



**KENTUCKY
POWER**

A unit of American Electric Power

Kentucky Power
P O Box 5190
101A Enterprise Drive
Frankfort, KY 40602
KentuckyPower.com

Elizabeth O'Donnell, Executive Director
Public Service Commission
Attn: Mr. John A. Rogness, Manager
P. O. Box 615
Frankfort, KY 40602-0615

RECEIVED

JUN 26 2007

**PUBLIC SERVICE
COMMISSION**

Re: KPSC Case No. 2007-00155

June 26, 2007

Dear Ms. O'Donnell:


On June 25, 2007, the Company filed responses to the Commission Staff's questions requested at the June 20, 2007 Informal Conference. On June 26, 2007, Mr. Rogness informed the Company that the Staff could not access the documents that were provided on the Flash Drive and requested that a paper copy of the information be submitted to the Commission. Attached for filing are the Company's response to Data Request No. 4. If you have you any questions, please call me at 502/696-7010.


Sincerely,

Errol K. Wagner
Director of Regulatory Services

Attachment (flash drive)

KPSC Case No. 2007-0015
 June 20, 2007 Informal C
 Item No. 4
 Page 1 of 2

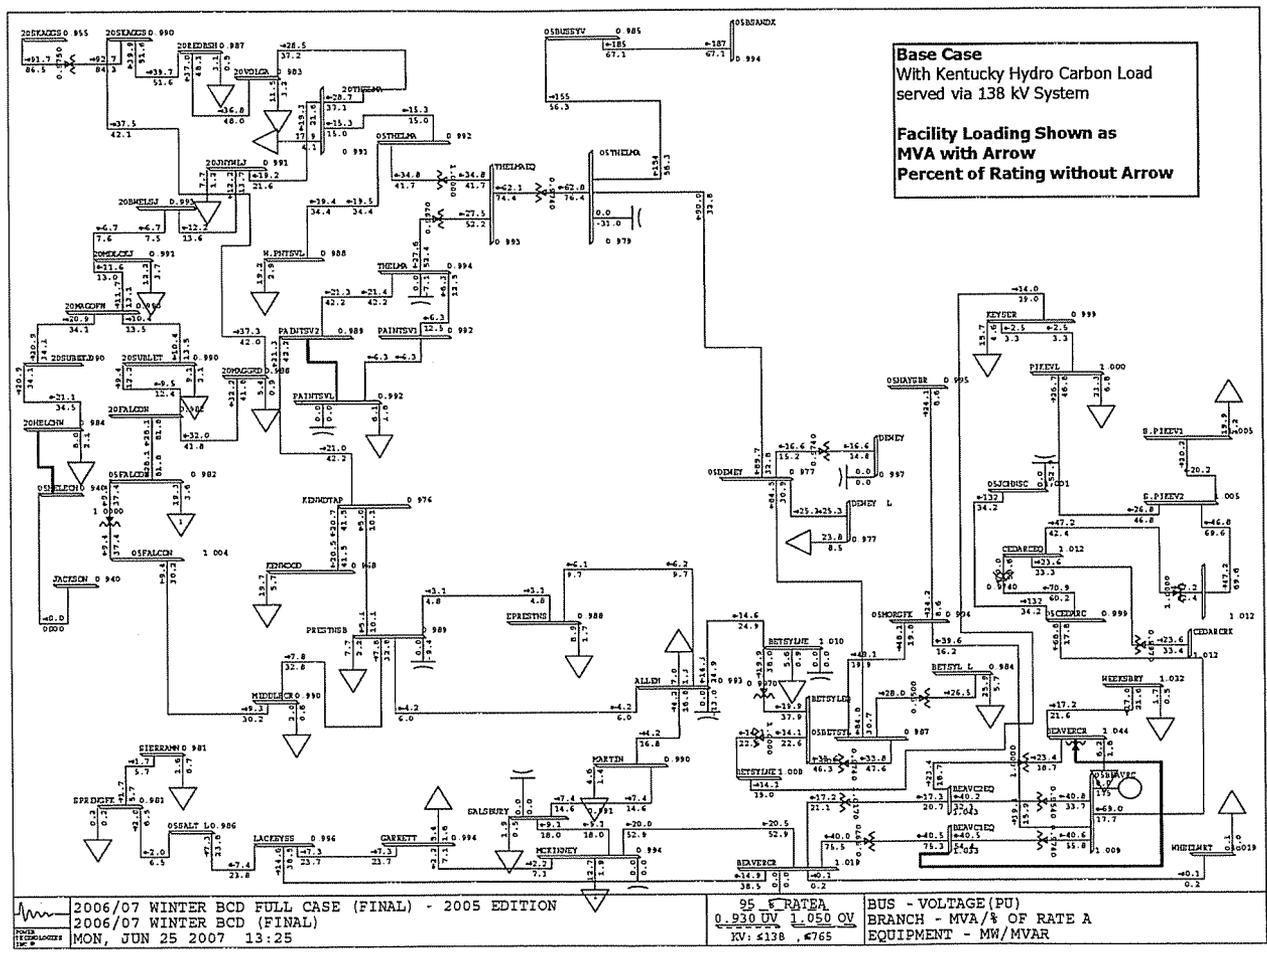

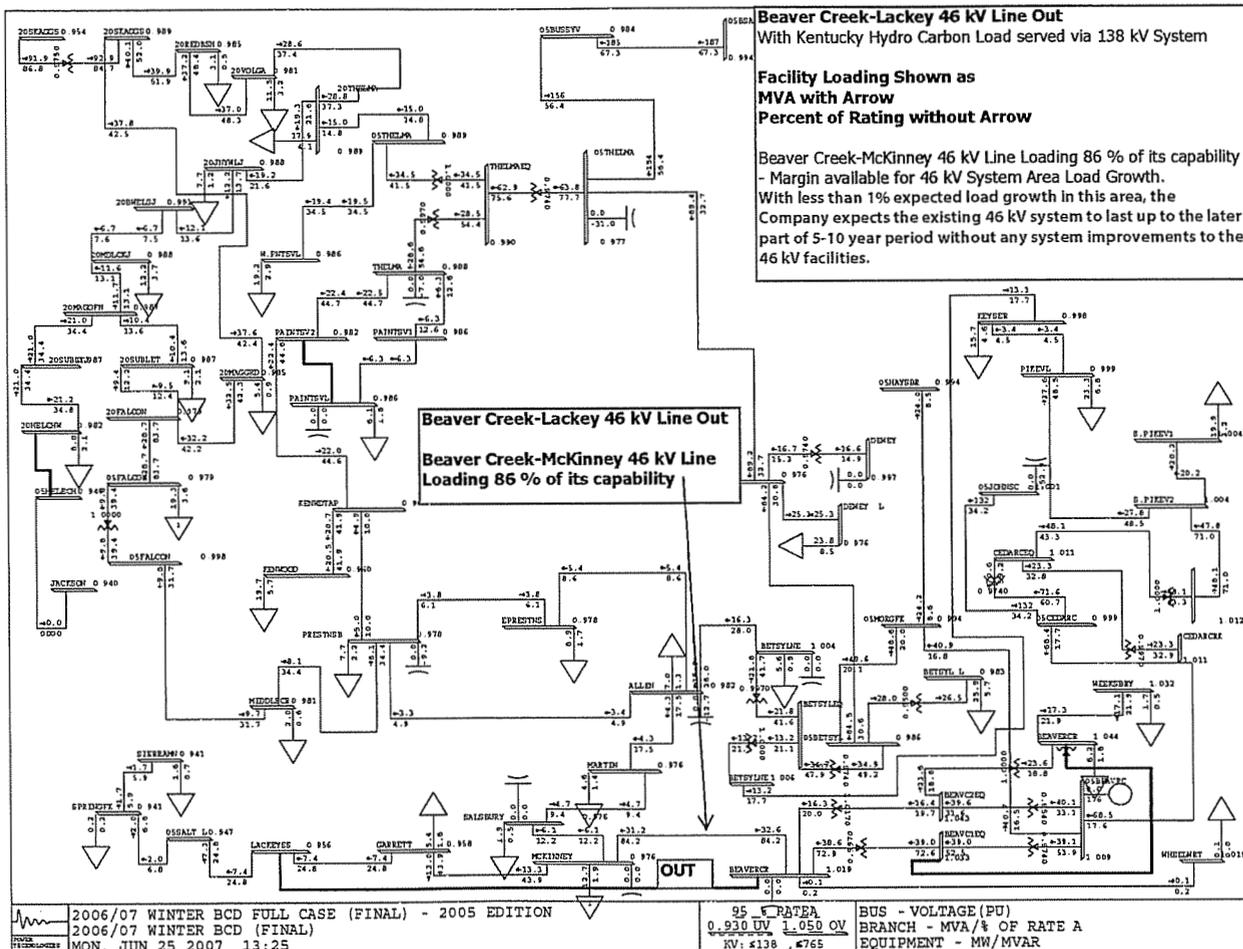

Beaver Creek-Lackey 46 kV Line Out
 With Kentucky Hydro Carbon Load served via 138 kV System

**Facility Loading Shown as
 MVA with Arrow
 Percent of Rating without Arrow**

Beaver Creek-McKinney 46 kV Line Loading 86 % of its capability - Margin available for 46 kV System Area Load Growth. With less than 1% expected load growth in this area, the Company expects the existing 46 kV system to last up to the later part of 5-10 year period without any system improvements to the 46 kV facilities.

KPSC Case No. 2007-00155
 June 20, 2007 Informal Co.
 Item No. 4
 Page 2 of 2