

COMMONWEALTH OF KENTUCKY  
BEFORE THE PUBLIC SERVICE COMMISSION

In the Matter of:

THE APPLICATION OF LAKE VILLAGE WATER )  
ASSOCIATION, INC. FOR A DEVIATION FROM )  
THE REQUIREMENTS OF 807 KAR 5:066, ) CASE NO. 91-023  
SECTION 5(4) REGARDING WATER STORAGE )

O R D E R

By application received January 18, 1991, Lake Village Water Association, Inc. ("Lake Village Water") requested a deviation from Commission Regulation 807 KAR 5:066, Section 5(4), which provides that each utility shall provide water storage to ensure a minimum of one day's supply of its average daily water usage. Lake Village Water states in its application that its average daily water usage, including unaccounted-for water, is approximately 261,800 gallons, and that its current water storage capacity is 47,000 gallons.

The Commission, having reviewed the application and being otherwise sufficiently advised, finds that:

1. Lake Village Water is not in compliance with Commission Regulation 807 KAR 5:066, Section 5(4).

2. Because of the time needed to plan, finance, and implement a program to construct water storage facilities, Lake Village Water should be given until July 1, 1994 to bring it within compliance of Commission Regulation 807 KAR 5:066, Section 5(4).


IT IS THEREFORE ORDERED that:

1. Lake Village Water be and it hereby is given until July 1, 1994 to comply with the provisions of 807 KAR 5:066, Section 5(4).


2. Lake Village Water shall take all necessary actions to bring its water storage facilities into compliance with Commission regulations prior to July 1, 1994.

Done at Frankfort, Kentucky, this 31st day of January, 1991.


PUBLIC SERVICE COMMISSION

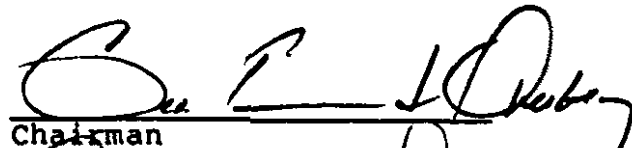

Chairman

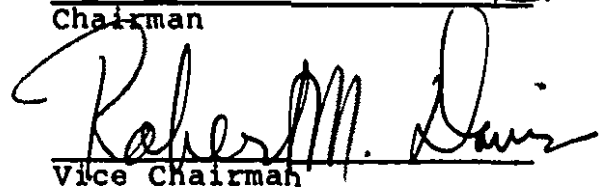

Vice Chairman

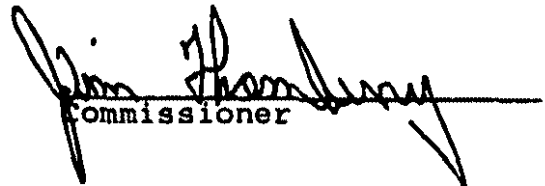

Commissioner

ATTEST:

  
Executive Director