

COMMONWEALTH OF KENTUCKY
BEFORE THE PUBLIC SERVICE COMMISSION

In the Matter of:

THE APPLICATION OF LOVELACEVILLE WATER)
COMPANY FOR A DEVIATION PURSUANT TO 807) CASE NO. 92-527
KAR 5:066, SECTION 4(4), REGARDING)
WATER STORAGE)

O R D E R

By application received November 23, 1992, Lovelaceville Water Company ("Lovelaceville Water") requested a deviation from Commission Regulation 807 KAR 5:066, Section 4(4), which provides that each utility shall provide water storage to ensure a minimum of one day's supply of its average daily water usage. Lovelaceville Water states in its application that its average daily water usage, including unaccounted-for water, is approximately 9,580 gallons, and that its current water storage capacity is 1,000 gallons.

The Commission, having reviewed the application and being otherwise sufficiently advised, finds that:

1. Lovelaceville Water is not in compliance with Commission Regulation 807 KAR 5:066, Section 4(4).

2. Because of the time needed to plan, finance, and implement a program to construct water storage facilities, Lovelaceville Water should be given until January 1, 1998 to bring it within compliance of Commission Regulation 807 KAR 5:066, Section 4(4).

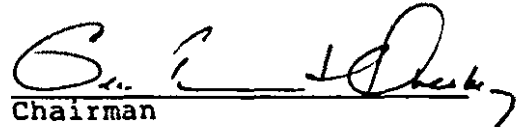
IT IS THEREFORE ORDERED that:

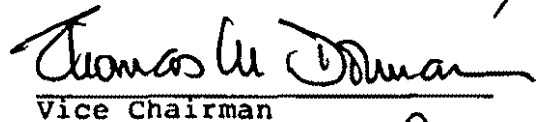
1. Lovelaceville Water be and it hereby is given until January 1, 1998 to comply with the provisions of 807 KAR 5:066, Section 4(4).

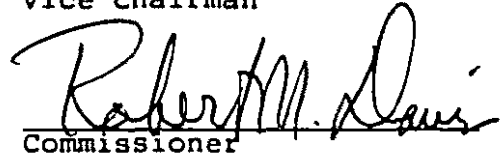
2. Lovelaceville Water shall take all necessary actions to bring its water storage facilities into compliance with Commission regulations prior to January 1, 1998.

Done at Frankfort, Kentucky, this 9th day of February, 1993.

PUBLIC SERVICE COMMISSION


Chairman


Vice Chairman


Commissioner

ATTEST:


Executive Director