



Matthew G. Bevin
Governor

Charles G. Snavelly
Secretary
Energy and Environment Cabinet

Commonwealth of Kentucky
Public Service Commission
211 Sower Blvd.
P.O. Box 615
Frankfort, Kentucky 40602-0615
Telephone: (502) 564-3940
Fax: (502) 564-3460
psc.ky.gov

Michael J. Schmitt
Chairman

Robert Cicero
Vice Chairman

Talina R. Mathews
Commissioner

March 12, 2019

PARTIES OF RECORD

Re: Case No. 2018-00372

The attached study titled, "Electric Vehicle Cost-Benefit Analysis: Plug-in Electric Vehicle Cost-Benefit Analysis: Kentucky" has been filed in the record of the above-referenced case.

If you have any questions, please contact Nancy J. Vinsel, Assistant General Counsel, at 502-782-2582.

Sincerely,

A handwritten signature in blue ink that reads "Gwen R. Pinson".

Gwen R. Pinson
Executive Director

njv

Attachment

Electric Vehicle Cost-Benefit Analysis

Plug-in Electric Vehicle Cost-Benefit Analysis: Kentucky



Contents

List of Figures	ii
List of Tables	ii
Executive Summary	ii
Study Results	1
Plug-in Electric Vehicles, Electricity Use, and Charging Load.....	2
<i>Vehicles and Miles Traveled</i>	2
<i>PEV Charging Electricity Use</i>	3
<i>PEV Charging Load</i>	4
Utility Customer Benefits	8
Kentucky Driver Benefits	11
Other Benefits	12
Total Societal Benefits	15
Study Methodology.....	17
References.....	19
Acknowledgements.....	20

List of Figures

Figure 1 NPV Cumulative Societal Net Benefits from KY PEVs	ii
Figure 2 NPV of Projected Life-time Utility Net Revenue per PEV	iii
Figure 3 Comparison of PEV Penetration Scenarios	1
Figure 4 Projected Kentucky Light Duty Fleet	2
Figure 5 Projected Kentucky Light Duty Fleet Vehicle Miles Traveled	3
Figure 6 Estimated Total Electricity Use in Kentucky	4
Figure 7 2040 Projected Kentucky PEV Charging Load, Baseline Charging (High PEV (80x50) scenario).....	5
Figure 8 2040 Projected Kentucky PEV Charging Load, Managed Charging (High PEV (80x50) scenario).....	6
Figure 9 PEV Charging Load in Dallas/Ft Worth and San Diego areas, EV Project	7
Figure 10 NPV of Projected Utility Net Revenue from Baseline PEV Charging	8
Figure 11 NPV of Projected Utility Revenue and Costs from Managed PEV Charging	9
Figure 12 Potential Effect of PEV Charging Net Revenue on Utility Customer Bills (nominal \$).....	10
Figure 13 Cumulative Gasoline Savings from PEVs in Kentucky	13
Figure 14 Projected GHG Emissions from the Light Duty Fleet in Kentucky	14
Figure 15 Projected NPV of Total Societal Benefits from Greater PEV use in KY – Baseline Charging.....	15
Figure 16 Projected NPV of Total Societal Benefits from Greater PEV use in KY – Managed Charging	16

List of Tables

Table 1 Projected Incremental Afternoon Peak Hour PEV Charging Load (MW).....	7
Table 2 Projected Fleet Average Vehicle Costs to Vehicle Owners (nominal \$)	11

About M.J. Bradley & Associates

M.J. Bradley & Associates, LLC (MJB&A), founded in 1994, is a strategic consulting firm focused on energy and environmental issues. The firm includes a multi-disciplinary team of experts with backgrounds in economics, law, engineering, and policy. The company works with private companies, public agencies, and non-profit organizations to understand and evaluate environmental regulations and policy, facilitate multi-stakeholder initiatives, shape business strategies, and deploy clean energy technologies.

Our multi-national client base includes electric and natural gas utilities, major transportation fleet operators, clean technology firms, environmental groups and government agencies.

We bring insights to executives, operating managers, and advocates. We help you find opportunity in environmental markets, anticipate and respond smartly to changes in administrative law and policy at federal and state levels. We emphasize both vision and implementation, and offer timely access to information along with ideas for using it to the best advantage.

© M.J. Bradley & Associates 2018


For questions or comments, please contact:

Dana Lowell
Senior Vice President
M.J. Bradley & Associates, LLC
+1 978 369 5533
dlowell@mjb Bradley.com

Executive Summary

This study estimated the costs and benefits of increased adoption of plug-in electric vehicles (PEVs) in the state of Kentucky. The study estimated the financial benefits that would accrue to all electric utility customers in Kentucky due to greater utilization of the electric grid during low load hours and resulting increased utility revenues from PEV charging. In addition, the study estimated the annual financial benefits to Kentucky drivers from owning PEVs—from fuel and maintenance cost savings compared to owning gasoline vehicles. The study also estimated reductions in gasoline consumption, and associated greenhouse gas (GHG) and nitrogen oxide (NOx) emission reductions from greater use of PEVs instead of gasoline vehicles.

Figure 1 NPV Cumulative Societal Net Benefits from KY PEVs

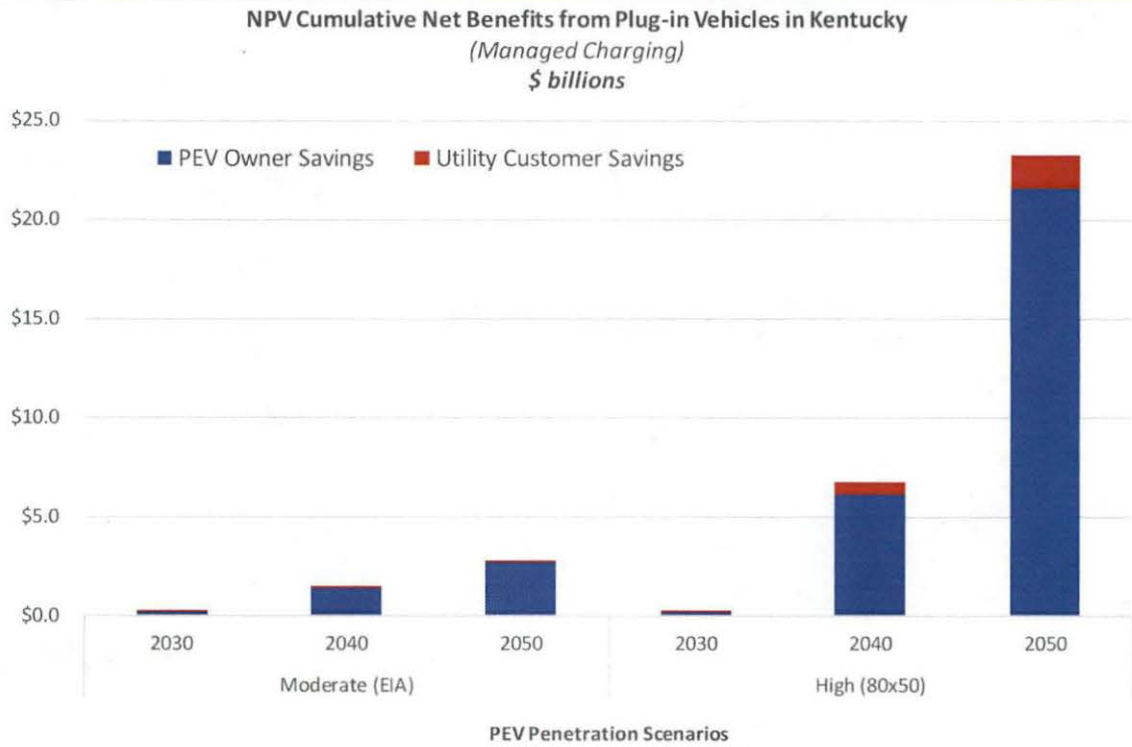

This study evaluated PEV costs and benefits for two distinct levels of PEV adoption – essentially a “business as usual” scenario of modest PEV penetration (EIA), and a much more aggressive scenario based on the PEV penetration that would be required to get the state onto a trajectory to reduce light-duty GHG emissions by 70 – 80 percent from current levels by 2050 (80x50). The levels of PEV penetration in the high 80x50 scenario are unlikely to be achieved without aggressive policy action at the state and local level, to incentivize individuals to purchase PEVs, and to support the necessary roll-out of PEV charging infrastructure.

As shown in Figure 1, if Kentucky PEV adoption follows the moderate trajectory currently assumed by the Energy Information Administration (EIA), the net present value of **cumulative net benefits from greater PEV use in the state will exceed \$2.8 billion state-wide by 2050.**¹ Of these total net benefits:

¹ Using a 3% discount rate


- \$0.1 billion will accrue to electric utility customers in the form of reduced electric bills, and
- \$2.7 billion will accrue directly to Kentucky drivers in the form of reduced annual vehicle operating costs.

Also shown in Figure 1, if PEV sales in Kentucky were high enough to get the state onto a trajectory to reduce light-duty GHG emissions by 70 – 80 percent from current levels by 2050 (80x50), the net present value of **cumulative net benefits from greater PEV use in Kentucky could exceed \$23.2 billion statewide by 2050**. Of these total net benefits:

- \$1.6 billion would accrue to electric utility customers in the form of reduced electric bills, and
- \$21.6 billion would accrue directly to Kentucky drivers in the form of reduced annual vehicle operating costs.

Utility customer savings result from net revenue received by the state’s utilities, from selling electricity to charge PEVs. This net revenue is net of additional costs that would be incurred by utilities to secure additional generating capacity, and to upgrade distribution systems, to handle the incremental load from PEV charging. The NPV of projected life-time utility net revenue per PEV is shown in Figure 2. Assuming a ten-year life, the average PEV in Kentucky in 2030 is projected to increase utility net revenue by about \$199 over its life-time, if charging is managed. PEVs in service in 2050 are projected to increase utility net revenue on average by about \$214 over their life time (NPV) if charging is managed.

Figure 2 NPV of Projected Life-time Utility Net Revenue per PEV

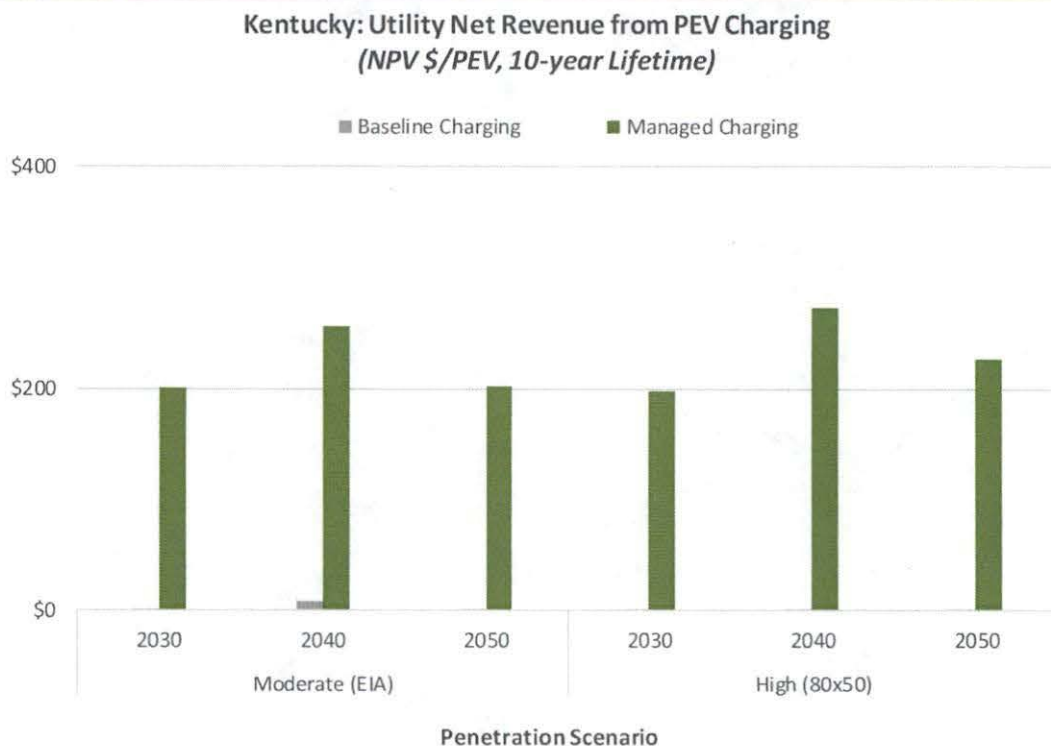

In addition, by 2050 PEV owners are projected to save more than \$1,050 per vehicle (nominal \$) in annual operating costs, compared to owning gasoline vehicles. A large portion of this direct financial benefit to Kentucky drivers derives from reduced gasoline use—from purchase of lower cost, regionally produced electricity instead of gasoline imported to the state. Under the Moderate PEV (EIA) scenario,

PEVs will reduce cumulative gasoline use in the state by more than 0.8 billion gallons through 2050 – this cumulative gasoline savings grows to 9.9 billion gallons through 2050 under the high PEV (80x50) scenario. In 2050, annual average gasoline savings will be approximately 126 gallons per PEV under the Moderate PEV (EIA) scenario, while projected savings under the High PEV (80x50) scenario are nearly 165 gallons per PEV.

This projected gasoline savings will help to promote energy security and independence, and will keep more of vehicle owners' money in the local economy, thus generating even greater economic impact. Studies in other states have shown that the switch to PEVs can generate up to \$570,000 in additional economic impact for every million dollars of direct savings, resulting in up to 25 additional jobs in the local economy for every 1,000 PEVs in the fleet [1].

In addition, this reduction in gasoline use will reduce cumulative net GHG emissions by over 8.5 million metric tons² through 2050 under the moderate PEV scenario, and over 103 million metric tons under the high PEV scenario. The switch from gasoline vehicles to PEVs is also projected to reduce annual NOx emissions in the state by over 240 tons in 2050 under the moderate PEV (EIA) scenario, and by over 3,740 tons under the high PEV (80x50) scenario.


² Net of emissions from electricity generation

Study Results

This section summarizes the results of this study, including: the projected number of PEVs; electricity use and load from PEV charging; projected gasoline savings and GHG reductions compared to continued use of gasoline vehicles; financial benefits to utility customers from increased electricity sales; and projected financial benefits to Kentucky drivers compared to owning gasoline vehicles. All costs and financial benefits are presented as net present value (NPV), using a 3 percent discount rate.

Two different PEV penetration levels between 2030 and 2050 are utilized to estimate costs and benefits.³ The “Moderate PEV” scenario is based on current projections of annual PEV sales from the Energy Information Administration (EIA). The “High PEV” scenario is based on the level of PEV penetration that would be required to get onto a trajectory to reduce light-duty GHG emissions in the state by 70 - 80 percent from current levels by 2050. The moderate PEV (EIA) scenario is essentially a “business as usual” scenario that continues current trends. However, the significantly higher levels of PEV penetration in the high 80x50 scenario are unlikely to be achieved without additional aggressive policy action at the state and local level, to incentivize individuals to purchase PEVs, and to support the necessary roll-out of PEV charging infrastructure. See Figure 3 for a comparison of the two scenarios through 2050.

Figure 3 Comparison of PEV Penetration Scenarios

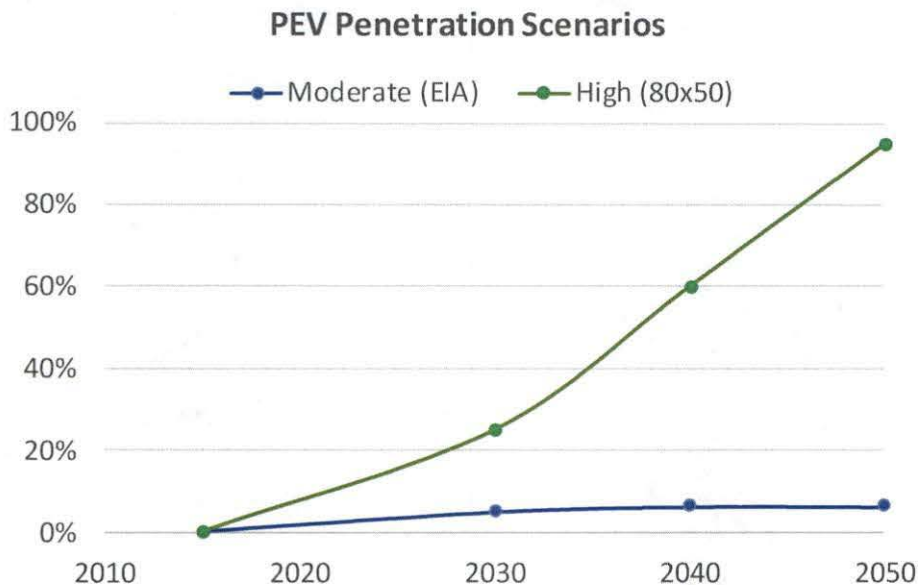

³ PEVs include battery-electric vehicles (BEV) and plug-in hybrid vehicles (PHEV). This study focused on passenger vehicles and trucks; there are opportunities for electrification of non-road equipment and heavy-duty trucks and buses, but evaluation of these applications was beyond the scope of this study.


Plug-in Electric Vehicles, Electricity Use, and Charging Load

Vehicles and Miles Traveled

The projected number of PEVs and conventional gasoline vehicles in the Kentucky light duty fleet⁴ under each PEV penetration scenario is shown in Figure 4, and the projected annual miles driven by these vehicles is shown in Figure 5. Under the Moderate PEV (EIA) scenario, the number of PEVs registered in Kentucky would increase from approximately 1,400 today to 236,000 in 2030, 314,500 in 2040, and 330,700 in 2050. Under the High PEV (80x50) scenario there would be 1.2 million PEVs in Kentucky by 2030, rising to 3.0 million in 2040, and 5.0 million in 2050. This equates to 25 percent of in-use light duty vehicles in Kentucky in 2030, rising to 60 percent in 2040 and 95 percent in 2050.⁵

This analysis estimates that under the High PEV (80x50) scenario Kentucky will reduce light-duty fleet gasoline consumption in 2050 by 52 percent compared to a baseline with no PEVs, due to 87 percent of fleet miles being driven by PEVs on electricity (Figure 5). However, to achieve this level of electric miles, 95 percent of light-duty vehicles will be PEVs, including PHEVs (Figure 4).

Figure 4 Projected Kentucky Light Duty Fleet

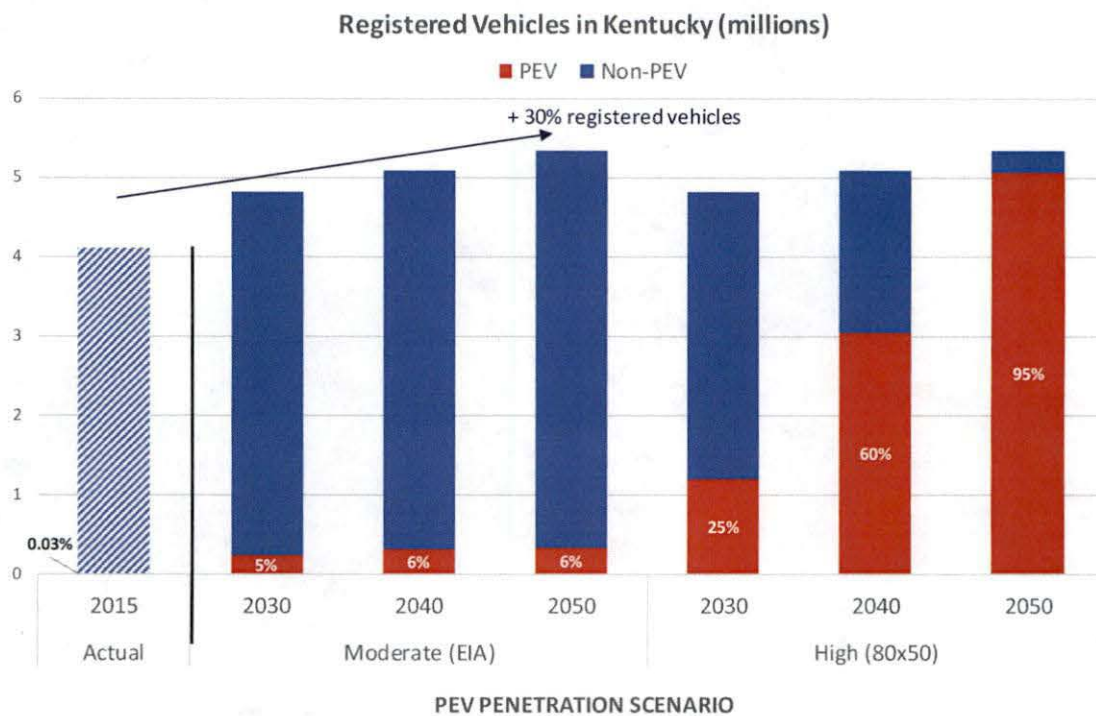


⁴ This analysis only includes cars and light trucks. It does not include medium- or heavy-duty trucks and buses.

⁵ Note that under both PEV penetration scenarios the percentage of total VMT driven by PEVs on electricity each year is lower than the percentage of PEVs in the fleet. This is because PHEVs are assumed to have a “utility factor” less than one – i.e., due to range restrictions a PHEV cannot convert 100 percent of the miles driven annually by a baseline gasoline vehicle into miles powered by grid electricity. In this analysis PHEVs are assumed to have an average utility factor of 85 percent.

Figure 5

Projected Kentucky Light Duty Fleet Vehicle Miles Traveled (million miles)

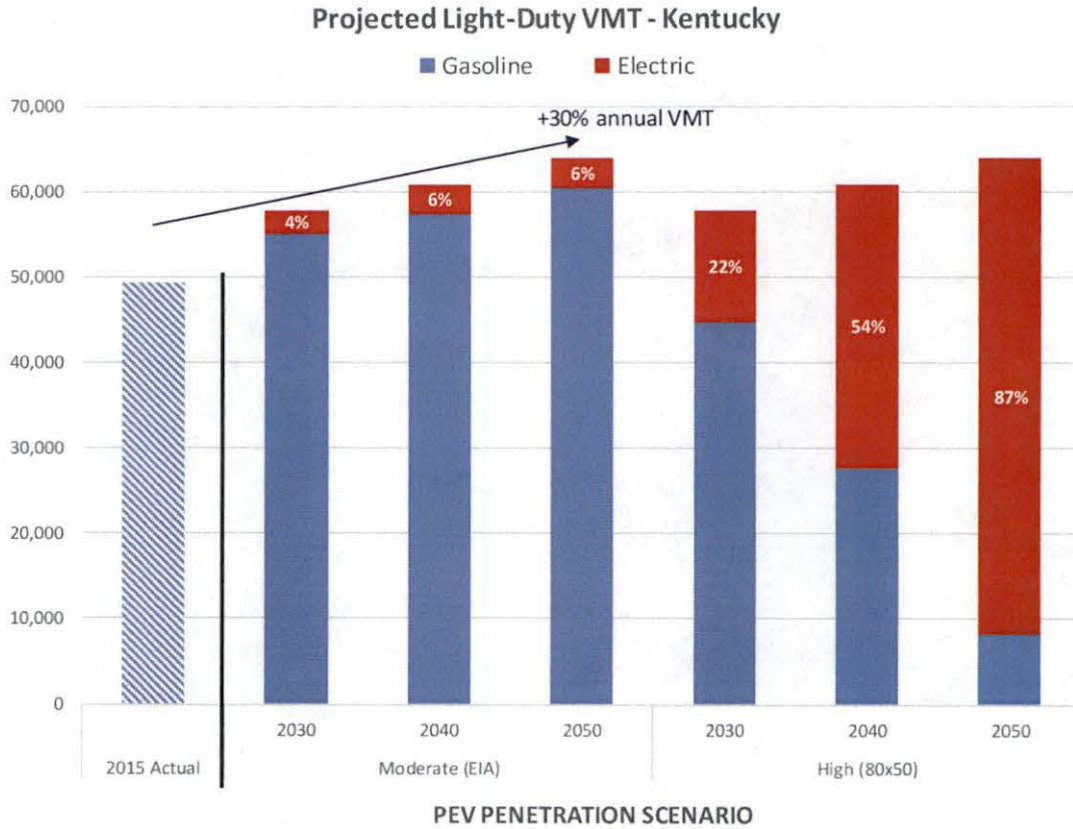


PEV Charging Electricity Use

The estimated total PEV charging electricity used in Kentucky each year under the PEV penetration scenarios is shown in Figure 6.

In Figure 6, projected baseline electricity use without PEVs is shown in blue and the estimated incremental electricity use for PEV charging is shown in red. State-wide electricity use in Kentucky is currently 71 million MWh per year. Annual electricity use is projected to increase to 81 million MWh in 2030 and continue to grow after that, reaching 92 million MWh in 2050 (29 percent greater than 2015 levels).

Figure 6

Estimated Total Electricity Use in Kentucky

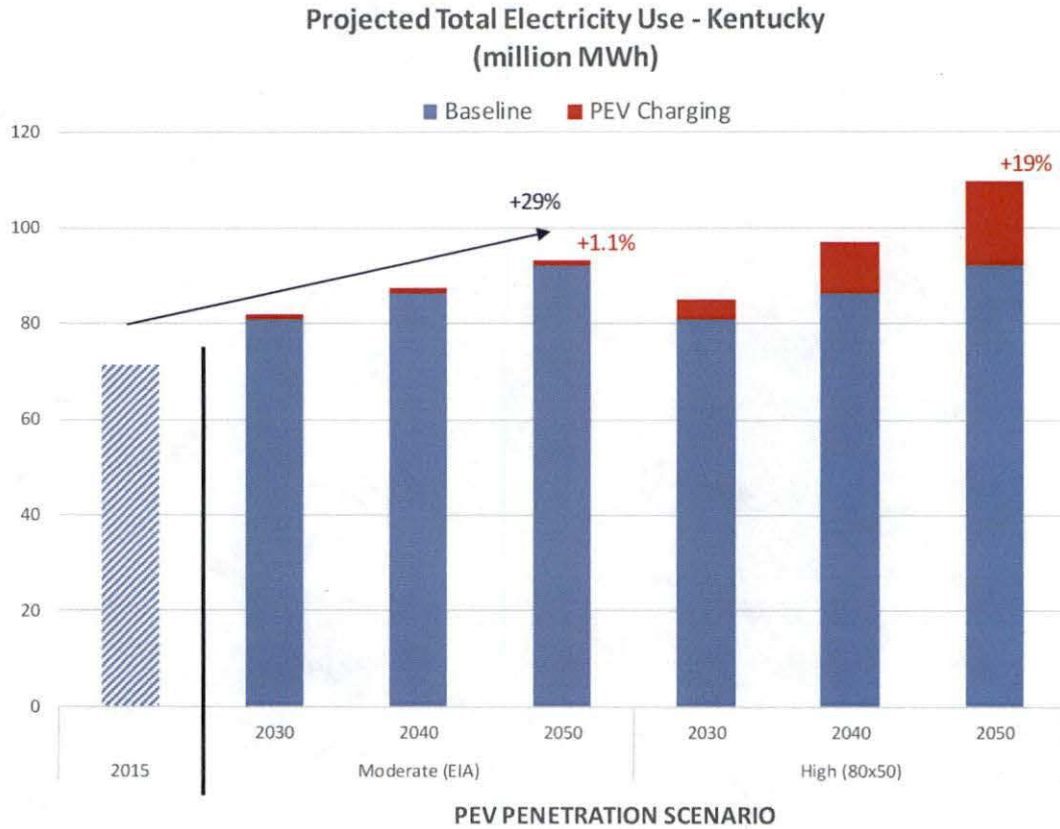

Under the Moderate PEV penetration scenario, electricity used for PEV charging is projected to be 0.8 million MWh in 2030 – an increase of about 1.0 percent over baseline electricity use. By 2050, electricity for PEV charging is projected to grow to 1.0 million MWh – an increase of 1.1 percent over baseline electricity use. Under the High PEV (80x50) scenario electricity used for PEV charging is projected to be 4.1 million MWh in 2030, growing to 17.5 million MWh and adding 19 percent to baseline electricity use in 2050.

PEV Charging Load


This analysis evaluated the effect of PEV charging on the Kentucky electric grid under two different charging scenarios. Under both scenarios 77 percent of all PEVs are assumed to charge exclusively at home and 23 percent are assumed to charge at locations other than at home (i.e. at work or at other “public” chargers). Under the baseline charging scenario all Kentucky drivers who charge at home are assumed to plug-in their vehicles and start charging as soon as they arrive at home each day, while under the managed charging scenario a significant portion of PEV owners are assumed to participate in a utility managed charging program to minimize PEV charging load in the late afternoon and early evening when other electricity demand is high.⁶

⁶ Utilities have many policy options to incentivize managed PEV charging. This analysis does not compare the efficacy of different options. For this analysis, managed charging is modeled as 85% of PEV owners that arrive home between noon and 11 pm delaying the start of charging until between Midnight and 2 am. This is only one of many managed charging program options that are available to utilities.

See Figure 7 (baseline) and Figure 8 (managed) for a comparison of PEV charging load under the baseline and managed charging scenarios, using the 2040 High (80x50) PEV penetration scenario as an example. In each of these figures the 2016 Kentucky 95th percentile load (MW)⁷ by time of day is plotted in orange, and the projected incremental load due to PEV charging is plotted in grey.

In 2016, daily electric load in Kentucky was generally less than 10,000 MW from midnight to 5 AM, ramping up to about 11,500 MW at 8 or 9 AM, and continuing to climb up to peak at approximately 13,700 MW between 3 PM and 5 PM, and then falling off through the evening hours.⁸

Figure 7 2040 Projected Kentucky PEV Charging Load, Baseline Charging (High PEV [80x50] scenario)

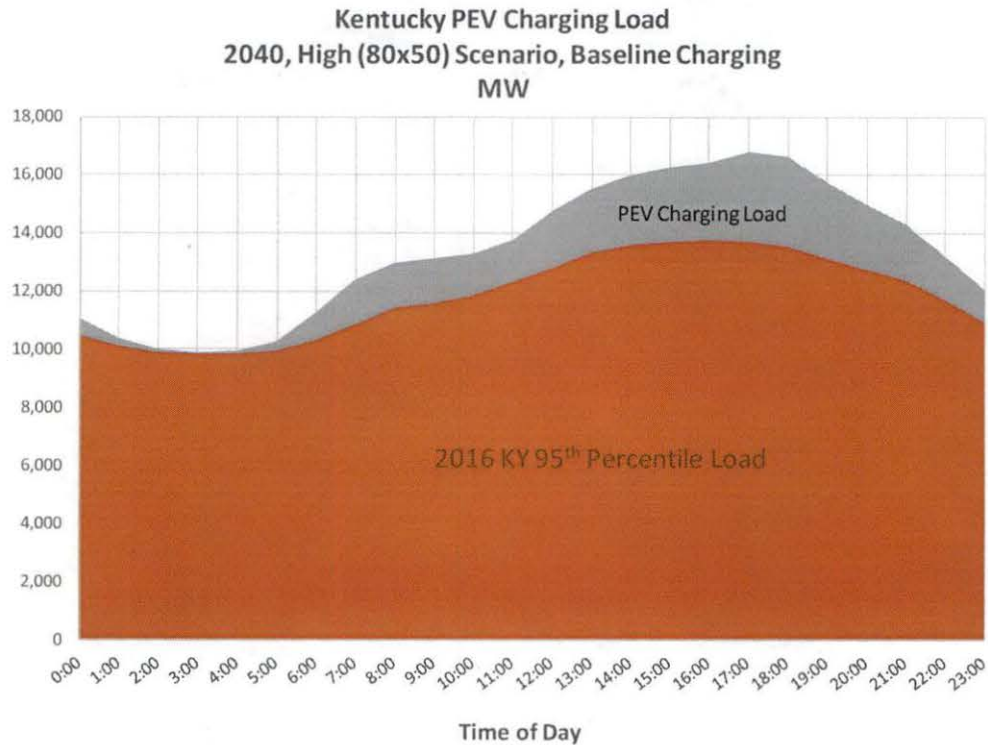


As shown in Figure 7, baseline PEV charging is projected to add load primarily between 8 AM and 8 PM, as some people charge at work early in the day, but most charge at home in the late afternoon and early evening. Under the baseline charging scenario, the PEV charging peak coincides with the existing summer afternoon peak load period between 3 PM and 5 PM.

⁷ For each hour of the day actual load in 2016 was higher than the value shown on only 5 percent of days (18 days).

⁸ In Figures 7 and 8, 95th Percentile Load is shown for the entire state of Kentucky across the entire year.

Figure 8

2040 Projected Kentucky PEV Charging Load, Managed Charging (High PEV [80x50] scenario)

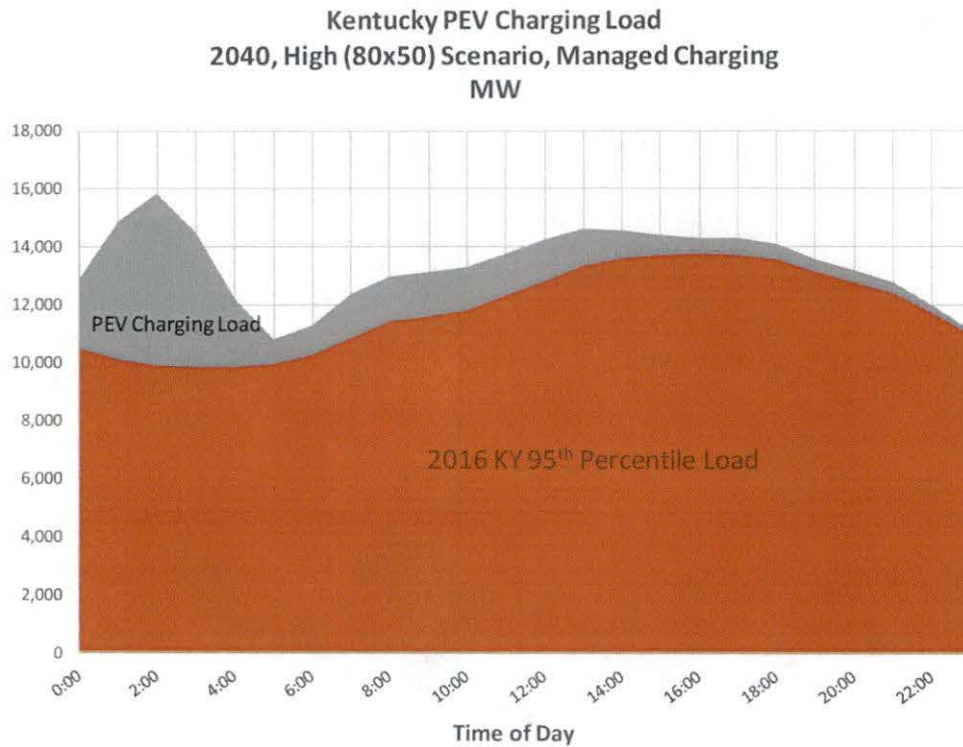


As shown in Figure 8, managed charging significantly reduces the incremental PEV charging load during the summer afternoon peak load period, but creates a secondary peak in the early morning hours, between midnight and 4 AM. The shape of this early morning peak can potentially be controlled based on the design of managed charging incentives.

These baseline and managed load shapes are consistent with real world PEV charging data collected by the EV Project, as shown in Figure 9. In Figure 9 the graph on the left shows PEV charging load in the Dallas/Ft Worth area where no managed charging incentive was offered to drivers. The graph on the right shows PEV charging load in the San Diego region, where the local utility offered drivers a time-of-use rate with significantly lower costs (\$/kWh) for charging during the “super off-peak” period between midnight and 5 a.m. [2]

Figure 9

PEV Charging Load in Dallas/Ft Worth and San Diego areas, EV Project

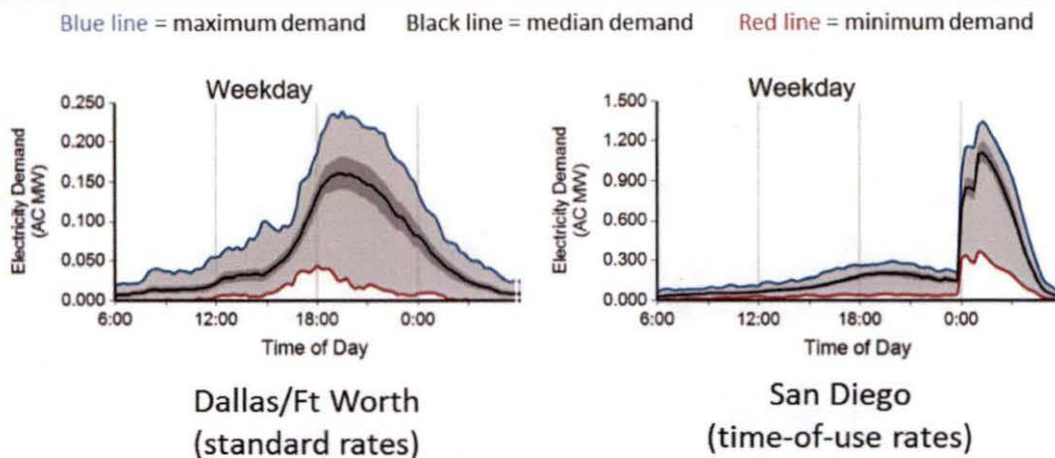

See Table 1 for a summary of the projected incremental afternoon peak hour load (MW) in Kentucky, from PEV charging under each penetration and charging scenario. This table also includes a calculation of how much this incremental PEV charging load would add to the 2016 95th percentile peak hour load. Under the Moderate PEV (EIA) penetration scenario, PEV charging would add 241 MW of load during the afternoon peak load period on a typical weekday in 2030, which would increase the 2016 baseline peak load by about 1.8 percent. By 2050, the afternoon incremental PEV charging load would increase to 303 MW, adding 2.2 percent to the 2016 baseline afternoon peak. By comparison the afternoon peak hour PEV charging load in 2030 would be only 46 MW for the managed charging scenario, increasing to 60 MW in 2050.

Under the High PEV (80x50) penetration scenario, baseline PEV charging would increase the total 2016 afternoon peak electric load by about 38 percent in 2050, while managed charging would only increase it by about 7 percent.⁹

Table 1 Projected Incremental Afternoon Peak Hour PEV Charging Load (MW)

		Moderate PEV (EIA)			High PEV (80x50)		
		2030	2040	2050	2030	2040	2050
Baseline Charging	PEV Charging (MW)	241	288	303	1,102	3,108	5,172
	<i>Increase relative to 2016 Peak</i>	1.8%	2.1%	2.2%	8.0%	22.6%	37.6%
Managed Charging	PEV Charging (MW)	46	57	60	217	592	986
	<i>Increase relative to 2016 Peak</i>	0.3%	0.4%	0.4%	1.6%	4.3%	7.2%

⁹ Given projected significant increases in total state-wide electricity use through 2050, baseline peak load (without PEVs) is also likely to be higher in 2050 than 2016 peak load; as such the percentage increase in baseline peak load due to high levels of PEV penetration is likely to be lower than that shown in Table 1. The incremental costs of adding this peak capacity are accounted for in the analysis. As discussed below, even when accounting for these costs there are still net rate-payer benefits from high levels of PEV penetration. As the analysis shows, the net rate-payer benefits are higher with managed charging, because the cost of serving the incremental peak load is lower.

As discussed below, increased peak hour load increases a utility’s cost of providing electricity, and may result in the need to upgrade distribution infrastructure. As such, managed PEV charging can provide additional net benefits to all utility customers, by reducing the cost of providing electricity used to charge PEVs.


Utility Customer Benefits

The estimated NPV of annual revenues and costs in 2030, 2040, and 2050, for Kentucky’s electric utilities to supply electricity to charge PEVs under each penetration scenario are shown in Figure 10, assuming the baseline PEV charging scenario.

Under the Moderate PEV penetration scenario, the NPV of annual revenue from electricity sold for PEV charging in Kentucky is projected to total \$63 million in 2030 and in 2050. Under the High PEV (80x50) scenario, the NPV of annual utility revenue from PEV charging is projected to total \$309 million in 2030, rising to \$1.0 billion in 2050.

In Figure 10, projected annual utility revenue is shown in dark blue. The different elements of incremental annual cost that utilities would incur to purchase and deliver additional electricity to support PEV charging are shown in red (generation), yellow (transmission), orange (peak capacity), and purple (infrastructure upgrade cost). Generation and transmission costs are proportional to the total power (MWh) used for PEV charging, while peak capacity costs are proportional to the incremental peak load (MW) imposed by PEV charging. Infrastructure upgrade costs are costs incurred by the utility to upgrade their distribution infrastructure to handle the increased peak load imposed by PEV charging.

Figure 10 NPV of Projected Annual Utility Revenue and Costs from Baseline PEV Charging

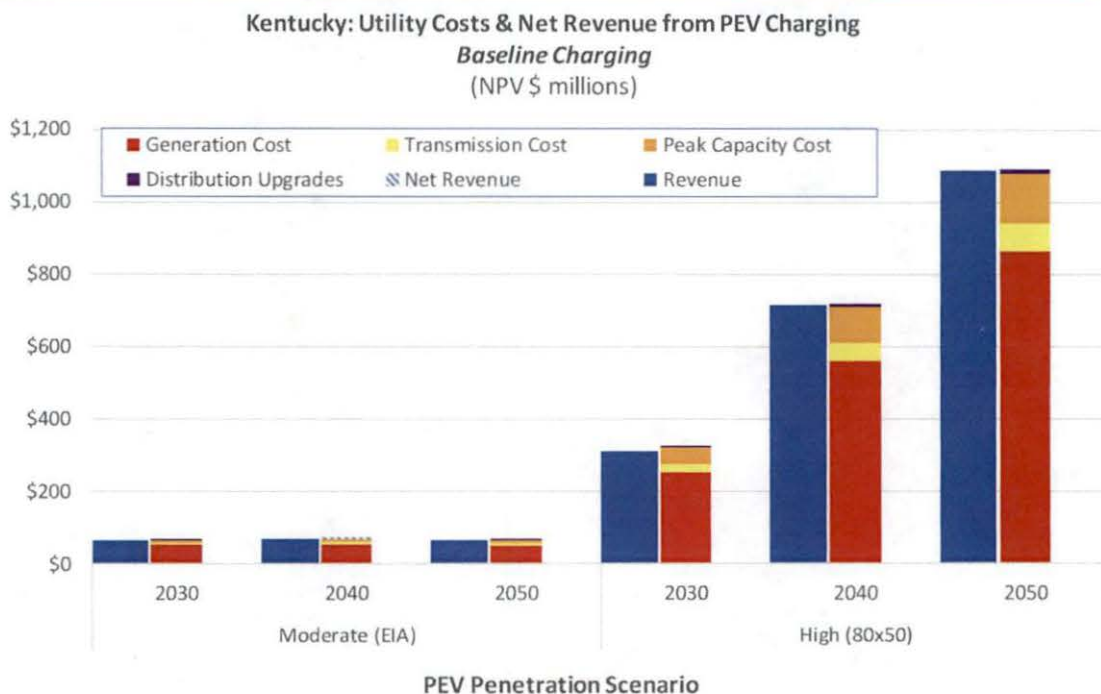

As shown in Figure 10, for both the Moderate PEV and High PEV (80x50) penetration scenarios, under the baseline charging scenario annual utility revenue from PEV charging is marginally lower than the annual incremental costs of serving the PEV charging load, resulting in zero or just slightly negative “net revenue”


(revenue minus costs) to the utility. This is due to the annual incremental cost of serving PEV charging peak load (cost of new capacity and distribution upgrades), which is slightly higher than the net revenue that utilities will receive under current rate structures (net of generation and transmission costs). Net revenue is normally shown as striped light blue bars and represents what utilities would realize from selling additional electricity for PEV charging. Under the Moderate PEV penetration scenario, the NPV of net annual revenue in Kentucky is projected to be -\$4 million in 2030, falling to -\$0.4 million in 2050. Under the High PEV (80x50) scenario, the NPV of utility net annual revenue from PEV charging is projected to total -\$14 million in 2030, falling to -\$6 million in 2050.

In Kentucky, utilities will need to rely on some form of managed PEV charging to limit incremental peak capacity costs, which are a major contributor to the negative net revenue shown above.

Figure 11 summarizes the NPV of projected annual utility revenue, costs, and net revenue for managed charging under each PEV penetration scenario. Compared to baseline charging (Figure 10) projected annual revenue, and projected annual generation and transmission costs are the same, but projected annual peak capacity and infrastructure costs are lower due to a smaller incremental peak load (see Table 1).

Compared to baseline charging, managed charging provides positive annual utility net revenue (NPV) for both penetration scenarios for all years. Managed charging increases utility net revenue to \$5 million in 2030 and \$7 million in 2050 under the Moderate PEV penetration scenario, due to lower costs. Under the High PEV (80x50) scenario, managed charging will increase the NPV of annual utility net revenue to \$24 million in 2030 and \$115 million in 2050. The NPV of projected annual utility net revenue averages \$21 per PEV in 2030, and \$21 - \$24 per PEV in 2050 if charging is managed.

Figure 11 NPV of Projected Annual Utility Revenue and Costs from Managed PEV Charging

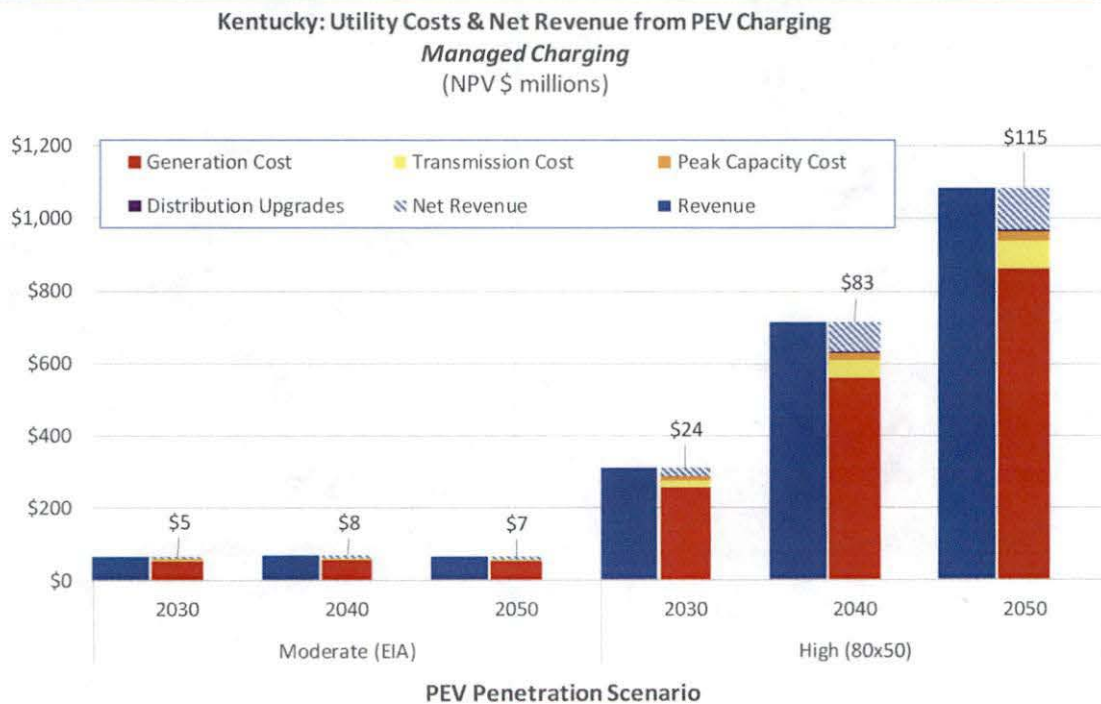


In general, a utility’s costs to maintain their distribution infrastructure increase each year with inflation, and these costs are passed on to utility customers in accordance with rules established by the Kentucky Public Service Commission (PSC), via periodic increases in residential and commercial electric rates. However, under the PSC

rules net revenue from additional electricity sales generally offset the allowable costs that can be passed on via higher rates. As such, the majority of projected utility net revenue from increased electricity sales for PEV charging (with managed charging) would in fact be passed on to utility customers in Kentucky, not retained by the utility companies.

Under current rate structures this net revenue would in effect put downward pressure on future rates, delaying or reducing future rate increases, thereby reducing electric bills for all customers. See Figure 12 for a summary of how the projected utility net revenue from PEV charging could affect average annual residential electricity bills for all Kentucky electric utility customers.¹⁰ As shown in the figure, under the High PEV (80x50) scenario projected average electric rates in Kentucky could be reduced up to 1.7 percent in 2050 due to net revenue from PEV charging, resulting in an annual savings of approximately \$39 (nominal dollars) per household in Kentucky. As discussed previously, baseline charging behavior results in negative net revenue under both penetration scenarios, which is why there are no utility customer savings in the figure.

It must be noted that how utility net revenue from PEV charging gets distributed is dependent on rate structure. Potential changes to current rates - to specifically incentivize off-peak PEV charging - could shift some or all of this benefit to PEV owners, thus reducing their electricity costs for vehicle charging without reducing costs for non-PEV owners. In either case, with even modest efforts to manage PEV charging rate payers who do not own a PEV will not be harmed by transportation electrification, and may benefit indirectly even if they continue to own gasoline vehicles.

Figure 12 Potential Effect of PEV Charging Net Revenue on Utility Customer Bills (nominal \$)

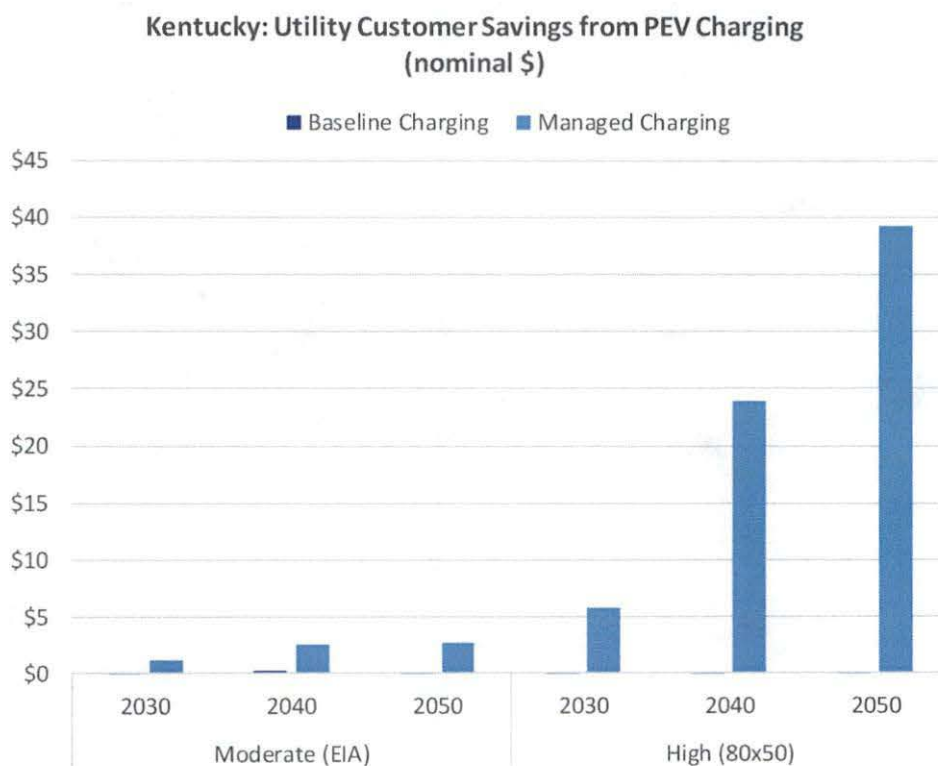

¹⁰ Based on 2016 average electricity use of 13,305 kWh per housing unit in Kentucky

Kentucky Driver Benefits

Current PEVs are more expensive to purchase than similar sized gasoline vehicles, but they are eligible for various government purchase incentives, including up to a \$7,500 federal tax credit. These incentives are important to spur an early market, but as described below PEVs are projected to provide a lower total cost of ownership than conventional vehicles in Kentucky by about 2035, even without government purchase subsidies.

The largest contributor to incremental purchase costs for PEVs compared to gasoline vehicles is the cost of batteries. Battery costs for light-duty plug-in vehicles have fallen from over \$1,000/kWh to less than \$300/kWh in the last six years; many analysts and auto companies project that battery prices will continue to fall – to below \$110/kWh by 2025, and below \$75/kWh by 2030. [3]

Based on these battery cost projections, this analysis projects that the average annual cost of owning a PEV in Kentucky will fall below the average cost of owning a gasoline vehicle by 2035, even without government purchase subsidies.¹¹ See Table 2 which summarizes the average projected annual cost of Kentucky PEVs and gasoline vehicles under each penetration scenario.

All costs in Table 2 are in nominal dollars, which is the primary reason why costs for both gasoline vehicles and PEVs are higher in 2040 and 2050 than in 2030 (due to inflation). In addition, the penetration scenarios assume that the relative number of PEV cars and higher cost PEV light trucks will change over time; in particular the High PEV (80x50) scenario assumes that there will be a significantly higher percentage of PEV light trucks in the fleet in 2050 than in 2030, which further increases the average PEV purchase cost in 2050 compared to 2030.

Table 2 Projected Fleet Average Vehicle Costs to Vehicle Owners (nominal \$)

GASOLINE VEHICLE		Moderate (EIA)			High (80x50)		
		2030	2040	2050	2030	2040	2050
Vehicle Purchase	\$/yr	\$5,257	\$5,855	\$7,167	\$4,454	\$6,125	\$8,376
Gasoline	\$/yr	\$1,228	\$1,396	\$1,673	\$1,198	\$1,499	\$1,972
Maintenance	\$/yr	\$274	\$332	\$410	\$272	\$340	\$432
TOTAL ANNUAL COST	\$/yr	\$6,759	\$7,583	\$9,251	\$5,925	\$7,964	\$10,780

PEV -KY		Moderate (EIA)			High (80x50)		
		2030	2040	2050	2030	2040	2050
Baseline Charging/Standard Rate							
Vehicle Purchase	\$/yr	\$5,257	\$5,855	\$7,167	\$5,044	\$6,436	\$8,577
Electricity	\$/yr	\$412	\$460	\$538	\$400	\$490	\$602
Gasoline	\$/yr	\$82	\$98	\$115	\$80	\$104	\$133
Personal Charger	\$/yr	\$81	\$99	\$122	\$81	\$99	\$122
Maintenance	\$/yr	\$168	\$204	\$251	\$167	\$207	\$259
TOTAL ANNUAL COST	\$/yr	\$6,000	\$6,714	\$8,194	\$5,772	\$7,335	\$9,693

Savings per PEV	\$/yr	\$759	\$869	\$1,057	\$153	\$629	\$1,087
------------------------	--------------	--------------	--------------	----------------	--------------	--------------	----------------

As shown in Table 2, under the High PEV Scenario (80x50) even in 2050 average PEV purchase costs are projected to be higher than average purchase costs for gasoline vehicles (with no government subsidies), but the annualized effect of this incremental purchase cost is outweighed by significant fuel cost savings, as well as

¹¹ The analysis assumes that all battery electric vehicles in-use after 2030 will have 200-mile range per charge and that all plug-in hybrid vehicles will have 50-mile all-electric range.

savings in scheduled maintenance costs. For the Moderate PEV Scenario in 2030, the average Kentucky PEV owner is projected to have annual operating savings of \$759 due to reduced maintenance as well as electricity costs being lower than gasoline¹². For both scenarios, this annual savings is projected to increase to \$1,050 - \$1,090 per PEV per year by 2050, as projected gasoline prices continue to increase faster than projected electricity prices.

The NPV of total annual cost savings to Kentucky drivers from greater PEV ownership are projected to be \$115 million in 2030 rising to \$124 million in 2050 under the moderate PEV penetration scenario. Under the High PEV (80x50) scenario, the NPV of total annual cost savings to Kentucky drivers from greater PEV ownership are projected to be \$118 million in 2030, rising to \$2.0 billion in 2050.

Other Benefits

Energy Security and Emissions Reductions

Along with the financial benefits to electric utility customers and PEV owners described above, light-duty vehicle electrification can provide additional benefits, including significant reductions in gasoline fuel use and transportation sector emissions.

The estimated cumulative fuel savings (barrels of gasoline¹³) from PEV use in Kentucky under each penetration scenario are shown in Figure 13. Annual fuel savings under the Moderate PEV penetration scenario are projected to total 0.9 million barrels in 2030, with cumulative savings of more than 20 million barrels by 2050. For the High PEV (80x50) scenario, annual fuel savings in 2030 are projected to be 4.2 million barrels, and by 2050 cumulative savings will exceed 236 million barrels.


These fuel savings can help put the U.S. on a path toward energy independence, by reducing the need for imported petroleum. In addition, a number of studies have demonstrated that EVs can generate significantly greater local economic impact than gasoline vehicles - including generating additional local jobs - by keeping more of vehicle owners' money in the local economy rather than sending it out of state by purchasing gasoline.

¹² Under the moderate PEV (EIA) scenario, this analysis assumes that PEV owners will pay the same net purchase price for gasoline vehicles and PEVs, despite the higher projected purchase price of comparable PEVs. There is evidence that current PEV purchasers are foregoing the purchase of more expensive vehicles to purchase higher-priced PEVs within their target budget. With only modest future PEV penetration this analysis assumes that this behavior will continue. However, for the High PEV scenario net PEV owner benefits reflect the fact that PEV purchasers will pay a higher price for their PEVs than they would have paid for a similar gasoline vehicle.

¹³ One barrel of gasoline equals 42 US gallons

Economic impact analyses for the states of California, Florida, Ohio and Oregon have estimated that for every million dollars in direct PEV owner savings, an additional \$0.29 - \$0.57 million in secondary economic benefits will be generated within the local economy, depending on PEV adoption scenario. These studies also estimated that between 13 and 25 additional in-state jobs will be generated for every 1,000 PEVs in the fleet. [1]


Figure 13 Cumulative Gasoline Savings from PEVs in Kentucky

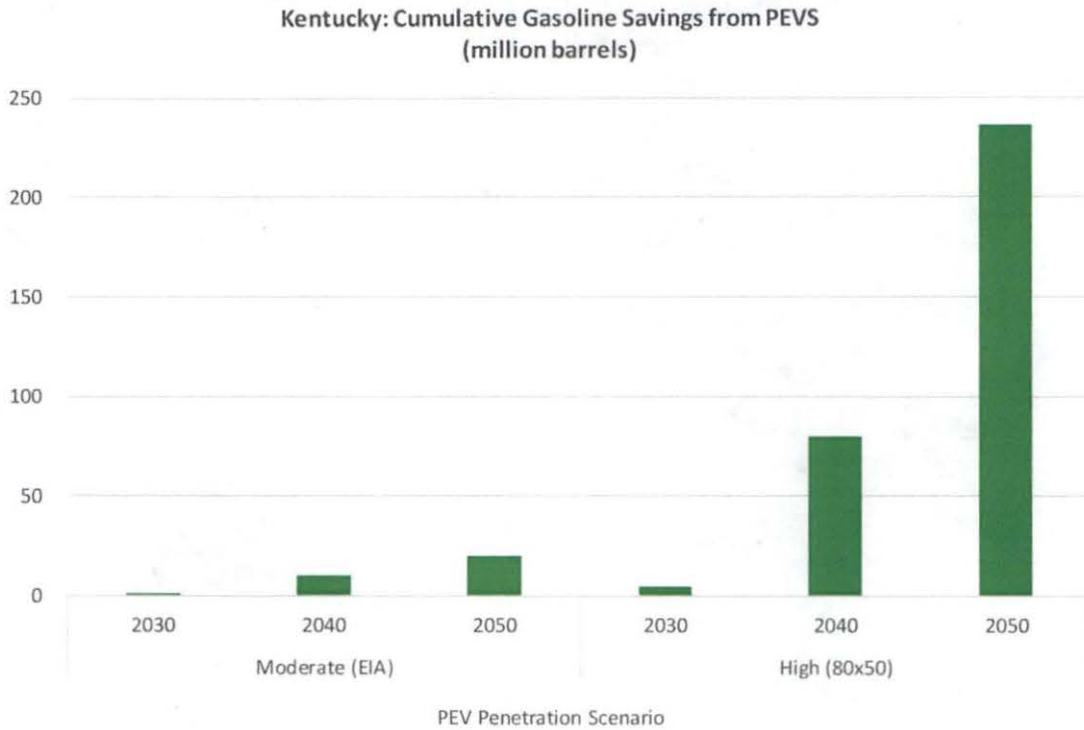

The projected annual greenhouse gas (GHG) emissions (million metric tons carbon-dioxide equivalent, CO₂-e million tons) from the Kentucky light duty fleet under each PEV penetration scenario are shown in Figure 14. In this figure, projected emissions under the PEV scenarios are shown in blue. The values shown represent “wells-to-wheels” emissions, including direct tailpipe emissions and “upstream” emissions from production and transport of gasoline. Estimated emission for the PEV scenarios includes GHG emissions from generating electricity to charge PEVs, as well as GHG emissions from gasoline vehicles in the fleet. Estimated emissions from PEV charging are based on EIA projections of average carbon intensity for the Reliability First Corporation / West electricity market module region, which includes Kentucky.

Figure 14

Projected GHG Emissions from the Light Duty Fleet in Kentucky

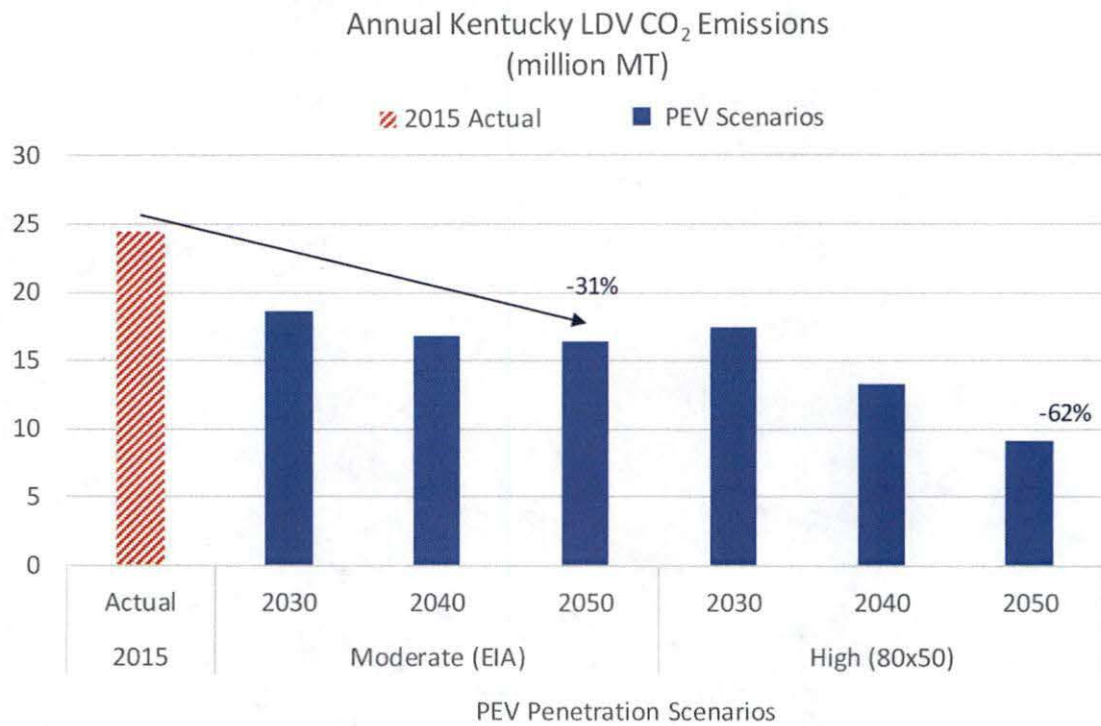

As shown in Figure 14, GHG emissions from the light duty fleet in Kentucky were approximately 24 million metric tons in 2015.

Compared to 2015 baseline emissions, in 2050 GHG emissions are projected to be reduced by up to 8 million tons under the Moderate PEV penetration scenario and as much as 15 million tons under the High PEV (80x50) scenario. Through 2050, cumulative net GHG emissions are projected to be reduced by nearly 152 million tons under the Moderate PEV penetration scenario and 234 million metric tons under the High PEV (80x50) scenario.

NO_x Emissions

In 2015 the Electric Power Research Institute (EPRI), in conjunction with the Natural Resources Defense Council (NRDC), conducted national-level modeling to estimate GHG and air quality benefits from high levels of transportation electrification [4]. Under their electrification scenario EPRI estimated that NO_x would be reduced by 11.4 tons and VOCs would be reduced by 5.5 tons, for every billion vehicle miles traveled¹⁴.

Extrapolating from this data, under the Moderate PEV Scenario (EIA), by 2050 light-duty vehicle electrification in Kentucky could reduce annual NO_x emissions by 240 tons and reduce annual VOC emissions by 116 tons.


¹⁴ For light-duty vehicles the analysis assumed that by 2030 approximately 17 percent of annual vehicle miles would be powered by grid electricity, using PEVs. Based on current and projected electric sector trends the analysis also assumed that approximately 49 percent of the incremental power required for transportation electrification in 2030 would be produced using solar and wind, with the remainder produced by combined cycle natural gas plants.

Under the High PEV Scenario (80x50), total NOx reductions in 2050 could reach more than 3,740 tons per year, and total VOC reductions could reach 1,800 tons per year.¹⁵

Total Societal Benefits

The NPV of total annual estimated benefits from increased PEV use in Kentucky under each PEV penetration scenario are summarized in Figures 15 and 16. These benefits include cost savings to Kentucky drivers and utility customer savings from reduced electric bills. Figure 15 shows the NPV of annual projected societal benefits if Kentucky drivers charge in accordance with the baseline charging scenario. Figure 16 shows the NPV of projected annual benefits with managed charging.

Figure 15 Projected NPV of Total Societal Benefits from Greater PEV use in KY – Baseline Charging

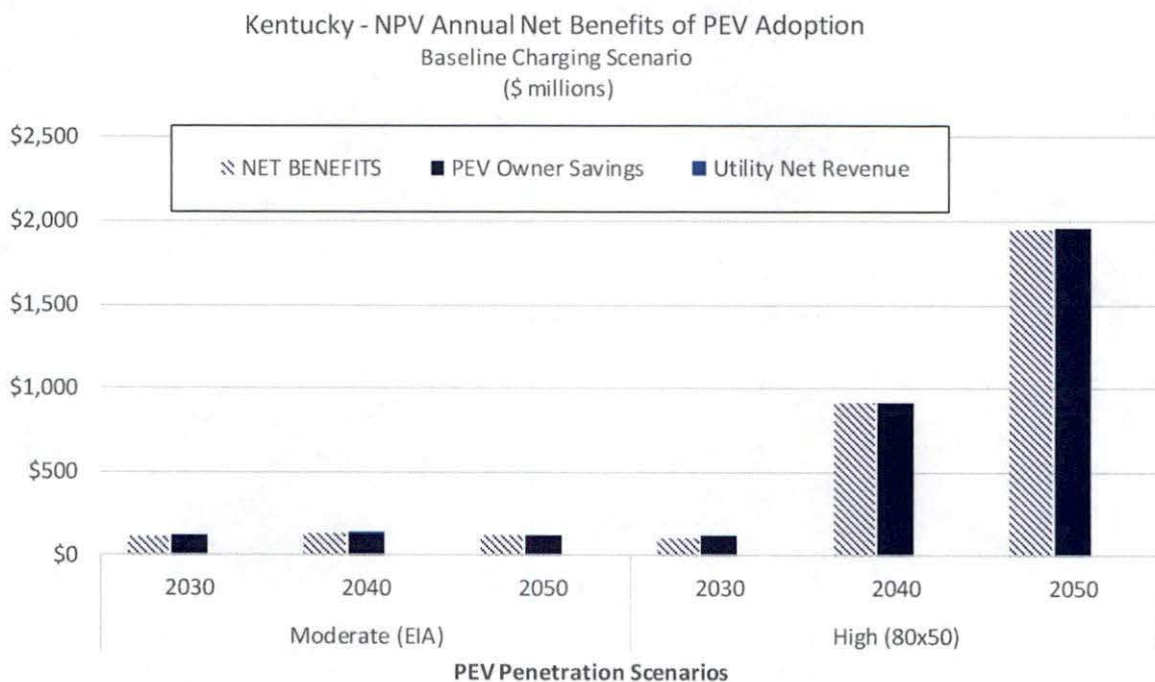


As shown in Figure 15, the NPV of annual benefits is projected to be a minimum of \$124 million per year in 2050 under the Moderate PEV penetration scenario and \$2.0 billion per year in 2050 under the High PEV (80x50) scenario. All of these annual benefits will accrue to Kentucky drivers as a cash savings in vehicle operating costs since utility net revenue is break-even to slightly negative under the baseline charging scenario, as discussed above.

¹⁵ Across the entire state, estimated annual light-duty vehicle miles traveled (VMT) totals 0.64 trillion miles in 2050. Of these miles approximately, 6 percent are powered by grid electricity under the EIA penetration scenario, and 87 percent are powered by grid electricity under the 80x50 penetration scenario

As shown in Figure 16, the NPV of annual benefits in 2050 will increase by \$7 million under the Moderate PEV (EIA) penetration scenario, and \$121 million under the High PEV (80x50) scenario with managed charging. Of these increased benefits, all will accrue to electric utility customers as a reduction in their electricity bills.

Figure 16 Projected NPV of Total Societal Benefits from Greater PEV use in KY – Managed Charging

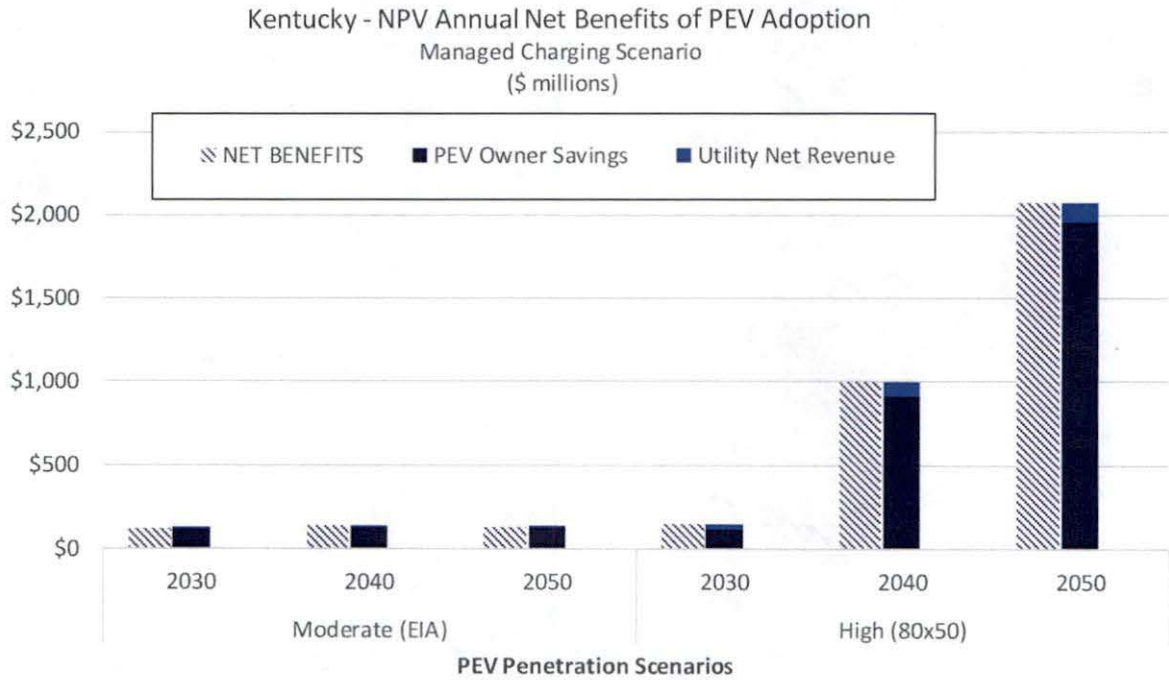

Study Methodology

This section briefly describes the methodology used for this study. For more information on how this study was conducted, including a complete discussion of the assumptions used and their sources, see the report: *Mid-Atlantic and Northeast Plug-in Electric Vehicle Cost-Benefit Analysis, Methodology & Assumptions* (October 2016).¹⁶ This report can be found at:

http://mjbradley.com/sites/default/files/NE_PEV_CB_Analysis_Methodology.pdf

This study evaluated the costs and benefits of two distinct levels of PEV penetration in Kentucky between 2030 and 2050, based on the range of publicly available PEV adoption estimates from various analysts.

Moderate PEV Scenario –EIA: Based on EIA’s current projections for new PEV sales between 2015 and 2050, as contained in the 2017 Annual Energy Outlook (AEO). Under this scenario approximately 4.9 percent of in-use light duty vehicles in Kentucky will be PEV in 2030, rising to 6.2 percent in 2040 and remaining steady through 2050.

High PEV Scenario – 80x50: PEV penetration levels each year that would put the state on a trajectory to reduce total annual light-duty fleet GHG emissions by 70 – 80 percent from current levels in 2050. Under this scenario 25 percent of in-use vehicles will be PEV in 2030, rising to 60 percent in 2040 and 95 percent in 2050.

Both of these scenarios are compared to a baseline scenario with very little PEV penetration, and continued use of gasoline vehicles. The baseline scenario is based on future annual vehicle miles traveled (VMT) and fleet characteristics (e.g., cars versus light trucks) as projected by the Energy Information Administration in their most recent Annual Energy Outlook (AEO 2017).

Based on assumed future PEV characteristics and usage, the analysis projects annual electricity use for PEV charging at each level of penetration, as well as the average load from PEV charging by time of day. The analysis then projects the total revenue that Kentucky’s electric distribution utilities would realize from sale of this electricity, their costs of providing the electricity to their customers, and the potential net revenue (revenue in excess of costs) that could be used to support maintenance of the distribution system.

The costs of serving PEV load include the cost of electricity generation, the cost of transmission, incremental peak generation capacity costs for the additional peak load resulting from PEV charging, and annual infrastructure upgrade costs for increasing the capacity of the secondary distribution system to handle the additional load.

For each PEV penetration scenario this analysis calculates utility revenue, costs, and net revenue for two different PEV charging scenarios: 1) a baseline scenario in which all PEVs are plugged in and start to charge as soon as they arrive at home each day, and 2) a managed charging scenario in which a significant portion of PEVs that arrive home between noon and 11 PM each day delay the start of charging until after midnight.

Real world experience from the EV Project demonstrates that, without a “nudge”, drivers will generally plug in and start charging immediately upon arriving home after work (scenario 1), exacerbating system-wide evening peak demand.¹⁷ However, if given a “nudge” - in the form of a properly designed and marketed financial

¹⁶ This analysis used the same methodology as described in the referenced report, but used different PEV penetration scenarios, as described here. In addition, for this analysis fuel costs and other assumptions taken from the Energy Information Administration (EIA) were updated from EIA’s Annual Energy Outlook 2016 to those in the Annual Energy Outlook 2017. Finally, for projections of future PEV costs this analysis used updated July 2017 battery cost projections from Bloomberg New Energy Finance.

¹⁷ The EV Project is a public/private partnership partially funded by the Department of Energy which has collected and analyzed operating and charging data from more than 8,300 enrolled plug-in electric vehicles and approximately 12,000 public and residential charging stations over a two-year period.

incentive - many Kentucky drivers will choose to delay the start of charging until later times, thus reducing the effect of PEV charging on evening peak electricity demand (scenario 2). [5]

For each PEV penetration scenario, this analysis also calculates the total incremental annual cost of purchase and operation for all PEVs in the state, compared to “baseline” purchase and operation of gasoline cars and light trucks. For both PEVs and baseline vehicles annual costs include the amortized cost of purchasing the vehicle, annual costs for gasoline and electricity, and annual maintenance costs. For the Moderate PEV Scenario, it was assumed that PEV vehicle costs are the same as baseline gasoline vehicles, with the reasoning that consumers have a set budget and will purchase what they can afford, regardless of technology type. For the High PEV Scenario, the same logic could not be applied, as it is assumed that nearly all vehicle purchases will be PEV. For PEVs it also includes the amortized annual cost of the necessary home charger. This analysis is used to estimate average annual financial benefits to Kentucky drivers.

Finally, for each PEV penetration scenario this analysis calculates annual greenhouse gas (GHG) emissions from electricity generation for PEV charging, and compares that to baseline emissions from operation of gasoline vehicles. For the baseline and PEV penetration scenarios GHG emissions are expressed as carbon dioxide equivalent emissions (CO₂-e) in metric tons (MT). GHG emissions from gasoline vehicles include direct tailpipe emissions as well as “upstream” emissions from production and transport of gasoline.

For each PEV penetration scenario GHG emissions from PEV charging are calculated based on an electricity scenario that is consistent with the latest Energy Information Administration (EIA) projections for future SERC Reliability Corporation / Virginia -Carolina.

Net annual GHG reductions from the use of PEVs are calculated as baseline GHG emissions (emitted by gasoline vehicles) minus GHG emissions from each PEV penetration scenario.

References

- [1] AECOM and Quercus Consulting, *Ripple Effect, Forecasting the economic impact of electric vehicles in Florida*, August 2014
- Drive Electric Ohio, *Electric Vehicle Readiness Plan for Ohio, 2013*
- California Electric Transportation Coalition (2012), *Plug-in Electric Vehicle Deployment in California: An Economic Jobs Assessment*. <http://www.caletc.com/wp-content/uploads/2012/11/Economic-Jobs-AssessmentExec-Summary.pdf>
- E. Korejwa, (2015), *The Returns to Vehicle Electrification: An Assessment of the Economic and Budgetary Impacts of Electric Vehicle Adoption in Oregon*, Drive Oregon. <http://driveoregon.org/wp-content/uploads/2015/02/Oregon-EV>Returns.pdf>
- J. Todd, J. Chen, and F. Clogston, (2012), *Creating the Clean Energy Economy: Analysis of the Electric Vehicle Industry, 2013*. Originally from U.S. Energy Information Administration. Gasoline and Diesel Fuel Update. Retrieved from <http://www.eia.gov/petroleum/gasdiesel/>
- J. Cortright, (2010) *New York City's Green Dividend*. CEOs for Cities. http://www.ceosforcities.org/pagefiles/NYCGD_elctrnc_FINAL.pdf
- [2] Idaho National Laboratory, *2013 EV Project Electric Vehicle Charging Infrastructure Summary Report*, January 2013 through December 2013.
- S. Morsy, Bloomberg New Energy Finance, *Long-Term Electric Vehicle Outlook 2017*, July 6, 2017
- [3] S. Morsy, Bloomberg New Energy Finance, Advanced Transport, *Long-term Electric Vehicle Outlook 2017*, July 6, 2017
- [4] U.S. Environmental Protection Agency, Office of Air and Radiation, Office of Air Quality Planning and Standards, Technical Support Document, *Estimating the Benefit per Ton of Reducing PM2.5 Precursors from 17 Sectors*, Jan 2013, <https://www.epa.gov/sites/production/files/2014-10/documents/sourceapportionmentbpttsd.pdf>
- [5] Idaho National Laboratory, *2013 EV Project Electric Vehicle Charging Infrastructure Summary Report*, January 2013 through December 2013

Acknowledgements

Lead Authors: Dana Lowell, Brian Jones, and David Seamonds

This study was conducted by M.J. Bradley & Associates for Duke Energy. It is one of six state-level analyses that will be conducted of plug-in electric vehicle costs and benefits in the different U.S. states in which Duke operates. These studies are intended to provide input to state policy discussions about actions required to promote further adoption of electric vehicles, as well as to inform internal Duke planning efforts.

*Big Sandy R.E.C.C.
Big Sandy R.E.C.C.
504 11th Street
Paintsville, KY 41240

*Kentucky Power Company
Kentucky Power Company
855 Central Avenue, Suite 200
Ashland, KY 41101

*Blue Grass Energy Cooperative Corp.
Blue Grass Energy Cooperative Corp.
1201 Lexington Road
P. O. Box 990
Nicholasville, KY 40340-0990

*Taylor County R.E.C.C.
Taylor County R.E.C.C.
625 West Main Street
P. O. Box 100
Campbellsville, KY 42719

*Kenergy Corp.
Kenergy Corp.
6402 Old Corydon Road
P. O. Box 18
Henderson, KY 42419

*Clark Energy Cooperative, Inc.
Clark Energy Cooperative, Inc.
2640 Ironworks Road
P. O. Box 748
Winchester, KY 40392-0748

*Farmers R.E.C.C.
Farmers R.E.C.C.
504 South Broadway
P. O. Box 1298
Glasgow, KY 42141-1298

*Duke Energy Kentucky, Inc.
Duke Energy Kentucky, Inc.
139 East Fourth Street
Cincinnati, OH 45202

*Cumberland Valley Electric, Inc.
Cumberland Valley Electric, Inc.
Highway 25E
P. O. Box 440
Gray, KY 40734

*Jackson Purchase Energy Corporation
Jackson Purchase Energy Corporation
2900 Irvin Cobb Drive
P. O. Box 4030
Paducah, KY 42002-4030

*Nolin R.E.C.C.
Nolin R.E.C.C.
411 Ring Road
Elizabethtown, KY 42701-6767

*East Kentucky Power Cooperative, Inc.
East Kentucky Power Cooperative, Inc.
4775 Lexington Road
P. O. Box 707
Winchester, KY 40392-0707

*Fleming-Mason Energy Cooperative, In
Fleming-Mason Energy Cooperative, Inc.
1449 Elizaville Road
P. O. Box 328
Flemingsburg, KY 41041

*South Kentucky R.E.C.C.
South Kentucky R.E.C.C.
925-929 N Main Street
P. O. Box 910
Somerset, KY 42502-0910

*Inter-County Energy Cooperative Corp
Inter-County Energy Cooperative Corporation
1009 Hustonville Road
P. O. Box 87
Danville, KY 40423-0087

*Justin M. McNeil
Office of the Attorney General Office of Rate
700 Capitol Avenue
Suite 20
Frankfort, KENTUCKY 40601-8204

*Larry Cook
Assistant Attorney General
Office of the Attorney General Office of Rate
700 Capitol Avenue
Suite 20
Frankfort, KENTUCKY 40601-8204

*Jackson Energy Cooperative Corporati
Jackson Energy Cooperative Corporation
115 Jackson Energy Lane
McKee, KY 40447

*Kent Chandler
Assistant Attorney General
Office of the Attorney General Office of Rate
700 Capitol Avenue
Suite 20
Frankfort, KENTUCKY 40601-8204

*Meade County R.E.C.C.
Meade County R.E.C.C.
P. O. Box 489
Brandenburg, KY 40108-0489

*Licking Valley R.E.C.C.
Licking Valley R.E.C.C.
P. O. Box 605
271 Main Street
West Liberty, KY 41472

*Owen Electric Cooperative, Inc.
Owen Electric Cooperative, Inc.
8205 Highway 127 North
P. O. Box 400
Owenton, KY 40359

*Kentucky Utilities Company
Kentucky Utilities Company
220 W. Main Street
P. O. Box 32010
Louisville, KY 40232-2010

*Shelby Energy Cooperative, Inc.
Shelby Energy Cooperative, Inc.
620 Old Finchville Road
Shelbyville, KY 40065

*Louisville Gas and Electric Company
Louisville Gas and Electric Company
220 W. Main Street
P. O. Box 32010
Louisville, KY 40232-2010

*Grayson R.E.C.C.
Grayson R.E.C.C.
109 Bagby Park
Grayson, KY 41143

*Rebecca W Goodman
Assistant Attorney General
Office of the Attorney General Office of Rate
700 Capitol Avenue
Suite 20
Frankfort, KENTUCKY 40601-8204

*Big Rivers Electric Corporation
Big Rivers Electric Corporation
201 Third Street
P. O. Box 24
Henderson, KY 42420

*Rick Bender
Executive Director
Kentucky Office of Energy Policy Energy and
300 Sower Blvd.
Frankfort, KENTUCKY 40601

*Salt River Electric Cooperative Corp
Salt River Electric Cooperative Corp.
111 West Brashear Avenue
P. O. Box 609
Bardstown, KY 40004