



Andy Beshear  
Governor

Rebecca W. Goodman  
Secretary  
Energy and Environment Cabinet

Commonwealth of Kentucky  
**Public Service Commission**  
211 Sower Blvd.  
P.O. Box 615  
Frankfort, Kentucky 40602-0615  
Telephone: (502) 564-3940  
Fax: (502) 564-3460  
psc.ky.gov

Kent A. Chandler  
Chairman

Angie Hatton  
Vice Chairman

Mary Pat Regan  
Commissioner

## PARTIES OF RECORD

Re: Case No. 2023-00040

Attached is a copy of a memorandum, which is being filed in the record of the above-referenced case. If you have any comments you would like to make regarding the contents of the memorandum, please do so within five days of receipt of this letter.

If you have any questions, please contact Moriah Tussey at [moriah.tussey@ky.gov](mailto:moriah.tussey@ky.gov)

Sincerely,

A handwritten signature in blue ink that reads "Linda C. Bridwell".

Linda C. Bridwell, PE  
Executive Director

Attachment

# PSC INFORMAL CONFERENCE SIGN IN SHEET

CASE NUMBER: 2023-00040 IC KENTUCKY POWER

LOCATION: PSC CONFERENCE ROOM 131

DATE: August 17, 2023 3PM-4PM

NAME	COMPANY
Moriah Tussey	PSC
Hannah Gray	PSC
Nicole Orr	PSC
Tina Frederic	PSC
Ashley Hatcher	PSC
CHINTAN RAVAL	AEP
BRIAN WEST	KPCO
Nick Koehler	AEP
Katie Glass	Gates & Harrison for KPCO
Lerah Kahn	Kentucky Power
J.E.B. Pinney	PSC
Heather Temple	PSC
John Rogness	PSC
Christian Every	PSC
Tripp Coston	PSC

## INTRA-AGENCY MEMORANDUM

### KENTUCKY PUBLIC SERVICE COMMISSION

**TO:** Case File No. 2023-00040  
**FROM:** Moriah Tussey  
**DATE:** August 18, 2023  
**RE:** Informal Conference of August 17, 2023


Pursuant to an Order issued on August 16, 2023, an informal conference (IC) was conducted on August 17, 2023. Attached is a copy of the attendance roster.

The purpose of the IC was to discuss the proposed project and alternatives presented in the application in Case No. 2023-00040.

- Discuss alternatives presented in the CPCN
- Alternative #1: line through Johns Creek-Belfry-Stone
  - Single cap bank at Johns Creek station to address the 2020 PJM requirement
  - To fix baseline violations and an expansion on the original proposal
  - Rebuild yellow line between Stone and Sprigg
  - Rebuild 46 kV to a 69 kV
- Alternative #2: keep adding capacitor banks and various places on the lines in the area and the difficulties that solution would present
- Kentucky Power presented a map that was part of PJM approval process that will be attached to this memo filing.
- Kentucky Power indicated that it would file supplemental testimony to support its application.

There being no further discussion, the IC was then adjourned.

cc: Parties of Record

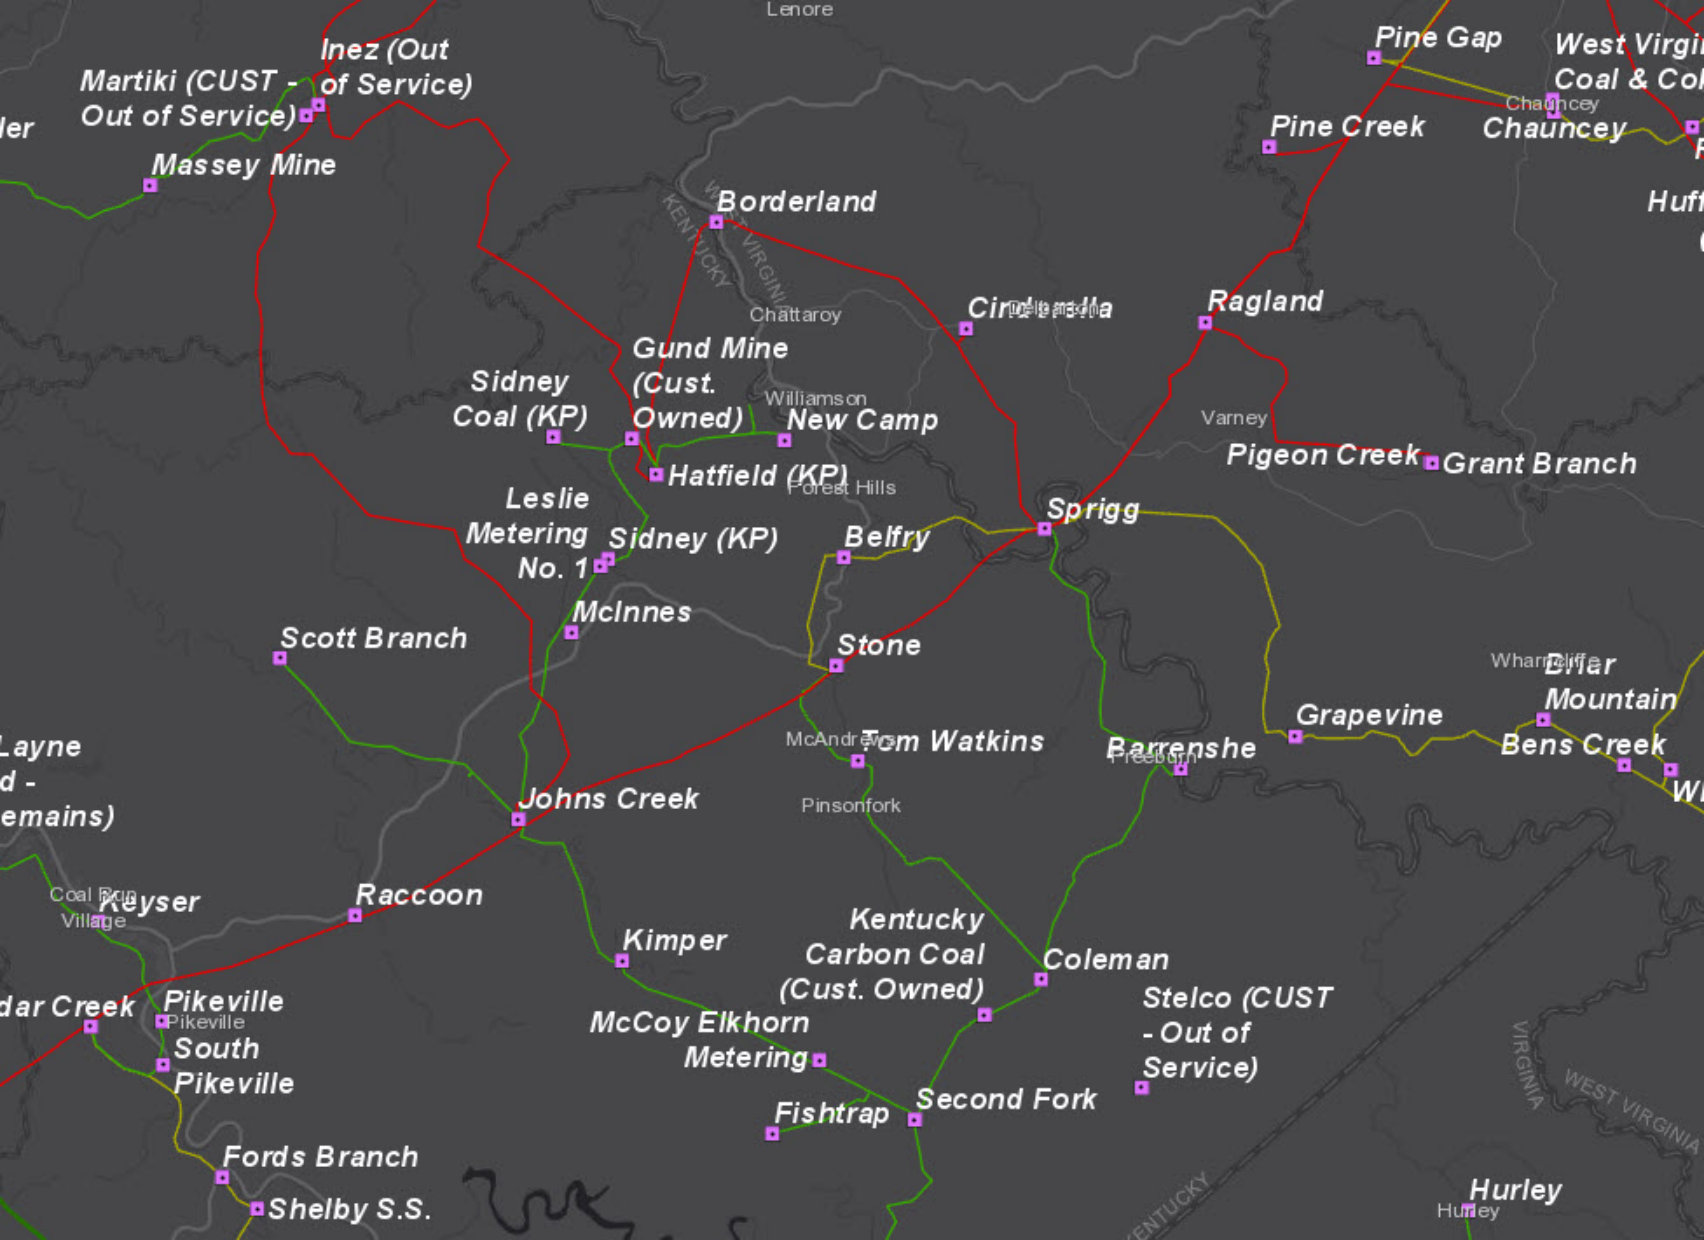

\*David Weiss  
Kentucky Power Company  
1645 Winchester Avenue  
Ashland, KY 41101

\*Hector Garcia  
Kentucky Power Company  
1645 Winchester Avenue  
Ashland, KY 41101

\*Kentucky Power Company  
1645 Winchester Avenue  
Ashland, KY 41101

\*Katie M Glass  
Stites & Harbison  
421 West Main Street  
P. O. Box 634  
Frankfort, KENTUCKY 40602-0634