



March 31, 2017

RECEIVED

MAR 31 2017

PUBLIC SERVICE  
COMMISSION

Dr. Talina Mathews, PhD  
Executive Director  
Kentucky Public Service Commission  
211 Sower Boulevard  
P.O. Box 615  
Frankfort, Kentucky 40602-0615

Re: Annual Resource Assessment for East Kentucky Power Cooperative, Inc.  
(Administrative Case No. 387).

Dear Dr. Mathews:

Pursuant to the Commission's Order dated October 7, 2005 in Administrative Case No. 387, please find enclosed for filing with the Commission an original and ten copies of the 2016 Annual Resource Assessment for East Kentucky Power Cooperative, Inc. ("EKPC").

Also enclosed, please find a discussion of a price elasticity study commissioned by EKPC pertaining to forecasted demand, energy and reserve margin information, submitted previously as part of EKPC's 2014 and 2015 Annual Resource Assessments. Because results of EKPC's most recent End Use Survey do not indicate that any recent price changes have changed customer electricity usage significantly since the price elasticity study analysis was completed, this study remains a valid view of price elasticity for the EKPC system.

If you have any questions, please call me.

Very truly yours,

A handwritten signature in blue ink, appearing to read 'Patrick C. Woods', is written over a light blue horizontal line.

Patrick C. Woods  
Director, Regulatory and Compliance Services

Enclosures

**EAST KENTUCKY POWER COOPERATIVE, INC.**

**UPDATED INFORMATION TO BE FILED ANNUALLY AS SUPPLEMENT TO THE  
ANNUAL REPORT**

**AS ORDERED on October 7, 2005 in the CLOSED PSC ADMINISTRATIVE CASE 387**

**PUBLIC SERVICE COMMISSION'S REQUEST DATED 12/20/01**

**COMMONWEALTH OF KENTUCKY**  
**BEFORE THE PUBLIC SERVICE COMMISSION**

**In the Matter of:**

<b>A REVIEW OF THE ADEQUACY OF</b>	)
<b>KENTUCKY'S GENERATION</b>	) <b>ADMINISTRATIVE</b>
<b>CAPACITY AND TRANSMISSION</b>	) <b>CASE NO. 387</b>
<b>SYSTEM</b>	)

**EAST KENTUCKY POWER COOPERATIVE, INC.**

**PSC ADMINISTRATIVE CASE 387**

**PUBLIC SERVICE COMMISSION'S REQUEST DATED 12/20/01**

East Kentucky Power Cooperative, Inc. (EKPC) hereby submits responses to the information requests contained in Appendix G to the Order of the Public Service Commission ("PSC") in this case dated December 20, 2001, as subsequently revised by Orders dated March 29, 2004 and October 7, 2005. Each response with its associated supportive reference materials is individually tabbed.

The requests listed below, which were originally contained in Appendix G of the Commission's Order dated December 20, 2001, are no longer required pursuant to the Commission's Order of March 29, 2004, amending the previous Order.

Request No. 1

Request No. 2

Request No. 5

Request No. 9

Request No. 10

COMMONWEALTH OF KENTUCKY

BEFORE THE PUBLIC SERVICE COMMISSION

In the Matter of:

A REVIEW OF THE ADEQUACY	)	
OF KENTUCKY'S GENERATION	)	PSC ADMINISTRATIVE
CAPACITY AND TRANSMISSION	)	CASE NO. 387
SYSTEM	)	

CERTIFICATE

STATE OF KENTUCKY )  
 )  
 COUNTY OF CLARK )

Amanda Stacy, being duly sworn, states that she has supervised the preparation of the responses of East Kentucky Power Cooperative, Inc. to the Public Service Commission in the above-referenced case dated December 20, 2001, and that the matters and things set forth therein are true and accurate to the best of her knowledge, information and belief, formed after reasonable inquiry.

*Amanda Stacy*

Subscribed and sworn before me on this 31 day of March, 2017.

*Gwyn M. Willoughby #50044*  
Notary Public



**COMMONWEALTH OF KENTUCKY**  
**BEFORE THE PUBLIC SERVICE COMMISSION**

**In the Matter of:**

<b>A REVIEW OF THE ADEQUACY</b>	)	
<b>OF KENTUCKY'S GENERATION</b>	)	
<b>CAPACITY AND TRANSMISSION</b>	)	<b>PSC ADMINISTRATIVE</b>
<b>SYSTEM</b>	)	<b>CASE NO. 387</b>


**CERTIFICATE**

**STATE OF KENTUCKY** )  
                                  )  
**COUNTY OF CLARK** )

Julia J. Tucker, being duly sworn, states that she has supervised the preparation of the responses of East Kentucky Power Cooperative, Inc. to the Public Service Commission in the above-referenced case dated December 20, 2001, and that the matters and things set forth therein are true and accurate to the best of her knowledge, information and belief, formed after reasonable inquiry.

  
\_\_\_\_\_

Subscribed and sworn before me on this 31 day of March, 2017.

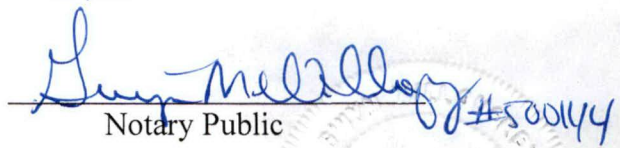  
\_\_\_\_\_  
Notary Public #500144



**EAST KENTUCKY POWER COOPERATIVE, INC.**  
**PSC ADMINISTRATIVE CASE NO. 387**  
**ANNUAL RESOURCE ASSESSMENT FILING**

**PUBLIC SERVICE COMMISSION REQUEST DATED 12/20/01**

**REQUEST 3**

**RESPONSIBLE PERSON: Julia J. Tucker**

**Request 3.** Actual and weather-normalized coincident peak demands for the just completed calendar year. Demands should be disaggregated into (a) native load demand (firm and non-firm) and (b) off-system demand (firm and non-firm).

**Response 3a.** Refer to table below.

<b>Monthly Native Load Peak Demands 2016</b>		
	Actual (Firm and Non-Firm) (MW)	Weather Adjusted (Firm and Non-Firm) (MW)
January	2,890	3,198
February	2,608	3,196
March	2,020	2,500
April	1,813	1,874
May	1,920	2,051
June	2,197	2,234
July	2,293	2,341
August	2,282	2,357
September	2,170	2,128
October	1,678	1,643
November	2,176	2,358
December	2,652	2,656

**Response 3b.** EKPC had no off-system demand obligations during the calendar year 2016.

**EAST KENTUCKY POWER COOPERATIVE, INC.  
PSC ADMINISTRATIVE CASE NO. 387  
ANNUAL RESOURCE ASSESSMENT FILING**

**PUBLIC SERVICE COMMISSION REQUEST DATED 12/20/01**



**REQUEST 4**



**RESPONSIBLE PERSON: Julia J. Tucker**



**Request 4.** Load shape curves that show actual peak demands and weather-normalized peak demands (native load demand and total demand) on a monthly basis for the just completed calendar year.



**Response 4.** Actual monthly peak-day load shapes are presented on pages 2 through 7 of this response. EKPC performs an analysis to weather-normalize the peak hour but EKPC does not weather-normalize the peak-day load shapes.





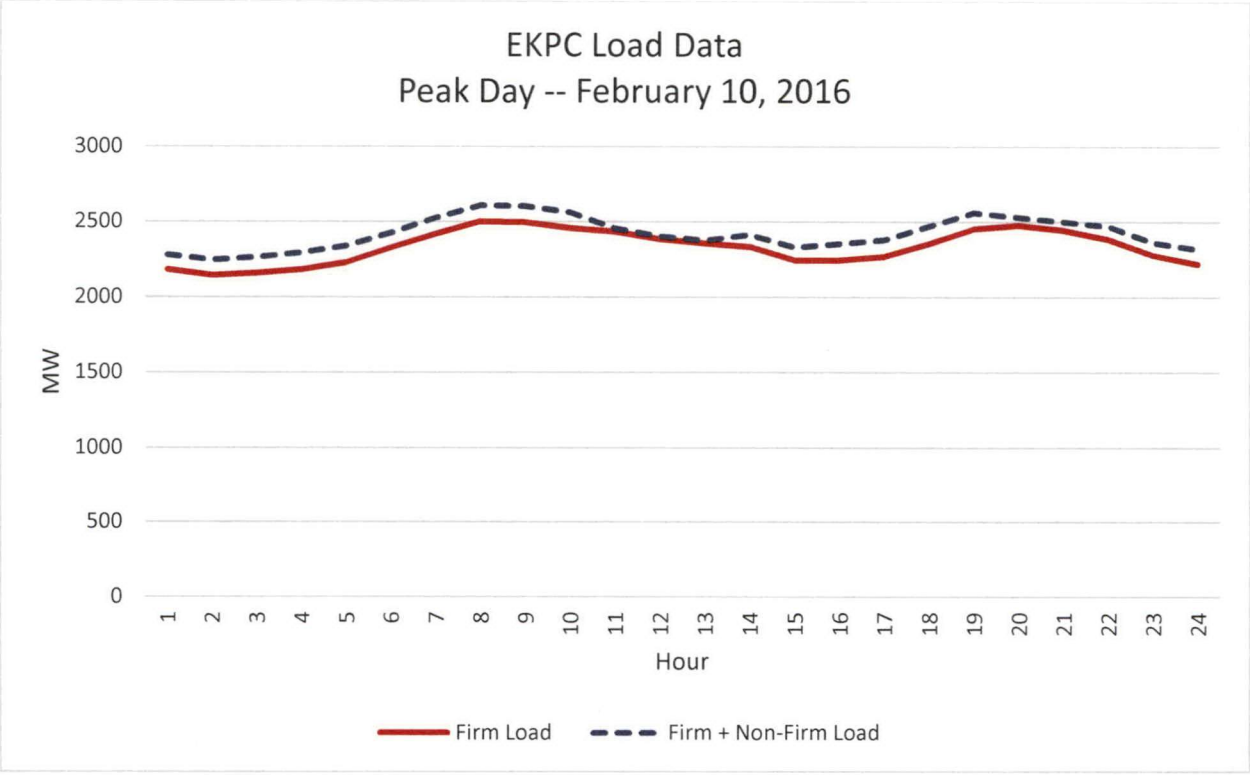
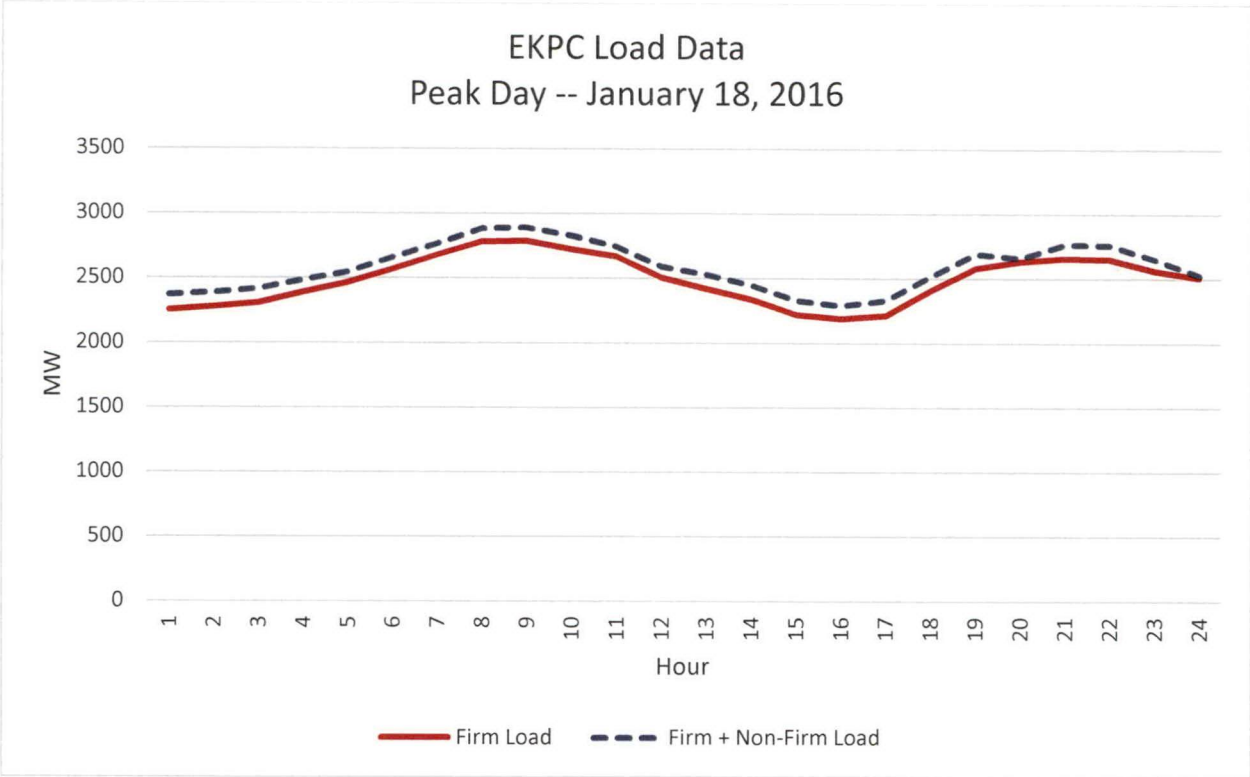


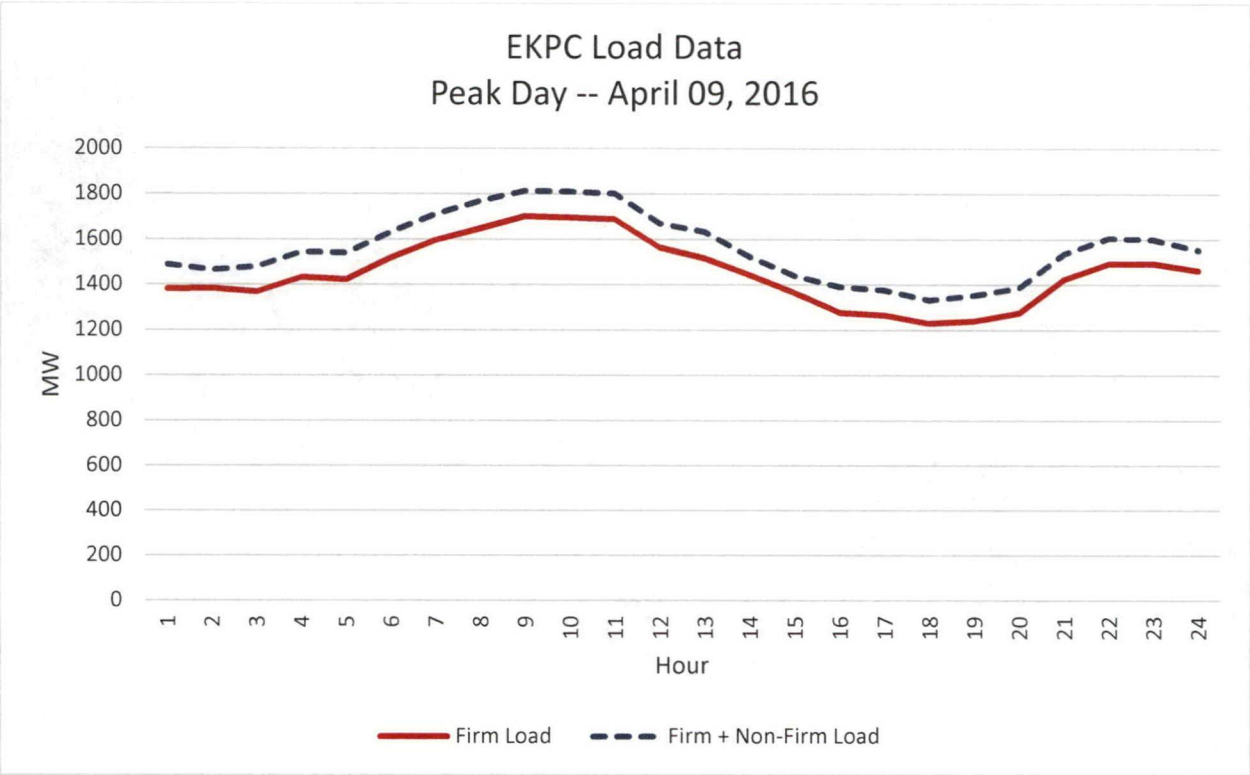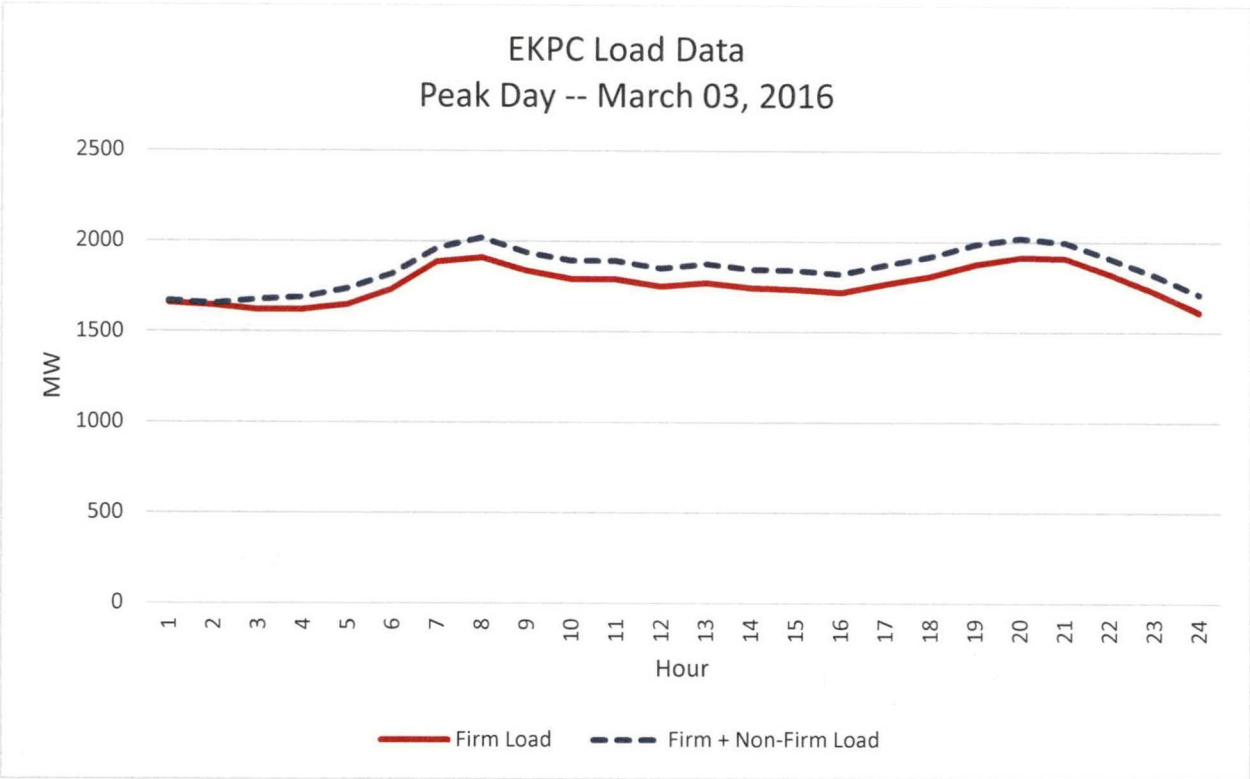

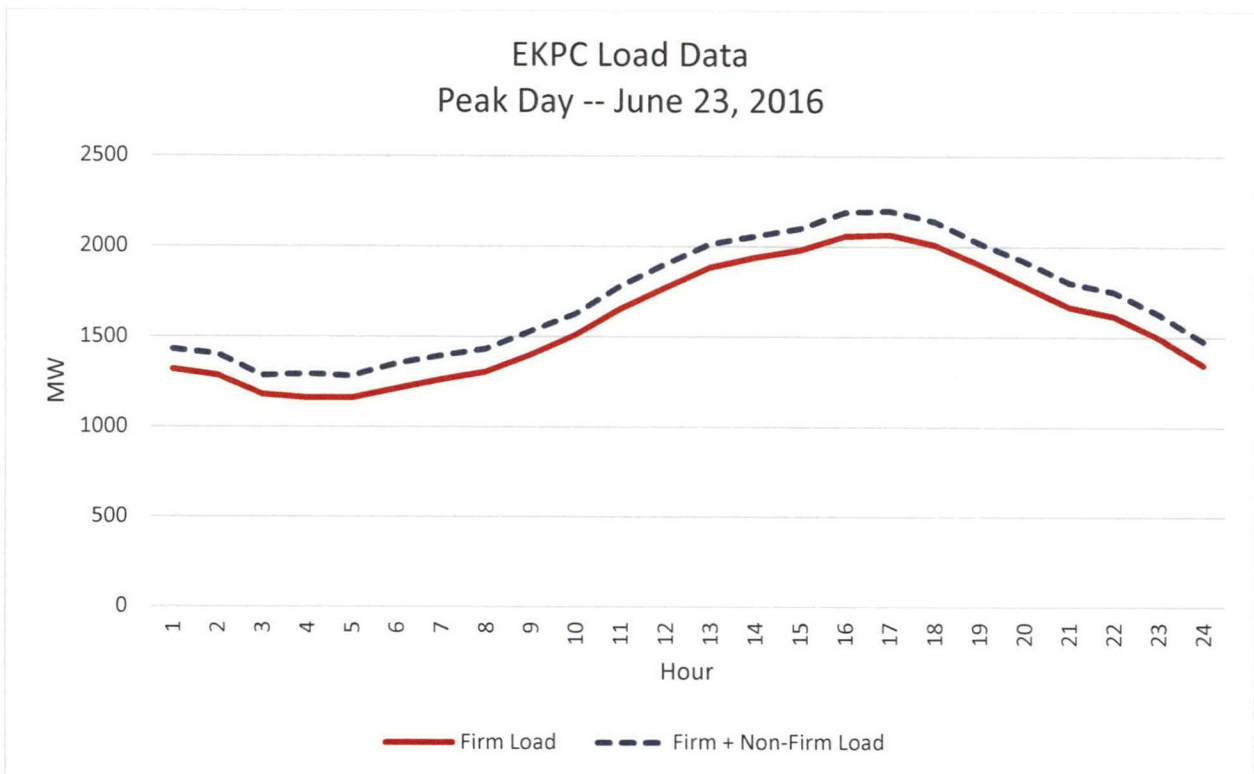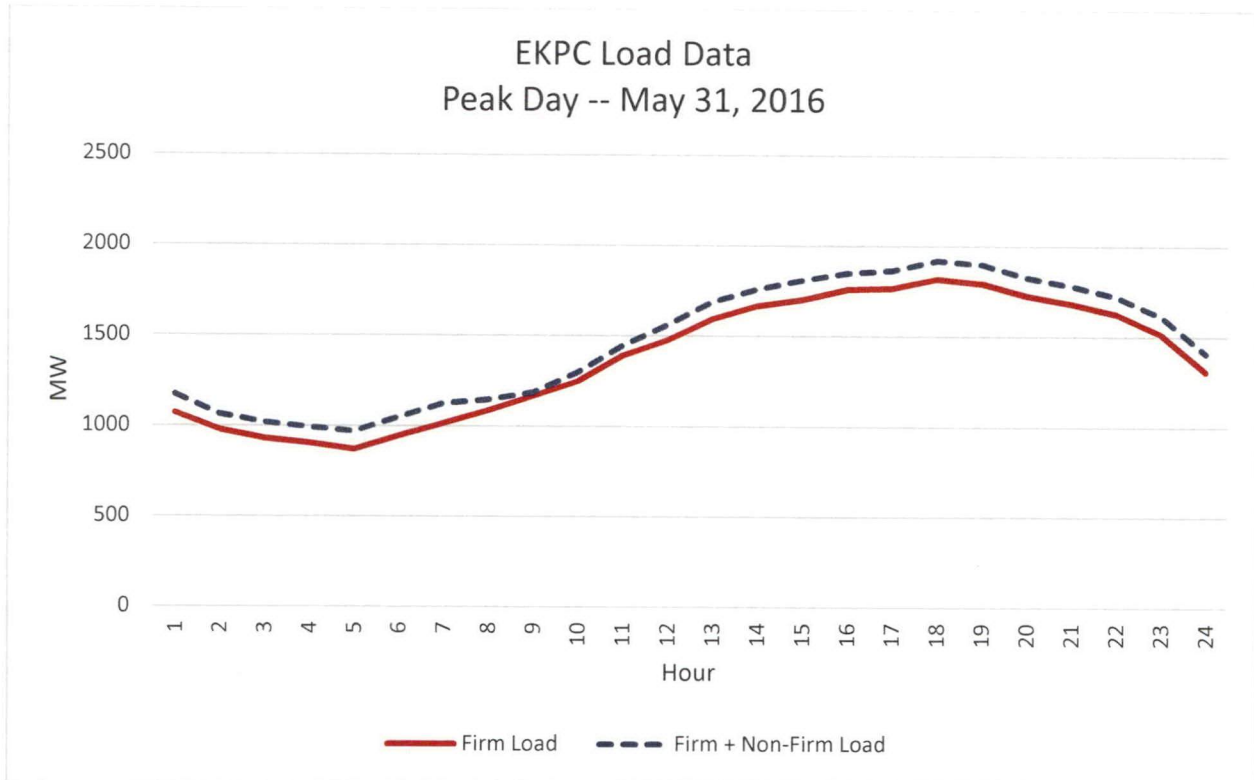

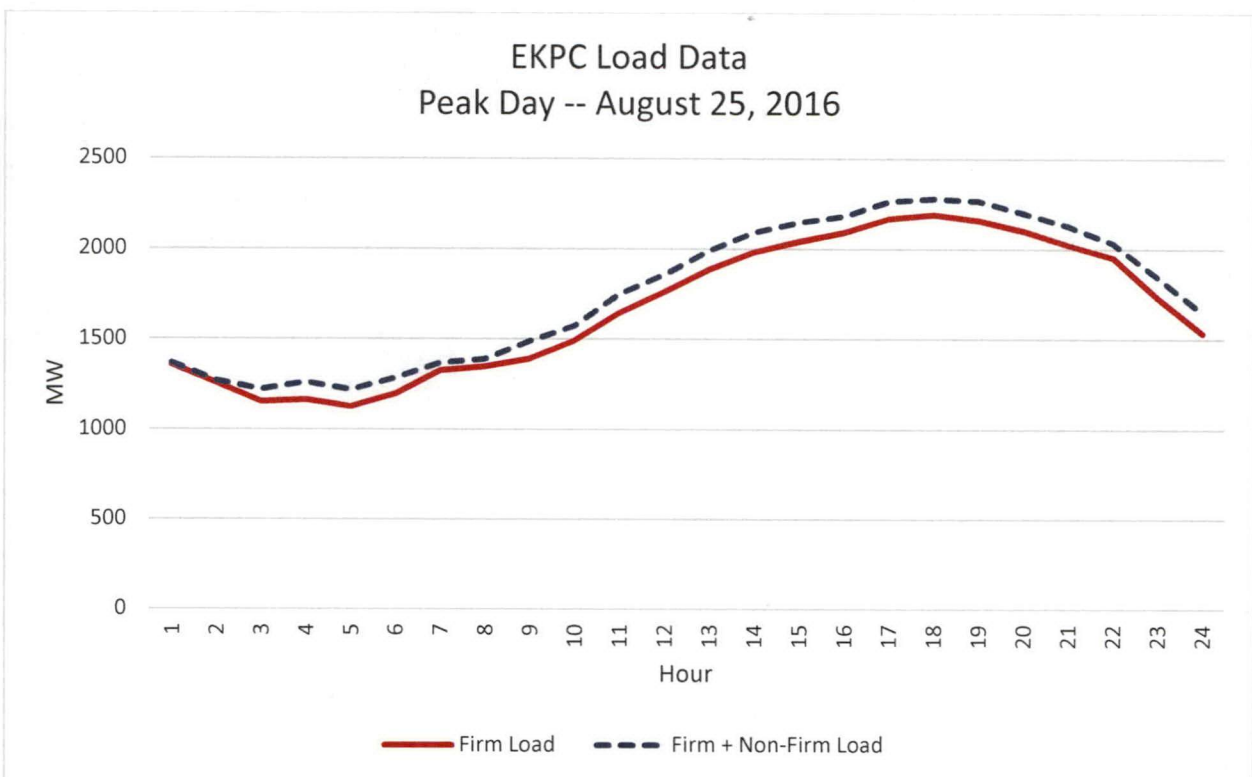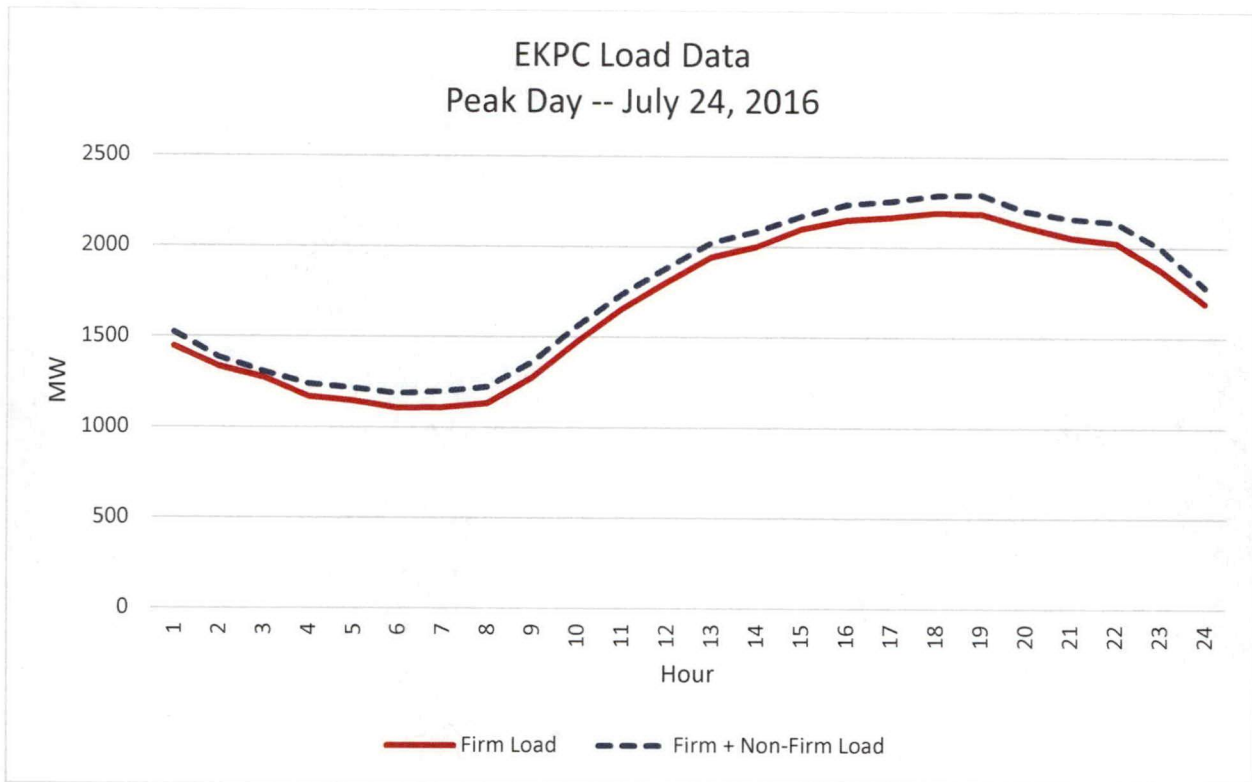

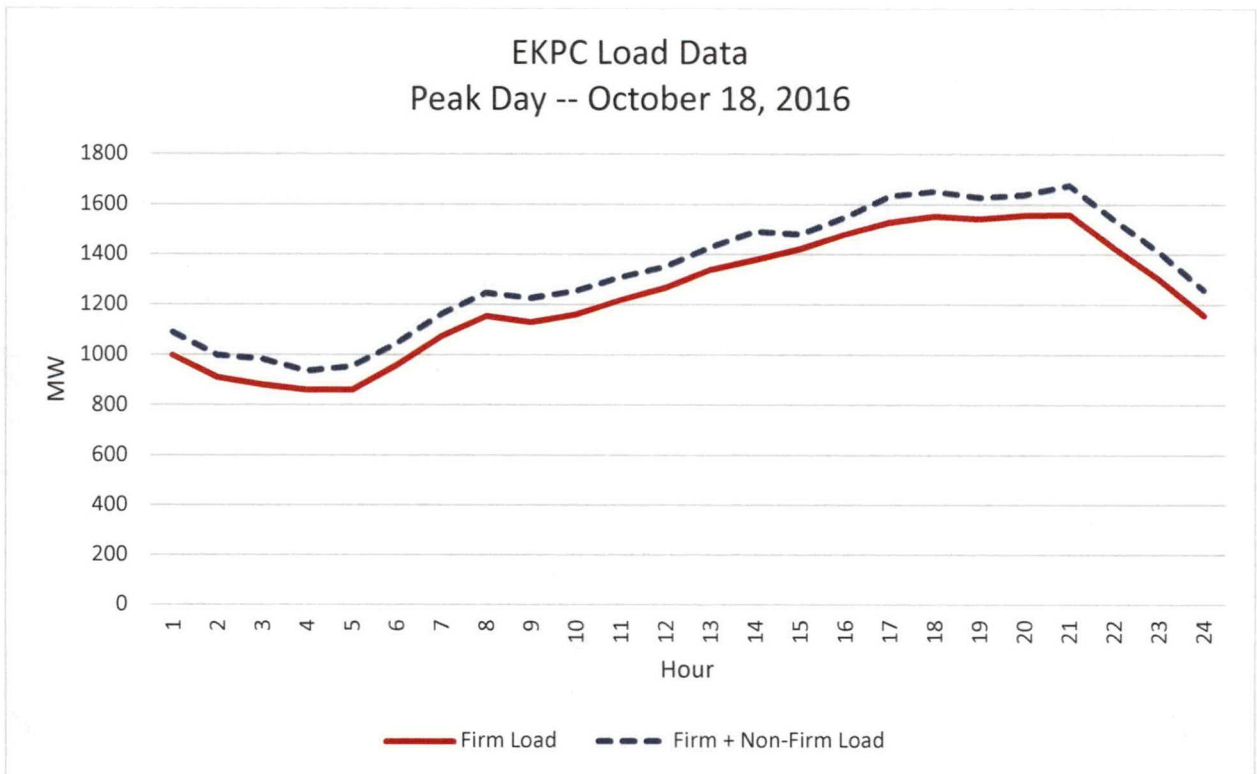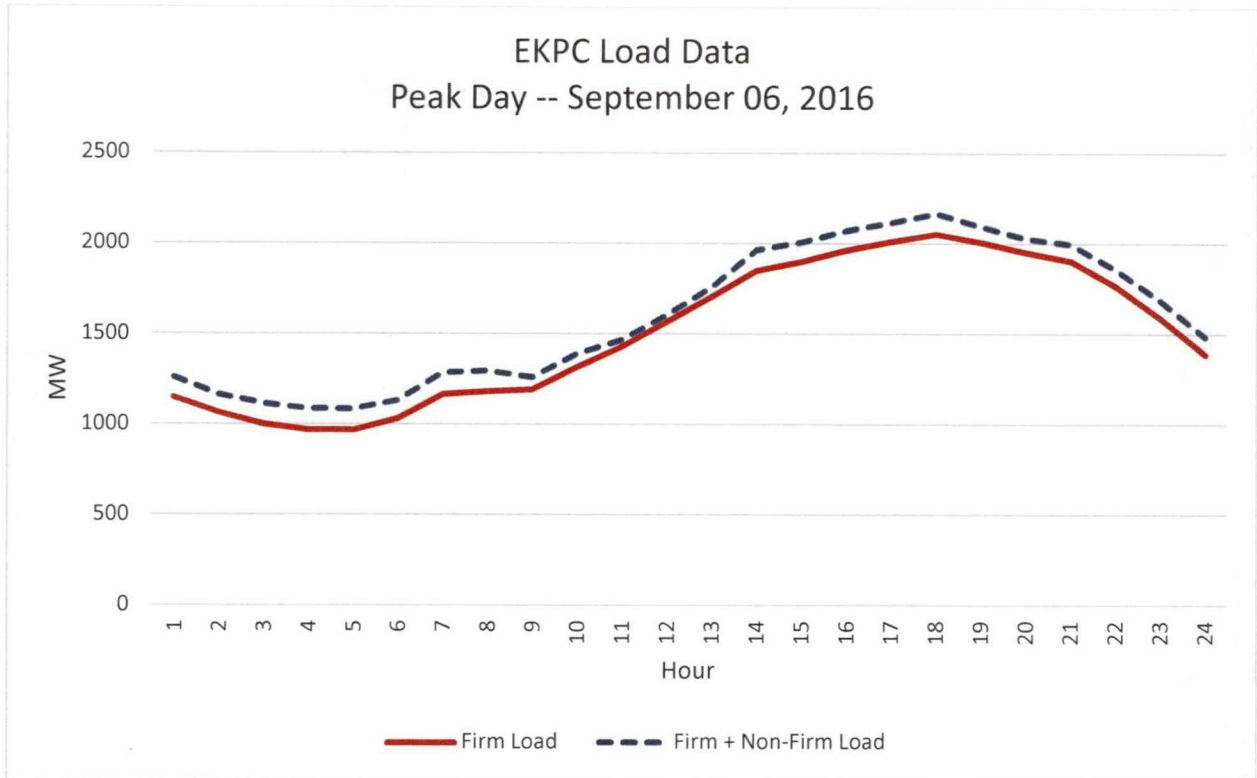

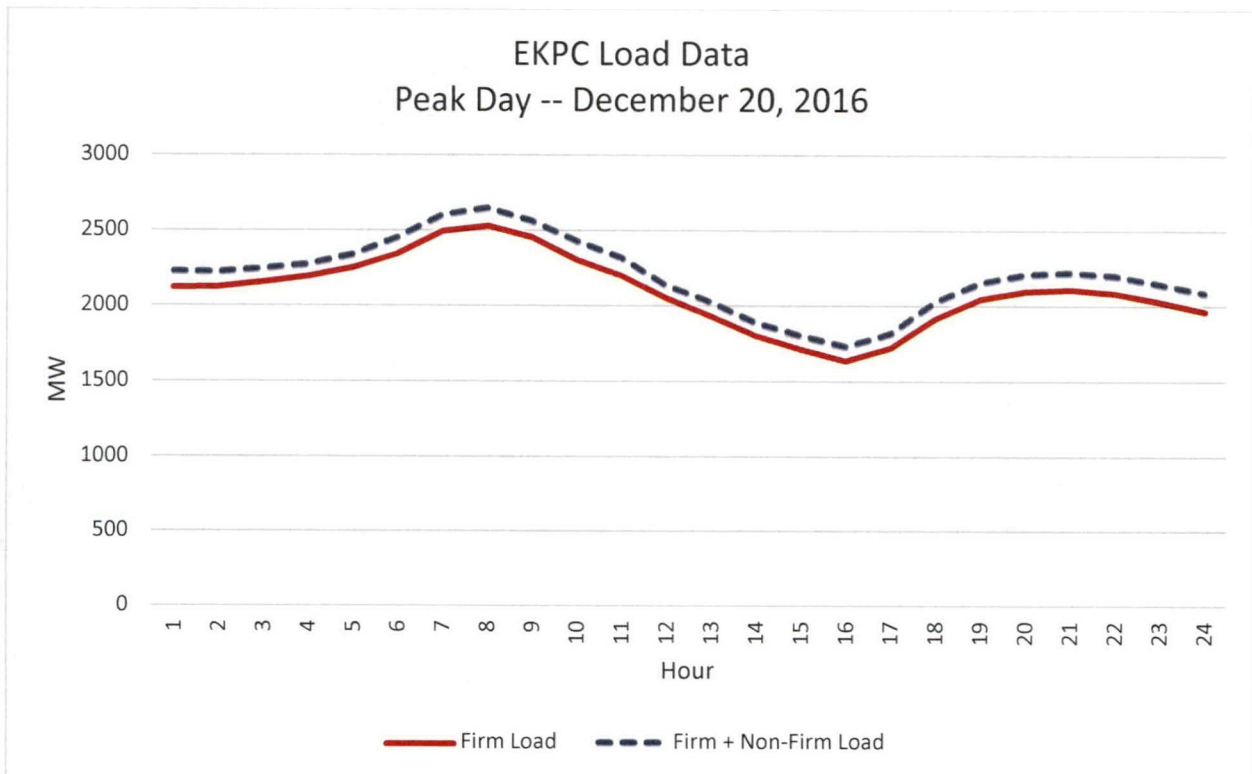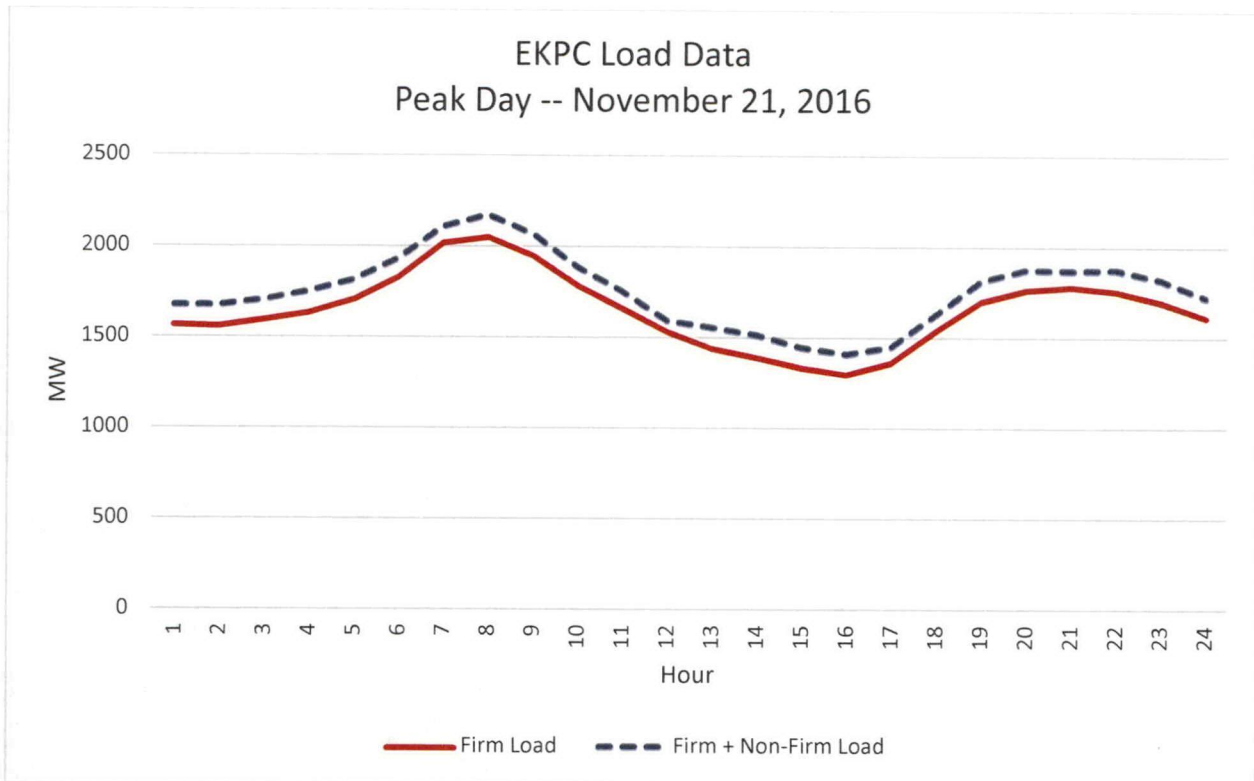

**EAST KENTUCKY POWER COOPERATIVE, INC.  
PSC ADMINISTRATIVE CASE NO. 387  
ANNUAL RESOURCE ASSESSMENT FILING**

**PUBLIC SERVICE COMMISSION REQUEST DATED 12/20/01**

**REQUEST 6**

**RESPONSIBLE PERSON: Julia J. Tucker**

**Request 6.** Based on the most recent demand forecast, the base case demand and energy forecasts and high case demand and energy forecasts for the current year and the following four years. The information should be disaggregated into (a) native load (firm and non-firm demand) and (b) off-system load (both firm and non-firm demand).

**Response 6a.** EKPC prepares higher and lower growth scenarios to bracket its baseline scenario forecast. The ranges are shown in the table below. The peaks are firm native load only. EKPC does not prepare range forecasts for non-firm native load.

Net Winter Peak Demand (MW)				Net Summer Peak Demand (MW)				Net Requirements (GWh)			
Season	Low Case	Base Case	High Case	Year	Low Case	Base Case	High Case	Year	Low Case	Base Case	High Case
2016 - 17	2,883	3,176	3,340	2017	2,217	2,317	2,386	2017	12,626	13,497	14,631
2017 - 18	2,914	3,199	3,408	2018	2,241	2,340	2,434	2018	12,762	13,637	14,926
2018 - 19	2,941	3,217	3,473	2019	2,262	2,362	2,481	2019	12,881	13,757	15,212
2019 - 20	2,970	3,251	3,541	2020	2,285	2,399	2,529	2020	13,008	13,935	15,509
2020 - 21	2,989	3,257	3,600	2021	2,300	2,419	2,572	2021	13,093	14,044	15,770

**Response 6b.** EKPC is projecting no off-system demand.



**EAST KENTUCKY POWER COOPERATIVE, INC.  
PSC ADMINISTRATIVE CASE NO. 387  
ANNUAL RESOURCE ASSESSMENT FILING**

**PUBLIC SERVICE COMMISSION REQUEST DATED 12/20/01**

**REQUEST 7**

**RESPONSIBLE PERSON: Julia J. Tucker**

**Request 7.** The target reserve margin currently used for planning purposes, stated as a percentage of demand. If changed from what was in use in 2001, include a detailed explanation of the change.

**Response 7.** EKPC integrated into PJM on June 1, 2013. EKPC is required to provide its pro-rated share of the PJM reserve requirements. PJM is a summer peaking system, so EKPC's required reserve share is based on its summer load at the time of the PJM system peak. EKPC's load diversity with PJM's peak time acts to reduce EKPC's net reserve requirement. EKPC is required to cover approximately 3% of EKPC's summer peak load in order to cover its pro-rata share of the PJM reserve requirements. However, EKPC is still exposed to market prices for any native load that is not covered by its own generation availability. Therefore, EKPC plans to cover its winter peak load with approximately a 6% reserve margin to ensure it has adequate generation resources secured to cover its native load during extreme winter peak conditions.

**EAST KENTUCKY POWER COOPERATIVE, INC.**  
**PSC ADMINISTRATIVE CASE NO. 387**  
**ANNUAL RESOURCE ASSESSMENT FILING**

**PUBLIC SERVICE COMMISSION REQUEST DATED 12/20/01**

**REQUEST 8**

**RESPONSIBLE PERSON: Julia J. Tucker**

**Request 8.** Projected reserve margins stated in megawatts and as a percentage of demand for the current year and the following 4 years. Identify projected deficits and current plans for addressing these. For each year identify the level of firm capacity purchases projected to meet native load demand.

**Response 8.** The table below shows the projected summer peak and reserve levels.

Year	Summer Load (MW)*	Reserves (MW)	Reserves (%)	Winter Load (MW)	Reserves (MW)	Reserves (%)
2017	2,317	2,959	28%	3,176	3,239	2%
2018	2,340	2,968	27%	3,199	3,248	2%
2019	2,362	3,135	33%	3,217	3,248	1%
2020	2,399	3,135	31%	3,251	3,437	6%
2021	2,419	3,135	30%	3,257	3,437	6%

\*Net of DSM

EAST KENTUCKY POWER COOPERATIVE, INC.  
PSC ADMINISTRATIVE CASE NO. 387  
ANNUAL RESOURCE ASSESSMENT FILING

PUBLIC SERVICE COMMISSION REQUEST DATED 12/20/2001

REQUEST 11

RESPONSIBLE PERSON: Julia J. Tucker

Request 11. A list that identifies scheduled outages or retirements of generating capacity during the current year and the following four years.

Response 11. Please see scheduled outage information below and through page 4 of this response.

Cooper Unit 1  
2017 5 weeks or less  
2018 4 weeks or less  
2019 4 weeks or less  
2020 4 weeks or less  
2021 4 weeks or less

Cooper Unit 2  
2017 6 weeks or less  
2018 4 weeks or less  
2019 4 weeks or less  
2020 4 weeks or less  
2021 4 weeks or less

Spurlock Unit 1

2017 19 weeks or less  
2018 13 weeks or less  
2019 12 weeks or less  
2020 12 weeks or less  
2021 12 weeks or less

Spurlock Unit 2

2017 13 weeks or less  
2018 7 weeks or less  
2019 6 weeks or less  
2020 6 weeks or less  
2021 6 weeks or less

Spurlock Unit 3

2017 5 weeks or less  
2018 5 weeks or less  
2019 5 weeks or less  
2020 5 weeks or less  
2021 5 weeks or less

Spurlock Unit 4

2017 6 weeks or less  
2018 5 weeks or less  
2019 5 weeks or less  
2020 5 weeks or less  
2021 5 weeks or less

Bluegrass CT1

2017 9 weeks or less  
2018 1 weeks or less  
2019 2 weeks or less  
2020 2 weeks or less  
2021 2 weeks or less

Bluegrass CT2

2017 9 weeks or less  
2018 2 weeks or less  
2019 2 weeks or less  
2020 2 weeks or less  
2021 2 weeks or less

Bluegrass CT3

2017 2 weeks or less  
2018 2 weeks or less  
2019 4 weeks or less  
2020 2 weeks or less  
2021 2 weeks or less

JK Smith CT1

2017 2 weeks or less  
2018 4 weeks or less  
2019 4 weeks or less  
2020 4 weeks or less  
2021 4 weeks or less

JK Smith CT2

2017 2 weeks or less  
2018 10 weeks or less  
2019 2 weeks or less  
2020 3 weeks or less  
2021 3 weeks or less

JK Smith CT3

2017 2 weeks or less  
2018 2 weeks or less  
2019 2 weeks or less  
2020 2 weeks or less  
2021 2 weeks or less

JK Smith CT4

2017 2 weeks or less  
2018 4 weeks or less  
2019 4 weeks or less  
2020 4 weeks or less  
2021 4 weeks or less

JK Smith CT5

2017 2 weeks or less  
2018 3 weeks or less  
2019 3 weeks or less  
2020 3 weeks or less  
2021 3 weeks or less

JK Smith CT6

2017 5 weeks or less  
2018 4 weeks or less  
2019 4 weeks or less  
2020 4 weeks or less  
2021 4 weeks or less

JK Smith CT7

2017 4 weeks or less  
2018 2 weeks or less  
2019 2 weeks or less  
2020 2 weeks or less  
2021 2 weeks or less

JK Smith CT9

2017 6 weeks or less  
2018 6 weeks or less  
2019 6 weeks or less  
2020 6 weeks or less  
2021 6 weeks or less

JK Smith CT10

2017 6 weeks or less  
2018 5 weeks or less  
2019 5 weeks or less  
2020 5 weeks or less  
2021 5 weeks or less

**EAST KENTUCKY POWER COOPERATIVE, INC.  
PSC ADMINISTRATIVE CASE NO. 387  
ANNUAL RESOURCE ASSESSMENT FILING**

**PUBLIC SERVICE COMMISSION REQUEST DATED 12/20/01**

**REQUEST 12**

**RESPONSIBLE PERSON: Julia J. Tucker**

**Request 12.** Identify all planned base load or peaking capacity additions to meet native load requirements over the next 10 years. Show the expected in-service date, size and site for all planned additions. Include additions planned by the utility, as well as those by affiliates, if constructed in Kentucky or intended to meet load in Kentucky.

**Response 12.** EKPC purchased the Bluegrass Generation facility on December 29, 2015. The facility consists of three simple cycle combustion turbines with a net summer rating of 165 MW each. Two of the units are already being utilized by EKPC. The third unit is currently subject to a tolling agreement with LGE/KU until April 30, 2019. EKPC will have full access to that capacity beginning May 1, 2019.

EKPC received a CPCN from the PSC to construct an 8.5 MW solar facility to be located at its Headquarters facility. The installation should be complete by November 1, 2017.

EKPC plans to continue its development of economical Landfill Gas-to-Energy projects, but nothing definitive is currently planned or under construction.

EKPC will continue to closely monitor all PJM market and environmental law changes to ensure that its power supply is adequately serving its owner members.



**EAST KENTUCKY POWER COOPERATIVE, INC.**  
**PSC ADMINISTRATIVE CASE NO. 387**  
**ANNUAL RESOURCE ASSESSMENT FILING**

**PUBLIC SERVICE COMMISSION REQUEST DATED 12/20/01**

**REQUEST 13**

**RESPONSIBLE PERSON: Amanda Stacy**

**Request 13.** The following transmission energy data for the just completed calendar year and the forecast for the current year and the following four years:

**Request 13a.** Total energy received from all interconnections and generation sources connected to the transmission system.

**Request 13b.** Total energy delivered to all interconnections on the transmission system.

**Response 13a.** The total energy received from all interconnections and from generation sources connected to the EKPC transmission system for calendar year 2016 was 22,824,134 MWh.

**Response 13b.** The total energy delivered to all interconnections on the EKPC system in 2016 was 10,078,539 MWh.

The forecasted total energy requirements for the EKPC system for 2017 through 2021 are as follows:

2017	13,497,273 MWh
2018	13,636,977 MWh
2019	13,757,175 MWh
2020	13,934,502 MWh
2021	14,044,189 MWh

**Request 13c.** Peak load capacity of the transmission system.

**Response 13c.** The transmission capacity of a grid system changes constantly based on factors like generation dispatch, ambient temperature, load characteristics, contingencies, transfers, etc. EKPC's transmission system is planned and constructed to deliver all of its generation resources to its native load delivery points and to other contracted users of the EKPC transmission system during forecasted normal summer and winter peak load conditions. EKPC's transmission system is also designed to accommodate an outage of a single transmission facility and/or generating unit. Also, EKPC designs its transmission system to deliver its generation resources to its native load delivery points during "extreme" weather conditions (1-in-10 year temperatures) for summer and winter with all facilities in service.

Other than simulation of imports into EKPC to replace an outage of a single generating unit, the transfers used in the EKPC transmission planning process are those modeled in the NERC MMWG models, which are typically the long-term firm transactions known at the time of the development of the models.

Transfer studies performed in regional assessments by both SERC and PJM have not identified any significant limitations within the EKPC system. Therefore, EKPC’s system is expected to be capable of handling a reasonable level of overlaid transfers while also delivering energy to EKPC’s native-load customers and other transmission customers using EKPC’s transmission system to deliver energy for their native-load customers (for instance, LG&E/KU).

**Request 13d.** Peak demand for summer and winter seasons on the transmission system.

**Response 13d.** Please refer to the table below.

<b>Summer</b>	<b>2016</b>	<b>2017</b>	<b>2018</b>	<b>2019</b>	<b>2020</b>	<b>2021</b>
<b>Date</b>	7/24/2016					
<b>Hr.</b>	1900					
<b>Peak Demand (MW)</b>	2293	2317	2340	2362	2399	2419
<b>Winter</b>	<b>2016</b>	<b>2017</b>	<b>2018</b>	<b>2019</b>	<b>2020</b>	<b>2021</b>
<b>Date</b>	1/18/2016	1/8/2017				
<b>Hr.</b>	0900	0900				
<b>Peak Demand (MW)</b>	2890	2871*	3199	3217	3251	3257

\*Reflects January 2017 actual winter peak.

**EAST KENTUCKY POWER COOPERATIVE, INC.**  
**PSC ADMINISTRATIVE CASE NO. 387**  
**ANNUAL RESOURCE ASSESSMENT FILING**

**PUBLIC SERVICE COMMISSION REQUEST DATED 12/20/01**

**REQUEST 14**

**RESPONSIBLE PERSON: Amanda Stacy**

**Request 14.** Identify all planned transmission capacity additions for the next 10 years. Include the expected in-service date, size and site for all planned additions and identify the transmission need each addition is intended to address.

**Response 14.** Pages 2 through 7 of this response include EKPC's 10-year transmission expansion plan for the 2017-2026 period. During this period, EKPC expects to make the following transmission improvements for normal system development and load growth to serve native load customers and not to provide for large wholesale power transfers.

18.11 miles of new transmission line (69 kV)

0.8 miles of new transmission line (138 kV)

0.9 miles of new transmission line (161 kV)

107.97 miles of transmission line reconductor/rebuild (69 kV)

0.66 miles of transmission line rebuild (138 kV)

38.83 miles of transmission line operating temperature upgrades

- 1 new transmission station (100 MVA added)
- 2 new transmission switching stations
- 3 Transmission transformer upgrades/additions (250 MVA added)
- 10 transmission capacitor banks addition/upgrades (98.93 MVAR)
- 17 projects to upgrade terminal facilities
- 6 new distribution substations (113 MVA added)
- 5 upgrades of existing distribution substations (50 MVA added)

<b>EKPC 10-YEAR TRANSMISSION EXPANSION SCHEDULE (2017 – 2026)</b>	
<b>A. New Transmission Lines and Status Changes</b>	<b>Needed In-</b>
<b>Project Description</b>	<b>Service Date</b>
Construct a new 69 kV line from Beattyville Distribution-Oakdale using 556 ACSR/TW (11.66 miles). Operate this new line normally closed and operate the existing Oakdale Jct.-Oakdale line normally open.	12/2018
Construct new Bekaert- North Shelby 69 kV tap line (LGE/KU Simpsonville/Shelbyville 69 kV line) using 556 ACSR/TW (1.55 miles).	12/2018
Loop in the existing Dale-JK Smith 138 kV line section via two new (0.4 mile each) 138 kV line additions. Retire both Dale-Hunt 69 kV line section.	12/2019
Construct new Fox Hollow-Fox Hollow Jct 161 kV line section using 795 MCM ACSR. (~0.9 miles). New TVA 161kV Interconnection.	12/2020
Construct new 69 kV line section from Munk Jct - Williamstown using 556.5 MCM ACSR/TW (4.9 miles).	12/2024

<b>EKPC 10-YEAR TRANSMISSION EXPANSION SCHEDULE (2017 – 2026)</b>	
<b>B. Transmission Line Re-conductor/Rebuilds</b>	<b>Needed In-</b>
<b>Project Description</b>	<b>Service Date</b>
Rebuild the existing West Bardstown - West Bardstown Jct 69 kV line section (4.5 miles) using 556.5 MCM ACTW.	12/2017
Rebuild the existing Baker Lane - Holloway Jct. 69 kV line section (1.28 miles) using 556.5 MCM ACTW.	12/2017
Rebuild a 2.63 mile portion of the existing 3/0 section of the KU Lynch-Arkland 69 kV line using 266.8 MCM ACSR.	12/2017
Rebuild the existing Nelson County - Colesburg Jct 69 kV line section (5.6 miles) using 556.5 MCM ACSR/TW.	8/2018
Rebuild the existing Hope-Preston 69 kV line section (4.2 miles) using 556.5 MCM ACSR/TW.	9/2018
Rebuild the existing Colesburg Jct-Roanoke Tap 69 kV line section (0.99 miles) using 556.5 MCM ACSR/TW.	10/2018
Rebuild the existing Lyman BW Tap-Tunnel Hill Tap 69 kV line section (1.5 miles) using 556.5 MCM ACSR/TW.	12/2018
Rebuild the existing Mazie-Newfoundland 69 kV line section (10.2 miles) using 556.5 MCM ACSR/TW.	12/2018
Rebuild the existing Stephensburg - Glendale 69 kV line section (9.0 miles) using 556.5 MCM ACSR/TW.	12/2018
Rebuild the existing Preston-KU Owingsville 69 kV line section (4.4 miles) using 556.5 MCM ACSR/TW.	5/2019
Decouple the double-circuited Spurlock- Maysville Industrial Tap 138 kV & Spurlock-Flemingsburg 138 kV line sections. (0.66 miles)	6/2019
Rebuild the existing Lyman BW Tap-Roanoke Tap 69 kV line section (4.48 miles) using 556.5 MCM ACSR/TW.	9/2019
Rebuild the existing KU Owingsville-Peasticks 69 kV line section (1.93 miles) using 556.5 MCM ACSR/TW.	9/2019
Rebuild the existing Elizabethtown-Tunnel Hill Tap 69 kV line section (3.4 miles) using 556.5 MCM ACSR/TW.	12/2019
Rebuild the existing Leon-Airport Road 69 kV line section (5.7 miles) using 556.5 MCM ACSR/TW.	12/2019
Rebuild the existing Glendale-Hodgensville 69 kV line section (8.7 miles) using 556.5 MCM ACSR/TW.	12/2019
Rebuild the existing Peasticks-Hillsboro 69 kV line section (10.5 miles) using 556.5 MCM ACSR/TW.	12/2020
Rebuild the existing Airport Road-Elliott Co Prison 69 kV line section (7.4 miles) using 556.5 MCM ACSR/TW.	12/2020
Rebuild the existing Elliott Co Prison-Newfoundland 69 kV line section (1.8 miles) using 556.5 MCM ACSR/TW.	6/2021

Re-conductor the Brodhead-Three Links Jct 69 kV line section (8.2 miles) using 556.5 MCM ACSR/TW.	12/2021
Re-conductor the Davis - Fayette 69kV line section (3.15 miles) using 556.5 MCM ACTW wire.	12/2021
Re-conductor Tharp Tap-KU Elizabethtown 69kV line section (2.11 miles) to 795 MCM ACSR.	12/2024
Rebuild Boone - Big Bone Tap 69kV line section (6.3 miles) using 556.5 MCM ACSR/TW.	12/2025

<b>EKPC 10-YEAR TRANSMISSION EXPANSION SCHEDULE (2017 – 2026)</b>	
<b>C. Transmission Line High Temperature Upgrades</b>	<b>Needed In-Service Date</b>
<b>Project Description</b>	
Increase the MOT of the Arkland Tap-Oven Fork 69 kV line section (4.3 miles) to 167°F.	6/2017
Increase the MOT of the Rowan County-Elliottville 69 kV line section (5.83 miles) to 167°F.	6/2017
Increase the MOT of the Mount Sterling-Fogg Pike-Reid Village 69 kV line section (3.2 miles) to 167°F.	6/2017
Increase the MOT of the Griffin-Griffin Junction 69 kV line section (6.4 miles) to 167°F.	6/2017
Increase the MOT of the Oakdale Jct.-Oakdale 69 kV line section (10.5 miles) to 167°F.	6/2019
Increase the MOT of the Davis Jct. - Nicholasville 69 kV line section (4.0 miles) to 266°F.	6/2021
Increase the MOT of the Plumville-Rectorville 69 kV line section (2.9 miles) to 212°F.	6/2021
Increase the MOT of the EKPC Elizabethtown Distribution #2 Tap - Tharp Tap 69 KV line section (1.7 miles) to 302°F.	12/2026

<b>EKPC 10-YEAR TRANSMISSION EXPANSION SCHEDULE (2017 – 2026)</b>	
<b>D. New Transmission Substations</b>	<b>Needed In-Service Date</b>
<b>Project Description</b>	
Construct new 138/69 kV station at the existing Hunt station site with a new 138-69 kV 100 MVA transformer.	12/2019

<b>EKPC 10-YEAR TRANSMISSION EXPANSION SCHEDULE (2017 – 2026)</b>	
<b>E. New Transmission Switching Stations</b>	<b>Needed In-Service Date</b>
<b>Project Description</b>	
Construct new North Shelby 69 kV switching station - LG&E/KU interconnection.	12/2018
Construct new Munk Junction 69 kV switching station.	12/2024

<b>EKPC 10-YEAR TRANSMISSION EXPANSION SCHEDULE (2017 – 2026)</b>	
<b>F. Transmission Transformer Upgrades/Additions</b>	<b>Needed In-Service Date</b>
<b>Project Description</b>	
Replace the existing 100 MVA 161-69 kV transformer bank at Bullitt County substation with a 150 MVA transformer.	11/2017
Add new Fox Hollow 161-69 kV 150 MVA transformer.	12/2020
Replace the existing 100 MVA 138-69 kV transformer bank at West Berea substation with a 150 MVA transformer.	12/2026

<b>EKPC 10-YEAR TRANSMISSION EXPANSION SCHEDULE (2017 – 2026)</b>	
<b>G. Capacitor Bank Additions</b>	<b>Needed In-Service Date</b>
<b>Project Description</b>	
Retire the Hilda 13.776 MVAR capacitor bank and move to Plummers Landing including the resize to 12.245 MVAR	12/2017
Install a 69 kV, 13.776 MVAR capacitor bank at Three Links substation	12/2019
Install a 22.96 MVAR, 69 kV capacitor bank at Owen County Substation.	12/2020
Resize the Williamstown 69 kV capacitor bank from 8.4 MVAR to 11.225 MVAR.	12/2021
Resize the Sideview 69 kV capacitor bank from 6.12 MVAR to 9.18 MVAR.	12/2023
Install a 25.511 MVAR, 69 kV capacitor bank at Sewellton Junction substation.	12/2024
Resize the Cedar Grove 69 kV capacitor bank from 10.8 to 22.45 MVAR.	12/2025
Resize the Albany 69 kV capacitor bank from 8.4 to 13.776 MVAR.	6/2026
Install a 69 kV, 15.31 MVAR capacitor bank at South Anderson substation.	12/2026
Raise Vlo setting for Newby 69 kV cap bank to 0.955 pu	12/2026



<b>EKPC 10-YEAR TRANSMISSION EXPANSION SCHEDULE (2016 – 2025)</b>	
<b>H. Terminal Facility Upgrades</b>	<b>Needed In-Service Date</b>
<b>Project Description</b>	
Install a 69 kV normally open breaker at Shelby County connecting the KU Shelbyville South and Logan 69 kV line sections.	4/2017
Add a new 69 kV breaker at Thelma for the Thelma - AEP Thelma 69 kV tie.	12/2017
Increase the distance relay setting at Elizabethtown associated with Elizabethtown-Elizabethtown #2 to at least 126 MVA LTE.	12/2017
Increase the overcurrent relay at Bullitt County associated with Bullitt County 161-69 kV transformer to at least 178 MVA LTE Winter.	12/2018
Increase the Zone 3 distance relay setting at Baker Lane associated with the Baker Lane-Holloway Jct. 69 kV line to at least 142 MVA LTE Winter. Upgrade the 600 A disconnect switch W43-605 at Baker Lane associated with the Baker Lane-Holloway Jct. 69 kV line using a 1200 A switch.	12/2018
Replace the existing 5% impedance 1200 A line reactor on the Spurlock-KU Kenton 138kV line section with a 6.5% impedance 1600 A unit.	6/2021
Increase the overcurrent relay at West Berea associated with West Berea 138-69 kV transformer to at least 178 MVA LTE Winter.	12/2021
Upgrade CT associated with Bullitt County 161-69 kV transformer to at least 200 MVA Winter LTE	12/2022
Upgrade CTs (2) associated with the East Bardstown – KU Bardstown Industrial Tap 69 kV line section to 1200 A, at least 100 MVA Winter LTE; Upgrade existing East Bardstown bus and jumpers from 4/0 to 500 MCM copper or equivalent.	12/2023
Upgrade the 4/0 bus and jumpers at the Denny substation associated with the Denny-Gregory Road Tap line using 500 MCM copper or equivalent.	6/2024
Upgrade CT associated with Clay Village - KU Clay Village Tap 69 kV line section to 600A; at least 64 MVA Winter LTE; Upgrade distance relay associated with Clay Village - KU Clay Village Tap 69 kV line section to at least 64 MVA Winter LTE	12/2024
Upgrade distance relay associated with Stephensburg - Glendale 69 kV line section to at least winter LTE 100 MVA	12/2024
Upgrade the existing S408-605, 600 A Russell Spring KU Tap-Russell County disconnect switch to 1200A.	12/2025
Upgrade overcurrent relay associated with Powell Co 138-69 kV transformer to at least 139 MVA Winter LTE	12/2025

Upgrade the 4/0 bus and jumpers at Three Links Jct. substation associated with the West Berea Jct.-Three Links Jct. 69 kV line using 500 MCM copper or equivalent.	12/2026
Upgrade disconnect switches W53-625 and W61-635 associated with Davis - Fayette 69 kV line section to 1200A	12/2026
Upgrade distance relay associated with Glendale - Hodgenville 69 kV line section to at least 90 MVA Winter LTE	12/2026

<b>EKPC 10-YEAR TRANSMISSION EXPANSION SCHEDULE (2017 – 2026)</b>	
<b>I. New Distribution Substations and associated Tap Lines</b>	<b>Needed In-Service Date</b>
<b>Project Description</b>	
Construct a new Big Woods 69-12.5 kV, 12/16/20 MVA substation and associated 69 kV tap line (0.2 mile)	6/2017
Construct a new Duncannon Lane 69-12.5 kV 12/16/20 MVA substation and associated 69 kV tap line (1.0 miles) to the Fawkes - Crooksville 69 kV line section.	6/2018
Construct a new Contown 69-12.5 kV, 12/16/20 MVA substation and associated 69 kV tap line (0.2 mile) to the Phil - Creston 69 kV line section.	12/2019
Construct a new Pekin Pike 69-12.5 kV, 12/16/20 MVA substation and associated 69 kV tap line (6.4 Mile) to the Baker Lane – Holloway Jct. 69 kV line section.	12/2019
Rebuild the existing 69-12.5 kV Millers Creek substation at 161-12.5 kV 12/16/20 MVA substation and associated 161 kV tap line (~0.6 miles) to the Powell County – Beattyville 161 kV line section.	12/2019
Construct a new Broughtontown 69-25 kV, 12/16/20 MVA Substation and associated 69 kV tap line (7.4 mile) to the Highland – Tommy Gooch 69 kV line section.	12/2021

<b>EKPC 10-YEAR TRANSMISSION EXPANSION SCHEDULE (2017 – 2026)</b>	
<b>J. Distribution Substation Additions and Upgrades</b>	<b>Needed In-Service Date</b>
<b>Project Description</b>	
Upgrade the HQ Office 69-12.5 kV, 2.5 MVA substation to 12/16/20 MVA	9/2017
Upgrade the McKinney’s Corner 69-12.5 kV, 6 MVA substation to 12/16/20 MVA.	12/2018
Upgrade the existing Shepherdsville #2 69-12.5 kV, 11.2/14 MVA substation to 12/16/20 MVA.	6/2019
Upgrade Mile Lane 69-12.5 kV, 11.2/14 MVA substation to 12/16/20 MVA.	6/2020

# Price Elasticity of Demand

## 1 Introduction

East Kentucky Power Cooperative, Inc. (“EKPC”) filed an Integrated Resource Plan (“IRP”) with the Kentucky Public Service Commission (“KPSC”) on April 23, 2012<sup>1</sup>. The KPSC Staff filed a report titled “Staff Report on the 2012 Integrated Resource Plan of East Kentucky Power Cooperative, Inc. “, on September 2013. In its report, Staff recommended that “EKPC should discuss and report separately the impact on demand and energy forecasts of any projected increases in the price of electricity to its ultimate customers in its next IRP. The price elasticity of the demand for electricity should be fully examined and discussed, and a sensitivity analysis should be performed.”

## 2 Study Objective

EKPC engaged GDS Associates, Inc. (“GDS”) to conduct an independent study to estimate price elasticity of demand from primary source data to allow EKPC forecasters to verify and refine the elasticity assumptions that have been assumed for previous planning analyses, and to provide a basis for elasticity assumptions used in future load forecasts. Additionally, in efforts to provide support for EKPC’s analysis, the study entailed conducting secondary research to identify price elasticity study results conducted by other electric utilities and research firms. In response to the recommendation made by Staff, this report presents the estimated impact of potential increases in the price of electricity to EKPC’s ultimate customers. Additionally, results of the study provide the input necessary to conduct sensitivity analysis in EKPC’s next load forecast and IRP.

## 3 Methodology

Econometric modeling was used to perform the price elasticity analysis. Multiple model specifications were investigated to help provide a reasonable range of elasticity estimates. Models were developed at the aggregate EKPC level by customer class and at the member distribution cooperative level by class. All models were analyzed using data on an annual and monthly basis. GDS developed the methodology, conducted the analysis, and reviewed the methodology and results with EKPC staff prior to publishing this report.

### 3.1 Data

A database of the components necessary to build econometric models was developed by EKPC and provided to GDS. This section describes the data and sources used for the analysis.

#### 3.1.1 Utility Billing History

Monthly number of customers, kWh sales, and revenues by revenue class (residential, commercial, industrial, street lighting, and public authorities) were compiled for each member cooperative for January 2000 through September 2014.

The residential class represents 93% of the total number of customers served by EKPC’s member distribution cooperatives. In 2013, the class represented 58% of total energy sales, totaling 6,900 GWh. Residential energy sales have grown by an average compound rate of 1.6% per year from 2000 through 2013.


---

<sup>1</sup> KPSC Case No. 2012-00149

The commercial class, including public authority accounts, represented 7% of EKPC’s customers and 18% of energy sales in 2013. In terms of both number of customers and energy sales, the class grew faster than the residential class from 2000 through 2013. Energy sales averaged 2.1% per year in compound growth.

The industrial class consists of less than 150 total accounts, but represented 25% of total energy sales in 2013. Growth in the industrial class has been healthy, averaging 2.2% per year in energy sales growth.

Figure 2.1 – Energy Sales by Class (2000-2013)

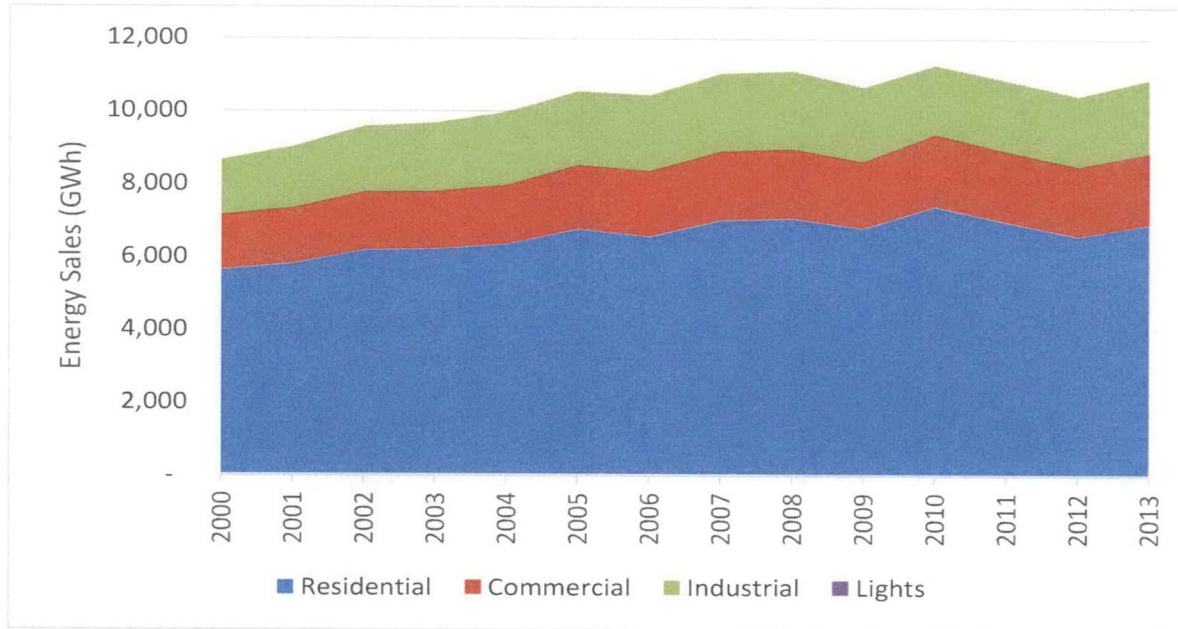

### 3.1.2 Price of Electricity

Nominal price of electricity was computed using the utility billing history. Annual average revenue per kWh was used to represent nominal price each year. The Purchase Consumption Expenditure (“PCE”) deflator, provided by Woods & Poole Economics, Inc., was used to compute real price of electricity. The annual real price of electricity was used to represent price in every month for econometric models developed using monthly data.

Table 2.1 – Purchase Consumption Expenditure Deflator (2009=100)


Year	PCE	Year	PCE
2000	83.1	2008	100.1
2001	84.7	2009	100.0
2002	85.9	2010	101.7
2003	87.6	2011	104.1
2004	89.7	2012	106.0
2005	92.3	2013	107.3
2006	94.7	2014	109.4
2007	97.1		

Real residential price has risen by an average of 7% per year from 2000 through 2013. Commercial and industrial prices have risen a little more modestly at 5% per year.

Figure 2.2 – Residential Price (EKPC Total)



Figure 2.3 – Commercial and Industrial Price (EKPC Total)

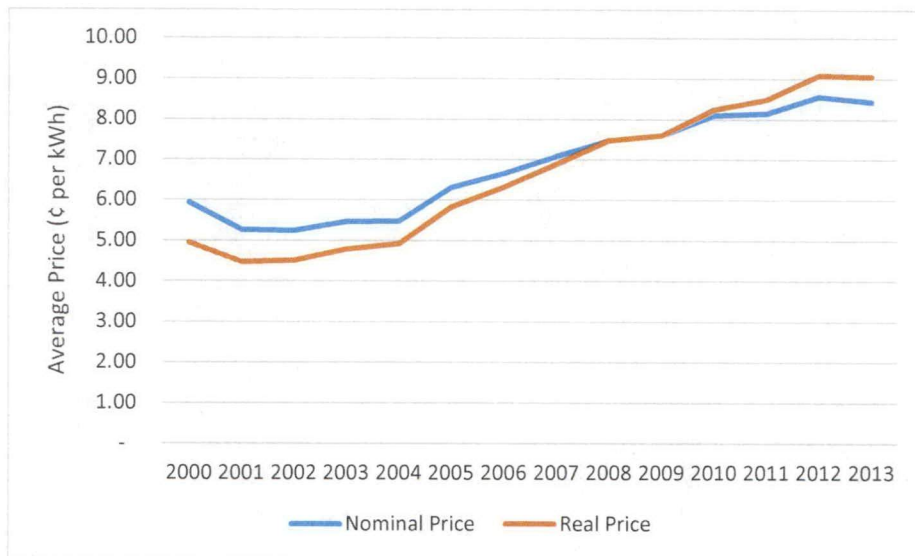

### 3.1.3 Weather Data

Monthly heating degree days (“HDD”) and cooling degree days (“CDD”) were obtained from the National Oceanic and Atmospheric Association (“NOAA”). Seven weather stations are used to represent local climatological conditions for EKPC’s members (see Table 2.2). Due to the fact that reported kWh sales are

often based on billing cycle readings and weather data are perfect calendar months, models were tested using actual month weather data, one month lag of weather data, and an average of the current and prior month.

Table 2.2 – Weather Station Assignment

Weather Station	EKPC Member Cooperatives Assigned to Station
Lexington, KY	Blue Grass Energy Cooperative, Clark Energy Cooperative, Inter-County Energy Cooperative
Bowling Green, KY	Farmers RECC, Taylor County RECC
Covington, KY	Fleming-Mason Energy Cooperative, Owen Electric Cooperative
Huntington, WV	Grayson RECC
Jackson, KY	Big Sandy RECC, Cumberland Valley Electric, Jackson Energy Cooperative, Licking Valley RECC
Louisville, KY	Nolin RECC, Salt River Electric Cooperative, Shelby Energy Cooperative
Somerset, KY	South Kentucky RECC

For the EKPC aggregate analyses, weighted average HDD and CDD were computed using class sales assigned to each weather station in each month as the weighting factors.

#### 3.1.4 Economic Data

Economic time series data for each member cooperative’s service territory was collected from IHS Global Insight<sup>2</sup>. Global Insight draws data from the US Census Bureau, the Bureau of Labor Statistics, and the Bureau of Economic Analysis to develop historical economic time series. For this study, population, real total personal income, and employment were included in the analysis database.


#### 3.1.5 Residential End-Use Appliance Data

Residential electric appliance saturation data was provided to GDS by EKPC staff. The most recent survey was completed in 2013, and surveys have been conducted every two to three years since 1981. EKPC staff interpolated market share information for the intervening years. Appliance efficiency trends over time for major end-use appliances (HVAC equipment and water heaters) were obtained from the Energy Information Administration’s (“EIA”) Annual Energy Outlook. Appliance saturations are specific to the member service territories. Appliance efficiencies are assumed to be consistent for the entire EKPC territory.

---

<sup>2</sup> Economic Outlook, March 2014

Figure 2.4 – Residential Electric End-Use Saturations (EKPC Total)

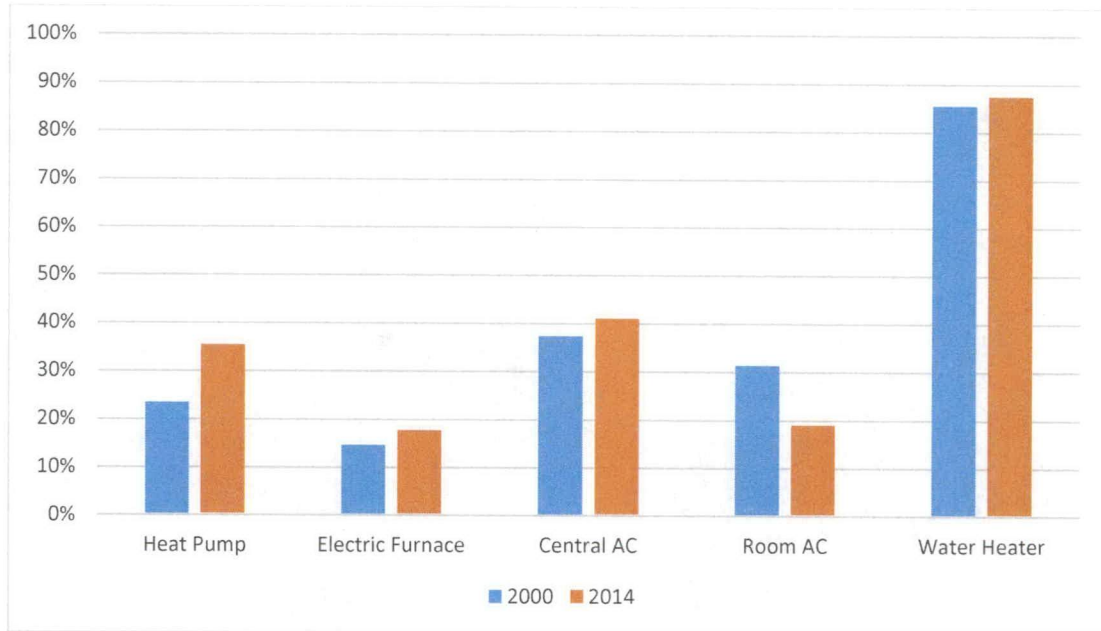

### 3.2 Econometric Modeling

Several econometric model specifications were designed and tested to evaluate price elasticity of demand. Furthermore, models were developed for the entire EKPC territory in aggregate and for each individual member distribution cooperative. The following sections describe the model designs for the residential and commercial classes. Resultant elasticity estimates produced by these models are provided in Section 3.

#### 3.2.1 Residential Models

Three separate model specifications were tested for the residential price elasticity estimate, one using monthly data and two using annual data. Equations 2.1 through 2.3 show the models tested for aggregate EKPC residential usage. Equations 2.1 and 2.2 were tested for individual member cooperatives.

##### Equation 2.1

$$AvgUse_{y,m} = \beta_0 + \beta_1 RealPrice_y + \beta_2 PCAPInc_{y,m} + \beta_3 WHDD_{y,m} + \beta_4 WCDD_{y,m} + \varepsilon_{y,m}$$

##### Equation 2.2

$$AvgUse_y = \beta_0 + \beta_1 RealPrice_y + \beta_2 PCAPInc_y + \beta_3 WHDD_y + \beta_4 WCDD_y + \varepsilon_y$$

##### Equation 2.3

$$\ln(AvgUse_y) = \beta_0 + \beta_1 \ln(RealPrice_y) + \beta_2 \ln(PCAPInc_y) + \beta_3 \ln(WHDD_y) + \beta_4 \ln(WCDD_y) + \varepsilon_y$$



Where:

$\beta_0, \beta_1, \beta_2, \beta_3,$ and $\beta_4$	Regression coefficients
y	Index for the year
m	Index for the month
AvgUse	Residential average usage (kWh per customer)
RealPrice	Real price of electricity
PCAPInc	Per capita income
wHDD	Weighted heating degree days (see further explanation below)
wCDD	Weighted cooling degree days (see further explanation below)
Ln	Natural logarithm
$\varepsilon$	Error term

For some of the individual member models, per capita income had a negative coefficient or had a coefficient with a p-value well in excess of 0.20. A negative coefficient for per capita income is theoretically incorrect, indicating average household energy consumption declines as income increases. In such instances, per capita income was removed from the models.

GDS also tested for first order autocorrelation in the residuals using the Durbin-Watson statistic. In models in which autocorrelation was evident, a first order autoregressive parameter was included in the model to correct for the correlation. This correction helps produce unbiased and more efficient estimators of the coefficients relative to a model with correlated residuals and no autoregressive parameter.

### 3.2.1.1 Weighted HDD and CDD

For the residential models, HDD and CDD were weighted to take electric appliance market share and efficiency into account. In theory, average usage will be more sensitive to weather as weather-sensitive electric appliances are added to the home (HVAC and water heaters). Likewise, as those appliances become more efficient, average usage will become less sensitive to weather. Therefore, a weighting scheme is developed for the HDD and CDD that effectively multiplies the weather variables by market share (direct relationship) and divides by an index for the change in efficiency over time (indirect relationship). For example, the weights for HDD in January 2000 and January 2014 are shown in table 2.3.

Table 2.3 – Example Development of HDD weights

Line No.	Item	Formula	January 2000	January 2014
[1]	Heat Pump Saturation		0.234	0.351
[2]	Heat Pump Efficiency (HSPF)		6.830	7.550
[3]	Efficiency Index (Sep 2014=1.00)		0.896	0.991
[4]	Heat Pump Weight	[1]÷[3]	0.261	0.354
[5]	Electric Furnace Saturation		0.146	0.175
[6]	Furnace Efficiency		3.410	3.410
[7]	Efficiency Index (Sep 2014=1.00)		1.000	1.000
[8]	Heat Pump Weight	[5]÷[7]	0.146	0.175
[9]	Weight for HDD	[4]+[8]	0.407	0.529

### 3.2.2 Small Commercial Models – EKPC Aggregate

Three separate model specifications were tested for the aggregate EKPC small commercial price elasticity estimate, one using monthly data and two using annual data. Equations 2.4 through 2.6 show the models tested.

#### Equation 2.4

$$AvgUse_{y,m} = \beta_0 + \beta_1 RealPrice_y + \beta_2 Emp_{y,m} + \beta_3 HDD_{y,m} + \beta_4 CDD_{y,m} + \varepsilon_{y,m}$$

#### Equation 2.5

$$AvgUse_y = \beta_0 + \beta_1 RealPrice_y + \beta_2 Emp_y + \beta_3 HDD_y + \beta_4 CDD_y + \varepsilon_y$$

#### Equation 2.6

$$Ln(AvgUse_y) = \beta_0 + \beta_1 Ln(RealPrice_y) + \beta_2 Ln(Emp_y) + \beta_3 Ln(HDD_y) + \beta_4 Ln(CDD_y) + \varepsilon_y$$

Where:

$\beta_0, \beta_1, \beta_2, \beta_3,$ and $\beta_4$	Regression coefficients
y	Index for the year
m	Index for the month
AvgUse	Residential average usage (kWh per customer)
RealPrice	Real price of electricity
Emp	Employment
HDD	Billing cycle heating degree days
CDD	Billing cycle cooling degree days
Ln	Natural logarithm
$\varepsilon$	Error term

### 3.2.3 Industrial Models – EKPC Aggregate

Three separate model specifications were tested for the industrial price elasticity estimate for aggregate EKPC industrial sales, one using monthly data and two using annual data. Equations 2.7 through 2.9 show the models tested.

#### Equation 2.7

$$AvgUse_{y,m} = \beta_0 + \beta_1 RealPrice_y + \beta_2 Emp_{y,m} + \sum_m \beta_{3,m} I_m + \varepsilon_{y,m}$$

#### Equation 2.8

$$AvgUse_y = \beta_0 + \beta_1 RealPrice_y + \beta_2 Emp_y + \varepsilon_y$$

#### Equation 2.9

$$Ln(AvgUse_y) = \beta_0 + \beta_1 Ln(RealPrice_y) + \beta_2 Ln(Emp_y) + \varepsilon_y$$

Where:

$\beta_0, \beta_1, \beta_2,$ and $\beta_{3,m}$	Regression coefficients
$y$	Index for the year
$m$	Index for the month
AvgUse	Residential average usage (kWh per customer)
RealPrice	Real price of electricity
Emp	Employment
$I_m$	Indicator variable for month $m$
Ln	Natural logarithm
$\varepsilon$	Error term

### 3.2.4 Commercial and Industrial Models by Member Cooperative

Econometric models consistent with Equation 2.4 were run for the combined commercial and industrial classes by member cooperative. As will be discussed further in Section 3, however, it was difficult to produce models for some members that provided theoretically sound results for price elasticity.

## 4 Results and Conclusions

At the EKPC aggregate level, the multiple econometric specifications produced elasticity estimates that were statistically equivalent at 90% confidence. The residential models by member cooperative produced a wider array of results as might be expected, but all provided a theoretically correct negative price elasticity estimate. The same cannot be said for all C&I models at the member cooperative level.

### 4.1 Residential Elasticity

The measured overall price elasticity of demand is approximately -0.25, indicating that a 1% increase in real prices will result in a 0.25% decrease in residential average usage per household across the entire EKPC system. Individual member results vary from a low of -0.02 to a high of -0.73. The higher variability in elasticity estimates at the member level is more likely a function of the data than a true significant difference in price response across different territories. Data adjustments, alignment of billing cycles with weather, and other anomalies are more likely to impact results at the member-level, whereas aggregate data will help average out some of that noise in the data and provide a truer estimate of overall price sensitivity.

Table 3.1 – Aggregate EKCP Residential Price Elasticity Estimates

Model Specification	Estimated Price Elasticity
Monthly Model (Equation 2.1)	-0.271
Annual Model (Equation 2.2)	-0.247
Annual Log-Log Model (Equation 2.3)	-0.181

None of the elasticity estimates shown in Table 3.1 can be verified as statistically different from the others at 90% confidence. Three separate modeling approaches providing consistent results supports the conclusion that the estimated elasticity is reasonable.

Table 3.2 – Member Cooperative Residential Price Elasticity Estimates

Member	Monthly Model (Equation 2.1) Price Elasticity Estimate	Annual Model (Equation 2.2) Price Elasticity Estimate
Jackson Energy Cooperative	-0.730	-0.298
Salt River Electric Cooperative	-0.023	-0.131
Taylor County RECC	-0.069	-0.488
Inter-County Energy Coop.	-0.172	-0.124
Shelby Energy Cooperative	-0.049	-0.035
Farmers RECC	-0.260	-0.223
Owen Electric Cooperative	-0.239	-0.062
Clark Energy Cooperative	-0.190	-0.187
Nolin RECC	-0.156	-0.116
Fleming-Mason Energy Coop.	-0.201	-0.287
South Kentucky RECC	-0.232	-0.177
Licking Valley RECC	-0.105	-0.076
Cumberland Valley Electric	-0.333	-0.060
Big Sandy RECC	-0.163	-0.194
Grayson RECC	-0.517	-0.240
Blue Grass Energy Cooperative	-0.128	-0.121
<b>Weighted Average*</b>	<b>-0.233</b>	<b>-0.168</b>

\* Weights based on 2013 residential energy sales.

Given that: a) noise in billing data has more impact at the member level, and b) for some member models, per capita income did not have significance in the model, GDS recommends that EKPC use a consistent price elasticity estimate based on the aggregated model results provided in Table 3.1. **It is concluded that an elasticity in the range of -0.20 and -0.30 would be a reasonable assumption based on the results of this analysis.**

#### 4.2 Commercial and Industrial Elasticity

Commercial and industrial price elasticity estimates are lower than residential. The small commercial class has an elasticity of approximately -0.10 and the industrial class is about -0.05. Smaller commercial accounts might be quite price inelastic due to several factors, including having little control over electricity consumption (for instance a convenience store with many freezers and refrigerator cases), being a tenant that does not pay the electric bill, or having electricity generally be a small proportion of the budget. Furthermore, large commercial and industrial accounts are unlikely to alter operations in response to small changes in price, but there is certainly a point where, if price goes too high or margins are too low for a company, they might stop operation altogether or shut down a shift, causing a large response to price at some certain threshold. It is reasonable to assume that, as a class, commercial customers are less sensitive to long-term price changes than are residential customers.

Table 3.3 – Aggregate EKPC Commercial and Industrial Price Elasticity Estimates

Model Specification	Small Commercial Price Elasticity	Industrial Price Elasticity
Monthly Model (Equations 2.4 and 2.7)	-0.149	-0.102
Annual Model (Equation 2.5 and 2.8)	-0.117	-0.034
Annual Log-Log Model (Equation 2.6 and 2.9)	-0.097	-0.030

At the member distribution cooperative level, several of the models were unable to measure a statistically significant (indicating a likelihood of a zero elasticity) or theoretically correct (negative coefficient) price elasticity. Due to some members having very few industrial accounts, the member-level analysis was conducted for the commercial and industrial customers in aggregate. As with the residential elasticity, GDS would recommend use of a system-wide elasticity estimate for EKPC’s load forecasting. An elasticity assumption in the range of -0.05 to -0.15 is for all commercial and industrial customers based on this analysis.

Table 3.4 – Member Cooperative C&I Price Elasticity Estimates

Member	Monthly Model (Equation 2.4) Price Elasticity Estimate
Jackson Energy Cooperative	-0.177
Salt River Electric Cooperative	-0.045
Taylor County RECC	-0.090
Inter-County Energy Coop.	-0.396
Shelby Energy Cooperative	n/a <sup>1</sup>
Farmers RECC	-0.221
Owen Electric Cooperative	-0.285
Clark Energy Cooperative	-0.131
Nolin RECC	-0.473
Fleming-Mason Energy Coop.	-0.067
South Kentucky RECC	n/a <sup>1</sup>
Licking Valley RECC	-0.023
Cumberland Valley Electric	n/a <sup>1</sup>
Big Sandy RECC	-0.175
Grayson RECC	-0.384
Blue Grass Energy Cooperative	-0.094

### 4.3 Secondary Research

Secondary research included a review of publically available information related to current price elasticity estimates being made by others in the industry. **Results of the review are provided below and confirm that the elasticity estimates derived for EKPC are consistent with industry estimates.**

Many utilities filing Integrated Resource Plans (“IRP”) with regulatory commissions throughout the country make reference to using price of electricity in their forecasting models. However, many either do not indicate the assumed or resultant price elasticities, or they protect the information under confidentiality arrangements. GDS identified three utilities that included elasticity information publicly in

their IRP reports. Delmarva Power and Light reported a residential elasticity of -0.13 in its 2014 IRP. They assumed a price elasticity of demand of -0.04 for commercial and -0.14 for industrial. Ameren Missouri's 2014 IRP states that the residential price elasticity they use is -0.14. They also reference a study conducted a few years prior to the 2014 IRP in which they estimated a residential elasticity of -0.16. Big Rivers Electric Corporation<sup>3</sup> reported a price elasticity of -0.18 for all rural customers combined in their 2014 IRP. KU/LGE reports in its March 2014 IRP that they used elasticity estimates of -0.1 for residential and -0.05 for commercial. These estimates are all reasonably consistent with the results obtained for EKPC.

The National Renewal Energy Laboratory ("NREL") completed an analysis of price elasticity in February 2006.<sup>4</sup> They found national residential elasticity of -0.24 and an elasticity of -0.27 for the East South Central region (of which Kentucky is a part). The estimated nationwide commercial price elasticity was -0.21 and the East South Central estimate was -0.27. Although the commercial elasticity estimates for NREL are higher than the EKPC estimates, they are close enough for practical purposes<sup>5</sup>. NREL also conducted analysis at the state level and determined that the price elasticity coefficient for the Kentucky model was not significantly different than zero for both the residential and commercial classifications.

Finally, GDS examined an analysis conducted by the EIA<sup>6</sup>. The study examined, in part, the impacts on energy consumption of potential policies that would limit energy-related carbon dioxide emissions. More specifically, the impacts of a future fee on CO<sub>2</sub> emissions were analyzed for three carbon-fee cases, \$10, \$20, and \$30 per metric ton of CO<sub>2</sub> in 2020 and rising by 5 percent per year annually thereafter. The EIA study was conducted at the national level and for each Census region. EIA reports that the electricity sector alters investment and operating decisions to reduce CO<sub>2</sub> emissions in response to CO<sub>2</sub> fees, and customers react to resulting higher retail electricity prices by cutting demand. An analysis of the changes in electricity prices and energy consumption for the three carbon-fee cases relative to the EIA reference case was performed, and the elasticity of demand (energy consumption) with respect to price for the residential and commercial sectors combined was -0.21 for the East South Central region.

#### 4.4 Conclusions

Based on the analysis conducted, various model specifications produce stable elasticity estimates for the residential and commercial customer classes. Results at the aggregate EKPC level produce reliable estimates of long-term price elasticity of demand for electricity consumption. The range of values estimated from models at the member cooperative level are somewhat volatile but within a reasonable range of the aggregate estimates. GDS recommends use of the aggregate model results for purposes of analyzing load response to price anywhere in the EKPC territory. Furthermore, the estimates derived in

---

<sup>3</sup> GDS prepared Big Rivers' 2014 IRP, including performing the price elasticity analysis. The elasticity assumption was reported in the public version of the IRP.

<sup>4</sup> Bernstein, M.A. and J. Griffin. "Regional Differences in the Price-Elasticity of Demand for Energy." NREL, Subcontractor Report NREL/SR-620-39512. February 2006.

<sup>5</sup> Although the elasticity estimate of -0.1 for EKPC is half as much as the elasticity estimate of -0.2 for NREL's regional model, the estimated load reduction per 1% increase in price is only 0.1% different between the two assumptions.

<sup>6</sup> Energy Information Administration, *Further Sensitivity Analysis of Hypothetical Policies to Limit Energy-Related Carbon Dioxide Emission*, Supplement to the Annual Energy Outlook 2013, July 2013.  
[http://www.eia.gov/forecasts/aeo/supplement/co2/pdf/aeo2013\\_supplement.pdf](http://www.eia.gov/forecasts/aeo/supplement/co2/pdf/aeo2013_supplement.pdf)

this analysis are consistent with the price elasticity assumptions used by the US Energy Information Administration for its Annual Energy Outlook forecasting, providing greater confidence in the results obtained herein.

- GDS recommends using a **RESIDENTIAL** price elasticity in the range of **-0.20 TO -0.30** as a reasonable assumption for load forecasting residential price sensitivities.
- GDS recommends using a **COMMERCIAL** price elasticity in the range of **-0.05 TO -0.15** as a reasonable assumption for load forecasting commercial price sensitivities.