

KEYED

- \bigcirc IN THE EXISTING SOUTH FLOCCULATION BASIN, REMOVE THE EXISTING EQUIPMENT IN THEIR ENTIRETY CONSISTING OF, BUT NOT LIMITED TO THE PADDLES, BAFFLES, GEARBOXES AND MOTORS, ETC. THE HANDRAILS AROUND THE BASINS SHALL ALSO BE REMOVED IN THEIR ENTIRETY. THE BASINS SHALL BE FILLED WITH APPROVED STRUCTURAL FILL MATERIAL AND A CONCRETE CAP SHALL BE POURED AT THE TOP, FLUSH WITH THE SURROUNDING CONCRETE. FOR DETAIL OF THE FILL MATERIAL, AND CONCRETE CAP REINFORCEMENT, SEE THE STRUCTURAL DRAWINGS.
- THE EXISTING WEIR GATES SHALL BE REMOVED, AND THE OPENING FILL WITH CONCRETE, FLUSH WITH THE INSIDE FACE OF THE WALL. THE 24" DIA. OVERFLOW PIPES SHALL BE REMOVED, DOWN TO THE BOTTOM OF THE FLOCCULATION BASIN AND THE PIPE SHALL BE FILLED WITH NON-SHRINK GROUT.

(2)

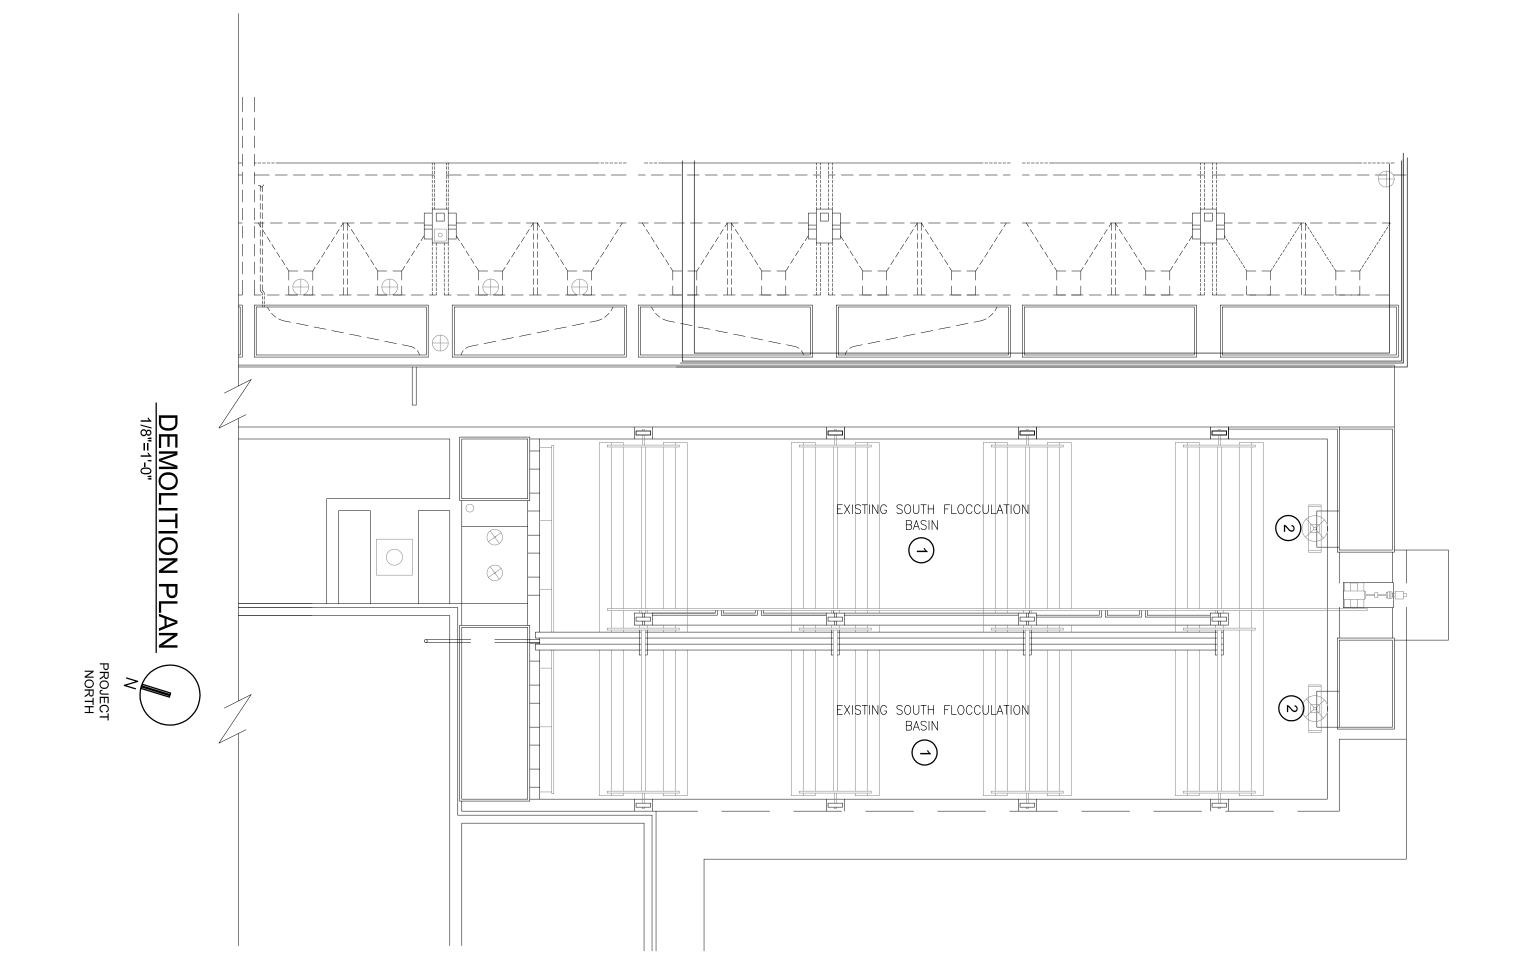

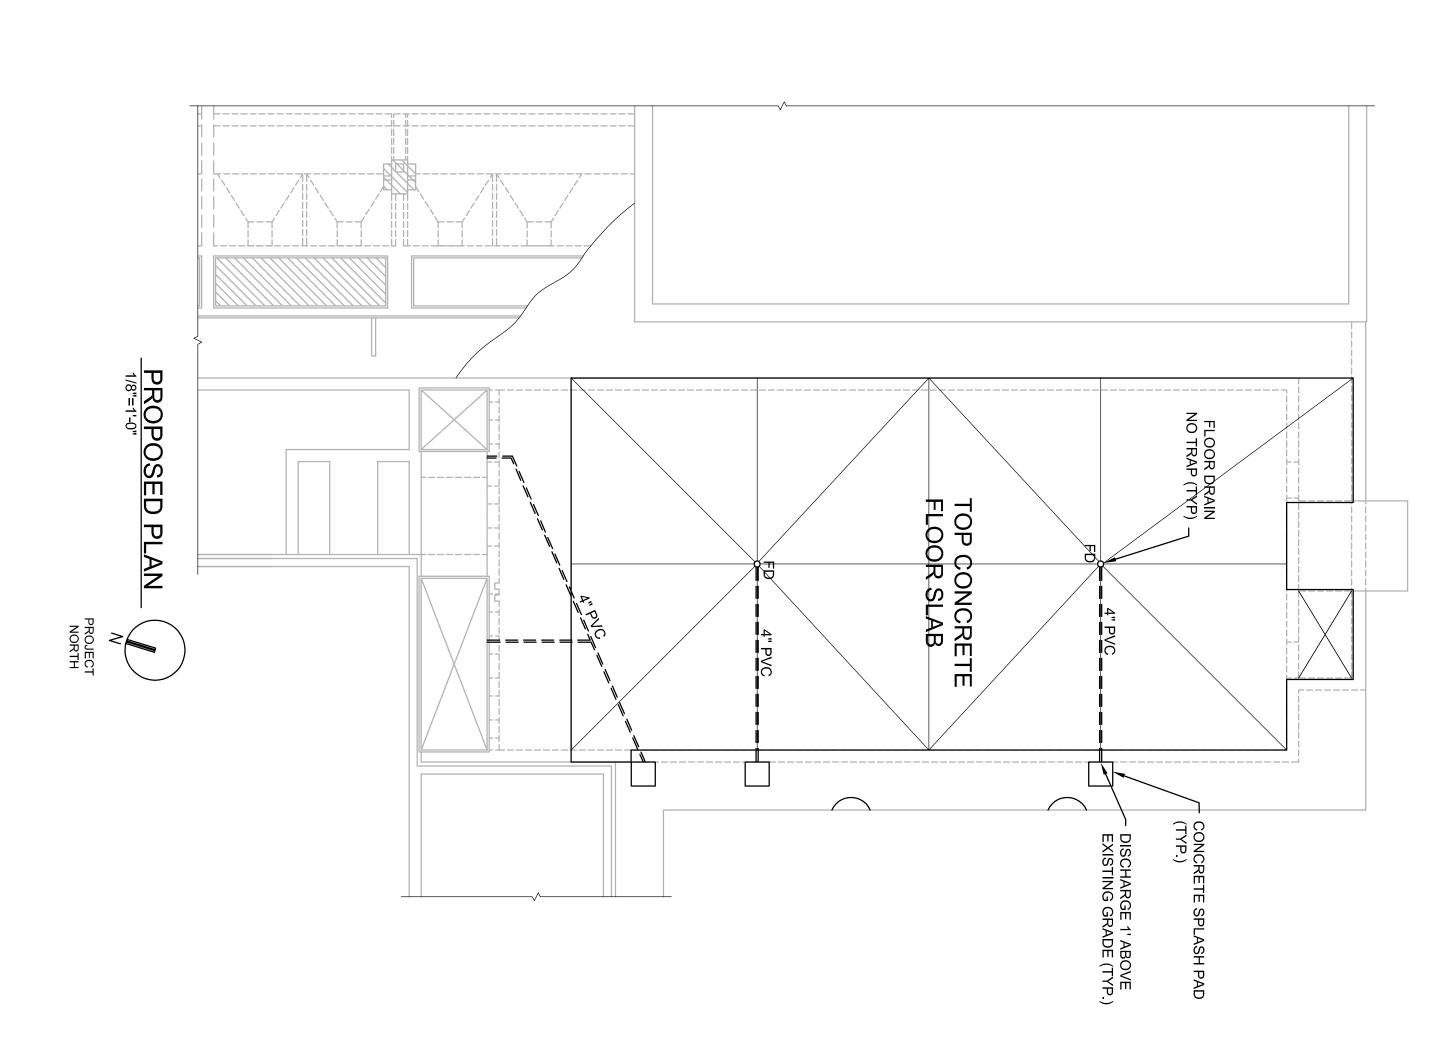

Water District CH2MHILL HDR ADVANCED TREATMENT PROCESS MECHANICAL FLOCCULATION BASIN MEMORIAL PARKWAY TREATMENT PLANT **DEMOLITION PLAN AND** NO. DATE BY APVD NORTHERN KENTUCKY WATER DISTRICT REVISION DSGN APVD PROPOSED PLAN DR CHK FORT THOMAS, KENTUCKY



BID DOCUMENTS

JRB D RAMSEY REUSE OF DOCUMENTS: THIS DOCUMENT, AND THE IDEAS AND DESIGNS INCORPORATED HEREIN, AS AN INSTRUMENT OF PROFESSIONAL SERVICE, IS THE PROPERTY OF CH2M HILL AND IS NOT TO BE USED, IN WHOLE OR IN PART, FOR ANY OTHER PROJECT WITHOUT THE WRITTEN AUTHORIZATION OF CH2MHILL.

B TIPPEY ©CH2M HILL 2004. ALL RIGHTS RESERVED.