

ATTACHMENT H

Time line of events and actions from 0354 to 1225 on 12/6/11.

(Weather) Cold and Rainy

0354 – Order created by LG&E for customer reporting an outside leak.

0354 – Order dispatched to Gas Trouble Technician (Kenneth Peavler)

0357 – Dispatched order to Gas Trouble Technician.

0415 – Second call from customer

0416 – Text message to Gas Technician

0418 – Gas Technician acknowledges and proceeds en route to River Trail Place

0430 – Gas Technician arrives onsite

0512 – Gas Technician requests a gas construction crew

0517 – On call crew leader was contacted

0519 – On call mechanic was contacted

0520 – Gas technician was informed construction crew was en route

0533 – “811” Emergency locate was called in to locate 200 foot radius from the intersection of Queens Castle and River Trail Place.

0533 to 0652 – Kenneth Peavler states in 2/8/12 Interviews he contacted his supervisor and waited for construction crew to arrive.

0652 – Construction crew arrives onsite

0703 – LG&E dispatch receives notification 5206 River Trail Place house explosion from team leader.

0704 – Operations manager is informed of the explosion

0752 – Construction crews start digging in front of 5133 Queens Castle Rd. to prepare for squeeze off.

0756 – Construction crew begins digging hole at end of street.

0757 – Fire Department reports high gas readings in the 5200 block of River Trail Place and starts evacuations.

0800 – 0809 Fire Dept. notices additional LG&E construction crews assisting digging bell holes and beginning the squeeze off process at 5202,5210 River Trail Place and 5131 Queens Castle Rd.

0820 – LG&E has all 3 locations squeezed off.

0823 – Gas flow is reduced 99% at sewer manhole and storm catch basins.

0825 – Bill Aitken(PSC) is informed of the incident from Keith McBride (LG&E)

0946 – Telephonic report to the National Response Center

1020 – Steve Samples and Joel Grugin arrive onsite of the incident

1211 – Gas service line supplying 5207 River Trail Place has water in service line and tests positive for the presence of chlorine.

1225 – MSD reports their lines are now clear of any natural gas.








5206







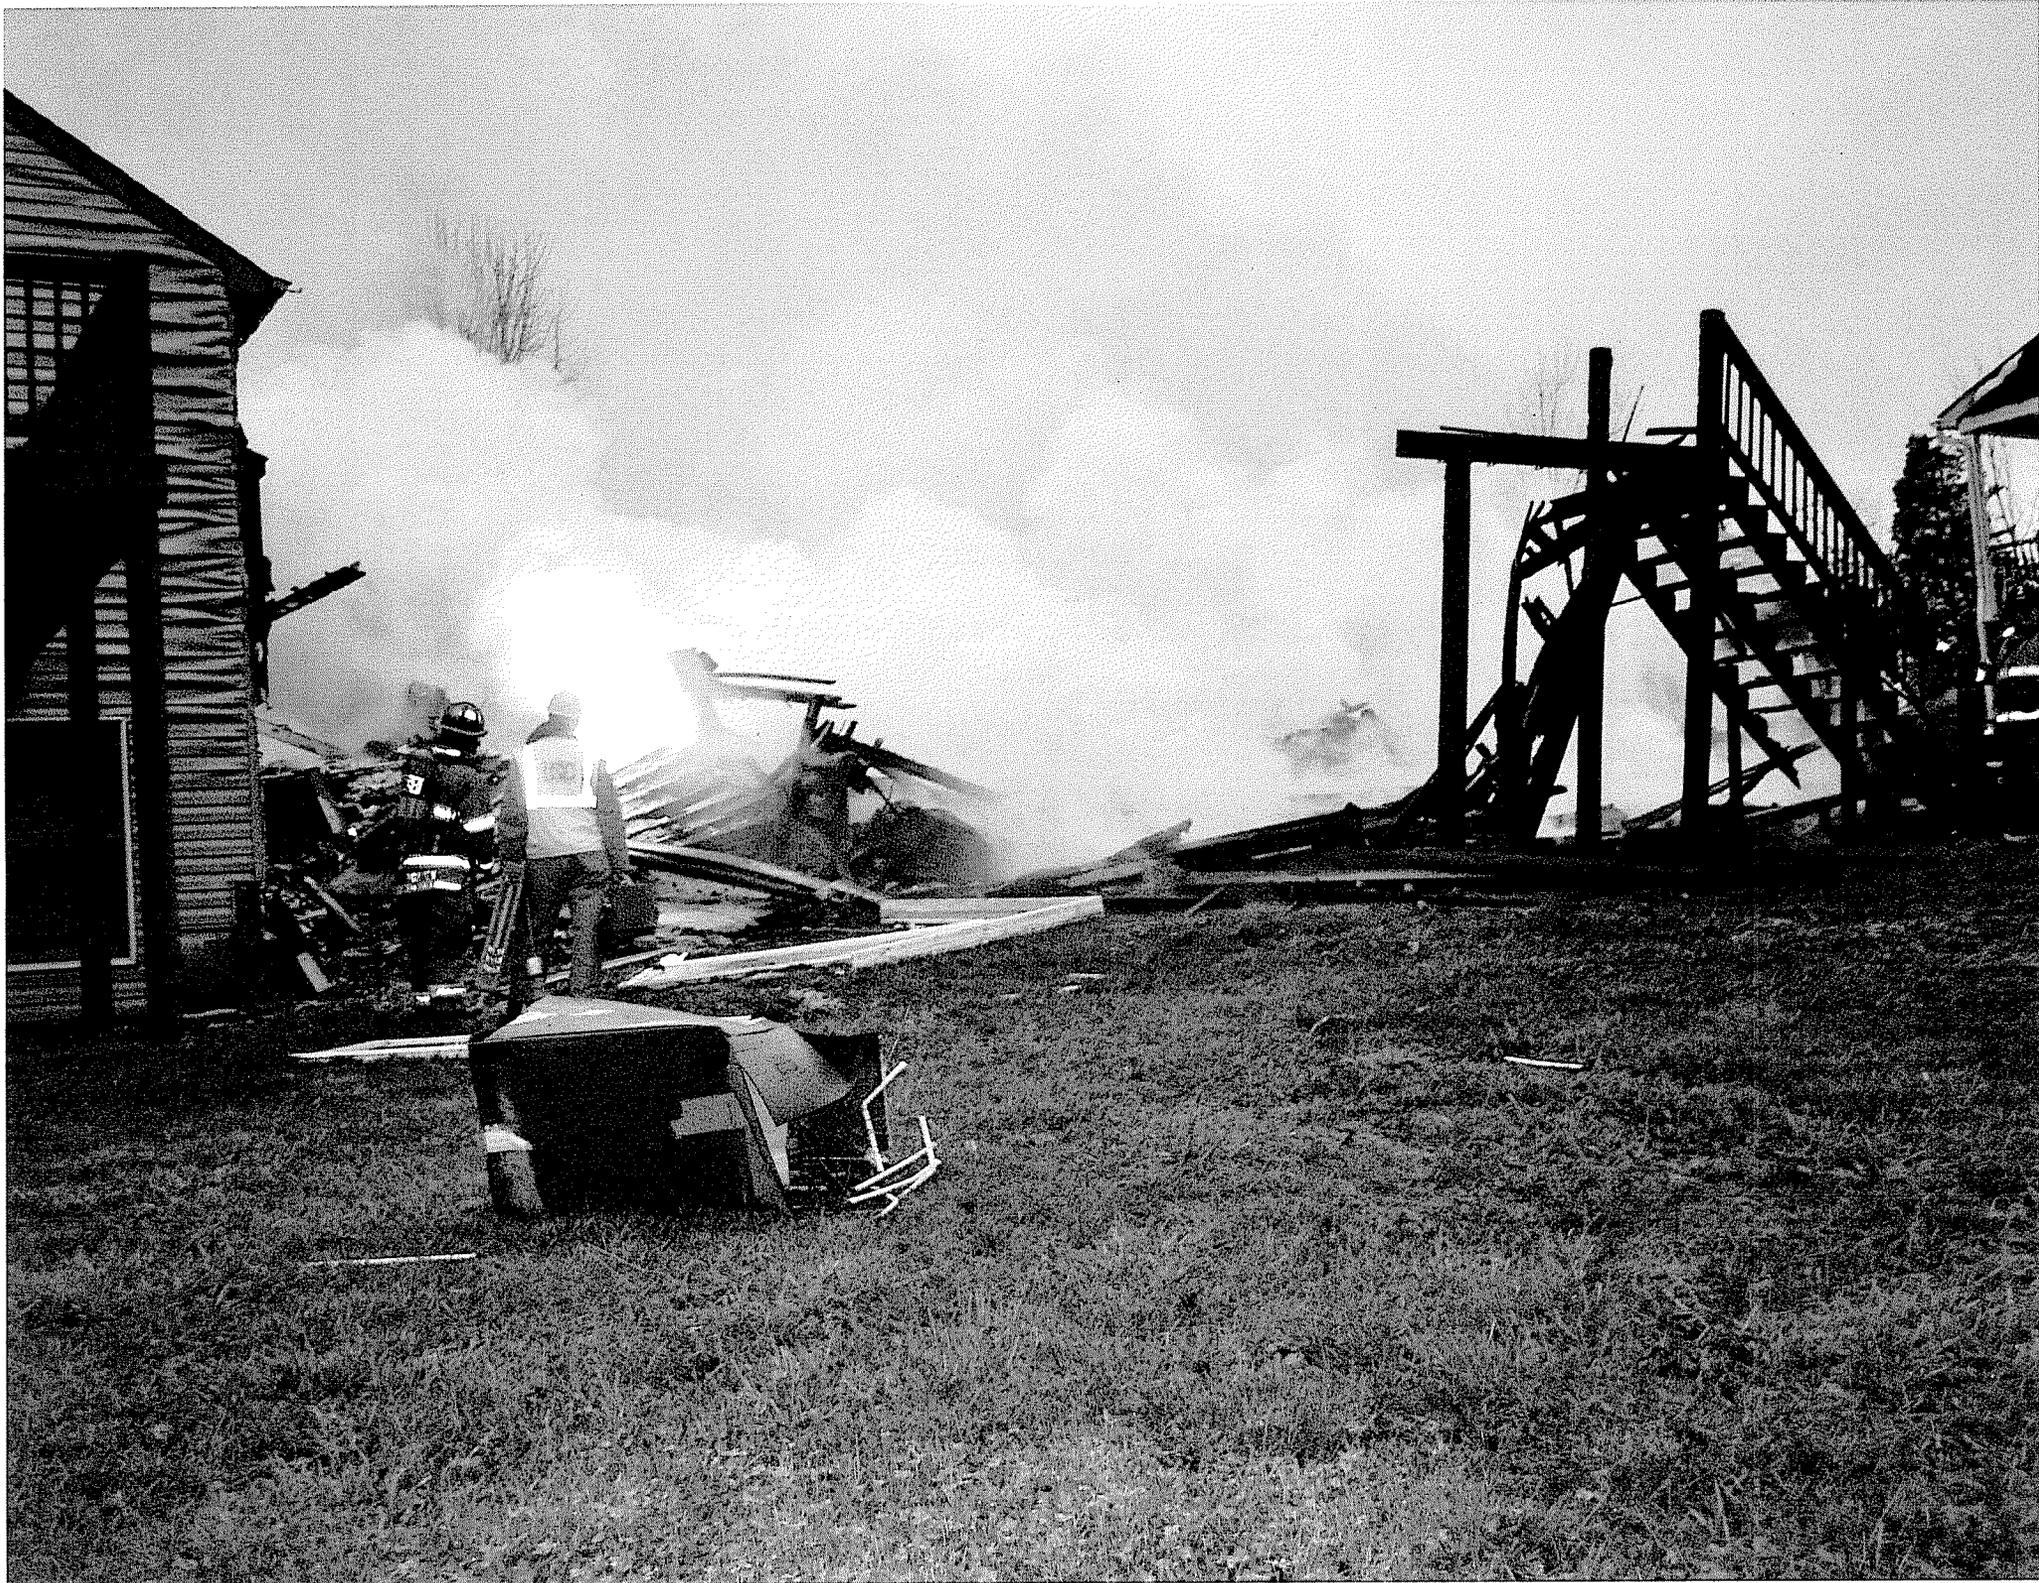



NOTE: Drawing is not to scale; all facility locations are approximate.

— Natural Gas Line — Telephone/Cable/Electric Lines — Waterline
⌵ Squeeze Off Location □ Gas Meter ○ Sewer Manhole ■ Storm Drain ● Water Meter

