

**a PPL company**

Jeff DeRouen  
Executive Director  
Kentucky Public Service Commission  
211 Sower Boulevard  
Frankfort, Kentucky 40601

**RECEIVED**

**FEB 28 2014**

**PUBLIC SERVICE  
COMMISSION**

**Kentucky Utilities Company**  
State Regulation and Rates  
220 W. Main Street  
Louisville, KY 40202  
www.lge-ku.com

Martin J. Reinert  
Sr. Regulatory Analyst  
O 502-627-4173  
marty.reinert@lge-ku.com

February 28, 2014

Re: *In the Matter of: Joint Application of Inter County Energy Cooperative, Kentucky Power Company, Kentucky Utilities Company, Louisville Gas and Electric Company, Owen Electric Cooperative, Shelby Energy Cooperative, Inc., and the Union Light, Heat & Power Company for Approval of a Pilot Meter Testing Plan Pursuant 807 KAR 5:041, Section 13, 15, 16, 17, and 22, Case No. 2005-00276*

**Annual Report – Kentucky Utilities Company**

Dear Mr. DeRouen:

The Kentucky Public Service Commission (“Commission”) originally approved a pilot sample meter testing plan for participating electric utilities in its Order of December 12, 2000, in Case Number 99-441. On November 10, 2005, in Case No. 2005-00276, the Commission approved the 2006 Sample Meter Testing Plan submitted by participating electric utilities on a permanent basis effective January 1, 2006.


Pursuant to the 2006 Sample Meter Testing Plan (originally filed on July 1, 2005), Section I(4) and Section II(D)(4), **Kentucky Utilities Company** submits the following:

The Certified Test Results of all new meters  
received  
(Attachment A)

2013 Statistical Sampling Test Results and  
Summary  
(Attachment B)

If you have any questions please do not hesitate to contact me.

Sincerely,


A handwritten signature in black ink that reads "Marty J. Reinert". The signature is written in a cursive style with a large, stylized initial 'M'.

Marty J. Reinert

Cc: Kyle Willard, Engineering Director PSC

Attachments



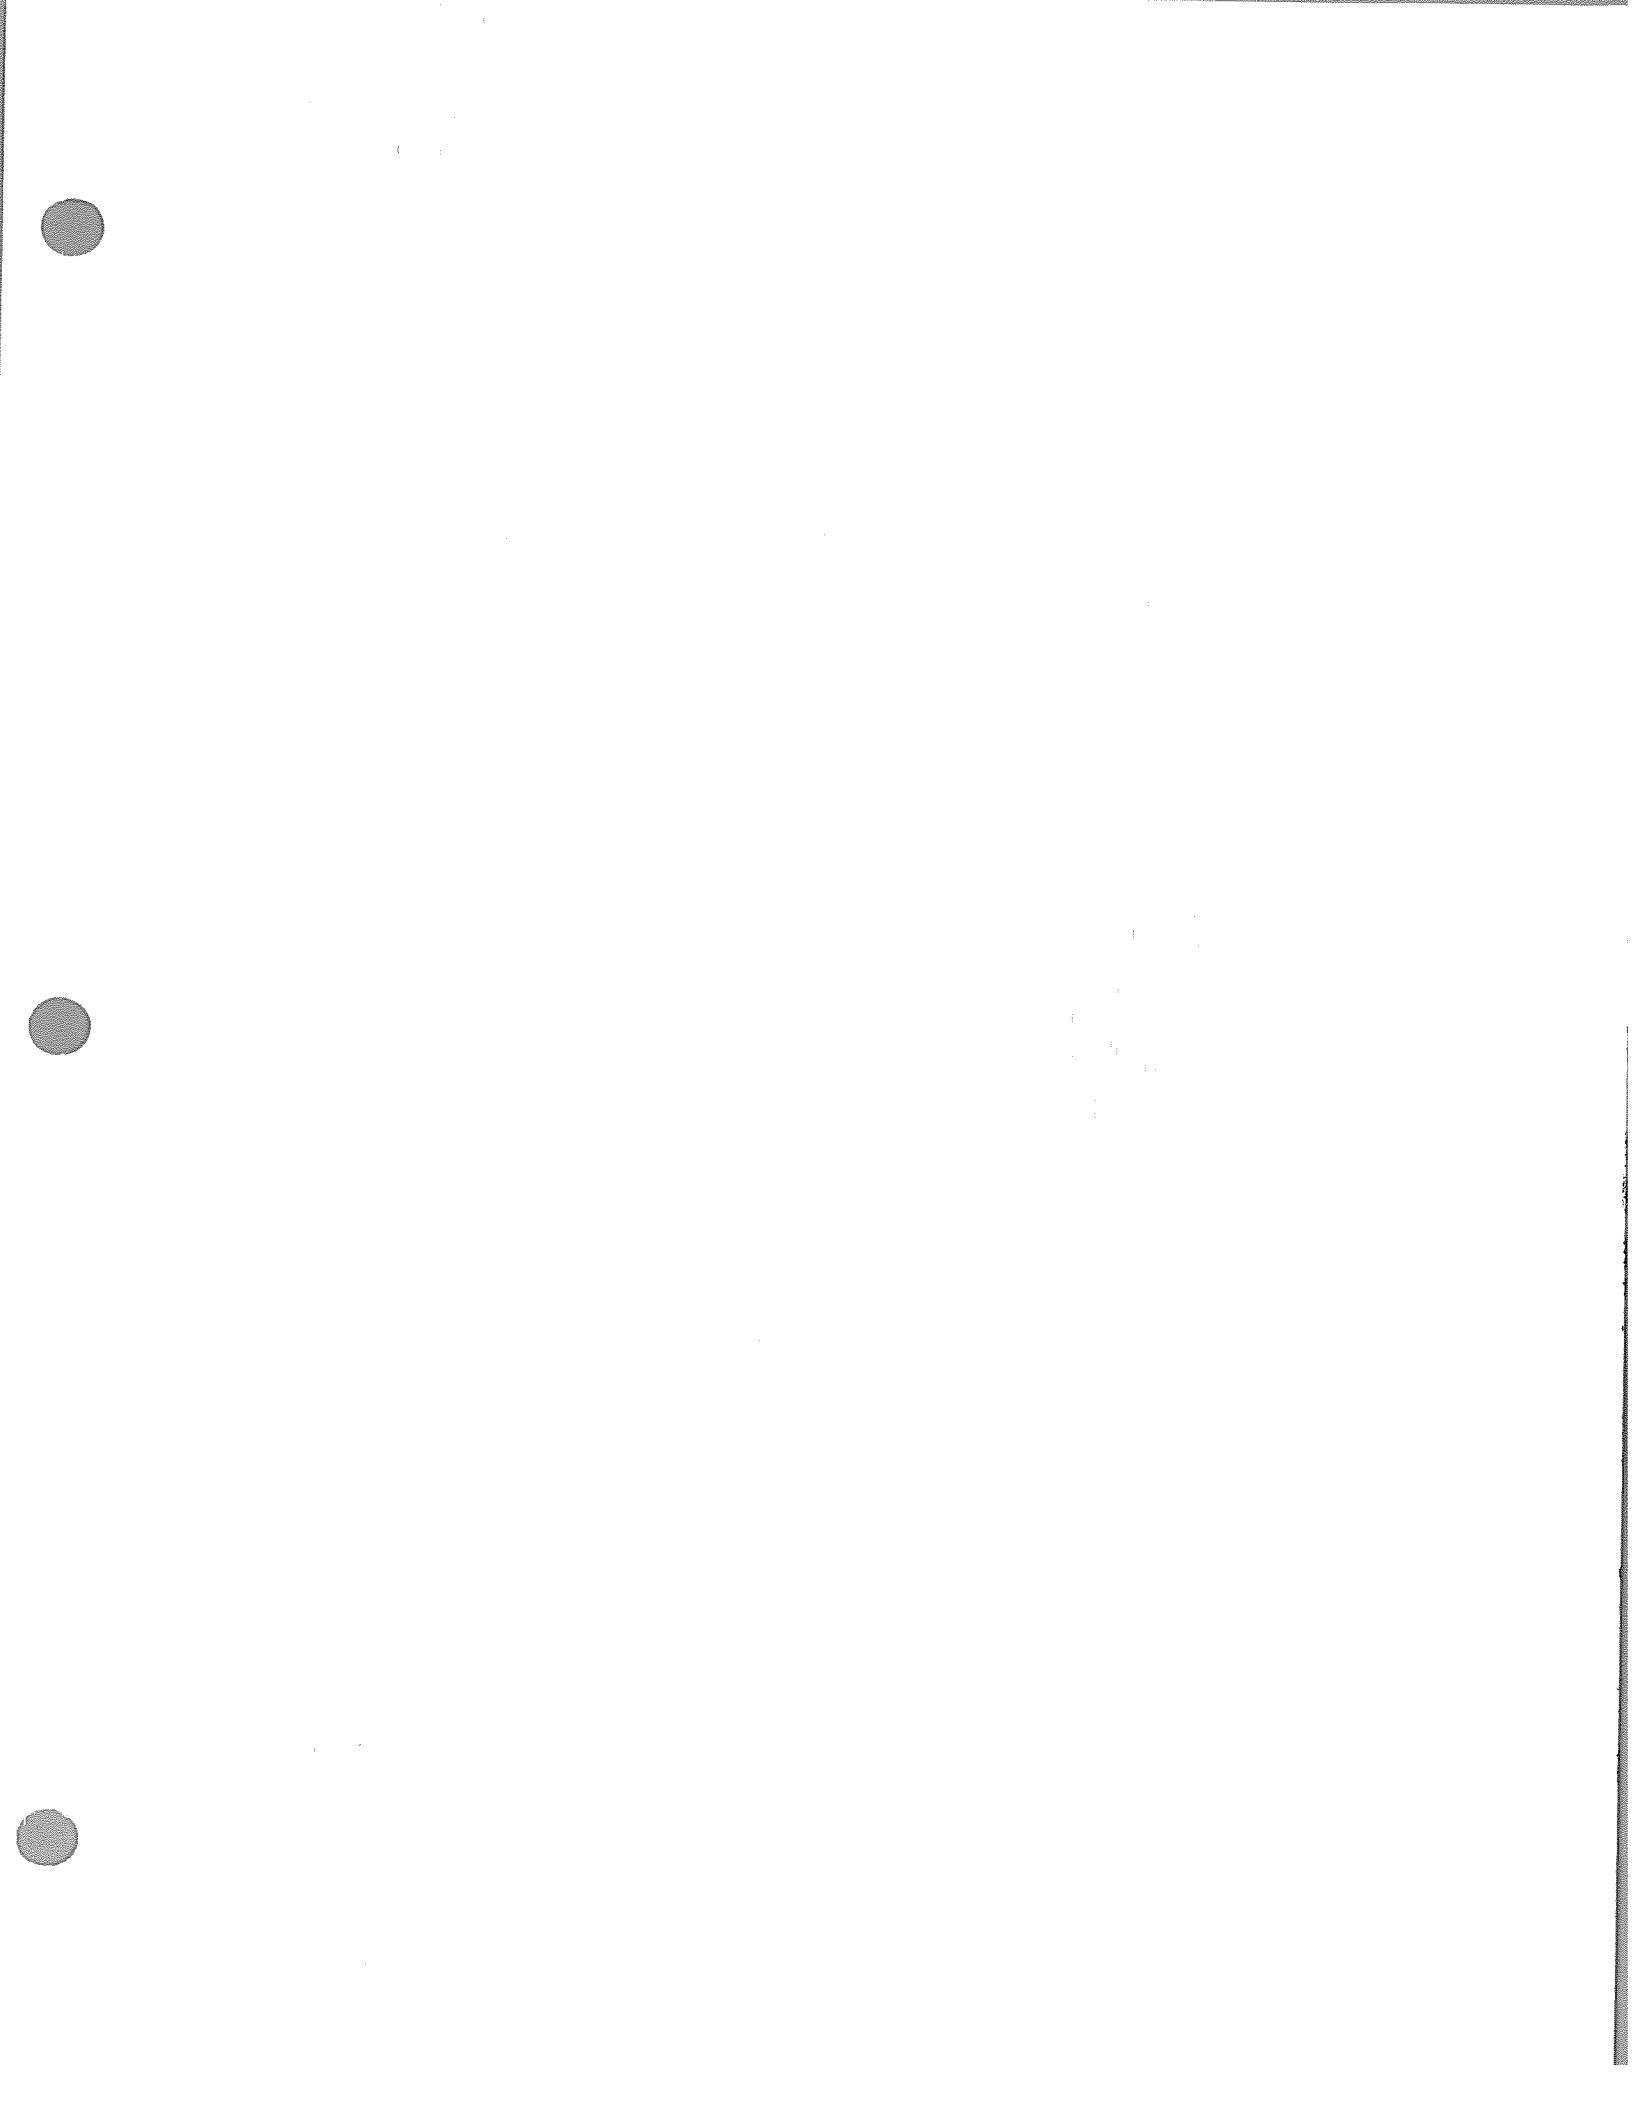

ATTACHMENT  
A

Certified Test Results

# LG&E and KU Energy LLC

## 5040 Annual Report of New Single Phase Meters

Last Data Update:

02/25/2014 07:36:45

### Dynamic Filters

Plant KU  
Month/Year 01/2013 - 12/2013

Plant	Manf. Model Number	Serial Number	Calendar Month/Year	Test Date	As Left Full Load	As Left Light Load	As Left Power Factor	Number of records
KU	C1S	2034776	02/2013	01/25/2013	100.000	100.100	100.0	1
KU	C1S	2034777	02/2013	01/25/2013	100.000	100.100	100.1	1
KU	C1S	2034778	02/2013	01/25/2013	100.000	100.100	100.0	1
KU	C1S	2034779	02/2013	01/25/2013	100.000	100.200	100.0	1
KU	C1S	2034780	02/2013	01/25/2013	100.000	100.100	100.0	1
KU	C1S	2034781	02/2013	01/29/2013	100.000	100.000	100.1	1
KU	C1S	2034782	02/2013	01/29/2013	100.000	100.100	100.1	1
KU	C1S	2034783	02/2013	01/25/2013	100.000	100.100	100.1	1
KU	C1S	2034784	02/2013	01/29/2013	100.000	100.100	100.1	1
KU	C1S	2034785	02/2013	01/29/2013	100.000	100.100	100.0	1
KU	C1S	2034786	02/2013	01/25/2013	100.000	100.100	100.1	1
KU	C1S	2034787	02/2013	01/29/2013	100.000	100.100	100.0	1
KU	C1S	2034788	02/2013	01/30/2013	100.000	100.000	100.0	1
KU	C1S	2034789	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2034790	02/2013	01/25/2013	99.900	100.100	100.0	1
KU	C1S	2034791	02/2013	01/25/2013	100.000	100.100	100.0	1
KU	C1S	2034792	02/2013	01/25/2013	100.000	100.000	100.1	1
KU	C1S	2034793	02/2013	01/25/2013	99.900	100.100	100.0	1

KU	C1S	2034794	02/2013	01/25/2013	99.900	100.100	100.0	1
KU	C1S	2034795	02/2013	01/25/2013	99.900	100.000	100.0	1
KU	C1S	2034796	02/2013	01/25/2013	100.000	100.100	100.0	1
KU	C1S	2034797	02/2013	01/25/2013	100.000	100.100	100.1	1
KU	C1S	2034798	02/2013	01/25/2013	100.000	100.100	100.1	1
KU	C1S	2034799	02/2013	01/25/2013	100.000	100.100	100.1	1
KU	C1S	2034800	02/2013	01/25/2013	99.900	100.100	100.0	1
KU	C1S	2034801	02/2013	01/25/2013	100.000	100.000	100.0	1
KU	C1S	2034802	02/2013	01/25/2013	100.000	100.100	100.0	1
KU	C1S	2034803	02/2013	01/25/2013	100.000	100.100	100.0	1
KU	C1S	2034804	02/2013	01/25/2013	100.000	100.100	100.0	1
KU	C1S	2034805	02/2013	01/25/2013	100.000	100.100	100.0	1
KU	C1S	2034806	02/2013	01/25/2013	99.900	100.100	100.0	1
KU	C1S	2034807	02/2013	01/25/2013	100.000	100.100	100.0	1
KU	C1S	2034808	02/2013	01/25/2013	100.000	100.100	100.0	1
KU	C1S	2034809	02/2013	01/25/2013	100.000	100.200	100.1	1
KU	C1S	2034810	02/2013	01/25/2013	99.900	100.000	100.1	1
KU	C1S	2034811	02/2013	01/25/2013	100.000	100.100	100.0	1
KU	C1S	2034812	02/2013	01/25/2013	100.000	100.200	100.1	1
KU	C1S	2034813	02/2013	01/25/2013	99.900	100.000	100.0	1
KU	C1S	2034814	02/2013	01/25/2013	100.000	100.100	100.1	1
KU	C1S	2034815	02/2013	01/25/2013	99.900	100.000	99.9	1
KU	C1S	2034816	02/2013	01/25/2013	100.000	100.100	100.0	1
KU	C1S	2034817	02/2013	01/29/2013	99.900	100.100	100.0	1
KU	C1S	2034818	02/2013	01/29/2013	99.900	100.100	100.0	1
KU	C1S	2034819	02/2013	01/29/2013	100.000	100.100	100.1	1
KU	C1S	2034820	02/2013	01/29/2013	100.000	100.200	100.1	1
KU	C1S	2034821	02/2013	01/29/2013	99.900	100.100	100.1	1
KU	C1S	2034822	02/2013	01/29/2013	100.000	100.100	100.1	1
KU	C1S	2034823	02/2013	01/25/2013	100.000	100.100	100.0	1

KU	C1S	2034824	02/2013	01/29/2013	99.900	100.100	100.0	1
KU	C1S	2034825	02/2013	01/25/2013	100.000	100.100	100.0	1
KU	C1S	2034826	02/2013	01/29/2013	100.000	100.100	100.0	1
KU	C1S	2034827	02/2013	01/25/2013	100.000	100.100	100.1	1
KU	C1S	2034828	02/2013	01/29/2013	100.000	100.000	100.0	1
KU	C1S	2034829	02/2013	01/29/2013	100.000	100.000	100.1	1
KU	C1S	2034830	02/2013	01/29/2013	100.000	100.100	100.1	1
KU	C1S	2034831	02/2013	01/29/2013	100.000	100.100	100.0	1
KU	C1S	2034832	02/2013	01/25/2013	100.000	100.100	100.0	1
KU	C1S	2034833	02/2013	01/25/2013	100.000	100.100	100.1	1
KU	C1S	2034834	02/2013	01/25/2013	100.000	100.100	100.0	1
KU	C1S	2034835	02/2013	01/29/2013	100.000	100.200	100.0	1
KU	C1S	2034836	02/2013	01/25/2013	100.000	100.100	100.0	1
KU	C1S	2034837	02/2013	01/29/2013	100.000	100.100	100.0	1
KU	C1S	2034838	02/2013	01/29/2013	100.000	100.000	100.0	1
KU	C1S	2034839	02/2013	01/29/2013	100.000	100.100	100.0	1
KU	C1S	2034840	02/2013	01/29/2013	100.000	100.000	99.9	1
KU	C1S	2034841	02/2013	01/29/2013	100.000	100.100	100.1	1
KU	C1S	2034842	02/2013	01/25/2013	99.900	100.100	100.0	1
KU	C1S	2034843	02/2013	01/29/2013	100.000	100.100	100.0	1
KU	C1S	2034844	02/2013	01/25/2013	100.000	100.000	100.0	1
KU	C1S	2034845	02/2013	01/25/2013	100.000	100.100	100.1	1
KU	C1S	2034846	02/2013	01/25/2013	100.000	100.100	99.9	1
KU	C1S	2034847	02/2013	01/29/2013	99.900	100.000	100.0	1
KU	C1S	2034848	02/2013	01/25/2013	100.000	100.100	100.1	1
KU	C1S	2034849	02/2013	01/29/2013	100.000	100.200	100.1	1
KU	C1S	2034850	02/2013	01/29/2013	100.000	100.100	100.1	1
KU	C1S	2034851	02/2013	01/29/2013	100.000	100.100	100.0	1
KU	C1S	2034852	02/2013	01/29/2013	100.000	100.200	100.0	1
KU	C1S	2034853	02/2013	01/29/2013	100.000	100.100	100.1	1



KU	C1S	2034854	02/2013	01/29/2013	100.000	100.100	100.0	1
KU	C1S	2034855	02/2013	01/29/2013	100.000	100.100	100.1	1
KU	C1S	2034856	02/2013	01/29/2013	100.000	100.100	100.1	1
KU	C1S	2034857	02/2013	01/29/2013	100.000	100.200	100.0	1
KU	C1S	2034858	02/2013	01/25/2013	100.000	100.000	100.0	1
KU	C1S	2034859	02/2013	01/25/2013	99.900	100.000	100.0	1
KU	C1S	2034860	02/2013	01/25/2013	100.000	100.100	100.0	1
KU	C1S	2034861	02/2013	01/25/2013	100.000	100.000	100.1	1
KU	C1S	2034862	02/2013	01/25/2013	100.000	100.200	100.0	1
KU	C1S	2034863	02/2013	01/29/2013	100.000	100.100	100.1	1
KU	C1S	2034864	02/2013	01/29/2013	100.000	100.100	100.0	1
KU	C1S	2034865	02/2013	01/30/2013	99.900	100.000	100.0	1
KU	C1S	2034866	02/2013	01/29/2013	100.000	100.100	99.9	1
KU	C1S	2034867	02/2013	01/25/2013	100.000	100.100	100.1	1
KU	C1S	2034868	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2034869	02/2013	01/30/2013	100.000	100.000	100.0	1
KU	C1S	2034870	02/2013	01/30/2013	100.000	100.200	100.0	1
KU	C1S	2034871	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2034872	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2034873	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2034874	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2034875	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2034876	02/2013	01/29/2013	100.000	100.100	100.0	1
KU	C1S	2034877	02/2013	01/30/2013	100.000	100.000	100.0	1
KU	C1S	2034878	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2034879	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2034880	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2034881	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2034882	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2034883	02/2013	01/30/2013	100.000	100.100	100.0	1

KU	C1S	2034884	02/2013	01/25/2013	100.000	100.100	100.1	1
KU	C1S	2034885	02/2013	01/25/2013	100.000	100.100	100.0	1
KU	C1S	2034886	02/2013	01/25/2013	100.000	100.200	100.0	1
KU	C1S	2034887	02/2013	01/25/2013	100.000	100.000	100.0	1
KU	C1S	2034888	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2034889	02/2013	01/30/2013	100.000	100.200	100.1	1
KU	C1S	2034890	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2034891	02/2013	01/25/2013	100.000	100.100	100.0	1
KU	C1S	2034892	02/2013	01/25/2013	100.000	100.000	100.0	1
KU	C1S	2034893	02/2013	01/25/2013	100.000	100.100	100.0	1
KU	C1S	2034894	02/2013	01/25/2013	100.000	100.100	100.1	1
KU	C1S	2034895	02/2013	01/25/2013	100.000	100.200	100.0	1
KU	C1S	2034896	02/2013	01/25/2013	99.900	100.000	99.9	1
KU	C1S	2034897	02/2013	01/29/2013	100.000	100.000	100.0	1
KU	C1S	2034898	02/2013	01/29/2013	100.000	100.100	100.1	1
KU	C1S	2034899	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2034900	02/2013	01/30/2013	100.000	100.200	100.0	1
KU	C1S	2034901	02/2013	01/25/2013	100.000	100.100	100.1	1
KU	C1S	2034902	02/2013	01/25/2013	100.000	100.100	100.0	1
KU	C1S	2034903	02/2013	01/25/2013	100.000	100.000	100.0	1
KU	C1S	2034904	02/2013	01/25/2013	100.000	100.100	100.1	1
KU	C1S	2034905	02/2013	01/25/2013	100.000	100.100	100.1	1
KU	C1S	2034906	02/2013	01/25/2013	100.000	100.000	100.0	1
KU	C1S	2034907	02/2013	01/30/2013	100.000	100.000	100.0	1
KU	C1S	2034908	02/2013	01/25/2013	100.000	100.100	100.0	1
KU	C1S	2034909	02/2013	01/25/2013	100.000	100.100	100.0	1
KU	C1S	2034910	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2034911	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2034912	02/2013	01/25/2013	100.000	100.000	100.0	1
KU	C1S	2034913	02/2013	01/25/2013	100.000	100.100	100.1	1

KU	C1S	2034914	02/2013	01/25/2013	100.000	100.100	100.1	1
KU	C1S	2034915	02/2013	01/25/2013	100.000	100.100	100.1	1
KU	C1S	2034916	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2034917	02/2013	01/25/2013	100.000	100.100	100.0	1
KU	C1S	2034918	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2034919	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2034920	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2034921	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2034922	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2034923	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2034924	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2034925	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2034926	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2034927	02/2013	01/30/2013	99.900	100.100	100.0	1
KU	C1S	2034928	02/2013	01/30/2013	100.000	100.000	100.0	1
KU	C1S	2034929	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2034930	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2034931	02/2013	01/29/2013	100.000	100.100	100.1	1
KU	C1S	2034932	02/2013	01/30/2013	99.900	100.000	100.0	1
KU	C1S	2034933	02/2013	01/30/2013	100.000	100.200	100.0	1
KU	C1S	2034934	02/2013	01/30/2013	99.900	100.100	99.9	1
KU	C1S	2034935	02/2013	01/30/2013	99.900	100.100	100.0	1
KU	C1S	2034936	02/2013	01/30/2013	100.000	100.200	100.0	1
KU	C1S	2034937	02/2013	01/30/2013	99.900	100.000	100.0	1
KU	C1S	2034938	02/2013	01/29/2013	100.000	100.100	100.0	1
KU	C1S	2034939	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2034940	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2034941	02/2013	01/29/2013	99.900	100.100	100.1	1
KU	C1S	2034942	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2034943	02/2013	01/30/2013	100.000	100.100	100.0	1



KU	C1S	2034944	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2034945	02/2013	01/29/2013	100.000	100.100	100.0	1
KU	C1S	2034946	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2034947	02/2013	01/29/2013	100.000	100.100	100.1	1
KU	C1S	2034948	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2034949	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2034950	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2034951	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2034952	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2034953	02/2013	01/30/2013	99.900	100.100	100.0	1
KU	C1S	2034954	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2034955	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2034956	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2034957	02/2013	01/30/2013	100.000	100.100	99.9	1
KU	C1S	2034958	02/2013	01/30/2013	100.000	100.200	100.1	1
KU	C1S	2034959	02/2013	01/30/2013	100.000	100.000	100.0	1
KU	C1S	2034960	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2034961	02/2013	01/30/2013	99.900	100.100	99.9	1
KU	C1S	2034962	02/2013	01/30/2013	100.000	100.200	100.0	1
KU	C1S	2034963	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2034964	02/2013	01/30/2013	99.900	100.100	100.0	1
KU	C1S	2034965	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2034966	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2034967	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2034968	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2034969	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2034970	02/2013	01/30/2013	100.000	100.200	100.1	1
KU	C1S	2034971	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2034972	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2034973	02/2013	01/30/2013	100.000	100.100	99.9	1

KU	C1S	2034974	02/2013	01/30/2013	100.000	100.000	100.0	1
KU	C1S	2034975	02/2013	01/30/2013	100.000	100.000	100.0	1
KU	C1S	2034976	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2034977	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2034978	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2034979	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2034980	02/2013	01/30/2013	100.000	100.000	100.0	1
KU	C1S	2034981	02/2013	01/30/2013	100.000	100.200	100.0	1
KU	C1S	2034982	02/2013	01/30/2013	99.900	100.100	99.9	1
KU	C1S	2034983	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2034984	02/2013	01/30/2013	99.900	100.100	100.0	1
KU	C1S	2034985	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2034986	02/2013	01/30/2013	99.900	100.000	100.0	1
KU	C1S	2034987	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2034988	02/2013	01/30/2013	100.000	100.100	99.9	1
KU	C1S	2034989	02/2013	01/30/2013	99.900	100.100	100.0	1
KU	C1S	2034990	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2034991	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2034992	02/2013	01/30/2013	100.000	100.100	99.9	1
KU	C1S	2034993	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2034994	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2034995	02/2013	01/30/2013	99.900	100.100	100.0	1
KU	C1S	2034996	02/2013	01/30/2013	99.900	100.100	100.0	1
KU	C1S	2034997	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2034998	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2034999	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035000	02/2013	01/29/2013	100.000	100.100	100.1	1
KU	C1S	2035001	02/2013	01/29/2013	100.000	100.200	100.0	1
KU	C1S	2035002	02/2013	01/29/2013	100.000	100.100	100.0	1
KU	C1S	2035003	02/2013	01/30/2013	100.000	100.100	100.0	1

KU	C1S	2035004	02/2013	01/29/2013	100.000	100.100	100.0	1
KU	C1S	2035005	02/2013	01/30/2013	100.000	100.200	100.0	1
KU	C1S	2035006	02/2013	01/29/2013	100.000	100.000	100.1	1
KU	C1S	2035007	02/2013	01/25/2013	100.000	100.100	100.1	1
KU	C1S	2035008	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035009	02/2013	01/25/2013	100.000	100.100	100.0	1
KU	C1S	2035010	02/2013	01/30/2013	99.900	100.200	100.0	1
KU	C1S	2035011	02/2013	01/30/2013	100.000	100.100	99.9	1
KU	C1S	2035012	02/2013	01/30/2013	100.000	100.100	99.9	1
KU	C1S	2035013	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035014	02/2013	01/25/2013	100.000	100.100	99.9	1
KU	C1S	2035015	02/2013	01/30/2013	100.000	100.200	100.0	1
KU	C1S	2035016	02/2013	01/25/2013	100.000	100.100	100.1	1
KU	C1S	2035017	02/2013	01/25/2013	100.000	100.100	100.1	1
KU	C1S	2035018	02/2013	01/25/2013	100.000	100.100	100.0	1
KU	C1S	2035019	02/2013	01/30/2013	99.900	100.100	99.9	1
KU	C1S	2035020	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035021	02/2013	01/30/2013	100.000	100.000	100.1	1
KU	C1S	2035022	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035023	02/2013	01/25/2013	100.000	100.100	100.1	1
KU	C1S	2035024	02/2013	01/25/2013	100.000	100.100	100.1	1
KU	C1S	2035025	02/2013	01/30/2013	99.900	100.100	100.0	1
KU	C1S	2035026	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035027	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035028	02/2013	01/29/2013	99.900	100.100	100.1	1
KU	C1S	2035029	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035030	02/2013	01/29/2013	100.000	100.100	100.0	1
KU	C1S	2035031	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035032	02/2013	01/29/2013	100.000	100.100	100.1	1
KU	C1S	2035033	02/2013	01/30/2013	99.900	100.100	100.0	1



KU	C1S	2035034	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035035	02/2013	01/30/2013	100.000	100.000	100.0	1
KU	C1S	2035036	02/2013	01/30/2013	99.900	100.000	100.0	1
KU	C1S	2035037	02/2013	01/30/2013	99.900	100.100	100.0	1
KU	C1S	2035038	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035039	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035040	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035041	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035042	02/2013	01/29/2013	100.000	100.100	99.9	1
KU	C1S	2035043	02/2013	01/25/2013	100.000	100.100	100.0	1
KU	C1S	2035044	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035045	02/2013	01/25/2013	100.000	100.000	100.0	1
KU	C1S	2035046	02/2013	01/30/2013	99.900	100.100	100.1	1
KU	C1S	2035047	02/2013	01/30/2013	99.900	100.000	100.0	1
KU	C1S	2035048	02/2013	01/30/2013	99.900	100.100	100.0	1
KU	C1S	2035049	02/2013	01/30/2013	99.900	100.100	100.0	1
KU	C1S	2035050	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035051	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035052	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035053	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035054	02/2013	01/29/2013	100.000	100.200	100.0	1
KU	C1S	2035055	02/2013	01/29/2013	100.000	100.100	100.0	1
KU	C1S	2035056	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035057	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035058	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035059	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035060	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035061	02/2013	01/30/2013	100.000	100.200	100.0	1
KU	C1S	2035062	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035063	02/2013	01/30/2013	100.000	100.100	100.0	1

KU	C1S	2035064	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035065	02/2013	01/30/2013	100.000	100.000	100.0	1
KU	C1S	2035066	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035067	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035068	02/2013	01/29/2013	99.900	100.100	100.0	1
KU	C1S	2035069	02/2013	01/29/2013	100.000	100.100	100.0	1
KU	C1S	2035070	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035071	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035072	02/2013	01/25/2013	99.900	100.000	100.0	1
KU	C1S	2035073	02/2013	01/25/2013	100.000	100.100	100.1	1
KU	C1S	2035074	02/2013	01/30/2013	100.000	100.200	100.0	1
KU	C1S	2035075	02/2013	01/30/2013	100.000	100.200	100.0	1
KU	C1S	2035076	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035077	02/2013	01/30/2013	99.900	100.100	100.1	1
KU	C1S	2035078	02/2013	01/30/2013	100.000	100.200	100.0	1
KU	C1S	2035079	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035080	02/2013	01/25/2013	100.000	100.000	100.1	1
KU	C1S	2035081	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035082	02/2013	01/25/2013	100.000	100.100	99.9	1
KU	C1S	2035083	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035084	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035085	02/2013	01/30/2013	100.000	100.000	100.0	1
KU	C1S	2035086	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035087	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035088	02/2013	01/29/2013	100.000	100.100	100.0	1
KU	C1S	2035089	02/2013	01/29/2013	100.000	100.100	100.1	1
KU	C1S	2035090	02/2013	01/30/2013	100.000	100.200	100.0	1
KU	C1S	2035091	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035092	02/2013	01/29/2013	100.000	100.100	100.1	1
KU	C1S	2035093	02/2013	01/25/2013	100.000	100.100	100.0	1

KU	C1S	2035094	02/2013	01/29/2013	100.000	100.200	100.0	1
KU	C1S	2035095	02/2013	01/25/2013	100.000	100.100	100.0	1
KU	C1S	2035096	02/2013	01/30/2013	99.900	100.000	100.0	1
KU	C1S	2035097	02/2013	01/29/2013	100.000	100.200	100.0	1
KU	C1S	2035098	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035099	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035100	02/2013	01/29/2013	100.000	100.100	100.0	1
KU	C1S	2035101	02/2013	01/29/2013	100.000	100.100	100.0	1
KU	C1S	2035102	02/2013	01/30/2013	99.900	100.000	100.0	1
KU	C1S	2035103	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035104	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035105	02/2013	01/30/2013	100.000	100.200	100.1	1
KU	C1S	2035106	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035107	02/2013	01/29/2013	100.000	100.200	100.0	1
KU	C1S	2035108	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035109	02/2013	01/30/2013	100.000	100.100	99.9	1
KU	C1S	2035110	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035111	02/2013	01/30/2013	99.900	100.000	99.9	1
KU	C1S	2035112	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035113	02/2013	01/30/2013	99.900	100.100	100.0	1
KU	C1S	2035114	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035115	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035116	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035117	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035118	02/2013	01/30/2013	100.000	100.200	100.0	1
KU	C1S	2035119	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035120	02/2013	01/30/2013	100.000	100.100	99.9	1
KU	C1S	2035121	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035122	02/2013	01/29/2013	100.000	100.100	100.0	1
KU	C1S	2035123	02/2013	01/29/2013	99.900	100.100	100.1	1



KU	C1S	2035124	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035125	02/2013	01/29/2013	100.000	100.100	100.1	1
KU	C1S	2035126	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035127	02/2013	01/29/2013	100.000	100.200	100.0	1
KU	C1S	2035128	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035129	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035130	02/2013	01/30/2013	99.900	100.100	100.0	1
KU	C1S	2035131	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035132	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035133	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035134	02/2013	01/30/2013	100.000	100.100	99.9	1
KU	C1S	2035135	02/2013	01/30/2013	99.900	100.100	100.0	1
KU	C1S	2035136	02/2013	01/30/2013	99.900	100.100	99.9	1
KU	C1S	2035137	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035138	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035139	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035140	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035141	02/2013	01/25/2013	100.000	100.100	100.0	1
KU	C1S	2035142	02/2013	01/25/2013	100.000	100.100	100.0	1
KU	C1S	2035143	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035144	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035145	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035146	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035147	02/2013	01/30/2013	99.900	100.000	100.0	1
KU	C1S	2035148	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035149	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035150	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035151	02/2013	01/30/2013	100.000	100.200	100.1	1
KU	C1S	2035152	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035153	02/2013	01/30/2013	100.000	100.100	100.0	1

KU	C1S	2035154	02/2013	01/30/2013	100.000	100.000	100.1	1
KU	C1S	2035155	02/2013	01/30/2013	100.000	100.000	100.0	1
KU	C1S	2035156	02/2013	01/29/2013	100.000	100.100	100.1	1
KU	C1S	2035157	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035158	02/2013	01/25/2013	99.900	100.000	99.9	1
KU	C1S	2035159	02/2013	01/25/2013	100.000	100.100	100.0	1
KU	C1S	2035160	02/2013	01/30/2013	100.000	100.200	100.1	1
KU	C1S	2035161	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035162	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035163	02/2013	01/30/2013	100.000	100.200	100.0	1
KU	C1S	2035164	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035165	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035166	02/2013	01/30/2013	100.000	100.000	100.0	1
KU	C1S	2035167	02/2013	01/30/2013	99.900	100.100	100.0	1
KU	C1S	2035168	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035169	02/2013	01/30/2013	99.900	100.100	100.0	1
KU	C1S	2035170	02/2013	01/29/2013	100.000	100.100	100.0	1
KU	C1S	2035171	02/2013	01/29/2013	100.000	100.100	100.0	1
KU	C1S	2035172	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035173	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035174	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035175	02/2013	01/30/2013	99.900	100.100	100.0	1
KU	C1S	2035176	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035177	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035178	02/2013	01/30/2013	99.900	100.000	100.0	1
KU	C1S	2035179	02/2013	01/25/2013	100.000	100.100	99.9	1
KU	C1S	2035180	02/2013	01/30/2013	100.000	100.200	100.0	1
KU	C1S	2035181	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035182	02/2013	01/30/2013	99.900	100.100	100.0	1
KU	C1S	2035183	02/2013	01/25/2013	100.000	100.100	100.1	1



KU	C1S	2035184	02/2013	01/25/2013	99.900	100.100	100.0	1
KU	C1S	2035185	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035186	02/2013	01/25/2013	100.000	100.100	100.1	1
KU	C1S	2035187	02/2013	01/30/2013	100.000	100.000	100.0	1
KU	C1S	2035188	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035189	02/2013	01/30/2013	100.000	100.200	100.0	1
KU	C1S	2035190	02/2013	01/30/2013	100.000	100.000	100.0	1
KU	C1S	2035191	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035192	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035193	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035194	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035195	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035196	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035197	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035198	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035199	02/2013	01/30/2013	100.000	100.200	100.1	1
KU	C1S	2035200	02/2013	01/30/2013	100.000	100.000	100.0	1
KU	C1S	2035201	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035202	02/2013	01/30/2013	100.000	100.200	100.1	1
KU	C1S	2035203	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035204	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035205	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035206	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035207	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035208	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035209	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035210	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035211	02/2013	01/30/2013	100.000	100.200	100.0	1
KU	C1S	2035212	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035213	02/2013	01/30/2013	100.000	100.100	100.1	1

KU	C1S	2035214	02/2013	01/30/2013	99.900	100.100	100.0	1
KU	C1S	2035215	02/2013	01/30/2013	100.000	100.100	99.9	1
KU	C1S	2035216	02/2013	01/30/2013	100.000	100.200	100.0	1
KU	C1S	2035217	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035218	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035219	02/2013	01/30/2013	100.000	100.200	100.0	1
KU	C1S	2035220	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035221	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035222	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035223	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035224	02/2013	01/30/2013	100.000	100.200	100.0	1
KU	C1S	2035225	02/2013	01/30/2013	100.000	100.200	100.0	1
KU	C1S	2035226	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035227	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035228	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035229	02/2013	01/30/2013	100.000	100.000	100.0	1
KU	C1S	2035230	02/2013	01/30/2013	99.900	100.100	100.0	1
KU	C1S	2035231	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035232	02/2013	01/30/2013	100.000	100.200	100.1	1
KU	C1S	2035233	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035234	02/2013	01/30/2013	100.000	100.200	100.0	1
KU	C1S	2035235	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035236	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035237	02/2013	01/30/2013	100.000	100.200	100.0	1
KU	C1S	2035238	02/2013	01/30/2013	99.900	100.000	100.0	1
KU	C1S	2035239	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035240	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035241	02/2013	01/30/2013	99.900	100.100	100.0	1
KU	C1S	2035242	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035243	02/2013	01/30/2013	100.000	100.100	100.0	1

KU	C1S	2035244	02/2013	01/30/2013	100.000	100.100	99.9	1
KU	C1S	2035245	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035246	02/2013	01/30/2013	99.900	100.100	100.0	1
KU	C1S	2035247	02/2013	01/30/2013	100.000	100.000	100.0	1
KU	C1S	2035248	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035249	02/2013	01/30/2013	99.900	100.100	100.1	1
KU	C1S	2035250	02/2013	01/30/2013	100.000	100.200	100.1	1
KU	C1S	2035251	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035252	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035253	02/2013	01/30/2013	100.000	100.200	100.0	1
KU	C1S	2035254	02/2013	01/30/2013	100.000	100.000	100.0	1
KU	C1S	2035255	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035256	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035257	02/2013	01/30/2013	100.000	100.200	100.0	1
KU	C1S	2035258	02/2013	01/30/2013	100.000	100.200	100.0	1
KU	C1S	2035259	02/2013	01/30/2013	99.900	100.100	100.0	1
KU	C1S	2035260	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035261	02/2013	01/30/2013	100.000	100.200	100.0	1
KU	C1S	2035262	02/2013	01/30/2013	99.900	100.100	100.0	1
KU	C1S	2035263	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035264	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035265	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035266	02/2013	01/30/2013	99.900	100.100	100.0	1
KU	C1S	2035267	02/2013	01/29/2013	100.000	100.200	100.0	1
KU	C1S	2035268	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035269	02/2013	01/29/2013	100.000	100.100	100.1	1
KU	C1S	2035270	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035271	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035272	02/2013	01/30/2013	100.000	100.000	99.9	1
KU	C1S	2035273	02/2013	01/30/2013	100.000	100.100	100.0	1



KU	C1S	2035274	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035275	02/2013	01/29/2013	100.000	100.100	100.1	1
KU	C1S	2035276	02/2013	01/29/2013	100.000	100.100	100.1	1
KU	C1S	2035277	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035278	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035279	02/2013	01/30/2013	100.000	100.200	100.1	1
KU	C1S	2035280	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035281	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035282	02/2013	01/30/2013	99.900	100.100	99.9	1
KU	C1S	2035283	02/2013	01/30/2013	100.000	100.000	100.1	1
KU	C1S	2035284	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035285	02/2013	01/30/2013	100.000	100.100	99.9	1
KU	C1S	2035286	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035287	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035288	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035289	02/2013	01/30/2013	100.000	100.200	100.1	1
KU	C1S	2035290	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035291	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035292	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035293	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035294	02/2013	01/30/2013	100.000	100.200	100.0	1
KU	C1S	2035295	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035296	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035297	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035298	02/2013	01/30/2013	100.000	100.200	100.0	1
KU	C1S	2035299	02/2013	01/30/2013	100.000	100.000	100.1	1
KU	C1S	2035300	02/2013	01/30/2013	100.000	100.100	99.9	1
KU	C1S	2035301	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035302	02/2013	01/30/2013	99.900	100.100	100.0	1
KU	C1S	2035303	02/2013	01/30/2013	100.000	100.200	100.0	1

KU	C1S	2035304	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035305	02/2013	01/30/2013	99.900	100.200	100.0	1
KU	C1S	2035306	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035307	02/2013	01/30/2013	100.000	100.000	100.0	1
KU	C1S	2035308	02/2013	01/30/2013	100.000	100.200	100.0	1
KU	C1S	2035309	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035310	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035311	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035312	02/2013	01/30/2013	99.900	100.100	100.0	1
KU	C1S	2035313	02/2013	01/30/2013	100.000	100.200	100.1	1
KU	C1S	2035314	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035315	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035316	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035317	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035318	02/2013	01/30/2013	100.000	100.200	100.0	1
KU	C1S	2035319	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035320	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035321	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035322	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035323	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035324	02/2013	01/30/2013	99.900	100.100	100.0	1
KU	C1S	2035325	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035326	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035327	02/2013	01/30/2013	100.000	100.200	100.1	1
KU	C1S	2035328	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035329	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035330	02/2013	01/30/2013	99.900	100.100	100.0	1
KU	C1S	2035331	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035332	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035333	02/2013	01/30/2013	100.000	100.100	100.0	1

KU	C1S	2035334	02/2013	01/30/2013	100.000	100.200	100.1	1
KU	C1S	2035335	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035336	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035337	02/2013	01/30/2013	99.900	100.100	100.0	1
KU	C1S	2035338	02/2013	01/30/2013	99.900	100.100	100.0	1
KU	C1S	2035339	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035340	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035341	02/2013	01/30/2013	100.000	100.200	100.0	1
KU	C1S	2035342	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035343	02/2013	01/30/2013	100.000	100.200	100.1	1
KU	C1S	2035344	02/2013	01/30/2013	99.900	100.100	100.0	1
KU	C1S	2035345	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035346	02/2013	01/30/2013	100.000	100.200	100.1	1
KU	C1S	2035347	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035348	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035349	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035350	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035351	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035352	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035353	02/2013	01/30/2013	100.000	100.100	99.9	1
KU	C1S	2035354	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035355	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035356	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035357	02/2013	01/30/2013	99.900	100.100	100.0	1
KU	C1S	2035358	02/2013	01/30/2013	99.900	100.100	100.0	1
KU	C1S	2035359	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035360	02/2013	01/30/2013	100.000	100.000	100.0	1
KU	C1S	2035361	02/2013	01/30/2013	100.000	100.200	100.0	1
KU	C1S	2035362	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035363	02/2013	01/30/2013	100.000	100.100	100.0	1



KU	C1S	2035364	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035365	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035366	02/2013	01/30/2013	100.000	100.200	100.0	1
KU	C1S	2035367	02/2013	01/30/2013	100.000	100.200	100.1	1
KU	C1S	2035368	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035369	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035370	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035371	02/2013	01/30/2013	100.000	100.200	100.1	1
KU	C1S	2035372	02/2013	01/30/2013	100.000	100.000	100.0	1
KU	C1S	2035373	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035374	02/2013	01/30/2013	100.000	100.200	99.9	1
KU	C1S	2035375	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035376	02/2013	01/30/2013	99.900	100.100	100.1	1
KU	C1S	2035377	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035378	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035379	02/2013	01/30/2013	99.900	100.100	100.0	1
KU	C1S	2035380	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035381	02/2013	01/30/2013	100.000	100.200	100.1	1
KU	C1S	2035382	02/2013	01/30/2013	100.000	100.200	100.0	1
KU	C1S	2035383	02/2013	01/30/2013	100.000	100.200	100.1	1
KU	C1S	2035384	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035385	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035386	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035387	02/2013	01/30/2013	100.000	100.000	100.0	1
KU	C1S	2035388	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035389	02/2013	01/30/2013	99.900	100.100	100.0	1
KU	C1S	2035390	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035391	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035392	02/2013	01/30/2013	100.000	100.200	100.1	1
KU	C1S	2035393	02/2013	01/30/2013	100.000	100.100	100.0	1

KU	C1S	2035394	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035395	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035396	02/2013	01/30/2013	100.000	100.000	100.0	1
KU	C1S	2035397	02/2013	01/30/2013	100.000	100.100	99.9	1
KU	C1S	2035398	02/2013	01/30/2013	99.900	100.100	100.0	1
KU	C1S	2035399	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035400	02/2013	01/30/2013	100.000	100.200	100.1	1
KU	C1S	2035401	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035402	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035403	02/2013	01/30/2013	99.900	100.100	100.1	1
KU	C1S	2035404	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035405	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035406	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035407	02/2013	01/30/2013	99.900	100.100	100.0	1
KU	C1S	2035408	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035409	02/2013	01/30/2013	100.000	100.200	100.1	1
KU	C1S	2035410	02/2013	01/30/2013	99.900	100.100	100.0	1
KU	C1S	2035411	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035412	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035413	02/2013	01/30/2013	100.000	100.200	100.1	1
KU	C1S	2035414	02/2013	01/30/2013	99.900	100.100	100.0	1
KU	C1S	2035415	02/2013	01/30/2013	100.000	100.000	100.0	1
KU	C1S	2035416	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035417	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035418	02/2013	01/30/2013	100.000	100.100	99.9	1
KU	C1S	2035419	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035420	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035421	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035422	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035423	02/2013	01/30/2013	100.000	100.100	100.0	1



KU	C1S	2035424	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035425	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035426	02/2013	01/30/2013	99.900	100.000	99.9	1
KU	C1S	2035427	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035428	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035429	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035430	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035431	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035432	02/2013	01/30/2013	99.900	100.100	100.0	1
KU	C1S	2035433	02/2013	01/30/2013	100.000	100.200	100.0	1
KU	C1S	2035434	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035435	02/2013	01/30/2013	100.000	100.000	100.0	1
KU	C1S	2035436	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035437	02/2013	01/30/2013	100.000	100.000	100.0	1
KU	C1S	2035438	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035439	02/2013	01/30/2013	100.000	100.200	100.0	1
KU	C1S	2035440	02/2013	01/30/2013	100.000	100.200	100.0	1
KU	C1S	2035441	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035442	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035443	02/2013	01/30/2013	100.000	100.000	100.1	1
KU	C1S	2035444	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035445	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035446	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035447	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035448	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035449	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035450	02/2013	01/30/2013	100.000	100.200	100.0	1
KU	C1S	2035451	02/2013	01/30/2013	100.000	100.100	99.9	1
KU	C1S	2035452	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035453	02/2013	01/30/2013	100.000	100.200	100.0	1

KU	C1S	2035454	02/2013	01/30/2013	99.900	100.200	100.0	1
KU	C1S	2035455	02/2013	01/30/2013	100.000	100.000	100.0	1
KU	C1S	2035456	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035457	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035458	02/2013	01/30/2013	100.000	100.200	100.1	1
KU	C1S	2035459	02/2013	01/30/2013	100.000	100.000	100.0	1
KU	C1S	2035460	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035461	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035462	02/2013	01/30/2013	100.000	100.000	100.0	1
KU	C1S	2035463	02/2013	01/30/2013	100.000	100.100	99.9	1
KU	C1S	2035464	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035465	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035466	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035467	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035468	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035469	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035470	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035471	02/2013	01/30/2013	99.900	100.100	100.0	1
KU	C1S	2035472	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035473	02/2013	01/30/2013	99.900	100.100	100.1	1
KU	C1S	2035474	02/2013	01/30/2013	100.000	100.200	100.1	1
KU	C1S	2035475	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035476	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035477	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035478	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035479	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035480	02/2013	01/30/2013	99.900	100.100	100.0	1
KU	C1S	2035481	02/2013	01/30/2013	100.000	100.000	100.1	1
KU	C1S	2035482	02/2013	01/30/2013	100.000	100.200	100.0	1
KU	C1S	2035483	02/2013	01/30/2013	100.000	100.200	100.1	1

KU	C1S	2035484	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035485	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035486	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035487	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035488	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035489	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035490	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035491	02/2013	01/30/2013	99.900	100.100	100.0	1
KU	C1S	2035492	02/2013	01/30/2013	100.000	100.200	100.1	1
KU	C1S	2035493	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035494	02/2013	01/30/2013	100.000	100.200	100.0	1
KU	C1S	2035495	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035496	02/2013	01/30/2013	100.000	100.200	100.0	1
KU	C1S	2035497	02/2013	01/30/2013	100.000	100.200	100.0	1
KU	C1S	2035498	02/2013	01/30/2013	100.000	100.000	100.0	1
KU	C1S	2035499	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035500	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035501	02/2013	01/30/2013	99.900	100.100	100.0	1
KU	C1S	2035502	02/2013	01/30/2013	100.000	100.200	100.0	1
KU	C1S	2035503	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035504	02/2013	01/30/2013	100.000	100.000	100.1	1
KU	C1S	2035505	02/2013	01/29/2013	99.900	100.100	100.0	1
KU	C1S	2035506	02/2013	01/29/2013	99.900	100.100	100.0	1
KU	C1S	2035507	02/2013	01/30/2013	99.900	100.000	100.0	1
KU	C1S	2035508	02/2013	01/30/2013	99.900	100.100	100.0	1
KU	C1S	2035509	02/2013	01/30/2013	100.000	100.200	100.1	1
KU	C1S	2035510	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035511	02/2013	01/30/2013	100.000	100.200	100.1	1
KU	C1S	2035512	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035513	02/2013	01/30/2013	100.000	100.200	100.1	1



KU	C1S	2035514	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035515	02/2013	01/30/2013	100.000	100.200	100.0	1
KU	C1S	2035516	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035517	02/2013	01/30/2013	100.000	100.100	99.9	1
KU	C1S	2035518	02/2013	01/30/2013	99.900	100.100	100.0	1
KU	C1S	2035519	02/2013	01/30/2013	100.000	100.200	100.1	1
KU	C1S	2035520	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035521	02/2013	01/30/2013	100.000	100.000	100.0	1
KU	C1S	2035522	02/2013	01/30/2013	99.900	100.000	100.0	1
KU	C1S	2035523	02/2013	01/30/2013	100.000	100.200	100.0	1
KU	C1S	2035524	02/2013	01/30/2013	99.900	100.000	100.0	1
KU	C1S	2035525	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035526	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035527	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035528	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035529	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035530	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035531	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035532	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035533	02/2013	01/30/2013	100.000	100.000	100.0	1
KU	C1S	2035534	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035535	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035536	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035537	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035538	02/2013	01/30/2013	100.000	100.000	100.0	1
KU	C1S	2035539	02/2013	01/30/2013	100.000	100.000	100.1	1
KU	C1S	2035540	02/2013	01/30/2013	99.900	100.100	100.0	1
KU	C1S	2035541	02/2013	01/30/2013	99.900	100.100	100.0	1
KU	C1S	2035542	02/2013	01/30/2013	100.000	100.200	100.0	1
KU	C1S	2035543	02/2013	01/30/2013	99.900	100.100	100.0	1

KU	C1S	2035544	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035545	02/2013	01/30/2013	99.900	100.000	100.0	1
KU	C1S	2035546	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035547	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035548	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035549	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035550	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035551	02/2013	01/30/2013	99.900	100.100	100.1	1
KU	C1S	2035552	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035553	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035554	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035555	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035556	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035557	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035558	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035559	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035560	02/2013	01/30/2013	100.000	100.200	100.1	1
KU	C1S	2035561	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035562	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035563	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035564	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035565	02/2013	01/30/2013	100.000	100.000	100.0	1
KU	C1S	2035566	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035567	02/2013	01/30/2013	100.000	100.000	100.1	1
KU	C1S	2035568	02/2013	01/30/2013	100.000	100.000	100.0	1
KU	C1S	2035569	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035570	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035571	02/2013	01/30/2013	100.000	100.000	100.1	1
KU	C1S	2035572	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035573	02/2013	01/30/2013	100.000	100.100	100.0	1

KU	C1S	2035574	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035575	02/2013	01/30/2013	100.000	100.000	100.1	1
KU	C1S	2035576	02/2013	01/30/2013	99.900	100.100	100.0	1
KU	C1S	2035577	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035578	02/2013	01/30/2013	99.900	100.100	100.1	1
KU	C1S	2035579	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035580	02/2013	01/30/2013	99.900	100.000	100.0	1
KU	C1S	2035581	02/2013	01/30/2013	100.000	100.100	99.9	1
KU	C1S	2035582	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035583	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035584	02/2013	01/30/2013	100.000	100.000	100.0	1
KU	C1S	2035585	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035586	02/2013	01/30/2013	99.900	100.000	99.9	1
KU	C1S	2035587	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035588	02/2013	01/30/2013	100.000	100.100	99.9	1
KU	C1S	2035589	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035590	02/2013	01/30/2013	100.000	100.200	100.1	1
KU	C1S	2035591	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035592	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035593	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035594	02/2013	01/30/2013	100.000	100.200	100.1	1
KU	C1S	2035595	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035596	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035597	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035598	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035599	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035600	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035601	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035602	02/2013	01/30/2013	100.000	100.200	100.0	1
KU	C1S	2035603	02/2013	01/30/2013	100.000	100.100	100.1	1



KU	C1S	2035604	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035605	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035606	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035607	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035608	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035609	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035610	02/2013	01/30/2013	100.000	100.200	100.0	1
KU	C1S	2035611	02/2013	01/30/2013	100.000	100.200	100.0	1
KU	C1S	2035612	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035613	02/2013	01/30/2013	99.900	100.000	100.0	1
KU	C1S	2035614	02/2013	01/30/2013	99.900	100.200	100.0	1
KU	C1S	2035615	02/2013	01/30/2013	100.000	100.200	100.0	1
KU	C1S	2035616	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035617	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035618	02/2013	01/30/2013	100.000	100.200	100.0	1
KU	C1S	2035619	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035620	02/2013	01/30/2013	99.900	100.000	100.0	1
KU	C1S	2035621	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035622	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035623	02/2013	01/30/2013	99.900	100.100	100.1	1
KU	C1S	2035624	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035625	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035626	02/2013	01/30/2013	99.900	100.000	100.0	1
KU	C1S	2035627	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035628	02/2013	01/30/2013	100.000	100.000	100.0	1
KU	C1S	2035629	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035630	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035631	02/2013	01/30/2013	99.900	100.000	100.0	1
KU	C1S	2035632	02/2013	01/30/2013	100.000	100.100	99.9	1
KU	C1S	2035633	02/2013	01/30/2013	100.000	100.100	100.0	1

KU	C1S	2035634	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035635	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035636	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035637	02/2013	01/30/2013	99.900	100.100	100.0	1
KU	C1S	2035638	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035639	02/2013	01/30/2013	100.000	100.000	100.1	1
KU	C1S	2035640	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035641	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035642	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035643	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035644	02/2013	01/30/2013	100.000	100.100	99.9	1
KU	C1S	2035645	02/2013	01/30/2013	100.000	100.000	100.1	1
KU	C1S	2035646	02/2013	01/30/2013	100.000	100.000	100.0	1
KU	C1S	2035647	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035648	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035649	02/2013	01/30/2013	100.000	100.200	100.0	1
KU	C1S	2035650	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035651	02/2013	01/30/2013	100.000	100.200	100.0	1
KU	C1S	2035652	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035653	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035654	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035655	02/2013	01/30/2013	100.000	100.200	100.0	1
KU	C1S	2035656	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035657	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035658	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035659	02/2013	01/30/2013	99.900	100.100	100.0	1
KU	C1S	2035660	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035661	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035662	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035663	02/2013	01/30/2013	100.000	100.100	100.0	1



KU	C1S	2035664	02/2013	01/30/2013	100.000	100.100	99.9	1
KU	C1S	2035665	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035666	02/2013	01/30/2013	100.000	100.200	100.0	1
KU	C1S	2035667	02/2013	01/30/2013	100.000	100.200	100.1	1
KU	C1S	2035668	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035669	02/2013	01/30/2013	100.000	100.200	100.1	1
KU	C1S	2035670	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035671	02/2013	01/30/2013	99.900	100.100	100.0	1
KU	C1S	2035672	02/2013	01/30/2013	100.000	100.200	100.0	1
KU	C1S	2035673	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035674	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035675	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035676	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035677	02/2013	01/30/2013	99.900	100.100	100.0	1
KU	C1S	2035678	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035679	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035680	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035681	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035682	02/2013	01/30/2013	100.000	100.000	100.0	1
KU	C1S	2035683	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035684	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035685	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035686	02/2013	01/30/2013	100.000	100.000	100.0	1
KU	C1S	2035687	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035688	02/2013	01/30/2013	99.900	100.100	100.0	1
KU	C1S	2035689	02/2013	01/30/2013	100.000	100.200	99.9	1
KU	C1S	2035690	02/2013	01/30/2013	99.900	100.100	100.0	1
KU	C1S	2035691	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035692	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035693	02/2013	01/30/2013	100.000	100.100	100.0	1

KU	C1S	2035694	02/2013	01/30/2013	99.900	100.200	100.1	1
KU	C1S	2035695	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035696	02/2013	01/30/2013	99.900	100.000	100.0	1
KU	C1S	2035697	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035698	02/2013	01/30/2013	100.000	100.000	100.0	1
KU	C1S	2035699	02/2013	01/30/2013	100.000	100.100	99.9	1
KU	C1S	2035700	02/2013	01/30/2013	100.000	100.000	100.1	1
KU	C1S	2035701	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035702	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035703	02/2013	01/30/2013	100.000	100.200	100.0	1
KU	C1S	2035704	02/2013	01/30/2013	100.000	100.000	100.1	1
KU	C1S	2035705	02/2013	01/30/2013	100.000	100.200	100.0	1
KU	C1S	2035706	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035707	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035708	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035709	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035710	02/2013	01/30/2013	99.900	100.000	100.0	1
KU	C1S	2035711	02/2013	01/30/2013	99.900	100.100	100.0	1
KU	C1S	2035712	02/2013	01/27/2013	100.000	100.100	100.0	1
KU	C1S	2035713	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035714	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035715	02/2013	01/30/2013	99.900	100.000	100.0	1
KU	C1S	2035716	02/2013	01/30/2013	100.000	100.100	99.9	1
KU	C1S	2035717	02/2013	01/30/2013	100.000	100.100	99.9	1
KU	C1S	2035718	02/2013	01/30/2013	100.000	100.200	100.0	1
KU	C1S	2035719	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035720	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035721	02/2013	01/28/2013	100.000	100.100	100.0	1
KU	C1S	2035722	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035723	02/2013	01/30/2013	99.900	100.000	100.1	1

KU	C1S	2035724	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035725	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035726	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035727	02/2013	01/30/2013	100.000	100.200	100.0	1
KU	C1S	2035728	02/2013	01/30/2013	100.000	100.200	100.0	1
KU	C1S	2035729	02/2013	01/30/2013	99.900	100.100	100.0	1
KU	C1S	2035730	02/2013	01/30/2013	100.000	100.000	99.9	1
KU	C1S	2035731	02/2013	01/30/2013	100.000	100.100	99.9	1
KU	C1S	2035732	02/2013	01/30/2013	100.000	100.200	100.1	1
KU	C1S	2035733	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035734	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035735	02/2013	01/30/2013	100.000	100.200	100.0	1
KU	C1S	2035736	02/2013	01/30/2013	100.000	100.000	100.0	1
KU	C1S	2035737	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035738	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035739	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035740	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035741	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035742	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035743	02/2013	01/30/2013	100.000	100.200	100.0	1
KU	C1S	2035744	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035745	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035746	02/2013	01/30/2013	100.000	100.100	99.9	1
KU	C1S	2035747	02/2013	01/30/2013	100.000	100.200	100.0	1
KU	C1S	2035748	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035749	02/2013	01/30/2013	100.000	100.200	100.0	1
KU	C1S	2035750	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035751	02/2013	01/30/2013	100.000	100.200	99.9	1
KU	C1S	2035752	02/2013	01/29/2013	99.900	100.100	100.0	1
KU	C1S	2035753	02/2013	01/30/2013	100.000	100.100	99.9	1



KU	C1S	2035754	02/2013	01/30/2013	99.900	100.100	100.0	1
KU	C1S	2035755	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035756	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035757	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035758	02/2013	01/30/2013	100.000	100.200	100.1	1
KU	C1S	2035759	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035760	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035761	02/2013	01/30/2013	100.000	100.200	100.1	1
KU	C1S	2035762	02/2013	01/30/2013	100.000	100.000	100.0	1
KU	C1S	2035763	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035764	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035765	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035766	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035767	02/2013	01/30/2013	99.900	100.100	100.1	1
KU	C1S	2035768	02/2013	01/29/2013	100.000	100.100	100.0	1
KU	C1S	2035769	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035770	02/2013	01/30/2013	100.000	100.000	100.0	1
KU	C1S	2035771	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035772	02/2013	01/30/2013	100.000	100.000	100.0	1
KU	C1S	2035773	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035774	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035775	02/2013	01/30/2013	100.000	100.000	99.9	1
KU	C1S	2035776	02/2013	01/29/2013	100.000	100.100	100.1	1
KU	C1S	2035777	02/2013	01/30/2013	100.000	100.200	100.0	1
KU	C1S	2035778	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035779	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035780	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035781	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035782	02/2013	01/30/2013	99.900	100.000	100.0	1
KU	C1S	2035783	02/2013	01/30/2013	99.900	100.100	100.0	1

KU	C1S	2035784	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035785	02/2013	01/30/2013	100.000	100.200	100.0	1
KU	C1S	2035786	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035787	02/2013	01/30/2013	99.900	100.100	100.1	1
KU	C1S	2035788	02/2013	01/30/2013	100.000	100.000	100.0	1
KU	C1S	2035789	02/2013	01/30/2013	100.000	100.000	100.0	1
KU	C1S	2035790	02/2013	01/30/2013	100.000	100.000	100.0	1
KU	C1S	2035791	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035792	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035793	02/2013	01/30/2013	100.000	100.200	100.0	1
KU	C1S	2035794	02/2013	01/30/2013	100.000	100.000	100.0	1
KU	C1S	2035795	02/2013	01/30/2013	100.000	100.200	100.1	1
KU	C1S	2035796	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035797	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035798	02/2013	01/30/2013	100.000	100.200	100.1	1
KU	C1S	2035799	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035800	02/2013	01/30/2013	99.900	100.000	100.0	1
KU	C1S	2035801	02/2013	01/30/2013	99.900	100.100	100.0	1
KU	C1S	2035802	02/2013	01/30/2013	100.000	100.200	100.1	1
KU	C1S	2035803	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035804	02/2013	01/30/2013	99.900	100.100	100.0	1
KU	C1S	2035805	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035806	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035807	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035808	02/2013	01/30/2013	100.000	100.200	100.1	1
KU	C1S	2035809	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035810	02/2013	01/30/2013	100.000	100.200	100.1	1
KU	C1S	2035811	02/2013	01/30/2013	99.900	100.100	100.0	1
KU	C1S	2035812	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035813	02/2013	01/30/2013	100.000	100.000	100.1	1



KU	C1S	2035814	02/2013	01/30/2013	100.000	100.200	100.1	1
KU	C1S	2035815	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035816	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035817	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035818	02/2013	01/30/2013	100.000	100.200	100.0	1
KU	C1S	2035819	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035820	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035821	02/2013	01/30/2013	100.000	100.100	99.9	1
KU	C1S	2035822	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035823	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035824	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035825	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035826	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035827	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035828	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035829	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035830	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035831	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035832	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035833	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035834	02/2013	01/29/2013	100.000	100.100	100.0	1
KU	C1S	2035835	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035836	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035837	02/2013	01/30/2013	100.000	100.100	99.9	1
KU	C1S	2035838	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035839	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035840	02/2013	01/30/2013	100.000	100.200	100.1	1
KU	C1S	2035841	02/2013	01/30/2013	100.000	100.100	99.9	1
KU	C1S	2035842	02/2013	01/30/2013	100.000	100.200	100.1	1
KU	C1S	2035843	02/2013	01/30/2013	100.000	100.100	99.9	1

KU	C1S	2035844	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035845	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035846	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035847	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035848	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035849	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035850	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035851	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035852	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035853	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035854	02/2013	01/30/2013	100.000	100.000	99.9	1
KU	C1S	2035855	02/2013	01/30/2013	99.900	100.100	100.0	1
KU	C1S	2035856	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035857	02/2013	01/30/2013	100.000	100.200	100.1	1
KU	C1S	2035858	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035859	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035860	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035861	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035862	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035863	02/2013	01/30/2013	99.900	100.100	100.0	1
KU	C1S	2035864	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035865	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035866	02/2013	01/30/2013	100.000	100.200	100.1	1
KU	C1S	2035867	02/2013	01/30/2013	100.000	100.200	100.0	1
KU	C1S	2035868	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035869	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035870	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035871	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035872	02/2013	01/30/2013	100.000	100.000	99.9	1
KU	C1S	2035873	02/2013	01/30/2013	100.000	100.100	100.0	1

KU	C1S	2035874	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035875	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035876	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035877	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035878	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035879	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035880	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035881	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035882	02/2013	01/30/2013	99.900	100.000	100.0	1
KU	C1S	2035883	02/2013	01/29/2013	100.000	100.100	100.0	1
KU	C1S	2035884	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035885	02/2013	01/29/2013	100.000	100.100	100.0	1
KU	C1S	2035886	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035887	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035888	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035889	02/2013	01/30/2013	100.000	100.200	100.0	1
KU	C1S	2035890	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035891	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035892	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035893	02/2013	01/30/2013	100.000	100.200	100.1	1
KU	C1S	2035894	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035895	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035896	02/2013	01/29/2013	100.000	100.100	100.0	1
KU	C1S	2035897	02/2013	01/29/2013	100.000	100.100	100.0	1
KU	C1S	2035898	02/2013	01/29/2013	99.900	100.100	100.0	1
KU	C1S	2035899	02/2013	01/29/2013	100.000	100.100	100.1	1
KU	C1S	2035900	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035901	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035902	02/2013	01/30/2013	100.000	100.100	99.9	1
KU	C1S	2035903	02/2013	01/30/2013	100.000	100.100	100.0	1



KU	C1S	2035904	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035905	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035906	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035907	02/2013	01/30/2013	100.000	100.000	100.0	1
KU	C1S	2035908	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035909	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035910	02/2013	01/30/2013	99.900	100.100	99.9	1
KU	C1S	2035911	02/2013	01/25/2013	100.000	100.100	100.1	1
KU	C1S	2035912	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035913	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035914	02/2013	01/25/2013	100.000	100.100	100.0	1
KU	C1S	2035915	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035916	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035917	02/2013	01/30/2013	100.000	100.200	100.0	1
KU	C1S	2035918	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035919	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035920	02/2013	01/30/2013	99.900	100.100	100.0	1
KU	C1S	2035921	02/2013	01/30/2013	100.000	100.200	100.0	1
KU	C1S	2035922	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035923	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035924	02/2013	01/30/2013	99.900	100.100	100.0	1
KU	C1S	2035925	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035926	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035927	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035928	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035929	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035930	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035931	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035932	02/2013	01/30/2013	100.000	100.200	100.1	1
KU	C1S	2035933	02/2013	01/30/2013	100.000	100.100	100.0	1

KU	C1S	2035934	02/2013	01/30/2013	99.900	100.000	99.9	1
KU	C1S	2035935	02/2013	01/29/2013	100.000	100.100	100.0	1
KU	C1S	2035936	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035937	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035938	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035939	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035940	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035941	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035942	02/2013	01/30/2013	100.000	100.200	100.0	1
KU	C1S	2035943	02/2013	01/30/2013	100.000	100.200	100.0	1
KU	C1S	2035944	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035945	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035946	02/2013	01/30/2013	100.000	100.000	100.0	1
KU	C1S	2035947	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035948	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035949	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035950	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035951	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035952	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035953	02/2013	01/30/2013	100.000	100.100	99.9	1
KU	C1S	2035954	02/2013	01/30/2013	100.000	100.000	100.0	1
KU	C1S	2035955	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035956	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035957	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035958	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035959	02/2013	01/30/2013	100.000	100.200	100.1	1
KU	C1S	2035960	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035961	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035962	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035963	02/2013	01/30/2013	100.000	100.100	100.0	1

KU	C1S	2035964	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035965	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035966	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035967	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035968	02/2013	01/30/2013	100.000	100.000	100.0	1
KU	C1S	2035969	02/2013	01/30/2013	100.000	100.200	100.1	1
KU	C1S	2035970	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035971	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035972	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035973	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035974	02/2013	01/30/2013	100.000	100.200	100.0	1
KU	C1S	2035975	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035976	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035977	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035978	02/2013	01/30/2013	99.900	100.100	100.0	1
KU	C1S	2035979	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035980	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035981	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035982	02/2013	01/30/2013	99.900	100.100	99.9	1
KU	C1S	2035983	02/2013	01/30/2013	99.900	100.100	100.0	1
KU	C1S	2035984	02/2013	01/30/2013	100.000	100.200	100.0	1
KU	C1S	2035985	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2035986	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035987	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035988	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035989	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035990	02/2013	01/30/2013	100.000	100.000	100.0	1
KU	C1S	2035991	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035992	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2035993	02/2013	01/30/2013	100.000	100.200	100.1	1



KU	C-1S	2035994	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C-1S	2035995	02/2013	01/30/2013	100.000	100.000	100.0	1
KU	C-1S	2035996	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C-1S	2035997	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C-1S	2035998	02/2013	01/30/2013	100.000	100.200	100.0	1
KU	C-1S	2035999	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C-1S	2036000	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C-1S	2036001	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C-1S	2036002	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C-1S	2036003	02/2013	01/30/2013	100.000	100.200	100.2	1
KU	C-1S	2036004	02/2013	01/30/2013	100.000	100.100	99.9	1
KU	C-1S	2036005	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C-1S	2036006	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C-1S	2036007	02/2013	01/30/2013	99.900	100.100	100.1	1
KU	C-1S	2036008	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C-1S	2036009	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C-1S	2036010	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C-1S	2036011	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C-1S	2036012	02/2013	01/29/2013	100.000	100.100	100.0	1
KU	C-1S	2036013	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C-1S	2036014	02/2013	01/30/2013	100.000	100.200	100.0	1
KU	C-1S	2036015	02/2013	01/25/2013	100.000	100.100	100.0	1
KU	C-1S	2036016	02/2013	01/30/2013	100.000	100.200	100.0	1
KU	C-1S	2036017	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C-1S	2036018	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C-1S	2036019	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C-1S	2036020	02/2013	01/30/2013	100.000	100.100	99.9	1
KU	C-1S	2036021	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C-1S	2036022	02/2013	01/30/2013	100.000	100.000	100.0	1
KU	C-1S	2036023	02/2013	01/30/2013	100.000	100.100	100.0	1

KU	C1S	2036024	02/2013	01/30/2013	99.900	100.100	100.0	1
KU	C1S	2036025	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2036026	02/2013	01/30/2013	100.000	100.200	100.0	1
KU	C1S	2036027	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036028	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2036029	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036030	02/2013	01/30/2013	99.900	100.100	99.9	1
KU	C1S	2036031	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036032	02/2013	01/30/2013	100.000	100.200	100.0	1
KU	C1S	2036033	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036034	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036035	02/2013	01/30/2013	99.900	100.100	99.9	1
KU	C1S	2036036	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2036037	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036038	02/2013	01/30/2013	100.000	100.200	100.1	1
KU	C1S	2036039	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036040	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2036041	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036042	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2036043	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036044	02/2013	01/30/2013	99.900	100.100	100.0	1
KU	C1S	2036045	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036046	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2036047	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2036048	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2036049	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036050	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2036051	02/2013	01/30/2013	100.000	100.200	100.0	1
KU	C1S	2036052	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2036053	02/2013	01/30/2013	100.000	100.100	100.0	1

KU	C1S	2036054	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2036055	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036056	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036057	02/2013	01/30/2013	99.900	100.100	100.1	1
KU	C1S	2036058	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2036059	02/2013	01/30/2013	100.000	100.200	100.1	1
KU	C1S	2036060	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036061	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036062	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036063	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2036064	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036065	02/2013	01/30/2013	100.000	100.200	99.9	1
KU	C1S	2036066	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2036067	02/2013	01/30/2013	100.000	100.000	100.0	1
KU	C1S	2036068	02/2013	01/30/2013	99.900	100.100	100.0	1
KU	C1S	2036069	02/2013	01/30/2013	100.000	100.000	100.0	1
KU	C1S	2036070	02/2013	01/30/2013	99.900	100.100	100.0	1
KU	C1S	2036071	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036072	02/2013	01/30/2013	100.000	100.200	100.0	1
KU	C1S	2036073	02/2013	01/30/2013	100.000	100.200	100.0	1
KU	C1S	2036074	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036075	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2036076	02/2013	01/30/2013	100.000	100.000	100.0	1
KU	C1S	2036077	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036078	02/2013	01/30/2013	99.900	100.100	100.1	1
KU	C1S	2036079	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2036080	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036081	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2036082	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036083	02/2013	01/30/2013	100.000	100.100	100.1	1



KU	C1S	2036084	02/2013	01/24/2013	99.900	100.100	100.0	1
KU	C1S	2036085	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036086	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036087	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036088	02/2013	01/30/2013	100.000	100.200	100.1	1
KU	C1S	2036089	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2036090	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036091	02/2013	01/30/2013	99.900	100.100	100.0	1
KU	C1S	2036092	02/2013	01/30/2013	99.900	100.100	100.0	1
KU	C1S	2036093	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036094	02/2013	01/30/2013	99.900	100.100	100.0	1
KU	C1S	2036095	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036096	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036097	02/2013	01/30/2013	100.000	100.000	100.0	1
KU	C1S	2036098	02/2013	01/30/2013	100.000	100.100	99.9	1
KU	C1S	2036099	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036100	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2036101	02/2013	01/30/2013	100.000	100.100	99.9	1
KU	C1S	2036102	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2036103	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036104	02/2013	01/30/2013	99.900	100.100	99.9	1
KU	C1S	2036105	02/2013	01/30/2013	99.900	100.100	100.0	1
KU	C1S	2036106	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036107	02/2013	01/30/2013	100.000	100.100	99.9	1
KU	C1S	2036108	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036109	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036110	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2036111	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2036112	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036113	02/2013	01/30/2013	100.000	100.100	100.0	1

KU	C1S	2036114	02/2013	01/30/2013	100.000	100.200	99.9	1
KU	C1S	2036115	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036116	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2036117	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036118	02/2013	01/30/2013	100.000	100.000	100.1	1
KU	C1S	2036119	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036120	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036121	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036122	02/2013	01/30/2013	100.000	100.000	100.0	1
KU	C1S	2036123	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036124	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2036125	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036126	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036127	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036128	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2036129	02/2013	01/30/2013	100.000	100.200	100.0	1
KU	C1S	2036130	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036131	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036132	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036133	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2036134	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036135	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036136	02/2013	01/30/2013	100.000	100.200	100.0	1
KU	C1S	2036137	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2036138	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036139	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036140	02/2013	01/30/2013	100.000	100.000	100.0	1
KU	C1S	2036141	02/2013	01/30/2013	100.000	100.100	99.9	1
KU	C1S	2036142	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2036143	02/2013	01/30/2013	100.000	100.100	100.0	1

KU	C1S	2036144	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036145	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2036146	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036147	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036148	02/2013	01/30/2013	100.000	100.000	100.0	1
KU	C1S	2036149	02/2013	01/30/2013	99.900	100.100	100.0	1
KU	C1S	2036150	02/2013	01/30/2013	100.000	100.000	100.0	1
KU	C1S	2036151	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036152	02/2013	01/29/2013	100.000	100.100	100.1	1
KU	C1S	2036153	02/2013	01/29/2013	99.900	100.100	99.9	1
KU	C1S	2036154	02/2013	01/30/2013	100.000	100.000	100.0	1
KU	C1S	2036155	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2036156	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036157	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2036158	02/2013	01/30/2013	100.000	100.000	100.0	1
KU	C1S	2036159	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2036160	02/2013	01/30/2013	100.000	100.000	100.1	1
KU	C1S	2036161	02/2013	01/30/2013	100.000	100.100	99.9	1
KU	C1S	2036162	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036163	02/2013	01/30/2013	99.900	100.100	99.9	1
KU	C1S	2036164	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036165	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2036166	02/2013	01/30/2013	100.000	100.100	99.9	1
KU	C1S	2036167	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2036168	02/2013	01/30/2013	100.000	100.200	100.0	1
KU	C1S	2036169	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2036170	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2036171	02/2013	01/30/2013	99.900	100.000	100.0	1
KU	C1S	2036172	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036173	02/2013	01/30/2013	100.000	100.100	100.0	1



KU	C1S	2036174	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2036175	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036176	02/2013	01/30/2013	99.900	100.100	100.0	1
KU	C1S	2036177	02/2013	01/29/2013	100.000	100.100	100.1	1
KU	C1S	2036178	02/2013	01/29/2013	99.900	100.100	100.0	1
KU	C1S	2036179	02/2013	01/30/2013	100.000	100.000	100.1	1
KU	C1S	2036180	02/2013	01/30/2013	100.000	100.200	100.0	1
KU	C1S	2036181	02/2013	01/30/2013	100.000	100.200	100.0	1
KU	C1S	2036182	02/2013	01/30/2013	99.900	100.100	100.0	1
KU	C1S	2036183	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036184	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036185	02/2013	01/30/2013	99.900	100.100	100.0	1
KU	C1S	2036186	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036187	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2036188	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2036189	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2036190	02/2013	01/30/2013	100.000	100.000	99.9	1
KU	C1S	2036191	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036192	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036193	02/2013	01/30/2013	100.000	100.200	100.0	1
KU	C1S	2036194	02/2013	01/30/2013	100.000	100.200	100.1	1
KU	C1S	2036195	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036196	02/2013	01/30/2013	100.000	100.200	99.9	1
KU	C1S	2036197	02/2013	01/30/2013	99.900	100.200	100.0	1
KU	C1S	2036198	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036199	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036200	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2036201	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036202	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036203	02/2013	01/30/2013	99.900	100.100	100.0	1

KU	C1S	2036204	02/2013	01/30/2013	100.000	100.000	100.0	1
KU	C1S	2036205	02/2013	01/30/2013	100.000	100.100	99.9	1
KU	C1S	2036206	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036207	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036208	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036209	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2036210	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036211	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036212	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2036213	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036214	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036215	02/2013	01/30/2013	100.000	100.000	100.0	1
KU	C1S	2036216	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036217	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036218	02/2013	01/30/2013	100.000	100.200	100.0	1
KU	C1S	2036219	02/2013	01/30/2013	100.000	100.200	100.1	1
KU	C1S	2036220	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2036221	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036222	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2036223	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036224	02/2013	01/30/2013	100.000	100.200	100.0	1
KU	C1S	2036225	02/2013	01/30/2013	99.900	100.100	100.0	1
KU	C1S	2036226	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2036227	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2036228	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036229	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036230	02/2013	01/30/2013	100.000	100.100	99.9	1
KU	C1S	2036231	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036232	02/2013	01/30/2013	99.900	100.100	100.0	1
KU	C1S	2036233	02/2013	01/30/2013	100.000	100.000	100.0	1

KU	C1S	2036234	02/2013	01/30/2013	100.000	100.200	100.0	1
KU	C1S	2036235	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2036236	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036237	02/2013	01/29/2013	100.000	100.000	100.0	1
KU	C1S	2036238	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036239	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036240	02/2013	01/29/2013	100.000	100.100	100.0	1
KU	C1S	2036241	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036242	02/2013	01/29/2013	100.000	100.100	100.1	1
KU	C1S	2036243	02/2013	01/30/2013	100.000	100.000	100.0	1
KU	C1S	2036244	02/2013	01/30/2013	100.000	100.000	100.0	1
KU	C1S	2036245	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2036246	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2036247	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036248	02/2013	01/30/2013	100.000	100.200	100.0	1
KU	C1S	2036249	02/2013	01/30/2013	99.900	100.000	100.0	1
KU	C1S	2036250	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036251	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036252	02/2013	01/29/2013	100.000	100.100	100.0	1
KU	C1S	2036253	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036254	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036255	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036256	02/2013	01/30/2013	99.900	100.100	100.0	1
KU	C1S	2036257	02/2013	01/30/2013	100.000	100.200	100.1	1
KU	C1S	2036258	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2036259	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036260	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036261	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2036262	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036263	02/2013	01/30/2013	100.000	100.100	99.9	1



KU	C1S	2036264	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036265	02/2013	01/30/2013	100.000	100.200	100.0	1
KU	C1S	2036266	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036267	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036268	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036269	02/2013	01/30/2013	100.000	100.000	99.9	1
KU	C1S	2036270	02/2013	01/30/2013	100.000	100.100	99.9	1
KU	C1S	2036271	02/2013	01/30/2013	100.000	100.200	100.0	1
KU	C1S	2036272	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2036273	02/2013	01/30/2013	99.900	100.000	100.0	1
KU	C1S	2036274	02/2013	01/30/2013	100.000	100.200	100.0	1
KU	C1S	2036275	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036276	02/2013	01/30/2013	100.000	100.200	100.0	1
KU	C1S	2036277	02/2013	01/30/2013	99.900	100.100	99.9	1
KU	C1S	2036278	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2036279	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036280	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036281	02/2013	01/30/2013	100.000	100.200	100.1	1
KU	C1S	2036282	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2036283	02/2013	01/30/2013	100.000	100.000	100.1	1
KU	C1S	2036284	02/2013	01/30/2013	99.900	100.200	100.0	1
KU	C1S	2036285	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036286	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036287	02/2013	01/30/2013	100.000	100.200	99.9	1
KU	C1S	2036288	02/2013	01/30/2013	100.000	100.200	100.0	1
KU	C1S	2036289	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036290	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2036291	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2036292	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036293	02/2013	01/30/2013	99.900	100.100	99.9	1

KU	C1S	2036294	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2036295	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036296	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036297	02/2013	01/30/2013	99.900	100.100	100.0	1
KU	C1S	2036298	02/2013	01/30/2013	100.000	100.100	99.9	1
KU	C1S	2036299	02/2013	01/30/2013	99.900	100.100	100.0	1
KU	C1S	2036300	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036301	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036302	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036303	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036304	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036305	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036306	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2036307	02/2013	01/30/2013	100.000	100.000	100.0	1
KU	C1S	2036308	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036309	02/2013	01/30/2013	100.000	100.200	100.0	1
KU	C1S	2036310	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036311	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036312	02/2013	01/30/2013	100.000	100.200	100.1	1
KU	C1S	2036313	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2036314	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036315	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036316	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036317	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036318	02/2013	01/30/2013	100.000	100.100	99.9	1
KU	C1S	2036319	02/2013	01/30/2013	99.900	100.000	100.0	1
KU	C1S	2036320	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036321	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036322	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036323	02/2013	01/30/2013	100.000	100.100	100.0	1

KU	C1S	2036324	02/2013	01/30/2013	99.900	100.100	100.1	1
KU	C1S	2036325	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036326	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036327	02/2013	01/30/2013	99.900	100.000	100.0	1
KU	C1S	2036328	02/2013	01/30/2013	100.000	100.200	100.1	1
KU	C1S	2036329	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036330	02/2013	01/30/2013	99.900	100.100	100.0	1
KU	C1S	2036331	02/2013	01/30/2013	99.900	100.100	100.0	1
KU	C1S	2036332	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036333	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036334	02/2013	01/30/2013	100.000	100.100	99.9	1
KU	C1S	2036335	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036336	02/2013	01/30/2013	99.900	100.000	99.9	1
KU	C1S	2036337	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036338	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2036339	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036340	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036341	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036342	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036343	02/2013	01/30/2013	99.900	100.200	100.0	1
KU	C1S	2036344	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036345	02/2013	01/30/2013	100.000	100.000	100.0	1
KU	C1S	2036346	02/2013	01/30/2013	100.000	100.200	100.1	1
KU	C1S	2036347	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2036348	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2036349	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036350	02/2013	01/30/2013	100.000	100.000	100.0	1
KU	C1S	2036351	02/2013	01/30/2013	99.900	100.100	100.0	1
KU	C1S	2036352	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036353	02/2013	01/30/2013	100.000	100.200	100.0	1



KU	C1S	2036354	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036355	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036356	02/2013	01/30/2013	100.000	100.200	100.0	1
KU	C1S	2036357	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2036358	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036359	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036360	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036361	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036362	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036363	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036364	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036365	02/2013	01/30/2013	99.900	100.100	100.0	1
KU	C1S	2036366	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036367	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036368	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036369	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036370	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2036371	02/2013	01/30/2013	99.900	100.000	100.0	1
KU	C1S	2036372	02/2013	01/30/2013	100.000	100.200	100.0	1
KU	C1S	2036373	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036374	02/2013	01/30/2013	100.000	100.200	99.9	1
KU	C1S	2036375	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2036376	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2036377	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036378	02/2013	01/30/2013	100.000	100.000	100.0	1
KU	C1S	2036379	02/2013	01/30/2013	99.900	100.000	100.0	1
KU	C1S	2036380	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036381	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036382	02/2013	01/30/2013	100.000	100.200	100.0	1
KU	C1S	2036383	02/2013	01/30/2013	99.900	100.100	100.0	1

KU	C1S	2036384	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2036385	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036386	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2036387	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036388	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036389	02/2013	01/30/2013	100.000	100.000	100.0	1
KU	C1S	2036390	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036391	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036392	02/2013	01/30/2013	100.000	100.200	100.1	1
KU	C1S	2036393	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036394	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036395	02/2013	01/30/2013	99.900	100.100	100.1	1
KU	C1S	2036396	02/2013	01/30/2013	100.000	100.200	100.0	1
KU	C1S	2036397	02/2013	01/30/2013	100.000	100.200	100.1	1
KU	C1S	2036398	02/2013	01/30/2013	99.900	100.000	100.0	1
KU	C1S	2036399	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036400	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036401	02/2013	01/30/2013	100.000	100.000	100.0	1
KU	C1S	2036402	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036403	02/2013	01/30/2013	100.000	100.100	99.9	1
KU	C1S	2036404	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036405	02/2013	01/30/2013	100.000	100.100	99.9	1
KU	C1S	2036406	02/2013	01/30/2013	100.000	100.200	100.1	1
KU	C1S	2036407	02/2013	01/30/2013	100.000	100.100	99.9	1
KU	C1S	2036408	02/2013	01/30/2013	99.900	100.100	100.0	1
KU	C1S	2036409	02/2013	01/30/2013	100.000	100.100	99.9	1
KU	C1S	2036410	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036411	02/2013	01/30/2013	99.900	100.100	100.0	1
KU	C1S	2036412	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036413	02/2013	01/30/2013	100.000	100.200	100.0	1

KU	C1S	2036414	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036415	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036416	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2036417	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036418	02/2013	01/30/2013	100.000	100.000	100.0	1
KU	C1S	2036419	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036420	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2036421	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2036422	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036423	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036424	02/2013	01/30/2013	100.000	100.200	100.0	1
KU	C1S	2036425	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036426	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036427	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036428	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2036429	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036430	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036431	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2036432	02/2013	01/30/2013	100.000	100.200	100.0	1
KU	C1S	2036433	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036434	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2036435	02/2013	01/30/2013	100.000	100.200	100.0	1
KU	C1S	2036436	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036437	02/2013	01/30/2013	99.900	100.100	100.0	1
KU	C1S	2036438	02/2013	01/30/2013	100.000	100.000	100.1	1
KU	C1S	2036439	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036440	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036441	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036442	02/2013	01/30/2013	100.000	100.200	100.0	1
KU	C1S	2036443	02/2013	01/30/2013	100.000	100.100	100.0	1



KU	C1S	2036444	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036445	02/2013	01/30/2013	99.900	100.000	100.0	1
KU	C1S	2036446	02/2013	01/30/2013	99.900	100.100	100.0	1
KU	C1S	2036447	02/2013	01/30/2013	100.000	100.000	99.9	1
KU	C1S	2036448	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036449	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036450	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2036451	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036452	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2036453	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036454	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036455	02/2013	01/30/2013	100.000	100.000	100.0	1
KU	C1S	2036456	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036457	02/2013	01/30/2013	99.900	100.100	100.0	1
KU	C1S	2036458	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036459	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036460	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036461	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036462	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036463	02/2013	01/30/2013	100.000	100.000	100.0	1
KU	C1S	2036464	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2036465	02/2013	01/30/2013	100.000	100.000	100.0	1
KU	C1S	2036466	02/2013	01/30/2013	100.000	100.200	100.0	1
KU	C1S	2036467	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036468	02/2013	01/30/2013	100.000	100.200	100.0	1
KU	C1S	2036469	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2036470	02/2013	01/30/2013	100.000	100.100	99.9	1
KU	C1S	2036471	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036472	02/2013	01/30/2013	99.900	100.100	100.0	1
KU	C1S	2036473	02/2013	01/30/2013	100.000	100.000	100.0	1

KU	C1S	2036474	02/2013	01/30/2013	99.900	100.100	100.0	1
KU	C1S	2036475	02/2013	01/30/2013	100.000	100.000	100.1	1
KU	C1S	2036476	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036477	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036478	02/2013	01/30/2013	100.000	100.200	100.0	1
KU	C1S	2036479	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036480	02/2013	01/30/2013	100.000	100.100	99.9	1
KU	C1S	2036481	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036482	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036483	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036484	02/2013	01/30/2013	100.000	100.100	99.9	1
KU	C1S	2036485	02/2013	01/30/2013	100.000	100.100	99.9	1
KU	C1S	2036486	02/2013	01/30/2013	99.900	100.100	100.0	1
KU	C1S	2036487	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2036488	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036489	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036490	02/2013	01/30/2013	99.900	100.000	99.9	1
KU	C1S	2036491	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036492	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036493	02/2013	01/30/2013	100.000	100.000	100.0	1
KU	C1S	2036494	02/2013	01/30/2013	100.000	100.000	99.9	1
KU	C1S	2036495	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2036496	02/2013	01/30/2013	99.900	100.100	100.0	1
KU	C1S	2036497	02/2013	01/30/2013	99.900	100.100	100.0	1
KU	C1S	2036498	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036499	02/2013	01/30/2013	100.000	100.200	100.0	1
KU	C1S	2036500	02/2013	01/30/2013	100.000	100.200	100.0	1
KU	C1S	2036501	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036502	02/2013	01/30/2013	100.000	100.000	100.0	1
KU	C1S	2036503	02/2013	01/30/2013	100.000	100.100	100.0	1

KU	C1S	2036504	02/2013	01/30/2013	99.900	100.100	100.0	1
KU	C1S	2036505	02/2013	01/30/2013	99.900	100.100	99.9	1
KU	C1S	2036506	02/2013	01/30/2013	100.000	100.200	100.0	1
KU	C1S	2036507	02/2013	01/30/2013	100.000	100.200	100.0	1
KU	C1S	2036508	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2036509	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036510	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036511	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036512	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036513	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036514	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036515	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2036516	02/2013	01/30/2013	99.900	100.100	100.1	1
KU	C1S	2036517	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036518	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2036519	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2036520	02/2013	01/30/2013	100.000	100.000	100.0	1
KU	C1S	2036521	02/2013	01/30/2013	99.900	100.100	100.0	1
KU	C1S	2036522	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2036523	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2036524	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036525	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2036526	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2036527	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036528	02/2013	01/30/2013	100.000	100.000	100.1	1
KU	C1S	2036529	02/2013	01/30/2013	99.900	100.100	100.0	1
KU	C1S	2036530	02/2013	01/30/2013	100.000	100.200	100.1	1
KU	C1S	2036531	02/2013	01/30/2013	99.900	100.100	100.0	1
KU	C1S	2036532	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2036533	02/2013	01/30/2013	100.000	100.100	100.0	1



KU	C1S	2036534	02/2013	01/30/2013	100.000	100.200	100.0	1
KU	C1S	2036535	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2036536	02/2013	01/30/2013	100.000	100.000	100.0	1
KU	C1S	2036537	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036538	02/2013	01/30/2013	99.900	100.100	100.1	1
KU	C1S	2036539	02/2013	01/30/2013	100.000	100.200	100.0	1
KU	C1S	2036540	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2036541	02/2013	01/30/2013	99.900	100.000	100.0	1
KU	C1S	2036542	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036543	02/2013	01/29/2013	100.000	100.000	100.1	1
KU	C1S	2036544	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2036545	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2036546	02/2013	01/30/2013	99.900	100.100	100.0	1
KU	C1S	2036547	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036548	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2036549	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036550	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2036551	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036552	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036553	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036554	02/2013	01/30/2013	100.000	100.000	99.9	1
KU	C1S	2036555	02/2013	01/30/2013	100.000	100.200	100.0	1
KU	C1S	2036556	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2036557	02/2013	01/30/2013	100.000	100.100	99.9	1
KU	C1S	2036558	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036559	02/2013	01/30/2013	100.000	100.100	99.9	1
KU	C1S	2036560	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036561	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2036562	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036563	02/2013	01/30/2013	100.000	100.100	100.0	1

KU	C1S	2036564	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2036565	02/2013	01/30/2013	100.000	100.200	100.0	1
KU	C1S	2036566	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2036567	02/2013	01/30/2013	100.000	100.200	99.9	1
KU	C1S	2036568	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036569	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036570	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036571	02/2013	01/30/2013	100.000	100.000	99.9	1
KU	C1S	2036572	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036573	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2036574	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036575	02/2013	01/30/2013	99.900	100.100	99.9	1
KU	C1S	2036576	02/2013	01/30/2013	100.000	100.100	99.9	1
KU	C1S	2036577	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036578	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2036579	02/2013	01/30/2013	100.000	100.000	99.9	1
KU	C1S	2036580	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036581	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036582	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2036583	02/2013	01/30/2013	99.900	100.100	99.9	1
KU	C1S	2036584	02/2013	01/30/2013	100.000	100.000	100.0	1
KU	C1S	2036585	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036586	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2036587	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036588	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036589	02/2013	01/30/2013	99.900	100.200	100.0	1
KU	C1S	2036590	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036591	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036592	02/2013	01/30/2013	100.000	100.200	100.0	1
KU	C1S	2036593	02/2013	01/30/2013	100.000	100.100	100.1	1

KU	C1S	2036594	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036595	02/2013	01/30/2013	99.900	100.100	100.0	1
KU	C1S	2036596	02/2013	01/30/2013	100.000	100.200	100.1	1
KU	C1S	2036597	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036598	02/2013	01/30/2013	99.900	100.100	100.1	1
KU	C1S	2036599	02/2013	01/30/2013	100.000	100.200	100.0	1
KU	C1S	2036600	02/2013	01/30/2013	99.900	100.100	100.0	1
KU	C1S	2036601	02/2013	01/30/2013	100.000	100.200	100.0	1
KU	C1S	2036602	02/2013	01/30/2013	99.900	100.100	100.0	1
KU	C1S	2036603	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2036604	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036605	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2036606	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036607	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036608	02/2013	01/25/2013	99.900	100.100	100.0	1
KU	C1S	2036609	02/2013	01/25/2013	100.000	100.100	100.0	1
KU	C1S	2036610	02/2013	01/30/2013	100.000	100.000	100.0	1
KU	C1S	2036611	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036612	02/2013	01/30/2013	99.900	100.100	100.0	1
KU	C1S	2036613	02/2013	01/30/2013	100.000	100.000	100.0	1
KU	C1S	2036614	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2036615	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036616	02/2013	01/30/2013	100.000	100.200	100.1	1
KU	C1S	2036617	02/2013	01/30/2013	100.000	100.200	100.1	1
KU	C1S	2036618	02/2013	01/30/2013	100.000	100.200	100.0	1
KU	C1S	2036619	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036620	02/2013	01/30/2013	100.000	100.000	100.0	1
KU	C1S	2036621	02/2013	01/30/2013	99.900	100.100	100.0	1
KU	C1S	2036622	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2036623	02/2013	01/30/2013	99.900	100.100	100.0	1



KU	C1S	2036624	02/2013	01/30/2013	100.000	100.200	100.0	1
KU	C1S	2036625	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036626	02/2013	01/29/2013	100.000	100.100	100.1	1
KU	C1S	2036627	02/2013	01/29/2013	100.000	100.100	100.2	1
KU	C1S	2036628	02/2013	01/30/2013	99.900	100.000	100.1	1
KU	C1S	2036629	02/2013	01/29/2013	100.000	100.200	100.1	1
KU	C1S	2036630	02/2013	01/29/2013	100.000	100.100	100.0	1
KU	C1S	2036631	02/2013	01/30/2013	99.900	100.100	100.0	1
KU	C1S	2036632	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036633	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036634	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036635	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036636	02/2013	01/30/2013	100.000	100.000	100.0	1
KU	C1S	2036637	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2036638	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2036639	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036640	02/2013	01/30/2013	100.000	100.000	100.0	1
KU	C1S	2036641	02/2013	01/30/2013	99.900	100.100	100.1	1
KU	C1S	2036642	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036643	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2036644	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036645	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2036646	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036647	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2036648	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036649	02/2013	01/30/2013	100.000	100.200	100.0	1
KU	C1S	2036650	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2036651	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2036652	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036653	02/2013	01/30/2013	100.000	100.200	100.0	1

KU	C1S	2036654	02/2013	01/30/2013	99.900	100.100	100.0	1
KU	C1S	2036655	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036656	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036657	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036658	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036659	02/2013	01/30/2013	99.900	100.000	100.0	1
KU	C1S	2036660	02/2013	01/30/2013	99.900	100.100	100.1	1
KU	C1S	2036661	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036662	02/2013	01/30/2013	99.900	100.100	100.0	1
KU	C1S	2036663	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2036664	02/2013	01/30/2013	99.900	100.000	100.0	1
KU	C1S	2036665	02/2013	01/30/2013	100.000	100.000	100.0	1
KU	C1S	2036666	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036667	02/2013	01/30/2013	100.000	100.200	100.0	1
KU	C1S	2036668	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036669	02/2013	01/30/2013	99.900	100.100	100.1	1
KU	C1S	2036670	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036671	02/2013	01/30/2013	99.900	100.100	100.0	1
KU	C1S	2036672	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2036673	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2036674	02/2013	01/30/2013	100.000	100.000	99.9	1
KU	C1S	2036675	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036676	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036677	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036678	02/2013	01/30/2013	99.900	100.100	100.1	1
KU	C1S	2036679	02/2013	01/30/2013	99.900	100.100	100.0	1
KU	C1S	2036680	02/2013	01/30/2013	99.900	100.100	100.0	1
KU	C1S	2036681	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2036682	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036683	02/2013	01/30/2013	100.000	100.200	100.0	1

KU	C1S	2036684	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2036685	02/2013	01/30/2013	100.000	100.200	100.1	1
KU	C1S	2036686	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2036687	02/2013	01/30/2013	100.000	100.100	100.1	1
KU	C1S	2036688	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036689	02/2013	01/30/2013	99.900	100.000	100.0	1
KU	C1S	2036690	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036691	02/2013	01/30/2013	99.900	100.100	99.9	1
KU	C1S	2036692	02/2013	01/30/2013	100.000	100.200	100.1	1
KU	C1S	2036693	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2036694	02/2013	01/30/2013	100.000	100.200	100.0	1
KU	C1S	2036695	02/2013	01/30/2013	100.000	100.100	100.0	1
KU	C1S	2037756	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2037757	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2037758	04/2013	04/16/2013	100.000	100.200	100.0	1
KU	C1S	2037759	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2037760	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2037761	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2037762	04/2013	04/16/2013	100.000	100.200	100.0	1
KU	C1S	2037763	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2037764	04/2013	04/16/2013	100.000	100.000	100.0	1
KU	C1S	2037765	04/2013	04/16/2013	100.000	100.200	100.1	1
KU	C1S	2037766	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2037767	04/2013	04/16/2013	100.000	100.000	100.1	1
KU	C1S	2037768	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2037769	04/2013	04/16/2013	100.000	100.200	99.9	1
KU	C1S	2037770	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2037771	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2037772	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2037773	04/2013	04/16/2013	100.000	100.100	100.1	1



KU	C1S	2037774	04/2013	04/16/2013	100.000	100.200	100.0	1
KU	C1S	2037775	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2037776	04/2013	04/16/2013	100.000	100.200	100.1	1
KU	C1S	2037777	04/2013	04/16/2013	99.900	100.000	100.1	1
KU	C1S	2037778	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2037779	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2037780	04/2013	04/16/2013	100.000	100.200	100.1	1
KU	C1S	2037781	04/2013	04/16/2013	100.000	100.200	100.1	1
KU	C1S	2037782	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2037783	04/2013	04/16/2013	99.900	100.000	100.0	1
KU	C1S	2037784	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2037785	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2037786	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2037787	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2037788	04/2013	04/16/2013	100.000	100.200	100.2	1
KU	C1S	2037789	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2037790	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2037791	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2037792	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2037793	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2037794	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2037795	04/2013	04/16/2013	100.000	100.000	100.0	1
KU	C1S	2037796	04/2013	04/16/2013	100.000	100.200	100.0	1
KU	C1S	2037797	04/2013	04/16/2013	99.900	100.100	100.0	1
KU	C1S	2037798	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2037799	04/2013	04/16/2013	100.000	100.200	100.1	1
KU	C1S	2037800	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2037801	04/2013	04/16/2013	100.000	100.000	100.0	1
KU	C1S	2037802	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2037803	04/2013	04/16/2013	100.000	100.100	100.1	1

KU	C-1S	2037804	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C-1S	2037805	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C-1S	2037806	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C-1S	2037807	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C-1S	2037808	04/2013	04/16/2013	100.000	100.100	99.9	1
KU	C-1S	2037809	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C-1S	2037810	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C-1S	2037811	04/2013	04/16/2013	100.000	100.200	100.0	1
KU	C-1S	2037812	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C-1S	2037813	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C-1S	2037814	04/2013	04/16/2013	99.900	100.000	100.0	1
KU	C-1S	2037815	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C-1S	2037816	04/2013	04/16/2013	100.000	100.000	99.9	1
KU	C-1S	2037817	04/2013	04/16/2013	100.000	100.200	100.0	1
KU	C-1S	2037818	04/2013	04/16/2013	100.000	100.200	100.1	1
KU	C-1S	2037819	04/2013	04/16/2013	100.000	100.200	100.0	1
KU	C-1S	2037820	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C-1S	2037821	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C-1S	2037822	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C-1S	2037823	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C-1S	2037824	04/2013	04/16/2013	99.900	100.200	99.9	1
KU	C-1S	2037825	04/2013	04/16/2013	100.000	100.200	100.1	1
KU	C-1S	2037826	04/2013	04/16/2013	100.000	100.000	99.9	1
KU	C-1S	2037827	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C-1S	2037828	04/2013	04/16/2013	100.000	100.200	100.0	1
KU	C-1S	2037829	04/2013	04/16/2013	100.000	100.200	100.1	1
KU	C-1S	2037830	04/2013	04/16/2013	100.000	100.200	100.0	1
KU	C-1S	2037831	04/2013	04/16/2013	99.900	100.100	100.0	1
KU	C-1S	2037832	04/2013	04/16/2013	100.000	100.200	100.1	1
KU	C-1S	2037833	04/2013	04/16/2013	100.000	100.100	100.0	1

KU	C1S	2037834	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2037835	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2037836	04/2013	04/16/2013	99.900	100.100	100.0	1
KU	C1S	2037837	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2037838	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2037839	04/2013	04/16/2013	100.000	100.100	99.8	1
KU	C1S	2037840	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2037841	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2037842	04/2013	04/16/2013	100.000	100.200	100.0	1
KU	C1S	2037843	04/2013	04/16/2013	100.000	100.000	100.0	1
KU	C1S	2037844	04/2013	04/16/2013	100.000	100.200	100.0	1
KU	C1S	2037845	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2037846	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2037847	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2037848	04/2013	04/16/2013	100.000	100.200	100.0	1
KU	C1S	2037849	04/2013	04/16/2013	100.000	100.200	100.1	1
KU	C1S	2037850	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2037851	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2037852	04/2013	04/16/2013	99.900	100.100	100.0	1
KU	C1S	2037853	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2037854	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2037855	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2037856	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2037857	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2037858	04/2013	04/16/2013	100.000	100.200	100.1	1
KU	C1S	2037859	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2037860	04/2013	04/16/2013	100.000	100.000	100.0	1
KU	C1S	2037861	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2037862	04/2013	04/16/2013	100.000	100.200	100.1	1
KU	C1S	2037863	04/2013	04/16/2013	100.000	100.100	100.1	1



KU	C1S	2037864	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2037865	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2037866	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2037867	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2037868	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2037869	04/2013	04/16/2013	100.000	100.200	100.0	1
KU	C1S	2037870	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2037871	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2037872	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2037873	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2037874	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2037875	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2037876	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2037877	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2037878	04/2013	04/16/2013	99.900	100.100	100.1	1
KU	C1S	2037879	04/2013	04/16/2013	100.000	100.100	99.9	1
KU	C1S	2037880	04/2013	04/16/2013	100.000	100.200	100.1	1
KU	C1S	2037881	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2037882	04/2013	04/16/2013	100.000	100.000	99.9	1
KU	C1S	2037883	04/2013	04/16/2013	100.000	100.200	100.0	1
KU	C1S	2037884	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2037885	04/2013	04/16/2013	99.900	100.100	100.0	1
KU	C1S	2037886	04/2013	04/16/2013	100.000	100.200	100.1	1
KU	C1S	2037887	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2037888	04/2013	04/16/2013	99.900	100.100	100.0	1
KU	C1S	2037889	04/2013	04/16/2013	100.000	100.000	100.0	1
KU	C1S	2037890	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2037891	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2037892	04/2013	04/16/2013	99.900	100.100	100.0	1
KU	C1S	2037893	04/2013	04/16/2013	100.000	100.100	100.0	1

KU	C1S	2037894	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2037895	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2037896	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2037897	04/2013	04/16/2013	100.000	100.200	100.0	1
KU	C1S	2037898	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2037899	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2037900	04/2013	04/16/2013	100.000	100.000	100.1	1
KU	C1S	2037901	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2037902	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2037903	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2037904	04/2013	04/16/2013	100.000	100.100	100.2	1
KU	C1S	2037905	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2037906	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2037907	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2037908	04/2013	04/16/2013	99.900	100.000	100.0	1
KU	C1S	2037909	04/2013	04/16/2013	99.900	100.200	100.0	1
KU	C1S	2037910	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2037911	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2037912	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2037913	04/2013	04/16/2013	100.000	100.200	99.9	1
KU	C1S	2037914	04/2013	04/16/2013	100.000	100.200	100.1	1
KU	C1S	2037915	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2037916	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2037917	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2037918	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2037919	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2037920	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2037921	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2037922	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2037923	04/2013	04/16/2013	100.000	100.100	100.1	1

KU	C1S	2037924	04/2013	04/16/2013	99.900	100.000	100.0	1
KU	C1S	2037925	04/2013	04/16/2013	100.000	100.100	99.9	1
KU	C1S	2037926	04/2013	04/16/2013	100.000	100.200	100.0	1
KU	C1S	2037927	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2037928	04/2013	04/16/2013	100.000	100.200	100.0	1
KU	C1S	2037929	04/2013	04/16/2013	100.000	100.200	100.1	1
KU	C1S	2037930	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2037931	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2037932	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2037933	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2037934	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2037935	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2037936	04/2013	04/16/2013	100.000	100.000	100.1	1
KU	C1S	2037937	04/2013	04/16/2013	100.000	100.000	100.1	1
KU	C1S	2037938	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2037939	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2037940	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2037941	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2037942	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2037943	04/2013	04/16/2013	100.000	100.200	100.0	1
KU	C1S	2037944	04/2013	04/16/2013	99.900	100.100	100.1	1
KU	C1S	2037945	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2037946	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2037947	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2037948	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2037949	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2037950	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2037951	04/2013	04/16/2013	100.000	100.100	99.9	1
KU	C1S	2037952	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2037953	04/2013	04/16/2013	99.900	100.100	100.0	1



KU	C1S	2037954	04/2013	04/16/2013	100.000	100.200	100.1	1
KU	C1S	2037955	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2037956	04/2013	04/16/2013	100.000	100.200	100.1	1
KU	C1S	2037957	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2037958	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2037959	04/2013	04/16/2013	100.000	100.200	100.1	1
KU	C1S	2037960	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2037961	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2037962	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2037963	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2037964	04/2013	04/16/2013	100.000	100.000	99.9	1
KU	C1S	2037965	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2037966	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2037967	04/2013	04/16/2013	99.900	100.100	100.0	1
KU	C1S	2037968	04/2013	04/16/2013	100.000	100.000	100.1	1
KU	C1S	2037969	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2037970	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2037971	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2037972	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2037973	04/2013	04/16/2013	100.000	100.100	99.9	1
KU	C1S	2037974	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2037975	04/2013	04/16/2013	100.000	100.000	100.0	1
KU	C1S	2037976	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2037977	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2037978	04/2013	04/16/2013	99.900	100.100	100.0	1
KU	C1S	2037979	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2037980	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2037981	04/2013	04/16/2013	100.000	100.200	100.0	1
KU	C1S	2037982	04/2013	04/16/2013	99.900	100.100	100.0	1
KU	C1S	2037983	04/2013	04/16/2013	100.000	100.100	100.0	1

KU	C1S	2037984	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2037985	04/2013	04/16/2013	100.000	100.000	100.0	1
KU	C1S	2037986	04/2013	04/16/2013	100.000	100.000	100.0	1
KU	C1S	2037987	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2037988	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2037989	04/2013	04/16/2013	100.000	100.200	100.1	1
KU	C1S	2037990	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2037991	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2037992	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2037993	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2037994	04/2013	04/16/2013	99.900	100.200	100.0	1
KU	C1S	2037995	04/2013	04/16/2013	100.000	100.200	100.1	1
KU	C1S	2037996	04/2013	04/16/2013	99.900	100.100	100.0	1
KU	C1S	2037997	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2037998	04/2013	04/16/2013	100.000	100.200	100.1	1
KU	C1S	2037999	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038000	04/2013	04/16/2013	100.000	100.200	100.0	1
KU	C1S	2038001	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038002	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038003	04/2013	04/16/2013	100.000	100.100	99.9	1
KU	C1S	2038004	04/2013	04/16/2013	99.900	100.000	100.0	1
KU	C1S	2038005	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038006	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038007	04/2013	04/16/2013	100.000	100.000	100.0	1
KU	C1S	2038008	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038009	04/2013	04/16/2013	100.000	100.100	99.9	1
KU	C1S	2038010	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038011	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038012	04/2013	04/16/2013	99.900	100.100	100.1	1
KU	C1S	2038013	04/2013	04/16/2013	100.000	100.200	100.1	1

KU	C1S	2038014	04/2013	04/16/2013	99.900	100.000	100.0	1
KU	C1S	2038015	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038016	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038017	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038018	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038019	04/2013	04/16/2013	100.000	100.200	100.0	1
KU	C1S	2038020	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038021	04/2013	04/16/2013	100.000	100.000	100.0	1
KU	C1S	2038022	04/2013	04/16/2013	100.000	100.000	100.1	1
KU	C1S	2038023	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038024	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038025	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038026	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038027	04/2013	04/16/2013	100.000	100.200	100.1	1
KU	C1S	2038028	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038029	04/2013	04/16/2013	100.000	100.200	100.1	1
KU	C1S	2038030	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038031	04/2013	04/16/2013	100.000	100.000	100.0	1
KU	C1S	2038032	04/2013	04/16/2013	100.000	100.200	100.0	1
KU	C1S	2038033	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038034	04/2013	04/16/2013	99.900	100.000	100.1	1
KU	C1S	2038035	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038036	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038037	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038038	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038039	04/2013	04/16/2013	100.000	100.200	100.0	1
KU	C1S	2038040	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038041	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038042	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038043	04/2013	04/16/2013	100.000	100.100	100.0	1



KU	C1S	2038044	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038045	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038046	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038047	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038048	04/2013	04/16/2013	100.000	100.200	100.1	1
KU	C1S	2038049	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038050	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038051	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038052	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038053	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038054	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038055	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038056	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038057	04/2013	04/16/2013	100.000	100.200	100.1	1
KU	C1S	2038058	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038059	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038060	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038061	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038062	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038063	04/2013	04/16/2013	100.000	100.000	99.9	1
KU	C1S	2038064	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038065	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038066	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038067	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038068	04/2013	04/16/2013	100.000	100.100	99.9	1
KU	C1S	2038069	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038070	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038071	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038072	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038073	04/2013	04/16/2013	100.000	100.000	100.0	1

KU	C1S	2038074	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038075	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038076	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038077	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038078	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038079	04/2013	04/16/2013	100.000	100.200	100.0	1
KU	C1S	2038080	04/2013	04/16/2013	99.900	100.000	100.0	1
KU	C1S	2038081	04/2013	04/16/2013	100.000	100.000	100.0	1
KU	C1S	2038082	04/2013	04/16/2013	99.900	100.000	100.0	1
KU	C1S	2038083	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038084	04/2013	04/16/2013	100.000	100.200	100.1	1
KU	C1S	2038085	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038086	04/2013	04/16/2013	100.000	100.200	100.0	1
KU	C1S	2038087	04/2013	04/16/2013	100.000	100.200	99.9	1
KU	C1S	2038088	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038089	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038090	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038091	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038092	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038093	04/2013	04/16/2013	100.000	100.000	100.1	1
KU	C1S	2038094	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038095	04/2013	04/16/2013	100.000	100.100	99.9	1
KU	C1S	2038096	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038097	04/2013	04/16/2013	100.000	100.000	100.1	1
KU	C1S	2038098	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038099	04/2013	04/16/2013	100.000	100.000	100.0	1
KU	C1S	2038100	04/2013	04/16/2013	100.000	100.000	99.9	1
KU	C1S	2038101	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038102	04/2013	04/16/2013	100.000	100.000	100.1	1
KU	C1S	2038103	04/2013	04/16/2013	100.000	100.100	100.1	1

KU	C1S	2038104	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038105	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038106	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038107	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038108	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038109	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038110	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038111	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038112	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038113	04/2013	04/16/2013	100.000	100.200	100.1	1
KU	C1S	2038114	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038115	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038116	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038117	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038118	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038119	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038120	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038121	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038122	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038123	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038124	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038125	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038126	04/2013	04/16/2013	99.900	100.100	100.0	1
KU	C1S	2038127	04/2013	04/16/2013	100.000	100.000	100.0	1
KU	C1S	2038128	04/2013	04/16/2013	99.900	100.100	100.0	1
KU	C1S	2038129	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038130	04/2013	04/16/2013	99.900	100.100	99.9	1
KU	C1S	2038131	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038132	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038133	04/2013	04/16/2013	100.000	100.100	100.1	1



KU	C1S	2038134	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038135	04/2013	04/16/2013	100.000	100.000	100.1	1
KU	C1S	2038136	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038137	04/2013	04/16/2013	100.000	100.000	99.9	1
KU	C1S	2038138	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038139	04/2013	04/16/2013	100.000	100.200	100.0	1
KU	C1S	2038140	04/2013	04/16/2013	100.000	100.000	100.0	1
KU	C1S	2038141	04/2013	04/16/2013	100.000	100.000	100.1	1
KU	C1S	2038142	04/2013	04/16/2013	100.000	100.200	100.0	1
KU	C1S	2038143	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038144	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038145	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038146	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038147	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038148	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038149	04/2013	04/16/2013	100.000	100.100	99.9	1
KU	C1S	2038150	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038151	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038152	04/2013	04/16/2013	100.000	100.200	100.1	1
KU	C1S	2038153	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038154	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038155	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038156	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038157	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038158	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038159	04/2013	04/16/2013	100.000	100.000	100.0	1
KU	C1S	2038160	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038161	04/2013	04/16/2013	100.000	100.000	100.0	1
KU	C1S	2038162	04/2013	04/16/2013	100.000	100.000	100.0	1
KU	C1S	2038163	04/2013	04/16/2013	100.000	100.000	99.9	1

KU	C1S	2038164	04/2013	04/16/2013	100.000	100.100	99.9	1
KU	C1S	2038165	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038166	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038167	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038168	04/2013	04/16/2013	99.900	100.000	100.0	1
KU	C1S	2038169	04/2013	04/16/2013	100.000	100.100	99.9	1
KU	C1S	2038170	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038171	04/2013	04/16/2013	100.000	100.200	100.1	1
KU	C1S	2038172	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038173	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038174	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038175	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038176	04/2013	04/16/2013	100.000	100.000	100.1	1
KU	C1S	2038177	04/2013	04/16/2013	99.900	100.100	100.0	1
KU	C1S	2038178	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038179	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038180	04/2013	04/16/2013	100.000	100.100	99.9	1
KU	C1S	2038181	04/2013	04/16/2013	100.000	100.000	100.0	1
KU	C1S	2038182	04/2013	04/16/2013	99.900	100.100	100.1	1
KU	C1S	2038183	04/2013	04/16/2013	100.000	100.100	99.9	1
KU	C1S	2038184	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038185	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038186	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038187	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038188	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038189	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038190	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038191	04/2013	04/16/2013	100.000	100.200	100.0	1
KU	C1S	2038192	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038193	04/2013	04/16/2013	99.900	100.100	100.1	1

KU	C1S	2038194	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038195	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038196	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038197	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038198	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038199	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038200	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038201	04/2013	04/16/2013	100.000	100.100	99.9	1
KU	C1S	2038202	04/2013	04/16/2013	100.000	100.200	100.1	1
KU	C1S	2038203	04/2013	04/16/2013	100.000	100.000	100.1	1
KU	C1S	2038204	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038205	04/2013	04/16/2013	100.000	100.000	100.1	1
KU	C1S	2038206	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038207	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038208	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038209	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038210	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038211	04/2013	04/16/2013	100.000	100.000	100.1	1
KU	C1S	2038212	04/2013	04/16/2013	100.000	100.200	100.0	1
KU	C1S	2038213	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038214	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038215	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038216	04/2013	04/16/2013	100.000	100.000	100.0	1
KU	C1S	2038217	04/2013	04/16/2013	100.000	100.000	100.1	1
KU	C1S	2038218	04/2013	04/16/2013	100.000	100.200	100.0	1
KU	C1S	2038219	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038220	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038221	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038222	04/2013	04/16/2013	99.900	100.000	100.0	1
KU	C1S	2038223	04/2013	04/16/2013	100.000	100.100	100.0	1



KU	C1S	2038224	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038225	04/2013	04/16/2013	99.900	100.100	100.0	1
KU	C1S	2038226	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038227	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038228	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038229	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038230	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038231	04/2013	04/16/2013	100.000	100.200	100.0	1
KU	C1S	2038232	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038233	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038234	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038235	04/2013	04/16/2013	100.000	100.100	99.9	1
KU	C1S	2038236	04/2013	04/16/2013	100.000	100.000	100.1	1
KU	C1S	2038237	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038238	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038239	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038240	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038241	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038242	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038243	04/2013	04/16/2013	99.900	100.000	100.0	1
KU	C1S	2038244	04/2013	04/16/2013	99.900	100.100	100.0	1
KU	C1S	2038245	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038246	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038247	04/2013	04/16/2013	100.000	100.200	100.0	1
KU	C1S	2038248	04/2013	04/16/2013	100.000	100.000	100.0	1
KU	C1S	2038249	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038250	04/2013	04/16/2013	100.000	100.000	100.1	1
KU	C1S	2038251	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038252	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038253	04/2013	04/16/2013	99.900	100.100	100.1	1

KU	C1S	2038254	04/2013	04/16/2013	100.000	100.200	100.0	1
KU	C1S	2038255	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038256	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038257	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038258	04/2013	04/16/2013	100.000	100.200	100.1	1
KU	C1S	2038259	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038260	04/2013	04/16/2013	100.000	100.200	100.0	1
KU	C1S	2038261	04/2013	04/16/2013	100.000	100.100	99.9	1
KU	C1S	2038262	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038263	04/2013	04/16/2013	100.000	100.200	100.0	1
KU	C1S	2038264	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038265	04/2013	04/16/2013	100.000	100.200	100.0	1
KU	C1S	2038266	04/2013	04/16/2013	100.000	100.200	100.1	1
KU	C1S	2038267	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038268	04/2013	04/16/2013	100.000	100.200	100.1	1
KU	C1S	2038269	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038270	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038271	04/2013	04/16/2013	99.900	100.000	100.0	1
KU	C1S	2038272	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038273	04/2013	04/16/2013	100.000	100.200	99.9	1
KU	C1S	2038274	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038275	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038276	04/2013	04/16/2013	100.000	100.000	100.1	1
KU	C1S	2038277	04/2013	04/16/2013	100.000	100.200	100.1	1
KU	C1S	2038278	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038279	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038280	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038281	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038282	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038283	04/2013	04/16/2013	100.000	100.200	100.0	1

KU	C1S	2038284	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038285	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038286	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038287	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038288	04/2013	04/16/2013	99.900	100.100	100.1	1
KU	C1S	2038289	04/2013	04/16/2013	100.000	100.200	100.0	1
KU	C1S	2038290	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038291	04/2013	04/16/2013	100.000	100.200	100.1	1
KU	C1S	2038292	04/2013	04/16/2013	100.000	100.200	100.0	1
KU	C1S	2038293	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038294	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038295	04/2013	04/16/2013	100.000	100.000	100.0	1
KU	C1S	2038296	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038297	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038298	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038299	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038300	04/2013	04/16/2013	99.900	100.000	100.0	1
KU	C1S	2038301	04/2013	04/16/2013	100.000	100.100	99.9	1
KU	C1S	2038302	04/2013	04/16/2013	99.900	100.100	100.0	1
KU	C1S	2038303	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038304	04/2013	04/16/2013	100.000	100.000	100.1	1
KU	C1S	2038305	04/2013	04/16/2013	100.000	100.000	100.1	1
KU	C1S	2038306	04/2013	04/16/2013	100.000	100.200	100.0	1
KU	C1S	2038307	04/2013	04/16/2013	99.900	100.100	100.0	1
KU	C1S	2038308	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038309	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038310	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038311	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038312	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038313	04/2013	04/16/2013	100.000	100.200	100.0	1



KU	C1S	2038314	04/2013	04/16/2013	99.900	100.100	100.0	1
KU	C1S	2038315	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038316	04/2013	04/16/2013	100.000	100.200	100.1	1
KU	C1S	2038317	04/2013	04/16/2013	99.900	100.200	100.0	1
KU	C1S	2038318	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038319	04/2013	04/16/2013	100.000	100.000	100.0	1
KU	C1S	2038320	04/2013	04/16/2013	99.900	100.100	99.9	1
KU	C1S	2038321	04/2013	04/16/2013	100.000	100.200	100.0	1
KU	C1S	2038322	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038323	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038324	04/2013	04/16/2013	100.000	100.200	100.0	1
KU	C1S	2038325	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038326	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038327	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038328	04/2013	04/16/2013	100.000	100.200	100.0	1
KU	C1S	2038329	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038330	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038331	04/2013	04/16/2013	99.900	100.000	100.0	1
KU	C1S	2038332	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038333	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038334	04/2013	04/16/2013	100.000	100.000	99.9	1
KU	C1S	2038335	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038336	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038337	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038338	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038339	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038340	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038341	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038342	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038343	04/2013	04/16/2013	100.000	100.100	100.0	1

KU	C1S	2038344	04/2013	04/16/2013	100.000	100.200	100.1	1
KU	C1S	2038345	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038346	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038347	04/2013	04/16/2013	100.000	100.000	100.1	1
KU	C1S	2038348	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038349	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038350	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038351	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038352	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038353	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038354	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038355	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038356	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038357	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038358	04/2013	04/16/2013	100.000	100.200	100.1	1
KU	C1S	2038359	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038360	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038361	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038362	04/2013	04/16/2013	100.000	100.000	100.0	1
KU	C1S	2038363	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038364	04/2013	04/16/2013	100.000	100.100	99.9	1
KU	C1S	2038365	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038366	04/2013	04/16/2013	100.000	100.000	100.0	1
KU	C1S	2038367	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038368	04/2013	04/16/2013	100.000	100.200	100.1	1
KU	C1S	2038369	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038370	04/2013	04/16/2013	100.000	100.200	99.9	1
KU	C1S	2038371	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038372	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038373	04/2013	04/16/2013	100.000	100.000	100.0	1

KU	C1S	2038374	04/2013	04/16/2013	99.900	100.100	100.0	1
KU	C1S	2038375	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038376	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038377	04/2013	04/16/2013	100.000	100.200	100.1	1
KU	C1S	2038378	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038379	04/2013	04/16/2013	100.000	100.200	100.0	1
KU	C1S	2038380	04/2013	04/16/2013	100.000	100.200	100.1	1
KU	C1S	2038381	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038382	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038383	04/2013	04/16/2013	100.000	100.200	100.0	1
KU	C1S	2038384	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038385	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038386	04/2013	04/16/2013	99.900	100.100	100.0	1
KU	C1S	2038387	04/2013	04/16/2013	100.000	100.000	100.0	1
KU	C1S	2038388	04/2013	04/16/2013	100.000	100.100	99.9	1
KU	C1S	2038389	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038390	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038391	04/2013	04/16/2013	100.000	100.200	100.0	1
KU	C1S	2038392	04/2013	04/16/2013	100.000	100.200	100.0	1
KU	C1S	2038393	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038394	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038395	04/2013	04/16/2013	100.000	100.200	100.1	1
KU	C1S	2038396	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038397	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038398	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038399	04/2013	04/16/2013	100.000	100.200	100.0	1
KU	C1S	2038400	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038401	04/2013	04/16/2013	100.000	100.000	100.1	1
KU	C1S	2038402	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038403	04/2013	04/16/2013	100.000	100.100	100.0	1



KU	C1S	2038404	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038405	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038406	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038407	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038408	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038409	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038410	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038411	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038412	04/2013	04/16/2013	100.000	100.200	100.0	1
KU	C1S	2038413	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038414	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038415	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038416	04/2013	04/16/2013	100.000	100.200	100.0	1
KU	C1S	2038417	04/2013	04/16/2013	99.900	100.100	100.1	1
KU	C1S	2038418	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038419	04/2013	04/16/2013	100.000	100.000	100.0	1
KU	C1S	2038420	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038421	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038422	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038423	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038424	04/2013	04/16/2013	100.000	100.100	99.9	1
KU	C1S	2038425	04/2013	04/16/2013	100.000	100.200	100.0	1
KU	C1S	2038426	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038427	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038428	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038429	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038430	04/2013	04/16/2013	100.000	100.200	100.1	1
KU	C1S	2038431	04/2013	04/16/2013	99.900	100.000	100.0	1
KU	C1S	2038432	04/2013	04/16/2013	99.900	100.100	100.0	1
KU	C1S	2038433	04/2013	04/16/2013	100.000	100.100	100.0	1

KU	C1S	2038434	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038435	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038436	04/2013	04/16/2013	100.000	100.200	100.0	1
KU	C1S	2038437	04/2013	04/16/2013	100.000	100.200	100.0	1
KU	C1S	2038438	04/2013	04/16/2013	100.000	100.200	100.0	1
KU	C1S	2038439	04/2013	04/16/2013	100.000	100.000	100.0	1
KU	C1S	2038440	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038441	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038442	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038443	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038444	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038445	04/2013	04/16/2013	100.000	100.200	100.0	1
KU	C1S	2038446	04/2013	04/16/2013	100.000	100.200	100.0	1
KU	C1S	2038447	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038448	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038449	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038450	04/2013	04/16/2013	100.000	100.200	100.1	1
KU	C1S	2038451	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038452	04/2013	04/16/2013	99.900	100.100	99.9	1
KU	C1S	2038453	04/2013	04/16/2013	100.000	100.200	100.0	1
KU	C1S	2038454	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038455	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038456	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038457	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038458	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038459	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038460	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038461	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038462	04/2013	04/16/2013	100.000	100.200	100.1	1
KU	C1S	2038463	04/2013	04/16/2013	100.000	100.100	100.0	1

KU	C1S	2038464	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038465	04/2013	04/16/2013	100.000	100.200	100.1	1
KU	C1S	2038466	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038467	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038468	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038469	04/2013	04/16/2013	100.000	100.100	99.9	1
KU	C1S	2038470	04/2013	04/16/2013	100.000	100.200	100.0	1
KU	C1S	2038471	04/2013	04/16/2013	99.900	100.100	100.1	1
KU	C1S	2038472	04/2013	04/16/2013	100.000	100.200	100.0	1
KU	C1S	2038473	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038474	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038475	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038476	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038477	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038478	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038479	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038480	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038481	04/2013	04/16/2013	100.000	100.200	100.0	1
KU	C1S	2038482	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038483	04/2013	04/16/2013	99.900	100.100	100.0	1
KU	C1S	2038484	04/2013	04/16/2013	100.000	100.000	100.0	1
KU	C1S	2038485	04/2013	04/16/2013	99.900	100.100	99.9	1
KU	C1S	2038486	04/2013	04/16/2013	100.000	100.000	100.0	1
KU	C1S	2038487	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038488	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038489	04/2013	04/16/2013	100.000	100.200	100.1	1
KU	C1S	2038490	04/2013	04/16/2013	100.000	100.000	99.9	1
KU	C1S	2038491	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038492	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038493	04/2013	04/16/2013	100.000	100.100	100.1	1



KU	C1S	2038494	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038495	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038496	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038497	04/2013	04/16/2013	100.000	100.100	99.9	1
KU	C1S	2038498	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038499	04/2013	04/16/2013	99.900	100.000	100.0	1
KU	C1S	2038500	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038501	04/2013	04/16/2013	100.000	100.200	100.0	1
KU	C1S	2038502	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038503	04/2013	04/16/2013	99.900	100.100	100.0	1
KU	C1S	2038504	04/2013	04/16/2013	100.000	100.200	100.1	1
KU	C1S	2038505	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038506	04/2013	04/16/2013	100.000	100.200	100.0	1
KU	C1S	2038507	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038508	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038509	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038510	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038511	04/2013	04/16/2013	100.000	100.200	100.1	1
KU	C1S	2038512	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038513	04/2013	04/16/2013	100.000	100.100	99.9	1
KU	C1S	2038514	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038515	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038516	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038517	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038518	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038519	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038520	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038521	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038522	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038523	04/2013	04/16/2013	100.000	100.100	100.0	1

KU	C1S	2038524	04/2013	04/16/2013	100.000	100.000	100.1	1
KU	C1S	2038525	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038526	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038527	04/2013	04/16/2013	100.000	100.000	100.0	1
KU	C1S	2038528	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038529	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038530	04/2013	04/16/2013	100.000	100.200	100.0	1
KU	C1S	2038531	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038532	04/2013	04/16/2013	100.000	100.100	99.9	1
KU	C1S	2038533	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038534	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038535	04/2013	04/16/2013	100.000	100.000	100.0	1
KU	C1S	2038536	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038537	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038538	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038539	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038540	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038541	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038542	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038543	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038544	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038545	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038546	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038547	04/2013	04/16/2013	100.000	100.200	100.1	1
KU	C1S	2038548	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038549	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038550	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038551	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038552	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038553	04/2013	04/16/2013	100.000	100.200	100.0	1

KU	C1S	2038554	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038555	04/2013	04/16/2013	100.000	100.200	100.0	1
KU	C1S	2038556	04/2013	04/16/2013	100.000	100.100	99.9	1
KU	C1S	2038557	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038558	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038559	04/2013	04/16/2013	100.000	100.200	100.1	1
KU	C1S	2038560	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038561	04/2013	04/16/2013	99.900	100.200	100.0	1
KU	C1S	2038562	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038563	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038564	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038565	04/2013	04/16/2013	99.900	100.100	100.0	1
KU	C1S	2038566	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038567	04/2013	04/16/2013	100.000	100.200	100.0	1
KU	C1S	2038568	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038569	04/2013	04/16/2013	100.000	100.200	100.0	1
KU	C1S	2038570	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038571	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038572	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038573	04/2013	04/16/2013	99.900	100.100	100.0	1
KU	C1S	2038574	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038575	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038576	04/2013	04/16/2013	100.000	100.100	99.9	1
KU	C1S	2038577	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038578	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038579	04/2013	04/16/2013	99.900	100.100	100.0	1
KU	C1S	2038580	04/2013	04/16/2013	99.900	100.200	100.0	1
KU	C1S	2038581	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038582	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038583	04/2013	04/16/2013	100.000	100.100	100.1	1



KU	C1S	2038584	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038585	04/2013	04/16/2013	100.000	100.200	100.1	1
KU	C1S	2038586	04/2013	04/16/2013	100.000	100.000	100.0	1
KU	C1S	2038587	04/2013	04/16/2013	100.000	100.200	100.0	1
KU	C1S	2038588	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038589	04/2013	04/16/2013	100.000	100.000	100.0	1
KU	C1S	2038590	04/2013	04/16/2013	100.000	100.200	100.1	1
KU	C1S	2038591	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038592	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038593	04/2013	04/16/2013	100.000	100.200	100.1	1
KU	C1S	2038594	04/2013	04/16/2013	100.000	100.000	100.0	1
KU	C1S	2038595	04/2013	04/16/2013	100.000	100.200	100.1	1
KU	C1S	2038596	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038597	04/2013	04/16/2013	100.000	100.200	100.1	1
KU	C1S	2038598	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038599	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038600	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038601	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038602	04/2013	04/16/2013	100.000	100.200	100.0	1
KU	C1S	2038603	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038604	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038605	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038606	04/2013	04/16/2013	100.000	100.100	99.9	1
KU	C1S	2038607	04/2013	04/16/2013	100.000	100.100	99.9	1
KU	C1S	2038608	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038609	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038610	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038611	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038612	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038613	04/2013	04/16/2013	100.000	100.000	99.9	1

KU	C1S	2038614	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038615	04/2013	04/16/2013	100.000	100.100	100.2	1
KU	C1S	2038616	04/2013	04/16/2013	100.000	100.000	100.1	1
KU	C1S	2038617	04/2013	04/16/2013	100.000	100.100	100.2	1
KU	C1S	2038618	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038619	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038620	04/2013	04/16/2013	100.000	100.000	99.9	1
KU	C1S	2038621	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038622	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038623	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038624	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038625	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038626	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038627	04/2013	04/16/2013	99.900	100.100	100.0	1
KU	C1S	2038628	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038629	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038630	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038631	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038632	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038633	04/2013	04/16/2013	100.000	100.000	100.1	1
KU	C1S	2038634	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038635	04/2013	04/16/2013	100.000	100.000	100.0	1
KU	C1S	2038636	04/2013	04/16/2013	100.000	100.000	100.1	1
KU	C1S	2038637	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038638	04/2013	04/16/2013	100.000	100.200	100.1	1
KU	C1S	2038639	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038640	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038641	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038642	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038643	04/2013	04/16/2013	100.000	100.000	100.0	1

KU	C1S	2038644	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038645	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038646	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038647	04/2013	04/16/2013	99.900	100.100	100.1	1
KU	C1S	2038648	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038649	04/2013	04/16/2013	99.900	100.000	100.0	1
KU	C1S	2038650	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038651	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038652	04/2013	04/16/2013	100.000	100.000	100.0	1
KU	C1S	2038653	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038654	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038655	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038656	04/2013	04/16/2013	100.000	100.200	100.1	1
KU	C1S	2038657	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038658	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038659	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038660	04/2013	04/16/2013	100.000	100.200	100.0	1
KU	C1S	2038661	04/2013	04/16/2013	100.000	100.200	100.1	1
KU	C1S	2038662	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038663	04/2013	04/16/2013	100.000	100.200	100.0	1
KU	C1S	2038664	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038665	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038666	04/2013	04/16/2013	100.000	100.200	100.1	1
KU	C1S	2038667	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038668	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038669	04/2013	04/16/2013	100.000	100.200	100.0	1
KU	C1S	2038670	04/2013	04/16/2013	100.000	100.000	100.0	1
KU	C1S	2038671	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038672	04/2013	04/16/2013	100.000	100.200	100.1	1
KU	C1S	2038673	04/2013	04/16/2013	100.000	100.200	100.1	1



KU	C1S	2038674	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038675	04/2013	04/16/2013	100.000	100.200	100.0	1
KU	C1S	2038676	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038677	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038678	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038679	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038680	04/2013	04/16/2013	100.000	100.200	100.1	1
KU	C1S	2038681	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038682	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038683	04/2013	04/16/2013	100.000	100.200	100.1	1
KU	C1S	2038684	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038685	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038686	04/2013	04/16/2013	100.000	100.000	100.1	1
KU	C1S	2038687	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038688	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038689	04/2013	04/16/2013	100.000	100.200	100.1	1
KU	C1S	2038690	04/2013	04/16/2013	100.000	100.100	99.9	1
KU	C1S	2038691	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038692	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038693	04/2013	04/16/2013	100.000	100.200	100.1	1
KU	C1S	2038694	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038695	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038696	04/2013	04/16/2013	100.000	100.200	100.1	1
KU	C1S	2038697	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038698	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038699	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038700	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038701	04/2013	04/16/2013	100.000	100.100	100.2	1
KU	C1S	2038702	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038703	04/2013	04/16/2013	100.000	100.100	100.0	1

KU	C1S	2038704	04/2013	04/16/2013	100.000	100.000	100.0	1
KU	C1S	2038705	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038706	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038707	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038708	04/2013	04/16/2013	100.000	100.100	100.2	1
KU	C1S	2038709	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038710	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038711	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038712	04/2013	04/16/2013	100.000	100.100	99.9	1
KU	C1S	2038713	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038714	04/2013	04/16/2013	100.000	100.200	100.0	1
KU	C1S	2038715	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038716	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038717	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038718	04/2013	04/16/2013	100.000	100.200	100.0	1
KU	C1S	2038719	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038720	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038721	04/2013	04/16/2013	100.000	100.200	100.0	1
KU	C1S	2038722	04/2013	04/16/2013	100.000	100.200	100.1	1
KU	C1S	2038723	04/2013	04/16/2013	99.900	100.100	100.0	1
KU	C1S	2038724	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038725	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038726	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038727	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038728	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038729	04/2013	04/16/2013	100.000	100.200	100.1	1
KU	C1S	2038730	04/2013	04/16/2013	100.000	100.200	100.1	1
KU	C1S	2038731	04/2013	04/16/2013	100.000	100.000	100.0	1
KU	C1S	2038732	04/2013	04/16/2013	100.000	100.200	100.0	1
KU	C1S	2038733	04/2013	04/16/2013	99.900	100.100	100.0	1

KU	C-1S	2038734	04/2013	04/16/2013	100.000	100.000	100.1	1
KU	C-1S	2038735	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C-1S	2038736	04/2013	04/16/2013	100.000	100.000	100.0	1
KU	C-1S	2038737	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C-1S	2038738	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C-1S	2038739	04/2013	04/16/2013	99.900	100.100	100.1	1
KU	C-1S	2038740	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C-1S	2038741	04/2013	04/16/2013	100.000	100.000	100.1	1
KU	C-1S	2038742	04/2013	04/16/2013	99.900	100.100	100.0	1
KU	C-1S	2038743	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C-1S	2038744	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C-1S	2038745	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C-1S	2038746	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C-1S	2038747	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C-1S	2038748	04/2013	04/16/2013	99.900	100.100	100.0	1
KU	C-1S	2038749	04/2013	04/16/2013	100.000	100.200	100.1	1
KU	C-1S	2038750	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C-1S	2038751	04/2013	04/16/2013	100.000	100.200	100.1	1
KU	C-1S	2038752	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C-1S	2038753	04/2013	04/16/2013	100.000	100.200	100.1	1
KU	C-1S	2038754	04/2013	04/16/2013	100.000	100.000	100.0	1
KU	C-1S	2038755	04/2013	04/16/2013	100.000	100.200	100.0	1
KU	C-1S	2038756	04/2013	04/16/2013	100.000	100.200	100.0	1
KU	C-1S	2038757	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C-1S	2038758	04/2013	04/16/2013	100.000	100.200	100.0	1
KU	C-1S	2038759	04/2013	04/16/2013	100.000	100.200	100.1	1
KU	C-1S	2038760	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C-1S	2038761	04/2013	04/16/2013	99.900	100.100	99.9	1
KU	C-1S	2038762	04/2013	04/16/2013	100.000	100.000	100.0	1
KU	C-1S	2038763	04/2013	04/16/2013	100.000	100.200	100.1	1



KU	C1S	2038764	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038765	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038766	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038767	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038768	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038769	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038770	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038771	04/2013	04/16/2013	99.900	100.100	100.0	1
KU	C1S	2038772	04/2013	04/16/2013	100.000	100.200	100.1	1
KU	C1S	2038773	04/2013	04/16/2013	100.000	100.200	100.1	1
KU	C1S	2038774	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038775	04/2013	04/16/2013	100.000	100.200	100.1	1
KU	C1S	2038776	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038777	04/2013	04/16/2013	99.900	100.100	100.0	1
KU	C1S	2038778	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038779	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038780	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038781	04/2013	04/16/2013	100.000	100.000	100.1	1
KU	C1S	2038782	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038783	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038784	04/2013	04/16/2013	100.000	100.200	100.1	1
KU	C1S	2038785	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038786	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038787	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038788	04/2013	04/16/2013	100.000	100.200	100.1	1
KU	C1S	2038789	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038790	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038791	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038792	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038793	04/2013	04/16/2013	100.000	100.100	100.0	1

KU	C1S	2038794	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038795	04/2013	04/16/2013	100.000	100.100	100.2	1
KU	C1S	2038796	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038797	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038798	04/2013	04/16/2013	100.000	100.200	100.0	1
KU	C1S	2038799	04/2013	04/16/2013	100.000	100.200	100.1	1
KU	C1S	2038800	04/2013	04/16/2013	100.000	100.200	100.0	1
KU	C1S	2038801	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038802	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038803	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038804	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038805	04/2013	04/16/2013	100.000	100.200	100.1	1
KU	C1S	2038806	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038807	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038808	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038809	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038810	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038811	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038812	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038813	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038814	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038815	04/2013	04/16/2013	99.900	100.100	100.0	1
KU	C1S	2038816	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038817	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038818	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038819	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038820	04/2013	04/16/2013	100.000	100.000	100.0	1
KU	C1S	2038821	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038822	04/2013	04/16/2013	100.000	100.200	100.0	1
KU	C1S	2038823	04/2013	04/16/2013	100.000	100.100	100.0	1

KU	C1S	2038824	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038825	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038826	04/2013	04/16/2013	100.000	100.200	99.9	1
KU	C1S	2038827	04/2013	04/16/2013	100.000	100.100	99.9	1
KU	C1S	2038828	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038829	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038830	04/2013	04/16/2013	100.000	100.000	100.0	1
KU	C1S	2038831	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038832	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038833	04/2013	04/16/2013	100.000	100.200	100.0	1
KU	C1S	2038834	04/2013	04/16/2013	100.000	100.200	100.2	1
KU	C1S	2038835	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038836	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038837	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038838	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038839	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038840	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038841	04/2013	04/16/2013	100.000	100.200	100.0	1
KU	C1S	2038842	04/2013	04/16/2013	100.000	100.200	100.1	1
KU	C1S	2038843	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038844	04/2013	04/16/2013	100.000	100.200	100.0	1
KU	C1S	2038845	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038846	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038847	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038848	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038849	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038850	04/2013	04/16/2013	100.000	100.200	100.0	1
KU	C1S	2038851	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038852	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038853	04/2013	04/16/2013	99.900	100.100	100.1	1



KU	C1S	2038854	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038855	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038856	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038857	04/2013	04/16/2013	100.000	100.200	100.0	1
KU	C1S	2038858	04/2013	04/16/2013	99.900	100.200	99.9	1
KU	C1S	2038859	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038860	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038861	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038862	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038863	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038864	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038865	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038866	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038867	04/2013	04/16/2013	100.000	100.200	100.0	1
KU	C1S	2038868	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038869	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038870	04/2013	04/16/2013	100.000	100.000	100.1	1
KU	C1S	2038871	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038872	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038873	04/2013	04/16/2013	100.000	100.200	100.0	1
KU	C1S	2038874	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038875	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038876	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038877	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038878	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038879	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038880	04/2013	04/16/2013	100.000	100.200	100.1	1
KU	C1S	2038881	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038882	04/2013	04/16/2013	100.000	100.200	100.0	1
KU	C1S	2038883	04/2013	04/16/2013	100.000	100.100	100.0	1

KU	C1S	2038884	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038885	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038886	04/2013	04/16/2013	99.900	100.000	100.0	1
KU	C1S	2038887	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038888	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038889	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038890	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038891	04/2013	04/16/2013	99.900	100.100	100.0	1
KU	C1S	2038892	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038893	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038894	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038895	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038896	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038897	04/2013	04/16/2013	100.000	100.200	100.0	1
KU	C1S	2038898	04/2013	04/16/2013	100.000	100.000	100.0	1
KU	C1S	2038899	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038900	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038901	04/2013	04/16/2013	100.000	100.200	100.0	1
KU	C1S	2038902	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038903	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038904	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038905	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038906	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038907	04/2013	04/16/2013	100.000	100.000	100.0	1
KU	C1S	2038908	04/2013	04/16/2013	100.000	100.200	100.1	1
KU	C1S	2038909	04/2013	04/16/2013	99.900	100.100	100.1	1
KU	C1S	2038910	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038911	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038912	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038913	04/2013	04/16/2013	100.000	100.100	100.1	1

KU	C1S	2038914	04/2013	04/16/2013	100.000	100.200	100.0	1
KU	C1S	2038915	04/2013	04/16/2013	99.900	100.100	100.0	1
KU	C1S	2038916	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038917	04/2013	04/16/2013	99.900	100.100	100.1	1
KU	C1S	2038918	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038919	04/2013	04/16/2013	100.000	100.100	99.9	1
KU	C1S	2038920	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038921	04/2013	04/16/2013	100.000	100.200	100.0	1
KU	C1S	2038922	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038923	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038924	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038925	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038926	04/2013	04/16/2013	100.000	100.000	100.1	1
KU	C1S	2038927	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038928	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038929	04/2013	04/16/2013	100.000	100.200	100.0	1
KU	C1S	2038930	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038931	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038932	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038933	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038934	04/2013	04/16/2013	100.000	100.200	100.0	1
KU	C1S	2038935	04/2013	04/16/2013	100.000	100.200	100.0	1
KU	C1S	2038936	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038937	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038938	04/2013	04/16/2013	100.000	100.200	100.0	1
KU	C1S	2038939	04/2013	04/16/2013	100.000	100.200	100.1	1
KU	C1S	2038940	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038941	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038942	04/2013	04/16/2013	99.900	100.000	99.9	1
KU	C1S	2038943	04/2013	04/16/2013	100.000	100.100	100.1	1



KU	C1S	2038944	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038945	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038946	04/2013	04/16/2013	100.000	100.000	100.1	1
KU	C1S	2038947	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038948	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038949	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038950	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038951	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038952	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038953	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038954	04/2013	04/16/2013	100.000	100.200	100.0	1
KU	C1S	2038955	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038956	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038957	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038958	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038959	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038960	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038961	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038962	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038963	04/2013	04/16/2013	100.000	100.200	100.0	1
KU	C1S	2038964	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038965	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038966	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038967	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038968	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038969	04/2013	04/16/2013	100.000	100.200	100.1	1
KU	C1S	2038970	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038971	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038972	04/2013	04/16/2013	100.000	100.100	99.9	1
KU	C1S	2038973	04/2013	04/16/2013	99.900	100.100	100.0	1

KU	C1S	2038974	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038975	04/2013	04/16/2013	100.000	100.100	99.9	1
KU	C1S	2038976	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038977	04/2013	04/16/2013	100.000	100.100	99.9	1
KU	C1S	2038978	04/2013	04/16/2013	100.000	100.200	100.0	1
KU	C1S	2038979	04/2013	04/16/2013	99.900	100.100	100.0	1
KU	C1S	2038980	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038981	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038982	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038983	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038984	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038985	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038986	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038987	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038988	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038989	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038990	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038991	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038992	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038993	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038994	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2038995	04/2013	04/16/2013	100.000	100.100	99.9	1
KU	C1S	2038996	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2038997	04/2013	04/16/2013	100.000	100.200	100.1	1
KU	C1S	2038998	04/2013	04/16/2013	100.000	100.200	100.0	1
KU	C1S	2038999	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039000	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039001	04/2013	04/16/2013	100.000	100.200	100.1	1
KU	C1S	2039002	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039003	04/2013	04/16/2013	100.000	100.100	100.1	1

KU	C-1S	2039004	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C-1S	2039005	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C-1S	2039006	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C-1S	2039007	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C-1S	2039008	04/2013	04/16/2013	100.000	100.200	100.1	1
KU	C-1S	2039009	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C-1S	2039010	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C-1S	2039011	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C-1S	2039012	04/2013	04/16/2013	100.000	100.100	99.9	1
KU	C-1S	2039013	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C-1S	2039014	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C-1S	2039015	04/2013	04/16/2013	100.000	100.100	99.9	1
KU	C-1S	2039016	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C-1S	2039017	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C-1S	2039018	04/2013	04/16/2013	100.000	100.000	100.0	1
KU	C-1S	2039019	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C-1S	2039020	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C-1S	2039021	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C-1S	2039022	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C-1S	2039023	04/2013	04/16/2013	99.900	100.100	99.9	1
KU	C-1S	2039024	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C-1S	2039025	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C-1S	2039026	04/2013	04/16/2013	100.000	100.000	100.1	1
KU	C-1S	2039027	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C-1S	2039028	04/2013	04/16/2013	100.000	100.200	100.1	1
KU	C-1S	2039029	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C-1S	2039030	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C-1S	2039031	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C-1S	2039032	04/2013	04/16/2013	100.000	100.000	100.1	1
KU	C-1S	2039033	04/2013	04/16/2013	100.000	100.000	100.0	1



KU	C1S	2039034	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039035	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039036	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039037	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039038	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039039	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039040	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039041	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039042	04/2013	04/16/2013	99.900	100.100	100.0	1
KU	C1S	2039043	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039044	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039045	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039046	04/2013	04/16/2013	100.000	100.000	100.0	1
KU	C1S	2039047	04/2013	04/16/2013	100.000	100.000	100.1	1
KU	C1S	2039048	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039049	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039050	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039051	04/2013	04/16/2013	100.000	100.000	100.0	1
KU	C1S	2039052	04/2013	04/16/2013	100.000	100.200	100.0	1
KU	C1S	2039053	04/2013	04/16/2013	100.000	100.000	100.0	1
KU	C1S	2039054	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039055	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039056	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039057	04/2013	04/16/2013	99.900	100.100	100.0	1
KU	C1S	2039058	04/2013	04/16/2013	99.900	100.100	100.0	1
KU	C1S	2039059	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039060	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039061	04/2013	04/16/2013	100.000	100.000	100.0	1
KU	C1S	2039062	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039063	04/2013	04/16/2013	100.000	100.100	100.0	1

KU	C1S	2039064	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039065	04/2013	04/16/2013	99.900	100.200	100.0	1
KU	C1S	2039066	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039067	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039068	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039069	04/2013	04/16/2013	100.000	100.200	100.1	1
KU	C1S	2039070	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039071	04/2013	04/16/2013	99.900	100.000	100.0	1
KU	C1S	2039072	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039073	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039074	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039075	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039076	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039077	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039078	04/2013	04/16/2013	100.000	100.200	100.1	1
KU	C1S	2039079	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039080	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039081	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039082	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039083	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039084	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039085	04/2013	04/16/2013	100.000	100.200	100.0	1
KU	C1S	2039086	04/2013	04/16/2013	99.900	100.100	100.0	1
KU	C1S	2039087	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039088	04/2013	04/16/2013	100.000	100.200	100.0	1
KU	C1S	2039089	04/2013	04/16/2013	100.000	100.100	99.9	1
KU	C1S	2039090	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039091	04/2013	04/16/2013	100.000	100.000	99.9	1
KU	C1S	2039092	04/2013	04/16/2013	100.000	100.000	99.9	1
KU	C1S	2039093	04/2013	04/16/2013	100.000	100.100	100.0	1

KU	C1S	2039094	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039095	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039096	04/2013	04/16/2013	99.900	100.000	100.0	1
KU	C1S	2039097	04/2013	04/16/2013	100.000	100.000	100.1	1
KU	C1S	2039098	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039099	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039100	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039101	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039102	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039103	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039104	04/2013	04/16/2013	100.000	100.200	100.1	1
KU	C1S	2039105	04/2013	04/16/2013	100.000	100.000	100.0	1
KU	C1S	2039106	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039107	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039108	04/2013	04/16/2013	100.000	100.000	100.0	1
KU	C1S	2039109	04/2013	04/16/2013	100.000	100.200	100.1	1
KU	C1S	2039110	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039111	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039112	04/2013	04/16/2013	100.000	100.200	100.1	1
KU	C1S	2039113	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039114	04/2013	04/16/2013	99.900	100.100	100.0	1
KU	C1S	2039115	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039116	04/2013	04/16/2013	100.000	100.000	100.1	1
KU	C1S	2039117	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039118	04/2013	04/16/2013	100.000	100.000	100.0	1
KU	C1S	2039119	04/2013	04/16/2013	100.000	100.200	100.1	1
KU	C1S	2039120	04/2013	04/16/2013	100.000	100.200	99.9	1
KU	C1S	2039121	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039122	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039123	04/2013	04/16/2013	100.000	100.100	100.1	1



KU	C1S	2039124	04/2013	04/16/2013	100.000	100.200	100.0	1
KU	C1S	2039125	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039126	04/2013	04/16/2013	100.000	100.000	100.0	1
KU	C1S	2039127	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039128	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039129	04/2013	04/16/2013	100.000	100.100	99.9	1
KU	C1S	2039130	04/2013	04/16/2013	99.900	100.100	100.0	1
KU	C1S	2039131	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039132	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039133	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039134	04/2013	04/16/2013	99.900	100.100	100.0	1
KU	C1S	2039135	04/2013	04/16/2013	100.000	100.000	100.0	1
KU	C1S	2039136	04/2013	04/16/2013	100.000	100.100	99.9	1
KU	C1S	2039137	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039138	04/2013	04/16/2013	99.900	100.100	100.0	1
KU	C1S	2039139	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039140	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039141	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039142	04/2013	04/16/2013	100.000	100.200	100.1	1
KU	C1S	2039143	04/2013	04/16/2013	100.000	100.200	100.0	1
KU	C1S	2039144	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039145	04/2013	04/16/2013	100.000	100.000	100.0	1
KU	C1S	2039146	04/2013	04/16/2013	100.000	100.200	100.1	1
KU	C1S	2039147	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039148	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039149	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039150	04/2013	04/16/2013	100.000	100.000	100.0	1
KU	C1S	2039151	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039152	04/2013	04/16/2013	99.900	100.100	100.0	1
KU	C1S	2039153	04/2013	04/16/2013	100.000	100.100	100.1	1

KU	C1S	2039154	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039155	04/2013	04/16/2013	100.000	100.200	100.1	1
KU	C1S	2039156	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039157	04/2013	04/16/2013	100.000	100.100	99.9	1
KU	C1S	2039158	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039159	04/2013	04/16/2013	100.000	100.100	99.9	1
KU	C1S	2039160	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039161	04/2013	04/16/2013	100.000	100.200	100.1	1
KU	C1S	2039162	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039163	04/2013	04/16/2013	100.000	100.100	99.9	1
KU	C1S	2039164	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039165	04/2013	04/16/2013	100.000	100.100	99.9	1
KU	C1S	2039166	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039167	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039168	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039169	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039170	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039171	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039172	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039173	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039174	04/2013	04/16/2013	100.000	100.100	99.9	1
KU	C1S	2039175	04/2013	04/16/2013	100.000	100.000	100.0	1
KU	C1S	2039176	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039177	04/2013	04/16/2013	100.000	100.000	100.0	1
KU	C1S	2039178	04/2013	04/16/2013	100.000	100.200	100.0	1
KU	C1S	2039179	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039180	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039181	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039182	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039183	04/2013	04/16/2013	100.000	100.100	100.0	1

KU	C1S	2039184	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039185	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039186	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039187	04/2013	04/16/2013	100.000	100.100	99.9	1
KU	C1S	2039188	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039189	04/2013	04/16/2013	100.000	100.000	100.0	1
KU	C1S	2039190	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039191	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039192	04/2013	04/16/2013	100.000	100.100	99.9	1
KU	C1S	2039193	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039194	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039195	04/2013	04/16/2013	100.000	100.200	100.1	1
KU	C1S	2039196	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039197	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039198	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039199	04/2013	04/16/2013	100.000	100.200	100.0	1
KU	C1S	2039200	04/2013	04/16/2013	99.900	100.200	100.0	1
KU	C1S	2039201	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039202	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039203	04/2013	04/16/2013	100.000	100.000	99.9	1
KU	C1S	2039204	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039205	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039206	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039207	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039208	04/2013	04/16/2013	100.000	100.000	100.0	1
KU	C1S	2039209	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039210	04/2013	04/16/2013	100.000	100.200	100.0	1
KU	C1S	2039211	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039212	04/2013	04/16/2013	100.000	100.000	100.1	1
KU	C1S	2039213	04/2013	04/16/2013	100.000	100.100	100.1	1



KU	C1S	2039214	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039215	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039216	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039217	04/2013	04/16/2013	99.900	100.000	100.0	1
KU	C1S	2039218	04/2013	04/16/2013	100.000	100.200	100.0	1
KU	C1S	2039219	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039220	04/2013	04/16/2013	99.900	100.100	99.9	1
KU	C1S	2039221	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039222	04/2013	04/16/2013	99.900	100.100	100.0	1
KU	C1S	2039223	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039224	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039225	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039226	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039227	04/2013	04/16/2013	99.900	100.100	100.0	1
KU	C1S	2039228	04/2013	04/16/2013	100.000	100.200	100.1	1
KU	C1S	2039229	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039230	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039231	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039232	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039233	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039234	04/2013	04/16/2013	100.000	100.000	100.0	1
KU	C1S	2039235	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039236	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039237	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039238	04/2013	04/16/2013	100.000	100.200	100.0	1
KU	C1S	2039239	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039240	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039241	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039242	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039243	04/2013	04/16/2013	100.000	100.100	100.0	1

KU	C1S	2039244	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039245	04/2013	04/16/2013	100.000	100.100	99.9	1
KU	C1S	2039246	04/2013	04/16/2013	100.000	100.000	100.0	1
KU	C1S	2039247	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039248	04/2013	04/16/2013	100.000	100.200	100.0	1
KU	C1S	2039249	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039250	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039251	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039252	04/2013	04/16/2013	99.900	100.100	100.1	1
KU	C1S	2039253	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039254	04/2013	04/16/2013	100.000	100.200	100.1	1
KU	C1S	2039255	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039256	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039257	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039258	04/2013	04/16/2013	100.000	100.000	100.1	1
KU	C1S	2039259	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039260	04/2013	04/16/2013	100.000	100.200	100.0	1
KU	C1S	2039261	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039262	04/2013	04/16/2013	100.000	100.000	100.0	1
KU	C1S	2039263	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039264	04/2013	04/16/2013	99.900	100.000	100.0	1
KU	C1S	2039265	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039266	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039267	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039268	04/2013	04/16/2013	100.000	100.200	100.1	1
KU	C1S	2039269	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039270	04/2013	04/16/2013	100.000	100.100	99.9	1
KU	C1S	2039271	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039272	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039273	04/2013	04/16/2013	99.900	100.000	100.0	1

KU	C1S	2039274	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039275	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039276	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039277	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039278	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039279	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039280	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039281	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039282	04/2013	04/16/2013	100.000	100.000	100.0	1
KU	C1S	2039283	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039284	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039285	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039286	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039287	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039288	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039289	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039290	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039291	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039292	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039293	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039294	04/2013	04/16/2013	100.000	100.200	100.0	1
KU	C1S	2039295	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039296	04/2013	04/16/2013	100.000	100.000	100.0	1
KU	C1S	2039297	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039298	04/2013	04/16/2013	100.000	100.000	100.0	1
KU	C1S	2039299	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039300	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039301	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039302	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039303	04/2013	04/16/2013	100.000	100.100	100.1	1



KU	C1S	2039304	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039305	04/2013	04/16/2013	100.000	100.100	99.9	1
KU	C1S	2039306	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039307	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039308	04/2013	04/16/2013	99.900	100.000	100.0	1
KU	C1S	2039309	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039310	04/2013	04/16/2013	99.900	100.100	100.1	1
KU	C1S	2039311	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039312	04/2013	04/16/2013	100.000	100.000	100.0	1
KU	C1S	2039313	04/2013	04/16/2013	99.900	100.000	99.9	1
KU	C1S	2039314	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039315	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039316	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039317	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039318	04/2013	04/16/2013	100.000	100.200	100.0	1
KU	C1S	2039319	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039320	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039321	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039322	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039323	04/2013	04/16/2013	100.000	100.200	100.0	1
KU	C1S	2039324	04/2013	04/16/2013	100.000	100.000	100.1	1
KU	C1S	2039325	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039326	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039327	04/2013	04/16/2013	100.000	100.200	100.1	1
KU	C1S	2039328	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039329	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039330	04/2013	04/16/2013	99.900	100.100	100.1	1
KU	C1S	2039331	04/2013	04/16/2013	100.000	100.200	100.0	1
KU	C1S	2039332	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039333	04/2013	04/16/2013	100.000	100.100	100.1	1

KU	C1S	2039334	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039335	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039336	04/2013	04/16/2013	100.000	100.200	100.0	1
KU	C1S	2039337	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039338	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039339	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039340	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039341	04/2013	04/16/2013	100.000	100.200	100.0	1
KU	C1S	2039342	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039343	04/2013	04/16/2013	100.000	100.200	100.0	1
KU	C1S	2039344	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039345	04/2013	04/16/2013	100.000	100.200	100.1	1
KU	C1S	2039346	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039347	04/2013	04/16/2013	99.900	100.100	100.0	1
KU	C1S	2039348	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039349	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039350	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039351	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039352	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039353	04/2013	04/16/2013	100.000	100.200	100.1	1
KU	C1S	2039354	04/2013	04/16/2013	100.000	100.100	99.9	1
KU	C1S	2039355	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039356	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039357	04/2013	04/16/2013	100.000	100.100	99.9	1
KU	C1S	2039358	04/2013	04/16/2013	100.000	100.000	100.0	1
KU	C1S	2039359	04/2013	04/16/2013	100.000	100.000	100.1	1
KU	C1S	2039360	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039361	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039362	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039363	04/2013	04/16/2013	100.000	100.100	99.9	1

KU	C1S	2039364	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039365	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039366	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039367	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039368	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039369	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039370	04/2013	04/16/2013	100.000	100.200	100.0	1
KU	C1S	2039371	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039372	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039373	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039374	04/2013	04/16/2013	100.000	100.000	99.9	1
KU	C1S	2039375	04/2013	04/16/2013	99.900	100.100	100.0	1
KU	C1S	2039376	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039377	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039378	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039379	04/2013	04/16/2013	99.900	100.100	100.0	1
KU	C1S	2039380	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039381	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039382	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039383	04/2013	04/16/2013	100.000	100.000	100.0	1
KU	C1S	2039384	04/2013	04/16/2013	100.000	100.200	100.2	1
KU	C1S	2039385	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039386	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039387	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039388	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039389	04/2013	04/16/2013	100.000	100.200	100.0	1
KU	C1S	2039390	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039391	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039392	04/2013	04/16/2013	100.000	100.200	100.1	1
KU	C1S	2039393	04/2013	04/16/2013	99.900	100.100	100.1	1



KU	C1S	2039394	04/2013	04/16/2013	100.000	100.100	99.8	1
KU	C1S	2039395	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039396	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039397	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039398	04/2013	04/16/2013	100.000	100.200	100.0	1
KU	C1S	2039399	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039400	04/2013	04/16/2013	100.000	100.000	100.0	1
KU	C1S	2039401	04/2013	04/16/2013	100.000	100.000	100.0	1
KU	C1S	2039402	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039403	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039404	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039405	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039406	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039407	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039408	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039409	04/2013	04/16/2013	100.000	100.200	100.1	1
KU	C1S	2039410	04/2013	04/16/2013	100.000	100.000	100.1	1
KU	C1S	2039411	04/2013	04/16/2013	99.900	100.100	100.0	1
KU	C1S	2039412	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039413	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039414	04/2013	04/16/2013	100.000	100.200	99.9	1
KU	C1S	2039415	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039416	04/2013	04/16/2013	100.000	100.200	100.1	1
KU	C1S	2039417	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039418	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039419	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039420	04/2013	04/16/2013	100.000	100.200	100.0	1
KU	C1S	2039421	04/2013	04/16/2013	100.000	100.200	100.0	1
KU	C1S	2039422	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039423	04/2013	04/16/2013	99.900	100.100	100.0	1

KU	C1S	2039424	04/2013	04/16/2013	100.000	100.200	100.0	1
KU	C1S	2039425	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039426	04/2013	04/16/2013	100.000	100.200	100.1	1
KU	C1S	2039427	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039428	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039429	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039430	04/2013	04/16/2013	100.000	100.000	100.0	1
KU	C1S	2039431	04/2013	04/16/2013	100.000	100.200	100.1	1
KU	C1S	2039432	04/2013	04/16/2013	100.000	100.000	100.1	1
KU	C1S	2039433	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039434	04/2013	04/16/2013	100.000	100.000	100.0	1
KU	C1S	2039435	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039436	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039437	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039438	04/2013	04/16/2013	100.000	100.000	100.2	1
KU	C1S	2039439	04/2013	04/16/2013	100.000	100.200	100.1	1
KU	C1S	2039440	04/2013	04/16/2013	100.000	100.200	100.0	1
KU	C1S	2039441	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039442	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039443	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039444	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039445	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039446	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039447	04/2013	04/16/2013	100.000	100.200	100.0	1
KU	C1S	2039448	04/2013	04/16/2013	100.000	100.200	100.1	1
KU	C1S	2039449	04/2013	04/16/2013	100.000	100.100	99.9	1
KU	C1S	2039450	04/2013	04/16/2013	100.000	100.200	100.1	1
KU	C1S	2039451	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039452	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039453	04/2013	04/16/2013	100.000	100.100	100.1	1

KU	C1S	2039454	04/2013	04/16/2013	100.000	100.200	100.1	1
KU	C1S	2039455	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039456	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039457	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039458	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039459	04/2013	04/16/2013	100.000	100.000	100.0	1
KU	C1S	2039460	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039461	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039462	04/2013	04/16/2013	99.900	100.100	100.0	1
KU	C1S	2039463	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039464	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039465	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039466	04/2013	04/16/2013	99.900	100.100	99.9	1
KU	C1S	2039467	04/2013	04/16/2013	99.900	100.100	100.0	1
KU	C1S	2039468	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039469	04/2013	04/16/2013	100.000	100.200	100.0	1
KU	C1S	2039470	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039471	04/2013	04/16/2013	99.900	100.100	100.0	1
KU	C1S	2039472	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039473	04/2013	04/16/2013	100.000	100.200	100.1	1
KU	C1S	2039474	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039475	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039476	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039477	04/2013	04/16/2013	99.900	100.100	100.0	1
KU	C1S	2039478	04/2013	04/16/2013	100.000	100.200	100.1	1
KU	C1S	2039479	04/2013	04/16/2013	100.000	100.000	99.9	1
KU	C1S	2039480	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039481	04/2013	04/16/2013	100.000	100.200	100.0	1
KU	C1S	2039482	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039483	04/2013	04/16/2013	100.000	100.100	100.1	1



KU	C1S	2039484	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039485	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039486	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039487	04/2013	04/16/2013	100.000	100.200	100.0	1
KU	C1S	2039488	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039489	04/2013	04/16/2013	100.000	100.000	100.0	1
KU	C1S	2039490	04/2013	04/16/2013	100.000	100.200	100.1	1
KU	C1S	2039491	04/2013	04/16/2013	100.000	100.200	100.1	1
KU	C1S	2039492	04/2013	04/16/2013	100.000	100.000	100.0	1
KU	C1S	2039493	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039494	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039495	04/2013	04/16/2013	99.900	100.100	100.1	1
KU	C1S	2039496	04/2013	04/16/2013	100.000	100.200	100.0	1
KU	C1S	2039497	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039498	04/2013	04/16/2013	100.000	100.200	100.0	1
KU	C1S	2039499	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039500	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039501	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039502	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039503	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039504	04/2013	04/16/2013	99.900	100.100	100.1	1
KU	C1S	2039505	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039506	04/2013	04/16/2013	100.000	100.000	100.0	1
KU	C1S	2039507	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039508	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039509	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039510	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039511	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039512	04/2013	04/16/2013	99.900	100.100	100.1	1
KU	C1S	2039513	04/2013	04/16/2013	100.000	100.100	100.0	1

KU	C1S	2039514	04/2013	04/16/2013	100.000	100.200	100.1	1
KU	C1S	2039515	04/2013	04/16/2013	100.000	100.000	100.0	1
KU	C1S	2039516	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039517	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039518	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039519	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039520	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039521	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039522	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039523	04/2013	04/16/2013	99.900	100.100	100.0	1
KU	C1S	2039524	04/2013	04/16/2013	100.000	100.000	100.0	1
KU	C1S	2039525	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039526	04/2013	04/16/2013	100.000	100.200	100.1	1
KU	C1S	2039527	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039528	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039529	04/2013	04/16/2013	100.000	100.200	100.0	1
KU	C1S	2039530	04/2013	04/16/2013	100.000	100.200	100.1	1
KU	C1S	2039531	04/2013	04/16/2013	100.000	100.200	100.1	1
KU	C1S	2039532	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039533	04/2013	04/16/2013	100.000	100.200	100.1	1
KU	C1S	2039534	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039535	04/2013	04/16/2013	100.000	100.200	100.1	1
KU	C1S	2039536	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039537	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039538	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039539	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039540	04/2013	04/16/2013	99.900	100.000	100.1	1
KU	C1S	2039541	04/2013	04/16/2013	99.900	100.100	100.0	1
KU	C1S	2039542	04/2013	04/16/2013	100.000	100.200	100.0	1
KU	C1S	2039543	04/2013	04/16/2013	100.000	100.100	100.0	1

KU	C1S	2039544	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039545	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039546	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039547	04/2013	04/16/2013	100.000	100.200	100.0	1
KU	C1S	2039548	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039549	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039550	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039551	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039552	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039553	04/2013	04/16/2013	100.000	100.200	100.1	1
KU	C1S	2039554	04/2013	04/16/2013	100.000	100.100	99.9	1
KU	C1S	2039555	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039556	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039557	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039558	04/2013	04/16/2013	100.000	100.100	99.9	1
KU	C1S	2039559	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039560	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039561	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039562	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039563	04/2013	04/16/2013	100.000	100.000	100.0	1
KU	C1S	2039564	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039565	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039566	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039567	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039568	04/2013	04/16/2013	100.000	100.000	100.0	1
KU	C1S	2039569	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039570	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039571	04/2013	04/16/2013	100.000	100.100	99.9	1
KU	C1S	2039572	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039573	04/2013	04/16/2013	100.000	100.100	100.0	1



KU	C1S	2039574	04/2013	04/16/2013	99.900	100.100	100.1	1
KU	C1S	2039575	04/2013	04/16/2013	100.000	100.000	100.0	1
KU	C1S	2039576	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039577	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039578	04/2013	04/16/2013	100.000	100.200	99.9	1
KU	C1S	2039579	04/2013	04/16/2013	100.000	100.200	100.0	1
KU	C1S	2039580	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039581	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039582	04/2013	04/16/2013	100.000	100.200	100.1	1
KU	C1S	2039583	04/2013	04/16/2013	100.000	100.200	100.1	1
KU	C1S	2039584	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039585	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039586	04/2013	04/16/2013	99.900	100.100	100.0	1
KU	C1S	2039587	04/2013	04/16/2013	100.000	100.200	100.1	1
KU	C1S	2039588	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039589	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039590	04/2013	04/16/2013	100.000	100.200	100.1	1
KU	C1S	2039591	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039592	04/2013	04/16/2013	99.900	100.100	100.1	1
KU	C1S	2039593	04/2013	04/16/2013	99.900	100.100	100.0	1
KU	C1S	2039594	04/2013	04/16/2013	100.000	100.200	100.0	1
KU	C1S	2039595	04/2013	04/16/2013	100.000	100.000	100.0	1
KU	C1S	2039596	04/2013	04/16/2013	100.000	100.100	99.9	1
KU	C1S	2039597	04/2013	04/16/2013	100.000	100.200	100.1	1
KU	C1S	2039598	04/2013	04/16/2013	100.000	100.000	100.0	1
KU	C1S	2039599	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039600	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039601	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039602	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039603	04/2013	04/16/2013	100.000	100.200	100.0	1

KU	C1S	2039604	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039605	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039606	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039607	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039608	04/2013	04/16/2013	100.000	100.200	100.0	1
KU	C1S	2039609	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039610	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039611	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039612	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039613	04/2013	04/16/2013	99.900	100.100	100.0	1
KU	C1S	2039614	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039615	04/2013	04/16/2013	100.000	100.200	100.0	1
KU	C1S	2039616	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039617	04/2013	04/16/2013	100.000	100.000	100.0	1
KU	C1S	2039618	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039619	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039620	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039621	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039622	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039623	04/2013	04/16/2013	100.000	100.100	99.9	1
KU	C1S	2039624	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039625	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039626	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039627	04/2013	04/16/2013	100.000	100.200	100.1	1
KU	C1S	2039628	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039629	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039630	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039631	04/2013	04/16/2013	100.000	100.000	100.0	1
KU	C1S	2039632	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039633	04/2013	04/16/2013	100.000	100.100	100.0	1

KU	C1S	2039634	04/2013	04/16/2013	100.000	100.000	100.0	1
KU	C1S	2039635	04/2013	04/16/2013	100.000	100.200	100.0	1
KU	C1S	2039636	04/2013	04/16/2013	100.000	100.200	100.1	1
KU	C1S	2039637	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039638	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039639	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039640	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039641	04/2013	04/16/2013	100.000	100.000	100.0	1
KU	C1S	2039642	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039643	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039644	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039645	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039646	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039647	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039648	04/2013	04/16/2013	100.000	100.200	100.1	1
KU	C1S	2039649	04/2013	04/16/2013	99.900	100.100	100.0	1
KU	C1S	2039650	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039651	04/2013	04/16/2013	100.000	100.200	100.0	1
KU	C1S	2039652	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039653	04/2013	04/16/2013	99.900	100.100	99.9	1
KU	C1S	2039654	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039655	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039656	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039657	04/2013	04/16/2013	100.000	100.100	99.9	1
KU	C1S	2039658	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039659	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039660	04/2013	04/16/2013	99.900	100.100	100.0	1
KU	C1S	2039661	04/2013	04/16/2013	100.000	100.000	99.9	1
KU	C1S	2039662	04/2013	04/16/2013	99.900	100.100	100.0	1
KU	C1S	2039663	04/2013	04/16/2013	100.000	100.100	100.1	1



KU	C1S	2039664	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039665	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039666	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039667	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039668	04/2013	04/16/2013	100.000	100.100	99.9	1
KU	C1S	2039669	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039670	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039671	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039672	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039673	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039674	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039675	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039676	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039677	04/2013	04/11/2013	100.000	100.100	100.2	1
KU	C1S	2039678	04/2013	04/11/2013	100.000	100.200	100.2	1
KU	C1S	2039679	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039680	04/2013	04/11/2013	100.000	100.100	100.1	1
KU	C1S	2039681	04/2013	04/11/2013	100.000	100.100	100.1	1
KU	C1S	2039682	04/2013	04/11/2013	100.000	100.100	100.0	1
KU	C1S	2039683	04/2013	04/16/2013	100.000	100.100	100.2	1
KU	C1S	2039684	04/2013	04/16/2013	100.000	100.200	100.1	1
KU	C1S	2039685	04/2013	04/16/2013	100.000	100.200	100.1	1
KU	C1S	2039686	04/2013	04/11/2013	100.000	100.100	100.2	1
KU	C1S	2039687	04/2013	04/16/2013	100.000	100.200	100.2	1
KU	C1S	2039688	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039689	04/2013	04/16/2013	100.000	100.100	100.2	1
KU	C1S	2039690	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039691	04/2013	04/16/2013	100.000	100.000	100.1	1
KU	C1S	2039692	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039693	04/2013	04/16/2013	99.900	100.000	100.1	1

KU	C1S	2039694	04/2013	04/16/2013	100.000	100.100	100.2	1
KU	C1S	2039695	04/2013	04/16/2013	99.900	100.100	100.1	1
KU	C1S	2039696	04/2013	04/16/2013	100.000	100.100	100.2	1
KU	C1S	2039697	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039698	04/2013	04/16/2013	100.000	100.200	100.1	1
KU	C1S	2039699	04/2013	04/11/2013	100.000	100.100	100.1	1
KU	C1S	2039700	04/2013	04/16/2013	99.900	100.100	100.2	1
KU	C1S	2039701	04/2013	04/11/2013	100.000	100.200	100.1	1
KU	C1S	2039702	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039703	04/2013	04/16/2013	100.000	100.200	100.1	1
KU	C1S	2039704	04/2013	04/11/2013	100.000	100.200	100.1	1
KU	C1S	2039705	04/2013	04/11/2013	100.000	100.100	100.1	1
KU	C1S	2039706	04/2013	04/16/2013	99.900	100.100	100.2	1
KU	C1S	2039707	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039708	04/2013	04/16/2013	100.000	100.000	100.2	1
KU	C1S	2039709	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039710	04/2013	04/11/2013	100.000	100.100	100.1	1
KU	C1S	2039711	04/2013	04/16/2013	99.900	100.100	100.1	1
KU	C1S	2039712	04/2013	04/16/2013	100.000	100.200	100.2	1
KU	C1S	2039713	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039714	04/2013	04/16/2013	100.000	100.000	100.1	1
KU	C1S	2039715	04/2013	04/11/2013	100.000	100.100	100.1	1
KU	C1S	2039716	04/2013	04/11/2013	100.000	100.100	100.1	1
KU	C1S	2039717	04/2013	04/11/2013	99.900	100.100	100.2	1
KU	C1S	2039718	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039719	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039720	04/2013	04/11/2013	100.000	100.200	100.2	1
KU	C1S	2039721	04/2013	04/11/2013	100.000	100.100	100.2	1
KU	C1S	2039722	04/2013	04/11/2013	100.000	100.100	100.0	1
KU	C1S	2039723	04/2013	04/16/2013	100.000	100.100	100.1	1

KU	C1S	2039724	04/2013	04/16/2013	100.000	100.200	100.1	1
KU	C1S	2039725	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039726	04/2013	04/16/2013	100.000	100.200	100.1	1
KU	C1S	2039727	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039728	04/2013	04/11/2013	100.000	100.100	100.1	1
KU	C1S	2039729	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039730	04/2013	04/11/2013	100.000	100.100	100.1	1
KU	C1S	2039731	04/2013	04/11/2013	100.000	100.100	100.1	1
KU	C1S	2039732	04/2013	04/11/2013	100.000	100.100	100.1	1
KU	C1S	2039733	04/2013	04/11/2013	100.000	100.100	100.2	1
KU	C1S	2039734	04/2013	04/11/2013	100.000	100.100	100.1	1
KU	C1S	2039735	04/2013	04/11/2013	100.000	100.100	100.1	1
KU	C1S	2039736	04/2013	04/16/2013	100.000	100.100	100.2	1
KU	C1S	2039737	04/2013	04/16/2013	100.000	100.100	100.2	1
KU	C1S	2039738	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039739	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039740	04/2013	04/16/2013	100.000	100.200	100.2	1
KU	C1S	2039741	04/2013	04/16/2013	100.000	100.100	100.2	1
KU	C1S	2039742	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039743	04/2013	04/16/2013	99.900	100.100	100.2	1
KU	C1S	2039744	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039745	04/2013	04/16/2013	100.000	100.200	100.2	1
KU	C1S	2039746	04/2013	04/16/2013	99.900	100.100	100.0	1
KU	C1S	2039747	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039748	04/2013	04/11/2013	100.000	100.100	100.1	1
KU	C1S	2039749	04/2013	04/16/2013	100.000	100.100	100.2	1
KU	C1S	2039750	04/2013	04/16/2013	100.000	100.100	100.2	1
KU	C1S	2039751	04/2013	04/16/2013	99.900	100.000	100.0	1
KU	C1S	2039752	04/2013	04/11/2013	100.000	100.100	100.1	1
KU	C1S	2039753	04/2013	04/11/2013	100.000	100.100	100.1	1



KU	C1S	2039754	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039755	04/2013	04/16/2013	100.000	100.200	100.1	1
KU	C1S	2039756	04/2013	04/11/2013	100.000	100.100	100.1	1
KU	C1S	2039757	04/2013	04/16/2013	100.000	100.100	100.2	1
KU	C1S	2039758	04/2013	04/11/2013	100.000	100.100	100.1	1
KU	C1S	2039759	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039760	04/2013	04/11/2013	100.000	100.100	100.2	1
KU	C1S	2039761	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039762	04/2013	04/11/2013	100.000	100.200	100.1	1
KU	C1S	2039763	04/2013	04/15/2013	100.000	100.100	100.1	1
KU	C1S	2039764	04/2013	04/11/2013	100.000	100.100	100.1	1
KU	C1S	2039765	04/2013	04/11/2013	100.000	100.100	100.1	1
KU	C1S	2039766	04/2013	04/11/2013	100.000	100.100	100.2	1
KU	C1S	2039767	04/2013	04/11/2013	100.000	100.100	100.2	1
KU	C1S	2039768	04/2013	04/11/2013	100.000	100.200	100.0	1
KU	C1S	2039769	04/2013	04/16/2013	100.000	100.200	100.2	1
KU	C1S	2039770	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039771	04/2013	04/11/2013	100.000	100.100	100.2	1
KU	C1S	2039772	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039773	04/2013	04/16/2013	99.900	100.100	100.1	1
KU	C1S	2039774	04/2013	04/16/2013	99.900	100.100	100.1	1
KU	C1S	2039775	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039776	04/2013	04/11/2013	100.000	100.100	100.2	1
KU	C1S	2039777	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039778	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039779	04/2013	04/11/2013	99.900	100.000	100.1	1
KU	C1S	2039780	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039781	04/2013	04/11/2013	100.000	100.200	100.1	1
KU	C1S	2039782	04/2013	04/11/2013	100.000	100.100	100.2	1
KU	C1S	2039783	04/2013	04/16/2013	99.900	100.100	100.1	1

KU	C1S	2039784	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039785	04/2013	04/16/2013	100.000	100.100	100.2	1
KU	C1S	2039786	04/2013	04/11/2013	100.000	100.100	100.1	1
KU	C1S	2039787	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039788	04/2013	04/16/2013	100.000	100.100	100.0	1
KU	C1S	2039789	04/2013	04/16/2013	99.900	100.100	100.0	1
KU	C1S	2039790	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039791	04/2013	04/16/2013	99.900	100.100	100.1	1
KU	C1S	2039792	04/2013	04/11/2013	100.000	100.200	100.2	1
KU	C1S	2039793	04/2013	04/16/2013	100.000	100.100	100.1	1
KU	C1S	2039794	04/2013	04/16/2013	100.000	100.100	100.2	1
KU	C1S	2039795	04/2013	04/11/2013	100.000	100.000	100.1	1
KU	C1S	2039796	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2039797	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2039798	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2039799	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2039800	07/2013	06/27/2013	99.900	100.100	100.0	1
KU	C1S	2039801	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2039802	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2039803	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2039804	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2039805	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2039806	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2039807	07/2013	06/27/2013	100.000	100.200	100.0	1
KU	C1S	2039808	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2039809	07/2013	06/27/2013	99.900	100.100	100.1	1
KU	C1S	2039810	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2039811	07/2013	06/27/2013	99.900	100.100	100.0	1
KU	C1S	2039812	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2039813	07/2013	06/27/2013	100.000	100.100	100.0	1

KU	C1S	2039814	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2039815	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2039816	07/2013	06/27/2013	99.900	100.100	100.1	1
KU	C1S	2039817	07/2013	06/27/2013	99.900	100.100	100.0	1
KU	C1S	2039818	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2039819	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2039820	07/2013	06/27/2013	100.000	100.200	99.9	1
KU	C1S	2039821	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2039822	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2039823	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2039824	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2039825	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2039826	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2039827	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2039828	07/2013	06/27/2013	100.000	100.200	100.0	1
KU	C1S	2039829	07/2013	06/27/2013	100.000	100.000	100.1	1
KU	C1S	2039830	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2039831	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2039832	07/2013	06/27/2013	100.000	100.100	99.9	1
KU	C1S	2039833	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2039834	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2039835	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2039836	07/2013	06/27/2013	99.900	100.100	100.0	1
KU	C1S	2039837	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2039838	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2039839	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2039840	07/2013	06/27/2013	99.900	100.000	99.9	1
KU	C1S	2039841	07/2013	06/27/2013	99.900	100.100	99.9	1
KU	C1S	2039842	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2039843	07/2013	06/27/2013	100.000	100.100	100.0	1



KU	C1S	2039844	07/2013	06/27/2013	100.000	100.100	99.9	1
KU	C1S	2039845	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2039846	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2039847	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2039848	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2039849	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2039850	07/2013	06/27/2013	99.900	100.100	100.0	1
KU	C1S	2039851	07/2013	06/27/2013	100.000	100.100	99.9	1
KU	C1S	2039852	07/2013	06/27/2013	99.900	100.200	100.0	1
KU	C1S	2039853	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2039854	07/2013	06/27/2013	100.000	100.200	100.0	1
KU	C1S	2039855	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2039856	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2039857	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2039858	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2039859	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2039860	07/2013	06/27/2013	100.000	100.200	100.1	1
KU	C1S	2039861	07/2013	06/27/2013	100.000	100.000	100.1	1
KU	C1S	2039862	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2039863	07/2013	06/27/2013	99.900	100.100	100.0	1
KU	C1S	2039864	07/2013	06/27/2013	99.900	100.100	100.0	1
KU	C1S	2039865	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2039866	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2039867	07/2013	06/27/2013	99.900	100.200	100.0	1
KU	C1S	2039868	07/2013	06/27/2013	99.900	100.100	100.0	1
KU	C1S	2039869	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2039870	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2039871	07/2013	06/27/2013	100.000	100.200	100.1	1
KU	C1S	2039872	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2039873	07/2013	06/27/2013	100.000	100.000	100.0	1

KU	C1S	2039874	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2039875	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2039876	07/2013	06/27/2013	99.900	100.100	100.0	1
KU	C1S	2039877	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2039878	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2039879	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2039880	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2039881	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2039882	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2039883	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2039884	07/2013	06/27/2013	100.000	100.200	100.0	1
KU	C1S	2039885	07/2013	06/27/2013	100.000	100.200	100.0	1
KU	C1S	2039886	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2039887	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2039888	07/2013	06/27/2013	99.900	100.100	100.0	1
KU	C1S	2039889	07/2013	06/26/2013	100.000	100.100	100.1	1
KU	C1S	2039890	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2039891	07/2013	06/26/2013	100.000	100.100	100.1	1
KU	C1S	2039892	07/2013	06/27/2013	99.900	100.000	99.9	1
KU	C1S	2039893	07/2013	06/27/2013	100.000	100.200	100.1	1
KU	C1S	2039894	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2039895	07/2013	06/27/2013	100.000	100.200	100.0	1
KU	C1S	2039896	07/2013	06/26/2013	100.000	100.100	100.0	1
KU	C1S	2039897	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2039898	07/2013	06/26/2013	100.000	100.100	100.0	1
KU	C1S	2039899	07/2013	06/27/2013	100.000	100.000	100.1	1
KU	C1S	2039900	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2039901	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2039902	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2039903	07/2013	06/27/2013	100.000	100.000	100.0	1

KU	C1S	2039904	07/2013	06/26/2013	100.000	100.100	100.0	1
KU	C1S	2039905	07/2013	06/27/2013	99.900	100.000	100.0	1
KU	C1S	2039906	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2039907	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2039908	07/2013	06/27/2013	99.900	100.100	100.0	1
KU	C1S	2039909	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2039910	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2039911	07/2013	06/27/2013	100.000	100.200	100.0	1
KU	C1S	2039912	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2039913	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2039914	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2039915	07/2013	06/27/2013	100.000	100.200	100.1	1
KU	C1S	2039916	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2039917	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2039918	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2039919	07/2013	06/27/2013	100.000	100.100	99.9	1
KU	C1S	2039920	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2039921	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2039922	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2039923	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2039924	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2039925	07/2013	06/27/2013	100.000	100.000	99.9	1
KU	C1S	2039926	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2039927	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2039928	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2039929	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2039930	07/2013	06/27/2013	99.900	100.100	100.1	1
KU	C1S	2039931	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2039932	07/2013	06/27/2013	99.900	100.100	100.1	1
KU	C1S	2039933	07/2013	06/27/2013	100.000	100.000	100.1	1



KU	C1S	2039934	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2039935	07/2013	06/27/2013	99.900	100.000	100.0	1
KU	C1S	2039936	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2039937	07/2013	06/27/2013	100.000	100.100	99.9	1
KU	C1S	2039938	07/2013	06/27/2013	100.000	100.000	100.1	1
KU	C1S	2039939	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2039940	07/2013	06/27/2013	100.000	100.200	100.0	1
KU	C1S	2039941	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2039942	07/2013	06/27/2013	100.000	100.200	100.0	1
KU	C1S	2039943	07/2013	06/27/2013	100.000	100.000	100.1	1
KU	C1S	2039944	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2039945	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2039946	07/2013	06/27/2013	100.000	100.200	100.0	1
KU	C1S	2039947	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2039948	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2039949	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2039950	07/2013	06/27/2013	99.900	100.000	100.0	1
KU	C1S	2039951	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2039952	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2039953	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2039954	07/2013	06/27/2013	100.000	100.100	99.9	1
KU	C1S	2039955	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2039956	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2039957	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2039958	07/2013	06/27/2013	99.900	100.100	100.1	1
KU	C1S	2039959	07/2013	06/27/2013	100.000	100.100	99.9	1
KU	C1S	2039960	07/2013	06/27/2013	100.000	100.200	100.0	1
KU	C1S	2039961	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2039962	07/2013	06/27/2013	99.900	100.100	100.0	1
KU	C1S	2039963	07/2013	06/27/2013	100.000	100.100	100.0	1

KU	C1S	2039964	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2039965	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2039966	07/2013	06/27/2013	100.000	100.000	100.1	1
KU	C1S	2039967	07/2013	06/27/2013	100.000	100.200	100.1	1
KU	C1S	2039968	07/2013	06/27/2013	100.000	100.200	100.1	1
KU	C1S	2039969	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2039970	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2039971	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2039972	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2039973	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2039974	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2039975	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2039976	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2039977	07/2013	06/27/2013	100.000	100.000	100.1	1
KU	C1S	2039978	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2039979	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2039980	07/2013	06/27/2013	99.900	100.000	100.0	1
KU	C1S	2039981	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2039982	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2039983	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2039984	07/2013	06/27/2013	100.000	100.000	100.1	1
KU	C1S	2039985	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2039986	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2039987	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2039988	07/2013	06/27/2013	100.000	100.100	99.9	1
KU	C1S	2039989	07/2013	06/27/2013	100.000	100.200	100.0	1
KU	C1S	2039990	07/2013	06/27/2013	100.000	100.200	100.0	1
KU	C1S	2039991	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2039992	07/2013	06/27/2013	100.000	100.100	99.9	1
KU	C1S	2039993	07/2013	06/27/2013	99.900	100.100	99.9	1

KU	C1S	2039994	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2039995	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2039996	07/2013	06/27/2013	100.000	100.200	100.1	1
KU	C1S	2039997	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2039998	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2039999	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040000	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040001	07/2013	06/27/2013	100.000	100.000	99.9	1
KU	C1S	2040002	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040003	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040004	07/2013	06/27/2013	100.000	100.000	100.1	1
KU	C1S	2040005	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040006	07/2013	06/27/2013	99.900	100.000	99.9	1
KU	C1S	2040007	07/2013	06/27/2013	100.000	100.200	100.1	1
KU	C1S	2040008	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040009	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040010	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040011	07/2013	06/27/2013	100.000	100.000	99.9	1
KU	C1S	2040012	07/2013	06/27/2013	99.900	100.100	100.1	1
KU	C1S	2040013	07/2013	06/27/2013	99.900	100.100	100.0	1
KU	C1S	2040014	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040015	07/2013	06/27/2013	99.900	100.100	100.0	1
KU	C1S	2040016	07/2013	06/27/2013	99.900	100.000	100.0	1
KU	C1S	2040017	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040018	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040019	07/2013	06/27/2013	99.900	100.100	100.0	1
KU	C1S	2040020	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040021	07/2013	06/27/2013	99.900	100.000	100.0	1
KU	C1S	2040022	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040023	07/2013	06/27/2013	100.000	100.000	100.1	1



KU	C1S	2040024	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040025	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040026	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2040027	07/2013	06/27/2013	99.900	100.100	100.0	1
KU	C1S	2040028	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2040029	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040030	07/2013	06/27/2013	99.900	100.100	100.0	1
KU	C1S	2040031	07/2013	06/27/2013	99.900	100.000	100.0	1
KU	C1S	2040032	07/2013	06/27/2013	99.900	100.000	100.0	1
KU	C1S	2040033	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040034	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040035	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040036	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040037	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040038	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2040039	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040040	07/2013	06/27/2013	100.000	100.000	100.1	1
KU	C1S	2040041	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040042	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040043	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040044	07/2013	06/27/2013	100.000	100.200	100.0	1
KU	C1S	2040045	07/2013	06/27/2013	100.000	100.100	99.9	1
KU	C1S	2040046	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040047	07/2013	06/27/2013	99.900	100.100	100.0	1
KU	C1S	2040048	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040049	07/2013	06/27/2013	99.900	100.100	100.0	1
KU	C1S	2040050	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040051	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040052	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040053	07/2013	06/27/2013	100.000	100.200	100.1	1

KU	C1S	2040054	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040055	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040056	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040057	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2040058	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040059	07/2013	06/27/2013	99.900	100.000	100.0	1
KU	C1S	2040060	07/2013	06/27/2013	99.900	100.100	100.0	1
KU	C1S	2040061	07/2013	06/27/2013	100.000	100.200	100.1	1
KU	C1S	2040062	07/2013	06/27/2013	100.000	100.200	100.0	1
KU	C1S	2040063	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040064	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040065	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040066	07/2013	06/27/2013	99.900	100.100	100.0	1
KU	C1S	2040067	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040068	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040069	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040070	07/2013	06/27/2013	100.000	100.000	100.1	1
KU	C1S	2040071	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040072	07/2013	06/27/2013	99.900	100.100	99.9	1
KU	C1S	2040073	07/2013	06/27/2013	99.900	100.100	100.0	1
KU	C1S	2040074	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2040075	07/2013	06/27/2013	100.000	100.200	100.1	1
KU	C1S	2040076	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040077	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040078	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040079	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040080	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040081	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2040082	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040083	07/2013	06/27/2013	100.000	100.100	100.0	1

KU	C1S	2040084	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040085	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040086	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040087	07/2013	06/27/2013	99.900	100.100	100.0	1
KU	C1S	2040088	07/2013	06/27/2013	100.000	100.100	99.9	1
KU	C1S	2040089	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040090	07/2013	06/27/2013	99.900	100.100	100.0	1
KU	C1S	2040091	07/2013	06/27/2013	100.000	100.200	100.0	1
KU	C1S	2040092	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040093	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040094	07/2013	06/27/2013	100.000	100.100	99.9	1
KU	C1S	2040095	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040096	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040097	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040098	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040099	07/2013	06/27/2013	99.900	100.200	100.0	1
KU	C1S	2040100	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2040101	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040102	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040103	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040104	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2040105	07/2013	06/27/2013	100.000	100.200	100.0	1
KU	C1S	2040106	07/2013	06/27/2013	100.000	100.200	100.0	1
KU	C1S	2040107	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040108	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040109	07/2013	06/27/2013	100.000	100.200	100.1	1
KU	C1S	2040110	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040111	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040112	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2040113	07/2013	06/27/2013	100.000	100.200	99.9	1



KU	C1S	2040114	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040115	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040116	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040117	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040118	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040119	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040120	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040121	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040122	07/2013	06/27/2013	99.900	100.100	100.0	1
KU	C1S	2040123	07/2013	06/27/2013	100.000	100.100	100.2	1
KU	C1S	2040124	07/2013	06/27/2013	100.000	100.000	99.9	1
KU	C1S	2040125	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040126	07/2013	06/27/2013	99.900	100.100	99.9	1
KU	C1S	2040127	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040128	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040129	07/2013	06/27/2013	99.900	100.000	100.0	1
KU	C1S	2040130	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040131	07/2013	06/27/2013	100.000	100.200	100.0	1
KU	C1S	2040132	07/2013	06/27/2013	100.000	100.200	100.1	1
KU	C1S	2040133	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040134	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040135	07/2013	06/27/2013	100.000	100.200	100.0	1
KU	C1S	2040136	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040137	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040138	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040139	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040140	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040141	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2040142	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040143	07/2013	06/27/2013	100.000	100.100	100.0	1

KU	C1S	2040144	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040145	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040146	07/2013	06/27/2013	99.900	100.000	100.0	1
KU	C1S	2040147	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040148	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040149	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2040150	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040151	07/2013	06/27/2013	99.900	100.000	100.0	1
KU	C1S	2040152	07/2013	06/27/2013	100.000	100.200	100.0	1
KU	C1S	2040153	07/2013	06/27/2013	99.900	100.000	100.0	1
KU	C1S	2040154	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040155	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040156	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040157	07/2013	06/27/2013	100.000	100.000	99.9	1
KU	C1S	2040158	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2040159	07/2013	06/27/2013	100.000	100.200	100.2	1
KU	C1S	2040160	07/2013	06/27/2013	99.900	100.100	100.1	1
KU	C1S	2040161	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040162	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040163	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040164	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2040165	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040166	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040167	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040168	07/2013	06/27/2013	99.900	100.100	100.0	1
KU	C1S	2040169	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040170	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040171	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040172	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040173	07/2013	06/27/2013	100.000	100.100	100.1	1

KU	C-1S	2040174	07/2013	06/27/2013	100.000	100.000	100.1	1
KU	C-1S	2040175	07/2013	06/27/2013	100.000	100.200	100.1	1
KU	C-1S	2040176	07/2013	06/27/2013	100.000	100.100	99.9	1
KU	C-1S	2040177	07/2013	06/27/2013	100.000	100.200	100.1	1
KU	C-1S	2040178	07/2013	06/27/2013	100.000	100.000	100.1	1
KU	C-1S	2040179	07/2013	06/27/2013	100.000	100.200	100.1	1
KU	C-1S	2040180	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C-1S	2040181	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C-1S	2040182	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C-1S	2040183	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C-1S	2040184	07/2013	06/27/2013	99.900	100.000	100.0	1
KU	C-1S	2040185	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C-1S	2040186	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C-1S	2040187	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C-1S	2040188	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C-1S	2040189	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C-1S	2040190	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C-1S	2040191	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C-1S	2040192	07/2013	06/27/2013	100.000	100.100	99.9	1
KU	C-1S	2040193	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C-1S	2040194	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C-1S	2040195	07/2013	06/27/2013	100.000	100.100	99.9	1
KU	C-1S	2040196	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C-1S	2040197	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C-1S	2040198	07/2013	06/27/2013	100.000	100.100	99.9	1
KU	C-1S	2040199	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C-1S	2040200	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C-1S	2040201	07/2013	06/27/2013	99.900	100.100	100.0	1
KU	C-1S	2040202	07/2013	06/27/2013	99.900	100.000	100.0	1
KU	C-1S	2040203	07/2013	06/27/2013	99.900	100.000	99.9	1



KU	C1S	2040204	07/2013	06/27/2013	99.900	100.100	100.0	1
KU	C1S	2040205	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040206	07/2013	06/27/2013	99.900	100.100	100.0	1
KU	C1S	2040207	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040208	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040209	07/2013	06/27/2013	99.900	100.100	100.0	1
KU	C1S	2040210	07/2013	06/27/2013	99.900	100.100	100.0	1
KU	C1S	2040211	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040212	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040213	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040214	07/2013	06/27/2013	100.000	100.200	100.0	1
KU	C1S	2040215	07/2013	06/27/2013	100.000	100.200	100.0	1
KU	C1S	2040216	07/2013	06/27/2013	99.900	100.100	100.1	1
KU	C1S	2040217	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040218	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2040219	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040220	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040221	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040222	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2040223	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040224	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040225	07/2013	06/27/2013	99.900	100.100	100.0	1
KU	C1S	2040226	07/2013	06/27/2013	99.900	100.100	100.1	1
KU	C1S	2040227	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040228	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2040229	07/2013	06/27/2013	99.900	100.100	100.0	1
KU	C1S	2040230	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2040231	07/2013	06/27/2013	100.000	100.000	100.1	1
KU	C1S	2040232	07/2013	06/27/2013	99.900	100.100	100.1	1
KU	C1S	2040233	07/2013	06/27/2013	99.900	100.000	100.0	1

KU	C1S	2040234	07/2013	06/27/2013	100.000	100.000	100.1	1
KU	C1S	2040235	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040236	07/2013	06/27/2013	99.900	100.100	100.0	1
KU	C1S	2040237	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2040238	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040239	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040240	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2040241	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040242	07/2013	06/27/2013	100.000	100.200	100.0	1
KU	C1S	2040243	07/2013	06/27/2013	100.000	100.100	99.9	1
KU	C1S	2040244	07/2013	06/27/2013	100.000	100.000	100.1	1
KU	C1S	2040245	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040246	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040247	07/2013	06/27/2013	99.900	100.100	100.1	1
KU	C1S	2040248	07/2013	06/27/2013	99.900	100.000	99.9	1
KU	C1S	2040249	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040250	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040251	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040252	07/2013	06/27/2013	100.000	100.000	100.1	1
KU	C1S	2040253	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040254	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040255	07/2013	06/27/2013	99.900	100.000	100.0	1
KU	C1S	2040256	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2040257	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040258	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040259	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040260	07/2013	06/27/2013	99.900	100.100	100.0	1
KU	C1S	2040261	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040262	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2040263	07/2013	06/27/2013	100.000	100.100	100.0	1

KU	C1S	2040264	07/2013	06/27/2013	99.900	100.100	100.0	1
KU	C1S	2040265	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040266	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040267	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2040268	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040269	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040270	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2040271	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040272	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040273	07/2013	06/27/2013	99.900	100.000	100.0	1
KU	C1S	2040274	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2040275	07/2013	06/27/2013	99.900	100.100	100.1	1
KU	C1S	2040276	07/2013	06/27/2013	99.900	100.100	100.0	1
KU	C1S	2040277	07/2013	06/27/2013	100.000	100.200	100.1	1
KU	C1S	2040278	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2040279	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040280	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040281	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040282	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040283	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040284	07/2013	06/27/2013	99.900	100.100	100.0	1
KU	C1S	2040285	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040286	07/2013	06/27/2013	100.000	100.200	100.1	1
KU	C1S	2040287	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040288	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2040289	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040290	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040291	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040292	07/2013	06/27/2013	99.900	100.100	100.0	1
KU	C1S	2040293	07/2013	06/27/2013	100.000	100.200	100.0	1



KU	C1S	2040294	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040295	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040296	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040297	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040298	07/2013	06/27/2013	99.900	100.100	100.0	1
KU	C1S	2040299	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040300	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040301	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040302	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040303	07/2013	06/27/2013	100.000	100.000	100.1	1
KU	C1S	2040304	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040305	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040306	07/2013	06/27/2013	100.000	100.000	100.1	1
KU	C1S	2040307	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040308	07/2013	06/27/2013	100.000	100.100	99.9	1
KU	C1S	2040309	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040310	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040311	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040312	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040313	07/2013	06/27/2013	100.000	100.100	99.9	1
KU	C1S	2040314	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040315	07/2013	06/27/2013	99.900	100.000	100.1	1
KU	C1S	2040316	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040317	07/2013	06/27/2013	100.000	100.200	100.1	1
KU	C1S	2040318	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040319	07/2013	06/27/2013	99.900	100.100	100.1	1
KU	C1S	2040320	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040321	07/2013	06/27/2013	100.000	100.000	100.1	1
KU	C1S	2040322	07/2013	06/27/2013	100.000	100.100	99.9	1
KU	C1S	2040323	07/2013	06/27/2013	100.000	100.000	100.0	1

KU	C1S	2040324	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040325	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040326	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040327	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040328	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040329	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040330	07/2013	06/27/2013	100.000	100.200	100.1	1
KU	C1S	2040331	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040332	07/2013	06/27/2013	99.900	100.100	100.1	1
KU	C1S	2040333	07/2013	06/27/2013	99.900	100.100	100.1	1
KU	C1S	2040334	07/2013	06/27/2013	100.000	100.200	100.0	1
KU	C1S	2040335	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040336	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040337	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2040338	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040339	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040340	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040341	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040342	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040343	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040344	07/2013	06/27/2013	99.900	100.100	100.0	1
KU	C1S	2040345	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040346	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040347	07/2013	06/27/2013	100.000	100.200	100.1	1
KU	C1S	2040348	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040349	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040350	07/2013	06/27/2013	100.000	100.200	100.1	1
KU	C1S	2040351	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040352	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040353	07/2013	06/27/2013	100.000	100.100	100.0	1

KU	C1S	2040354	07/2013	06/27/2013	99.900	100.100	100.0	1
KU	C1S	2040355	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040356	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040357	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040358	07/2013	06/27/2013	100.000	100.200	100.1	1
KU	C1S	2040359	07/2013	06/27/2013	100.000	100.200	100.1	1
KU	C1S	2040360	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040361	07/2013	06/27/2013	99.900	100.100	100.1	1
KU	C1S	2040362	07/2013	06/27/2013	99.900	100.000	100.0	1
KU	C1S	2040363	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040364	07/2013	06/27/2013	100.000	100.200	100.0	1
KU	C1S	2040365	07/2013	06/27/2013	99.900	100.000	100.0	1
KU	C1S	2040366	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040367	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040368	07/2013	06/27/2013	100.000	100.200	100.1	1
KU	C1S	2040369	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2040370	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2040371	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040372	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040373	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040374	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040375	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040376	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040377	07/2013	06/27/2013	100.000	100.100	99.9	1
KU	C1S	2040378	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040379	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040380	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040381	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040382	07/2013	06/27/2013	100.000	100.200	100.1	1
KU	C1S	2040383	07/2013	06/27/2013	100.000	100.100	99.9	1



KU	C1S	2040384	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040385	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040386	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040387	07/2013	06/27/2013	99.900	100.100	100.0	1
KU	C1S	2040388	07/2013	06/27/2013	99.900	100.000	100.1	1
KU	C1S	2040389	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040390	07/2013	06/27/2013	99.900	100.100	100.0	1
KU	C1S	2040391	07/2013	06/27/2013	100.000	100.200	100.1	1
KU	C1S	2040392	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040393	07/2013	06/27/2013	100.000	100.000	100.1	1
KU	C1S	2040394	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040395	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040396	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040397	07/2013	06/27/2013	100.000	100.200	100.0	1
KU	C1S	2040398	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2040399	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040400	07/2013	06/27/2013	99.900	100.100	99.9	1
KU	C1S	2040401	07/2013	06/27/2013	100.000	100.200	100.0	1
KU	C1S	2040402	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040403	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040404	07/2013	06/27/2013	100.000	100.100	99.9	1
KU	C1S	2040405	07/2013	06/27/2013	99.900	100.100	99.9	1
KU	C1S	2040406	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040407	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040408	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040409	07/2013	06/27/2013	100.000	100.200	100.1	1
KU	C1S	2040410	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040411	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040412	07/2013	06/27/2013	99.900	100.100	100.0	1
KU	C1S	2040413	07/2013	06/27/2013	100.000	100.100	100.0	1

KU	C1S	2040414	07/2013	06/27/2013	99.900	100.200	100.0	1
KU	C1S	2040415	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040416	07/2013	06/27/2013	99.900	100.100	100.0	1
KU	C1S	2040417	07/2013	06/27/2013	99.900	100.100	100.0	1
KU	C1S	2040418	07/2013	06/27/2013	100.000	100.200	100.0	1
KU	C1S	2040419	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2040420	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2040421	07/2013	06/27/2013	99.900	99.900	100.0	1
KU	C1S	2040422	07/2013	06/27/2013	99.900	100.100	99.9	1
KU	C1S	2040423	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040424	07/2013	06/27/2013	99.900	100.000	100.0	1
KU	C1S	2040425	07/2013	06/27/2013	99.900	100.100	100.0	1
KU	C1S	2040426	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040427	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040428	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040429	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040430	07/2013	06/27/2013	99.900	100.100	100.0	1
KU	C1S	2040431	07/2013	06/27/2013	99.900	100.100	99.9	1
KU	C1S	2040432	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040433	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2040434	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040435	07/2013	06/27/2013	100.000	100.100	99.9	1
KU	C1S	2040436	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040437	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040438	07/2013	06/27/2013	100.000	100.200	100.0	1
KU	C1S	2040439	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040440	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2040441	07/2013	06/27/2013	99.900	100.100	100.0	1
KU	C1S	2040442	07/2013	06/27/2013	99.900	100.100	100.0	1
KU	C1S	2040443	07/2013	06/27/2013	100.000	100.100	100.0	1

KU	C1S	2040444	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040445	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040446	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2040447	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040448	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040449	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2040450	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040451	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2040452	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2040453	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040454	07/2013	06/27/2013	99.900	100.000	100.1	1
KU	C1S	2040455	07/2013	06/27/2013	99.900	100.100	100.0	1
KU	C1S	2040456	07/2013	06/27/2013	100.000	100.000	99.9	1
KU	C1S	2040457	07/2013	06/27/2013	99.900	100.100	100.0	1
KU	C1S	2040458	07/2013	06/27/2013	100.000	100.200	100.1	1
KU	C1S	2040459	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040460	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040461	07/2013	06/27/2013	100.000	100.100	99.9	1
KU	C1S	2040462	07/2013	06/27/2013	100.000	100.000	100.1	1
KU	C1S	2040463	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040464	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040465	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040466	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040467	07/2013	06/27/2013	100.000	100.200	100.0	1
KU	C1S	2040468	07/2013	06/27/2013	99.900	100.100	100.0	1
KU	C1S	2040469	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040470	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040471	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040472	07/2013	06/27/2013	100.000	100.200	100.1	1
KU	C1S	2040473	07/2013	06/27/2013	100.000	100.000	100.0	1



KU	C1S	2040474	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040475	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040476	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040477	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040478	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040479	07/2013	06/27/2013	99.900	100.000	100.0	1
KU	C1S	2040480	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040481	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040482	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040483	07/2013	06/27/2013	100.000	100.100	99.9	1
KU	C1S	2040484	07/2013	06/27/2013	100.000	100.200	100.1	1
KU	C1S	2040485	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2040486	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040487	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040488	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040489	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2040490	07/2013	06/27/2013	100.000	100.200	100.1	1
KU	C1S	2040491	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2040492	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040493	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040494	07/2013	06/27/2013	100.000	100.200	100.0	1
KU	C1S	2040495	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040496	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040497	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040498	07/2013	06/27/2013	100.000	100.000	100.1	1
KU	C1S	2040499	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040500	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2040501	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040502	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040503	07/2013	06/27/2013	100.000	100.000	100.0	1

KU	C1S	2040504	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2040505	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040506	07/2013	06/27/2013	100.000	100.000	100.1	1
KU	C1S	2040507	07/2013	06/27/2013	99.900	100.100	100.0	1
KU	C1S	2040508	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040509	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040510	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040511	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040512	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040513	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040514	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040515	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040516	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040517	07/2013	06/27/2013	99.900	100.100	100.0	1
KU	C1S	2040518	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2040519	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2040520	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2040521	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040522	07/2013	06/27/2013	100.000	100.200	100.0	1
KU	C1S	2040523	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040524	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040525	07/2013	06/27/2013	99.900	100.100	100.0	1
KU	C1S	2040526	07/2013	06/27/2013	100.000	100.200	100.1	1
KU	C1S	2040527	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040528	07/2013	06/27/2013	100.000	100.100	99.9	1
KU	C1S	2040529	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2040530	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040531	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040532	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040533	07/2013	06/27/2013	100.000	100.100	100.0	1

KU	C1S	2040534	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040535	07/2013	06/27/2013	100.000	100.200	100.1	1
KU	C1S	2040536	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040537	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040538	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040539	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040540	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040541	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040542	07/2013	06/27/2013	99.900	100.100	100.0	1
KU	C1S	2040543	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040544	07/2013	06/27/2013	100.000	100.000	99.9	1
KU	C1S	2040545	07/2013	06/27/2013	100.000	100.100	99.9	1
KU	C1S	2040546	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040547	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040548	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040549	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040550	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040551	07/2013	06/27/2013	100.000	100.200	100.0	1
KU	C1S	2040552	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040553	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040554	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2040555	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040556	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040557	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040558	07/2013	06/27/2013	100.000	100.200	100.1	1
KU	C1S	2040559	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040560	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040561	07/2013	06/27/2013	99.900	100.100	100.0	1
KU	C1S	2040562	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040563	07/2013	06/27/2013	100.000	100.100	100.0	1



KU	C1S	2040564	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040565	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040566	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040567	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040568	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040569	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040570	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2040571	07/2013	06/27/2013	100.000	100.000	100.1	1
KU	C1S	2040572	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2040573	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2040574	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040575	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2040576	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2040577	07/2013	06/27/2013	100.000	100.200	100.0	1
KU	C1S	2040578	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040579	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040580	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2040581	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040582	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040583	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040584	07/2013	06/27/2013	100.000	100.200	100.0	1
KU	C1S	2040585	07/2013	06/27/2013	100.000	100.200	100.1	1
KU	C1S	2040586	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040587	07/2013	06/27/2013	99.900	100.200	100.0	1
KU	C1S	2040588	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040589	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040590	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040591	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2040592	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2040593	07/2013	06/27/2013	100.000	100.200	99.9	1

KU	C1S	2040594	07/2013	06/27/2013	99.900	100.100	100.0	1
KU	C1S	2040595	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040596	07/2013	06/27/2013	100.000	100.100	99.9	1
KU	C1S	2040597	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2040598	07/2013	06/27/2013	100.000	100.100	99.9	1
KU	C1S	2040599	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040600	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040601	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040602	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040603	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040604	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040605	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040606	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040607	07/2013	06/27/2013	100.000	100.100	99.9	1
KU	C1S	2040608	07/2013	06/27/2013	100.000	100.200	100.0	1
KU	C1S	2040609	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040610	07/2013	06/27/2013	100.000	100.000	100.1	1
KU	C1S	2040611	07/2013	06/27/2013	100.000	100.200	100.1	1
KU	C1S	2040612	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040613	07/2013	06/27/2013	99.900	100.100	100.0	1
KU	C1S	2040614	07/2013	06/27/2013	100.000	100.200	100.1	1
KU	C1S	2040615	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040616	07/2013	06/27/2013	99.900	100.100	100.0	1
KU	C1S	2040617	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2040618	07/2013	06/27/2013	100.000	100.100	99.9	1
KU	C1S	2040619	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040620	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040621	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2040622	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040623	07/2013	06/27/2013	100.000	100.000	100.0	1

KU	C1S	2040624	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040625	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040626	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040627	07/2013	06/27/2013	99.900	100.100	100.0	1
KU	C1S	2040628	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040629	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040630	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040631	07/2013	06/27/2013	100.000	100.200	100.1	1
KU	C1S	2040632	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040633	07/2013	06/27/2013	100.000	100.100	99.9	1
KU	C1S	2040634	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040635	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040636	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2040637	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040638	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2040639	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040640	07/2013	06/27/2013	99.900	100.100	100.0	1
KU	C1S	2040641	07/2013	06/27/2013	100.000	100.200	100.1	1
KU	C1S	2040642	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040643	07/2013	06/27/2013	100.000	100.200	100.1	1
KU	C1S	2040644	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040645	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040646	07/2013	06/27/2013	100.000	100.200	100.1	1
KU	C1S	2040647	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040648	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040649	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040650	07/2013	06/27/2013	99.900	100.000	100.1	1
KU	C1S	2040651	07/2013	06/27/2013	100.000	100.200	100.1	1
KU	C1S	2040652	07/2013	06/27/2013	99.900	100.100	100.0	1
KU	C1S	2040653	07/2013	06/27/2013	100.000	100.000	100.0	1



KU	C1S	2040654	07/2013	06/27/2013	99.900	100.100	100.0	1
KU	C1S	2040655	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040656	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040657	07/2013	06/27/2013	99.900	100.000	100.1	1
KU	C1S	2040658	07/2013	06/27/2013	100.000	100.100	99.9	1
KU	C1S	2040659	07/2013	06/27/2013	99.900	100.100	99.9	1
KU	C1S	2040660	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040661	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2040662	07/2013	06/27/2013	100.000	100.200	100.1	1
KU	C1S	2040663	07/2013	06/27/2013	100.000	100.000	100.1	1
KU	C1S	2040664	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040665	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040666	07/2013	06/27/2013	99.900	100.000	99.9	1
KU	C1S	2040667	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040668	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040669	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040670	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040671	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040672	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040673	07/2013	06/27/2013	100.000	100.000	99.9	1
KU	C1S	2040674	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040675	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040676	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040677	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040678	07/2013	06/27/2013	99.900	100.000	100.0	1
KU	C1S	2040679	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040680	07/2013	06/27/2013	100.000	100.000	100.1	1
KU	C1S	2040681	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040682	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040683	07/2013	06/27/2013	100.000	100.100	100.1	1

KU	C1S	2040684	07/2013	06/27/2013	99.900	100.100	100.0	1
KU	C1S	2040685	07/2013	06/27/2013	99.900	100.100	100.0	1
KU	C1S	2040686	07/2013	06/27/2013	100.000	100.200	100.1	1
KU	C1S	2040687	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040688	07/2013	06/27/2013	100.000	100.200	100.0	1
KU	C1S	2040689	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040690	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040691	07/2013	06/27/2013	99.900	100.100	99.9	1
KU	C1S	2040692	07/2013	06/27/2013	99.900	100.000	99.9	1
KU	C1S	2040693	07/2013	06/27/2013	100.000	100.200	100.1	1
KU	C1S	2040694	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040695	07/2013	06/27/2013	100.000	100.200	100.0	1
KU	C1S	2040696	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040697	07/2013	06/27/2013	100.000	100.200	100.0	1
KU	C1S	2040698	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040699	07/2013	06/27/2013	99.900	100.100	100.0	1
KU	C1S	2040700	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040701	07/2013	06/27/2013	99.900	100.200	100.0	1
KU	C1S	2040702	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040703	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040704	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040705	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040706	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040707	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2040708	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040709	07/2013	06/27/2013	99.900	100.100	100.0	1
KU	C1S	2040710	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040711	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040712	07/2013	06/27/2013	99.900	100.100	100.0	1
KU	C1S	2040713	07/2013	06/27/2013	100.000	100.100	100.0	1

KU	C1S	2040714	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040715	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040716	07/2013	06/27/2013	99.900	100.000	100.0	1
KU	C1S	2040717	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040718	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040719	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040720	07/2013	06/27/2013	99.900	100.100	100.1	1
KU	C1S	2040721	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040722	07/2013	06/27/2013	99.900	100.100	99.9	1
KU	C1S	2040723	07/2013	06/27/2013	100.000	100.000	100.1	1
KU	C1S	2040724	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2040725	07/2013	06/27/2013	100.000	100.200	100.1	1
KU	C1S	2040726	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040727	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040728	07/2013	06/27/2013	99.900	100.100	100.1	1
KU	C1S	2040729	07/2013	06/27/2013	99.900	100.100	100.0	1
KU	C1S	2040730	07/2013	06/27/2013	99.900	100.000	100.0	1
KU	C1S	2040731	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040732	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040733	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040734	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2040735	07/2013	06/27/2013	99.900	100.100	99.9	1
KU	C1S	2040736	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040737	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040738	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040739	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2040740	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040741	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2040742	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040743	07/2013	06/27/2013	100.000	100.000	100.0	1



KU	C1S	2040744	07/2013	06/27/2013	99.900	100.100	100.0	1
KU	C1S	2040745	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040746	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040747	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040748	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040749	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040750	07/2013	06/27/2013	99.900	100.100	100.0	1
KU	C1S	2040751	07/2013	06/27/2013	100.000	100.000	99.9	1
KU	C1S	2040752	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040753	07/2013	06/27/2013	100.000	100.200	100.1	1
KU	C1S	2040754	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040755	07/2013	06/27/2013	100.000	100.100	99.9	1
KU	C1S	2040756	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040757	07/2013	06/27/2013	99.900	100.000	100.1	1
KU	C1S	2040758	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040759	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040760	07/2013	06/27/2013	99.900	100.100	100.0	1
KU	C1S	2040761	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040762	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040763	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040764	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040765	07/2013	06/27/2013	100.000	100.100	99.9	1
KU	C1S	2040766	07/2013	06/27/2013	100.000	100.200	100.2	1
KU	C1S	2040767	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040768	07/2013	06/27/2013	99.900	100.100	100.0	1
KU	C1S	2040769	07/2013	06/27/2013	100.000	100.200	100.1	1
KU	C1S	2040770	07/2013	06/27/2013	100.000	100.200	100.2	1
KU	C1S	2040771	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040772	07/2013	06/27/2013	100.000	100.200	100.1	1
KU	C1S	2040773	07/2013	06/27/2013	100.000	100.200	100.0	1

KU	C1S	2040774	07/2013	06/27/2013	99.900	100.100	100.1	1
KU	C1S	2040775	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2040776	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040777	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040778	07/2013	06/27/2013	100.000	100.000	100.1	1
KU	C1S	2040779	07/2013	06/27/2013	100.000	100.000	100.1	1
KU	C1S	2040780	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040781	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040782	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2040783	07/2013	06/27/2013	99.900	100.100	100.0	1
KU	C1S	2040784	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040785	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040786	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040787	07/2013	06/27/2013	100.000	100.200	100.0	1
KU	C1S	2040788	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040789	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040790	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040791	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2040792	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2040793	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2040794	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2040795	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040796	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040797	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040798	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040799	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040800	07/2013	06/27/2013	100.000	100.200	100.0	1
KU	C1S	2040801	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040802	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040803	07/2013	06/27/2013	100.000	100.100	100.0	1

KU	C1S	2040804	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040805	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040806	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040807	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040808	07/2013	06/27/2013	100.000	100.200	100.1	1
KU	C1S	2040809	07/2013	06/27/2013	100.000	100.100	99.9	1
KU	C1S	2040810	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040811	07/2013	06/27/2013	100.000	100.000	99.9	1
KU	C1S	2040812	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040813	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040814	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040815	07/2013	06/27/2013	100.000	100.200	100.1	1
KU	C1S	2040816	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040817	07/2013	06/27/2013	99.900	100.200	100.0	1
KU	C1S	2040818	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040819	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040820	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040821	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040822	07/2013	06/27/2013	99.900	100.100	100.0	1
KU	C1S	2040823	07/2013	06/27/2013	100.000	100.200	100.0	1
KU	C1S	2040824	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040825	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040826	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040827	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040828	07/2013	06/27/2013	99.900	100.000	100.0	1
KU	C1S	2040829	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040830	07/2013	06/27/2013	99.900	100.100	99.9	1
KU	C1S	2040831	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040832	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2040833	07/2013	06/27/2013	100.000	100.200	100.1	1



KU	C1S	2040834	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040835	07/2013	06/27/2013	100.000	100.100	99.9	1
KU	C1S	2040836	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040837	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040838	07/2013	06/27/2013	100.000	100.200	100.1	1
KU	C1S	2040839	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040840	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040841	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040842	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040843	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2040844	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040845	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040846	07/2013	06/27/2013	99.900	100.100	100.0	1
KU	C1S	2040847	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040848	07/2013	06/27/2013	100.000	100.200	100.1	1
KU	C1S	2040849	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040850	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040851	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040852	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040853	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040854	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040855	07/2013	06/27/2013	100.000	100.100	99.9	1
KU	C1S	2040856	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2040857	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040858	07/2013	06/27/2013	100.000	100.200	100.0	1
KU	C1S	2040859	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040860	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040861	07/2013	06/27/2013	100.000	100.000	99.9	1
KU	C1S	2040862	07/2013	06/27/2013	100.000	100.200	100.0	1
KU	C1S	2040863	07/2013	06/27/2013	100.000	100.200	100.1	1

KU	C1S	2040864	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040865	07/2013	06/27/2013	100.000	100.200	100.0	1
KU	C1S	2040866	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040867	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040868	07/2013	06/27/2013	99.900	100.100	100.0	1
KU	C1S	2040869	07/2013	06/27/2013	99.900	100.000	100.0	1
KU	C1S	2040870	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2040871	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040872	07/2013	06/27/2013	100.000	100.200	100.0	1
KU	C1S	2040873	07/2013	06/27/2013	100.000	100.200	100.1	1
KU	C1S	2040874	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040875	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2040876	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040877	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040878	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040879	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2040880	07/2013	06/27/2013	99.900	100.100	99.9	1
KU	C1S	2040881	07/2013	06/27/2013	100.000	100.200	100.0	1
KU	C1S	2040882	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040883	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040884	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2040885	07/2013	06/27/2013	100.000	100.100	99.9	1
KU	C1S	2040886	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040887	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040888	07/2013	06/27/2013	100.000	100.100	99.9	1
KU	C1S	2040889	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040890	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040891	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040892	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040893	07/2013	06/27/2013	100.000	100.100	100.0	1

KU	C1S	2040894	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040895	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040896	07/2013	06/27/2013	100.000	100.100	99.9	1
KU	C1S	2040897	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040898	07/2013	06/27/2013	99.900	100.100	100.0	1
KU	C1S	2040899	07/2013	06/27/2013	99.900	100.000	100.0	1
KU	C1S	2040900	07/2013	06/27/2013	99.900	100.100	100.0	1
KU	C1S	2040901	07/2013	06/27/2013	100.000	100.200	100.0	1
KU	C1S	2040902	07/2013	06/27/2013	100.000	100.200	100.0	1
KU	C1S	2040903	07/2013	06/27/2013	99.900	100.000	100.0	1
KU	C1S	2040904	07/2013	06/27/2013	99.900	100.000	100.0	1
KU	C1S	2040905	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040906	07/2013	06/27/2013	99.900	100.100	100.1	1
KU	C1S	2040907	07/2013	06/27/2013	99.900	100.100	100.0	1
KU	C1S	2040908	07/2013	06/27/2013	99.900	100.100	100.0	1
KU	C1S	2040909	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040910	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040911	07/2013	06/27/2013	100.000	100.200	100.0	1
KU	C1S	2040912	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040913	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040914	07/2013	06/27/2013	100.000	100.200	100.1	1
KU	C1S	2040915	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040916	07/2013	06/27/2013	100.000	100.100	99.9	1
KU	C1S	2040917	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2040918	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040919	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040920	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040921	07/2013	06/27/2013	100.000	100.200	100.1	1
KU	C1S	2040922	07/2013	06/27/2013	100.000	100.100	99.9	1
KU	C1S	2040923	07/2013	06/27/2013	100.000	100.100	100.1	1



KU	C1S	2040924	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2040925	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040926	07/2013	06/27/2013	100.000	100.000	99.9	1
KU	C1S	2040927	07/2013	06/27/2013	100.000	100.200	100.0	1
KU	C1S	2040928	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040929	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040930	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040931	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2040932	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040933	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040934	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040935	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2040936	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040937	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040938	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040939	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040940	07/2013	06/27/2013	100.000	100.000	100.1	1
KU	C1S	2040941	07/2013	06/27/2013	100.000	100.100	99.9	1
KU	C1S	2040942	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2040943	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040944	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040945	07/2013	06/27/2013	100.000	100.200	100.1	1
KU	C1S	2040946	07/2013	06/27/2013	99.900	100.100	100.0	1
KU	C1S	2040947	07/2013	06/27/2013	100.000	100.000	99.9	1
KU	C1S	2040948	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040949	07/2013	06/27/2013	99.900	100.100	100.0	1
KU	C1S	2040950	07/2013	06/27/2013	99.900	100.100	100.0	1
KU	C1S	2040951	07/2013	06/27/2013	99.900	100.000	100.0	1
KU	C1S	2040952	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040953	07/2013	06/27/2013	99.900	100.000	100.0	1

KU	C1S	2040954	07/2013	*	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040955	07/2013		06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040956	07/2013		06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040957	07/2013		06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040958	07/2013		06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040959	07/2013		06/27/2013	100.000	100.100	99.9	1
KU	C1S	2040960	07/2013		06/27/2013	100.000	100.200	100.1	1
KU	C1S	2040961	07/2013		06/27/2013	99.900	100.100	100.1	1
KU	C1S	2040962	07/2013		06/27/2013	100.000	100.000	100.1	1
KU	C1S	2040963	07/2013		06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040964	07/2013		06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040965	07/2013		06/27/2013	100.000	100.000	100.0	1
KU	C1S	2040966	07/2013		06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040967	07/2013		06/27/2013	99.900	100.000	99.9	1
KU	C1S	2040968	07/2013		06/27/2013	99.900	100.000	100.0	1
KU	C1S	2040969	07/2013		06/27/2013	100.000	100.000	100.0	1
KU	C1S	2040970	07/2013		06/27/2013	100.000	100.000	100.0	1
KU	C1S	2040971	07/2013		06/27/2013	100.000	100.000	100.0	1
KU	C1S	2040972	07/2013		06/27/2013	99.900	100.100	100.0	1
KU	C1S	2040973	07/2013		06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040974	07/2013		06/27/2013	100.000	100.100	99.9	1
KU	C1S	2040975	07/2013		06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040976	07/2013		06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040977	07/2013		06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040978	07/2013		06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040979	07/2013		06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040980	07/2013		06/27/2013	99.900	100.100	100.0	1
KU	C1S	2040981	07/2013		06/27/2013	99.900	100.100	100.0	1
KU	C1S	2040982	07/2013		06/27/2013	100.000	100.200	100.0	1
KU	C1S	2040983	07/2013		06/27/2013	100.000	100.000	100.0	1

KU	C1S	2040984	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2040985	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2040986	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040987	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040988	07/2013	06/27/2013	100.000	100.000	100.1	1
KU	C1S	2040989	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040990	07/2013	06/27/2013	99.900	100.100	100.0	1
KU	C1S	2040991	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040992	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2040993	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040994	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040995	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040996	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040997	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2040998	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2040999	07/2013	06/27/2013	100.000	100.200	100.1	1
KU	C1S	2041000	07/2013	06/26/2013	100.000	100.100	100.1	1
KU	C1S	2041001	07/2013	06/25/2013	100.000	100.100	100.0	1
KU	C1S	2041002	07/2013	06/27/2013	100.000	100.000	100.1	1
KU	C1S	2041003	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041004	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041005	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041006	07/2013	06/27/2013	99.900	100.100	100.0	1
KU	C1S	2041007	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041008	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041009	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041010	07/2013	06/27/2013	100.000	100.000	99.9	1
KU	C1S	2041011	07/2013	06/27/2013	100.000	100.100	99.9	1
KU	C1S	2041012	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041013	07/2013	06/27/2013	100.000	100.100	100.0	1



KU	C1S	2041014	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041015	07/2013	06/25/2013	100.000	100.000	100.0	1
KU	C1S	2041016	07/2013	06/26/2013	100.000	100.100	100.1	1
KU	C1S	2041017	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2041018	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041019	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2041020	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2041021	07/2013	06/27/2013	99.900	100.100	100.1	1
KU	C1S	2041022	07/2013	06/27/2013	100.000	100.200	100.0	1
KU	C1S	2041023	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041024	07/2013	06/27/2013	99.900	100.100	100.0	1
KU	C1S	2041025	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041026	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041027	07/2013	06/27/2013	100.000	100.000	100.1	1
KU	C1S	2041028	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041029	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2041030	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041031	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2041032	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2041033	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041034	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041035	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041036	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041037	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041038	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041039	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041040	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2041041	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041042	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2041043	07/2013	06/27/2013	100.000	100.200	100.1	1

KU	C1S	2041044	07/2013	06/27/2013	100.000	100.200	100.0	1
KU	C1S	2041045	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2041046	07/2013	06/27/2013	99.900	100.100	99.9	1
KU	C1S	2041047	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2041048	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2041049	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2041050	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2041051	07/2013	06/27/2013	100.000	100.200	100.0	1
KU	C1S	2041052	07/2013	06/27/2013	100.000	100.200	100.1	1
KU	C1S	2041053	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041054	07/2013	06/27/2013	100.000	100.000	100.1	1
KU	C1S	2041055	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2041056	07/2013	06/27/2013	100.000	100.000	100.1	1
KU	C1S	2041057	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2041058	07/2013	06/27/2013	99.900	100.000	100.0	1
KU	C1S	2041059	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2041060	07/2013	06/27/2013	100.000	100.200	100.0	1
KU	C1S	2041061	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2041062	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2041063	07/2013	06/27/2013	100.000	100.200	100.0	1
KU	C1S	2041064	07/2013	06/27/2013	99.900	100.100	100.0	1
KU	C1S	2041065	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041066	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041067	07/2013	06/27/2013	100.000	100.100	99.9	1
KU	C1S	2041068	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2041069	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2041070	07/2013	06/27/2013	100.000	100.100	99.9	1
KU	C1S	2041071	07/2013	06/27/2013	99.900	100.000	100.0	1
KU	C1S	2041072	07/2013	06/27/2013	100.000	100.200	100.0	1
KU	C1S	2041073	07/2013	06/27/2013	100.000	100.100	100.1	1

KU	C1S	2041074	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041075	07/2013	06/27/2013	100.000	100.100	99.9	1
KU	C1S	2041076	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2041077	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2041078	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2041079	07/2013	06/26/2013	100.000	100.100	100.1	1
KU	C1S	2041080	07/2013	06/26/2013	100.000	100.100	100.0	1
KU	C1S	2041081	07/2013	06/27/2013	99.900	100.100	99.9	1
KU	C1S	2041082	07/2013	06/27/2013	100.000	100.200	100.1	1
KU	C1S	2041083	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041084	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041085	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2041086	07/2013	06/27/2013	99.900	100.100	99.9	1
KU	C1S	2041087	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041088	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2041089	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2041090	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041091	07/2013	06/27/2013	99.900	100.100	100.0	1
KU	C1S	2041092	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2041093	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2041094	07/2013	06/27/2013	100.000	100.200	100.1	1
KU	C1S	2041095	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041096	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041097	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2041098	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2041099	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041100	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2041101	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041102	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2041103	07/2013	06/27/2013	100.000	100.100	100.0	1



KU	C1S	2041104	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041105	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041106	07/2013	06/27/2013	100.000	100.200	100.0	1
KU	C1S	2041107	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041108	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2041109	07/2013	06/27/2013	100.000	100.200	100.0	1
KU	C1S	2041110	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2041111	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041112	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041113	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041114	07/2013	06/27/2013	99.900	100.000	100.0	1
KU	C1S	2041115	07/2013	06/27/2013	100.000	100.100	99.9	1
KU	C1S	2041116	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041117	07/2013	06/27/2013	100.000	100.200	100.1	1
KU	C1S	2041118	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041119	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2041120	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041121	07/2013	06/27/2013	99.900	100.100	100.0	1
KU	C1S	2041122	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041123	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2041124	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2041125	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041126	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2041127	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041128	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2041129	07/2013	06/27/2013	100.000	100.200	100.0	1
KU	C1S	2041130	07/2013	06/27/2013	100.000	100.200	100.0	1
KU	C1S	2041131	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041132	07/2013	06/27/2013	99.900	100.100	100.0	1
KU	C1S	2041133	07/2013	06/27/2013	99.900	100.000	100.1	1

KU	C1S	2041134	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041135	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041136	07/2013	06/27/2013	99.900	100.000	100.0	1
KU	C1S	2041137	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2041138	07/2013	06/27/2013	100.000	100.200	100.0	1
KU	C1S	2041139	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2041140	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041141	07/2013	06/27/2013	100.000	100.200	100.0	1
KU	C1S	2041142	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041143	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2041144	07/2013	06/27/2013	100.000	100.200	100.0	1
KU	C1S	2041145	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2041146	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2041147	07/2013	06/27/2013	99.900	100.100	100.1	1
KU	C1S	2041148	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2041149	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041150	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2041151	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041152	07/2013	06/27/2013	100.000	100.200	100.1	1
KU	C1S	2041153	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041154	07/2013	06/27/2013	99.900	100.100	99.9	1
KU	C1S	2041155	07/2013	06/27/2013	100.000	100.200	100.0	1
KU	C1S	2041156	07/2013	06/27/2013	99.900	100.100	100.0	1
KU	C1S	2041157	07/2013	06/27/2013	100.000	100.100	99.9	1
KU	C1S	2041158	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041159	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041160	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2041161	07/2013	06/27/2013	100.000	100.100	99.9	1
KU	C1S	2041162	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041163	07/2013	06/27/2013	100.000	100.000	100.0	1

KU	C1S	2041164	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2041165	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041166	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041167	07/2013	06/27/2013	99.900	100.100	99.9	1
KU	C1S	2041168	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041169	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2041170	07/2013	06/27/2013	99.900	100.100	100.0	1
KU	C1S	2041171	07/2013	06/27/2013	100.000	100.000	100.1	1
KU	C1S	2041172	07/2013	06/27/2013	99.900	100.100	100.0	1
KU	C1S	2041173	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2041174	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041175	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2041176	07/2013	06/27/2013	100.000	100.100	99.9	1
KU	C1S	2041177	07/2013	06/27/2013	100.000	100.000	100.1	1
KU	C1S	2041178	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2041179	07/2013	06/27/2013	99.900	100.100	99.9	1
KU	C1S	2041180	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041181	07/2013	06/27/2013	100.000	100.000	100.1	1
KU	C1S	2041182	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2041183	07/2013	06/27/2013	100.000	100.100	99.9	1
KU	C1S	2041184	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041185	07/2013	06/27/2013	99.900	100.100	100.0	1
KU	C1S	2041186	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041187	07/2013	06/27/2013	99.900	100.000	100.0	1
KU	C1S	2041188	07/2013	06/27/2013	99.900	100.100	100.0	1
KU	C1S	2041189	07/2013	06/27/2013	100.000	100.000	99.8	1
KU	C1S	2041190	07/2013	06/27/2013	99.900	100.100	100.0	1
KU	C1S	2041191	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041192	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2041193	07/2013	06/27/2013	100.000	100.100	100.0	1



KU	C1S	2041194	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041195	07/2013	06/27/2013	99.900	100.100	100.2	1
KU	C1S	2041196	07/2013	06/27/2013	100.000	100.000	99.9	1
KU	C1S	2041197	07/2013	06/27/2013	99.900	100.000	100.0	1
KU	C1S	2041198	07/2013	06/27/2013	100.000	100.100	99.9	1
KU	C1S	2041199	07/2013	06/27/2013	99.900	100.000	100.0	1
KU	C1S	2041200	07/2013	06/27/2013	100.000	100.200	100.1	1
KU	C1S	2041201	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2041202	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041203	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041204	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2041205	07/2013	06/27/2013	99.900	100.100	99.9	1
KU	C1S	2041206	07/2013	06/27/2013	100.000	100.100	99.9	1
KU	C1S	2041207	07/2013	06/27/2013	100.000	100.000	100.1	1
KU	C1S	2041208	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2041209	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041210	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041211	07/2013	06/27/2013	100.000	100.200	100.0	1
KU	C1S	2041212	07/2013	06/27/2013	100.000	100.200	100.0	1
KU	C1S	2041213	07/2013	06/27/2013	100.000	100.200	100.0	1
KU	C1S	2041214	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041215	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041216	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041217	07/2013	06/27/2013	99.900	100.100	100.0	1
KU	C1S	2041218	07/2013	06/27/2013	100.000	100.200	100.0	1
KU	C1S	2041219	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2041220	07/2013	06/27/2013	100.000	100.100	100.2	1
KU	C1S	2041221	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2041222	07/2013	06/27/2013	100.000	100.200	100.1	1
KU	C1S	2041223	07/2013	06/27/2013	100.000	100.000	100.0	1

KU	C1S	2041224	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041225	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041226	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2041227	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041228	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2041229	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041230	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2041231	07/2013	06/27/2013	99.900	100.100	100.0	1
KU	C1S	2041232	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041233	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041234	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041235	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041236	07/2013	06/27/2013	100.000	100.100	99.9	1
KU	C1S	2041237	07/2013	06/27/2013	99.900	100.000	100.0	1
KU	C1S	2041238	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041239	07/2013	06/27/2013	99.900	100.000	100.0	1
KU	C1S	2041240	07/2013	06/27/2013	100.000	100.000	99.9	1
KU	C1S	2041241	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041242	07/2013	06/27/2013	100.000	100.200	100.1	1
KU	C1S	2041243	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041244	07/2013	06/27/2013	100.000	100.200	100.0	1
KU	C1S	2041245	07/2013	06/27/2013	100.000	100.200	100.1	1
KU	C1S	2041246	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2041247	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2041248	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041249	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2041250	07/2013	06/27/2013	100.000	100.000	100.1	1
KU	C1S	2041251	07/2013	06/27/2013	100.000	100.100	99.9	1
KU	C1S	2041252	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041253	07/2013	06/27/2013	100.000	100.100	100.0	1

KU	C1S	2041254	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2041255	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2041256	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2041257	07/2013	06/27/2013	100.000	100.100	99.9	1
KU	C1S	2041258	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2041259	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2041260	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041261	07/2013	06/27/2013	100.000	100.200	100.0	1
KU	C1S	2041262	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2041263	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2041264	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041265	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041266	07/2013	06/27/2013	100.000	100.100	99.9	1
KU	C1S	2041267	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041268	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041269	07/2013	06/27/2013	99.900	100.100	100.1	1
KU	C1S	2041270	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041271	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041272	07/2013	06/27/2013	100.000	100.200	100.1	1
KU	C1S	2041273	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2041274	07/2013	06/27/2013	100.000	100.200	100.0	1
KU	C1S	2041275	07/2013	06/27/2013	100.000	99.900	100.0	1
KU	C1S	2041276	07/2013	06/27/2013	100.000	100.000	100.1	1
KU	C1S	2041277	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041278	07/2013	06/27/2013	99.900	100.000	100.1	1
KU	C1S	2041279	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2041280	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041281	07/2013	06/27/2013	100.000	100.200	100.0	1
KU	G1S	2041282	07/2013	06/27/2013	100.000	100.200	99.9	1
KU	C1S	2041283	07/2013	06/27/2013	100.000	100.100	100.1	1



KU	C1S	2041284	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041285	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041286	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041287	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2041288	07/2013	06/27/2013	100.000	100.000	100.1	1
KU	C1S	2041289	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041290	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041291	07/13	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041292	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041293	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041294	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041295	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041296	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2041297	07/2013	06/27/2013	100.000	100.200	100.1	1
KU	C1S	2041298	07/2013	06/27/2013	99.900	100.100	100.0	1
KU	C1S	2041299	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041300	07/2013	06/27/2013	100.000	100.200	100.0	1
KU	C1S	2041301	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041302	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041303	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2041304	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041305	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2041306	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2041307	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041308	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041309	07/2013	06/27/2013	100.000	100.100	99.9	1
KU	C1S	2041310	07/2013	06/27/2013	100.000	100.100	99.9	1
KU	C1S	2041311	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2041312	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2041313	07/2013	06/27/2013	100.000	100.100	100.0	1

KU	C1S	2041314	07/2013	06/27/2013	100.000	100.200	100.0	1
KU	C1S	2041315	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2041316	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041317	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041318	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2041319	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2041320	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2041321	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041322	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2041323	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2041324	07/2013	06/27/2013	99.900	100.100	100.0	1
KU	C1S	2041325	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2041326	07/2013	06/27/2013	99.900	100.100	100.0	1
KU	C1S	2041327	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041328	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2041329	07/2013	06/27/2013	99.900	100.000	99.9	1
KU	C1S	2041330	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2041331	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2041332	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041333	07/2013	06/27/2013	100.000	100.000	99.9	1
KU	C1S	2041334	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2041335	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2041336	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041337	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2041338	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041339	07/2013	06/27/2013	100.000	100.000	100.1	1
KU	C1S	2041340	07/2013	06/27/2013	99.900	100.100	100.1	1
KU	C1S	2041341	07/2013	06/27/2013	100.000	100.000	100.1	1
KU	C1S	2041342	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041343	07/2013	06/27/2013	100.000	100.100	100.0	1

KU	C1S	2041344	07/2013	06/27/2013	99.900	100.100	100.0	1
KU	C1S	2041345	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041346	07/2013	06/27/2013	100.000	100.100	99.9	1
KU	C1S	2041347	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041348	07/2013	06/27/2013	100.000	100.000	100.1	1
KU	C1S	2041349	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041350	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041351	07/2013	06/27/2013	100.000	100.200	100.1	1
KU	C1S	2041352	07/2013	06/27/2013	99.900	100.000	100.0	1
KU	C1S	2041353	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041354	07/2013	06/27/2013	100.000	100.000	100.1	1
KU	C1S	2041355	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2041356	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2041357	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041358	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041359	07/2013	06/27/2013	99.900	100.000	100.0	1
KU	C1S	2041360	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041361	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2041362	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2041363	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2041364	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041365	07/2013	06/27/2013	99.900	100.100	100.1	1
KU	C1S	2041366	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041367	07/2013	06/27/2013	100.000	100.000	99.9	1
KU	C1S	2041368	07/2013	06/27/2013	99.900	100.000	100.0	1
KU	C1S	2041369	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2041370	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041371	07/2013	06/27/2013	100.000	100.200	100.0	1
KU	C1S	2041372	07/2013	06/27/2013	99.900	100.100	100.0	1
KU	C1S	2041373	07/2013	06/27/2013	100.000	100.100	100.0	1



KU	C1S	2041374	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2041375	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2041376	07/2013	06/27/2013	99.900	100.100	99.9	1
KU	C1S	2041377	07/2013	06/27/2013	100.000	100.100	99.9	1
KU	C1S	2041378	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2041379	07/2013	06/27/2013	100.000	100.200	100.1	1
KU	C1S	2041380	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041381	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041382	07/2013	06/27/2013	100.000	100.200	100.1	1
KU	C1S	2041383	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2041384	07/2013	06/27/2013	100.000	100.200	100.1	1
KU	C1S	2041385	07/2013	06/27/2013	99.900	100.100	100.0	1
KU	C1S	2041386	07/2013	06/27/2013	100.000	100.200	100.0	1
KU	C1S	2041387	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041388	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041389	07/2013	06/27/2013	100.000	100.200	100.0	1
KU	C1S	2041390	07/2013	06/27/2013	100.000	100.200	100.1	1
KU	C1S	2041391	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041392	07/2013	06/27/2013	99.900	100.100	100.0	1
KU	C1S	2041393	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2041394	07/2013	06/27/2013	100.000	100.100	99.9	1
KU	C1S	2041395	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2041396	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2041397	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2041398	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041399	07/2013	06/27/2013	100.000	100.200	100.0	1
KU	C1S	2041400	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041401	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041402	07/2013	06/27/2013	99.900	100.100	100.1	1
KU	C1S	2041403	07/2013	06/27/2013	100.000	100.100	100.0	1

KU	C1S	2041404	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2041405	07/2013	06/27/2013	99.900	100.000	100.0	1
KU	C1S	2041406	07/2013	06/27/2013	99.900	100.100	100.1	1
KU	C1S	2041407	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041408	07/2013	06/27/2013	100.000	100.000	100.1	1
KU	C1S	2041409	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041410	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041411	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2041412	07/2013	06/27/2013	99.900	100.100	99.9	1
KU	C1S	2041413	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041414	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041415	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041416	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041417	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041418	07/2013	06/27/2013	99.900	100.000	100.0	1
KU	C1S	2041419	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041420	07/2013	06/27/2013	99.900	100.100	100.0	1
KU	C1S	2041421	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2041422	07/2013	06/27/2013	100.000	100.200	100.1	1
KU	C1S	2041423	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041424	07/2013	06/27/2013	100.000	100.200	100.0	1
KU	C1S	2041425	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041426	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2041427	07/2013	06/27/2013	99.900	100.100	100.1	1
KU	C1S	2041428	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2041429	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2041430	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041431	07/2013	06/27/2013	100.000	100.000	100.1	1
KU	C1S	2041432	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2041433	07/2013	06/27/2013	100.000	100.000	99.9	1

KU	C1S	2041434	07/2013	06/27/2013	99.900	100.000	99.9	1
KU	C1S	2041435	07/2013	06/27/2013	100.000	100.200	100.1	1
KU	C1S	2041436	07/2013	06/27/2013	100.000	100.200	100.1	1
KU	C1S	2041437	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041438	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041439	07/2013	06/27/2013	100.000	100.200	100.0	1
KU	C1S	2041440	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041441	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2041442	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041443	07/2013	06/27/2013	99.900	100.100	100.0	1
KU	C1S	2041444	07/2013	06/27/2013	99.900	100.100	100.0	1
KU	C1S	2041445	07/2013	06/27/2013	100.000	100.100	99.9	1
KU	C1S	2041446	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2041447	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041448	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041449	07/2013	06/27/2013	100.000	100.200	100.0	1
KU	C1S	2041450	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2041451	07/2013	06/27/2013	99.900	100.000	100.1	1
KU	C1S	2041452	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041453	07/2013	06/27/2013	99.900	100.100	100.0	1
KU	C1S	2041454	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2041455	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041456	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041457	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041458	07/2013	06/27/2013	100.000	100.200	100.1	1
KU	C1S	2041459	07/2013	06/27/2013	100.000	100.200	100.0	1
KU	C1S	2041460	07/2013	06/27/2013	100.000	100.000	100.1	1
KU	C1S	2041461	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2041462	07/2013	06/27/2013	99.900	100.100	100.0	1
KU	C1S	2041463	07/2013	06/27/2013	100.000	100.100	100.2	1



KU	C1S	2041464	07/2013	06/27/2013	100.000	100.000	100.1	1
KU	C1S	2041465	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2041466	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041467	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041468	07/2013	06/27/2013	100.000	100.200	100.0	1
KU	C1S	2041469	07/2013	06/27/2013	100.000	100.200	100.0	1
KU	C1S	2041470	07/2013	06/27/2013	100.000	100.100	99.9	1
KU	C1S	2041471	07/2013	06/27/2013	100.000	100.200	100.1	1
KU	C1S	2041472	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2041473	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041474	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041475	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2041476	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041477	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041478	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2041479	07/2013	06/27/2013	100.000	100.000	100.1	1
KU	C1S	2041480	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041481	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041482	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2041483	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041484	07/2013	06/27/2013	100.000	100.200	100.0	1
KU	C1S	2041485	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2041486	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2041487	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2041488	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2041489	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2041490	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041491	07/2013	06/27/2013	100.000	100.000	100.1	1
KU	C1S	2041492	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041493	07/2013	06/27/2013	100.000	100.000	100.1	1

KU	C1S	2041494	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2041495	07/2013	06/27/2013	99.900	100.000	100.0	1
KU	C1S	2041496	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041497	07/2013	06/27/2013	99.900	100.200	100.0	1
KU	C1S	2041498	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2041499	07/2013	06/27/2013	100.000	100.100	99.9	1
KU	C1S	2041500	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2041501	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041502	07/2013	06/27/2013	100.000	100.200	100.0	1
KU	C1S	2041503	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041504	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2041505	07/2013	06/27/2013	99.900	100.100	99.9	1
KU	C1S	2041506	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041507	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2041508	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2041509	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041510	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041511	07/2013	06/27/2013	100.000	100.200	100.1	1
KU	C1S	2041512	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041513	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041514	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041515	07/2013	06/27/2013	99.900	100.100	100.0	1
KU	C1S	2041516	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041517	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041518	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2041519	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041520	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041521	07/2013	06/27/2013	100.000	100.200	100.0	1
KU	C1S	2041522	07/2013	06/27/2013	100.000	100.200	100.1	1
KU	C1S	2041523	07/2013	06/27/2013	99.900	100.000	100.0	1

KU	C1S	2041524	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041525	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041526	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2041527	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041528	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2041529	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2041530	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041531	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041532	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041533	07/2013	06/27/2013	100.000	100.200	100.0	1
KU	C1S	2041534	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2041535	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041536	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041537	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2041538	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041539	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041540	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2041541	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2041542	07/2013	06/27/2013	99.900	100.200	100.1	1
KU	C1S	2041543	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2041544	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2041545	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2041546	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041547	07/2013	06/27/2013	100.000	100.200	100.0	1
KU	C1S	2041548	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041549	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041550	07/2013	06/27/2013	100.000	100.200	100.0	1
KU	C1S	2041551	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2041552	07/2013	06/27/2013	100.000	100.000	100.1	1
KU	C1S	2041553	07/2013	06/27/2013	100.000	100.100	100.1	1



KU	C1S	2041554	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041555	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2041556	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2041557	07/2013	06/27/2013	99.900	100.000	100.0	1
KU	C1S	2041558	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2041559	07/2013	06/27/2013	99.900	100.100	100.0	1
KU	C1S	2041560	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2041561	07/2013	06/27/2013	100.000	100.200	100.0	1
KU	C1S	2041562	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041563	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2041564	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041565	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041566	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2041567	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041568	07/2013	06/27/2013	99.900	100.100	100.0	1
KU	C1S	2041569	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2041570	07/2013	06/27/2013	100.000	100.200	100.0	1
KU	C1S	2041571	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041572	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2041573	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041574	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041575	07/2013	06/27/2013	100.000	100.000	100.1	1
KU	C1S	2041576	07/2013	06/27/2013	100.000	100.000	99.9	1
KU	C1S	2041577	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2041578	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041579	07/2013	06/27/2013	100.000	100.100	99.9	1
KU	C1S	2041580	07/2013	06/27/2013	100.000	100.000	100.1	1
KU	C1S	2041581	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2041582	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2041583	07/2013	06/27/2013	100.000	100.100	100.0	1

KU	C1S	2041584	07/2013	06/27/2013	100.000	100.200	100.1	1
KU	C1S	2041585	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041586	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041587	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041588	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041589	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2041590	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2041591	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2041592	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041593	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2041594	07/2013	06/27/2013	99.900	100.000	100.0	1
KU	C1S	2041595	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041596	07/2013	06/27/2013	99.900	100.000	100.1	1
KU	C1S	2041597	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041598	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041599	07/2013	06/27/2013	99.900	100.100	99.9	1
KU	C1S	2041600	07/2013	06/27/2013	100.000	100.100	99.9	1
KU	C1S	2041601	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2041602	07/2013	06/27/2013	100.000	100.000	100.1	1
KU	C1S	2041603	07/2013	06/27/2013	100.000	100.000	100.1	1
KU	C1S	2041604	07/2013	06/27/2013	99.900	100.100	100.0	1
KU	C1S	2041605	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2041606	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041607	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041608	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041609	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041610	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041611	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2041612	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041613	07/2013	06/27/2013	100.000	100.100	100.0	1

KU	C1S	2041614	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041615	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2041616	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041617	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041618	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2041619	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041620	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041621	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041622	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041623	07/2013	06/27/2013	99.900	100.000	100.0	1
KU	C1S	2041624	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041625	07/2013	06/27/2013	99.900	100.100	99.9	1
KU	C1S	2041626	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041627	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041628	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041629	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2041630	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041631	07/2013	06/27/2013	100.000	100.000	100.1	1
KU	C1S	2041632	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2041633	07/2013	06/27/2013	100.000	100.200	100.1	1
KU	C1S	2041634	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041635	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041636	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2041637	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2041638	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041639	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041640	07/2013	06/27/2013	99.900	100.100	100.0	1
KU	C1S	2041641	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041642	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2041643	07/2013	06/27/2013	100.000	100.100	100.1	1



KU	C1S	2041644	07/2013	06/27/2013	100.000	100.000	100.1	1
KU	C1S	2041645	07/2013	06/27/2013	100.000	100.200	100.1	1
KU	C1S	2041646	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2041647	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041648	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2041649	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2041650	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041651	07/2013	06/27/2013	99.900	100.100	100.1	1
KU	C1S	2041652	07/2013	06/27/2013	100.000	100.000	100.1	1
KU	C1S	2041653	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041654	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041655	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041656	07/2013	06/27/2013	100.000	100.200	100.0	1
KU	C1S	2041657	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041658	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041659	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041660	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2041661	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2041662	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2041663	07/2013	06/27/2013	99.900	100.100	100.0	1
KU	C1S	2041664	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2041665	07/2013	06/27/2013	99.900	100.200	100.0	1
KU	C1S	2041666	07/2013	06/27/2013	99.900	100.100	100.1	1
KU	C1S	2041667	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041668	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041669	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2041670	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2041671	07/2013	06/27/2013	99.900	100.100	100.1	1
KU	C1S	2041672	07/2013	06/27/2013	100.000	100.000	100.1	1
KU	C1S	2041673	07/2013	06/27/2013	100.000	100.200	100.0	1

KU	C1S	2041674	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041675	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041676	07/2013	06/27/2013	100.000	100.100	99.9	1
KU	C1S	2041677	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2041678	07/2013	06/27/2013	100.000	100.000	99.9	1
KU	C1S	2041679	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041680	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2041681	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2041682	07/2013	06/27/2013	99.900	100.200	100.1	1
KU	C1S	2041683	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041684	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2041685	07/2013	06/27/2013	100.000	100.100	99.9	1
KU	C1S	2041686	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2041687	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041688	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041689	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2041690	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041691	07/2013	06/27/2013	99.900	100.100	100.0	1
KU	C1S	2041692	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041693	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2041694	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041695	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041696	07/2013	06/27/2013	99.900	100.100	100.0	1
KU	C1S	2041697	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041698	07/2013	06/27/2013	99.900	100.000	99.9	1
KU	C1S	2041699	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2041700	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2041701	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2041702	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041703	07/2013	06/27/2013	100.000	100.100	100.0	1

KU	C1S	2041704	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2041705	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041706	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2041707	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041708	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2041709	07/2013	06/27/2013	100.000	100.100	100.1	1
KU	C1S	2041710	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2041711	07/2013	06/27/2013	100.000	100.200	100.0	1
KU	C1S	2041712	07/2013	06/27/2013	100.000	100.100	99.9	1
KU	C1S	2041713	07/2013	06/27/2013	100.000	100.200	100.0	1
KU	C1S	2041714	07/2013	06/27/2013	100.000	100.000	100.0	1
KU	C1S	2041715	07/2013	06/27/2013	100.000	100.100	100.0	1
KU	C1S	2506213	06/2013	05/29/2013	100.000	100.100	100.0	1
KU	C1S	2506214	06/2013	05/29/2013	100.000	100.000	100.0	1
KU	C1S	2506215	06/2013	05/29/2013	100.000	100.100	99.9	1
KU	C1S	2506216	06/2013	05/29/2013	100.000	100.100	100.0	1
KU	C1S	2506217	06/2013	05/29/2013	100.000	100.000	99.9	1
KU	C1S	2506218	06/2013	05/29/2013	100.000	100.100	100.0	1
KU	C1S	2506219	06/2013	05/29/2013	99.900	100.100	100.0	1
KU	C1S	2506220	06/2013	05/29/2013	100.000	100.100	100.0	1
KU	C1S	2506221	06/2013	05/29/2013	100.000	100.200	100.1	1
KU	C1S	2506222	06/2013	05/29/2013	100.000	100.100	100.0	1
KU	C1S	2506223	06/2013	05/29/2013	100.000	100.100	100.0	1
KU	C1S	2506224	06/2013	05/29/2013	100.000	100.100	100.0	1
KU	C1S	2506225	06/2013	05/29/2013	100.000	100.100	99.9	1
KU	C1S	2506226	06/2013	05/29/2013	100.000	100.100	100.1	1
KU	C1S	2506227	06/2013	05/29/2013	100.000	100.100	100.0	1
KU	C1S	2506228	06/2013	05/29/2013	100.000	100.100	100.0	1
KU	C1S	2506229	06/2013	05/29/2013	100.000	100.100	100.1	1
KU	C1S	2506230	06/2013	05/29/2013	100.000	100.100	100.0	1



KU	C1S	2506231	06/2013	05/29/2013	100.000	100.000	99.9	1
KU	C1S	2506232	06/2013	05/29/2013	100.000	100.200	100.0	1
KU	C1S	2506233	06/2013	05/29/2013	100.000	100.000	100.0	1
KU	C1S	2506234	06/2013	05/29/2013	100.000	100.000	100.0	1
KU	C1S	2506235	06/2013	05/29/2013	100.000	100.100	100.1	1
KU	C1S	2506236	06/2013	05/28/2013	100.000	100.100	100.0	1
KU	C1S	2506237	06/2013	05/29/2013	100.000	100.200	100.1	1
KU	C1S	2506238	06/2013	05/29/2013	100.000	100.100	100.0	1
KU	C1S	2506239	06/2013	05/28/2013	100.000	100.200	100.1	1
KU	C1S	2506240	06/2013	05/29/2013	100.000	100.100	100.0	1
KU	C1S	2506241	06/2013	05/29/2013	100.000	100.000	100.0	1
KU	C1S	2506242	06/2013	05/28/2013	100.000	100.200	100.0	1
KU	C1S	2506243	06/2013	05/28/2013	100.000	100.100	100.1	1
KU	C1S	2506244	06/2013	05/29/2013	100.000	100.100	99.9	1
KU	C1S	2506245	06/2013	05/29/2013	100.000	100.100	100.0	1
KU	C1S	2506246	06/2013	05/28/2013	100.000	100.100	100.0	1
KU	C1S	2506247	06/2013	05/29/2013	100.000	100.000	100.1	1
KU	C1S	2506248	06/2013	05/28/2013	100.000	100.100	100.0	1
KU	C1S	2506249	06/2013	05/28/2013	100.000	100.100	100.0	1
KU	C1S	2506250	06/2013	05/29/2013	100.000	100.100	100.0	1
KU	C1S	2506251	06/2013	05/29/2013	100.000	100.100	99.9	1
KU	C1S	2506252	06/2013	05/29/2013	100.000	100.000	100.0	1
KU	C1S	2506253	06/2013	05/29/2013	99.900	100.000	100.1	1
KU	C1S	2506254	06/2013	05/29/2013	100.000	100.100	100.1	1
KU	C1S	2506255	06/2013	05/29/2013	100.000	100.100	100.1	1
KU	C1S	2506256	06/2013	05/28/2013	100.000	100.100	100.1	1
KU	C1S	2506257	06/2013	05/29/2013	100.000	100.100	100.1	1
KU	C1S	2506258	06/2013	05/29/2013	100.000	100.100	100.0	1
KU	C1S	2506259	06/2013	05/29/2013	100.000	100.100	99.9	1
KU	C1S	2506260	06/2013	05/29/2013	100.000	100.000	100.0	1

KU	C1S	2506261	06/2013	05/29/2013	100.000	100.100	100.0	1
KU	C1S	2506262	06/2013	05/29/2013	100.000	100.100	100.0	1
KU	C1S	2506263	06/2013	05/29/2013	100.000	100.100	100.0	1
KU	C1S	2506264	06/2013	05/29/2013	100.000	100.100	100.0	1
KU	C1S	2506265	06/2013	05/29/2013	100.000	100.100	100.0	1
KU	C1S	2506266	06/2013	05/29/2013	100.000	100.100	100.1	1
KU	C1S	2506267	06/2013	05/29/2013	100.000	100.000	100.0	1
KU	C1S	2506268	06/2013	05/29/2013	100.000	100.200	100.1	1
KU	C1S	2506269	06/2013	05/29/2013	100.000	100.100	100.0	1
KU	C1S	2506270	06/2013	05/29/2013	100.000	100.100	100.0	1
KU	C1S	2506271	06/2013	05/28/2013	100.000	100.200	100.1	1
KU	C1S	2506272	06/2013	05/29/2013	99.900	100.100	100.1	1
KU	C1S	2506273	06/2013	05/29/2013	100.000	100.100	100.1	1
KU	C1S	2506274	06/2013	05/28/2013	100.000	100.100	100.1	1
KU	C1S	2506275	06/2013	05/29/2013	100.000	100.100	100.0	1
KU	C1S	2506276	06/2013	05/29/2013	100.000	100.100	99.9	1
KU	C1S	2506277	06/2013	05/28/2013	100.000	100.100	100.1	1
KU	C1S	2506278	06/2013	05/29/2013	100.000	100.100	100.0	1
KU	C1S	2506279	06/2013	05/29/2013	100.000	100.200	100.0	1
KU	C1S	2506280	06/2013	05/29/2013	100.000	100.100	100.0	1
KU	C1S	2506281	06/2013	05/29/2013	99.900	100.100	100.0	1
KU	C1S	2506282	06/2013	05/29/2013	100.000	100.100	100.1	1
KU	C1S	2506283	06/2013	05/29/2013	100.000	100.100	99.9	1
KU	C1S	2506284	06/2013	05/29/2013	100.000	100.100	100.0	1
KU	C1S	2506285	06/2013	05/29/2013	100.000	100.100	100.1	1
KU	C1S	2506286	06/2013	05/29/2013	100.000	100.100	99.9	1
KU	C1S	2506287	06/2013	05/29/2013	99.900	100.100	100.0	1
KU	C1S	2506288	06/2013	05/29/2013	99.900	100.100	100.1	1
KU	C1S	2506289	06/2013	05/29/2013	100.000	100.100	100.1	1
KU	C1S	2506290	06/2013	05/29/2013	100.000	100.100	100.0	1

KU	C1S	2506291	06/2013	05/29/2013	100.000	100.100	100.0	1
KU	C1S	2506292	06/2013	05/29/2013	100.000	100.100	100.0	1
KU	C1S	2506293	06/2013	05/29/2013	100.000	100.000	100.0	1
KU	C1S	2506294	06/2013	05/29/2013	100.000	100.100	100.0	1
KU	C1S	2506295	06/2013	05/29/2013	100.000	100.100	100.1	1
KU	C1S	2506296	06/2013	05/29/2013	100.000	100.100	100.1	1
KU	C1S	2506297	06/2013	05/29/2013	100.000	100.000	100.1	1
KU	C1S	2506298	06/2013	05/29/2013	100.000	100.100	100.0	1
KU	C1S	2506299	06/2013	05/29/2013	100.000	100.200	100.0	1
KU	C1S	2506300	06/2013	05/29/2013	100.000	100.100	100.1	1
KU	C1S	2506301	06/2013	05/29/2013	99.900	100.000	100.0	1
KU	C1S	2506302	06/2013	05/29/2013	100.000	100.100	100.1	1
KU	C1S	2506303	06/2013	05/29/2013	100.000	100.000	100.0	1
KU	C1S	2506304	06/2013	05/29/2013	100.000	100.100	100.0	1
KU	C1S	2506305	06/2013	05/29/2013	100.000	100.100	100.1	1
KU	C1S	2506306	06/2013	05/29/2013	100.000	100.100	100.0	1
KU	C1S	2506307	06/2013	05/29/2013	100.000	100.200	100.1	1
KU	C1S	2506308	06/2013	05/29/2013	100.000	100.100	100.1	1
KU	C1S	2506309	06/2013	05/29/2013	100.000	100.100	100.1	1
KU	C1S	2506310	06/2013	05/29/2013	100.000	100.200	100.0	1
KU	C1S	2506311	06/2013	05/29/2013	100.000	100.200	100.1	1
KU	C1S	2506312	06/2013	05/29/2013	100.000	100.100	100.0	1
KU	C1S	2506313	06/2013	05/29/2013	100.000	100.200	100.1	1
KU	C1S	2506314	06/2013	05/29/2013	100.000	100.000	100.0	1
KU	C1S	2506315	06/2013	05/29/2013	100.000	100.100	100.1	1
KU	C1S	2506316	06/2013	05/29/2013	100.000	100.100	100.1	1
KU	C1S	2506317	06/2013	05/29/2013	100.000	100.000	100.1	1
KU	C1S	2506318	06/2013	05/29/2013	100.000	100.100	100.1	1
KU	C1S	2506319	06/2013	05/29/2013	100.000	100.100	99.9	1
KU	C1S	2506320	06/2013	05/29/2013	100.000	100.100	100.0	1



KU	C1S	2506321	06/2013	05/29/2013	100.000	100.100	100.0	1
KU	C1S	2506322	06/2013	05/29/2013	100.000	100.000	100.0	1
KU	C1S	2506323	06/2013	05/29/2013	100.000	100.000	100.0	1
KU	C1S	2506324	06/2013	05/29/2013	100.000	100.100	100.0	1
KU	C1S	2506325	06/2013	05/29/2013	100.000	100.200	100.1	1
KU	C1S	2506326	06/2013	05/29/2013	100.000	100.100	100.1	1
KU	C1S	2506327	06/2013	05/29/2013	100.000	100.100	100.1	1
KU	C1S	2506328	06/2013	05/29/2013	100.000	100.100	100.0	1
KU	C1S	2506329	06/2013	05/29/2013	99.900	100.000	100.0	1
KU	C1S	2506330	06/2013	05/29/2013	100.000	100.100	100.0	1
KU	C1S	2506331	06/2013	05/29/2013	100.000	100.100	100.0	1
KU	C1S	2506332	06/2013	05/29/2013	100.000	100.100	100.0	1
KU	C1S	2506333	06/2013	05/29/2013	100.000	100.200	100.1	1
KU	C1S	2506334	06/2013	05/29/2013	99.900	100.200	100.0	1
KU	C1S	2506335	06/2013	05/29/2013	99.900	100.100	100.1	1
KU	C1S	2506336	06/2013	05/29/2013	100.000	100.200	100.0	1
KU	C1S	2506337	06/2013	05/29/2013	100.000	100.100	100.0	1
KU	C1S	2506338	06/2013	05/29/2013	100.000	100.100	100.0	1
KU	C1S	2506339	06/2013	05/29/2013	100.000	100.100	100.0	1
KU	C1S	2506340	06/2013	05/29/2013	100.000	100.100	100.0	1
KU	C1S	2506341	06/2013	05/29/2013	100.000	100.100	100.0	1
KU	C1S	2506342	06/2013	05/29/2013	100.000	100.100	100.0	1
KU	C1S	2506343	06/2013	05/29/2013	100.000	100.100	100.0	1
KU	C1S	2506344	06/2013	05/29/2013	100.000	100.000	100.0	1
KU	C1S	2506345	06/2013	05/29/2013	100.000	100.100	100.0	1
KU	C1S	2506346	06/2013	05/29/2013	100.000	100.100	100.0	1
KU	C1S	2506347	06/2013	05/29/2013	100.000	100.100	99.9	1
KU	C1S	2506348	06/2013	05/29/2013	100.000	100.100	99.9	1
KU	C1S	2506349	06/2013	05/29/2013	100.000	100.100	100.0	1
KU	C1S	2506350	06/2013	05/29/2013	100.000	100.100	100.0	1

KU	C1S	2506351	06/2013	05/29/2013	100.000	100.200	100.0	1
KU	C1S	2506352	06/2013	05/29/2013	100.000	100.100	100.1	1
KU	C1S	2506353	06/2013	05/29/2013	100.000	100.100	100.1	1
KU	C1S	2506354	06/2013	05/29/2013	100.000	100.100	99.9	1
KU	C1S	2506355	06/2013	05/29/2013	100.000	100.100	100.1	1
KU	C1S	2506356	06/2013	05/29/2013	100.000	100.200	100.0	1
KU	C1S	2506357	06/2013	05/29/2013	100.000	100.100	100.0	1
KU	C1S	2506358	06/2013	05/29/2013	99.900	100.100	100.0	1
KU	C1S	2506359	06/2013	05/29/2013	100.000	100.100	100.1	1
KU	C1S	2506360	06/2013	05/29/2013	100.000	100.000	100.0	1
KU	C1S	2506361	06/2013	05/29/2013	100.000	100.100	100.0	1
KU	C1S	2506362	06/2013	05/29/2013	100.000	100.100	100.0	1
KU	C1S	2506363	06/2013	05/29/2013	100.000	100.100	100.1	1
KU	C1S	2506364	06/2013	05/29/2013	100.000	100.200	100.0	1
KU	C1S	2506365	06/2013	05/29/2013	100.000	100.100	100.1	1
KU	C1S	2506366	06/2013	05/29/2013	99.900	100.100	100.0	1
KU	C1S	2506367	06/2013	05/29/2013	100.000	100.100	100.1	1
KU	C1S	2506368	06/2013	05/29/2013	100.000	100.100	100.0	1
KU	C1S	2506369	06/2013	05/29/2013	100.000	100.100	100.0	1
KU	C1S	2506370	06/2013	05/29/2013	99.900	100.100	100.0	1
KU	C1S	2506371	06/2013	05/29/2013	100.000	100.100	100.1	1
KU	C1S	2506372	06/2013	05/29/2013	100.000	100.100	100.0	1
KU	C1S	2506373	06/2013	05/29/2013	99.900	100.100	100.0	1
KU	C1S	2506374	06/2013	05/29/2013	100.000	100.100	100.1	1
KU	C1S	2506375	06/2013	05/29/2013	100.000	100.200	100.0	1
KU	C1S	2506376	06/2013	05/29/2013	100.000	100.000	100.0	1
KU	C1S	2506377	06/2013	05/29/2013	100.000	100.100	100.1	1
KU	C1S	2506378	06/2013	05/29/2013	100.000	100.100	100.0	1
KU	C1S	2506379	06/2013	05/29/2013	100.000	100.100	100.0	1
KU	C1S	2506380	06/2013	05/29/2013	100.000	100.100	100.0	1

KU	C1S	2506381	06/2013	05/29/2013	100.000	100.100	100.0	1
KU	C1S	2506382	06/2013	05/29/2013	100.000	100.100	100.0	1
KU	C1S	2506383	06/2013	05/29/2013	100.000	100.200	100.0	1
KU	C1S	2506384	06/2013	05/29/2013	99.900	100.100	100.0	1
KU	C1S	2506385	06/2013	05/29/2013	100.000	100.100	99.9	1
KU	C1S	2506386	06/2013	05/29/2013	100.000	100.100	100.1	1
KU	C1S	2506387	06/2013	05/29/2013	100.000	100.100	100.1	1
KU	C1S	2506388	06/2013	05/29/2013	100.000	100.100	100.0	1
KU	C1S	2506389	06/2013	05/29/2013	100.000	100.000	100.1	1
KU	C1S	2506390	06/2013	05/29/2013	100.000	100.200	100.0	1
KU	C1S	2506391	06/2013	05/29/2013	100.000	100.100	100.0	1
KU	C1S	2506392	06/2013	05/29/2013	99.900	100.100	99.9	1
KU	C1S	2506393	06/2013	05/29/2013	100.000	100.000	100.0	1
KU	C1S	2506394	06/2013	05/29/2013	100.000	100.100	100.1	1
KU	C1S	2506395	06/2013	05/29/2013	100.000	100.100	100.0	1
KU	C1S	2506396	06/2013	05/29/2013	100.000	100.100	100.1	1
KU	C1S	2506397	06/2013	05/29/2013	100.000	100.100	100.0	1
KU	C1S	2506398	06/2013	05/29/2013	100.000	100.100	100.2	1
KU	C1S	2506399	06/2013	05/29/2013	100.000	100.000	100.0	1
KU	C1S	2506400	06/2013	05/29/2013	100.000	100.000	100.0	1
KU	C1S	2506401	06/2013	05/29/2013	100.000	100.100	100.1	1
KU	C1S	2506402	06/2013	05/29/2013	100.000	100.000	100.1	1
KU	C1S	2506403	06/2013	05/29/2013	99.900	100.100	100.0	1
KU	C1S	2506404	06/2013	05/29/2013	100.000	100.000	100.1	1
KU	C1S	2506405	06/2013	05/29/2013	100.000	100.200	100.1	1
KU	C1S	2506406	06/2013	05/29/2013	99.900	100.000	100.1	1
KU	C1S	2506407	06/2013	05/29/2013	100.000	100.000	100.1	1
KU	C1S	2506408	06/2013	05/29/2013	100.000	100.100	100.1	1
KU	C1S	2506409	06/2013	05/29/2013	100.000	100.100	100.0	1
KU	C1S	2506410	06/2013	05/29/2013	100.000	100.100	100.1	1



KU	C1S	2506411	06/2013	05/29/2013	100.000	100.200	100.0	1
KU	C1S	2506412	06/2013	05/29/2013	100.000	100.100	100.0	1
KU	C1S	2506413	06/2013	05/29/2013	100.000	100.000	100.0	1
KU	C1S	2506414	06/2013	05/29/2013	100.000	100.100	100.0	1
KU	C1S	2506415	06/2013	05/29/2013	100.000	100.100	100.0	1
KU	C1S	2506416	06/2013	05/29/2013	100.000	100.100	100.0	1
KU	C1S	2506417	06/2013	05/29/2013	100.000	100.100	100.1	1
KU	C1S	2506418	06/2013	05/29/2013	100.000	100.100	100.1	1
KU	C1S	2506419	06/2013	05/29/2013	100.000	100.100	100.0	1
KU	C1S	2506420	06/2013	05/29/2013	99.900	100.100	99.9	1
KU	C1S	2506421	06/2013	05/29/2013	100.000	100.100	100.0	1
KU	C1S	2506422	06/2013	05/29/2013	100.000	100.100	100.1	1
KU	C1S	2506423	06/2013	05/29/2013	99.900	100.000	100.0	1
KU	C1S	2506424	06/2013	05/29/2013	100.000	100.100	100.1	1
KU	C1S	2506425	06/2013	05/29/2013	100.000	100.100	100.0	1
KU	C1S	2506426	06/2013	05/29/2013	99.900	100.100	100.0	1
KU	C1S	2506427	06/2013	05/29/2013	100.000	100.100	99.9	1
KU	C1S	2506428	06/2013	05/29/2013	100.000	100.100	100.0	1
KU	C1S	2506429	06/2013	05/29/2013	99.900	100.100	100.0	1
KU	C1S	2506430	06/2013	05/29/2013	100.000	100.100	100.1	1
KU	C1S	2506431	06/2013	05/29/2013	100.000	100.200	100.1	1
KU	C1S	2506432	06/2013	05/29/2013	100.000	100.100	100.1	1
KU	C1S	2506433	06/2013	05/29/2013	100.000	100.100	100.0	1
KU	C1S	2506434	06/2013	05/29/2013	100.000	100.100	100.0	1
KU	C1S	2506435	06/2013	05/29/2013	99.900	100.100	100.1	1
KU	C1S	2506436	06/2013	05/29/2013	100.000	100.000	100.0	1
KU	C1S	2506437	06/2013	05/29/2013	100.000	100.100	100.1	1
KU	C1S	2506438	06/2013	05/29/2013	100.000	100.000	100.0	1
KU	C1S	2506439	06/2013	05/29/2013	100.000	100.100	100.1	1
KU	C1S	2506440	06/2013	05/29/2013	100.000	100.100	100.1	1

KU	C1S	2506441	06/2013	05/29/2013	100.000	100.100	100.1	1
KU	C1S	2506442	06/2013	05/29/2013	100.000	100.000	99.9	1
KU	C1S	2506443	06/2013	05/29/2013	100.000	100.100	100.0	1
KU	C1S	2506444	06/2013	05/29/2013	100.000	100.100	100.1	1
KU	C1S	2506445	06/2013	05/29/2013	100.000	100.100	100.1	1
KU	C1S	2506446	06/2013	05/29/2013	99.900	100.100	100.0	1
KU	C1S	2506447	06/2013	05/29/2013	100.000	100.100	100.1	1
KU	C1S	2506448	06/2013	05/29/2013	99.900	100.100	100.0	1
KU	C1S	2506449	06/2013	05/29/2013	100.000	100.100	100.0	1
KU	C1S	2506450	06/2013	05/29/2013	100.000	100.100	100.0	1
KU	C1S	2506451	06/2013	05/29/2013	100.000	100.200	100.0	1
KU	C1S	2506452	06/2013	05/29/2013	100.000	100.100	100.1	1
KU	C1SR	2506453	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506454	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506455	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506456	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2506457	08/2013	08/05/2013	99.900	100.000	100.1	1
KU	C1SR	2506458	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506459	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2506460	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2506461	08/2013	08/05/2013	100.000	100.200	100.1	1
KU	C1SR	2506462	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506463	08/2013	08/05/2013	99.900	100.100	100.1	1
KU	C1SR	2506464	08/2013	08/05/2013	100.000	100.200	100.0	1
KU	C1SR	2506465	08/2013	08/05/2013	100.000	100.200	100.1	1
KU	C1SR	2506466	08/2013	08/05/2013	100.000	100.200	100.1	1
KU	C1SR	2506467	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2506468	08/2013	08/05/2013	100.000	100.000	99.9	1
KU	C1SR	2506469	08/2013	08/05/2013	100.000	100.200	100.0	1
KU	C1SR	2506470	08/2013	08/05/2013	100.000	100.100	100.1	1

KU	C1SR	2506471	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2506472	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506473	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2506474	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2506475	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506476	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506477	08/2013	08/05/2013	100.000	100.200	100.0	1
KU	C1SR	2506478	08/2013	08/05/2013	100.000	100.000	99.9	1
KU	C1SR	2506479	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2506480	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2506481	08/2013	08/05/2013	100.000	100.200	100.0	1
KU	C1SR	2506482	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506483	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506484	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2506485	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2506486	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506487	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2506488	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506489	08/2013	08/05/2013	100.000	100.000	100.1	1
KU	C1SR	2506490	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506491	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506492	08/2013	08/05/2013	100.000	100.200	100.1	1
KU	C1SR	2506493	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506494	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2506495	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2506496	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506497	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2506498	08/2013	08/05/2013	100.000	100.200	100.0	1
KU	C1SR	2506499	08/2013	08/05/2013	100.000	100.200	100.1	1
KU	C1SR	2506500	08/2013	08/05/2013	100.000	100.200	100.0	1



KU	C1SR	2506501	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506502	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506503	08/2013	08/05/2013	100.000	100.200	100.0	1
KU	C1SR	2506504	08/2013	08/05/2013	99.900	100.100	100.0	1
KU	C1SR	2506505	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2506506	08/2013	08/05/2013	100.000	100.000	100.1	1
KU	C1SR	2506507	08/2013	08/05/2013	100.000	100.200	99.9	1
KU	C1SR	2506508	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506509	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2506510	08/2013	08/05/2013	99.900	100.100	100.0	1
KU	C1SR	2506511	08/2013	08/05/2013	100.000	100.100	100.2	1
KU	C1SR	2506512	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2506513	08/2013	08/05/2013	100.000	100.200	100.2	1
KU	C1SR	2506514	08/2013	08/05/2013	100.000	100.200	100.0	1
KU	C1SR	2506515	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2506516	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2506517	08/2013	08/05/2013	99.900	100.100	99.9	1
KU	C1SR	2506518	08/2013	08/05/2013	100.000	100.200	100.0	1
KU	C1SR	2506519	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2506520	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506521	08/2013	08/05/2013	99.900	100.000	100.0	1
KU	C1SR	2506522	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506523	08/2013	08/05/2013	100.000	100.200	100.1	1
KU	C1SR	2506524	08/2013	08/05/2013	100.000	100.200	99.9	1
KU	C1SR	2506525	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2506526	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2506527	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506528	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506529	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506530	08/2013	08/05/2013	100.000	100.100	100.1	1

KU	C1SR	2506531	08/2013	08/01/2013	100.000	100.100	100.0	1
KU	C1SR	2506532	08/2013	08/05/2013	99.900	100.100	100.0	1
KU	C1SR	2506533	08/2013	08/05/2013	100.000	100.200	100.0	1
KU	C1SR	2506534	08/2013	07/31/2013	100.000	100.200	100.1	1
KU	C1SR	2506535	08/2013	08/05/2013	99.900	100.100	100.0	1
KU	C1SR	2506536	08/2013	07/31/2013	100.000	100.100	100.1	1
KU	C1SR	2506537	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2506538	08/2013	08/05/2013	100.000	100.200	100.1	1
KU	C1SR	2506539	08/2013	08/05/2013	100.000	100.000	100.1	1
KU	C1SR	2506540	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2506541	08/2013	08/01/2013	100.000	100.000	100.0	1
KU	C1SR	2506542	08/2013	08/05/2013	100.000	100.200	100.1	1
KU	C1SR	2506543	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2506544	08/2013	08/05/2013	100.000	100.100	99.9	1
KU	C1SR	2506545	08/2013	08/05/2013	100.000	100.100	100.2	1
KU	C1SR	2506546	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506547	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506548	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506549	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506550	08/2013	08/01/2013	100.000	100.100	100.1	1
KU	C1SR	2506551	08/2013	08/01/2013	99.900	100.000	100.1	1
KU	C1SR	2506552	08/2013	07/31/2013	99.900	100.100	100.0	1
KU	C1SR	2506553	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506554	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506555	08/2013	08/01/2013	100.000	100.000	100.0	1
KU	C1SR	2506556	08/2013	08/01/2013	100.000	100.100	100.0	1
KU	C1SR	2506557	08/2013	08/01/2013	100.000	100.100	100.1	1
KU	C1SR	2506558	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506559	08/2013	08/05/2013	100.000	100.100	99.9	1
KU	C1SR	2506560	08/2013	08/05/2013	100.000	100.100	100.0	1

KU	C1SR	2506561	08/2013	08/01/2013	100.000	100.100	100.0	1
KU	C1SR	2506562	08/2013	08/05/2013	100.000	100.100	99.9	1
KU	C1SR	2506563	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506564	08/2013	08/05/2013	100.000	100.200	100.1	1
KU	C1SR	2506565	08/2013	07/31/2013	100.000	100.100	100.0	1
KU	C1SR	2506566	08/2013	08/01/2013	100.000	100.100	100.0	1
KU	C1SR	2506567	08/2013	08/05/2013	100.000	100.100	100.2	1
KU	C1SR	2506568	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2506569	08/2013	08/05/2013	99.900	100.100	100.1	1
KU	C1SR	2506570	08/2013	07/31/2013	100.000	100.100	100.0	1
KU	C1SR	2506571	08/2013	08/05/2013	100.000	100.200	100.1	1
KU	C1SR	2506572	08/2013	07/31/2013	100.000	100.100	100.1	1
KU	C1SR	2506573	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506574	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2506575	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2506576	08/2013	07/31/2013	100.000	100.100	100.1	1
KU	C1SR	2506577	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506578	08/2013	08/05/2013	100.000	100.200	100.0	1
KU	C1SR	2506579	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2506580	08/2013	08/05/2013	100.000	100.200	100.0	1
KU	C1SR	2506581	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506582	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506583	08/2013	08/05/2013	100.000	100.000	100.1	1
KU	C1SR	2506584	08/2013	08/05/2013	100.000	100.200	100.1	1
KU	C1SR	2506585	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506586	08/2013	08/01/2013	100.000	100.100	100.0	1
KU	C1SR	2506587	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2506588	08/2013	08/05/2013	100.000	100.200	100.0	1
KU	C1SR	2506589	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2506590	08/2013	08/05/2013	100.000	100.100	100.1	1



KU	C1SR	2506591	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2506592	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506593	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506594	08/2013	08/05/2013	100.000	100.200	100.0	1
KU	C1SR	2506595	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506596	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506597	08/2013	08/05/2013	100.000	100.200	100.1	1
KU	C1SR	2506598	08/2013	08/05/2013	100.000	100.100	99.9	1
KU	C1SR	2506599	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2506600	08/2013	08/05/2013	100.000	100.100	99.9	1
KU	C1SR	2506601	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506602	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2506603	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506604	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506605	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506606	08/2013	08/01/2013	100.000	100.200	100.0	1
KU	C1SR	2506607	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2506608	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506609	08/2013	08/05/2013	99.900	100.100	100.0	1
KU	C1SR	2506610	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2506611	08/2013	08/05/2013	100.000	100.200	100.0	1
KU	C1SR	2506612	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506613	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2506614	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2506615	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2506616	08/2013	08/01/2013	100.000	100.100	100.1	1
KU	C1SR	2506617	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506618	08/2013	07/31/2013	100.000	100.100	100.0	1
KU	C1SR	2506619	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2506620	08/2013	08/05/2013	100.000	100.100	100.0	1

KU	C1SR	2506621	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2506622	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506623	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2506624	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506625	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506626	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506627	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2506628	08/2013	08/01/2013	100.000	100.100	100.0	1
KU	C1SR	2506629	08/2013	08/05/2013	100.000	100.100	99.9	1
KU	C1SR	2506630	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2506631	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506632	08/2013	08/05/2013	99.900	100.100	100.1	1
KU	C1SR	2506633	08/2013	08/01/2013	100.000	100.100	100.0	1
KU	C1SR	2506634	08/2013	08/05/2013	100.000	100.100	99.9	1
KU	C1SR	2506635	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2506636	08/2013	08/05/2013	100.000	100.200	100.1	1
KU	C1SR	2506637	08/2013	08/01/2013	100.000	100.100	100.0	1
KU	C1SR	2506638	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506639	08/2013	08/01/2013	100.000	100.100	100.1	1
KU	C1SR	2506640	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506641	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2506642	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506643	08/2013	08/05/2013	100.000	100.100	99.9	1
KU	C1SR	2506644	08/2013	08/05/2013	100.000	100.200	100.0	1
KU	C1SR	2506645	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2506646	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2506647	08/2013	08/05/2013	100.000	100.100	99.9	1
KU	C1SR	2506648	08/2013	08/05/2013	100.000	100.200	100.0	1
KU	C1SR	2506649	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2506650	08/2013	08/05/2013	100.000	100.100	100.0	1

KU	C1SR	2506651	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506652	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506653	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506654	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2506655	08/2013	07/31/2013	100.000	100.100	100.1	1
KU	C1SR	2506656	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2506657	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2506658	08/2013	08/05/2013	100.000	100.200	100.1	1
KU	C1SR	2506659	08/2013	08/05/2013	100.000	100.200	100.2	1
KU	C1SR	2506660	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2506661	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506662	08/2013	08/05/2013	100.000	100.200	100.1	1
KU	C1SR	2506663	08/2013	08/05/2013	100.000	100.200	100.0	1
KU	C1SR	2506664	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2506665	08/2013	08/05/2013	100.000	100.200	100.0	1
KU	C1SR	2506666	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506667	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2506668	08/2013	08/01/2013	100.000	100.100	99.9	1
KU	C1SR	2506669	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506670	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506671	08/2013	08/05/2013	100.000	100.100	100.2	1
KU	C1SR	2506672	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2506673	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2506674	08/2013	08/05/2013	100.000	100.200	100.1	1
KU	C1SR	2506675	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2506676	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2506677	08/2013	08/05/2013	100.000	100.200	100.0	1
KU	C1SR	2506678	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2506679	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506680	08/2013	07/31/2013	100.000	100.200	100.0	1



KU	C1SR	2506681	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2506682	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2506683	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2506684	08/2013	08/05/2013	99.900	100.100	100.0	1
KU	C1SR	2506685	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506686	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506687	08/2013	08/01/2013	100.000	100.100	100.1	1
KU	C1SR	2506688	08/2013	08/05/2013	100.000	100.200	100.0	1
KU	C1SR	2506689	08/2013	07/31/2013	100.000	100.100	100.0	1
KU	C1SR	2506690	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506691	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2506692	08/2013	08/05/2013	100.000	100.200	100.0	1
KU	C1SR	2506693	08/2013	08/05/2013	100.000	100.200	100.1	1
KU	C1SR	2506694	08/2013	08/05/2013	100.000	100.200	100.1	1
KU	C1SR	2506695	08/2013	08/05/2013	100.000	100.000	100.1	1
KU	C1SR	2506696	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2506697	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2506698	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2506699	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2506700	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2506701	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506702	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2506703	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506704	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2506705	08/2013	08/05/2013	100.000	100.200	100.0	1
KU	C1SR	2506706	08/2013	08/05/2013	100.000	100.200	100.0	1
KU	C1SR	2506707	08/2013	08/05/2013	100.000	100.100	99.9	1
KU	C1SR	2506708	08/2013	08/01/2013	100.000	100.200	100.0	1
KU	C1SR	2506709	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2506710	08/2013	08/05/2013	100.000	100.100	100.0	1

KU	C1SR	2506711	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2506712	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2506713	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506714	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2506715	08/2013	08/05/13	100.000	100.200	100.1	1
KU	C1SR	2506716	08/2013	07/31/2013	100.000	100.100	100.0	1
KU	C1SR	2506717	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2506718	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2506719	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2506720	08/2013	08/05/2013	100.000	100.100	99.9	1
KU	C1SR	2506721	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506722	08/2013	08/05/2013	100.000	100.200	100.0	1
KU	C1SR	2506723	08/2013	08/05/2013	100.000	100.200	100.0	1
KU	C1SR	2506724	08/2013	08/05/2013	100.000	100.200	100.1	1
KU	C1SR	2506725	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506726	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506727	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506728	08/2013	08/05/2013	100.000	100.100	99.9	1
KU	C1SR	2506729	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506730	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506731	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506732	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506733	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506734	08/2013	08/05/2013	100.000	100.200	100.1	1
KU	C1SR	2506735	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506736	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506737	08/2013	08/05/2013	100.000	100.200	99.9	1
KU	C1SR	2506738	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506739	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506740	08/2013	08/05/2013	100.000	100.100	100.1	1

KU	C1SR	2506741	08/2013	08/05/2013	100.000	100.200	100.1	1
KU	C1SR	2506742	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506743	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506744	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506745	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506746	08/2013	08/05/2013	100.000	100.200	100.1	1
KU	C1SR	2506747	08/2013	07/31/2013	99.900	100.000	100.0	1
KU	C1SR	2506748	08/2013	08/01/2013	100.000	100.100	100.1	1
KU	C1SR	2506749	08/2013	08/01/2013	100.000	100.100	100.0	1
KU	C1SR	2506750	08/2013	08/01/2013	100.000	100.100	100.1	1
KU	C1SR	2506751	08/2013	08/05/2013	100.000	100.200	100.1	1
KU	C1SR	2506752	08/2013	08/05/2013	100.000	100.200	100.0	1
KU	C1SR	2506753	08/2013	08/01/2013	100.000	100.100	100.1	1
KU	C1SR	2506754	08/2013	08/05/2013	100.000	100.100	99.9	1
KU	C1SR	2506755	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506756	08/2013	08/05/2013	100.000	100.100	99.9	1
KU	C1SR	2506757	08/2013	08/01/2013	100.000	100.100	100.0	1
KU	C1SR	2506758	08/2013	08/01/2013	100.000	100.100	100.0	1
KU	C1SR	2506759	08/2013	08/01/2013	100.000	100.200	100.0	1
KU	C1SR	2506760	08/2013	08/05/2013	100.000	100.000	100.1	1
KU	C1SR	2506761	08/2013	08/05/2013	100.000	100.200	100.1	1
KU	C1SR	2506762	08/2013	08/05/2013	100.000	100.200	100.0	1
KU	C1SR	2506763	08/2013	08/05/2013	100.000	100.100	99.9	1
KU	C1SR	2506764	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506765	08/2013	08/05/2013	99.900	100.200	100.0	1
KU	C1SR	2506766	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506767	08/2013	08/01/2013	100.000	100.000	100.0	1
KU	C1SR	2506768	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506769	08/2013	08/01/2013	100.000	100.100	100.1	1
KU	C1SR	2506770	08/2013	08/01/2013	100.000	100.200	100.0	1



KU	C1SR	2506771	08/2013	08/01/2013	100.000	100.100	100.0	1
KU	C1SR	2506772	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506773	08/2013	08/05/2013	100.000	100.100	99.9	1
KU	C1SR	2506774	08/2013	08/01/2013	100.000	100.200	100.1	1
KU	C1SR	2506775	08/2013	08/05/2013	100.000	100.200	100.1	1
KU	C1SR	2506776	08/2013	08/01/2013	100.000	100.100	100.1	1
KU	C1SR	2506777	08/2013	08/01/2013	100.000	100.100	100.0	1
KU	C1SR	2506778	08/2013	08/01/2013	100.000	100.100	100.0	1
KU	C1SR	2506779	08/2013	08/01/2013	100.000	100.200	100.1	1
KU	C1SR	2506780	08/2013	08/01/2013	100.000	100.100	99.9	1
KU	C1SR	2506781	08/2013	08/01/2013	100.000	100.200	100.0	1
KU	C1SR	2506782	08/2013	08/01/2013	99.900	100.100	100.0	1
KU	C1SR	2506783	08/2013	08/01/2013	100.000	100.200	100.0	1
KU	C1SR	2506784	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506785	08/2013	08/01/2013	100.000	100.000	100.1	1
KU	C1SR	2506786	08/2013	08/05/2013	100.000	100.000	99.9	1
KU	C1SR	2506787	08/2013	08/01/2013	100.000	100.100	100.1	1
KU	C1SR	2506788	08/2013	07/31/2013	100.000	100.100	100.1	1
KU	C1SR	2506789	08/2013	08/01/2013	100.000	100.100	100.0	1
KU	C1SR	2506790	08/2013	08/01/2013	100.000	100.200	100.0	1
KU	C1SR	2506791	08/2013	08/01/2013	99.900	100.100	100.0	1
KU	C1SR	2506792	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506793	08/2013	08/01/2013	100.000	100.100	100.1	1
KU	C1SR	2506794	08/2013	08/01/2013	100.000	100.000	100.0	1
KU	C1SR	2506795	08/2013	08/05/2013	100.000	100.200	99.9	1
KU	C1SR	2506796	08/2013	08/01/2013	100.000	100.100	100.0	1
KU	C1SR	2506797	08/2013	08/01/2013	100.000	100.200	100.1	1
KU	C1SR	2506798	08/2013	08/01/2013	100.000	100.100	100.0	1
KU	C1SR	2506799	08/2013	08/05/2013	99.900	100.100	100.0	1
KU	C1SR	2506800	08/2013	07/31/2013	100.000	100.200	100.0	1

KU	C1SR	2506801	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506802	08/2013	08/05/2013	100.000	100.200	100.0	1
KU	C1SR	2506803	08/2013	08/01/2013	100.000	100.100	100.0	1
KU	C1SR	2506804	08/2013	08/01/2013	100.000	100.100	100.0	1
KU	C1SR	2506805	08/2013	08/01/2013	100.000	100.100	100.1	1
KU	C1SR	2506806	08/2013	08/01/2013	99.900	100.100	100.1	1
KU	C1SR	2506807	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506808	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506809	08/2013	08/01/2013	100.000	100.000	100.1	1
KU	C1SR	2506810	08/2013	08/01/2013	100.000	100.200	100.1	1
KU	C1SR	2506811	08/2013	08/01/2013	100.000	100.100	100.1	1
KU	C1SR	2506812	08/2013	08/01/2013	100.000	100.100	100.0	1
KU	C1SR	2506813	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506814	08/2013	08/01/2013	100.000	100.100	100.1	1
KU	C1SR	2506815	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2506816	08/2013	08/01/2013	100.000	100.000	100.0	1
KU	C1SR	2506817	08/2013	08/01/2013	100.000	100.100	100.0	1
KU	C1SR	2506818	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2506819	08/2013	08/05/2013	100.000	100.200	100.0	1
KU	C1SR	2506820	08/2013	08/05/2013	99.900	100.000	100.1	1
KU	C1SR	2506821	08/2013	08/05/2013	100.000	100.000	99.9	1
KU	C1SR	2506822	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506823	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2506824	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2506825	08/2013	08/01/2013	100.000	100.100	100.0	1
KU	C1SR	2506826	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506827	08/2013	08/05/2013	100.000	100.100	99.9	1
KU	C1SR	2506828	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2506829	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2506830	08/2013	08/05/2013	100.000	100.100	99.9	1

KU	C1SR	2506831	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506832	08/2013	08/05/2013	100.000	100.000	100.0	1
KU	C1SR	2506833	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506834	08/2013	08/05/2013	100.000	100.100	99.9	1
KU	C1SR	2506835	08/2013	08/01/2013	100.000	100.000	100.0	1
KU	C1SR	2506836	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506837	08/2013	08/01/2013	100.000	100.100	100.0	1
KU	C1SR	2506838	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506839	08/2013	08/05/2013	100.000	100.100	99.9	1
KU	C1SR	2506840	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2506841	08/2013	08/01/2013	100.000	100.100	100.1	1
KU	C1SR	2506842	08/2013	08/01/2013	100.000	100.200	100.0	1
KU	C1SR	2506843	08/2013	08/05/2013	100.000	100.200	100.0	1
KU	C1SR	2506844	08/2013	08/01/2013	100.000	100.100	100.0	1
KU	C1SR	2506845	08/2013	08/05/2013	100.000	100.200	100.1	1
KU	C1SR	2506846	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2506847	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506848	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2506849	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506850	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2506851	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506852	08/2013	08/05/2013	100.000	100.100	99.9	1
KU	C1SR	2506853	08/2013	08/01/2013	100.000	100.000	100.1	1
KU	C1SR	2506854	08/2013	08/01/2013	100.000	100.200	100.1	1
KU	C1SR	2506855	08/2013	08/05/2013	100.000	100.200	100.0	1
KU	C1SR	2506856	08/2013	08/05/2013	100.000	100.200	100.1	1
KU	C1SR	2506857	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2506858	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2506859	08/2013	08/05/2013	100.000	100.200	100.1	1
KU	C1SR	2506860	08/2013	07/31/2013	100.000	100.100	100.0	1



KU	C1SR	2506861	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506862	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2506863	08/2013	08/05/2013	100.000	100.100	99.9	1
KU	C1SR	2506864	08/2013	08/05/2013	100.000	100.100	99.9	1
KU	C1SR	2506865	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506866	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2506867	08/2013	08/05/2013	100.000	100.200	100.1	1
KU	C1SR	2506868	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506869	08/2013	08/01/2013	100.000	100.000	100.0	1
KU	C1SR	2506870	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506871	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2506872	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2506873	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506874	08/2013	08/05/2013	100.000	100.200	99.9	1
KU	C1SR	2506875	08/2013	08/01/2013	99.900	100.100	100.0	1
KU	C1SR	2506876	08/2013	08/01/2013	100.000	100.100	100.1	1
KU	C1SR	2506877	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506878	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506879	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506880	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506881	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506882	08/2013	08/05/2013	100.000	100.000	100.0	1
KU	C1SR	2506883	08/2013	08/01/2013	100.000	100.100	100.0	1
KU	C1SR	2506884	08/2013	08/05/2013	100.000	100.200	100.0	1
KU	C1SR	2506885	08/2013	08/01/2013	100.000	100.100	100.1	1
KU	C1SR	2506886	08/2013	08/05/2013	99.900	100.100	100.0	1
KU	C1SR	2506887	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506888	08/2013	08/01/2013	100.000	100.100	100.1	1
KU	C1SR	2506889	08/2013	08/01/2013	100.000	100.100	100.0	1
KU	C1SR	2506890	08/2013	08/01/2013	100.000	100.100	100.0	1

KU	C1SR	2506891	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506892	08/2013	08/05/2013	100.000	100.100	99.9	1
KU	C1SR	2506893	08/2013	08/01/2013	100.000	100.100	100.0	1
KU	C1SR	2506894	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2506895	08/2013	08/01/2013	100.000	100.200	100.0	1
KU	C1SR	2506896	08/2013	08/01/2013	100.000	100.100	100.0	1
KU	C1SR	2506897	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506898	08/2013	08/01/2013	100.000	100.100	100.1	1
KU	C1SR	2506899	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2506900	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2506901	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2506902	08/2013	08/01/2013	100.000	100.100	100.1	1
KU	C1SR	2506903	08/2013	08/01/2013	100.000	100.000	99.9	1
KU	C1SR	2506904	08/2013	08/05/2013	100.000	100.200	100.1	1
KU	C1SR	2506905	08/2013	08/01/2013	100.000	100.200	100.1	1
KU	C1SR	2506906	08/2013	08/01/2013	100.000	100.100	100.1	1
KU	C1SR	2506907	08/2013	08/01/2013	99.900	100.100	100.0	1
KU	C1SR	2506908	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506909	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506910	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506911	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506912	08/2013	08/01/2013	100.000	100.100	100.0	1
KU	C1SR	2506913	08/2013	08/05/2013	100.000	100.100	99.9	1
KU	C1SR	2506914	08/2013	08/01/2013	100.000	100.100	100.0	1
KU	C1SR	2506915	08/2013	08/05/2013	100.000	100.200	100.1	1
KU	C1SR	2506916	08/2013	08/01/2013	100.000	100.100	100.0	1
KU	C1SR	2506917	08/2013	08/01/2013	99.900	100.000	100.1	1
KU	C1SR	2506918	08/2013	08/01/2013	100.000	100.100	100.0	1
KU	C1SR	2506919	08/2013	08/01/2013	99.900	100.100	100.1	1
KU	C1SR	2506920	08/2013	08/01/2013	100.000	100.100	100.0	1

KU	C1SR	2506921	08/2013	08/01/2013	100.000	100.100	100.0	1
KU	C1SR	2506922	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2506923	08/2013	08/05/2013	100.000	100.000	100.1	1
KU	C1SR	2506924	08/2013	08/01/2013	100.000	100.100	100.0	1
KU	C1SR	2506925	08/2013	07/31/2013	100.000	100.200	100.1	1
KU	C1SR	2506926	08/2013	08/01/2013	100.000	100.100	100.1	1
KU	C1SR	2506927	08/2013	08/05/2013	100.000	100.200	100.0	1
KU	C1SR	2506928	08/2013	08/01/2013	100.000	100.100	100.0	1
KU	C1SR	2506929	08/2013	08/01/2013	100.000	100.100	100.0	1
KU	C1SR	2506930	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506931	08/2013	08/05/2013	100.000	100.200	100.1	1
KU	C1SR	2506932	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506933	08/2013	07/31/2013	100.000	100.100	99.9	1
KU	C1SR	2506934	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506935	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506936	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506937	08/2013	08/05/2013	100.000	100.200	100.0	1
KU	C1SR	2506938	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506939	08/2013	08/05/2013	100.000	100.200	100.1	1
KU	C1SR	2506940	08/2013	08/01/2013	100.000	100.100	100.2	1
KU	C1SR	2506941	08/2013	08/01/2013	100.000	100.100	100.1	1
KU	C1SR	2506942	08/2013	08/01/2013	100.000	100.100	100.0	1
KU	C1SR	2506943	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506944	08/2013	07/31/2013	100.000	100.100	100.0	1
KU	C1SR	2506945	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2506946	08/2013	08/02/2013	100.000	100.100	100.0	1
KU	C1SR	2506947	08/2013	08/02/2013	100.000	100.100	100.1	1
KU	C1SR	2506948	08/2013	08/05/2013	100.000	100.200	100.0	1
KU	C1SR	2506949	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2506950	08/2013	08/01/2013	100.000	100.100	100.0	1



KU	C1SR	2506951	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506952	08/2013	08/01/2013	100.000	100.100	100.1	1
KU	C1SR	2506953	08/2013	08/05/2013	100.000	100.200	99.9	1
KU	C1SR	2506954	08/2013	08/05/2013	99.900	100.100	100.0	1
KU	C1SR	2506955	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506956	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506957	08/2013	08/05/2013	100.000	100.000	100.0	1
KU	C1SR	2506958	08/2013	08/01/2013	100.000	100.100	100.0	1
KU	C1SR	2506959	08/2013	08/01/2013	100.000	100.200	100.0	1
KU	C1SR	2506960	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506961	08/2013	08/01/2013	100.000	100.100	100.0	1
KU	C1SR	2506962	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506963	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506964	08/2013	08/05/2013	100.000	100.000	100.0	1
KU	C1SR	2506965	08/2013	08/01/2013	100.000	100.100	100.0	1
KU	C1SR	2506966	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506967	08/2013	08/05/2013	100.000	100.200	100.1	1
KU	C1SR	2506968	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2506969	08/2013	08/01/2013	100.000	100.100	100.1	1
KU	C1SR	2506970	08/2013	08/05/2013	100.000	100.000	100.1	1
KU	C1SR	2506971	08/2013	08/01/2013	100.000	100.200	100.0	1
KU	C1SR	2506972	08/2013	08/01/2013	100.000	100.100	100.0	1
KU	C1SR	2506973	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506974	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506975	08/2013	08/01/2013	99.900	100.100	100.1	1
KU	C1SR	2506976	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506977	08/2013	08/02/2013	100.000	100.100	100.1	1
KU	C1SR	2506978	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506979	08/2013	08/01/2013	100.000	100.100	100.2	1
KU	C1SR	2506980	08/2013	08/02/2013	100.000	100.100	100.0	1

KU	C1SR	2506981	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506982	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506983	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506984	08/2013	08/01/2013	100.000	100.100	100.0	1
KU	C1SR	2506985	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506986	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506987	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506988	08/2013	08/01/2013	100.000	100.200	100.0	1
KU	C1SR	2506989	08/2013	08/05/2013	100.000	100.000	100.0	1
KU	C1SR	2506990	08/2013	08/02/2013	100.000	100.100	100.1	1
KU	C1SR	2506991	08/2013	08/01/2013	100.000	100.100	100.0	1
KU	C1SR	2506992	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2506993	08/2013	08/02/2013	100.000	100.100	100.1	1
KU	C1SR	2506994	08/2013	08/01/2013	100.000	100.100	100.1	1
KU	C1SR	2506995	08/2013	08/01/2013	100.000	100.100	99.9	1
KU	C1SR	2506996	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2506997	08/2013	08/02/2013	100.000	100.100	100.1	1
KU	C1SR	2506998	08/2013	08/02/2013	100.000	100.100	100.1	1
KU	C1SR	2506999	08/2013	08/01/2013	100.000	100.100	100.0	1
KU	C1SR	2507000	08/2013	08/01/2013	100.000	100.000	100.0	1
KU	C1SR	2507001	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2507002	08/2013	08/01/2013	100.000	100.100	100.1	1
KU	C1SR	2507003	08/2013	08/01/2013	100.000	100.100	100.1	1
KU	C1SR	2507004	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2507005	08/2013	08/01/2013	100.000	100.100	100.0	1
KU	C1SR	2507006	08/2013	08/01/2013	100.000	100.200	100.1	1
KU	C1SR	2507007	08/2013	08/01/2013	100.000	100.100	100.1	1
KU	C1SR	2507008	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2507009	08/2013	08/01/2013	100.000	100.100	100.0	1
KU	C1SR	2507010	08/2013	08/01/2013	100.000	100.100	100.1	1

KU	C1SR	2507011	08/2013	08/01/2013	100.000	100.100	100.0	1
KU	C1SR	2507012	08/2013	08/01/2013	100.000	100.100	100.0	1
KU	C1SR	2507013	08/2013	08/01/2013	100.000	100.200	100.1	1
KU	C1SR	2507014	08/2013	08/01/2013	100.000	100.100	100.1	1
KU	C1SR	2507015	08/2013	08/01/2013	100.000	100.100	100.0	1
KU	C1SR	2507016	08/2013	08/01/2013	100.000	100.100	100.0	1
KU	C1SR	2507017	08/2013	08/05/2013	100.000	100.200	100.0	1
KU	C1SR	2507018	08/2013	08/01/2013	100.000	100.100	100.0	1
KU	C1SR	2507019	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2507020	08/2013	08/05/2013	100.000	100.000	100.0	1
KU	C1SR	2507021	08/2013	08/01/2013	99.900	100.100	99.9	1
KU	C1SR	2507022	08/2013	08/01/2013	100.000	100.100	100.0	1
KU	C1SR	2507023	08/2013	08/01/2013	100.000	100.100	100.1	1
KU	C1SR	2507024	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2507025	08/2013	08/01/2013	100.000	100.100	100.0	1
KU	C1SR	2507026	08/2013	08/01/2013	99.900	100.100	100.0	1
KU	C1SR	2507027	08/2013	08/01/2013	100.000	100.100	100.1	1
KU	C1SR	2507028	08/2013	08/05/2013	100.000	100.100	99.9	1
KU	C1SR	2507029	08/2013	07/31/2013	99.900	100.100	100.0	1
KU	C1SR	2507030	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2507031	08/2013	07/31/2013	100.000	100.100	100.0	1
KU	C1SR	2507032	08/2013	08/02/2013	100.000	100.200	100.0	1
KU	C1SR	2507033	08/2013	08/02/2013	100.000	100.100	100.1	1
KU	C1SR	2507034	08/2013	08/05/2013	100.000	100.200	100.1	1
KU	C1SR	2507035	08/2013	08/02/2013	100.000	100.200	100.1	1
KU	C1SR	2507036	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2507037	08/2013	08/05/2013	100.000	100.200	100.0	1
KU	C1SR	2507038	08/2013	08/01/2013	100.000	100.200	100.0	1
KU	C1SR	2507039	08/2013	08/01/2013	100.000	100.100	100.0	1
KU	C1SR	2507040	08/2013	08/01/2013	100.000	100.100	100.1	1



KU	C1SR	2507041	08/2013	08/01/2013	100.000	100.100	100.0	1
KU	C1SR	2507042	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2507043	08/2013	08/01/2013	100.000	100.100	100.1	1
KU	C1SR	2507044	08/2013	08/01/2013	100.000	100.100	100.0	1
KU	C1SR	2507045	08/2013	08/02/2013	100.000	100.100	100.0	1
KU	C1SR	2507046	08/2013	08/01/2013	100.000	100.100	100.1	1
KU	C1SR	2507047	08/2013	08/02/2013	100.000	100.100	100.1	1
KU	C1SR	2507048	08/2013	08/02/2013	100.000	100.100	100.0	1
KU	C1SR	2507049	08/2013	08/05/2013	99.900	100.200	100.0	1
KU	C1SR	2507050	08/2013	08/02/2013	100.000	100.100	100.0	1
KU	C1SR	2507051	08/2013	08/05/2013	100.000	100.000	100.1	1
KU	C1SR	2507052	08/2013	08/01/2013	100.000	100.100	100.0	1
KU	C1SR	2507053	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2507054	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2507055	08/2013	08/05/2013	100.000	100.200	100.1	1
KU	C1SR	2507056	08/2013	08/05/2013	100.000	100.100	99.9	1
KU	C1SR	2507057	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2507058	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2507059	08/2013	08/05/2013	100.000	100.200	100.0	1
KU	C1SR	2507060	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2507061	08/2013	08/01/2013	100.000	100.100	100.0	1
KU	C1SR	2507062	08/2013	08/02/2013	100.000	100.100	100.1	1
KU	C1SR	2507063	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2507064	08/2013	08/01/2013	100.000	100.100	100.1	1
KU	C1SR	2507065	08/2013	08/01/2013	100.000	100.000	100.1	1
KU	C1SR	2507066	08/2013	08/01/2013	100.000	100.100	100.0	1
KU	C1SR	2507067	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2507068	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2507069	08/2013	08/01/2013	100.000	100.100	100.0	1
KU	C1SR	2507070	08/2013	08/01/2013	100.000	100.100	100.0	1

KU	C1SR	2507071	08/2013	08/01/2013	100.000	100.200	100.0	1
KU	C1SR	2507072	08/2013	08/05/2013	99.900	100.100	100.1	1
KU	C1SR	2507073	08/2013	08/05/2013	99.900	100.000	100.1	1
KU	C1SR	2507074	08/2013	08/01/2013	100.000	100.100	100.0	1
KU	C1SR	2507075	08/2013	08/05/2013	100.000	100.200	100.1	1
KU	C1SR	2507076	08/2013	08/05/2013	100.000	100.100	99.9	1
KU	C1SR	2507077	08/2013	08/01/2013	100.000	100.200	100.1	1
KU	C1SR	2507078	08/2013	08/05/2013	100.000	100.200	100.1	1
KU	C1SR	2507079	08/2013	08/05/2013	100.000	100.200	100.1	1
KU	C1SR	2507080	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2507081	08/2013	08/02/2013	100.000	100.100	100.0	1
KU	C1SR	2507082	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2507083	08/2013	08/01/2013	100.000	100.100	100.1	1
KU	C1SR	2507084	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2507085	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2507086	08/2013	08/02/2013	100.000	100.100	100.1	1
KU	C1SR	2507087	08/2013	08/01/2013	99.900	100.000	100.0	1
KU	C1SR	2507088	08/2013	08/02/2013	100.000	100.100	100.0	1
KU	C1SR	2507089	08/2013	08/05/2013	99.900	100.100	100.0	1
KU	C1SR	2507090	08/2013	08/05/2013	100.000	100.200	100.0	1
KU	C1SR	2507091	08/2013	08/01/2013	100.000	100.100	100.1	1
KU	C1SR	2507092	08/2013	08/01/2013	100.000	100.100	100.0	1
KU	C1SR	2507093	08/2013	08/05/2013	99.900	100.100	100.1	1
KU	C1SR	2507094	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2507095	08/2013	08/01/2013	100.000	100.100	100.0	1
KU	C1SR	2507096	08/2013	08/01/2013	100.000	100.100	100.1	1
KU	C1SR	2507097	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2507098	08/2013	08/01/2013	100.000	100.100	100.1	1
KU	C1SR	2507099	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2507100	08/2013	08/05/2013	100.000	100.200	100.0	1

KU	C1SR	2507101	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2507102	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2507103	08/2013	08/05/2013	100.000	100.200	100.0	1
KU	C1SR	2507104	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2507105	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2507106	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2507107	08/2013	08/05/2013	99.900	100.100	100.0	1
KU	C1SR	2507108	08/2013	08/05/2013	99.900	100.100	100.0	1
KU	C1SR	2507109	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2507110	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2507111	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2507112	08/2013	08/01/2013	100.000	100.100	100.1	1
KU	C1SR	2507113	08/2013	08/01/2013	100.000	100.200	100.0	1
KU	C1SR	2507114	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2507115	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2507116	08/2013	08/02/2013	99.900	100.000	100.0	1
KU	C1SR	2507117	08/2013	08/02/2013	100.000	100.200	100.0	1
KU	C1SR	2507118	08/2013	08/02/2013	100.000	100.100	100.1	1
KU	C1SR	2507119	08/2013	08/05/2013	100.000	100.200	100.1	1
KU	C1SR	2507120	08/2013	08/05/2013	100.000	100.000	100.0	1
KU	C1SR	2507121	08/2013	08/05/2013	100.000	100.200	99.9	1
KU	C1SR	2507122	08/2013	08/05/2013	100.000	100.200	100.1	1
KU	C1SR	2507123	08/2013	08/05/2013	100.000	100.200	100.1	1
KU	C1SR	2507124	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2507125	08/2013	08/05/2013	100.000	100.200	100.0	1
KU	C1SR	2507126	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2507127	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2507128	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2507129	08/2013	08/05/2013	100.000	100.100	99.9	1
KU	C1SR	2507130	08/2013	08/05/2013	100.000	100.200	100.1	1



KU	C1SR	2507131	08/2013	08/05/2013	100.000	100.000	99.9	1
KU	C1SR	2507132	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2507133	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2507134	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2507135	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2507136	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2507137	08/2013	08/05/2013	100.000	100.200	100.0	1
KU	C1SR	2507138	08/2013	08/05/2013	100.000	100.100	100.2	1
KU	C1SR	2507139	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2507140	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2507141	08/2013	08/05/2013	100.000	100.200	100.1	1
KU	C1SR	2507142	08/2013	08/05/2013	100.000	100.200	100.0	1
KU	C1SR	2507143	08/2013	08/05/2013	100.000	100.200	100.1	1
KU	C1SR	2507144	08/2013	08/05/2013	100.000	100.200	99.9	1
KU	C1SR	2507145	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2507146	08/2013	08/05/2013	100.000	100.000	100.0	1
KU	C1SR	2507147	08/2013	08/01/2013	100.000	100.200	100.1	1
KU	C1SR	2507148	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2507149	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2507150	08/2013	08/05/2013	100.000	100.200	100.1	1
KU	C1SR	2507151	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2507152	08/2013	08/01/2013	100.000	100.100	100.1	1
KU	C1SR	2507153	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2507154	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2507155	08/2013	08/01/2013	100.000	100.000	100.0	1
KU	C1SR	2507156	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2507157	08/2013	08/05/2013	100.000	100.200	100.0	1
KU	C1SR	2507158	08/2013	08/01/2013	100.000	100.100	100.0	1
KU	C1SR	2507159	08/2013	08/01/2013	100.000	100.000	100.0	1
KU	C1SR	2507160	08/2013	08/05/2013	100.000	100.100	100.0	1

KU	C1SR	2507161	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2507162	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2507163	08/2013	08/05/2013	100.000	100.200	100.0	1
KU	C1SR	2507164	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2507165	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2507166	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2507167	08/2013	08/05/2013	100.000	100.100	99.9	1
KU	C1SR	2507168	08/2013	08/01/2013	100.000	100.100	100.0	1
KU	C1SR	2507169	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2507170	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2507171	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2507172	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2507173	08/2013	08/05/2013	100.000	100.200	100.0	1
KU	C1SR	2507174	08/2013	08/05/2013	99.900	100.200	100.1	1
KU	C1SR	2507175	08/2013	08/05/2013	100.000	100.200	100.0	1
KU	C1SR	2507176	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2507177	08/2013	08/05/2013	100.000	100.200	100.1	1
KU	C1SR	2507178	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2507179	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2507180	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2507181	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2507182	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2507183	08/2013	08/05/2013	100.000	100.200	100.1	1
KU	C1SR	2507184	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2507185	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2507186	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2507187	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2507188	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2507189	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2507190	08/2013	08/05/2013	100.000	100.200	100.1	1

KU	C1SR	2507191	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2507192	08/2013	08/05/2013	100.000	100.200	100.0	1
KU	C1SR	2507193	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2507194	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2507195	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2507196	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2507197	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2507198	08/2013	08/05/2013	99.900	100.100	100.1	1
KU	C1SR	2507199	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2507200	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2507201	08/2013	08/05/2013	100.000	100.200	100.1	1
KU	C1SR	2507202	08/2013	08/05/2013	99.900	100.100	100.1	1
KU	C1SR	2507203	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2507204	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2507205	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2507206	08/2013	08/05/2013	100.000	100.100	100.2	1
KU	C1SR	2507207	08/2013	08/05/2013	100.000	100.200	100.0	1
KU	C1SR	2507208	08/2013	08/05/2013	99.900	100.200	100.0	1
KU	C1SR	2507209	08/2013	08/05/2013	99.900	100.100	100.1	1
KU	C1SR	2507210	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2507211	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2507212	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2507213	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2507214	08/2013	08/05/2013	100.000	100.200	100.1	1
KU	C1SR	2507215	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2507216	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2507217	08/2013	08/05/2013	100.000	100.200	100.0	1
KU	C1SR	2507218	08/2013	08/05/2013	100.000	100.100	99.9	1
KU	C1SR	2507219	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2507220	08/2013	08/05/2013	100.000	100.100	100.1	1



KU	C1SR	2507221	08/2013	08/05/2013	100.000	100.200	100.0	1
KU	C1SR	2507222	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2507223	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2507224	08/2013	08/05/2013	100.000	100.000	100.0	1
KU	C1SR	2507225	08/2013	08/05/2013	99.900	100.000	100.1	1
KU	C1SR	2507226	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2507227	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2507228	08/2013	08/01/2013	100.000	100.100	100.0	1
KU	C1SR	2507229	08/2013	08/05/2013	100.000	100.200	100.0	1
KU	C1SR	2507230	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2507231	08/2013	08/05/2013	100.000	100.000	100.1	1
KU	C1SR	2507232	08/2013	08/05/2013	99.900	100.100	100.0	1
KU	C1SR	2507233	08/2013	08/01/2013	100.000	100.100	100.1	1
KU	C1SR	2507234	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2507235	08/2013	08/05/2013	100.000	100.100	100.2	1
KU	C1SR	2507236	08/2013	08/05/2013	100.000	100.200	100.0	1
KU	C1SR	2507237	08/2013	08/05/2013	99.900	100.100	99.9	1
KU	C1SR	2507238	08/2013	08/05/2013	99.900	100.100	100.0	1
KU	C1SR	2507239	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2507240	08/2013	08/05/2013	99.900	100.100	100.1	1
KU	C1SR	2507241	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2507242	08/2013	08/05/2013	100.000	100.200	100.2	1
KU	C1SR	2507243	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2507244	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2507245	08/2013	08/01/2013	100.000	100.100	100.0	1
KU	C1SR	2507246	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2507247	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2507248	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2507249	08/2013	08/01/2013	100.000	100.200	100.1	1
KU	C1SR	2507250	08/2013	08/01/2013	100.000	100.100	100.1	1

KU	C1SR	2507251	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2507252	08/2013	08/01/2013	100.000	100.100	100.0	1
KU	C1SR	2507253	08/2013	08/05/2013	100.000	100.100	100.2	1
KU	C1SR	2507254	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2507255	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2507256	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2507257	08/2013	07/31/2013	100.000	100.200	100.1	1
KU	C1SR	2507258	08/2013	08/01/2013	100.000	100.100	100.0	1
KU	C1SR	2507259	08/2013	08/01/2013	100.000	100.100	100.1	1
KU	C1SR	2507260	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2507261	08/2013	08/02/2013	100.000	100.100	100.1	1
KU	C1SR	2507262	08/2013	08/05/2013	100.000	100.200	100.1	1
KU	C1SR	2507263	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2507264	08/2013	08/05/2013	100.000	100.200	100.1	1
KU	C1SR	2507265	08/2013	08/01/2013	100.000	100.100	100.1	1
KU	C1SR	2507266	08/2013	08/05/2013	100.000	100.200	100.0	1
KU	C1SR	2507267	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2507268	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2507269	08/2013	08/05/2013	99.900	100.100	100.0	1
KU	C1SR	2507270	08/2013	08/01/2013	100.000	100.100	100.1	1
KU	C1SR	2507271	08/2013	08/05/2013	100.000	100.200	100.1	1
KU	C1SR	2507272	08/2013	08/05/2013	100.000	100.200	100.1	1
KU	C1SR	2507273	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2507274	08/2013	08/05/2013	100.000	100.200	100.1	1
KU	C1SR	2507275	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2507276	08/2013	08/05/2013	99.900	100.100	100.1	1
KU	C1SR	2507277	08/2013	08/01/2013	100.000	100.100	100.1	1
KU	C1SR	2507278	08/2013	08/05/2013	100.000	100.100	100.2	1
KU	C1SR	2507279	08/2013	08/01/2013	100.000	100.100	99.9	1
KU	C1SR	2507280	08/2013	08/05/2013	99.900	100.100	100.0	1

KU	C1SR	2507281	08/2013	08/05/2013	100.000	100.200	100.0	1
KU	C1SR	2507282	08/2013	08/02/2013	99.900	100.000	100.1	1
KU	C1SR	2507283	08/2013	08/01/2013	100.000	100.100	100.1	1
KU	C1SR	2507284	08/2013	08/02/2013	100.000	100.200	100.0	1
KU	C1SR	2507285	08/2013	08/05/2013	100.000	100.100	100.2	1
KU	C1SR	2507286	08/2013	08/05/2013	100.000	100.200	100.0	1
KU	C1SR	2507287	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2507288	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2507289	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2507290	08/2013	08/05/2013	99.900	100.100	100.0	1
KU	C1SR	2507291	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2507292	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2507293	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2507294	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2507295	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2507296	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2507297	08/2013	08/05/2013	100.000	100.200	100.1	1
KU	C1SR	2507298	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2507299	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2507300	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2507301	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2507302	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2507303	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2507304	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2507305	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2507306	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2507307	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2507308	08/2013	08/01/2013	100.000	100.200	100.0	1
KU	C1SR	2507309	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2507310	08/2013	08/05/2013	100.000	100.100	100.1	1



KU	C1SR	2507311	08/2013	08/02/2013	100.000	100.200	100.0	1
KU	C1SR	2507312	08/2013	08/01/2013	100.000	100.200	100.0	1
KU	C1SR	2507313	08/2013	08/02/2013	100.000	100.100	100.1	1
KU	C1SR	2507314	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2507315	08/2013	08/02/2013	100.000	100.100	100.0	1
KU	C1SR	2507316	08/2013	08/01/2013	100.000	100.100	100.0	1
KU	C1SR	2507317	08/2013	08/02/2013	100.000	100.100	100.0	1
KU	C1SR	2507318	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2507319	08/2013	08/05/2013	100.000	100.200	100.1	1
KU	C1SR	2507320	08/2013	08/02/2013	99.900	100.100	100.0	1
KU	C1SR	2507321	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2507322	08/2013	07/31/2013	100.000	100.100	100.1	1
KU	C1SR	2507323	08/2013	08/02/2013	100.000	100.100	100.1	1
KU	C1SR	2507324	08/2013	08/01/2013	100.000	100.100	100.1	1
KU	C1SR	2507325	08/2013	08/05/2013	100.000	100.200	100.0	1
KU	C1SR	2507326	08/2013	08/01/2013	99.900	100.100	100.1	1
KU	C1SR	2507327	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2507328	08/2013	08/01/2013	100.000	100.100	100.0	1
KU	C1SR	2507329	08/2013	08/05/2013	100.000	100.200	100.1	1
KU	C1SR	2507330	08/2013	08/01/2013	100.000	100.200	100.1	1
KU	C1SR	2507331	08/2013	08/01/2013	100.000	100.100	100.0	1
KU	C1SR	2507332	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2507333	08/2013	08/01/2013	99.900	100.100	100.0	1
KU	C1SR	2507334	08/2013	08/01/2013	100.000	100.100	100.1	1
KU	C1SR	2507335	08/2013	08/05/2013	100.000	100.200	100.0	1
KU	C1SR	2507336	08/2013	08/05/2013	100.000	100.200	100.1	1
KU	C1SR	2507337	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2507338	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2507339	08/2013	08/05/2013	100.000	100.200	100.1	1
KU	C1SR	2507340	08/2013	08/05/2013	100.000	100.000	100.1	1

KU	C1SR	2507341	08/2013	08/05/2013	100.000	100.200	100.1	1
KU	C1SR	2507342	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2507343	08/2013	08/05/2013	100.000	100.200	100.1	1
KU	C1SR	2507344	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2507345	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2507346	08/2013	08/05/2013	100.000	100.200	100.0	1
KU	C1SR	2507347	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2507348	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2507349	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2507350	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2507351	08/2013	08/05/2013	100.000	100.100	100.0	1
KU	C1SR	2507352	08/2013	08/05/2013	100.000	100.100	100.1	1
KU	C1SR	2507353	08/2013	08/08/2013	100.000	100.100	100.0	1
KU	C1SR	2507354	08/2013	07/25/2013	100.000	100.200	100.0	1
KU	C1SR	2507355	08/2013	08/08/2013	100.000	100.100	100.0	1
KU	C1SR	2507356	08/2013	08/08/2013	100.000	100.100	100.1	1
KU	C1SR	2507357	08/2013	08/08/2013	100.000	100.100	100.0	1
KU	C1SR	2507358	08/2013	08/08/2013	100.000	100.100	100.1	1
KU	C1SR	2507359	08/2013	08/08/2013	100.000	100.200	100.2	1
KU	C1SR	2507360	08/2013	07/30/2013	100.000	100.200	100.0	1
KU	C1SR	2507361	08/2013	07/30/2013	100.000	100.100	100.0	1
KU	C1SR	2507362	08/2013	08/08/2013	100.000	100.100	100.0	1
KU	C1SR	2507363	08/2013	08/08/2013	99.900	100.100	100.0	1
KU	C1SR	2507364	08/2013	07/30/2013	100.000	100.100	100.0	1
KU	C1SR	2507365	08/2013	08/08/2013	100.000	100.100	100.2	1
KU	C1SR	2507366	08/2013	08/08/2013	100.000	100.100	100.0	1
KU	C1SR	2507367	08/2013	08/08/2013	99.900	100.000	100.1	1
KU	C1SR	2507368	08/2013	08/08/2013	100.000	100.100	100.2	1
KU	C1SR	2507369	08/2013	08/08/2013	100.000	100.100	100.2	1
KU	C1SR	2507370	08/2013	07/25/2013	100.000	100.100	99.8	1

KU	C1SR	2507371	08/2013	08/08/2013	100.000	100.200	100.1	1
KU	C1SR	2507372	08/2013	07/25/2013	100.000	100.100	100.1	1
KU	C1SR	2507373	08/2013	08/08/2013	100.000	100.200	100.0	1
KU	C1SR	2507374	08/2013	07/25/2013	100.000	100.100	100.1	1
KU	C1SR	2507375	08/2013	08/08/2013	100.000	100.100	100.2	1
KU	C1SR	2507376	08/2013	08/08/2013	100.000	100.100	100.2	1
KU	C1SR	2507377	08/2013	08/08/2013	100.000	100.100	100.2	1
KU	C1SR	2507378	08/2013	08/08/2013	100.000	100.100	100.0	1
KU	C1SR	2507379	08/2013	07/30/2013	100.000	100.100	100.0	1
KU	C1SR	2507380	08/2013	07/30/2013	100.000	100.200	100.2	1
KU	C1SR	2507381	08/2013	07/30/2013	100.000	100.000	100.2	1
KU	C1SR	2507382	08/2013	07/30/2013	100.000	100.100	99.9	1
KU	C1SR	2507383	08/2013	07/30/2013	100.000	100.100	100.1	1
KU	C1SR	2507384	08/2013	07/30/2013	100.000	100.100	100.1	1
KU	C1SR	2507385	08/2013	07/30/2013	100.000	100.100	100.1	1
KU	C1SR	2507386	08/2013	07/30/2013	99.900	100.100	100.2	1
KU	C1SR	2507387	08/2013	07/30/2013	100.000	100.100	100.2	1
KU	C1SR	2507388	08/2013	07/30/2013	100.000	100.100	100.0	1
KU	C1SR	2507389	08/2013	08/08/2013	100.000	100.100	100.1	1
KU	C1SR	2507390	08/2013	07/30/2013	100.000	100.100	100.0	1
KU	C1SR	2507391	08/2013	07/30/2013	100.000	100.100	99.9	1
KU	C1SR	2507392	08/2013	07/30/2013	100.000	100.100	100.2	1
KU	C1SR	2507393	08/2013	07/30/2013	100.000	100.100	100.0	1
KU	C1SR	2507394	08/2013	07/30/2013	100.000	100.100	100.1	1
KU	C1SR	2507395	08/2013	07/30/2013	100.000	100.100	100.0	1
KU	C1SR	2507396	08/2013	07/30/2013	100.000	100.100	100.2	1
KU	C1SR	2507397	08/2013	07/30/2013	100.000	100.000	100.1	1
KU	C1SR	2507398	08/2013	07/30/2013	100.000	100.100	100.2	1
KU	C1SR	2507399	08/2013	07/30/2013	100.000	100.200	100.2	1
KU	C1SR	2507400	08/2013	07/30/2013	100.000	100.100	100.1	1



KU	C1SR	2507401	08/2013	07/30/2013	100.000	100.100	100.2	1
KU	C1SR	2507402	08/2013	07/30/2013	100.000	100.100	100.1	1
KU	C1SR	2507403	08/2013	08/08/2013	100.000	100.100	100.2	1
KU	C1SR	2507404	08/2013	07/30/2013	100.000	100.000	100.1	1
KU	C1SR	2507405	08/2013	07/30/2013	100.000	100.100	100.1	1
KU	C1SR	2507406	08/2013	07/30/2013	100.000	100.200	100.0	1
KU	C1SR	2507407	08/2013	08/08/2013	100.000	100.200	100.1	1
KU	C1SR	2507408	08/2013	07/30/2013	100.000	100.200	99.9	1
KU	C1SR	2507409	08/2013	07/30/2013	100.000	100.200	100.2	1
KU	C1SR	2507410	08/2013	08/08/2013	100.000	100.100	99.9	1
KU	C1SR	2507411	08/2013	07/30/2013	100.000	100.100	100.1	1
KU	C1SR	2507412	08/2013	07/30/2013	100.000	100.100	100.2	1
KU	C1SR	2507413	08/2013	07/30/2013	100.000	100.100	100.0	1
KU	C1SR	2507414	08/2013	07/30/2013	100.000	100.100	100.1	1
KU	C1SR	2507415	08/2013	07/30/2013	100.000	100.100	100.1	1
KU	C1SR	2507416	08/2013	08/08/2013	100.000	100.100	100.0	1
KU	C1SR	2507417	08/2013	07/30/2013	100.000	100.100	100.1	1
KU	C1SR	2507418	08/2013	08/08/2013	100.000	100.200	100.0	1
KU	C1SR	2507419	08/2013	08/08/2013	100.000	100.100	100.0	1
KU	C1SR	2507420	08/2013	08/08/2013	99.900	100.100	100.1	1
KU	C1SR	2507421	08/2013	08/08/2013	100.000	100.100	100.0	1
KU	C1SR	2507422	08/2013	08/08/2013	100.000	100.100	100.2	1
KU	C1SR	2507423	08/2013	08/08/2013	100.000	100.200	100.0	1
KU	C1SR	2507424	08/2013	08/08/2013	100.000	100.100	100.2	1
KU	C1SR	2507425	08/2013	08/08/2013	100.000	100.200	100.1	1
KU	C1SR	2507426	08/2013	07/30/2013	100.000	100.100	100.2	1
KU	C1SR	2507427	08/2013	07/30/2013	100.000	100.200	100.1	1
KU	C1SR	2507428	08/2013	08/08/2013	100.000	100.200	100.1	1
KU	C1SR	2507429	08/2013	08/08/2013	100.000	100.100	100.1	1
KU	C1SR	2507430	08/2013	08/08/2013	100.000	100.100	100.2	1

KU	C1SR	2507431	08/2013	07/30/2013	100.000	100.100	100.2	1
KU	C1SR	2507432	08/2013	07/30/2013	100.000	100.200	100.1	1
KU	C1SR	2507433	08/2013	08/08/2013	100.000	100.100	100.1	1
KU	C1SR	2507434	08/2013	08/08/2013	100.000	100.100	100.1	1
KU	C1SR	2507435	08/2013	07/30/2013	100.000	100.100	100.0	1
KU	C1SR	2507436	08/2013	08/08/2013	99.900	100.100	100.1	1
KU	C1SR	2507437	08/2013	07/30/2013	100.000	100.100	100.1	1
KU	C1SR	2507438	08/2013	08/08/2013	100.000	100.100	100.0	1
KU	C1SR	2507439	08/2013	08/08/2013	100.000	100.100	100.2	1
KU	C1SR	2507440	08/2013	08/08/2013	100.000	100.100	100.1	1
KU	C1SR	2507441	08/2013	08/08/2013	100.000	100.100	100.1	1
KU	C1SR	2507442	08/2013	08/08/2013	99.900	100.100	100.1	1
KU	C1SR	2507443	08/2013	08/08/2013	100.000	100.100	100.2	1
KU	C1SR	2507444	08/2013	08/08/2013	100.000	100.100	100.0	1
KU	C1SR	2507445	08/2013	08/08/2013	99.900	100.000	100.1	1
KU	C1SR	2507446	08/2013	08/08/2013	100.000	100.200	100.1	1
KU	C1SR	2507447	08/2013	08/08/2013	100.000	100.100	100.2	1
KU	C1SR	2507448	08/2013	08/08/2013	99.900	100.100	100.0	1
KU	C1SR	2507449	08/2013	08/08/2013	100.000	100.200	100.1	1
KU	C1SR	2507450	08/2013	08/08/2013	100.000	100.100	100.2	1
KU	C1SR	2507451	08/2013	08/08/2013	100.000	100.100	100.2	1
KU	C1SR	2507452	08/2013	08/08/2013	100.000	100.000	100.1	1
Overall Result					X	X	X	7,120





ATTACHMENT  
B

Sampling Test Results

**KU**  
**2013 SAMPLE**  
**ELECTRIC METER SUMMARY**

**SAMPLE**

In-Service Population	491,450	Divided into 60 Lots
Sample Quantity	4,143	
Meters Tested	4,143	
Meters Not Tested	0	
Failed Lots	0	
Failed Lot Meters	0	

Kentucky Utilities

2013 Sample Test Program ( 01/01/2013 ) to ( 12/31/2013 )

Device Category: F2S240V30AC200 Model Number: AB1 Division: 01 Sample Lot: 1116 Lot Descr: KU AB1  
 In Service Population: 10,000 Sample Quantity: 75 Meters Tested: 75 Pass/ Fail: PASS

Test Results Per ANSI/ASQC Z1.9-1993

Double Specification Limit - Variability Unknown - Standard Deviation Method  
 One AQL Value for Both Upper and Lower Specification Limit Combined  
 AQL = 2.5% - Inspection Level II "E" # Normal Inspection

Page 1  
 Run Date: 12/31/2013  
 Run Time: 02:31:01 AM

Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy
C331725	99.30	C331738	98.30	C331744	99.60	C331785	99.40	C331816	99.60
C331980	100.30	C332052	98.30	C332340	100.30	C332380	99.80	C332431	99.80
C332708	99.20	C332865	99.30	C332955	99.50	C332996	99.40	C333102	99.80
C333218	99.50	C333263	99.90	C333408	99.90	C333625	99.90	C333655	100.30
C333765	99.40	L297631	99.50	L297659	98.80	L297739	100.30	L297784	99.90
L298008	99.70	L298055	99.30	L298177	100.10	L298207	98.40	L298673	99.90
L298709	99.40	L298926	100.40	L298929	100.20	L298957	100.10	L299477	99.90
L299592	100.20	L299622	99.60	L299623	98.80	L299665	98.90	L299895	100.20
L300270	99.80	L300300	99.80	L300348	100.30	L300640	100.00	L300641	99.40
L300786	100.00	L301240	99.80	L301368	99.60	L301712	99.30	L301743	100.20
L301888	99.40	L301942	100.70	L302031	100.60	L302159	99.00	L302224	99.80
L302429	99.90	L302487	100.10	L302657	100.10	L302793	100.30	L302799	100.10
L303285	99.70	L303330	100.20	L303405	100.00	M444912	99.20	M444966	99.20
M445047	100.40	M445069	100.00	M445162	99.60	M445221	100.20	M445229	100.00
M445797	99.60	W147192	99.50	W147360	99.30	W147366	100.00	W147964	100.00

INFORMATION NEEDED

VALUE OBTAINED

1 Sample Size (N)	75
2 Sum of Measurements: (Sum X)	7479.50
3 Sum of Squared Measurements	745924.45
4 Correction Factor (CF): Sum of Measurements Squared / N	745905.60
5 Corrected Sum of Squares (SS)	18.85
6 Variance (V) : SS/(N-1)	0.2547
7 Estimate of Lot Standard Deviation (S): SQRT of V	0.5047
8 Sample Mean (XBAR): Sum X/N	99.73
9 Upper Specification Limit (U)	102.00
10 Lower Specification Limit (L)	98.00
11 Quality Index Upper (QU): (U-XBAR) / S	4.50
12 Quality Index Lower (QL): (XBAR-L) / S	3.42
13 Estimate of Lot Percent NCF Above U (PU)	0.00
14 Estimate of Lot Percent NCF Below L (PL)	0.02
15 Total Estimate Percent NCF. In Lot (P): PU+PL	0.02
16 Maximum Allowable Percent NCF(M)	4.83
17 Acceptability Criterion: Compare P with M	PASS
18 The Lot Meets the Acceptability Criterion if P <= M	
19 The Lot Fails the Acceptability Criterion if P > M	



Kentucky Utilities

2013 Sample Test Program ( 01/01/2013 ) to ( 12/31/2013 )

Device Category: F2S240V30AC200

Model Number: AB1

Division: 01

Sample Lot: 1117

Lot Descr: KU AB1-2

In Service Population: 5,841

Sample Quantity: 75

Meters Tested: 75

Pass/ Fail: PASS

Test Results Per ANSI/ASQC Z1.9-1993

Double Specification Limit - Variability Unknown - Standard Deviation Method

One AQL Value for Both Upper and Lower Specification Limit Combined

AQL = 2.5% - Inspection Level II "E" # Normal Inspection

Page 2

Run Date: 12/31/2013

Run Time: 02:31:01 AM

Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy
C334198	100.00	C334237	99.80	C334355	98.70	C334413	98.80	C334431	99.80
C334442	100.10	C334531	99.80	C334580	99.90	C334710	99.70	C334714	100.00
C334765	100.00	C334855	100.10	C335070	100.50	C344890	100.00	C408131	100.30
C408175	100.30	C408210	99.10	C408213	100.40	C408277	100.30	C408371	100.30
C408420	100.30	C408485	100.50	C408539	100.30	C408839	100.10	C408857	99.90
C408868	99.70	C408986	100.00	C409106	100.10	C409135	100.40	C409220	100.40
C409268	99.90	C409481	99.80	C409531	100.00	C409533	100.40	C409714	100.40
C409739	100.20	C409841	100.20	C433599	100.50	C433636	100.00	C433718	100.50
C433755	100.20	C433855	100.20	C433876	100.20	C433973	100.30	C434513	100.10
C434562	100.30	C434614	100.30	C434665	100.10	C434736	100.30	C434800	100.20
C434801	100.20	C434807	100.00	C434826	100.20	C434861	100.30	C434880	100.20
C435013	100.30	C435068	100.00	C435103	100.10	C435140	100.10	C435216	100.40
C435217	99.90	W148125	99.80	W148134	99.50	W148163	99.80	W148355	100.30
W148379	99.80	W148414	100.00	W148468	100.60	W148551	100.20	W148562	100.00
W148729	98.70	W148978	100.00	W149039	99.10	W149164	99.90	W149193	100.20

INFORMATION NEEDED

VALUE OBTAINED

1 Sample Size (N)	75
2 Sum of Measurements: (Sum X)	7503.30
3 Sum of Squared Measurements	750671.21
4 Correction Factor (CF): Sum of Measurements Squared / N	750660.15
5 Corrected Sum of squares (ss)	11.06
6 Variance (V) : SS/(N-1)	0.1495
7 Estimate of Lot Standard Deviation(S): SQRT of V	0.3867
8 Sample Mean(XBAR) : Sum X/N	100.04
9 Upper Specification Limit (U)	102.00
10 Lower Specification Limit (L)	98.00
11 Quality Index Upper (QU): (U-XBAR) / s	5.06
12 Quality Index Lower (QL): (XBAR-L) / s	5.29
13 Estimate of Lot Percent NCF Above U (PU)	0.00
14 Estimate of Lot Percent NCF Below L (PL)	0.00
15 Total Estimate Percent NCF. In Lot (P): PU+PL	0.00
16 Maximum Allowable Percent NCF(M)	4.83
17 Acceptability Criterion: Compare P with M	PASS
18 The Lot Meets the Acceptability Criterion if P <= M	
19 The Lot Fails the Acceptability Criterion if P > M	

Kentucky Utilities

2013 Sample Test Program ( 01/01/2013 ) to ( 12/31/2013 )

Device Category: F2S240V30AC200E    Model Number: ALF    Division: 01    Sample Lot: 1118    Lot Descr: KU ALF - 1  
 In Service Population: 14    Sample Quantity: 3    Meters Tested: 3    Pass/ Fail: PASS

Test Results Per ANSI/ASQC Z1.9-1993

Double Specification Limit - Variability Unknown - Standard Deviation Method

One AQL Value for Both Upper and Lower Specification Limit Combined

AQL = 2.5% - Inspection Level II "E" # Normal Inspection

Page 3

Run Date: 12/31/2013

Run Time: 02:31:01 AM

Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy
2505755	100.00	2505756	99.90	2505758	100.00				

INFORMATION NEEDED

VALUE OBTAINED

1 Sample Size (N)	3
2 Sum of Measurements: (Sum X)	299.90
3 Sum of Squared Measurements	29980.01
4 Correction Factor (CF): Sum of Measurements Squared / N	29980.00
5 Corrected Sum of Squares (SS)	0.01
6 Variance (V) : SS/(N-1)	0.0033
7 Estimate of Lot Standard Deviation(S): SQRT of V	0.0577
8 Sample Mean(XBAR): Sum X/N	99.97
9 Upper Specification Limit (U)	102.00
10 Lower Specification Limit (L)	98.00
11 Quality Index Upper (QU): (U-XBAR) / s	35.22
12 Quality Index Lower (QL): (XBAR-L) / s	34.06
13 Estimate of Lot Percent NCF Above U (PU)	0.00
14 Estimate of Lot Percent NCF Below L (PL)	0.00
15 Total Estimate Percent NCF. In Lot (P): PU+PL	0.00
16 Maximum Allowable Percent NCF(M)	7.59
17 Acceptability Criterion: Compare P with M	PASS
18 The Lot Meets the Acceptability Criterion if P <= M	
19 The Lot Fails the Acceptability Criterion if P > M	

Kentucky Utilities

2013 Sample Test Program ( 01/01/2013 ) to ( 12/31/2013 )

Device Category: F2S240V30AC200E Model Number: C1SR Division: 01 Sample Lot: 1119 Lot Descr: KU C1S - 1  
 In Service Population: 10,000 Sample Quantity: 75 Meters Tested: 75 Pass/ Fail: PASS

Test Results Per ANSI/ASQC Z1.9-1993

Double Specification Limit - Variability Unknown - Standard Deviation Method  
 One AQL Value for Both Upper and Lower Specification Limit Combined  
 AQL = 2.5% - Inspection Level II "E" # Normal Inspection

Page 4

Run Date: 12/31/2013

Run Time: 02:31:01 AM

Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy
2000194	100.00	2000796	100.10	2000888	100.00	2000931	100.10	2001045	100.00
2001128	100.10	2001437	99.90	2001601	100.00	2001738	100.00	2001823	100.00
2001928	100.00	2002401	100.20	C352532	100.00	C352912	100.00	C369162	99.90
C369207	100.00	C369246	100.10	C380901	100.00	C380917	100.10	C380928	100.10
C381199	99.90	C381239	100.10	C381258	100.00	C381362	100.10	C381403	100.20
C381546	100.20	C381585	100.20	C381652	100.00	C381711	100.00	C381854	100.30
C382072	100.20	C382408	100.10	C382733	100.10	C382852	100.10	C406373	100.10
C407209	100.00	C407424	100.10	C407473	100.00	C407537	100.10	C407574	99.90
C407607	100.10	C407689	100.40	C407964	100.10	C416074	100.00	C416175	100.20
C416400	100.00	C416492	100.00	C416605	99.90	C416622	100.00	C416705	99.90
C416733	100.00	C416763	99.90	C416807	100.00	C417047	100.10	C417398	100.00
C417493	100.10	C465623	100.00	C465698	100.00	C465729	100.00	C465920	99.90
C465996	99.90	C466084	100.10	C466537	100.00	C466579	100.00	C466669	99.90
C466725	100.00	C466808	100.00	C466920	100.00	C466952	100.00	C467044	100.00
C467109	100.20	C467198	100.10	C467241	100.20	C467371	100.00	C467507	100.10

INFORMATION NEEDED

VALUE OBTAINED

1 Sample Size (N)	75
2 Sum of Measurements: (Sum X)	7503.40
3 Sum of Squared Measurements	750680.88
4 Correction Factor (CF): Sum of Measurements Squared / N	750680.15
5 Corrected Sum of Squares (SS)	0.73
6 Variance (V) : SS/(N-1)	0.0098
7 Estimate of Lot Standard Deviation(S): SQRT of V	0.0990
8 Sample Mean (XBAR): Sum X/N	100.05
9 Upper Specification Limit (U)	102.00
10 Lower Specification Limit (L)	98.00
11 Quality Index Upper (QU): (U-XBAR) / s	19.74
12 Quality Index Lower (QL): (XBAR-L) / s	20.65
13 Estimate of Lot Percent NCF Above U (PU)	0.00
14 Estimate of Lot Percent NCF Below L (PL)	0.00
15 Total Estimate Percent NCF. In Lot (P): PU+PL	0.00
16 Maximum Allowable Percent NCF (M)	4.83
17 Acceptability Criterion: Compare P with M	PASS
18 The Lot Meets the Acceptability Criterion if P <= M	
19 The Lot Fails the Acceptability Criterion if P > M	



Kentucky Utilities

2013 Sample Test Program ( 01/01/2013 ) to ( 12/31/2013 )

Device Category: F2S240V30AC200E Model Number: C1S Division: 01 Sample Lot: 1120 Lot Descr: KU C1S - 2  
 In Service Population: 10,000 Sample Quantity: 75 Meters Tested: 75 Pass/ Fail: PASS

Test Results Per ANSI/ASQC Z1.9-1993

Double Specification Limit - Variability Unknown - Standard Deviation Method  
 One AQL Value for Both Upper and Lower Specification Limit Combined  
 AQL = 2.5% - Inspection Level II "E" # Normal Inspection

Page 5  
 Run Date: 12/31/2013  
 Run Time: 02:31:01 AM

Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy
2002492	100.10	2002582	100.10	2002644	100.20	2002645	100.00	2002746	100.20
2002793	100.10	2002797	100.20	2002988	100.20	2003531	100.00	2003706	100.10
2003718	100.00	2003790	100.10	2003908	99.90	2003939	100.00	2004364	100.00
2004380	99.90	2004510	100.00	2004783	100.10	2004908	99.90	2005093	100.00
2005248	100.00	2005303	100.00	2005475	100.00	2005615	100.10	2005646	99.90
2005669	100.10	2005928	100.00	2006361	99.90	2006415	99.90	2007036	100.00
2007172	100.00	2007183	99.90	2007357	99.90	2007378	99.90	2007510	99.90
2007656	100.00	2007763	99.90	2007858	100.00	2008010	99.90	2008163	100.00
2008400	99.90	2008458	100.10	2008502	100.10	2008599	99.90	2008779	100.10
2009013	100.10	2500099	100.10	2500146	100.00	2500457	100.00	2500468	100.00
2500639	100.00	2500663	100.20	2500787	100.10	2501032	100.00	2501166	100.10
2501439	100.10	2501458	100.10	2501625	100.10	2501743	100.10	2501920	99.90
C467910	100.00	C467982	99.90	C468034	100.20	C468224	100.00	C468232	100.00
C468241	100.20	C468269	100.10	C468403	100.10	C468659	100.00	C468743	100.00
C468906	100.10	C469043	100.00	C469057	100.10	C469231	100.00	C469353	100.10

INFORMATION NEEDED

VALUE OBTAINED

1 Sample Size (N)	75
2 Sum of Measurements: (Sum X)	7502.20
3 Sum of Squared Measurements	750440.68
4 Correction Factor (CF): Sum of Measurements Squared / N	750440.06
5 Corrected Sum of Squares (SS)	0.62
6 Variance (V) : SS/(N-1)	0.0083
7 Estimate of Lot Standard Deviation(S): SQRT of V	0.0912
8 Sample Mean (XBAR): Sum X/N	100.03
9 Upper Specification Limit (U)	102.00
10 Lower Specification Limit (L)	98.00
11 Quality Index Upper (QU): (U-XBAR) / s	21.61
12 Quality Index Lower (QL): (XBAR-L) / s	22.25
13 Estimate of Lot Percent NCF Above U (PU)	0.00
14 Estimate of Lot Percent NCF Below L (PL)	0.00
15 Total Estimate Percent NCF. In Lot (P): PU+PL	0.00
16 Maximum Allowable Percent NCF (M)	4.83
17 Acceptability Criterion: Compare P with M	PASS
18 The Lot Meets the Acceptability Criterion if P <= M	
19 The Lot Fails the Acceptability Criterion if P > M	

Kentucky Utilities

2013 Sample Test Program ( 01/01/2013 ) to ( 12/31/2013 )

Device Category: F2S240V30AC200E Model Number: CIS Division: 01 Sample Lot: 1121 Lot Descr: KU CIS - 3  
 In Service Population: 10,000 Sample Quantity: 75 Meters Tested: 75 Pass/ Fail: PASS

Test Results Per ANSI/ASQC Z1.9-1993

Double Specification Limit - Variability Unknown - Standard Deviation Method  
 One AQL Value for Both Upper and Lower Specification Limit Combined  
 AQL = 2.5% - Inspection Level II "E" # Normal Inspection

Page 6

Run Date: 12/31/2013

Run Time: 02:31:01 AM

Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy
2009069	100.00	2009295	100.00	2009330	100.10	2009376	99.90	2009531	100.10
2009664	100.10	2009670	100.00	2009697	99.80	2009766	100.00	2009905	100.00
2010046	100.10	2010280	100.00	2010318	100.00	2010345	100.00	2010399	99.90
2010420	100.10	2010872	100.00	2010878	100.00	2011101	99.90	2011292	100.00
2011486	100.00	2011670	100.00	2011745	99.90	2012122	100.10	2012547	100.10
2012988	100.10	2013735	100.10	2013786	100.10	2013835	99.70	2013838	99.90
2013846	99.90	2014006	100.00	2014154	99.90	2014893	100.00	2014907	100.00
2014959	99.90	2014990	100.00	2015077	100.00	2015092	99.90	2015426	100.00
2015431	99.80	2015578	100.00	2015704	100.10	2015727	100.00	2015744	100.00
2015945	99.90	2015957	99.90	2016086	100.00	2016167	99.90	2016302	100.10
2016315	100.10	2016859	99.90	2017008	99.90	2017077	100.10	2502281	100.00
2502468	100.10	2502568	100.00	2502603	100.00	2502622	99.90	2503153	99.90
2503248	100.00	2503292	100.00	2503295	100.04	2503347	100.00	2503508	100.20
2503548	100.00	2503589	100.00	2503767	100.00	2503802	99.90	2504611	100.00
2504964	100.10	2505169	100.10	2505410	100.00	2505520	100.10	2505676	99.80

INFORMATION NEEDED

VALUE OBTAINED

1 Sample Size (N)	75
2 Sum of Measurements: (Sum X)	7499.44
3 Sum of Squared Measurements	749888.60
4 Correction Factor (CF): Sum of Measurements Squared / N	749888.00
5 Corrected Sum of Squares (SS)	0.60
6 Variance (V) : SS/(N-1)	0.0081
7 Estimate of Lot Standard Deviation (S): SQRT of V	0.0899
8 Sample Mean (XBAR) : Sum X/N	99.99
9 Upper Specification Limit (U)	102.00
10 Lower Specification Limit (L)	98.00
11 Quality Index Upper (QU): (U-XBAR) / S	22.34
12 Quality Index Lower (QL): (XBAR-L) / S	22.18
13 Estimate of Lot Percent NCF Above U (PU)	0.00
14 Estimate of Lot Percent NCF Below L (PL)	0.00
15 Total Estimate Percent NCF. In Lot (P): PU+PL	0.00
16 Maximum Allowable Percent NCF (M)	4.83
17 Acceptability Criterion: Compare P with M	PASS
18 The Lot Meets the Acceptability Criterion if P <= M	
19 The Lot Fails the Acceptability Criterion if P > M	

Kentucky Utilities

2013 Sample Test Program ( 01/01/2013 ) to ( 12/31/2013 )

Device Category: F2S240V30AC200E    Model Number: C1S    Division: 01    Sample Lot: 1122    Lot Descr: KU C1S - 4  
 In Service Population: 7,001    Sample Quantity: 75    Meters Tested: 75    Pass/ Fail: PASS

Test Results Per ANSI/ASQC Z1.9-1993

Double Specification Limit - Variability Unknown - Standard Deviation Method

One AQL Value for Both Upper and Lower Specification Limit Combined

AQL = 2.5% - Inspection Level II "E" # Normal Inspection

Page 7

Run Date: 12/31/2013

Run Time: 02:31:01 AM

Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy
2017860	100.00	2017874	100.00	2018633	99.90	2018672	100.00	2018741	99.90
2018756	99.80	2018882	99.80	2018907	100.00	2018938	100.00	2019095	100.10
2019118	99.70	2019262	99.90	2019401	99.90	2019475	99.80	2019590	100.00
2019595	99.70	2019642	99.90	2019975	99.90	2020016	99.70	2020129	100.00
2020236	99.90	2020339	100.10	2020378	99.90	2020411	100.00	2020645	100.10
2021138	99.80	2021290	100.00	2021436	100.00	2021615	99.90	2021626	100.00
2021664	100.00	2021790	100.00	2021793	100.00	2021811	99.80	2021889	99.90
2021957	100.10	2022050	100.00	2022226	99.90	2022311	100.00	2022336	100.00
2022417	100.00	2022544	100.00	2023124	99.90	2023221	99.90	2023289	99.90
2023348	99.90	2023462	100.00	2023567	99.80	2023597	100.00	2023803	100.00
2023892	99.90	2023958	99.80	2024323	99.90	2024355	100.00	2024499	100.00
2024505	100.00	2024898	99.90	2024907	100.00	2025168	99.80	2025234	99.80
2025855	99.90	2025923	100.00	2025933	100.00	2026152	99.80	2027165	100.00
2027486	100.00	2027519	99.80	2027834	100.00	2028791	100.00	2028855	100.00
2032019	100.00	2032664	100.00	2505823	99.90	2505936	100.20	2505966	100.00

INFORMATION NEEDED

VALUE OBTAINED

1 Sample Size (N)	75
2 Sum of Measurements: (Sum X)	7495.50
3 Sum of Squared Measurements	749100.99
4 Correction Factor (CF): Sum of Measurements Squared / N	749100.27
5 Corrected Sum of Squares (SS)	0.72
6 Variance (V) : SS/(N-1)	0.0097
7 Estimate of Lot Standard Deviation(S): SQRT of V	0.0986
8 Sample Mean(XBAR): Sum X/N	99.94
9 Upper Specification Limit (U)	102.00
10 Lower Specification Limit (L)	98.00
11 Quality Index Upper (QU): (U-XBAR) / S	20.88
12 Quality Index Lower (QL): (XBAR-L) / S	19.67
13 Estimate of Lot Percent NCF Above U (PU)	0.00
14 Estimate of Lot Percent NCF Below L (PL)	0.00
15 Total Estimate Percent NCF. In Lot (P): PU+PL	0.00
16 Maximum Allowable Percent NCF(M)	4.83
17 Acceptability Criterion: Compare P with M	PASS
18 The Lot Meets the Acceptability Criterion if P <= M	
19 The Lot Fails the Acceptability Criterion if P > M	



Kentucky Utilities

2013 Sample Test Program ( 01/01/2013 ) to ( 12/31/2013 )

Device Category: F2S240V30AC200

Model Number: D4S

Division: 01

Sample Lot: 1123

Lot Descr: KU D4S - 1

In Service Population: 10,000

Sample Quantity: 75

Meters Tested: 75

Pass/ Fail: PASS

Test Results Per ANSI/ASQC Z1.9-1993

Double Specification Limit - Variability Unknown - Standard Deviation Method

One AQL Value for Both Upper and Lower Specification Limit Combined

AQL = 2.5% - Inspection Level II "E" # Normal Inspection

Page 8

Run Date: 12/31/2013

Run Time: 02:31:01 AM

Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy
C222033	99.90	C222072	99.80	C222179	100.00	C223067	99.60	C224087	100.00
C225262	99.60	C226337	100.10	C226351	99.60	C226385	100.00	C227663	100.00
C227685	100.20	C227690	99.30	C228043	99.90	C228160	99.90	C228457	100.00
C228509	100.30	C228513	100.00	C228525	99.80	C228556	99.90	C228578	99.60
C228618	100.10	C228636	99.60	C229661	100.40	C229763	99.90	C230685	100.00
C231857	100.00	C232050	100.30	C232269	100.00	C232417	100.30	C233671	100.30
C233766	100.00	C233837	99.90	C233844	99.60	C236032	99.90	C236044	100.20
C236265	100.10	C236928	100.30	I008084	99.50	I129297	99.80	I136358	99.70
I141173	100.30	M345505	99.50	M345654	100.20	M345704	99.60	M345737	100.00
M345760	99.40	M350653	99.60	M350705	99.90	M351716	99.90	M352512	100.40
M353038	99.70	M353994	99.90	M353995	100.20	M367821	99.90	M367934	99.80
M375017	99.60	M375114	100.20	M375589	99.90	M375649	99.60	M376124	99.80
M376455	100.20	M376457	100.30	M376608	99.60	M376696	99.50	M376906	99.40
M381036	99.70	W101488	100.60	W102725	100.30	W102785	99.50	W102825	100.30
W104889	99.80	W105173	100.00	W105715	99.70	W106623	99.90	W107546	99.70

INFORMATION NEEDED

VALUE OBTAINED

1 Sample Size (N)	75
2 Sum of Measurements: (Sum X)	7493.30
3 Sum of Squared Measurements	748666.55
4 Correction Factor (CF): Sum of Measurements Squared / N	748660.60
5 Corrected Sum of Squares (SS)	5.95
6 Variance (V) : SS/(N-1)	0.0804
7 Estimate of Lot Standard Deviation(S): SQRT of V	0.2836
8 Sample Mean(XBAR): Sum X/N	99.91
9 Upper Specification Limit (U)	102.00
10 Lower Specification Limit (L)	98.00
11 Quality Index Upper (QU): (U-XBAR) / S	7.37
12 Quality Index Lower (QL): (XBAR-L) / S	6.74
13 Estimate of Lot Percent NCF Above U (PU)	0.00
14 Estimate of Lot Percent NCF Below L (PL)	0.00
15 Total Estimate Percent NCF. In Lot (P): PU+PL	0.00
16 Maximum Allowable Percent NCF(M)	4.83
17 Acceptability Criterion: Compare P with M	PASS
18 The Lot Meets the Acceptability Criterion if P <= M	
19 The Lot Fails the Acceptability Criterion if P > M	

Kentucky Utilities

2013 Sample Test Program ( 01/01/2013 ) to ( 12/31/2013 )

Device Category: F2S240V30AC200    Model Number: D4S    Division: 01    Sample Lot: 1124    Lot Descr: KU D4S-2  
 In Service Population: 10,000    Sample Quantity: 75    Meters Tested: 75    Pass/ Fail: PASS

Test Results Per ANSI/ASQC Z1.9-1993

Double Specification Limit - Variability Unknown - Standard Deviation Method  
 One AQL Value for Both Upper and Lower Specification Limit Combined  
 AQL = 2.5% - Inspection Level II "E" # Normal Inspection

Page 9  
 Run Date: 12/31/2013  
 Run Time: 02:31:01 AM

Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy
C240746	100.10	C241153	100.40	C241232	100.00	C241255	100.20	C241270	99.60
C241307	99.80	C245374	99.90	C245537	99.80	C245706	99.90	C245785	99.70
C250473	99.90	C254978	100.00	C255147	100.20	C255424	100.00	L216222	100.00
L216388	99.70	L216395	99.80	L221706	100.10	M385805	99.90	M385844	99.80
M386656	100.30	M389083	99.80	M389084	99.70	M389204	100.00	M389261	100.00
M389335	100.00	M389594	100.10	M389720	100.10	M389789	100.20	M389793	100.20
M390335	99.70	M390393	99.90	M390405	100.00	M390553	100.20	M390760	99.90
M392242	99.90	M392490	100.30	M392496	100.20	M392545	99.80	M392819	99.90
M393236	99.70	M393280	99.90	M393334	100.30	M396104	99.70	M396209	99.90
M396274	99.60	M396561	99.70	M396859	99.90	M397137	99.60	M397255	99.70
M397543	99.80	M397686	99.80	M397777	100.00	M398056	99.90	M398178	99.80
M398353	99.90	M398416	100.00	M398625	100.00	W109645	99.90	W109690	100.00
W110100	99.70	W110337	100.00	W110903	99.90	W110966	100.10	W112075	99.70
W112085	99.80	W112107	99.80	W112336	99.80	W112358	100.00	W112377	99.90
W114609	100.50	W114621	100.20	W114814	100.30	W114908	100.20	W116930	100.20

INFORMATION NEEDED

VALUE OBTAINED

1 Sample Size (N)	75
2 Sum of Measurements: (Sum X)	7496.20
3 Sum of Squared Measurements	749243.20
4 Correction Factor (CF): Sum of Measurements Squared / N	749240.19
5 Corrected Sum of Squares (SS)	3.01
6 Variance (V) : SS/(N-1)	0.0406
7 Estimate of Lot Standard Deviation(S): SQRT of V	0.2016
8 Sample Mean (XBAR) : Sum X/N	99.95
9 Upper Specification Limit (U)	102.00
10 Lower Specification Limit (L)	98.00
11 Quality Index Upper (QU): (U-XBAR) / S	10.17
12 Quality Index Lower (QL): (XBAR-L) / S	9.67
13 Estimate of Lot Percent NCF Above U (PU)	0.00
14 Estimate of Lot Percent NCF Below L (PL)	0.00
15 Total Estimate Percent NCF. In Lot (P): PU+PL	0.00
16 Maximum Allowable Percent NCF (M)	4.83
17 Acceptability Criterion: Compare P with M	PASS
18 The Lot Meets the Acceptability Criterion if P <= M	
19 The Lot Fails the Acceptability Criterion if P > M	

Kentucky Utilities

2013 Sample Test Program ( 01/01/2013 ) to ( 12/31/2013 )

Device Category: F2S240V30AC200      Model Number: D4S      Division: 01      Sample Lot: 1125      Lot Descr: KU D4S - 3  
 In Service Population: 7,221      Sample Quantity: 75      Meters Tested: 75      Pass/ Fail: PASS

Test Results Per ANSI/ASQC Z1.9-1993

Double Specification Limit - Variability Unknown - Standard Deviation Method

One AQL Value for Both Upper and Lower Specification Limit Combined

AQL = 2.5% - Inspection Level II "E" # Normal Inspection

Page 10

Run Date: 12/31/2013

Run Time: 02:31:01 AM

Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy
C221969	99.90	C222025	100.20	C222145	100.10	C222219	99.90	C222840	100.30
C256935	100.10	C256961	100.40	C256973	100.00	C257060	100.00	C257133	100.10
C257323	100.00	C257411	100.40	C257433	100.60	C257440	100.40	C257771	100.10
C263999	100.30	C264019	99.90	C264040	99.70	L218884	100.00	L218919	99.70
L219222	99.70	L219280	100.10	L219315	100.10	L219319	99.70	L223882	100.40
L224047	99.60	L224154	100.10	L224339	99.60	L224361	100.30	L224419	99.80
L224430	99.80	L224639	99.90	L224734	99.80	L224822	100.30	L227770	99.70
L228336	100.00	L228451	99.90	L228560	99.90	L228737	99.80	L228860	99.60
L228880	100.00	L228972	99.90	M394609	100.00	M394677	100.40	M394768	100.40
M394906	99.80	M394961	99.90	M395031	99.70	M395169	100.10	M395244	99.80
M395335	99.60	M395386	100.10	M395493	99.70	M395856	99.90	M395900	99.90
M398723	99.60	M398856	99.70	M399268	99.70	M399431	99.40	M401163	99.80
M401239	99.70	M401505	100.30	M401652	99.80	M401772	100.10	M401980	99.80
M427819	100.20	M427871	100.40	W119519	100.00	W119620	100.50	W119931	99.80
W120009	100.40	W120185	99.70	W120298	99.80	W120431	100.30	W120509	100.00

INFORMATION NEEDED

VALUE OBTAINED

1 Sample Size (N)	75
2 Sum of Measurements: (Sum X)	7498.40
3 Sum of Squared Measurements	749685.30
4 Correction Factor (CF): Sum of Measurements Squared / N	749680.03
5 Corrected Sum of Squares (SS)	5.27
6 Variance (V) : SS/(N-1)	0.0712
7 Estimate of Lot Standard Deviation(S): SQRT of V	0.2668
8 Sample Mean(XBAR) : Sum X/N	99.98
9 Upper Specification Limit (U)	102.00
10 Lower Specification Limit (L)	98.00
11 Quality Index Upper (QU): (U-XBAR) / S	7.58
12 Quality Index Lower (QL): (XBAR-L) / S	7.42
13 Estimate of Lot Percent NCF Above U (PU)	0.00
14 Estimate of Lot Percent NCF Below L (PL)	0.00
15 Total Estimate Percent NCF. In Lot (P): PU+PL	0.00
16 Maximum Allowable Percent NCF(M)	4.83
17 Acceptability Criterion: Compare P with M	PASS
18 The Lot Meets the Acceptability Criterion if P <= M	
19 The Lot Fails the Acceptability Criterion if P > M	



Kentucky Utilities

2013 Sample Test Program ( 01/01/2013 ) to ( 12/31/2013 )

Device Category: F2S240V30AC200    Model Number: D5S    Division: 01    Sample Lot: 1126    Lot Descr: KU D5S - 1  
 In Service Population: 472    Sample Quantity: 25    Meters Tested: 25    Pass/ Fail: PASS

Test Results Per ANSI/ASQC Z1.9-1993

Double Specification Limit - Variability Unknown - Standard Deviation Method

One AQL Value for Both Upper and Lower Specification Limit Combined

AQL = 2.5% - Inspection Level II "E" # Normal Inspection

Page 11

Run Date: 12/31/2013

Run Time: 02:31:01 AM

Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy
C279781	99.90	C279824	99.60	C279866	100.00	C279883	99.80	C279970	99.90
C279975	99.70	C283559	99.90	C283596	99.40	C283612	99.20	C283626	99.40
C283708	99.50	C298903	100.40	C298947	100.20	C298966	100.40	C298984	100.20
C299003	100.10	C299018	100.10	C299020	99.50	C299034	99.90	C299057	100.00
C299098	100.10	C299128	100.20	C299141	100.30	C299153	100.30	C299166	100.00

INFORMATION NEEDED

VALUE OBTAINED

1 Sample Size (N)	25
2 Sum of Measurements: (Sum X)	2498.00
3 Sum of Squared Measurements	249602.84
4 Correction Factor (CF): Sum of Measurements Squared / N	249600.16
5 Corrected Sum of Squares (SS)	2.68
6 Variance (V) : SS/(N-1)	0.1117
7 Estimate of Lot Standard Deviation(S): SQRT of V	0.3342
8 Sample Mean (XBAR): Sum X/N	99.92
9 Upper Specification Limit (U)	102.00
10 Lower Specification Limit (L)	98.00
11 Quality Index Upper (QU): (U-XBAR) / s	6.22
12 Quality Index Lower (QL): (XBAR-L) / s	5.75
13 Estimate of Lot Percent NCF Above U (PU)	0.00
14 Estimate of Lot Percent NCF Below L (PL)	0.00
15 Total Estimate Percent NCF. In Lot (P): PU+PL	0.00
16 Maximum Allowable Percent NCF(M)	5.98
17 Acceptability Criterion: Compare P with M	PASS
18 The Lot Meets the Acceptability Criterion if P <= M	
19 The Lot Fails the Acceptability Criterion if P > M	

Kentucky Utilities

2013 Sample Test Program ( 01/01/2013 ) to ( 12/31/2013 )

Device Category: F2S240V30AC200E Model Number: I210 Division: 01 Sample Lot: 1127 Lot Descr: KU I210 - 1  
 In Service Population: 5,238 Sample Quantity: 75 Meters Tested: 75 Pass/ Fail: PASS

Test Results Per ANSI/ASQC Z1.9-1993

Double Specification Limit - Variability Unknown - Standard Deviation Method  
 One AQL Value for Both Upper and Lower Specification Limit Combined  
 AQL = 2.5% - Inspection Level II "E" # Normal Inspection

Page 12  
 Run Date: 12/31/2013  
 Run Time: 02:31:01 AM

Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy
C432006	99.90	C432140	99.90	C432172	100.00	C432177	99.90	C432216	100.00
C432298	100.00	C432356	99.90	C432381	99.90	C432393	100.00	C432425	100.00
C432456	100.10	C432513	99.90	C432541	99.90	C432616	99.90	C432803	99.90
C432813	99.90	C433001	100.10	C433079	99.20	C433089	100.00	C433227	100.00
C433416	99.90	C445522	100.00	C445544	99.90	C445570	99.90	C445572	100.00
C445595	99.90	C445895	100.00	C446076	99.90	C446174	99.90	C446251	100.00
C456401	99.90	C456532	100.00	C456543	100.00	C456555	99.90	C456708	99.90
C456714	100.00	C456782	100.00	C456815	99.90	C456903	100.00	C456925	100.00
C456951	100.10	C457192	100.00	C457208	99.90	C457255	100.00	C457257	100.00
C457271	100.00	C457330	100.00	C457378	100.00	C457390	100.00	C457397	99.90
C457503	100.00	C457633	100.00	C463942	100.10	C464025	99.90	C464054	100.00
C464259	100.10	C464272	100.00	C464273	100.10	C464285	100.20	C464360	100.00
C464457	100.00	C464487	100.00	C464542	100.10	C464661	99.90	C464694	100.20
C464707	100.00	C464812	100.00	C464834	100.00	C464885	100.00	C464937	100.00
C465224	100.00	C465229	100.10	C465248	100.00	C465572	100.00	C465579	100.00

INFORMATION NEEDED

VALUE OBTAINED

1 Sample Size (N)	75
2 Sum of Measurements: (Sum X)	7498.00
3 Sum of Squared Measurements	749601.04
4 Correction Factor (CF): Sum of Measurements Squared / N	749600.05
5 Corrected Sum of Squares (SS)	0.99
6 Variance (V) : SS/(N-1)	0.0133
7 Estimate of Lot Standard Deviation(S): SQRT of V	0.1155
8 Sample Mean(XBAR): Sum X/N	99.97
9 Upper Specification Limit (U)	102.00
10 Lower Specification Limit (L)	98.00
11 Quality Index Upper (QU): (U-XBAR) / S	17.55
12 Quality Index Lower (QL): (XBAR-L) / S	17.09
13 Estimate of Lot Percent NCF Above U (PU)	0.00
14 Estimate of Lot Percent NCF Below L (PL)	0.00
15 Total Estimate Percent NCF. In Lot (P): PU+PL	0.00
16 Maximum Allowable Percent NCF(M)	4.83
17 Acceptability Criterion: Compare P with M	PASS
18 The Lot Meets the Acceptability Criterion if P <= M	
19 The Lot Fails the Acceptability Criterion if P > M	

Kentucky Utilities

2013 Sample Test Program ( 01/01/2013 ) to ( 12/31/2013 )

Device Category: F2S240V15AC100      Model Number: I50S      Division: 01      Sample Lot: 1128      Lot Descr: KU I50 - 1  
 In Service Population: 1,162      Sample Quantity: 35      Meters Tested: 35      Pass/ Fail: PASS

Test Results Per ANSI/ASQC Z1.9-1993

Double Specification Limit - Variability Unknown - Standard Deviation Method

One AQL Value for Both Upper and Lower Specification Limit Combined

AQL = 2.5% - Inspection Level II "E" # Normal Inspection

Page 13

Run Date: 12/31/2013

Run Time: 02:31:01 AM

Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy
C171474	100.50	C174527	100.30	C174873	99.90	C183466	100.30	C284793	100.50
C286524	99.90	L062418	99.90	L064317	99.90	L064338	99.60	L064974	99.80
L066919	100.40	L070251	99.80	L070313	100.30	L071319	100.00	L072764	100.10
L073080	100.10	L073381	100.00	L073802	99.80	L074157	100.00	L074296	100.00
L075289	99.90	L075481	99.60	M431753	100.70	W072138	100.60	W076349	100.00
W077821	99.80	W078887	100.00	W079040	100.10	W079043	101.90	W079330	99.90
W079334	99.90	W079360	100.20	W081301	100.20	W081324	99.70	W083050	100.60

INFORMATION NEEDED

VALUE OBTAINED

1 Sample Size (N)	35
2 Sum of Measurements: (Sum X)	3504.20
3 Sum of Squared Measurements	350846.50
4 Correction Factor (CF): Sum of Measurements Squared / N	350840.50
5 Corrected Sum of Squares (SS)	6.00
6 Variance (V) : SS/(N-1)	0.1764
7 Estimate of Lot Standard Deviation(S): SQRT of V	0.4199
8 Sample Mean(XBAR): Sum X/N	100.12
9 Upper Specification Limit (U)	102.00
10 Lower Specification Limit (L)	98.00
11 Quality Index Upper (QU): (U-XBAR) / S	4.48
12 Quality Index Lower (QL): (XBAR-L) / S	5.05
13 Estimate of Lot Percent NCF Above U (PU)	0.00
14 Estimate of Lot Percent NCF Below L (PL)	0.00
15 Total Estimate Percent NCF. In Lot (P): PU+PL	0.00
16 Maximum Allowable Percent NCF (M)	5.58
17 Acceptability Criterion: Compare P with M	PASS
18 The Lot Meets the Acceptability Criterion if P <= M	
19 The Lot Fails the Acceptability Criterion if P > M	



Kentucky Utilities

2013 Sample Test Program ( 01/01/2013 ) to ( 12/31/2013 )

Device Category: F2S240V15AC100    Model Number: IS5S    Division: 01    Sample Lot: 1129    Lot Descr: KU I55 - 1  
 In Service Population: 1,019    Sample Quantity: 35    Meters Tested: 35    Pass/ Fail: PASS

Test Results Per ANSI/ASQC Z1.9-1993

Double Specification Limit - Variability Unknown - Standard Deviation Method

One AQL Value for Both Upper and Lower Specification Limit Combined

AQL = 2.5% -, Inspection Level II "E" # Normal Inspection

Page 14

Run Date: 12/31/2013

Run Time: 02:31:01 AM

Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy
C200904	99.90	L002117	99.50	L009457	99.80	L075977	99.80	L076406	100.00
L076453	100.00	L076673	99.80	L076938	100.20	L077613	99.50	L078036	99.90
L078830	100.20	L079495	99.90	L079865	100.00	L080033	100.00	L080215	100.10
L080899	99.80	L081692	99.90	L081701	100.00	L082493	100.10	L082496	100.00
L082848	99.70	L083871	99.60	L083882	100.00	L084030	99.90	L084399	99.70
L085477	100.00	L085767	99.70	L085921	99.90	L086818	99.70	L087005	100.20
L087127	100.20	L087431	99.80	L088678	99.60	L089612	100.00	M417696	99.90

INFORMATION NEEDED

VALUE OBTAINED

1 Sample Size (N)	35
2 Sum of Measurements: (Sum X)	3496.30
3 Sum of Squared Measurements	349261.63
4 Correction Factor (CF): Sum of Measurements Squared / N	349260.39
5 Corrected Sum of Squares (SS)	1.24
6 Variance (V) : SS/(N-1)	0.0364
7 Estimate of Lot Standard Deviation(S): SQRT of V	0.1909
8 Sample Mean(XBAR): Sum X/N	99.89
9 Upper Specification Limit (U)	102.00
10 Lower Specification Limit (L)	98.00
11 Quality Index Upper (QU): (U-XBAR) / S	11.03
12 Quality Index Lower (QL): (XBAR-L) / S	9.92
13 Estimate of Lot Percent NCF Above U (PU)	0.00
14 Estimate of Lot Percent NCF Below L (PL)	0.00
15 Total Estimate Percent NCF. In Lot (P): PU+PL	0.00
16 Maximum Allowable Percent NCF (M)	5.58
17 Acceptability Criterion: Compare P with M	PASS
18 The Lot Meets the Acceptability Criterion if P <= M	
19 The Lot Fails the Acceptability Criterion if P > M	

Kentucky Utilities

2013 Sample Test Program ( 01/01/2013 ) to ( 12/31/2013 )

Device Category: F2S240V30AC200    Model Number: I60S    Division: 01    Sample Lot: 1130    Lot Descr: KU I60 - 1  
 In Service Population: 10,000    Sample Quantity: 75    Meters Tested: 75    Pass/ Fail: PASS

Test Results Per ANSI/ASQC Z1.9-1993

Double Specification Limit - Variability Unknown - Standard Deviation Method

One AQL Value for Both Upper and Lower Specification Limit Combined

AQL = 2.5% - Inspection Level II "E" # Normal Inspection

Page 15

Run Date: 12/31/2013

Run Time: 02:31:01 AM

Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy
C203602	100.30	C203827	100.30	C203839	100.40	C204177	100.20	C204507	100.00
C204853	100.20	C206130	100.10	L003760	99.90	L004795	99.40	L004891	99.90
L005876	100.10	L009615	99.80	L013635	99.80	L013900	100.00	L016691	99.70
L016725	99.80	L018625	99.80	L020505	100.10	L069355	100.00	L071152	99.70
L090092	99.70	L090759	100.00	L091214	99.80	L091351	99.80	L091765	99.90
L091799	100.30	L092296	100.00	L092400	99.90	L092514	100.20	L092586	100.00
L092663	99.70	L092858	100.00	L093126	99.80	L093134	100.30	L093533	99.60
L095343	100.20	L095558	99.60	L095773	99.80	L095835	100.40	L096402	100.10
L096913	100.30	L096918	99.80	L097147	100.00	L097156	99.90	L097228	100.50
L097506	100.50	L097668	100.10	L097894	99.80	L098264	99.60	L098384	99.90
L098924	100.40	L100392	99.90	L100535	99.70	L101070	100.00	L101322	99.90
L101371	99.90	L102136	100.30	L102267	99.90	L102596	100.00	L102621	100.20
L103039	99.80	L103521	99.90	L104619	99.80	L104625	100.00	L104840	99.70
L104902	100.20	L104916	100.10	L105242	99.70	L105725	100.00	L106202	100.10
L106682	99.70	L107117	99.80	L107123	99.90	L107205	99.70	W091482	100.10

INFORMATION NEEDED

VALUE OBTAINED

1 Sample size (N)	75
2 Sum of Measurements: (Sum X)	7497.70
3 Sum of Squared Measurements	749544.13
4 Correction Factor (CF): Sum of Measurements Squared / N	749540.07
5 Corrected Sum of Squares (SS)	4.06
6 Variance (V) : SS/(N-1)	0.0549
7 Estimate of Lot Standard Deviation(S): SQRT of V	0.2342
8 Sample Mean(XBAR): Sum X/N	99.97
9 Upper Specification Limit (U)	102.00
10 Lower Specification Limit (L)	98.00
11 Quality Index Upper (QU): (U-XBAR) / S	8.67
12 Quality Index Lower (QL): (XBAR-L) / S	8.41
13 Estimate of Lot Percent NCF Above U (PU)	0.00
14 Estimate of Lot Percent NCF Below L (PL)	0.00
15 Total Estimate Percent NCF. In Lot (P): PU+PL	0.00
16 Maximum Allowable Percent NCF(M)	4.83
17 Acceptability Criterion: Compare P with M	PASS
18 The Lot Meets the Acceptability Criterion if P <= M	
19 The Lot Fails the Acceptability Criterion if P > M	

Kentucky Utilities

2013 Sample Test Program ( 01/01/2013 ) to ( 12/31/2013 )

Device Category: F2S240V30AC200  
In Service Population: 10,000

Model Number: I60S  
Sample Quantity: 75

Division: 01  
Meters Tested: 75

Sample Lot: 1131  
Pass/ Fail: PASS

Lot Descr: KU I60 - 2

Test Results Per ANSI/ASQC Z1.9-1993

Double Specification Limit - Variability Unknown - Standard Deviation Method

One AQL Value for Both Upper and Lower Specification Limit Combined

AQL = 2.5% - Inspection Level II "E" # Normal Inspection

Page 16

Run Date: 12/31/2013

Run Time: 02:31:01 AM

Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy
C209460	100.10	C209478	100.00	C209534	99.90	C210708	100.30	C213152	100.40
L002757	100.30	L002929	100.10	L007799	99.90	L010061	100.00	L010784	100.00
L015506	99.80	L017798	99.90	L048901	99.90	L070649	100.10	L074335	99.80
L080843	99.60	L084576	99.80	L097360	99.90	L101978	99.70	L103922	99.70
L107935	100.00	L107947	99.70	L108574	99.80	L108818	99.80	L109264	100.20
L109271	100.10	L109409	99.70	L109446	99.80	L109898	100.00	L109989	99.80
L110224	100.10	L110504	99.90	L110777	99.80	L110992	99.00	L111017	99.90
L111162	99.70	L111177	99.60	L111211	100.10	L111445	99.90	L111458	99.50
L111510	100.30	L111707	100.10	L111813	99.80	L112181	100.20	L112194	99.70
L112434	99.80	L112857	99.80	L112983	99.90	L113109	99.90	L113215	99.50
L113269	99.80	L113275	99.90	L113333	99.80	L113440	99.70	L113932	100.10
L113991	100.00	L114139	99.70	L114255	99.70	L114429	99.60	L114631	99.80
L114638	100.10	L115053	100.00	L115165	99.80	L115246	100.00	L115629	99.90
L115999	99.90	L116595	100.40	L116710	99.70	L117043	99.90	L117226	100.20
L117294	100.00	L117975	100.30	L118152	100.10	L118176	99.70	L118271	100.10

INFORMATION NEEDED

VALUE OBTAINED

1 Sample Size (N)	75
2 Sum of Measurements: (Sum X)	7492.80
3 Sum of Squared Measurements	748564.62
4 Correction Factor (CF): Sum of Measurements Squared / N	748560.69
5 Corrected Sum of Squares (SS)	3.93
6 Variance (V) : SS/(N-1)	0.0531
7 Estimate of Lot Standard Deviation(S): SQRT of V	0.2304
8 Sample Mean(XBAR) : Sum X/N	99.90
9 Upper Specification Limit (U)	102.00
10 Lower Specification Limit (L)	98.00
11 Quality Index Upper (QU): (U-XBAR) / S	9.10
12 Quality Index Lower (QL): (XBAR-L) / S	8.26
13 Estimate of Lot Percent NCF Above U (PU)	0.00
14 Estimate of Lot Percent NCF Below L (PL)	0.00
15 Total Estimate Percent NCF. In Lot (P): PU+PL	0.00
16 Maximum Allowable Percent NCF (M)	4.83
17 Acceptability Criterion: Compare P with M	PASS
18 The Lot Meets the Acceptability Criterion if P <= M	
19 The Lot Fails the Acceptability Criterion if P > M	



Kentucky Utilities

2013 Sample Test Program ( 01/01/2013 ) to ( 12/31/2013 )

Device Category: F2S240V30AC200    Model Number: I60S    Division: 01    Sample Lot: 1132    Lot Descr: KU I60 - 3  
 In Service Population: 10,000    Sample Quantity: 75    Meters Tested: 75    Pass/ Fail: PASS

Test Results Per ANSI/ASQC Z1.9-1993

Double Specification Limit - Variability Unknown - Standard Deviation Method

One AQL Value for Both Upper and Lower Specification Limit Combined

AQL = 2.5% - Inspection Level II "E" # Normal Inspection

Page 17

Run Date: 12/31/2013

Run Time: 02:31:01 AM

Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy
C216809	100.40	C218730	100.40	C218889	100.40	C218913	100.10	C218993	100.00
C219027	100.30	L001664	99.90	L003826	100.30	L004405	100.00	L005834	99.90
L011487	99.80	L011940	99.80	L013452	99.70	L015351	99.90	L015548	99.70
L019879	100.10	L021529	100.00	L064078	100.10	L066564	100.00	L067325	100.00
L068338	100.00	L070942	99.80	L080298	100.20	L084520	100.20	L087814	100.10
L089497	100.10	L089810	100.10	L090977	100.20	L091332	100.10	L093940	100.40
L095573	100.20	L099587	99.70	L118398	100.10	L118404	100.10	L118423	99.90
L119143	99.70	L119217	99.70	L120145	99.80	L120392	100.00	L120673	100.10
L120748	100.30	L120750	100.10	L120825	100.00	L121006	100.00	L121094	99.90
L121342	99.80	L121347	100.00	L121421	100.10	L121626	100.30	L121641	100.00
L121972	99.70	L122077	100.10	L122241	100.10	L122492	100.20	L123479	100.10
L123483	100.50	L123494	100.10	L123755	100.00	L123881	100.00	L124080	100.00
L124196	100.50	L124417	100.10	L124537	100.20	L124846	100.20	L124947	99.60
L125364	100.40	L125365	100.30	L125659	99.20	L125697	99.80	L125933	99.80
L125944	99.70	L126046	100.10	L126123	100.00	L126425	100.20	L126699	100.10

INFORMATION NEEDED

VALUE OBTAINED

1 Sample Size (N)	75
2 Sum of Measurements: (Sum X)	7502.80
3 Sum of Squared Measurements	750564.02
4 Correction Factor (CF): Sum of Measurements Squared / N	750560.10
5 Corrected Sum of Squares (SS)	3.92
6 Variance (V) : SS/(N-1)	0.0529
7 Estimate of Lot Standard Deviation(S): SQRT of V	0.2300
8 Sample Mean(XBAR): Sum X/N	100.04
9 Upper Specification Limit (U)	102.00
10 Lower Specification Limit (L)	98.00
11 Quality Index Upper (QU): (U-XBAR) / S	8.53
12 Quality Index Lower (QL): (XBAR-L) / S	8.86
13 Estimate of Lot Percent NCF Above U (PU)	0.00
14 Estimate of Lot Percent NCF Below L (PL)	0.00
15 Total Estimate Percent NCF. In Lot (P): PU+PL	0.00
16 Maximum Allowable Percent NCF(M)	4.83
17 Acceptability Criterion: Compare P with M	PASS
18 The Lot Meets the Acceptability Criterion if P <= M	
19 The Lot Fails the Acceptability Criterion if P > M	

Kentucky Utilities

2013 Sample Test Program ( 01/01/2013 ) to ( 12/31/2013 )

Device Category: F2S240V30AC200      Model Number: I60S      Division: 01      Sample Lot: 1133      Lot Descr: KU I60 - 4  
 In Service Population: 738      Sample Quantity: 35      Meters Tested: 35      Pass/ Fail: PASS

Test Results Per ANSI/ASQC Z1.9-1993

Double Specification Limit - Variability Unknown - Standard Deviation Method  
 One AQL Value for Both Upper and Lower Specification Limit Combined  
 AQL = 2.5% - Inspection Level II "E" # Normal Inspection

Page 18  
 Run Date: 12/31/2013  
 Run Time: 02:31:01 AM

Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy
C219913	100.20	C219924	100.50	C219944	100.30	C220016	100.20	C220046	100.50
L007673	100.00	L007988	99.90	L014109	99.80	L072084	100.40	L127186	100.40
L127201	99.90	L127218	99.90	L127222	100.20	L127283	100.10	L127343	100.30
L127394	100.30	L127422	100.10	L127430	100.20	L127546	99.80	L127566	100.00
L127570	100.10	L127583	100.20	L127589	100.20	L127674	100.30	L127676	100.30
L127708	99.90	L127718	99.80	L127736	99.90	L127750	100.20	L127757	100.20
L127787	99.90	L127809	99.70	L127850	100.00	L252002	100.30	L268383	99.70

INFORMATION NEEDED

VALUE OBTAINED

1 Sample Size (N)	35
2 Sum of Measurements: (Sum X)	3503.70
3 Sum of Squared Measurements	350742.07
4 Correction Factor (CF): Sum of Measurements Squared / N	350740.39
5 Corrected Sum of Squares (SS)	1.68
6 Variance (V) : SS/(N-1)	0.0494
7 Estimate of Lot Standard Deviation(S): SQRT of V	0.2222
8 Sample Mean(XBAR): Sum X/N	100.11
9 Upper Specification Limit (U)	102.00
10 Lower Specification Limit (L)	98.00
11 Quality Index Upper (QU): (U-XBAR) / S	8.52
12 Quality Index Lower (QL): (XBAR-L) / S	9.48
13 Estimate of Lot Percent NCF Above U (PU)	0.00
14 Estimate of Lot Percent NCF Below L (PL)	0.00
15 Total Estimate Percent NCF. In Lot (P): PU+PL	0.00
16 Maximum Allowable Percent NCF (M)	5.58
17 Acceptability Criterion: Compare P with M	PASS
18 The Lot Meets the Acceptability Criterion if P <= M	
19 The Lot Fails the Acceptability Criterion if P > M	

- Kentucky Utilities

2013 Sample Test Program ( 01/01/2013 ) to ( 12/31/2013 )

Device Category: F2S240V30AC200    Model Number: I70S    Division: 01    Sample Lot: 1134    Lot Descr: KU I70 - 1  
 In Service Population: 10,000    Sample Quantity: 75    Meters Tested: 75    Pass/ Fail: PASS

Test Results Per ANSI/ASQC Z1.9-1993  
 Double Specification Limit - Variability Unknown - Standard Deviation Method  
 One AQL Value for Both Upper and Lower Specification Limit Combined  
 AQL = 2.5% - Inspection Level II "E" # Normal Inspection

Page 19  
 Run Date: 12/31/2013  
 Run Time: 02:31:01 AM

Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy
C223394	100.40	C225568	100.30	C225630	99.90	C226773	100.10	C226916	100.40
C227013	100.10	L001980	100.00	L002115	100.10	L003031	100.20	L003276	100.40
L005890	99.90	L015206	100.30	L016267	100.20	L017258	100.30	L018491	100.30
L019018	100.30	L028842	100.20	L029776	100.20	L040863	100.50	L041447	100.40
L047730	100.30	L049029	100.10	L074089	100.20	L075290	100.20	L079482	100.10
L127493	100.30	L127649	100.30	L127931	100.30	L128079	100.10	L128179	99.80
L128253	99.90	L128292	99.90	L128439	99.80	L128761	100.10	L128826	100.20
L129499	99.90	L129529	100.00	L129620	100.10	L129697	100.00	L130100	100.20
L130110	100.20	L130242	100.10	L130511	99.90	L130523	100.10	L130548	100.20
L130664	99.90	L130665	100.10	L130713	99.90	L130715	100.10	L130731	99.70
L131214	100.10	L131723	100.00	L131744	100.30	L131925	100.30	L132010	100.10
L132043	100.00	L132253	100.00	L132301	99.90	L132860	100.50	L133148	100.20
L133235	100.20	L133274	99.80	L133303	100.40	L133603	99.90	L134177	100.00
L134283	100.40	L134341	100.30	L134502	100.10	L134512	100.20	L134553	100.30
L134949	99.90	L135130	99.90	L135899	100.40	L227102	99.80	M384786	100.10

INFORMATION NEEDED

VALUE OBTAINED

1 Sample Size (N)	75
2 Sum of Measurements: (Sum X)	7509.60
3 Sum of Squared Measurements	751923.84
4 Correction Factor (CF): Sum of Measurements Squared / N	751921.23
5 Corrected Sum of Squares (SS)	2.61
6 Variance (V) : SS/(N-1)	0.0353
7 Estimate of Lot Standard Deviation(S): SQRT of V	0.1878
8 Sample Mean (XBAR) : Sum X/N	100.13
9 Upper Specification Limit (U)	102.00
10 Lower Specification Limit (L)	98.00
11 Quality Index Upper (QU) : (U-XBAR) / S	9.97
12 Quality Index Lower (QL) : (XBAR-L) / S	11.33
13 Estimate of Lot Percent NCF Above U (PU)	0.00
14 Estimate of Lot Percent NCF Below L (PL)	0.00
15 Total Estimate Percent NCF. In Lot (P): PU+PL	0.00
16 Maximum Allowable Percent NCF(M)	4.83
17 Acceptability Criterion: Compare P with M	PASS
18 The Lot Meets the Acceptability Criterion if P <= M	
19 The Lot Fails the Acceptability Criterion if P > M	



Kentucky Utilities

2013 Sample Test Program ( 01/01/2013 ) to ( 12/31/2013 )

Device Category: F2S240V30AC200  
In Service Population: 10,000

Model Number: I70S  
Sample Quantity: 75

Division: 01  
Meters Tested: 75

Sample Lot: 1135  
Lot Descr: KU I70 - 2  
Pass/ Fail: PASS

Test Results Per ANSI/ASQC Z1.9-1993

Double Specification Limit - Variability Unknown - Standard Deviation Method

One AQL Value for Both Upper and Lower Specification Limit Combined

AQL = 2.5% - Inspection Level II "E" # Normal Inspection

Page 20

Run Date: 12/31/2013

Run Time: 02:31:01 AM

Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy
C229109	100.10	C229210	100.30	C229339	100.20	C230736	101.00	C230965	100.40
C232862	100.00	C232921	100.60	C232999	100.20	C233185	100.10	L136678	100.30
L136710	100.30	L136719	100.20	L136729	99.60	L136781	100.60	L136989	100.00
L137264	100.40	L137456	100.30	L137878	100.40	L138546	100.10	L138674	100.50
L138924	100.10	L138991	100.40	L139369	100.30	L139418	100.30	L139453	100.10
L139516	100.00	L139560	100.20	L139564	100.10	L139725	100.40	L140273	100.10
L140492	100.30	L140695	99.90	L142184	99.90	L142273	100.00	L142764	100.00
L143102	100.00	L143195	99.60	L143228	100.30	L143564	100.90	L143991	100.20
L144953	100.00	L144984	99.90	L145372	100.50	L145469	99.80	L145515	100.30
L145516	100.30	L145529	100.40	L146041	100.50	L146061	100.40	L146560	100.50
L146750	100.40	L147059	100.10	L147250	100.30	L147523	100.00	L147529	100.10
L148230	99.90	L148253	100.20	L148535	100.40	L148626	100.40	L148916	99.70
L149049	99.70	L149108	99.70	L149115	99.90	L149169	100.00	M351465	100.00
M351488	100.20	M353060	100.20	M353170	99.80	M374347	100.10	W103675	100.10
W104060	100.10	W104108	100.20	W107641	100.30	W108006	100.30	W108085	100.20

INFORMATION NEEDED

- 1 Sample Size (N)
- 2 Sum of Measurements: (Sum X)
- 3 Sum of Squared Measurements
- 4 Correction Factor (CF): Sum of Measurements Squared / N
- 5 Corrected Sum of Squares (SS)
- 6 Variance (V) : SS/(N-1)
- 7 Estimate of Lot Standard Deviation(S): SQRT of V
- 8 Sample Mean(XBAR): Sum X/N
- 9 Upper Specification Limit (U)
- 10 Lower Specification Limit (L)
- 11 Quality Index Upper (QU): (U-XBAR) / S
- 12 Quality Index Lower (QL): (XBAR-L) / S
- 13 Estimate of Lot Percent NCF Above U (PU)
- 14 Estimate of Lot Percent NCF Below L (PL)
- 15 Total Estimate Percent NCF. In Lot (P): PU+PL
- 16 Maximum Allowable Percent NCF (M)
- 17 Acceptability Criterion: Compare P with M
- 18 The Lot Meets the Acceptability Criterion if P <= M
- 19 The Lot Fails the Acceptability Criterion if P > M

VALUE OBTAINED

75  
7513.60  
752727.54  
752722.47  
5.07  
0.0686  
0.2619  
100.18  
102.00  
98.00  
6.95  
8.33  
0.00  
0.00  
0.00  
4.83

PASS

Kentucky Utilities

2013 Sample Test Program ( 01/01/2013 ) to ( 12/31/2013 )

Device Category: F2S240V30AC200    Model Number: I70S    Division: 01    Sample Lot: 1136    Lot Descr: KU I70 - 3  
 In Service Population: 10,000    Sample Quantity: 75    Meters Tested: 75    Pass/ Fail: PASS

Test Results Per ANSI/ASQC Z1.9-1993

Double Specification Limit - Variability Unknown - Standard Deviation Method

One AQL Value for Both Upper and Lower Specification Limit Combined

AQL = 2.5% - Inspection Level II "E" # Normal Inspection

Page 21

Run Date: 12/31/2013

Run Time: 02:31:01 AM

Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy
C235015	100.30	C235017	100.30	C235048	100.10	C235133	100.10	C238854	99.70
C239008	100.00	C239028	100.10	C239136	100.30	C239401	99.30	C242956	100.50
C243129	100.40	C243303	100.10	C243336	100.40	C243389	100.30	C243529	100.00
L170066	100.10	L170943	100.70	L171021	99.80	L171154	100.30	L171163	100.00
L171382	100.00	L171569	100.00	L171614	99.90	L171660	100.10	L172237	99.70
L172303	99.90	L172432	100.10	L172454	100.00	L172469	99.80	L172506	100.50
L172705	100.00	L172890	100.10	L173213	100.30	L173231	100.00	L173674	99.90
L173853	99.80	L174335	100.20	L174381	100.00	L174413	99.50	L174563	100.30
L175190	100.30	L175287	100.10	L175390	99.90	L175400	100.20	L175535	100.40
L175701	100.30	L176251	99.90	L176377	100.20	L176499	99.90	L176652	99.90
L176763	100.10	L176788	99.80	L176849	100.00	L177652	100.10	L177856	100.10
L177989	100.20	L178386	100.20	L178407	99.90	L178417	100.00	L178535	100.50
L178570	100.50	L179227	99.80	L179336	99.80	L179436	100.00	L180298	100.20
L180772	99.80	L181000	100.30	L181149	100.00	L182057	100.00	L182589	100.20
M388655	99.70	M388677	100.00	M388678	100.20	M388737	100.20	W108963	100.40

INFORMATION NEEDED

VALUE OBTAINED

1 Sample Size (N)	75
2 Sum of Measurements: (Sum X)	7506.00
3 Sum of Squared Measurements	751204.88
4 Correction Factor (CF): Sum of Measurements Squared / N	751200.48
5 Corrected Sum of Squares (SS)	4.40
6 Variance (V) : SS/(N-1)	0.0595
7 Estimate of Lot Standard Deviation (S): SQRT of V	0.2438
8 Sample Mean (XBAR): Sum X/N	100.08
9 Upper Specification Limit (U)	102.00
10 Lower Specification Limit (L)	98.00
11 Quality Index Upper (QU): (U-XBAR) / S	7.87
12 Quality Index Lower (QL): (XBAR-L) / S	8.53
13 Estimate of Lot Percent NCF Above U (PU)	0.00
14 Estimate of Lot Percent NCF Below L (PL)	0.00
15 Total Estimate Percent NCF. In Lot (P): PU+PL	0.00
16 Maximum Allowable Percent NCF (M)	4.83
17 Acceptability Criterion: Compare P with M	PASS
18 The Lot Meets the Acceptability Criterion if P <= M	
19 The Lot Fails the Acceptability Criterion if P > M	

Kentucky Utilities

2013 Sample Test Program ( 01/01/2013 ) to ( 12/31/2013 )

Device Category: F2S240V30AC200      Model Number: I70S      Division: 01      Sample Lot: 1137      Lot Descr: KU I70 - 4  
 In Service Population: 10,000      Sample Quantity: 75      Meters Tested: 75      Pass/ Fail: PASS

Test Results Per ANSI/ASQC Z1.9-1993

Double Specification Limit - Variability Unknown - Standard Deviation Method  
 One AQL Value for Both Upper and Lower Specification Limit Combined  
 AQL = 2.5% - Inspection Level II "E" # Normal Inspection

Page 22  
 Run Date: 12/31/2013  
 Run Time: 02:31:01 AM

Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy
C243933	99.90	C244045	100.40	L182707	100.00	L182721	100.20	L182782	99.90
L183549	100.20	L183637	99.50	L183785	100.30	L183813	100.50	L183938	100.20
L184078	100.10	L184188	100.50	L184516	100.30	L185602	99.80	L185714	100.30
L185775	100.30	L185790	99.90	L185981	100.20	L186001	99.90	L186043	100.20
L186815	100.20	L186831	99.80	L186840	100.30	L186890	99.90	L187107	100.00
L187321	99.70	L187420	100.20	L187538	100.50	L187643	99.90	L187728	100.00
L188525	100.10	L188595	99.70	L188760	99.60	L188845	100.10	L189038	99.90
L189081	99.60	L189237	99.70	L189565	99.90	L189582	99.70	L190388	100.20
L190419	100.40	L190435	99.80	L190721	100.10	L190812	100.10	L191493	100.30
L191827	100.00	L192020	100.00	L192280	100.20	L192557	100.20	L192579	100.10
L192664	99.90	L192769	100.20	L192903	100.10	L192910	99.30	L192979	99.80
L194996	100.10	L195006	100.10	L195023	100.00	L195500	99.90	L195506	100.00
L195951	99.90	L196046	99.70	L196066	99.90	L196092	100.00	L196671	100.00
L196772	100.10	L196830	100.20	L197700	99.70	L197854	99.70	L198468	100.00
L198495	99.90	L198777	100.30	WL12517	99.90	WL13931	100.10	WL14013	100.30

INFORMATION NEEDED

VALUE OBTAINED

1 Sample Size (N)	75
2 Sum of Measurements: (Sum X)	7501.90
3 Sum of Squared Measurements	750384.37
4 Correction Factor (CF): Sum of Measurements Squared / N	750380.05
5 Corrected Sum of Squares (SS)	4.32
6 Variance (V) : SS/(N-1)	0.0584
7 Estimate of Lot Standard Deviation(S): SQRT of V	0.2417
8 Sample Mean(XBAR): Sum X/N	100.03
9 Upper Specification Limit (U)	102.00
10 Lower Specification Limit (L)	98.00
11 Quality Index Upper (QU): (U-XBAR) / S	8.17
12 Quality Index Lower (QL): (XBAR-L) / S	8.38
13 Estimate of Lot Percent NCF Above U (PU)	0.00
14 Estimate of Lot Percent NCF Below L (PL)	0.00
15 Total Estimate Percent NCF. In Lot (P): PU+PL	0.00
16 Maximum Allowable Percent NCF(M)	4.83
17 Acceptability Criterion: Compare P with M	PASS
18 The Lot Meets the Acceptability Criterion if P <= M	
19 The Lot Fails the Acceptability Criterion if P > M	



Kentucky Utilities

2013 Sample Test Program ( 01/01/2013 ) to ( 12/31/2013 )

Device Category: F2S240V30AC200 Model Number: I70S Division: 01 Sample Lot: 1138 Lot Descr: KU I70 - 5  
 In Service Population: 10,000 Sample Quantity: 75 Meters Tested: 75 Pass/ Fail: PASS

Test Results Per ANSI/ASQC Z1.9-1993

Double Specification Limit - Variability Unknown - Standard Deviation Method

one AQL Value for Both Upper and Lower Specification Limit Combined

AQL = 2.5% - Inspection Level II "E" # Normal Inspection

Page 23

Run Date: 12/31/2013

Run Time: 02:31:01 AM

Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy
C247532	100.70	C247683	100.50	C247746	100.40	C248129	100.30	C248213	100.40
C248290	99.70	C248376	100.30	C248606	100.00	C248616	100.00	C252077	100.50
C252384	100.20	C252548	99.90	C252704	99.90	C252712	100.10	C252995	100.20
C253032	100.30	C253107	100.30	L035580	100.20	L200209	99.90	L200578	100.00
L202084	99.90	L202167	99.90	L203473	99.70	L203631	100.20	L203690	99.80
L204300	99.60	L204581	100.10	L204609	99.70	L204701	99.50	L204731	100.20
L204771	100.10	L204996	99.80	L205234	100.10	L205251	100.20	L205306	99.80
L205355	100.10	L205457	99.90	L205610	100.20	L206022	100.10	L206158	100.10
L206178	100.10	L206878	99.90	L206904	99.40	L207246	100.00	L207476	100.20
L207533	100.20	L207634	99.50	L207699	99.90	L207878	100.30	L207928	100.20
L208074	100.30	L208818	100.00	L209055	100.20	L209060	100.00	L209226	100.20
L210017	99.70	L210171	99.70	L210191	99.70	L210528	99.90	L210742	100.10
L211789	99.90	L211874	99.90	L212064	100.20	L212258	100.20	L212941	100.10
L212958	100.30	W114172	100.30	W116089	100.20	W116113	100.30	W116151	100.00
W116153	100.40	W116253	100.50	W116265	100.00	W117581	100.20	W117799	100.30

INFORMATION NEEDED

VALUE OBTAINED

1 Sample Size (N)	75
2 Sum of Measurements: (Sum X)	7505.10
3 Sum of Squared Measurements	751025.15
4 Correction Factor (CF): Sum of Measurements Squared / N	751020.35
5 Corrected Sum of Squares (SS)	4.80
6 Variance (V) : SS/(N-1)	0.0649
7 Estimate of Lot Standard Deviation(S): SQRT of V	0.2548
8 Sample Mean(XBAR) : Sum X/N	100.07
9 Upper Specification Limit (U)	102.00
10 Lower Specification Limit (L)	98.00
11 Quality Index Upper (QU): (U-XBAR) / S	7.58
12 Quality Index Lower (QL): (XBAR-L) / S	8.12
13 Estimate of Lot Percent NCF Above U (PU)	0.00
14 Estimate of Lot Percent NCF Below L (PL)	0.00
15 Total Estimate Percent NCF. In Lot (P): PU+PL	0.00
16 Maximum Allowable Percent NCF(M)	4.83
17 Acceptability Criterion: Compare P with M	PASS
18 The Lot Meets the Acceptability Criterion if P <= M	
19 The Lot Fails the Acceptability Criterion if P > M	

Kentucky Utilities

2013 Sample Test Program ( 01/01/2013 ) to ( 12/31/2013 )

Device Category: F2S240V30AC200    Model Number: I70S    Division: 01    Sample Lot: 1139    Lot Descr: KU I70 - 6  
 In Service Population: 10,000    Sample Quantity: 75    Meters Tested: 75    Pass/ Fail: PASS

Test Results Per ANSI/ASQC Z1.9-1993

Double Specification Limit - Variability Unknown - Standard Deviation Method

One AQL Value for Both Upper and Lower Specification Limit Combined

AQL = 2.5% - Inspection Level II "E" # Normal Inspection

Page 24

Run Date: 12/31/2013

Run Time: 02:31:01 AM

Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy
C255632	100.30	C255802	99.70	C255914	100.10	C265487	100.50	L213458	100.00
L213791	100.10	L213905	99.90	L214023	100.00	L214062	100.10	L214466	100.20
L214494	100.20	L214682	100.00	L214713	100.00	L214931	100.20	L214958	99.90
L215053	100.00	L215194	100.00	L215439	100.20	L216961	100.00	L217319	100.20
L217365	100.00	L217763	100.20	L217991	100.40	L218181	100.30	L219613	100.20
L219898	99.90	L219955	99.60	L220122	100.10	L220257	99.80	L220463	100.10
L220524	100.30	L220529	100.00	L220674	100.30	L220680	100.30	L220940	99.80
L221032	99.80	L222028	99.90	L222246	100.10	L222383	100.20	L222449	99.90
L224976	100.30	L224984	100.30	L225073	100.00	L225110	100.00	L225173	99.80
L225274	100.10	L225319	100.40	L225608	100.00	L225991	99.90	L226140	100.00
L226275	100.30	L226447	100.00	L226496	100.10	L226625	100.00	L226755	100.00
L226785	99.80	L226790	100.00	L227319	100.30	L227331	100.10	L227435	100.00
M402069	100.30	M402229	100.20	M403680	99.90	M403805	100.20	M403821	100.00
M404004	99.90	M404330	100.20	M426789	100.00	M426828	99.90	M427318	100.20
W119073	100.20	W119347	99.90	W120837	99.90	W120958	100.00	W121075	100.20

INFORMATION NEEDED

VALUE OBTAINED

1 Sample Size (N)	75
2 Sum of Measurements: (Sum X)	7505.20
3 Sum of Squared Measurements	751042.68
4 Correction Factor (CF): Sum of Measurements Squared / N	751040.36
5 Corrected Sum of Squares (SS)	2.32
6 Variance (V) : SS/(N-1)	0.0313
7 Estimate of Lot Standard Deviation(S): SQRT of V	0.1770
8 Sample Mean(XBAR) : Sum X/N	100.07
9 Upper Specification Limit (U)	102.00
10 Lower Specification Limit (L)	98.00
11 Quality Index Upper (QU) : (U-XBAR) / S	10.91
12 Quality Index Lower (QL) : (XBAR-L) / S	11.69
13 Estimate of Lot Percent NCF Above U (PU)	0.00
14 Estimate of Lot Percent NCF Below L (PL)	0.00
15 Total Estimate Percent NCF. In Lot (P) : PU+PL	0.00
16 Maximum Allowable Percent NCF(M)	4.83
17 Acceptability Criterion: Compare P with M	PASS
18 The Lot Meets the Acceptability Criterion if P <= M	
19 The Lot Fails the Acceptability Criterion if P > M	

Kentucky Utilities

2013 Sample Test Program ( 01/01/2013 ) to ( 12/31/2013 )

Device Category: F2S240V30AC200 Model Number: I70S Division: 01 Sample Lot: 1140 Lot Descr: KU I70 - 7  
 In Service Population: 10,000 Sample Quantity: 75 Meters Tested: 75 Pass/ Fail: PASS

Test Results Per ANSI/ASQC Z1.9-1993

Double Specification Limit - Variability Unknown - Standard Deviation Method

One AQL Value for Both Upper and Lower Specification Limit Combined

AQL = 2.5% - Inspection Level II "E" # Normal Inspection

Page 25

Run Date: 12/31/2013

Run Time: 02:31:01 AM

Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy
C223120	100.10	C256408	100.00	C261645	100.20	C261660	100.50	C261741	100.50
C261840	100.50	C261922	100.30	C262087	100.30	C262154	99.50	C262470	100.40
C266906	100.10	C266986	100.00	C267330	100.10	C272027	100.50	C272112	100.50
C272126	100.10	C272142	100.40	C272224	100.00	C272239	100.30	C272402	100.30
C272410	100.50	C272584	99.90	C272680	100.00	C272823	100.20	C273044	99.90
C273051	100.00	C273057	99.80	C273059	99.90	C276784	99.90	C276842	100.20
C276868	100.30	L048361	100.20	L233435	100.20	L233502	100.00	L233523	100.10
L233827	100.00	L233901	100.10	L234206	99.70	L234209	100.20	L234256	99.90
L234302	100.00	L234676	99.90	L234911	100.00	L234999	99.30	L235552	100.10
L237550	100.00	L237574	100.20	L237951	100.20	L237971	100.40	L238007	100.40
L238648	100.00	L238802	99.80	L238955	100.10	L239118	100.00	L239471	100.00
L239861	100.00	L239919	99.40	L239959	99.90	L241330	100.40	L241406	100.30
L241425	100.20	L241495	100.10	L241593	100.00	L241628	100.20	L241644	100.40
L241673	100.10	L241719	100.10	M404393	99.90	M404789	100.00	M416740	99.90
M416800	100.20	W122402	100.50	W122408	99.90	W123318	100.40	W123467	100.10

INFORMATION NEEDED

VALUE OBTAINED

1 Sample Size (N)	75
2 Sum of Measurements: (Sum X)	7508.00
3 Sum of Squared Measurements	751605.34
4 Correction Factor (CF): Sum of Measurements Squared / N	751600.85
5 Corrected Sum of Squares (SS)	4.49
6 Variance (V) : SS/(N-1)	0.0606
7 Estimate of Lot Standard Deviation(S): SQRT of V	0.2462
8 Sample Mean (XBAR) : Sum X/N	100.11
9 Upper Specification Limit (U)	102.00
10 Lower Specification Limit (L)	98.00
11 Quality Index Upper (QU): (U-XBAR) / S	7.69
12 Quality Index Lower (QL): (XBAR-L) / S	8.56
13 Estimate of Lot Percent NCF Above U (PU)	0.00
14 Estimate of Lot Percent NCF Below L (PL)	0.00
15 Total Estimate Percent NCF. In Lot (P): PU+PL	0.00
16 Maximum Allowable Percent NCF (M)	4.83
17 Acceptability Criterion: Compare P with M	PASS
18 The Lot Meets the Acceptability Criterion if P <= M	
19 The Lot Fails the Acceptability Criterion if P > M	



Kentucky Utilities

2013 Sample Test Program ( 01/01/2013 ) to ( 12/31/2013 ) -

Device Category: F2S240V30AC200      Model Number: I70S      Division: 01      Sample Lot: 1141      Lot Descr: KU\_I70 - 8  
 In Service Population: 10,000      Sample Quantity: 75      Meters Tested: 75      Pass/ Fail: PASS

Test Results Per ANSI/ASQC Z1.9-1993  
 Double Specification Limit - Variability Unknown - Standard Deviation Method  
 One AQL Value for Both Upper and Lower Specification Limit Combined  
 AQL = 2.5% - Inspection Level II "E" # Normal Inspection

Page 26  
 Run Date: 12/31/2013  
 Run Time: 02:31:01 AM

Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy
C277421	100.30	C277499	99.90	C277540	99.90	C281223	100.30	C281318	100.40
C281346	100.10	C281524	100.30	C281532	100.60	C281555	100.00	C281721	99.90
C281826	100.00	C281904	100.30	C281905	100.10	C282023	100.00	C286739	100.10
C286907	99.70	C287165	100.30	C287538	100.10	C287740	100.20	C287744	100.20
C290180	100.20	C290942	99.70	C290960	99.80	C290964	100.20	C290986	100.20
C291013	100.30	C292350	100.20	C292409	100.00	C292517	100.00	C292603	100.10
C292716	100.30	C292908	100.20	C292923	100.20	C293009	100.20	C293071	99.90
C293500	100.20	C293596	99.90	C293610	99.90	L242578	100.10	L242666	100.00
L242738	100.30	L242747	100.00	L242880	99.90	L244059	100.00	L244267	100.20
L244289	100.00	L244603	99.70	L252028	100.00	L262288	100.30	L262385	100.20
L262709	100.30	L262744	100.20	L263018	100.10	M420036	99.90	M420051	100.00
M420093	99.90	M420157	99.90	M420177	99.70	M420184	100.20	M420547	99.90
M420613	99.80	M420723	100.10	M420830	99.70	W124115	100.20	W126524	100.00
W127347	100.10	W128039	100.10	W128351	99.80	W128427	99.80	W128469	99.80
W128536	99.80	W129171	99.80	W129242	100.00	W129270	99.90	W130272	100.00

INFORMATION NEEDED

VALUE OBTAINED

1 Sample Size (N)	75
2 Sum of Measurements: (Sum X)	7503.90
3 Sum of Squared Measurements	750782.97
4 Correction Factor (CF): Sum of Measurements Squared / N	750780.20
5 Corrected Sum of Squares (SS)	2.77
6 Variance (V) : SS/(N-1)	0.0374
7 Estimate of Lot Standard Deviation(S): SQRT of V	0.1934
8 Sample Mean(XBAR): Sum X/N	100.05
9 Upper Specification Limit (U)	102.00
10 Lower Specification Limit (L)	98.00
11 Quality Index Upper (QU): (U-XBAR) / S	10.07
12 Quality Index Lower (QL): (XBAR-L) / S	10.61
13 Estimate of Lot Percent NCF Above U (PU)	0.00
14 Estimate of Lot Percent NCF Below L (PL)	0.00
15 Total Estimate Percent NCF. In Lot (P): PU+PL	0.00
16 Maximum Allowable Percent NCF (M)	4.83
17 Acceptability Criterion: Compare P with M	PASS
18 The Lot Meets the Acceptability Criterion if P <= M	
19 The Lot Fails the Acceptability Criterion if P > M	

Kentucky Utilities

2013 Sample Test Program ( 01/01/2013 ) to ( 12/31/2013 )

Device Category: F2S240V30AC200    Model Number: I70S    Division: 01    Sample Lot: 1142    Lot Descr: KU I70 - 9  
 In Service Population: 10,000    Sample Quantity: 75    Meters Tested: 75    Pass/ Fail: PASS

Test Results Per ANSI/ASQC Z1.9-1993

Double Specification Limit - Variability Unknown - Standard Deviation Method

One AQL Value for Both Upper and Lower Specification Limit Combined

AQL = 2.5% - Inspection Level II "E" # Normal Inspection

Page 27

Run Date: 12/31/2013

Run Time: 02:31:01 AM

Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy
C294249	100.20	C294455	100.20	C295830	100.10	C296069	100.20	C296100	100.30
C296161	100.10	C296220	100.30	C296240	100.50	C296384	100.30	C296399	100.20
C296580	100.30	C296590	100.20	C296674	100.30	C299288	100.50	C299300	100.30
C299335	100.30	C299574	100.30	C299727	100.40	C299986	100.40	C299993	100.30
C300008	100.40	C300152	100.20	C304595	100.10	C304656	100.00	C304781	100.40
C304997	100.20	C305064	99.90	C305098	100.10	C305259	100.50	I263239	99.90
I263500	100.40	I263790	99.80	I263976	100.20	I264023	100.10	I264155	100.10
I264157	99.90	I264255	100.30	I264373	100.20	I264383	99.90	I264398	99.70
I264540	100.30	I264574	100.10	I264941	100.30	I265040	100.20	I265242	100.10
I265251	100.60	I265289	100.20	I265570	100.50	I265881	100.10	I266293	100.00
I266757	100.10	I276607	100.00	I276694	99.90	I276907	100.30	I277200	99.70
I277263	99.80	I277323	100.00	I277517	100.00	I277572	99.90	M431789	99.60
M433924	100.30	M433939	100.20	M433971	100.50	M434510	100.20	W131386	99.70
W131400	100.20	W131422	100.20	W131630	100.00	W131651	100.10	W131793	100.20
W131828	100.00	W132201	100.20	W132694	100.10	W132842	99.90	W132886	100.20

INFORMATION NEEDED

VALUE OBTAINED

1 Sample Size (N)	75
2 Sum of Measurements: (Sum X)	7511.70
3 Sum of Squared Measurements	752345.09
4 Correction Factor (CF): Sum of Measurements Squared / N	752341.83
5 Corrected Sum of Squares (SS)	3.26
6 Variance (V) : SS/(N-1)	0.0441
7 Estimate of Lot Standard Deviation(S): SQRT of V	0.2100
8 Sample Mean(XBAR): Sum X/N	100.16
9 Upper Specification Limit (U)	102.00
10 Lower Specification Limit (L)	98.00
11 Quality Index Upper (QU): (U-XBAR) / S	8.78
12 Quality Index Lower (QL): (XBAR-L) / S	10.26
13 Estimate of Lot Percent NCF Above U (PU)	0.00
14 Estimate of Lot Percent NCF Below L (PL)	0.00
15 Total Estimate Percent NCF. In Lot (P): PU+PL	0.00
16 Maximum Allowable Percent NCF(M)	4.83
17 Acceptability Criterion: Compare P with M	PASS
18 The Lot Meets the Acceptability Criterion if P <= M	
19 The Lot Fails the Acceptability Criterion if P > M	

Kentucky Utilities

2013 Sample Test Program ( 01/01/2013 ) to ( 12/31/2013 )

Device Category: F2S240V30AC200 Model Number: I70S Division: 01 Sample Lot: 1143 Lot Descr: KU I70 - 10  
 In Service Population: 10,000 Sample Quantity: 75 Meters Tested: 75 Pass/ Fail: PASS

Test Results Per ANSI/ASQC Z1.9-1993

Double Specification Limit - Variability Unknown - Standard Deviation Method

One AQL Value for Both Upper and Lower Specification Limit Combined

AQL = 2.5% - Inspection Level II "E" # Normal Inspection

Page 28

Run Date: 12/31/2013

Run Time: 02:31:01 AM

Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy
C298545	99.80	C298556	100.00	C305542	100.60	C305549	100.50	C305671	100.40
C305672	100.40	C335297	99.80	C335394	100.00	C335604	99.90	C335819	100.00
C336107	99.80	C336708	100.00	C336890	99.70	C336910	99.00	C337058	99.80
C337284	99.70	C337405	99.40	C337664	99.90	C337980	99.80	C338081	99.70
L303912	99.40	L304028	99.40	L304050	99.70	L304176	99.30	L304359	99.70
L304485	99.80	L304603	99.80	L304716	100.00	L304849	99.60	L304890	100.00
L304923	99.60	L304945	99.80	L304993	99.60	L305003	99.90	L305400	99.80
L305412	100.00	L305430	99.50	L305578	100.00	L305732	99.70	L306036	99.80
L306288	99.60	L306633	99.80	L306753	99.80	L306898	99.60	L306956	99.90
L306991	99.80	L307040	99.90	L307338	99.50	L307374	99.80	L307382	99.50
L307495	99.70	L307782	99.50	L307785	99.70	M437747	100.30	M437893	100.10
M437958	100.00	M437959	100.20	M438037	100.10	M438082	100.00	M438206	100.00
M446584	99.60	M446647	99.90	M446659	99.80	M446819	100.00	W136375	100.10
W136525	99.90	W136553	100.00	W136657	100.10	W136685	100.10	W136704	100.20
W136984	100.10	W137342	99.90	W137516	100.00	W137551	100.10	W137603	100.20

INFORMATION NEEDED

VALUE OBTAINED

1 Sample Size (N)	75
2 Sum of Measurements: (Sum X)	7489.40
3 Sum of Squared Measurements	747887.14
4 Correction Factor (CF): Sum of Measurements Squared / N	747881.50
5 Corrected Sum of Squares (SS)	5.64
6 Variance (V) : SS/(N-1)	0.0762
7 Estimate of Lot Standard Deviation (S): SQRT of V	0.2761
8 Sample Mean (XBAR): Sum X/N	99.86
9 Upper Specification Limit (U)	102.00
10 Lower Specification Limit (L)	98.00
11 Quality Index Upper (QU): (U-XBAR) / S	7.76
12 Quality Index Lower (QL): (XBAR-L) / S	6.73
13 Estimate of Lot Percent NCF Above U (PU)	0.00
14 Estimate of Lot Percent NCF Below L (PL)	0.00
15 Total Estimate Percent NCF. In Lot (P): PU+PL	0.00
16 Maximum Allowable Percent NCF (M)	4.83
17 Acceptability Criterion: Compare P with M	PASS
18 The Lot Meets the Acceptability Criterion if P <= M	
19 The Lot Fails the Acceptability Criterion if P > M	



Kentucky Utilities

2013 Sample Test Program ( 01/01/2013 ) to ( 12/31/2013 )

Device Category: F2S240V30AC200

Model Number: I70S

Division: 01

Sample Lot: 1144

Lot Descr: KU I70 - 11

In Service Population: 10,000

Sample Quantity: 75

Meters Tested: 75

Pass/ Fail: PASS

Test Results Per ANSI/ASQC Z1.9-1993

Double Specification Limit - Variability Unknown - Standard Deviation Method

Page 29

One AQL Value for Both Upper and Lower Specification Limit Combined

Run Date: 12/31/2013

AQL = 2.5% - Inspection Level II "E" # Normal Inspection

Run Time: 02:31:01 AM

Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy
C338250	99.60	C338437	99.90	C338484	99.60	C338722	99.70	C338954	99.80
C339001	99.60	C339261	99.80	C339347	99.70	C339583	99.80	C339815	99.70
C339852	99.70	C340411	100.60	C340420	99.80	C340583	99.70	C340652	100.10
C340677	99.90	C340735	100.00	C340820	99.90	C340898	99.90	C341239	99.90
C341247	99.90	C341301	99.70	C341391	100.00	C342631	99.70	C342711	99.50
C342739	99.90	C342748	99.80	C343084	99.80	C343121	99.70	C343125	99.80
C343134	99.90	C343279	99.80	C343409	99.80	C343542	99.70	C343562	99.70
C343683	99.90	C343687	99.90	C343781	99.70	C343799	99.60	C344016	99.90
C344251	99.80	I307854	99.70	I308132	99.80	I308135	99.50	I308426	99.50
L308594	99.60	I308767	99.90	I308828	99.70	L308901	99.80	L309140	99.50
L309231	100.00	I309292	99.50	L309348	99.30	L309717	99.50	M446907	99.40
M446945	100.30	M447329	100.00	M447330	99.80	M447537	100.00	M447594	99.60
M447603	100.00	M447807	99.70	W149453	99.70	W149718	99.90	W149760	99.80
W149796	99.80	W149844	99.70	W149955	99.70	W150029	99.60	W150581	99.70
W150622	99.60	W150727	99.70	W150774	99.90	W150785	100.20	W150940	99.70

INFORMATION NEEDED

VALUE OBTAINED

1 Sample Size (N)	75
2 Sum of Measurements: (Sum X)	7483.30
3 Sum of Squared Measurements	746666.67
4 Correction Factor (CF): Sum of Measurements Squared / N	746663.72
5 Corrected Sum of Squares (SS)	2.95
6 Variance (V) : SS/(N-1)	0.0399
7 Estimate of Lot standard Deviation(s): SQRT of V	0.1997
8 Sample Mean(XBAR): Sum X/N	99.78
9 Upper Specification Limit (U)	102.00
10 Lower Specification Limit (L)	98.00
11 Quality Index Upper (QU): (U-XBAR) / s	11.13
12 Quality Index Lower (QL): (XBAR-L) / s	8.90
13 Estimate of Lot Percent NCF Above U (PU)	0.00
14 Estimate of Lot Percent NCF Below L (PL)	0.00
15 Total Estimate Percent NCF. In Lot (P): PU+PL	0.00
16 Maximum Allowable Percent NCF (M)	4.83
17 Acceptability Criterion: Compare P with M	PASS
18 The Lot Meets the Acceptability Criterion if P <= M	
19 The Lot Fails the Acceptability Criterion if P > M	

Kentucky Utilities

2013 Sample Test Program ( 01/01/2013 ) to ( 12/31/2013 )

Device Category: F2S240V30AC200      Model Number: I70S      Division: 01      Sample Lot: 1145      Lot Descr: KU I70 - 12  
 In Service Population: 7,731      Sample Quantity: 75      Meters Tested: 75      Pass/ Fail: PASS

Test Results Per ANSI/ASQC Z1.9-1993

Double Specification Limit - Variability Unknown - Standard Deviation Method

One AQL Value for Both Upper and Lower Specification Limit Combined

AQL = 2.5% - Inspection Level II "E" # Normal Inspection

Page 30

Run Date: 12/31/2013

Run Time: 02:31:01 AM

Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy
C342207	99.60	C351772	100.30	C351788	100.00	C351926	100.40	C351932	100.30
C351987	99.90	C352304	100.40	L310051	99.70	L310090	99.60	L310097	99.90
L310227	100.00	L310440	99.70	L310463	99.90	L310551	99.70	L310621	99.90
L310667	99.60	L310740	100.00	L310749	99.70	L310964	99.50	L311263	99.90
L311488	99.80	L311528	99.70	L311559	99.50	L311654	100.10	L311744	99.80
L311753	100.10	L311792	99.90	L311873	100.00	L311899	99.80	L311905	99.70
L312064	99.90	L312243	99.90	L312359	99.60	L312529	100.10	L312618	99.90
L312634	100.10	L312638	99.90	L312797	100.20	L312876	99.70	L313078	100.10
W151418	99.70	W151477	100.00	W151614	99.70	W151663	100.00	W151771	99.90
W151864	99.90	W151939	99.90	W152105	99.80	W152185	99.90	W152365	100.00
W152366	99.80	W152547	99.70	W152649	99.80	W152746	100.10	W152788	99.90
W152895	99.60	W152910	99.90	W152974	99.90	W153088	99.70	W153345	99.80
W153574	99.80	W153668	99.70	W153852	99.80	W154214	100.10	W154266	99.90
W154290	99.50	W154375	99.80	W154595	100.10	W154640	99.80	W154790	99.90
W154942	99.70	W155094	99.90	W155105	100.00	W155344	100.10	W155455	99.80

INFORMATION NEEDED

VALUE OBTAINED

1 Sample Size (N)	75
2 Sum of Measurements: (Sum X)	7490.70
3 Sum of Squared Measurements	748144.03
4 Correction Factor (CF): Sum of Measurements Squared / N	748141.15
5 Corrected Sum of Squares (SS)	2.88
6 Variance (V) : SS/(N-1)	0.0389
7 Estimate of Lot Standard Deviation(S): SQRT of V	0.1972
8 Sample Mean(XBAR): Sum X/N	99.88
9 Upper Specification Limit (U)	102.00
10 Lower Specification Limit (L)	98.00
11 Quality Index Upper (QU): (U-XBAR) / S	10.77
12 Quality Index Lower (QL): (XBAR-L) / S	9.51
13 Estimate of Lot Percent NCF Above U (PU)	0.00
14 Estimate of Lot Percent NCF Below L (PL)	0.00
15 Total Estimate Percent NCF. In Lot (P): PU+PL	0.00
16 Maximum Allowable Percent NCF (M)	4.83
17 Acceptability Criterion: Compare P with M	PASS
18 The Lot Meets the Acceptability Criterion if P <= M	
19 The Lot Fails the Acceptability Criterion if P > M	

Kentucky Utilities

2013 Sample Test Program ( 01/01/2013 ) to ( 12/31/2013 )

Device Category: F2S240V30AC200 Model Number: J4S Division: 01 Sample Lot: 1146 Lot Descr: KU J4S - 1  
 In Service Population: 10,000 Sample Quantity: 75 Meters Tested: 75 Pass/ Fail: PASS

Test Results Per ANSI/ASQC Z1.9-1993

Double Specification Limit - Variability Unknown - Standard Deviation Method

One AQL Value for Both Upper and Lower Specification Limit Combined

AQL = 2.5% - Inspection Level II "E" # Normal Inspection

Page 31

Run Date: 12/31/2013

Run Time: 02:31:01 AM

Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy
C233548	100.00	C233560	100.30	C235328	100.00	C235665	100.30	C240092	100.00
C240276	99.70	C240282	100.00	C240365	100.20	C244712	99.60	C245000	100.00
C245158	99.80	C245199	100.60	C248774	100.20	C249657	99.60	C249674	100.20
C253262	99.60	C253295	99.80	C253348	99.80	C253493	100.10	C253510	99.50
C253612	99.70	C253715	100.00	C253995	99.50	C262746	100.00	C263043	100.00
C263481	99.80	C263550	99.30	C263663	99.70	C263705	100.00	C263783	99.30
C267962	99.90	M387861	100.30	M387909	100.00	M391238	100.40	M391318	99.90
M391720	100.00	M393901	99.80	M394327	99.60	M394415	100.00	M394484	100.00
M408679	99.70	M408744	100.00	M408872	99.90	M410728	100.10	M411206	99.80
M412745	99.70	M412924	99.80	M412964	100.00	M412981	99.50	M413000	99.50
M426314	100.10	M426404	99.80	M426410	99.30	M426545	100.00	M426648	100.00
M426914	99.90	M426973	99.80	M452836	100.30	M452881	100.00	M452991	99.90
W104625	100.10	W104658	100.10	W105227	99.50	W106464	99.40	W108586	99.70
W108618	99.80	W109510	99.60	W110569	100.20	W110844	100.10	W111095	99.70
W113596	99.90	W117934	99.60	W118033	100.00	W122780	99.70	W122962	99.60

INFORMATION NEEDED

VALUE OBTAINED

1 Sample Size (N)	75
2 Sum of Measurements: (Sum X)	7490.60
3 Sum of Squared Measurements	748126.48
4 Correction Factor (CF): Sum of Measurements Squared / N	748121.18
5 Corrected Sum of Squares (SS)	5.30
6 Variance (V) : SS/(N-1)	0.0716
7 Estimate of Lot Standard Deviation(S): SQRT of V	0.2677
8 Sample Mean(XBAR): Sum X/N	99.87
9 Upper Specification Limit (U)	102.00
10 Lower Specification Limit (L)	98.00
11 Quality Index Upper (QU): (U-XBAR) / S	7.94
12 Quality Index Lower (QL): (XBAR-L) / S	7.00
13 Estimate of Lot Percent NCF Above U (PU)	0.00
14 Estimate of Lot Percent NCF Below L (PL)	0.00
15 Total Estimate Percent NCF. In Lot (P): PU+PL	0.00
16 Maximum Allowable Percent NCF(M)	4.83
17 Acceptability Criterion: Compare P with M	PASS
18 The Lot Meets the Acceptability Criterion if P <= M	
19 The Lot Fails the Acceptability Criterion if P > M	



Kentucky Utilities

2013 Sample Test Program ( 01/01/2013 ) to ( 12/31/2013 )

Device Category: F2S240V30AC200 Model Number: J4S Division: 01 Sample Lot: 1147 Lot Descr: KU J4S - 2  
 In Service Population: 2,702 Sample Quantity: 50 Meters Tested: 50 Pass/ Fail: PASS

Test Results Per ANSI/ASQC Z1.9-1993

Double Specification Limit - Variability Unknown - Standard Deviation Method

One AQL Value for Both Upper and Lower Specification Limit Combined

AQL = 2.5% - Inspection Level II "E" # Normal Inspection

Page 32

Run Date: 12/31/2013

Run Time: 02:31:01 AM

Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy
C268196	100.00	C268229	99.70	C268233	99.90	C268239	100.00	C268341	100.20
C268473	99.80	C268524	99.80	C268632	99.80	C268710	99.90	C268784	99.80
C268785	99.40	C268807	100.30	C269012	100.10	C351283	100.50	C351373	99.80
C351428	99.70	C351479	99.70	C351682	99.60	L240072	99.80	L240074	99.40
L240145	99.70	L240197	99.40	L240287	99.30	L240558	99.60	L241787	100.20
L241924	100.00	L241934	99.90	L241980	99.90	L242004	99.70	L242200	99.40
L242269	99.60	L242282	99.60	L247458	99.80	M415422	99.80	M415431	99.90
M415455	99.70	M415520	100.10	M415629	100.00	M415821	99.70	M416121	99.70
M416138	99.70	M428141	100.10	W123584	99.70	W123655	99.80	W123660	99.60
W123675	99.60	W123721	99.30	W123745	99.90	W123801	99.90	W123808	99.50

INFORMATION NEEDED

VALUE OBTAINED

1 Sample Size (N)	50
2 Sum of Measurements: (Sum X)	4989.30
3 Sum of Squared Measurements	497865.41
4 Correction Factor (CF): Sum of Measurements Squared / N	497862.29
5 Corrected Sum of Squares (SS)	3.12
6 Variance (V) : SS/(N-1)	0.0637
7 Estimate of Lot Standard Deviation(S): SQRT of V	0.2523
8 Sample Mean(XBAR): Sum X/N	99.79
9 Upper Specification Limit (U)	102.00
10 Lower Specification Limit (L)	98.00
11 Quality Index Upper (QU): (U-XBAR) / S	8.77
12 Quality Index Lower (QL): (XBAR-L) / S	7.08
13 Estimate of Lot Percent NCF Above U (PU)	0.00
14 Estimate of Lot Percent NCF Below L (PL)	0.00
15 Total Estimate Percent NCF, In Lot (P): PU+PL	0.00
16 Maximum Allowable Percent NCF(M)	5.21
17 Acceptability Criterion: Compare P with M	PASS
18 The Lot Meets the Acceptability Criterion if P <= M	
19 The Lot Fails the Acceptability Criterion if P > M	

Kentucky Utilities

2013 Sample Test Program ( 01/01/2013 ) to ( 12/31/2013 )

Device Category: F2S240V30AC200      Model Number: J5S      Division: 01      Sample Lot: 1148      Lot Descr: KU J5S - 1  
 In Service Population: 10,000      Sample Quantity: 75      Meters Tested: 75      Pass/ Fail: PASS

Test Results Per ANSI/ASQC Z1.9-1993

Double Specification Limit - Variability Unknown - Standard Deviation Method  
 One AQL Value for Both Upper and Lower Specification Limit Combined  
 AQL = 2.5% - Inspection Level II "E" # Normal Inspection

Page 33  
 Run Date: 12/31/2013  
 Run Time: 02:31:01 AM

Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy
C273073	99.70	C273106	99.70	C273177	99.90	C273289	99.60	C273644	99.90
C273923	100.20	C274176	100.20	C277682	100.00	C277725	99.40	C277838	99.80
C277930	100.10	C278105	100.10	C278237	100.00	C278582	100.20	C278702	99.90
C278744	100.20	C278791	100.30	C278807	100.10	C282416	100.10	C282588	99.80
C282620	99.60	C282751	100.00	C282756	100.70	C283174	100.20	C283190	100.40
C283216	100.20	C283253	100.20	C283294	100.20	C283339	100.40	C288182	99.70
C288927	99.80	C288993	100.20	L243101	99.80	L243231	99.90	L244635	100.10
L244642	99.80	L244651	100.20	L244792	99.90	L245007	99.60	L245130	100.20
L245893	100.30	L245955	99.50	L246331	100.00	L246364	99.80	L246469	99.70
L246748	99.80	L246784	100.30	L247070	99.70	L247600	99.80	L248370	99.70
L248623	100.10	L248804	99.40	L248890	99.50	L250304	99.80	L250317	99.70
L250431	100.00	L250503	99.70	L250562	100.00	L250603	99.80	L251066	99.10
L251238	99.80	L251372	99.20	L251453	99.30	L251498	99.60	L251623	99.90
L251751	100.20	L251833	99.50	L251904	100.10	L252771	100.40	L252955	100.00
L253072	100.00	W126267	100.20	W126939	100.00	W127020	99.90	W127052	99.70

INFORMATION NEEDED

VALUE OBTAINED

1 Sample Size (N)	75
2 Sum of Measurements: (Sum X)	7493.80
3 Sum of Squared Measurements	748767.20
4 Correction Factor (CF): Sum of Measurements Squared / N	748760.51
5 Corrected Sum of Squares (SS)	6.69
6 Variance (V) : SS/(N-1)	0.0904
7 Estimate of Lot Standard Deviation(S): SQRT of V	0.3006
8 Sample Mean(XBAR): Sum X/N	99.92
9 Upper Specification Limit (U)	102.00
10 Lower Specification Limit (L)	98.00
11 Quality Index Upper (QU): (U-XBAR) / S	6.93
12 Quality Index Lower (QL): (XBAR-L) / S	6.38
13 Estimate of Lot Percent NCF Above U (PU)	0.00
14 Estimate of Lot Percent NCF Below L (PL)	0.00
15 Total Estimate Percent NCF. In Lot (P): PU+PL	0.00
16 Maximum Allowable Percent NCF(M)	4.83
17 Acceptability Criterion: Compare P with M	PASS
18 The Lot Meets the Acceptability Criterion if P <= M	
19 The Lot Fails the Acceptability Criterion if P > M	

Kentucky Utilities

2013 Sample Test Program ( 01/01/2013 ) to ( 12/31/2013 )

Device Category: F2S240V30AC200    Model Number: J5S    Division: 01    Sample Lot: 1149    Lot Descr: KU J5S - 2  
 In Service Population: 10,000    Sample Quantity: 75    Meters Tested: 75    Pass/ Fail: PASS

Test Results Per ANSI/ASQC Z1.9-1993

Double Specification Limit - Variability Unknown - Standard Deviation Method  
 One AQL Value For Both Upper and Lower Specification Limit Combined  
 AQL = 2.5% - Inspection Level II "E" # Normal Inspection

Page 34  
 Run Date: 12/31/2013  
 Run Time: 02:31:01 AM

Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy
C283746	99.60	C291384	99.80	C291428	99.80	C291430	100.00	C291442	100.00
C291474	100.10	C291621	100.00	C291876	100.70	C291896	99.60	C291898	101.20
C291987	100.20	C292253	99.90	L253137	100.00	L253543	100.00	L253670	99.90
L253829	100.00	L254037	99.70	L254126	100.00	L254214	99.70	L254267	99.80
L254315	99.40	L254876	100.00	L255359	100.20	L255459	99.60	L255578	99.90
L255582	100.40	L255622	100.10	L255647	100.30	L255867	100.20	L256452	99.90
L257075	99.80	L257201	98.20	L257580	99.90	L257845	100.10	L257957	100.20
L257977	100.50	L258518	100.30	L258528	100.30	L258803	100.10	L258864	100.00
L258944	100.40	L259803	100.30	L259827	100.30	L259862	99.80	M421542	99.60
M421870	100.20	M422817	99.10	M423437	100.20	M423587	99.80	M423683	100.10
M423748	100.00	M423806	99.80	M423983	99.90	M424018	99.60	M424070	100.10
M424081	100.10	M424084	100.10	M424415	100.10	M424559	100.20	M424899	100.00
M428745	99.90	M428778	99.90	M428832	100.20	M428842	99.80	W128085	100.20
W128172	100.00	W128218	99.80	W128296	99.60	W128319	100.10	W128726	100.60
W128739	99.90	W128744	100.10	W128768	100.00	W128786	100.00	W128853	100.10

INFORMATION NEEDED

VALUE OBTAINED

1 Sample size (N)	75
2 Sum of Measurements: (Sum X)	7499.30
3 Sum of Squared Measurements	749869.79
4 Correction Factor (CF): Sum of Measurements Squared / N	749860.01
5 Corrected Sum of Squares (SS)	9.78
6 Variance (V) : SS/(N-1)	0.1322
7 Estimate of Lot Standard Deviation(S): SQRT of V	0.3636
8 Sample Mean(XBAR): Sum X/N	99.99
9 Upper Specification Limit (U)	102.00
10 Lower Specification Limit (L)	98.00
11 Quality Index Upper (QU): (U-XBAR) / S	5.53
12 Quality Index Lower (QL): (XBAR-L) / S	5.47
13 Estimate of Lot Percent NCF Above U (PU)	0.00
14 Estimate of Lot Percent NCF Below L (PL)	0.00
15 Total Estimate Percent NCF. In Lot (P): PU+PL	0.00
16 Maximum Allowable Percent NCF (M)	4.83
17 Acceptability Criterion: Compare P with M	PASS
18 The Lot Meets the Acceptability Criterion if P <= M	
19 The Lot Fails the Acceptability Criterion if P > M	



Kentucky Utilities

2013 Sample Test Program ( 01/01/2013 ) to ( 12/31/2013 )

Device Category: F2S240V30AC200 Model Number: J5S Division: 01 Sample Lot: 1150 Lot Descr: KU J5S - 3  
 In Service Population: 10,000 Sample Quantity: 75 Meters Tested: 75 Pass/ Fail: PASS

Test Results Per ANSI/ASQC Z1.9-1993

Double Specification Limit - Variability Unknown - Standard Deviation Method  
 One AQL Value for Both Upper and Lower Specification Limit Combined  
 AQL = 2.5% - Inspection Level II "E" # Normal Inspection

Page 35  
 Run Date: 12/31/2013  
 Run Time: 02:31:01 AM

Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy
C284221	100.00	C284241	100.20	C294665	99.90	C294851	100.20	C294936	100.40
C295156	99.70	C295298	100.20	C295300	99.90	C295639	100.30	C295668	100.00
C295688	100.10	C296986	100.60	C296990	100.20	C297326	100.10	C297761	99.90
C297920	100.20	C298097	99.90	L260498	100.20	L260579	100.30	L260792	99.70
L261043	100.00	L261222	100.00	L261286	100.30	L261290	99.50	L261737	99.60
L261764	100.10	L261769	100.00	L261797	100.30	L261983	100.20	L262004	100.00
L266921	99.90	L267093	99.90	L267094	100.10	L267190	99.90	L267227	100.00
L267232	100.30	L267466	100.10	L267475	100.30	L267622	100.20	L267816	100.10
L267825	100.30	L267908	100.20	L267935	100.30	L269241	100.10	L269347	99.60
L269585	100.10	L269652	99.40	L269701	100.00	L269851	99.90	L269992	99.90
L270241	99.80	L270333	99.70	M429274	100.30	M429568	100.10	M429718	99.80
M429779	100.20	M429813	100.00	M429875	100.10	M429899	100.10	M429975	100.10
M430386	100.10	M430802	99.90	M430855	99.90	M430872	99.90	M430929	100.10
M430975	99.80	M432254	100.00	M432359	99.70	M432365	100.50	W129888	100.10
W130839	100.10	W130848	100.50	W130906	100.10	W130998	100.30	W131002	101.00

INFORMATION NEEDED

VALUE OBTAINED

1 Sample Size (N)	75
2 Sum of Measurements: (Sum X)	7504.80
3 Sum of Squared Measurements	750965.02
4 Correction Factor (CF): Sum of Measurements Squared / N	750960.31
5 Corrected Sum of Squares (SS)	4.71
6 Variance (V) : SS/(N-1)	0.0637
7 Estimate of Lot Standard Deviation (S): SQRT of V	0.2524
8 Sample Mean (XBAR) : Sum X/N	100.06
9 Upper Specification Limit (U)	102.00
10 Lower Specification Limit (L)	98.00
11 Quality Index Upper (QU): (U-XBAR) / S	7.67
12 Quality Index Lower (QL): (XBAR-L) / S	8.18
13 Estimate of Lot Percent NCF Above U (PU)	0.00
14 Estimate of Lot Percent NCF Below L (PL)	0.00
15 Total Estimate Percent NCF. In Lot (P): PU+PL	0.00
16 Maximum Allowable Percent NCF (M)	4.83
17 Acceptability Criterion: Compare P with M	PASS
18 The Lot Meets the Acceptability Criterion if P <= M	
19 The Lot Fails the Acceptability Criterion if P > M	

Kentucky Utilities

2013 Sample Test Program ( 01/01/2013 ) to ( 12/31/2013 )

Device Category: F2S240V30AC200 Model Number: J5S Division: 01 Sample Lot: 1151 Lot Descr: KU J5S - 4  
 In Service Population: 10,000 Sample Quantity: 75 Meters Tested: 75 Pass/ Fail: PASS

Test Results Per ANSI/ASQC Z1.9-1993

Double Specification Limit - Variability Unknown - Standard Deviation Method  
 One AQL Value for Both Upper and Lower Specification Limit Combined  
 AQL = 2.5% - Inspection Level II "E" # Normal Inspection

Page 36

Run Date: 12/31/2013

Run Time: 02:31:01 AM

Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy
C297777	100.30	C303099	99.80	C303141	100.20	C303251	99.80	C303375	100.20
C303489	100.30	C303546	100.00	C303586	99.90	C303614	99.50	C303653	100.00
C303683	100.20	C303707	99.70	C303713	99.80	C303867	100.30	C303984	100.20
C304013	100.10	C304229	100.00	C306287	99.70	C306305	100.00	C306324	99.70
C306699	99.50	C306891	99.60	C307120	100.00	C307152	99.90	C307342	99.90
C307376	100.00	C307379	99.90	L270427	99.90	L270467	100.10	L270647	100.00
L270808	100.10	L271081	99.70	L271213	99.60	L271515	99.70	L271560	100.10
L271581	99.70	L271764	99.80	L271856	100.10	L271924	100.00	L271960	100.00
L272102	99.70	L272143	100.00	L272270	99.90	L272353	99.50	L272437	99.60
L272490	99.70	L272763	99.80	L272888	100.00	L273208	99.90	L273353	99.90
L273864	99.40	L273939	100.10	L274187	99.90	L274210	99.60	L274568	99.80
L274652	100.30	L274868	99.70	L274916	99.80	L274996	100.00	L275086	99.70
L275375	99.80	L275396	100.00	L275397	99.70	L275832	99.10	L276009	100.10
L276149	100.10	L276352	100.00	L276402	100.00	M432935	99.90	M433449	100.20
M433502	99.80	P001123	99.70	P001140	99.70	P007061	100.00	P007076	99.90

INFORMATION NEEDED

VALUE OBTAINED

1 Sample Size (N)	75
2 Sum of Measurements: (Sum X)	7491.60
3 Sum of Squared Measurements	748324.84
4 Correction Factor (CF): Sum of Measurements Squared / N	748320.94
5 Corrected Sum of Squares (SS)	3.90
6 Variance (V) : SS/(N-1)	0.0527
7 Estimate of Lot Standard Deviation(S): SQRT of V	0.2295
8 Sample Mean (XBAR) : Sum X/N	99.89
9 Upper Specification Limit (U)	102.00
10 Lower Specification Limit (L)	98.00
11 Quality Index Upper (QU) : (U-XBAR) / S	9.20
12 Quality Index Lower (QL) : (XBAR-L) / S	8.22
13 Estimate of Lot Percent NCF Above U (PU)	0.00
14 Estimate of Lot Percent NCF Below L (PL)	0.00
15 Total Estimate Percent NCF. In Lot (P) : PU+PL	0.00
16 Maximum Allowable Percent NCF (M)	4.83
17 Acceptability Criterion: Compare P with M	PASS
18 The Lot Meets the Acceptability Criterion if P <= M	
19 The Lot Fails the Acceptability Criterion if P > M	

Kentucky Utilities

2013 Sample Test Program ( 01/01/2013 ) to ( 12/31/2013 )

Device Category: F2S240V30AC200 Model Number: J5S Division: 01 Sample Lot: 1152 Lot Descr: KU J5S - 5  
 In Service Population: 10,000 Sample Quantity: 75 Meters Tested: 75 Pass/ Fail: PASS

Test Results Per ANSI/ASQC Z1.9-1993

Double Specification Limit - Variability Unknown - Standard Deviation Method

One AQL Value for Both Upper and Lower Specification Limit Combined

AQL = 2.5% - Inspection Level II "E" # Normal Inspection

Page 37

Run Date: 12/31/2013

Run Time: 02:31:01 AM

Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy
C307697	99.80	C307709	99.90	C307842	100.10	C307894	100.10	C307909	99.30
C308064	99.80	C308219	99.90	C308221	99.60	C308354	99.50	C308452	99.80
C308622	100.30	C308654	99.90	C308720	99.70	C308838	99.50	C308894	99.70
C308916	99.60	C309010	99.90	C309050	99.60	C309348	99.90	C309397	100.00
C309430	99.70	C309609	99.80	C309615	99.80	C309693	99.80	C309722	99.60
C309781	99.90	C310271	99.90	C311066	99.70	C311122	100.20	C311269	100.00
C311277	99.70	C311334	99.20	C311359	99.40	C311436	99.90	L278272	100.20
L278350	99.90	L278383	99.60	L278488	99.80	L278517	99.40	L278705	99.80
L278776	99.70	L278798	99.80	L278863	99.80	L279187	99.70	L279201	98.60
L279510	99.60	L279734	99.70	L280097	100.00	L280164	99.60	L280475	99.90
L280482	100.00	L280584	99.60	L280694	99.90	L280835	100.00	L281021	99.60
L281189	99.80	L281548	99.60	L281894	99.80	L281920	99.80	L282047	99.90
L282093	99.80	L282140	100.00	L282315	100.00	L282504	99.30	L282532	99.70
L282782	100.00	L282806	99.70	L283042	99.80	L283138	99.90	L283255	99.90
L283341	99.90	L283398	99.90	M438824	99.80	M438850	99.60	M439100	99.90

INFORMATION NEEDED

VALUE OBTAINED

1 Sample Size (N)	75
2 Sum of Measurements: (Sum X)	7482.80
3 Sum of Squared Measurements	746568.46
4 Correction Factor (CF): Sum of Measurements Squared / N	746563.94
5 Corrected Sum of Squares (SS)	4.52
6 Variance (V) : SS/(N-1)	0.0610
7 Estimate of Lot Standard Deviation(S): SQRT of V	0.2470
8 Sample Mean(XBAR) : Sum X/N	99.77
9 Upper Specification Limit (U)	102.00
10 Lower Specification Limit (L)	98.00
11 Quality Index Upper (QU): (U-XBAR) / S	9.02
12 Quality Index Lower (QL): (XBAR-L) / S	7.17
13 Estimate of Lot Percent NCF Above U (PU)	0.00
14 Estimate of Lot Percent NCF Below L (PL)	0.00
15 Total Estimate Percent NCF. In Lot (P): PU+PL	0.00
16 Maximum Allowable Percent NCF(M)	4.83
17 Acceptability Criterion: Compare P with M	PASS
18 The Lot Meets the Acceptability Criterion if P <= M	
19 The Lot Fails the Acceptability Criterion if P > M	



Kentucky Utilities

2013 Sample Test Program ( 01/01/2013 ) to ( 12/31/2013 )

Device Category: F2S240V30AC200 Model Number: J5S Division: 01 Sample Lot: 1153 Lot Descr: KU J5S - 6  
 In Service Population: 10,000 Sample Quantity: 75 Meters Tested: 75 Pass/ Fail: PASS

Test Results Per ANSI/ASQC Z1.9-1993

Double Specification Limit - Variability Unknown - Standard Deviation Method

One AQL Value for Both Upper and Lower Specification Limit Combined

AQL = 2.5% - Inspection Level II "E" # Normal Inspection

Page 38

Run Date: 12/31/2013

Run Time: 02:31:01 AM

Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy
C311555	99.50	C311617	100.20	C311710	100.40	C311937	99.80	C312002	99.80
C312126	100.20	C312302	100.60	C312521	99.80	C312594	99.50	C312789	100.20
C312832	100.50	C313103	99.90	C313310	99.80	C313617	99.50	C313724	99.40
C314402	100.30	C314617	99.70	C314686	100.10	C314750	100.00	C314805	99.40
C314851	100.00	C314913	99.30	C314915	99.70	C315071	99.70	C315214	100.20
C315239	100.20	C315315	100.00	C315355	100.20	C315458	99.90	C315688	100.30
C315715	100.60	C315785	99.20	C315833	99.80	C315837	99.60	C316061	100.40
C316190	100.30	C316282	100.10	C316318	100.20	C316338	100.50	C316393	100.20
C316751	99.80	C317004	99.70	C317176	100.00	C317206	100.00	C317293	99.70
C317573	99.70	C317879	100.30	C318048	99.90	C318131	100.10	C318202	100.00
C318345	99.90	C318544	99.80	C318632	99.80	C318783	100.20	C318929	100.00
C319116	100.40	C319327	99.60	C319792	99.40	C320129	100.00	M437026	100.20
M437060	99.60	W138580	100.10	W138614	99.60	W138689	99.70	W138923	100.00
W138986	99.90	W139344	99.90	W139664	100.00	W139687	100.70	W139762	99.80
W139961	100.00	W140020	100.00	W140122	99.80	W140234	100.30	W140360	99.70

INFORMATION NEEDED

VALUE OBTAINED

1 Sample Size (N)	75
2 Sum of Measurements: (Sum X)	7496.60
3 Sum of Squared Measurements	749327.86
4 Correction Factor (CF): Sum of Measurements Squared / N	749320.15
5 Corrected Sum of Squares (SS)	7.71
6 Variance (V) : SS/(N-1)	0.1041
7 Estimate of Lot Standard Deviation(S): SQRT of V	0.3227
8 Sample Mean(XBAR): Sum X/N	99.95
9 Upper Specification Limit (U)	102.00
10 Lower Specification Limit (L)	98.00
11 Quality Index Upper (QU): (U-XBAR) / S	6.34
12 Quality Index Lower (QL): (XBAR-L) / S	6.06
13 Estimate of Lot Percent NCF Above U (PU)	0.00
14 Estimate of Lot Percent NCF Below L (PL)	0.00
15 Total Estimate Percent NCF. In Lot (P): PU+PL	0.00
16 Maximum Allowable Percent NCF(M)	4.83
17 Acceptability Criterion: Compare P with M	PASS
18 The Lot Meets the Acceptability Criterion if P <= M	
19 The Lot Fails the Acceptability Criterion if P > M	

Kentucky Utilities

2013 Sample Test Program ( 01/01/2013 ) to ( 12/31/2013 )

Device Category: F2S240V30AC200 Model Number: J5S Division: 01 Sample Lot: 1154 Lot Descr: KU J5S - 7  
 In Service Population: 10,000 Sample Quantity: 75 Meters Tested: 75 Pass/ Fail: PASS

Test Results Per ANSI/ASQC Z1.9-1993

Double Specification Limit - Variability Unknown - Standard Deviation Method

One AQL Value for Both Upper and Lower Specification Limit Combined

AQL = 2.5% - Inspection Level II "E" # Normal Inspection

Page 39

Run Date: 12/31/2013

Run Time: 02:31:01 AM

Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy
C320351	100.20	C320366	99.70	C326038	100.00	C326114	99.90	C326133	100.00
C326597	100.00	C326628	99.90	C326636	100.50	C326718	99.80	C326719	100.30
C326727	100.20	C326780	100.10	C326816	100.00	C326893	100.30	C327137	100.10
C327212	100.40	C327307	100.20	C327493	100.20	C327744	99.40	C328075	100.20
C328274	99.70	C328370	99.60	C328429	99.90	L283678	100.00	L283733	99.90
L283740	99.90	L283760	99.80	L283875	100.10	L283889	99.60	L284152	99.90
L284226	99.90	L284509	99.50	L284676	99.90	L284758	99.80	L284881	99.90
L284946	99.70	L285056	99.80	L285261	99.40	L285601	100.00	L285835	99.50
L286111	99.70	L286283	100.40	L286287	100.00	L286363	99.80	L286510	100.00
L286529	99.70	L286600	99.80	L286868	100.00	L287118	100.10	L287325	99.70
L287509	99.80	L291494	99.90	L291638	99.80	M439613	99.40	M439878	100.00
M440047	99.80	M440586	99.80	M440595	99.80	M440609	99.90	M440611	99.90
M440666	99.60	M440705	99.70	M440760	99.20	W140680	100.30	W140880	100.10
W140939	100.10	W140979	99.90	W141017	99.70	W141030	99.80	W141136	100.10
W141963	99.60	W141978	99.60	W142068	99.80	W142148	99.60	W142319	99.60

INFORMATION NEEDED

VALUE OBTAINED

1 Sample Size (N)	75
2 Sum of Measurements: (Sum X)	7491.20
3 Sum of Squared Measurements	748245.82
4 Correction Factor (CF): Sum of Measurements Squared / N	748241.03
5 Corrected Sum of Squares (SS)	4.79
6 Variance (V) : SS/(N-1)	0.0647
7 Estimate of Lot Standard Deviation (S): SQRT of V	0.2544
8 Sample Mean (XBAR): Sum X/N	99.88
9 Upper Specification Limit (U)	102.00
10 Lower Specification Limit (L)	98.00
11 Quality Index Upper (QU): (U-XBAR) / S	8.32
12 Quality Index Lower (QL): (XBAR-L) / S	7.40
13 Estimate of Lot Percent NCF Above U (PU)	0.00
14 Estimate of Lot Percent NCF Below L (PL)	0.00
15 Total Estimate Percent NCF. In Lot (P): PU+PL	0.00
16 Maximum Allowable Percent NCF(M)	4.83
17 Acceptability Criterion: Compare P with M	PASS
18 The Lot Meets the Acceptability Criterion if P <= M	
19 The Lot Fails the Acceptability Criterion if P > M	

Kentucky Utilities

2013 Sample Test Program ( 01/01/2013 ) to ( 12/31/2013 )

Device Category: F2S240V30AC200      Model Number: J5S      Division: 01      Sample Lot: 1155      Lot Descr: KU J5S - 8  
 In Service Population: 10,000      Sample Quantity: 75      Meters Tested: 75      Pass/ Fail: PASS

Test Results Per ANSI/ASQC Z1.9-1993

Double Specification Limit - Variability Unknown - Standard Deviation Method  
 One AQL Value for Both Upper and Lower Specification Limit Combined  
 AQL = 2.5% - Inspection Level II "E" # Normal Inspection

Page 40  
 Run Date: 12/31/2013  
 Run Time: 02:31:01 AM

Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy
C328818	100.10	C328833	100.10	C328876	99.20	C328921	99.90	C329247	100.00
C329274	99.90	C329514	99.70	C329543	100.20	C329926	100.10	C330251	99.60
C330395	100.00	L292431	100.00	L292450	99.70	L292464	100.10	L292726	100.00
L292951	100.00	L293165	100.10	L293184	100.20	L293219	100.00	L293309	100.30
L293328	99.90	L293669	99.90	L293947	100.20	L294022	100.00	L294087	100.20
L294339	100.30	L294970	100.10	L295005	100.40	L295077	100.00	L295286	100.00
L295398	99.50	L295432	100.30	L295494	99.70	L295928	100.40	L295955	99.90
L295975	100.00	L296249	100.00	L296308	99.60	L296316	100.10	L296390	100.10
L296428	99.80	L296434	99.60	L296449	99.70	L296514	99.60	L296637	99.50
L296823	100.10	L297131	99.90	L297281	99.70	L297323	99.60	L297343	100.60
L297490	100.70	L297502	100.20	M442637	99.90	M442665	100.10	M442686	99.60
M443031	100.20	M443175	100.00	M443609	100.50	M443678	100.40	M443769	100.10
M443880	99.90	M444013	100.10	M444061	99.70	M444401	100.60	W144585	100.20
W144733	100.30	W144809	100.00	W144996	99.20	W145035	100.10	W145088	100.20
W145269	100.30	W146079	100.00	W146123	99.80	W146156	100.20	W146169	99.90

INFORMATION NEEDED

VALUE OBTAINED

1 Sample Size (N)	75
2 Sum of Measurements: (Sum X)	7500.10
3 Sum of Squared Measurements	750026.33
4 Correction Factor (CF): Sum of Measurements Squared / N	750020.00
5 Corrected Sum of Squares (SS)	6.33
6 Variance (V) : SS/(N-1)	0.0855
7 Estimate of Lot Standard Deviation(S): SQRT of V	0.2925
8 Sample Mean (XBAR): Sum X/N	100.00
9 Upper Specification Limit (U)	102.00
10 Lower Specification Limit (L)	98.00
11 Quality Index Upper (QU): (U-XBAR) / S	6.83
12 Quality Index Lower (QL): (XBAR-L) / S	6.84
13 Estimate of Lot Percent NCF Above U (PU)	0.00
14 Estimate of Lot Percent NCF Below L (PL)	0.00
15 Total Estimate Percent NCF. In Lot (P): PU+PL	0.00
16 Maximum Allowable Percent NCF(M)	4.83
17 Acceptability Criterion: Compare P with M	PASS
18 The Lot Meets the Acceptability Criterion if P <= M	
19 The Lot Fails the Acceptability Criterion if P > M	



Kentucky Utilities

2013 Sample Test Program ( 01/01/2013 ) to ( 12/31/2013 )

Device Category: F2S240V30AC200 Model Number: J5S Division: 01 Sample Lot: 1156 Lot Descr: KU J5S - 9  
 In Service Population: 10,000 Sample Quantity: 75 Meters Tested: 75 Pass/ Fail: PASS

Test Results Per ANSI/ASQC Z1.9-1993

Double Specification Limit - Variability Unknown - Standard Deviation Method

One AQL Value for Both Upper and Lower Specification Limit Combined

AQL = 2.5% - Inspection Level II "E" # Normal Inspection

Page 41

Run Date: 12/31/2013

Run Time: 02:31:01 AM

Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy
C331455	99.50	C331614	99.70	C349323	100.20	C349347	99.40	C349360	100.40
C349435	99.00	C349662	99.20	C349810	99.90	C349859	99.40	C349921	98.80
C350269	99.50	C350483	99.50	C350631	99.80	C350637	100.20	C350644	99.90
C350844	99.70	C353269	100.20	C353305	99.60	C353317	99.50	C353318	99.30
C353383	98.70	C353410	99.50	C353548	99.80	C353558	99.60	C353612	99.40
C353684	99.40	C353694	99.40	C353704	100.00	C353731	99.60	C353803	99.70
C353833	99.30	C354067	99.30	C354510	99.90	C354716	99.30	C354826	99.90
C354857	99.90	C354920	100.20	C354991	99.80	C355358	99.60	C355430	99.30
C355793	100.00	C355799	99.20	C355870	99.30	L313408	100.20	L313542	99.80
L313715	99.80	L314192	99.10	L314218	99.90	L314382	99.30	L314672	99.90
L314858	98.70	L314928	99.30	L315574	99.50	L315602	99.50	L315612	99.60
L315759	100.00	L315975	99.90	L316048	99.50	L316100	99.20	L316175	99.90
L316505	99.20	L316877	99.10	L316887	98.90	L317238	100.20	L317262	99.80
L317297	99.50	L317442	99.70	M437375	99.60	M437519	99.90	M445928	100.20
M445944	99.70	M446022	100.20	M446254	99.90	W146371	99.50	W146504	99.80

INFORMATION NEEDED

VALUE OBTAINED

1 Sample Size (N)	75
2 Sum of Measurements: (Sum X)	7471.10
3 Sum of Squared Measurements	744241.71
4 Correction Factor (CF): Sum of Measurements Squared / N	744231.14
5 Corrected Sum of Squares (SS)	10.57
6 Variance (V) : SS/(N-1)	0.1429
7 Estimate of Lot Standard Deviation (S): SQRT of V	0.3780
8 Sample Mean (XBAR): Sum X/N	99.61
9 Upper Specification Limit (U)	102.00
10 Lower Specification Limit (L)	98.00
11 Quality Index Upper (QU): (U-XBAR) / S	6.31
12 Quality Index Lower (QL): (XBAR-L) / S	4.27
13 Estimate of Lot Percent NCF Above U (PU)	0.00
14 Estimate of Lot Percent NCF Below L (PL)	0.00
15 Total Estimate Percent NCF. In Lot (P): PU+PL	0.00
16 Maximum Allowable Percent NCF (M)	4.83
17 Acceptability Criterion: Compare P with M	PASS
18 The Lot Meets the Acceptability Criterion if P <= M	
19 The Lot Fails the Acceptability Criterion if P > M	

Kentucky Utilities

2013 Sample Test Program ( 01/01/2013 ) to ( 12/31/2013 )

Device Category: F2S240V30AC200      Model Number: J5S      Division: 01      Sample Lot: 1157      Lot Descr: KU J5S - 10  
 In Service Population: 10,000      Sample Quantity: 75      Meters Tested: 75      Pass/ Fail: PASS

Test Results Per ANSI/ASQC Z1.9-1993

Double Specification Limit - Variability Unknown - Standard Deviation Method  
 One AQL Value for Both Upper and Lower Specification Limit Combined  
 AQL = 2.5% - Inspection Level II "E" # Normal Inspection

Page 42

Run Date: 12/31/2013

Run Time: 02:31:01 AM

Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy
C356096	99.80	C356144	99.70	C356170	100.60	C356568	98.90	C356618	99.70
C356805	99.50	C356957	99.90	C357203	100.00	C357245	99.60	C357265	99.40
C357292	99.20	C357358	99.80	C357484	100.10	C357842	100.10	C357876	100.10
C358404	99.20	C358441	100.10	C358446	99.00	C358583	99.80	C358801	99.70
C359154	99.90	C359324	99.70	C359483	101.10	C359520	100.20	C359553	100.40
C359723	100.00	C360018	99.10	C360579	98.90	C360583	99.40	C360699	99.80
C360757	99.50	C360990	99.60	C361004	99.60	C361037	99.50	C361129	99.30
C361149	98.90	C361212	99.70	C361594	99.50	C361686	98.90	C361840	98.80
C361873	99.40	C361981	99.20	C362124	99.60	C362218	99.90	C362349	99.70
C362357	99.50	C362384	100.00	C362956	99.60	C363157	99.60	C363601	99.90
C363608	99.40	C363892	99.70	C364017	99.30	C364055	99.90	C364126	99.90
C364405	99.60	C364413	99.80	C364565	99.60	C364631	99.20	C364796	99.70
C364915	98.60	C364923	99.60	C365107	99.70	C365154	99.40	C365391	99.50
C365603	99.10	C365686	99.70	C365906	99.30	C365937	99.80	C366156	99.60
C366164	99.30	C366441	99.30	C366449	99.90	C366513	99.60	C366579	100.30

INFORMATION NEEDED

VALUE OBTAINED

1 Sample Size (N)	75
2 Sum of Measurements: (Sum X)	7471.20
3 Sum of Squared Measurements	744264.04
4 Correction Factor (CF): Sum of Measurements Squared / N	744251.06
5 Corrected Sum of Squares (SS)	12.98
6 Variance (V) : SS/(N-1)	0.1754
7 Estimate of Lot Standard Deviation(S): SQRT of V	0.4188
8 Sample Mean(XBAR): Sum X/N	99.62
9 Upper Specification Limit (U)	102.00
10 Lower Specification Limit (L)	98.00
11 Quality Index Upper (QU): (U-XBAR) / S	5.69
12 Quality Index Lower (QL): (XBAR-L) / S	3.86
13 Estimate of Lot Percent NCF Above U (PU)	0.00
14 Estimate of Lot Percent NCF Below L (PL)	0.00
15 Total Estimate Percent NCF. In Lot (P): PU+PL	0.00
16 Maximum Allowable Percent NCF (M)	4.83
17 Acceptability Criterion: Compare P with M	PASS
18 The Lot Meets the Acceptability Criterion if P <= M	
19 The Lot Fails the Acceptability Criterion if P > M	

Kentucky Utilities

2013 Sample Test Program ( 01/01/2013 ) to ( 12/31/2013 )

Device Category: F2S240V30AC200 Model Number: J5S Division: 01 Sample Lot: 1158 Lot Descr: KU J5S - 11  
 In Service Population: 10,000 Sample Quantity: 75 Meters Tested: 75 Pass/ Fail: PASS

Test Results Per ANSI/ASQC Z1.9-1993

Double Specification Limit - Variability Unknown - Standard Deviation Method

One AQL Value for Both Upper and Lower Specification Limit Combined

AQL = 2.5% - Inspection Level II "E" # Normal Inspection

Page 43

Run Date: 12/31/2013

Run Time: 02:31:01 AM

Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy
C367027	99.70	C367254	100.50	C367289	100.30	C367321	99.10	C367340	99.40
C367726	99.50	C368143	99.80	C368277	99.80	C368422	99.10	C370395	99.90
C370422	98.80	C370502	100.10	C370518	100.50	C370656	100.30	C370722	99.90
C370778	99.80	C370998	99.40	C371059	99.50	C371211	99.50	C371321	98.90
C371596	99.60	C371685	99.40	C371713	99.50	C371728	99.30	C371748	99.50
C371941	99.40	C372550	98.90	C372570	99.20	C372598	99.90	C373091	99.60
C373429	99.80	C374075	99.90	C374111	99.80	C374160	99.70	C374472	99.60
C374515	99.80	C374623	100.00	C374631	99.40	C374662	99.80	C374666	99.80
C374760	99.90	C375048	99.90	C375177	99.90	C375377	100.10	M447979	99.20
M448101	99.50	M448143	99.10	M448168	99.50	M448186	98.90	M448196	99.80
M448257	100.20	M448338	99.30	M448449	99.50	M448899	99.60	M449052	99.90
M449223	99.20	M449254	99.80	M449284	99.90	M449308	99.50	M449312	99.60
M449487	99.80	M449512	99.70	M449739	99.10	M449755	99.20	M449879	99.60
M449881	99.50	M449931	99.20	M450037	99.30	M450048	99.50	M450100	99.30
M450267	99.90	M450348	99.10	M450519	100.00	M450756	99.20	M450868	99.30

INFORMATION NEEDED

VALUE OBTAINED

1 Sample Size (N)	75
2 Sum of Measurements: (Sum X)	7469.70
3 Sum of Squared Measurements	743962.47
4 Correction Factor (CF): Sum of Measurements Squared / N	743952.24
5 Corrected Sum of Squares (SS)	10.23
6 Variance (V) : SS/(N-1)	0.1382
7 Estimate of Lot Standard Deviation(S): SQRT of V	0.3718
8 Sample Mean(XBAR): Sum X/N	99.60
9 Upper Specification Limit (U)	102.00
10 Lower Specification Limit (L)	98.00
11 Quality Index Upper (QU): (U-XBAR) / S	6.47
12 Quality Index Lower (QL): (XBAR-L) / S	4.29
13 Estimate of Lot Percent NCF Above U (PU)	0.00
14 Estimate of Lot Percent NCF Below L (PL)	0.00
15 Total Estimate Percent NCF. In Lot (P): PU+PL	0.00
16 Maximum Allowable Percent NCF (M)	4.83
17 Acceptability Criterion: Compare P with M	PASS
18 The Lot Meets the Acceptability Criterion if P <= M	
19 The Lot Fails the Acceptability Criterion if P > M	



Kentucky Utilities

2013 Sample Test Program ( 01/01/2013 ) to ( 12/31/2013 )

Device Category: F2S240V30AC200      Model Number: J5S      Division: 01      Sample Lot: 1159      Lot Descr: KU J5S - 12  
 In Service Population: 10,000      Sample Quantity: 75      Meters Tested: 75      Pass/ Fail: PASS

Test Results Per ANSI/ASQC Z1.9-1993

Double Specification Limit - Variability Unknown - Standard Deviation Method  
 One AQL Value for Both Upper and Lower Specification Limit Combined  
 AQL = 2.5% - Inspection Level II "E" # Normal Inspection

Page 44  
 Run Date: 12/31/2013  
 Run Time: 02:31:01 AM

Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy
C375767	99.90	C375904	99.90	C376004	99.90	C376066	100.00	C376108	99.90
C376347	99.80	C376618	99.90	C376660	99.80	C376819	100.10	C377173	100.00
C377490	99.30	C377587	100.10	C377714	100.20	C377750	99.90	C377756	99.50
C377898	99.80	C378005	100.30	C378133	99.50	C378227	99.80	C378303	99.80
C378371	99.50	C378541	100.10	C378852	100.10	C379125	99.80	C379190	99.70
C379216	99.40	C379256	99.60	C379315	99.70	C379344	99.70	C379349	99.50
C379418	99.80	C379663	100.00	C379903	99.70	C379946	99.80	C380286	99.90
C380373	100.30	C383585	100.20	C383684	100.10	C383932	100.16	C383933	99.70
C384133	99.90	C384531	99.90	C384583	100.30	C384984	100.20	C385022	99.20
C385162	99.40	C385174	99.70	C385402	99.70	C385519	99.80	C385579	99.90
C385677	100.20	C385757	100.30	C386318	99.80	C386648	100.00	C386696	99.90
C386744	99.80	C386847	100.10	C386974	100.20	C387102	100.00	C387159	100.60
C387490	99.80	C387755	99.80	C387822	99.70	C388014	99.60	C388178	99.60
C388231	100.00	C388412	100.30	C388535	99.50	C388589	99.50	C388692	99.90
C388807	100.10	C388848	100.00	C388991	99.80	C389036	99.90	L317694	99.90

INFORMATION NEEDED

VALUE OBTAINED

1 Sample Size (N)	75
2 Sum of Measurements: (Sum X)	7490.46
3 Sum of Squared Measurements	748098.36
4 Correction Factor (CF): Sum of Measurements Squared / N	748093.21
5 Corrected Sum of Squares (SS)	5.14
6 Variance (V) : SS/(N-1)	0.0695
7 Estimate of Lot Standard Deviation(s): SQRT of V	0.2636
8 Sample Mean(XBAR): Sum X/N	99.87
9 Upper Specification Limit (U)	102.00
10 Lower Specification Limit (L)	98.00
11 Quality Index Upper (QU): (U-XBAR) / s	8.07
12 Quality Index Lower (QL): (XBAR-L) / s	7.10
13 Estimate of Lot Percent NCF Above U (PU)	0.00
14 Estimate of Lot Percent NCF Below L (PL)	0.00
15 Total Estimate Percent NCF In Lot (P): PU+PL	0.00
16 Maximum Allowable Percent NCF (M)	4.83
17 Acceptability Criterion: Compare P with M	PASS
18 The Lot Meets the Acceptability Criterion if P.<= M	
19 The Lot Fails the Acceptability Criterion if P > M	

Kentucky Utilities

2013 Sample Test Program ( 01/01/2013 ) to ( 12/31/2013 )

Device Category: F2S240V30AC200      Model Number: J5S      Division: 01      Sample Lot: 1160      Lot Descr: KU J5S - 13  
 In Service Population: 10,000      Sample Quantity: 75      Meters Tested: 75      Pass/ Fail: PASS

Test Results Per ANSI/ASQC Z1.9-1993

Double Specification Limit - Variability Unknown - Standard Deviation Method

One AQL Value for Both Upper and Lower Specification Limit Combined

AQL = 2.5% - Inspection Level II "E" # Normal Inspection

Page 45

Run Date: 12/31/2013

Run Time: 02:31:01 AM

Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy
C389505	99.70	C389704	99.70	C389739	99.60	C389744	99.80	C389751	99.80
C389789	99.70	C390238	99.60	C390442	99.70	C392109	100.00	C392227	99.70
C392379	99.80	C392510	99.40	C392620	99.60	C392654	99.60	C392702	99.40
C392731	99.50	C392961	99.60	C392994	99.60	C393091	99.80	C393148	99.70
C393577	99.80	C393639	100.20	C393955	99.40	C394072	100.60	C394166	100.10
C394253	100.20	C394263	99.80	C394396	100.00	C394446	99.90	C394706	99.80
C394717	99.40	C394804	99.70	C394811	99.80	C394897	99.90	C394906	100.00
C395028	100.30	C395393	100.00	C395596	99.80	C395634	100.20	C395975	98.90
C395982	100.20	C396050	100.10	C396084	100.40	C396147	99.90	C396150	100.60
C396307	100.80	C396319	100.20	C396435	99.80	C396486	100.10	C396493	100.20
C396966	100.60	C397041	99.80	C397085	100.20	C397288	100.40	C397372	99.40
C397431	100.10	C397625	99.80	C397897	100.10	C397901	100.20	C398039	99.80
C398163	100.00	C398513	99.90	C398687	99.50	C398825	100.30	C398827	100.40
C399026	100.30	C399043	100.20	C399298	100.00	C400148	100.60	C400260	100.20
C400325	100.30	C400614	99.30	C400740	100.70	C400914	100.20	C401035	100.20

INFORMATION NEEDED

VALUE OBTAINED

1 Sample Size (N)	75
2 Sum of Measurements: (Sum X)	7495.90
3 Sum of Squared Measurements	749190.09
4 Correction Factor (CF): Sum of Measurements Squared / N	749180.22
5 Corrected Sum of Squares (SS)	9.87
6 Variance (V) : SS/(N-1)	0.1333
7 Estimate of Lot Standard Deviation(S): SQRT of V	0.3651
8 Sample Mean (XBAR): Sum X/N	99.95
9 Upper Specification Limit (U)	102.00
10 Lower Specification Limit (L)	98.00
11 Quality Index Upper (QU): (U-XBAR) / S	5.63
12 Quality Index Lower (QL): (XBAR-L) / S	5.33
13 Estimate of Lot Percent NCF Above U (PU)	0.00
14 Estimate of Lot Percent NCF Below L (PL)	0.00
15 Total Estimate Percent NCF. In Lot (P): PU+PL	0.00
16 Maximum Allowable Percent NCF(M)	4.83
17 Acceptability Criterion: Compare P with M	PASS
18 The Lot Meets the Acceptability Criterion if P <= M	
19 The Lot Fails the Acceptability Criterion if P > M	

Kentucky Utilities

2013 Sample Test Program ( 01/01/2013 ) to ( 12/31/2013 )

Device Category: F2S240V30AC200

Model Number: J5S

Division: 01

Sample Lot: 1161

Lot Descr: KU J5S - 14

In Service Population: 10,000

Sample Quantity: 75

Meters Tested: 75

Pass/ Fail: PASS

Test Results Per ANSI/ASQC Z1.9-1993

Double Specification Limit - Variability Unknown - Standard Deviation Method

One AQL Value for Both Upper and Lower Specification Limit Combined

AQL = 2.5% - Inspection Level II "E" # Normal Inspection

Page 46

Run Date: 12/31/2013

Run Time: 02:31:01 AM

Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy
C401291	99.50	C401867	99.60	C401888	100.00	C402115	99.50	C402156	99.90
C402247	100.00	C402391	100.30	C402857	99.70	C403013	99.90	C403063	100.60
C403158	100.20	C403314	100.60	C403390	100.10	C403420	100.30	C403547	99.90
C403568	99.50	C403613	99.40	C403843	99.60	C404106	100.00	C404137	99.40
C404164	100.00	C404234	99.80	C404257	99.60	C404351	99.80	C404565	100.20
C404839	100.00	C404906	99.90	C404954	100.20	C405064	99.20	C405203	99.40
C405594	99.70	C405603	99.30	C405614	99.80	C405655	99.90	C405769	99.70
C405800	100.10	C410197	99.40	C410294	100.00	C410330	99.00	C410349	99.60
C410428	99.10	C410493	99.40	C411075	99.80	C411099	100.10	C411206	99.60
C411284	99.30	C411711	100.30	C411726	100.10	C411875	99.20	C411938	99.80
C411972	99.70	C412001	99.50	C412088	99.80	C412137	99.40	C412421	100.10
C412647	99.80	C412677	99.60	C412696	99.90	C412801	98.90	C412864	99.30
C413304	99.00	C413728	99.00	C414007	99.60	C414330	99.50	C414380	99.50
C414428	99.30	C414451	99.70	C414468	92.50	C414495	99.30	C414500	100.00
C414509	99.60	C414553	99.20	C414647	99.40	C414811	99.50	C415037	99.50

INFORMATION NEEDED

VALUE OBTAINED

1 Sample Size (N)	75
2 Sum of Measurements: (Sum X)	7469.90
3 Sum of Squared Measurements	744053.39
4 Correction Factor (CF): Sum of Measurements Squared / N	743992.08
5 Corrected Sum of Squares (SS)	61.31
6 Variance (V) : SS/(N-1)	0.8285
7 Estimate of Lot Standard Deviation(S): SQRT of V	0.9102
8 Sample Mean(XBAR) : Sum X/N	99.60
9 Upper Specification Limit (U)	102.00
10 Lower Specification Limit (L)	98.00
11 Quality Index Upper (QU) : (U-XBAR) / S	2.64
12 Quality Index Lower (QL) : (XBAR-L) / S	1.76
13 Estimate of Lot Percent NCF Above U (PU)	0.35
14 Estimate of Lot Percent NCF Below L (PL)	3.81
15 Total Estimate Percent NCF. In Lot (P) : PU+PL	4.16
16 Maximum Allowable Percent NCF (M)	4.83
17 Acceptability Criterion: Compare P with M	PASS
18 The Lot Meets the Acceptability Criterion if P <= M	
19 The Lot Fails the Acceptability Criterion if P > M	



Kentucky Utilities

2013 Sample Test Program ( 01/01/2013 ) to ( 12/31/2013 )

Device Category: F2S240V30AC200      Model Number: J5S      Division: 01      Sample Lot: 1162      Lot Descr: KU J5S - 15  
 In Service Population: 8,169      Sample Quantity: 75      Meters Tested: 75      Pass/ Fail: PASS

Test Results Per ANSI/ASQC Z1.9-1993

Double Specification Limit - Variability Unknown - Standard Deviation Method

One AQL Value for Both Upper and Lower Specification Limit Combined

AQL = 2.5% - Inspection Level II "E" # Normal Inspection

Page 47

Run Date: 12/31/2013

Run Time: 02:31:01 AM

Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy
C415237	99.80	C415248	98.80	C415336	99.30	C415492	99.00	C415628	99.10
C415654	99.60	C415662	99.70	C417758	99.50	C417801	99.50	C417848	99.70
C418138	99.40	C418173	99.60	C418198	99.40	C418229	99.50	C418421	99.00
C418437	98.80	C418553	99.50	C418637	98.90	C418644	98.70	C418815	99.50
C418899	99.20	C419005	98.90	C419355	98.60	C419813	99.20	C419987	98.90
C420002	99.50	C420042	99.00	C420310	98.60	C420386	99.10	C420411	98.90
C420412	99.00	C420437	99.60	C420585	99.50	C420741	99.00	C420899	98.90
C421143	99.40	C421213	99.40	C421218	99.30	C421626	99.10	C421753	99.80
C422015	99.20	C422034	99.00	C422058	99.40	C422241	99.00	C422247	98.80
C422290	99.80	C422313	99.50	C422315	99.50	C422475	99.40	C422520	99.40
C422621	99.10	C422677	100.00	C422806	99.10	C422934	99.60	C422979	99.10
C423034	98.80	C423116	99.70	C423444	99.00	C423675	100.20	C423802	99.10
C423977	99.30	C424181	99.80	C424334	99.70	C424365	99.70	C424409	99.90
C424799	99.20	C424863	99.90	C424896	99.50	C425096	99.80	C425118	99.20
C425121	99.40	C425177	99.20	C425197	99.60	C425419	100.40	C425468	99.50

INFORMATION NEEDED

VALUE OBTAINED

1 Sample Size (N)	75
2 Sum of Measurements: (Sum X)	7450.00
3 Sum of Squared Measurements	740043.70
4 Correction Factor (CF): Sum of Measurements Squared / N	740033.33
5 Corrected Sum of Squares (SS)	10.37
6 Variance (V) : SS/(N-1)	0.1401
7 Estimate of Lot Standard Deviation(S): SQRT of V	0.3743
8 Sample Mean (XBAR): Sum X/N	99.33
9 Upper Specification Limit (U)	102.00
10 Lower Specification Limit (L)	98.00
11 Quality Index Upper (QU): (U-XBAR) / s	7.12
12 Quality Index Lower (QL): (XBAR-L) / s	3.56
13 Estimate of Lot Percent NCF Above U (PU)	0.00
14 Estimate of Lot Percent NCF Below L (PL)	0.01
15 Total Estimate Percent NCF. In Lot (P): PU+PL	0.01
16 Maximum Allowable Percent NCF (M)	4.83
17 Acceptability Criterion: Compare P with M	PASS
18 The Lot Meets the Acceptability Criterion if P <= M	
19 The Lot Fails the Acceptability Criterion if P > M	

Kentucky Utilities

2013 Sample Test Program ( 01/01/2013 ) to ( 12/31/2013 )

Device Category: F2S240V15AC100      Model Number: MKS      Division: 01      Sample Lot: 1163      Lot Descr: KU. MKS - 1  
 In Service Population: 552      Sample Quantity: 35      Meters Tested: 35      Pass/ Fail: PASS

Test Results Per ANSI/ASQC Z1.9-1993

Double Specification Limit - Variability Unknown - Standard Deviation Method  
 One AQL Value for Both Upper and Lower Specification Limit Combined  
 AQL = 2.5% - Inspection Level II "E" # Normal Inspection

Page 48

Run Date: 12/31/2013

Run Time: 02:31:01 AM

Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy
C185016	100.00	C186125	100.30	C189258	99.10	C190207	99.10	C191788	99.80
C193170	98.70	C193946	99.60	C194898	99.40	C195221	99.60	C195711	99.90
C197515	100.10	C198210	100.00	C200061	99.70	C202064	99.50	C203007	99.40
W083460	100.20	W083882	100.00	W084566	99.00	W085629	100.10	W085905	100.40
W086584	99.30	W088080	99.40	W088086	100.00	W088109	99.60	W088949	99.20
W089110	100.00	W089419	99.60	W089875	99.50	W090779	99.60	W090960	100.00
W091389	100.00	W091737	99.60	W091910	100.00	W091930	101.00	W092121	100.20

INFORMATION NEEDED

VALUE OBTAINED

1 Sample Size (N)	35
2 Sum of Measurements: (Sum X)	3490.90
3 Sum of Squared Measurements	348189.47
4 Correction Factor (CF): Sum of Measurements Squared / N	348182.37
5 Corrected Sum of Squares (SS)	7.10
6 Variance (V) : SS/(N-1)	0.2089
7 Estimate of Lot standard Deviation (S): SQRT of V	0.4571
8 Sample Mean (XBAR): Sum X/N	99.74
9 Upper Specification Limit (U)	102.00
10 Lower Specification Limit (L)	98.00
11 Quality Index Upper (QU): (U-XBAR) / S	4.94
12 Quality Index Lower (QL): (XBAR-L) / S	3.81
13 Estimate of Lot Percent NCF Above U (PU)	0.00
14 Estimate of Lot Percent NCF Below L (PL)	0.00
15 Total Estimate Percent NCF. In Lot (P): PU+PL	0.00
16 Maximum Allowable Percent NCF (M)	5.58
17 Acceptability Criterion: Compare P with M	PASS
18 The Lot Meets the Acceptability Criterion if P <= M	
19 The Lot Fails the Acceptability Criterion if P > M	

Kentucky Utilities

2013 Sample Test Program ( 01/01/2013 ) to ( 12/31/2013 )

Device Category: F2S240V30AC200      Model Number: MQS      Division: 01      Sample Lot: 1164      Lot Descr: KU MQS - 1  
 In Service Population: 3,997      Sample Quantity: 75      Meters Tested: 75      Pass/ Fail: PASS

Test Results Per ANSI/ASQC Z1.9-1993

Double Specification Limit - Variability Unknown - Standard Deviation Method

One AQL Value for Both Upper and Lower Specification Limit Combined

AQL = 2.5% - Inspection Level II "E" # Normal Inspection

Page 49

Run Date: 12/31/2013

Run Time: 02:31:01 AM

Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy
C205232	100.20	C205309	100.00	C205338	100.00	C206463	99.90	C206497	100.00
C207092	99.50	C207142	99.50	C207618	100.30	C208153	99.80	C208166	99.80
C208526	99.90	C208534	99.70	C208565	100.20	C209171	99.90	C209304	100.40
C209397	100.10	C209822	99.70	C209830	100.30	C209922	100.00	C210351	99.80
C210447	100.00	C211245	99.90	C211253	100.20	C211690	99.50	C211741	100.20
C211803	100.10	C212209	99.80	C212660	99.70	C212689	99.80	C213638	100.40
C214595	100.10	C214599	99.90	C214645	99.40	C214666	100.10	C214676	100.50
C215530	99.80	C215627	100.30	C216493	99.50	C216517	98.90	C216565	99.70
C217966	99.70	C219273	100.20	C222504	100.20	C222654	99.90	C223527	99.90
C223535	100.20	M350420	100.10	M350426	99.50	M362751	99.70	M362977	99.90
M371691	100.00	M372161	100.00	M452424	99.90	W092462	100.40	W092731	100.50
W092792	100.10	W092867	100.00	W092913	100.50	W092958	100.30	W094144	100.10
W094805	100.40	W094808	100.00	W094904	100.00	W094932	100.20	W095937	99.90
W096116	100.40	W096462	100.20	W097277	100.20	W098245	100.00	W099081	100.20
W100743	99.30	W100948	99.90	W100959	100.10	W100977	99.50	W101847	100.30

INFORMATION NEEDED

VALUE OBTAINED

1 Sample Size (N)	75
2 Sum of Measurements: (Sum X)	7498.50
3 Sum of Squared Measurements	749706.97
4 Correction Factor (CF): Sum of Measurements Squared / N	749700.03
5 Corrected Sum of Squares (SS)	6.94
6 Variance (V) : SS/(N-1)	0.0938
7 Estimate of Lot Standard Deviation(S): SQRT of V	0.3062
8 Sample Mean(XBAR): Sum X/N	99.98
9 Upper Specification Limit (U)	102.00
10 Lower Specification Limit (L)	98.00
11 Quality Index Upper (QU): (U-XBAR) / S	6.60
12 Quality Index Lower (QL): (XBAR-L) / S	6.47
13 Estimate of Lot Percent NCF Above U (PU)	0.00
14 Estimate of Lot Percent NCF Below L (PL)	0.00
15 Total Estimate Percent NCF. In Lot (P): PU+PL	0.00
16 Maximum Allowable Percent NCF(M)	4.83
17 Acceptability Criterion: Compare P with M	PASS
18 The Lot Meets the Acceptability Criterion if P <= M	
19 The Lot Fails the Acceptability Criterion if P > M	



Kentucky Utilities

2013 Sample Test Program ( 01/01/2013 ) to ( 12/31/2013 )

Device Category: F2S240V30AC200      Model Number: MS      Division: 01      Sample Lot: 1165      Lot Descr: KU MS - 1  
 In Service Population: 10,000      Sample Quantity: 75      Meters Tested: 75      Pass/ Fail: PASS

Test Results Per ANSI/ASQC Z1.9-1993

Double Specification Limit - Variability Unknown - Standard Deviation Method  
 One AQL Value for Both Upper and Lower Specification Limit Combined  
 AQL = 2.5% - Inspection Level II "E" # Normal Inspection

Page 50  
 Run Date: 12/31/2013  
 Run Time: 02:31:01 AM

Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy
C227140	100.10	C227207	100.10	C227408	100.20	C231095	99.80	C231227	100.60
C231529	100.10	C231550	100.40	C232459	100.80	C232709	99.80	C232711	100.30
C232793	100.10	C234588	99.20	C237333	100.40	C238080	99.80	C238090	100.30
C241873	100.40	C241914	100.10	C241992	99.80	C242060	100.20	C242119	100.10
L136234	99.80	L137729	100.40	L137806	99.90	L139270	100.30	L139299	100.00
L139337	100.20	L141413	99.80	L142993	99.70	L144488	99.20	L147759	100.30
L147835	100.30	L147951	99.80	L148116	100.30	L148129	99.90	L149943	100.00
L149956	100.30	L171748	100.00	L171791	100.00	L173445	100.10	L173468	99.80
L173518	99.90	L175955	99.90	L175996	100.10	L177107	100.10	L177122	99.80
L177258	100.10	L177467	100.00	L180012	99.60	L181465	100.40	L181623	100.40
L181908	99.90	L182935	99.90	L183056	99.60	L183089	99.90	L183150	100.50
L183155	100.00	L183221	99.90	L183329	99.60	L185531	99.60	L186143	100.20
L186162	99.50	L186239	100.10	L186357	100.10	L186394	100.00	L186648	100.40
L187958	100.20	M374551	100.10	M386513	99.60	M388514	100.30	W103382	100.40
W103390	100.20	W103957	100.30	W107710	100.20	W108091	100.40	W109575	100.30

INFORMATION NEEDED

VALUE OBTAINED

1 Sample Size (N)	75
2 Sum of Measurements: (Sum X)	7504.20
3 Sum of Squared Measurements	750846.86
4 Correction Factor (CF): Sum of Measurements Squared / N	750840.24
5 Corrected Sum of Squares (SS)	6.62
6 Variance (V) : SS/(N-1)	0.0895
7 Estimate of Lot Standard Deviation(S): SQRT of V	0.2992
8 Sample Mean(XBAR): Sum X/N	100.06
9 Upper Specification Limit (U)	102.00
10 Lower Specification Limit (L)	98.00
11 Quality Index Upper (QU): (U-XBAR) / S	6.50
12 Quality Index Lower (QL): (XBAR-L) / S	6.87
13 Estimate of Lot Percent NCF Above U (PU)	0.00
14 Estimate of Lot Percent NCF Below L (PL)	0.00
15 Total Estimate Percent NCF, In Lot (P): PU+PL	0.00
16 Maximum Allowable Percent NCF (M)	4.83
17 Acceptability Criterion: Compare P with M	PASS
18 The Lot Meets the Acceptability Criterion if P <= M	
19 The Lot Fails the Acceptability Criterion if P > M	

Kentucky Utilities

2013 Sample Test Program ( 01/01/2013 ) to ( 12/31/2013 )

Device Category: F2S240V30AC200      Model Number: MS      Division: 01      Sample Lot: 1166      Lot Descr: KU MS - 2  
 In Service Population: 10,000      Sample Quantity: 75      Meters Tested: 75      Pass/ Fail: PASS

Test Results Per ANSI/ASQC Z1.9-1993

Double Specification Limit - Variability Unknown - Standard Deviation Method

One AQL Value for Both Upper and Lower Specification Limit Combined

AQL = 2.5% - Inspection Level II "E" # Normal Inspection

Page 51

Run Date: 12/31/2013

Run Time: 02:31:01 AM

Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy
C242363	100.20	C242544	99.50	C242648	99.90	C242661	100.30	C242733	100.70
C246528	100.20	C246600	100.20	C246625	100.40	C246649	100.30	C246822	100.20
C246873	99.90	C246913	100.00	C246934	100.20	C247000	100.10	C247368	100.00
L188155	100.60	L188306	100.20	L189841	99.60	L190062	99.90	L190119	99.70
L193434	100.00	L193640	99.90	L193699	100.00	L194144	100.50	L194258	99.80
L194309	99.90	L194314	99.90	L194479	99.60	L196946	99.70	L197021	100.10
L197084	100.00	L197106	99.50	L197158	100.10	L197307	99.70	L197335	99.80
L197395	99.70	L198298	100.00	L199033	100.20	L199052	99.40	L199320	99.80
L199368	99.40	L201011	99.80	L201044	99.90	L201201	99.50	L202308	99.90
L202483	100.00	L202905	99.90	L203059	100.10	L203144	99.80	L203199	99.60
L206415	99.90	L206463	100.00	L206605	99.90	L208363	100.20	L208580	99.80
L208634	100.10	L208640	99.70	L209518	100.00	L209602	99.90	L209764	100.40
M386747	99.80	M386760	100.10	M386834	100.20	W110427	100.10	W110686	100.30
W111264	99.70	W112141	99.90	W112214	100.30	W112940	100.00	W115107	100.00
W115148	99.80	W115167	100.20	W115197	100.30	W115337	99.80	W115480	100.10

INFORMATION NEEDED

VALUE OBTAINED

1 Sample Size (N)	75
2 Sum of Measurements: (Sum X)	7498.10
3 Sum of Squared Measurements	749625.33
4 Correction Factor (CF): Sum of Measurements Squared / N	749620.05
5 Corrected Sum of Squares (SS)	5.28
6 Variance (V) : SS/(N-1)	0.0714
7 Estimate of Lot Standard Deviation (S): SQRT of V	0.2672
8 Sample Mean (XBAR): Sum X/N	99.97
9 Upper Specification Limit (U)	102.00
10 Lower Specification Limit (L)	98.00
11 Quality Index Upper (QU): (U-XBAR) / S	7.58
12 Quality Index Lower (QL): (XBAR-L) / S	7.39
13 Estimate of Lot Percent NCF Above U (PU)	0.00
14 Estimate of Lot Percent NCF Below L (PL)	0.00
15 Total Estimate Percent NCF. In Lot (P): PU+PL	0.00
16 Maximum Allowable Percent NCF (M)	4.83
17 Acceptability Criterion: Compare P with M	PASS
18 The Lot Meets the Acceptability Criterion if P <= M	
19 The Lot Fails the Acceptability Criterion if P > M	

Kentucky Utilities

2013 Sample Test Program ( 01/01/2013 ) to ( 12/31/2013 )

Device Category: F2S240V30AC200    Model Number: MS    Division: 01    Sample Lot: 1167    Lot Descr: KU MS - 3  
 In Service Population: 10,000    Sample Quantity: 75    Meters Tested: 75    Pass/ Fail: PASS

Test Results Per ANSI/ASQC Z1.9-1993

Double Specification Limit - Variability Unknown - Standard Deviation Method

One AQL Value for Both Upper and Lower Specification Limit Combined

AQL = 2.5% - Inspection Level II "E" # Normal Inspection

Page 52

Run Date: 12/31/2013

Run Time: 02:31:01 AM

Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy
C251006	99.50	C251016	100.00	C251079	100.00	C251168	100.20	C251557	100.50
C251572	100.40	C251641	100.30	C251920	100.30	C259244	100.10	C259348	99.90
C259618	100.20	C259801	100.10	C259990	100.50	C260457	100.30	C260637	100.60
C260693	100.50	C260871	100.30	C260889	100.40	C260901	100.00	C261246	99.80
C261466	99.80	C261482	100.20	C265600	100.30	C266277	100.10	C266284	100.20
C266329	99.90	C266527	100.20	L085752	99.90	L209917	99.70	L211344	100.20
L212499	100.40	L212524	99.70	L212758	100.00	L215596	100.30	L215610	99.80
L215772	99.90	L216026	100.30	L218350	99.90	L218597	99.80	L218703	100.40
L218784	100.20	L221130	100.00	L221139	100.00	L221167	99.90	L221275	100.30
L221280	100.30	L221348	100.10	L222683	99.40	L222751	100.10	L222810	100.10
L222860	100.20	L222947	99.70	L223482	100.10	L223664	100.10	L223733	99.70
L231046	100.30	L231270	100.00	L232197	100.50	L232213	100.30	L232242	99.70
L232675	99.70	L232755	100.10	W115589	99.80	W115725	99.70	W115770	100.00
W115842	99.80	W117273	99.60	W117299	100.10	W117366	100.20	W117493	100.10
W118479	100.70	W118580	99.80	W118644	100.30	W118716	100.10	W118862	100.40

INFORMATION NEEDED

VALUE OBTAINED

1 Sample Size (N)	75
2 Sum of Measurements: (Sum X)	7506.30
3 Sum of Squared Measurements	751265.95
4 Correction Factor (CF): Sum of Measurements Squared / N	751260.53
5 Corrected Sum of Squares (SS)	5.42
6 Variance (V) : SS/(N-1)	0.0733
7 Estimate of Lot Standard Deviation(S) : SQRT of V	0.2707
8 Sample Mean(XBAR): Sum X/N	100.08
9 Upper Specification Limit (U)	102.00
10 Lower Specification Limit (L)	98.00
11 Quality Index Upper (QU): (U-XBAR) / s	7.08
12 Quality Index Lower (QL): (XBAR-L) / s	7.70
13 Estimate of Lot Percent NCF Above U (PU)	0.00
14 Estimate of Lot Percent NCF Below L (PL)	0.00
15 Total Estimate Percent NCF. In Lot (P): PU+PL	0.00
16 Maximum Allowable Percent NCF(M)	4.83
17 Acceptability Criterion: Compare P with M	PASS
18 The Lot Meets the Acceptability Criterion if P <= M	
19 The Lot Fails the Acceptability Criterion if P > M	



Kentucky Utilities

2013 Sample Test Program ( 01/01/2013 ) to ( 12/31/2013 )

Device Category: F2S240V30AC200      Model Number: MS      Division: 01      Sample Lot: 1168      Lot Descr: KU MS - 4  
 In Service Population: 10,000      Sample Quantity: 75      Meters Tested: 75      Pass/ Fail: PASS

Test Results Per ANSI/ASQC Z1.9-1993

Double Specification Limit - Variability Unknown - Standard Deviation Method  
 One AQL Value for Both Upper and Lower Specification Limit Combined  
 AQL = 2.5% - Inspection Level II "E" # Normal Inspection

Page 53  
 Run Date: 12/31/2013  
 Run Time: 02:31:01 AM

Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy
C266200	100.30	C270693	100.10	C270728	100.10	C270862	100.10	C271157	99.90
C271443	100.20	C271641	100.50	C271647	100.00	C271732	100.00	C271744	100.10
C271799	100.10	C271840	100.20	C271876	99.90	C275423	99.90	C276286	100.20
C280413	99.90	C280448	100.30	C280558	100.40	C280596	100.00	C280749	100.50
C285196	100.00	C285237	100.10	C285344	100.30	C285364	99.80	C285371	99.70
C285420	99.90	C285434	100.00	C285452	99.70	C285646	99.90	C285777	99.80
C285874	100.00	C285894	100.80	C285900	100.00	C286142	100.30	C286219	99.70
C286243	100.10	C289568	100.10	C289747	99.50	L236496	100.80	L236510	100.20
L236787	100.00	L237005	99.80	L237046	100.20	L237061	100.10	L237096	100.30
L237301	100.20	L238137	100.00	L238340	99.70	L241003	100.10	L241145	100.00
L245262	100.30	L245297	99.90	L245477	100.00	L245552	100.00	L245696	99.80
L245769	99.90	L259983	100.20	L260354	100.20	L260374	100.10	L260443	100.30
W124767	99.70	W126650	99.90	W126720	100.10	W126769	100.00	W126844	99.80
W126868	99.70	W132497	100.50	W132638	99.90	W133026	100.00	W133050	100.10
W133062	100.20	W133140	100.10	W133217	100.10	W133260	100.10	W133431	100.20

INFORMATION NEEDED

VALUE OBTAINED

1 Sample Size (N)	75
2 Sum of Measurements: (Sum X)	7504.90
3 Sum of Squared Measurements	750984.47
4 Correction Factor (CF): Sum of Measurements Squared / N	750980.32
5 Corrected Sum of Squares (SS)	4.15
6 Variance (V) : SS/(N-1)	0.0561
7 Estimate of Lot Standard Deviation (S): SQRT of V	0.2368
8 Sample Mean (XBAR): Sum X/N	100.07
9 Upper Specification Limit (U)	102.00
10 Lower Specification Limit (L)	98.00
11 Quality Index Upper (QU): (U-XBAR) / S	8.17
12 Quality Index Lower (QL): (XBAR-L) / S	8.72
13 Estimate of Lot Percent NCF Above U (PU)	0.00
14 Estimate of Lot Percent NCF Below L (PL)	0.00
15 Total Estimate Percent NCF. In Lot (P): PU+PL	0.00
16 Maximum Allowable Percent NCF (M)	4.83
17 Acceptability Criterion: Compare P with M	PASS
18 The Lot Meets the Acceptability Criterion if P <= M	
19 The Lot Fails the Acceptability Criterion if P > M	

Kentucky Utilities

2013 Sample Test Program ( 01/01/2013 ) to ( 12/31/2013 )

Device Category: F2S240V30AC200    Model Number: MS    Division: 01    Sample Lot: 1169    Lot Descr: KU MS - 5  
 In Service Population: 3,084    Sample Quantity: 50    Meters Tested: 50    Pass/ Fail: PASS

Test Results Per ANSI/ASQC Z1.9-1993

Double Specification Limit - Variability Unknown - Standard Deviation Method

One AQL Value for Both Upper and Lower Specification Limit Combined

AQL = 2.5% - Inspection Level II "E" # Normal Inspection

Page 54

Run Date: 12/31/2013

Run Time: 02:31:01 AM

Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy
L312410	99.80	L312453	100.20	M434688	100.20	M434718	100.30	M434757	100.20
M434763	99.90	M434815	100.00	M435068	100.20	M435085	100.30	M435138	100.20
M435140	100.00	M435194	100.20	M435291	100.40	M435308	100.20	M435327	99.80
M435333	100.10	M435465	99.70	M435476	100.60	M435580	100.10	W133595	100.50
W134194	100.00	W134208	100.30	W134448	100.30	W134543	100.30	W134575	99.50
W134712	99.90	W134735	99.50	W134766	99.70	W134868	100.00	W134872	100.10
W134880	100.10	W134899	99.90	W134915	100.10	W134984	99.70	W135039	99.90
W135075	99.60	W135144	100.00	W135223	100.30	W135276	100.00	W135278	100.10
W135339	100.00	W135425	100.40	W135469	100.20	W135585	100.30	W135724	100.20
W135802	100.20	W135861	99.90	W135863	100.00	W135986	100.30	W136000	100.00

INFORMATION NEEDED

VALUE OBTAINED

1 Sample Size (N)	50
2 Sum of Measurements: (Sum X)	5003.70
3 Sum of Squared Measurements	500743.17
4 Correction Factor (CF): Sum of Measurements Squared / N	500740.27
5 Corrected Sum of Squares (SS)	2.90
6 Variance (V) : SS/(N-1)	0.0591
7 Estimate of Lot Standard Deviation(S): SQRT of V	0.2431
8 Sample Mean(XBAR): Sum X/N	100.07
9 Upper Specification Limit (U)	102.00
10 Lower Specification Limit (L)	98.00
11 Quality Index Upper (QU): (U-XBAR) / S	7.92
12 Quality Index Lower (QL): (XBAR-L) / S	8.53
13 Estimate of Lot Percent NCF Above U (PU)	0.00
14 Estimate of Lot Percent NCF Below L (PL)	0.00
15 Total Estimate Percent NCF. In Lot (P): PU+PL	0.00
16 Maximum Allowable Percent NCF(M)	5.21
17 Acceptability Criterion: Compare P with M	PASS
18 The Lot Meets the Acceptability Criterion if P <= M	
19 The Lot Fails the Acceptability Criterion if P > M	

Kentucky Utilities

2013 Sample Test Program ( 01/01/2013 ) to ( 12/31/2013 )

Device Category: F2S240V30AC200      Model Number: MSII      Division: 01      Sample Lot: 1170      Lot Descr: KU MSII - 1  
 In Service Population: 4,904      Sample Quantity: 75      Meters Tested: 75      Pass/ Fail: PASS

Test Results Per ANSI/ASQC Z1.9-1993

Double Specification Limit - Variability Unknown - Standard Deviation Method

One AQL Value for Both Upper and Lower Specification Limit Combined

AQL = 2.5% - Inspection Level II "E" # Normal Inspection

Page 55

Run Date: 12/31/2013

Run Time: 02:31:01 AM

Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy
C265700	100.30	C275531	100.00	C275536	100.00	C275584	100.00	C275653	99.80
C276007	100.30	C298655	100.30	C298724	100.30	C298819	100.10	C300432	100.20
C300464	100.10	C300555	100.10	C300687	100.30	C300718	100.30	C300749	100.10
C300770	100.20	C300827	100.10	C300850	100.00	C300908	100.00	C300934	99.80
C301201	100.30	C301282	99.70	C301305	100.10	C301306	99.90	C301347	100.10
C301482	100.20	C301575	99.80	C301612	100.00	C301674	100.00	C301687	100.00
C301796	99.70	C301847	100.10	C301857	98.80	C301970	100.30	C301974	100.00
C301990	100.10	C301996	100.20	C302114	100.30	C302280	100.30	C302350	100.20
C302450	100.20	C302603	100.10	C302621	99.90	C302655	100.30	I312767	100.10
M416272	99.50	M416303	99.90	M421025	99.60	M421075	100.20	M421123	100.20
M421125	99.80	M421207	100.20	M421237	99.50	M422173	100.10	M422256	99.90
M422269	100.00	M422325	100.00	M422373	100.30	M422394	100.20	M422518	99.90
M422570	99.80	M428443	99.70	M428535	100.10	M435654	100.20	M435966	100.20
M436006	99.90	M436015	100.00	M436165	100.20	M436334	99.90	M436371	100.20
M436404	100.30	M436419	99.90	M436454	100.00	M436458	100.00	M436569	100.10

INFORMATION NEEDED

VALUE OBTAINED

1 Sample Size (N)	75
2 Sum of Measurements: (Sum X)	7502.80
3 Sum of Squared Measurements	750564.52
4 Correction Factor (CF): Sum of Measurements Squared / N	750560.10
5 Corrected Sum of Squares (SS)	4.42
6 Variance (V) : SS/(N-1)	0.0597
7 Estimate of Lot Standard Deviation (S): SQRT of V	0.2443
8 Sample Mean (XBAR): Sum X/N	100.04
9 Upper Specification Limit (U)	102.00
10 Lower Specification Limit (L)	98.00
11 Quality Index Upper (QU): (U-XBAR) / S	8.03
12 Quality Index Lower (QL): (XBAR-L) / S	8.34
13 Estimate of Lot Percent NCF Above U (PU)	0.00
14 Estimate of Lot Percent NCF Below L (PL)	0.00
15 Total Estimate Percent NCF. In Lot (P): PU+PL	0.00
16 Maximum Allowable Percent NCF (M)	4.83
17 Acceptability Criterion: Compare P with M	PASS
18 The Lot Meets the Acceptability Criterion if P <= M	
19 The Lot Fails the Acceptability Criterion if P > M	



Kentucky Utilities

2013 Sample Test Program ( 01/01/2013 ) to ( 12/31/2013 )

Device Category: F2S240V30AC200      Model Number: MX      Division: 01      Sample Lot: 1171      Lot Descr: KU MX - 1  
 In Service Population: 10,000      Sample Quantity: 75      Meters Tested: 75      Pass/ Fail: PASS

Test Results Per ANSI/ASQC Z1.9-1993

Double Specification Limit - Variability Unknown - Standard Deviation Method  
 One AQL Value for Both Upper and Lower Specification Limit Combined  
 AQL = 2.5% - Inspection Level II "E" # Normal Inspection

Page 56  
 Run Date: 12/31/2013  
 Run Time: 02:31:01 AM

Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy
C320834	100.00	C320912	99.30	C321115	99.90	C321294	100.20	C321556	100.30
C321655	100.10	C321658	100.10	C321664	99.60	C321914	100.00	C321999	100.10
C322135	100.00	C322258	100.00	C322456	99.80	C322997	100.00	C323208	100.00
C323276	99.90	C323307	100.20	C323668	100.10	C323771	99.40	C323784	99.70
C323853	100.00	C324035	100.00	C324049	99.60	C324184	99.80	C324493	100.00
C324626	100.20	C324649	100.10	C324998	100.20	C325000	100.00	C325321	99.80
C325336	100.00	C325510	100.20	L288220	99.90	L288279	99.80	L288338	100.20
L288364	100.20	L288515	100.00	L288522	99.90	L288538	100.90	L288641	100.10
L288712	99.90	L289267	99.70	L289512	100.00	L289517	100.10	L289523	100.20
L289791	101.30	L290303	99.90	L290326	99.90	L290393	100.00	L290486	100.00
L290492	100.10	L290521	100.00	L290555	100.00	L290597	100.00	L290616	99.80
L290632	99.60	L290913	99.90	L291015	100.00	L291400	99.80	L292108	100.20
L292175	100.00	M440879	100.00	M440978	99.90	M441252	100.10	M441515	100.10
M441689	99.90	M441717	99.90	M441738	100.20	M442172	100.10	M442212	100.20
M442347	100.10	M442563	98.60	W142683	99.90	W142831	100.00	W143051	100.20

INFORMATION NEEDED

VALUE OBTAINED

1 Sample Size (N)	75
2 Sum of Measurements: (Sum X)	7499.20
3 Sum of Squared Measurements	749847.02
4 Correction Factor (CF): Sum of Measurements Squared / N	749840.01
5 Corrected Sum of Squares (SS)	7.01
6 Variance (V) : SS/(N-1)	0.0947
7 Estimate of Lot Standard Deviation(S): SQRT of V	0.3078
8 Sample Mean(XBAR) : Sum X/N	99.99
9 Upper Specification Limit (U)	102.00
10 Lower Specification Limit (L)	98.00
11 Quality Index Upper (QU): (U-XBAR) / S	6.53
12 Quality Index Lower (QL): (XBAR-L) / S	6.46
13 Estimate of Lot Percent NCF Above U (PU)	0.00
14 Estimate of Lot Percent NCF Below L (PL)	0.00
15 Total Estimate Percent NCF. In Lot (P): PU+PL	0.00
16 Maximum Allowable Percent NCF(M)	4.83
17 Acceptability Criterion: Compare P with M	PASS
18 The Lot Meets the Acceptability Criterion if P <= M	
19 The Lot Fails the Acceptability Criterion if P > M	

Kentucky Utilities

2013 Sample Test Program ( 01/01/2013 ) to ( 12/31/2013 )

Device Category: F2S240V30AC200      Model Number: MX      Division: 01      Sample Lot: 1172      Lot Descr: KU MX - 2  
 In Service Population: 10,000      Sample Quantity: 75      Meters Tested: 75      Pass/ Fail: PASS

Test Results Per ANSI/ASQC Z1.9-1993

Double Specification Limit - Variability Unknown - Standard Deviation Method

One AQL Value for Both Upper and Lower Specification Limit Combined

AQL = 2.5% - Inspection Level II "E" # Normal Inspection

Page 57

Run Date: 12/31/2013

Run Time: 02:31:01 AM

Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy
C390964	99.80	C390969	99.90	C391031	99.80	C391058	99.80	C391205	100.10
C425940	99.50	C426004	100.00	C426109	99.80	C426129	100.00	C426144	100.00
C426222	99.60	C426289	99.40	C426505	99.40	C426612	99.70	C426814	99.50
C427192	99.80	C427211	99.50	C427475	99.80	C427548	99.70	C427904	99.90
C427932	99.90	C428113	99.80	C428177	99.60	C428201	99.60	C428287	99.10
C428290	99.90	C428577	99.90	C428648	100.00	C428747	99.90	C428850	99.90
C429303	99.80	C429384	99.80	C429596	99.90	C429627	99.70	C429693	100.00
C429726	99.70	C429795	99.50	C429843	99.60	C429986	100.00	C430417	99.40
C430611	99.50	C430809	99.80	C430891	99.40	C430896	99.40	C430917	99.70
C430982	99.60	C430995	99.90	C431153	99.30	C431246	99.70	C431247	100.00
C431267	99.40	C431276	99.70	C431321	99.00	C431399	99.80	C431414	99.90
C431837	99.40	C435580	99.70	C435670	99.60	C435796	99.40	C436304	100.00
C436355	99.90	C436556	99.40	C436823	99.60	C437118	99.60	C437299	99.80
C437393	99.80	C437443	99.90	C437549	99.80	W143151	99.80	W143306	99.80
W143347	99.60	W143488	100.40	W143815	100.20	W144101	100.20	W144126	100.30

INFORMATION NEEDED

VALUE OBTAINED

1 Sample Size (N)	75
2 Sum of Measurements: (Sum X)	7480.30
3 Sum of Squared Measurements	746070.05
4 Correction Factor (CF): Sum of Measurements Squared / N	746065.17
5 Corrected Sum of Squares (SS)	4.88
6 Variance (V) : SS/(N-1)	0.0659
7 Estimate of Lot Standard Deviation(S): SQRT of V	0.2567
8 Sample Mean(XBAR): Sum X/N	99.74
9 Upper Specification Limit (U)	102.00
10 Lower Specification Limit (L)	98.00
11 Quality Index Upper (QU): (U-XBAR) / S	8.82
12 Quality Index Lower (QL): (XBAR-L) / S	6.77
13 Estimate of Lot Percent NCF Above U (PU)	0.00
14 Estimate of Lot Percent NCF Below L (PL)	0.00
15 Total Estimate Percent NCF. In Lot (P): PU+PL	0.00
16 Maximum Allowable Percent NCF(M)	4.83
17 Acceptability Criterion: Compare P with M	PASS
18 The Lot Meets the Acceptability Criterion if P <= M	
19 The Lot Fails the Acceptability Criterion if P > M	

Kentucky Utilities

2013 Sample Test Program ( 01/01/2013 ) to ( 12/31/2013 )

Device Category: F2S240V30AC200 Model Number: MX Division: 01 Sample Lot: 1173 Lot Descr: KU MX - 3  
 In Service Population: 10,000 Sample Quantity: 75 Meters Tested: 75 Pass/ Fail: PASS

Test Results Per ANSI/ASQC Z1.9-1993

Double Specification Limit - Variability Unknown - Standard Deviation Method  
 One AQL Value for Both Upper and Lower Specification Limit Combined  
 AQL = 2.5% - Inspection Level II "E" # Normal Inspection

Page 58

Run Date: 12/31/2013

Run Time: 02:31:01 AM

Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy
C437825	99.80	C437866	99.50	C438120	99.70	C438420	100.00	C438786	99.80
C438842	100.00	C438944	99.70	C439383	100.00	C439441	100.00	C439477	100.00
C439892	99.90	C439949	99.70	C440133	99.90	C440177	100.00	C440256	99.80
C440374	99.90	C440521	99.80	C440561	99.30	C440770	99.80	C440797	100.00
C440802	100.00	C440946	100.10	C441151	99.60	C441320	99.80	C441639	99.70
C441727	99.70	C441807	99.40	C442024	99.70	C442257	99.70	C442620	99.50
C442674	99.70	C442810	99.60	C443362	99.90	C443383	99.70	C443431	99.90
C443450	99.90	C443494	99.50	C443535	98.80	C443635	99.50	C443716	99.90
C443757	99.70	C443793	99.80	C444068	99.90	C444149	100.20	C444307	99.60
C444513	99.70	C444639	99.50	C444728	100.00	C444928	99.80	C446547	99.30
C446597	99.60	C446734	99.60	C446865	99.60	C447088	99.80	C447168	99.80
C447429	99.50	C447541	99.70	C447641	99.60	C447833	99.30	C447851	99.80
C448076	99.80	C448111	99.30	C448144	99.10	C448199	99.60	C448383	99.70
C448427	99.90	C448465	99.70	C448669	99.70	C448796	99.90	C448981	99.80
C449067	99.50	C449094	99.90	C449317	99.90	C449329	99.90	C449330	99.60

INFORMATION NEEDED

VALUE OBTAINED

1 Sample Size (N)	75
2 Sum of Measurements: (Sum X)	7479.30
3 Sum of Squared Measurements	745869.81
4 Correction Factor (CF): Sum of Measurements Squared / N	745865.71
5 Corrected Sum of Squares (SS)	4.10
6 Variance (V) : SS/(N-1)	0.0554
7 Estimate of Lot Standard Deviation(S): SQRT of V	0.2353
8 Sample Mean(XBAR) : Sum X/N	99.72
9 Upper Specification Limit (U)	102.00
10 Lower Specification Limit (L)	98.00
11 Quality Index Upper (QU): (U-XBAR) / S	9.67
12 Quality Index Lower (QL): (XBAR-L) / S	7.33
13 Estimate of Lot Percent NCF Above U (PU)	0.00
14 Estimate of Lot Percent NCF Below L (PL)	0.00
15 Total Estimate Percent NCF. In Lot (P): PU+PL	0.00
16 Maximum Allowable Percent NCF (M)	4.83
17 Acceptability Criterion: Compare P with M	PASS
18 The Lot Meets the Acceptability Criterion if P <= M	
19 The Lot Fails the Acceptability Criterion if P > M	

Kentucky Utilities

2013 Sample Test Program ( 01/01/2013 ) to ( 12/31/2013 )

Device Category: F2S240V30AC200 Model Number: MX Division: 01 Sample Lot: 1174 Lot Descr: KU MX - 4  
 In Service Population: 10,000 Sample Quantity: 75 Meters Tested: 75 Pass/ Fail: PASS

Test Results Per ANSI/ASQC Z1.9-1993

Double Specification Limit - Variability Unknown - Standard Deviation Method

One AQL Value for Both Upper and Lower Specification Limit Combined

AQL = 2.5% - Inspection Level II "E" # Normal Inspection

Page 59

Run Date: 12/31/2013

Run Time: 02:31:01 AM

Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy
C449527	99.80	C449614	99.90	C449662	99.90	C449784	100.00	C449827	99.90
C450005	99.80	C450192	100.00	C450210	99.60	C451082	99.80	C451131	99.80
C451308	99.90	C451356	99.90	C451368	99.70	C451552	99.60	C451713	100.00
C452154	99.70	C452301	98.60	C452329	99.70	C452437	99.40	C452467	99.50
C452613	99.80	C452672	98.90	C453180	99.70	C453251	99.40	C453308	99.80
C453312	99.90	C453366	99.80	C453373	99.90	C453387	99.70	C453405	99.70
C453439	99.70	C453442	99.30	C453776	99.50	C453801	99.70	C453953	99.70
C453989	99.70	C454001	99.90	C454002	99.70	C454258	100.00	C454483	99.70
C454504	100.10	C454620	99.90	C454688	99.80	C454781	100.00	C454875	99.70
C454985	99.70	C455079	99.70	C455229	99.90	C455336	99.90	C455465	100.00
C455686	99.80	C457718	99.90	C457760	100.10	C458027	100.00	C458127	99.90
C458132	99.50	C458455	100.00	C458701	99.80	C459462	99.60	C459692	99.80
C459761	100.00	C459774	99.80	C459785	99.80	C459811	99.90	C460046	99.90
C460074	100.00	C460097	99.80	C460365	99.80	C460540	99.70	C460544	99.80
C460593	100.10	C460604	99.80	C460718	99.80	C460974	99.90	C461510	99.70

INFORMATION NEEDED

VALUE OBTAINED

1 Sample Size (N)	75
2 Sum of Measurements: (Sum X)	7482.90
3 Sum of Squared Measurements	746588.05
4 Correction Factor (CF): Sum of Measurements Squared / N	746583.90
5 Corrected Sum of Squares (SS)	4.15
6 Variance (V) : SS/(N-1)	0.0561
7 Estimate of Lot Standard Deviation(S): SQRT of V	0.2368
8 Sample Mean (XBAR): Sum X/N	99.77
9 Upper Specification Limit (U)	102.00
10 Lower Specification Limit (L)	98.00
11 Quality Index Upper (QU): (U-XBAR) / S	9.41
12 Quality Index Lower (QL): (XBAR-L) / S	7.48
13 Estimate of Lot Percent NCF Above U (PU)	0.00
14 Estimate of Lot Percent NCF Below L (PL)	0.00
15 Total Estimate Percent NCF. In Lot (P): PU+PL	0.00
16 Maximum Allowable Percent NCF (M)	4.83
17 Acceptability Criterion: Compare P with M	PASS
18 The Lot Meets the Acceptability Criterion if P <= M	
19 The Lot Fails the Acceptability Criterion if P > M	



Kentucky Utilities

2013 Sample Test Program ( 01/01/2013 ) to ( 12/31/2013 )

Device Category: F2S240V30AC200 Model Number: MX Division: 01 Sample Lot: 1175 Lot Descr: KU MX - 5  
 In Service Population: 1,605 Sample Quantity: 50 Meters Tested: 50 Pass/ Fail: PASS

Test Results Per ANSI/ASQC Z1.9-1993

Double Specification Limit - Variability Unknown - Standard Deviation Method  
 One AQL Value for Both Upper and Lower Specification Limit Combined  
 AQL = 2.5% - Inspection Level II "E" # Normal Inspection

Page 60  
 Run Date: 12/31/2013  
 Run Time: 02:31:01 AM

Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy
C461876	99.80	C461880	99.80	C461888	99.90	C461944	100.00	C461976	99.80
C461992	99.90	C462004	99.90	C462022	99.90	C462028	100.00	C462040	99.80
C462081	100.10	C462192	99.90	C462269	99.90	C462278	100.00	C462317	99.80
C462335	99.80	C462345	100.10	C462416	99.80	C462446	99.90	C462495	99.80
C462504	100.10	C462522	99.80	C462523	99.80	C462545	99.20	C462569	100.10
C462601	99.80	C462651	99.70	C462690	99.00	C462729	99.80	C462748	100.10
C462792	99.90	C462842	100.00	C462862	99.90	C462954	99.80	C462971	99.90
C462974	99.80	C462984	99.90	C463005	99.80	C463009	100.00	C463011	100.10
C463153	99.90	C463177	99.30	C463183	99.40	C463209	99.20	C463221	99.90
C463235	99.40	C463253	100.90	C463294	99.60	C463361	100.00	C463399	99.70

INFORMATION NEEDED

VALUE OBTAINED

1 Sample Size (N)	50
2 Sum of Measurements: (Sum X)	4991.70
3 Sum of Squared Measurements	498345.43
4 Correction Factor (CF): Sum of Measurements Squared / N	498341.38
5 Corrected Sum of Squares (SS)	4.05
6 Variance (V) : SS/(N-1)	0.0827
7 Estimate of Lot Standard Deviation(S): SQRT of V	0.2876
8 Sample Mean (XBAR): Sum X/N	99.83
9 Upper Specification Limit (U)	102.00
10 Lower Specification Limit (L)	98.00
11 Quality Index Upper (QU): (U-XBAR) / S	7.53
12 Quality Index Lower (QL): (XBAR-L) / S	6.38
13 Estimate of Lot Percent NCF Above U (FU)	0.00
14 Estimate of Lot Percent NCF Below L (FL)	0.00
15 Total Estimate Percent NCF. In Lot (P): FU+FL	0.00
16 Maximum Allowable Percent NCF (M)	5.21
17 Acceptability Criterion: Compare P with M	PASS
18 The Lot Meets the Acceptability Criterion if P <= M	
19 The Lot Fails the Acceptability Criterion if P > M	

Kentucky Utilities  
2013 Sample Test Program ( 01/01/2013 ) to ( 12/31/2013 )

LOT NAME	MANUFACTURER	MODEL	IN-SERV POP	SAMP QTY	SET	REMV	MTRS TST	PASS/FAIL	LOT NUMBER
KU AB1	Asea Brown Boveri (ABB)	AB1	10,000	75	0	0	75	PASS TESTING COMPLETE	1116
KU AB1-2	Asea Brown Boveri (ABB)	AB1	5,841	75	0	0	75	PASS TESTING COMPLETE	1117
KU ALF - 1	Landis + Gyr	ALF	14	3	0	0	3	PASS TESTING COMPLETE	1118
KU C1S - 1	Itron	C1SR	10,000	75	0	0	75	PASS TESTING COMPLETE	1119
KU C1S - 2	Itron	C1S	10,000	75	0	0	75	PASS TESTING COMPLETE	1120
KU C1S - 3	Itron	C1S	10,000	75	0	0	75	PASS TESTING COMPLETE	1121
KU C1S - 4	Itron	C1S	7,001	75	0	0	75	PASS TESTING COMPLETE	1122
KU D4S - 1	Westinghouse	D4S	10,000	75	0	0	75	PASS TESTING COMPLETE	1123
KU D4S-2	Westinghouse	D4S	10,000	75	0	0	75	PASS TESTING COMPLETE	1124
KU D4S - 3	Westinghouse	D4S	7,221	75	0	0	75	PASS TESTING COMPLETE	1125
KU D5S - 1	Westinghouse	D5S	472	25	0	0	25	PASS TESTING COMPLETE	1126
KU I210 - 1	General Electric	I210	5,238	75	0	0	75	PASS TESTING COMPLETE	1127
KU I50 - 1	General Electric	I50s	1,162	35	0	0	35	PASS TESTING COMPLETE	1128
KU I55 - 1	General Electric	I55S	1,019	35	0	0	35	PASS TESTING COMPLETE	1129
KU I60 - 1	General Electric	I60S	10,000	75	0	0	75	PASS TESTING COMPLETE	1130
KU I60 - 2	General Electric	I60S	10,000	75	0	0	75	PASS TESTING COMPLETE	1131
KU I60 - 3	General Electric	I60S	10,000	75	0	0	75	PASS TESTING COMPLETE	1132
KU I60 - 4	General Electric	I60S	738	35	0	0	35	PASS TESTING COMPLETE	1133
KU I70 - 1	General Electric	I70S	10,000	75	0	0	75	PASS TESTING COMPLETE	1134
KU I70 - 2	General Electric	I70S	10,000	75	0	0	75	PASS TESTING COMPLETE	1135
KU I70 - 3	General Electric	I70S	10,000	75	0	0	75	PASS TESTING COMPLETE	1136
KU I70 - 4	General Electric	I70S	10,000	75	0	0	75	PASS TESTING COMPLETE	1137
KU I70 - 5	General Electric	I70S	10,000	75	0	0	75	PASS TESTING COMPLETE	1138
KU I70 - 6	General Electric	I70S	10,000	75	0	0	75	PASS TESTING COMPLETE	1139
KU I70 - 7	General Electric	I70S	10,000	75	0	0	75	PASS TESTING COMPLETE	1140
KU I70 - 8	General Electric	I70S	10,000	75	0	0	75	PASS TESTING COMPLETE	1141
KU I70 - 9	General Electric	I70S	10,000	75	0	0	75	PASS TESTING COMPLETE	1142
KU I70 - 10	General Electric	I70S	10,000	75	0	0	75	PASS TESTING COMPLETE	1143
KU I70 - 11	General Electric	I70S	10,000	75	0	0	75	PASS TESTING COMPLETE	1144
KU I70 - 12	General Electric	I70S	7,731	75	0	0	75	PASS TESTING COMPLETE	1145
KU J4S - 1	Sangamo	J4S	10,000	75	0	0	75	PASS TESTING COMPLETE	1146
KU J4S - 2	Sangamo	J4S	2,702	50	0	0	50	PASS TESTING COMPLETE	1147
KU J5S - 1	Sangamo	J5S	10,000	75	0	0	75	PASS TESTING COMPLETE	1148
KU J5S - 2	Sangamo	J5S	10,000	75	0	0	75	PASS TESTING COMPLETE	1149
KU J5S - 3	Sangamo	J5S	10,000	75	0	0	75	PASS TESTING COMPLETE	1150
KU J5S - 4	Sangamo	J5S	10,000	75	0	0	75	PASS TESTING COMPLETE	1151
KU J5S - 5	Sangamo	J5S	10,000	75	0	0	75	PASS TESTING COMPLETE	1152
KU J5S - 6	Sangamo	J5S	10,000	75	0	0	75	PASS TESTING COMPLETE	1153
KU J5S - 7	Sangamo	J5S	10,000	75	0	0	75	PASS TESTING COMPLETE	1154
KU J5S - 8	Sangamo	J5S	10,000	75	0	0	75	PASS TESTING COMPLETE	1155
KU J5S - 9	Sangamo	J5S	10,000	75	0	0	75	PASS TESTING COMPLETE	1156
KU J5S - 10	Sangamo	J5S	10,000	75	0	0	75	PASS TESTING COMPLETE	1157
KU J5S - 11	Sangamo	J5S	10,000	75	0	0	75	PASS TESTING COMPLETE	1158
KU J5S - 12	Sangamo	J5S	10,000	75	0	0	75	PASS TESTING COMPLETE	1159
KU J5S - 13	Sangamo	J5S	10,000	75	0	0	75	PASS TESTING COMPLETE	1160
KU J5S - 14	Sangamo	J5S	10,000	75	0	0	75	PASS TESTING COMPLETE	1161
KU J5S - 15	Sangamo	J5S	8,169	75	0	0	75	PASS TESTING COMPLETE	1162
KU MKS - 1	Duncan	MKS	552	35	0	0	35	PASS TESTING COMPLETE	1163
KU MQS - 1	Duncan	MQS	3,997	75	0	0	75	PASS TESTING COMPLETE	1164
KU MS - 1	Duncan	MS	10,000	75	0	0	75	PASS TESTING COMPLETE	1165
KU MS - 2	Duncan	MS	10,000	75	0	0	75	PASS TESTING COMPLETE	1166
KU MS - 3	Duncan	MS	10,000	75	0	0	75	PASS TESTING COMPLETE	1167
KU MS - 4	Duncan	MS	10,000	75	0	0	75	PASS TESTING COMPLETE	1168
KU MS - 5	Landis + Gyr	MS	3,084	50	0	0	50	PASS TESTING COMPLETE	1169
KU MSII - 1	Landis + Gyr	MSII	4,904	75	0	0	75	PASS TESTING COMPLETE	1170
KU MX - 1	Landis + Gyr	MX	10,000	75	0	0	75	PASS TESTING COMPLETE	1171

KU MX - 2	Landis + Gyr	MX	10,000	75	0	0	75	PASS TESTING COMPLETE	1172
KU MX - 3	Landis + Gyr	MX	10,000	75	0	0	75	PASS TESTING COMPLETE	1173
KU MX - 4	Landis + Gyr	MX	10,000	75	0	0	75	PASS TESTING COMPLETE	1174
KU MX - 5	Landis + Gyr	MX	1,605	50	0	0	50	PASS TESTING COMPLETE	1175

---

TOTALS	491,450	4143	0	0	4143
--------	---------	------	---	---	------

TOTAL LOTS PASSED:	60
TOTAL LOTS FAILED:	0
METERS CANNOT TEST:	0

Report completed successfully with results.