



Page No. _____
 Date 10-22-12 Repaired 12-19-12
 Status (Circle Status) Pos. Neg.
 Leak Indication Classification (Circle Leak Indication)
 1 2 3
 TIME REPORTED _____
 1 LEAK ONLY

**LEAKAGE CONTROL REPORT
 FIELD SURVEY**

Company Martin Contracting District _____
 City Tompkinsville State Ky
 No Address Nearest Street Address
Sicott + Hallee 7th Street

TYPE OF GAS

Natural	<input checked="" type="checkbox"/>
Manuf.	<input type="checkbox"/>
L.P.	<input type="checkbox"/>
Other	<input type="checkbox"/>

LEAK INDICATION FIRST DETECTED (AT) (IN) (BY)

Atmosphere	<input checked="" type="checkbox"/>
Bar Hole Test	<input type="checkbox"/>
Man Hole	<input type="checkbox"/>
Pit (Reg. or Meter)	<input type="checkbox"/>
Valve Box	<input type="checkbox"/>
Main Valve	<input type="checkbox"/>
Curb Valve	<input type="checkbox"/>
Meter Box	<input type="checkbox"/>
Underground Fuel Tank	<input type="checkbox"/>
Selected Test	<input type="checkbox"/>

METHOD OF SURVEY

Vegetation	<input type="checkbox"/>
Portable F I	<input checked="" type="checkbox"/>
Mobile F I	<input type="checkbox"/>
Bar Hole	<input type="checkbox"/>
Other	<input type="checkbox"/>

PRESSURE

High	<input type="checkbox"/>
Intermediate	<input checked="" type="checkbox"/>
Low	<input type="checkbox"/>

LEAK INDICATION APPEARS TO BE AT:


Main	<input checked="" type="checkbox"/>
Service	<input type="checkbox"/>
Service Tap	<input type="checkbox"/>
Main At Tie In	<input type="checkbox"/>
Drip	<input type="checkbox"/>
Meter	<input type="checkbox"/>
Curb Valve	<input type="checkbox"/>
Main Valve	<input type="checkbox"/>
Other	<input type="checkbox"/>

PIPE DESIGNATION

Distribution	<input type="checkbox"/>
Transmission	<input type="checkbox"/>
Gathering	<input type="checkbox"/>
Other	<input type="checkbox"/>

CGI TEST

Positive	<input type="checkbox"/>
Negative	<input type="checkbox"/>

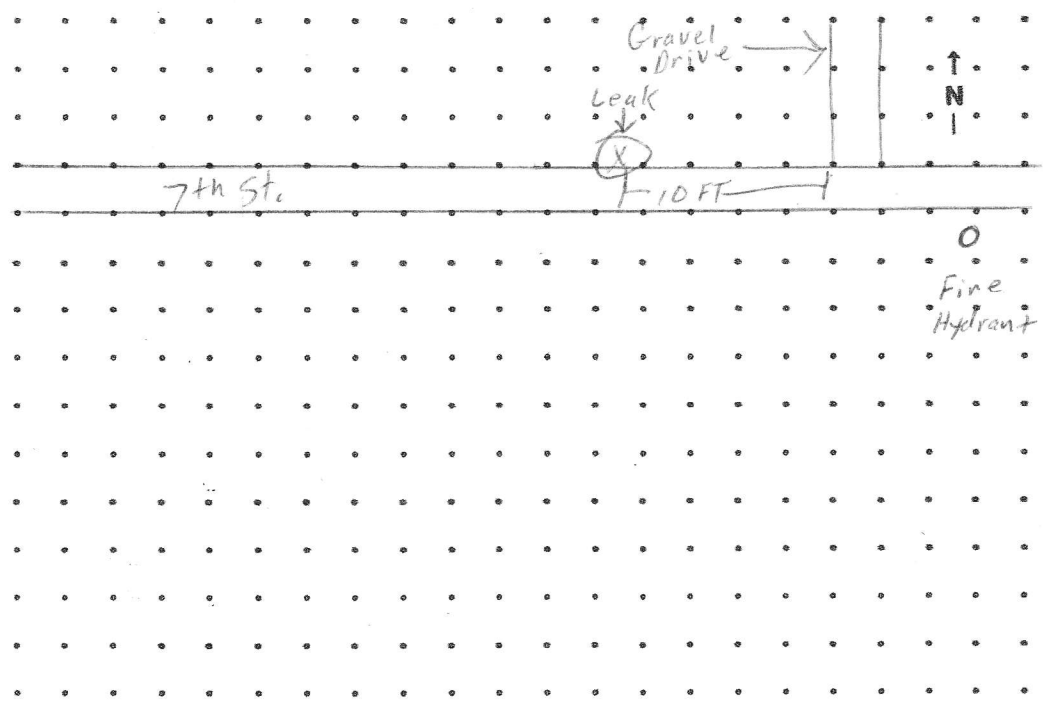

LEAK INDICATION (Vegetation Only)

Trees	<input type="checkbox"/>
Shrubs	<input type="checkbox"/>
Grass	<input type="checkbox"/>
Lawn	<input type="checkbox"/>
Weeds	<input type="checkbox"/>
Odor	<input type="checkbox"/>
Other	<input type="checkbox"/>

LOCATION OF PIPE

Street	<input type="checkbox"/>
Between St. & Sidewalk	<input type="checkbox"/>
Under Sidewalk	<input type="checkbox"/>
Lawn	<input type="checkbox"/>
Easement	<input type="checkbox"/>
R.O.W.	<input checked="" type="checkbox"/>
Other	<input type="checkbox"/>

Remarks When we dug this up we found a 1" steel main with a pin hole in it. We repaired it with a clamp. There is also a threaded coupling in the section that needs replaced. When our welder is back, we will repair the entire section with new pipe.

COVER

Concrete	<input type="checkbox"/>
Asphalt	<input type="checkbox"/>
Brick	<input type="checkbox"/>
Gravel	<input type="checkbox"/>
Soil	<input checked="" type="checkbox"/>
Other	<input type="checkbox"/>