

Center Messages

To drakesboro@comcast.net • drakesborogas@gmail.com

Kentucky 811

SUMM

DAILY AUDIT OF TICKETS SENT ON 01/18/23

Date/Time: 01/19/2023 01:15:32 AM

Receiving Terminal: 0032

Seq #	Ticket #	Seq #	Ticket #
-----	-----	-----	-----

* indicates ticket # is repeated

Total Tickets: 0

Please call (573) 636-1556 if this data does not match the tickets you received on 01/18/23

Center Messages

To drakesboro@comcast.net • drakesborogas@gmail.com

Kentucky 811

SUMM

DAILY AUDIT OF TICKETS SENT ON 01/19/23

Date/Time: 01/20/2023 01:15:35 AM

Receiving Terminal: 0032

Seq #	Ticket #	Seq #	Ticket #
1	230191187-NORM	2	230191361-NORM

* Indicates ticket # is repeated

Total Tickets: 2

NORM - NORMAL

| 2

Please call (573) 636-1556 if this data does not match the tickets you received on 01/19/23

1/21/2023 12:17 AM

ky@ccinc.com

Center Messages

To drakesboro@comcast.net • drakesborogas@gmail.com

Kentucky 811

SUMM

DAILY AUDIT OF TICKETS SENT ON 01/20/23

Date/Time: 01/21/2023 01:15:33 AM

Receiving Terminal: 0032

Seq #	Ticket #	Seq #	Ticket #
1	230200910-NORM	2	230200959-NORM

* Indicates ticket # is repeated

Total Tickets: 2

NORM - NORMAL | 2

Please call (573) 636-1556 if this data does not match the tickets you received on 01/20/23

1/22/2023 12:17 AM

ky@ocinc.com

Center Messages

To drakesboro@comcast.net • drakesborogas@gmail.com

Kentucky 811

SUMM

DAILY AUDIT OF TICKETS SENT ON 01/21/23

Date/Time: 01/22/2023 01:15:23 AM

Receiving Terminal: 0032

Seq #	Ticket #	Seq #	Ticket #
-----	-----	-----	-----

* indicates ticket # is repeated

Total tickets: 0

Please call (573) 636-1556 if this data does not match the tickets you received on 01/21/23

1/23/2023 12:17 AM

ky@ccinc.com

Center Messages

To drakesboro@comcast.net • drakesborogas@gmail.com

Kentucky 811

SUMM

DAILY AUDIT OF TICKETS SENT ON 01/22/23

Date/Time: 01/23/2023 01:15:23 AM

Receiving Terminal: 0032

Seq #	Ticket #	Seq #	Ticket #
-----	-----	-----	-----

* indicates ticket # is repeated

Total Tickets: 0

Please call (573) 636-1556 if this data does not match the tickets you received on 01/22/23

ky@ocinc.com

1/24/2023 12:17 AM

Center Messages

To drakesboro@comcast.net • drakesborogas@gmail.com

Kentucky 811

SUMM

DAILY AUDIT OF TICKETS SENT ON 01/23/23

Date/Time: 01/24/2023 01:15:34 AM

Receiving Terminal: 0032

Seq #	Ticket #
1	230230761-EMER

* Indicates ticket # is repeated

Total Tickets: 1

EMER - EMERGENCY | 1

Please call (573) 636-1556 if this data does not match the tickets you received on 01/23/23

ky@ocinc.com

1/26/2023 12:18 AM

Center Messages

To drakesboro@comcast.net • drakesborogas@gmail.com

Kentucky 811

SUMM

DAILY AUDIT OF TICKETS SENT ON 01/25/23

Date/Time: 01/26/2023 01:15:31 AM

Receiving Terminal: 0032

Seq #	Ticket #	Seq #	Ticket #
-----	-----	-----	-----

* indicates ticket # is repeated

Total Tickets: 0

Please call (573) 636-1556 if this data does not match the tickets you received on 01/25/23

ky@ocinc.com

1/27/2023 12:17 AM

Center Messages

To drakesboro@comcast.net • drakesborogas@gmail.com

Kentucky 811

SUMM

DAILY AUDIT OF TICKETS SENT ON 01/26/23

Date/Time: 01/27/2023 01:15:32 AM

Receiving Terminal: 0032

Seq #	Ticket #
-----	-----
Seq #	Ticket #

* indicates ticket # is repeated

Total Tickets: 0

Please call (573) 636-1556 if this data does not match the tickets you received on 01/26/23

ky@ocinc.com

Center Messages

To drakesboro@comcast.net • drakesborogas@gmail.com

1/28/2023 12:17 AM

Kentucky 811

SUMM

DAILY AUDIT OF TICKETS SENT ON 01/27/23

Date/Time: 01/28/2023 01:15:31 AM

Receiving Terminal: 0032

Seq #	Ticket #
-----	-----

* indicates ticket # is repeated

Total Tickets: 0

Please call (573) 636-1556 if this data does not match the tickets you received on 01/27/23



Brian Jones <drakesborogas@gmail.com>

Center Messages

1 message

Fri, Jan 27, 2023 at 12:17 AM

ky@ocinc.com <ky@ocinc.com>
To: drakesboro@comcast.net, drakesborogas@gmail.com

Kentucky 811

SUMM

DAILY AUDIT OF TICKETS SENT ON 01/26/23

Date/Time: 01/27/2023 01:15:32 AM

Receiving Terminal: 0032

Seq #	Ticket #	Seq #	Ticket #
-----	-----	-----	-----

* Indicates ticket # is repeated

Total Tickets: 0

Please call (573) 636-1556 if this data does not match the tickets you received on 01/26/23



Brian Jones <drakesborogas@gmail.com>

Center Messages

1 message

Sat, Jan 28, 2023 at 12:17 AM

ky@ocinc.com <ky@ocinc.com>
To: drakesboro@comcast.net, drakesborogas@gmail.com

Kentucky 811

SUMM

DAILY AUDIT OF TICKETS SENT ON 01/27/23

Date/Time: 01/28/2023 01:15:31 AM

Receiving Terminal: 0032

Seq #	Ticket #	Seq #	Ticket #
-----	-----	-----	-----

* Indicates ticket # is repeated

Total Tickets: 0

Please call (573) 636-1556 if this data does not match the tickets you received on 01/27/23



Brian Jones <drakesborogas@gmail.com>

Center Messages

1 message

Sun, Jan 29, 2023 at 12:17 AM

ky@ocinc.com <ky@ocinc.com>
To: drakesboro@comcast.net, drakesborogas@gmail.com

Kentucky 811

SUMM

DAILY AUDIT OF TICKETS SENT ON 01/28/23

Date/Time: 01/29/2023 01:15:23 AM

Receiving Terminal: 0032

Seq #	Ticket #	Seq #	Ticket #
-----	-----	-----	-----

* Indicates ticket # is repeated

Total Tickets: 0

Please call (573) 636-1556 if this data does not match the tickets you received on 01/28/23



Brian Jones <drakesborogas@gmail.com>

Center Messages

1 message

ky@ocinc.com <ky@ocinc.com>
To: drakesboro@comcast.net, drakesborogas@gmail.com

Mon, Jan 30, 2023 at 12:17 AM

Kentucky 811

SUMM

DAILY AUDIT OF TICKETS SENT ON 01/29/23

Date/Time: 01/30/2023 01:15:23 AM

Receiving Terminal: 0032

Seq #	Ticket #	Seq #	Ticket #
-----	-----	-----	-----

* Indicates ticket # is repeated

Total Tickets: 0

Please call (573) 636-1556 if this data does not match the tickets you received on 01/29/23

ky@ocinc.com

1/31/2023 12:17 AM

Center Messages

To drakesboro@comcast.net • drakesborogas@gmail.com

Kentucky 811

SUMM

DAILY AUDIT OF TICKETS SENT ON 01/30/23

Date/Time: 01/31/2023 01:15:30 AM


Receiving Terminal: 0032

Seq #	Ticket #	Seq #	Ticket #
-----	-----	-----	-----

* indicates ticket # is repeated

Total tickets: 0

Please call (573) 636-1556 if this data does not match the tickets you received on 01/30/23

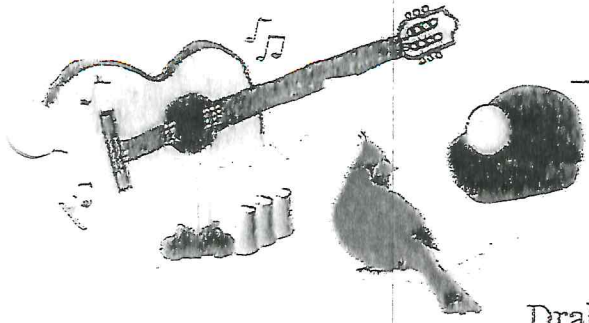

CITY OF DRAKESBORO

P.O. Box 129 • Mose Rager Blvd. • Drakesboro, KY 42337
270-476-8986
(888) 662-2406 (Voice/TTY); (866) 557-5762 (Español)

Drakesboro Work Order

Work Order #: _____

Date: 11/22

Time: _____



Water WW Acct #: 40-63020-1

Name: Awilda Delapaz

Mobile Number: 270-602-9187

Address: 409 Washington St

Work to be Done:

New Meter# 151124

New Reading _____

Turn on & Read _____

Old Reading 6926 10/27

Read and Lock 6958

Set Meter and Lock _____

Reading Only _____

Locate Line _____

(See Below)

Read and Lock (Nonpayment) _____
Number _____

Get Meter _____

Check Pressure _____

Flush Line _____

Check & Leak _____

Unlock Only and Read (Do Not Turn On) _____

Special Instructions house burnt down

Needs forwarding address

Rebuilding & wants to
Keep acct open

Hold on to
Dep. Cust is
rebuilding

Work Done:

Flushed: Yes No GPM: _____ How Long: _____ Water Logs: _____

Water Leak: Yes No GPM: _____ How Long: _____ Water Logs: _____

Parts Used to Complete Job:

Comments: Meter locked

Work Completed By: B. Jones

Date Completed: 11-22-22


Time Started: _____

Time Ended: _____

Customer signature _____ date _____

Equal Opportunity Employer and Service Provider

The employees of Drakesboro are not trained HVAC personnel. Lighting of pilots are a courtesy and the City can not be held liable.

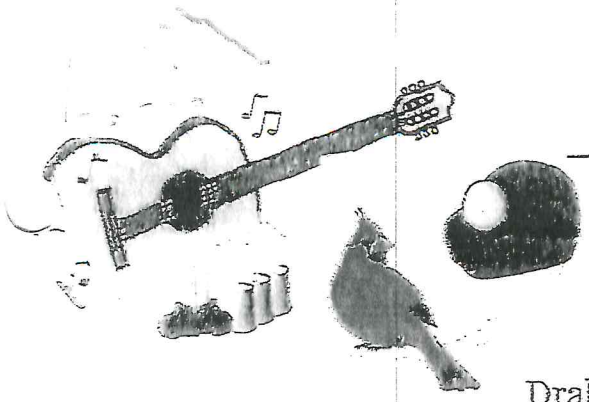

CITY OF DRAKESBORO

P.O. Box 129 • Mose Rager Blvd. • Drakesboro, KY 42337

270-476-8986

COMPLETED

(888) 662-2406 (Voice/TTY); (866) 557-5762 (Español)

By: AP Date: 11/13/22

Drakesboro Work Order

Work Order #: _____

Date: 11/30/22

Time: _____

Gas

Water WW

Acct #: 30-38300-01

Name: William Farber

Mobile Number: _____

Address: 6236 State Rt 176 Drakesboro Ky 42337

Work to be Done:

New Meter# 20P272983

New Reading _____

Turn on & Read _____

Old Reading _____

Read and Lock _____

Set Meter and Lock _____

Reading Only 1147

Locate Line _____

(See Below)

Read and Lock (Nonpayment) _____

Get Meter _____

Number _____

Check Pressure _____

Flush Line _____

Mark Farber (son)

Check & Leak _____

Unlock Only and Read (Do Not Turn On) _____

270-875-8766

Special Instructions Sold house

121 Edgewood Dr.

Providence Ky 42450

*FB bill should be
28.20 per
1/17 Paid in full
of final bill*

*mail
Deposit
to
Mark*

Work Done:

Flushed: Yes No

GPM: _____

How Long: _____

Water Logs: _____

Water Leak: Yes No

GPM: _____

How Long: _____

Water Logs: _____

*12/19-
mailed refund
to Mark AP*

Parts Used to Complete Job:

~~99.00 + 2.00 to William~~
* ~~\$100.00~~ gas Deposit Refund
made payable to City of Drakesboro

Comments:

* Still have final bill
* Fold gas card up AP
* Put in final billing today AP
Date Completed: 11-30-22

Work Completed By: BA & BJ

Time Started: _____

Time Ended: _____

Customer signature _____


** Email sent to
Karen for refund
to 97.20000*

Equal Opportunity Employer and Service Provider

The employees of Drakesboro are not trained HVAC personnel. Lighting of pilots are a courtesy and the City can not be held liable.

CITY OF DRAKESBORO

P.O. Box 129 • Mose Rager Blvd. • Drakesboro, KY 42337
270-476-8986
(888) 662-2406 (Voice/TTY); (866) 557-5762 (Español)

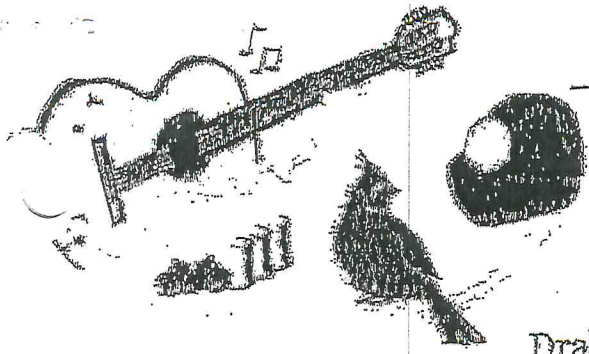

Drakesboro Work Order

Work Order #: _____

Date: 12/19/22 Time: _____ Gas Water WW Acct #: 20-18730-1

Name: Kim Meadows Mobile Number: ~~(500) 900-0000~~

Address: 68 Joe Davis Loop (270) 820-~~0000~~
7844

Work to be Done:

New Meter# 19M366175 New Reading _____
Turn on & Read _____ Old Reading 1061
Read and Lock _____ Set Meter and Lock _____
Reading Only 1061 Locate Line (See Below) _____
Read and Lock (Nonpayment) _____ Get Meter _____
Number _____
Check Pressure _____ Flush Line _____ Check & Leak _____
Unlock Only and Read (Do Not Turn On) _____
Special Instructions \$100.00 Deposit too

Work Done:

Flushed: Yes No GPM: _____ How Long: _____ Water Logs: _____
Water Leak: Yes No GPM: _____ How Long: _____ Water Logs: _____

Parts Used to Complete Job: _____

Comments: 13,486.74 cks
1595.93

pressure test failed, not contacted back


Work Completed By: BA & BS Date Completed: 12-19-22

Time Started: _____ Time Ended: _____

Customer signature _____ date _____

Equal Opportunity Employer and Service Provider

The employees of Drakesboro are not trained HVAC personnel. Lighting of pits is a courtesy and the City can not be held liable.

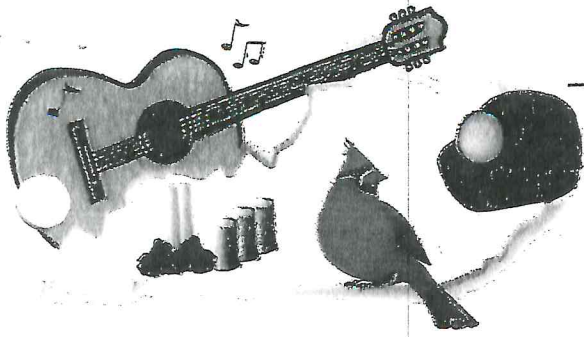

CITY OF DRAKESBORO

P.O. Box 129 • Mose Rager Blvd. • Drakesboro, KY 42337
270-476-8986
(888)662-2406 (Voice/TTY): (866)577-5762 (Español)

Date _____

Time _____

Pressure Test for Gas Line

Plumber Information:

License # _____

Phone # _____

Name: _____

Address: _____

Meter read at time of Pressure Test _____

Customer: _____


Pressure Tested for _____ minutes.

Address: _____

At _____ lbs of Pressure.

Signature of Licensed Plumber

Signature of City of Drakesboro gas Employee and Russmar Representative

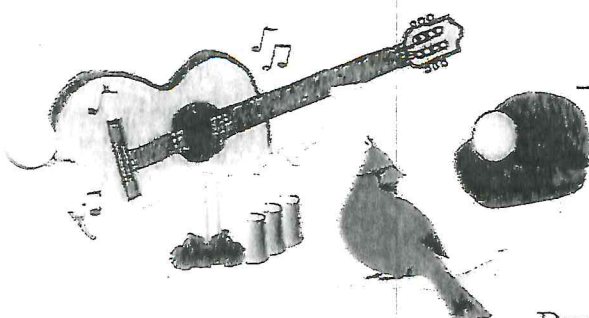

12:30-1:00

CITY OF DRAKESBORO

P.O. Box 129 • Mose Rager Blvd. • Drakesboro, KY 42337
270-476-8986
(888) 662-2406 (Voice/TTY); (866) 557-5762 (Español)

Drakesboro Work Order

Work Order #: _____

Date: 12/28/22 Time: _____ Gas Water WW Acct #: 10-09380-004
Name: Ashley Lark Mobile Number: 270-225-8131
Address: 2272 US 431

Work to be Done:

COMPLETED
By: AP Date: 1/5/23

**if passes*

New Meter# 485970 New Reading _____
Turn on & Read _____ Old Reading 4306 (11/20/20)
Read and Lock _____ Set Meter and Lock _____
Reading Only 4564 Locate Line (See Below) _____
Read and Lock (Nonpayment) _____ Get Meter _____
Number _____

*Card made
Acct made
active due
to usage.
before passing
pressure test
as stated
by Ashley.*

Check Pressure _____ Flush Line _____ Check & Leak _____
Unlock Only and Read (Do Not Turn On) _____

Special Instructions Purchased - ^{Just} pressure test & turn on if passes.

Deposit made

** Moved in on 12/31 - & used before Brian done another pressure test to show no leaks. There was a leak when tested ~~12/28/22~~ 12/28/22*

Work Done:
Flushed: Yes No GPM: _____ How Long: _____ Water Logs: _____
Water Leak: Yes No GPM: _____ How Long: _____ Water Logs: _____

Parts Used to Complete Job: _____

Comments: Pressure test & meter leak test performed stove, hot water heater, furnace no leaks turned gas on and lit appliances


Work Completed By: BA + BJ Date Completed: 01-04-2023

Time Started: _____ Time Ended: _____

Customer signature _____ date _____

Equal Opportunity Employer and Service Provider

The employees of Drakesboro are not trained HVAC personnel. Lighting of pilots are a courtesy and the City can not be held liable.

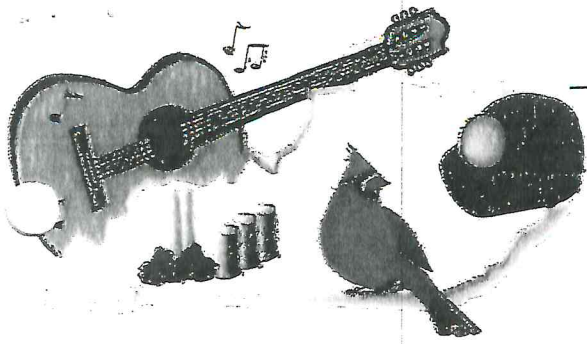

CITY OF DRAKESBORO

P.O. Box 129 • Mose Rager Blvd. • Drakesboro, KY 42337
270-476-8986
(888)662-2406 (Voice/TTY); (866)577-5762 (Español)

Date 01-04-2023

Time 12:40

Pressure Test for Gas Line

Plumber Information:

License # _____

Phone # _____

Name: _____

Address: _____

Meter read at time of Pressure Test 4564

Customer: Ashley Lark


Pressure Tested for 10 minutes.

Address: 2772 US 431 South

At 20 lbs of Pressure.

Signature of Licensed Plumber

Signature of City of Drakesboro gas Employee and Russmar Representative

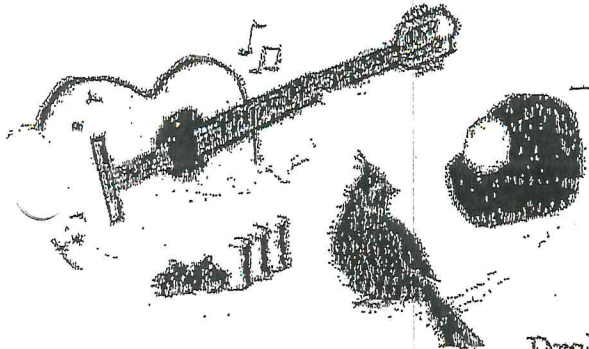

CITY OF DRAKESBORO

P.O. Box 129 • Mose Rager Blvd. • Drakesboro, KY 42337
270-476-8986
(888) 662-2406 (Voice/TTY); (866) 557-5762 (Español)

Drakesboro Work Order

Work Order #: _____

Date: 12/28 Time: _____ Gas Water WW Acct #: 50-76090-1

Name: NADMI Chumley-Shemi Ray Mobile Number: (270) 602-9114

Address: 55 Hwy 10 E (270) 543-7356 → Niece

Work to be Done:

New Meter# 4186 228 New Reading _____

Turn on & Read _____ Old Reading 5435 4/1/22

Read and Lock 5788 Set Meter and Lock

Reading Only _____ Locate Line

Read and Lock (Nonpayment) _____ Get Meter

Number _____

Check Pressure _____ Flush Line _____ Check & Leak _____

Unlock Only and Read (Do Not Turn On) _____

Special Instructions Non-payment \$ 1,084.10 (Pics can't help)

Called 2 x unreachable # (until she gets a Current bill)
AP

COMPLETED
(See Below)
By: AP Date: 12/28/22

Work Done:

Flushed: Yes No GPM: _____ How Long: _____ Water Logs: _____

Water Leak: Yes No GPM: _____ How Long: _____ Water Logs: _____

Parts Used to Complete Job:

Comments: Knocked on door advised female of bill
balance or we would have to shut gas off
gas turned off and locked

Work Completed By: BA & BJ Date Completed: 12-28-22

Time Started: _____ Time Ended: _____

Customer signature _____ date _____

Equal Opportunity Employer and Service Provider

The employees of Drakesboro are not trained HVAC personnel. Lighting of pilots are a courtesy and the City can not be held liable.

0050-76090-00
55 Hwy 70 East

03/28/22 04/01/22

Needs to be within Lmp.

Past Due			1,128.10
GA	543500	541800	1700 0.00

0050-76090-001 12/16/22

1,128.10 0.00 1,128.10

IF NOT PAID BY 25th .SERVICE
WILL BE DISCONNECTED on 26TH
PAY ONLINE @ DRAKESBORO.ORG
OFFICE 270-476-8986

C/O SHERRY RAY
55 STATE ROUTE 70 EAST
DRAKESBORO KY

R02	1,128.10	12/16/22	1,128.10	42337
-----	----------	----------	----------	-------



CITY OF DRAKESBORO

P.O. Box 129 • Mose Rager Blvd. • Drakesboro, KY 42337

270-476-8986

(888) 662-2406 (Voice/TTY); (866) 557-5762 (Español)

Drakesboro Work Order

Work Order #: _____

Date: 12/29/22

Time: _____

(Gas) Water WW Acct #: 30-37400-03

Name: Kelley Rolley

Mobile Number: 270-602-9098

Address: 959 Merle Travis

Work to be Done:

New Meter# 20PZ46304

New Reading _____

Turn on & Read 421

Old Reading 4/28/22 267

Read and Lock _____

Set Meter and Lock

Measure Only _____

Locate Line

Read and Lock (Nonpayment) Number _____

Get Meter

Check Pressure _____

Flush Line _____

Check & Leak _____

Unlock Only and Read (Do Not Turn On) _____

* Should be pressure tested.

Special Instructions Should not be on. Was turned off for non payment. need \$100.00 deposit \$50.00 reconnection

** Will be turned off if pressure test does not pass & if no payment or voucher

Work Done:

Flushed: Yes No GPM: _____

How Long: _____

Water Logs: _____

Water Leak: Yes No GPM: _____

How Long: _____

Water Logs: _____

Parts Used to Complete Job:

\$213.54 received By Friday 1/6/23

Comments:

* HVAC person turned it on in November per Kelly.
* pressure and meter bar test performed no leaks 1.4 furnace

Work Completed By: BA & BJ

Date Completed: 01-04-2023

Time Started: _____

Time Ended: _____


Customer signature _____ date _____

Equal Opportunity Employer and Service Provider

The employees of Drakesboro are not trained HVAC personnel. Lighting of pilots are a courtesy and the City can not be held liable.

1/10/23 Locked & Caged

COMPLETED (See Below) BY: [Signature] DATE: 1/4/23

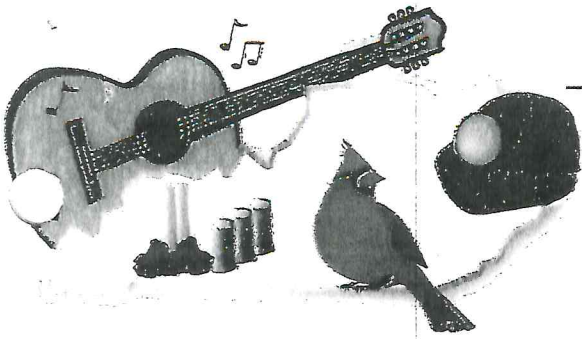

CITY OF DRAKESBORO

P.O. Box 129 • Mose Rager Blvd. • Drakesboro, KY 42337
270-476-8986
(888)662-2406 (Voice/TTY): (866)577-5762 (Español)

Date 01-04-2023

Time 2:10

Pressure Test for Gas Line

Plumber Information:

License # _____

Phone # _____

Name: _____

Address: _____

Meter read at time of Pressure Test 421

Pressure Tested for 10 minutes.

At 20 lbs of Pressure.


Customer: Kelley Rolley

Address: 959 Merle Tron's Hwy

Signature of Licensed Plumber

A handwritten signature in black ink, appearing to be 'The [unclear]'.

Signature of City of Drakesboro gas Employee and Russmar Representative

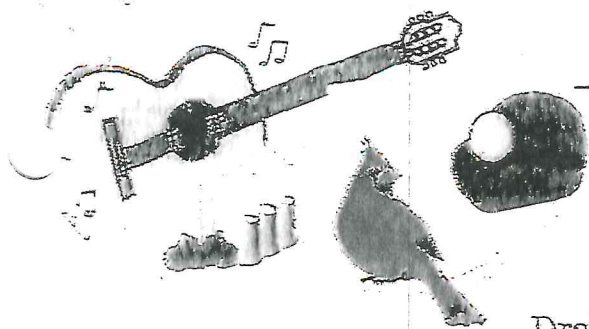

CITY OF DRAKESBORO

P.O. Box 129 • Mose Rager Blvd. • Drakesboro, KY 42337
270-476-8986
(888) 662-2406 (Voice/TTY); (866) 557-5762 (Español)

Drakesboro Work Order

Work Order #: _____

Date: 12-30-22 Time: _____

Gas Water WW Acct #: 30-47230-4

Name: Angela Pendley

Mobile Number: 270-779-5660

Address: 580 Hwy 431 North

Work to be Done:

New Meter# 485990 ^{old meter} New Reading 20246376 ^{new meter}

meter change out successful

Turn on & Read _____ Old Reading new reading - 0

Read and Lock _____ Set Meter and Lock _____

Reading Only 7793 ^{old reading} Locate Line _____ (See Below)

COMPLETED
By: AP Date: 1/4/23

Read and Lock (Nonpayment) _____ Get Meter _____
Number _____

Check Pressure _____ Flush Line _____ Check & Leak _____

Unlock Only and Read (Do Not Turn On) _____

Special Instructions New pipe installed

Work Done:

Flushed: Yes No GPM: _____ How Long: _____ Water Logs: _____
Water Leak: Yes No GPM: _____ How Long: _____ Water Logs: _____

Parts Used to Complete Job: _____

Comments: pressure test & meter bar test performed all passed new meter and spuds & nuts installed


Work Completed By: BA & BJ Date Completed: 01-03-2023

Time Started: _____ Time Ended: _____

Customer signature _____ date _____

Equal Opportunity Employer and Service Provider

The employees of Drakesboro are not trained HAZOP personnel. Lighting of pilots are a courtesy and the City can not be held liable.

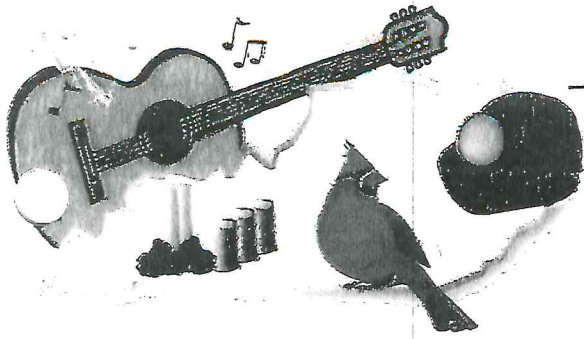

CITY OF DRAKESBORO

P.O. Box 129 • Mose Rager Blvd. • Drakesboro, KY 42337
270-476-8986
(888)662-2406 (Voice/TTY); (866)577-5762 (Español)

Date 01-03-2023

Time 14:30

Pressure Test for Gas Line

Plumber Information:

License # _____

Phone # _____

Name: _____

Address: _____

Meter read at time of Pressure Test 0

Customer: Angela Pendley

Pressure Tested for 10 minutes.


Address: 580 431 North

At 20 lbs of Pressure.

Signature of Licensed Plumber

[Signature]

Signature of City of Drakesboro gas Employee and Russmar Representative

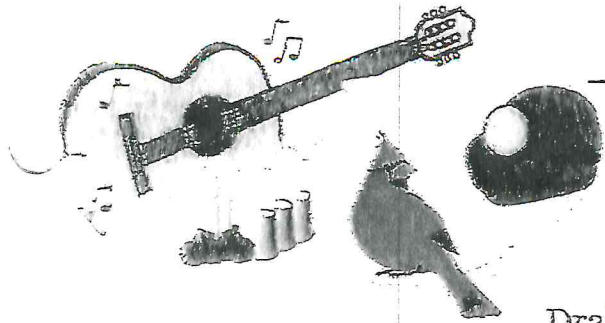

CITY OF DRAKESBORO

P.O. Box 129 • Mose Rager Blvd. • Drakesboro, KY 42337
270-476-8986
(888) 662-2406 (Voice/TTY); (866) 557-5762 (Español)

Drakesboro Work Order

Work Order #: _____

Date: 1/3/23 Time: _____ Gas Water WW Acct #: 40-56200-2

Name: Lindy Soltész Mobile Number: 203-631-0933

Address: 108 Jones Ave. Drakesboro Ky 42337

Work to be Done:

Card in book
 New acct made

New Meter# 486052 New Reading _____

Turn on & Read _____ Old Reading 8600 (11/29/22)

Read and Lock _____ Set Meter and Lock _____

Reading Only 8775 1/3/23 Locate Line (See Below)

Read and Lock (Nonpayment) _____ Get Meter
Number _____

Check Pressure _____ Flush Line _____ Check & Leak _____

Unlock Only and Read (Do Not Turn On) _____

Special Instructions Purchased home 12/28/22, have pd deposit, by ck, leave service on when SKye Graber ends her service.

Work Done:

Flushed: Yes No GPM: _____ How Long: _____ Water Logs: _____
Water Leak: Yes No GPM: _____ How Long: _____ Water Logs: _____

Parts Used to Complete Job:


Comments:

Work Completed By: B. Jones Date Completed: 01-03-2023

Time Started: _____ Time Ended: _____

Customer signature _____ date _____

The employees of Drakesboro are not trained HVAC personnel. Lighting of pilots are a courtesy and the City can not be held liable.

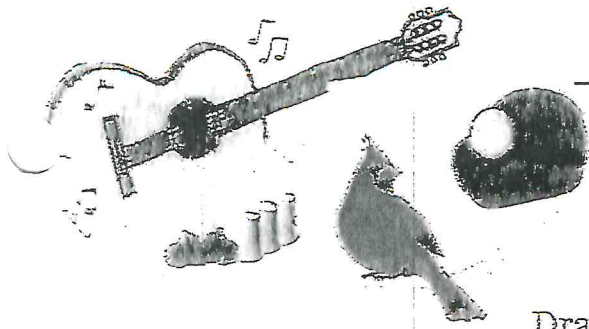

CITY OF DRAKESBORO

P.O. Box 129 • Mose Rager Blvd. • Drakesboro, KY 42337
270-476-8986
(888) 662-2406 (Voice/TTY); (866) 557-5762 (Español)

Drakesboro Work Order

Work Order #: _____

Date: 1/3/23 Time: _____

Gas Water WW Acct #: 20-30910-1

Name: Billy Lovell

Mobile Number: 270-476-8574 or 270-977-1124

Address: 113 Bradford Dr.

Work to be Done:

Old Meter# 18048415
New Meter# new meter- 20P246362

old reading - 1860

New Reading New reading - 0

Turn on & Read _____

Old Reading _____

Read and Lock _____

Set Meter and Lock _____

Reading Only _____

Locate Line (See Below) _____

Read and Lock (Nonpayment) Number _____

Get Meter _____

Check Pressure _____

Flush Line _____

Check & Leak _____

Unlock Only and Read (Do Not Turn On) _____

Special Instructions Meter change out -

COMPLETED
By: AP Date: 1/4/23

Work Done:

Flushed: Yes No GPM: _____ How Long: _____ Water Logs: _____

Water Leak: Yes No GPM: _____ How Long: _____ Water Logs: _____

Parts Used to Complete Job: _____

Comments: Meter changed out 1/4 hot water and furnace

Work Completed By: BA & BJ

Date Completed: 1-4-2023


Time Started: _____

Time Ended: _____

Customer signature _____ date _____

Equal Opportunity Employer and Service Provider

The employees of Drakesboro are not trained in fire prevention. Lighting of pilots are a courtesy and the City can not be held liable.

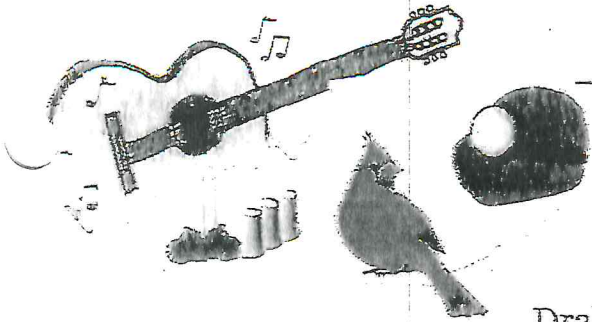

CITY OF DRAKESBORO

P.O. Box 129 • Mose Rager Blvd. • Drakesboro, KY 42337
270-476-8986
(888) 662-2406 (Voice/TTY): (866) 557-5762 (Español)

Drakesboro Work Order

Work Order #: _____

Date: 1/5/23 Time: _____ Gas Water WW Acct #: 20-30910-1

Name: Billy Lovell Mobile Number: 270-476-8574

Address: 113 Bradford Dr.

Work to be Done:

New Meter# 20P 246362 New Reading _____

Turn on & Read _____ Old Reading (0) read new meter

Read and Lock _____ Set Meter and Lock _____

Reading Only _____ Locate Line _____

Read and Lock (Nonpayment) _____ Get Meter _____
Number _____

Check Pressure _____ Flush Line _____ Check & Leak _____

Unlock Only and Read (Do Not Turn On) _____

Special Instructions Water not getting hot & Check water tank to make sure is still lit.

(See Below)
COMPLETED
By: AP Date: 1/5/23

Work Done:

Flushed: Yes No GPM: _____ How Long: _____ Water Logs: _____
Water Leak: Yes No GPM: _____ How Long: _____ Water Logs: _____

Parts Used to Complete Job: _____

Comments: Turned hot water setting up for customer


Work Completed By: BA & BJ Date Completed: 01-05-2023

Time Started: _____ Time Ended: _____

Customer signature _____ date _____

Equal Opportunity Employer and Service Provider

The employees of Drakesboro are not trained HVAC personnel. Lighting of pilots are a courtesy and the City can not be held liable.

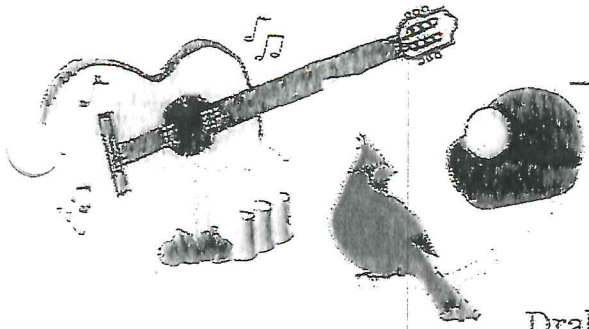

CITY OF DRAKESBORO

P.O. Box 129 • Mose Rager Blvd. • Drakesboro, KY 42337
270-476-8986
(888) 662-2406 (Voice/TTY); (866) 557-5762 (Español)

Drakesboro Work Order

Work Order #: _____

Date: 1/5/23 Time: _____ Gas Water WW Acct #: 0050-79350-1

Name: Scotty Smith Mobile Number: (270)476-2583

Address: 4421 St. Rt. 70 E

Work to be Done:

COMPLETED

New Meter# 4345375 New Reading _____ By: SP Date: 1/6/23

Turn on & Read _____ Old Reading 4431 12/9

Read and Lock _____ Set Meter and Lock _____

Reading Only 4137 Locate Line (See Below)

Read and Lock (Nonpayment) _____ Get Meter Number _____

Check Pressure _____ Flush Line _____ Check & Leak _____

Unlock Only and Read (Do Not Turn On) _____

Special Instructions Check meter, Bill has never been that high.

Work Done:

Flushed: Yes No GPM: _____ How Long: _____ Water Logs: _____

Water Leak: Yes No GPM: _____ How Long: _____ Water Logs: _____

Parts Used to Complete Job: _____

Comments: Meter read incorrect


Work Completed By: BA & BJ Date Completed: 1-6-2023

Time Started: _____ Time Ended: _____

Customer signature: _____ date _____

Equal Opportunity Employer and Service Provider

The employees of Drakesboro are not treated on the basis of race, sex, or religion. Lighting of pipes are a courtesy and the city can not be held liable.

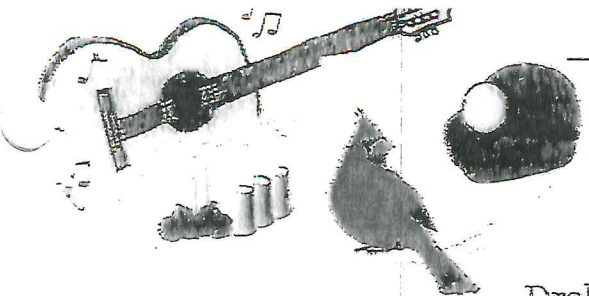

Drakesboro Work Order

Work Order #: _____

Date: 1/6/23 Time: _____ (Gas) Water WW Acct #: 30-39650-2

Name: Crystal Bolen Mobile Number: 270-543-2187

Address: 57 Ditney Hill

Work to be Done:

New Meter# 20P246379 New Reading _____

Turn on & Read _____ Old Reading 73 (12/29/22)

Read and Lock _____ Set Meter and Lock _____

Reading Only 74 _____ Locate Line _____

Read and Lock (Nonpayment) _____ Get Meter _____

Check Pressure _____ Flush Line _____ Check & Leak _____

Unlock Only and Read (Do Not Turn On) _____

Special Instructions Wants pressure checked. Said gas keeps surging & has bought new heater & still doing the same. Call before going this afternoon. (Has new meter)

Work Done:

Flushed: Yes No GPM: _____ How Long: _____ Water Logs: _____
Water Leak: Yes No GPM: _____ How Long: _____ Water Logs: _____

Parts Used to Complete Job:


Comments: Changed out regulator wall heater still not working properly had valve shut off to wall heater customer going to buy new heater and call back

Work Completed By: BA+ BJ Date Completed: 1-6-2023

Time Started: _____ Time Ended: _____

Customer signature _____ date _____

(See Below)
COMPLETED
By: [Signature] Date: 1/9/23

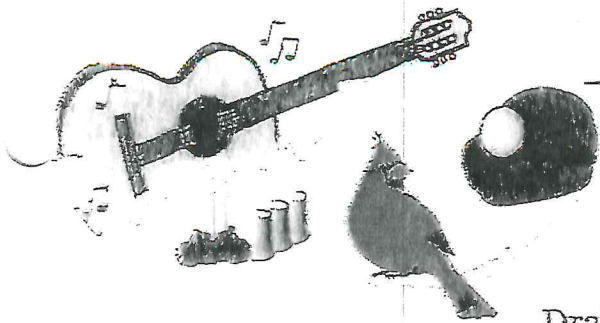

CITY OF DRAKESBORO

P.O. Box 129 • Mose Rager Blvd. • Drakesboro, KY 42337
270-476-8986
(888) 662-2406 (Voice/TTY); (866) 557-5762 (Español)

Drakesboro Work Order

Work Order #: _____

Date: 1/6/23 Time: _____ (Gas) Water WW Acct #: 10-00800-2

Name: Linda Darlene Naron Mobile Number: 370-725-6411

Address: 380 Myers Chapel Rd Belton Ky 42324

Work to be Done:

New Meter# _____ New Reading _____

Turn on & Read _____ Old Reading 9687 (12/29/22)

Read and Lock _____ Set Meter and Lock _____

Reading Only 9708 _____ Locate Line _____

Read and Lock (Nonpayment) _____ Get Meter _____

Number _____

COMPLETED (See Below)

By: AP Date: 1/6/23

Check Pressure _____ Flush Line _____ Check & Leak _____

Unlock Only and Read (Do Not Turn On) _____

Special Instructions New account.

Work Done:

Flushed: Yes No GPM: _____ How Long: _____ Water Logs: _____

Water Leak: Yes No GPM: _____ How Long: _____ Water Logs: _____

Parts Used to Complete Job:

Comments: Called Sandy w/ Read # 9708

SMG

Work Completed By: _____ Date Completed: _____


Time Started: _____ Time Ended: _____

Customer signature _____ date _____

Equal Opportunity Employer and Service Provider

The employees of Drakesboro are not trained HVAC personnel. Lighting of pilots are a courtesy and the City can not be held liable.

P.O. Box 129 • Mose Rager Blvd. • Drakesboro, KY 42337
270-476-8986
(888) 662-2406 (Voice/TTY); (866) 557-5762 (Español)

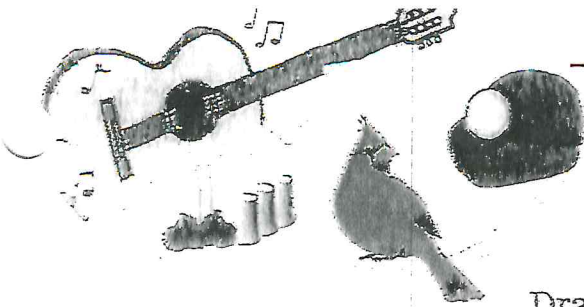

Drakesboro Work Order

Work Order #: _____

Date: 1/10/23 Time: _____ (Gas) Water WW Acct #: 30-37400-3
Name: Kelly Bolley Mobile Number: 270-602-9098
Address: 959 Merle Travis Hwy

Work to be Done:

New Meter# 20P246364 New Reading _____
Turn on & Read _____ Old Reading 267 (4/28/22)
Read and Lock _____ Set Meter and Lock _____
Reading Only _____ Locate Line _____
Read and Lock (Nonpayment) 434 Get Meter _____
Number _____
Check Pressure _____ Flush Line _____
Unlock Only and Read (Do Not Turn On) _____

✓ Note on Account

(See Below)
COMPLETED
By: AP Date: 1/10/23
Check & Leak _____

90.62-Bill
50.00 Reconnect
240.62

Special Instructions Pressure test passed, was told that payment of \$240.62 needed to be paid by 1/10/23 or we will turn off & lock. No payment & no callback.
*HVAC Turned on in Nov per Kelly

Work Done:

Flushed: Yes No GPM: _____ How Long: _____ Water Logs: _____
Water Leak: Yes No GPM: _____ How Long: _____ Water Logs: _____

Parts Used to Complete Job:

Comments: Meter shut off / locked out with cage

Work Completed By: BA4 BJ Date Completed: 1-10-2023

Time Started: _____ Time Ended: _____

Customer signature _____ date _____

The employees of Drakesboro are not trained HVAC personnel. Lighting of pilots are a courtesy and the City can not be held liable.



Meter Turn On and Turn Off Form - 1201

City/Company:

Information

Turn On Turn Off

Date:

Time:

Address:

Meter Number:

Meter Reading:

Reason for Turn Off/On?

Was the Meter Valve Locked? Yes No

Additional Remarks:

Completed By:

Call before
you go!

CITY OF DRAKESBORO

P.O. Box 129 • Mose Rager Blvd. • Drakesboro, KY 42337
270-476-8986
(888) 662-2406 (Voice/TTY); (866) 557-5762 (Español)

Drakesboro Work Order

Work Order #: _____

Date: 1/10/23

Time: _____

Gas

Water WW

Acct #: 30-37300-4

Name: Lance Miller

Mobile Number: 904-887-1165

Address: 931 Merle Travis Hwy

Work to be Done:

New Meter# 20P246371

New Reading _____

Turn on & Read 0

Old Reading 669? 4/24/17

Read and Lock _____

Set Meter and Lock _____

Reading Only _____

Locate Line _____

Read and Lock (Nonpayment) _____
Number _____

Get Meter _____

Check Pressure _____

Flush Line _____

Check & Leak _____

Unlock Only and Read (Do Not Turn On) _____

Special Instructions Will need a pressure test.

(See Below)
COMPLETED

By: AP Date: 1/10/23

Work Done:

Flushed: Yes No GPM: _____ How Long: _____ Water Logs: _____

Water Leak: Yes No GPM: _____ How Long: _____ Water Logs: _____

Parts Used to Complete Job:

Comments: Pressure test & meter hqr test done no leaks new meter installed gas turned on meter piping painted for atmospheric corrosion

Work Completed By: BA & PJ

Date Completed: 1-11-2023

Time Started: _____

Time Ended: _____

Customer signature _____ date _____

Equal Opportunity Employer and Service Provider

The employees of Drakesboro are not trained HVAC personnel. Lighting of bills are a courtesy and the City can not be held liable.


Open Checklist

- Active/ Begin
- Deposit
- Renter/Owner Docs.
- Read Card
- Search Old Acct.
- Work order
- Drivers License
- Domicile Declaration

30-37300-41
Lance Miller

Close Checklist

- Final
- Work Order
- Forwarding Address
- Phone Number
- Flip Read Card
- Refund deposit after final bill

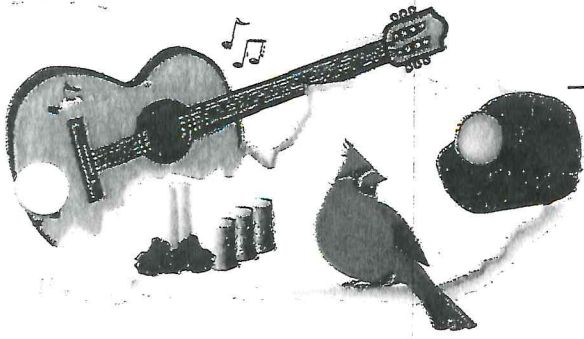

CITY OF DRAKESBORO

P.O. Box 129 • Mose Rager Blvd. • Drakesboro, KY 42337
270-476-8986
(888)662-2406 (Voice/TTY): (866)577-5762 (Español)

Date 1-11-2023

Time 11:55

Pressure Test for Gas Line

Plumber Information:

License # _____

Phone # _____

Name: _____

Address: _____

Meter read at time of Pressure Test 0

Customer: Lance Miller

Pressure Tested for 10 minutes.

Address: 481 Merle Travis Hwy

At 20 lbs of Pressure.

Signature of Licensed Plumber

A handwritten signature in black ink, appearing to be "R. Jones", written over a horizontal line.

Signature of City of Drakesboro gas Employee and Russmar Representative

Meter Turn On and Turn Off Form - 1201

City/Company:

Information

Turn On Turn Off

Date:

Time:

Address:

Meter Number:


Meter Reading:

Reason for Turn Off/On?

Was the Meter Valve Locked? Yes No

Additional Remarks:

Completed By:

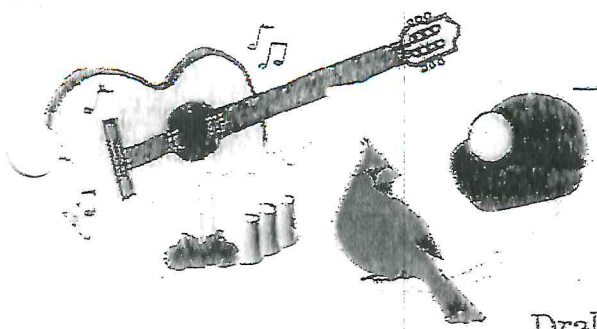

CITY OF DRAKESBORO

P.O. Box 129 • Mose Rager Blvd. • Drakesboro, KY 42337
270-476-8984
(888) 662-2406 (Voice/TTY); (866) 557-5762 (Español)

Drakesboro Work Order Work Order #: _____

Date: 1/10/23 Time: _____ Gas Water WW Acct #: 50-81400-1
Name: Tara [Signature] Mobile Number: 270-602-7164
Address: 108 Allen Rd (Elvie Reulett)

Work to be Done:

New Meter# 19M215031 New Reading _____
Turn on & Read _____ Old Reading _____
Read and Lock 0 Set Meter and Lock _____
Reading Only _____ Locate Line _____
Read and Lock (Nonpayment) _____ Get Meter _____
Number _____
Check Pressure _____ Flush Line _____ Check & Leak _____
Unlock Only and Read (Do Not Turn On) _____

COMPLETED
by AP Date: 1/10/23
(See Below)

Special Instructions: Gas smell outside - all gas
stuff in home is turned off -

Work Done:

Flushed: Yes No GPM: _____ How Long: _____ Water Logs: _____
Water Leak: Yes No GPM: _____ How Long: _____ Water Logs: _____

Parts Used to Complete Job: _____

Comments: Call of gas smell found small leak on customer
piping running along the side of house, locked out
meter until repairs can be made

Work Completed By: B. Jones Date Completed: 1-10-2023

Time Started: _____ Time Ended: _____
Customer signature _____ date _____

Meter Turn On and Turn Off Form - 1201

City/Company:

Information

Turn On Turn Off

Date:

Time:

Address:

Meter Number:

Meter Reading:

Reason for Turn Off/On?

Was the Meter Valve Locked? Yes No

Additional Remarks:

Completed By:



Telephonic Report of Customer Leak-201

City/Company: City of Drakesboro Utilities

Customer Leak Information


Time Call Received: [] Date: Jan 10, 2023
Name of Caller: Tara Caller's Phone Number: 270-602-7164
Name of Customer if not Caller: Elvie Revlett
Address of Leak: 108 Allen Road
Nature of Leak: Odor []
Is the Gas Odor or Sound Inside the House? Yes No
If Yes, Where is it located? N/A
Is the Gas Odor or Sound Outside the House? Yes No
If Yes, Where is it located? Along front walkway
How Long Have You Been Smelling or Hearing the Gas? Only on windy days
Will Someone Be Home For Us to Check the Leak? Yes No
Was the Caller Told to Evacuate the Structure? Yes No

Leak Response Information

Time Investigator Dispatched: 02:03 Date: Jan 10, 2023
Name of Investigator: Brian Jones
Time Investigator Arrived at Scene: 02:18 % LEL in Air at Entry of Structure: None % LEL
Was Evacuation Required due to %Gas in Air Reading Exceeding 20% LEL? Yes No
Action Taken: Used cgi around area customer was smelling gas found that small leak in customer piping above ground turned gas off and locked out meter until repairs can be made
Time Investigator Completion at Scene: 02:55
Grade of Leak: N/A
Additional Follow-up Required? Yes No
Was Shut-in Test Performed Prior to leaving meter turned on? Yes No
If Yes, What Type of Follow-up?
Additional Remarks:
Serial Number of CGI Used: 610441
Investigator Signature: Brian Jones

Supervisor Checklist Information

Was the leak response time reviewed? Yes No
Were the emergency procedures followed? Yes No
Did the response time exceed 1 Hour? Yes No
Supervisor Signature: Brian Jones

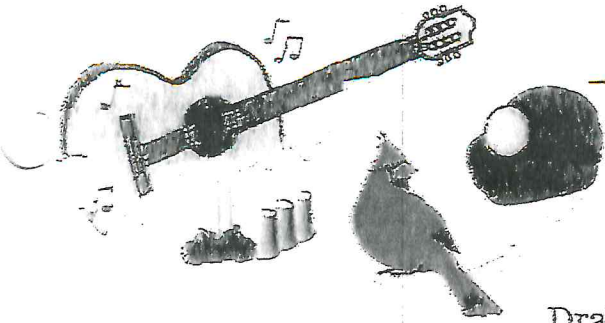

CITY OF DRAKESBORO

P.O. Box 129 • Mose Rager Blvd. • Drakesboro, KY 42337
270-476-8986
(888) 662-2406 (Voice/TTY); (866) 557-5762 (Español)

Drakesboro Work Order

Work Order #: _____

Date: 1/13/23 Time: 8:15am Gas Water WW Acct #: 10-05200-2

Name: Summer Ingram Mobile Number: 270-543-6711

Address: P.O. Box 122 Beechmont Ky 42330
3391 U.S. 431 S. Beechmont

Work to be Done:

New Meter# 4786062 New Reading _____

Turn on & Read _____ Old Reading 5769 (12/29/22) *\$acct in begin*

Read and Lock _____ Set Meter and Lock _____

Reading Only 5805 _____ Locate Line _____ (See Below)

Read and Lock (Nonpayment) _____ Get Meter _____

Number _____

Check Pressure _____ Flush Line _____

Unlock Only and Read (Do Not Turn On) _____

Special Instructions Moved into & renting grandparents,
Stanley & Janetta Fulkerson, home.

COMPLETED
By: [Signature] Date: 1/13/23
Check & Leak _____

Work Done:

Flushed: Yes No GPM: _____ How Long: _____ Water Logs: _____

Water Leak: Yes No GPM: _____ How Long: _____ Water Logs: _____

Parts Used to Complete Job:

Comments:

Work Completed By: B. Jones Date Completed: 1-13-2023

Time Started: _____ Time Ended: _____

Customer signature _____ date _____


Equal Opportunity Employer and Service Provider

The employees of Drakesboro are not trained HVAC personnel. Lighting of pilots are a courtesy and the City can not be held liable.

Call before

CITY OF DRAKESBORO

P.O. Box 129 • Mose Rager Blvd. • Drakesboro, KY 42337
270-476-8986
(888) 662-2406 (Voice/TTY); (866) 557-5762 (Español)

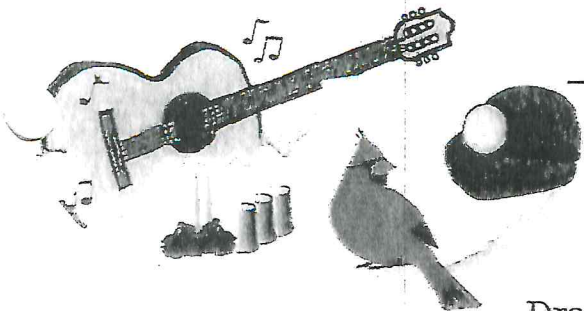

Drakesboro Work Order

Work Order #: _____

Date: 1/17 Time: _____ Gas Water WW Acct #: _____

Name: Emily Legrand Mobile Number: (270) 602-9084

Address: 268 Bradford dr.

Work to be Done:

New Meter# _____ New Reading _____

Turn on & Read _____ Old Reading _____

Read and Lock _____ Set Meter and Lock _____

Reading Only 5138 Locate Line _____

Read and Lock (Nonpayment) _____ Get Meter _____
Number _____

Check Pressure _____ Flush Line _____ Check & Leak _____

Unlock Only and Read (Do Not Turn On) _____

Special Instructions Read

COMPLETED

(See Below)
By: [Signature] Date: 1-30-23

Work Done:

Flushed: Yes No GPM: _____ How Long: _____ Water Logs: _____

Water Leak: Yes No GPM: _____ How Long: _____ Water Logs: _____

Parts Used to Complete Job:

Comments: Read meter meter number not legible

Work Completed By: B. Jones Date Completed: 1-17-2023

Time Started: _____ Time Ended: _____

Customer signature _____ date _____

Equal Opportunity Employer and Service Provider


The employees of Drakesboro are not trained HVAC personnel. Lighting of pilots are a courtesy and the City can not be held liable.

Open Checklist

- Active/ Begin
- Deposit
- Renter/Owner Docs.
- Read Card
- Search Old Acct.
- Work order
- Drivers License
- Domicile Declaration

Close Checklist

- Final
- Work Order
- Forwarding Address
- Phone Number
- Flip Read Card
- Refund deposit after final bill

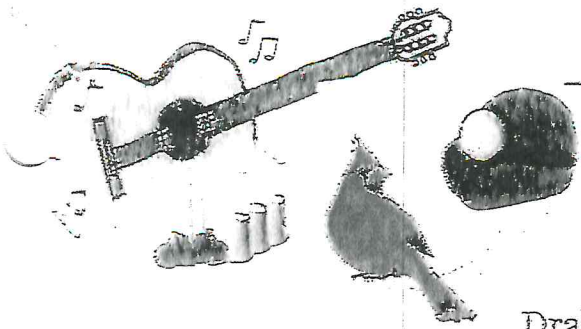

CITY OF DRAKESBORO

P.O. Box 129 • Mose Rager Blvd. • Drakesboro, KY 42337
270-476-8986
(888) 662-2406 (Voice/TTY); (866) 557-5762 (Español)

Drakesboro Work Order

Work Order #: _____

Date: 1-19-2023 Time: 11:19

Gas Water WW Acct #: 0020-21700-001

Name: Rudy Cundiff

Mobile Number: 270-543-6264

Address: 242 Beechcreek Road

Work to be Done:

New Meter# _____ New Reading _____

Turn on & Read _____ Old Reading 9688 4-8-22

Read and Lock _____ Set Meter and Lock _____

Reading Only _____ Locate Line (See Below)

Read and Lock (Nonpayment) _____ Get Meter _____

Number _____

Check Pressure _____ Flush Line _____ Check & Leak _____

Unlock Only and Read (Do Not Turn On) _____

Special Instructions _____

COMPLETED
By: BJ Date: 1-30-23

Work Done:

Flushed: Yes No GPM: _____ How Long: _____ Water Logs: _____

Water Leak: Yes No GPM: _____ How Long: _____ Water Logs: _____

Parts Used to Complete Job: _____

Comments: Pressure test failed, meter capped off


Work Completed By: B. Jones Date Completed: _____

Time Started: _____ Time Ended: _____

Customer signature [Signature] date _____

Equal Opportunity Employer and Service Provider

The employees of Drakesboro are not trained HVAC professionals. Lighting of pilots are a courtesy and the City can not be held liable.

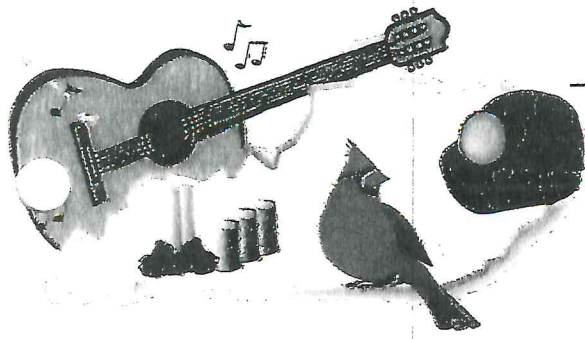

CITY OF DRAKESBORO

P.O. Box 129 • Mose Rager Blvd. • Drakesboro, KY 42337

270-476-8986

(888)662-2406 (Voice/TTY): (866)577-5762 (Español)

Date _____

Time _____

Pressure Test for Gas Line

Plumber Information:

License # _____

Phone # _____

Name: _____

Address: _____

Meter read at time of Pressure Test _____

Customer: _____


Pressure Tested for _____ minutes.

Address: _____

At _____ lbs of Pressure.

Signature of Licensed Plumber

Signature of City of Drakesboro gas Employee and Russmar Representative

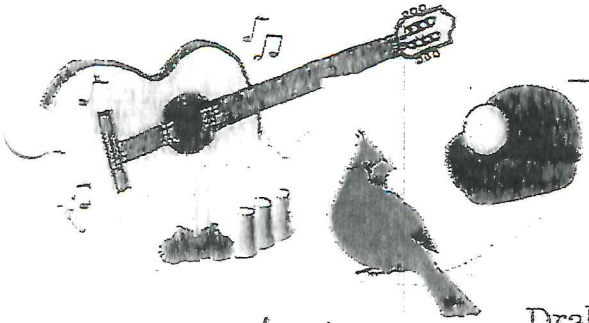

CITY OF DRAKESBORO

P.O. Box 129 • Mose Rager Blvd. • Drakesboro, KY 42337
270-476-8986
(888) 662-2406 (Voice/TTY); (866) 557-5762 (Español)

Drakesboro Work Order

Work Order #: _____

Date: 1/20/23 Time: _____ Gas Water WW Acct #: 20-29000-2

Name: Cody Dalton Mobile Number: 270-608-4524

Address: 100 Beechmont Dr.

Work to be Done:

New Meter# 21970877 New Reading 1947

Turn on & Read _____ Old Reading _____

Read and Lock _____ Set Meter and Lock _____

Reading Only _____ Locate Line (See Below)

Read and Lock (Nonpayment) _____ Get Meter

Number _____

Check Pressure _____ Flush Line _____ Check & Leak _____

Unlock Only and Read (Do Not Turn On) _____

Special Instructions High usage
previous read - 1884

COMPLETED
By: BJ Date: 1-30-23

Work Done:

Flushed: Yes No GPM: _____ How Long: _____ Water Logs: _____

Water Leak: Yes No GPM: _____ How Long: _____ Water Logs: _____

Parts Used to Complete Job: _____

Comments: Higher usage due to furnace being gas
not electric why usage has been higher


Work Completed By: BA & BJ Date Completed: 1-23-23

Time Started: _____ Time Ended: _____

Customer signature _____ date _____

Equal Opportunity Employer and Service Provider

The employees of Drakesboro are not trained HVAC personnel. Lighting of pilots are a courtesy and the City can not be held liable.

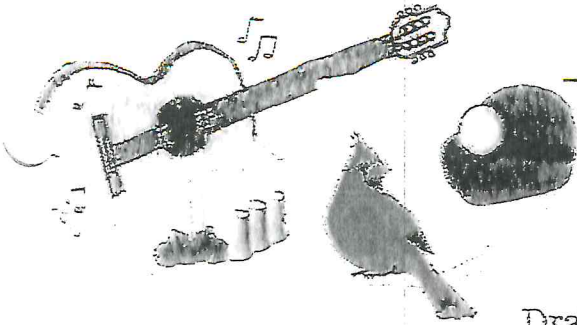

CITY OF DRAKESBORO

P.O. Box 129 • Mose Rager Blvd. • Drakesboro, KY 42337
270-476-8986
(888) 662-2406 (Voice/TTY); (866) 557-5762 (Español)

Drakesboro Work Order

Work Order #: _____

Date: 1-20-23 Time: _____ Gas Water WW Acct #: _____

Name: Lori Stinson Mobile Number: _____

Address: 271 Hazel Creek Rd.

Work to be Done:

New Meter# 485840 New Reading _____

Turn on & Read _____ Old Reading _____

Read and Lock _____ Set Meter and Lock _____

Reading Only 4738 Locate Line _____

Read and Lock (Nonpayment) _____ Get Meter
Number _____

Check Pressure _____ Flush Line _____ Check & Leak _____

Unlock Only and Read (Do Not Turn On) _____

Special Instructions Turn off and lock till new customer
can come in to sign agreement

COMPLETED

(See Below) *[Signature]* Date 1-30-23

Work Done:

Flushed: Yes No GPM: _____ How Long: _____ Water Logs: _____

Water Leak: Yes No GPM: _____ How Long: _____ Water Logs: _____


Parts Used to Complete Job:

Comments: off and locked house has been sold

Work Completed By: B. Jones Date Completed: 1-20-2023

Time Started: _____ Time Ended: _____

Customer signature: _____ date: _____

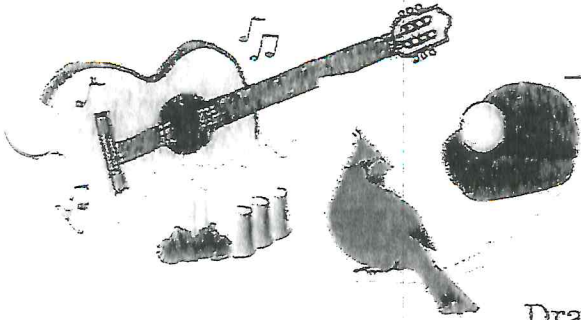

CITY OF DRAKESBORO

P.O. Box 129 • Mose Rager Blvd. • Drakesboro, KY 42337
270-476-8986
(888) 662-2406 (Voice/TTY); (866) 557-5762 (Español)

Drakesboro Work Order

Work Order #: _____

Date: 1-25-23 Time: _____ Gas Water WW Acct #: 0040-51400-005

Name: Michael Latham Mobile Number: _____

Address: 114 Ricedale Circle

Work to be Done:

New Meter# 18048411 New Reading 2250

Turn on & Read _____ Old Reading _____

Read and Lock _____ Set Meter and Lock _____

Reading Only _____ Locate Line (See Below)

Read and Lock (Nonpayment) _____ Get Meter Number _____

Check Pressure _____ Flush Line _____ Check & Leak _____

Unlock Only and Read (Do Not Turn On) _____

Special Instructions service turned off 1-24-2023

COMPLETED
BY: [Signature] 1-30-23

Work Done:

Flushed: Yes No GPM: _____ How Long: _____ Water Logs: _____

Water Leak: Yes No GPM: _____ How Long: _____ Water Logs: _____

Parts Used to Complete Job: _____

Comments: Meter turned off due to house fire will re-connect when repairs have been made to residence

Work Completed By: BAJ BJ Date Completed: 1-25-2023

Time Started: _____ Time Ended: _____


Customer signature _____ date _____

Equal Opportunity Employer and Service Provider

The employees of Drakesboro are not trained HVAC personnel. Lighting of pilots are a courtesy and the City can not be held liable.

CITY OF DRAKESBORO

P.O. Box 129 • Mose Rager Blvd. • Drakesboro, KY 42337
270-476-8986
(888) 662-2406 (Voice/TTY); (866) 557-5762 (Español)

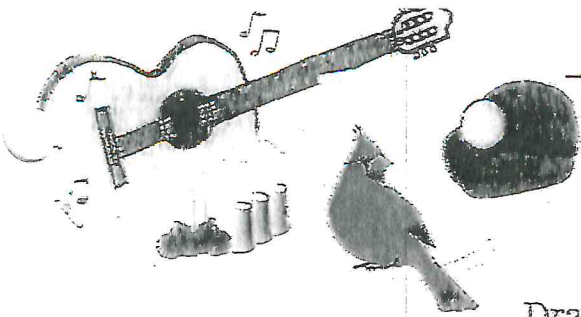

Drakesboro Work Order

Work Order #: _____

Date: 1/26/23 Time: 11:10 Gas Water WW Acct #: _____

Name: LESLIE THOMAS Mobile Number: 270-820-4148

Address: W DRAKE ST

Work to be Done:

New Meter# _____ New Reading _____

Turn on & Read _____ Old Reading _____

Read and Lock _____ Set Meter and Lock _____

Reading Only _____ Locate Line _____

Read and Lock (Nonpayment) _____ Get Meter _____

Number _____

Check Pressure _____ Flush Line _____ Check & Leak _____

Unlock Only and Read (Do Not Turn On) _____

Special Instructions _____

COMPLETED
(See Below)
BY: [Signature] Date: 2-1-23

Work Done:

Flushed: Yes No GPM: _____ How Long: _____ Water Logs: _____

Water Leak: Yes No GPM: _____ How Long: _____ Water Logs: _____

Parts Used to Complete Job: _____

Comments: Smell of gas coming from meter across street
found small leak on residential meter set going to make
work order for repairs to be made today 1-26-2023


Work Completed By: BAJ BJ Date Completed: 1-26-2023

Time Started: _____ Time Ended: _____

Customer signature _____ date _____

Equal Opportunity Employer and Service Provider

The employees of Drakesboro are not trained HVAC personnel. Lighting of pilots are a courtesy and the City can not be held liable.

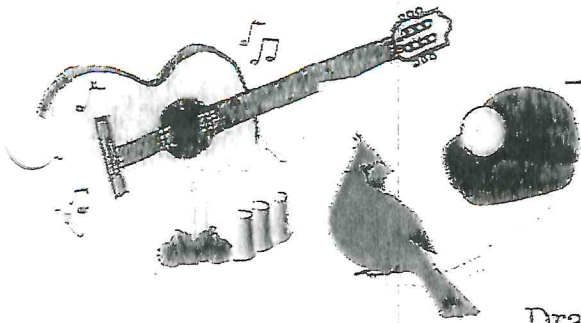

CITY OF DRAKESBORO

P.O. Box 129 • Mose Rager Blvd. • Drakesboro, KY 42337
270-476-8986
(888) 662-2406 (Voice/TTY): (866) 557-5762 (Español)

Drakesboro Work Order

Work Order #: _____

Date: 1-26-23 Time: _____ Gas Water WW Acct #: 0040-64810-001
Name: Larry Shrodes Mobile Number: _____
Address: 141 West Drake Street

Work to be Done:

New Meter# 486011 New Reading 290
Turn on & Read _____ Old Reading _____
Read and Lock _____ Set Meter and Lock _____
Reading Only _____ Locate Line (See Below) _____
Read and Lock (Nonpayment) _____ Get Meter _____
Number _____
Check Pressure _____ Flush Line _____ Check & Leak _____
Unlock Only and Read (Do Not Turn On) _____

Special Instructions Change out Residential Meter + Insulated Spuds

COMPLETED
BY: BSJ DATE: 2-1-23

Work Done:


Flushed: Yes No GPM: _____ How Long: _____ Water Logs: _____
Water Leak: Yes No GPM: _____ How Long: _____ Water Logs: _____

Parts Used to Complete Job:

Comments: Found gasket leaking on feed side of meter turned gas off replaced gasket turned gas back on no leaks lit hot water heater back

Work Completed By: BA + BSJ Date Completed: 1-26-2023

Time Started: _____ Time Ended: _____
Customer signature _____ date _____

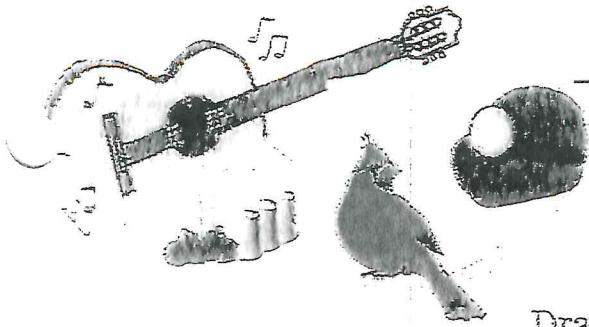

CITY OF DRAKESBORO

P.O. Box 129 • Moose Rager Blvd. • Drakesboro, KY 42337
270-476-8986
(888) 662-2406 (Voice/TTY); (866) 557-5762 (Español)

Drakesboro Work Order

Work Order #: _____

Date: 1/27/23 Time: _____ Gas Water WW Acct #: _____

Name: BRIAN LEAR Mobile Number: 270-977-7817

Address: 1687 CORUM LANDING RD DRAKESBORO, KY

Work to be Done:

New Meter# 209550 New Reading 0258

Turn on & Read _____ Old Reading _____

Read and Lock _____ Set Meter and Lock _____

Reading Only _____ Locate Line (See Below)

Read and Lock (Nonpayment) _____ Get Meter
Number _____

Check Pressure _____ Flush Line _____ Check & Leak _____

Unlock Only and Read (Do Not Turn On) _____

Special Instructions Smell of gas around meter in garage

COMPLETED
BY [Signature] DATE 2-9-23

Work Done:

Flushed: Yes No GPM: _____ How Long: _____ Water Logs: _____

Water Leak: Yes No GPM: _____ How Long: _____ Water Logs: _____

Parts Used to Complete Job: _____

Comments: Found leak on both sides meter turned gas off replaced meter nuts, spuds, gaskets turned gas back on no leaks lit 2 ventless wall heaters in garage

Work Completed By: BA + BJ Date Completed: 1-27-2023

Time Started: _____ Time Ended: _____

Customer signature _____ date _____

Equal Opportunity Employer and Service Provider

The employees of Drakesboro are not trained in the proper lighting of pilot are a courtesy and the City can not be held liable.