


P.O. Box 129 - Mose Kager Blvd. • Drakesboro, KY 42337
270-476-8986
(888) 662-2406 (Voice/TTY); (866) 557-5752 (Español)

Turn off
2-28-2023

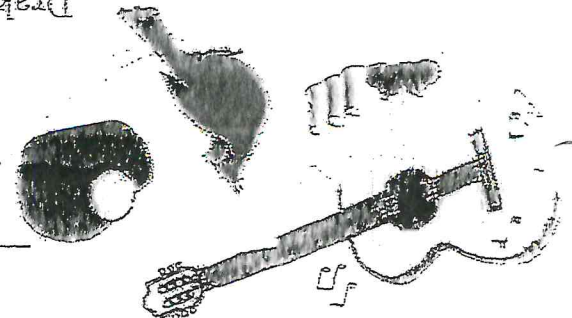

Drakesboro Work Order
Work Order #: _____
Date: 2-28-2023 Time: _____
Gas Water WW Acct #: 0020-31300-006

Name: Jim Dale
Mobile Number: _____
Address: 758 Masonic Drive Beechmont, Ky 42323

Work to be Done:

New Meter# 19013968
New Reading 6164
Old Reading 6018

COMPLETED
BY BJ
DATE 2-27-23

Turn on & Read
Read and Lock
Reading Only
Read and Lock (Nonpayment)
Get Meter
Flush Line
Check Pressure
Unlock Only and Read (Do Not Turn On)
Special Instructions

Turn Off For Final Read

Work Done:

Flushed: Yes No GPM: _____ How Long: _____ Water Logs: _____
Water Leak: Yes No GPM: _____ How Long: _____ Water Logs: _____


Parts Used to Complete Job:

Comments: Meter turned off per request of center

Time Started: _____ Time Ended: _____
Customer Signature: _____ Date: _____
The employees of Drakesboro are not trained in the use of firearms and the city can not be held liable.

CITY OF DRAKESBORO

P.O. Box 129 - Mose Kager Blvd. - Drakesboro, KY 42357
270-476-8984
(888) 662-2406 (Voice/TTY); (866) 557-5762 (Español)

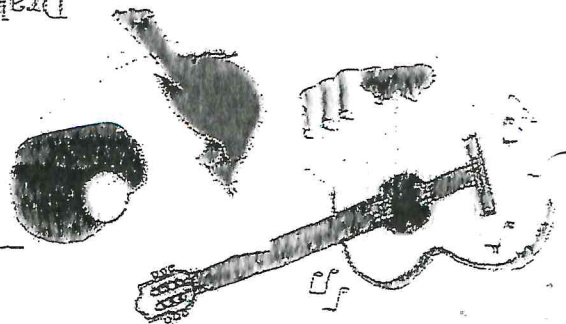

Drakesboro Work Order

Work Order #: _____ Date: 2-15-2023 Time: _____

Name: _____ Mobile Number: _____

Address: 311 Disney Hill Road

Work to be Done:

New Meter# _____

Turn on & Read _____ Old Reading _____

Read and Lock _____ Set Meter and Lock _____

Reading Only _____ Locate Line _____

Read and Lock (Nonpayment) _____ Get Meter _____

Number _____ Check Pressure _____ Flush Line _____ Check & Leak _____

Unlock Only and Read (Do Not Turn On)

Special Instructions No damage to natural gas line or service line

Work Done:

Flushed: Yes No GPM: _____ How Long: _____ Water Logs: _____

Water Leak: Yes No GPM: _____ How Long: _____ Water Logs: _____

Parts Used to Complete Job:

Comments: Large tree fell right near gas meter arrived on scene gas meter not damaged remained on scene until county road department could push tree away from gas meter to ensure no damage or leaks

Name of Employee: B. Jones Date Completed: 2-15-2023

Time Started: _____ Time Ended: _____

Customer signature: _____

Equal Opportunity Employer and Service Provider

The employees of Drakesboro are not required to accept or perform any work if the lighting of pipes are a concern and the city can provide adequate lighting.

COMPLETED
BY: (See Below) BJS
DATE: 2-15-23

Incident Number: 23-005097

Incident Type: E911

Incident State: DISPATCHED

Global Number:

Linked Numbers:

Incident Detail

Received At:

02/15/2023 18:07:06

Created At:

02/15/2023 18:07:06

Dispatched At:

02/15/2023 18:08:37

Created By:

MBURKET

Event Type: TREE DOWN

Incident Case Numbers:

Incident Dispositions:

Disposition Comment:

Caller Location: 30 DITNEY HILL RD, DRAKESBORO [232] (37.213452, -87.058146)

Event Location: 311 DITNEY HILL RD, DRAKESBORO [232] (37.209596, -87.059932)

Location Kind: CIVIC ADDRESS

Caller Name: JOHN EWING

Business Name:

Phone Number: (270)-602 7624

Service Class:

Cell Sector:

Callback Number:

Comment: ROADWAY COMPLETELY BLOCKED, TRUNK OF TREE APPROX 4 FOOT AROUND

Narrative Log

Narrative By

Narrative At

Category

Is Sensitive

Narrative

MBURKET

02/15/2023 18:09:54

NO

314 10-8

MBURKET

02/15/2023 18:12:27

NO

CONTACT MADE W/ BRANDON BURDEN

MBURKET

02/15/2023 18:13:04

NO

307 10-8

VMCPHERSON

02/15/2023 18:15:40

NO

CONTACT MADE WITH BRIAN JONES/DRAKESBORO WATER AND GAS

SNELSON

02/15/2023 18:20:21

NO

BRIAN JONES 10-97

MBURKET

02/15/2023 19:56:33

NO

BRIAN JONES 10-98

Event Type Log

Event Type By

Event Type At

Event Type

MBURKET

02/15/2023 18:07:36

TREE DOWN

Location Log

Location By

Location At

Location Kind

Location

MBURKET

02/15/2023 18:07:34

CIVIC ADDRESS

311 DITNEY HILL RD, DRAKESBORO [232] (37.209596, -87.059932)

MBURKET

02/15/2023 18:07:13

CIVIC ADDRESS

30 DITNEY HILL RD, DRAKESBORO [232] (37.213452, -87.058146)

Incident State Log

Incident State By

Incident State At

Incident State

MBURKET

02/15/2023 18:07:06

CREATED

MBURKET

02/15/2023 18:08:37

DISPATCHED

Category Log

Category: EMS

Event Type At: 02/15/2023 18:07:06
Response Area: EMS ESN 232
Final Disposition:

Category Event Type Log

Event Type By Event Type At Event Type

Category: FIRE
Event Type At: 02/15/2023 18:07:06
Response Area: FIRE ESN 232
Final Disposition:

Category Event Type Log

Event Type By Event Type At Event Type

Category: LAW
Event Type At: 02/15/2023 18:07:06
Response Area: LAW ESN 232
Final Disposition:

Category Event Type Log

Event Type By Event Type At Event Type

Resource Dispatch Log

Agency Category Agency Run Numbers:

DRAKESBORO FIRE DEPARTMENT

FIRE

Dispositions:

Resource Assigned Station: Resource Run Numbers:

DRAKESBORO FD

Case Numbers:

Personnel:

Dispositions:

Comment:

Dispatch State At Dispatch State By Odometer Was Voiced

DISPATCHED

02/15/2023 18:08:37

MBURKET

NO

307

Case Numbers:

Personnel:

DARRELL WICK

Dispositions:

Comment:

Dispatch State At Dispatch State By Odometer Was Voiced

DISPATCHED

02/15/2023 18:13:46

SNELSON

NO

ON SCENE

02/15/2023 18:13:46

SNELSON

NO

CLEAR

02/15/2023 19:58:21

MBURKET

NO

E3

Case Numbers:

Personnel:

Dispositions:

Comment:

Dispatch State

Dispatch State At

Dispatch State By

Odometer

Was Voided

DISPATCHED

02/15/2023 18:21:08

SNELSON

NO

ENROUTE

02/15/2023 18:21:08

SNELSON

NO

ON SCENE

02/15/2023 18:23:14

MBURKET

NO

CLEAR

02/15/2023 19:58:21

MBURKET

NO

DISPATCHED

02/15/2023 18:18:32

MBURKET

NO

ENROUTE

02/15/2023 18:18:32

MBURKET

NO

ON SCENE

02/15/2023 18:20:41

SNELSON

NO

CLEAR

02/15/2023 19:58:21

MBURKET

NO

P.O. Box 129 • Mose Rager Blvd. • Drakesboro, KY 42337

270-476-8986

(888) 662-2406 (Voice/TTY); (866) 557-5752 (Spanish)

Kyle C. 2-15-23

COMPLETED

Drakesboro Work Order

Work Order #: _____

Date: 2-15-2023 Time: _____

Gas Water WW

Mobile Number: _____

Name: Naomi Chumley

Address: 55 State Route 70 East

Work to be Done:

New Meter# 486228

New Reading 5788

Turn on & Read

Old Reading 5896

Read and Lock

Set Meter and Lock

Reading Only

Locate Line (See Below)

Read and Lock (Nonpayment)

Get Meter

Number

Check Pressure

Flush Line

Check & Leak

Unlock Only and Read (Do Not Turn On)

Special Instructions: Make sure service is still turned off at meters

Work Done:

Flushed: Yes No

GPM: _____

How Long: _____

Water Logs: _____

Water Leak: Yes No

GPM: _____

How Long: _____

Water Logs: _____

Parts Used to Complete Job:

Comments: Meter re-read and meter is off and locked out

Time Started: _____ Time Ended: _____


Date Completed: 2-15-2023

Customer Signature: _____


Date: _____

Equal Opportunity Employer and Service Provider

The employees of Drakesboro are not unionized and the city can not be held liable for any damages or costs.

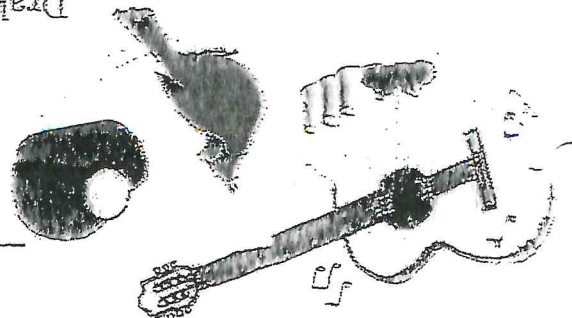

P.O. Box 129 - Moose Rager Blvd. - Drakesboro, KY 42337
270-476-8986
(888) 662-2406 (Voice/TTY); (866) 557-5762 (Spanish)

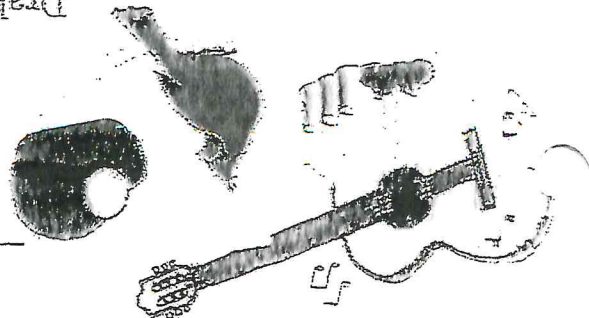

Drakesboro Work Order

Work Order #:

Date: 2-15-23 Time: _____

(Gas) Water WW

Acct #:

Name: Ashley Rixie

Mobile Number:

Address: 300 Kennedy Jones

Work to be Done:

New Meter# 21976871

New Reading 2368

Old Reading

Turn on & Read

Set Meter and Lock

Read and Lock

Locate Line (See Below)

Reading Only

Get Meter

Read and Lock (Nonpayment)

Number

Flush Line

Check Pressure

Check & Leak

Unlock Only and Read (Do Not Turn On)

Special Instructions Check homeowner thinks she smells gas

Work Done:

Flushed: Yes No GPM: _____

How Long: _____

Water Logs: _____

Water Leak: Yes No GPM: _____

How Long: _____

Water Logs: _____

Parts Used to Complete Job:

Comments: Small leak found with cg, had line to outside
unit capped off no leak customer having have come to
make repairs

Time Started: _____ Time Ended: _____
Date Downloaded: 2-15-2023

Customer signature: _____

date: _____


The employees of Drakesboro
are not retained and the City
and the City can not be held
liable for any damages or
injury of persons or property.

Equal Opportunity Employer and Service Provider

COMPLETED
2-15-23
BY BS

CITY OF DRAKESBORO

P.O. Box 129 • Mose Rager Blvd. • Drakesboro, KY 42337
270-476-8986
(888) 662-2406 (Voice/TTY); (866) 557-5752 (Español)

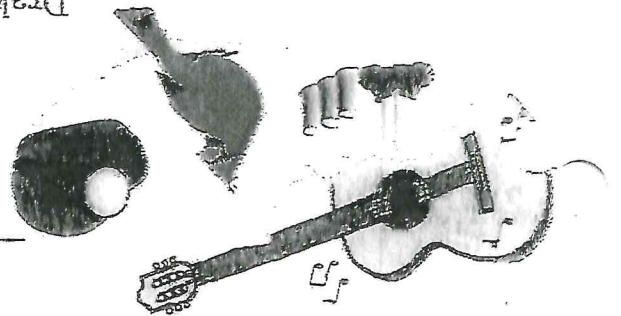

Drakesboro Work Order

Work Order #:

Date: 1-26-2023 Time: _____
Gas Water WW Acct #: 0050-77600-003

Name: Brandon Missionary
Mobile Number: _____

Address: 461 State Route to East

Work to be Done:

New Meter# 455559

New Reading _____

Turn on & Read _____

Old Reading _____

Read and Lock _____

Set Meter and Lock _____

Reading Only 2135

Locate Line _____

(See Below)

Read and Lock (Nonpayment) _____

Get Meter _____

Check Pressure _____

Flush Line _____

Check & Leak _____

Unlock Only and Read (Do Not Turn On)

Special Instructions Change of ownership
Adam and Melissa Alverson
Reading only

461 State Route to East

Work Done:

Flushed: Yes No GPM: _____

How Long: _____

Water Logs: _____

Water Leak: Yes No GPM: _____

How Long: _____

Water Logs: _____

Parts Used to Complete Job:

Comments: Reading only Service on

Work Done: By BA + BJ

Date Completed: 2-1-2023

Time Started: _____

Time Ended: _____

Customer signature _____

date _____

Equal Opportunity Employer and Service Provider

The employees of Drakesboro
are not trained HVAC personnel
Lifting of pipes are a courtesy
and the City can not be held liable.

P.O. Box 129 - Mose Rager Blvd. - Drakesboro, KY 42337
270-476-8986
(888) 662-2406 (Voice/TTY); (866) 557-5762 (Spanish)

10:00 a.m. 6/2/23

Drakesboro Work Order

Work Order #:

Date: 2/2/2023 Time: 1:40

Gas

Water WW

Acct #: 0020-26490-001

Name: JERRY MAURY

Mobile Number: 270-543-1066 (ANALETRA)

Address: 100 HAZEL CREEK RD

Work to be Done:

New Meter# 1017827

New Reading 855200

Turn on & Read

Old Reading

Read and Lock

Set Meter and Lock

Reading Only 8618

Locate Line

(See Below)

Read and Lock (Nonpayment)

Get Meter

Number

Check Pressure

Flush Line

Check & Leak

Unlock Only and Read (Do Not Turn On)

Special Instructions Check gas meter and read

Work Done:

Flushed: Yes No

GPM: _____

How Long: _____

Water Logs: _____

Water Leak: Yes No

GPM: _____

How Long: _____

Water Logs: _____

Parts Used to Complete Job:


Comments: Meter is working

Time Started: _____ Time Ended: _____

Customer signature/ date


Equal Opportunity Employer and Service Provider

The employees of Drakesboro are not trained in the use of firearms and the city can not be held liable.

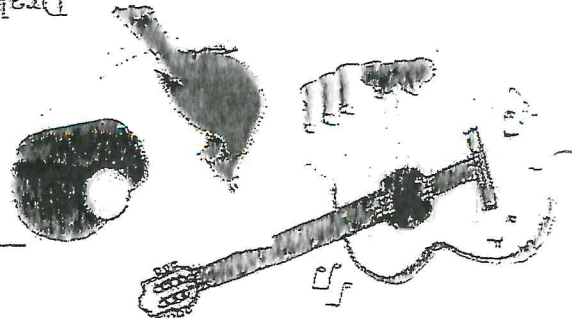

COMPLETED
2-3-23

P.O. Box 129 - Mose Rager Blvd. - Drakesboro, KY 42337
270-476-8986
(888) 662-2406 (Voice/TTY); (866) 557-5762 (Spanish)

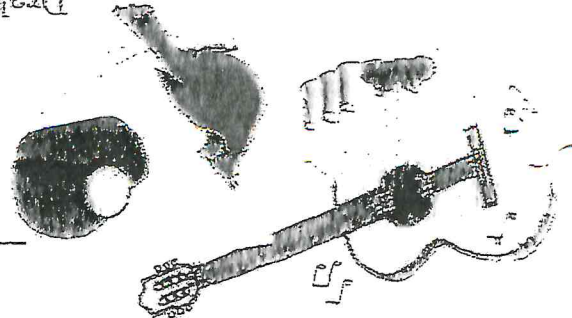

Drakesboro Work Order

Work Order #:

Date: 2-3-2023

Time:

Gas Water WW

Mobile Number: 270-885-8166

Name: Harold Riley II

Address: 580 Hwy 431 N Drakesboro, Ky 42337

Work to be Done:

New Meter# 20F246376

New Reading 0086

Turn on & Read

Old Reading

Read and Lock

Set Meter and Lock

Reading Only

Locate Line

Read and Lock (Nonpayment)

Get Meter

Number

Check Pressure

Flush Line

Check & Leak

Unlock Only and Read (Do Not Turn On)

Special Instructions

Work Done:

Flushed: Yes No GPM: _____

How Long: _____

Water Logs: _____

Water Leak: Yes No GPM: _____

How Long: _____

Water Logs: _____

Parts Used to Complete Job:

Comments: Meter read for change of ownership

Time Started: _____ Time Ended: _____
Date Completed: 2-3-2023

Customer Signature: _____

date: _____

Equal Opportunity Employer and Service Provider

The employees of Drakesboro are not unionized and the City can not be held liable for lighting of bills and a contract.

COMPLETED BY (see below) 2-3-2023

Odorizer Fill Report-704



City/Company:

Location of Odorizer:

Date:

Make of Odorizer: Tank Size (Gal):

Leaks Noted or Repaired:

Accuracy and Function of Gauge:

Maintenance Activities Performed:

Previous Reading on Gauge:

Current Reading on Gauge:

Total Odorant Used:

Type of Odorant Used:

Remarks:

Signature:

ODOR-FADE WARNING

A GAS LEAK CAN CAUSE A FIRE OR EXPLOSION RESULTING IN SERIOUS INJURY OR DEATH

Be aware that the stenching chemical added to gas to make it detectable may not warn of a gas leak or the presence of natural gas to all persons in every instance.


- Instances where the odorant in an odorized gas may be undetectable include:
- Odor intensity may fade or be eliminated for a variety of chemical and physical causes, including the oxidation of rusting pipes, absorption into or sticking onto the interior of pipes or appliances, or absorption into liquids.
 - Contact with soil in underground leaks may de-odorize or remove odorant from the gas
 - Some people have a diminished ability or inability to smell the stench. Factors that negatively affect a person's sense of smell include age, gender, medical conditions, and alcohol/tobacco usage.
 - The stench of odorized gas may not awaken sleeping persons
 - Other odors may mask or hide the stench
 - Exposure to the odor for even a short period of time, may cause nasal fatigue, where a person can no longer smell the stench.

Gas detectors listed by the Underwriters Laboratories (UL) can be used as an extra measure of safety for detecting gas leaks, especially under conditions where the odorant alone may not provide an adequate warning. Gas detectors emit a loud, shrill sound when gas is present and do not depend on sense of smell. Because the odor intensity can fade or people may have problems with their sense of smell, we recommend installing, per manufacturer's instructions, one or more combustible gas detectors, in suitable locations to ensure adequate coverage to detect gas leaks.

Educate yourself, your employees, and your customers with the content of this warning and other important facts associated with the so-called "odor-fade phenomenon."

CITY OF DRAKESBORO

P.O. Box 129 - Mose Rager Blvd. - Drakesboro, KY 42337
270-476-8986
(888) 662-2406 (Voice/TTY); (866) 557-5752 (Spanish)

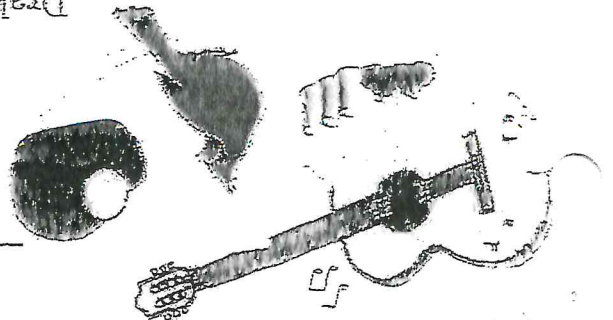

Drakesboro Work Order
Work Order #:
Date: 2-6-2023 Time: 10:15 (Gas) Water WW Acct #:
Name: Drakesboro Natural Gas Mobile Number:
Address: Horseshoe Loop regulator station

Work to be Done:

New Meter# _____
Turn on & Read _____
Old Reading _____
BY: RS DATE: 2-6-2023

Read and Lock _____
Set Meter and Lock _____
Locate Line (See Below) _____
Read and Lock (Nonpayment) _____
Get Meter _____
Number _____

Check Pressure _____
Flush Line _____
Check & Leak _____

Unlock Only and Read (Do Not Turn On) _____

Special Instructions _____

Work Done:

Flushed: Yes No GPM: _____ How Long: _____ Water Logs: _____
Water Leak: Yes No GPM: _____ How Long: _____ Water Logs: _____

Parts Used to Complete Job:

Comments: Odorant delivered and filled odorant level 4.5
pounds filled to 9.0 pounds

Technician: B. Allard Date Completed: 2-6-2023

Time Started: _____

Time Ended: _____

Customer signature: _____


date: _____

The employees of Drakesboro are not treated as employees and the City can not be held liable.

Equal Opportunity Employer and Service Provider

CITY OF DRAKESBORO

P.O. Box 129 • Moose Rager Blvd. • Drakesboro, KY 42337
270-476-8986
(888) 662-2406 (Voice/TTY); (866) 557-5762 (Español)

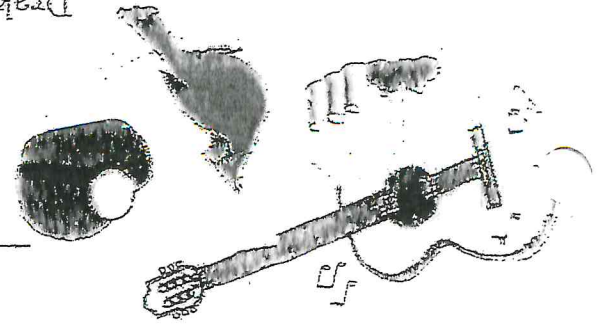

Drakesboro Work Order

Work Order #: _____
Date: 8-7-23 Time: 11:30am ~~Water~~ Gas
Name: Crystal Bolen Mobile Number: 870-543-2187
Address: 57 Dittney Hill Rd

Work to be Done:

New Meter# 20F240379 New Reading RT 2-9-23

COMPLETED

Turn on & Read _____ Old Reading _____

Read and Lock _____ Set Meter and Lock _____

Reading Only 0078 Locate Line _____ (See Below)

Read and Lock (Nonpayment) _____ Get Meter _____

Check Pressure _____ Flush Line _____

Unlock Only and Read (Do Not Turn On) _____

Special Instructions: Wants gas + water turned off.

Have not moved in yet but there are reads on the meters

Work Done:

Flushed: Yes No GPM: _____ How Long: _____ Water Logs: _____

Water Leak: Yes No GPM: _____ How Long: _____ Water Logs: _____

Parts Used to Complete Job:

Comments: Meter turned off per customer

From signature of: BAC BT Date completed: 2-9-23

Time Started: _____

Time Ended: _____

Customer signature: _____

date: _____


The employees of Drakesboro are not warranting the accuracy and the city can make no warranty.

Equal Opportunity Employer and Service Provider

CITY OF DRAKESBORO

P.O. Box 129 • Mose Rager Blvd. • Drakesboro, KY 42337
270-476-8986
(888) 662-2406 (Voice/TTY); (866) 557-5752 (Español)

11:00 am
Monday

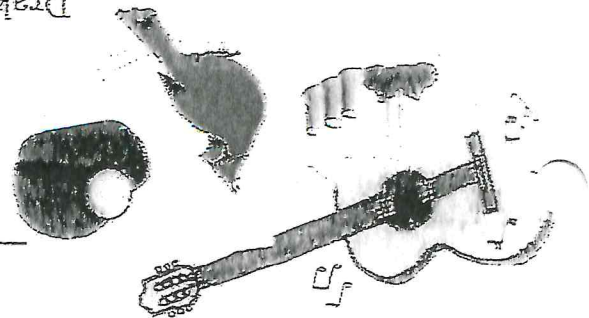

Drakesboro Work Order

Work Order #:

Date: 2-7-23 Time: 9:17 am (Gas) Water WW Acct #:

Name: Tyler/Kevin Bradford Mobile Number: 270-696-3871

Address: 301 Deer Park Dr. Beechmont

Work to be Done:

New Meter# _____

Turn on & Read _____

Read and Lock _____

Reading Only _____

Read and Lock (Nonpayment) _____

Get Meter _____

Check Pressure _____

Flush Line _____

Check & Leak _____

Unlock Only and Read (Do Not Turn On) _____

Special Instructions

Set up time and day to check gas.
Wondering if gas work was being done because
fire place goes out & relits

Work Done:

Flushed: Yes No GPM: _____ How Long: _____ Water Logs: _____

Water Leak: Yes No GPM: _____ How Long: _____ Water Logs: _____

Parts Used to Complete Job:

Comments: Customer said all appliances are working properly

now

Work performed by: R. Jones Date Completed: 2-13-2023

Time Started: _____ Time Ended: _____


Customer signature: _____ date: _____

The employees of Drakesboro are not bonded. If you are not bonded, please advise the city can advise you later.

Equal Opportunity Employer and Service Provider

CITY OF DRAKESBORO

P.O. Box 129 • Mose Kager Blvd. • Drakesboro, KY 42337
270-476-8986
(888) 662-2406 (Voice/TTY); (866) 557-5752 (Español)

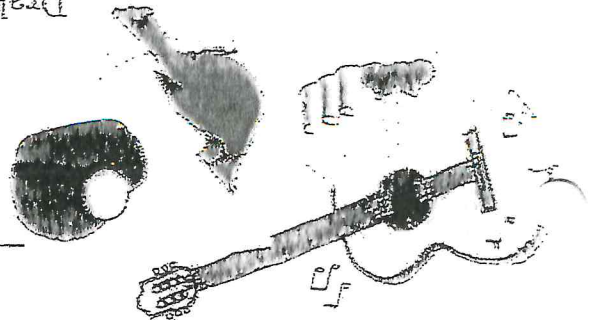

Drakesboro Work Order

Date: 2-13-23 Time: 2:20pm (Gas) Water WW Acct #: 0010-17558-001

Name: Kimberly Landrum Mobile Number: 270-754-7123

Address: 890 Beech Creek Browder Rd

Work to be Done:

New Meter# 486276

Turn on & Read

Read and Lock

Reading Only 3679

Read and Lock (Nonpayment)

Get Meter

Flush Line

Check Pressure

Unlock Only and Read (Do Not Turn On)

Special Instructions: Wants gas to be turned off

Work Done:

Flushed: Yes No GPM: _____ How Long: _____ Water Logs: _____

Water Leak: Yes No GPM: _____ How Long: _____ Water Logs: _____

Parts Used to Complete Job:

Comments: Gas turned off and locked

Work performed by: B. Jones Date Completed: 2-14-23

Time Started: _____ Time Ended: _____


Customer Signature: _____

Date: _____

Equal Opportunity Employer and Service Provider

The employees of the City of Drakesboro are not bonded and the City can not be held liable for any damage or injury caused by the employees of the City of Drakesboro.

P.O. Box 129 • Mose Kager Blvd. • Drakesboro, KY 42337
270-476-8986
(888) 662-2406 (Voice/TTY); (866) 557-5752 (Español)

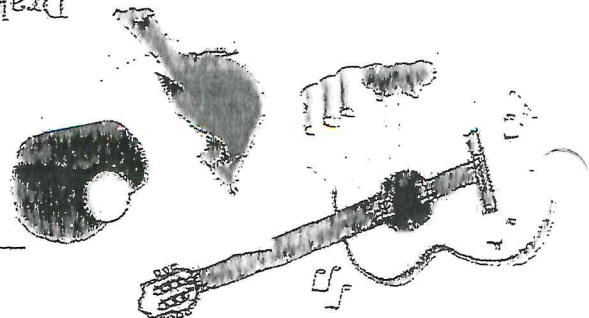

Drakesboro Work Order

Work Order #:

Date: 8-30-23 Time: 8:40am (Gas) Water WW Acct #

Name: Anna Groves Mobile Number: 270-830-5951

Address: 500 Leslie Smith St

Work to be Done:

New Meter#

Turn on & Read Old Reading

Read and Lock Set Meter and Lock

Reading Only Locate Line (See Below)

Read and Lock (Nonpayment) Get Meter

Number

Check Pressure

Flush Line

Check & Leak

Unlock Only and Read (Do Not Turn On)

Special Instructions Smells gas in her room, wants gas test done

Work Done:

Flushed: Yes No

GPM: _____

How Long: _____

Water Logs: _____

Parts Used to Complete Job:

Water Leak Yes No

GPM: _____

How Long: _____

Water Logs: _____

Comments: Used Cg; in residence no gas smell gas is capped off at feed side of meter is not connected to residence

BA4 R5

Date Completed: 8-20-2023

Time Started:

Time Ended:

Customer Signature:

Date:

The employees of Drakesboro are not employed by a contractor and the city can not be held liable.

Equal Opportunity Employer and Service Provider