

CITY OF DRAKESBORO

P.O. Box 129 • Mose Rager Blvd. • Drakesboro, KY 42337
270-476-8984
(888) 662-2406 (Voice/TTY); (866) 557-5762 (Español)

Drakesboro Work Order

Work Order #: _____

Date: 2-28-23 Time: 2:14pm Gas Water WW Acct #: 0010-17558-001

Name: Kimberly Handrum Mobile Number: 270-754-7123

Address: 890 Beech Creek Browder Rd

Work to be Done:

New Meter# 486286 New Reading 3679
 Turn on & Read _____ Old Reading _____
 Read and Lock _____ Set Meter and Lock _____
 Reading Only _____ Locate Line _____ (See Below)
 Read and Lock (Nonpayment) _____ Get Meter _____
 Number _____
 Check Pressure _____ Flush Line _____ Check & Leak _____
 Unlock Only and Read (Do Not Turn On) _____
 Special Instructions Pl. Turn off & read

COMPLETED
By: B. Jones Date: 3-1-23

Work Done:

Flushed: Yes No GPM: _____ How Long: _____ Water Logs: _____
 Water Leak: Yes No GPM: _____ How Long: _____ Water Logs: _____

Parts Used to Complete Job:

Comments: Needs a final reading to close out account, doesn't live there anymore. meter turned off and locked out


Work Completed by: BA & BJ Date Completed: 3-1-2023

Time Started: _____ Time Ended: _____

Customer signature _____ date _____

Equal Opportunity Employer and Service Provider

The employees of Drakesboro are not trained in the use of power tools. Lighting of pipes are a violation and the City can not be held liable.

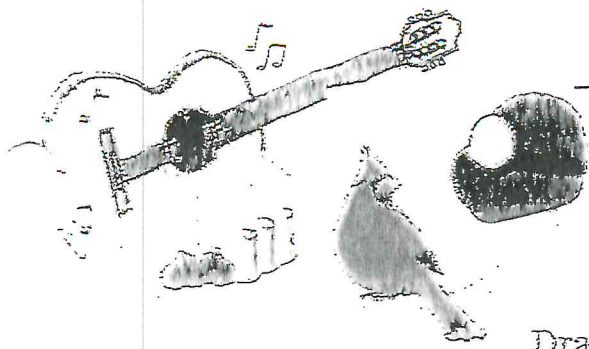

CITY OF DRAKESBORO

P.O. Box 129 • Mose Rager Blvd. • Drakesboro, KY 42337
270-476-8984
(888) 662-2406 (Voice/TTY); (866) 557-5762 (Español)

Drakesboro Work Order

Work Order #: _____

Date: 2-28-23 Time: 2:14pm Gas Water WW Acct #: 0080-26550-004

Name: Hori Stinson Mobile Number: 270-225-7434

Address: 271 Hazel Creek Rd

Work to be Done:

COMPLETE!
By: B. Jones Date: 3-1-23

New Meter# 485840 New Reading 4868

Turn on & Read _____ Old Reading _____

Read and Lock _____ Set Meter and Lock _____

Reading Only _____ Locate Line (See Below)

Read and Lock (Nonpayment) _____ Get Meter
Number _____

Check Pressure _____ Flush Line _____ Check & Leak _____

Unlock Only and Read (Do Not Turn On) _____

Special Instructions Read only

Work Done:

Flushed: Yes No GPM: _____ How Long: _____ Water Logs: _____

Water Leak: Yes No GPM: _____ How Long: _____ Water Logs: _____

Parts Used to Complete Job:

Comments: Needs final reading to be put ~~on~~ account in
Kim Handrum's name. Meter turned off and
locked out

Work Completed by: BA & BJ Date Completed: 3-1-2023

Time Started: _____ Time Ended: _____

Customer signature _____ date _____

Equal Opportunity Employer and Service Provider

The employees of Drakesboro are not unionized. The lighting of pipes are a condition and the City can not be held liable.

HAS BEEN IN FLUKIDA
MOST OF THE MONTH.
SHUTS ON THERMOSTAT
OFF.

CITY OF DRAKESBORO

P.O. Box 129 • Mose Rager Blvd. • Drakesboro, KY 42337
270-476-8986
(888) 662-2406 (Voice/TTY); (866) 557-5762 (Español)

COMPLETED

By: B. Jones Date: 3-3-2023

* CAN BEFORE YOU GO SO
HE CAN BE THERE

Drakesboro Work Order

Work Order #: _____

Date: 3/2/2023 Time: 3:00 Gas Water WW Acct #: 0030-37300-004

Name: LANCE MILLER Mobile Number: 904-887-1165

Address: 931 MERLE TRAVIS HWY

Work to be Done:

New Meter# 20P 246371 New Reading 0122

Turn on & Read _____ Old Reading 114

Read and Lock _____ Set Meter and Lock

Reading Only _____ Locate Line (See Below)

Read and Lock (Nonpayment) _____ Get Meter
Number _____

Check Pressure _____ Flush Line _____ Check & Leak _____

Unlock Only and Read (Do Not Turn On) _____

Special Instructions High gas bill

Work Done:

Flushed: Yes No GPM: _____ How Long: _____ Water Logs: _____

Water Leak: Yes No GPM: _____ How Long: _____ Water Logs: _____

Parts Used to Complete Job: _____

Comments: Customer advised bill was high no leaks found
on meter or in residence


Work Completed By: BA + BJ Date Completed: 3-3-2023

Time Started: _____ Time Ended: _____

Customer signature: _____ date _____

Equal Opportunity Employer and Service Provider

The employees of Drakesboro are not trained in the use of
Lighting of pipes are a courtesy
and the City can not be held liable.

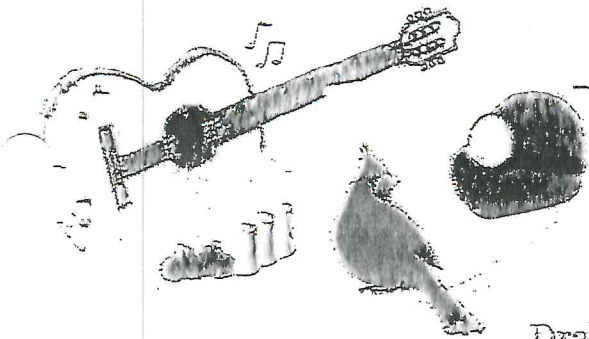

CITY OF DRAKESBORO

P.O. Box 129 • Mose Rager Blvd. • Drakesboro, KY 42337
270-476-8986
(888) 662-2406 (Voice/TTY); (866) 557-5762 (Español)

Drakesboro Work Order

Work Order #: _____

Date: 3/6/2023 Time: 8:09 Gas Water WW Acct #: 0050-7760-004

Name: ADAM & MELISSA ALVERSON Mobile Number: 270-543-2573

Address: 461 HWY 70 E

Work to be Done:

New Meter# 485859 New Reading 2198

Turn on & Read _____ Old Reading 2/1/23 - 2/15/23 2127

Read and Lock _____ Set Meter and Lock

Reading Only _____ Locate Line (See Below) BY B. Jones DATE 3-6-23

Read and Lock (Nonpayment) _____ Get Meter Number _____

Check Pressure _____ Flush Line _____ Check & Leak _____

Unlock Only and Read (Do Not Turn On) _____

Special Instructions High bill check meter reading

Work Done:

Flushed: Yes No GPM: _____ How Long: _____ Water Logs: _____

Water Leak: Yes No GPM: _____ How Long: _____ Water Logs: _____

Parts Used to Complete Job: _____

Comments: Read gas meter, meter not spinning


Work Completed By: BA & BJ Date Completed: 3-6-2023

Time Started: _____ Time Ended: _____

Customer signature: _____ date: _____

Equal Opportunity Employer and Service Provider

The employees of Drakesboro are not trained in the use of firearms. Lighting of pipes is a courtesy and the City can not be held liable.

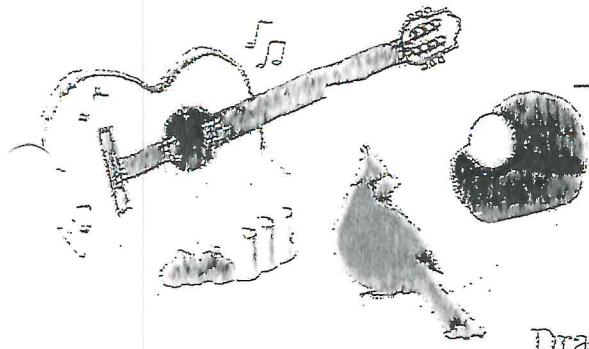

CITY OF DRAKESBORO

P.O. Box 129 • Mose Rager Blvd. • Drakesboro, KY 42337
270-476-8986
(888) 662-2406 (Voice/TTY); (866) 557-5762 (Español)

COMPLETED
By: B. Toles Date: 3/9/23

Drakesboro Work Order

Work Order #: _____

Date: 3-7-23 Time: 3:00pm (Gas) Water WW Acct #: 6010-11770-001

Name: Church of Jesus Christ Mobile Number: 270-820-5952

Address: _____

Work to be Done:

New Meter# 486048 New Reading 6959
 Turn on & Read _____ Old Reading 6959
 Read and Lock _____ Set Meter and Lock _____
 Reading Only _____ Locate Line (See Below) _____
 Read and Lock (Nonpayment) _____ Get Meter _____
 Number _____
 Check Pressure _____ Flush Line _____ Check & Leak _____
 Unlock Only and Read (Do Not Turn On) _____
 Special Instructions _____

Work Done:

Flushed: Yes No GPM: _____ How Long: _____ Water Logs: _____
 Water Leak: Yes No GPM: _____ How Long: _____ Water Logs: _____

Parts Used to Complete Job: _____

Comments: Wants gas turned off
Gas service turned off

Work Completed by: BA & BJ Date Completed: 3-9-2023

Time Started: _____ Time Ended: _____

Customer signature _____ date _____

Equal Opportunity Employer and Service Provider

The employees of Drakesboro are not bonded. If you have any questions or concerns, please call the City Office and the City can help you.

CITY OF DRAKESBORO

P.O. Box 129 • Mose Rager Blvd. • Drakesboro, KY 42337
270-476-8986
(888) 662-2406 (Voice/TTY); (866) 557-5762 (Español)

COMPLETED

By: B. Jones Date: 3/8/23

RECHECK

Drakesboro Work Order

Work Order #: _____

Date: 3/8/23

Time: 9:35

Gas

Water WW

Acct #: 0020-26400-001

Name: DARRELL FLEMING

Mobile Number: 270-602-7042

Address: 3091 MERLE TRAVIS HWY

Work to be Done:

New Meter# 486114

New Reading 7374

Turn on & Read _____

Old Reading 7346 on 2/15

Read and Lock _____

Set Meter and Lock

Reading Only _____

Locate Line

(See Below)

Read and Lock (Nonpayment) _____

Get Meter

Number _____

Check Pressure _____

Flush Line _____

Check & Leak _____

Unlock Only and Read (Do Not Turn On) _____

Special Instructions _____

Work Done:

Flushed: Yes No

GPM: _____

How Long: _____

Water Logs: _____

Water Leak: Yes No

GPM: _____

How Long: _____

Water Logs: _____

Parts Used to Complete Job: _____

Comments: Checked meter read, shut off all gas appliances performed meter bar test no leaks found lit all gas appliances back

Work completed by: BA & BJ

Date Completed: 3-8-2023

Time Started: _____

Time Ended: _____

Customer signature _____

date _____

Equal Opportunity Employer and Service Provider

The employees of Drakesboro are not unionized. Lightbulbs are a public utility and the city can not be held liable.

CITY OF DRAKESBORO

P.O. Box 129 • Mose Rager Blvd. • Drakesboro, KY 42337
270-476-8986
(888) 662-2406 (Voice/TTY); (866) 557-5762 (Español)

BY B. Jones DATE 3-16-2023

Drakesboro Work Order Work Order #: _____

Date: 3-15-23 Time: _____ (Gas) Water WW Acct #: 0040-50930-004
Name: Leigha Warner Mobile Number: _____
Address: 215 Broad Street

Work to be Done:

New Meter# 20744157 New Reading _____
Turn on & Read _____ Old Reading 1199
Read and Lock 1199 Set Meter and Lock _____
Reading Only _____ Locate Line (See Below) _____
Read and Lock (Nonpayment) _____ Get Meter _____
Number _____
Check Pressure _____ Flush Line _____ Check & Leak _____
Unlock Only and Read (Do Not Turn On) _____

Special Instructions Turn off Due to Non-payment.
Talk to owner & she said that was fine she would have
it turned back on before it got cold.

Work Done:

Flushed: Yes No GPM: _____ How Long: _____ Water Logs: _____
Water Leak: Yes No GPM: _____ How Long: _____ Water Logs: _____

Parts Used to Complete Job: _____

Comments: Meter turned off and locked


Work completed by BA & BJ Date Completed: 3-16-2023

Time Started: _____ Time Ended: _____

Customer signature _____ date _____

Equal Opportunity Employer and Service Provider

The employees of Drakesboro are not bonded and the lighting of pipes are a concern and the city can not be responsible.

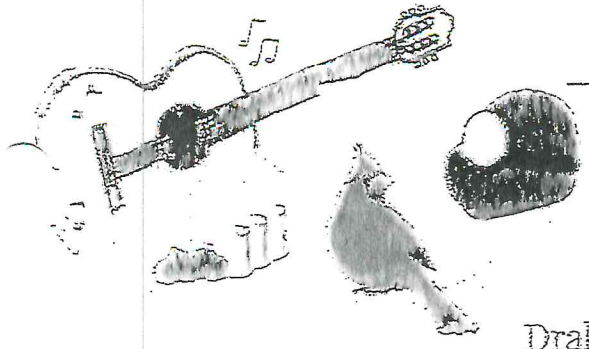

CITY OF DRAKESBORO

P.O. Box 129 - Mose Rager Blvd. - Drakesboro, KY 42337

270-476-8986

(888) 662-2406 (Voice/TTY); (866) 557-5752 (Español)

COMPLETED

By: B. Jones Date: 3/15/23

Drakesboro Work Order

Work Order #: _____

Date: 3-15-23 Time: _____ Gas Water WW Acct #: 0050-81400-001

Name: Elvie Rexlett Mobile Number: _____

Address: 108 Allen Rd.

Work to be Done:

New Meter# 19M215031 New Reading 0

Turn on & Read _____ Old Reading _____

Read and Lock _____ Set Meter and Lock _____

Reading Only _____ Locate Line (See Below) _____

Read and Lock (Nonpayment) _____ Get Meter _____
Number _____

Check Pressure _____ Flush Line _____ Check & Leak _____

Unlock Only and Read (Do Not Turn On) _____

Special Instructions Wants gas turned completely off,
have no use for it.

Work Done:

Flushed: Yes No GPM: _____ How Long: _____ Water Logs: _____

Water Leak: Yes No GPM: _____ How Long: _____ Water Logs: _____

Parts Used to Complete Job: _____

Comments: _____


Work Completed by: BA/BJ Date Completed: 3/15/23

Time Started: _____ Time Ended: _____

Customer signature: _____ date _____

Equal Opportunity Employer and Service Provider

The employees of the city are not vaccinated. If you are a customer and the city can not be vaccinated, the city can not be vaccinated.

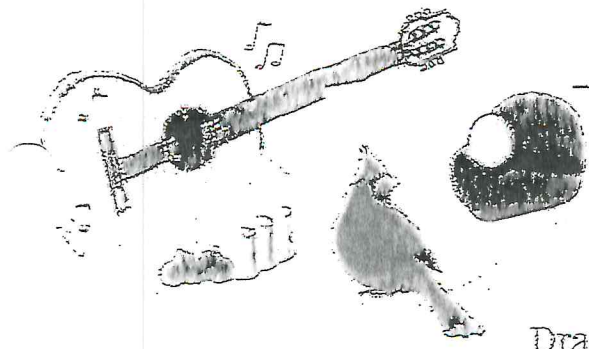

CITY OF DRAKESBORO

P.O. Box 129 • Mose Rager Blvd. • Drakesboro, KY 42337
270-476-8986
(888) 662-2406 (Voice/TTY); (866) 557-5762 (Español)

COMPLETED
BY B. Jones DATE 3-17-23

Drakesboro Work Order Work Order #: _____

Date: 3-17-23 Time: 3:25pm Gas Water WW Acct #: 0010-11600-
Name: Johnny Ashley Mobile Number: 270-820-6736
Address: 1569 Hwy 431 S

Work to be Done:

New Meter# 21976878 New Reading _____
Turn on & Read _____ Old Reading _____
Read and Lock 2274 Set Meter and Lock _____
Reading Only _____ Locate Line (See Below) _____
Read and Lock (Nonpayment) _____ Get Meter _____
Number _____
Check Pressure _____ Flush Line _____ Check & Leak _____
Unlock Only and Read (Do Not Turn On) _____
Special Instructions Wants gas turned off, just moved.

Work Done:

Flushed: Yes No GPM: _____ How Long: _____ Water Logs: _____
Water Leak: Yes No GPM: _____ How Long: _____ Water Logs: _____

Parts Used to Complete Job: _____

Comments: Gas meter turned off

Work Completed by: BA + BJ Date Completed: 3-17-2023

Time Started: _____ Time Ended: _____

Customer signature _____ date _____

Equal Opportunity Employer and Service Provider

The employees of Drakesboro are not trained in the use of firearms. Lighting of pipes are a violation and the City can not be held liable.

CITY OF DRAKESBORO

P.O. Box 129 • Mose Rager Blvd. • Drakesboro, KY 42337
270-476-8986

(888) 662-2406 (Voice/TTY); (866) 557-5762 (Español)

COMPLETED

By: B. Jones Date: 3-30-2023

Drakesboro Work Order

Work Order #: _____

Date: 3-13-23 Time: 3:00pm Gas Water WW Acct #: 0050-83075-002

Name: Lasandra Dulin / Spirit of peace Mobile Number: 502-491-4254

Address: 4239 Riverside Rd

Work to be Done:

New Meter# 19013970 New Reading 1015

Turn on & Read _____ Old Reading _____

Read and Lock _____ Set Meter and Lock _____

Reading Only _____ Locate Line (See Below)

Read and Lock (Nonpayment) _____ Get Meter
Number _____

Check Pressure _____ Flush Line _____ Check & Leak _____

Unlock Only and Read (Do Not Turn On) _____

Special Instructions _____

Work Done:

Flushed: Yes No GPM: _____ How Long: _____ Water Logs: _____

Water Leak: Yes No GPM: _____ How Long: _____ Water Logs: _____

Parts Used to Complete Job: _____

Comments: Needs to be pressure tested, turn on
and read. pressure test & meter bar test performed
no leaks gas service turned on


Work Completed By: BA & BJ Date Completed: 3-30-2023

Time Started: _____ Time Ended: _____

Customer signature _____ date _____

Equal Opportunity Employer and Service Provider

The employees of Drakesboro are not trained HVAC personnel. Lighting of pilots are a courtesy and the City can not be held liable.

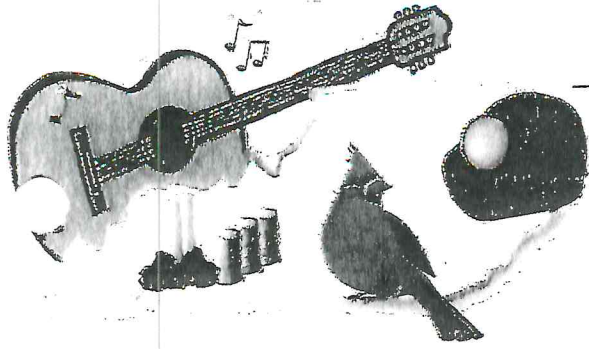

CITY OF DRAKESBORO

P.O. Box 129 • Mose Rager Blvd. • Drakesboro, KY 42337
270-476-8986
(888)662-2406 (Voice/TTY); (866)577-5762 (Español)

Date 3-30-2023

Time _____

Pressure Test for Gas Line

Plumber Information:

License # _____ Phone # _____
Name: _____
Address: _____

Meter read at time of Pressure Test 10/5

Customer: Lesandra Dulin

Pressure Tested for 10 minutes.

Address: 4239 Riverside Rd.

At 20 lbs of Pressure.

Signature of Licensed Plumber

Signature of City of Drakesboro gas Employee and Russmar Representative

CITY OF DRAKESBORO

P.O. Box 129 • Mose Rager Blvd. • Drakesboro, KY 42337
270-476-8986
(888) 662-2406 (Voice/TTY); (866) 557-5762 (Español)

COMPLETED

By: B. Jones Date: 3-31-23

Drakesboro Work Order

Work Order #: _____

Date: 3/31/2023 Time: 11:30 Gas Water WW Acct #: 0020-21700-001

Name: RUDY CUNDIFF Mobile Number: _____

Address: 242 BEECHCREEK RD

Work to be Done:

New Meter# 20P246366 New Reading 0

Turn on & Read _____ Old Reading _____

Read and Lock _____ Set Meter and Lock _____

Reading Only _____ Locate Line (See Below)

Read and Lock (Nonpayment) _____ Get Meter
Number _____

Check Pressure _____ Flush Line _____ Check & Leak _____

Unlock Only and Read (Do Not Turn On) _____

Special Instructions _____

NEED READING FOR BILL

Work Done:

Flushed: Yes No GPM: _____ How Long: _____ Water Logs: _____

Water Leak: Yes No GPM: _____ How Long: _____ Water Logs: _____

Parts Used to Complete Job: _____

Comments: _____


Work Completed By: B. Jones Date Completed: 3-31-2023

Time Started: _____ Time Ended: _____

Customer signature _____ date _____

Equal Opportunity Employer and Service Provider

The employees of Drakesboro are not trained as plumbers. Lighting of pilots are a customer and the City can not be responsible.

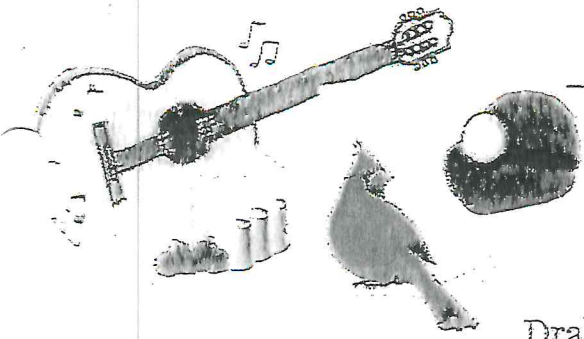

CITY OF DRAKESBORO

P.O. Box 129 • Mose Rager Blvd. • Drakesboro, KY 42337
270-476-8986
(888) 662-2406 (Voice/TTY); (866) 557-5762 (Español)

Drakesboro Work Order

Work Order #: _____

Date: 01/26/23 Time: 2:00 Gas Water WW Acct #: 0020-21700-001

Name: RUDY CUNDIFF Mobile Number: 270-543-6264

Address: 242 BEECHCREEK RD

Work to be Done:

New Meter# _____ New Reading _____
 Turn on & Read _____ Old Reading 9688 ON 04/08/2022
 Read and Lock _____ Set Meter and Lock
 Reading Only _____ Locate Line (See Below)
 Read and Lock (Nonpayment) _____ Get Meter
 Number _____
 Check Pressure _____ Flush Line _____ Check & Leak
 Unlock Only and Read (Do Not Turn On) _____

Special Instructions pressure test 2-1-23 01:32 failed
pressure test 2-3-23 10:39 failed

Work Done:

Flushed: Yes No GPM: _____ How Long: _____ Water Logs: _____
 Water Leak: Yes No GPM: _____ How Long: _____ Water Logs: _____

Parts Used to Complete Job:

Comments:

Work Completed By: _____ Date Completed: _____

Time Started: _____ Time Ended: _____

Customer signature: _____ date _____

Equal Opportunity Employer and Service Provider


The employees of Drakesboro are not trained in/AD propane. Lighting of pilots are a courtesy and the City can not be responsible.

CITY OF DRAKESBORO

P.O. Box 129 • Mose Rager Blvd. • Drakesboro, KY 42337

270-476-8986

(888)662-2406 (Voice/TTY): (866)577-5762 (Español)

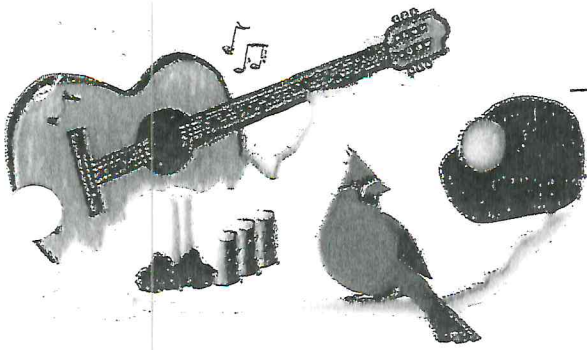

Date 2-9-2023

Time 12:54

Pressure Test for Gas Line

Plumber Information:

License # HMO 4615

Phone # 270-225-0884

Name: Hometown Heating & Cooling

Address: 1615 Hwy 431 South

Meter read at time of Pressure Test 0

Customer: Randy Cundiff

Pressure Tested for 10 minutes.

Address: 242 Beechcreek Rd.


At 20 lbs of Pressure.

A handwritten signature in black ink, appearing to read 'D. Cundiff', written over a horizontal line.

Signature of Licensed Plumber

A handwritten signature in black ink, appearing to read 'Brian', written over a horizontal line.

Signature of City of Drakesboro gas Employee and Russmar Representative

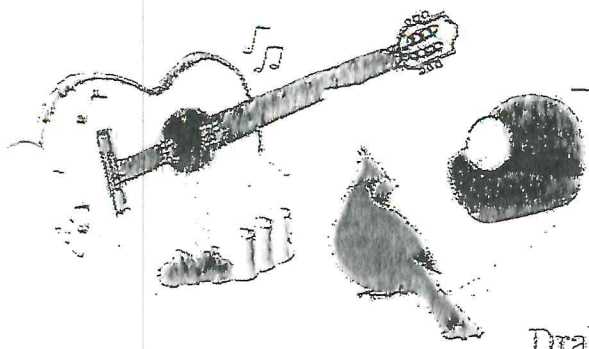

CITY OF DRAKESBORO

P.O. Box 129 • Mose Rager Blvd. • Drakesboro, KY 42337
270-476-8986
(888) 662-2406 (Voice/TTY); (866) 557-5762 (Español)

Drakesboro Work Order

Work Order #: _____

Date: 2/2/23 Time: 9:15 Gas Water WW Acct #: 0020-21700-001

Name: RUDY CUNDIFF Mobile Number: 270-543-6264

Address: 242 BEECHCREEK RD

Work to be Done: _____
New Meter# old meter - 3289034 old reading - 9689
new meter - 20A246366 new reading - 0

Turn on & Read _____ Old Reading 9688 ON 04/08/2022

Read and Lock _____ Set Meter and Lock

Reading Only _____ Locate Line (See Below)

Read and Lock (Nonpayment) _____ Get Meter
Number _____

Check Pressure _____ Flush Line _____ Check & Leak

Unlock Only and Read (Do Not Turn On) _____

Special Instructions lines had to be repaired by owner 2 times before
meter was installed and gas turned back on

Work Done:

Flushed: Yes No GPM: _____ How Long: _____ Water Logs: _____
Water Leak: Yes No GPM: _____ How Long: _____ Water Logs: _____

Parts Used to Complete Job: _____

Comments: Pressure test done by Hometown Heating & Cooling (2-9-2023)
installed new meter and piping unlocked valve turned gas
on / meter turned back off on 2-17-23 - 3:00 pm could not get

Work Completed By: BAJ BJ Date Completed: 2-17-2023 owner to answer phone

Time Started: _____ Time Ended: _____

Customer signature: _____ date: _____

Equal Opportunity Employer and Service Provider

The employees of Drakesboro are not trained PLIC personnel. Lighting of pilots are a courtesy and the City can not be held liable.