

# CITY OF DRAKESBORO

P.O. Box 129 • Mose Rager Blvd. • Drakesboro, KY 42337  
270-476-8986  
(888) 662-2406 (Voice/TTY); (866) 557-5762 (Español)

**COMPLETED**

By: B. Jones Date: 4-4-2023

Drakesboro Work Order

Work Order #: \_\_\_\_\_

Date: 4-4-23 Time: 9:23am Gas Water WW Acct #: 0030-49428-001

Name: Holiness Church Mobile Number: 270-820-7349

Address: On Big Springs Rd

Work to be Done:

New Meter# 486214 New Reading \_\_\_\_\_

Turn on & Read \_\_\_\_\_ Old Reading \_\_\_\_\_

Read and Lock \_\_\_\_\_ Set Meter and Lock \_\_\_\_\_

Reading Only 4664 Locate Line (See Below)

Read and Lock (Nonpayment) \_\_\_\_\_ Get Meter \_\_\_\_\_  
Number \_\_\_\_\_

Check Pressure \_\_\_\_\_ Flush Line \_\_\_\_\_ Check & Leak \_\_\_\_\_

Unlock Only and Read (Do Not Turn On) \_\_\_\_\_

Special Instructions Wants gas shut off

Work Done:

Flushed:  Yes  No GPM: \_\_\_\_\_ How Long: \_\_\_\_\_ Water Logs: \_\_\_\_\_

Water Leak:  Yes  No GPM: \_\_\_\_\_ How Long: \_\_\_\_\_ Water Logs: \_\_\_\_\_

Parts Used to Complete Job:

Comments: Meter turned off

Work Completed By: B. Jones Date Completed: 4-4-2023

Time Started: \_\_\_\_\_ Time Ended: \_\_\_\_\_

Customer's signature \_\_\_\_\_ date \_\_\_\_\_

*Equal Opportunity Employer and Service Provider*

The employees of Drakesboro are not authorized to accept payment for lighting of private accounts and the City can not be held liable.

# Meter Turn On and Turn Off Form - 1201

City/Company:

## Information

Turn On       Turn Off

Date:

Time:

Address:

Meter Number:


Meter Reading:

Reason for Turn Off/On?

Was the Meter Valve Locked?     Yes     No

Additional Remarks:

Completed By:

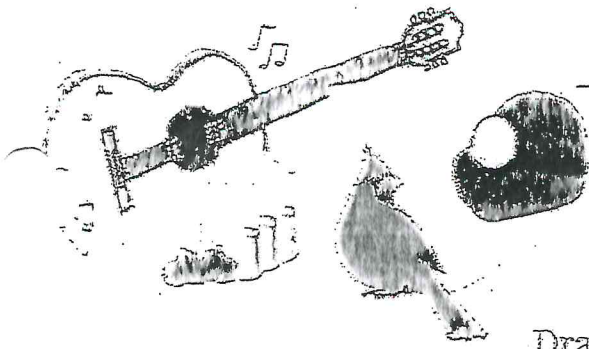

# CITY OF DRAKESBORO

P.O. Box 129 • Mose Rager Blvd. • Drakesboro, KY 42337  
270-476-8984  
(888) 662-2406 (Voice/TTY); (866) 557-5762 (Español)

**COMPLETED**

By: B. Jones Date: 4-6-23

## Drakesboro Work Order

Work Order #: \_\_\_\_\_

Date: 04/05/2023 Time: 1:27

Gas Water WW Acct #: 0020-21700-001

Name: RUDY CUNDIFF

Mobile Number: 270-543-6264

Address: 242 BEECHCREEK RD

### Work to be Done:

New Meter# 20P246366

New Reading 0

Turn on & Read \_\_\_\_\_

Old Reading \_\_\_\_\_

Read and Lock \_\_\_\_\_

Set Meter and Lock

Reading Only \_\_\_\_\_

Locate Line (See Below)

Read and Lock (Nonpayment) \_\_\_\_\_  
Number \_\_\_\_\_

Get Meter

Check Pressure \_\_\_\_\_

Flush Line \_\_\_\_\_

Check & Leak \_\_\_\_\_

Unlock Only and Read (Do Not Turn On) \_\_\_\_\_

Special Instructions \_\_\_\_\_

PULL METER

### Work Done:

Flushed:  Yes  No GPM: \_\_\_\_\_ How Long: \_\_\_\_\_ Water Logs: \_\_\_\_\_

Water Leak:  Yes  No GPM: \_\_\_\_\_ How Long: \_\_\_\_\_ Water Logs: \_\_\_\_\_

### Parts Used to Complete Job:

Comments: LOCKED METER / INSTAL BLOCK DISK

Work Completed By: BA/BS

Date Completed: 4/6/23

Time Started: \_\_\_\_\_

Time Ended: \_\_\_\_\_

Customer signature: \_\_\_\_\_ date: \_\_\_\_\_

Equal Opportunity Employer and Service Provider

The employees of Drakesboro are not bonded. All plumbing, lighting or other work done by the City can not be covered.

# Meter Turn On and Turn Off Form - 1201

City/Company:

## Information

Turn On       Turn Off

Date:

Time:

Address:

Meter Number:

Meter Reading:

Reason for Turn Off/On?

Was the Meter Valve Locked?     Yes     No

Additional Remarks:

Completed By:

# CITY OF DRAKESBORO

P.O. Box 129 - Mose Rager Blvd. - Drakesboro, KY 42337

270-476-8986

**COMPLETED**

(888) 662-2406 (Voice/TTY): (866) 557-5762 (Español)

By: B. Jones Date: 4-10-23

## Drakesboro Work Order

Work Order #: \_\_\_\_\_

Date: 4-10-23 Time: \_\_\_\_\_  Gas  Water  WW Acct #: 0030-49430-004

Name: Kevin Willoughby Mobile Number: 270-731-9014

Address: 130 Big Springs Rd.

### Work to be Done:

New Meter# 485827 New Reading 3754

Turn on & Read \_\_\_\_\_ Old Reading \_\_\_\_\_

Read and Lock \_\_\_\_\_ Set Meter and Lock \_\_\_\_\_

Reading Only \_\_\_\_\_ Locate Line (See Below)

Read and Lock (Nonpayment) \_\_\_\_\_ Get Meter \_\_\_\_\_

Number \_\_\_\_\_

Check Pressure \_\_\_\_\_ Flush Line \_\_\_\_\_ Check & Leak \_\_\_\_\_

Unlock Only and Read (Do Not Turn On) \_\_\_\_\_

Special Instructions Wants gas turned on. Needs to be pressure tested first.

### Work Done:

Flushed:  Yes  No GPM: \_\_\_\_\_ How Long: \_\_\_\_\_ Water Logs: \_\_\_\_\_

Water Leak:  Yes  No GPM: \_\_\_\_\_ How Long: \_\_\_\_\_ Water Logs: \_\_\_\_\_

Parts Used to Complete Job: \_\_\_\_\_

Comments: Pressure test after new piping installed, passed 1/2 hot water heater and stove

Work completed by: BA4 BT Date Completed: 4-10-23

Time Started: \_\_\_\_\_ Time Ended: \_\_\_\_\_


Customer signature: \_\_\_\_\_ date: \_\_\_\_\_

Equal Opportunity Employer and Service Provider

The employees of Drakesboro are not trained in the use of power tools. Lighting of poles are a specialty and the City can provide poles.

# CITY OF DRAKESBORO

P.O. Box 129 • Mose Rager Blvd. • Drakesboro, KY 42337  
270-476-8986  
(888)662-2406 (Voice/TTY): (866)577-5762 (Español)

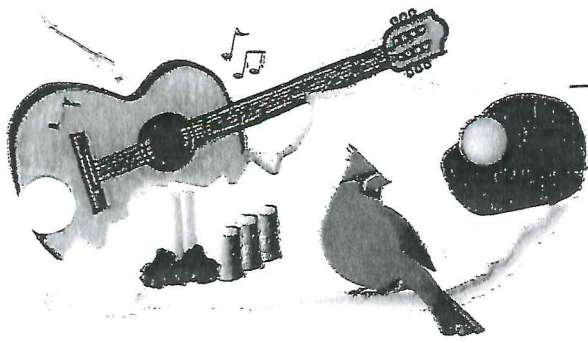

Date 4-10-23

Time 03:30

## Pressure Test for Gas Line

### Plumber Information:

License # \_\_\_\_\_

Phone # \_\_\_\_\_

Name: \_\_\_\_\_

Address: \_\_\_\_\_  
\_\_\_\_\_

Meter read at time of Pressure Test 3754

Pressure Tested for 10 minutes.

At 20 lbs of Pressure.


Customer: Kevin Willoughby

Address: 130 Big Springs

Drakesboro Ky 42337

\_\_\_\_\_  
Signature of Licensed Plumber

\_\_\_\_\_  
Signature of City of Drakesboro gas Employee and Russmar Representative

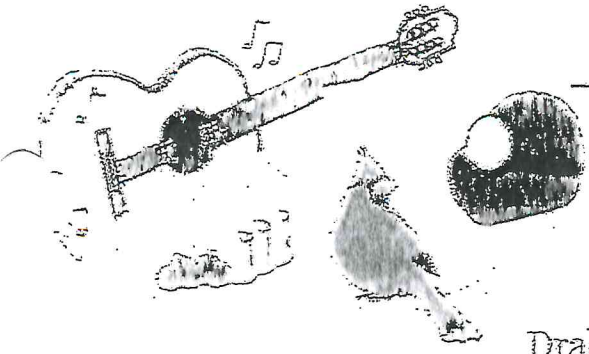

# CITY OF DRAKESBORO

P.O. Box 129 • Mose Rager Blvd. • Drakesboro, KY 42337  
270-476-8984  
(888) 662-2406 (Voice/TTY); (866) 557-5752 (Español)

COMPLETED  
By: B. James Date: 4-10-23

## Drakesboro Work Order

Date: 4-10-23 Time: \_\_\_\_\_ Gas Water WW Acct #: 0030 - 43300 - 001  
Name: Drakesboro Methodist P. Mobile Number: 270-820-5263  
Address: 203 Mose Rager Blvd

### Work to be Done:

New Meter# 486224 New Reading \_\_\_\_\_  
Turn on & Read \_\_\_\_\_ Old Reading \_\_\_\_\_  
Read and Lock \_\_\_\_\_ Set Meter and Lock \_\_\_\_\_  
Reading Only 8171 Locate Line (See Below) \_\_\_\_\_  
Read and Lock (Nonpayment) \_\_\_\_\_ Get Meter \_\_\_\_\_  
Number \_\_\_\_\_  
Check Pressure \_\_\_\_\_ Flush Line \_\_\_\_\_ Check & Leak \_\_\_\_\_  
Unlock Only and Read (Do Not Turn On) \_\_\_\_\_  
Special Instructions wants current reading on gas

### Work Done:

Flushed:  Yes  No GPM: \_\_\_\_\_ How Long: \_\_\_\_\_ Water Logs: \_\_\_\_\_  
Water Leak:  Yes  No GPM: \_\_\_\_\_ How Long: \_\_\_\_\_ Water Logs: \_\_\_\_\_

### Parts Used to Complete Job:

\_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_

### Comments: Meter read


Work Completed By: BA + BJ Date Completed: 4-10-23

Time Started: \_\_\_\_\_ Time Ended: \_\_\_\_\_

Customer signature \_\_\_\_\_ date \_\_\_\_\_

Equal Opportunity Employer and Service Provider

The employees of Drakesboro are not trained in the use of firearms. Lighting of pipe are a violation and the City can not be held liable.

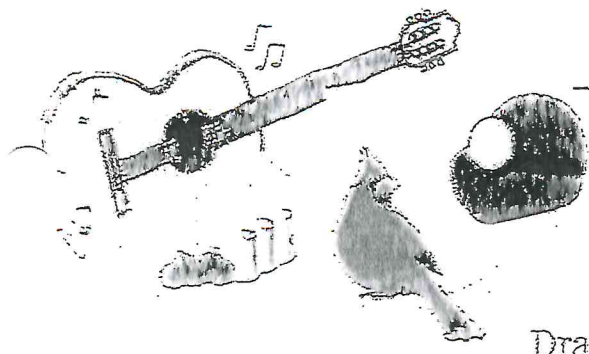

# CITY OF DRAKESBORO

P.O. Box 129 • Mose Rager Blvd. • Drakesboro, KY 42337  
270-476-8986  
(888) 662-2406 (Voice/TTY); (866) 557-5762 (Español)

COMPLETED  
By B. Jones Date 4-10-23

## Drakesboro Work Order Work Order #: \_\_\_\_\_

Date: 4-10-23 Time: \_\_\_\_\_ Gas Water WW Acct #: 50-83990-1  
Name: Kara Saye Mobile Number: 270-225-0618  
Address: 6548 St. Rt. 70 East

### Work to be Done:

- New Meter# 215173 \_\_\_\_\_ New Reading \_\_\_\_\_
- Turn on & Read \_\_\_\_\_ Old Reading \_\_\_\_\_
- Read and Lock 688 \_\_\_\_\_ Set Meter and Lock \_\_\_\_\_
- Reading Only \_\_\_\_\_ Locate Line \_\_\_\_\_ (See Below)
- Read and Lock (Nonpayment) \_\_\_\_\_ Get Meter \_\_\_\_\_
- Number \_\_\_\_\_
- Check Pressure \_\_\_\_\_ Flush Line \_\_\_\_\_ Check & Leak \_\_\_\_\_
- Unlock Only and Read (Do Not Turn On) \_\_\_\_\_

Special Instructions Wants gas turned off, will pay reconnect fee.

### Work Done:

Flushed:  Yes  No GPM: \_\_\_\_\_ How Long: \_\_\_\_\_ Water Logs: \_\_\_\_\_  
 Water Leak:  Yes  No GPM: \_\_\_\_\_ How Long: \_\_\_\_\_ Water Logs: \_\_\_\_\_

Parts Used to Complete Job: \_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_

Comments: Gas turned off locked out

Work Completed By: BA4 BJ Date Completed: 4-10-23


Time Started: \_\_\_\_\_ Time Ended: \_\_\_\_\_

Customer signature \_\_\_\_\_ date \_\_\_\_\_

*Equal Opportunity Employer and Service Provider*

The employees of Drakesboro are not trained in the use of power tools. Lightning of pipes are a violation and the City can not be responsible.



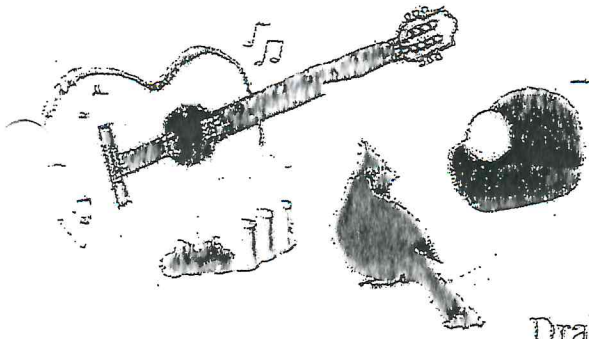

# CITY OF DRAKESBORO

P.O. Box 129 • Mose Rager Blvd. • Drakesboro, KY 42337

270-476-8986

COMPLETE

(888) 662-2406 (Voice/TTY); (866) 557-5762 (Español)

By B. Jones Date 4-18-23

Drakesboro Work Order

Work Order #: \_\_\_\_\_

Date: 4-18-23 Time: \_\_\_\_\_

Gas  Water  WW Acct #: 0040-56535-001

Name: Kim Arnold

Mobile Number: 270-931-0993

Address: 411 Jones Avenue

Work to be Done:

New Meter# 151160

New Reading 3995

Turn on & Read \_\_\_\_\_

Old Reading 3967

Read and Lock

Set Meter and Lock

Reading Only \_\_\_\_\_

Locate Line (See Below)

Read and Lock (Nonpayment) \_\_\_\_\_

Get Meter

Number \_\_\_\_\_

Check Pressure \_\_\_\_\_

Flush Line \_\_\_\_\_

Check & Leak \_\_\_\_\_

Unlock Only and Read (Do Not Turn On) \_\_\_\_\_

Special Instructions Hasn't paid on Bill since Feb. 2023

Work Done:

Flushed:  Yes  No GPM: \_\_\_\_\_ How Long: \_\_\_\_\_ Water Logs: \_\_\_\_\_

Water Leak:  Yes  No GPM: \_\_\_\_\_ How Long: \_\_\_\_\_ Water Logs: \_\_\_\_\_

Parts Used to Complete Job:

Comments: Service turned off locked out

Technician: BA/BS

Date Completed: 4/18/23

Time Started: \_\_\_\_\_

Time Ended: \_\_\_\_\_

Customer signature: \_\_\_\_\_ date \_\_\_\_\_

Equal Opportunity Employer and Service Provider

The employees of Drakesboro are not bonded for the purpose of lighting of pipes are a public utility and the city can not be responsible.

# Meter Turn On and Turn Off Form - 1201

City/Company:

## Information

Turn On       Turn Off

Date:

Time:

Address:

Meter Number:


Meter Reading:

Reason for Turn Off/On?

Was the Meter Valve Locked?     Yes     No

Additional Remarks:

Completed By:

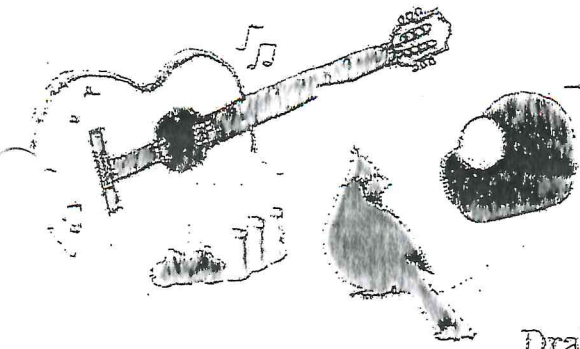

# CITY OF DRAKESBORO

P.O. Box 129 • Mose Rager Blvd. • Drakesboro, KY 42337  
270-476-8986  
(888) 662-2406 (Voice/TTY); (866) 557-5752 (Español)

**COMPLETE**

By B Jones Date 4-18-23

Drakesboro Work Order

Work Order #: \_\_\_\_\_

Date: 4/18/23 Time: 8:40 Gas Water WW Acct #: \_\_\_\_\_

Name: Pamella Parsons Mobile Number: 270-645-2007

Address: 758 Masonic Drive

Work to be Done:

New Meter# 19013968 New Reading \_\_\_\_\_

• Turn on & Read 6164 Old Reading \_\_\_\_\_

Read and Lock \_\_\_\_\_ Set Meter and Lock \_\_\_\_\_

Reading Only \_\_\_\_\_ Locate Line (See Below)

Read and Lock (Nonpayment) \_\_\_\_\_ Get Meter  
Number \_\_\_\_\_

Check Pressure \_\_\_\_\_ Flush Line \_\_\_\_\_ Check & Leak \_\_\_\_\_

Unlock Only and Read (Do Not Turn On) \_\_\_\_\_

Special Instructions Turn on and read - new move in.

Work Done:

Flushed:  Yes  No GPM: \_\_\_\_\_ How Long: \_\_\_\_\_ Water Logs: \_\_\_\_\_

Water Leak:  Yes  No GPM: \_\_\_\_\_ How Long: \_\_\_\_\_ Water Logs: \_\_\_\_\_

Parts Used to Complete Job:

\_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_

Comments: Gas service turned on, no leaks

Work Completed by BA+BJ Date Completed: 4-18-23

Time Started: \_\_\_\_\_ Time Ended: \_\_\_\_\_

Customer signature \_\_\_\_\_ date \_\_\_\_\_

*Equal Opportunity Employer and Service Provider*

The employees of Drakesboro are not trained in the use of firearms. Lighing of pipes are a violation and the City can not be responsible.

# Meter Turn On and Turn Off Form - 1201

City/Company:

## Information

Turn On       Turn Off

Date:

Time:

Address:

Meter Number:


Meter Reading:

Reason for Turn Off/On?

Was the Meter Valve Locked?     Yes     No

Additional Remarks:

Completed By:

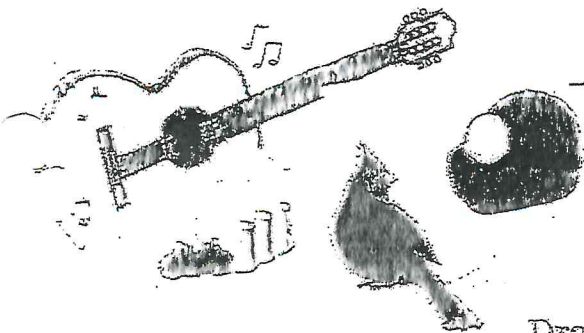

# CITY OF DRAKESBORO

P.O. Box 129 • Mose Rager Blvd. • Drakesboro, KY 42337  
270-476-8986  
(888) 662-2406 (Voice/TTY); (866) 557-5762 (Español)

COMPLETED

By B. Jones Date 4-18-23

Drakesboro Work Order

Work Order #: \_\_\_\_\_

Date: 4-18-23 Time: \_\_\_\_\_

Gas  Water  WW Acct #: 0030-34156-002

Name: Chasity Ewing

Mobile Number: 270-608-0237

Address: 5645 St. Rt. 176

Work to be Done:

New Meter# 18104719

New Reading 3768

Turn on & Read \_\_\_\_\_

Old Reading 3754

Read and Lock

Set Meter and Lock

Reading Only \_\_\_\_\_

Locate Line (See Below)

Read and Lock (Nonpayment) \_\_\_\_\_  
Number \_\_\_\_\_

Get Meter

Check Pressure \_\_\_\_\_

Flush Line \_\_\_\_\_

Check & Leak \_\_\_\_\_

Unlock Only and Read (Do Not Turn On) \_\_\_\_\_

Special Instructions Hasn't PAID since Feb. 2023

Work Done:

Flushed:  Yes  No GPM: \_\_\_\_\_ How Long: \_\_\_\_\_ Water Logs: \_\_\_\_\_

Water Leak:  Yes  No GPM: \_\_\_\_\_ How Long: \_\_\_\_\_ Water Logs: \_\_\_\_\_

Parts Used to Complete Job:

Comments: Gas service turned off locked out due to non-payment of bill

Technician: BA/BJ

Date Completed: 4/18/23

Time Started: \_\_\_\_\_

Time Ended: \_\_\_\_\_

Customer signature \_\_\_\_\_ date \_\_\_\_\_

Equal Opportunity Employer and Service Provider

The employees of Drakesboro are not trained in the lighting of pilot and a gas leak and the City can not be responsible.

# Meter Turn On and Turn Off Form - 1201

City/Company:

## Information

Turn On       Turn Off

Date:

Time:

Address:

Meter Number:


Meter Reading:

Reason for Turn Off/On?

Was the Meter Valve Locked?     Yes     No

Additional Remarks:

Completed By:

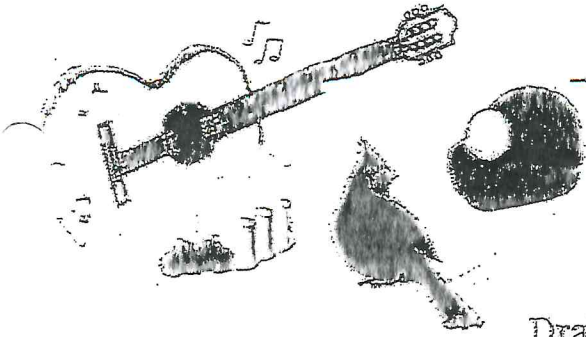

# CITY OF DRAKESBORO

P.O. Box 129 • Mose Rager Blvd. • Drakesboro, KY 42337  
270-476-8986  
(888) 662-2406 (Voice/TTY); (866) 557-5762 (Español)

COMPLETED

By B. Jones Date 4-19-23

Drakesboro Work Order

Work Order #: \_\_\_\_\_

Date: 4-18-23 Time: \_\_\_\_\_

Gas  Water  WW Acct #: 0010-00930-004

Name: Brian Piper

Mobile Number: 270-602-7968

Address: 381 Union Ridge Road

Work to be Done:

New Meter# 20P272080

New Reading 892

Turn on & Read \_\_\_\_\_

Old Reading 871

Read and Lock

Set Meter and Lock

Reading Only \_\_\_\_\_

Locate Line (See Below)

Read and Lock (Nonpayment) \_\_\_\_\_

Get Meter

Number \_\_\_\_\_

Check Pressure \_\_\_\_\_

Flush Line \_\_\_\_\_

Check & Leak \_\_\_\_\_

Unlock Only and Read (Do Not Turn On) \_\_\_\_\_

Special Instructions Hasn't paid on Bill since Feb. 2023

Work Done:

Flushed:  Yes  No GPM: \_\_\_\_\_

How Long: \_\_\_\_\_ Water Logs: \_\_\_\_\_

Water Leak:  Yes  No GPM: \_\_\_\_\_

How Long: \_\_\_\_\_ Water Logs: \_\_\_\_\_

Parts Used to Complete Job:

Comments: gas service turned off locked out due to non-payment of bill

Technician: BA/BJ

Date Completed: 4/19/23

Time Started: \_\_\_\_\_

Time Ended: \_\_\_\_\_

Customer signature: \_\_\_\_\_ date: \_\_\_\_\_

Equal Opportunity Employer and Service Provider

The employees of Drakesboro are not bonded. The lighting of pipes are a customer and the city can not be responsible.

# Meter Turn On and Turn Off Form - 1201

City/Company:

## Information

Turn On       Turn Off

Date:

Time:

Address:

Meter Number:

Meter Reading:


Reason for Turn Off/On?

Was the Meter Valve Locked?     Yes     No

Additional Remarks:

Completed By:



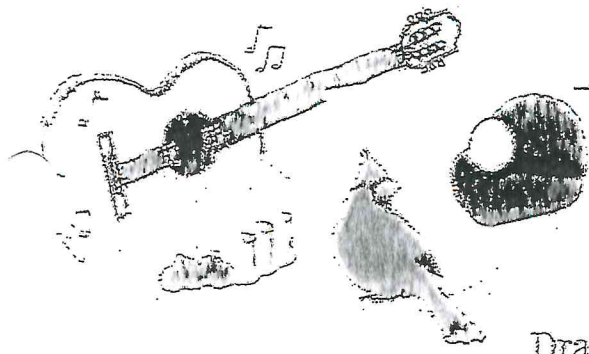

# CITY OF DRAKESBORO

P.O. Box 129 • Mose Rager Blvd. • Drakesboro, KY 42337  
270-476-8986  
(888) 662-2406 (Voice/TTY); (866) 557-5762 (Español)

**COMPLETED**  
By: B. Jones Date: 4-19-23

## Drakesboro Work Order Work Order #: \_\_\_\_\_

Date: 4-19-23 Time: \_\_\_\_\_  Gas  Water  WW Acct #: 0040-56535-001

Name: Kim Arnold Mobile Number: 270-931-0993

Address: 411 Jones Ave

### Work to be Done:

New Meter# 157160 New Reading 3995

Turn on & Read \_\_\_\_\_ Old Reading \_\_\_\_\_

Read and Lock \_\_\_\_\_ Set Meter and Lock \_\_\_\_\_

Reading Only \_\_\_\_\_ Locate Line (See Below) \_\_\_\_\_

Read and Lock (Nonpayment) \_\_\_\_\_ Get Meter \_\_\_\_\_  
Number \_\_\_\_\_

Check Pressure \_\_\_\_\_ Flush Line \_\_\_\_\_ Check & Leak \_\_\_\_\_

Unlock Only and Read (Do Not Turn On) \_\_\_\_\_

Special Instructions Needs gas turned back on

### Work Done:

Flushed:  Yes  No GPM: \_\_\_\_\_ How Long: \_\_\_\_\_ Water Logs: \_\_\_\_\_

Water Leak:  Yes  No GPM: \_\_\_\_\_ How Long: \_\_\_\_\_ Water Logs: \_\_\_\_\_

Parts Used to Complete Job: \_\_\_\_\_

Comments: Meter unlocked gas service turned back on

Work completed by: B. Jones Date Completed: 4-19-23

Time Started: \_\_\_\_\_ Time Ended: \_\_\_\_\_

Customer signature: \_\_\_\_\_ date: \_\_\_\_\_

*Equal Opportunity Employer and Service Provider*

The employees of the City are not authorized to accept payment for work performed. Payment for work performed is a condition of the City's contract with the City and the City can not be held liable for any work performed by its employees.

# Meter Turn On and Turn Off Form - 1201

City/Company:

## Information

Turn On       Turn Off

Date:

Time:

Address:

Meter Number:


Meter Reading:

Reason for Turn Off/On?

Was the Meter Valve Locked?     Yes     No

Additional Remarks:

Completed By:

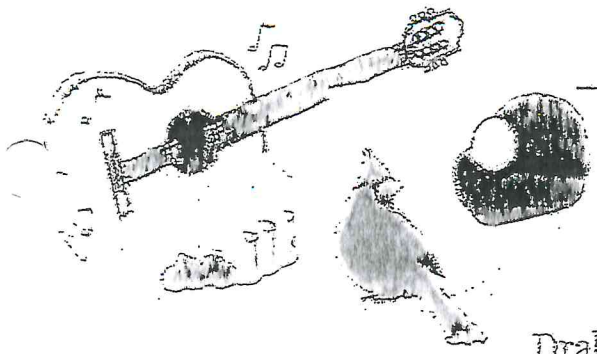

# CITY OF DRAKESBORO

P.O. Box 129 - Mose Rager Blvd. - Drakesboro, KY 42337

**COMPLETED**

270-476-8986

(888) 662-2406 (Voice/TTY); (866) 557-5762 (Español)

By: B. Jones Date: 4-20-23

## Drakesboro Work Order

Work Order #: \_\_\_\_\_

Date: 4-20-23 Time: 11:02am Gas Water WW Acct #: 0050-77029-001

Name: Joe Fleming Mobile Number: 270-543-9830

Address: 133 Douglas St.

### Work to be Done:

New Meter# 20744150 New Reading 2297

Turn on & Read \_\_\_\_\_ Old Reading \_\_\_\_\_

Read and Lock \_\_\_\_\_ Set Meter and Lock \_\_\_\_\_

Reading Only \_\_\_\_\_ Locate Line (See Below)

Read and Lock (Nonpayment) \_\_\_\_\_ Get Meter  
Number \_\_\_\_\_

Check Pressure \_\_\_\_\_ Flush Line \_\_\_\_\_ Check & Leak \_\_\_\_\_

Unlock Only and Read (Do Not Turn On) \_\_\_\_\_

Special Instructions Wants gas turned off. Will pay reconnect.

### Work Done:

Flushed:  Yes  No GPM: \_\_\_\_\_ How Long: \_\_\_\_\_ Water Logs: \_\_\_\_\_

Water Leak:  Yes  No GPM: \_\_\_\_\_ How Long: \_\_\_\_\_ Water Logs: \_\_\_\_\_

### Parts Used to Complete Job:

Comments: Meter turned off locked out

Work Completed by: BA + BJ

Date Completed: 4-20-23

Time Started: \_\_\_\_\_

Time Ended: \_\_\_\_\_

Customer signature \_\_\_\_\_ date \_\_\_\_\_

*Equal Opportunity Employer and Service Provider*

The employees of the City of Drakesboro are not trained in the use of firearms. Lighting of pipes are a public safety hazard and the City can not be held responsible.

# Meter Turn On and Turn Off Form - 1201

City/Company:

## Information

Turn On       Turn Off

Date:

Time:

Address:

Meter Number:


Meter Reading:

Reason for Turn Off/On?

Was the Meter Valve Locked?     Yes     No

Additional Remarks:

Completed By:

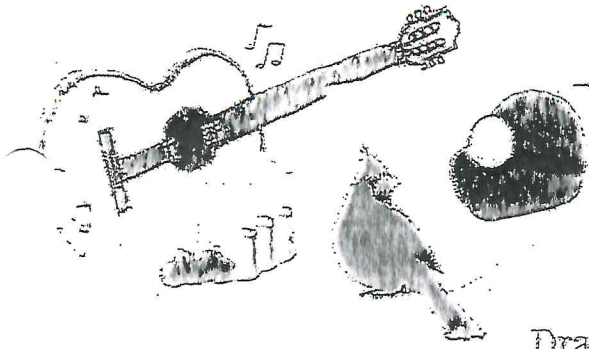

# CITY OF DRAKESBORO

P.O. Box 129 • Mose Rager Blvd. • Drakesboro, KY 42337  
270-476-8986  
(888) 662-2406 (Voice/TTY); (866) 557-5762 (Español)

## COMPLETED

By: B. Allard Date: 4-27-23

### Drakesboro Work Order

Work Order #: \_\_\_\_\_

Date: 04/26/23 Time: 11:00 (Gas) Water WW Acct #: 0010-01140-002

Name: GWEN MOSLEY Mobile Number: 1-931-551-1459

Address: 411 WA MOHON LN BELTON

#### Work to be Done:

New Meter# 19910759 New Reading 66 READ 4/25/2023

Turn on & Read \_\_\_\_\_ Old Reading 66

Read and Lock \_\_\_\_\_ Set Meter and Lock

Reading Only \_\_\_\_\_ Locate Line (See Below)

Read and Lock (Nonpayment) \_\_\_\_\_ Get Meter  
Number \_\_\_\_\_

Check Pressure \_\_\_\_\_ Flush Line \_\_\_\_\_ Check & Leak \_\_\_\_\_

Unlock Only and Read (Do Not Turn On) \_\_\_\_\_

Special Instructions MOVING - SHUT OFF

(\* NEW ADDRESS: 550 TRAVIS RD  
MARTIN, TN 38237)

#### Work Done:

Flushed:  Yes  No GPM: \_\_\_\_\_ How Long: \_\_\_\_\_ Water Logs: \_\_\_\_\_

Water Leak:  Yes  No GPM: \_\_\_\_\_ How Long: \_\_\_\_\_ Water Logs: \_\_\_\_\_

#### Parts Used to Complete Job:

\_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_

Comments: Service turned off and locked out

Work Completed By: B. Allard Date Completed: 4/27/23

Time Started: \_\_\_\_\_ Time Ended: \_\_\_\_\_

Customer signature: \_\_\_\_\_ date: \_\_\_\_\_

The employees of Drakesboro are not trained plumbers. Lighting of pilots are a customer and the City can not be responsible.

# Meter Turn On and Turn Off Form - 1201

City/Company:

## Information

Turn On     Turn Off

Date:

Time:

Address:

Meter Number:


Meter Reading:

Reason for Turn Off/On?

Was the Meter Valve Locked?     Yes     No

Additional Remarks:

Completed By:

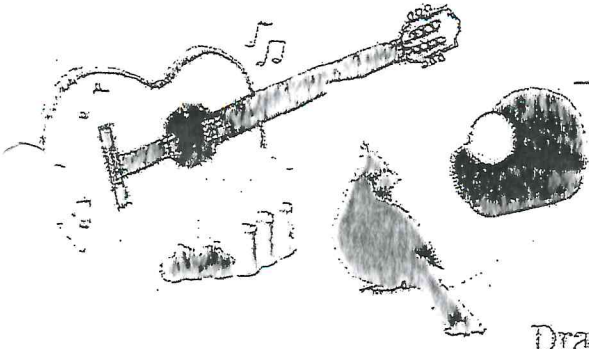

# CITY OF DRAKESBORO

P.O. Box 129 • Mose Rager Blvd. • Drakesboro, KY 42337  
270-476-8986  
(888) 662-2406 (Voice/TTY); (866) 557-5762 (Español)

COMPLETED

By: B. Allard Date: 4-27-23

Drakesboro Work Order

Work Order #: \_\_\_\_\_

Date: 4/24/23 Time: 9:41 (Gas) Water WW Acct 0040-51120-001

Name: ROCKY HICKS Mobile Number: 270-225-5011

Address: 205 BROAD ST DIBORO

Work to be Done:

New Meter# 23035864 New Reading 1530

Turn on & Read \_\_\_\_\_ Old Reading 1489 3/28/2023

Read and Lock \_\_\_\_\_ Set Meter and Lock

Reading Only \_\_\_\_\_ Locate Line (See Below)

Read and Lock (Nonpayment) \_\_\_\_\_ Get Meter  
Number \_\_\_\_\_

Check Pressure \_\_\_\_\_ Flush Line \_\_\_\_\_ Check & Leak \_\_\_\_\_

Unlock Only and Read (Do Not Turn On) \_\_\_\_\_

Special Instructions WANTS TURNED OFF FOR SUMMER

Work Done:

Flushed:  Yes  No GPM: \_\_\_\_\_ How Long: \_\_\_\_\_ Water Logs: \_\_\_\_\_

Water Leak:  Yes  No GPM: \_\_\_\_\_ How Long: \_\_\_\_\_ Water Logs: \_\_\_\_\_

Parts Used to Complete Job: \_\_\_\_\_

Comments: Service turned off and locked out

By: B. Allard Date Completed: 4/27/23

Time Started: \_\_\_\_\_ Time Ended: \_\_\_\_\_

Customer signature: \_\_\_\_\_ date: \_\_\_\_\_

Equal Opportunity Employer and Service Provider

The employees of Drakesboro are not trained in the use of firearms. Lifting of pipes are a customer and the City can not be responsible.

# Meter Turn On and Turn Off Form - 1201

City/Company:

## Information

Turn On       Turn Off

Date:

Time:

Address:

Meter Number:

Meter Reading:

Reason for Turn Off/On?

Was the Meter Valve Locked?     Yes     No


Additional Remarks:

Completed By:



# CITY OF DRAKESBORO

P.O. Box 129 • Mose Rager Blvd. • Drakesboro, KY 42337  
270-476-8986  
(888) 662-2406 (Voice/TTY): (866) 557-5762 (Español)

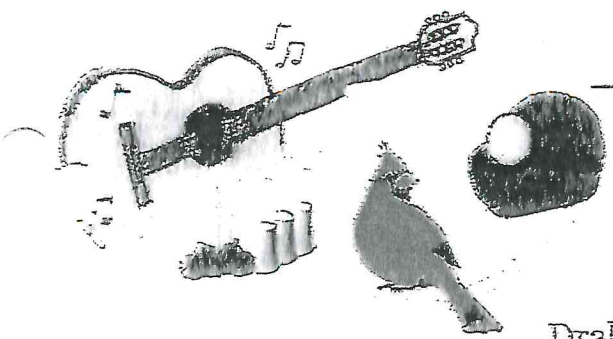

## Drakesboro Work Order Work Order #: \_\_\_\_\_

Date: 4-28-23 Time: 3:19pm Gas Water WW Acct #: 0010-04100-016  
Name: Daniel Summers Mobile Number: 270-731-9040  
Address: 3510 US Highway 431 South

### Work to be Done:

New Meter# 297516 \_\_\_\_\_ New Reading \_\_\_\_\_  
Turn on & Read \_\_\_\_\_ Old Reading \_\_\_\_\_  
Read and Lock \_\_\_\_\_ Set Meter and Lock \_\_\_\_\_  
Reading Only 3789 \_\_\_\_\_ Locate Line (See Below)  
Read and Lock (Nonpayment) \_\_\_\_\_ Get Meter  
Number \_\_\_\_\_  
Check Pressure \_\_\_\_\_ Flush Line \_\_\_\_\_ Check & Leak \_\_\_\_\_  
Unlock Only and Read (Do Not Turn On) \_\_\_\_\_  
Special Instructions possible leak smell of gas in residence

### Work Done:

Flushed:  Yes  No GPM: \_\_\_\_\_ How Long: \_\_\_\_\_ Water Logs: \_\_\_\_\_  
Water Leak:  Yes  No GPM: \_\_\_\_\_ How Long: \_\_\_\_\_ Water Logs: \_\_\_\_\_

### Parts Used to Complete Job:

Comments: No leak found cyi used & meter bar test performed

Work Completed By: BA + BJ Date Completed: 4-28-23

Time Started: \_\_\_\_\_ Time Ended: \_\_\_\_\_

Customer signature \_\_\_\_\_ date \_\_\_\_\_

*Equal Opportunity Employer and Service Provider*

The employees of Drakesboro are not trained in the profession of lighting of pilots and a court order and the City can not be held liable.