


CITY OF DRAKESBORO

P.O. Box 129 • Mose Rager Blvd. • Drakesboro, KY 42337
270-476-8986
(888) 662-2406 (Voice/TTY); (866) 557-5762 (Español)

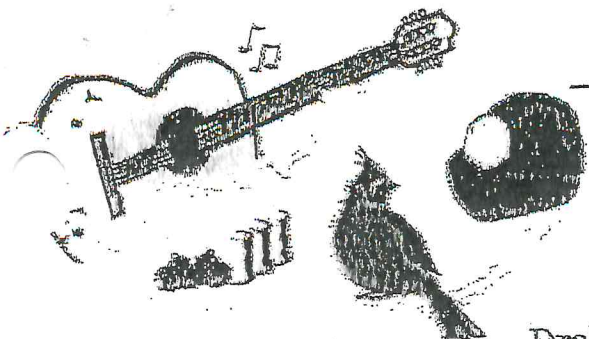

Drakesboro Work Order

Work Order #: _____

Date: 12/22/22 Time: _____ (Gas) Water WW Acct #: 30-37101-1

Name: Bobby + Rita Styers Mobile Number: 270-519-4063 or 270-210-2492

Address: 850 Merle Travis Hwy Drakesboro Ky 42337

Work to be Done:

- New Meter# 20P246374 ✓ New Reading _____
- Turn on & Read _____ Old Reading _____
- Read and Lock _____ Set Meter and Lock _____
- Reading Only 0 (New) ✓ Locate Line (See Below)
- Read and Lock (Nonpayment) _____ Get Meter _____
- Number _____
- Check Pressure _____ Flush Line _____ Check & Leak _____
- Unlock Only and Read (Do Not Turn On) _____
- Special Instructions _____

✓ Card in book
✓ Applied
✓ Do not meter in begin

Work Done:

Flushed: Yes No GPM: _____ How Long: _____ Water Logs: _____
Water Leak: Yes No GPM: _____ How Long: _____ Water Logs: _____

Parts Used to Complete Job:

Comments: New service 179' ft 3/4 inch poly pipe all tested by USDI also weld on tap done by usdi

Work Completed By: B. Jones Date Completed: 12-22-22

Time Started: _____ Time Ended: _____

Customer signature _____ date _____

Equal Opportunity Employer and Service Provider

The employees of Drakesboro are not trained HVAC personnel. Lighting of pilots are a courtesy and the City can not be held liable.



CITY OF DRAKESBORO

P.O. Box 129 • Mose Rager Blvd. • Drakesboro, KY 42337
270-476-8986
(888)662-2406 (Voice/TTY): (866)577-5762 (Español)

Date 12-22-2022

Time _____

Pressure Test for Gas Line

Plumber Information:

License # _____

Phone # _____

Name: _____

Address: _____

Meter read at time of Pressure Test 0

Pressure Tested for 10 minutes.

At 20 lbs of Pressure.

Customer: Bobby & Rita Styers

Address: 850 Merle Travis Hwy

Signature of Licensed Plumber

A handwritten signature in black ink, appearing to read "Tom Jones", written over a horizontal line.

Signature of City of Drakesboro gas Employee and Russmar Representative

Meter Turn On and Turn Off Form - 1201

City/Company:

Information

Turn On Turn Off

Date:

Time:

Address:

Meter Number:

Meter Reading:

Reason for Turn Off/On?

Was the Meter Valve Locked? Yes No

Additional Remarks:

Completed By:



CITY OF DRAKESBORO

P.O. Box 129 • Mose Rager Blvd. • Drakesboro, KY 42337
270-476-8986
(888) 662-2406 (Voice/TTY); (866) 557-5762 (Español)

Drakesboro Work Order

Work Order #: _____

Date: 12/28/22 Time: _____ (Gas) Water WW Acct #: 40-59550-2

Name: Melissa Dene Mobile Number: 903-372-8948

Address: 304 Christian St.

Work to be Done:

New Meter# 486412 New Reading _____

Turn on & Read _____ Old Reading 3295 (12/28/22)

Read and Lock _____ Set Meter and Lock _____

Reading Only 3299 Locate Line _____ (See Below)

Read and Lock (Nonpayment) _____ Get Meter
Number _____

Check Pressure _____ Flush Line _____ Check & Leak _____

Unlock Only and Read (Do Not Turn On) _____

Special Instructions Only read, renters moving in

✓ Card flipped
✓ Final
✓ Deposit left
to renters

Work Done:

Flushed: Yes No GPM: _____ How Long: _____ Water Logs: _____

Water Leak: Yes No GPM: _____ How Long: _____ Water Logs: _____

Parts Used to Complete Job:

Comments:

Work Completed By: B. Jones Date Completed: 12-29-22

Time Started: _____ Time Ended: _____


Customer signature _____ date _____

Equal Opportunity Employer and Service Provider

The employees of Drakesboro are not trained HVAC personnel. Lighting of pilots are a courtesy and the City can not be held liable.

CITY OF DRAKESBORO

P.O. Box 129 • Mose Rager Blvd. • Drakesboro, KY 42337
270-476-8986
(888) 662-2406 (Voice/TTY); (866) 557-5752 (Español)

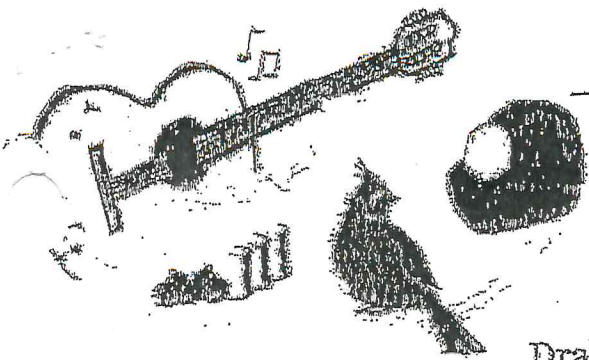

Drakesboro Work Order

Work Order #: _____

Date: 12/27/22 Time: _____

Gas Water WW Acct #: 10-08200-2

Name: Tim Johnson

Mobile Number: 270-621-1000

Address: 2999 431 S. Beechmont 42323

Work to be Done:

New Meter# 20P2416373 New Reading 0

Turn on & Read _____ Old Reading _____

Read and Lock _____ Set Meter and Lock _____

Reading Only 0 _____ Locate Line (See Below)

Read and Lock (Nonpayment) _____ Get Meter _____

Number _____

Check Pressure _____ Flush Line _____ Check & Leak _____

Unlock Only and Read (Do Not Turn On) _____

Special Instructions _____

*Acct. Begin
Card included
app filed*

Work Done:

Flushed: Yes No GPM: _____ How Long: _____ Water Logs: _____

Water Leak: Yes No GPM: _____ How Long: _____ Water Logs: _____

Parts Used to Complete Job:

Comments: Pressure test & meter bar test performed

Work Completed By: BA & BJ

Date Completed: 12-28-2022

Time Started: _____

Time Ended: _____

Customer signature _____ date _____

Equal Opportunity Employer and Service Provider

The employees of Drakesboro are not trained HVAC personnel. Lighting of pilots are a courtesy and the City can not be held liable.



CITY OF DRAKESBORO

P.O. Box 129 • Mose Rager Blvd. • Drakesboro, KY 42337

270-476-8986

(888)662-2406 (Voice/TTY): (866)577-5762 (Español)

Date 12-28-2022

Time 11:59

Pressure Test for Gas Line

Plumber Information:

License # _____

Phone # _____

Name: _____

Address: _____

Meter read at time of Pressure Test 0

Customer: Tim Johnson

Pressure Tested for 10 minutes.

Address: 2999 431 South


At 20 lbs of Pressure.

Signature of Licensed Plumber

Signature of City of Drakesboro gas Employee and Russmar Representative

CITY OF DRAKESBORO

P.O. Box 129 • Mose Rager Blvd. • Drakesboro, KY 42337
270-476-8986
(888) 662-2406 (Voice/TTY); (866) 557-5762 (Español)

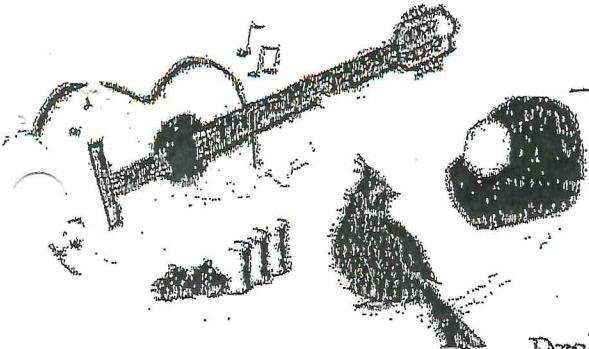

8:30 am

Drakesboro Work Order

Work Order #: _____

Date: 12/21/22 Time: 11:50 Gas Water WW Acct #: 10-00530-2

Name: Adam Mefford Mobile Number: 977-9293

Address: 150 Mefford Lane Belton Ky

Work to be Done:

New Meter# 20P246380

New Reading _____

Turn on & Read 0

Old Reading 5/29/2020 BY AF (6172)

Read and Lock _____

Set Meter and Lock _____

Reading Only _____

Locate Line (See Below) _____

Read and Lock (Nonpayment) Number _____

Get Meter _____

Check Pressure _____

Flush Line _____ Check & Leak _____

Unlock Only and Read (Do Not Turn On) _____

Special Instructions Needs pressure test + turn on gas

New meter installed pressure test of meter bar

test performed all passed

Work Done:

Flushed: Yes No GPM: _____ How Long: _____ Water Logs: _____

Water Leak: Yes No GPM: _____ How Long: _____ Water Logs: _____

Parts Used to Complete Job: _____

Comments: Adjustment in June 2020 439.24 to zero out.
Remember the circumstances? (Mike) no.
need to have deposit - new acct - He will come this afternoon.

Work Completed By: BA & BJ Date Completed: 12-21-22

Time Started: _____ Time Ended: _____

Customer signature _____ date _____

Equal Opportunity Employer and Service Provider

COMPLETED
Date: 12/30/22

The employees of Drakesboro are not trained HVAC personnel. Lighting of pilots are a courtesy and the City can not be held liable.



CITY OF DRAKESBORO

P.O. Box 129 • Mose Rager Blvd. • Drakesboro, KY 42337
270-476-8986
(888)662-2406 (Voice/TTY): (866)577-5762 (Español)

Date 12-21-22

Time 08:50

Pressure Test for Gas Line

Plumber Information:

License # _____

Phone # _____

Name: _____

Address: _____

Meter read at time of Pressure Test 0

Customer: Adam Melford

Pressure Tested for 10 minutes.

Address: 150 Melford Lane

At 20 lbs of Pressure.

Signature of Licensed Plumber

Signature of City of Drakesboro gas Employee and Russmar Representative



Meter Turn On and Turn Off Form - 1201

City/Company:

Information

Turn On Turn Off

Date:

Time:

Address:

Meter Number:

Meter Reading:

Reason for Turn Off/On?

Was the Meter Valve Locked? Yes No

Additional Remarks:

Completed By:

CITY OF DRAKESBORO

P.O. Box 129 • Mose Rager Blvd. • Drakesboro, KY 42337
270-476-8986
(888) 662-2406 (Voice/TTY): (866) 557-5762 (Español)



✓ Acct made
✓ Card in hand

Drakesboro Work Order

Work Order #: _____

Date: 12/28 Time: _____ Gas Water WW Acct #: 0040-59550-003

Name: Bill Maners Mobile Number: 731-549-6978

Address: 304 Christian st

Work to be Done:

✓ New Meter# 486412 _____ New Reading _____

Turn on & Read _____ Old Reading 3295 _____

Read and Lock _____ Set Meter and Lock _____

✓ Reading Only 3299 _____ Locate Line _____

Read and Lock (Nonpayment) _____ Get Meter _____
Number _____

Check Pressure _____ Flush Line _____ Check & Leak _____

Unlock Only and Read (Do Not Turn On) _____

Special Instructions new customer. Just get reading!

COMPLETED
(See Below)
By: JP Date: 12/30/22

Work Done:

Flushed: Yes No GPM: _____ How Long: _____ Water Logs: _____

Water Leak: Yes No GPM: _____ How Long: _____ Water Logs: _____

Parts Used to Complete Job:

Comments:

Work Completed By: BA & BJ Date Completed: 12-29-22

Time Started: _____ Time Ended: _____

Customer signature _____ date _____

Equal Opportunity Employer and Service Provider


The employees of Drakesboro are not trained HVAC personnel. Lighting of pilots are a courtesy and the City can not be held liable.

Open Checklist

- Active/ Begin
- Deposit
- Renter/Owner Docs.
- Read Card
- Search Old Acct.
- Work order
- Drivers License
- Domicile Declaration

Close Checklist

- Final
- Work Order
- Forwarding Address
- Phone Number
- Flip Read Card
- Refund deposit after final bill

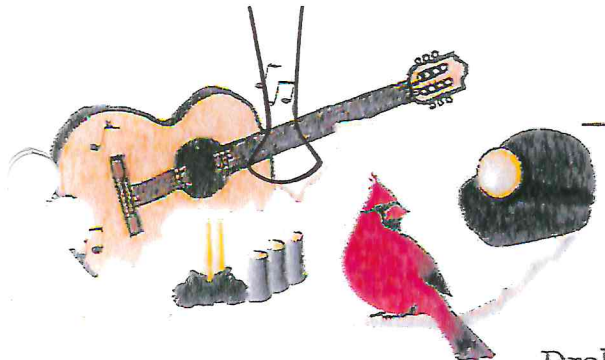

CITY OF DRAKESBORO

P.O. Box 129 • Mose Rager Blvd. • Drakesboro, KY 42337
270-476-8986
(888) 662-2406 (Voice/TTY); (866) 557-5762 (Español)

Drakesboro Work Order Work Order #: _____

Date: 12/28/22 Time: 1:17pm Gas Water WW Acct #: 50-71005-3
Name: Kevin Bradford Mobile Number: 270-696-3271
Address: 301 Deerpark Beechmont Ky 42323

Work to be Done:

New Meter# _____ New Reading _____
Turn on & Read _____ Old Reading 10957 (12/29/22)
Read and Lock _____ Set Meter and Lock _____
Reading Only _____ Locate Line _____
Read and Lock (Nonpayment) _____ Get Meter _____
Number _____
Check Pressure _____ Flush Line _____ Check & Leak _____
Unlock Only and Read (Do Not Turn On) _____

(See Below)
COMPLETED
By: AP Date: 12/28/22

Special Instructions Customer called says they smell gas

Work Done:

Flushed: Yes No GPM: _____ How Long: _____ Water Logs: _____
Water Leak: Yes No GPM: _____ How Long: _____ Water Logs: _____


Parts Used to Complete Job:

Comments: Checked all around meter no leaks found sprayed meter fittings and used cgi

Work Completed By: BA + BJ Date Completed: 12-28-22

Time Started: _____ Time Ended: _____

Customer signature _____ date _____

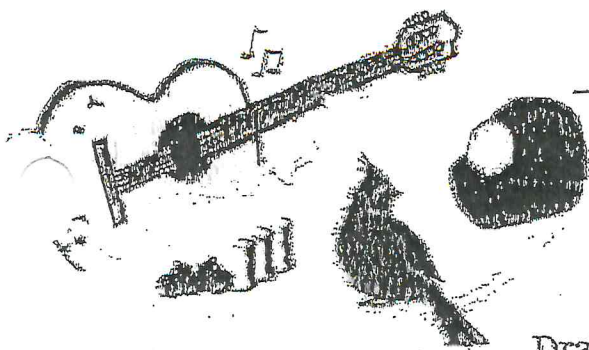

CITY OF DRAKESBORO

P.O. Box 129 • Mose Rager Blvd. • Drakesboro, KY 42337

270-476-8986

(888) 662-2406 (Voice/TTY); (866) 557-5762 (Español)

Drakesboro Work Order

Work Order #: _____

Date: 12/29/22 Time: _____ (Gas) Water WW Acct #: 10-03500-3

Name: Magnum Goff Mobile Number: _____

Address: 3570 U.S. Hwy 431S.

Work to be Done:

COMPLETED

By: AP Date: 12/29/22

New Meter# _____ New Reading _____

Turn on & Read _____ Old Reading 4181 - (Nov/22)

Read and Lock _____ Set Meter and Lock _____

Reading Only 4244 _____ Locate Line (See Below)

Read and Lock (Nonpayment) _____ Get Meter
Number _____

Check Pressure _____ Flush Line _____ Check & Leak _____

Unlock Only and Read (Do Not Turn On) _____

Special Instructions High usage - Read 12/29 - 4943 (usage - 762)

Work Done:

Flushed: Yes No GPM: _____ How Long: _____ Water Logs: _____

Water Leak: Yes No GPM: _____ How Long: _____ Water Logs: _____

Parts Used to Complete Job: _____

Comments: m's read meter

Work Completed By: B. Jones Date Completed: 12-29-22

Time Started: _____ Time Ended: _____

Customer signature _____ date _____

Equal Opportunity Employer and Service Provider

The employees of Drakesboro are not trained HVAC personnel. Lighting of pilots are a courtesy and the City can not be held liable.



CITY OF DRAKESBORO

P.O. Box 129 • Mose Rager Blvd. • Drakesboro, KY 42337
270-476-8986
(888) 662-2406 (Voice/TTY): (866) 557-5762 (Español)

Estimate

Drakesboro Work Order

Work Order #: _____

Date: 12/14 Time: _____ Gas Water WW Acct #: _____

Name: Lydia Meredith Mobile Number: 270-526-7755

Address: 1970 St. Rt. 70 E Drakesboro (across from Robert McClearn)

Work to be Done:

New Meter# _____ New Reading _____

Turn on & Read _____ Old Reading _____

Read and Lock _____ Set Meter and Lock _____

Reading Only _____ Locate Line _____

Read and Lock (Nonpayment) _____ Get Meter _____

Number _____

Check Pressure _____ Flush Line _____ Check & Leak _____

Unlock Only and Read (Do Not Turn On) _____

Special Instructions interested in gas for fireplace. Will be moving in house about Spring. Just wanting to know cost if have to put in.

COMPLETED
12/27/22
BY: AP
(See Below)

Work Done:

Flushed: Yes No GPM: _____ How Long: _____ Water Logs: _____

Water Leak: Yes No GPM: _____ How Long: _____ Water Logs: _____


Parts Used to Complete Job: _____

Comments: Spoke with person advised line was on opposite side of road would be new tap and have to be road bored

Work Completed By: B. Jones Date Completed: 12-27-22

Time Started: _____ Time Ended: _____

Customer signature _____ date _____

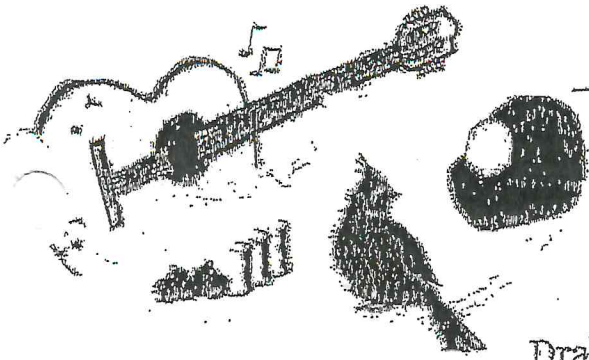

CITY OF DRAKESBORO

P.O. Box 129 • Mose Rager Blvd. • Drakesboro, KY 42337
270-476-8986
(888) 662-2406 (Voice/TTY); (866) 557-5762 (Español)

Drakesboro Work Order

Work Order #: _____

Date: 12/22/22 Time: _____

Gas Water WW Acct #: 40-64450-3

Name: Misty Brown

Mobile Number: 820-7682

Address: 303 Buffalo dr

Work to be Done:

New Meter# 485928

New Reading _____

Turn on & Read _____

Old Reading 6634 11/29

Read and Lock _____

Set Meter and Lock _____

Reading Only 6697

Locate Line _____

Read and Lock (Nonpayment) _____
Number _____

Get Meter _____

Check Pressure _____

Flush Line _____

Check & Leak _____

Unlock Only and Read (Do Not Turn On) _____

Special Instructions Customer Called Asking if something was wrong w/gas because her pilot light wont light.

COMPLETED
(See Below)
By: [Signature] Date: 12/22/22

Work Done:

Flushed: Yes No GPM: _____ How Long: _____ Water Logs: _____

Water Leak: Yes No GPM: _____ How Long: _____ Water Logs: _____

Parts Used to Complete Job:

Comments: Got furnace to light and work

Work Completed By: BA + BJ

Date Completed: 12-22-22

Time Started: _____

Time Ended: _____

Customer signature _____


date _____

Equal Opportunity Employer and Service Provider

The employees of Drakesboro are not trained HVAC personnel. Lighting of pilots are a courtesy and the City can not be held liable.

CITY OF DRAKESBORO

P.O. Box 129 • Mose Rager Blvd. • Drakesboro, KY 42337
270-476-8986
(888) 662-2406 (Voice/TTY); (866) 557-5762 (Español)

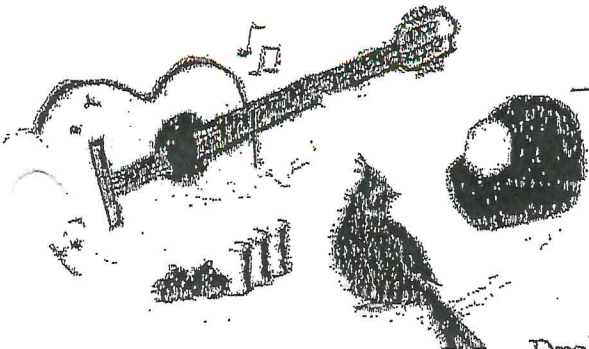

Drakesboro Work Order

Work Order #: _____

Date: 12/21/22 Time: _____
Name: Susan Todd Mobile Number: 980-721-1564
Address: 49104 Riverside rd

Gas Water WW Acct #: 50-830082

Work to be Done:

New Meter# 1072022 New Reading 1783
✓ Turn on & Read Old Reading 1183 11/30
Read and Lock Set Meter and Lock
Reading Only Locate Line (See Below)
Read and Lock (Nonpayment) Get Meter
Number _____
Check Pressure Flush Line Check & Leak
Unlock Only and Read (Do Not Turn On)
Special Instructions Turning back on in case of weekend weather.

COMPLETED
By: AP Date: 12/20/22

Work Done:

Flushed: Yes No GPM: _____ How Long: _____ Water Logs: _____
Water Leak: Yes No GPM: _____ How Long: _____ Water Logs: _____

Parts Used to Complete Job:

Comments: Meter unlocked turned back on

Work Completed By: BA & BJ Date Completed: 12-22-22

Time Started: _____ Time Ended: _____

Customer signature _____ date _____

Equal Opportunity Employer and Service Provider

The employees of Drakesboro are not trained HVAC personnel. Lighting of pilots are a courtesy and the City can not be held liable.



CITY OF DRAKESBORO

P.O. Box 129 • Mose Rager Blvd. • Drakesboro, KY 42337
270-476-8986
(888) 662-2406 (Voice/TTY); (866) 557-5762 (Español)

Drakesboro Work Order

Work Order #: _____

Date: 10/26 Time: _____ Gas Water WW Acct #: 1-05809-03

Name: Stephanie Flener Mobile Number: no phone

Address: 406 Ike Everly #5

Work to be Done:

COMPLETED

By: AP Date: 12/22/22

New Meter# _____ New Reading _____

Turn on & Read _____ Old Reading 10/19/22 (1770)

Read and Lock _____ Set Meter and Lock _____

Reading Only _____ Locate Line (See Below)

→ Read and Lock (Nonpayment) 1771 Get Meter

AP 11/7/22
✓, folded card

Check Pressure _____ Flush Line _____ Check & Leak _____

Unlock Only and Read (Do Not Turn On) 1

Special Instructions 118.65 payment before shut off

← Refund \$150.00
Deposit
- Apply to
bill.

Work Done:

Flushed: Yes No GPM: _____ How Long: _____ Water Logs: _____

Water Leak: Yes No GPM: _____ How Long: _____ Water Logs: _____

Parts Used to Complete Job:

Comments: meter off and locked

~~Not Completed~~
COMPLETED
By: MAA Date: 11/2/22
Request Ref
check payable
to COP.

Work Completed By: BA & BJ Date Completed: 10-26-22


Time Started: _____ Time Ended: _____

Customer signature _____ date _____

Equal Opportunity Employer and Service Provider

The employees of Drakesboro are not trained HVAC personnel. Lighting of pilots are a courtesy and the City can not be held liable.

• Dep.
applied
to account

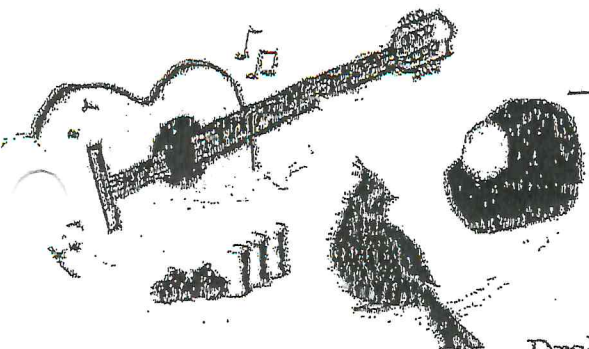

CITY OF DRAKESBORO

P.O. Box 129 • Mose Rager Blvd. • Drakesboro, KY 42337
270-476-8986
(888) 662-2406 (Voice/TTY); (866) 557-5762 (Español)

Drakesboro Work Order Work Order #: _____

Date: 11/28/22 Time: 8:22am Gas Water WW Acct #: 2-10440-065

Name: Leigh Ann Wilson Chaplin Mobile Number: 270-602-7953 *entered final*

Address: 100 Harper Circle Drakesboro

Work to be Done:

New Meter# 10720746 New Reading _____

Turn on & Read _____ Old Reading 2558 (11/17/22)

Read and Lock 2566 Set Meter and Lock _____

Reading Only _____ Locate Line _____ (See Below)

Read and Lock (Nonpayment) _____ Get Meter _____

Number _____

Check Pressure _____ Flush Line _____ Check & Leak _____

Unlock Only and Read (Do Not Turn On) _____

Special Instructions Forwarding address - 19 Jade E D. Lot 22 Greenville Ky 42345

*Put in final
folded card
Request Dep. ref.
to pay Bill
mailed ref.
\$50.00
Dep. ref.
made payroll
to COD.*

*Dep applied
to acct.*

Work Done:

Flushed: Yes No GPM: _____ How Long: _____ Water Logs: **COMPLETED**

Water Leak: Yes No GPM: _____ How Long: _____ Water Logs: by: AP Date: 12/22/22

Parts Used to Complete Job: _____

Comments: meter off


Work Completed By: BA + BJ Date Completed: 11-28-22

Time Started: _____ Time Ended: _____

Customer signature _____ date _____

Equal Opportunity Employer and Service Provider

The employees of Drakesboro are not trained HVAC personnel. Lighting of pilots are a courtesy and the City can not be held liable.

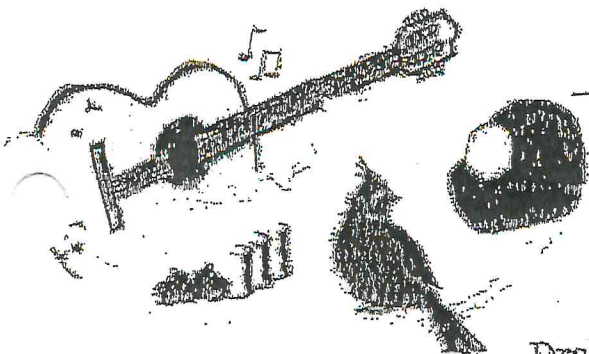

CITY OF DRAKESBORO

P.O. Box 129 • Mose Rager Blvd. • Drakesboro, KY 42337
270-476-8986
(888) 662-2406 (Voice/TTY); (866) 557-5762 (Español)

Drakesboro Work Order

Work Order #: _____

Date: 12/1/22 Time: _____ Gas Water WW Acct #: _____

Name: Barry Mohan Mobile Number: (270) 225-0181

Address: 133 Church St.

Work to be Done:

- New Meter# _____ New Reading _____
- Turn on & Read _____ Old Reading 7852 11/29
- Read and Lock _____ Set Meter and Lock _____
- Reading Only _____ Locate Line _____ (See Below)
- Read and Lock (Nonpayment) _____ Get Meter _____
- Number _____
- Check Pressure _____ Flush Line _____ Check & Leak _____
- Unlock Only and Read (Do Not Turn On) _____

COMPLETED

By: AP Date: 12/1/22

*Brother #15
Barry is
out of town
brother is
the one were
working
with*

Special Instructions log five place isnt working, said we have solved this problem before. My guess is the pilot light went out.

Work Done:

Flushed: Yes No GPM: _____ How Long: _____ Water Logs: _____

Water Leak: Yes No GPM: _____ How Long: _____ Water Logs: _____

Parts Used to Complete Job:

Comments: All other gas appliances working advised owner to call hvac to look at furnace

Work Completed By: BA & BJ Date Completed: 12-21-22

Time Started: _____ Time Ended: _____

Customer signature _____ date _____

Equal Opportunity Employer and Service Provider

The employees of Drakesboro are not trained HVAC personnel. Lighting of pilots are a courtesy and the City can not be held liable.



CITY OF DRAKESBORO

P.O. Box 129 • Mose Rager Blvd. • Drakesboro, KY 42337
270-476-8986
(888) 662-2406 (Voice/TTY); (866) 557-5762 (Español)

Drakesboro Work Order

Work Order #: _____

Date: 12/15/22 Time: _____ Gas Water WW Acct #: 10-09390-09

Name: Rose Shively Mobile Number: 270-731-6383

Address: 2258 US Hwy 431 S

Work to be Done:

New Meter# 485730 New Reading COMPLETED

Turn on & Read _____ Old Reading BY AP 12/19/22

Read and Lock _____ Set Meter and Lock _____

Reading Only 2021 Locate Line (See Below)

Read and Lock (Nonpayment) _____ Get Meter Number _____

Check Pressure _____ Flush Line _____ Check & Leak _____

Unlock Only and Read (Do Not Turn On) _____

Special Instructions feels Bill is too high. Please check the meter. SNG

Work Done:

Flushed: Yes No GPM: _____ How Long: _____ Water Logs: _____

Water Leak: Yes No GPM: _____ How Long: _____ Water Logs: _____

Parts Used to Complete Job:

Comments: Meter not spinning no one home at time when utility company there

Work Completed By: BA & BJ Date Completed: 12-16-22

Time Started: _____ Time Ended: _____

Customer signature _____ date _____

Equal Opportunity Employer and Service Provider

The employees of Drakesboro are not trained HVAC personnel. Lighting of pilots are a courtesy and the City can not be held liable.



CITY OF DRAKESBORO

P.O. Box 129 • Mose Rager Blvd. • Drakesboro, KY 42337
270-476-8986
(888) 662-2406 (Voice/TTY); (866) 557-5762 (Español)

Reconnect for winter

Drakesboro Work Order Work Order #: _____

Date: 12/16 Time: 12:56 Gas Water WW Acct #: 20-24390-2
Name: John Gunn Mobile Number: 270-977-1222
Address: 59 Howard Bowers Rd.

Work to be Done:

New Meter# 18104700 New Reading _____
Turn on & Read 4143 Old Reading 4143 (5/5/22)
Read and Lock _____ Set Meter and Lock _____
Reading Only _____ Locate Line (See Below) **COMPLETED**
Read and Lock (Nonpayment) _____ Get Meter _____
Number _____ By: AP Date: 12/16/22

Check Pressure _____ Flush Line _____ Check & Leak _____
Unlock Only and Read (Do Not Turn On) _____

Special Instructions Wants turned on after pressure test.
Coming in to pay Reconnect fee for winter - \$50.00. PDV 12/16

Work Done:

Flushed: Yes No GPM: _____ How Long: _____ Water Logs: _____
Water Leak: Yes No GPM: _____ How Long: _____ Water Logs: _____

Parts Used to Complete Job:

Comments: Pressure test done & meter bar test no
leaks found wall heater only gas appliance is wall
heater in residence

Work Completed By: BA & BJ Date Completed: 12-16-22

Time Started: _____ Time Ended: _____

Customer signature _____ date _____

The employees of Drakesboro are not trained HVAC personnel. Lighting of pilots are a courtesy and the City can not be held liable.



P.O. Box 129 • Mose Rager Blvd. • Drakesboro, KY 42337
270-476-8986
(888)662-2406 (Voice/TTY): (866)577-5762 (Español)

Date 12-16-22

Time _____

Pressure Test for Gas Line

Plumber Information:

License # _____ Phone # _____

Name: _____

Address: _____

Meter read at time of Pressure Test 4143

Customer: John Gunn


Pressure Tested for 10 minutes.

Address: 59 Howard Bowers Lane

At 20 lbs of Pressure.

Signature of Licensed Plumber

Signature of City of Drakesboro gas Employee and Russmar Representative

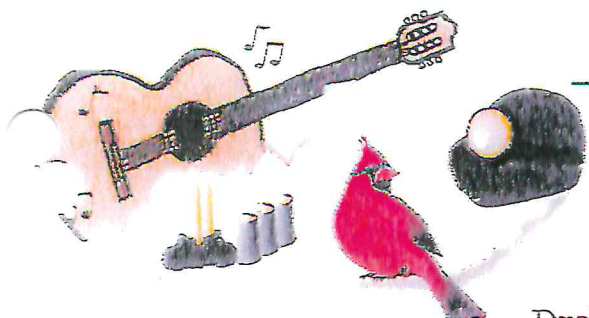

CITY OF DRAKESBORO

P.O. Box 129 • Mose Rager Blvd. • Drakesboro, KY 42337
270-476-8986
(888) 662-2406 (Voice/TTY); (866) 557-5762 (Español)

Drakesboro Work Order

Work Order #: _____

Date: 11/30/22 Time: _____ Gas Water WW Acct #: 30-38300-01

Name: William Farber Mobile Number: _____

Address: 6236 State Rt 176 Drakesboro Ky 42337

Work to be Done:

New Meter# 20P272983

New Reading _____

Turn on & Read _____

Old Reading _____

Read and Lock _____

Set Meter and Lock _____

Reading Only 1147

Locate Line _____

(See Below)

Read and Lock (Nonpayment) _____
Number _____

Get Meter _____

Check Pressure _____

Flush Line _____

Mark Farber (son)
Check & Leak _____

Unlock Only and Read (Do Not Turn On) _____

270-875-8766

Special Instructions Sold house

121 Edgewood Dr.

Providence Ky 42450

*Bill should be
FB 28.20/pd*

*177 Payment
+ final. AP*

*mail
Dep. ref
to
Mark*

Work Done:

Flushed: Yes No GPM: _____

How Long: _____

Water Logs: _____

Water Leak: Yes No GPM: _____

How Long: _____

Water Logs: _____

*12/19-
mailed refund
to Mark. AP*

Parts Used to Complete Job:

*~~97.20 + 2.8 to 101.11/m~~
* ~~100.00~~ gas Deposit Refund
made payable to City of Drakesboro*

Comments: _____

** Still have final bill
* Fold gas card up AP*

Work Completed By: BA & BJ

** Put in final billing today. AP*
Date Completed: 11-30-22

Time Started: _____

Time Ended: _____

Customer signature _____

** ~~Email sent to
Kara for refund
to 97.20 cap~~*

Equal Opportunity Employer and Service Provider

The employees of Drakesboro are not trained HVAC personnel. Lighting of pilots are a courtesy and the City can not be held liable.

Not between
2/2:30 pm.



CITY OF DRAKESBORO

P.O. Box 129 • Mose Rager Blvd. • Drakesboro, KY 42337
270-476-8986
(888) 662-2406 (Voice/TTY); (866) 557-5762 (Español)

Drakesboro Work Order

Work Order #: _____

Date: 12/13 Time: _____ Gas Water WW Acct #: 40-50575-4

Name: Jennifer Chaplic Mobile Number: 270-820-6013

Address: 100 Harper Circle

Work to be Done:

New Meter# 219976886 New Reading _____

Turn on & Read 1400 Old Reading 1397 12/13

Read and Lock _____ Set Meter and Lock _____

Reading Only _____ Locate Line _____

Read and Lock (Nonpayment) _____ Get Meter _____
Number _____

Check Pressure _____ Flush Line _____ Check & Leak _____

Unlock Only and Read (Do Not Turn On) _____

Special Instructions Turn on, new customer

Dep.
meter
Card in Book

Work Done:

Flushed: Yes No GPM: _____ How Long: _____ Water Logs: _____

Water Leak: Yes No GPM: _____ How Long: _____ Water Logs: _____

Parts Used to Complete Job: _____

COMPLETED

By: MA Date: 12/14/20

Comments: Gas turned back on, furnace lit

Work Completed By: B. Jones Date Completed: 12-13-22

Time Started: _____ Time Ended: _____

Customer signature _____ date _____

Equal Opportunity Employer and Service Provider

The employees of Drakesboro are not trained HVAC personnel. Lighting of pilots are a courtesy and the City can not be held liable.

Meter Turn On and Turn Off Form - 1201

City/Company:

Information

Turn On Turn Off

Date:

Time:

Address:

Meter Number:


Meter Reading:

Reason for Turn Off/On?

Was the Meter Valve Locked? Yes No

Additional Remarks:

Completed By:

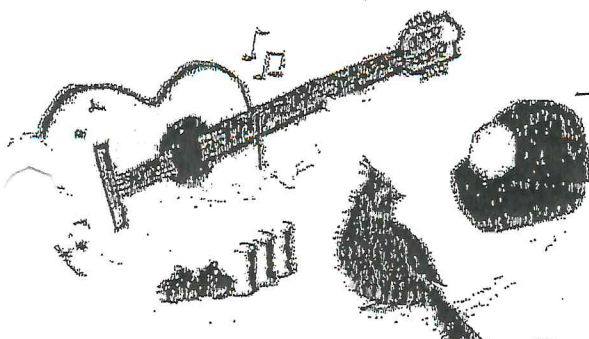

CITY OF DRAKESBORO

P.O. Box 129 • Mose Rager Blvd. • Drakesboro, KY 42337
270-476-8986
(888) 662-2406 (Voice/TTY); (866) 557-5762 (Español)

Drakesboro Work Order

Work Order #: _____

Date: 12/12 Time: _____ Gas Water WW Acct #: 10-4400-13

Name: Tara Palisano Mobile Number: 941-467-5860

Address: 3498 US Hwy 431 S Bmont

Work to be Done:

New Meter# 17242265 New Reading 6810

Turn on & Read _____ Old Reading 6751 12/12

Read and Lock _____ Set Meter and Lock _____

Reading Only _____ Locate Line (See Below) _____

Read and Lock (Nonpayment) _____ Get Meter _____

Number _____

Check Pressure _____ Flush Line _____ Check & Leak _____

Unlock Only and Read (Do Not Turn On) _____

Special Instructions veread

Work Done:

Flushed: Yes No GPM: _____ How Long: _____ Water Logs: _____

Water Leak: Yes No GPM: _____ How Long: _____ Water Logs: _____

Parts Used to Complete Job: _____

Comments: Reread meter

Work Completed By: BA & BJ Date Completed: 12-17-22

Time Started: _____ Time Ended: _____

Customer signature _____ date _____


Equal Opportunity Employer and Service Provider

The employees of Drakesboro are not trained HVAC personnel. Lighting of pilots are a courtesy and the City can not be held liable.

COMPLETED
By: MMA Date: 12/13/22

CITY OF DRAKESBORO

P.O. Box 129 • Mose Rager Blvd. • Drakesboro, KY 42337
270-476-8986
(888) 662-2406 (Voice/TTY); (866) 557-5762 (Español)

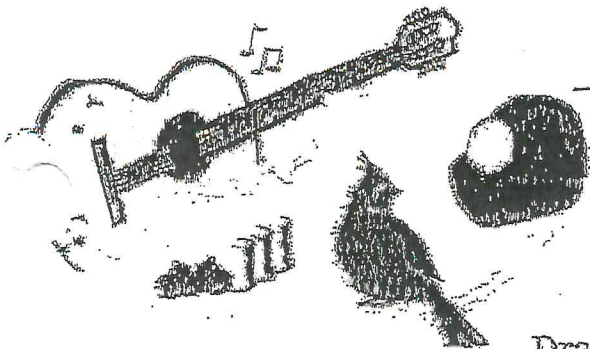

Drakesboro Work Order

Work Order #: _____

Date: 12/6 Time: _____ **Gas** Water WW Acct #: 10-15220-2

Name: Martha Campfield Mobile Number: (270)820-3146

Address: 2019 Beechcreek Boulevard rd

Work to be Done:

New Meter# 485843 ***** New Reading 1599 By AP Date: 12/6/22

Turn on & Read _____ Old Reading 11064 11/28

Read and Lock _____ Set Meter and Lock _____

Reading Only _____ Locate Line (See Below)

Read and Lock (Nonpayment) _____ Get Meter
Number _____

Check Pressure _____ Flush Line _____ Check & Leak _____

Unlock Only and Read (Do Not Turn On) _____

Special Instructions replaced (read error) corrected

Work Done:

COMPLETED
By: MA Date: 12/6

Flushed: Yes No GPM: _____ How Long: _____ Water Logs: _____

Water Leak: Yes No GPM: _____ How Long: _____ Water Logs: _____

Parts Used to Complete Job:

Comments:

Work Completed By: B. Albed Date Completed: 12/6/22


Time Started: _____ Time Ended: _____

Customer signature _____ date _____

Equal Opportunity Employer and Service Provider

The employees of Drakesboro are not trained HVAC personnel. Lighting of pilots are a courtesy and the City can not be held liable.

CITY OF DRAKESBORO

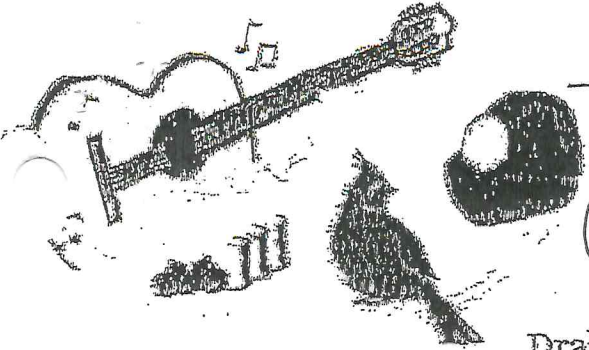

P.O. Box 129 • Mose Rager Blvd. • Drakesboro, KY 42337
270-476-8986
(888) 662-2406 (Voice/TTY); (866) 557-5762 (Español)

Schedule on Friday
Call Friday morning

Drakesboro Work Order Work Order #: _____

Date: 11/30/22 Time: 12:25 Gas Water WW Acct #: 20-18290-066

Name: Leslie Simpson Mobile Number: 270-225-7488

Address: 31 Chumley Ln.

Work to be Done:

New Meter# 216308 New Reading _____

Turn on & Read 4895 Old Reading 4712 (6/16/22)

Read and Lock _____ Set Meter and Lock _____

Reading Only _____ Locate Line _____ (See Below)

Read and Lock (Nonpayment) _____ Get Meter _____

Number _____

Check Pressure Flush Line _____ Check & Leak _____

Unlock Only and Read (Do Not Turn On) _____

Special Instructions Needs pressure test & Turn on if OK

✓ Flip page for reads
✓ make acct active

COMPLETED
By: DP Date: 12/6/22

Work Done:

Flushed: Yes No GPM: _____ How Long: _____ Water Logs: _____

Water Leak: Yes No GPM: _____ How Long: _____ Water Logs: _____

Parts Used to Complete Job: _____

Comments: Pressure test & meter bar test done no leaks
turned gas on fired off outside furnace

Work Completed By: BA & BJ Date Completed: 12-2-22

Time Started: _____ Time Ended: _____

Customer signature _____ date _____

Equal Opportunity Employer and Service Provider

The employees of Drakesboro are not trained HVAC personnel. Lighting of pilots are a courtesy and the City can not be held liable.



CITY OF DRAKESBORO

P.O. Box 129 • Mose Rager Blvd. • Drakesboro, KY 42337
270-476-8986
(888)662-2406 (Voice/TTY): (866)577-5762 (Español)

Date 12-2-22

Time 10:15

Pressure Test for Gas Line

Plumber Information:

License # _____

Phone # _____

Name: _____

Address: _____

Meter read at time of Pressure Test 4895

Customer: Leslie Simpson

Pressure Tested for 10 minutes.


Address: 31 Chunley Ln.

At 20 lbs of Pressure.

Signature of Licensed Plumber

A handwritten signature in black ink, appearing to be 'R. Simpson', written over a horizontal line.

Signature of City of Drakesboro gas Employee and Russmar Representative

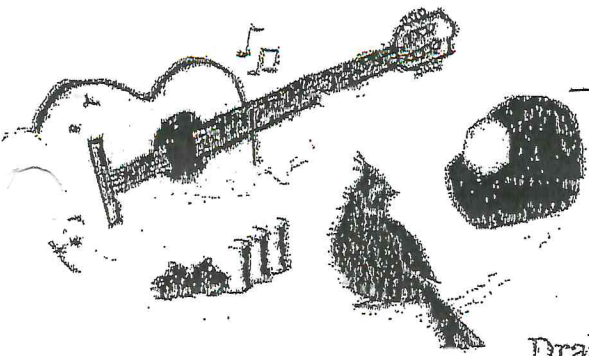

CITY OF DRAKESBORO

P.O. Box 129 • Mose Rager Blvd. • Drakesboro, KY 42337
270-476-8986
(888) 662-2406 (Voice/TTY); (866) 557-5762 (Español)

Drakesboro Work Order

Work Order #: _____

Date: 12/1/22 Time: _____ Gas Water WW Acct #: 2-10421-01

Name: Rita Shingler Stecker Mobile Number: _____

Address: 700 Jones Ave #3

Work to be Done:

- New Meter# _____ New Reading _____
- Turn on & Read _____ Old Reading _____
- Read and Lock _____ Set Meter and Lock _____
- Reading Only _____ Locate Line (See Below)
- Read and Lock (Nonpayment) _____ Get Meter _____
- Number _____
- Check Pressure _____ Flush Line _____ Check & Leak _____
- Unlock Only and Read (Do Not Turn On) _____
- Special Instructions has possible leak @ meter

COMPLETED
BY: AP Date: 12/1/22

Work Done:

- Flushed: Yes No GPM: _____ How Long: _____ Water Logs: _____
- Water Leak: Yes No GPM: _____ How Long: _____ Water Logs: _____

Parts Used to Complete Job:

Comments: Checked meter not spinning

Work Completed By: BA & BS Date Completed: 12-2-22

Time Started: _____ Time Ended: _____

Customer signature _____ date _____

Equal Opportunity Employer and Service Provider

The employees of Drakesboro are not trained HVAC personnel. Lighting of pits are a courtesy and the City can not be held liable.