

DRAKESBORO WORK ORDER

Work Order #: _____

DATE: _____ Time: _____ Gas Water WW Acct #: _____

NAME: City of Drakesboro Meter Number: _____

ADDRESS: 212 Mose Rager Blvd, Drakesboro, Ky

WORK TO BE DONE:

NEW METER # _____ NEW READING _____

TURN ON & READ _____ OLD READING _____

READ and LOCK _____ SET METER and LOCK _____

READING ONLY _____ LOCATE LINE (SEE BELOW) _____

READ and LOCK (NON PAYMENT) _____ GET METER NUMBER _____

CHECK PRESSURE _____ FLUSH LINE _____ CHECK f. LEAK _____

UNLOCK ONLY and READ (DO NOT TURN ON) _____

SPECIAL INSTRUCTIONS: Installation of pipeline markers.

WORK DONE:

FLUSHED: Yes No GPM: _____ How Long: _____ Water Loss: _____

WATER LEAK: Yes No GPM: _____ How Long: _____ Water Loss: _____


PARTS USED TO COMPLETE JOB:

50 Pipeline Markers

COMMENTS: Pipeline markers have been installed all up us Hwy 431, on Hwy 176, Hwy 246, and Hwy 70. Will continue to instal pipe line markers until system is sufficiently covered.

WORK COMPLETED BY: Will S... DATE COMPLETED: 7-26-19

TIME STARTED: _____ TIME FINISHED: _____

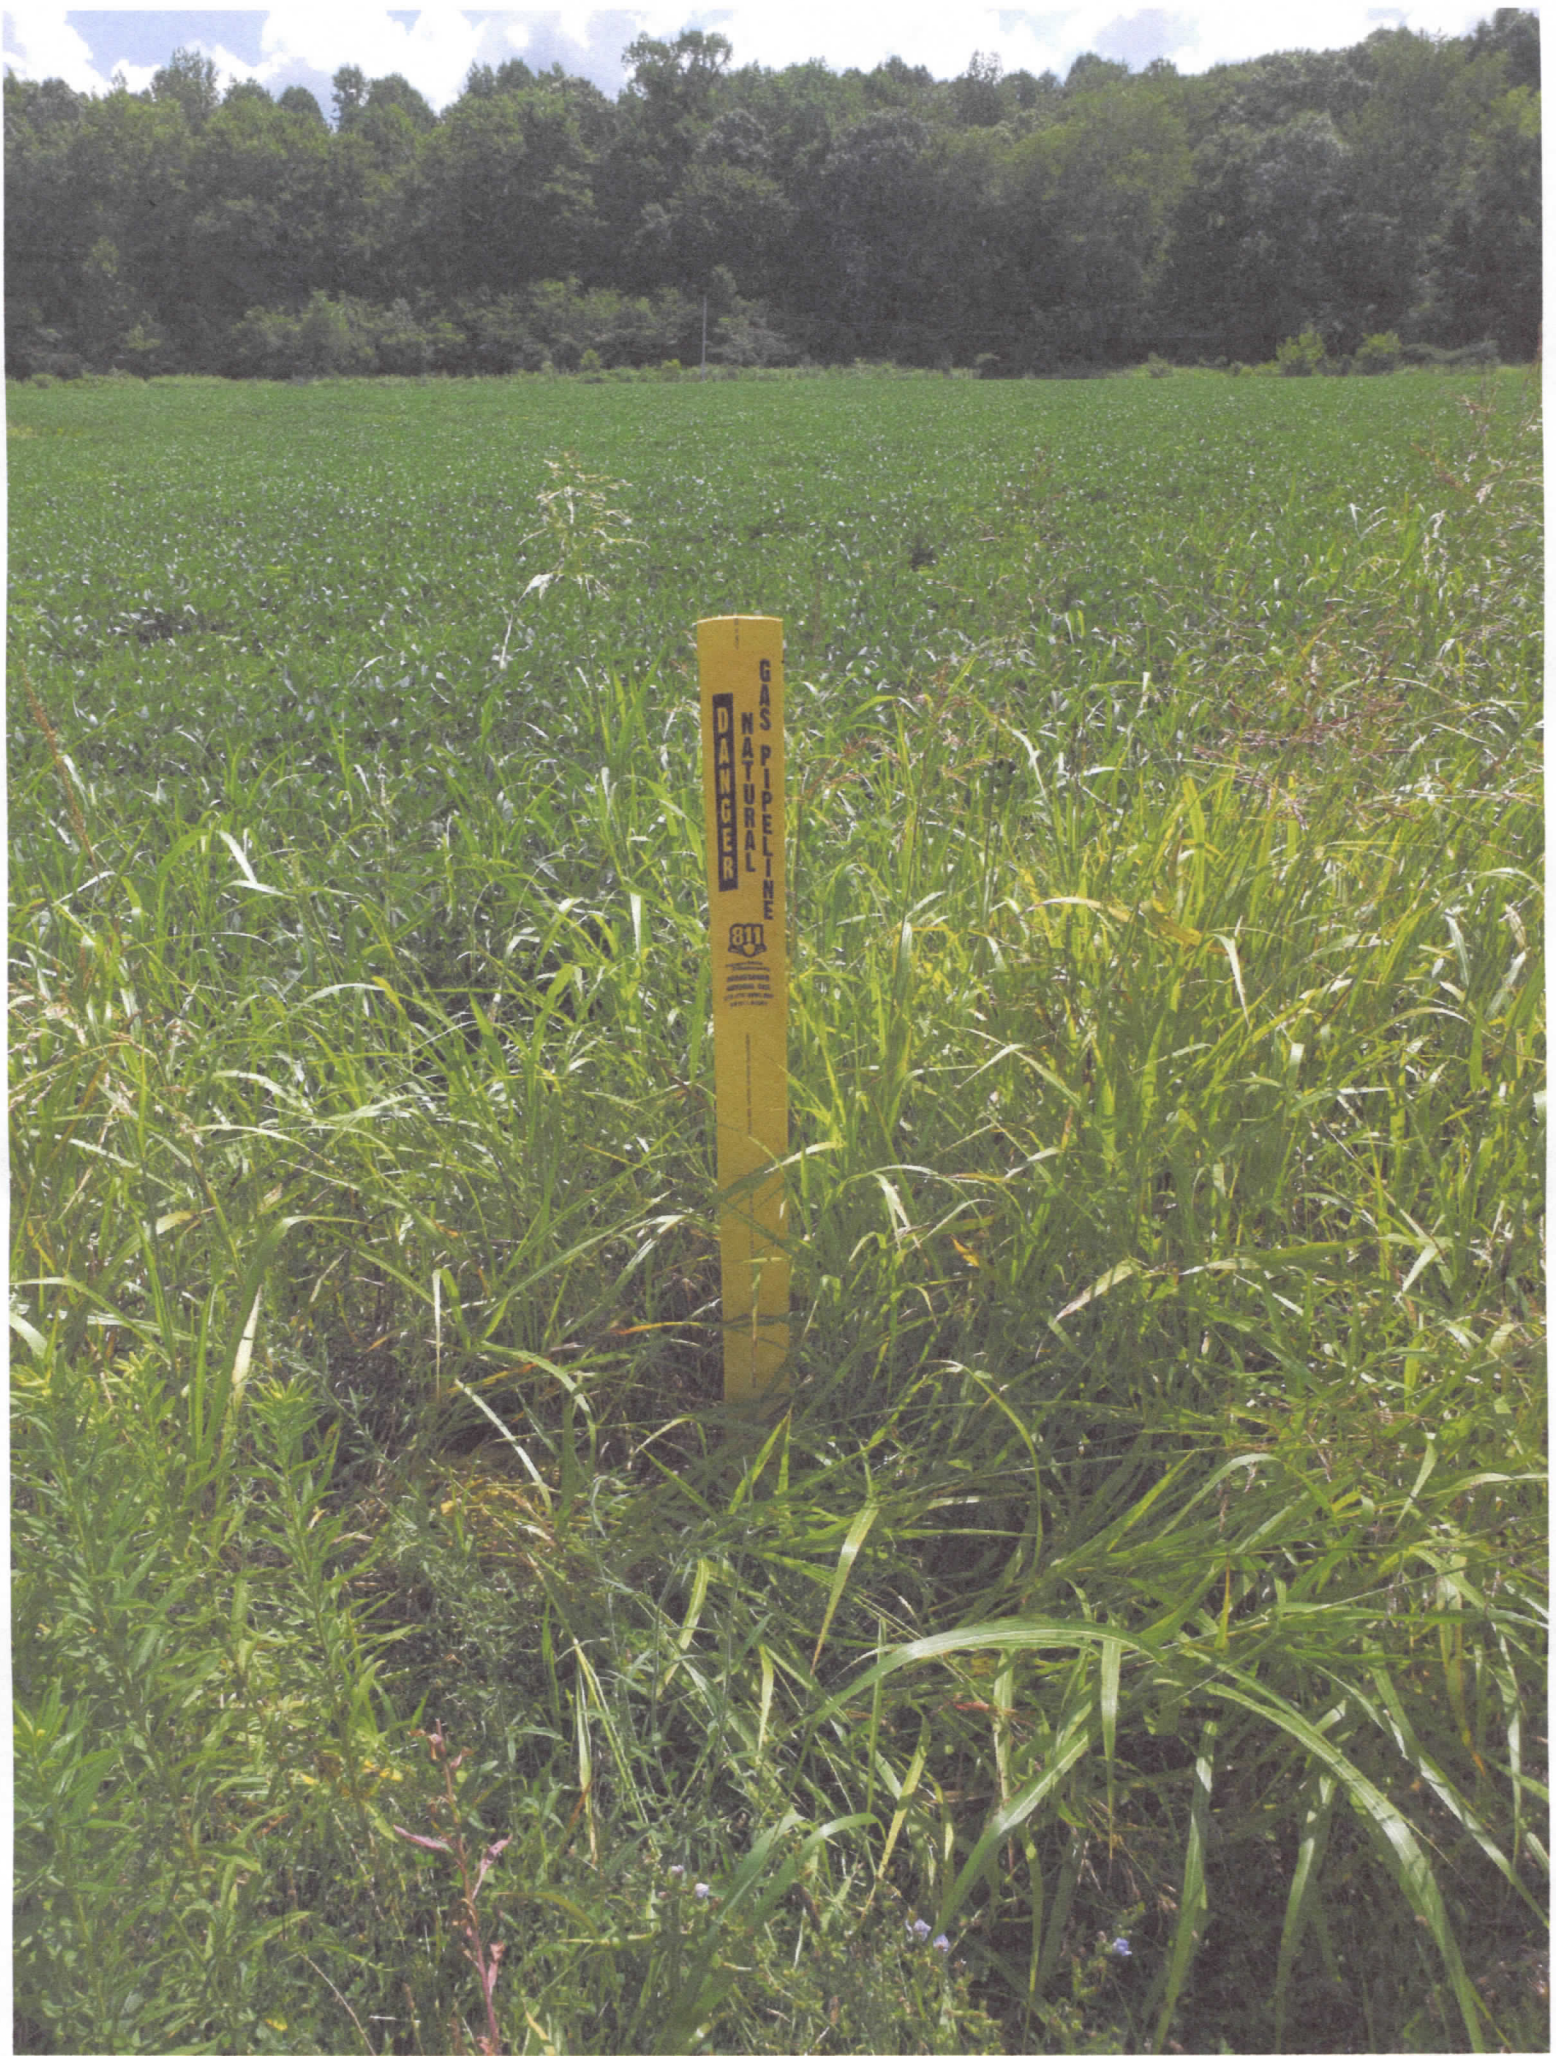

GAS PIPELINE
DANGER

811
MISSISSIPPI
UTILITY SERVICE
COUNCIL

DRAKESBORO WORK ORDER

Work Order #: _____

DATE: 7-18-19 Time: _____ Gas Water WW Acct #: _____

NAME: Rocky Hicks Meter Number: _____

ADDRESS: 203 Broad Street, Drakesboro, Ky.

WORK TO BE DONE:

NEW METER # _____ NEW READING _____

TURN ON & READ _____ OLD READING _____

READ and LOCK _____ SET METER and LOCK _____

READING ONLY _____ LOCATE LINE (SEE BELOW)

READ and LOCK (NON PAYMENT) _____ GET METER NUMBER _____

CHECK PRESSURE _____ FLUSH LINE _____ CHECK f. LEAK _____

UNLOCK ONLY and READ (DO NOT TURN ON) _____

SPECIAL INSTRUCTIONS: Service instal

WORK DONE:

FLUSHED: Yes No GPM: _____ How Long: _____ Water Loss: _____

WATER LEAK: Yes No GPM: _____ How Long: _____ Water Loss: _____

PARTS USED TO COMPLETE JOB:

2" x 1/2 steel tap

1/2 x 3/4 stub coupling

1 1/2" 1/2 polly

3/4 EFV / 320 FT 3/4 polly riser

3/4 steel to polly riser

lock valve, 6" 3/4 nipple

Regulator, 8" x 1" nipple 1/2"

1" x 6" nipple / meter bar

COMMENTS:

Pressure test from riser to tap

@ 90 psi for 30 min.

2x spud, nut, plug.

WORK COMPLETED BY: Rocky Hicks DATE COMPLETED: 7-18-19

TIME STARTED: _____ TIME FINISHED: _____



1/2 x 3/4
Coupling

↑
Anode wire
8" From Tap

3/4 x 3/4
EFV



Distance ⓘ

320 ft ▼



VISUAL INSPECTION OF MAINS AND SERVICE PIPELINES

[Redacted]			
[Redacted]			
Steel	✓ Excellent	✓ Localized	Millwrap ✓
PE	Good	General	Enamel
Cast Iron	Slight Pitting	Other	Rockets
CSST	Extreme Pitting	Pitting Depth	Oxidemp
Main	✓ Hole/Voids		Xtremost
Service	Graphitization		Mastic
Other	Bent		Cold Roll
	Broken		Hot Wrap
	Other		Heat Shrink
[Redacted]			
Good	✓ Rock	✓ Dry	✓ Main Extension ✓
Poor	Cluder	Wet/Swampy	Service Tap
Damaged	Clay	✓ Normal	Leak Repair
Other	Loam	✓ Moisture Range (3-5)	Re-routing
	Sand	Moisture Range (5-8)	Third Party
	Allayion		Abandonment
	Other		Deactivation
			Utility Theft
			Other

Description/Comments:

← Inspection

305

← Driveway

← 2" Main

Kennedy Jones Ave

N
W
E

Broad Street

Donald Sims
7-18-19

DRAKESBORO WORK ORDER

Work Order #: 100

DATE: 7-22-19 Time: Gas Water WW Acct #: _____

NAME: Robert Stover Meter Number: _____

ADDRESS: 219 Christain St

270-820-8381

WORK TO BE DONE:

- NEW METER # _____ NEW READING _____
- TURN ON & READ _____ OLD READING _____
- READ and LOCK _____ SET METER and LOCK _____
- READING ONLY _____ LOCATE LINE (SEE BELOW) _____
- READ and LOCK (NON PAYMENT) _____ GET METER NUMBER _____
- CHECK PRESSURE _____ FLUSH LINE _____ CHECK f. LEAK _____
- UNLOCK ONLY and READ (DO NOT TURN ON) _____

SPECIAL INSTRUCTIONS: Has no gas. Had some gas Saturday. Please check to see if there is a problem.

WORK DONE:

FLUSHED: Yes No GPM: _____ How Long: _____ Water Loss: _____

WATER LEAK: Yes No GPM: _____ How Long: _____ Water Loss: _____

PARTS USED TO COMPLETE JOB:

COMMENTS: Stover had turned off outside valve by heat unit by hitting with lawnmower

WORK COMPLETED BY: [Signature] DATE COMPLETED: 7-22-19

TIME STARTED: _____ TIME FINISHED: _____

DRAKESBORO WORK ORDER

Work Order #: _____

DATE: 7-17-19 Time: _____ Gas Water WW Acct #: _____

NAME: Charles Lindsey Meter Number: _____

ADDRESS: 10 Hershel Davis Lane

270-860-6630

WORK TO BE DONE:

NEW METER # _____ NEW READING _____

TURN ON & READ _____ OLD READING 511

READ and LOCK _____ SET METER and LOCK _____

READING ONLY _____ LOCATE LINE (SEE BELOW)

READ and LOCK (NON PAYMENT) _____ GET METER NUMBER _____

CHECK PRESSURE _____ FLUSH LINE _____ CHECK f. LEAK _____

UNLOCK ONLY and READ (DO NOT TURN ON) _____

SPECIAL INSTRUCTIONS:

gas meter ~~set~~ turned off for
summer customer knows about \$30⁰⁰
reconnect. fee

WORK DONE:

FLUSHED: Yes No GPM: _____ How Long: _____ Water Loss: _____

WATER LEAK: Yes No GPM: _____ How Long: _____ Water Loss: _____

PARTS USED TO COMPLETE JOB:

COMMENTS: off + LOCK

WORK COMPLETED BY: J. Shaw DATE COMPLETED: 7-19-19

TIME STARTED: _____ TIME FINISHED: _____

DRAKESBORO WORK ORDER

Work Order #: _____

DATE: 7-16-19

Time: _____

Gas

Water

WW Acct #: _____

NAME: _____

Meter Number: _____

ADDRESS: 71 Reynolds Drive, Beechmont, Ky.

WORK TO BE DONE:

NEW METER # _____ NEW READING _____

TURN ON & READ _____ OLD READING _____

READ and LOCK _____ SET METER and LOCK _____

READING ONLY _____ LOCATE LINE (SEE BELOW)

READ and LOCK (NON PAYMENT) _____ GET METER NUMBER _____

CHECK PRESSURE _____ FLUSH LINE _____ CHECK f. LEAK

UNLOCK ONLY and READ (DO NOT TURN ON) _____

SPECIAL INSTRUCTIONS: 911 called, customer said area smelled like gas strong. Dispatched - 8:23
On scene - 8:35
Cleared - 9:40

WORK DONE:

FLUSHED: Yes No GPM: _____ How Long: _____ Water Loss: _____

WATER LEAK: Yes No GPM: _____ How Long: _____ Water Loss: _____

PARTS USED TO COMPLETE JOB:

COMMENTS: Upon arrival, smell of gas was strong. Used flame pack on the area. Ended up finding a propane tank that a residence had been working on that was purging propane strong. Tightened 4 screws, stopped leak.

WORK COMPLETED BY: Dee S DATE COMPLETED: 7-16-19

TIME STARTED: _____ TIME FINISHED: _____

DRAKESBORO WORK ORDER

Work Order #: _____

DATE: 7-15-19

Time: Gas Water

WW Acct #: _____

NAME: Mike Dearmond

Meter Number: _____

ADDRESS: 424 Beech Creek Rd

Beech Creek

WORK TO BE DONE:

NEW METER # _____ NEW READING _____

TURN ON & READ _____ OLD READING _____

READ and LOCK _____ SET METER and LOCK _____

READING ONLY _____ LOCATE LINE _____ (SEE BELOW)

READ and LOCK (NON PAYMENT) 3082 GET METER NUMBER _____

CHECK PRESSURE _____ FLUSH LINE _____ CHECK f. LEAK _____

UNLOCK ONLY and READ (DO NOT TURN ON) _____

SPECIAL INSTRUCTIONS: wants meter shut off for summer. Customer knows about \$30⁰⁰ reconnect fee.

WORK DONE:

FLUSHED: Yes No GPM: _____ How Long: _____ Water Loss: _____

WATER LEAK: Yes No GPM: _____ How Long: _____ Water Loss: _____

PARTS USED TO COMPLETE JOB:

COMMENTS: OFF + LOCK

WORK COMPLETED BY: J. Shaw

DATE COMPLETED: 7-15-19

TIME STARTED: _____

TIME FINISHED: _____

DRAKESBORO WORK ORDER

Work Order #: _____

DATE: 7-15-19

Time: _____

Gas

Water

WW

Acct #: _____

NAME: Kenny Folker son

Meter Number: _____

ADDRESS: 3010 US 70

WORK TO BE DONE:

NEW METER # 215051 NEW READING _____

TURN ON & READ _____ OLD READING _____

READ and LOCK _____ SET METER and LOCK _____

READING ONLY _____ LOCATE LINE (SEE BELOW)

READ and LOCK (NON PAYMENT) 7617 GET METER NUMBER _____

CHECK PRESSURE _____ FLUSH LINE _____ CHECK f. LEAK _____

UNLOCK ONLY and READ (DO NOT TURN ON) _____

SPECIAL INSTRUCTIONS:

meter pulled for lack of access

WORK DONE:

FLUSHED: Yes No GPM: _____ How Long: _____ Water Loss: _____

WATER LEAK: Yes No GPM: _____ How Long: _____ Water Loss: _____

PARTS USED TO COMPLETE JOB:

COMMENTS: Customer layed tree's across the driveway denying access to the meter. Meter was pulled

WORK COMPLETED BY: Ollie

DATE COMPLETED: 7-15-19

TIME STARTED: _____

TIME FINISHED: _____

DRAKESBORO WORK ORDER

Work Order #: _____

DATE: 7-15-19 Time: _____ Gas Water WW Acct #: _____

NAME: Bruce Penrod Meter Number: _____

ADDRESS: 401 Merle Travis
270-977-5748

WORK TO BE DONE:

NEW METER # _____ NEW READING _____

TURN ON & READ _____ OLD READING _____

READ and LOCK _____ SET METER and LOCK _____

READING ONLY _____ LOCATE LINE (SEE BELOW) _____

READ and LOCK (NON PAYMENT) 3127 GET METER NUMBER _____

CHECK PRESSURE _____ FLUSH LINE _____ CHECK f. LEAK _____

UNLOCK ONLY and READ (DO NOT TURN ON) _____

SPECIAL INSTRUCTIONS: wants gas meter shut off for summer. Customer knows about \$30⁰⁰ reconnect fee

WORK DONE:

FLUSHED: Yes No GPM: _____ How Long: _____ Water Loss: _____

WATER LEAK: Yes No GPM: _____ How Long: _____ Water Loss: _____

PARTS USED TO COMPLETE JOB:

COMMENTS: OFF + Lock

WORK COMPLETED BY: J. Shaw DATE COMPLETED: 7-15-19

TIME STARTED: _____ TIME FINISHED: _____

DRAKESBORO WORK ORDER

Work Order #: _____

DATE: 7-15-19 Time: 10:39 Gas Water WW Acct #: 10-10005-1

NAME: Larry Benton Meter Number: _____

ADDRESS: 1888 U.S. Hwy 431 South Browder, KY

WORK TO BE DONE:

NEW METER # _____ NEW READING _____

TURN ON & READ _____ OLD READING _____

READ and LOCK 2112 SET METER and LOCK _____

READING ONLY _____ LOCATE LINE (SEE BELOW) _____

READ and LOCK (NO TURN ON) _____ GET METER NUMBER _____

CHECK PRESSURE _____ FLUSH LINE _____ CHECK f. LEAK _____

UNLOCK ONLY and READ (DO NOT TURN ON) _____

SPECIAL INSTRUCTIONS: Wants meter turned off for the summer @ the Barber Shop - but (not) for the house - Barber Shop only

WORK DONE:

FLUSHED: Yes No GPM: _____ How Long: _____ Water Loss: _____

WATER LEAK: Yes No GPM: _____ How Long: _____ Water Loss: _____

PARTS USED TO COMPLETE JOB:

COMMENTS: Off & Locked

WORK COMPLETED BY: [Signature] DATE COMPLETED: 7-15-19

TIME STARTED: _____ TIME FINISHED: _____

DRAKESBORO WORK ORDER

Work Order #: _____

DATE: 7-15-19

Time: _____

Gas

Water

WW Acct #: _____

NAME: _____

Meter Number: _____

ADDRESS: 3325 US 431, Belmont Ky

WORK TO BE DONE:

NEW METER # _____ NEW READING _____

TURN ON & READ _____ OLD READING _____

READ and LOCK _____ SET METER and LOCK _____

READING ONLY _____ LOCATE LINE _____ (SEE BELOW)

READ and LOCK (NON PAYMENT) _____ GET METER NUMBER _____

CHECK PRESSURE _____ FLUSH LINE _____ CHECK f. LEAK

UNLOCK ONLY and READ (DO NOT TURN ON) _____

SPECIAL INSTRUCTIONS: Customer called and said they
smelled gas in the area called 5:44
On scene 5:57
cleared 6:55

WORK DONE:

FLUSHED: Yes No GPM: _____ How Long: _____ Water Loss: _____

WATER LEAK: Yes No GPM: _____ How Long: _____ Water Loss: _____

PARTS USED TO COMPLETE JOB:

Flame Pack

Soapy Water

COMMENTS: Sprayed Every Meter set on the block.
Used Flame pack and surveyed the whole area.
Nothing was found. No smell white there.

WORK COMPLETED BY: Dee St

DATE COMPLETED: 7-15-19

TIME STARTED: _____

TIME FINISHED: _____

DRAKESBORO WORK ORDER

Work Order #: _____

DATE: 7-12-19

Time: _____

Gas

Water

WW

Acct #: _____

NAME: James Garrett

Meter Number: _____

ADDRESS: 4737 US 431 S

270 543 4138

Belton Ky

WORK TO BE DONE:

NEW METER # _____ NEW READING _____

TURN ON & READ _____ OLD READING _____

READ and LOCK _____ SET METER and LOCK _____

READING ONLY _____ LOCATE LINE (SEE BELOW) _____

READ and LOCK (NON PAYMENT) _____ GET METER NUMBER _____

CHECK PRESSURE _____ FLUSH LINE _____ CHECK f. LEAK

UNLOCK ONLY and READ (DO NOT TURN ON) _____

SPECIAL INSTRUCTIONS:

Smells gas

WORK DONE:

FLUSHED: Yes No GPM: _____ How Long: _____ Water Loss: _____

WATER LEAK: Yes No GPM: _____ How Long: _____ Water Loss: _____

PARTS USED TO COMPLETE JOB:

2 Spud gaskets

Sensus New Regulator # 1013-894

1" Nipple 2-18

1" Nipple

COMMENTS:

Spray test showed old regulator had a small leak. Changed the regulator out with a new one. Stopped the leak.

WORK COMPLETED BY: D. Smith

DATE COMPLETED: 7-12-19

TIME STARTED: _____

TIME FINISHED: _____