

CITY OF DRAKESBORO

P.O. Box 129 • Mose Rager Blvd. • Drakesboro, KY 42337

270-476-8986

(888) 662-2406 (Voice/TTY); (866) 557-5762 (Español)



Drakesboro Work Order

Work Order #: 9721

Date: 9-7-21 Time: _____ Gas Water WW Acct #: _____

Name: Hwy 431 Mobile Number: _____

Address: Rectifier #1

Work to be Done:

New Meter# _____ New Reading _____

Turn on & Read _____ Old Reading _____

Read and Lock _____ Set Meter and Lock

Reading Only _____ Locate Line (See Below)

Read and Lock (Nonpayment) _____ Get Meter

Number _____

Check Pressure _____ Flush Line _____ Check & Leak _____

Unlock Only and Read (Do Not Turn On) _____

Special Instructions _____

Work Done:

Finished: Yes No GPM: _____ How Long: _____ Water Logs: _____

Water Leak: Yes No GPM: _____ How Long: _____ Water Logs: _____

Parts Used to Complete Job:

Comments: _____


Work Completed By: Completed by Jeff Roberts Date Completed: 9/7/21

Time Started: _____ Time Ended: 9

VISUAL INSPECTION OF MAINS AND SERVICE PIPELINES

Address	Hwy 431	Location	Rectifier 1		
TYPE	4"	CONDITION	CORROSION	COATING TYPE	
<input checked="" type="checkbox"/> Steel <input type="checkbox"/> PE <input type="checkbox"/> Cast Iron <input type="checkbox"/> CSST <input type="checkbox"/> Main <input type="checkbox"/> Service <input type="checkbox"/> Other	<input checked="" type="checkbox"/> Excellent <input type="checkbox"/> Good <input type="checkbox"/> Slight Pitting <input type="checkbox"/> Extreme Pitting <input type="checkbox"/> Hole/Voids <input type="checkbox"/> Graphitization <input type="checkbox"/> Bent <input type="checkbox"/> Broken <input type="checkbox"/> Other	<input type="checkbox"/> Localized <input type="checkbox"/> General <input type="checkbox"/> Other	<input checked="" type="checkbox"/> Millwrap <input type="checkbox"/> Enamel <input type="checkbox"/> Roskote <input type="checkbox"/> Oxidemp <input type="checkbox"/> Xtrucoat <input type="checkbox"/> Mastie <input type="checkbox"/> Cold Roll <input type="checkbox"/> Hot Wrap <input type="checkbox"/> Other		
		Pitting Depth ?			
		Inches			
		Centimeter			
COATING CONDITION	SOIL TYPE	SOIL COMPOSITION	EXCAVATION		
<input checked="" type="checkbox"/> Good <input type="checkbox"/> Poor <input type="checkbox"/> Damaged <input type="checkbox"/> Other	<input type="checkbox"/> Rock <input type="checkbox"/> Cinder <input checked="" type="checkbox"/> Clay <input type="checkbox"/> Loam <input type="checkbox"/> Sand <input type="checkbox"/> Alluvion <input type="checkbox"/> Other	<input type="checkbox"/> Dry <input type="checkbox"/> Wet/Swampy <input checked="" type="checkbox"/> Normal <input type="checkbox"/> Other	<input type="checkbox"/> Main Extension <input type="checkbox"/> Service Tap <input type="checkbox"/> Leak Repair <input type="checkbox"/> Re-routing <input type="checkbox"/> Third Party <input type="checkbox"/> Abandonment Section <input type="checkbox"/> Deactivation <input type="checkbox"/> Utility Theft <input checked="" type="checkbox"/> Other		
		Moisture Range			
		<input type="checkbox"/> 3-5 <input type="checkbox"/> 5-8			

Description/Comments:

Excavated 4" Steel Main on Hwy 431. Beck Mont 
 To Install Cao Weld Shot on Main for New Rectifier.
 C/P Reading Before Install of Rectifier
 -.537
 Coated all Pipe with Tape Coat.
See Pictures

Name	Jeffrey Smith	Date	9/7/2021
------	---------------	------	----------














MODEL DPM

1.3

DIGITAL POTENTIAL
METER

MGM
100 MILLER Co.

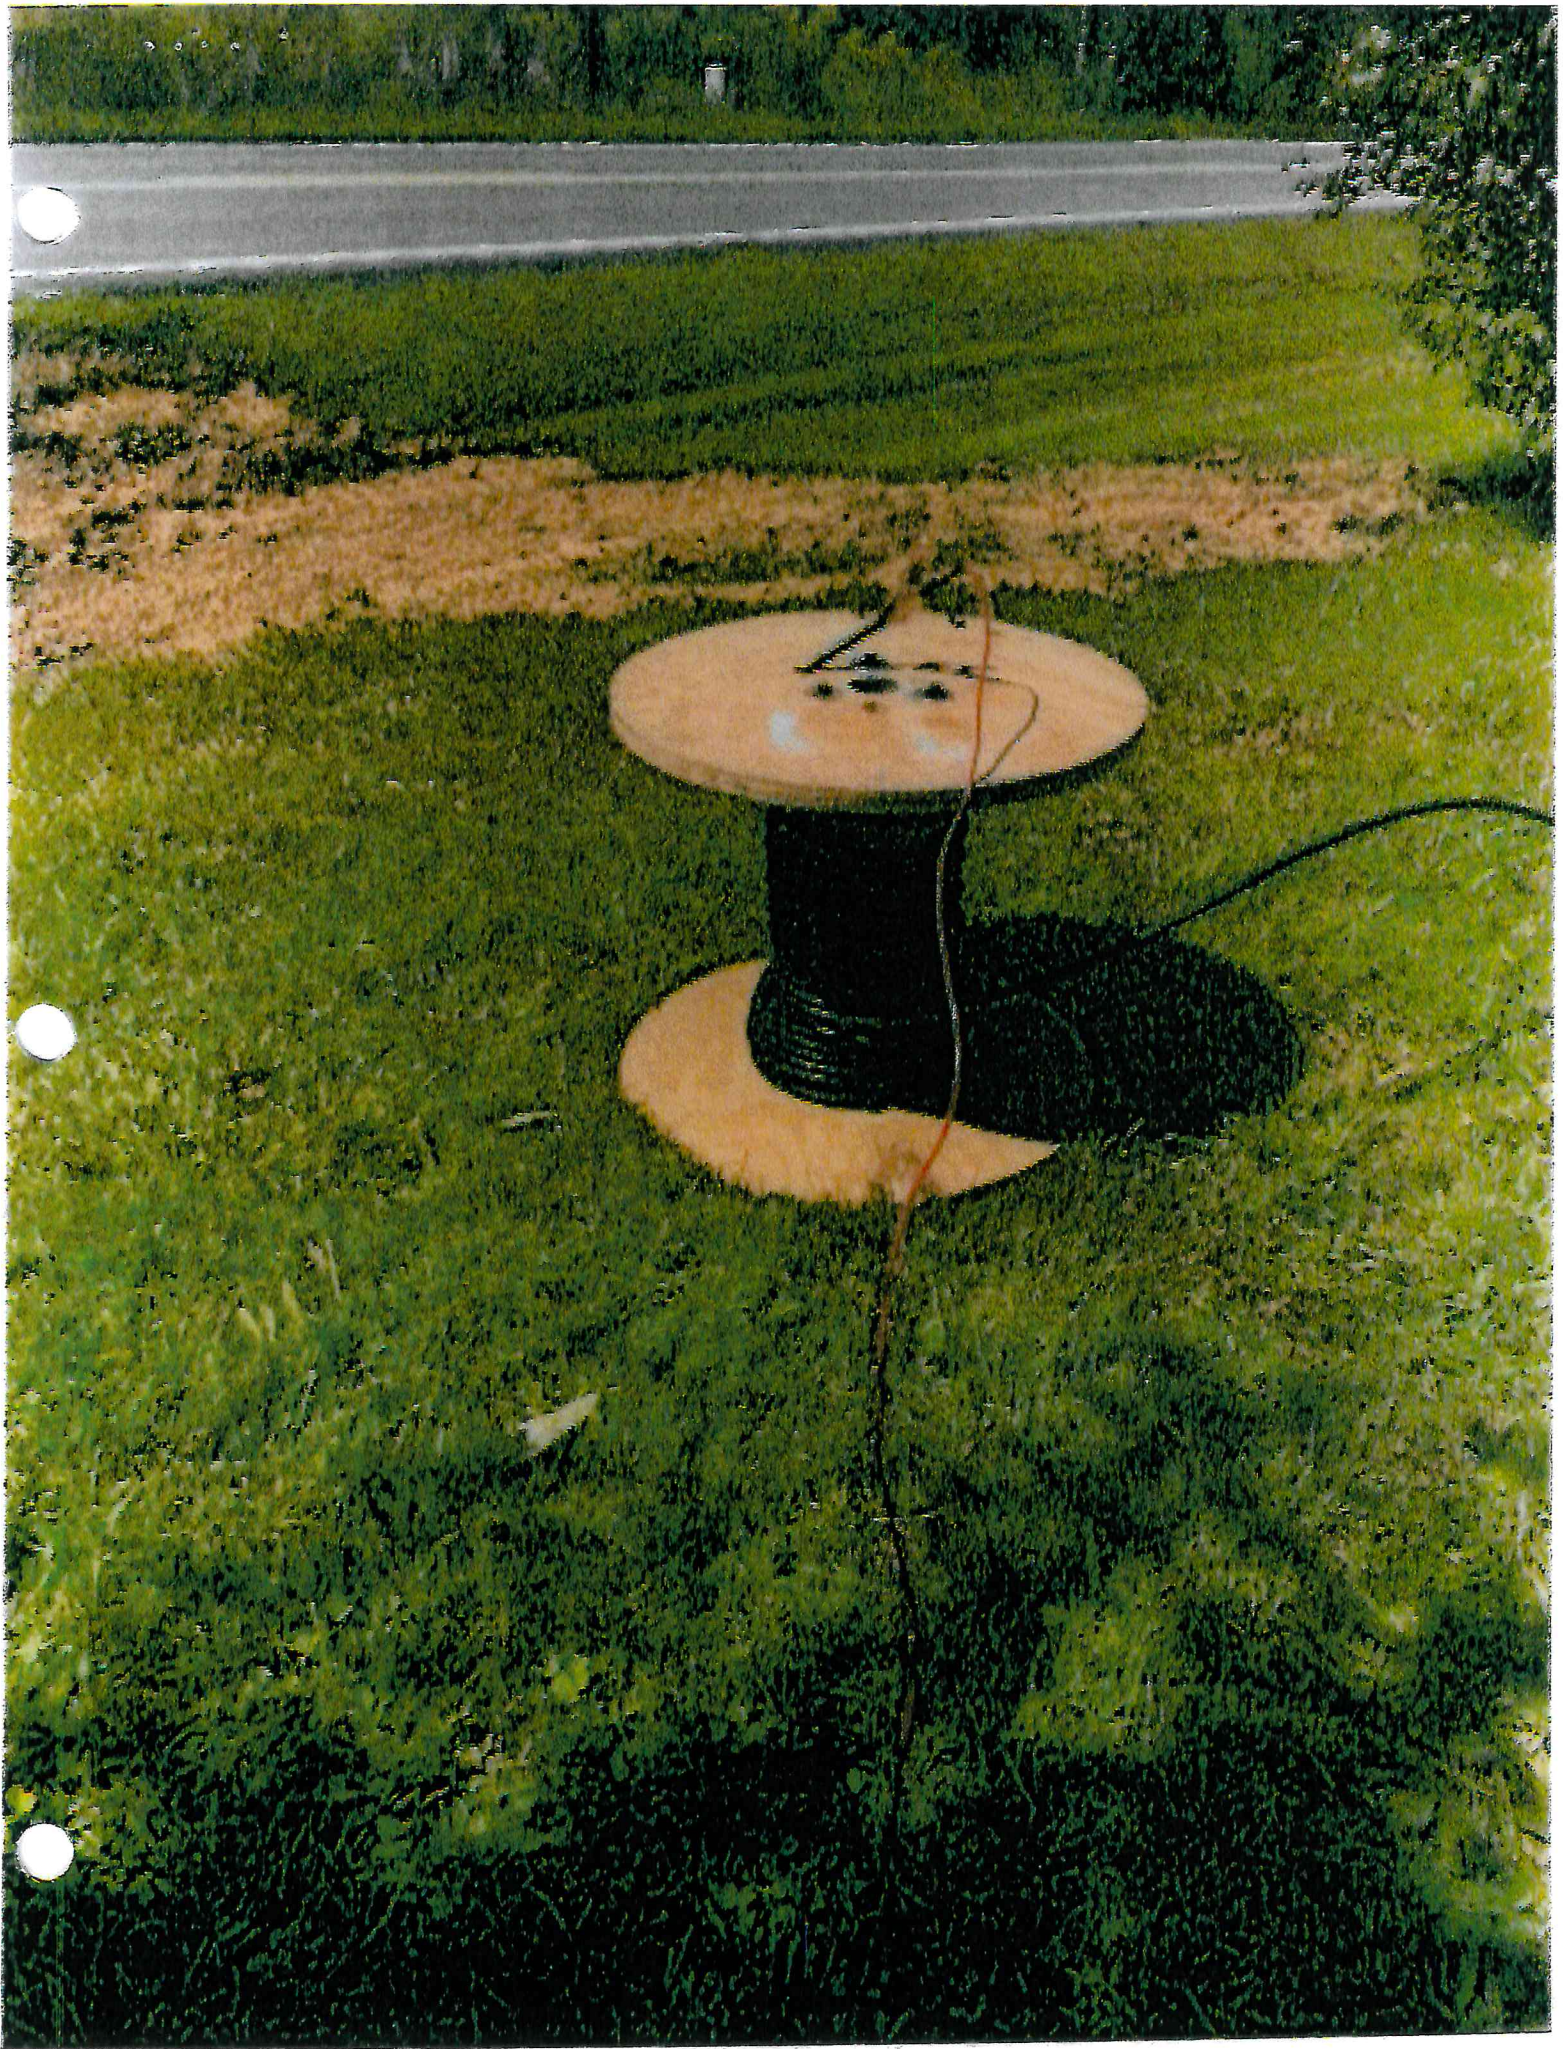


VISUAL INSPECTION OF MAINS AND SERVICE PIPELINES

Address IKE EVERLY Location Rectifier 2

TYPE <u>2"</u>	CONDITION	CORROSION	COATING TYPE
<input checked="" type="checkbox"/> Steel <input type="checkbox"/> PE <input type="checkbox"/> Cast Iron <input type="checkbox"/> CSST <input type="checkbox"/> Main <input type="checkbox"/> Service <input type="checkbox"/> Other	<input checked="" type="checkbox"/> Excellent <input type="checkbox"/> Good <input type="checkbox"/> Slight Pitting <input type="checkbox"/> Extreme Pitting <input type="checkbox"/> Hole/Voids <input type="checkbox"/> Graphitization <input type="checkbox"/> Bent <input type="checkbox"/> Broken <input type="checkbox"/> Other	<input type="checkbox"/> Localized <input type="checkbox"/> General <input type="checkbox"/> Other <p align="center"><u>N/A</u></p>	<input checked="" type="checkbox"/> Millwrap <input type="checkbox"/> Enamel <input type="checkbox"/> Roskote <input type="checkbox"/> Oxidemp <input type="checkbox"/> Xtrncoat <input type="checkbox"/> Mastic <input type="checkbox"/> Cold Roll <input type="checkbox"/> Hot Wrap <input type="checkbox"/> Other
		Pitting Depth ?	
		Inches	
		Centimeter	

COATING CONDITION	SOIL TYPE	SOIL COMPOSITION	EXCAVATION
<input checked="" type="checkbox"/> Good <input type="checkbox"/> Poor <input type="checkbox"/> Damaged <input type="checkbox"/> Other	<input type="checkbox"/> Rock <input type="checkbox"/> Cinder <input checked="" type="checkbox"/> Clay <input type="checkbox"/> Loam <input type="checkbox"/> Sand <input type="checkbox"/> Alluvion <input type="checkbox"/> Other	<input type="checkbox"/> Dry <input type="checkbox"/> Wet/Swampy <input checked="" type="checkbox"/> Normal <input type="checkbox"/> Other	<input type="checkbox"/> Main Extension <input type="checkbox"/> Service Tap <input type="checkbox"/> Leak Repair <input type="checkbox"/> Re-routing <input type="checkbox"/> Third Party <input type="checkbox"/> Abandonment Section <input type="checkbox"/> Deactivation <input type="checkbox"/> Utility Theft <input checked="" type="checkbox"/> Other
		Moisture Range	
		<input type="checkbox"/> 3-5	
		<input type="checkbox"/> 5-8	

Description/Comments:

Excavated 2" Steel Main on IKE EVERLY 

To install C&D weld shot on main for new Rectifier

C/P - Reading Before Install of Rectifier.

-, L649

Coated all pipe with Tape Coat

See Pictures

Name [Signature] Date 9/8/2021







