


CITY OF DRAKESBORO

P.O. Box 129 • Mose Rager Blvd. • Drakesboro, KY 42337
270-476-8986

COMPLETED (888) 662-2406 (Voice/TTY); (866) 557-5762 (Español)

By: AP Date: 11/30/22

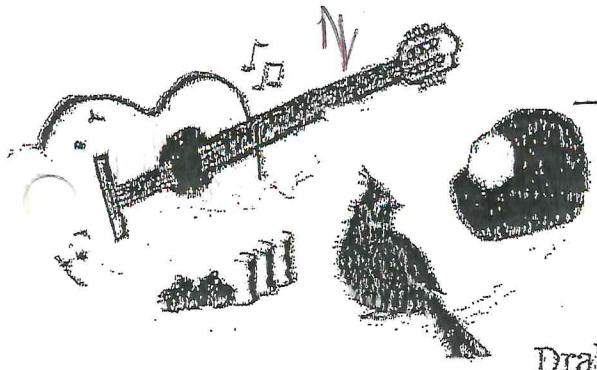

Drakesboro Work Order Work Order #: _____

Date: 11/30/22 Time: _____ Gas Water WW Acct #: 30-38300-02

Name: Jason + Tracy Harlan Mobile Number: 803-9975

Address: 60236 State Rte 176 Drakesboro Ky 42337

Work to be Done:

New Meter# 20P272983

New Reading _____

Turn on & Read _____

Old Reading 1147 (11/30/22)

Read and Lock _____

Set Meter and Lock _____

Reading Only 1147 _____

Locate Line (See Below) _____

Read and Lock (Nonpayment) _____
Number _____

Get Meter _____

Check Pressure _____

Flush Line _____ Check & Leak _____

Unlock Only and Read (Do Not Turn On) _____

Special Instructions Bought house

pd 100.00 deposit
CASH

- page put in book
- New acct made
- Set AS begin
- Dep. put in acct.

Work Done:

Flushed: Yes No GPM: _____ How Long: _____ Water Logs: _____

Water Leak: Yes No GPM: _____ How Long: _____ Water Logs: _____

Parts Used to Complete Job: _____

Comments: _____

Work Completed By: BA4 BJ Date Completed: 11-30-22

Time Started: _____ Time Ended: _____


Customer signature _____ date _____

Equal Opportunity Employer and Service Provider

The employees of Drakesboro are not trained HVAC personnel. Lighting of pilots are a courtesy and the City can not be held liable.

CITY OF DRAKESBORO

P.O. Box 129 • Mose Rager Blvd. • Drakesboro, KY 42337
270-476-8986
(888) 662-2406 (Voice/TTY); (866) 557-5762 (Español)

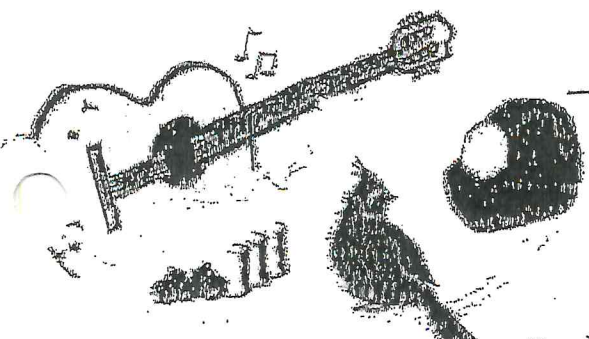

Drakesboro Work Order

Work Order #: _____

Date: 11/29/22 Time: _____ Gas Water WW Acct #: 50-83000-002
Name: Susan & Jimmy Todd Mobile Number: 980-721-1564
Address: 4964 Riverside Rd. Drakesboro Ky 42337

Work to be Done:

New Meter# 1672022 New Reading _____
Turn on & Read _____ Old Reading 11783
Read and Lock _____ Set Meter and Lock _____
Reading Only _____ Locate Line _____
Read and Lock (Nonpayment) _____ Get Meter _____
Number _____
Check Pressure _____ Flush Line _____ Check & Leak _____
Unlock Only and Read (Do Not Turn On) _____

COMPLETED
BY: AP (See Below) DATE: 11/30/22

Special Instructions check meter to see if working. Same read Aug 2022
Meter turned off 11/23/22, cust will no longer be using natural gas

Work Done:

Flushed: Yes No GPM: _____ How Long: _____ Water Logs: _____
Water Leak: Yes No GPM: _____ How Long: _____ Water Logs: _____

Parts Used to Complete Job:

Comments: meter off and locked will check if turned back on active

Work Completed By: BAA BS Date Completed: 11-30-22

Time Started: _____ Time Ended: _____


Customer signature _____ date _____

Equal Opportunity Employer and Service Provider

The employees of Drakesboro are not trained HVAC personnel. Lighting of pilots are a courtesy and the City can not be held liable.

CITY OF DRAKESBORO

P.O. Box 129 • Mose Rager Blvd. • Drakesboro, KY 42337
270-476-8986
(888) 662-2406 (Voice/TTY); (866) 557-5762 (Español)

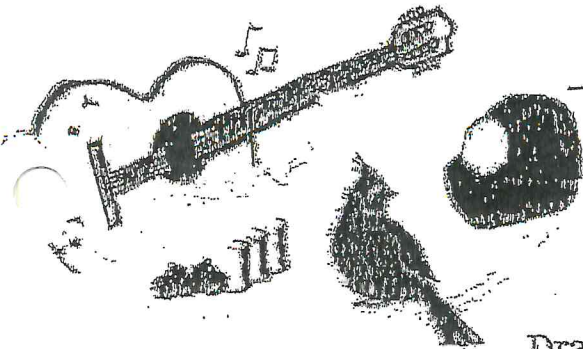

Drakesboro Work Order

Work Order #: _____

Date: 11/29/22 Time: _____

Gas Water WW Acct #: 50-75292-1

Name: Mike Camplin

Mobile Number: _____

Address: 206 St. Rt 2270

COMPLETED

By: AP Date: 11/30

Work to be Done:

New Meter# 151140 New Reading _____
 Turn on & Read _____ Old Reading 1421 (Since - April 27, 2020)
 Read and Lock _____ Set Meter and Lock _____
 Reading Only _____ Locate Line (See Below) _____
 Read and Lock (Nonpayment) _____ Get Meter _____
 Number _____
 Check Pressure _____ Flush Line _____ Check & Leak _____
 Unlock Only and Read (Do Not Turn On) _____
 Special Instructions Check meter to see if working

Work Done:

Flushed: Yes No GPM: _____ How Long: _____ Water Logs: _____
 Water Leak: Yes No GPM: _____ How Long: _____ Water Logs: _____

Parts Used to Complete Job:

Comments: Cracked meter, meter working properly

Work Completed By: BA & BJ

Date Completed: 11-30-22

Time Started: _____

Time Ended: _____

Customer signature _____ date _____

Equal Opportunity Employer and Service Provider


The employees of Drakesboro are not trained HVAC personnel. Lighting of pits is a courtesy and the City can not be held liable.

CITY OF DRAKESBORO

P.O. Box 129 • Mose Rager Blvd. • Drakesboro, KY 42337

270-476-8986

(888) 662-2406 (Voice/TTY); (866) 557-5762 (Español)

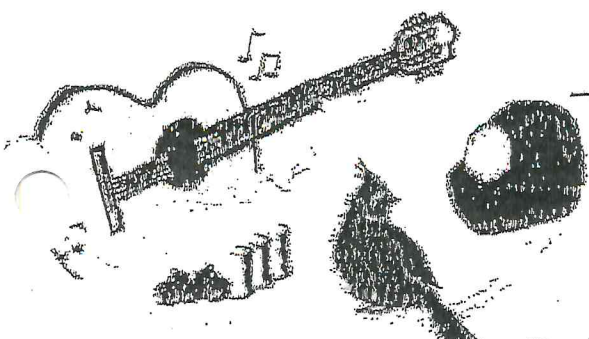

Drakesboro Work Order

Work Order #: _____

Date: 11/29/22 Time: _____ Gas Water WW Acct #: 50-80500-1

Name: Nancy Bull Mobile Number: no #

Address: 131 Corum Landing Rd.

Work to be Done:

New Meter# _____ New Reading _____
Turn on & Read _____ Old Reading 646 (since - 3/29/21)
Read and Lock _____ Set Meter and Lock _____
Reading Only _____ Locate Line _____ (See Below)
Read and Lock (Nonpayment) _____ Get Meter **COMPLETED**
Number _____ By: AP Date: 11/30/22
Check Pressure _____ Flush Line _____ Check & Leak _____
Unlock Only and Read (Do Not Turn On) _____
Special Instructions Check meter -
WORKING CORRECT

Work Done:

Flushed: Yes No GPM: _____ How Long: _____ Water Logs: _____
Water Leak: Yes No GPM: _____ How Long: _____ Water Logs: _____

Parts Used to Complete Job:

Comments:

Work Completed By: BA/BS Date Completed: 11/30/22

Time Started: _____ Time Ended: _____


Customer signature _____ date _____

Equal Opportunity Employer and Service Provider

The employees of Drakesboro are not trained HVAC personnel. Lighting of pilots are a courtesy and the City can not be held liable.

CITY OF DRAKESBORO

P.O. Box 129 • Mose Rager Blvd. • Drakesboro, KY 42337
270-476-8986
(888) 662-2406 (Voice/TTY); (866) 557-5762 (Español)

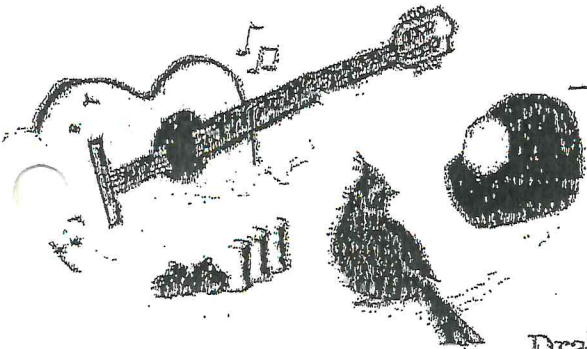

Drakesboro Work Order

Work Order #: _____

Date: 11/29/22 Time: _____ (Gas) Water WW Acct #: 50-811400-001

Name: Elvie Reulett Mobile Number: NO #

Address: 108 Allen Rd. Drakesboro Ky 42337

Work to be Done:

New Meter# 194215031 New Reading Current

Turn on & Read _____ Old Reading Since (1/8/20)

Read and Lock _____ Set Meter and Lock

Reading Only _____ Locate Line

Read and Lock (Nonpayment) _____ Get Meter

Number _____

Check Pressure _____ Flush Line _____ Check & Leak _____

Unlock Only and Read (Do Not Turn On) _____

Special Instructions Check meter to see if working.

(See Below)
COMPLETED
By: AP Date: 11/30/22

Work Done:

Flushed: Yes No GPM: _____ How Long: _____ Water Logs: _____

Water Leak: Yes No GPM: _____ How Long: _____ Water Logs: _____

Parts Used to Complete Job: _____

Comments: WORKING CORRECT

Work Completed By: BA/BS Date Completed: 11/30/22

Time Started: _____ Time Ended: _____


Customer signature _____ date _____

Equal Opportunity Employer and Service Provider

The employees of Drakesboro are not trained HVAC personnel. Lighting of pilots are a courtesy and the City can not be held liable.

CITY OF DRAKESBORO

P.O. Box 129 • Mose Rager Blvd. • Drakesboro, KY 42337
270-476-8986
(888) 662-2406 (Voice/TTY); (866) 557-5762 (Español)

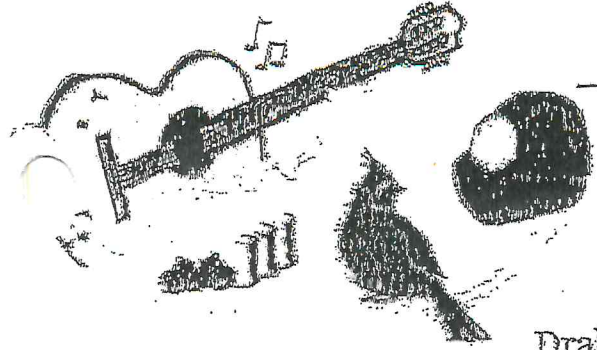

Drakesboro Work Order

Work Order #: _____

Date: 11/29/22 Time: _____ (Gas) Water WW Acct #: 50-81500-001

Name: Dion Sharer Mobile Number: NO #

Address: 117 Colmyer Lane

Work to be Done:

New Meter# ~~486181~~ 486181 New Reading _____

Turn on & Read _____ Old Reading 8744 (5/23/18)

Read and Lock _____ Set Meter and Lock _____

Reading Only _____ Locate Line _____ (See Below)

Read and Lock (Nonpayment) _____ Get Meter _____

Number _____ By: AP Date: 11/30/22

Check Pressure _____ Flush Line _____ Check & Leak _____

Unlock Only and Read (Do Not Turn On) _____

Special Instructions Zero reads - Same read since

Work Done:

Flushed: Yes No GPM: _____ How Long: _____ Water Logs: _____

Water Leak: Yes No GPM: _____ How Long: _____ Water Logs: _____

Parts Used to Complete Job: _____

Comments: WORKING

Work Completed By: BA/BJ Date Completed: 11/30/22

Time Started: _____ Time Ended: _____

Customer signature _____ date _____

Equal Opportunity Employer and Service Provider

The employees of Drakesboro are not trained HVAC personnel. Lighting of pilots are a courtesy and the City can not be held liable.



CITY OF DRAKESBORO

P.O. Box 129 • Mose Rager Blvd. • Drakesboro, KY 42337
270-476-8986

COMPLETED (888) 662-2406 (Voice/TTY); (866) 557-5762 (Español)

By: AP Date: 11/30/22

Drakesboro Work Order

Work Order #: _____

Date: 11/28/22 Time: _____ Gas Water WW Acct #: 50-83990-1

Name: Kara Saye Mobile Number: (270) 225-0618

Address: 6548 St Rt. 70 E

Work to be Done:

New Meter# 215173 _____ New Reading _____

Turn on & Read 646 _____ Old Reading 646 _____

Read and Lock _____ Set Meter and Lock _____

Reading Only _____ Locate Line _____ (See Below) leads

Read and Lock (Nonpayment) _____ Get Meter _____
Number _____

Check Pressure _____ Flush Line _____ Check & Leak _____

Unlock Only and Read (Do Not Turn On) _____

Special Instructions Reconnect from Summer
\$50.00 added to account ✓ 11/29/22 AP

- ✓ Acct made
- ✓ added reconnect fee to acct.
- ✓ flipped and for

Work Done:

Flushed: Yes No GPM: _____ How Long: _____ Water Logs: _____

Water Leak: Yes No GPM: _____ How Long: _____ Water Logs: _____

Parts Used to Complete Job: _____

Comments: Meter turned on

Work Completed By: BA/BJ Date Completed: 11/28/22

Time Started: _____ Time Ended: _____

Customer signature _____ date _____

Equal Opportunity Employer and Service Provider

The employees of Drakesboro are not trained HVAC personnel. Lighting of pilots are a courtesy and the City can not be held liable.

Meter Turn On and Turn Off Form - 1201

City/Company:

Information

Turn On Turn Off

Date:

Time:

Address:

Meter Number:

Meter Reading:

Reason for Turn Off/On?

Was the Meter Valve Locked? Yes No


Additional Remarks:

Completed By:

mothers coming.
@ 9:00

CITY OF DRAKESBORO

P.O. Box 129 • Mose Rager Blvd. • Drakesboro, KY 42337
270-476-8986
(888) 662-2406 (Voice/TTY); (866) 557-5762 (Español)

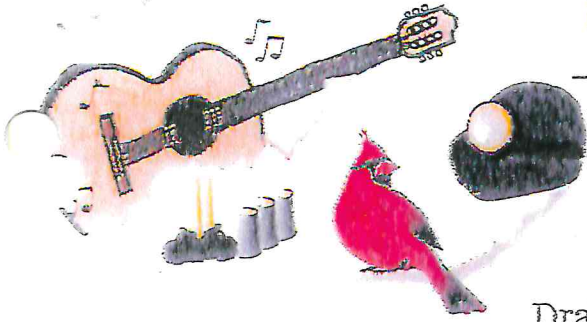

Drakesboro Work Order

Work Order #: _____

Date: 11/22 Time: _____

Gas Water WW Acct #: 10-935-1

Name: Joyce Camplin

Mobile Number: (270) 657-2603

Address: 690 Union ridge rd

Work to be Done:

✓ New Meter# 16245869

New Reading _____

✓ flipped pg for reads

✓ Turn on & Read 856

Old Reading 856 5/27/21

✓ notes on acct + made active

Read and Lock _____

Set Meter and Lock _____

Reading Only _____

Locate Line (See Below)

Read and Lock (Nonpayment) _____

Get Meter _____

Number _____

Check Pressure _____

Flush Line _____

COMPLETED

Check & Leak

By: AP Date: 11/23/22

Unlock Only and Read (Do Not Turn On) _____

Special Instructions Turn Gas on - pressure test

paid reconnection fee

Work Done:

Flushed: Yes No GPM: _____ How Long: _____ Water Logs: _____

Water Leak: Yes No GPM: _____ How Long: _____ Water Logs: _____

Parts Used to Complete Job:

Comments: pressure test performed for 10 minutes
no leaks also meter bar test no leaks sit natural
gas fireplace all working properly

Work Completed By: BA & BJ Date Completed: 11-23-22

Time Started: _____

Time Ended: _____

Customer signature Shelby Phelps

Equal Opportunity Employer and Service Provider

The employees of Drakesboro are not trained HVAC personnel. Lighting of pilots are a courtesy and the City can not be held liable.



CITY OF DRAKESBORO

P.O. Box 129 • Mose Rager Blvd. • Drakesboro, KY 42337
270-476-8986
(888)662-2406 (Voice/TTY): (866)577-5762 (Español)

Date 11-23-22

Time 09:55

Pressure Test for Gas Line

Plumber Information:

License # _____

Phone # _____

Name: _____

Address: _____

Meter read at time of Pressure Test _____

Customer: Joyce Campin

Pressure Tested for 10 minutes.

Address: 690 Union Ridge Rd.

At 20 lbs of Pressure.

Signature of Licensed Plumber

A handwritten signature in black ink, appearing to read "Tom Jones", written over a horizontal line.

Signature of City of Drakesboro gas Employee and Russmar Representative

Meter Turn On and Turn Off Form - 1201

City/Company:

Information

Turn On Turn Off

Date:

Time:

Address:

Meter Number:

Meter Reading:

Reason for Turn Off/On?

Was the Meter Valve Locked? Yes No

Additional Remarks:

Completed By:



Knock
Phones not
Working.

CITY OF DRAKESBORO

P.O. Box 129 • Mose Rager Blvd. • Drakesboro, KY 42337
270-476-8986
(888) 662-2406 (Voice/TTY); (866) 557-5762 (Español)

Drakesboro Work Order

Work Order #: _____

Date: 11/28/22 Time: _____ Gas Waiver WW Acct #: 40-61900-2

Name: Jennifer/Dalton Davis Mobile Number: (270) 225-0773

Address: 202 Goose Hollow

Work to be Done:

New Meter# 21032218 New Reading 2960

Turn on & Read _____ Old Reading 2861

* Read and Lock 2960 Set Meter and Lock

Reading Only _____ Locate Line (See Below)

Read and Lock (Nonpayment) _____ Get Meter
Number _____

Check Pressure _____ Flush Line _____ Check & Leak _____

Unlock Only and Read (Do Not Turn On) _____

Special Instructions Non-payment \$ 52.36

COMPLETED
By: AP Date: 11/28/22

Work Done:

Flushed: Yes No GPM: _____ How Long: _____ Water Logs: _____

Water Leak: Yes No GPM: _____ How Long: _____ Water Logs: _____

Parts Used to Complete Job: _____

Comments: Knocked on door no answer meter turned off

Work Completed By: BA & BJ Date Completed: 11-28-22

Time Started: _____ Time Ended: _____

Customer signature _____ date _____

Equal Opportunity Employer and Service Provider

The employees of Drakesboro are not trained HVAC personnel. Lighting of pilots are a courtesy and the City can not be held liable.

Meter Turn On and Turn Off Form - 1201

City/Company:

Information

Turn On Turn Off

Date:

Time:

Address:

Meter Number:

Meter Reading:

Reason for Turn Off/On?

Was the Meter Valve Locked? Yes No

Additional Remarks:

Completed By:



CITY OF DRAKESBORO

P.O. Box 129 • Mose Rager Blvd. • Drakesboro, KY 42337
270-476-8986
(888) 662-2406 (Voice/TTY); (866) 557-5762 (Español)

Drakesboro Work Order

Work Order #: _____

Date: 11-29-22 Time: _____

Gas Water WW Acct #: 40-61900-002

Name: Dalton Davis

Mobile Number: 270-608-7565

Address: 202 Goose Hollow

Work to be Done:

COMPLETED

New Meter# 21032218

New Reading _____ by AP Date: 11/29/22

Turn on & Read 2960

Old Reading 2960

Read and Lock _____

Set Meter and Lock

Reading Only _____

Locate Line (See Below)

Read and Lock (Nonpayment) _____
Number _____

Get Meter

Check Pressure _____

Flush Line _____

Check & Leak _____

Unlock Only and Read (Do Not Turn On) _____

Special Instructions Turn gas back on - Pd. Reconnect fee \$50.00

locked due to non pymt.

Work Done:

Flushed: Yes No GPM: _____ How Long: _____ Water Logs: _____

Water Leak: Yes No GPM: _____ How Long: _____ Water Logs: _____

Parts Used to Complete Job:

Comments: Gas turned back on heater fired up

Work Completed By: BA + BJ

Date Completed: 11-29-22

Time Started: _____

Time Ended: _____

Customer signature _____ date _____

Equal Opportunity Employer and Service Provider

The employees of Drakesboro are not trained HVAC personnel. Lighting of pilots are a courtesy and the City can not be held liable.

Meter Turn On and Turn Off Form - 1201

City/Company:

Information

Turn On Turn Off

Date:

Time:

Address:

Meter Number:

Meter Reading:

Reason for Turn Off/On?

Was the Meter Valve Locked? Yes No

Additional Remarks:

Completed By:



CITY OF DRAKESBORO

P.O. Box 129 • Mose Rager Blvd. • Drakesboro, KY 42337
270-476-8986
(888) 662-2406 (Voice/TTY); (866) 557-5762 (Español)

Drakesboro Work Order

Work Order #: _____

Date: 11/14/22 Time: _____ Gas Water WW Acct #: 20-22650-1

Name: Beechcreek Missionary Baptist Mobile Number: (270) 847-6764

Address: 50 Church loop

Work to be Done:

New Meter# 486255 _____ New Reading _____

Turn on & Read _____ Old Reading 7241 _____

Read and Lock _____ Set Meter and Lock _____

Reading Only 7285 _____ Locate Line (See Below)

Read and Lock (Nonpayment) _____ Get Meter
Number _____

Check Pressure _____ Flush Line _____ Check & Leak _____

Unlock Only and Read (Do Not Turn On) _____

Special Instructions reread - Customer was turned on in Oct. 2022
office staff didnt make account active. Calc. usage for
that month and had them pay so their Dec. 2022 bill was so
High. (MIA)

Work Done:

Flushed: Yes No GPM: _____ How Long: _____ Water Logs: _____

Water Leak: Yes No GPM: _____ How Long: _____ Water Logs: _____

Parts Used to Complete Job: _____

Comments: Reread

Work Completed By: B. Jones Date Completed: 11-14-22

Time Started: _____ Time Ended: _____

Customer signature _____ date _____

Equal Opportunity Employer and Service Provider

The employees of Drakesboro are not trained HVAC personnel. Lighting of pilots are a courtesy and the City can not be held liable.

COMPLETED
By: MIA Date: 11/15/22



CITY OF DRAKESBORO

P.O. Box 129 • Mose Rager Blvd. • Drakesboro, KY 42337
270-476-8986
(888) 662-2406 (Voice/TTY); (866) 557-5762 (Español)

Drakesboro Work Order

Work Order #: _____

Date: 11/14/22 Time: _____ Gas Water WW Acct #: 40-50950-4

Name: Leigha Warner Mobile Number: (270) 584-3570

Address: 215 Broad St

Work to be Done:

New Meter# 20744157 New Reading _____

Turn on & Read _____ Old Reading 882

Read and Lock _____ Set Meter and Lock _____

Reading Only 1120 Locate Line (See Below)

Read and Lock (Nonpayment) _____ Get Meter Number _____

Check Pressure _____ Flush Line _____ Check & Leak _____

Unlock Only and Read (Do Not Turn On) _____

Special Instructions Reconnection on bill. Brian Jones went to turn service back on and meter was already on from January 2022. Sandy Goff didn't make acct active.

Work Done:

Flushed: Yes No GPM: _____ How Long: _____ Water Logs: _____

Water Leak: Yes No GPM: _____ How Long: _____ Water Logs: _____

Parts Used to Complete Job: _____

COMPLETED

By: MA Date: 11/22/22

Comments: _____

Work Completed By: _____ Date Completed: _____

Time Started: _____ Time Ended: _____

Customer signature _____ date _____

Equal Opportunity Employer and Service Provider

The employees of Drakesboro are not trained HVAC personnel. Lighting of pilots are a courtesy and the City can not be held liable.



CITY OF DRAKESBORO

P.O. Box 129 • Mose Rager Blvd. • Drakesboro, KY 42337
270-476-8986
(888) 662-2406 (Voice/TTY); (866) 557-5762 (Español)

Drakesboro Work Order

Work Order #: _____

Date: 11-17-22 Time: _____ Gas Water WW Acct #: _____

Name: Drakesboro Natural Gas Mobile Number: _____

Address: Horseshoe Loop

Work to be Done:

COMPLETED

New Meter# _____ New Reading _____ By: AP Date: 11/17/22

Turn on & Read _____ Old Reading _____

Read and Lock _____ Set Meter and Lock _____

Reading Only _____ Locate Line (See Below)

Read and Lock (Nonpayment) _____ Get Meter
Number _____

Check Pressure _____ Flush Line _____ Check & Leak _____

Unlock Only and Read (Do Not Turn On) _____

Special Instructions _____

Work Done:

Flushed: Yes No GPM: _____ How Long: _____ Water Logs: _____

Water Leak: Yes No GPM: _____ How Long: _____ Water Logs: _____

Parts Used to Complete Job:

Comments: odorizer at purchase point filled on 11-8-22
all oq's and msds sheet for odorizer are located
at city of Drakesboro office

Work Completed By: BA & BJ Date Completed: 11-17-22

Time Started: _____ Time Ended: _____

Customer signature _____ date _____

Equal Opportunity Employer and Service Provider

The employees of Drakesboro are not trained HVAC personnel. Lighting of pilots are a courtesy and the City can not be held liable.



Odorizer Fill Report-704

City/Company:

Location of Odorizer:

Date:

Make of Odorizer: Tank Size (Gal):

Leaks Noted or Repaired:

Accuracy and Function of Gauge:

Maintenance Activities Performed:

Previous Reading on Gauge:

Current Reading on Gauge:

Total Odorant Used:

Type of Odorant Used:

Remarks:

Signature:

ODOR-FADE WARNING

A GAS LEAK CAN CAUSE A FIRE OR EXPLOSION RESULTING IN SERIOUS INJURY OR DEATH

Be aware that the stenching chemical added to gas to make it detectable may not warn of a gas leak or the presence of natural gas to all persons in every instance.

Instances where the odorant in an odorized gas may be undetectable include:

- Odor intensity may fade or be eliminated for a variety of chemical and physical causes, including the oxidation of rusting pipes, absorption into or sticking onto the interior of pipes or appliances, or absorption into liquids.
- Contact with soil in underground leaks may de-odorize or remove odorant from the gas
- Some people have a diminished ability or inability to smell the stench. Factors that negatively affect a persons's sense of smell include age, gender, medical conditions, and alcohol/tobacco usage.
- The stench of odorized gas may not awaken sleeping persons
- Other odors may mask or hide the stench
- Exposure to the odor for even a short period of time, may cause nasal fatigue, where a person can no longer smell the stench.

Gas detectors listed by the Underwriters Laboratories (UL) can be used as an extra measure of safety for detecting gas leaks, especially under conditions where the odorant alone may not provide an adequate warning. Gas detectors emit a loud, shrill sound when gas is present and do not depend on sense of smell. Because the odor intensity can fade or people may have problems with their sense of smell, we recommend installing, per manufacturer's instructions, one or more combustible gas detectors, in suitable locations to ensure adequate coverage to detect gas leaks.

Educate yourself, your employees, and your customers with the content of this warning and other important facts associated with the so-called "odor-fade phenomenon."



P.O. Box 129 • Mose Rager Blvd. • Drakesboro, KY 42337
270-476-8986
(888) 662-2406 (Voice/TTY); (866) 557-5762 (Español)

Drakesboro Work Order

Work Order #: _____

Date: 11/14/22 Time: _____ Gas Waiver WW Acct #: 10-930-4
Name: Brian K piper Mobile Number: 602-7968
Address: 381 union ridge

Work to be Done:

★ New Meter# 20P2272989 New Reading _____
Turn on & Read 563 Old Reading 563 5/31/20
Read and Lock _____ Set Meter and Lock _____
Reading Only _____ Locate Line _____ (See Below)
Read and Lock (Nonpayment) _____ Get Meter _____
Number _____
Check Pressure _____ Flush Line _____ Check & Leak 11/15/22
Unlock Only and Read (Do Not Turn On) _____
Special Instructions pressure test. turn on.
Anytime Tommorrow

COMPLETED
By: AP Date: 11/15/22

Work Done:

Flushed: Yes No GPM: _____ How Long: _____ Water Logs: _____
Water Leak: Yes No GPM: _____ How Long: _____ Water Logs: _____

Parts Used to Complete Job:

Comments: Pressure test and meter bar test done
11-10-22 gas meter unlocked turned on

Work Completed By: BA & BJ Date Completed: 11-15-22

Time Started: _____ Time Ended: _____

Customer signature _____ date _____

Equal Opportunity Employer and Service Provider

The employees of Drakesboro are not trained HVAC personnel. Lighting of pilots are a courtesy and the City can not be held liable.

Meter Turn On and Turn Off Form - 1201

City/Company:

Information

Turn On Turn Off

Date:

Time:

Address:

Meter Number:

Meter Reading:

Reason for Turn Off/On?

Was the Meter Valve Locked? Yes No


Additional Remarks:

Completed By:

Will be v. white
all day. #

CITY OF DRAKESBORO

P.O. Box 129 • Mose Rager Blvd. • Drakesboro, KY 42337
270-476-8986
(888) 662-2406 (Voice/TTY); (866) 557-5762 (Español)

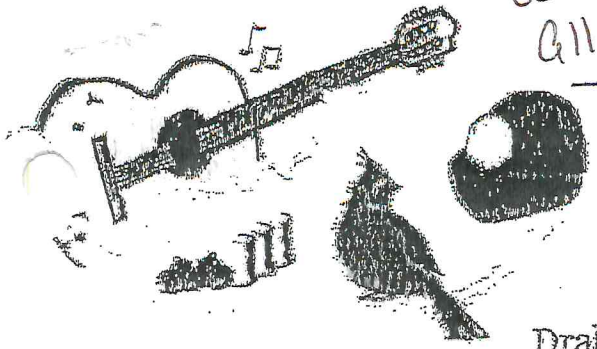

Drakesboro Work Order

Work Order #: _____

Date: 11/14/22 Time: 12:15 (Gas) Water WW Acct #: 50-78200-3

Name: Jacob Page Mobile Number: 270-608-5253

Address: 2134 State Rte 70 E Browder Ky 42326

Work to be Done:

COMPLETED

~~New~~ Meter# 215182

New Reading AP Date: 11/14/22

Turn on & Read 3054

Old Reading 3072 (4/1/22)

Read and Lock _____

Set Meter and Lock

Reading Only _____

Locate Line

(See Below) ~~of deposit~~
~~of DPPP's down~~
for fees

Read and Lock (Nonpayment) _____
Number _____

Get Meter

Check Pressure _____

Flush Line _____ Check & Leak _____

Unlock Only and Read (Do Not Turn On) _____

Special Instructions pd reconnection Fee \$50.00 balance \$138.20

Deposit \$100.00 - & New application

Needs pressure test.

Work Done:

Flushed: Yes No GPM: _____ How Long: _____ Water Logs: _____

Water Leak: Yes No GPM: _____ How Long: _____ Water Logs: _____

Parts Used to Complete Job:

Comments: Found small leaks on outside piping that have to be repaired, meter put back together and locked

Work Completed By: B. Jones

Date Completed: 11-14-2022

Time Started: _____

Time Ended: _____

Customer signature _____ date _____

Equal Opportunity Employer and Service Provider

The employees of Drakesboro are not trained HVAC personnel. Lighting of pilots are a courtesy and the City can not be held liable.



CITY OF DRAKESBORO

P.O. Box 129 • Mose Rager Blvd. • Drakesboro, KY 42337
270-476-8986
(888) 662-2406 (Voice/TTY); (866) 557-5762 (Español)

Drakesboro Work Order

Work Order #: _____

Date: 11/10/22 Time: _____

Gas Water WW Acct #: 10-00930-004

Name: Brian Piper-

Mobile Number: 602-7968

Address: 381 Union Ridge Rd

Work to be Done:

COMPLETED

New Meter# 21P272989

New Reading _____

By: AP Date: 11/10/22

Turn on & Read _____

Old Reading 563

Account Noted ✓

Read and Lock _____

Set Meter and Lock _____

Reading Only 563

Locate Line (See Below)

Read and Lock (Nonpayment) _____
Number _____

Get Meter _____

Check Pressure _____

Flush Line _____

Check & Leak _____

Unlock Only and Read (Do Not Turn On) _____

Special Instructions

Ready for pressure test

Work Done:

Flushed: Yes No GPM: _____ How Long: _____ Water Logs: _____

Water Leak: Yes No GPM: _____ How Long: _____ Water Logs: _____

Parts Used to Complete Job:

Needs to pay 322.96 + reconnect 50.00

Comments: pressure test done no leaks also 372.96 meter bar test performed no leaks service turned back off until bill can be paid

Work Completed By: BA & BJ

Date Completed: 11-10-22

Time Started: _____

Time Ended: _____

Customer signature _____ date _____

Equal Opportunity Employer and Service Provider

The employees of Drakesboro are not trained HVAC personnel. Lighting of pilots are a courtesy and the City can not be held liable.



CITY OF DRAKESBORO

P.O. Box 129 • Mose Rager Blvd. • Drakesboro, KY 42337
270-476-8986
(888)662-2406 (Voice/TTY): (866)577-5762 (Español)

Date 11-10-22

Time 02:35

Pressure Test for Gas Line

Plumber Information:

License # _____

Phone # _____

Name: _____

Address: _____

Meter read at time of Pressure Test 563

Customer: Brian Piper

Pressure Tested for 10 minutes.

Address: 381 Union Ridge

At 20 lbs of Pressure.

Signature of Licensed Plumber



Signature of City of Drakesboro gas Employee and Russmar Representative



CITY OF DRAKESBORO

P.O. Box 129 • Mose Rager Blvd. • Drakesboro, KY 42337
270-476-8986
(888) 662 - 2406 (Voice/TTY); (866) 557 - 5762 (Español)

Drakesboro Work Order

Work Order #: 111022

Date: 11/10/22 Time: _____ Gas Water WW Acct #: 10-01952-001
Name: Harold Neal Garrett Mobile Number: 270-543-1588
Address: 70 Hillview Drive Beechmont Ky 42323

Work to be Done:

New Meter# M 23036896 New Reading _____
Turn on & Read 1151 Old Reading 5/11/22 1151
Read and Lock _____ Set Meter and Lock _____
Reading Only _____ Locate Line _____
Read and Lock (Nonpayment) _____ Get Meter _____
Number _____
Check Pressure _____ Flush Line _____ Check & Leak _____
Unlock Only and Read (Do Not Turn On) _____

COMPLETED
(See Below)
By: AP Date: 11/11/22

Special Instructions

Needs pressure test. a turn on if pressure test passed.

Work Done:

Flushed: Yes No GPM: _____ How Long: _____ Water Logs: _____
Water Leak: Yes No GPM: _____ How Long: _____ Water Logs: _____

Parts Used to Complete Job:

Comments: pressure test done, no leaks meter bar test
no leaks gas turned on furnace fired off

Work Completed By: BA4 BJ Date Completed: 11-10-22

Time Started: _____ Time Ended: _____

Customer signature: Harold Garrett date _____

Equal Opportunity Employer and Service Provider

The employees of Drakesboro are not trained HVAC personnel. Lighting of pilots are a courtesy and the City can not be held liable.



CITY OF DRAKESBORO

P.O. Box 129 • Mose Rager Blvd. • Drakesboro, KY 42337
270-476-8986
(888)662-2406 (Voice/TTY): (866)577-5762 (Español)

Date 11-10-22

Time _____

Pressure Test for Gas Line

Plumber Information:

License # _____

Phone # _____

Name: _____

Address: _____

Meter read at time of Pressure Test 1151

Customer: Harold Garrett

Pressure Tested for 10 minutes.

Address: 70 Hillview Drive

At 20 lbs of Pressure.

Signature of Licensed Plumber

[Handwritten Signature]

Signature of City of Drakesboro gas Employee and Russmar Representative

Meter Turn On and Turn Off Form - 1201

City/Company:

Information

Turn On Turn Off

Date:

Time:

Address:

Meter Number:

Meter Reading:

Reason for Turn Off/On?

Was the Meter Valve Locked? Yes No

Additional Remarks:

Completed By:



CITY OF DRAKESBORO

P.O. Box 129 • Mose Rager Blvd. • Drakesboro, KY 42337
270-476-8986
(888) 662-2406 (Voice/TTY); (866) 557-5762 (Español)

Drakesboro Work Order

Work Order #: _____

Date: 11/10/22 Time: _____ Gas Water WW Acct #: 50-81000-02

Name: Maydean Beliles Mobile Number: 977-6665

Address: 26 Allen Rd

Work to be Done:

New Meter# 251538 _____ New Reading _____

Turn on & Read _____ Old Reading _____

Read and Lock _____ Set Meter and Lock _____

Reading Only 8668 _____ Locate Line (See Below)

Read and Lock (Nonpayment) _____ Get Meter Number _____

Check Pressure _____ Flush Line _____ Check & Leak _____

Unlock Only and Read (Do Not Turn On) _____

Special Instructions Carbon Monoxide alarm going off @ 10 last night. Turned off wall heater / pilot. She will be back in town around 10:30 / 11:00 will call

Work Done:

Flushed: Yes No GPM: _____ How Long: _____ Water Logs: _____

Water Leak: Yes No GPM: _____ How Long: _____ Water Logs: _____

Parts Used to Complete Job: _____

Comments: Found small leak readings coming from control valve inside furnace homeowner getting hvac tech to look at it shut off valve closed to furnace and control valve turned off.

Work Completed By: BA + BJ Date Completed: 11-10-22

Time Started: _____ Time Ended: _____

Customer signature _____ date _____


Equal Opportunity Employer and Service Provider

The employees of Drakesboro are not trained HVAC personnel. Lighting of pilots are a courtesy and the City can not be held liable.

COMPLETED
By: AP Date: 11/10/22

CITY OF DRAKESBORO

P.O. Box 129 • Mose Rager Blvd. • Drakesboro, KY 42337
270-476-8986
(888) 662-2406 (Voice/TTY); (866) 557-5762 (Español)

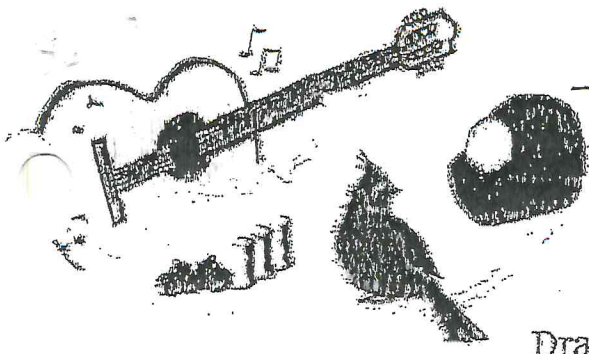

Drakesboro Work Order

Work Order #: _____

Date: 11/10/22 Time: _____ Gas Water WW Acct #: 50-79800-1

Name: Larry Benton Mobile Number: 7476-2651

Address: 5459 SA Rte 70E

Check Card

Work to be Done:

New Meter# 1047958 New Reading _____

Turn on & Read 3478 Old Reading 3476 (4/28/22)

Read and Lock _____ Set Meter and Lock _____

Reading Only _____ Locate Line _____

Read and Lock (Nonpayment) _____ Get Meter _____

Check Pressure _____ Flush Line _____ Check & Leak _____

Unlock Only and Read (Do Not Turn On) _____

Special Instructions pd. Reconnect fee ✓ Turn on ground 9:10.

COMPLETED
Date: 11/10/22

Work Done:

Flushed: Yes No GPM: _____ How Long: _____ Water Logs: _____

Water Leak: Yes No GPM: _____ How Long: _____ Water Logs: _____

Parts Used to Complete Job: _____

Comments: Pressure test and meter bar test done no leaks
gas service turned back on

Work Completed By: BA & BJ Date Completed: 11-11-22

Time Started: _____ Time Ended: _____

Customer signature _____ date _____

Equal Opportunity Employer and Service Provider

The employees of Drakesboro are not trained HVAC personnel. Lighting of pilots are a courtesy and the City can not be held liable.



CITY OF DRAKESBORO

P.O. Box 129 • Mose Rager Blvd. • Drakesboro, KY 42337
270-476-8986
(888)662-2406 (Voice/TTY): (866)577-5762 (Español)

Date 11-11-2022

Time 10:00

Pressure Test for Gas Line

Plumber Information:

License # _____

Phone # _____

Name: _____

Address: _____

Meter read at time of Pressure Test 3478

Customer: Larry Benton

Pressure Tested for 10 minutes.

Address: 5459 st Rt. 70

At 20 lbs of Pressure.

Signature of Licensed Plumber

[Handwritten Signature]

Signature of City of Drakesboro gas Employee and Russmar Representative



Meter Turn On and Turn Off Form - 1201

City/Company:

Information

Turn On Turn Off

Date:

Time:

Address:

Meter Number:


Meter Reading:

Reason for Turn Off/On?

Was the Meter Valve Locked? Yes No

Additional Remarks:

Completed By:

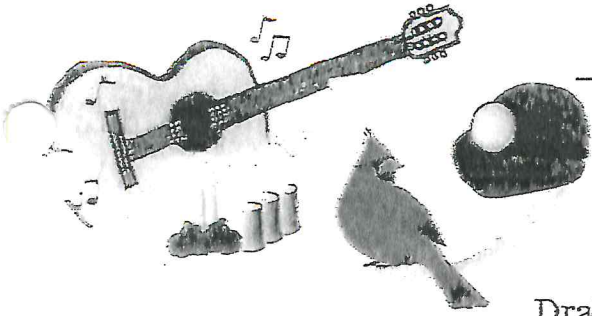

CITY OF DRAKESBORO

P.O. Box 129 • Mose Rager Blvd. • Drakesboro, KY 42337
270-476-8986
(888) 662-2406 (Voice/TTY); (866) 557-5762 (Español)

Drakesboro Work Order

Work Order #: _____

Date: 11/2/22 Time: _____



Water WW Acct #: 10-17001-1

Name: Chris Steele

Mobile Number: (270) 977-1190

Address: 160 Woodruff Ln.

Work to be Done:

COMPLETED

New Meter# 20744152

New Reading _____

By: AP Date: 11/8/22

Turn on & Read _____

Old Reading 708

Read and Lock _____

Set Meter and Lock _____

Reading Only 0710

Locate Line _____

(See Below)

Read and Lock (Nonpayment) _____
Number _____

Get Meter _____

Check Pressure _____

Flush Line _____

Check & Leak _____

Unlock Only and Read (Do Not Turn On) _____

Special Instructions _____

Work Done:

Flushed: Yes No GPM: _____ How Long: _____ Water Logs: _____

Water Leak: Yes No GPM: _____ How Long: _____ Water Logs: _____

Parts Used to Complete Job:

Comments: 1/2" poly gas line hit by auger on tractor while installing fence posts

Work Completed By: BA + BJ

Date Completed: 11-7-22


Time Started: _____

Time Ended: _____

Customer signature _____ date _____

Equal Opportunity Employer and Service Provider

The employees of Drakesboro are not trained HVAC personnel. Lighting of pilots are a courtesy and the City can not be held liable.

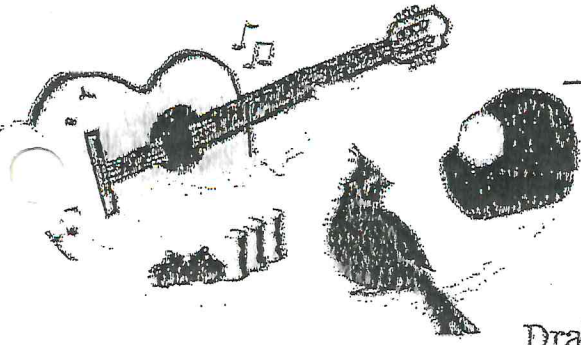

CITY OF DRAKESBORO

P.O. Box 129 • Mose Rager Blvd. • Drakesboro, KY 42337
270-476-8986
(888) 662-2406 (Voice/TTY); (866) 557-5762 (Español)

Drakesboro Work Order

Work Order #: _____

Date: 11/7/22 Time: 12:17 Gas Water WW Acct #: 50-84010-001

Name: Alex Knight Mobile Number: 270-476-2749

Address: 81 Knight Loop Drakesboro Ky 42337

Work to be Done:

New Meter# 21976903 New Reading _____

~~Turn on & Read~~ Old Reading 1854 (5/25/22)

Read and Lock _____ Set Meter and Lock _____

Reading Only 1888 (11/07/22) Locate Line _____

Read and Lock (Nonpayment) _____ Get Meter _____

Number _____

Check Pressure _____ Flush Line _____ Check & Leak _____

Unlock Only and Read (Do Not Turn On) _____

Special Instructions _____

Work Done:

Flushed: Yes No GPM: _____ How Long: _____ Water Logs: _____

Water Leak: Yes No GPM: _____ How Long: _____ Water Logs: _____

Parts Used to Complete Job: _____

Comments: _____

Work Completed By: B. Jones Date Completed: 11-07-22

Time Started: _____ Time Ended: _____

Customer signature _____ date _____

Equal Opportunity Employer and Service Provider

The employees of Drakesboro are not trained HVAC personnel. Lighting of pilots are a courtesy and the City can not be held liable.

(See Below)
COMPLETED
By: AP Date: 11/7/22



CITY OF DRAKESBORO

P.O. Box 129 • Mose Rager Blvd. • Drakesboro, KY 42337
270-476-8986
(888) 662-2406 (Voice/TTY); (866) 557-5762 (Español)

Drakesboro Work Order

Work Order #: 92729

Date: 9-27-29 Time: _____ Gas Water WW Acct #: ~~50-18000-00~~

Name: Sharon Knight Mobile Number: 50-84010-01

Address: 81 Knight Loop Drakesboro

Work to be Done:

New Meter# 219 76903 New Reading 1854

Turn on & Read Old Reading 5/25/22 1854

Read and Lock Set Meter and Lock

Reading Only Locate Line

Read and Lock (Nonpayment) Get Meter
Number _____

Check Pressure Flush Line Check & Leak

Unlock Only and Read (Do Not Turn On) _____

Special Instructions 50\$ Re-connection Fee She will bring in. smg
put on bill smg

COMPLETED
(See Below) 9/28/22
By: AP Date: _____

Work Done:

Flushed: Yes No GPM: _____ How Long: _____ Water Logs: _____

Water Leak: Yes No GPM: _____ How Long: _____ Water Logs: _____

Parts Used to Complete Job:

AP
1) drop the page for read
2) activate
3) add reconnect fee to bill.

Comments:

Work Completed By: R. Alled Date Completed: 9/27/22

Time Started: _____ Time Ended: _____

Customer signature _____ date _____

@ 10:00 am

CITY OF DRAKESBORO

P.O. Box 129 • Mose Rager Blvd. • Drakesboro, KY 42337
270-476-8986
(888) 662-2406 (Voice/TTY); (866) 557-5762 (Español)



Drakesboro Work Order

Work Order #: _____

Date: 11-4-22 Time: _____ Water WW Acct #: 30-50000-005

Name: Timothy Burden (Wesley Travis) Mobile Number: (270) 931-3602

Address: 404 Ike Every Blvd

COMPLETED

Work to be Done:

New Meter# 19M 65934 New Reading By: AP Date: 11/4/22

Turn on & Read _____ Old Reading 842 (3/29/21)

Read and Lock _____ Set Meter and Lock _____

Reading Only 0847 Locate Line (See Below)

Read and Lock (Nonpayment) _____ Get Meter Number _____

Check Pressure _____ Flush Line _____ Check & Leak _____

Unlock Only and Read (Do Not Turn On) _____

Special Instructions Customer called ab a whiffness for pressure test at Ike Every Apt @ 10:00.

Work Done:

Flushed: Yes No GPM: _____ How Long: _____ Water Logs: _____

Water Leak: Yes No GPM: _____ How Long: _____ Water Logs: _____

Parts Used to Complete Job:

Comments: pressure test done by pride johnson heating and cooling, also pressure test done by Drakesboro gas company and meter bar test performed no leaks

Work Completed By: BA4 BJ Date Completed: 10-4-22

Time Started: _____

Time Ended: _____

Customer signature _____ date _____

Equal Opportunity Employer and Service Provider

The employees of Drakesboro are not trained HVAC personnel. Lighting of pilots are a courtesy and the City can not be held liable.



CITY OF DRAKESBORO

P.O. Box 129 • Mose Rager Blvd. • Drakesboro, KY 42337
270-476-8986
(888)662-2406 (Voice/TTY): (866)577-5762 (Español)

Date 11-04-2022

Time 10:05

Pressure Test for Gas Line

Plumber Information:

License # HJ19979

Phone # 270-754-5264

Name: Chase Edwards

Address: 108 Center Street

Central City ky 42330

Meter read at time of Pressure Test 0847

Customer: Timothy Burden

Pressure Tested for 15 minutes.

Address: 404 Ike Everly Apt. 1

At 20 lbs of Pressure.

Drakesboro, ky 42337

X Chase Edwards


Signature of Licensed Plumber

Tim Burden

Signature of City of Drakesboro gas Employee and Russmar Representative

CITY OF DRAKESBORO

P.O. Box 129 • Mose Rager Blvd. • Drakesboro, KY 42337
270-476-8986
(888) 662-2406 (Voice/TTY); (866) 557-5762 (Español)

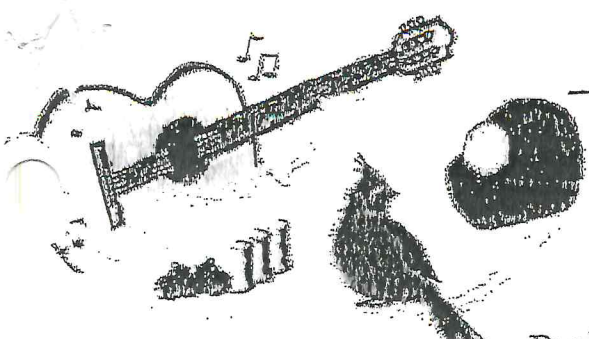

Drakesboro Work Order

Work Order #: _____

Date: 11/3/22 Time: _____ Gas Water WW Acct #: 40-59550-002
Name: Melissa Dene Mobile Number: ~~602-000~~ Call JPSmith
Address: 304 Christian St.

Work to be Done:

New Meter# 486412 New Reading _____
Turn on & Read 3153 Old Reading 3153 (10/27/22)
Read and Lock _____ Set Meter and Lock _____
Reading Only _____ Locate Line _____ (See Below)
Read and Lock (Nonpayment) _____ Get Meter **COMPLETED**
Number _____ By: JP Date: 11/3/22
Check Pressure _____ Flush Line _____ Check & Leak _____
Unlock Only and Read (Do Not Turn On) _____

Special Instructions Almost done fixing gas leaks. Needs
you to come out & pressure test & turn gas on.

Work Done:

Flushed: Yes No GPM: _____ How Long: _____ Water Logs: _____
Water Leak: Yes No GPM: _____ How Long: _____ Water Logs: _____

Parts Used to Complete Job:

Comments: Pressure test done, also meter bgr test done
no leaks,

Work Completed By: BA + BJ Date Completed: 11-3-22

Time Started: _____ Time Ended: _____
Customer signature John P Smith date _____
Equal Opportunity Employer and Service Provider

The employees of Drakesboro are not trained HVAC personnel. Lighting of pilots are a courtesy and the City can not be held liable.



CITY OF DRAKESBORO

P.O. Box 129 • Mose Rager Blvd. • Drakesboro, KY 42337
270-476-8986
(888)662-2406 (Voice/TTY): (866)577-5762 (Español)

Date 11-3-2022

Time 11:09-

Pressure Test for Gas Line

Plumber Information:

License # _____

Phone # _____

Name: _____

Address: _____

Meter read at time of Pressure Test 3153

Customer: Melissa Dean

Pressure Tested for 10 minutes.

Address: 304 Christian Street

At 10 lbs of Pressure.

Drakesboro ky 42337

Signature of Licensed Plumber

Signature of City of Drakesboro gas Employee and Russmar Representative



Meter Turn On and Turn Off Form - 1201

City/Company:

Information

Turn On Turn Off

Date:

Time:

Address:

Meter Number:

Meter Reading:

Reason for Turn Off/On?

Was the Meter Valve Locked? Yes No

Additional Remarks:

Completed By:



CITY OF DRAKESBORO

P.O. Box 129 • Mose Rager Blvd. • Drakesboro, KY 42337
270-476-8986
(888) 662-2406 (Voice/TTY); (866) 557-5762 (Español)

Drakesboro Work Order

Work Order #: _____

Date: 11-01-22 Time: _____
Name: Jeremy Smith Mobile Number: 270-543-3758
Address: 514 Jacksontown log (chicken houses)

Gas Water WW

Acct #: 40-56560-1

Work to be Done:

New Meter# 19K654086 - 717 Old 19K654086 - 427 10/28
19K654087 - 8565 New Reading 19K654087 - 8215 10/28
Turn on & Read 19K654085 - 9227 Old Reading 19K654085 - 8846 10/28
19K654084 - 9838 19K654084 - 9440 10/28

Read and Lock _____ Set Meter and Lock _____
Reading Only _____ Locate Line _____ (See Below)
Read and Lock (Nonpayment) _____ Get Meter _____
Number _____
Check Pressure _____ Flush Line _____ Check & Leak _____

COMPLETED
By: AP Date: 11/4/22

Unlock Only and Read (Do Not Turn On) _____
Special Instructions Customer is switching gas companies

Work Done:

Flushed: Yes No GPM: _____ How Long: _____ Water Logs: _____
Water Leak: Yes No GPM: _____ How Long: _____ Water Logs: _____

Parts Used to Complete Job:

Comments: Pulled all chicken house meters from farm

Work Completed By: BA & BJ Date Completed: 11-4-22

Time Started: _____ Time Ended: _____

Customer signature _____ date _____

Equal Opportunity Employer and Service Provider

The employees of Drakesboro are not trained HVAC personnel. Lighting of pilots are a courtesy and the City can not be held liable.

Meter Turn On and Turn Off Form - 1201

City/Company:

Information

Turn On Turn Off

Date:

Time:

Address:

Meter Number:

Meter Reading:

Reason for Turn Off/On?

Was the Meter Valve Locked? Yes No

Additional Remarks:

Completed By:

Meter Turn On and Turn Off Form - 1201

City/Company:

Information

Turn On Turn Off

Date:

Time:

Address:

Meter Number:

Meter Reading:

Reason for Turn Off/On?

Was the Meter Valve Locked? Yes No

Additional Remarks:

Completed By:



Meter Turn On and Turn Off Form - 1201

City/Company:

Information

Turn On Turn Off

Date:

Time:

Address:

Meter Number:

Meter Reading:

Reason for Turn Off/On?

Was the Meter Valve Locked? Yes No

Additional Remarks:

Completed By:

Meter Turn On and Turn Off Form - 1201

City/Company:

Information

Turn On Turn Off

Date:

Time:

Address:

Meter Number:

Meter Reading:

Reason for Turn Off/On?

Was the Meter Valve Locked? Yes No

Additional Remarks:

Completed By: