

**CASE NO. 2020-00206**  
**AEUG FLEMING SOLAR, LLC**  
**SUPPLEMENTAL RESPONSES TO SITING BOARD'S POST-HEARING REQUEST FOR INFORMATION**

---

4. State when the ambient noise study is expected to be completed and provide a copy of the ambient noise study when completed.

Original Response: The ambient noise study is expected to be performed during the week of April 19, 2021. A copy of the ambient noise study will be filed with the Siting Board no later than May 14, 2021.

**Supplemental Response: Please see attached report.**

Witness: Brad Sohm, P.E. Senior Air Quality Specialist, SWCA Environmental Consultants



# Fleming Solar Facility Project: Baseline Sound Monitoring

MAY 2021

PREPARED FOR  
**AEUG Fleming Solar, LLC**

PREPARED BY  
**SWCA Environmental Consultants**



# **FLEMING SOLAR FACILITY PROJECT: BASELINE SOUND MONITORING**

Prepared for  
**AEUG Fleming Solar, LLC**  
55 East Monroe Street, Suite 1925  
Chicago, Illinois 60603  
(312) 673-3000

Prepared by  
**SWCA Environmental Consultants**  
201 Chatham Street, Suite 3  
Sanford, North Carolina 27330  
(919) 292-2200  
[www.swca.com](http://www.swca.com)

SWCA Project No. 63271

May 2021



*This page intentionally left blank.*

## CONTENTS

<b>Contents</b> .....	<b>i</b>
Appendices .....	i
Tables .....	i
<b>1 Introduction</b> .....	<b>1</b>
<b>2 Area Description</b> .....	<b>1</b>
<b>3 Sound Fundamentals</b> .....	<b>1</b>
3.1 Sound Descriptors.....	1
3.2 Sound Levels of Representative Sounds and Noises .....	2
<b>4 Applicable noise regulations</b> .....	<b>3</b>
<b>5 Measurement Locations</b> .....	<b>3</b>
<b>6 Instrument Description</b> .....	<b>6</b>
<b>7 Calibration Checks</b> .....	<b>6</b>
<b>8 Meteorological Data</b> .....	<b>8</b>
<b>9 Readings</b> .....	<b>8</b>
<b>10 Results</b> .....	<b>9</b>
<b>11 Noise Impacts</b> .....	<b>10</b>
<b>12 Literature Cited</b> .....	<b>11</b>

## Appendices

- Appendix A. Monitoring Locations
- Appendix B. Calibration Certificates
- Appendix C. Weather Data
- Appendix D. Technician Field Sheets

## Tables

Table 1. Average Human Ability to Perceive Changes in Sound Levels .....	2
Table 2. Sound Levels of Representative Sounds and Noises .....	3
Table 3. Monitoring locations.....	6
Table 4. Instrumentation .....	6
Table 5. Pre- and Post-Instrument Response Checks.....	7
Table 6. Weather conditions for April 19 through April 21, 2021 .....	8
Table 7. Summary of Ambient Sound Measurements .....	9
Table 8. Calculated Sound Levels at Nearest NSA Due to Operation.....	10

*This page intentionally left blank.*

# 1 INTRODUCTION

At the request of AEUG Fleming Solar, LLC (AEUG Fleming Solar), SWCA Environmental Consultants (SWCA) conducted a sound monitoring survey on April 19 -21, 2021 to document the acoustic environment in the area surrounding the proposed Fleming Solar Project (the Project) located in in Fleming County, Kentucky. The purpose of the sound monitoring survey was to determine the baseline or ambient sound levels experienced near the Project at the closest noise-sensitive areas (NSAs). This memorandum provides a summary of the baseline sound monitoring results for the area surrounding the Fleming Solar Project.

These following sections describe the area monitored and provide a map showing the location of the proposed Project and locations of the sound monitors, a description of the sound level meter (SLM) used, a description of the metrics recorded, and a summary of sound level readings collected at the monitoring locations.

The memorandum contains the following sections detailing the results of the sound monitoring:

- Section 2.0 provides a general project area description.
- Section 3.0 provides a basic introduction to the sound fundamentals and descriptors of time averaged sound levels.
- Section 4.0 presents a brief summary of the local applicable noise regulations.
- Section 5.0 contains a brief description of the sound monitoring locations.
- Section 6.0 provides a description of the sound level meter used.
- Section 7.0 includes a description of the calibration sequences.
- Section 8.0 includes a discussion of the survey weather conditions.
- Section 9.0 includes a discussion on how the sound meters were setup, the parameters used, and data collected.
- Section 10.0 includes a discussion of how the measured ambient data effects the noise impacts previously reported in the Noise and Traffic Study.
- Section 11.0 provides a discussion of how the measured ambient data effects the noise impacts previously reported in the Noise and Traffic Study.
- Appendix A provides photographs of the sound equipment at the monitoring locations.
- Appendix B contains the laboratory calibration certificates for the sound level meters.
- Appendix C provides summaries of the sound data collected and weather conditions.
- Appendix D contains daily field data sheets.

## 2 AREA DESCRIPTION

AEUG Fleming Solar proposes to develop the 188-megawatt (MW) photovoltaic (PV) Fleming Solar Project in Fleming County, Kentucky. The Project would be built on portions of approximately 1,590 acres (Project Area). The majority (94.7%) of the Project Area currently is in agricultural use (U.S. Geological Survey 2016).

The Project Area is located between Elizaville, Flemingsburg Junction, and Flemingsburg. It is roughly bounded by Old Convict Road on the north, Highway 32 on the south, Highway 11 on the east, and Nepton Road to the west. The topography in the area consists of a series of gently rolling hills and swales. Land use is primarily pasture and agricultural, as noted above, with no large, forested areas. Tree lines typically occur at parcel boundaries, in riparian zones, and along roadways. Scattered rural residential development, commercial and retail businesses, communication facilities, and vehicular transportation network are all present within and surrounding the Project Area.

## 3 SOUND FUNDAMENTALS

Sound is defined as a form of energy that is transmitted by pressure variations, which the animal or human ear can detect. Noise can be defined as any unpleasant or unwanted sound that is unintentionally added to a desired sound or environment. The noise effects in humans include interference with communication, learning, rest or sleep and physiological health effects.

There are two main properties of sound - the amplitude and the frequency. Amplitude refers to the level of energy that reaches the ear (how loud we perceive the sound, while frequency is the number of cycles or oscillations per unit of time completed by the source. Frequency is normally expressed in hertz (Hz).

Sound power is defined as the measurement of the ability of a source to make noise. It is independent of the acoustic environment in which is located. The sound power level ( $L_{pw}$ ) of a source is the amount of energy it produces relative to a reference value and is normally expressed in decibels (dB). The decibel is a logarithmic scale to describe the sound pressure ratio. For example, on the decibel scale, the smallest audible sound is 0 dB. A sound 10 times more powerful is 10 dB, while a sound 100 times more powerful is 20 dB.

Humans perceive a frequency range of about 20 Hz to about 20,000 Hz. A-weighting scale – an internationally standardized frequency weighting was designed to approximate the audible range of frequencies of a healthy human ear. A-weighted scale corresponds to the fact that the human ear is not as sensitive to sound of the lower frequencies as it is at the higher frequencies.

### 3.1 Sound Descriptors

A number of different descriptors of-time averaged sound levels are used to account for fluctuations of sound intensity over time. The sound descriptors calculated by the sound meters and used in this report to describe environmental sound are defined below:

- A-weighted Sound Level describes a receiver's sound at any moment in time. A-weighting is an internationally standardized frequency weighting used to account for the relative loudness as perceived by the human ear at different frequencies.

- Maximum Sound Level ( $L_{max}$ ) describes the highest sound level occurring during a single sound event.
- Minimum Sound Level ( $L_{min}$ ) describes the lowest sound level occurring during a single sound event.
- The Equivalent Sound Level ( $L_{eq}$ ) describes the average sound exposure from all events over a specified period of time.
- The Day-Night Average Sound Level ( $L_{dn}$ ) describes the cumulative sound exposure from all events over a full 24 hours, with events between 10 p.m. (22:00) and 7 a.m. (07:00) increased by 10 decibels to account for greater nighttime sensitivity to noise.
- Daytime Sound Level ( $L_d$ ) is defined as the equivalent sound level for a 15-hour period between 7 a.m. (07:00) and 10 p.m. (22:00).
- Nighttime Sound Level ( $L_n$ ) is defined as the equivalent sound level for a 9-hour period between 10 p.m. (22:00) and 7 a.m. (07:00).
- Residual sound level ( $L_{90}$ ) is the level that is exceeded 90% of the time over a specified period. The residual sound level excludes intruding sound from sporadic anthropogenic noises, wildlife, and wind gusts that raise the average and maximum levels over a measurement period.

## 3.2 Sound Levels of Representative Sounds and Noises

The U.S. Environmental Protection Agency (EPA) has developed an index to assess noise impacts from a variety of sources using residential receptors. If  $L_{dn}$  values exceed 65 dBA, residential development is not recommended (EPA 1974). Sound levels in a quiet rural area at night are typically between 32 and 35 dBA. Quiet urban night-time sound levels range from 40 to 50 dBA.

Sound levels during the day in a noisy urban area are frequently as high as 70 to 80 dBA. Sound levels above 110 dBA become intolerable; levels higher than 80 dBA over continuous periods can result in hearing loss. Levels above 70 dBA tend to be associated with task interference. Levels between 50 and 55 dBA are associated with raised voices in a normal conversation. Constant noises tend to be less noticeable than irregular or periodic noises.

Table 1 provides criteria that have been used to estimate an individual's perception to increases in sound. In general, an average person perceives an increase of 3 dBA or less as barely perceptible. An increase of 10 dBA is perceived as a doubling of the sound.

**Table 1. Average Human Ability to Perceive Changes in Sound Levels**

Increase in Sound Level (dBA)	Human Perception of Sound
2-3	Barely perceptible
5	Readily noticeable
10	Doubling of the sound
20	Dramatic change

Source: Bolt, Beranek, and Newman, Inc. (1973)

Table 2 presents sound levels for some common sound sources and the human response to those decibel levels.

**Table 2. Sound Levels of Representative Sounds and Noises**

Source and Distance	Sound Level (dBA)	Human Response
Jet takeoff (nearby)	150	
Jet takeoff (15 m/50 feet)	140	
50-hp siren (30 m/100 feet)	130	
Loud rock concert (near stage)	120	Pain threshold
Construction noise (3 m/10 feet)	110	Intolerable
Jet takeoff (610 m/2,000 feet)	100	
Heavy truck (8 m/25 feet)	90	
Garbage disposal (0.6 m/2 feet)	80	Constant exposure endangers hearing
Busy traffic	70	
Normal conversation	60	
Light traffic (30 m/100 feet)	50	Quiet
Library	40	
Soft whisper (4.5 m/15 feet)	30	Very quiet
Rustling leaves	20	
Normal breathing	10	Barely audible
Threshold of hearing	0	

Source: Beranek (1988)

## 4 APPLICABLE NOISE REGULATIONS

In 1974 the U.S. EPA published “Information on Levels of Environmental Noise Requisite to Protect Public Health and Welfare with an Adequate Margin on Safety”. In this publication, the U.S. EPA evaluated the effects of environmental noise with respect to health and safety and determined an  $L_{dn}$  of 55 dBA (equivalent to a continuous noise level of 48.6 dBA) to be the maximum sound level that will not adversely affect public health and welfare by interfering with speech or other activities in outdoor areas.

Since no other local, county, or state thresholds were identified, an  $L_{dn}$  of 55 dBA has been used to determine if the Project would adversely affect public health and welfare at identified residential NSAs.

## 5 MEASUREMENT LOCATIONS

Two (2) long-term and nine (9) short-term sound monitoring locations were selected to provide the existing ambient (or background) sound level, that represents the existing reference sound levels near and at the Project’s site. The specific placement of the sound level meters was mainly determined by environmental and logistical constraints, and the location of the closest NSAs. The long-term sound monitors were placed at the closest Project property boundary to an NSA, and the Project property boundary nearest to the NSA with the greatest predicted operational noise impacts. Short-term monitors were placed at the neighboring NSAs to provide good coverage of the area surrounding the project. Sound levels at the long-term and short-

term monitoring sites are expressed as  $L_{90}$ , as use of the  $L_{90}$  level removes the influence of intruding sound from sporadic noises, as it is not a constant sound, thereby not considered part of the existing background sound level.

The following is a description of the sound measurement position near the NSAs:

- Long-term monitoring location 1 (LT-1): Monitor located approximately 100 feet east of Nepton Road. The area is a rural grassland with scattered trees.
- Long-term monitoring location 2 (LT-2): Monitor is located approximately 415 feet south of Kentucky 559. This region has a hilly and grassy landscape with scattered patches of trees.
- Short-term monitoring location 1 (NSA 2): Monitor located on a small neighborhood approximately 0.12 miles north of Highway 32. The area is hilly with patches of scattered trees.
- Short-term monitoring location 2 (NSA 14): Monitor located 0.3 miles NW of the proposed Project area. The area is hilly with patches of scattered trees.
- Short-term monitoring location 3 (NSA 16): Monitor located next to Kentucky 559, approximately 0.19 miles north of the Project site. The area is hilly with patches of scattered trees.
- Short-term monitoring location 4 (NSA 19): Monitor located 60 feet south of Kentucky 559, north of the central area of the Project site. The area is hilly with patches of scattered trees.
- Short-term monitoring location 5 (NSA 23): Monitor located approximately 770 feet northwest of the central section of the Project site. The area is hilly with patches of scattered trees.
- Short-term monitoring location 6 (NSA 26): Monitor located 0.35 miles west of the central section of the Project site. The area is hilly with patches of scattered trees.
- Short-term monitoring location 7 (NSA 29): Monitor located off Highway 57 and approximately 0.35 miles southwest of the central section of the Project site. The area is hilly with patches of scattered trees.
- Short-term monitoring location 8 (NSA 32/33): Monitor located near Highway 32, and approximately 0.12 miles south of the central area of the Project site. The area is hilly with patches of scattered trees.
- Short-term monitoring location 9 (NSA 35): Monitor located near small unnamed road off Kentucky 170, and 0.2 miles east of the west area of the Project site.

Monitoring locations are mapped on Figure 1 and described below in Table 3.



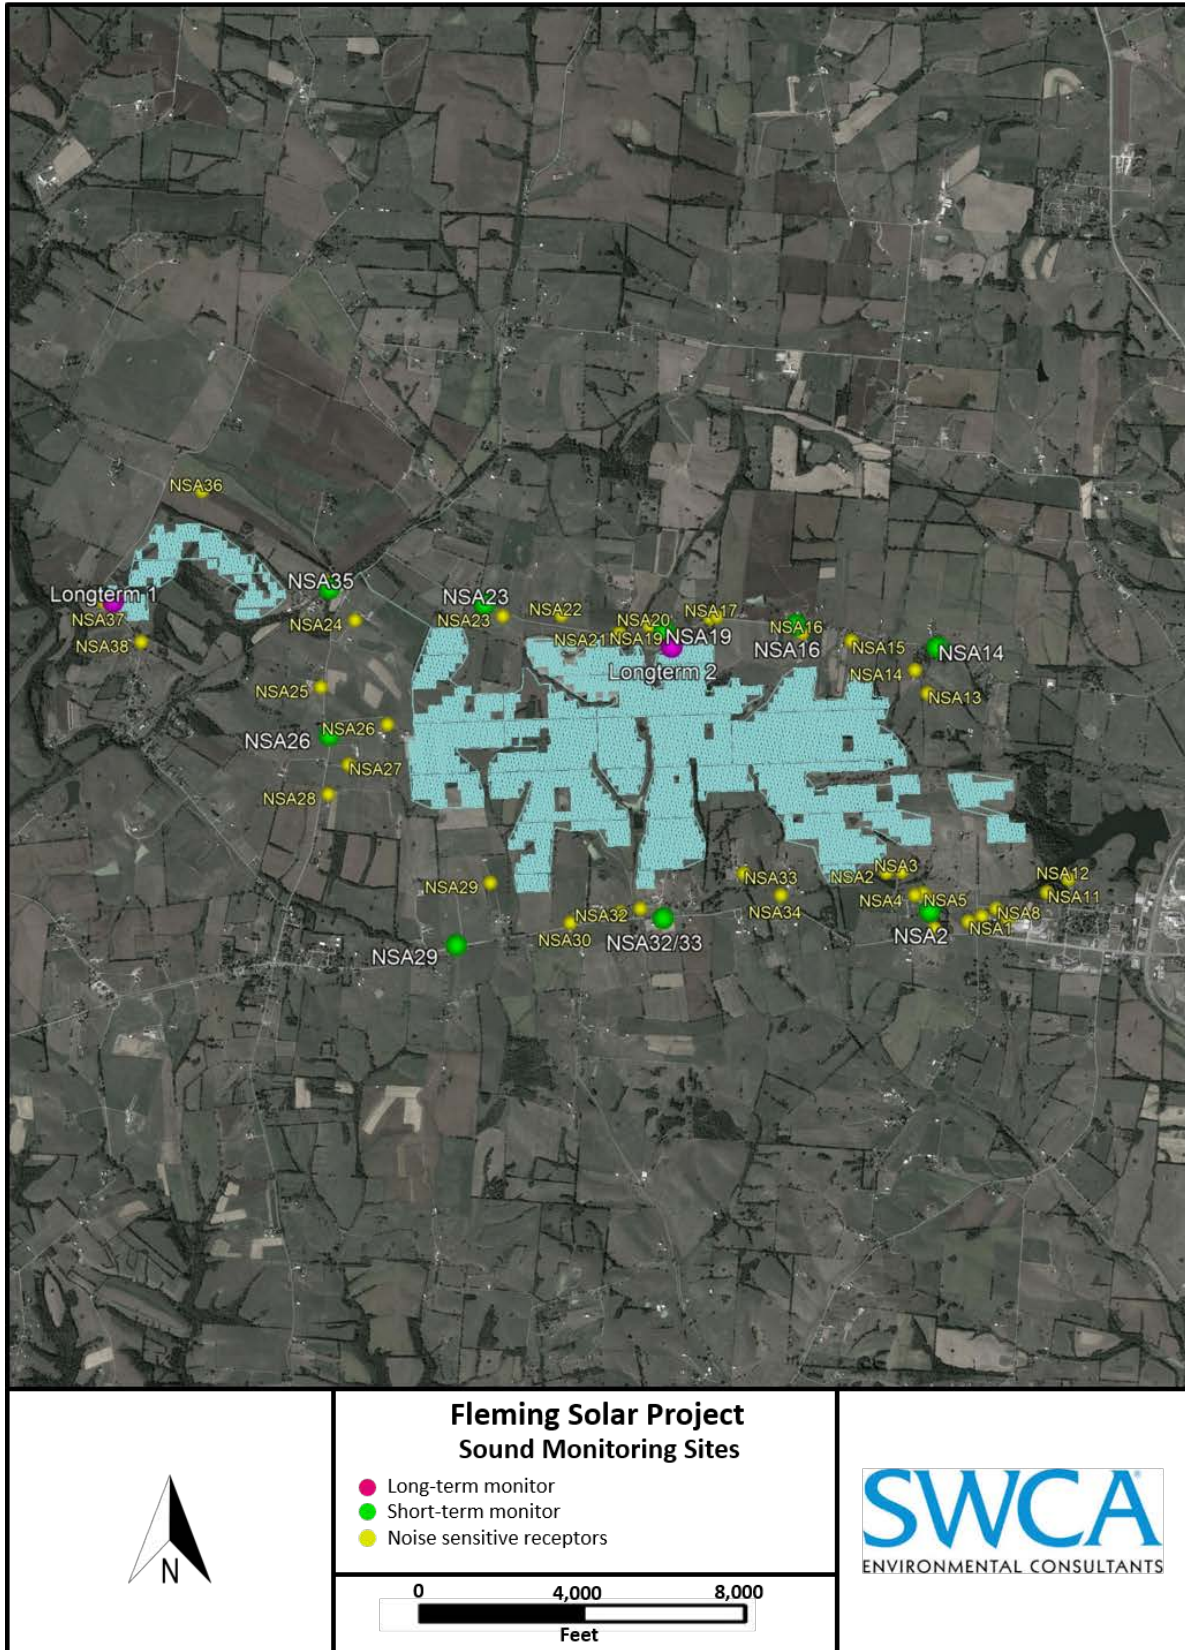


Figure 1. Monitoring Locations

**Table 3. Monitoring locations**

Monitor	Monitor Location		Elevation	Dominant Background Noise Source
	Latitude	Longitude		
LT-1	38.44288	-83.838902	890 ft	Traffic, birds.
LT-2	38.439939	-83.792827	970 ft	Traffic, birds, insects, cattle.
NS A2	38.422903	-83.771578	917 ft	Traffic, birds.
NSA 14	38.439892	-83.770935	962 ft	Traffic, birds.
NSA 16	38.441339	-83.782599	982 ft	Traffic, birds, cattle.
NSA 19	38.440961	-83.793446	975 ft	Traffic, birds, roosters, insects.
NSA 23	38.44292	-83.808264	924 ft	Traffic, light wind.
NSA 26	38.434245	-83.821081	932 ft	Traffic, birds, cattle.
NSA 29	38.420736	-83.810601	882 ft	Traffic, birds, cattle.
NSA 32/33	38.422468	-83.793555	920 ft	Traffic.
NSA 35	38.443702	-83.821043	856 ft	Traffic, birds, dogs.

## 6 INSTRUMENT DESCRIPTION

Sound measurements were collected using three (3) Larson Davis Precision Integrating Sound Level Meter Model 831C meeting the requirements of the American National Standards Institute (ANSI), one (1) PCB PRM831 preamplifier and one (1) PCB 377B02 free-field microphones as described in Table 4.

The microphone was fitted with an environmental windscreen and bird spikes and set upon a tripod at a height of 5 feet above ground and located as far from the influence of vertical reflective sources as possible. All cables were secured to prevent any sounds due to wiring hitting other objects. All clocks associated with the sound measurement were synchronized using the Larson Davis G4 LD Utility software.

**Table 4. Instrumentation**

Monitoring Location	Sound Level Meter	Preamplifier	1/2" free-field microphone
LT-1	Larson Davis 831C (S/N 0010737)	PRM831 (S/N 58503)	377B02 (S/N 311601)
LT-2	Larson Davis 831C (S/N 0010739)	PRM831 (S/N 58504)	377B02 (S/N 311602)
NSA 2 NSA 14 NSA 16 NSA 19 NSA 23 NSA 26 NSA 29 NSA 32/33 NSA 35	Larson Davis 831C (S/N 0011446)	PRM831 (S/N 29478)	377B02 (S/N 326325)

## 7 CALIBRATION CHECKS

The sound level meter was calibrated at the beginning and end of each measurement period using a Larson Davis Model CAL200 Precision Acoustic Calibrator. The Larson Davis CAL200 emits a 1 kHz tone at 114 dB against which the response can be checked. The calibrator has been designed for both field and laboratory use and the accuracy has been calibrated to a reference traceable to the National Institute of Standards and Technology (NIST).

Instrument calibration certificates for the 831C sound level meters, the microphone, and the Larson Davis CAL200 calibrator are included in Appendix B.

As recommended by Larson Davis, when using a free-field microphone, the pressure level at the microphone diaphragm will be slightly different. Thus, a free field correction of -0.12 dB was applied to the 114.0 dB tone. The LD 831C SLMs showed a response of less than the normal error of 0.50 dB. The results for the calibrations are shown in Table 5.

**Table 5. Pre- and Post-Instrument Response Checks**

Monitoring Location	Test	Sound Level	Response	Error <sup>1</sup>
LT-1	Pre-Test (4-19-2021)	114 dB (113.88 dB)	114.01 dB	0.13 dB
	Post-Test (4-21-2021)	114 dB (113.88 dB)	113.89 dB	0.01 dB
LT-2	Pre-Test (4-19-2021)	114 dB (113.88 dB)	114.04 dB	0.16 dB
	Post-Test (4-21-2021)	114 dB (113.88 dB)	113.96 dB	0.08 dB
NSA 2	Pre-Test (4-20-2021)	114 dB (113.88 dB)	113.75 dB	-0.13 dB
	Post-Test (4-20-2021)	114 dB (113.88 dB)	113.88 dB	0.00 dB
NSA 14	Pre-Test (4-20-2021)	114 dB (113.88 dB)	113.97 dB	0.09 dB
	Post-Test (4-20-2021)	114 dB (113.88 dB)	113.77 dB	-0.11 dB
NSA 16	Pre-Test (4-20-2021)	114 dB (113.88 dB)	113.89 dB	0.01 dB
	Post-Test (4-20-2021)	114 dB (113.88 dB)	113.74 dB	-0.14 dB
NSA 19	Pre-Test (4-20-2021)	114 dB (113.88 dB)	113.99 dB	0.11 dB
	Post-Test (4-20-2021)	114 dB (113.88 dB)	113.92 dB	0.04 dB
NSA 23	Pre-Test (4-20-2021)	114 dB (113.88 dB)	113.85 dB	-0.03 dB
	Post-Test (4-20-2021)	114 dB (113.88 dB)	113.85 dB	-0.03 dB
NSA 26	Pre-Test (4-20-2021)	114 dB (113.88 dB)	113.93 dB	0.05 dB
	Post-Test (4-20-2021)	114 dB (113.88 dB)	113.82 dB	-0.06 dB
NSA 29	Pre-Test (4-20-2021)	114 dB (113.88 dB)	113.85 dB	-0.03 dB
	Post-Test (4-20-2021)	114 dB (113.88 dB)	113.87 dB	-0.01 dB
NSA 32/33	Pre-Test (4-20-2021)	114 dB (113.88 dB)	113.90 dB	0.02 dB
	Post-Test (4-20-2021)	114 dB (113.88 dB)	113.90 dB	0.02 dB
NSA 35	Pre-Test (4-20-2021)	114 dB (113.88 dB)	113.94 dB	0.06 dB
	Post-Test (4-20-2021)	114 dB (113.88 dB)	113.91 dB	0.03 dB

<sup>1</sup> Calibration error indicates the difference between the values measured by the instrument and the tone emitted by the acoustic calibrator.

## 8 METEOROLOGICAL DATA

Meteorological data was not measured at the monitoring sites during the measurement period. Instead, sound data collected during the survey were validated against weather data from the Blue Grass Airport Station (KKYFLEMI5) located approximately 7 miles northeast of the Project in the city of Lexington, Kentucky. Hourly weather information is presented in Appendix C. A summary of the survey weather conditions are listed in Table 6.

**Table 6. Weather conditions for April 19 through April 21, 2021**

Weather Station	Start	End	Wind Speed (mph)		Temperature (F)		Humidity (% relative humidity)	
			Range	Average	Range	Average	Range	Average
Blue Grass Airport Station (KKYFLEMI5)	4/19/2021 14:00	4/21/2021 17:00	0.0-7.0	2.9	32.0-68.0	49.0	43-99	71

The ASTM Standard Guide for Measurement of Outdoor A-Weighted Noise levels (ASTM E1014-12) specifies that data should not be used when steady wind speeds exceed 20 kilometers per hour (km/hr) (12.4 mph). Because wind speeds above 12.4 mph were identified, no hourly data points were removed from any of the sound data sets.

## 9 READINGS

Long-term monitoring was conducted from April 19 to April 21, 2021. Sound meter LD 831C – 0010737 was placed at the monitoring location LT-1 from 3:23 PM (EDT) on April 19 to 4:47 PM (EDT) on April 21. Data were collected for approximately 49 hours; sound levels were recorded over each 1-minute and 1-hour intervals. Sound meter LD 831C – 0010739 was placed at the monitoring location LT-2 from 2:35 PM (EDT) on April 19 to 4:08 PM (EDT) on April 21. Data were collected for approximately 49 hours; sound levels were recorded over each 1-minute and 1-hour intervals.

Short-term monitoring was conducted at nine (9) NSAs. Start and stop times for the nine (9) short-term monitoring sites are presented in Table 7 of the results section. Short-term sound levels were recorded for a single 15-minute interval.

The sound level meters were programmed to sample and store A-weighted sound level data including  $L_{eq}$ , percentile levels and community sound parameters. The following gives a brief description of the methodology used for the sound data collection:

- A-weighted sound level was selected.
- Sound meter was set on “slow” response.
- During sound measurements any dominant background noise source was noted.
- Weather conditions were observed and documented.

Field data sheets were completed during each visit and are provided in Appendix D of this report.

Observed sources of background noise that contributed to the existing sound level at the monitoring locations included road traffic, birds, insects, and cattle. A total of 29 non-consecutive 1-minute data points, ranging between 56.8 and 83.9 dBA, were excluded from the results at monitoring site LT-1 as they were “flagged” by the SLM as they were markedly higher from the values immediately before and after. No data points were excluded from the results at all the remaining monitoring sites due to interference.

Existing conditions at the long-term and short-term sound monitoring sites are better represented by the  $L_{90}$  parameter. As defined above, the 90th percentile-exceeded sound level,  $L_{90}$ , is a metric that indicates the single sound level that is exceeded during 90 percent of a measurement period although the actual instantaneous sound levels fluctuate continuously. The  $L_{90}$  sound level is typically considered the ambient sound level as it quantifies the acoustical character of an environment and represents the residual (i.e., ambient) sound level between discrete sound events of short duration, such as bird chirps, dog barks, car horns, etc. The measured  $L_{90}$  time-intervals are arithmetically averaged to present the background levels of the environment for day and night.

## 10 RESULTS

Data collection began on April 19, 2021 and continued through April 21, 2021. Table 7 summarizes the measured A-weighted  $L_{eq}$ ,  $L_{dn}$  (calculated from the measured  $L_{eq}$ ) for each of the monitoring locations.

**Table 7. Summary of Ambient Sound Measurements**

Monitoring Location	Monitoring Start	Monitoring End	Elapsed Time	Measured Sound Levels				
				$L_{eq}$	$L_{90}$	$L_{dn}$	$L_d$	$L_n$
LT-1 <sup>(a)</sup>	4/19/2021 15:23	4/21/2021 16:47	49:23	<b>41.7</b>	24.7	46.4	42.6	39.4
LT-2 <sup>(a)</sup>	4/19/2021 14:35	4/21/2021 16:08	49:32	<b>44.0</b>	24.9	47.2	45.3	39.3
NSA 2	4/20/2021 9:04	4/20/2021 9:20	00:16	47.5	<b>40.8</b>	-	47.5	-
NSA 14	4/20/2021 15:05	4/20/2021 15:21	00:16	57.8	<b>37.2</b>	-	57.8	-
NSA 16	4/20/2021 12:45	4/20/2021 13:01	00:15	59.6	<b>34.8</b>	-	59.6	-
NSA 19	4/20/2021 13:18	4/20/2021 13:44	00:26	51.3	<b>43.3</b>	-	51.3	-
NSA 23	4/20/2021 14:08	4/20/2021 14:25	00:17	52.2	<b>37.2</b>	-	52.2	-
NSA 26	4/20/2021 15:43	4/20/2021 15:59	00:16	57.4	<b>41.4</b>	-	57.4	-
NSA 29	4/20/2021 10:30	4/20/2021 10:47	00:17	66.4	<b>38.1</b>	-	66.4	-
NSA 32/33	4/20/2021 16:19	4/20/2021 16:35	00:16	69.3	<b>45.1</b>	-	69.3	-
NSA 35	4/20/2021 11:26	4/20/2021 11:42	00:15	43.3	<b>37.8</b>	-	43.3	-

a) Data derived from the average 1-hour  $L_{eq}$  calculated by logarithmic averaging the number of noise measurements taken at each specific hour.

A combination of two (2) long-term and nine (9) short-term sound measurements were collected at selected noise-sensitive areas. The ambient sound level measurement locations were selected to be representative of the environment most likely to be impacted.

## 11 NOISE IMPACTS

The Noise and Traffic Study presented in the Fleming Solar Project: Site Assessment Report (SAR) dated November 2020, presented estimated noise impacts at neighboring NSAs from the operation of the proposed Project. Standard acoustical engineering methods were used and were based on vendor-supplied equipment sound levels. The estimated sound levels were based on inverters, trackers, and transformers specified in the preliminary design. Predicted levels at the closest sensitive receptor were calculated based on geometric spreading attenuation using International Organization for Standardization (ISO) 9613-2, Acoustics – Sound Attenuation during Propagation Outdoors (ISO 1996).

Existing ambient sound levels at these NSAs were based on general ambient sound levels ( $L_{eq}$  and  $L_{dn}$ ) based on land use categories published by The American National Standards Institute (ANSI 2013). The areas surrounding the Project were defined as a sparse suburban or rural area with very few (if any) near sources of sound; therefore, background sound levels were conservatively represented by those of *Category 6: Very quiet suburban and rural residential* of the ANSI Publication. Thus, the majority of the analysis area was expected to have background  $L_{dn}$  of about 42 dBA or less.

As shown in Table 7, measured  $L_{90}$  values in the vicinity of the Project range between 24.7 and 24.9 dBA. Table 8 provides a comparison between the present values in the SAR and the estimated noise impacts after updating the ambient sound levels based on the monitored values for the “as proposed” scenario at the nearest NSA. Daytime and nighttime  $L_{90}$  sound levels were calculated from recorded 1-minute  $L_{eq}$  values to determine an overall baseline  $L_{eq}$  and  $L_{dn}$  sound levels to estimate total sound levels at the nearest NSA.

**Table 8. Calculated Sound Levels at Nearest NSA Due to Operation**

Parameter	Calculated $L_{eq}$ Total (dBA)	Community Sound Level (dBA)		
		$L_{day}$	$L_{night}$	$L_{dn}$
Project Sound Contribution – As Proposed <sup>a</sup>	48.1	48.1	48.0	54.4
SAR Estimated Ambient Sound Level <sup>b</sup>	38.6	40.0	34.0	42.0
Total Sound Level at Nearest NSA (Project plus Ambient)	48.6	48.8	48.3	54.8
Estimated Increase due to the Project	10.0	8.8	14.3	12.8
Measured Ambient Sound Level (April 19-21, 2021 Survey) <sup>c,d</sup>	28.8	30.6	20.3	30.5
Total Sound Level at Nearest NSA (Project plus ambient)	48.1	48.1	48.0	54.5
Estimated Increase due to the Project	19.3	17.5	27.7	24.0

<sup>a</sup> Sound levels were estimated assuming the equipment locations as proposed in the Project layout. Presented values correspond to the maximum cumulative sound levels for all the evaluated NSAs. The nearest residential sensitive receptor is located approximately 157 feet from the property boundary and approximately 739 feet from the nearest inverter.

<sup>b</sup> ANSI S12.9-2013/Part 3

<sup>c</sup>  $L_{day}$  and  $L_{night}$  sound levels were derived from the average 1-min  $L_{eq}$  measurements and presented as the 90<sup>th</sup> percentile-exceeded sound level  $L_{90}$  for the daytime and nighttime hours.

<sup>d</sup> Representative  $L_{eq}$  and  $L_{dn}$  values were estimated from  $L_{day}$  and  $L_{night}$  values.

As presented above, the estimated sound contribution from the “as proposed” scenario  $L_{dn}$  at the nearest sensitive receptor, a residence on the north side of the Project 739 feet from the nearest inverter, has not changed (54.4 dBA  $L_{dn}$ ).

As shown in Table 8, the  $L_{dn}$  value at the closest NSA when the monitored levels are used to represent the existing ambient conditions (30.5 dBA  $L_{dn}$ ) was estimated as 54.5 dBA; hence, below the EPA’s recommended 24-hour average day and night value of 55 dBA  $L_{dn}$  (EPA 1974).

## 12 LITERATURE CITED

- American National Standards Institute, Inc (ANSI). 2013. Quantities and Procedures for Description and Measurements with an Observer Present – Part 3: Short-term Measurements with an Observer Present, ANSI/ASA S12.9-2013/Part 3. ANSI S12.9-2013/Part 3, 2013.
- Beranek, L.L. (ed.). 1988. *Noise and Vibration Control*. Washington, D.C.: Institute of Noise Control Engineering.
- Bolt, Beranek and Newman, Inc. 1973. *Fundamentals and Abatement of Highway Traffic Noise*. Report Number PB-222-703. U.S. Department of Transportation, Federal Highway Administration.
- U.S. Environmental Protection Agency (EPA). 1974. Information on levels of environmental noise requisite to protect public health and welfare with an adequate margin of safety. Available at: [http://www.nonoise.org/library/levels/levels.htm#levelsof\\_](http://www.nonoise.org/library/levels/levels.htm#levelsof_) Accessed April 16, 2021.

*This page intentionally left blank.*

---



**APPENDIX A**  
**Monitoring Site Photographs**



**Figure A1. Long-term monitoring site LT-1**



**Figure A2. Long-term monitoring site LT-2**



**Figure A3. Short-term monitoring site NSA 2**



**Figure A4. Short-term monitoring site NSA 14**





**Figure A5. Short-term monitoring site NSA 16**



**Figure A6. Short-term monitoring site NSA 19**



**Figure A7. Short-term monitoring site NSA 23**



**Figure A8. Short-term monitoring site NSA 26**





**Figure A9. Short-term monitoring site NSA 29**



**Figure A10. Short-term monitoring site NSA 32/33**



**Figure A11. Short-term monitoring site NSA 35**





**APPENDIX B**  
**Equipment Calibration Certificates**

# Calibration Certificate

Certificate Number 2021001372

**Customer:**

The Modal Shop  
10310 AeroHub Boulevard  
Cincinnati, OH 45215, United States

<b>Model Number</b>	CAL200	<b>Procedure Number</b>	D0001.8386
<b>Serial Number</b>	18566	<b>Technician</b>	Scott Montgomery
<b>Test Results</b>	<b>Pass</b>	<b>Calibration Date</b>	4 Feb 2021
<b>Initial Condition</b>	As Manufactured	<b>Calibration Due</b>	
<b>Description</b>	Larson Davis CAL200 Acoustic Calibrator	<b>Temperature</b>	23 °C ± 0.3 °C
		<b>Humidity</b>	31 %RH ± 3 %RH
		<b>Static Pressure</b>	101.1 kPa ± 1 kPa

**Evaluation Method** The data is acquired by the insert voltage calibration method using the reference microphone's open circuit sensitivity. Data reported in dB re 20 µPa.

**Compliance Standards** Compliant to Manufacturer Specifications per D0001.8190 and the following standards:  
IEC 60942:2017 ANSI S1.40-2006

Issuing lab certifies that the instrument described above meets or exceeds all specifications as stated in the referenced procedure (unless otherwise noted). It has been calibrated using measurement standards traceable to the SI through the National Institute of Standards and Technology (NIST), or other national measurement institutes, and meets the requirements of ISO/IEC 17025:2017.

**Test points marked with a ‡ in the uncertainties column do not fall within this laboratory's scope of accreditation.**

The quality system is registered to ISO 9001:2015.

This calibration is a direct comparison of the unit under test to the listed reference standards and did not involve any sampling plans to complete. No allowance has been made for the instability of the test device due to use, time, etc. Such allowances would be made by the customer as needed.

The uncertainties were computed in accordance with the ISO Guide to the Expression of Uncertainty in Measurement (GUM). A coverage factor of approximately 2 sigma (k=2) has been applied to the standard uncertainty to express the expanded uncertainty at approximately 95% confidence level.

This report may not be reproduced, except in full, unless permission for the publication of an approved abstract is obtained in writing from the organization issuing this report.

Standards Used			
Description	Cal Date	Cal Due	Cal Standard
Agilent 34401A DMM	08/04/2020	08/04/2021	001021
Larson Davis Model 2900 Real Time Analyzer	04/02/2020	04/02/2021	001051
Microphone Calibration System	03/03/2020	03/03/2021	005446
1/2" Preamplifier	08/27/2020	08/27/2021	006506
Larson Davis 1/2" Preamplifier 7-pin LEMO	08/06/2020	08/06/2021	006507
1/2 inch Microphone - RI - 200V	06/04/2020	06/04/2021	006510
Pressure Transducer	07/17/2020	07/17/2021	007368

LARSON DAVIS - A PCB PIEZOTRONICS DIV.  
1681 West 820 North  
Provo, UT 84601, United States  
716-684-0001



**Output Level**

Nominal Level [dB]	Pressure [kPa]	Test Result [dB]	Lower limit [dB]	Upper limit [dB]	Expanded Uncertainty [dB]	Result
114	101.0	114.01	113.80	114.20	0.14	Pass
94	101.1	94.01	93.80	94.20	0.15	Pass

-- End of measurement results--

**Frequency**

Nominal Level [dB]	Pressure [kPa]	Test Result [Hz]	Lower limit [Hz]	Upper limit [Hz]	Expanded Uncertainty [Hz]	Result
114	101.0	1,000.03	990.00	1,010.00	0.20	Pass
94	101.1	1,000.04	990.00	1,010.00	0.20	Pass

-- End of measurement results--

**Total Harmonic Distortion + Noise (THD+N)**

Nominal Level [dB]	Pressure [kPa]	Test Result [%]	Lower limit [%]	Upper limit [%]	Expanded Uncertainty [%]	Result
114	101.0	0.34	0.00	2.00	0.25 ‡	Pass
94	101.1	0.38	0.00	2.00	0.25 ‡	Pass

-- End of measurement results--

**Level Change Over Pressure**

Tested at: 114 dB, 25 °C, 27 %RH

Nominal Pressure [kPa]	Pressure [kPa]	Test Result [dB]	Lower limit [dB]	Upper limit [dB]	Expanded Uncertainty [dB]	Result
108.0	107.9	-0.03	-0.30	0.30	0.04 ‡	Pass
101.3	101.3	0.00	-0.30	0.30	0.04 ‡	Pass
92.0	92.0	0.04	-0.30	0.30	0.04 ‡	Pass
83.0	82.8	0.05	-0.30	0.30	0.04 ‡	Pass
74.0	74.1	0.02	-0.30	0.30	0.04 ‡	Pass
65.0	65.1	-0.06	-0.30	0.30	0.04 ‡	Pass

-- End of measurement results--

**Frequency Change Over Pressure**

Tested at: 114 dB, 25 °C, 27 %RH

Nominal Pressure [kPa]	Pressure [kPa]	Test Result [Hz]	Lower limit [Hz]	Upper limit [Hz]	Expanded Uncertainty [Hz]	Result
108.0	107.9	0.00	-10.00	10.00	0.20 ‡	Pass
101.3	101.3	0.00	-10.00	10.00	0.20 ‡	Pass
92.0	92.0	0.00	-10.00	10.00	0.20 ‡	Pass
83.0	82.8	-0.01	-10.00	10.00	0.20 ‡	Pass
74.0	74.1	-0.01	-10.00	10.00	0.20 ‡	Pass
65.0	65.1	-0.01	-10.00	10.00	0.20 ‡	Pass

-- End of measurement results--



### Total Harmonic Distortion + Noise (THD+N) Over Pressure

Tested at: 114 dB, 25 °C, 27 %RH

Nominal Pressure [kPa]	Pressure [kPa]	Test Result [%]	Lower limit [%]	Upper limit [%]	Expanded Uncertainty [%]	Result
108.0	107.9	0.33	0.00	2.00	0.25 ‡	Pass
101.3	101.3	0.33	0.00	2.00	0.25 ‡	Pass
92.0	92.0	0.34	0.00	2.00	0.25 ‡	Pass
83.0	82.8	0.34	0.00	2.00	0.25 ‡	Pass
74.0	74.1	0.36	0.00	2.00	0.25 ‡	Pass
65.0	65.1	0.38	0.00	2.00	0.25 ‡	Pass

-- End of measurement results--

Signatory: Scott Montgomery

LARSON DAVIS - A PCB PIEZOTRONICS DIV.  
1681 West 820 North  
Provo, UT 84601, United States  
716-684-0001






# Model CAL200 Relative SPL vs. Temperature

Larson Davis Model CAL200 Serial Number: 18566

Model CAL200 Relative SPL vs. Temperature at 50% RH.  
A 2559 Mic (SN: 2915) with a PRM901 Preamp (SN: 0186), station 8 was used to check the levels.

Test Date: 08 Jan 2021 12:02:42 PM

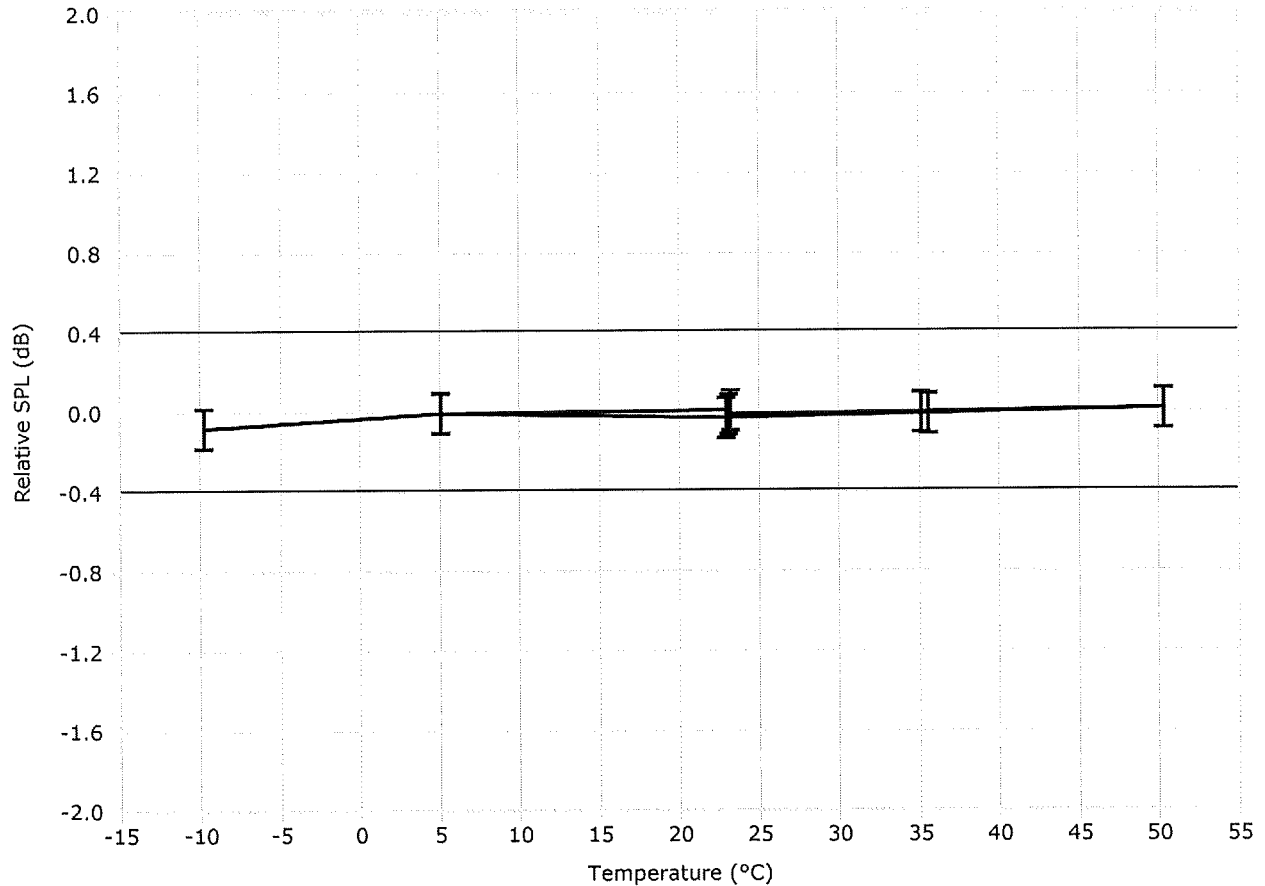

0.1dB expanded uncertainty at ~95% confidence level (k=2)

Sequence File: CAL250w200.SEQ

Test Location: Larson Davis, a division of PCB Piezotronics, Inc.  
1681 West 820 North, Provo, Utah 84601  
Tel: 716 684-0001 [www.LarsonDavis.com](http://www.LarsonDavis.com)




# Model CAL200 Relative Frequency vs. Temperature

Larson Davis Model CAL200 Serial Number: 18566

Model CAL200 Relative Frequency vs. Temperature at 50% RH.  
A 2559 Mic (SN: 2915) with a PRM901 Preamp (SN: 0186), station 8 was used to check the levels.

Test Date: 08 Jan 2021 12:02:42 PM

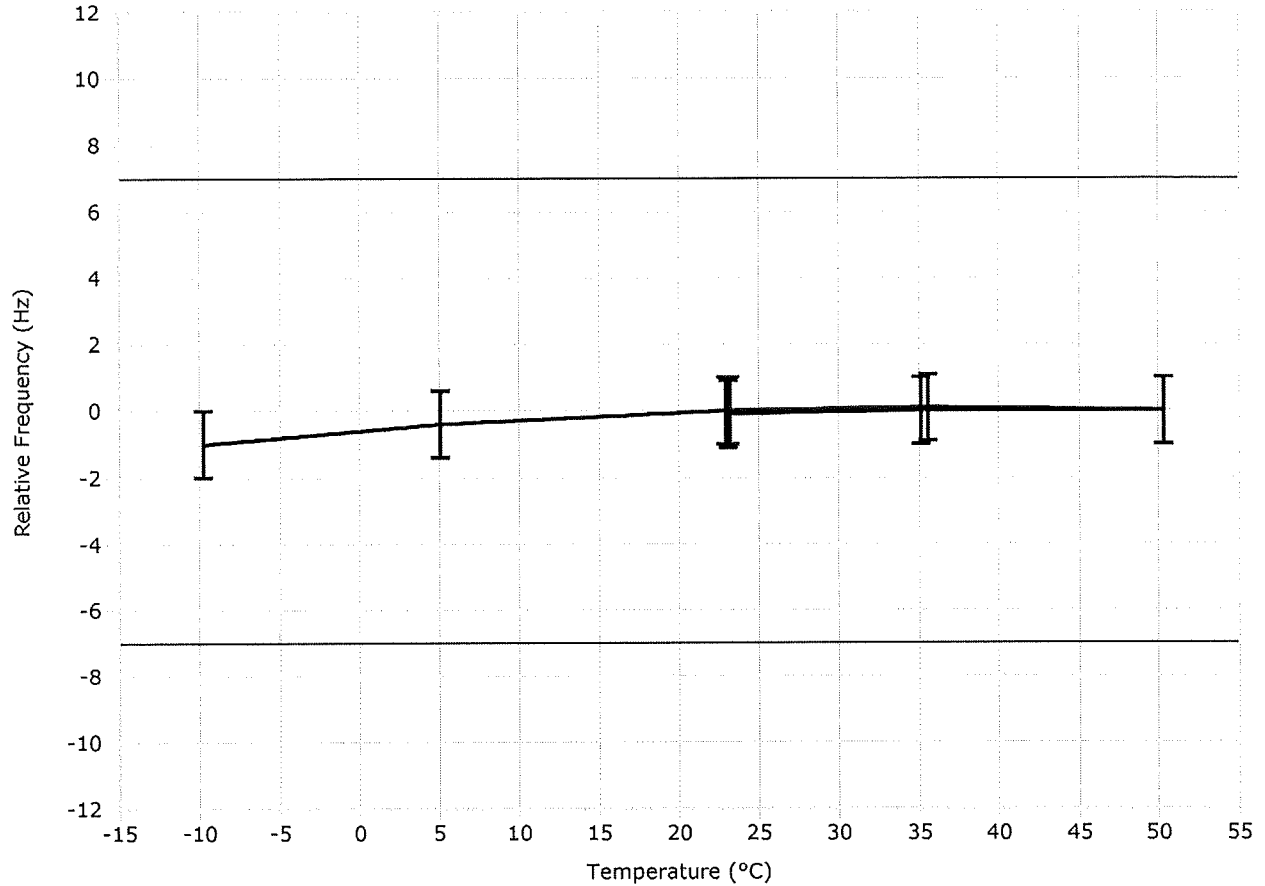

1.0 Hz expanded uncertainty at ~95% confidence level (k=2)

Sequence File: CAL250w200.SEQ

Test Location: Larson Davis, a division of PCB Piezotronics, Inc.  
1681 West 820 North, Provo, Utah 84601  
Tel: 716 684-0001 [www.LarsonDavis.com](http://www.LarsonDavis.com)

# Calibration Certificate

Certificate Number 2021002515

**Customer:**

The Modal Shop  
10310 AeroHub Boulevard  
Cincinnati, OH 45215, United States

<b>Model Number</b>	377B02	<b>Procedure Number</b>	D0001.8387		
<b>Serial Number</b>	326325	<b>Technician</b>	Abraham Ortega		
<b>Test Results</b>	<b>Pass</b>	<b>Calibration Date</b>	8 Mar 2021		
<b>Initial Condition</b>	As Manufactured	<b>Calibration Due</b>			
<b>Description</b>	1/2 inch Microphone - FF - 0V	<b>Temperature</b>	25.2	°C	± 0.01 °C
		<b>Humidity</b>	25.6	%RH	± 0.5 %RH
		<b>Static Pressure</b>	101.43	kPa	± 0.03 kPa

**Evaluation Method** Tested electrically using an electrostatic actuator.

**Compliance Standards** Compliant to Manufacturer Specifications.

Issuing lab certifies that the instrument described above meets or exceeds all specifications as stated in the referenced procedure (unless otherwise noted). It has been calibrated using measurement standards traceable to the SI through the National Institute of Standards and Technology (NIST), or other national measurement institutes, and meets the requirements of ISO/IEC 17025:2017. **Test points marked with a ‡ do not fall within this laboratory's scope of accreditation.**

The quality system is registered to ISO 9001:2015.

This calibration is a direct comparison of the unit under test to the listed reference standards and did not involve any sampling plans to complete. No allowance has been made for the instability of the test device due to use, time, etc. Such allowances would be made by the customer as needed.

The uncertainties were computed in accordance with the ISO Guide to the Expression of Uncertainty in Measurement (GUM). A coverage factor of approximately 2 sigma (k=2) has been applied to the standard uncertainty to express the expanded uncertainty at approximately 95% confidence level.

This report may not be reproduced, except in full, unless permission for the publication of an approved abstract is obtained in writing from the organization issuing this report.

## Standards Used

Description	Cal Date	Cal Due	Cal Standard
Larson Davis Model 2900 Real Time Analyzer	07/01/2020	07/01/2021	001230
Microphone Calibration System	08/25/2020	08/25/2021	001233
1/2" Preampifier	12/18/2020	12/18/2021	001274
Agilent 34401A DMM	12/08/2020	12/08/2021	001329
Larson Davis CAL250 Acoustic Calibrator	09/01/2020	09/01/2021	003030
1/2" Preampifier	04/13/2020	04/13/2021	006506
Larson Davis 1/2" Preampifier 7-pin LEMO	07/09/2020	07/09/2021	006507
1/2 inch Microphone - RI - 200V	06/04/2020	06/04/2021	006510
1/2 inch Microphone - RI - 200V	07/31/2020	07/31/2021	006519
Larson Davis 1/2" Preampifier 7-pin LEMO	07/09/2020	07/09/2021	006530
Larson Davis 1/2" Preampifier 7-pin LEMO	07/24/2020	07/24/2021	006531

LARSON DAVIS - A PCB PIEZOTRONICS DIV.  
1681 West 820 North  
Provo, UT 84601, United States  
716-684-0001



Certificate Number 2021002515

Frequency [Hz]	Actuator [dB]	Free Field [dB]	Lower limit [dB]	Upper limit [dB]	Result
251.19	0.00	0.00	-0.50	0.50	Pass ‡
316.23	-0.01	0.00	-0.50	0.50	Pass ‡
398.11	-0.02	-0.02	-0.50	0.50	Pass ‡
501.19	-0.03	0.01	-0.50	0.50	Pass ‡
630.96	-0.04	0.00	-0.50	0.50	Pass ‡
794.33	-0.06	0.03	-0.50	0.50	Pass ‡
1,000.00	-0.09	0.03	-0.50	0.50	Pass ‡
1,059.25	-0.10	0.03	-0.50	0.50	Pass ‡
1,122.02	-0.11	0.03	-0.50	0.50	Pass ‡
1,188.50	-0.12	0.03	-0.50	0.50	Pass ‡
1,258.93	-0.13	0.03	-0.50	0.50	Pass ‡
1,333.52	-0.14	0.04	-0.50	0.50	Pass ‡
1,412.54	-0.16	0.03	-0.50	0.50	Pass ‡
1,496.24	-0.18	0.02	-0.50	0.50	Pass ‡
1,584.89	-0.19	0.02	-0.50	0.50	Pass ‡
1,678.80	-0.21	0.02	-0.50	0.50	Pass ‡
1,778.28	-0.24	0.01	-0.50	0.50	Pass ‡
1,883.65	-0.26	0.02	-0.50	0.50	Pass ‡
1,995.26	-0.29	0.02	-0.50	0.50	Pass ‡
2,113.49	-0.32	0.02	-0.50	0.50	Pass ‡
2,238.72	-0.35	0.02	-0.50	0.50	Pass ‡
2,371.37	-0.39	0.02	-0.50	0.50	Pass ‡
2,511.89	-0.43	0.03	-0.50	0.50	Pass ‡
2,660.73	-0.47	0.04	-0.50	0.50	Pass ‡
2,818.38	-0.53	0.03	-0.50	0.50	Pass ‡
2,985.38	-0.58	0.04	-0.50	0.50	Pass ‡
3,162.28	-0.65	0.03	-0.50	0.50	Pass ‡
3,349.65	-0.72	0.02	-0.50	0.50	Pass ‡
3,548.13	-0.80	0.02	-0.50	0.50	Pass ‡
3,758.37	-0.88	0.02	-0.50	0.50	Pass ‡
3,981.07	-0.98	0.02	-0.50	0.50	Pass ‡
4,216.97	-1.08	0.03	-0.56	0.56	Pass ‡
4,466.84	-1.20	0.03	-0.63	0.63	Pass ‡
4,731.51	-1.33	0.04	-0.69	0.69	Pass ‡
5,011.87	-1.48	0.05	-0.75	0.75	Pass ‡
5,308.84	-1.63	0.07	-0.81	0.81	Pass ‡
5,623.41	-1.81	0.07	-0.88	0.88	Pass ‡
5,956.62	-2.00	0.07	-0.94	0.94	Pass ‡
6,309.57	-2.21	0.08	-1.00	1.00	Pass ‡
6,683.44	-2.44	0.08	-1.00	1.00	Pass ‡
7,079.46	-2.68	0.10	-1.00	1.00	Pass ‡
7,498.94	-2.96	0.11	-1.00	1.00	Pass ‡
7,943.28	-3.26	0.13	-1.00	1.00	Pass ‡
8,413.95	-3.59	0.14	-1.00	1.00	Pass ‡
8,912.51	-3.99	0.12	-1.00	1.00	Pass ‡
9,440.61	-4.43	0.09	-1.00	1.00	Pass ‡
10,000.00	-4.89	0.06	-1.00	1.00	Pass ‡
10,592.54	-5.51	-0.11	-1.13	1.13	Pass ‡
11,220.19	-5.98	-0.12	-1.25	1.25	Pass ‡
11,885.02	-6.40	-0.08	-1.38	1.38	Pass ‡
12,589.25	-6.78	-0.01	-1.50	1.50	Pass ‡
13,335.21	-6.99	0.20	-1.63	1.63	Pass ‡
14,125.38	-7.16	0.43	-1.75	1.75	Pass ‡

LARSON DAVIS - A PCB PIEZOTRONICS DIV.  
 1681 West 820 North  
 Provo, UT 84601, United States  
 716-684-0001





# Calibration Certificate

Certificate Number 2021003381

**Customer:**

The Modal Shop  
10310 AeroHub Boulevard  
Cincinnati, OH 45215, United States

<b>Model Number</b>	831C	<b>Procedure Number</b>	D0001.8378
<b>Serial Number</b>	11446	<b>Technician</b>	Ron Harris
<b>Test Results</b>	<b>Pass</b>	<b>Calibration Date</b>	26 Mar 2021
<b>Initial Condition</b>	As Manufactured	<b>Calibration Due</b>	
<b>Description</b>	Larson Davis Model 831C Class 1 Sound Level Meter Firmware Revision: 04.6.0R0	<b>Temperature</b>	23.47 °C ± 0.25 °C
		<b>Humidity</b>	52.3 %RH ± 2.0 %RH
		<b>Static Pressure</b>	85.18 kPa ± 0.13 kPa

**Evaluation Method** Tested electrically using Larson Davis PRM831 S/N 071089 and a 12.0 pF capacitor to simulate microphone capacitance. Data reported in dB re 20 µPa assuming a microphone sensitivity of 50.0 mV/Pa.

**Compliance Standards** Compliant to Manufacturer Specifications and the following standards when combined with Calibration Certificate from procedure D0001.8384:

IEC 60651:2001 Type 1	ANSI S1.4-2014 Class 1
IEC 60804:2000 Type 1	ANSI S1.4 (R2006) Type 1
IEC 61672:2013 Class 1	ANSI S1.43 (R2007) Type 1
IEC 61260:2014 Class 1	ANSI S1.11-2014 Class 1

Issuing lab certifies that the instrument described above meets or exceeds all specifications as stated in the referenced procedure (unless otherwise noted). It has been calibrated using measurement standards traceable to the International System of Units (SI) through the National Institute of Standards and Technology (NIST), or other national measurement institutes, and meets the requirements of ISO/IEC 17025:2017. **Test points marked with a ‡ in the uncertainties column do not fall within this laboratory's scope of accreditation.**

The quality system is registered to ISO 9001:2015.

This calibration is a direct comparison of the unit under test to the listed reference standards and did not involve any sampling plans to complete. No allowance has been made for the instability of the test device due to use, time, etc. Such allowances would be made by the customer as needed.

The uncertainties were computed in accordance with the ISO Guide to the Expression of Uncertainty in Measurement (GUM). A coverage factor of approximately 2 sigma (k=2) has been applied to the standard uncertainty to express the expanded uncertainty at approximately 95% confidence level.

This report may not be reproduced, except in full, unless permission for the publication of an approved abstract is obtained in writing from the organization issuing this report.

Correction data from Larson Davis SoundAdvisor Model 831C Reference Manual, I831C.01 Rev M, 2019-09-10

Calibration Check Frequency: 1000 Hz; Reference Sound Pressure Level: 114 dB re 20 µPa; Reference Range: 0 dB gain

LARSON DAVIS - A PCB PIEZOTRONICS DIV.

1681 West 820 North  
Provo, UT 84601, United States  
716-684-0001




**LARSON DAVIS**  
A PCB PIEZOTRONICS DIV.

Standards Used			
Description	Cal Date	Cal Due	Cal Standard
Hart Scientific 2626-S Humidity/Temperature Sensor	2020-05-12	2021-05-12	006943
SRS DS360 Ultra Low Distortion Generator	2020-04-14	2021-04-14	007635



### Z-weight Filter Response

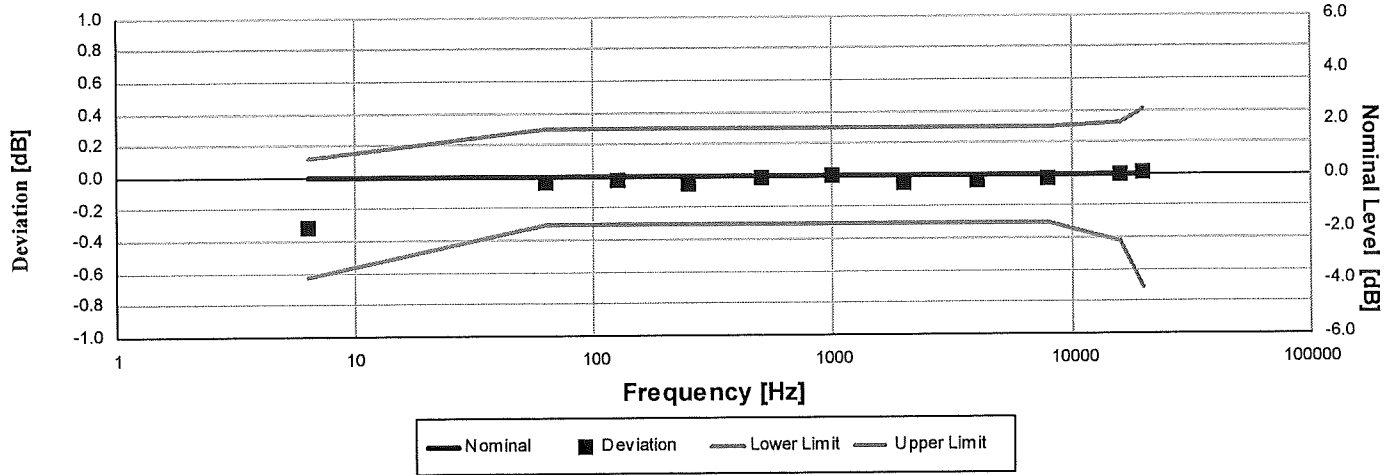


Electrical signal test of frequency weighting performed according to IEC 61672-3:2013 13 and ANSI S1.4-2014 Part 3: 13 for compliance to IEC 61672-1:2013 5.5; IEC 60651:2001 6.1 and 9.2.2; IEC 60804:2000 5; ANSI S1.4:1983 (R2006) 5.1 and 8.2.1; ANSI S1.4-2014 Part 1: 5.5

Frequency [Hz]	Test Result [dB]	Deviation [dB]	Lower limit [dB]	Upper limit [dB]	Expanded Uncertainty [dB]	Result
6.31	-0.31	-0.31	-0.63	0.12	0.15	Pass
63.10	-0.03	-0.03	-0.30	0.30	0.15	Pass
125.89	-0.03	-0.03	-0.30	0.30	0.15	Pass
251.19	-0.04	-0.04	-0.30	0.30	0.15	Pass
501.19	-0.01	-0.01	-0.30	0.30	0.15	Pass
1,000.00	0.00	0.00	-0.30	0.30	0.15	Pass
1,995.26	-0.04	-0.04	-0.30	0.30	0.15	Pass
3,981.07	-0.04	-0.04	-0.30	0.30	0.15	Pass
7,943.28	-0.03	-0.03	-0.30	0.30	0.15	Pass
15,848.93	0.00	0.00	-0.42	0.32	0.15	Pass
19,952.62	0.01	0.01	-0.71	0.41	0.15	Pass

-- End of measurement results--



A-weighted 0 dB Gain Broadband Log Linearity: 8,000.00 Hz

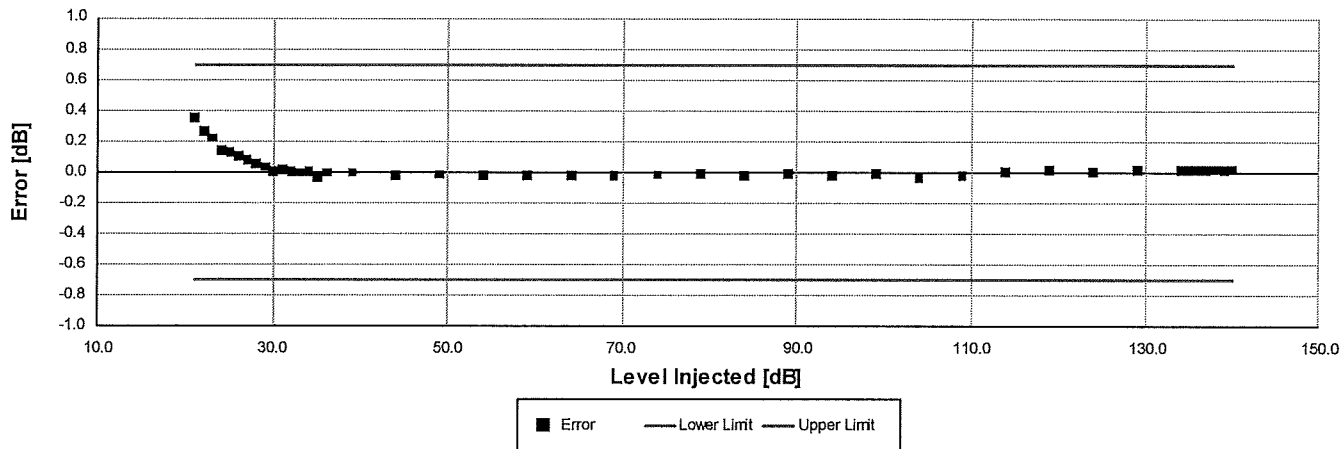

Broadband level linearity performed according to IEC 61672-3:2013 16 and ANSI S1.4-2014 Part 3: 16 for compliance to IEC 61672-1:2013 5.6, IEC 60804:2000 6.2, IEC 61252:2002 8, ANSI S1.4 (R2006) 6.9, ANSI S1.4-2014 Part 1: 5.6, ANSI S1.43 (R2007) 6.2

Level [dB]	Error [dB]	Lower limit [dB]	Upper limit [dB]	Expanded Uncertainty [dB]	Result
21.00	0.36	-0.70	0.70	0.16	Pass
22.00	0.27	-0.70	0.70	0.16	Pass
23.00	0.22	-0.70	0.70	0.16	Pass
24.00	0.15	-0.70	0.70	0.16	Pass
25.00	0.13	-0.70	0.70	0.16	Pass
26.00	0.10	-0.70	0.70	0.16	Pass
27.00	0.08	-0.70	0.70	0.16	Pass
28.00	0.06	-0.70	0.70	0.16	Pass
29.00	0.04	-0.70	0.70	0.18	Pass
30.00	0.00	-0.70	0.70	0.17	Pass
31.00	0.01	-0.70	0.70	0.17	Pass
32.00	0.00	-0.70	0.70	0.17	Pass
33.00	0.00	-0.70	0.70	0.16	Pass
34.00	0.01	-0.70	0.70	0.16	Pass
35.00	-0.03	-0.70	0.70	0.16	Pass
36.00	0.00	-0.70	0.70	0.16	Pass
39.00	0.00	-0.70	0.70	0.16	Pass
44.00	-0.02	-0.70	0.70	0.16	Pass
49.00	-0.01	-0.70	0.70	0.16	Pass
54.00	-0.02	-0.70	0.70	0.16	Pass
59.00	-0.02	-0.70	0.70	0.16	Pass
64.00	-0.02	-0.70	0.70	0.16	Pass
69.00	-0.02	-0.70	0.70	0.16	Pass
74.00	-0.01	-0.70	0.70	0.16	Pass
79.00	-0.01	-0.70	0.70	0.16	Pass
84.00	-0.02	-0.70	0.70	0.16	Pass
89.00	-0.01	-0.70	0.70	0.16	Pass
94.00	-0.02	-0.70	0.70	0.16	Pass
99.00	-0.01	-0.70	0.70	0.16	Pass
104.00	-0.03	-0.70	0.70	0.15	Pass
109.00	-0.02	-0.70	0.70	0.15	Pass
114.00	0.00	-0.70	0.70	0.15	Pass
119.00	0.02	-0.70	0.70	0.15	Pass
124.00	0.00	-0.70	0.70	0.15	Pass
129.00	0.02	-0.70	0.70	0.15	Pass
134.00	0.01	-0.70	0.70	0.15	Pass

LARSON DAVIS - A PCB PIEZOTRONICS DIV.  
 1681 West 820 North  
 Provo, UT 84601, United States  
 716-684-0001




Level [dB]	Error [dB]	Lower limit [dB]	Upper limit [dB]	Expanded Uncertainty [dB]	Result
135.00	0.02	-0.70	0.70	0.15	Pass
136.00	0.02	-0.70	0.70	0.15	Pass
137.00	0.02	-0.70	0.70	0.15	Pass
138.00	0.02	-0.70	0.70	0.15	Pass
139.00	0.02	-0.70	0.70	0.15	Pass
140.00	0.02	-0.70	0.70	0.15	Pass

-- End of measurement results--



A-weighted 20 dB Gain Broadband Log Linearity: 8,000.00 Hz

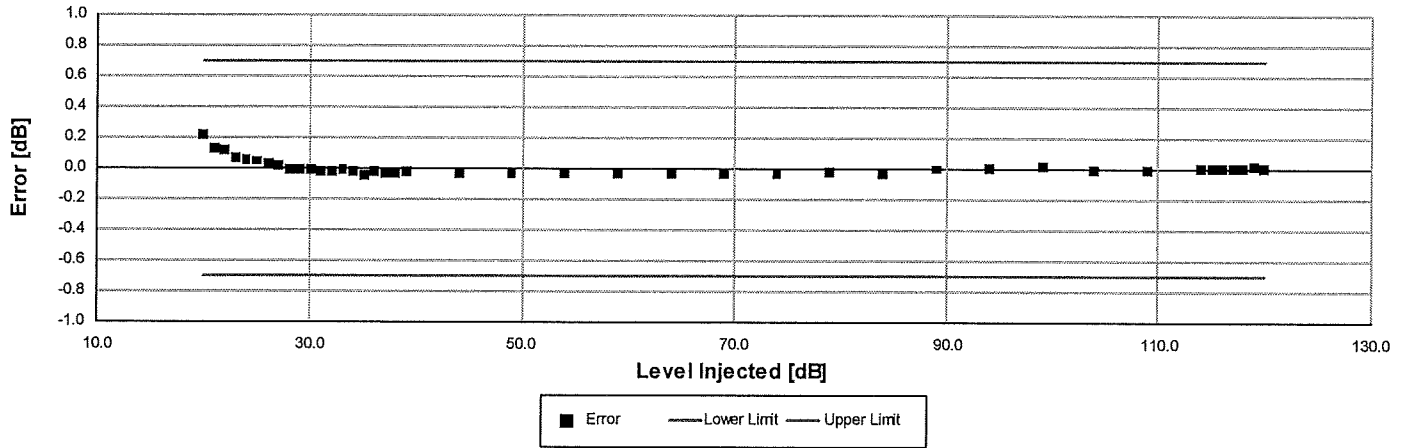

Broadband level linearity performed according to IEC 61672-3:2013 16 and ANSI S1.4-2014 Part 3: 16 for compliance to IEC 61672-1:2013 5.6, IEC 60804:2000 6.2, IEC 61252:2002 8, ANSI S1.4 (R2006) 6.9, ANSI S1.4-2014 Part 1: 5.6, ANSI S1.43 (R2007) 6.2

Level [dB]	Error [dB]	Lower limit [dB]	Upper limit [dB]	Expanded Uncertainty [dB]	Result
20.00	0.21	-0.70	0.70	0.17	Pass
21.00	0.13	-0.70	0.70	0.16	Pass
22.00	0.12	-0.70	0.70	0.16	Pass
23.00	0.07	-0.70	0.70	0.16	Pass
24.00	0.05	-0.70	0.70	0.16	Pass
25.00	0.05	-0.70	0.70	0.16	Pass
26.00	0.03	-0.70	0.70	0.19	Pass
27.00	0.02	-0.70	0.70	0.18	Pass
28.00	-0.01	-0.70	0.70	0.19	Pass
29.00	-0.01	-0.70	0.70	0.18	Pass
30.00	-0.01	-0.70	0.70	0.17	Pass
31.00	-0.02	-0.70	0.70	0.17	Pass
32.00	-0.02	-0.70	0.70	0.17	Pass
33.00	-0.01	-0.70	0.70	0.16	Pass
34.00	-0.02	-0.70	0.70	0.16	Pass
35.00	-0.05	-0.70	0.70	0.16	Pass
36.00	-0.02	-0.70	0.70	0.16	Pass
37.00	-0.03	-0.70	0.70	0.16	Pass
38.00	-0.03	-0.70	0.70	0.16	Pass
39.00	-0.02	-0.70	0.70	0.16	Pass
44.00	-0.03	-0.70	0.70	0.16	Pass
49.00	-0.03	-0.70	0.70	0.16	Pass
54.00	-0.03	-0.70	0.70	0.16	Pass
59.00	-0.04	-0.70	0.70	0.16	Pass
64.00	-0.03	-0.70	0.70	0.16	Pass
69.00	-0.03	-0.70	0.70	0.16	Pass
74.00	-0.03	-0.70	0.70	0.16	Pass
79.00	-0.02	-0.70	0.70	0.16	Pass
84.00	-0.04	-0.70	0.70	0.16	Pass
89.00	0.00	-0.70	0.70	0.16	Pass
94.00	0.00	-0.70	0.70	0.16	Pass
99.00	0.01	-0.70	0.70	0.16	Pass
104.00	-0.01	-0.70	0.70	0.15	Pass
109.00	-0.01	-0.70	0.70	0.15	Pass
114.00	0.00	-0.70	0.70	0.15	Pass
115.00	0.00	-0.70	0.70	0.15	Pass

LARSON DAVIS - A PCB PIEZOTRONICS DIV.  
 1681 West 820 North  
 Provo, UT 84601, United States  
 716-684-0001



Level [dB]	Error [dB]	Lower limit [dB]	Upper limit [dB]	Expanded Uncertainty [dB]	Result
116.00	0.00	-0.70	0.70	0.15	Pass
117.00	0.01	-0.70	0.70	0.15	Pass
118.00	0.01	-0.70	0.70	0.15	Pass
119.00	0.02	-0.70	0.70	0.15	Pass
120.00	0.01	-0.70	0.70	0.15	Pass

-- End of measurement results--

### Peak Rise Time

Peak rise time performed according to IEC 60651:2001 9.4.4 and ANSI S1.4:1983 (R2006) 8.4.4

Amplitude [dB]	Duration [μs]	Test Result [dB]	Lower limit [dB]	Upper limit [dB]	Expanded Uncertainty [dB]	Result	
139.00	40	Negative Pulse	135.89	134.64	136.64	0.15	Pass
		Positive Pulse	135.85	134.63	136.63	0.15	Pass
	30	Negative Pulse	135.10	134.64	136.64	0.15	Pass
		Positive Pulse	135.08	134.63	136.63	0.15	Pass

-- End of measurement results--

### Positive Pulse Crest Factor

#### 200 μs pulse tests at 2.0, 12.0, 22.0, 32.0 dB below Overload Limit

Crest Factor measured according to IEC 60651:2001 9.4.2 and ANSI S1.4:1983 (R2006) 8.4.2

Amplitude [dB]	Crest Factor	Test Result [dB]	Limits [dB]	Expanded Uncertainty [dB]	Result
138.00	3	OVLD	± 0.50	0.15 ‡	Pass
	5	OVLD	± 1.00	0.15 ‡	Pass
	10	OVLD	± 1.50	0.15 ‡	Pass
128.00	3	-0.10	± 0.50	0.15 ‡	Pass
	5	-0.09	± 1.00	0.15 ‡	Pass
	10	OVLD	± 1.50	0.15 ‡	Pass
118.00	3	-0.12	± 0.50	0.15 ‡	Pass
	5	-0.12	± 1.00	0.15 ‡	Pass
	10	-0.17	± 1.50	0.15 ‡	Pass
108.00	3	-0.11	± 0.50	0.15 ‡	Pass
	5	-0.10	± 1.00	0.15 ‡	Pass
	10	-0.14	± 1.50	0.15 ‡	Pass

-- End of measurement results--



## Negative Pulse Crest Factor

200  $\mu$ s pulse tests at 2.0, 12.0, 22.0, 32.0 dB below Overload Limit

Crest Factor measured according to IEC 60651:2001 9.4.2 and ANSI S1.4:1983 (R2006) 8.4.2

Amplitude [dB]	Crest Factor	Test Result [dB]	Limits [dB]	Expanded Uncertainty [dB]	Result
138.00	3	OVLD	$\pm 0.50$	0.15 ‡	Pass
	5	OVLD	$\pm 1.00$	0.15 ‡	Pass
	10	OVLD	$\pm 1.50$	0.15 ‡	Pass
128.00	3	-0.08	$\pm 0.50$	0.15 ‡	Pass
	5	-0.09	$\pm 1.00$	0.15 ‡	Pass
	10	OVLD	$\pm 1.50$	0.15 ‡	Pass
118.00	3	-0.10	$\pm 0.50$	0.15 ‡	Pass
	5	-0.10	$\pm 1.00$	0.15 ‡	Pass
	10	-0.25	$\pm 1.50$	0.15 ‡	Pass
108.00	3	-0.10	$\pm 0.50$	0.15 ‡	Pass
	5	-0.10	$\pm 1.00$	0.15 ‡	Pass
	10	0.04	$\pm 1.50$	0.16 ‡	Pass

-- End of measurement results--

## Gain

Gain measured according to IEC 61672-3:2013 17.3 and 17.4 and ANSI S1.4-2014 Part 3: 17.3 and 17.4

Measurement	Test Result [dB]	Lower limit [dB]	Upper limit [dB]	Expanded Uncertainty [dB]	Result
0 dB Gain	94.01	93.91	94.11	0.15	Pass
0 dB Gain, Linearity	28.08	27.31	28.71	0.16	Pass
20 dB Gain	94.02	93.91	94.11	0.15	Pass
20 dB Gain, Linearity	23.09	22.31	23.71	0.16	Pass
OBA High Range	94.01	93.20	94.80	0.15	Pass
OBA Normal Range	94.01	93.91	94.11	0.15	Pass

-- End of measurement results--

## Broadband Noise Floor

Self-generated noise measured according to IEC 61672-3:2013 11.2 and ANSI S1.4-2014 Part 3: 11.2

Measurement	Test Result [dB]	Upper limit [dB]	Result
A-weight Noise Floor	6.10	9.00	Pass
C-weight Noise Floor	11.90	15.00	Pass
Z-weight Noise Floor	21.68	25.00	Pass

-- End of measurement results--

## Total Harmonic Distortion


Measured using 1/3-Octave filters

Measurement	Test Result [dB]	Lower Limit [dB]	Upper Limit [dB]	Expanded Uncertainty [dB]	Result
10 Hz Signal	137.53	137.20	138.80	0.15	Pass
THD	-82.10		-60.00	1.30 ‡	Pass
THD+N	-80.31		-60.00	1.30 ‡	Pass

-- End of measurement results--



1/3-Octave Self-Generated Noise

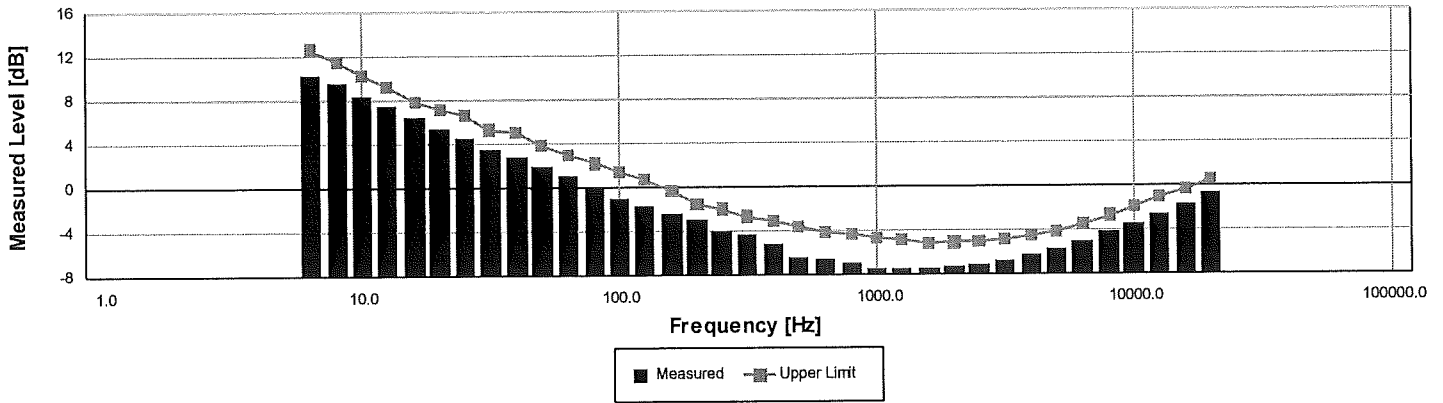

The SLM is set to normal range and 20 dB gain.

Frequency [Hz]	Test Result [dB]	Upper limit [dB]	Result
6.30	10.31	12.60	Pass
8.00	9.58	11.50	Pass
10.00	8.36	10.20	Pass
12.50	7.55	9.20	Pass
16.00	6.36	7.90	Pass
20.00	5.42	7.20	Pass
25.00	4.48	6.60	Pass
31.50	3.48	5.30	Pass
40.00	2.87	5.00	Pass
50.00	1.85	3.80	Pass
63.00	1.00	3.00	Pass
80.00	-0.06	2.20	Pass
100.00	-1.00	1.40	Pass
125.00	-1.71	0.70	Pass
160.00	-2.36	-0.40	Pass
200.00	-2.94	-1.50	Pass
250.00	-4.06	-2.00	Pass
315.00	-4.36	-2.70	Pass
400.00	-5.28	-3.10	Pass
500.00	-6.37	-3.70	Pass
630.00	-6.63	-4.10	Pass
800.00	-6.94	-4.30	Pass
1,000.00	-7.39	-4.70	Pass
1,250.00	-7.41	-4.80	Pass
1,600.00	-7.49	-5.20	Pass
2,000.00	-7.37	-5.10	Pass
2,500.00	-7.16	-5.00	Pass
3,150.00	-6.72	-4.80	Pass
4,000.00	-6.22	-4.50	Pass
5,000.00	-5.66	-4.10	Pass
6,300.00	-4.96	-3.40	Pass
8,000.00	-4.13	-2.70	Pass
10,000.00	-3.41	-1.90	Pass
12,500.00	-2.56	-1.10	Pass
16,000.00	-1.67	-0.30	Pass
20,000.00	-0.70	0.60	Pass

-- End of measurement results--



-- End of Report--

Signatory: Ron Harris

LARSON DAVIS - A PCB PIEZOTRONICS DIV.  
1681 West 820 North  
Provo, UT 84601, United States  
716-684-0001



# Calibration Certificate

Certificate Number 2019003913

**Customer:**

SWCA

Suite 1700

20 East Thomas Road

Phoenix, AZ 85012, United States

**Model Number** 831C

**Serial Number** 10739

**Test Results** Pass

**Initial Condition** As Manufactured

**Description** Larson Davis Model 831C  
Class 1 Sound Level Meter  
Firmware Revision: 03.3.0R3

**Procedure Number** D0001.8378

**Technician** Ron Harris

**Calibration Date** 29 Mar 2019

**Calibration Due**

**Temperature** 23.4 °C ± 0.25 °C

**Humidity** 49.7 %RH ± 2.0 %RH

**Static Pressure** 86.16 kPa ± 0.13 kPa

**Evaluation Method** Tested electrically using Larson Davis PRM831 S/N 058504 and a 12.0 pF capacitor to simulate microphone capacitance. Data reported in dB re 20 µPa assuming a microphone sensitivity of 50.0 mV/Pa.

**Compliance Standards** Compliant to Manufacturer Specifications and the following standards when combined with Calibration Certificate from procedure D0001.8384:

IEC 60651:2001 Type 1	ANSI S1.4-2014 Class 1
IEC 60804:2000 Type 1	ANSI S1.4 (R2006) Type 1
IEC 61260:2014 Class 1	ANSI S1.11-2014 Class 1
IEC 61672:2013 Class 1	ANSI S1.43 (R2007) Type 1

Issuing lab certifies that the instrument described above meets or exceeds all specifications as stated in the referenced procedure (unless otherwise noted). It has been calibrated using measurement standards traceable to the International System of Units (SI) through the National Institute of Standards and Technology (NIST), or other national measurement institutes, and meets the requirements of ISO/IEC 17025:2005. Test points marked with a ‡ in the uncertainties column do not fall within this laboratory's scope of accreditation.

The quality system is registered to ISO 9001:2015.

This calibration is a direct comparison of the unit under test to the listed reference standards and did not involve any sampling plans to complete. No allowance has been made for the instability of the test device due to use, time, etc. Such allowances would be made by the customer as needed.

The uncertainties were computed in accordance with the ISO Guide to the Expression of Uncertainty in Measurement (GUM). A coverage factor of approximately 2 sigma (k=2) has been applied to the standard uncertainty to express the expanded uncertainty at approximately 95% confidence level.

This report may not be reproduced, except in full, unless permission for the publication of an approved abstract is obtained in writing from the organization issuing this report.

Correction data from Larson Davis SoundAdvisor Model 831C Reference Manual, I831C.01 Rev B, 2017-03-31

Calibration Check Frequency: 1000 Hz; Reference Sound Pressure Level: 114 dB re 20 µPa; Reference Range: 0 dB gain

LARSON DAVIS - A PCB PIEZOTRONICS DIV.

1681 West 820 North

Provo, UT 84601, United States

716-684-0001




**LARSON DAVIS**  
A PCB PIEZOTRONICS DIV.

Standards Used

Description	Cal Date	Cal Due	Cal Standard
Hart Scientific 2626-H Temperature Probe	2018-08-19	2019-08-19	006798
SRS DS360 Ultra Low Distortion Generator	2018-10-04	2019-10-04	007167



### Z-weight Filter Response

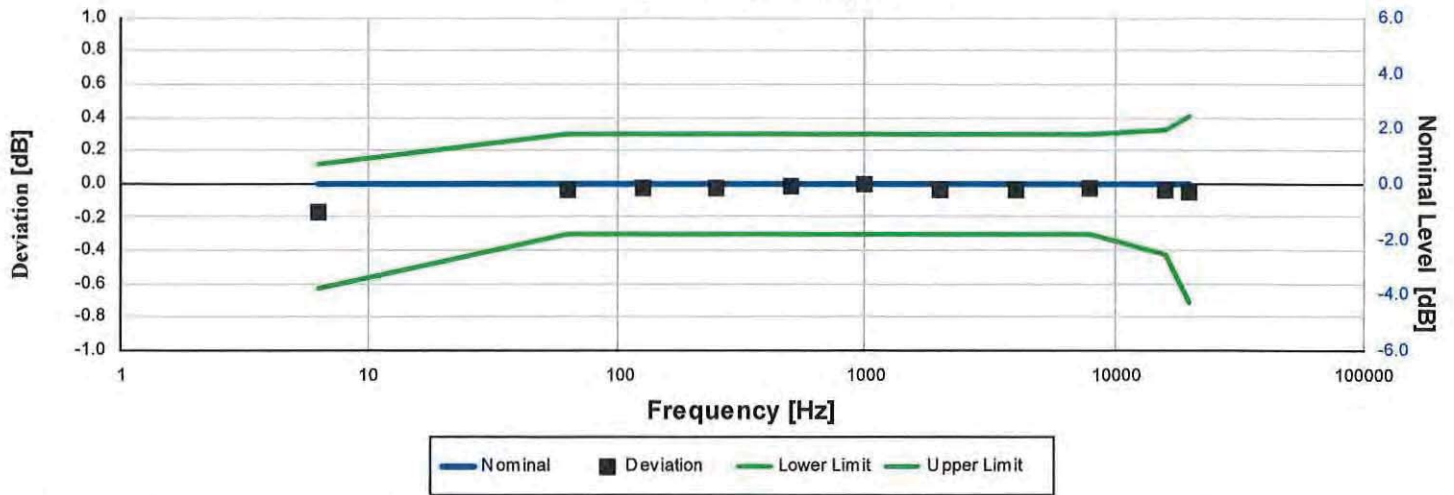


Electrical signal test of frequency weighting performed according to IEC 61672-3:2013 13 and ANSI S1.4-2014 Part 3: 13 for compliance to IEC 61672-1:2013 5.5; IEC 60651:2001 6.1 and 9.2.2; IEC 60804:2000 5; ANSI S1.4:1983 (R2006) 5.1 and 8.2.1; ANSI S1.4-2014 Part 1: 5.5

Frequency [Hz]	Test Result [dB]	Deviation [dB]	Lower limit [dB]	Upper limit [dB]	Expanded Uncertainty [dB]	Result
6.31	-0.17	-0.17	-0.63	0.12	0.15	Pass
63.10	-0.04	-0.04	-0.30	0.30	0.15	Pass
125.89	-0.02	-0.02	-0.30	0.30	0.15	Pass
251.19	-0.03	-0.03	-0.30	0.30	0.15	Pass
501.19	-0.01	-0.01	-0.30	0.30	0.15	Pass
1,000.00	0.00	0.00	-0.30	0.30	0.15	Pass
1,995.26	-0.04	-0.04	-0.30	0.30	0.15	Pass
3,981.07	-0.04	-0.04	-0.30	0.30	0.15	Pass
7,943.28	-0.03	-0.03	-0.30	0.30	0.15	Pass
15,848.93	-0.03	-0.03	-0.42	0.32	0.15	Pass
19,952.62	-0.05	-0.05	-0.71	0.41	0.15	Pass

-- End of measurement results--



### A-weighted 0 dB Gain Broadband Log Linearity: 8,000.00 Hz

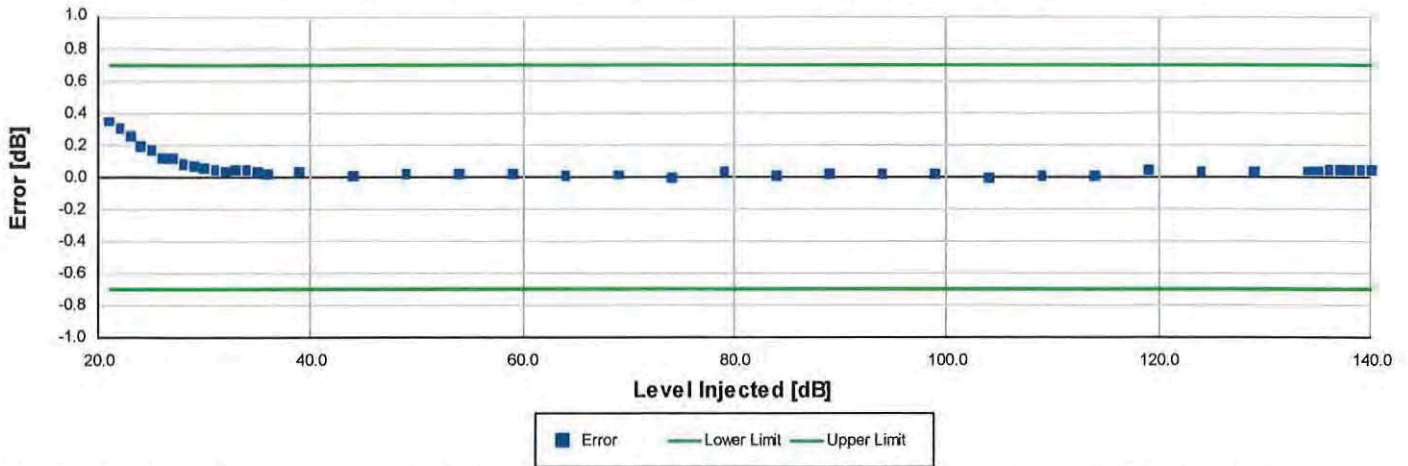

Broadband level linearity performed according to IEC 61672-3:2013 16 and ANSI S1.4-2014 Part 3: 16 for compliance to IEC 61672-1:2013 5.6, IEC 60804:2000 6.2, IEC 61252:2002 8, ANSI S1.4 (R2006) 6.9, ANSI S1.4-2014 Part 1: 5.6, ANSI S1.43 (R2007) 6.2

Level [dB]	Error [dB]	Lower limit [dB]	Upper limit [dB]	Expanded Uncertainty [dB]	Result
21.00	0.35	-0.70	0.70	0.16	Pass
22.00	0.30	-0.70	0.70	0.16	Pass
23.00	0.25	-0.70	0.70	0.16	Pass
24.00	0.20	-0.70	0.70	0.16	Pass
25.00	0.16	-0.70	0.70	0.16	Pass
26.00	0.12	-0.70	0.70	0.16	Pass
27.00	0.11	-0.70	0.70	0.16	Pass
28.00	0.08	-0.70	0.70	0.16	Pass
29.00	0.07	-0.70	0.70	0.18	Pass
30.00	0.05	-0.70	0.70	0.17	Pass
31.00	0.04	-0.70	0.70	0.17	Pass
32.00	0.03	-0.70	0.70	0.17	Pass
33.00	0.05	-0.70	0.70	0.16	Pass
34.00	0.04	-0.70	0.70	0.16	Pass
35.00	0.03	-0.70	0.70	0.16	Pass
36.00	0.02	-0.70	0.70	0.16	Pass
39.00	0.03	-0.70	0.70	0.16	Pass
44.00	0.01	-0.70	0.70	0.16	Pass
49.00	0.01	-0.70	0.70	0.16	Pass
54.00	0.01	-0.70	0.70	0.16	Pass
59.00	0.01	-0.70	0.70	0.16	Pass
64.00	0.00	-0.70	0.70	0.16	Pass
69.00	0.01	-0.70	0.70	0.16	Pass
74.00	-0.01	-0.70	0.70	0.16	Pass
79.00	0.03	-0.70	0.70	0.16	Pass
84.00	0.01	-0.70	0.70	0.16	Pass
89.00	0.01	-0.70	0.70	0.16	Pass
94.00	0.01	-0.70	0.70	0.16	Pass
99.00	0.01	-0.70	0.70	0.16	Pass
104.00	-0.01	-0.70	0.70	0.15	Pass
109.00	0.01	-0.70	0.70	0.15	Pass
114.00	0.00	-0.70	0.70	0.15	Pass
119.00	0.04	-0.70	0.70	0.15	Pass
124.00	0.03	-0.70	0.70	0.15	Pass
129.00	0.03	-0.70	0.70	0.15	Pass
134.00	0.04	-0.70	0.70	0.15	Pass




Level [dB]	Error [dB]	Lower limit [dB]	Upper limit [dB]	Expanded Uncertainty [dB]	Result
135.00	0.04	-0.70	0.70	0.15	Pass
136.00	0.04	-0.70	0.70	0.15	Pass
137.00	0.04	-0.70	0.70	0.15	Pass
138.00	0.04	-0.70	0.70	0.15	Pass
139.00	0.04	-0.70	0.70	0.15	Pass
140.00	0.04	-0.70	0.70	0.15	Pass

-- End of measurement results--



### A-weighted 20 dB Gain Broadband Log Linearity: 8,000.00 Hz

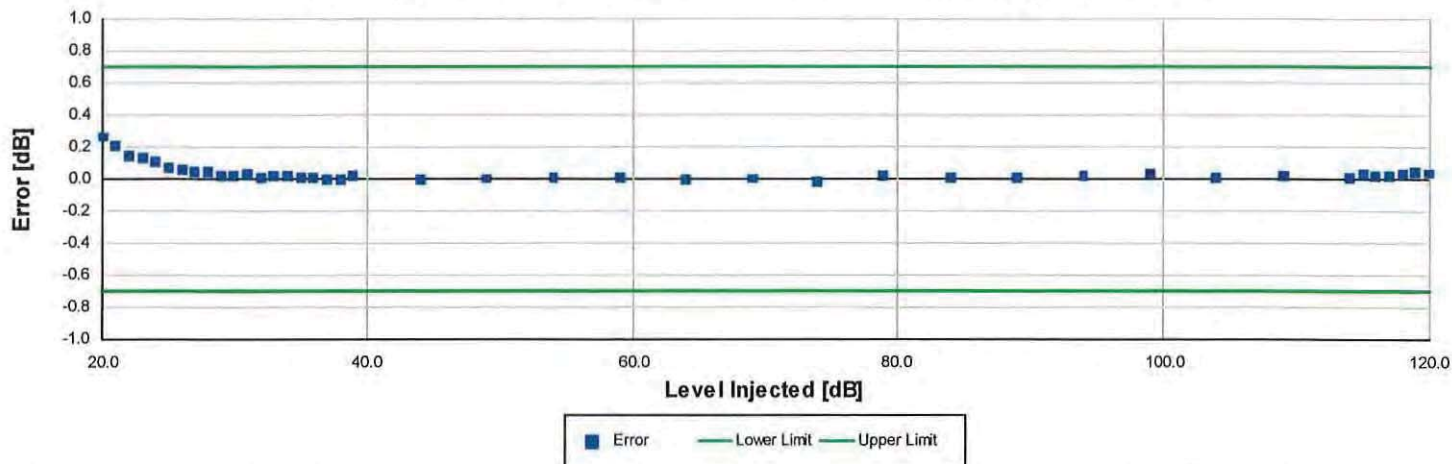

Broadband level linearity performed according to IEC 61672-3:2013 16 and ANSI S1.4-2014 Part 3: 16 for compliance to IEC 61672-1:2013 5.6, IEC 60804:2000 6.2, IEC 61252:2002 8, ANSI S1.4 (R2006) 6.9, ANSI S1.4-2014 Part 1: 5.6, ANSI S1.43 (R2007) 6.2

Level [dB]	Error [dB]	Lower limit [dB]	Upper limit [dB]	Expanded Uncertainty [dB]	Result
20.00	0.26	-0.70	0.70	0.17	Pass
21.00	0.20	-0.70	0.70	0.16	Pass
22.00	0.14	-0.70	0.70	0.16	Pass
23.00	0.12	-0.70	0.70	0.16	Pass
24.00	0.10	-0.70	0.70	0.16	Pass
25.00	0.07	-0.70	0.70	0.16	Pass
26.00	0.05	-0.70	0.70	0.19	Pass
27.00	0.04	-0.70	0.70	0.18	Pass
28.00	0.04	-0.70	0.70	0.19	Pass
29.00	0.02	-0.70	0.70	0.18	Pass
30.00	0.02	-0.70	0.70	0.17	Pass
31.00	0.03	-0.70	0.70	0.17	Pass
32.00	0.01	-0.70	0.70	0.17	Pass
33.00	0.01	-0.70	0.70	0.16	Pass
34.00	0.02	-0.70	0.70	0.16	Pass
35.00	0.00	-0.70	0.70	0.16	Pass
36.00	0.00	-0.70	0.70	0.16	Pass
37.00	-0.01	-0.70	0.70	0.16	Pass
38.00	-0.01	-0.70	0.70	0.16	Pass
39.00	0.01	-0.70	0.70	0.16	Pass
44.00	0.00	-0.70	0.70	0.16	Pass
49.00	0.00	-0.70	0.70	0.16	Pass
54.00	0.00	-0.70	0.70	0.16	Pass
59.00	0.00	-0.70	0.70	0.16	Pass
64.00	-0.01	-0.70	0.70	0.16	Pass
69.00	0.00	-0.70	0.70	0.16	Pass
74.00	-0.02	-0.70	0.70	0.16	Pass
79.00	0.01	-0.70	0.70	0.16	Pass
84.00	0.00	-0.70	0.70	0.16	Pass
89.00	0.01	-0.70	0.70	0.16	Pass
94.00	0.02	-0.70	0.70	0.16	Pass
99.00	0.03	-0.70	0.70	0.16	Pass
104.00	0.01	-0.70	0.70	0.15	Pass
109.00	0.02	-0.70	0.70	0.15	Pass
114.00	0.00	-0.70	0.70	0.15	Pass
115.00	0.03	-0.70	0.70	0.15	Pass

LARSON DAVIS - A PCB PIEZOTRONICS DIV.  
 1681 West 820 North  
 Provo, UT 84601, United States  
 716-684-0001





Level [dB]	Error [dB]	Lower limit [dB]	Upper limit [dB]	Expanded Uncertainty [dB]	Result
116.00	0.02	-0.70	0.70	0.15	Pass
117.00	0.02	-0.70	0.70	0.15	Pass
118.00	0.02	-0.70	0.70	0.15	Pass
119.00	0.04	-0.70	0.70	0.15	Pass
120.00	0.03	-0.70	0.70	0.15	Pass

-- End of measurement results--

### Peak Rise Time

Peak rise time performed according to IEC 60651:2001 9.4.4 and ANSI S1.4:1983 (R2006) 8.4.4

Amplitude [dB]	Duration [μs]	Test Result [dB]	Lower limit [dB]	Upper limit [dB]	Expanded Uncertainty [dB]	Result	
139.00	40	Negative Pulse	138.32	137.00	139.00	0.15	Pass
		Positive Pulse	138.26	137.00	139.00	0.15	Pass
	30	Negative Pulse	137.50	137.00	139.00	0.15	Pass
		Positive Pulse	137.49	137.00	139.00	0.15	Pass

-- End of measurement results--

### Positive Pulse Crest Factor

#### 200 μs pulse tests at 2.0, 12.0, 22.0, 32.0 dB below Overload Limit

Crest Factor measured according to IEC 60651:2001 9.4.2 and ANSI S1.4:1983 (R2006) 8.4.2

Amplitude [dB]	Crest Factor	Test Result [dB]	Limits [dB]	Expanded Uncertainty [dB]	Result
138.00	3	OVLD	± 0.50	0.15 ‡	Pass
	5	OVLD	± 1.00	0.15 ‡	Pass
	10	OVLD	± 1.50	0.15 ‡	Pass
128.00	3	-0.12	± 0.50	0.15 ‡	Pass
	5	-0.10	± 1.00	0.15 ‡	Pass
	10	OVLD	± 1.50	0.15 ‡	Pass
118.00	3	-0.13	± 0.50	0.15 ‡	Pass
	5	-0.11	± 1.00	0.15 ‡	Pass
	10	-0.26	± 1.50	0.15 ‡	Pass
108.00	3	-0.12	± 0.50	0.15 ‡	Pass
	5	-0.10	± 1.00	0.15 ‡	Pass
	10	-0.25	± 1.50	0.15 ‡	Pass

-- End of measurement results--



### Negative Pulse Crest Factor

#### 200 $\mu$ s pulse tests at 2.0, 12.0, 22.0, 32.0 dB below Overload Limit

Crest Factor measured according to IEC 60651:2001 9.4.2 and ANSI S1.4:1983 (R2006) 8.4.2

Amplitude [dB]	Crest Factor	Test Result [dB]	Limits [dB]	Expanded Uncertainty [dB]	Result
138.00	3	OVL	$\pm 0.50$	0.15 $\pm$	Pass
	5	OVL	$\pm 1.00$	0.15 $\pm$	Pass
	10	OVL	$\pm 1.50$	0.15 $\pm$	Pass
128.00	3	-0.11	$\pm 0.50$	0.15 $\pm$	Pass
	5	-0.10	$\pm 1.00$	0.15 $\pm$	Pass
	10	OVL	$\pm 1.50$	0.15 $\pm$	Pass
118.00	3	-0.14	$\pm 0.50$	0.15 $\pm$	Pass
	5	-0.15	$\pm 1.00$	0.15 $\pm$	Pass
	10	-0.09	$\pm 1.50$	0.15 $\pm$	Pass
108.00	3	-0.11	$\pm 0.50$	0.15 $\pm$	Pass
	5	-0.12	$\pm 1.00$	0.15 $\pm$	Pass
	10	-0.08	$\pm 1.50$	0.16 $\pm$	Pass

-- End of measurement results--

### Gain


Gain measured according to IEC 61672-3:2013 17.3 and 17.4 and ANSI S1.4-2014 Part 3: 17.3 and 17.4

Measurement	Test Result [dB]	Lower limit [dB]	Upper limit [dB]	Expanded Uncertainty [dB]	Result
0 dB Gain	94.00	93.89	94.09	0.15	Pass
0 dB Gain, Linearity	28.08	27.29	28.69	0.16	Pass
20 dB Gain	94.01	93.89	94.09	0.15	Pass
20 dB Gain, Linearity	23.13	22.29	23.69	0.16	Pass
OBA High Range	93.99	93.20	94.80	0.15	Pass
OBA Normal Range	93.95	93.89	94.09	0.15	Pass

-- End of measurement results--



1/3-Octave Self-Generated Noise

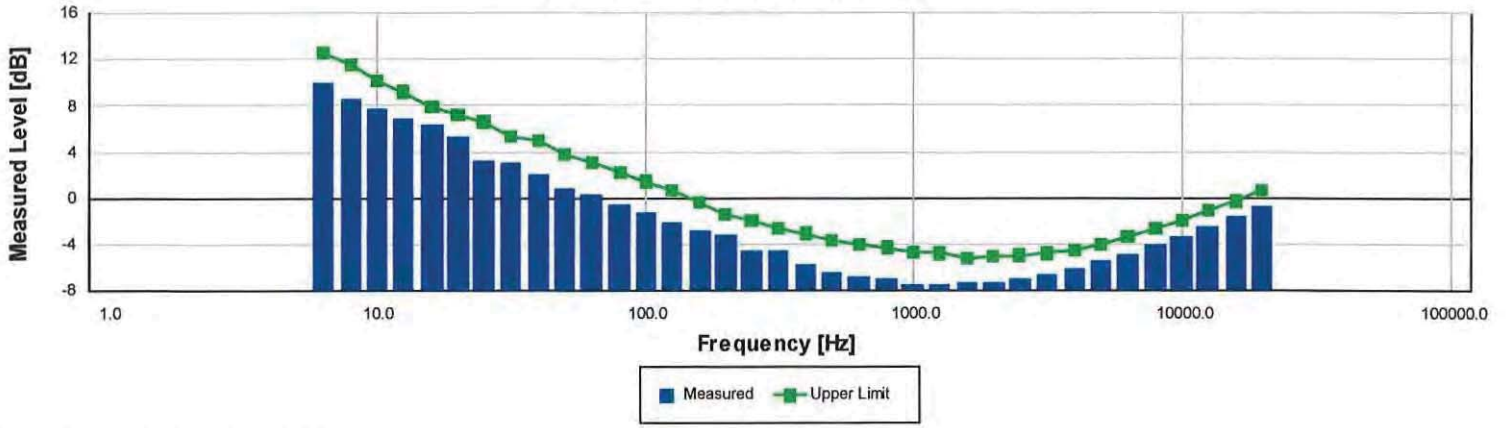

The SLM is set to normal range and 20 dB gain.

Frequency [Hz]	Test Result [dB]	Upper limit [dB]	Result
6.30	10.07	12.60	Pass
8.00	8.56	11.50	Pass
10.00	7.65	10.20	Pass
12.50	6.92	9.20	Pass
16.00	6.37	7.90	Pass
20.00	5.23	7.20	Pass
25.00	3.27	6.60	Pass
31.50	3.12	5.30	Pass
40.00	2.11	5.00	Pass
50.00	0.90	3.80	Pass
63.00	0.30	3.00	Pass
80.00	-0.62	2.20	Pass
100.00	-1.34	1.40	Pass
125.00	-2.17	0.70	Pass
160.00	-2.89	-0.40	Pass
200.00	-3.15	-1.50	Pass
250.00	-4.64	-2.00	Pass
315.00	-4.57	-2.70	Pass
400.00	-5.79	-3.10	Pass
500.00	-6.53	-3.70	Pass
630.00	-6.79	-4.10	Pass
800.00	-6.96	-4.30	Pass
1,000.00	-7.46	-4.70	Pass
1,250.00	-7.45	-4.80	Pass
1,600.00	-7.40	-5.20	Pass
2,000.00	-7.30	-5.10	Pass
2,500.00	-6.99	-5.00	Pass
3,150.00	-6.58	-4.80	Pass
4,000.00	-6.10	-4.50	Pass
5,000.00	-5.50	-4.10	Pass
6,300.00	-4.89	-3.40	Pass
8,000.00	-4.12	-2.70	Pass
10,000.00	-3.32	-1.90	Pass
12,500.00	-2.52	-1.10	Pass
16,000.00	-1.63	-0.30	Pass
20,000.00	-0.70	0.60	Pass

-- End of measurement results--





**Broadband Noise Floor**

Self-generated noise measured according to IEC 61672-3:2013 11.2 and ANSI S1.4-2014 Part 3: 11.2

Measurement	Test Result [dB]	Upper limit [dB]	Result
A-weight Noise Floor	6.20	9.00	Pass
C-weight Noise Floor	11.65	15.00	Pass
Z-weight Noise Floor	21.50	25.00	Pass

-- End of measurement results--

**Total Harmonic Distortion**

Measured using 1/3-Octave filters

Measurement	Test Result [dB]	Lower Limit [dB]	Upper Limit [dB]	Expanded Uncertainty [dB]	Result
10 Hz Signal	137.56	137.20	138.80	0.15	Pass
THD	-81.11		-60.00	1.30 ‡	Pass
THD+N	-79.51		-60.00	1.30 ‡	Pass

-- End of measurement results--

-- End of Report--

Signatory: Ron Harris

LARSON DAVIS - A PCB PIEZOTRONICS DIV.  
 1681 West 820 North  
 Provo, UT 84601, United States  
 716-684-0001



# Calibration Certificate

Certificate Number 2019003906

**Customer:**

SWCA  
Suite 1700  
20 East Thomas Road  
Phoenix, AZ 85012, United States

**Model Number** 831C  
**Serial Number** 10737  
**Test Results** Pass

**Initial Condition** As Manufactured

**Description** Larson Davis Model 831C  
Class 1 Sound Level Meter  
Firmware Revision: 03.3.0R3

**Procedure Number** D0001.8378  
**Technician** Ron Harris  
**Calibration Date** 29 Mar 2019  
**Calibration Due**  
**Temperature** 23.48 °C ± 0.25 °C  
**Humidity** 49.6 %RH ± 2.0 %RH  
**Static Pressure** 86.08 kPa ± 0.13 kPa

**Evaluation Method** Tested electrically using Larson Davis PRM831 S/N 058503 and a 12.0 pF capacitor to simulate microphone capacitance. Data reported in dB re 20 µPa assuming a microphone sensitivity of 50.0 mV/Pa.

**Compliance Standards** Compliant to Manufacturer Specifications and the following standards when combined with Calibration Certificate from procedure D0001.8384:

IEC 60651:2001 Type 1	ANSI S1.4-2014 Class 1
IEC 60804:2000 Type 1	ANSI S1.4 (R2006) Type 1
IEC 61260:2014 Class 1	ANSI S1.11-2014 Class 1
IEC 61672:2013 Class 1	ANSI S1.43 (R2007) Type 1

Issuing lab certifies that the instrument described above meets or exceeds all specifications as stated in the referenced procedure (unless otherwise noted). It has been calibrated using measurement standards traceable to the International System of Units (SI) through the National Institute of Standards and Technology (NIST), or other national measurement institutes, and meets the requirements of ISO/IEC 17025:2005. Test points marked with a ‡ in the uncertainties column do not fall within this laboratory's scope of accreditation.

The quality system is registered to ISO 9001:2015.

This calibration is a direct comparison of the unit under test to the listed reference standards and did not involve any sampling plans to complete. No allowance has been made for the instability of the test device due to use, time, etc. Such allowances would be made by the customer as needed.

The uncertainties were computed in accordance with the ISO Guide to the Expression of Uncertainty in Measurement (GUM). A coverage factor of approximately 2 sigma (k=2) has been applied to the standard uncertainty to express the expanded uncertainty at approximately 95% confidence level.

This report may not be reproduced, except in full, unless permission for the publication of an approved abstract is obtained in writing from the organization issuing this report.


Correction data from Larson Davis SoundAdvisor Model 831C Reference Manual, I831C.01 Rev B, 2017-03-31

Calibration Check Frequency: 1000 Hz; Reference Sound Pressure Level: 114 dB re 20 µPa; Reference Range: 0 dB gain

Standards Used			
Description	Cal Date	Cal Due	Cal Standard
Hart Scientific 2626-H Temperature Probe	2018-08-19	2019-08-19	006798
SRS DS360 Ultra Low Distortion Generator	2018-10-04	2019-10-04	007167



### Z-weight Filter Response

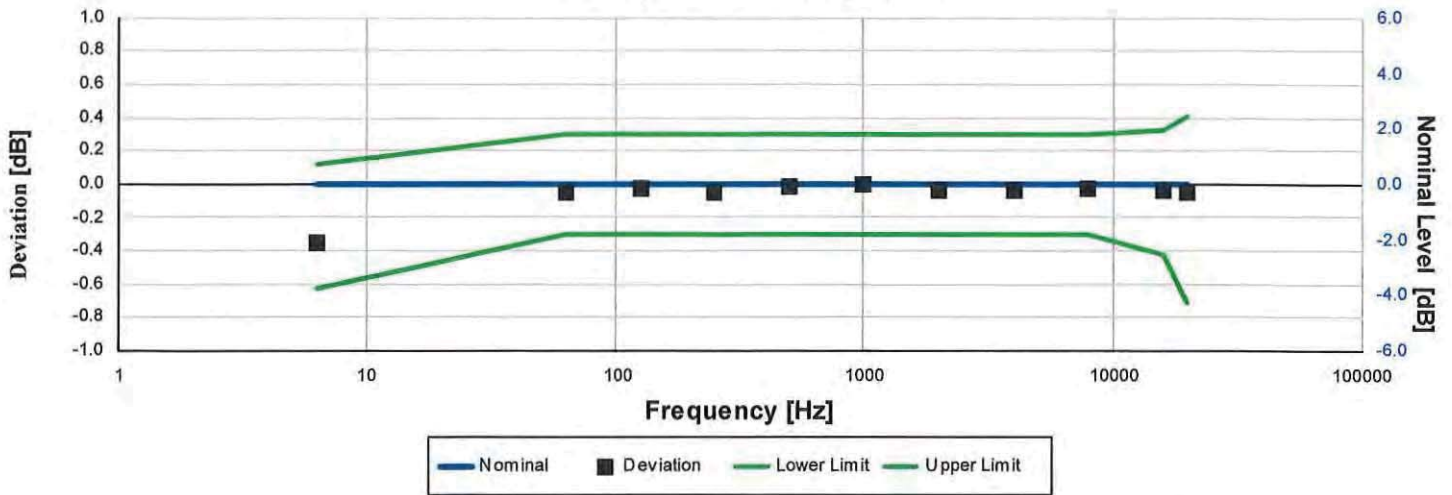

Electrical signal test of frequency weighting performed according to IEC 61672-3:2013 13 and ANSI S1.4-2014 Part 3: 13 for compliance to IEC 61672-1:2013 5.5; IEC 60651:2001 6.1 and 9.2.2; IEC 60804:2000 5; ANSI S1.4:1983 (R2006) 5.1 and 8.2.1; ANSI S1.4-2014 Part 1: 5.5


Frequency [Hz]	Test Result [dB]	Deviation [dB]	Lower limit [dB]	Upper limit [dB]	Expanded Uncertainty [dB]	Result
6.31	-0.34	-0.34	-0.63	0.12	0.15	Pass
63.10	-0.05	-0.05	-0.30	0.30	0.15	Pass
125.89	-0.03	-0.03	-0.30	0.30	0.15	Pass
251.19	-0.05	-0.05	-0.30	0.30	0.15	Pass
501.19	-0.01	-0.01	-0.30	0.30	0.15	Pass
1,000.00	0.00	0.00	-0.30	0.30	0.15	Pass
1,995.26	-0.04	-0.04	-0.30	0.30	0.15	Pass
3,981.07	-0.04	-0.04	-0.30	0.30	0.15	Pass
7,943.28	-0.03	-0.03	-0.30	0.30	0.15	Pass
15,848.93	-0.03	-0.03	-0.42	0.32	0.15	Pass
19,952.62	-0.05	-0.05	-0.71	0.41	0.15	Pass

-- End of measurement results--





### A-weighted 0 dB Gain Broadband Log Linearity: 8,000.00 Hz

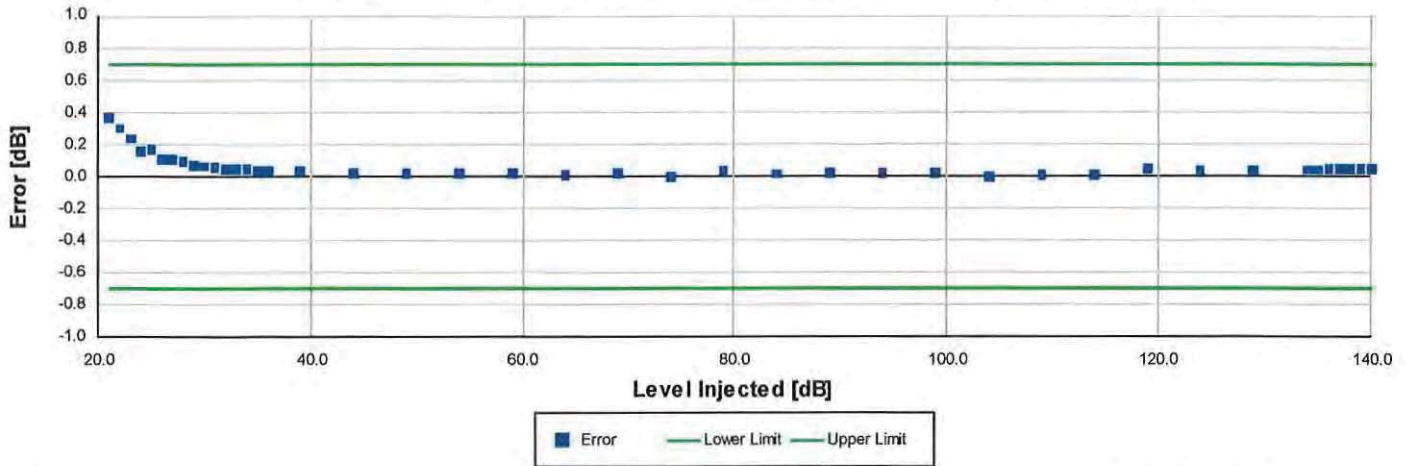

Broadband level linearity performed according to IEC 61672-3:2013 16 and ANSI S1.4-2014 Part 3: 16 for compliance to IEC 61672-1:2013 5.6, IEC 60804:2000 6.2, IEC 61252:2002 8, ANSI S1.4 (R2006) 6.9, ANSI S1.4-2014 Part 1: 5.6, ANSI S1.43 (R2007) 6.2

Level [dB]	Error [dB]	Lower limit [dB]	Upper limit [dB]	Expanded Uncertainty [dB]	Result
21.00	0.36	-0.70	0.70	0.16	Pass
22.00	0.30	-0.70	0.70	0.16	Pass
23.00	0.24	-0.70	0.70	0.16	Pass
24.00	0.16	-0.70	0.70	0.16	Pass
25.00	0.16	-0.70	0.70	0.16	Pass
26.00	0.10	-0.70	0.70	0.16	Pass
27.00	0.10	-0.70	0.70	0.16	Pass
28.00	0.09	-0.70	0.70	0.16	Pass
29.00	0.07	-0.70	0.70	0.18	Pass
30.00	0.06	-0.70	0.70	0.17	Pass
31.00	0.05	-0.70	0.70	0.17	Pass
32.00	0.05	-0.70	0.70	0.17	Pass
33.00	0.05	-0.70	0.70	0.16	Pass
34.00	0.04	-0.70	0.70	0.16	Pass
35.00	0.03	-0.70	0.70	0.16	Pass
36.00	0.03	-0.70	0.70	0.16	Pass
39.00	0.03	-0.70	0.70	0.16	Pass
44.00	0.01	-0.70	0.70	0.16	Pass
49.00	0.01	-0.70	0.70	0.16	Pass
54.00	0.02	-0.70	0.70	0.16	Pass
59.00	0.02	-0.70	0.70	0.16	Pass
64.00	0.01	-0.70	0.70	0.16	Pass
69.00	0.01	-0.70	0.70	0.16	Pass
74.00	-0.01	-0.70	0.70	0.16	Pass
79.00	0.03	-0.70	0.70	0.16	Pass
84.00	0.01	-0.70	0.70	0.16	Pass
89.00	0.01	-0.70	0.70	0.16	Pass
94.00	0.01	-0.70	0.70	0.16	Pass
99.00	0.02	-0.70	0.70	0.16	Pass
104.00	-0.01	-0.70	0.70	0.15	Pass
109.00	0.01	-0.70	0.70	0.15	Pass
114.00	0.00	-0.70	0.70	0.15	Pass
119.00	0.04	-0.70	0.70	0.15	Pass
124.00	0.03	-0.70	0.70	0.15	Pass
129.00	0.03	-0.70	0.70	0.15	Pass
134.00	0.04	-0.70	0.70	0.15	Pass






Level [dB]	Error [dB]	Lower limit [dB]	Upper limit [dB]	Expanded Uncertainty [dB]	Result
135.00	0.04	-0.70	0.70	0.15	Pass
136.00	0.04	-0.70	0.70	0.15	Pass
137.00	0.04	-0.70	0.70	0.15	Pass
138.00	0.04	-0.70	0.70	0.15	Pass
139.00	0.04	-0.70	0.70	0.15	Pass
140.00	0.04	-0.70	0.70	0.15	Pass

-- End of measurement results--



### A-weighted 20 dB Gain Broadband Log Linearity: 8,000.00 Hz

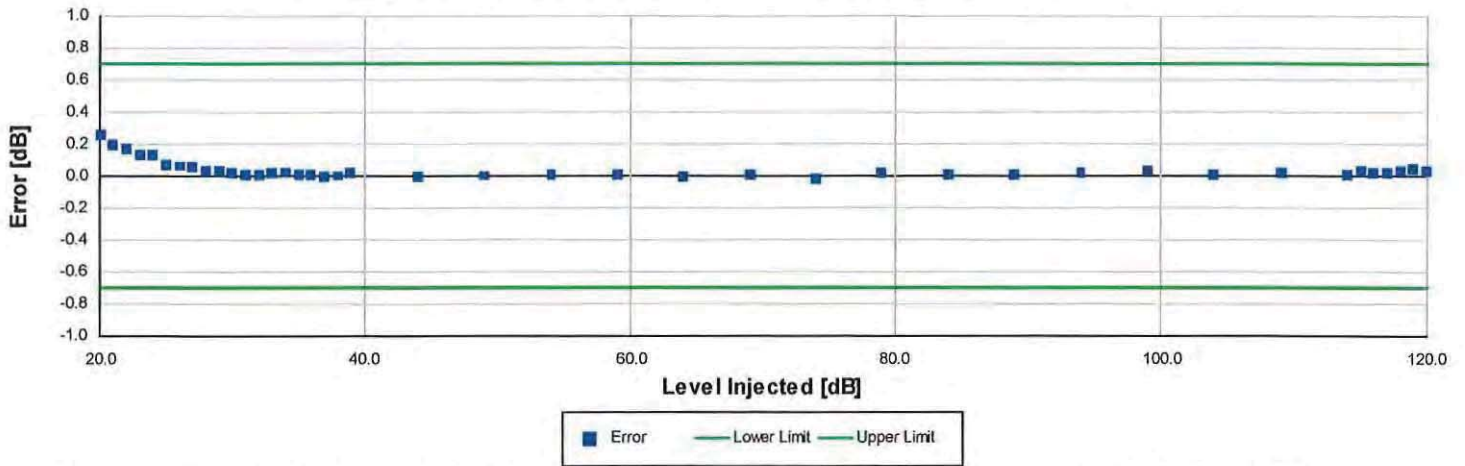

Broadband level linearity performed according to IEC 61672-3:2013 16 and ANSI S1.4-2014 Part 3: 16 for compliance to IEC 61672-1:2013 5.6, IEC 60804:2000 6.2, IEC 61252:2002 8, ANSI S1.4 (R2006) 6.9, ANSI S1.4-2014 Part 1: 5.6, ANSI S1.43 (R2007) 6.2

Level [dB]	Error [dB]	Lower limit [dB]	Upper limit [dB]	Expanded Uncertainty [dB]	Result
20.00	0.25	-0.70	0.70	0.17	Pass
21.00	0.19	-0.70	0.70	0.16	Pass
22.00	0.16	-0.70	0.70	0.16	Pass
23.00	0.13	-0.70	0.70	0.16	Pass
24.00	0.12	-0.70	0.70	0.16	Pass
25.00	0.07	-0.70	0.70	0.16	Pass
26.00	0.06	-0.70	0.70	0.19	Pass
27.00	0.05	-0.70	0.70	0.18	Pass
28.00	0.02	-0.70	0.70	0.19	Pass
29.00	0.03	-0.70	0.70	0.18	Pass
30.00	0.01	-0.70	0.70	0.17	Pass
31.00	0.01	-0.70	0.70	0.17	Pass
32.00	0.01	-0.70	0.70	0.17	Pass
33.00	0.02	-0.70	0.70	0.16	Pass
34.00	0.02	-0.70	0.70	0.16	Pass
35.00	0.01	-0.70	0.70	0.16	Pass
36.00	0.00	-0.70	0.70	0.16	Pass
37.00	-0.01	-0.70	0.70	0.16	Pass
38.00	0.00	-0.70	0.70	0.16	Pass
39.00	0.01	-0.70	0.70	0.16	Pass
44.00	0.00	-0.70	0.70	0.16	Pass
49.00	0.00	-0.70	0.70	0.16	Pass
54.00	0.00	-0.70	0.70	0.16	Pass
59.00	0.00	-0.70	0.70	0.16	Pass
64.00	-0.01	-0.70	0.70	0.16	Pass
69.00	0.00	-0.70	0.70	0.16	Pass
74.00	-0.02	-0.70	0.70	0.16	Pass
79.00	0.01	-0.70	0.70	0.16	Pass
84.00	0.00	-0.70	0.70	0.16	Pass
89.00	0.01	-0.70	0.70	0.16	Pass
94.00	0.02	-0.70	0.70	0.16	Pass
99.00	0.03	-0.70	0.70	0.16	Pass
104.00	0.01	-0.70	0.70	0.15	Pass
109.00	0.02	-0.70	0.70	0.15	Pass
114.00	0.00	-0.70	0.70	0.15	Pass
115.00	0.03	-0.70	0.70	0.15	Pass

LARSON DAVIS - A PCB PIEZOTRONICS DIV.  
 1681 West 820 North  
 Provo, UT 84601, United States  
 716-684-0001



Level [dB]	Error [dB]	Lower limit [dB]	Upper limit [dB]	Expanded Uncertainty [dB]	Result
116.00	0.02	-0.70	0.70	0.15	Pass
117.00	0.02	-0.70	0.70	0.15	Pass
118.00	0.02	-0.70	0.70	0.15	Pass
119.00	0.04	-0.70	0.70	0.15	Pass
120.00	0.03	-0.70	0.70	0.15	Pass

-- End of measurement results--

### Peak Rise Time

Peak rise time performed according to IEC 60651:2001 9.4.4 and ANSI S1.4:1983 (R2006) 8.4.4

Amplitude [dB]	Duration [μs]	Test Result [dB]	Lower limit [dB]	Upper limit [dB]	Expanded Uncertainty [dB]	Result	
139.00	40	Negative Pulse	138.33	137.00	139.00	0.15	Pass
		Positive Pulse	138.33	137.00	139.00	0.15	Pass
	30	Negative Pulse	137.50	137.00	139.00	0.15	Pass
		Positive Pulse	137.50	137.00	139.00	0.15	Pass

-- End of measurement results--

### Positive Pulse Crest Factor

#### 200 μs pulse tests at 2.0, 12.0, 22.0, 32.0 dB below Overload Limit

Crest Factor measured according to IEC 60651:2001 9.4.2 and ANSI S1.4:1983 (R2006) 8.4.2

Amplitude [dB]	Crest Factor	Test Result [dB]	Limits [dB]	Expanded Uncertainty [dB]	Result
138.00	3	OVLD	± 0.50	0.15 ‡	Pass
	5	OVLD	± 1.00	0.15 ‡	Pass
	10	OVLD	± 1.50	0.15 ‡	Pass
128.00	3	-0.12	± 0.50	0.15 ‡	Pass
	5	-0.10	± 1.00	0.15 ‡	Pass
	10	OVLD	± 1.50	0.15 ‡	Pass
118.00	3	-0.13	± 0.50	0.15 ‡	Pass
	5	-0.14	± 1.00	0.15 ‡	Pass
	10	-0.18	± 1.50	0.15 ‡	Pass
108.00	3	-0.12	± 0.50	0.15 ‡	Pass
	5	-0.12	± 1.00	0.15 ‡	Pass
	10	0.01	± 1.50	0.15 ‡	Pass

-- End of measurement results--





### Negative Pulse Crest Factor

#### 200 µs pulse tests at 2.0, 12.0, 22.0, 32.0 dB below Overload Limit

Crest Factor measured according to IEC 60651:2001 9.4.2 and ANSI S1.4:1983 (R2006) 8.4.2

Amplitude [dB]	Crest Factor	Test Result [dB]	Limits [dB]	Expanded Uncertainty [dB]	Result
138.00	3	OVL	± 0.50	0.15 ‡	Pass
	5	OVL	± 1.00	0.15 ‡	Pass
	10	OVL	± 1.50	0.15 ‡	Pass
128.00	3	-0.11	± 0.50	0.15 ‡	Pass
	5	-0.10	± 1.00	0.15 ‡	Pass
	10	OVL	± 1.50	0.15 ‡	Pass
118.00	3	-0.13	± 0.50	0.15 ‡	Pass
	5	-0.13	± 1.00	0.15 ‡	Pass
	10	-0.18	± 1.50	0.15 ‡	Pass
108.00	3	-0.12	± 0.50	0.15 ‡	Pass
	5	-0.10	± 1.00	0.15 ‡	Pass
	10	-0.08	± 1.50	0.16 ‡	Pass

-- End of measurement results--

### Gain


Gain measured according to IEC 61672-3:2013 17.3 and 17.4 and ANSI S1.4-2014 Part 3: 17.3 and 17.4

Measurement	Test Result [dB]	Lower limit [dB]	Upper limit [dB]	Expanded Uncertainty [dB]	Result
0 dB Gain	94.00	93.89	94.09	0.15	Pass
0 dB Gain, Linearity	28.11	27.29	28.69	0.16	Pass
20 dB Gain	94.00	93.89	94.09	0.15	Pass
20 dB Gain, Linearity	23.09	22.29	23.69	0.16	Pass
OBA High Range	93.99	93.20	94.80	0.15	Pass
OBA Normal Range	93.99	93.89	94.09	0.15	Pass

-- End of measurement results--



1/3-Octave Self-Generated Noise

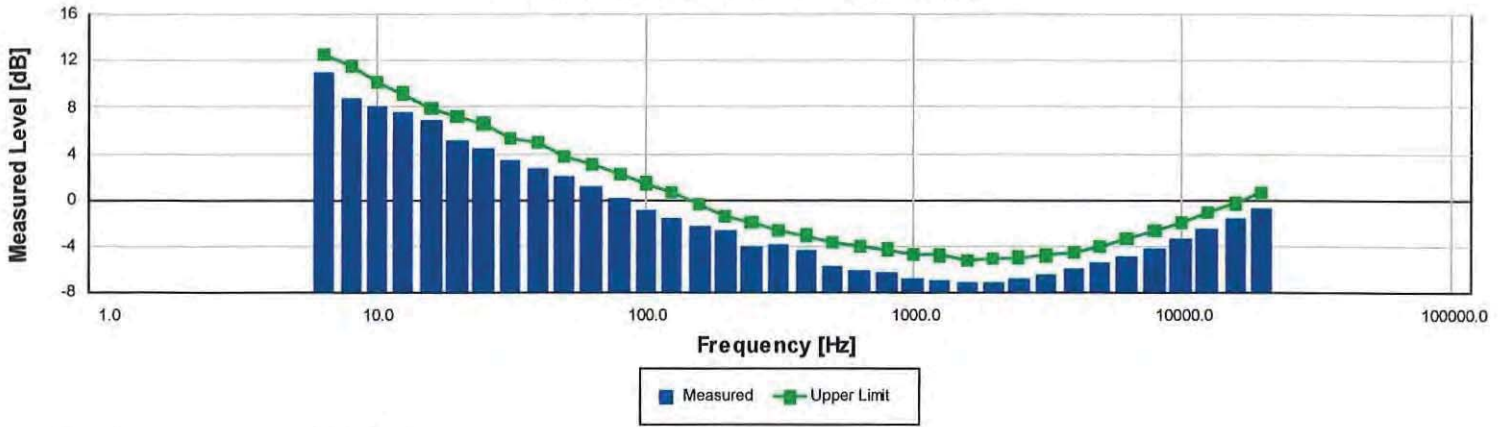

The SLM is set to normal range and 20 dB gain.

Frequency [Hz]	Test Result [dB]	Upper limit [dB]	Result
6.30	11.01	12.60	Pass
8.00	8.70	11.50	Pass
10.00	8.12	10.20	Pass
12.50	7.62	9.20	Pass
16.00	6.93	7.90	Pass
20.00	5.16	7.20	Pass
25.00	4.50	6.60	Pass
31.50	3.50	5.30	Pass
40.00	2.80	5.00	Pass
50.00	1.98	3.80	Pass
63.00	1.14	3.00	Pass
80.00	0.10	2.20	Pass
100.00	-0.84	1.40	Pass
125.00	-1.63	0.70	Pass
160.00	-2.30	-0.40	Pass
200.00	-2.62	-1.50	Pass
250.00	-4.12	-2.00	Pass
315.00	-3.88	-2.70	Pass
400.00	-4.46	-3.10	Pass
500.00	-5.68	-3.70	Pass
630.00	-6.15	-4.10	Pass
800.00	-6.23	-4.30	Pass
1,000.00	-6.76	-4.70	Pass
1,250.00	-6.92	-4.80	Pass
1,600.00	-7.10	-5.20	Pass
2,000.00	-7.08	-5.10	Pass
2,500.00	-6.83	-5.00	Pass
3,150.00	-6.51	-4.80	Pass
4,000.00	-5.86	-4.50	Pass
5,000.00	-5.44	-4.10	Pass
6,300.00	-4.90	-3.40	Pass
8,000.00	-4.13	-2.70	Pass
10,000.00	-3.37	-1.90	Pass
12,500.00	-2.54	-1.10	Pass
16,000.00	-1.70	-0.30	Pass
20,000.00	-0.70	0.60	Pass

-- End of measurement results--



**Broadband Noise Floor**

Self-generated noise measured according to IEC 61672-3:2013 11.2 and ANSI S1.4-2014 Part 3: 11.2

Measurement	Test Result [dB]	Upper limit [dB]	Result
A-weight Noise Floor	6.40	9.00	Pass
C-weight Noise Floor	12.00	15.00	Pass
Z-weight Noise Floor	22.14	25.00	Pass

-- End of measurement results--

**Total Harmonic Distortion**

Measured using 1/3-Octave filters

Measurement	Test Result [dB]	Lower Limit [dB]	Upper Limit [dB]	Expanded Uncertainty [dB]	Result
10 Hz Signal	137.55	137.20	138.80	0.15	Pass
THD	-77.70		-60.00	1.30 ‡	Pass
THD+N	-76.55		-60.00	1.30 ‡	Pass

-- End of measurement results--

-- End of Report--

Signatory: Ron Harris

LARSON DAVIS - A PCB PIEZOTRONICS DIV.  
 1681 West 820 North  
 Provo, UT 84601, United States  
 716-684-0001





# Calibration Certificate

Certificate Number 2019003919

**Customer:**

SWCA  
Suite 1700  
20 East Thomas Road  
Phoenix, AZ 85012, United States

**Model Number** 831C  
**Serial Number** 10739  
**Test Results** Pass  
**Initial Condition** As Manufactured  
**Description** Larson Davis Model 831C  
Class 1 Sound Level Meter  
Firmware Revision: 03.3.0R3

**Procedure Number** D0001.8384  
**Technician** Ron Harris  
**Calibration Date** 29 Mar 2019  
**Calibration Due**  
**Temperature** 23.5 °C ± 0.25 °C  
**Humidity** 49.3 %RH ± 2.0 %RH  
**Static Pressure** 86.26 kPa ± 0.13 kPa

**Evaluation Method**      **Tested with:**      **Data reported in dB re 20 µPa.**

Larson Davis PRM831. S/N 058504  
PCB 377B02. S/N 311602  
Larson Davis CAL200. S/N 9079  
Larson Davis CAL291. S/N 0108

**Compliance Standards**      Compliant to Manufacturer Specifications and the following standards when combined with Calibration Certificate from procedure D0001.8378:

IEC 60651:2001 Type 1	ANSI S1.4-2014 Class 1
IEC 60804:2000 Type 1	ANSI S1.4 (R2006) Type 1
IEC 61260:2014 Class 1	ANSI S1.11-2014 Class 1
IEC 61672:2013 Class 1	ANSI S1.43 (R2007) Type 1

Issuing lab certifies that the instrument described above meets or exceeds all specifications as stated in the referenced procedure (unless otherwise noted). It has been calibrated using measurement standards traceable to the International System of Units (SI) through the National Institute of Standards and Technology (NIST), or other national measurement institutes, and meets the requirements of ISO/IEC 17025:2005.

Test points marked with a ‡ in the uncertainties column do not fall within this laboratory's scope of accreditation.

The quality system is registered to ISO 9001:2015.

This calibration is a direct comparison of the unit under test to the listed reference standards and did not involve any sampling plans to complete. No allowance has been made for the instability of the test device due to use, time, etc. Such allowances would be made by the customer as needed.

The uncertainties were computed in accordance with the ISO Guide to the Expression of Uncertainty in Measurement (GUM). A coverage factor of approximately 2 sigma (k=2) has been applied to the standard uncertainty to express the expanded uncertainty at approximately 95% confidence level.

This report may not be reproduced, except in full, unless permission for the publication of an approved abstract is obtained in writing from the organization issuing this report.

Correction data from Larson Davis SoundAdvisor Model 831C Reference Manual, I831C.01 Rev B, 2017-03-31

For 1/4" microphones, the Larson Davis ADP024 1/4" to 1/2" adaptor is used with the calibrators and the Larson Davis ADP043 1/4" to

1/2" adaptor is used with the preamplifier.

Calibration Check Frequency: 1000 Hz; Reference Sound Pressure Level: 114 dB re 20 µPa; Reference Range: 0 dB gain

Periodic tests were performed in accordance with procedures from IEC 61672-3:2013 / ANSI/ASA S1.4-2014/Part3.

No Pattern approval for IEC 61672-1:2013 / ANSI/ASA S1.4-2014/Part 1 available.

The sound level meter submitted for testing successfully completed the periodic tests of IEC 61672-3:2013 / ANSI/ASA S1.4-2014/Part 3, for the environmental conditions under which the tests were performed. However, no general statement or conclusion can be made about conformance of the sound level meter to the full specifications of IEC 61672-1:2013 / ANSI/ASA S1.4-2014/Part 1 because (a) evidence was not publicly available, from an independent testing organization responsible for pattern approvals, to demonstrate that the model of sound level meter fully conformed to the class 1 specifications in IEC 61672-1:2013 / ANSI/ASA S1.4-2014/Part 1 or correction data for acoustical test of frequency weighting were not provided in the Instruction Manual and (b) because the periodic tests of IEC 61672-3:2013 / ANSI/ASA S1.4-2014/Part 3 cover only a limited subset of the specifications in IEC 61672-1:2013 / ANSI/ASA S1.4-2014/Part 1.

**Standards Used**

Description	Cal Date	Cal Due	Cal Standard
Larson Davis CAL291 Residual Intensity Calibrator	2018-09-19	2019-09-19	001250
SRS DS360 Ultra Low Distortion Generator	2018-06-21	2019-06-21	006311
Hart Scientific 2626-H Temperature Probe	2018-08-19	2019-08-19	006798
Larson Davis CAL200 Acoustic Calibrator	2018-07-24	2019-07-24	007027
Larson Davis Model 831	2019-02-22	2020-02-22	007182
PCB 377A13 1/2 inch Prepolarized Pressure Microphone	2019-03-06	2020-03-06	007185

**Acoustic Calibration**

Measured according to IEC 61672-3:2013 10 and ANSI S1.4-2014 Part 3: 10

Measurement	Test Result [dB]	Lower Limit [dB]	Upper Limit [dB]	Expanded Uncertainty [dB]	Result
1000 Hz	114.01	113.80	114.20	0.14	Pass

**Acoustic Signal Tests, C-weighting**

Measured according to IEC 61672-3:2013 12 and ANSI S1.4-2014 Part 3: 12 using a comparison coupler with Unit Under Test (UUT) and reference SLM using slow time-weighted sound level for compliance to IEC 61672-1:2013 5.5; ANSI S1.4-2014 Part 1: 5.5

Frequency [Hz]	Test Result [dB]	Expected [dB]	Lower Limit [dB]	Upper Limit [dB]	Expanded Uncertainty [dB]	Result
125	-0.18	-0.20	-1.20	0.80	0.23	Pass
1000	0.12	0.00	-0.70	0.70	0.23	Pass
8000	-3.20	-3.00	-5.50	-1.50	0.32	Pass

-- End of measurement results--

**Self-generated Noise**

Measured according to IEC 61672-3:2013 11.1 and ANSI S1.4-2014 Part 3: 11.1

Measurement	Test Result [dB]
A-weighted, 20 dB gain	46.33

-- End of measurement results--

LARSON DAVIS - A PCB PIEZOTRONICS DIV.  
 1681 West 820 North  
 Provo, UT 84601, United States  
 716-684-0001





-- End of Report--

Signatory: Ron Harris



# Calibration Certificate

Certificate Number 2019001804

**Customer:**

SWCA  
Suite 1700  
20 East Thomas Road  
Phoenix, AZ 85012, United States

**Model Number** PRM831  
**Serial Number** 058504  
**Test Results** Pass  
**Initial Condition** As Manufactured  
**Description** Larson Davis 1/2" Preamplifier for Model 831  
Type 1

**Procedure Number** D0001.8383  
**Technician** Malinda Madsen  
**Calibration Date** 12 Feb 2019  
**Calibration Due**  
**Temperature** 23.25 °C ± 0.01 °C  
**Humidity** 49.3 %RH ± 0.5 %RH  
**Static Pressure** 86.16 kPa ± 0.03 kPa

**Evaluation Method** Tested electrically using a 12.0 pF capacitor to simulate microphone capacitance.  
Data reported in dB re 20 µPa assuming a microphone sensitivity of 50.0 mV/Pa.

**Compliance Standards** Compliant to Manufacturer Specifications

Issuing lab certifies that the instrument described above meets or exceeds all specifications as stated in the referenced procedure (unless otherwise noted). It has been calibrated using measurement standards traceable to the SI through the National Institute of Standards and Technology (NIST), or other national measurement institutes, and meets the requirements of ISO/IEC 17025:2005. **Test points marked with a ‡ in the uncertainties column do not fall within this laboratory's scope of accreditation.**

The quality system is registered to ISO 9001:2015.

This calibration is a direct comparison of the unit under test to the listed reference standards and did not involve any sampling plans to complete. No allowance has been made for the instability of the test device due to use, time, etc. Such allowances would be made by the customer as needed.

The uncertainties were computed in accordance with the ISO Guide to the Expression of Uncertainty in Measurement (GUM). A coverage factor of approximately 2 sigma (k=2) has been applied to the standard uncertainty to express the expanded uncertainty at approximately 95% confidence level.

This report may not be reproduced, except in full, unless permission for the publication of an approved abstract is obtained in writing from the organization issuing this report.

## Standards Used


Description	Cal Date	Cal Due	Cal Standard
Larson Davis Model 2900 Real Time Analyzer	02/16/2018	02/16/2019	001447
Hart Scientific 2626-H Temperature Probe	08/19/2018	08/19/2019	006798
Agilent 34401A DMM	07/11/2018	07/11/2019	007116
SRS DS360 Ultra Low Distortion Generator	03/16/2018	03/16/2019	007174

LARSON DAVIS - A PCB PIEZOTRONICS DIV.  
1681 West 820 North  
Provo, UT 84601, United States  
716-684-0001



**LARSON DAVIS**  
A PCB PIEZOTRONICS DIV.

### Frequency Response

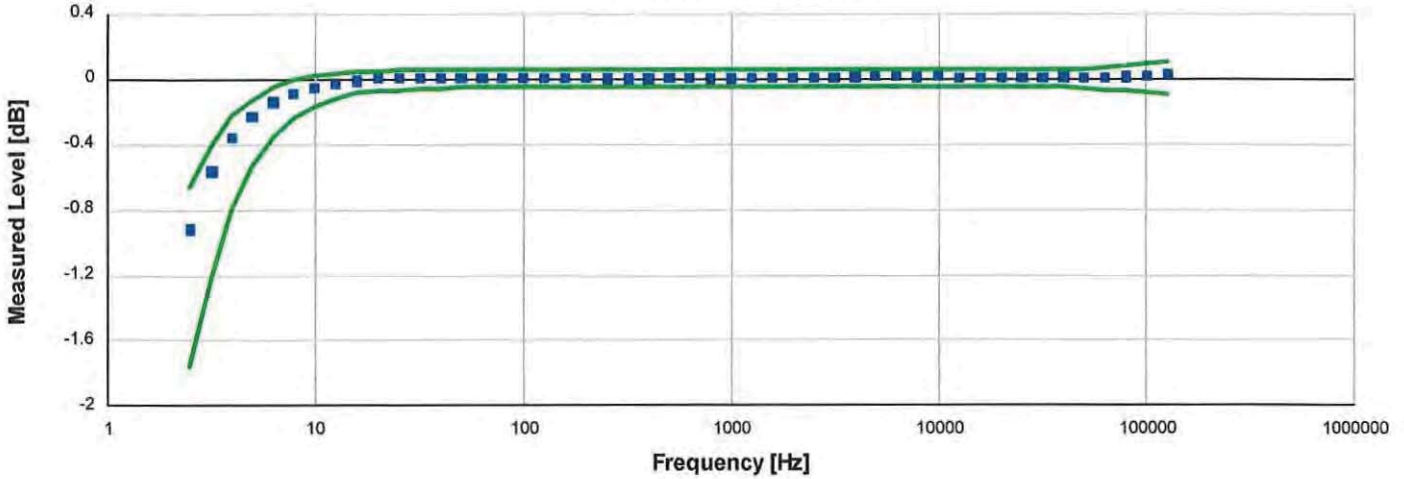

Frequency response electrically tested at 120.0 dB re 1 µV

Frequency [Hz]	Test Result [dB re 1 kHz]	Lower limit [dB]	Upper limit [dB]	Expanded Uncertainty [dB]	Result
2.50	-0.92	-1.76	-0.66	0.12	Pass
3.20	-0.57	-1.20	-0.40	0.12	Pass
4.00	-0.36	-0.81	-0.23	0.12	Pass
5.00	-0.23	-0.53	-0.13	0.12	Pass
6.30	-0.14	-0.36	-0.05	0.12	Pass
7.90	-0.09	-0.24	-0.01	0.12	Pass
10.00	-0.05	-0.17	0.03	0.12	Pass
12.60	-0.03	-0.13	0.04	0.12	Pass
15.80	-0.01	-0.09	0.04	0.12	Pass
20.00	0.00	-0.08	0.05	0.12	Pass
25.10	0.00	-0.07	0.05	0.12	Pass
31.60	0.00	-0.07	0.05	0.12	Pass
39.80	0.01	-0.06	0.05	0.12	Pass
50.10	0.01	-0.06	0.05	0.12	Pass
63.10	0.01	-0.05	0.05	0.12	Pass
79.40	0.01	-0.05	0.05	0.12	Pass
100.00	0.01	-0.05	0.05	0.12	Pass
125.90	0.00	-0.05	0.05	0.12	Pass
158.50	0.00	-0.05	0.05	0.12	Pass
199.50	0.00	-0.05	0.05	0.12	Pass
251.20	0.00	-0.05	0.05	0.12	Pass
316.20	0.00	-0.05	0.05	0.12	Pass
398.10	0.00	-0.05	0.05	0.12	Pass
501.20	0.00	-0.05	0.05	0.12	Pass
631.00	0.00	-0.05	0.05	0.12	Pass
794.30	0.00	-0.05	0.05	0.12	Pass
1,000.00	0.00	-0.05	0.05	0.12	Pass
1,258.90	0.00	-0.05	0.05	0.12	Pass
1,584.90	0.00	-0.05	0.05	0.12	Pass
1,995.30	0.01	-0.05	0.05	0.12	Pass
2,511.90	0.01	-0.05	0.05	0.12	Pass
3,162.30	0.01	-0.05	0.05	0.12	Pass

LARSON DAVIS - A PCB PIEZOTRONICS DIV.  
 1681 West 820 North  
 Provo, UT 84601, United States  
 716-684-0001





**Certificate Number 2019001804**

Frequency [Hz]	Test Result [dB re 1 kHz]	Lower limit [dB]	Upper limit [dB]	Expanded Uncertainty [dB]	Result
3,981.10	0.01	-0.05	0.05	0.12	Pass
5,011.90	0.01	-0.05	0.05	0.12	Pass
6,309.60	0.01	-0.05	0.05	0.12	Pass
7,943.30	0.01	-0.05	0.05	0.12	Pass
10,000.00	0.01	-0.05	0.05	0.12	Pass
12,589.30	0.00	-0.05	0.05	0.12	Pass
15,848.90	0.00	-0.05	0.05	0.12	Pass
19,952.60	0.00	-0.05	0.05	0.12	Pass
25,118.90	0.01	-0.05	0.05	0.12	Pass
31,622.80	0.00	-0.05	0.05	0.12	Pass
39,810.70	0.01	-0.05	0.05	0.12	Pass
50,118.70	0.00	-0.06	0.06	0.12	Pass
63,095.70	0.01	-0.07	0.07	0.12	Pass
79,432.80	0.01	-0.08	0.08	0.12	Pass
100,000.00	0.02	-0.09	0.09	0.12	Pass
125,892.50	0.03	-0.10	0.10	0.26	Pass

**Gain Measurement**

Measurement	Test Result [dB]	Lower limit [dB]	Upper limit [dB]	Expanded Uncertainty [dB]	Result
Output Gain @ 1 kHz	-0.14	-0.45	-0.03	0.12	Pass

-- End of measurement results--


**DC Bias Measurement**

Measurement	Test Result [V]	Lower limit [V]	Upper limit [V]	Expanded Uncertainty [V]	Result
DC Voltage	18.67	15.50	19.50	0.04 ‡	Pass

-- End of measurement results--



### 1/3-Octave Self-Generated Noise

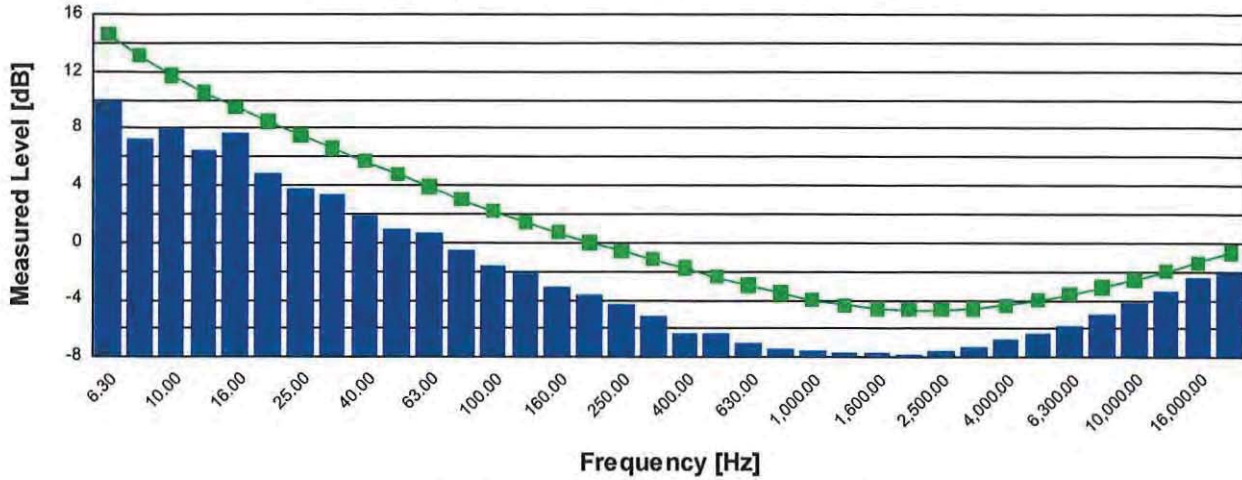

Frequency [Hz]	Test Result [dB re 1 μV]	Upper limit [dB re 1 μV]	Result
6.30	9.80	14.60	Pass
8.00	7.20	13.10	Pass
10.00	7.90	11.70	Pass
12.50	6.50	10.50	Pass
16.00	7.70	9.50	Pass
20.00	4.80	8.50	Pass
25.00	3.70	7.50	Pass
31.50	3.30	6.60	Pass
40.00	1.80	5.70	Pass
50.00	0.90	4.80	Pass
63.00	0.70	3.90	Pass
80.00	-0.60	3.00	Pass
100.00	-1.60	2.20	Pass
125.00	-2.20	1.40	Pass
160.00	-3.10	0.70	Pass
200.00	-3.70	0.00	Pass
250.00	-4.30	-0.60	Pass
315.00	-5.20	-1.20	Pass
400.00	-6.30	-1.80	Pass
500.00	-6.40	-2.40	Pass
630.00	-7.00	-3.00	Pass
800.00	-7.40	-3.50	Pass
1,000.00	-7.60	-4.00	Pass
1,250.00	-7.70	-4.40	Pass
1,600.00	-7.70	-4.60	Pass
2,000.00	-7.80	-4.70	Pass
2,500.00	-7.60	-4.70	Pass
3,150.00	-7.30	-4.60	Pass
4,000.00	-6.70	-4.40	Pass
5,000.00	-6.30	-4.00	Pass
6,300.00	-5.80	-3.60	Pass
8,000.00	-5.00	-3.10	Pass
10,000.00	-4.20	-2.60	Pass
12,500.00	-3.40	-2.00	Pass
16,000.00	-2.50	-1.40	Pass
20,000.00	-2.00	-0.70	Pass

-- End of measurement results--



### Self-generated Noise

Bandwidth	Test Result [ $\mu\text{V}$ ]	Test Result [dB re 1 $\mu\text{V}$ ]	Upper limit [dB re 1 $\mu\text{V}$ ]	Result
A-weighted (1 Hz - 20 kHz)	1.88	5.50	8.00	Pass
Broadband (1 Hz - 20 kHz)	4.12	12.30	15.50	Pass

-- End of measurement results--

Signatory: *Malinda Madsen*

LARSON DAVIS - A PCB PIEZOTRONICS DIV.  
1681 West 820 North  
Provo, UT 84601, United States  
716-684-0001





# Calibration Certificate

Certificate Number 2019003678

**Customer:**

SWCA  
Suite 1700  
20 East Thomas Road  
Phoenix, AZ 85012, United States

**Model Number** CAL200  
**Serial Number** 16651  
**Test Results** Pass  
**Initial Condition** As Manufactured  
**Description** Larson Davis CAL200 Acoustic Calibrator

**Procedure Number** D0001.8386  
**Technician** Scott Montgomery  
**Calibration Date** 25 Mar 2019  
**Calibration Due**  
**Temperature** 24 °C ± 0.3 °C  
**Humidity** 33 %RH ± 3 %RH  
**Static Pressure** 101.1 kPa ± 1 kPa

**Evaluation Method** The data is acquired by the insert voltage calibration method using the reference microphone's open circuit sensitivity. Data reported in dB re 20 µPa.

**Compliance Standards** Compliant to Manufacturer Specifications per D0001.8190 and the following standards:  
IEC 60942:2017 ANSI S1.40-2006

Issuing lab certifies that the instrument described above meets or exceeds all specifications as stated in the referenced procedure (unless otherwise noted). It has been calibrated using measurement standards traceable to the SI through the National Institute of Standards and Technology (NIST), or other national measurement institutes, and meets the requirements of ISO/IEC 17025:2005. **Test points marked with a ‡ in the uncertainties column do not fall within this laboratory's scope of accreditation.**

The quality system is registered to ISO 9001:2015.

This calibration is a direct comparison of the unit under test to the listed reference standards and did not involve any sampling plans to complete. No allowance has been made for the instability of the test device due to use, time, etc. Such allowances would be made by the customer as needed.

The uncertainties were computed in accordance with the ISO Guide to the Expression of Uncertainty in Measurement (GUM). A coverage factor of approximately 2 sigma (k=2) has been applied to the standard uncertainty to express the expanded uncertainty at approximately 95% confidence level.

This report may not be reproduced, except in full, unless permission for the publication of an approved abstract is obtained in writing from the organization issuing this report.

### Standards Used

Description	Cal Date	Cal Due	Cal Standard
Agilent 34401A DMM	09/06/2018	09/06/2019	001021
Larson Davis Model 2900 Real Time Analyzer	04/10/2018	04/10/2019	001051
Microphone Calibration System	03/04/2019	03/04/2020	005446
1/2" Preamplifier	09/20/2018	09/20/2019	006506
Larson Davis 1/2" Preamplifier 7-pin LEMO	08/07/2018	08/07/2019	006507
1/2 inch Microphone - RI - 200V	05/10/2018	05/10/2019	006510
Pressure Transducer	07/18/2018	07/18/2019	007368

LARSON DAVIS - A PCB PIEZOTRONICS DIV.  
1681 West 820 North  
Provo, UT 84601, United States  
716-684-0001



### Output Level

Nominal Level [dB]	Pressure [kPa]	Test Result [dB]	Lower limit [dB]	Upper limit [dB]	Expanded Uncertainty [dB]	Result
114	101.3	114.01	113.80	114.20	0.14	Pass
94	101.1	94.03	93.80	94.20	0.15	Pass

-- End of measurement results--

### Frequency

Nominal Level [dB]	Pressure [kPa]	Test Result [Hz]	Lower limit [Hz]	Upper limit [Hz]	Expanded Uncertainty [Hz]	Result
114	101.3	1,000.19	990.00	1,010.00	0.20	Pass
94	101.1	1,000.20	990.00	1,010.00	0.20	Pass

-- End of measurement results--

### Total Harmonic Distortion + Noise (THD+N)

Nominal Level [dB]	Pressure [kPa]	Test Result [%]	Lower limit [%]	Upper limit [%]	Expanded Uncertainty [%]	Result
114	101.3	0.37	0.00	2.00	0.25 ‡	Pass
94	101.1	0.43	0.00	2.00	0.25 ‡	Pass

-- End of measurement results--

### Level Change Over Pressure

Tested at: 114 dB, 24 °C, 29 %RH

Nominal Pressure [kPa]	Pressure [kPa]	Test Result [dB]	Lower limit [dB]	Upper limit [dB]	Expanded Uncertainty [dB]	Result
108.0	108.0	-0.01	-0.30	0.30	0.04 ‡	Pass
101.3	101.6	0.00	-0.30	0.30	0.04 ‡	Pass
92.0	91.9	0.02	-0.30	0.30	0.04 ‡	Pass
83.0	82.9	0.02	-0.30	0.30	0.04 ‡	Pass
74.0	73.9	-0.01	-0.30	0.30	0.04 ‡	Pass
65.0	65.0	-0.08	-0.30	0.30	0.04 ‡	Pass

-- End of measurement results--

### Frequency Change Over Pressure

Tested at: 114 dB, 24 °C, 29 %RH

Nominal Pressure [kPa]	Pressure [kPa]	Test Result [Hz]	Lower limit [Hz]	Upper limit [Hz]	Expanded Uncertainty [Hz]	Result
108.0	108.0	0.00	-10.00	10.00	0.20 ‡	Pass
101.3	101.6	0.00	-10.00	10.00	0.20 ‡	Pass
92.0	91.9	0.00	-10.00	10.00	0.20 ‡	Pass
83.0	82.9	0.00	-10.00	10.00	0.20 ‡	Pass
74.0	73.9	-0.01	-10.00	10.00	0.20 ‡	Pass
65.0	65.0	-0.01	-10.00	10.00	0.20 ‡	Pass

-- End of measurement results--





**Total Harmonic Distortion + Noise (THD+N) Over Pressure**

Tested at: 114 dB, 24 °C, 29 %RH

Nominal Pressure [kPa]	Pressure [kPa]	Test Result [%]	Lower limit [%]	Upper limit [%]	Expanded Uncertainty [%]	Result
108.0	108.0	0.37	0.00	2.00	0.25 ‡	Pass
101.3	101.6	0.36	0.00	2.00	0.25 ‡	Pass
92.0	91.9	0.35	0.00	2.00	0.25 ‡	Pass
83.0	82.9	0.35	0.00	2.00	0.25 ‡	Pass
74.0	73.9	0.35	0.00	2.00	0.25 ‡	Pass
65.0	65.0	0.36	0.00	2.00	0.25 ‡	Pass

-- End of measurement results--

Signatory: Scott Montgomery

LARSON DAVIS - A PCB PIEZOTRONICS DIV.  
 1681 West 820 North  
 Provo, UT 84601, United States  
 716-684-0001






## Model CAL200 Relative SPL vs. Temperature

Larson Davis Model CAL200 Serial Number: 16651

Model CAL200 Relative SPL vs. Temperature at 50% RH.

A 2559 Mic (SN: 2989) with a PRM901 Preamp (SN: 0167), station 14 was used to check the levels.

Test Date: 12 Feb 2019 4:21:02 PM

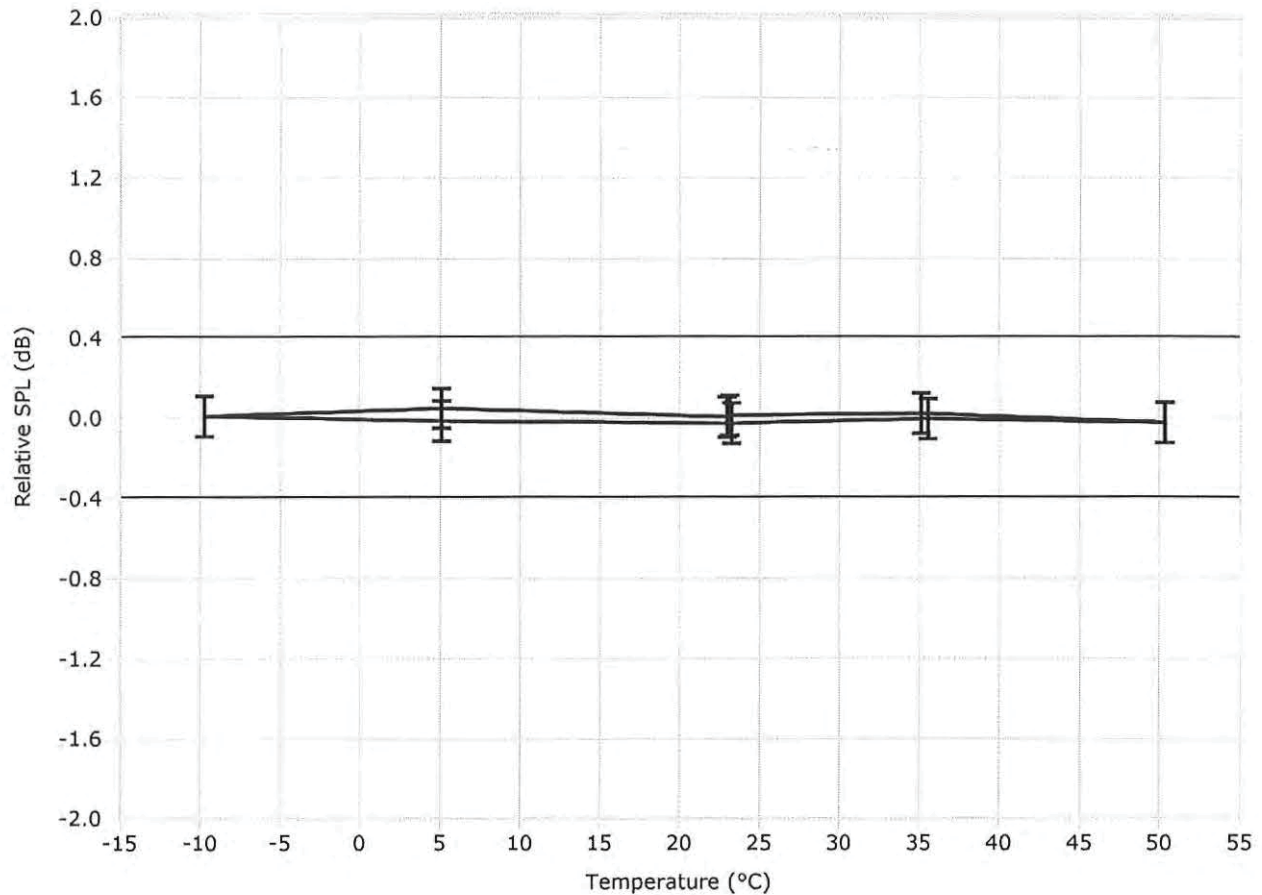

0.1dB expanded uncertainty at ~95% confidence level (k=2)

Sequence File: CAL200.SEQ

Test Location: Larson Davis, a division of PCB Piezotronics, Inc.  
1681 West 820 North, Provo, Utah 84601  
Tel: 716 684-0001 [www.LarsonDavis.com](http://www.LarsonDavis.com)




# Model CAL200 Relative Frequency vs. Temperature

Larson Davis Model CAL200 Serial Number: 16651

Model CAL200 Relative Frequency vs. Temperature at 50% RH.

A 2559 Mic (SN: 2989) with a PRM901 Preamp (SN: 0167), station 14 was used to check the levels.

Test Date: 12 Feb 2019 4:21:02 PM

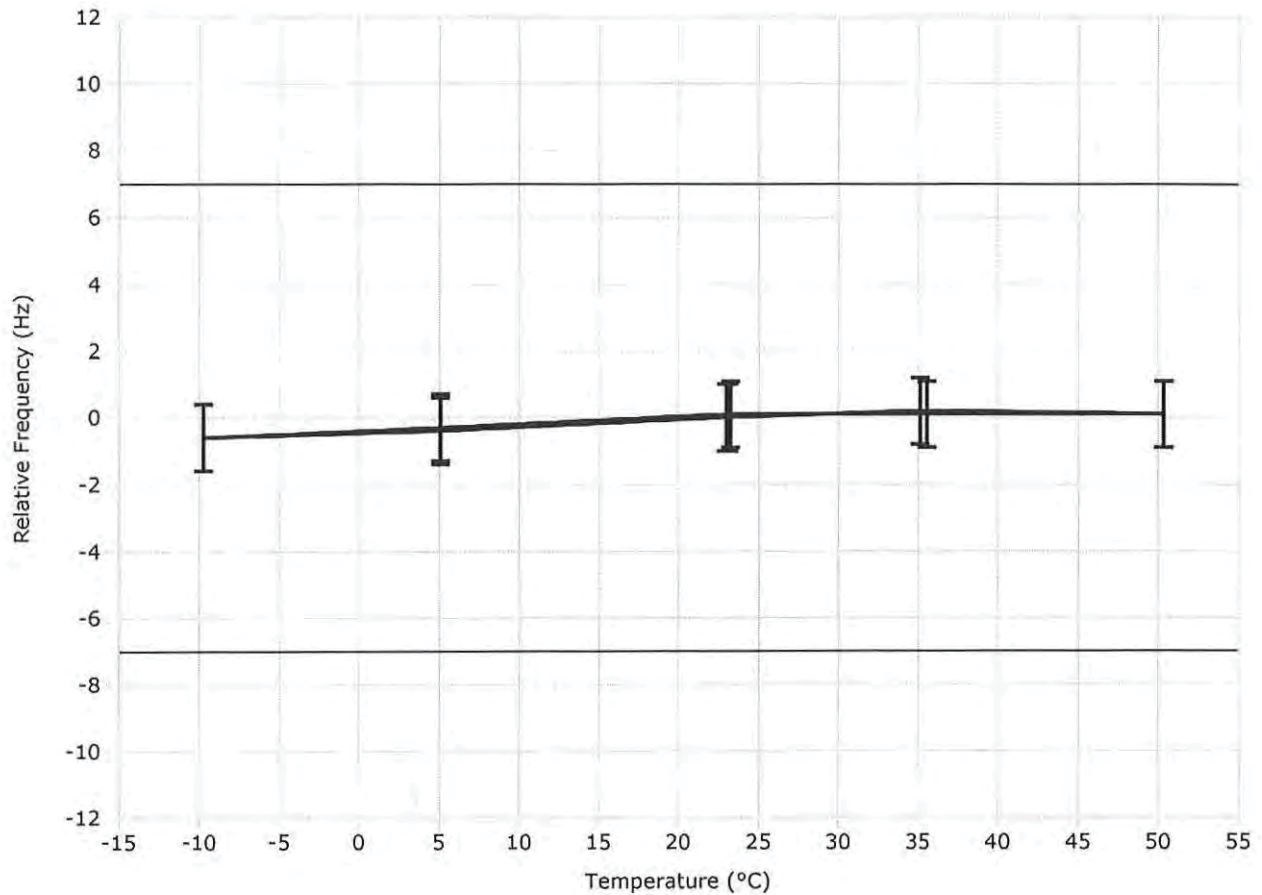

1.0 Hz expanded uncertainty at ~95% confidence level (k=2)

Sequence File: CAL200.SEQ

Test Location: Larson Davis, a division of PCB Piezotronics, Inc.  
1681 West 820 North, Provo, Utah 84601  
Tel: 716 684-0001 [www.LarsonDavis.com](http://www.LarsonDavis.com)

# Calibration Certificate

Certificate Number 2019001803

**Customer:**

SWCA  
Suite 1700  
20 East Thomas Road  
Phoenix,AZ 85012,United States

**Model Number** PRM831

**Serial Number** 058503

**Test Results** Pass

**Initial Condition** As Manufactured

**Description** Larson Davis 1/2" Preamplifier for Model 831  
Type 1

**Procedure Number** D0001.8383

**Technician** Malinda Madsen

**Calibration Date** 12 Feb 2019

**Calibration Due**

**Temperature** 23.29 °C ± 0.01 °C

**Humidity** 50.7 %RH ± 0.5 %RH

**Static Pressure** 86.17 kPa ± 0.03 kPa

**Evaluation Method** Tested electrically using a 12.0 pF capacitor to simulate microphone capacitance.  
Data reported in dB re 20 µPa assuming a microphone sensitivity of 50.0 mV/Pa.

**Compliance Standards** Compliant to Manufacturer Specifications

Issuing lab certifies that the instrument described above meets or exceeds all specifications as stated in the referenced procedure (unless otherwise noted). It has been calibrated using measurement standards traceable to the SI through the National Institute of Standards and Technology (NIST), or other national measurement institutes, and meets the requirements of ISO/IEC 17025:2005.

Test points marked with a ‡ in the uncertainties column do not fall within this laboratory's scope of accreditation.

The quality system is registered to ISO 9001:2015.

This calibration is a direct comparison of the unit under test to the listed reference standards and did not involve any sampling plans to complete. No allowance has been made for the instability of the test device due to use, time, etc. Such allowances would be made by the customer as needed.

The uncertainties were computed in accordance with the ISO Guide to the Expression of Uncertainty in Measurement (GUM). A coverage factor of approximately 2 sigma (k=2) has been applied to the standard uncertainty to express the expanded uncertainty at approximately 95% confidence level.

This report may not be reproduced, except in full, unless permission for the publication of an approved abstract is obtained in writing from the organization issuing this report.

## Standards Used

Description	Cal Date	Cal Due	Cal Standard
Larson Davis Model 2900 Real Time Analyzer	02/16/2018	02/16/2019	001447
Hart Scientific 2626-H Temperature Probe	08/19/2018	08/19/2019	006798
Agilent 34401A DMM	07/11/2018	07/11/2019	007116
SRS DS360 Ultra Low Distortion Generator	03/16/2018	03/16/2019	007174


LARSON DAVIS - A PCB PIEZOTRONICS DIV.  
1681 West 820 North  
Provo,UT 84601,United States  
716-684-0001



**LARSON DAVIS**  
A PCB PIEZOTRONICS DIV.



### Frequency Response

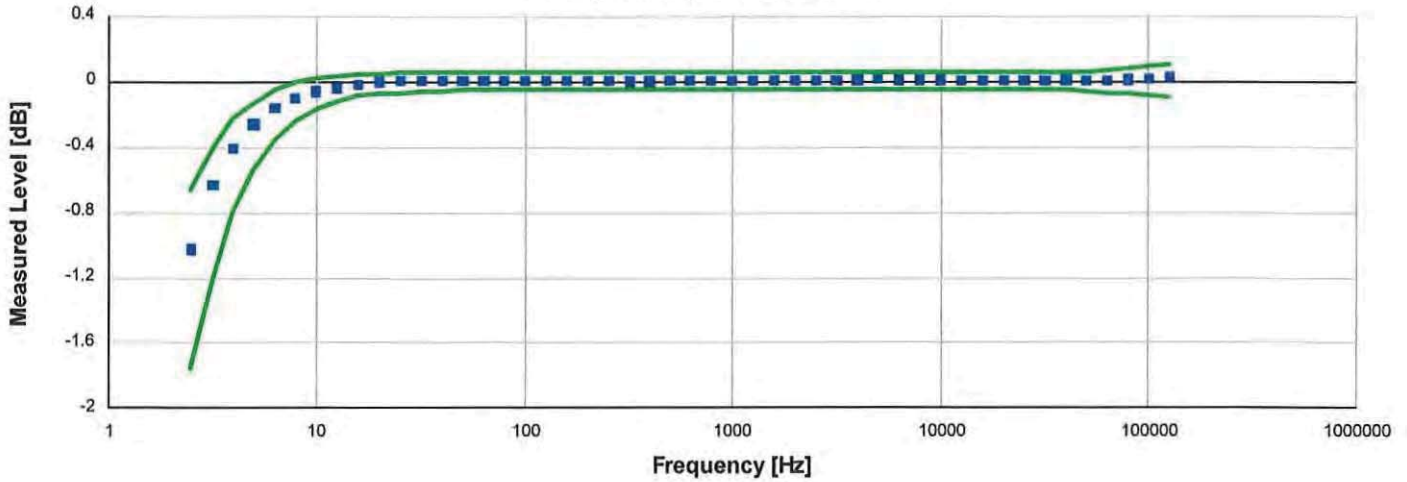

Frequency response electrically tested at 120.0 dB re 1 µV

Frequency [Hz]	Test Result [dB re 1 kHz]	Lower limit [dB]	Upper limit [dB]	Expanded Uncertainty [dB]	Result
2.50	-1.03	-1.76	-0.66	0.12	Pass
3.20	-0.64	-1.20	-0.40	0.12	Pass
4.00	-0.41	-0.81	-0.23	0.12	Pass
5.00	-0.26	-0.53	-0.13	0.12	Pass
6.30	-0.16	-0.36	-0.05	0.12	Pass
7.90	-0.10	-0.24	-0.01	0.12	Pass
10.00	-0.06	-0.17	0.03	0.12	Pass
12.60	-0.04	-0.13	0.04	0.12	Pass
15.80	-0.02	-0.09	0.04	0.12	Pass
20.00	0.00	-0.08	0.05	0.12	Pass
25.10	0.00	-0.07	0.05	0.12	Pass
31.60	0.00	-0.07	0.05	0.12	Pass
39.80	0.00	-0.06	0.05	0.12	Pass
50.10	0.01	-0.06	0.05	0.12	Pass
63.10	0.01	-0.05	0.05	0.12	Pass
79.40	0.01	-0.05	0.05	0.12	Pass
100.00	0.01	-0.05	0.05	0.12	Pass
125.90	0.00	-0.05	0.05	0.12	Pass
158.50	0.00	-0.05	0.05	0.12	Pass
199.50	0.00	-0.05	0.05	0.12	Pass
251.20	0.00	-0.05	0.05	0.12	Pass
316.20	0.00	-0.05	0.05	0.12	Pass
398.10	0.00	-0.05	0.05	0.12	Pass
501.20	0.00	-0.05	0.05	0.12	Pass
631.00	0.00	-0.05	0.05	0.12	Pass
794.30	0.00	-0.05	0.05	0.12	Pass
1,000.00	0.00	-0.05	0.05	0.12	Pass
1,258.90	0.00	-0.05	0.05	0.12	Pass
1,584.90	0.01	-0.05	0.05	0.12	Pass
1,995.30	0.01	-0.05	0.05	0.12	Pass
2,511.90	0.01	-0.05	0.05	0.12	Pass
3,162.30	0.01	-0.05	0.05	0.12	Pass

LARSON DAVIS - A PCB PIEZOTRONICS DIV.  
 1681 West 820 North  
 Provo, UT 84601, United States  
 716-684-0001



**Certificate Number 2019001803**

Frequency [Hz]	Test Result [dB re 1 kHz]	Lower limit [dB]	Upper limit [dB]	Expanded Uncertainty [dB]	Result
3,981.10	0.01	-0.05	0.05	0.12	Pass
5,011.90	0.01	-0.05	0.05	0.12	Pass
6,309.60	0.01	-0.05	0.05	0.12	Pass
7,943.30	0.01	-0.05	0.05	0.12	Pass
10,000.00	0.01	-0.05	0.05	0.12	Pass
12,589.30	0.00	-0.05	0.05	0.12	Pass
15,848.90	0.00	-0.05	0.05	0.12	Pass
19,952.60	0.00	-0.05	0.05	0.12	Pass
25,118.90	0.01	-0.05	0.05	0.12	Pass
31,622.80	0.01	-0.05	0.05	0.12	Pass
39,810.70	0.01	-0.05	0.05	0.12	Pass
50,118.70	0.00	-0.06	0.06	0.12	Pass
63,095.70	0.01	-0.07	0.07	0.12	Pass
79,432.80	0.01	-0.08	0.08	0.12	Pass
100,000.00	0.02	-0.09	0.09	0.12	Pass
125,892.50	0.03	-0.10	0.10	0.26	Pass

**Gain Measurement**

Measurement	Test Result [dB]	Lower limit [dB]	Upper limit [dB]	Expanded Uncertainty [dB]	Result
Output Gain @ 1 kHz	-0.14	-0.45	-0.03	0.12	Pass

-- End of measurement results--


**DC Bias Measurement**

Measurement	Test Result [V]	Lower limit [V]	Upper limit [V]	Expanded Uncertainty [V]	Result
DC Voltage	18.61	15.50	19.50	0.04 ‡	Pass

-- End of measurement results--



### 1/3-Octave Self-Generated Noise

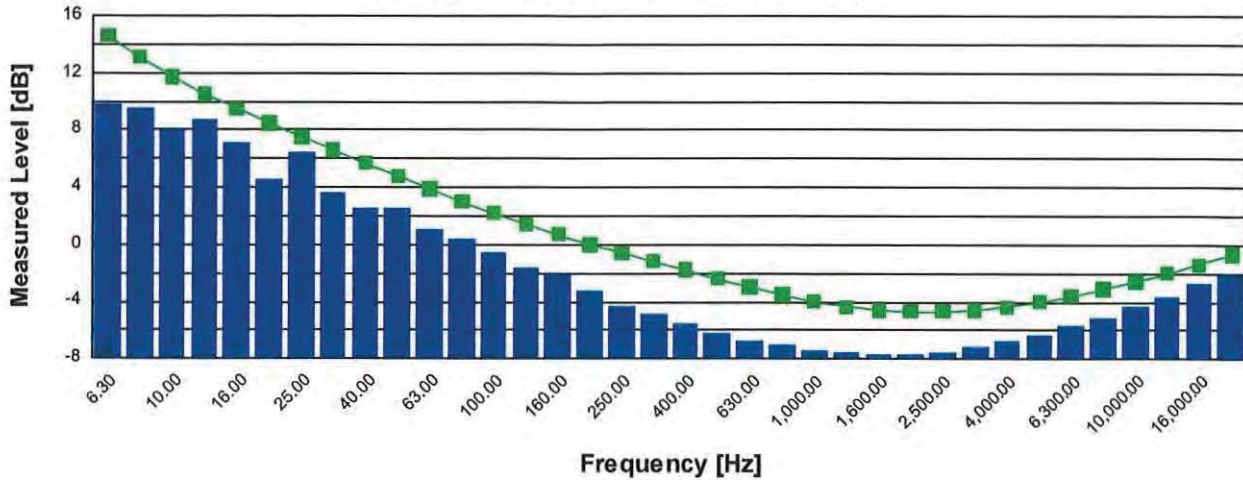

Frequency [Hz]	Test Result [dB re 1 μV]	Upper limit [dB re 1 μV]	Result
6.30	9.80	14.60	Pass
8.00	9.50	13.10	Pass
10.00	8.10	11.70	Pass
12.50	8.70	10.50	Pass
16.00	7.10	9.50	Pass
20.00	4.60	8.50	Pass
25.00	6.50	7.50	Pass
31.50	3.60	6.60	Pass
40.00	2.50	5.70	Pass
50.00	2.50	4.80	Pass
63.00	1.00	3.90	Pass
80.00	0.40	3.00	Pass
100.00	-0.60	2.20	Pass
125.00	-1.70	1.40	Pass
160.00	-2.10	0.70	Pass
200.00	-3.20	0.00	Pass
250.00	-4.40	-0.60	Pass
315.00	-4.90	-1.20	Pass
400.00	-5.60	-1.80	Pass
500.00	-6.20	-2.40	Pass
630.00	-6.70	-3.00	Pass
800.00	-7.00	-3.50	Pass
1,000.00	-7.40	-4.00	Pass
1,250.00	-7.60	-4.40	Pass
1,600.00	-7.70	-4.60	Pass
2,000.00	-7.70	-4.70	Pass
2,500.00	-7.60	-4.70	Pass
3,150.00	-7.20	-4.60	Pass
4,000.00	-6.80	-4.40	Pass
5,000.00	-6.30	-4.00	Pass
6,300.00	-5.70	-3.60	Pass
8,000.00	-5.10	-3.10	Pass
10,000.00	-4.40	-2.60	Pass
12,500.00	-3.60	-2.00	Pass
16,000.00	-2.70	-1.40	Pass
20,000.00	-2.10	-0.70	Pass

-- End of measurement results--



### Self-generated Noise

Bandwidth	Test Result [ $\mu\text{V}$ ]	Test Result [dB re 1 $\mu\text{V}$ ]	Upper limit [dB re 1 $\mu\text{V}$ ]	Result
A-weighted (1 Hz - 20 kHz)	1.91	5.60	8.00	Pass
Broadband (1 Hz - 20 kHz)	4.57	13.20	15.50	Pass
-- End of measurement results--				

Signatory: Malinda Madsen

LARSON DAVIS - A PCB PIEZOTRONICS DIV.  
1681 West 820 North  
Provo, UT 84601, United States  
716-684-0001





# Calibration Certificate

Certificate Number 2019003911

**Customer:**

SWCA  
Suite 1700  
20 East Thomas Road  
Phoenix, AZ 85012, United States

**Model Number** 831C  
**Serial Number** 10737  
**Test Results** Pass

**Initial Condition** As Manufactured

**Description** Larson Davis Model 831C  
Class 1 Sound Level Meter  
Firmware Revision: 03.3.0R3

**Procedure Number** D0001.8384  
**Technician** Ron Harris  
**Calibration Date** 29 Mar 2019  
**Calibration Due**  
**Temperature** 23.58 °C ± 0.25 °C  
**Humidity** 49.7 %RH ± 2.0 %RH  
**Static Pressure** 86.15 kPa ± 0.13 kPa

**Evaluation Method** **Tested with:** **Data reported in dB re 20 µPa.**  
Larson Davis PRM831. S/N 058503  
PCB 377B02. S/N 311601  
Larson Davis CAL200. S/N 9079  
Larson Davis CAL291. S/N 0108

**Compliance Standards** Compliant to Manufacturer Specifications and the following standards when combined with Calibration Certificate from procedure D0001.8378:

IEC 60651:2001 Type 1	ANSI S1.4-2014 Class 1
IEC 60804:2000 Type 1	ANSI S1.4 (R2006) Type 1
IEC 61260:2014 Class 1	ANSI S1.11-2014 Class 1
IEC 61672:2013 Class 1	ANSI S1.43 (R2007) Type 1

Issuing lab certifies that the instrument described above meets or exceeds all specifications as stated in the referenced procedure (unless otherwise noted). It has been calibrated using measurement standards traceable to the International System of Units (SI) through the National Institute of Standards and Technology (NIST), or other national measurement institutes, and meets the requirements of ISO/IEC 17025:2005.

Test points marked with a ‡ in the uncertainties column do not fall within this laboratory's scope of accreditation.

The quality system is registered to ISO 9001:2015.

This calibration is a direct comparison of the unit under test to the listed reference standards and did not involve any sampling plans to complete. No allowance has been made for the instability of the test device due to use, time, etc. Such allowances would be made by the customer as needed.

The uncertainties were computed in accordance with the ISO Guide to the Expression of Uncertainty in Measurement (GUM). A coverage factor of approximately 2 sigma (k=2) has been applied to the standard uncertainty to express the expanded uncertainty at approximately 95% confidence level.

This report may not be reproduced, except in full, unless permission for the publication of an approved abstract is obtained in writing from the organization issuing this report.

Correction data from Larson Davis SoundAdvisor Model 831C Reference Manual, I831C.01 Rev B, 2017-03-31

For 1/4" microphones, the Larson Davis ADP024 1/4" to 1/2" adaptor is used with the calibrators and the Larson Davis ADP043 1/4" to

LARSON DAVIS - A PCB PIEZOTRONICS DIV.  
1681 West 820 North  
Provo, UT 84601, United States  
716-684-0001



**LARSON DAVIS**  
A PCB PIEZOTRONICS DIV.

1/2" adaptor is used with the preamplifier.

Calibration Check Frequency: 1000 Hz; Reference Sound Pressure Level: 114 dB re 20 µPa; Reference Range: 0 dB gain

Periodic tests were performed in accordance with procedures from IEC 61672-3:2013 / ANSI/ASA S1.4-2014/Part3.

No Pattern approval for IEC 61672-1:2013 / ANSI/ASA S1.4-2014/Part 1 available.

The sound level meter submitted for testing successfully completed the periodic tests of IEC 61672-3:2013 / ANSI/ASA S1.4-2014/Part 3, for the environmental conditions under which the tests were performed. However, no general statement or conclusion can be made about conformance of the sound level meter to the full specifications of IEC 61672-1:2013 / ANSI/ASA S1.4-2014/Part 1 because (a) evidence was not publicly available, from an independent testing organization responsible for pattern approvals, to demonstrate that the model of sound level meter fully conformed to the class 1 specifications in IEC 61672-1:2013 / ANSI/ASA S1.4-2014/Part 1 or correction data for acoustical test of frequency weighting were not provided in the Instruction Manual and (b) because the periodic tests of IEC 61672-3:2013 / ANSI/ASA S1.4-2014/Part 3 cover only a limited subset of the specifications in IEC 61672-1:2013 / ANSI/ASA S1.4-2014/Part 1.

**Standards Used**

Description	Cal Date	Cal Due	Cal Standard
Larson Davis CAL291 Residual Intensity Calibrator	2018-09-19	2019-09-19	001250
SRS DS360 Ultra Low Distortion Generator	2018-06-21	2019-06-21	006311
Hart Scientific 2626-H Temperature Probe	2018-08-19	2019-08-19	006798
Larson Davis CAL200 Acoustic Calibrator	2018-07-24	2019-07-24	007027
Larson Davis Model 831	2019-02-22	2020-02-22	007182
PCB 377A13 1/2 inch Prepolarized Pressure Microphone	2019-03-06	2020-03-06	007185

**Acoustic Calibration**

Measured according to IEC 61672-3:2013 10 and ANSI S1.4-2014 Part 3: 10

Measurement	Test Result [dB]	Lower Limit [dB]	Upper Limit [dB]	Expanded Uncertainty [dB]	Result
1000 Hz	114.01	113.80	114.20	0.14	Pass

**Acoustic Signal Tests, C-weighting**

Measured according to IEC 61672-3:2013 12 and ANSI S1.4-2014 Part 3: 12 using a comparison coupler with Unit Under Test (UUT) and reference SLM using slow time-weighted sound level for compliance to IEC 61672-1:2013 5.5; ANSI S1.4-2014 Part 1: 5.5

Frequency [Hz]	Test Result [dB]	Expected [dB]	Lower Limit [dB]	Upper Limit [dB]	Expanded Uncertainty [dB]	Result
125	-0.21	-0.20	-1.20	0.80	0.23	Pass
1000	0.14	0.00	-0.70	0.70	0.23	Pass
8000	-2.64	-3.00	-5.50	-1.50	0.32	Pass

-- End of measurement results--

**Self-generated Noise**

Measured according to IEC 61672-3:2013 11.1 and ANSI S1.4-2014 Part 3: 11.1

Measurement	Test Result [dB]
A-weighted, 20 dB gain	45.90

-- End of measurement results--



-- End of Report--

---

Signatory: Ron Harris





# ~ Certificate of Calibration and Compliance ~

Microphone Model: 377B02

Serial Number: 311602

Manufacturer: PCB

## Calibration Environmental Conditions

Environmental test conditions as printed on microphone calibration chart.

## Reference Equipment

Manufacturer	Model #	Serial #	PCB Control #	Cal Date	Due Date
National Instruments	PCIe-6351	1896F08	CA1918	10/19/18	10/18/19
Larson Davis	PRM915	132	CA1552	11/29/18	11/29/19
Larson Davis	PRM902	4407	CA1248	5/23/18	5/23/19
Larson Davis	PRM916	125	TA469	6/26/18	6/26/19
Larson Davis	CAL250	5026	CA1278	9/19/18	9/19/19
Larson Davis	2201	115	TA472	4/12/18	4/12/19
Bruel & Kjaer	4192	2764626	CA1636	8/15/18	8/15/19
Larson Davis	GPRM902	4163	CA1089	6/12/18	6/12/19
Newport	iTHX-SD/N	1080002	CA1511	2/8/19	2/7/20
Larson Davis	PRA951-4	234	CA1154	10/24/18	10/24/19
Larson Davis	PRM915	147	CA2179	6/8/18	6/7/19
PCB	68510-02	N/A	CA2672	12/21/18	12/20/19
0	0	0	0	not required	not required
0	0	0	0	not required	not required
0	0	0	0	not required	not required

Frequency sweep performed with B&K UA0033 electrostatic actuator.

## Condition of Unit

As Found: n/a

As Left: New Unit, In Tolerance

## Notes

1. Calibration of reference equipment is traceable to one or more of the following National Labs; NIST, PTB or DFM.
2. This certificate shall not be reproduced, except in full, without written approval from PCB Piezotronics, Inc.
3. Calibration is performed in compliance with ISO 10012-1, ANSI/NCSL Z540.3 and ISO 17025.
4. See Manufacturer's Specification Sheet for a detailed listing of performance specifications.
5. Open Circuit Sensitivity is measured using the insertion voltage method following procedure AT603-5.
6. Measurement uncertainty (95% confidence level with coverage factor of 2) for sensitivity is +/-0.20 dB.
7. Unit calibrated per ACS-20.

Technician: Leonard Lukasik

Date: February 13, 2019



3425 Walden Avenue, Depew, New York, 14043

TEL: 888-684-0013

FAX: 716-685-3886

www.pcb.com

ID: CAL112-3632926196.063+0

# ~ Calibration Report ~

Microphone Model: 377B02

Serial Number: 311602

Description: 1/2" Free-Field Microphone

## Calibration Data

Open Circuit Sensitivity @ 251.2 Hz: 53.17 mV/Pa  
-25.49 dB re 1V/Pa


Polarization Voltage, External: 0 V  
Capacitance: 12.7 pF

Temperature: 69 °F (21°C)

Ambient Pressure: 977 mbar

Relative Humidity: 31 %

Frequency Response (0 dB @ 251.2 Hz)

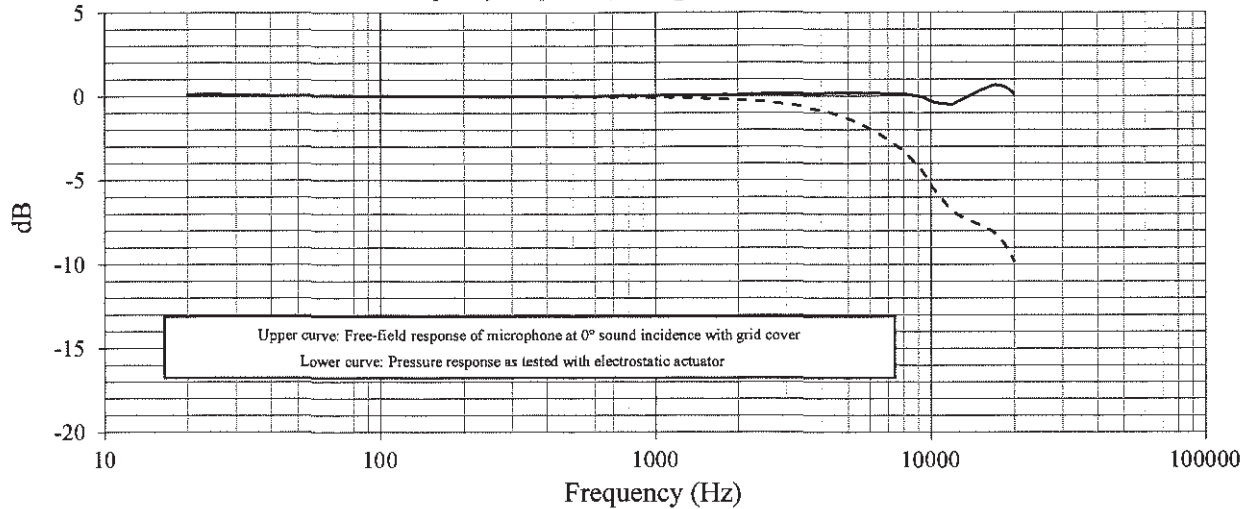

Freq (Hz)	Lower (dB)	Upper (dB)	Freq (Hz)	Lower (dB)	Upper (dB)	Freq (Hz)	Lower (dB)	Upper (dB)	Freq (Hz)	Lower (dB)	Upper (dB)
20.0	0.10	0.10	1679	-0.16	0.07	7499	-2.95	0.12	-	-	-
25.1	0.12	0.12	1778	-0.17	0.08	7943	-3.26	0.13	-	-	-
31.6	0.07	0.07	1884	-0.21	0.07	8414	-3.68	0.05	-	-	-
39.8	0.06	0.06	1995	-0.24	0.07	8913	-4.11	0.01	-	-	-
50.1	0.06	0.06	2114	-0.25	0.09	9441	-4.62	-0.10	-	-	-
63.1	0.05	0.05	2239	-0.27	0.11	10000	-5.26	-0.31	-	-	-
79.4	0.04	0.04	2371	-0.32	0.09	10593	-5.82	-0.42	-	-	-
100.0	0.03	0.03	2512	-0.33	0.13	11220	-6.31	-0.45	-	-	-
125.9	0.02	0.02	2661	-0.39	0.12	11885	-6.82	-0.50	-	-	-
158.5	0.01	0.01	2818	-0.43	0.13	12589	-7.08	-0.31	-	-	-
199.5	0.01	0.01	2985	-0.50	0.12	13335	-7.29	-0.10	-	-	-
251.2	0.00	0.00	3162	-0.54	0.14	14125	-7.48	0.11	-	-	-
316.2	-0.01	0.00	3350	-0.60	0.14	14962	-7.64	0.33	-	-	-
398.1	-0.02	-0.02	3548	-0.69	0.13	15849	-7.87	0.48	-	-	-
501.2	-0.02	0.02	3758	-0.79	0.12	16788	-8.08	0.64	-	-	-
631.0	-0.04	0.00	3981	-0.86	0.14	17783	-8.49	0.62	-	-	-
794.3	-0.05	0.04	4217	-0.95	0.16	18837	-9.03	0.48	-	-	-
1000.0	-0.08	0.05	4467	-1.07	0.17	19953	-9.81	0.12	-	-	-
1059.3	-0.07	0.06	4732	-1.19	0.18	-	-	-	-	-	-
1122.0	-0.08	0.07	5012	-1.36	0.17	-	-	-	-	-	-
1188.5	-0.09	0.06	5309	-1.52	0.18	-	-	-	-	-	-
1258.9	-0.09	0.07	5623	-1.72	0.16	-	-	-	-	-	-
1333.5	-0.13	0.06	5957	-1.91	0.16	-	-	-	-	-	-
1412.5	-0.12	0.07	6310	-2.11	0.18	-	-	-	-	-	-
1496.2	-0.15	0.05	6683	-2.39	0.13	-	-	-	-	-	-
1584.9	-0.16	0.05	7080	-2.66	0.12	-	-	-	-	-	-

Technician: Leonard Lukasik

Date: February 13, 2019



3425 Walden Avenue, Depew, New York, 14043

TEL: 888-684-0013 FAX: 716-685-3886 www.pcb.com

ID: CAL112-389292198.003-0

# ~ Certificate of Calibration and Compliance ~

Microphone Model: 377B02

Serial Number: 311601

Manufacturer: PCB

## Calibration Environmental Conditions

Environmental test conditions as printed on microphone calibration chart.

## Reference Equipment

Manufacturer	Model #	Serial #	PCB Control #	Cal Date	Due Date
National Instruments	PCIe-6351	1896F08	CA1918	10/19/18	10/18/19
Larson Davis	PRM915	132	CA1552	11/29/18	11/29/19
Larson Davis	PRM902	4407	CA1248	5/23/18	5/23/19
Larson Davis	PRM916	125	TA469	6/26/18	6/26/19
Larson Davis	CAL250	5026	CA1278	9/19/18	9/19/19
Larson Davis	2201	115	TA472	4/12/18	4/12/19
Bruel & Kjaer	4192	2764626	CA1636	8/15/18	8/15/19
Larson Davis	GPRM902	4163	CA1089	6/12/18	6/12/19
Newport	iTHX-SD/N	1080002	CA1511	2/8/19	2/7/20
Larson Davis	PRA951-4	234	CA1154	10/24/18	10/24/19
Larson Davis	PRM915	147	CA2179	6/8/18	6/7/19
PCB	68510-02	N/A	CA2672	12/21/18	12/20/19
0	0	0	0	not required	not required
0	0	0	0	not required	not required
0	0	0	0	not required	not required

Frequency sweep performed with B&K UA0033 electrostatic actuator.

## Condition of Unit

As Found: n/a

As Left: New Unit, In Tolerance

## Notes

1. Calibration of reference equipment is traceable to one or more of the following National Labs; NIST, PTB or DFM.
2. This certificate shall not be reproduced, except in full, without written approval from PCB Piezotronics, Inc.
3. Calibration is performed in compliance with ISO 10012-1, ANSI/NC SL Z540.3 and ISO 17025.
4. See Manufacturer's Specification Sheet for a detailed listing of performance specifications.
5. Open Circuit Sensitivity is measured using the insertion voltage method following procedure AT603-5.
6. Measurement uncertainty (95% confidence level with coverage factor of 2) for sensitivity is +/-0.20 dB.
7. Unit calibrated per ACS-20.

Technician: Leonard Lukasik

Date: February 13, 2019



3425 Walden Avenue, Depew, New York, 14043

TEL: 888-684-0013 FAX: 716-685-3886 www.pcb.com

ID: CAL112-3632925915.64440



# ~ Calibration Report ~

Microphone Model: 377B02

Serial Number: 311601

Description: 1/2" Free-Field Microphone

## Calibration Data

Open Circuit Sensitivity @ 251.2 Hz: 44.87 mV/Pa  
-26.96 dB re 1V/Pa


Polarization Voltage, External: 0 V  
Capacitance: 12.3 pF

Temperature: 69 °F (21°C)

Ambient Pressure: 977 mbar

Relative Humidity: 31 %

### Frequency Response (0 dB @ 251.2 Hz)

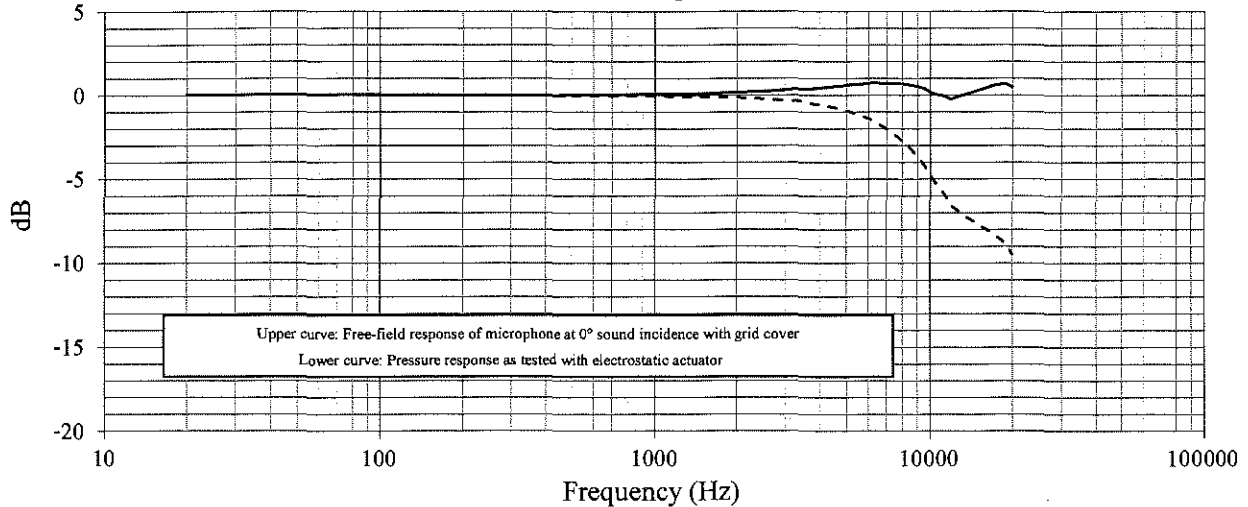

Freq (Hz)	Lower (dB)	Upper (dB)	Freq (Hz)	Lower (dB)	Upper (dB)	Freq (Hz)	Lower (dB)	Upper (dB)	Freq (Hz)	Lower (dB)	Upper (dB)
20.0	0.04	0.04	1679	-0.12	0.12	7499	-2.38	0.69	-	-	-
25.1	0.03	0.03	1778	-0.11	0.14	7943	-2.72	0.67	-	-	-
31.6	0.04	0.04	1884	-0.14	0.14	8414	-3.12	0.61	-	-	-
39.8	0.03	0.03	1995	-0.13	0.18	8913	-3.58	0.53	-	-	-
50.1	0.03	0.03	2114	-0.17	0.17	9441	-4.11	0.41	-	-	-
63.1	0.03	0.03	2239	-0.17	0.20	10000	-4.78	0.17	-	-	-
79.4	0.02	0.02	2371	-0.20	0.21	10593	-5.38	0.02	-	-	-
100.0	0.01	0.01	2512	-0.22	0.24	11220	-5.92	-0.06	-	-	-
125.9	0.01	0.01	2661	-0.26	0.25	11885	-6.54	-0.22	-	-	-
158.5	0.00	0.00	2818	-0.29	0.28	12589	-6.85	-0.08	-	-	-
199.5	0.01	0.01	2985	-0.32	0.30	13335	-7.16	0.04	-	-	-
251.2	0.00	0.00	3162	-0.34	0.34	14125	-7.43	0.17	-	-	-
316.2	-0.02	-0.01	3350	-0.37	0.37	14962	-7.68	0.29	-	-	-
398.1	-0.02	-0.02	3548	-0.44	0.38	15849	-7.94	0.41	-	-	-
501.2	-0.03	0.01	3758	-0.52	0.38	16788	-8.17	0.55	-	-	-
631.0	-0.03	0.01	3981	-0.57	0.43	17783	-8.48	0.63	-	-	-
794.3	-0.05	0.05	4217	-0.65	0.46	18837	-8.85	0.66	-	-	-
1000.0	-0.05	0.07	4467	-0.72	0.51	19953	-9.47	0.46	-	-	-
1059.3	-0.07	0.06	4732	-0.83	0.54	-	-	-	-	-	-
1122.0	-0.06	0.08	5012	-0.93	0.61	-	-	-	-	-	-
1188.5	-0.06	0.09	5309	-1.08	0.63	-	-	-	-	-	-
1258.9	-0.08	0.08	5623	-1.22	0.66	-	-	-	-	-	-
1333.5	-0.09	0.09	5957	-1.37	0.70	-	-	-	-	-	-
1412.5	-0.10	0.09	6310	-1.56	0.73	-	-	-	-	-	-
1496.2	-0.10	0.10	6683	-1.82	0.70	-	-	-	-	-	-
1584.9	-0.10	0.11	7080	-2.08	0.70	-	-	-	-	-	-

Technician: Leonard Lukasik

Date: February 13, 2019



3425 Walden Avenue, Depew, New York, 14043

TEL: 888-684-0013 FAX: 716-685-3886 www.pcb.com

ID: CAL112-363292915-644-0

**APPENDIX C**  
**Weather Data**

**Fleming Solar Project  
Baseline Noise Survey  
Weather Data**

**Station:** BLUE GRASS AIRPORT STATION - FLEMINGSBURG

**ID:** KKYFLEM15

**Start date:** 4/19/2021

**End date:** 4/21/2021

Day	Time	Temperature		Hourly Wind	Max Gust	Precipitation	Humidity	Daily max	Daily min
		F	C	mph	mph	in	%	F	F
4/19/2021	0:00	47.00	8.33	0.00	1.00	0.00	81	65.00	40.00
	1:00	46.00	7.78	1.00	1.00	0.00	84		
	2:00	44.00	6.67	0.00	0.00	0.00	86		
	3:00	43.00	6.11	0.00	0.00	0.00	89		
	4:00	42.00	5.56	0.00	0.00	0.00	91		
	5:00	40.00	4.44	0.00	0.00	0.00	93		
	6:00	41.00	5.00	0.00	0.00	0.00	92		
	7:00	43.00	6.11	1.00	2.00	0.00	89		
	8:00	46.00	7.78	1.00	2.00	0.00	88		
	9:00	50.00	10.00	2.00	2.00	0.00	82		
	10:00	56.00	13.33	3.00	3.00	0.00	72		
	11:00	59.00	15.00	2.00	3.00	0.00	65		
	12:00	61.00	16.11	2.00	3.00	0.00	59		
	13:00	62.00	16.67	3.00	4.00	0.00	54		
	14:00	64.00	17.78	3.00	5.00	0.00	51		
	15:00	64.00	17.78	3.00	4.00	0.00	50		
	16:00	65.00	18.33	4.00	6.00	0.00	46		
	17:00	65.00	18.33	5.00	6.00	0.00	44		
	18:00	64.00	17.78	4.00	6.00	0.00	43		
	19:00	61.00	16.11	3.00	4.00	0.00	49		
	20:00	57.00	13.89	1.00	1.00	0.00	58		
	21:00	53.00	11.67	1.00	1.00	0.00	64		
	22:00	52.00	11.11	1.00	1.00	0.00	67		
	23:00	51.00	10.56	1.00	1.00	0.00	68		

**Fleming Solar Project  
Baseline Noise Survey  
Weather Data**

**Station:** BLUE GRASS AIRPORT STATION - FLEMINGSBURG  
**ID:** KKYFLEM15

**Start date:** 4/19/2021      **End date:** 4/21/2021

Day	Time	Temperature		Hourly Wind	Max Gust	Precipitation	Humidity	Daily max	Daily min
		F	C	mph	mph	in	%	F	F
4/20/2021	0:00	48.00	8.89	1.00	1.00	0.00	73	68.00	39.00
	1:00	47.00	8.33	0.00	1.00	0.00	76		
	2:00	45.00	7.22	0.00	0.00	0.00	80		
	3:00	44.00	6.67	1.00	1.00	0.00	83		
	4:00	43.00	6.11	0.00	0.00	0.00	85		
	5:00	40.00	4.44	0.00	0.00	0.00	92		
	6:00	39.00	3.89	0.00	0.00	0.00	95		
	7:00	40.00	4.44	0.00	0.00	0.00	97		
	8:00	45.00	7.22	1.00	1.00	0.00	90		
	9:00	50.00	10.00	1.00	2.00	0.00	79		
	10:00	56.00	13.33	2.00	2.00	0.00	69		
	11:00	60.00	15.56	2.00	2.00	0.00	66		
	12:00	63.00	17.22	3.00	5.00	0.00	57		
	13:00	66.00	18.89	4.50	6.00	0.00	53		
	14:00	68.00	20.00	6.00	7.00	0.00	46		
	15:00	68.00	20.00	5.00	8.00	0.00	45		
	16:00	68.00	20.00	5.00	6.00	0.00	45		
	17:00	67.00	19.44	4.00	5.00	0.00	45		
	18:00	66.00	18.89	4.00	5.00	0.00	45		
	19:00	64.00	17.78	2.00	2.00	0.00	48		
	20:00	58.00	14.44	0.00	1.00	0.00	56		
	21:00	53.00	11.67	1.00	1.00	0.00	66		
	22:00	49.00	9.44	6.00	8.00	0.00	73		
	23:00	45.00	7.22	5.00	7.00	0.00	73		

**Fleming Solar Project  
Baseline Noise Survey  
Weather Data**

**Station:** BLUE GRASS AIRPORT STATION - FLEMINGSBURG  
**ID:** KKYFLEM15

**Start date:** 4/19/2021      **End date:** 4/21/2021

Day	Time	Temperature		Hourly Wind	Max Gust	Precipitation	Humidity	Daily max	Daily min
		F	C	mph	mph	in	%	F	F
4/21/2021	0:00	41.00	5.00	5.00	7.00	0.00	78	43.00	32.00
	1:00	39.00	3.89	7.00	9.00	0.00	84		
	2:00	35.00	1.67	5.00	7.00	0.00	91		
	3:00	32.00	0.00	3.00	4.00	0.00	97		
	4:00	32.00	0.00	3.00	4.00	0.00	98		
	5:00	32.00	0.00	3.00	3.00	0.00	98		
	6:00	32.00	0.00	3.00	4.00	0.00	99		
	7:00	32.00	0.00	3.00	3.00	0.00	99		
	8:00	32.00	0.00	2.00	3.00	0.00	98		
	9:00	33.00	0.56	3.00	5.00	0.00	97		
	10:00	33.00	0.56	5.00	7.00	0.00	95		
	11:00	36.00	2.22	5.00	7.00	0.00	86		
	12:00	38.00	3.33	5.00	6.00	0.00	80		
	13:00	40.00	4.44	4.00	6.00	0.00	73		
	14:00	40.00	4.44	5.00	7.00	0.00	64		
	15:00	41.00	5.00	4.00	6.00	0.00	61		
	16:00	43.00	6.11	4.00	5.00	0.00	60		
	17:00	43.00	6.11	3.00	4.00	0.00	61		
	18:00	41.00	5.00	3.00	4.00	0.00	60		
	19:00	40.00	4.44	2.00	3.00	0.00	68		
	20:00	36.00	2.22	0.00	0.00	0.00	74		
	21:00	34.00	1.11	0.00	1.00	0.00	79		
	22:00	34.00	1.11	1.00	1.00	0.00	83		
23:00	33.00	0.56	0.00	0.00	0.00	89			





**APPENDIX D**  
**Field Logs**









## Fleming Solar Project Baseline Noise Survey Monitoring Locations

**Location:** NSA 14

**Coordinates** Lat: 38.439892 **Calibrator** Model : CAL200  
 Lon: -83.770935 S/N: 16651  
 Elevation (ft): 962

**Sound Meter** Model : LD 831C **Preamplifier** Model : PRM831  
 S/N: 0011446 S/N: 29478

**Microphone** Model : 377B02  
 S/N: 326325

**Monitoring** Start Time: 4/20/2021 3:05PM **Calibrations** Pre-Test: 0.09  
 End Time: 4/20/2021 3:21PM Post-Test: -0.11

Location Description
The area is hilly with patches of scattered trees. Birds in area. Can hear trees on the other side of the road. Light wind. Light traffic.

Parameter	20-Apr								
	15:05	15:21							
Duration hh:mm	0:00	16:46							
Memory									
Battery									
Exceedance Events									
Overall Peak									
Overall Laeq		57.80							
LDN		57.80							
Day		57.80							
Night									

**Log:**

Event	Day	Time	Comment (Dominant Background Noise Source)
1	20-Apr	3:12PM	Three Cars
2	20-Apr	3:14PM	Car drove past.
3	20-Apr	3:19PM	Car drove past.

















**CASE NO. 2020-00206**

**AEUG FLEMING SOLAR, LLC**

**SUPPLEMENTAL RESPONSES TO SITING BOARD'S POST-HEARING REQUEST FOR INFORMATION**

---

9. State when a glare study can be completed and provide a copy of such study.

Original Response: AEUG Fleming anticipates that a glare study will be complete and able to be filed by May 17, 2021.

**Supplemental Response: Due to delays with AEUG Fleming's contractor that will be performing the work, the glare study will not be available for filing until June 15, 2021. AEUG Fleming will file the glare study at that time.**

Witness: Mark Randall