

**COMMONWEALTH OF KENTUCKY
BEFORE THE PUBLIC SERVICE COMMISSION**

In the Matter of:

Electronic Application Of Kentucky Power Company)	
For A Certificate of Public Convenience And)	
Necessity To Construct A 138 kV Transmission Line)	
And Associated Facilities Floyd And Knott Counties,)	Case No. 2021-00346
Kentucky (Garrett Area Improvements 138 kV)	
Transmission Project))	

Kentucky Power Company’s Motion for Approval to Modify As-Filed Centerline

Kentucky Power Company (“Kentucky Power” or the “Company”) respectfully moves the Kentucky Public Service Commission (“Commission”) pursuant to Ordering Paragraphs 3 and 8 of the Commission’s March 8, 2022 Order in this matter, to modify the as-filed centerline in 11 locations, as indicated herein. **Kentucky Power respectfully requests an order from the Commission within 14 days of the date this motion was filed, or as soon as is practicable.** In support of its motion, Kentucky Power states as follows:

Kentucky Power requests to modify the centerline, and corresponding structures, in certain locations from the as-filed locations included in its Application. Each of the requests to modify the as-filed centerline included herein are instances where the proposed modification is greater than 100 feet from either side of the as-filed centerline, in accordance with Ordering Paragraph 8 of the March 8, 2022 Order.

Exhibit 1 filed herewith is comprised of an overview of the entire Garrett Area Improvements 138kV Transmission Project.¹ Within Exhibit 1 are gray boxes that indicate on what page of Exhibit 2 a close-up view each proposed centerline modification may be found. **Exhibit 2** shows, on each page that corresponds with Exhibit 1, a close-up view of the proposed modification

¹ Exhibit 1 filed herewith corresponds to Exhibit 2 of the Application.

to the centerline and structure locations. Exhibit 2 includes preliminary structure numbers and locations, and the names of parcel owners who would be affected by the proposed modification. Kentucky Power served, on the date of this filing, a copy of this motion on all landowners affected by the proposed modification(s) as shown in **Exhibit 3**.

Below, the Company provides a description of the proposed modifications and the support for same as depicted on each page (“Sheet”) of Exhibit 2.

Sheet 1 of 11:

The Company proposes to shift the as-filed centerline due to ground constraints that were identified during detailed design. In this specific location, LIDAR survey showed the construction of a new building directly below the originally filed centerline. Shifting the proposed centerline to the Southwest 120 feet eliminates this encroachment that was unknown at time of the original filing. This proposed modification would occur entirely within existing parcel boundaries. As such, no additional/new property owners are affected by this proposed modification.

Sheet 2 of 11:

The Company proposes to shift the as-filed centerline due to ground constraints that were identified during detailed design. In this specific location, LIDAR survey representing the ground profile presented a more desirable location for structure placement. Shifting the proposed centerline to the Northwest 175 feet conforms with Kentucky Power’s means and methods for safety (steep terrain, potential for geotechnical slope failure) and constructability. This proposed modification would occur entirely within existing parcel boundaries. As such, no additional/new property owners are affected by this proposed modification.

Sheet 3 of 11:

The Company proposes to shift the as-filed centerline due to ground constraints that were identified during detailed design. In this specific location, LIDAR survey representing the ground profile presented a more desirable location for structure placement along the ridge line. Shifting the proposed centerline to the West 110 feet conforms with Kentucky Power's means and methods for safety (steep terrain, potential for geotechnical slope failure) and constructability. This proposed modification would occur entirely within existing parcel boundaries. As such, no additional/new property owners are affected by this proposed modification.

Sheet 4 of 11:

The Company proposes to shift the as-filed centerline due to ground constraints that were identified during detailed design. In this specific location, LIDAR survey representing the ground profile presented a more desirable location for structure placement along the ridge line. Shifting the proposed centerline to the Southwest 235 feet conforms with Kentucky Power's means and methods for safety (steep terrain, potential for geotechnical slope failure) and constructability. This proposed modification would occur entirely within existing parcel boundaries. As such, no additional/new property owners are affected by this proposed modification.

Sheet 5 of 11:

The Company proposes to shift the as-filed centerline due to ground constraints that were identified during detailed design. In this specific location, LIDAR survey representing the ground profile presented a more desirable location for structure placement along the ridge line. Shifting the proposed centerline to the South 140 feet conforms with Kentucky Power's means and methods for safety (steep terrain, potential for geotechnical slope failure) and constructability. This

proposed modification would occur entirely within existing parcel boundaries. As such, no additional/new property owners are affected by this proposed modification.

Sheet 6 of 11:

The Company proposes to shift the as-filed centerline due to ground constraints that were identified during detailed design. In this specific location, LIDAR survey representing the ground profile presented a more desirable location for structure placement along the ridge line. Shifting the proposed centerline to the Southeast 220 feet conforms with Kentucky Power's means and methods for safety (steep terrain, potential for geotechnical slope failure) and constructability. This proposed modification would occur entirely within existing parcel boundaries. As such, no additional/new property owners are affected by this proposed modification.

Sheet 7 of 11:

The Company proposes to shift the as-filed centerline due to ground constraints that were identified during detailed design. In this specific location, LIDAR survey representing the ground profile presented a more desirable location for structure placement along the ridge line resulting in the ability to eliminate additional structures, including a heavy full dead-end structure. Shifting the proposed centerline to the Northwest 105 feet conforms with Kentucky Power's means and methods for safety (steep terrain, potential for geotechnical slope failure) and constructability. This proposed modification would occur entirely within existing parcel boundaries. As such, no additional/new property owners are affected by this proposed modification.

Sheet 8 of 11 (cont'd from Sheet 7):

The Company proposes to shift the as-filed centerline due to ground constraints that were identified during detailed design. In this specific location, LIDAR survey representing the ground profile presented a more desirable location for structure placement along the ridge line resulting

in the ability to eliminate additional structures, including a heavy full dead-end structure. Shifting the proposed centerline to the Southeast 180 feet conforms with Kentucky Power's means and methods for safety (steep terrain, potential for geotechnical slope failure) and constructability. This proposed modification would occur entirely within existing parcel boundaries. As such, no additional/new property owners are affected by this proposed modification.

Sheet 9 of 11:

The Company proposes to shift the as-filed centerline due to ground constraints that were identified during detailed design. In this specific location, LIDAR survey representing the ground profile presented a more desirable location for structure placement along the ridge line. Shifting the proposed centerline to the West 290 feet conforms with Kentucky Power's means and methods for safety (steep terrain, potential for geotechnical slope failure) and constructability. This proposed modification would occur entirely within existing parcel boundaries. As such, no additional/new property owners are affected by this proposed modification.

Sheet 10 of 11:

The Company proposes to shift the as-filed centerline due to ground constraints that were identified during detailed design. In this specific location, LIDAR survey representing the ground profile presented a more desirable location for structure placement along the ridge line. Shifting the proposed centerline to the right 275 feet conforms with Kentucky Power's means and methods for safety (steep terrain, potential for geotechnical slope failure) and constructability. This proposed modification would occur entirely within existing parcel boundaries. As such, no additional/new property owners are affected by this proposed modification.

Sheet 11 of 11:

The Company proposes to shift the as-filed centerline due to ground constraints that were identified during detailed design. In this specific location, LIDAR survey representing the ground profile presented a more desirable location for structure placement along the ridge line, allowing for the removal of an originally proposed dead-end structure. Eliminating this structure location results in a shift of the proposed centerline 300 feet to the Northwest. This proposed modification would occur entirely within existing parcel boundaries. As such, no additional/new property owners are affected by this proposed modification.

WHEREFORE, Kentucky Power Company respectfully requests the Commission to enter an Order within 14 days of the date this motion was filed, or as soon as is practicable:

1. Granting Kentucky Power's requests to modify the location of the centerline as detailed herein and as demonstrated in Exhibit 2; and
2. Granting Kentucky Power all further relief to which it may be entitled.

Respectfully submitted,



Katie M. Glass
STITES & HARBISON PLLC
421 West Main Street
P. O. Box 634
Frankfort, Kentucky 40602-0634
Telephone: (502) 223-3477
Facsimile: (502) 779-8349
kglass@stites.com

COUNSEL FOR KENTUCKY POWER
COMPANY

EXHIBIT 1



* Shown is a preliminary design. This design is not the final route centerline or structure locations. Final line route and structure locations will be determined during final engineering, which includes ground survey and geotechnical and environmental studies. Nonetheless, the Company believes the centerline illustrated is the most suitable alignment based upon preliminary analysis.

** A 100-foot wide right-of-way will be sited within the 1000-foot Filing Corridor. The Company needs the flexibility to shift the centerline no more than 500 feet in either direction from the centerline indicated as necessary after completion of the final engineering, ground surveys and interviews with the landowners.

***The PVA parcels are not based on an accurate ground survey and should not be construed or used as exact descriptions of legal boundaries. See Exhibits 15 & 16 for list of landowners in proposed ROW and 1000-Foot Filing Corridor.


© 11/02/2021 37 - GIS/MD/CPN_FilingMap1A_2021_11_02.mxd




Garrett Area Transmission Line Project

Proposed Route: Aerial Background

Legend			
▲ Existing Substation	— Proposed Route*	▭ 1000-foot Filing Corridor**	▭ The Property Value Administrator (PVA) Parcels and Landowner Reference No.***
△ Proposed Substation	- - - Proposed 100-foot ROW**	— Existing Transmission Line	

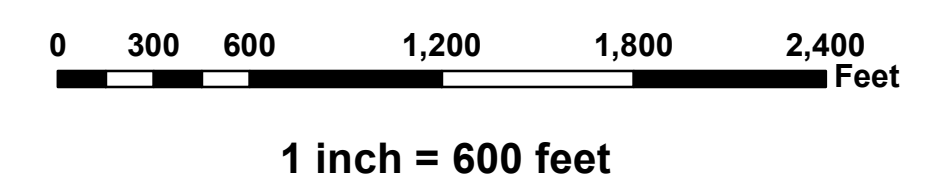

Date: 11/2/2021
Sheet: 5 of 5

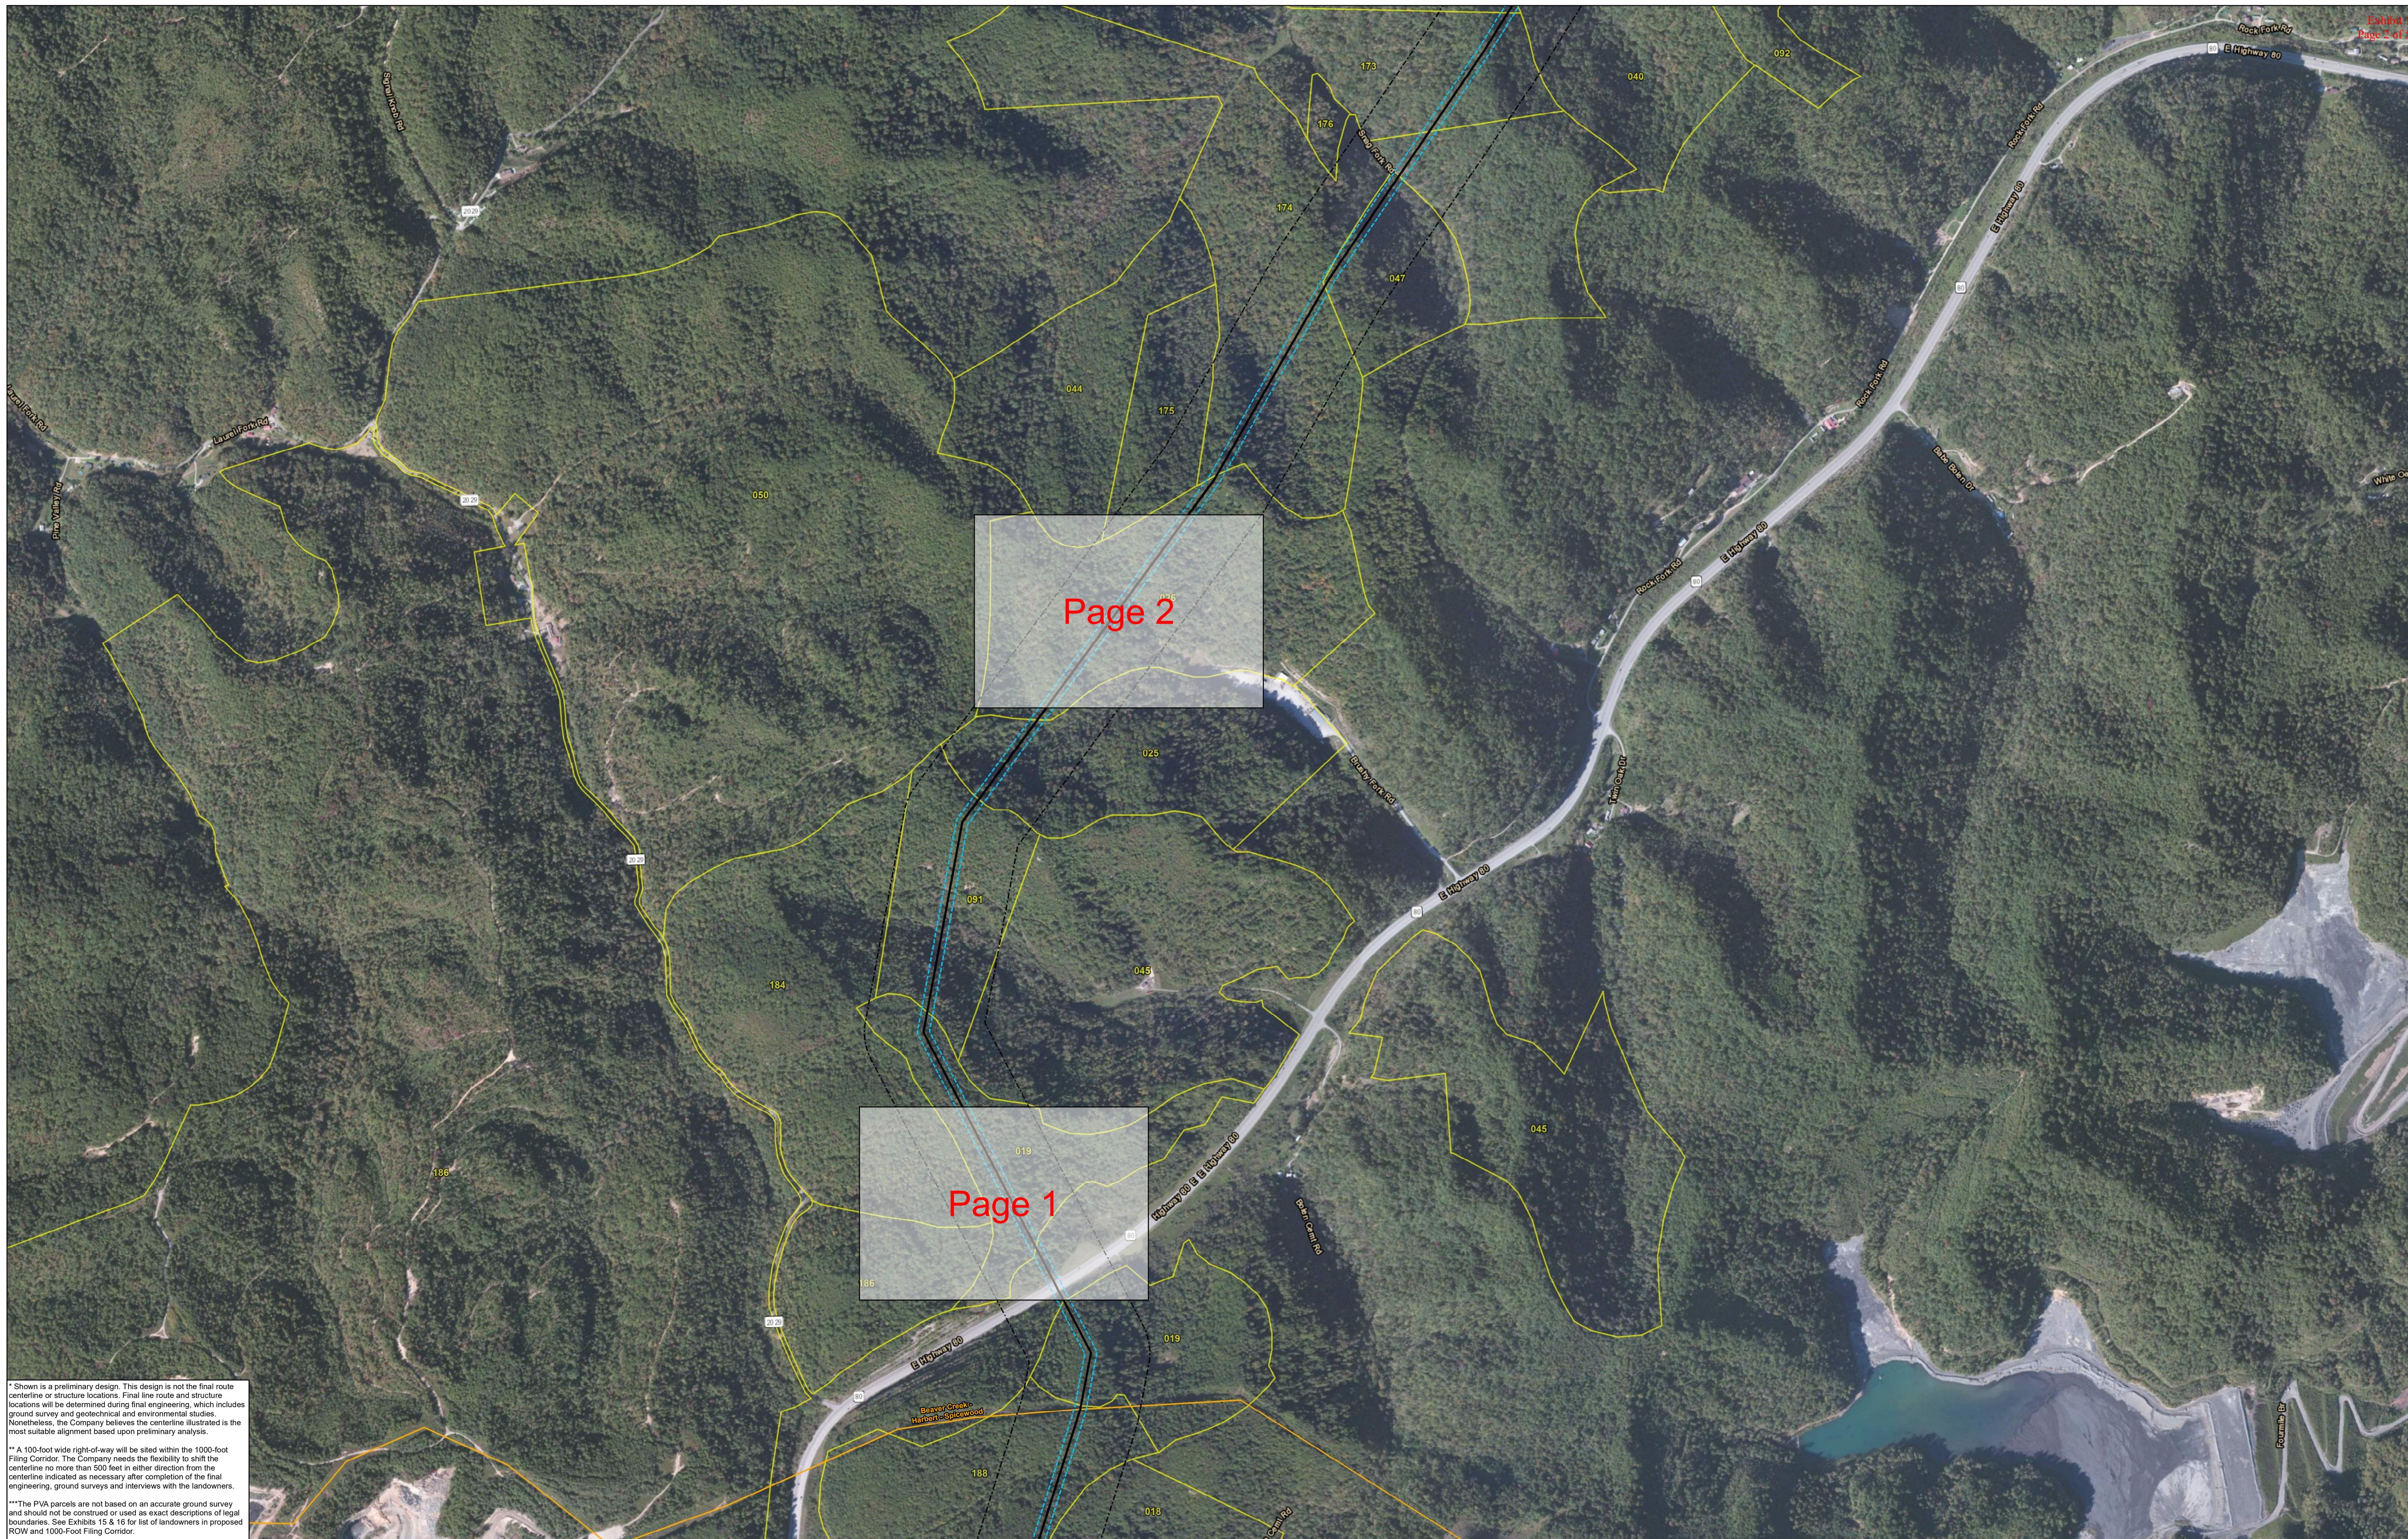

Page 2

Page 1

* Shown is a preliminary design. This design is not the final route centerline or structure locations. Final line route and structure locations will be determined during final engineering, which includes ground survey and geotechnical and environmental studies. Nonetheless, the Company believes the centerline illustrated is the most suitable alignment based upon preliminary analysis.

** A 100-foot wide right-of-way will be sited within the 1000-foot Filing Corridor. The Company needs the flexibility to shift the centerline no more than 500 feet in either direction from the centerline indicated as necessary after completion of the final engineering, ground surveys and interviews with the landowners.

***The PVA parcels are not based on an accurate ground survey and should not be construed or used as exact descriptions of legal boundaries. See Exhibits 15 & 16 for list of landowners in proposed ROW and 1000-Foot Filing Corridor.


© 190264.37 - GIS/MD/CPON_FilingMap1A_2021_11_02.mxd



Garrett Area Transmission Line Project

Proposed Route: Aerial Background

Legend			
▲ Existing Substation	— Proposed Route*	--- 1000-foot Filing Corridor**	□ The Property Value Administrator (PVA) Parcels and Landowner Reference No.***
△ Proposed Substation	- - - Proposed 100-foot ROW**	— Existing Transmission Line	

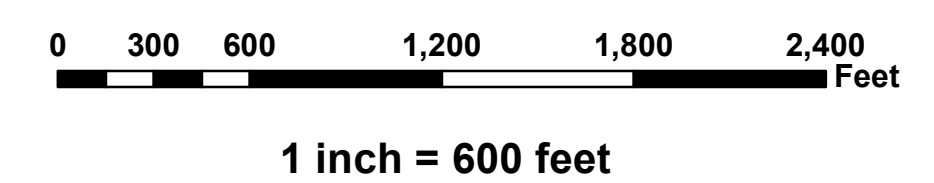

▲ North Arrow

Date: 11/2/2021

Sheet: 4 of 5



* Shown is a preliminary design. This design is not the final route centerline or structure locations. Final line route and structure locations will be determined during final engineering, which includes ground survey and geotechnical and environmental studies. Nonetheless, the Company believes the centerline illustrated is the most suitable alignment based upon preliminary analysis.

** A 100-foot wide right-of-way will be sited within the 1000-foot Filing Corridor. The Company needs the flexibility to shift the centerline no more than 500 feet in either direction from the centerline indicated as necessary after completion of the final engineering, ground surveys and interviews with the landowners.


***The PVA parcels are not based on an accurate ground survey and should not be construed or used as exact descriptions of legal boundaries. See Exhibits 15 & 16 for list of landowners in proposed ROW and 1000-Foot Filing Corridor.



Garrett Area Transmission Line Project

Proposed Route: Aerial Background

Legend			
▲ Existing Substation	— Proposed Route*	--- 1000-foot Filing Corridor**	□ The Property Value Administrator (PVA) Parcels and Landowner Reference No.***
△ Proposed Substation	- - - Proposed 100-foot ROW**	— Existing Transmission Line	

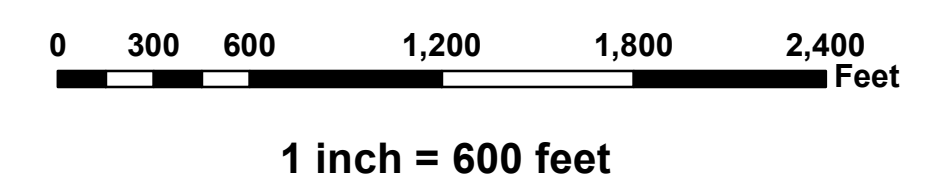



* Shown is a preliminary design. This design is not the final route centerline or structure locations. Final line route and structure locations will be determined during final engineering, which includes ground survey and geotechnical and environmental studies. Nonetheless, the Company believes the centerline illustrated is the most suitable alignment based upon preliminary analysis.

** A 100-foot wide right-of-way will be sited within the 1000-foot Filing Corridor. The Company needs the flexibility to shift the centerline no more than 500 feet in either direction from the centerline indicated as necessary after completion of the final engineering, ground surveys and interviews with the landowners.


***The PVA parcels are not based on an accurate ground survey and should not be construed or used as exact descriptions of legal boundaries. See Exhibits 15 & 16 for list of landowners in proposed ROW and 1000-Foot Filing Corridor.



Garrett Area Transmission Line Project

Proposed Route: Aerial Background

Legend			
▲ Existing Substation	— Proposed Route*	--- 1000-foot Filing Corridor**	▭ The Property Value Administrator (PVA) Parcels and Landowner Reference No.***
△ Proposed Substation	- - - Proposed 100-foot ROW**	— Existing Transmission Line	

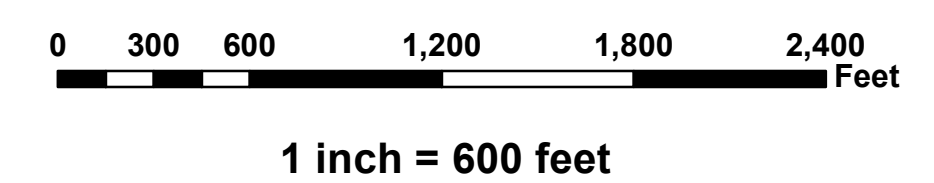



* Shown is a preliminary design. This design is not the final route centerline or structure locations. Final line route and structure locations will be determined during final engineering, which includes ground survey and geotechnical and environmental studies. Nonetheless, the Company believes the centerline illustrated is the most suitable alignment based upon preliminary analysis.

** A 100-foot wide right-of-way will be sited within the 1000-foot Filing Corridor. The Company needs the flexibility to shift the centerline no more than 500 feet in either direction from the centerline indicated as necessary after completion of the final engineering, ground surveys and interviews with the landowners.

***The PVA parcels are not based on an accurate ground survey and should not be construed or used as exact descriptions of legal boundaries. See Exhibits 15 & 16 for list of landowners in proposed ROW and 1000-Foot Filing Corridor.



Garrett Area Transmission Line Project

Proposed Route: Aerial Background

Legend			
▲ Existing Substation	— Proposed Route*	--- 1000-foot Filing Corridor**	▭ The Property Value Administrator (PVA) Parcels and Landowner Reference No.***
△ Proposed Substation	- - - Proposed 100-foot ROW**	— Existing Transmission Line	









EXHIBIT 2

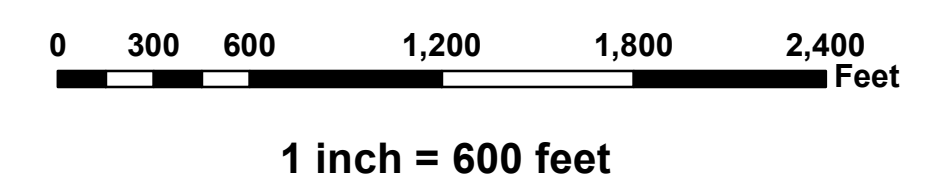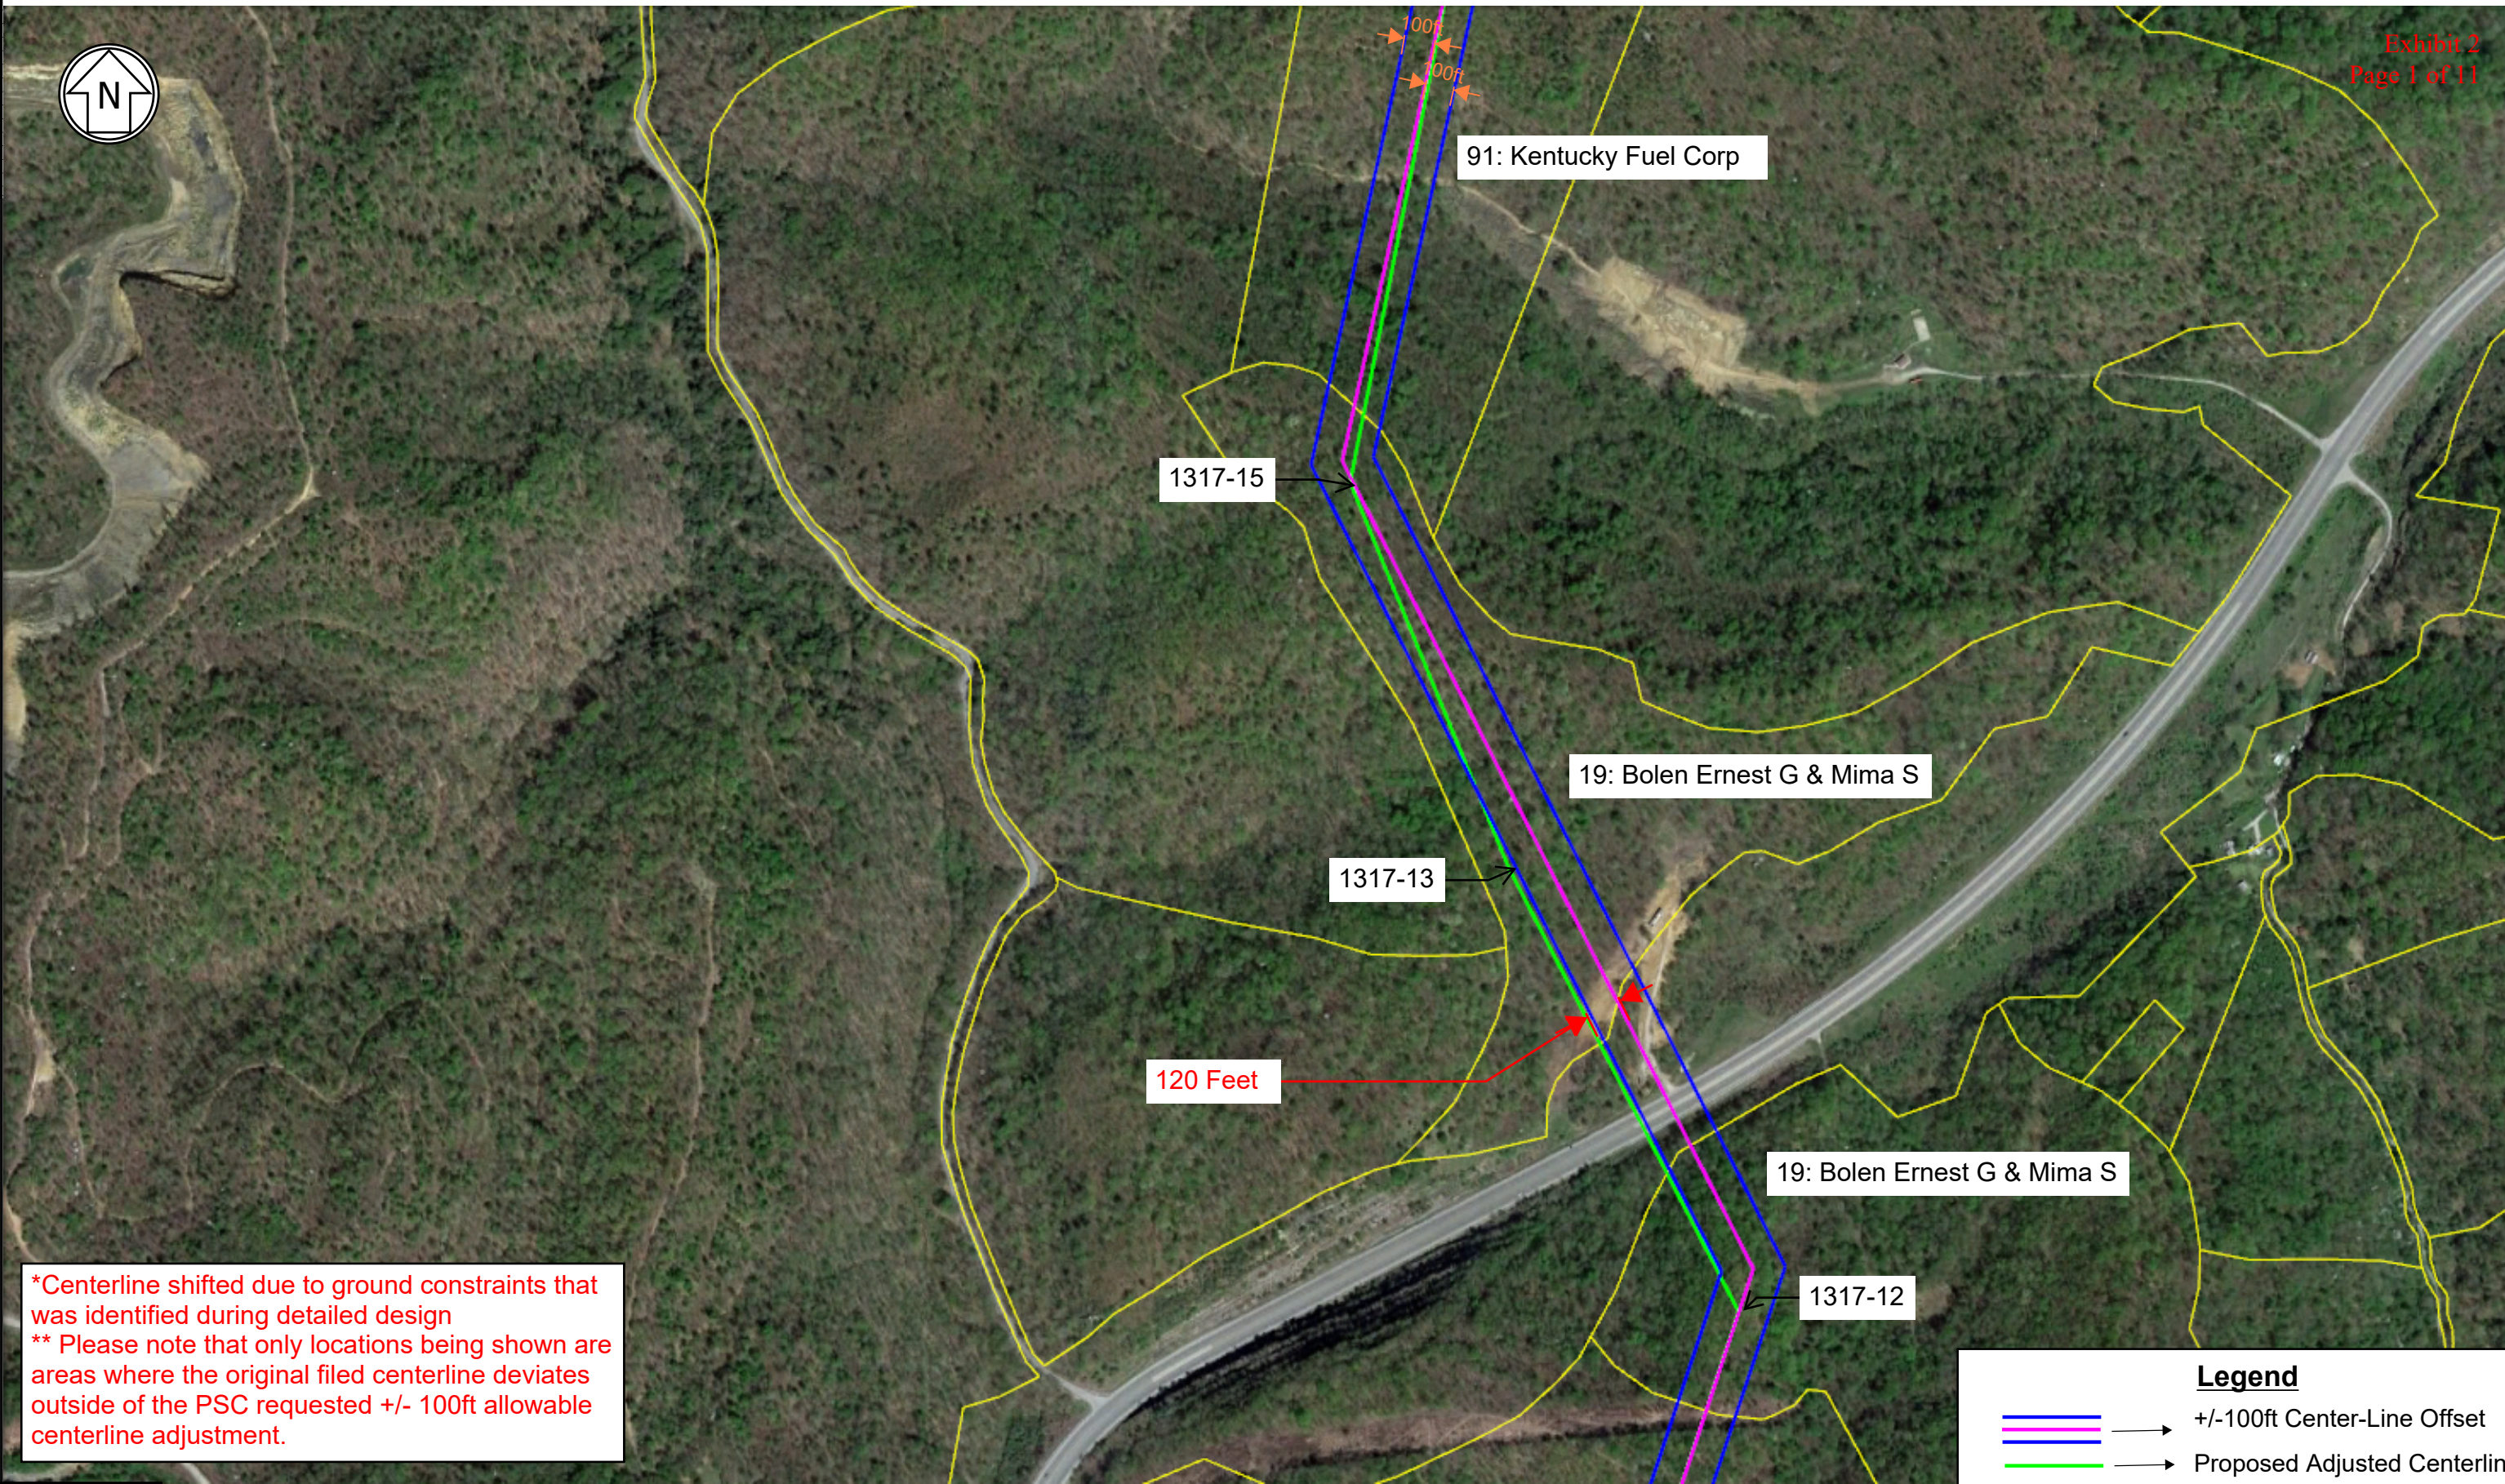


*Centerline shifted due to ground constraints that was identified during detailed design
** Please note that only locations being shown are areas where the original filed centerline deviates outside of the PSC requested +/- 100ft allowable centerline adjustment.

Legend




-  +/-100ft Center-Line Offset
-  Proposed Adjusted Centerline
-  Garrett Area Parcels

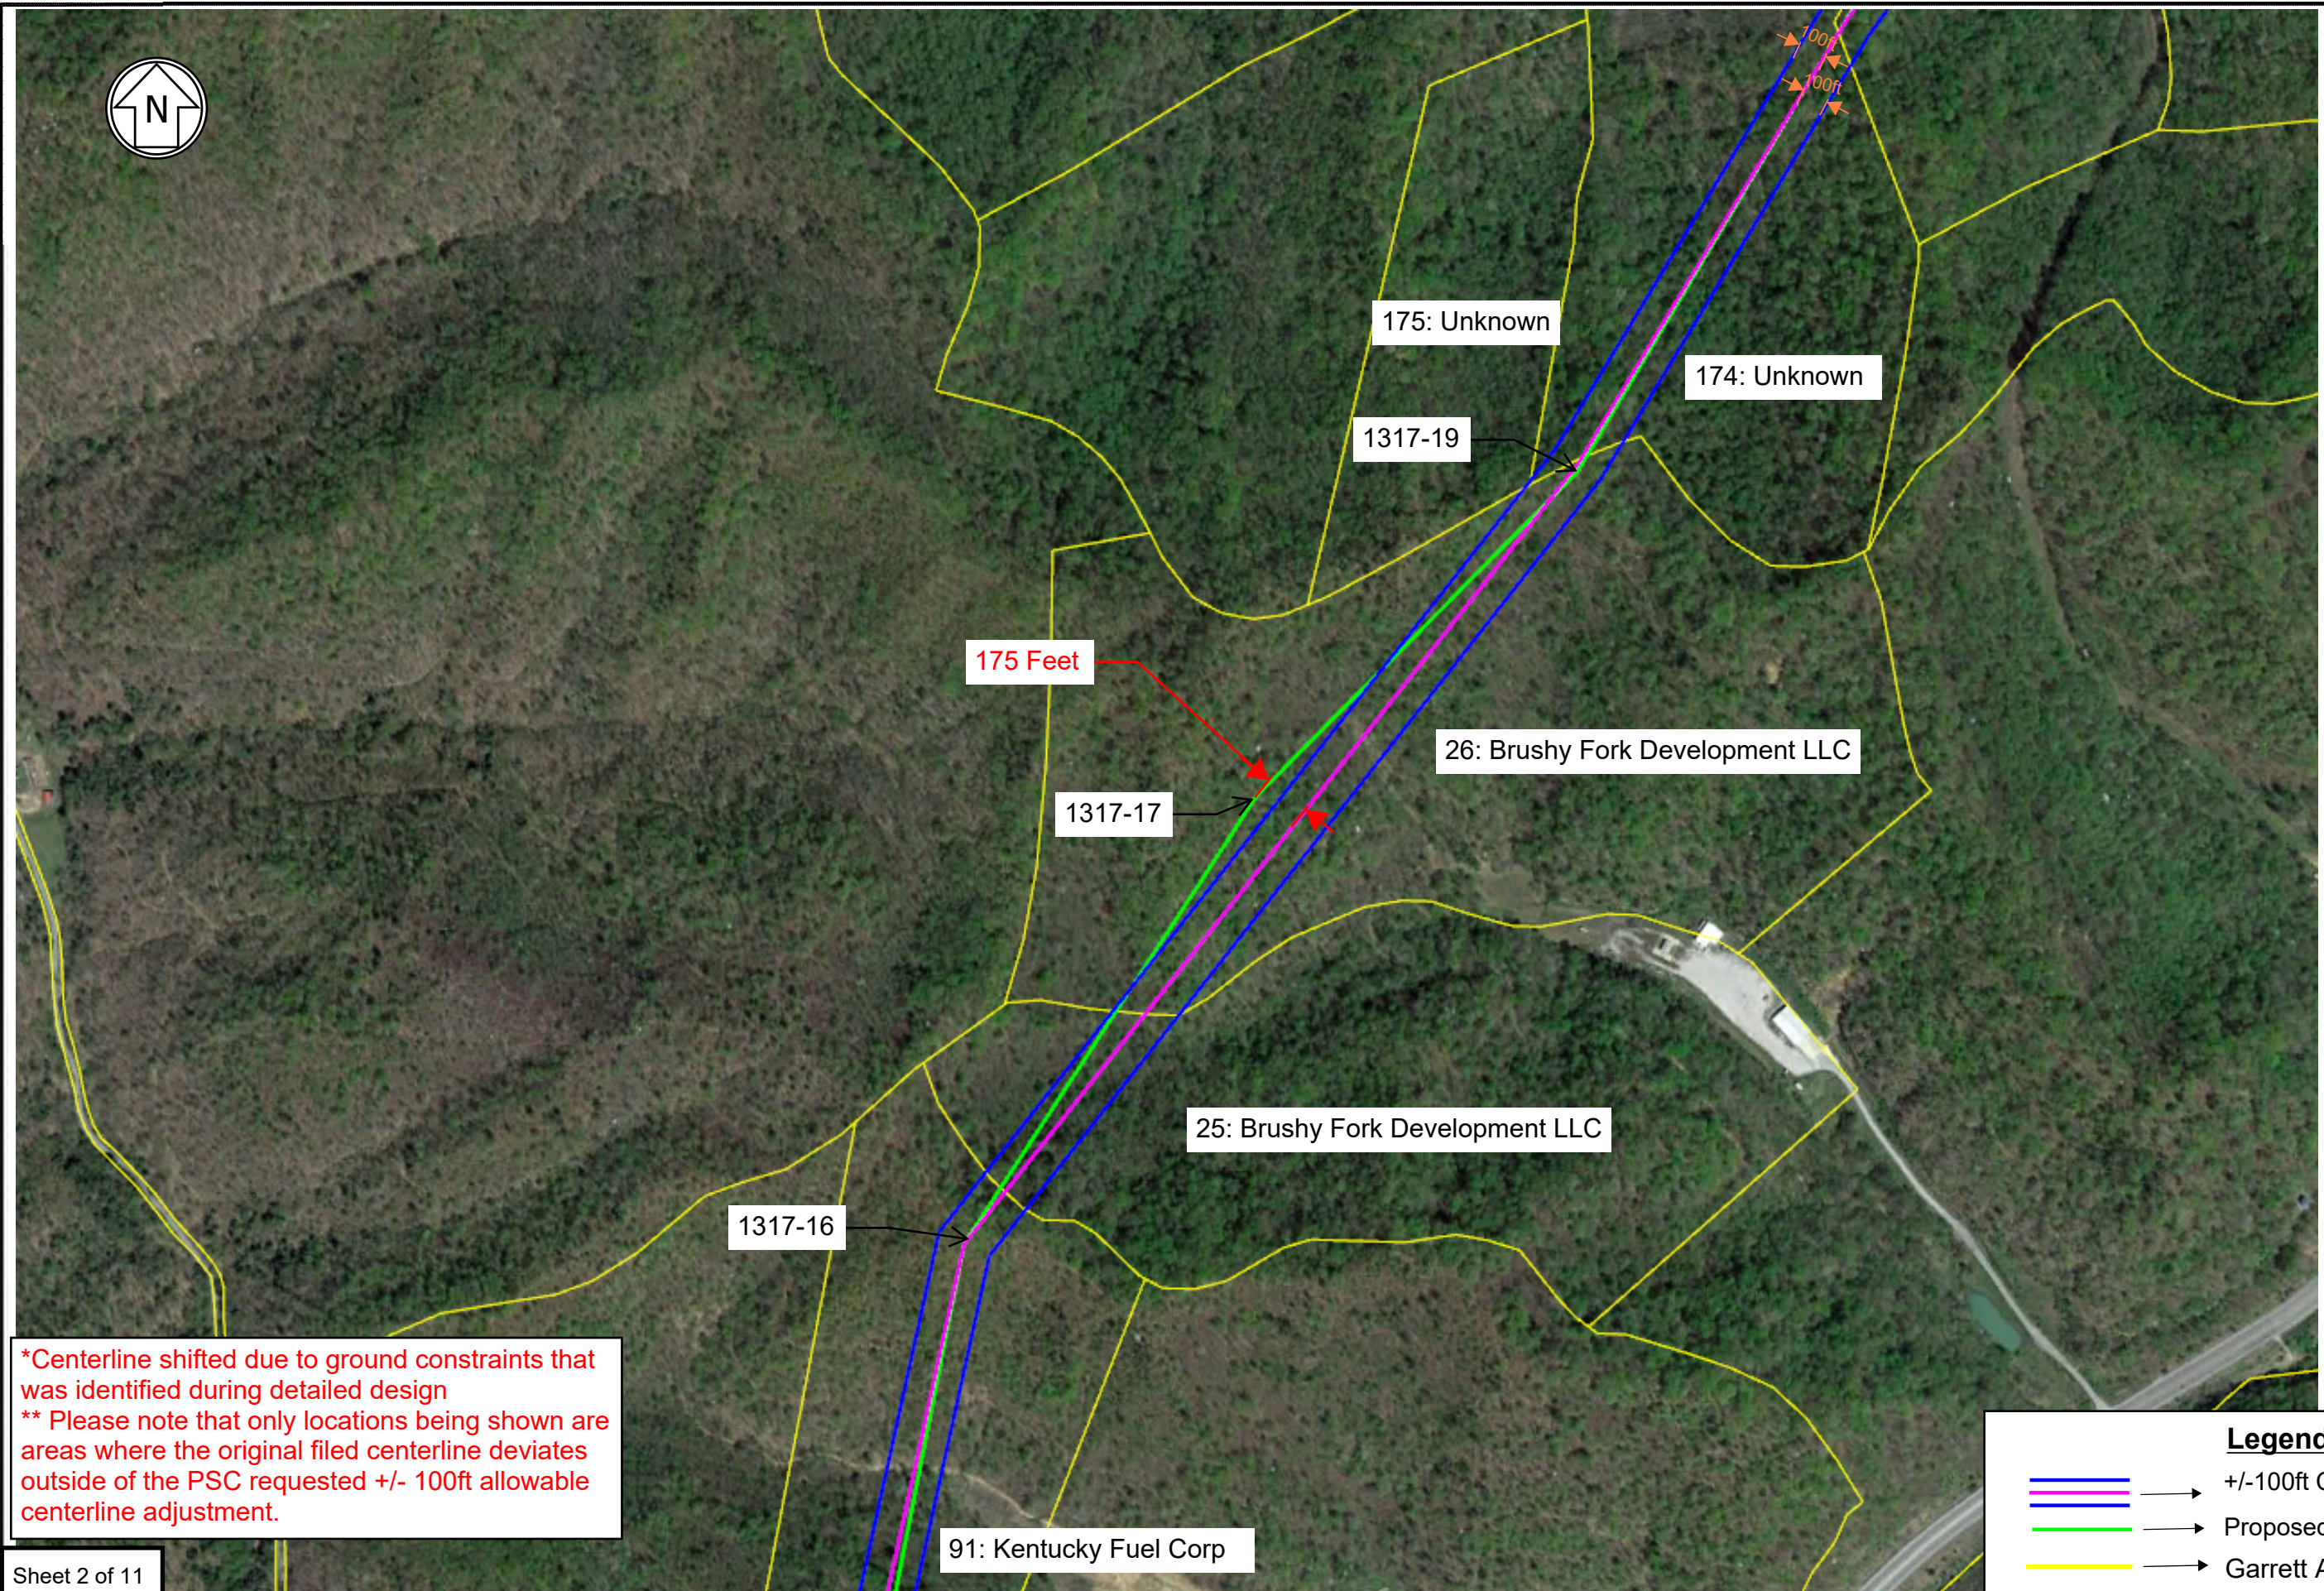




*Centerline shifted due to ground constraints that was identified during detailed design
 ** Please note that only locations being shown are areas where the original filed centerline deviates outside of the PSC requested +/- 100ft allowable centerline adjustment.

Legend

-  +/-100ft Center-Line Offset
-  Proposed Adjusted Centerline
-  Garrett Area Parcels

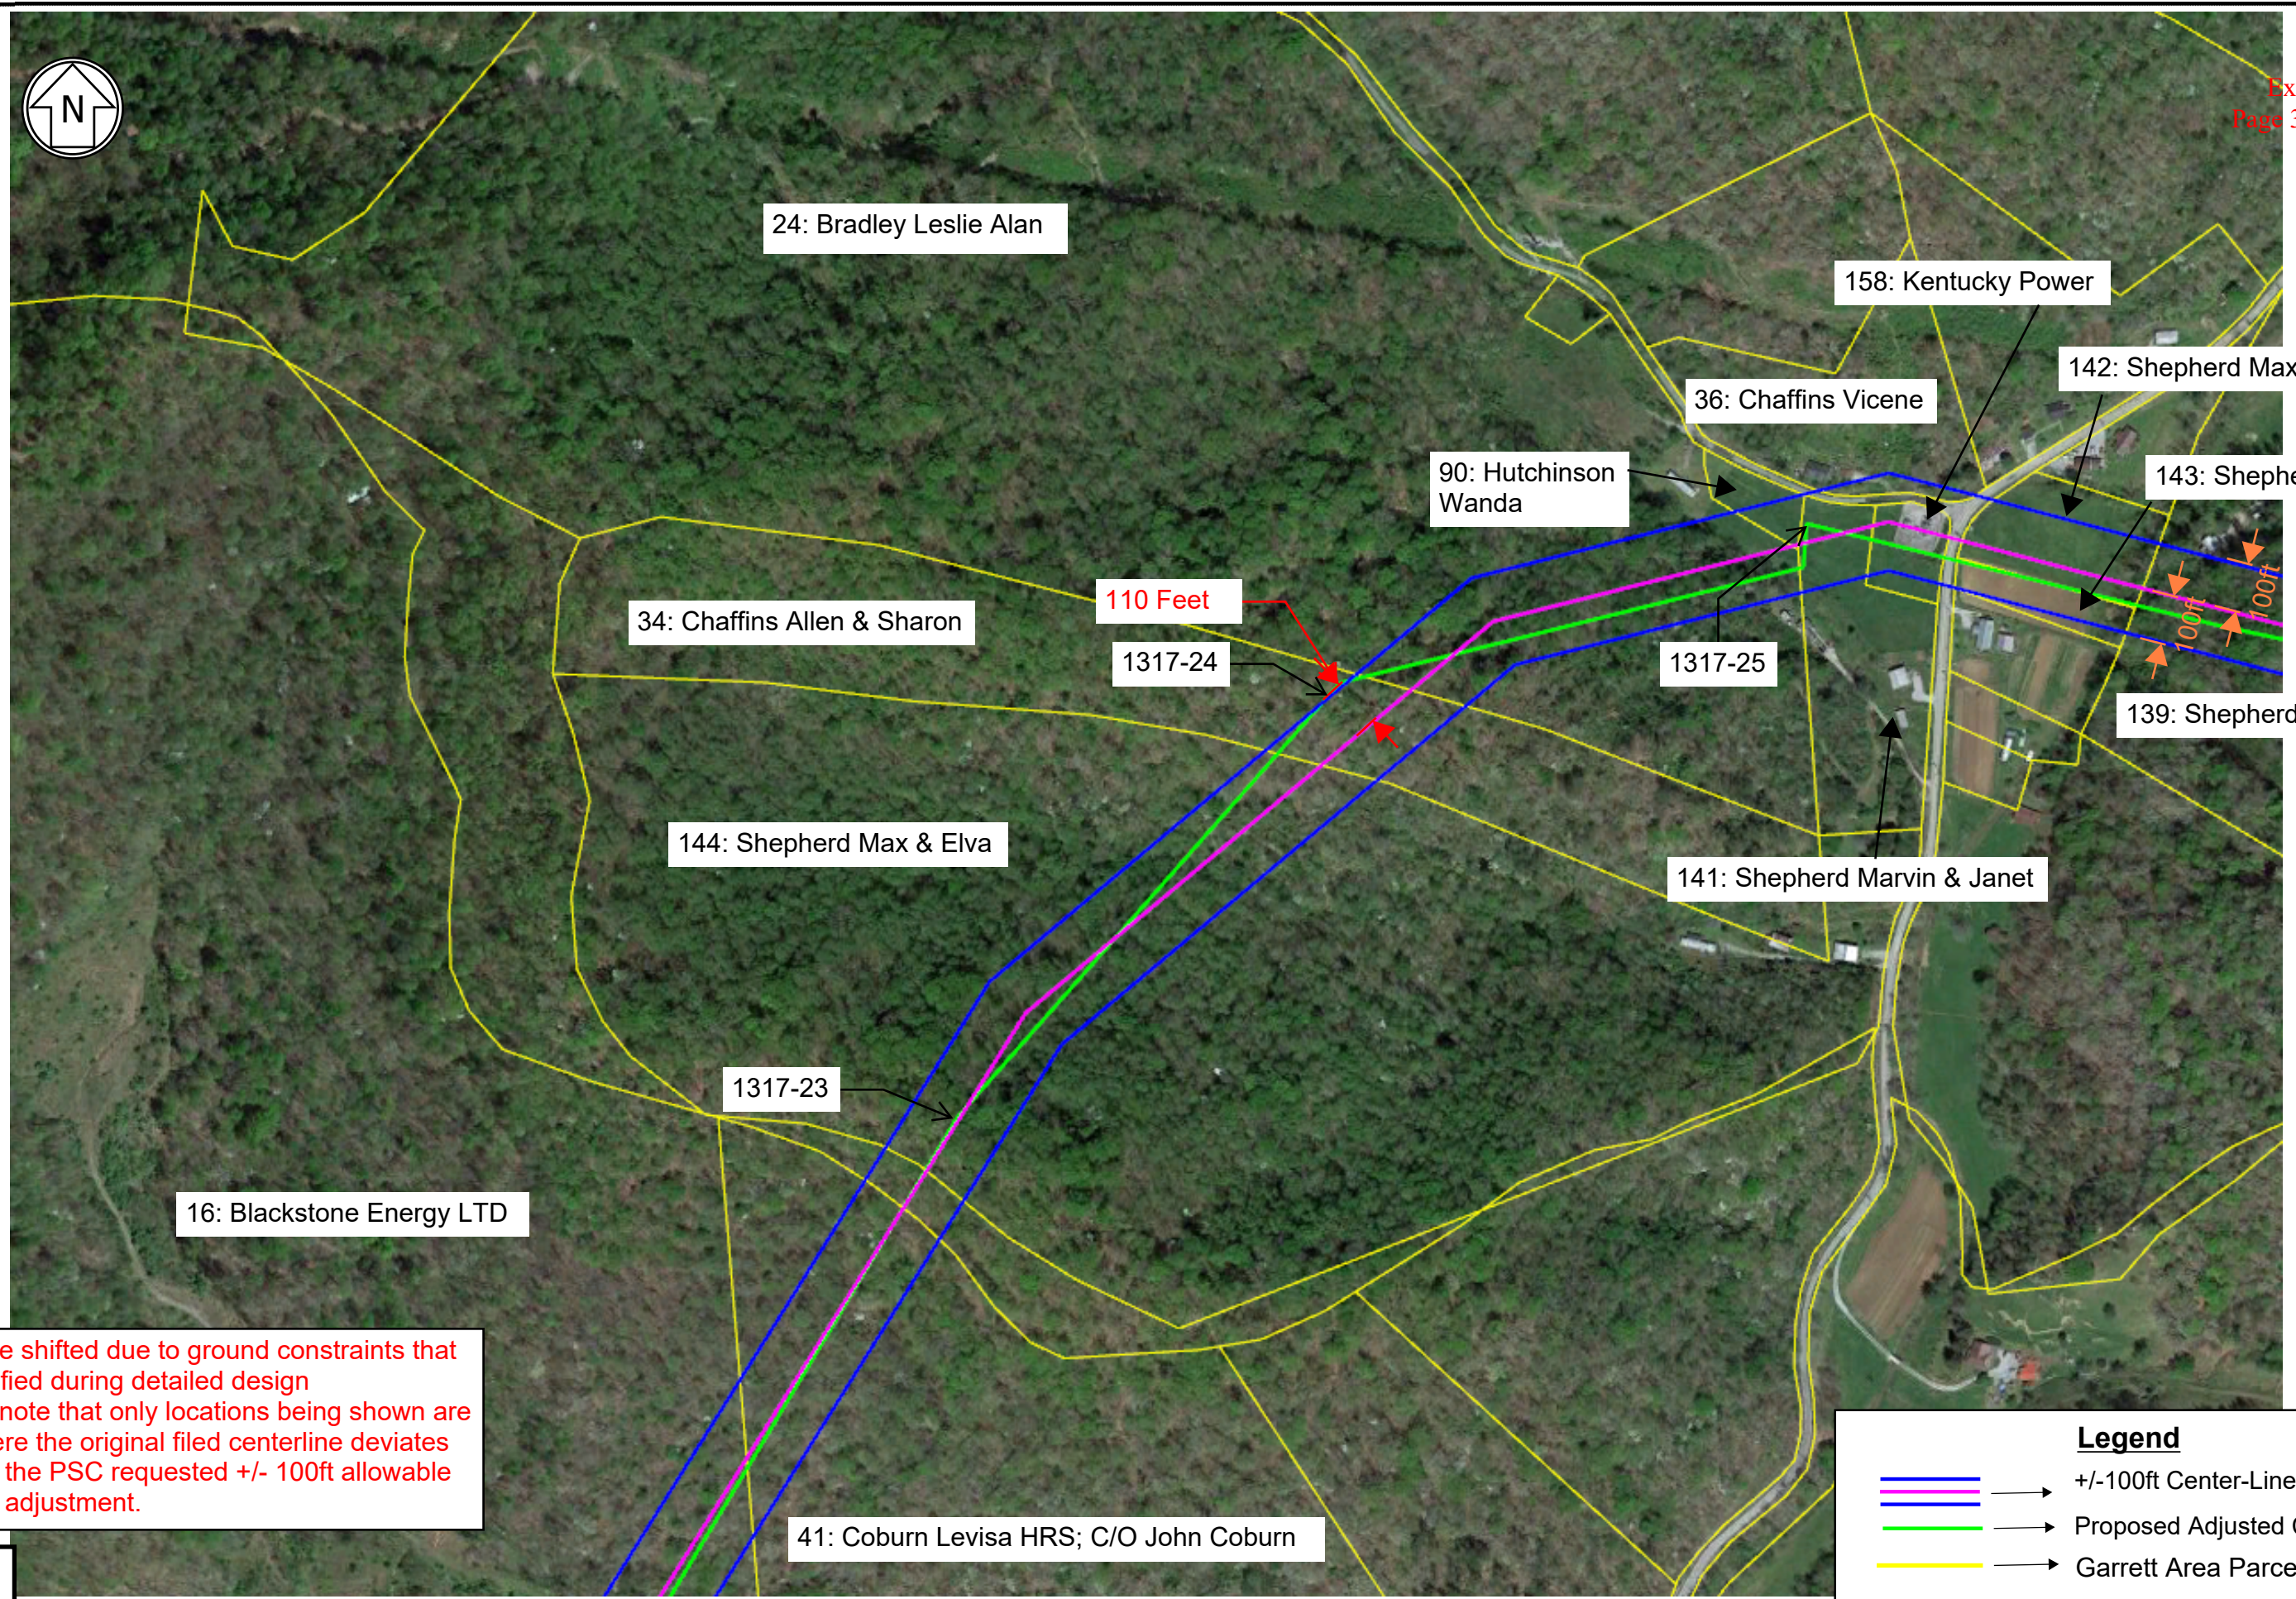

24: Bradley Leslie Alan

158: Kentucky Power

142: Shepherd Max

36: Chaffins Vicene

143: Shepherd Max

90: Hutchinson Wanda

34: Chaffins Allen & Sharon

110 Feet

1317-24

1317-25

139: Shepherd Faye

144: Shepherd Max & Elva

141: Shepherd Marvin & Janet

16: Blackstone Energy LTD

1317-23


41: Coburn Levisa HRS; C/O John Coburn

*Centerline shifted due to ground constraints that was identified during detailed design
** Please note that only locations being shown are areas where the original filed centerline deviates outside of the PSC requested +/- 100ft allowable centerline adjustment.

Legend

- +/-100ft Center-Line Offset
- +/-100ft Center-Line Offset
- Proposed Adjusted Centerline
- Garrett Area Parcels



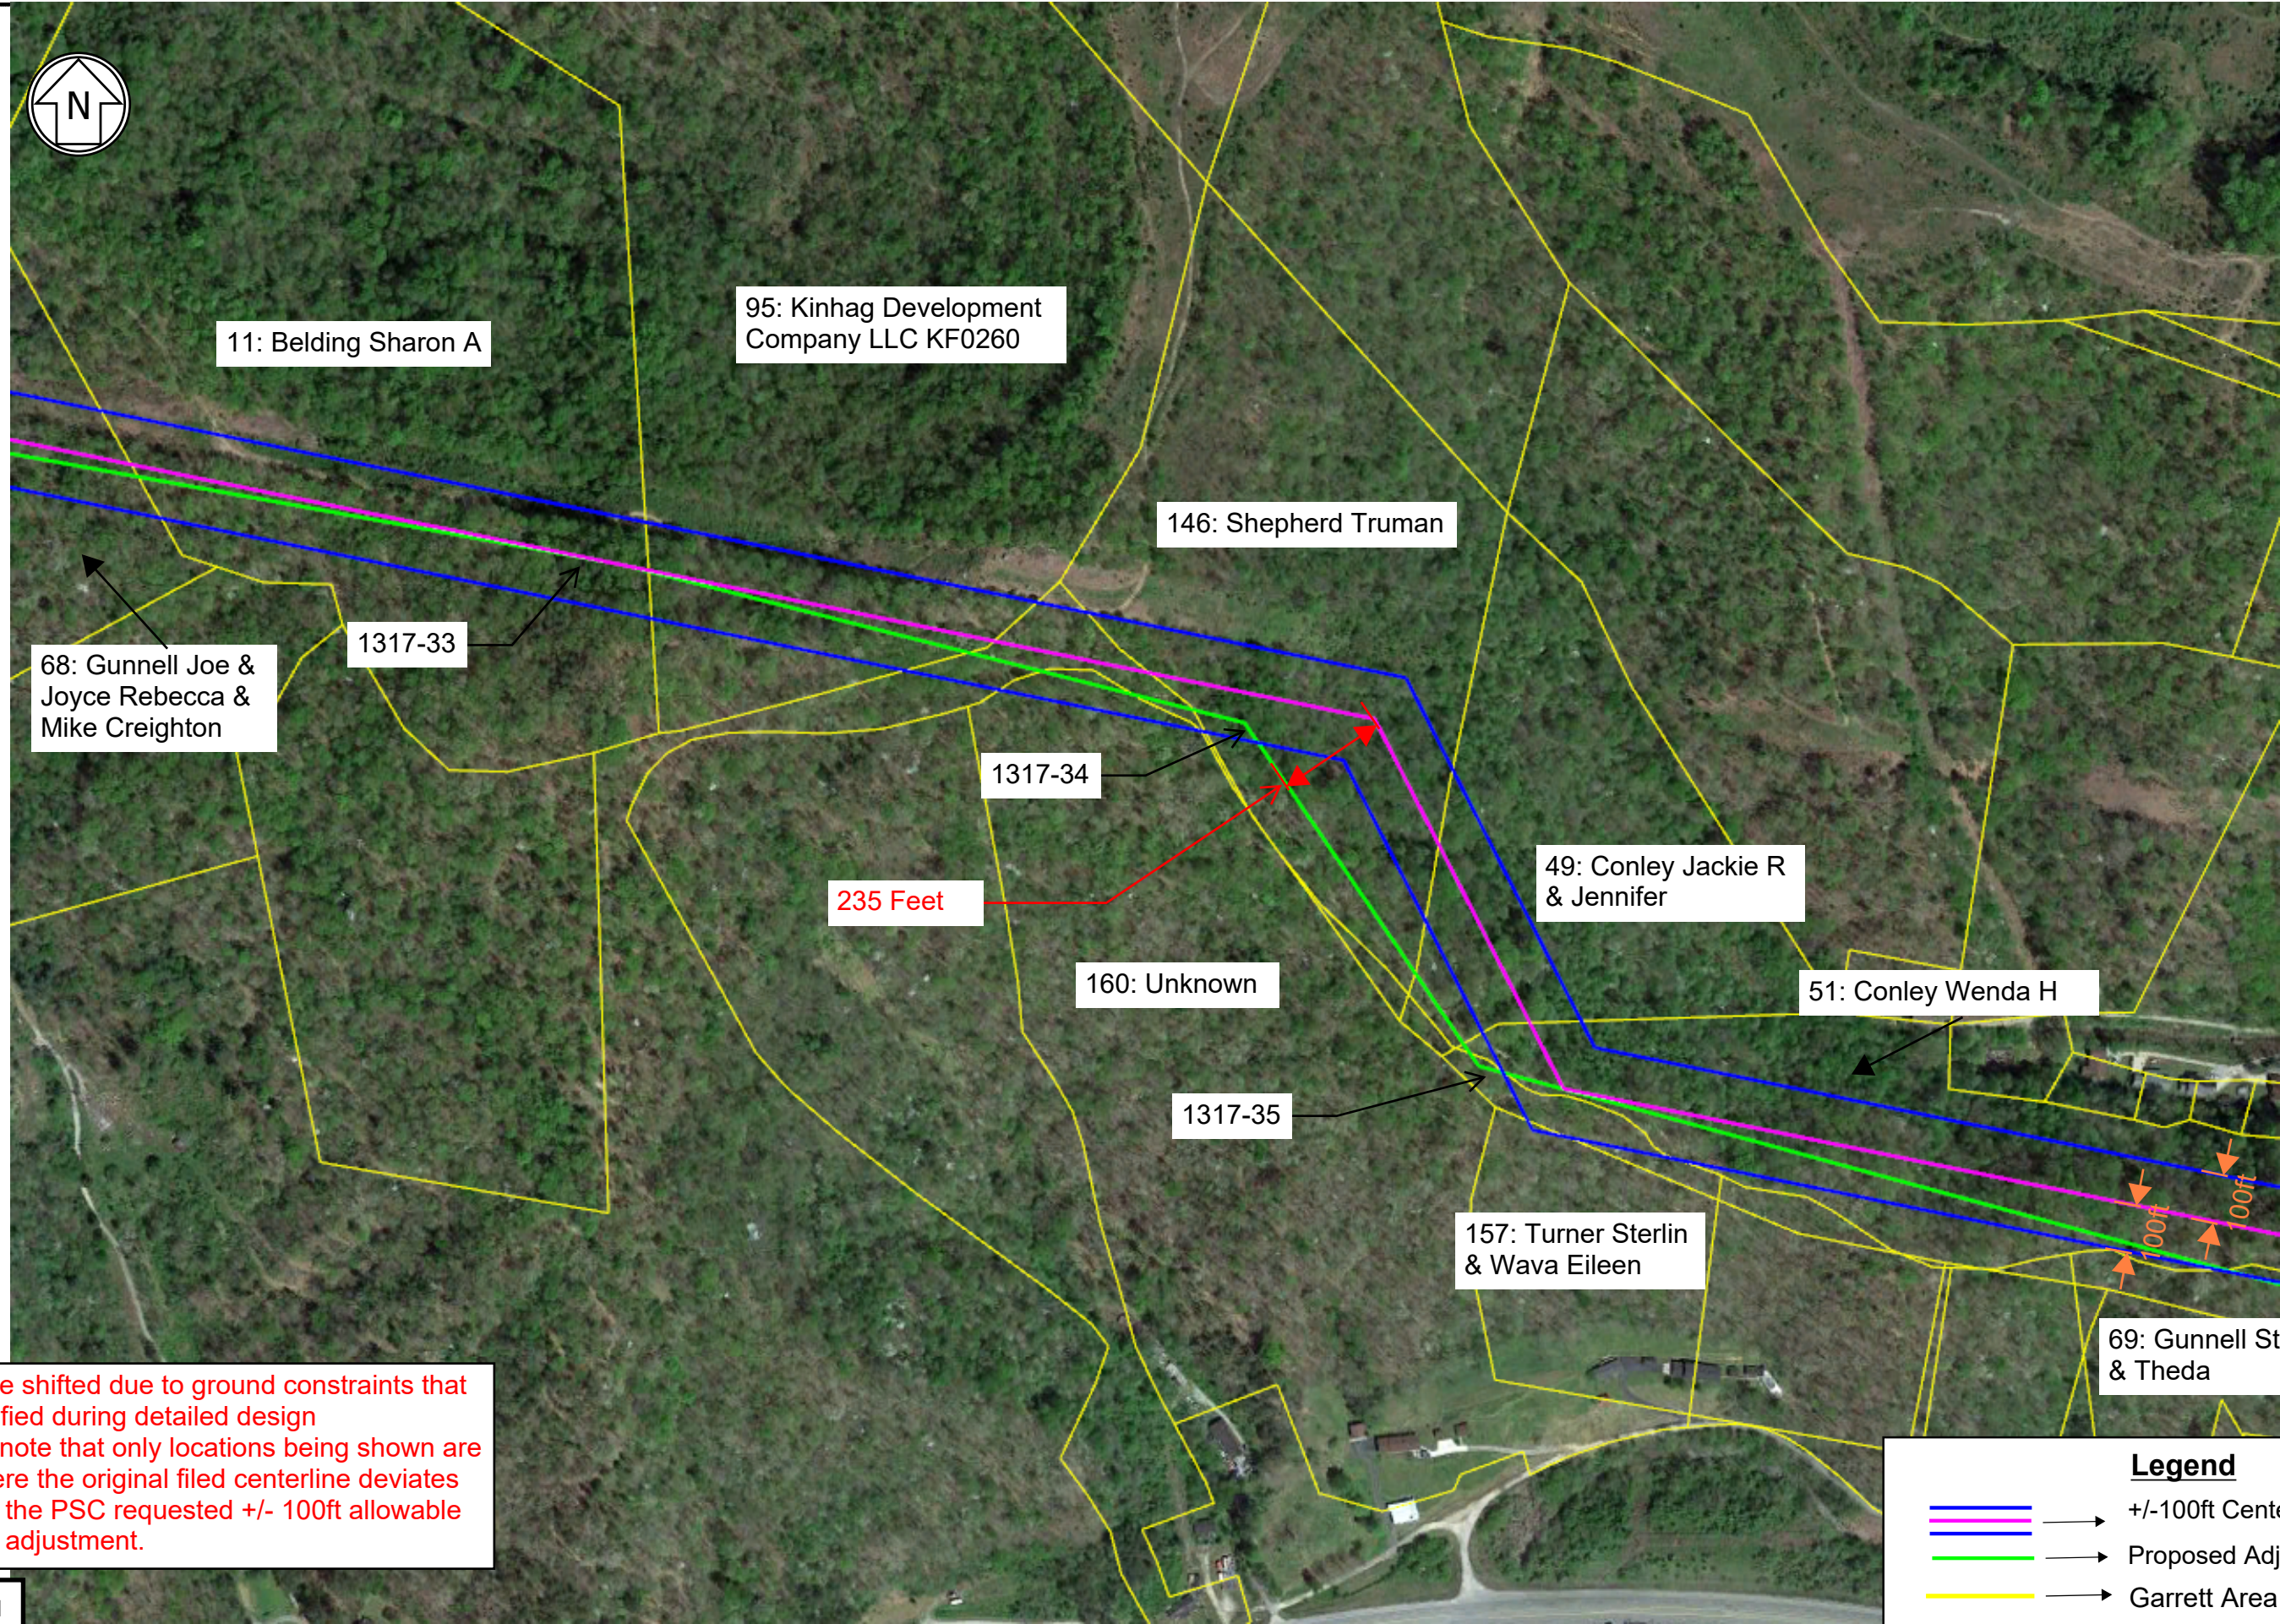

*Centerline shifted due to ground constraints that was identified during detailed design
 ** Please note that only locations being shown are areas where the original filed centerline deviates outside of the PSC requested +/- 100ft allowable centerline adjustment.

Legend

- +/-100ft Center-Line Offset
- Proposed Adjusted Centerline
- Garrett Area Parcels

Sheet 4 of 11

-No new/additional property owners affected from original PSC landowner notification


Case# 2021-00346



KENTUCKY POWER

THIS DRAWING IS THE PROPERTY OF AMERICAN ELECTRIC POWER AND IS LOANED UPON CONDITION THAT IT IS NOT TO BE COPIED OR REPRODUCED IN WHOLE OR IN PART OR USED FOR ANY PURPOSE WITHOUT THE WRITTEN CONSENT OF AMERICAN ELECTRIC POWER OR FOR ANY PURPOSE DETRIMENTAL TO THEIR INTEREST AND IS TO BE RETURNED UPON REQUEST.

GARRETT AREA IMPROVEMENTS PROJECT

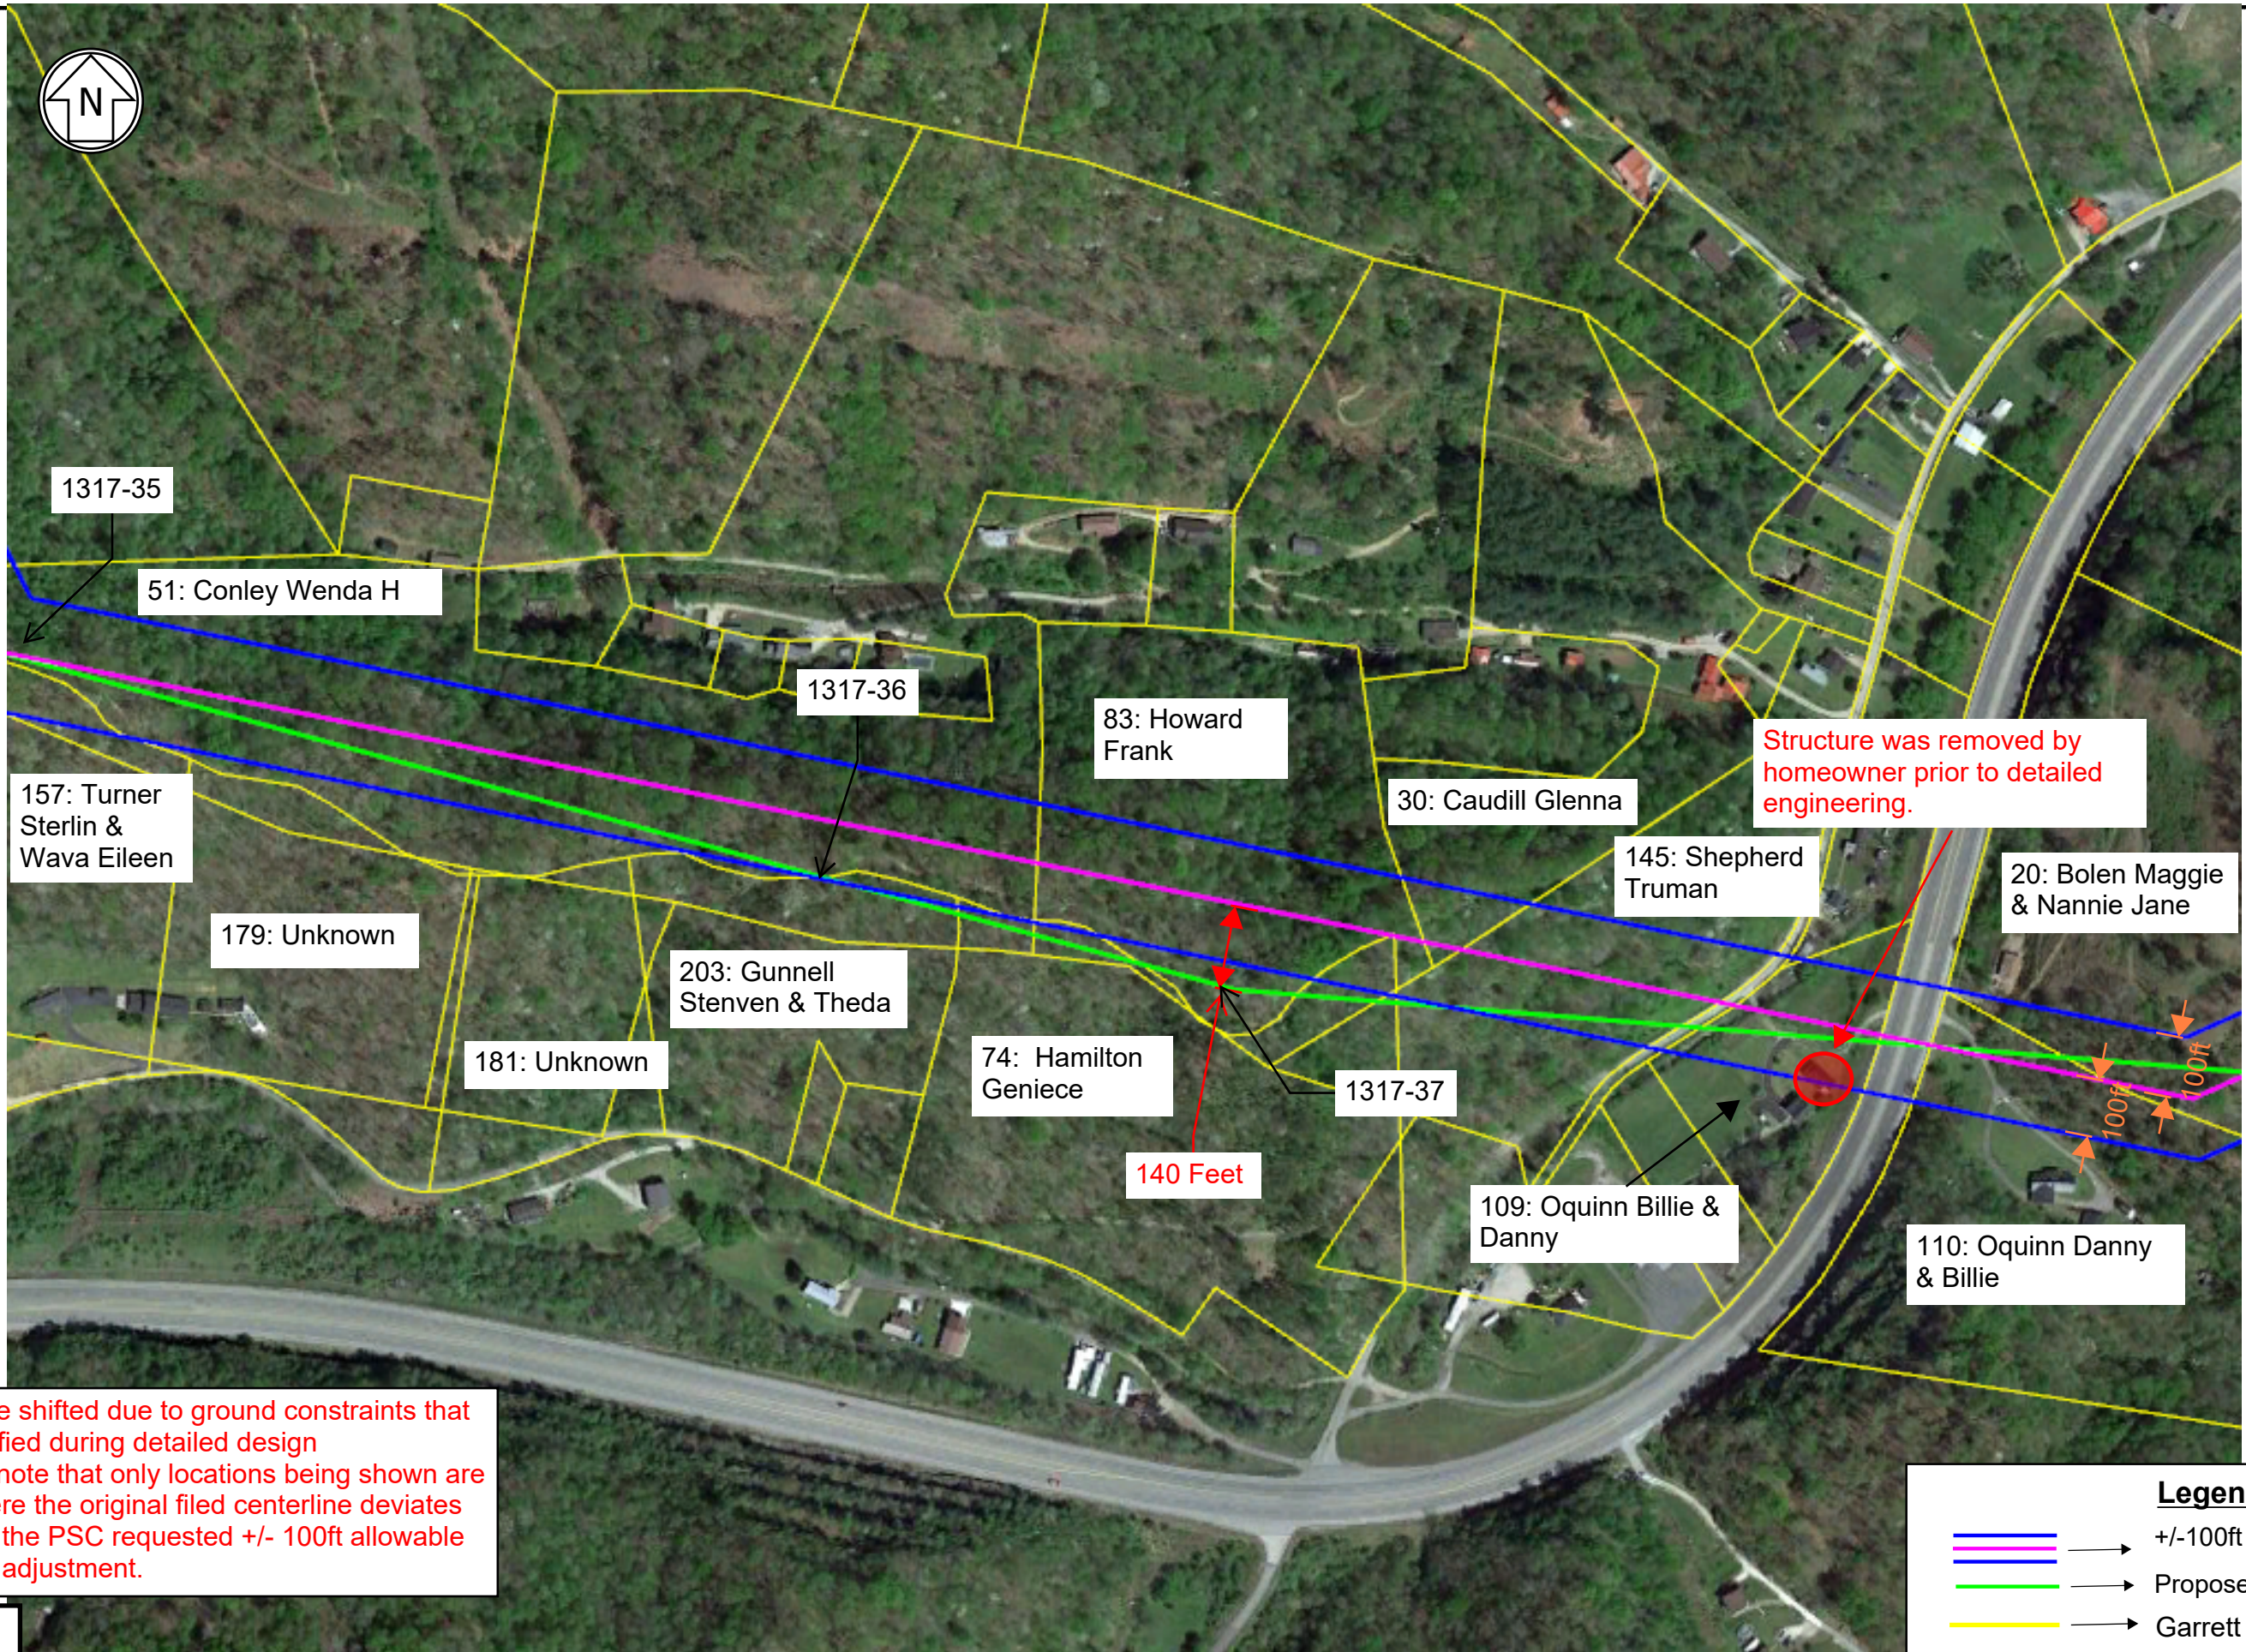

Structure was removed by homeowner prior to detailed engineering.


140 Feet

100ft
100ft
100ft

*Centerline shifted due to ground constraints that was identified during detailed design
 ** Please note that only locations being shown are areas where the original filed centerline deviates outside of the PSC requested +/- 100ft allowable centerline adjustment.

Legend

- +/-100ft Center-Line Offset
- Proposed Adjusted Centerline
- Garrett Area Parcels

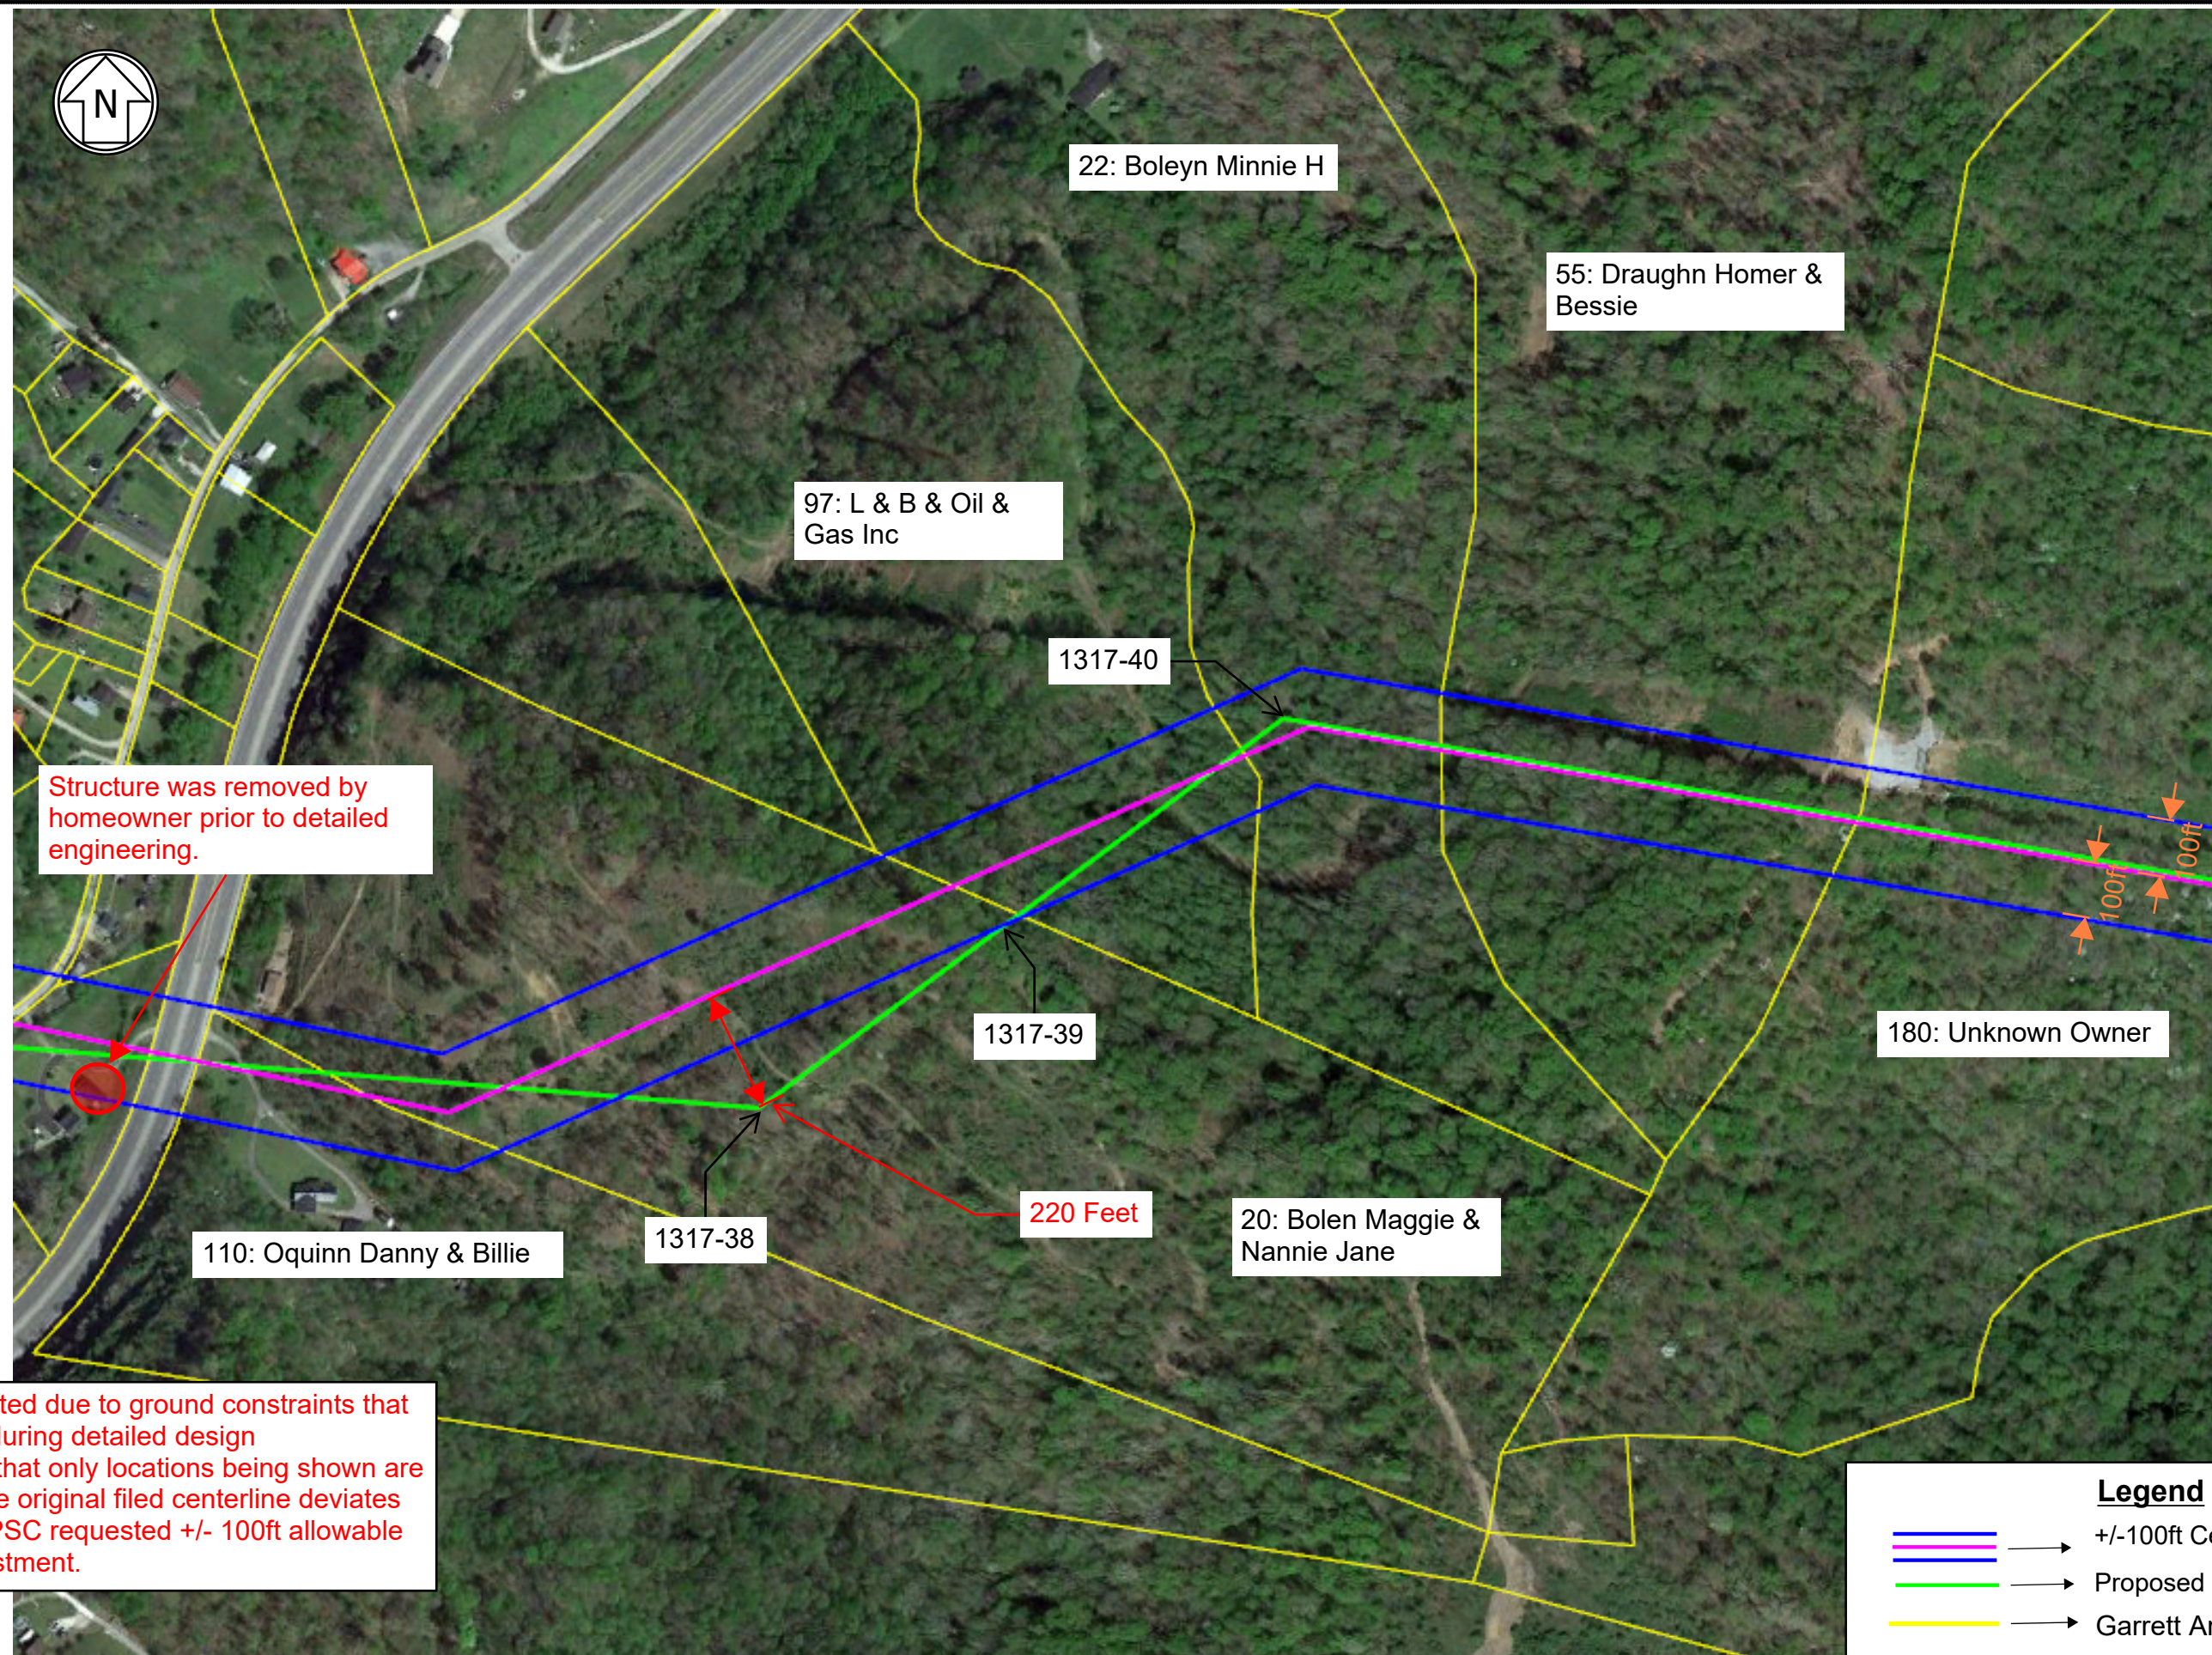


Structure was removed by homeowner prior to detailed engineering.

*Centerline shifted due to ground constraints that was identified during detailed design
 ** Please note that only locations being shown are areas where the original filed centerline deviates outside of the PSC requested +/- 100ft allowable centerline adjustment.

Legend

- +/-100ft Center-Line Offset
- Proposed Adjusted Centerline
- Garrett Area Parcels

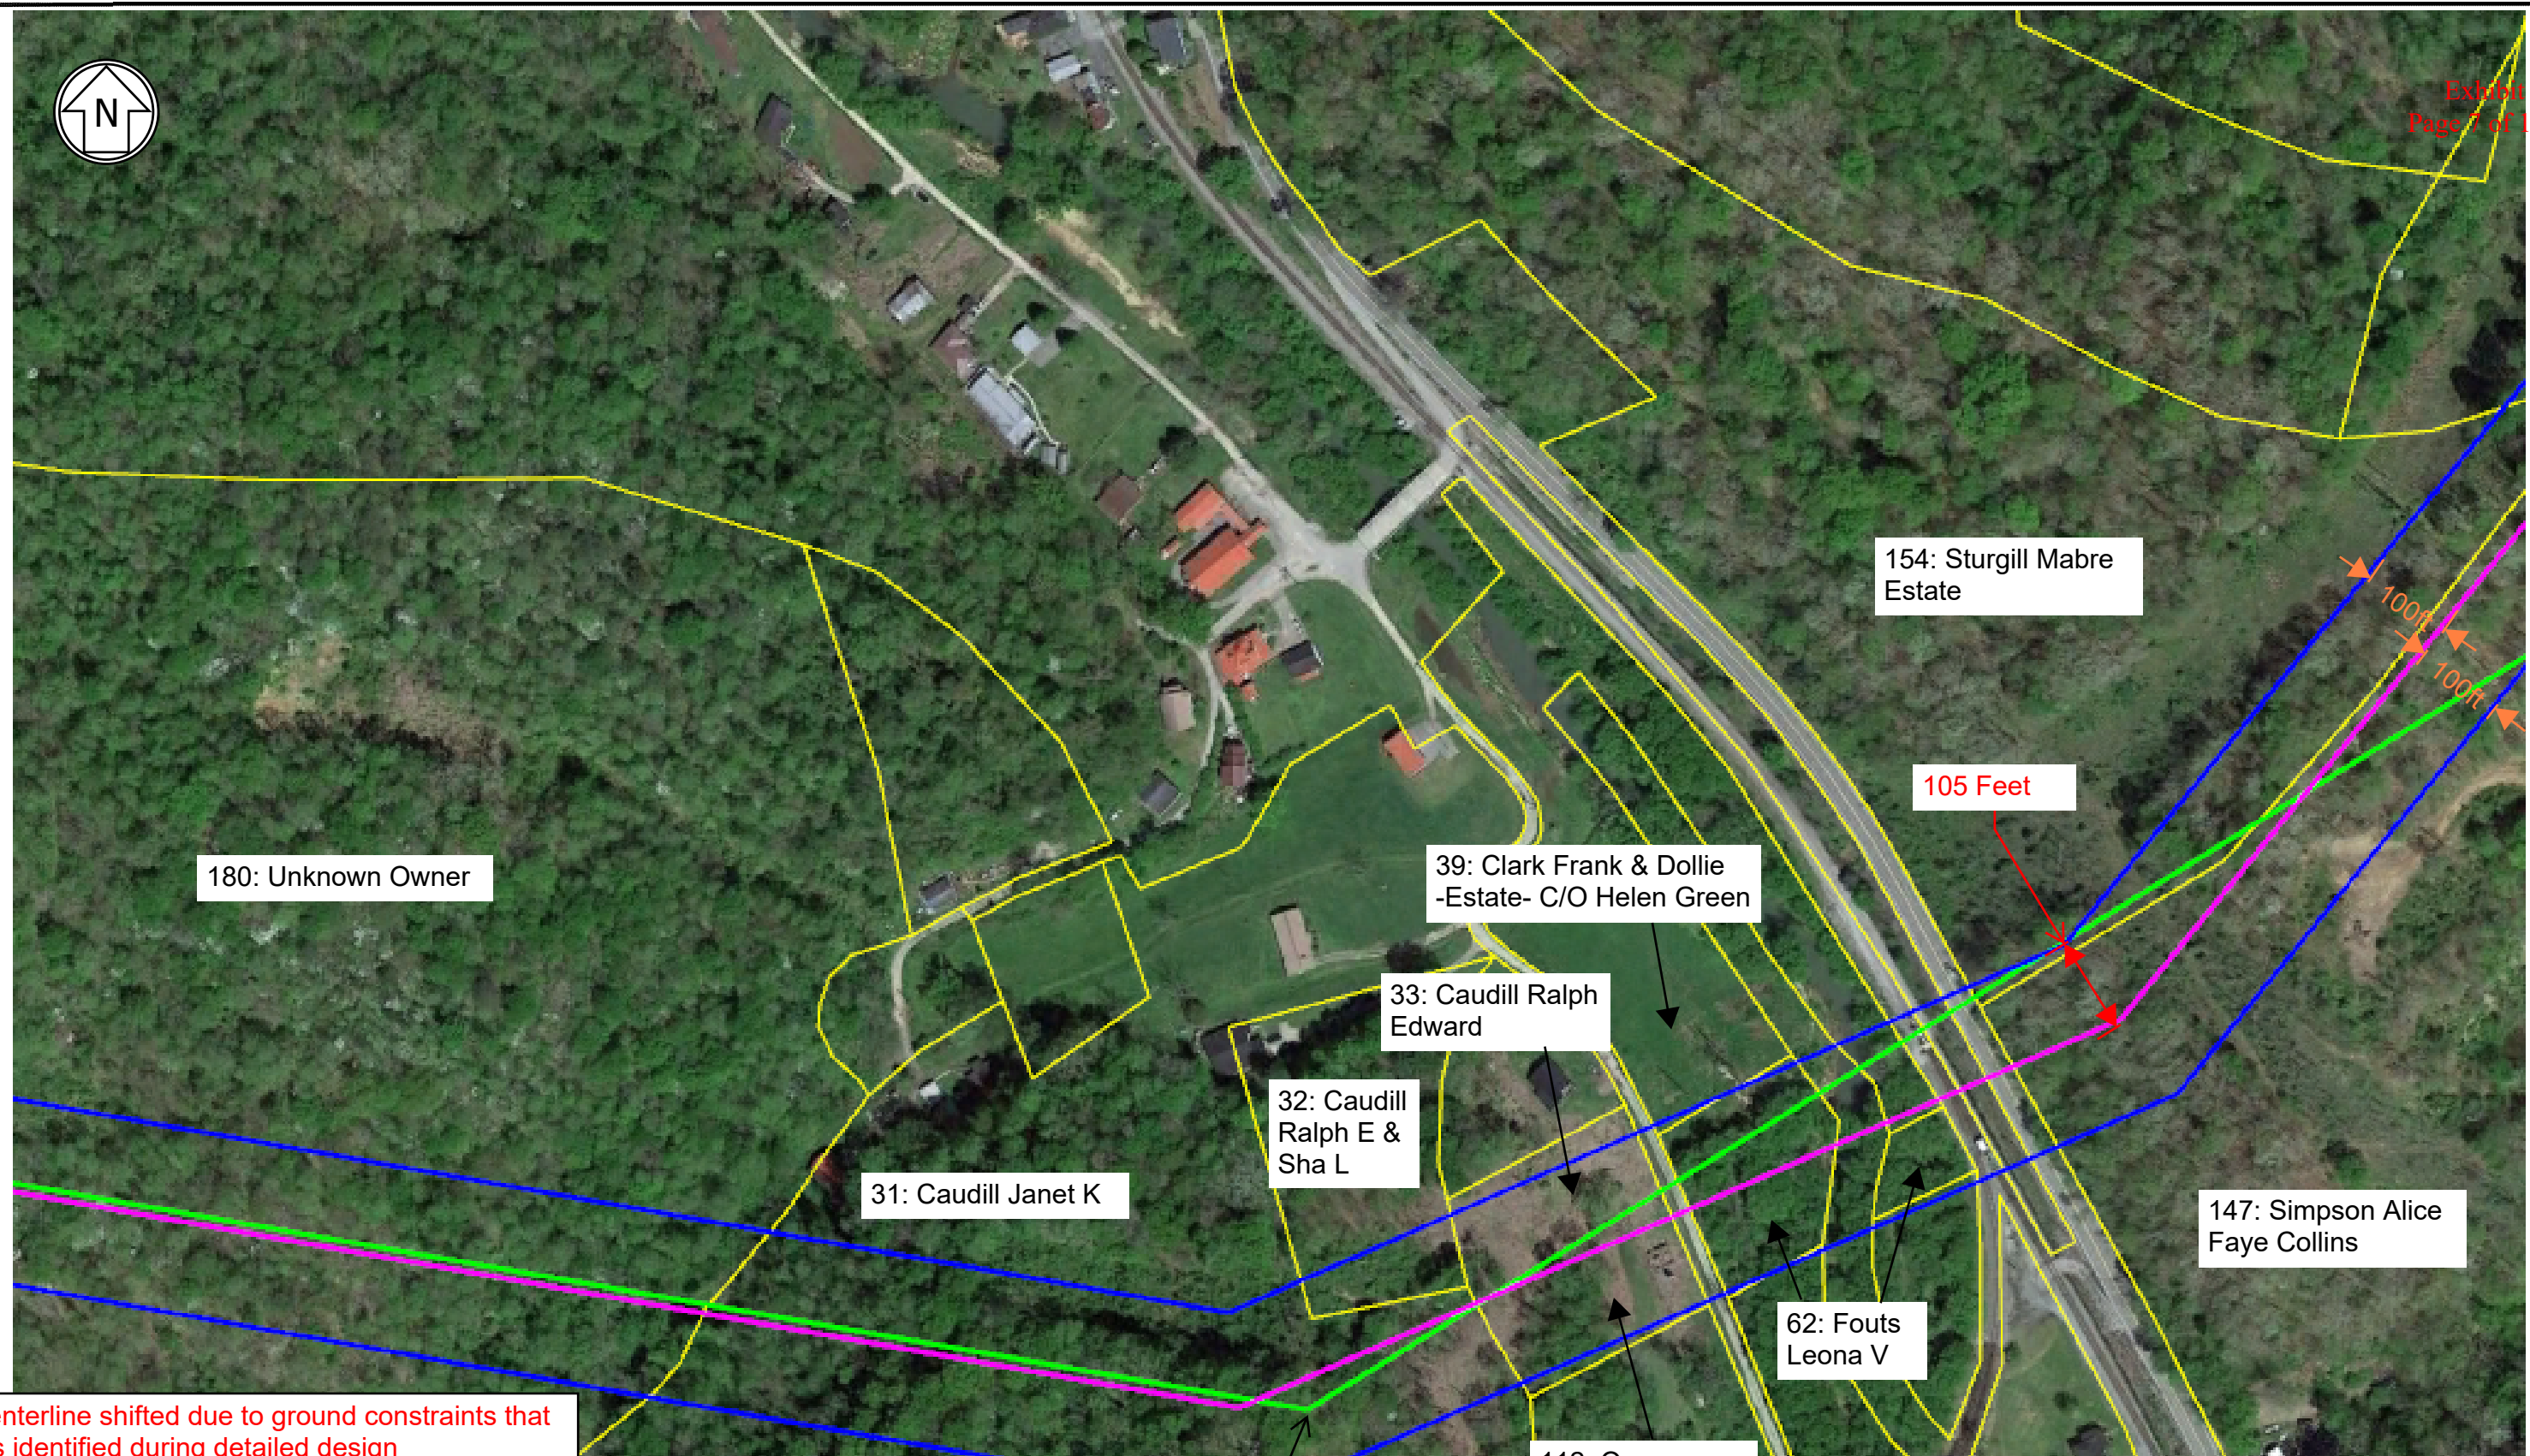


*Centerline shifted due to ground constraints that was identified during detailed design
** Please note that only locations being shown are areas where the original filed centerline deviates outside of the PSC requested +/- 100ft allowable centerline adjustment.

Legend

- +/-100ft Center-Line Offset Line
- Proposed Adjusted Centerline
- Garrett Area Parcels

Sheet 7 of 11

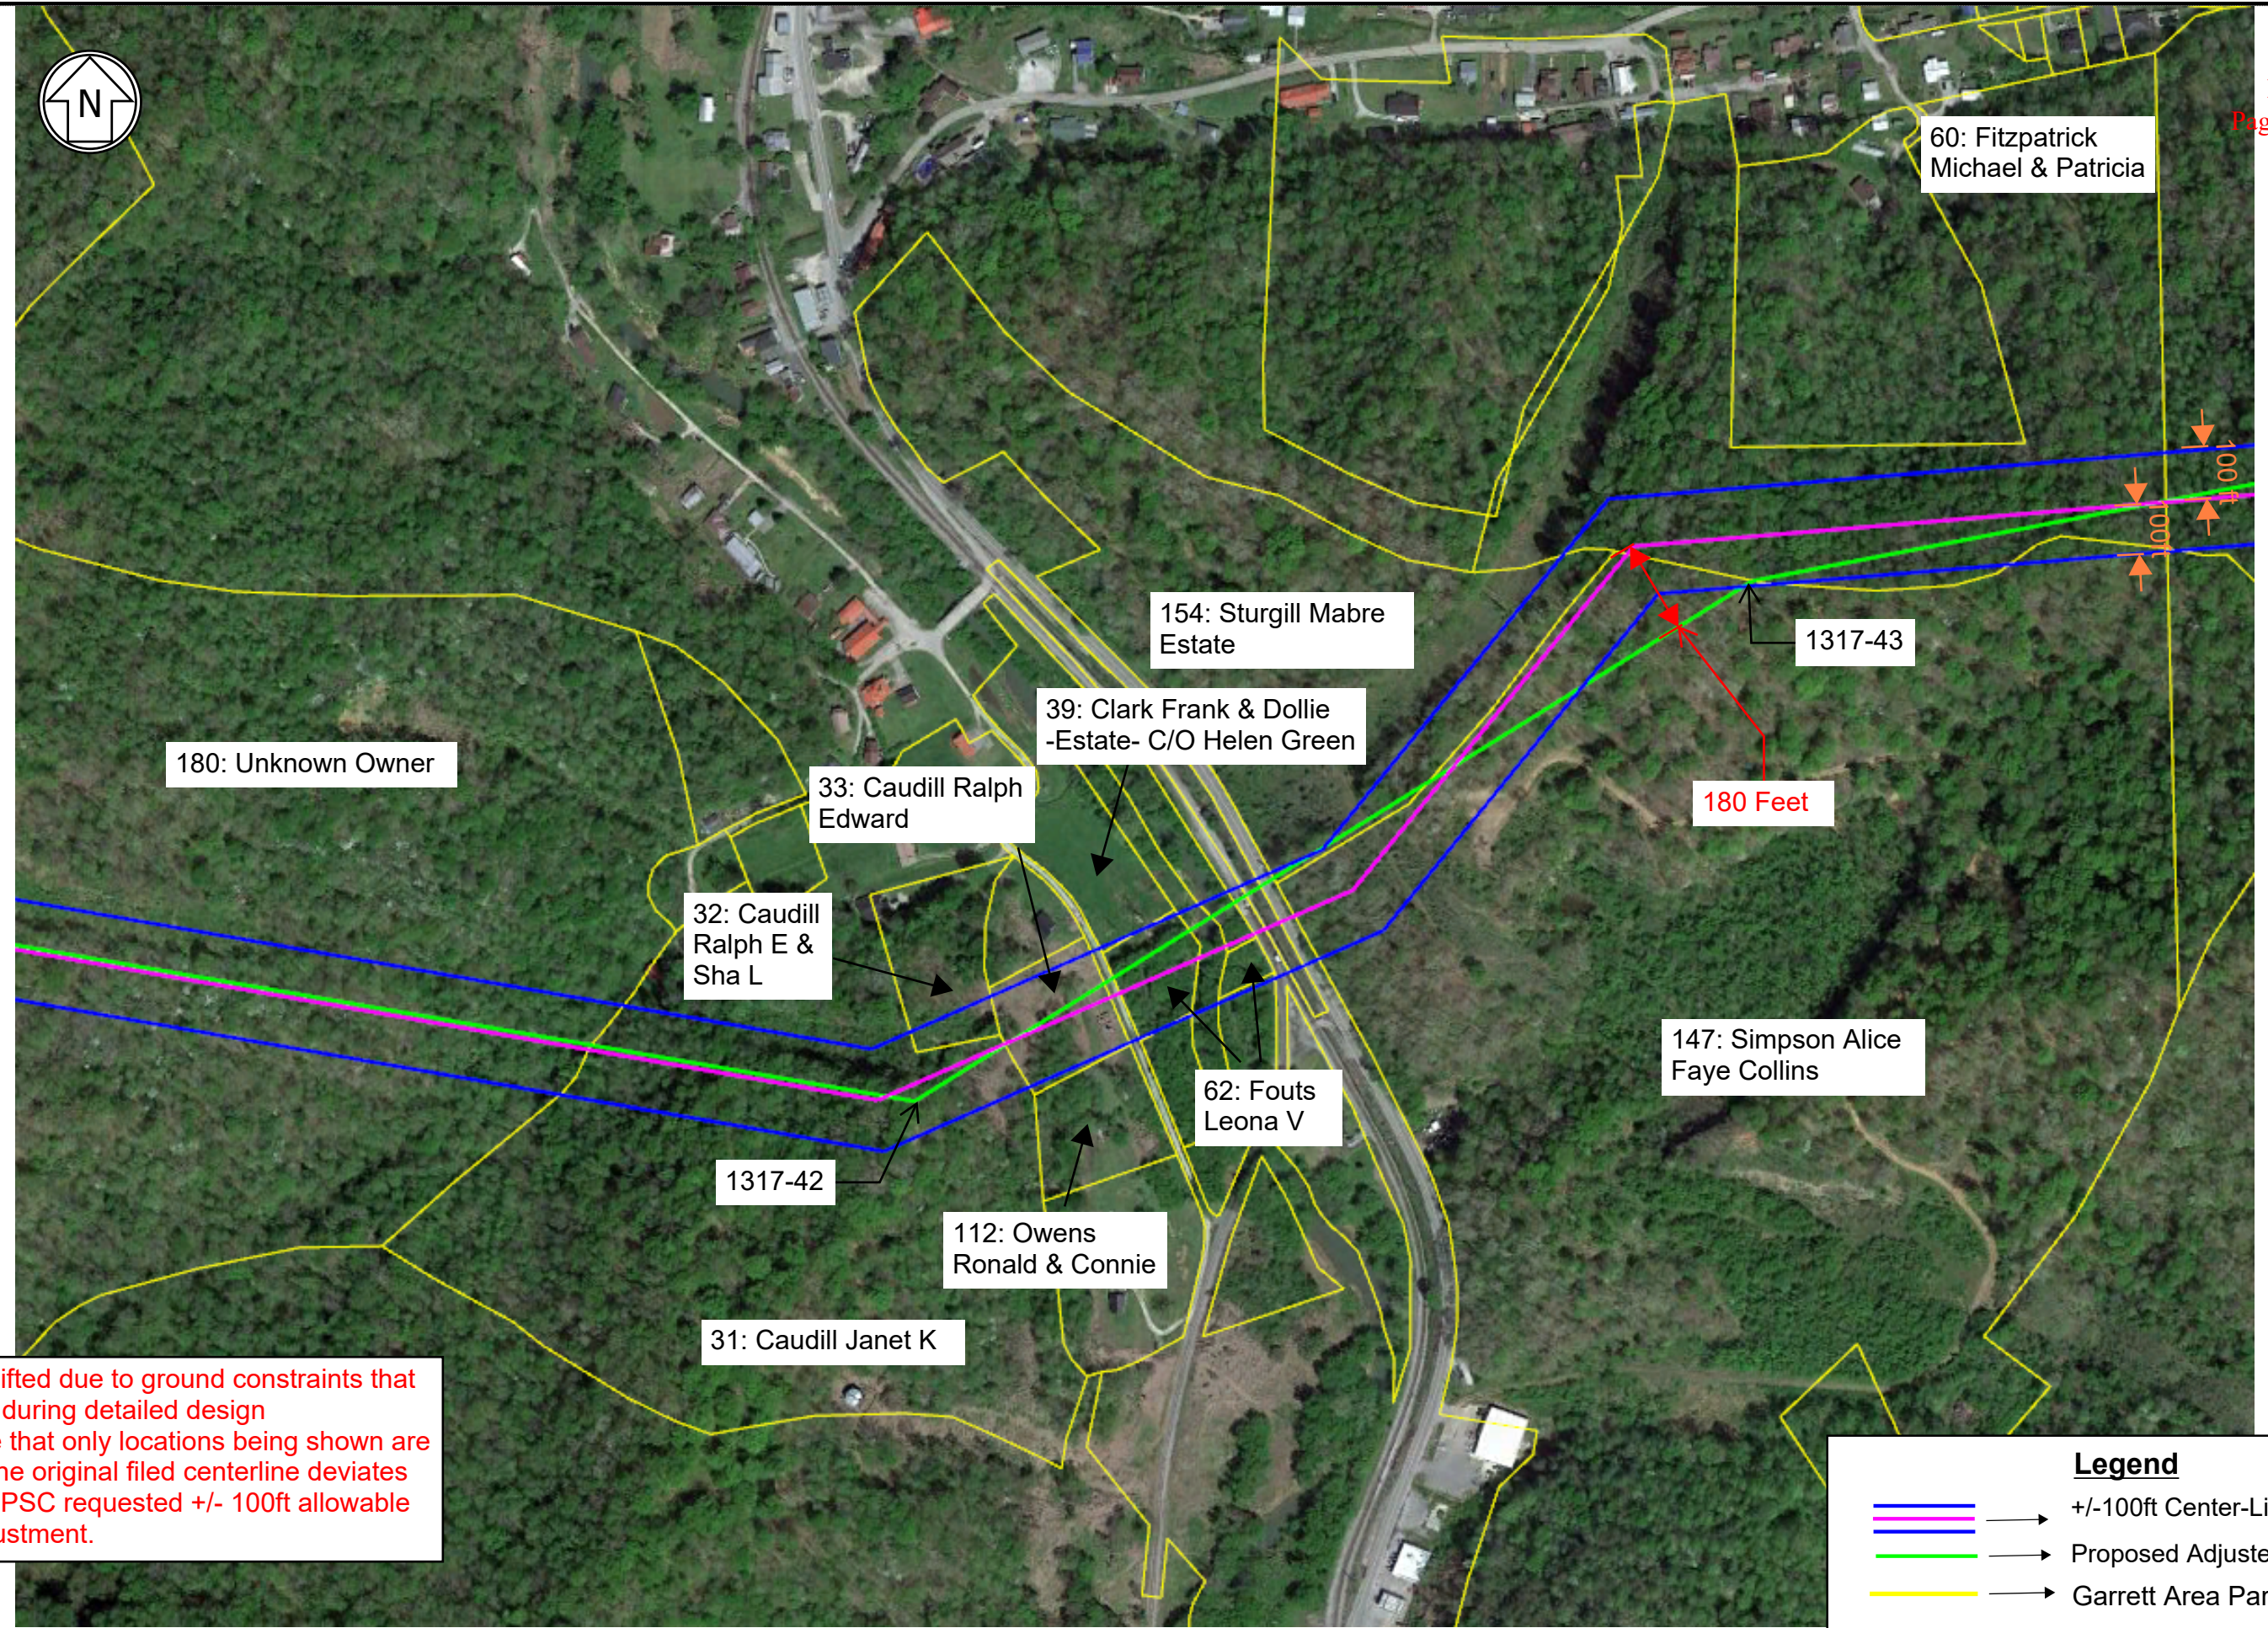

60: Fitzpatrick
Michael & Patricia

154: Sturgill Mabre
Estate

39: Clark Frank & Dollie
-Estate- C/O Helen Green

1317-43

180: Unknown Owner

33: Caudill Ralph
Edward

180 Feet

32: Caudill
Ralph E &
Sha L

147: Simpson Alice
Faye Collins

62: Fouts
Leona V

1317-42

112: Owens
Ronald & Connie


31: Caudill Janet K

*Centerline shifted due to ground constraints that was identified during detailed design
** Please note that only locations being shown are areas where the original filed centerline deviates outside of the PSC requested +/- 100ft allowable centerline adjustment.

Legend




- +/-100ft Center-Line Offset
- Proposed Adjusted Centerline
- Garrett Area Parcels

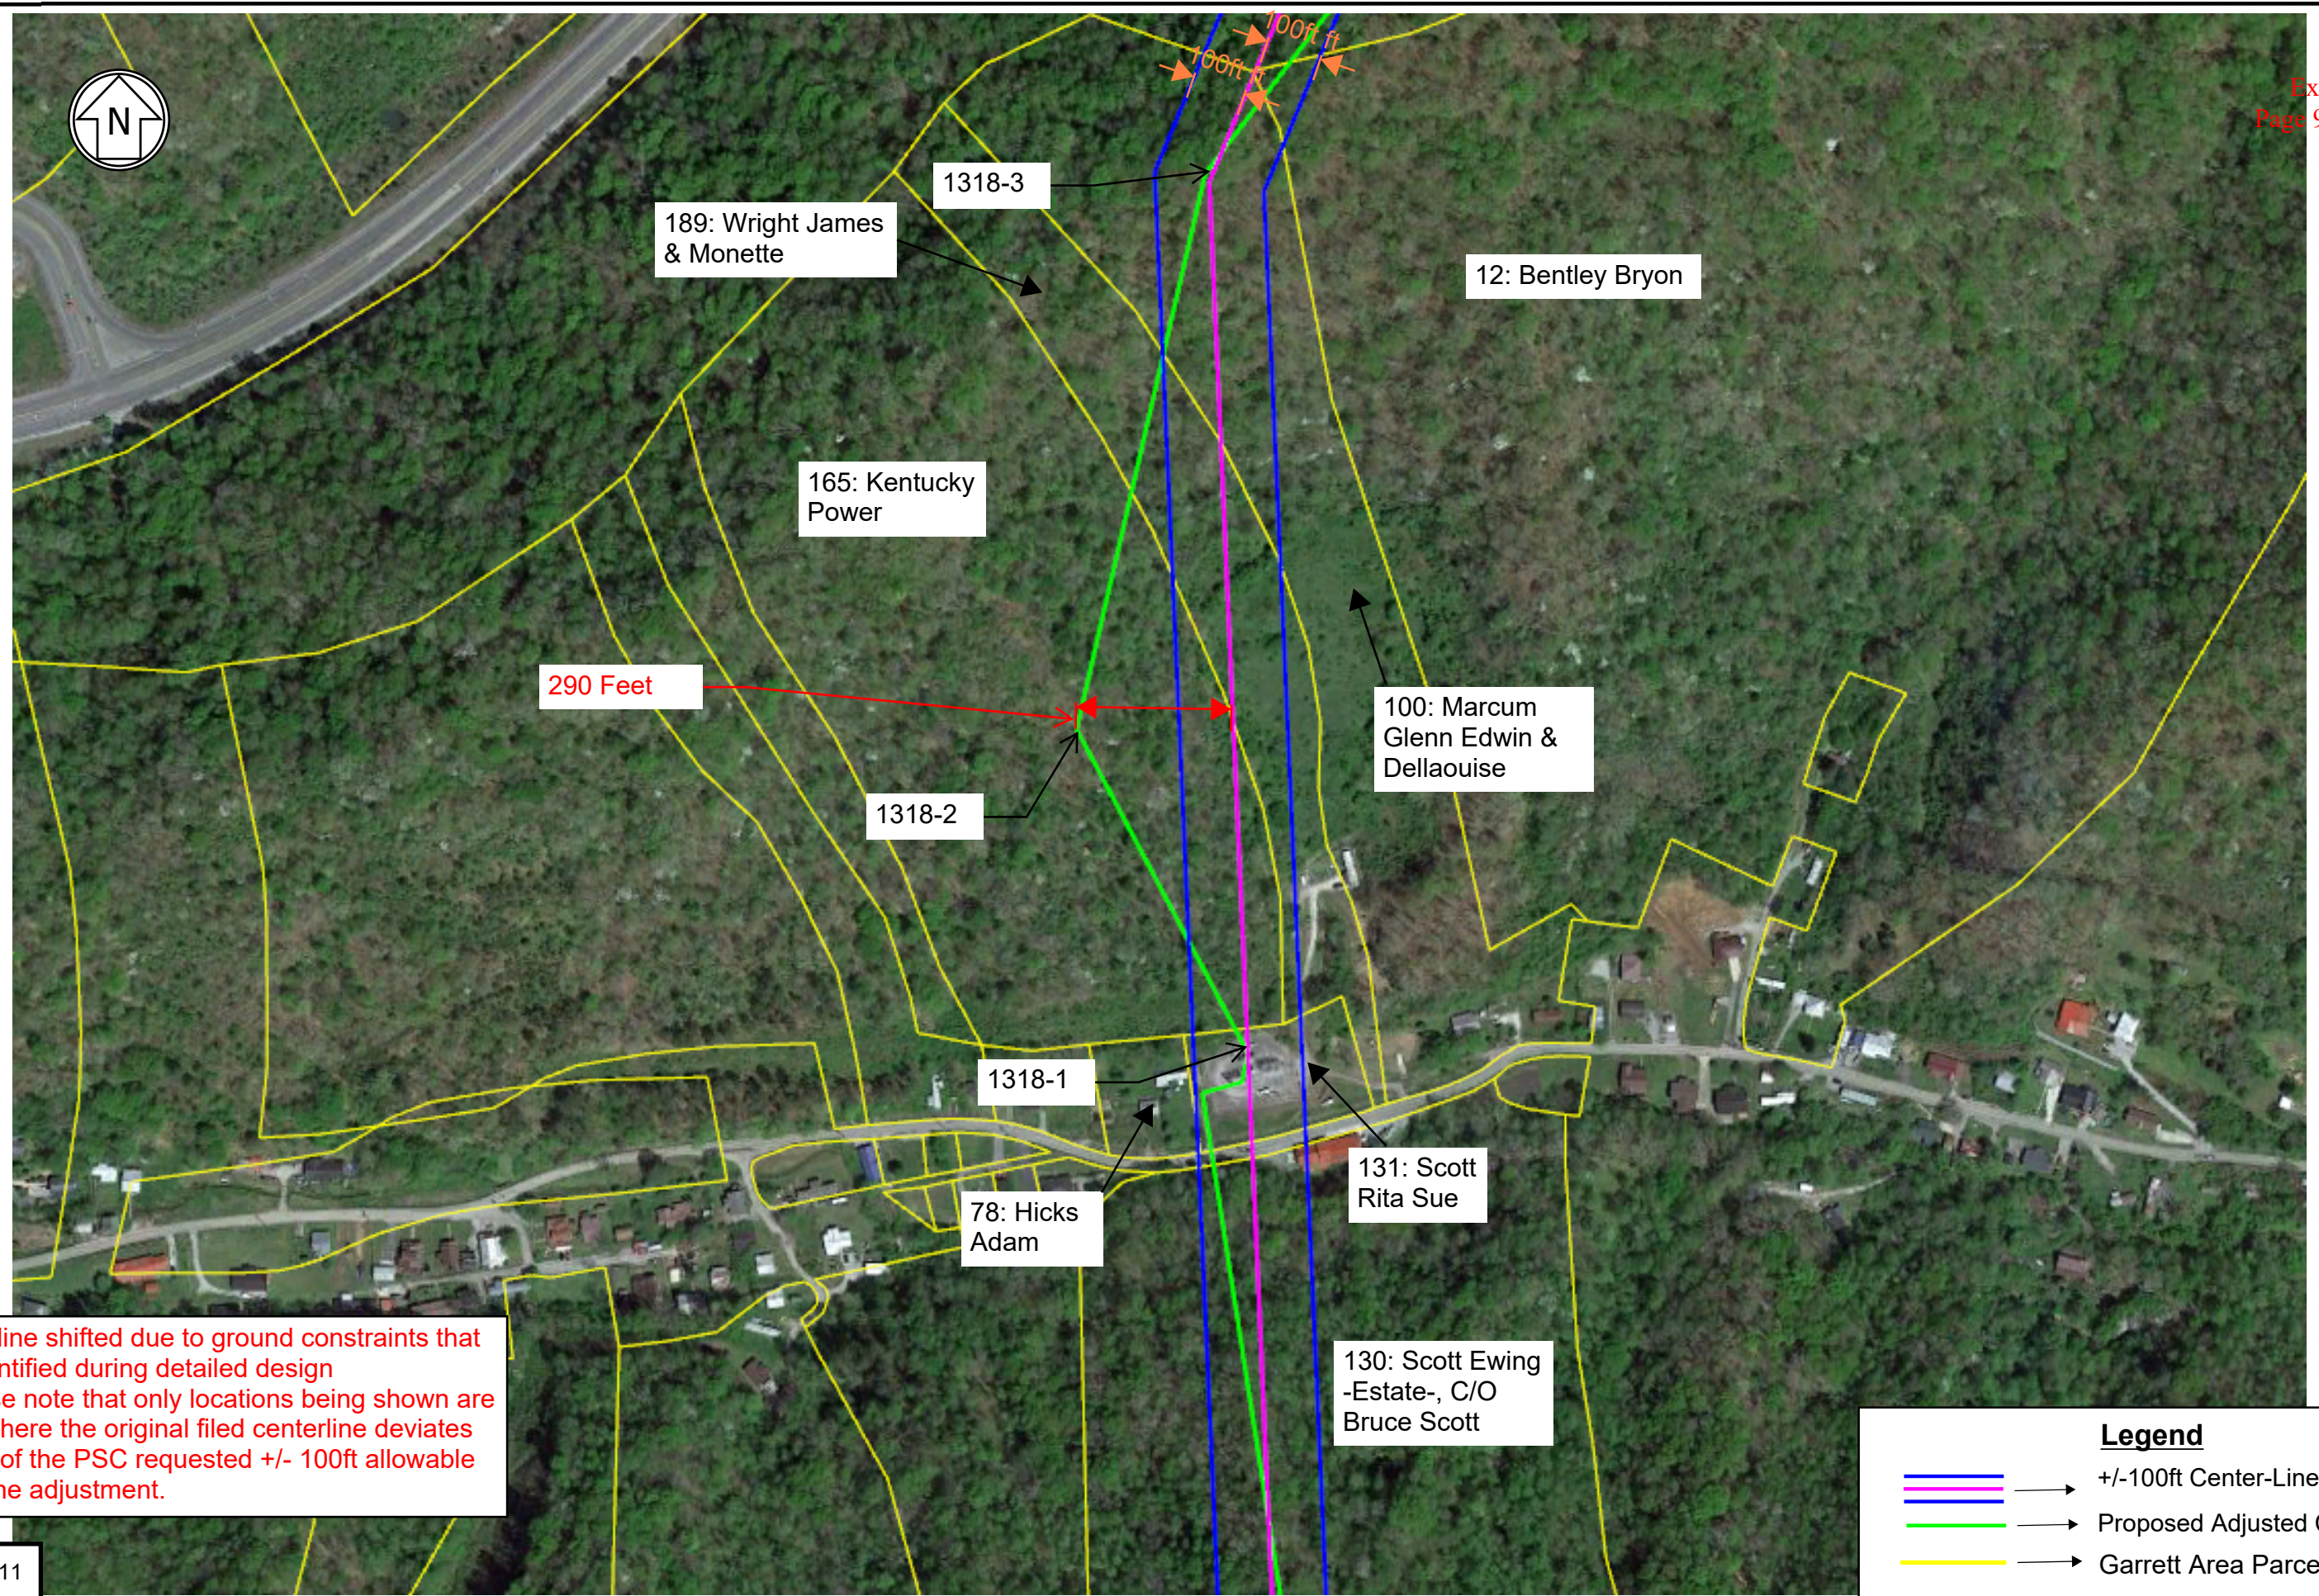




*Centerline shifted due to ground constraints that was identified during detailed design
** Please note that only locations being shown are areas where the original filed centerline deviates outside of the PSC requested +/- 100ft allowable centerline adjustment.

Legend

-  +/-100ft Center-Line Offset
-  Proposed Adjusted Centerline
-  Garrett Area Parcels




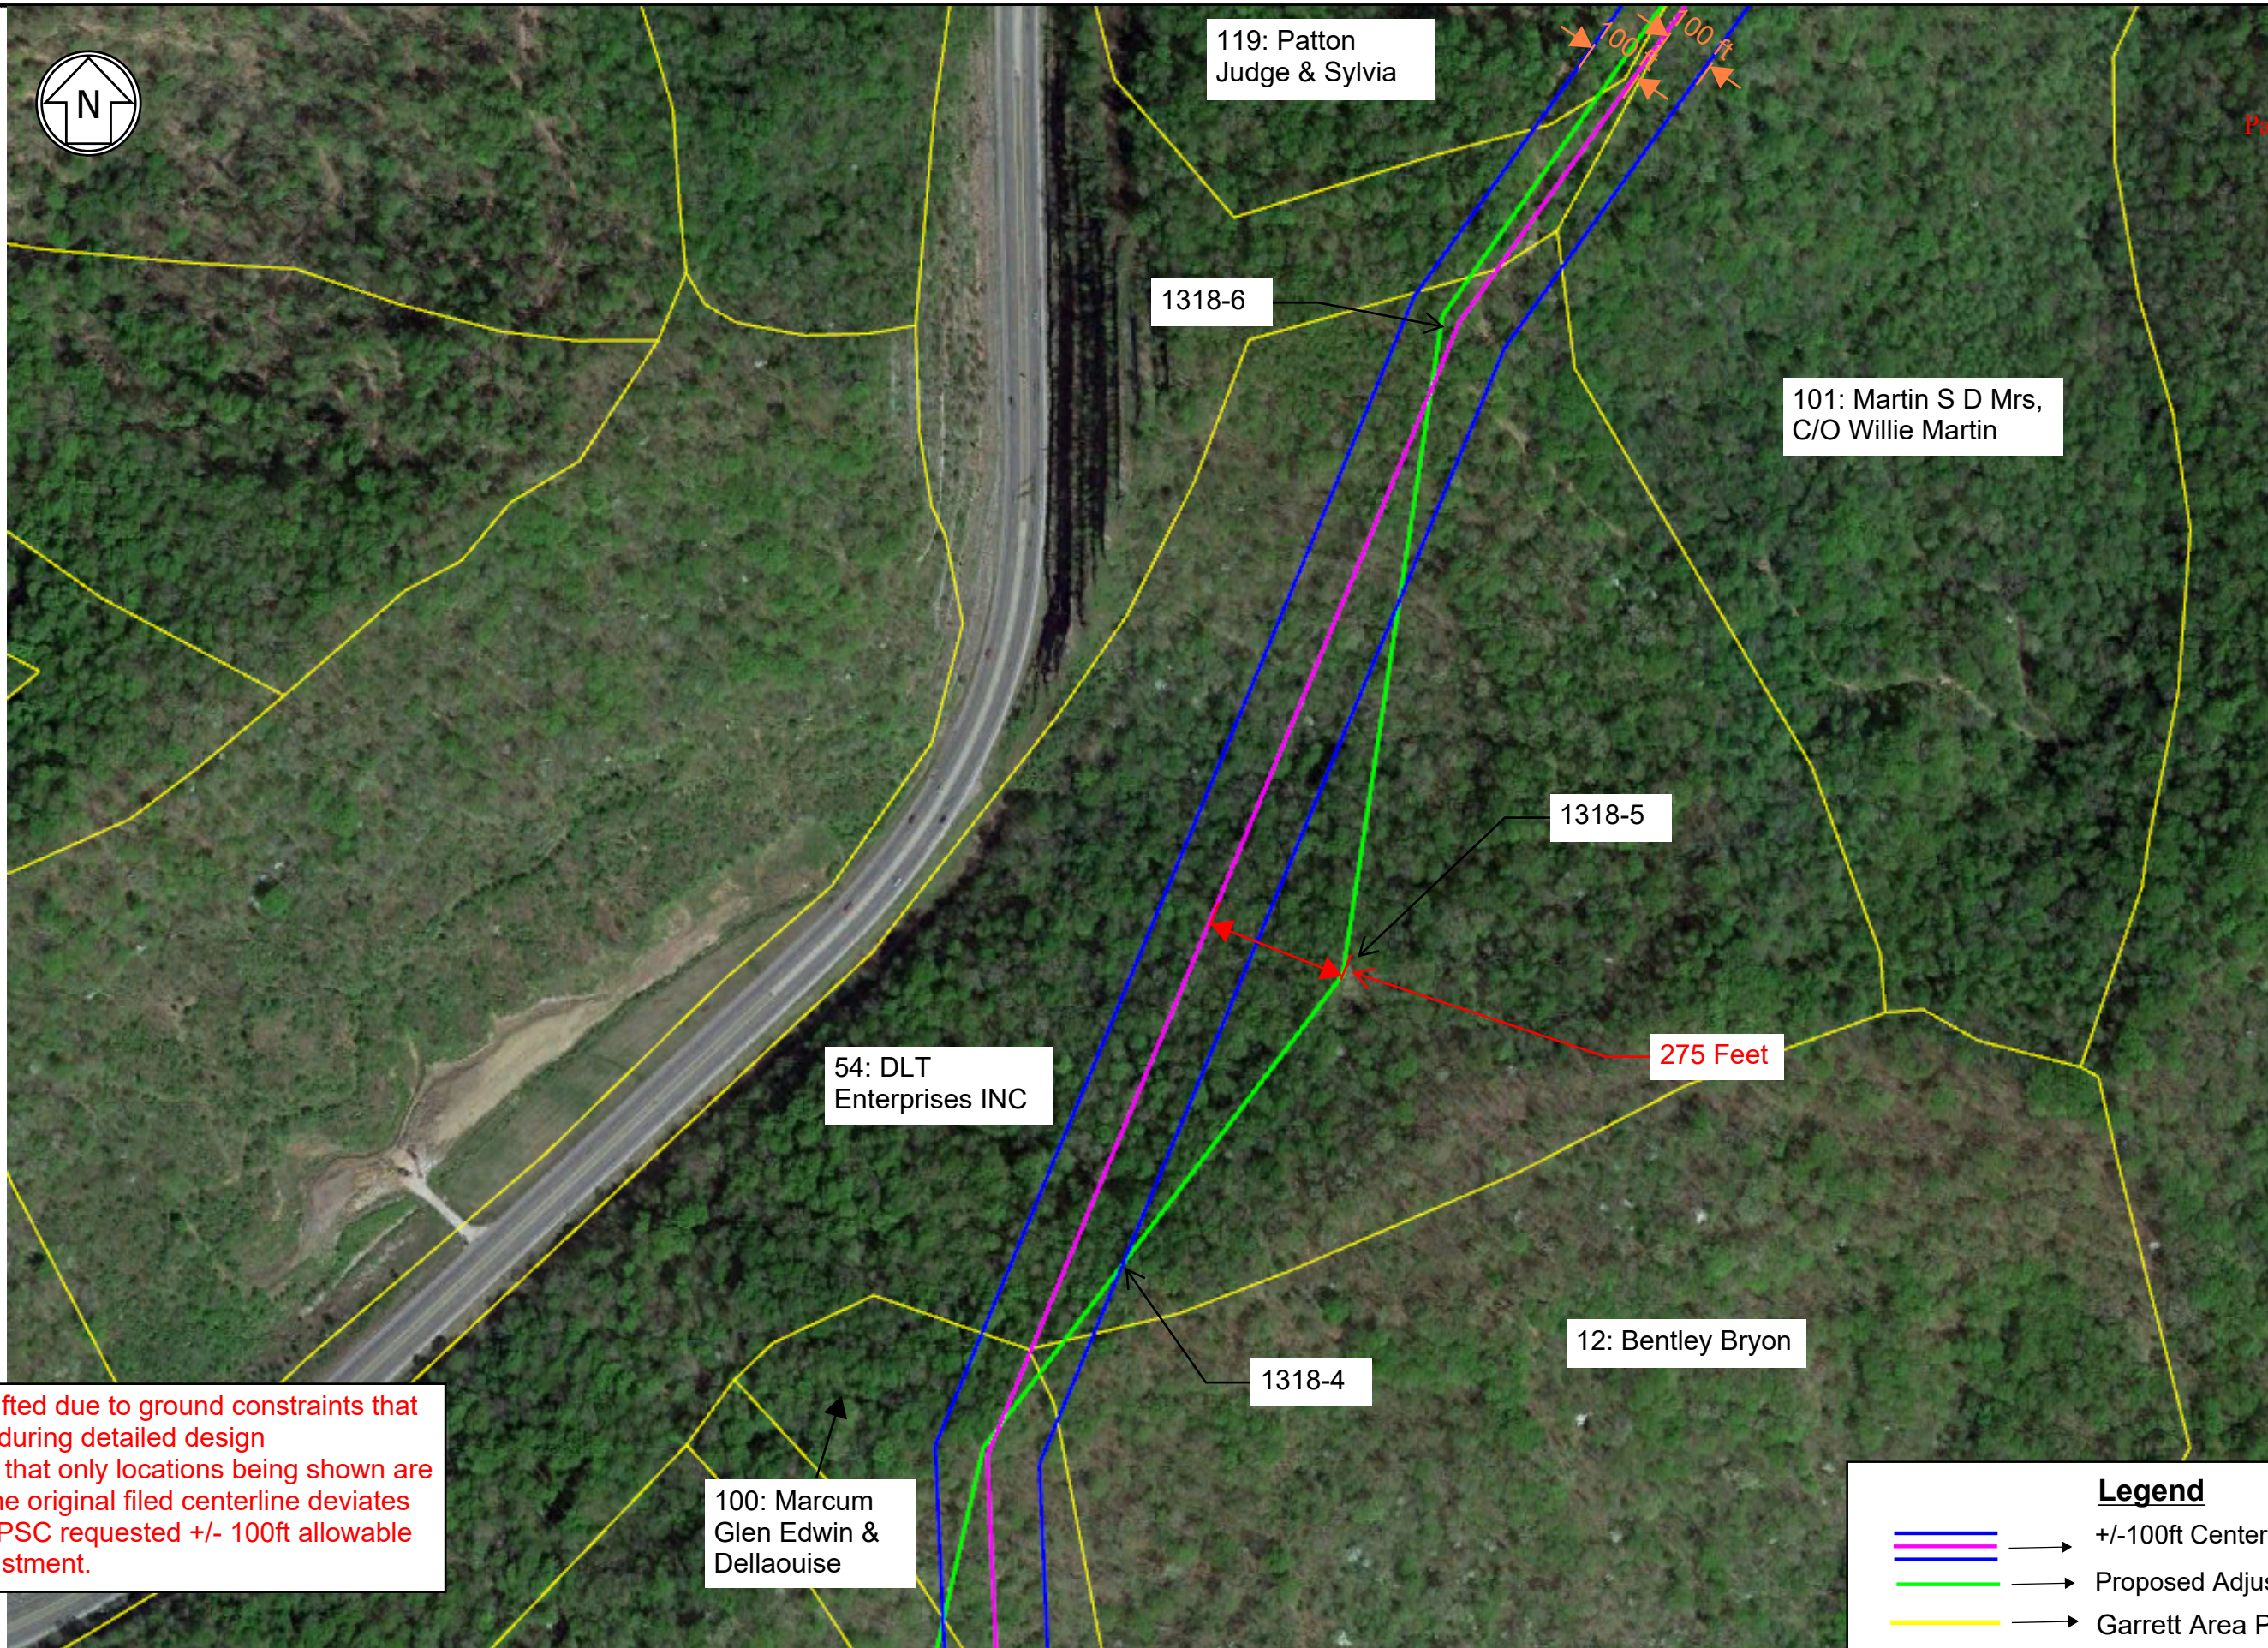

*Centerline shifted due to ground constraints that was identified during detailed design
** Please note that only locations being shown are areas where the original filed centerline deviates outside of the PSC requested +/- 100ft allowable centerline adjustment.

Legend

- +/-100ft Center-Line Offset
- Proposed Adjusted Centerline
- Garrett Area Parcels

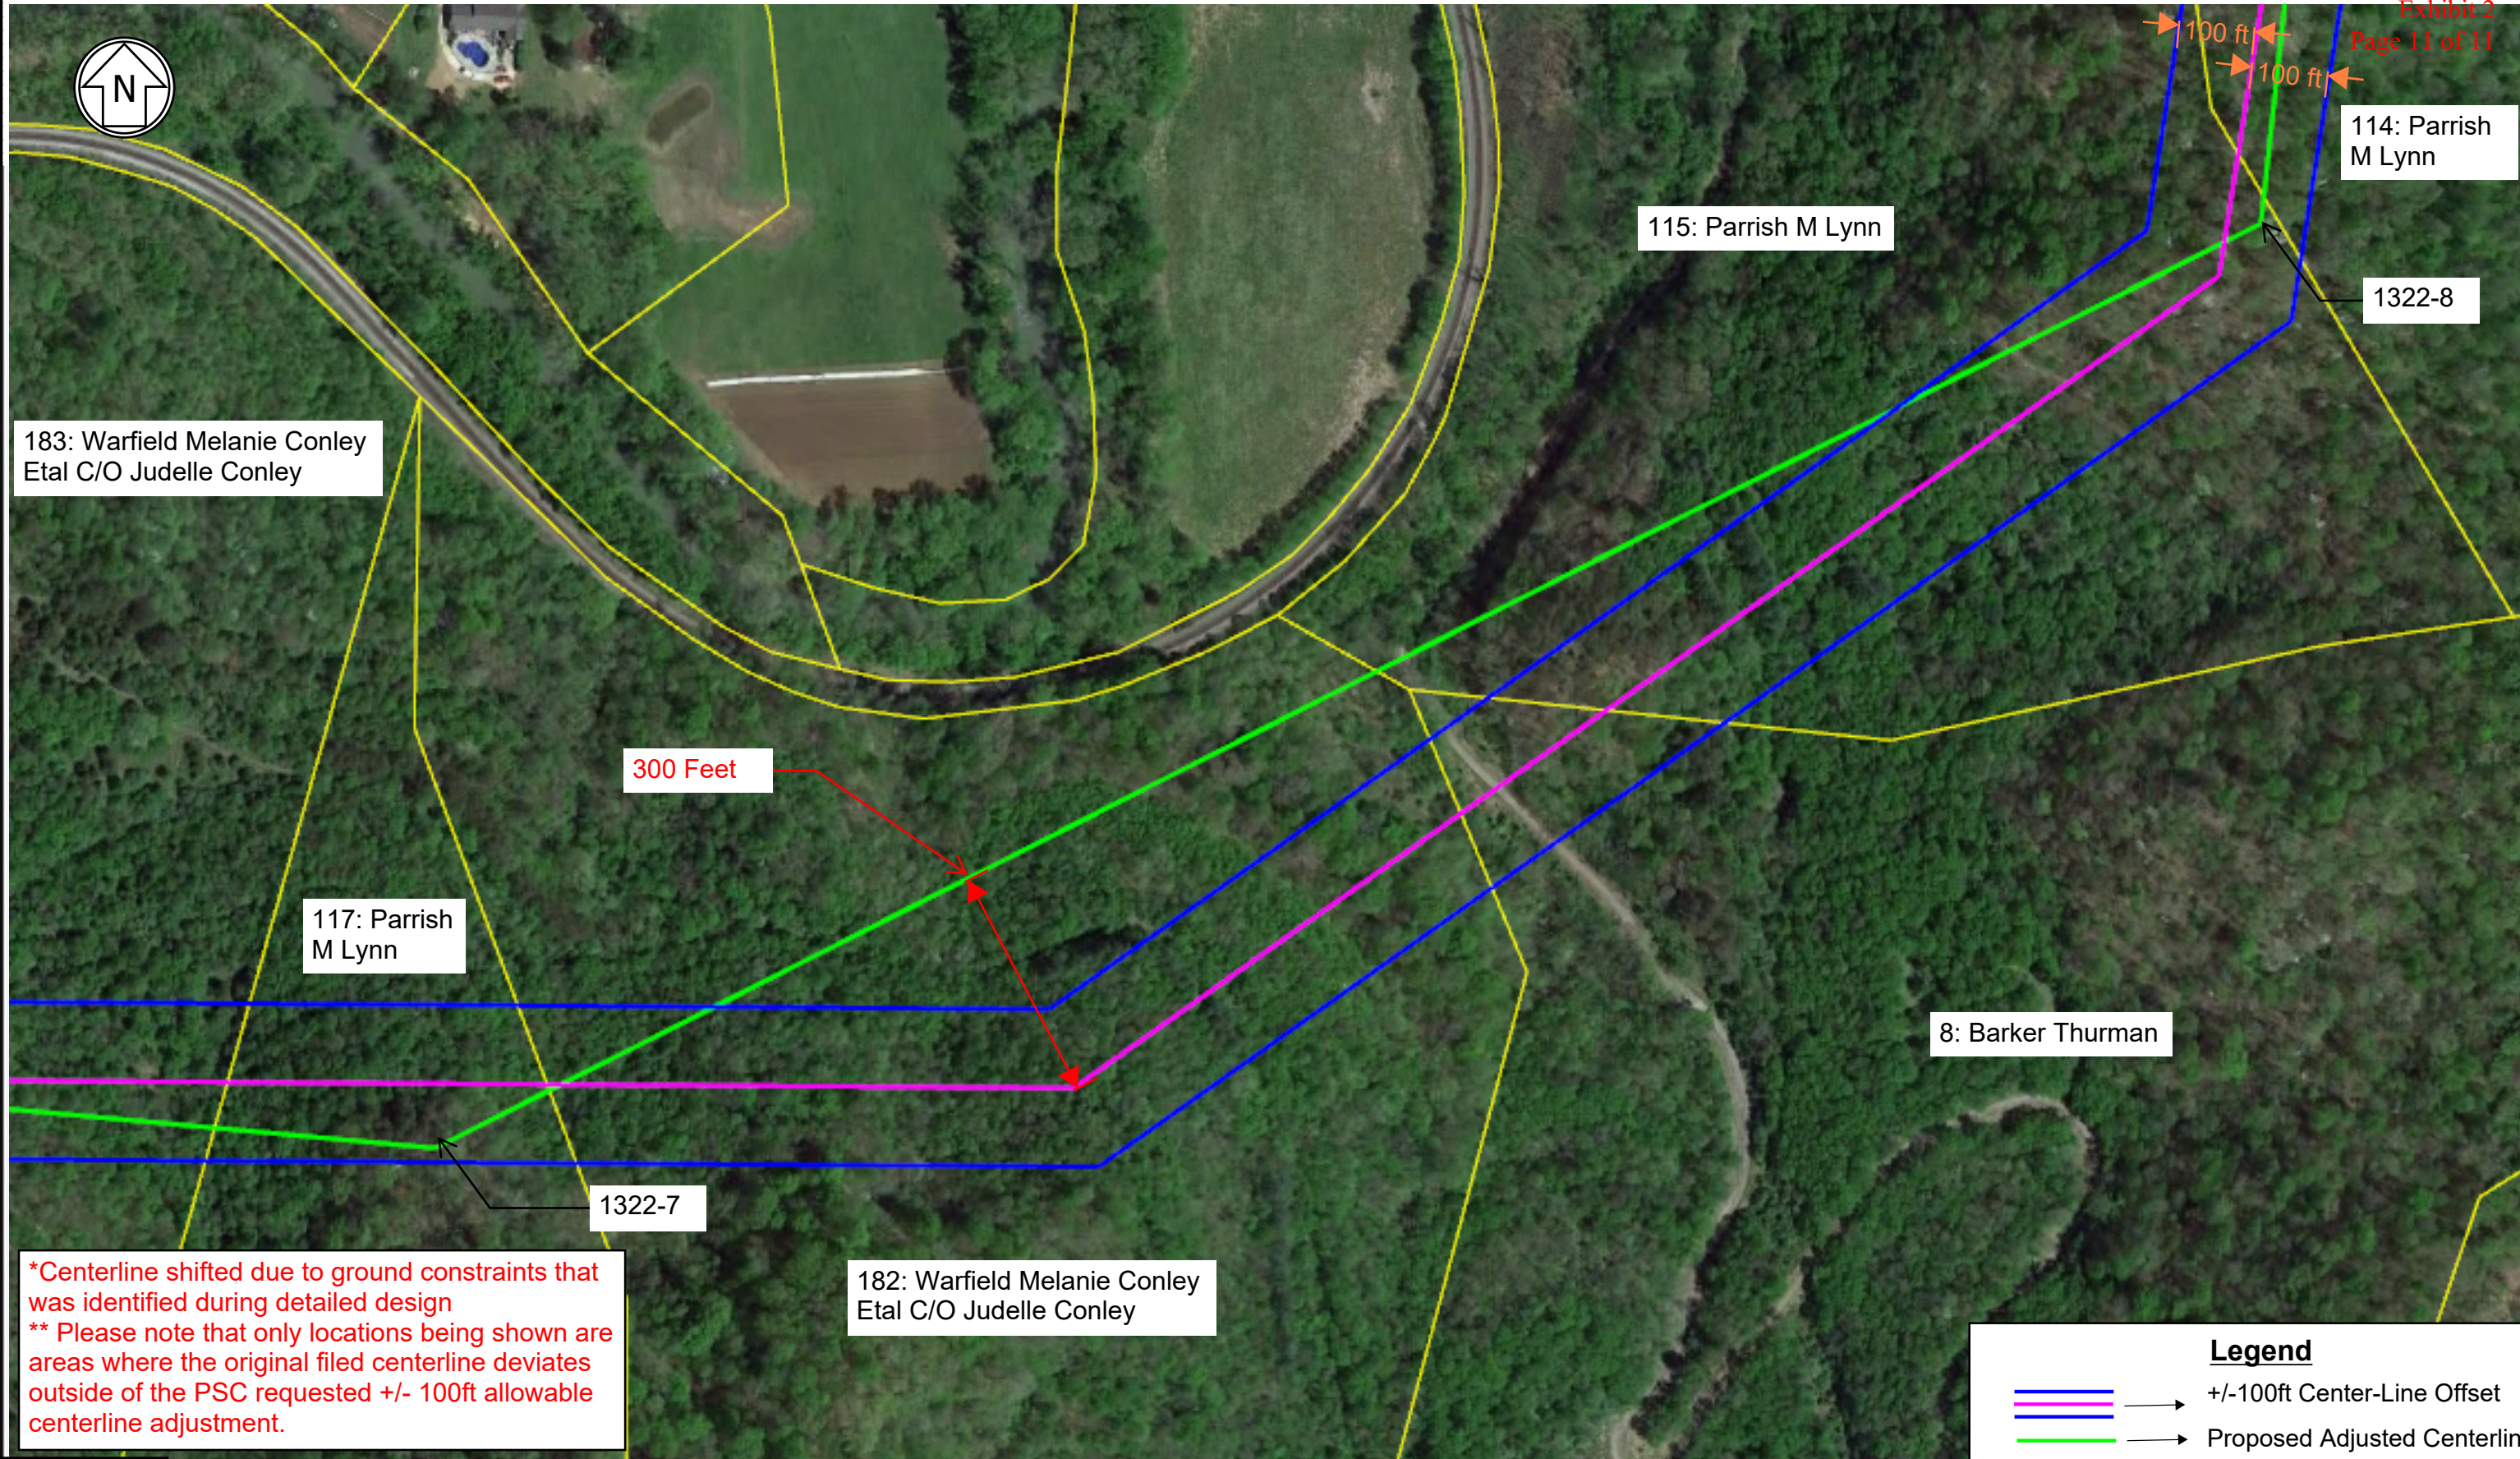

183: Warfield Melanie Conley
Etal C/O Judelle Conley

117: Parrish
M Lynn

115: Parrish M Lynn

114: Parrish
M Lynn

8: Barker Thurman

182: Warfield Melanie Conley
Etal C/O Judelle Conley

1322-7

1322-8

300 Feet

*Centerline shifted due to ground constraints that
was identified during detailed design
** Please note that only locations being shown are
areas where the original filed centerline deviates
outside of the PSC requested +/- 100ft allowable
centerline adjustment.

Legend




-  +/-100ft Center-Line Offset
-  Proposed Adjusted Centerline
-  Garrett Area Parcels



EXHIBIT 3

Sheet #	Property ID	Property Owner Name	Address		NOI Mailed
Sheet 1	19	Bolen, Ernest G. & Mima S.	PO Box 141	Hueysville, KY 41640	Yes -10.25.2021
Sheet 1	19	Bolen, Ernest G. & Mima S.	PO Box 141	Hueysville, KY 41640	Yes -10.25.2021
Sheet 1	91	Kentucky Fuel Corp	302 S. Jefferson St; Suite 400	Roanoke, VA 24011	Yes -10.25.2021
Sheet 2	91	Kentucky Fuel Corp	302 S. Jefferson St; Suite 400	Roanoke, VA 24011	Yes -10.25.2021
Sheet 2	25	Brushy Fork Development LLC	4144 POSSUM TROT RD	Leburn, KY 4831	Yes -10.25.2021
Sheet 2	26	Brushy Fork Development LLC	4144 POSSUM TROT RD	Leburn, KY 4831	Yes -10.25.2021
Sheet 2	174	Unknown			
Sheet 2	175	Unknown			
Sheet 3	41	Coburn Levis HRS; C/O John Coburn	PO Box 853	Mt. Sterling, KY 40353	Yes -10.25.2021
Sheet 3	16	Blackstone Energy LTD	302 S. Jefferson St; Suite 400	Roanoke, VA 24011	Yes -10.25.2021
Sheet 3	144	Shepherd, Max & Elva	408 S Main St	Wolcottville, IN 46795	Yes -10.25.2021
Sheet 3	34	Chaffins, Allen & Sharon	1325 Saltlick Rd	Hueysville, KY 41640	Yes -10.25.2021
Sheet 3	141	Shepherd, Marvin & Janet	5406 HWY 2029	Hueysville, KY 41640	Yes -10.25.2021
Sheet 3	24	Bradley, Leslie Alan	425 Lick Fork Rd	Hueysville, KY 41640	Yes -10.25.2021
Sheet 3	90	Hutchinson, Wanda	135 Wells Hill Lane	West Liberty, KY 4475	Yes -10.25.2021
Sheet 3	36	Chaffins, Sharon	1325 Saltlick Rd	Hueysville, KY 41640	Yes -10.25.2021
Sheet 3	158	Kentucky Power Company	1645 Winchester Ave	Ashland, KY 41101	Yes -10.25.2021
Sheet 3	142	Shepherd, Max	408 S. Main St	Wolcottville, IN 46795	Yes -10.25.2021
Sheet 3	143	Shepherd, Max	408 S. Main St	Wolcottville, IN 46795	Yes -10.25.2021
Sheet 3	139	Shepherd, Faye	PO Box 415	Garrett, KY 41630	Yes -10.25.2021
Sheet 4	68	Gunnell, Joe & Joyce, Rebecca & Creighton, Mike	4433 Bullfork Rd	Morhead, KY 40351	Yes -10.25.2021
Sheet 4	11	Belding, Sharon A.	213 Jesselin Dr	Lexington, KY 40503	Yes -10.25.2021
Sheet 4	95	Kinhag Development Company LLC KF0260	PO Box 155	Allen, KY 41601	Yes -10.25.2021
Sheet 4	146	Shepherd, Truman	PO Box 665	Prestonsburg, KY 41653	Yes -10.25.2021
Sheet 4	160	Unknown			
Sheet 4	49	Conley, Jackie R. & Jennifer	276 Howard Branch	Garrett, KY 41630	Yes -10.25.2021
Sheet 4	157	Turner, Sterlin & Wava, Eileen	139 Cherry Lane	Garrett, KY 41630	Yes -10.25.2021
Sheet 4	51	Conley, Wenda H.	347 Howard Branch	Garrett, KY 41630	Yes -10.25.2021
Sheet 4	69	Gunnell, Steve & Theda	PO Box 83	Garrett, KY 41630	Yes -10.25.2021
Sheet 5	51	Conley, Wenda H.	347 Howard Branch	Garrett, KY 41630	Yes -10.25.2021
Sheet 5	157	Turner, Sterlin & Wava, Eileen	139 Cherry Lane	Garrett, KY 41630	Yes -10.25.2021
Sheet 5	179	Unknown			
Sheet 5	181	Unknown			
Sheet 5	203	Gunnell, Steve & Theda	PO Box 83	Garrett, KY 41630	Yes -10.25.2021
Sheet 5	74	Hamilton, Geniece	83 Garrett Lane	Garrett, KY 41630	Yes -10.25.2021
Sheet 5	83	Howard, Frank	16540 Elm Sugar Rd	Vanwert OH, 4589	Yes -10.25.2021
Sheet 5	30	Caudill, Glenda	47 Howard Branch	Garrett, KY 41630	Yes -10.25.2021
Sheet 5	145	Shepherd, Truman	PO Box 665	Prestonsburg, KY 41653	Yes -10.25.2021
Sheet 5	109	Oquinn, Danny & Billie	14457 KY Rt 80	Langley, KY 41645	Yes -10.25.2021
Sheet 5	110	Oquinn, Danny & Billie	14457 KY Rt 80	Langley, KY 41645	Yes -10.25.2021
Sheet 5	20	Bolen, Maggie & Nannie, Jane	14250 Hwy 80	Garrett, KY 41630	Yes -10.25.2021
Sheet 6	110	Oquinn, Danny & Billie	14457 KY Rt 80	Langley, KY 41645	Yes -10.25.2021
Sheet 6	20	Bolen, Maggie & Nannie, Jane	14250 Hwy 80	Garrett, KY 41630	Yes -10.25.2021
Sheet 6	97	L&B Oil & Gas Inc	PO Box 219	Harold, KY 41635	Yes -10.25.2021
Sheet 6	22	Boleyn, Minnie H.	94 S. Caboose St.	Garrett, KY 41630	Yes -10.25.2021
Sheet 6	55	Draughn, Homer & Bessie	1803 Barwick Dr.	Lexington, KY 40505	Yes -10.25.2021
Sheet 6	180	Unknown			
Sheet 7	180	Unknown Owner			
Sheet 7	31	Caudill, Janet K.	105 South Ralphs Rd.	Garrett, KY 41630	Yes -10.25.2021
Sheet 7	32	Caudill, Ralph E. & Sha L.	105 South Ralphs Rd.	Garrett, KY 41630	Yes -10.25.2021
Sheet 7	33	Caudill, Ralph Edward	105 South Ralphs Rd.	Garrett, KY 41630	Yes -10.25.2021
Sheet 7	112	Owens, Ronald & Connie	245 S. Ralph Rd.	Garrett, KY 41630	Yes -10.25.2021
Sheet 7	39	Clark, Frank & Dollie Estate - C/O Helen Green	208 Charlotte	Tiffin, OH 44883	Yes -10.25.2021
Sheet 7	62	Fouts, Leona V.	2077 Harden Dr.	Mt. Perry, OH 43760	Yes -10.25.2021
Sheet 7	154	Sturgill Mabre Estate	Unknown	Garrett, KY 41630	Yes -10.25.2021
Sheet 7	147	Simpson, Alice & Faye Collins	9901 Windfall Trace	Louisville, KY 40223	Yes -10.25.2021
Sheet 8	180	Unknown			
Sheet 8	180	Unknown Owner			
Sheet 8	31	Caudill, Janet K.	105 South Ralphs Rd.	Garrett, KY 41630	Yes -10.25.2021
Sheet 8	32	Caudill, Ralph E. & Sha L.	105 South Ralphs Rd.	Garrett, KY 41630	Yes -10.25.2021
Sheet 8	33	Caudill, Ralph Edward	105 South Ralphs Rd.	Garrett, KY 41630	Yes -10.25.2021
Sheet 8	112	Owens, Ronald & Connie	245 S. Ralph Rd.	Garrett, KY 41630	Yes -10.25.2021
Sheet 8	39	Clark, Frank & Dollie Estate - C/O Helen Green	208 Charlotte	Tiffin, OH 44883	Yes -10.25.2021
Sheet 8	62	Fouts, Leona V.	2077 Harden Dr.	Mt. Perry, OH 43760	Yes -10.25.2021
Sheet 8	154	Sturgill Mabre Estate	Unknown	Garrett, KY 41630	Yes -10.25.2021
Sheet 8	147	Simpson, Alice & Faye Collins	9901 Windfall Trace	Louisville, KY 40223	Yes -10.25.2021
Sheet 8	60	Fitzpatrick, Michael & Patricia	17 Bob Campbell Dr.	Garrett, KY 41630	Yes -10.25.2021
Sheet 9	130	Scott Ewing -Estate-, C/O Bruce Scott	PO Box 62	Garrett, KY 41630	Yes -10.25.2021
Sheet 9	78	Hicks, Adam	26 N. River St.	Auxier, KY 4160	Yes -10.25.2021
Sheet 9	131	Scott, Rita Sue	PO Box 197	Garrett, Ky 41630	Yes -10.25.2021
Sheet 9	100	Marcum, Glenn Edwin & Dellaouise	PO Box 234	Garrett, Ky 41630	Yes -10.25.2021
Sheet 9	189	Wright, James & Monette	9757 Mortenvue Dr.	Taylor, MI 48180	Yes -10.25.2021
Sheet 9	12	Bentely, Bryon	PO Box 29	Farmers, KY 40319	Yes -10.25.2021
Sheet 10	100	Marcum, Glenn Edwin & Dellaouise	PO Box 234	Garrett, KY 41630	Yes -10.25.2021
Sheet 10	12	Bentely, Bryon	PO Box 29	Farmers, KY 40319	Yes -10.25.2021
Sheet 10	54	DLT Enterprises INC	PO Box 1590	Martin, KY 41649	Yes -10.25.2021
Sheet 10	101	Martin, S.D. Mrs, C/O Willie Martin	3023 KY Rt 122	Printer, KY 41655	Yes -10.25.2021
Sheet 10	119	Patton, Judge & Sylvia	PO Box 14	Garrett, KY 41630	Yes -10.25.2021
Sheet 11	183	Warfield Melanie Conley Etal C/O Judelle Conley	1865 Gayle Dr.	Lexington, KY 40505	Yes -10.25.2021
Sheet 11	117	Parrish, M. Lynn	PO Box 2096	Pikeville, KY 41501	Yes -10.25.2021

Sheet #	Property ID	Property Owner Name	Address		NOI Mailed
Sheet 11	182	Warfield Melanie Conley Etal C/O Judelle Conley	1865 Gayle Dr.	Lexington, KY 40505	Yes -10.25.2021
Sheet 11	8	Barker, Thurman	PO Box 2146	Pikeville, KY 41501	Yes -10.25.2021
Sheet 11	115	Parrish, M. Lynn	PO Box 2096	Pikeville, KY 41501	Yes -10.25.2021
Sheet 11	114	Parrish M. Lynn	PO Box 2096	Pikeville, KY 41501	Yes -10.25.2021