

July 25, 2022

Ms. Linda Bridwell  
Executive Director  
Public Service Commission  
PO Box 615  
Frankfort, KY 40602

RE: Case No. 2022-00054  
Beech Grove Water System, Inc.  
Amended Response to Staff Report of July 19, 2022


Dear Ms. Bridwell:

Beech Grove Water System, Inc. (the "System") submits the following comments concerning the Commission Staff Report dated July 19, 2022 as a replacement to the previous comments submitted on July 22, 2022:

1. Although the System does not agree with the Staff's removal of certain labor expenses from nonrecurring charges, the System does not wish to contest that adjustment in this case. The System's failure to object to Staff's findings and recommendations concerning the reduction of certain Non-Recurring Charges shall not be construed to be a waiver of the System's right to contest a similar finding or recommendation in a future rate proceeding. The System expressly reserves its right to do so.
2. The System requests that the rate for the Bulk Loading Station be set at \$0.25 per thirty-five gallons instead of \$0.00687 per gallon. The system uses an antiquated vending-machine-type device that accepts only one quarter at a time and dispenses a fixed amount of water for that quarter. The vending device is not capable of changes that would allow for the recommended rate of \$0.00687 per gallon.
3. The System concurs with the remainder of findings presented in the Staff Report.
4. The System waives its right to request an informal conference or hearing in this case.

If you need any additional information from the System to expedite implementation of the new rates, please contact our office.

Sincerely,

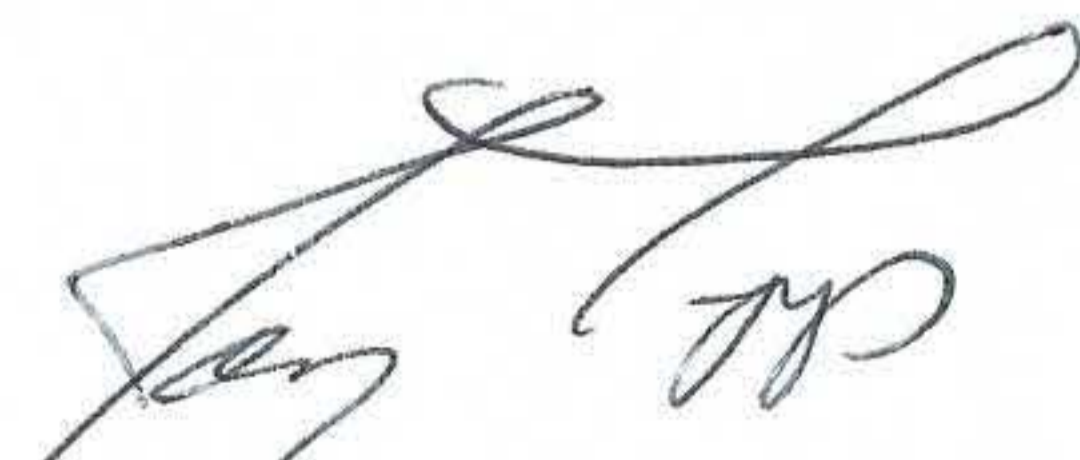

Joey Tapp  
Chairman