


Scanning Batch Sheet

Show Form



JULY (SEP) 09 2019 - 10:08 AM) REC
 Long Island Power Authority
 Program Mfr. Information

Solborne

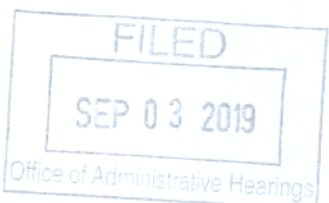

COMMONWEALTH OF KENTUCKY
ENERGY AND ENVIRONMENT CABINET
DIVISION OF ENFORCEMENT
CASE NO. DOW 19-3-0154

IN RE: Bluegrass Water Utility Operating Company, LLC
Longview/Homestead Wastewater Treatment Plant
3243 Frankfort Road
Georgetown, KY 40324
AI No. 8083
Activity ID No. ERF20190001

AGREED ORDER

WHEREAS, the parties to this Agreed Order, the Energy and Environment Cabinet (hereinafter "Cabinet") and Bluegrass Water Utility Operating Company, LLC (hereinafter "BWUOC") state:

STATEMENTS OF FACT

1. The Cabinet is charged with the statutory duty of enforcing KRS Chapter 224 and the regulations promulgated pursuant thereto.
2. BWUOC is an active Kentucky Limited Liability Company in good standing that owns and operates utilities and whose principal address, according to the Kentucky Secretary of State is 500 NW Plaza Drive, Suite 500, Saint Ann, Missouri 63074..
3. Longview/Homestead Wastewater Treatment Plant (hereinafter "Longview WWTP" or "facility"), is located at 3243 Frankfort Road, Georgetown, Kentucky 40324. The facility has a design capacity of 0.100 million gallons per day and discharges to an unnamed tributary to Elkhorn Creek.
4. Longview WWTP is currently owned and operated by LH Treatment Company, LLC. The facility's discharges are permitted under Kentucky Pollutant Discharge Elimination

Systems (hereinafter "KPDES") permit number KY0081591, issued by the Cabinet's Division of Water (hereinafter "DOW"). The facility's KPDES permit expires on June 30, 2024.

5. LH Treatment Company, LLC is an active for-profit Kentucky corporation in good standing, according to the Kentucky Secretary of State.

6. BWUOC has indicated to the Cabinet that it plans to acquire Longview WWTP, provided it receives from the Kentucky Public Service Commission ("Commission") all approvals required to make the acquisition. If the Commission approves the acquisition, BWUOC plans to assume ownership and operation of Longview WWTP on or around September 15, 2019.

7. BWUOC has contracted with a third-party firm to produce an engineering memorandum detailing the status of and repairs needed at Longview WWTP (Exhibit A). This report was submitted to the Cabinet on or about July 29, 2019.

8. If it receives all required Commission approvals, BWUOC has indicated to the Cabinet that it plans to make substantial repairs and/or upgrades to the facility to address the deficiencies noted in Exhibit A.

NOW THEREFORE, in the interest of providing corrective actions to Longview WWTP, the parties hereby consent to the entry of this Agreed Order and agree as follows:

REMEDIAL MEASURES

9. BWUOC shall notify the Cabinet in writing that it has assumed ownership and operation of Longview WWTP within fifteen (15) days of acquiring the facility.

10. Within fifteen (15) days of assuming ownership and operation of the facility, BWUOC shall submit a "Change in Ownership Certification" to the Cabinet.

11. At all times, commencing with assuming ownership of the facility, BWUOC shall provide for proper operation and maintenance of the facility in accordance with 401 KAR 5:065

Section 2(1).

12. Following the initial ninety (90) days of its operation of the facility, BWUOC shall submit to the Cabinet for review and acceptance, a written Corrective Action Plan (hereinafter "CAP") to bring the facility into compliance with its KPDES permit and correct the deficiencies noted in Exhibit A. The CAP shall include, but not be limited to, an identification of actions BWUOC shall implement to ensure compliance that includes; proper operation and maintenance to its sewage treatment system, collection system, and disinfection unit. The CAP shall also include a list of all actions necessary to ensure the completion of upgrades to its facility including a list of completion dates for each action. Include in the CAP a final compliance date for completion of all remedial measures listed;

- A. Upon review of the CAP, the Cabinet may, in whole or in part, (1) accept or (2) decline and provide comments to the BWUOC identifying the deficiencies. Upon receipt of Cabinet comments, the BWUOC shall have ninety (90) days to revise and resubmit the CAP for review and acceptance. Upon resubmittal, the Cabinet may, in whole or in part, (1) accept or (2) disapprove and provide comments to the BWUOC identifying the deficiencies. Upon such resubmittal, if the CAP is disapproved, the Cabinet may deem the BWUOC to be out of compliance with this Agreed Order for failure to timely submit the CAP. The parties to this Agreed Order may also agree in writing to further extend the period in which the BWUOC and the Cabinet accept a revised and resubmitted CAP.
- B. The BWUOC may request an amendment of the accepted CAP by writing the Director of the Division of Enforcement at 300 Sower Blvd., Frankfort,

Kentucky 40601 and stating the reasons for the request. If granted, the amended CAP shall not affect any provision of this Agreed Order unless expressly provided in the amended CAP. This does not require an amendment request pursuant to paragraph 20 of this Agreed Order.

C. Upon Cabinet acceptance of all or any part of the CAP, the amended CAP or any accepted part thereof (provided that the accepted part is not dependent upon implementation of any part not yet accepted), shall be deemed incorporated into this Agreed Order as an enforceable requirement of this Agreed Order. This does not require an amendment request pursuant to paragraph 20 of this Agreed Order.

13. So long as BWUOC is in compliance with the terms and conditions of this Agreed Order, the Cabinet's Division of Enforcement agrees to hold any formal enforcement action for numeric permit parameter violations for the KPDES permit described in paragraph 4, in abeyance. Should BWUOC fail to comply with the terms and conditions of this Agreed Order, the Cabinet may seek formal enforcement action that would have otherwise been held in abeyance.

14. By the final compliance date in the accepted CAP, BWUOC shall be in full compliance with its KPDES permit.

15. All submittals required by the terms of this Agreed Order shall be submitted to: Division of Enforcement, Attention: Director, 300 Sower Blvd., Frankfort, Kentucky, 40601.

MISCELLANEOUS PROVISIONS

16. This Agreed Order shall be of no force and effect unless BWUOC assumes ownership and operations of Longview WWTP.

17. This Agreed Order addresses only the items described above. Other than the matters agreed to by entry of this Agreed Order, nothing contained herein shall be construed to waive or to limit any remedy or cause of action by the Cabinet based on statutes or regulations under its jurisdiction and BWUOC reserves its defenses thereto. The Cabinet expressly reserves its right at any time to issue administrative orders and to take any other action it deems necessary that is not inconsistent with this Agreed Order, including the right to order all necessary remedial measures, assess penalties for violations, or recover all response costs incurred, and BWUOC reserves its defenses thereto.

18. This Agreed Order shall not prevent the Cabinet from issuing, reissuing, renewing, modifying, revoking, suspending, denying, terminating, or reopening any permit to BWUOC. BWUOC reserves its defenses thereto, except that BWUOC shall not use this Agreed Order as a defense.

19. BWUOC waives its right to any hearing on the matters admitted herein. However, failure by BWUOC to comply strictly with any or all of the terms of this Agreed Order shall be grounds for the Cabinet to seek enforcement of this Agreed Order in Franklin Circuit Court and to pursue any other appropriate administrative or judicial action under KRS Chapter 224 and the regulations promulgated pursuant thereto.

20. The Agreed Order may not be amended except by a written order of the Cabinet's Secretary or his designee. BWUOC may request an amendment by writing the Director of the Division of Enforcement at 300 Sower Blvd., Frankfort, Kentucky 40601, and stating the reasons for the request. If granted, the amended Agreed Order shall not affect any provision of this Agreed Order unless expressly provided in the amended Agreed Order.

21. The Cabinet does not, by its consent to the entry of this Agreed Order, warrant or

aver in any manner that BWUOC's complete compliance with this Agreed Order will result in compliance with the provisions of KRS Chapter 224 and the regulations promulgated pursuant thereto. Notwithstanding the Cabinet's review and approval of any plans formulated pursuant to this Agreed Order, BWUOC shall remain solely responsible for compliance with the terms of KRS Chapter 224 and the regulations promulgated thereto, this Agreed Order, and any permit and compliance schedule requirements.

22. BWUOC shall give notice of this Agreed Order to any purchaser, lessee or successor in interest prior to the transfer of ownership and/or operation of any part of the facility occurring prior to termination of this Agreed Order, shall notify the Cabinet that such notice has been given, and shall follow all statutory requirements for a transfer.

23. This Agreed Order applies specifically and exclusively to the unique facilities referenced herein and is inapplicable to any other facility.

24. Compliance with this Agreed Order is not conditional on the receipt of any federal, state, or local funds.

25. This Agreed Order shall be of no force and effect unless and until it is entered by the Secretary or his designee as evidenced by his signature thereon. If this Agreed Order contains any date by which BWUOC is to take any action or cease any activity, and the Secretary enters the Agreed Order after that date, then BWUOC is nonetheless obligated to have taken the action or ceased the activity by the date contained in this Agreed Order.

TERMINATION

26. This Agreed Order shall terminate upon BWUOC's completion of all requirements described in this Agreed Order. BWUOC may submit written notice to the Cabinet when it believes all requirements have been performed. The Cabinet shall notify BWUOC in writing whether it

concur that all requirements of this Agreed Order have been completed. The Cabinet reserves its right to enforce this Agreed Order, and BWUOC reserves its right to file a petition for hearing pursuant to KRS 224.10-420(2) contesting the Cabinet's determination.

CASE NO. DOW 19-3-0154

AGREED TO BY:




Josiah Cox, President
Bluegrass Water Utility Operating Company, LLC




Date

APPROVAL RECOMMENDED BY:




Michael B. Kroeger, Director
Division of Enforcement

8/27/19
Date



John G. Horne II, Executive Director
Office of General Counsel
Energy and Environment Cabinet

8/27/19
Date




R. Bruce Scott, Deputy Secretary
Energy and Environment Cabinet

8/28/19
Date

ORDER

Wherefore, the foregoing Agreed Order is entered as the final Order of the Energy and Environment Cabinet this 3rd day of September, 2019.

ENERGY AND ENVIRONMENT CABINET


SCOTT W. BRINKMAN, SECRETARY of the
GOVERNOR'S EXECUTIVE CABINET

CERTIFICATE OF SERVICE

I hereby certify that a true and accurate copy of the foregoing **AGREED ORDER** was mailed, postage prepaid, to the following this 3rd day of September, 2019.

Bluegrass Water Utility Operating Company, LLC
Attn: Jacon Freeman
500 NW Plaza Drive, Suite 500
Saint Ann, MO 63074

And mailed, messenger to:

Michael B. Kroeger, Director
Division of Enforcement
300 Sower Blvd.
Frankfort, Kentucky 40601

John G. Horne II, Executive Director
Office of General Counsel
Energy and Environment Cabinet
300 Sower Blvd.
Frankfort, Kentucky 40601



DOCKET COORDINATOR

Distribution:

DCW
BGD
SH
FBT

Exhibit A

Civil Engineering
Surveying & Mapping
Potable Water
Wastewater Treatment



Civil Site Design
Construction Support
Transportation
Wastewater Collection

LH Treatment-Kentucky (Wastewater, KY0081591)
Engineering Memorandum
Date: February 17, 2019

Wastewater Treatment Facility Understanding

The wastewater treatment facility is made up of a standard extended aeration activated sludge facility. It doesn't appear this system has an active permit to operate. The permit appears to have expired on December 31, 2018. The plant consists of an aeration tank, clarifier, and chlorine disinfection with dechlorination. (Appendix Picture 1) The facility appears to have a good quality structure, air piping, sludge returns, and capacity to continue to be efficient towards treatment. I performed a quick estimate of capacity and it appears the structures are adequate for the 276 customers currently attached.

A review was performed of EPA's Echo compliance website which lists violations. Prior to July 1, 2017, the system appeared to be a regular offender of violations in regards to effluent limits. It is my understanding they recently completed upgrades to the facility and total performance has improved. However, the system still appears to be exceeding limits but violations are more sporadic. In 2018, the facility violated CBOD, TRC, E. coli, Ammonia, DO and TSS at least once. Understanding that the tankage and piping appears to be efficiently laid out and seems in good quality with adequate capacity, I would tend to believe that the system violations may be more from operational issues rather than capacity of facility.

While the plant appears adequate, there are a few items of concern for the facility. The facility looks relatively new and in reasonable shape. However, the system continues to violate at least one limit each testing period.

The aeration process of the treatment facility appeared to have a reasonable mixed liquor. However, standard operational testing has not been provided to us for evaluation on the operational control of the facility. Daily testing should be completed until an understanding of the facility is clear. Additionally, I'm not aware of the current operator's maintenance practice. The diffusers should be pulled from the tank and inspected in case they have fouled due to not performing preventative maintenance. While the aeration tank mixed liquor looked reasonable, it is obvious consistent operation control is not occurring. (Appendix Picture 2)

The clarifier appears to be working properly. However, the supernatant water of the clarifier appeared to have a large amount of floc releasing and/or coming to the surface. While this might also be an operational issue in regards to control of the mixed liquor and sludge returns, the clarifier is not operating at an optimal level. Allowing floc to discharge the facility can lead to surpassing the limits imposed on the facility. As discussed above, various limits were exceeded in 2018. Avoiding excessive floc in the clarifier is vital in maintaining a healthy facility. Additionally, the effluent trough appears to have some green algae attached to the bottom, which if not cleaned, may build up and cause issues with

CONFIDENTIAL TO CSWR

Civil Engineering
Surveying & Mapping
Potable Water
Wastewater Treatment

21 DESIGN

Civil Site Design
Construction Support
Transportation
Wastewater Collection

effluent samples periodically. The clarifier should be cleaned as well as evaluated for size after actual dimensions and/or as-built drawings are provided. (Appendix Picture 3)

Minimal pictures were provided of the chlorination system that would aid in 21DG providing an opinion of its state. However, the system has violated E. coli and TRC in the past year and they should be evaluated. Again, these violations could be due to poor operational and maintenance practices.

The effluent quality looks clean as it was discharging to the stream. There were no signs of sludge or buildup in the stream. (Appendix Picture 4)

It did not appear any monitoring was in place for this facility. I recommend Mission monitoring be installed for improvement control and access.

It also appeared that the shed needed to be cleaned up. Various supports are not conventional and consist of buckets and wood holding up some piping. Sunlight is also coming through the walls that will tend to let rain into the building. This will allow the building to deteriorate faster than desired. Insulation appears to be failing and should be repaired. The shed should be cleaned up to allow better access and conventional supportive items.

Improvements: Pull and inspect diffusers and possible replacement. Install Mission monitoring. Clean up shed for adequate installation and cleaner environment. Perform operational improvements that will likely allow the facility to return to meeting effluent limits.

Wastewater Collection System Understanding

No information in regards to the collection system was provided to the Engineer for review to drafting this memo. It is recommended to obtain DMRS and/or flow data for the facility from the current owner to evaluate if I and I is a problem. If the owner is knowledgeable on wastewater systems, they may also be able to shed some light on if I and I is a problem. This would be adequate to start our evaluation period until actual flow monitoring and smoke testing of the system is completed. The system does have a flow meter installed at the effluent and it is recommended to get access to the data that is being compiled.

No maps of the system were provided. The system will need to be mapped for future operation as it appeared nothing has been compiled for our review or operational maintenance purposes. The Engineer was not informed if this system was all gravity, pressure, or had any pump stations. The system should also be smoke tested. Video inspection is anticipated on parts of the system as well.

Improvements Required: Map the system. Install a flow meter. Smoke test and video inspect the collection system.



CONFIDENTIAL TO CSWR

Civil Engineering
Surveying & Mapping
Potable Water
Wastewater Treatment


21 DESIGN

Civil Site Design
Construction Support
Transportation
Wastewater Collection


APPENDIX

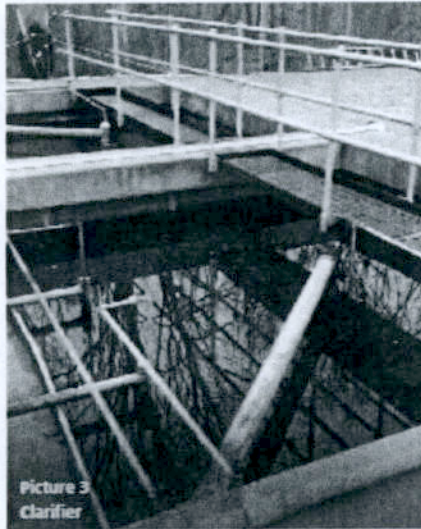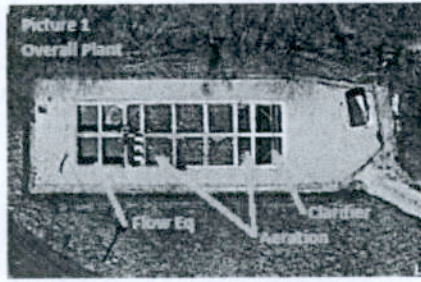


CONFIDENTIAL TO CSWR

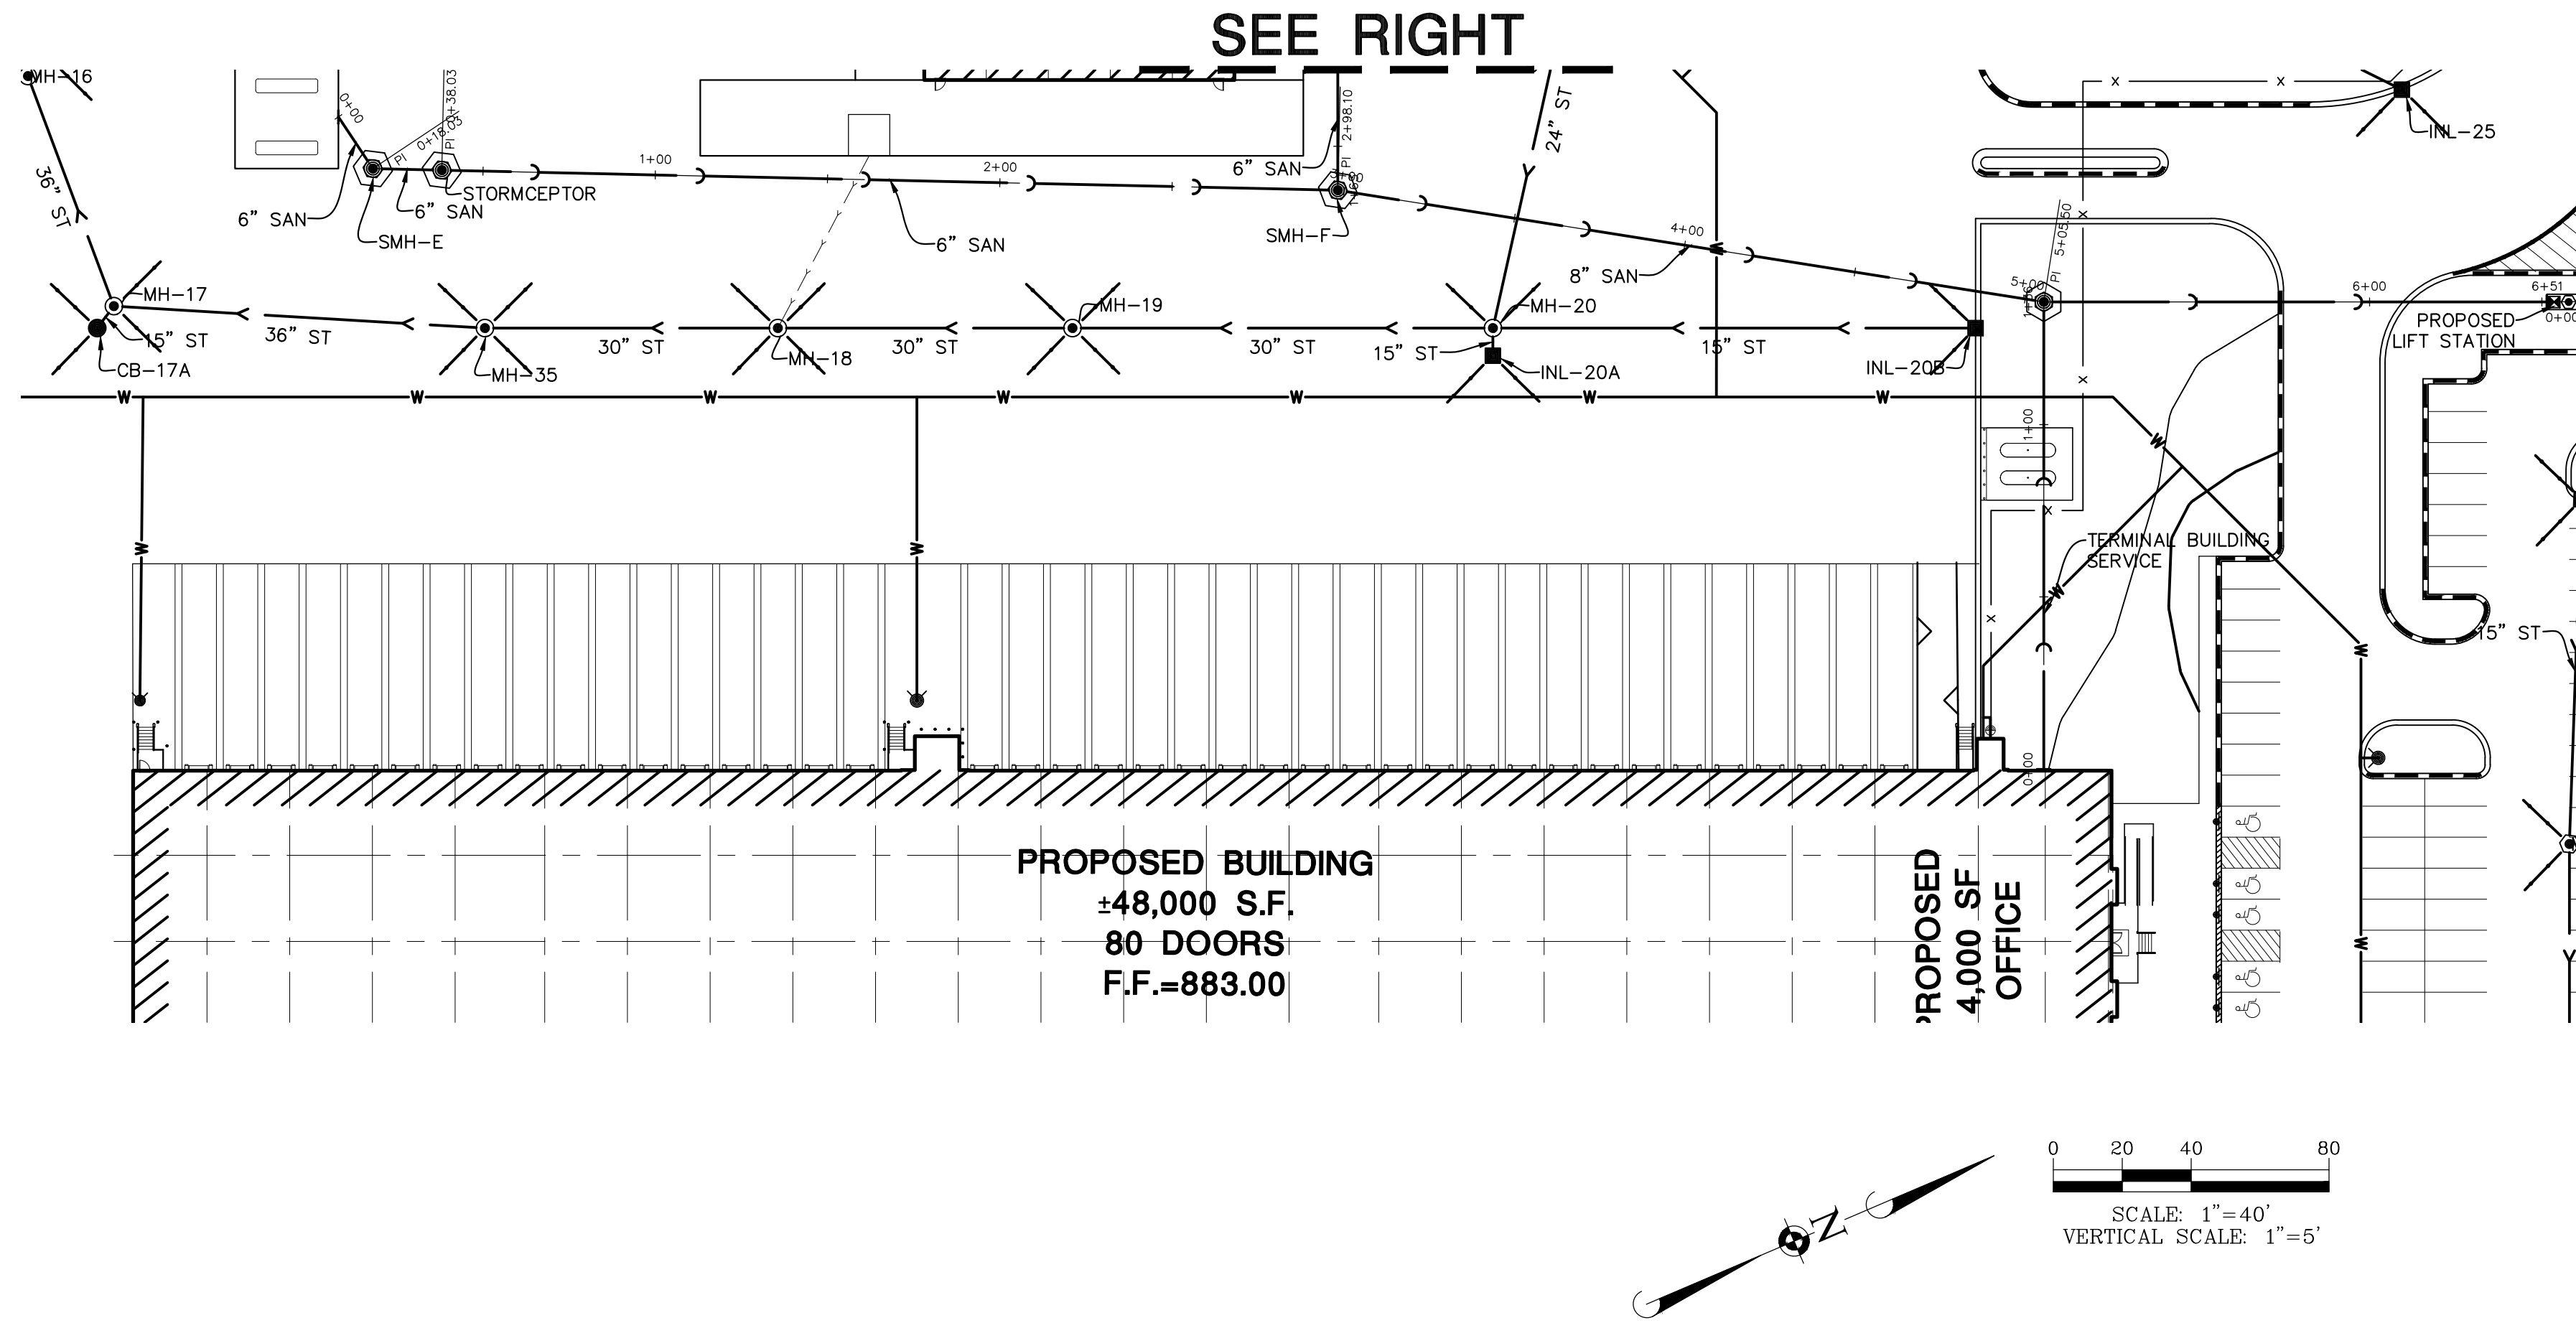


SANITARY SEWER PROFILE TERMINAL BUILDING SERVICE

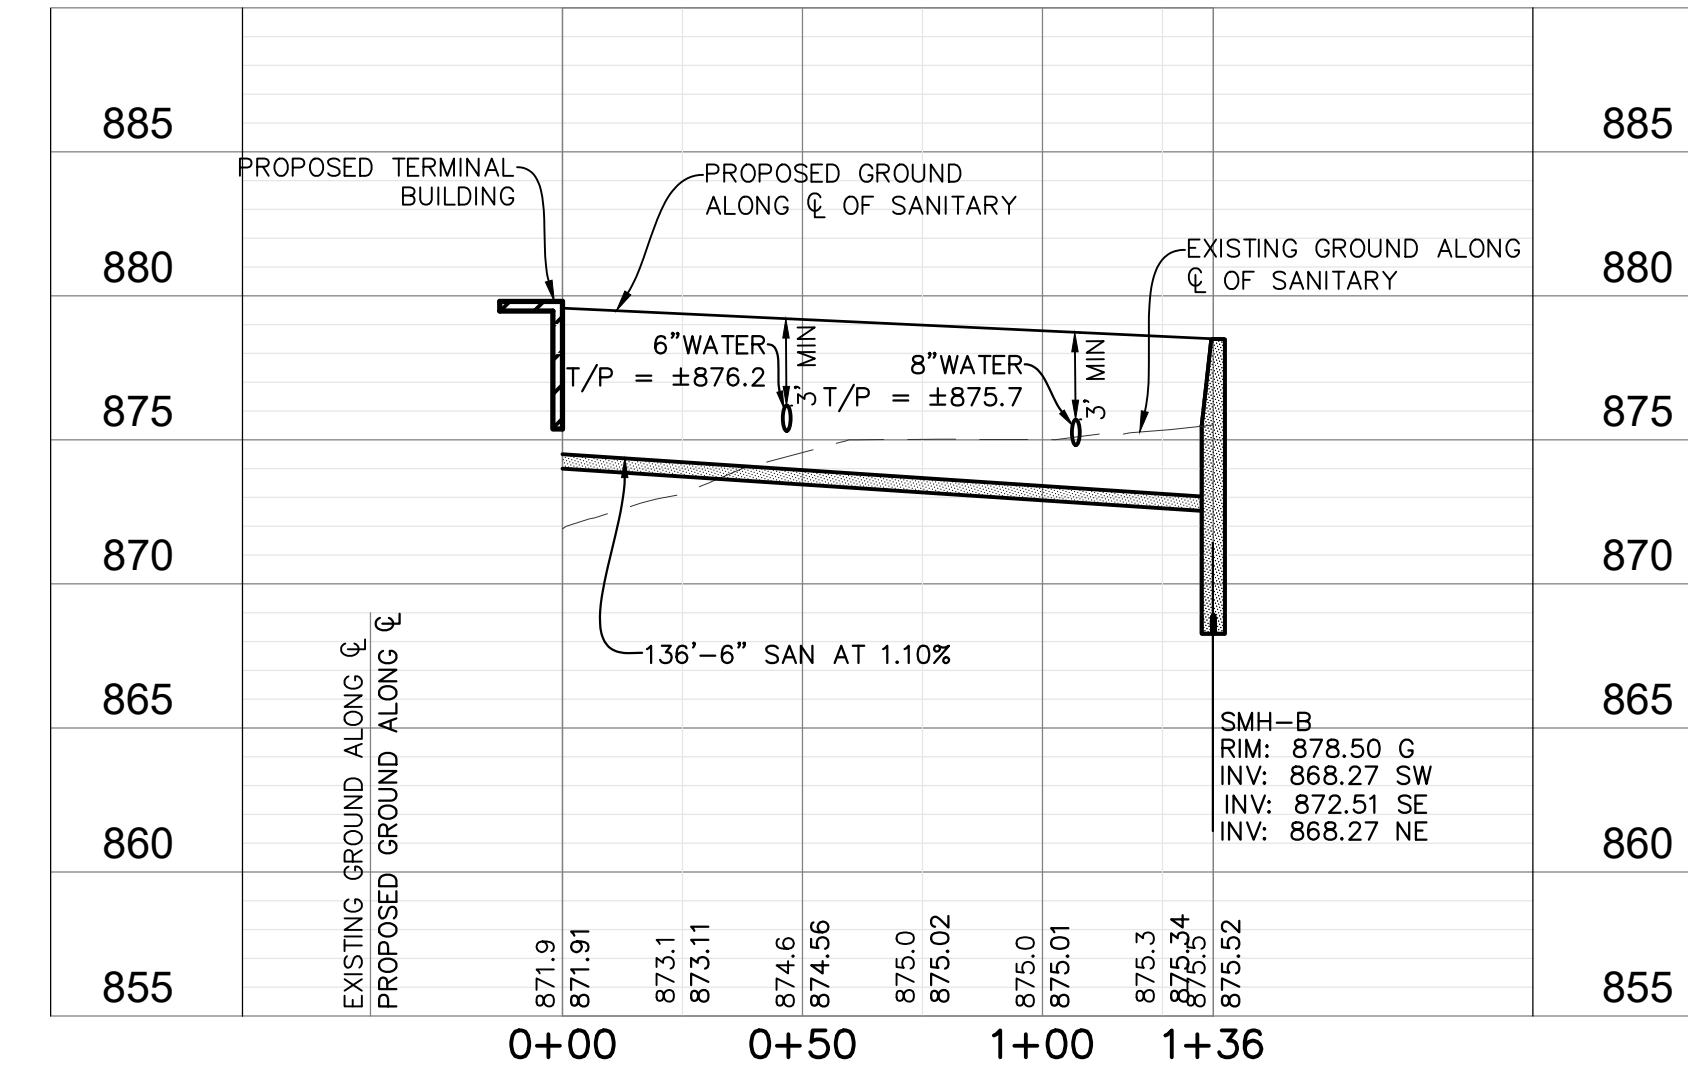

SANITARY SEWER PROFILE SMH E - LIFT STATION

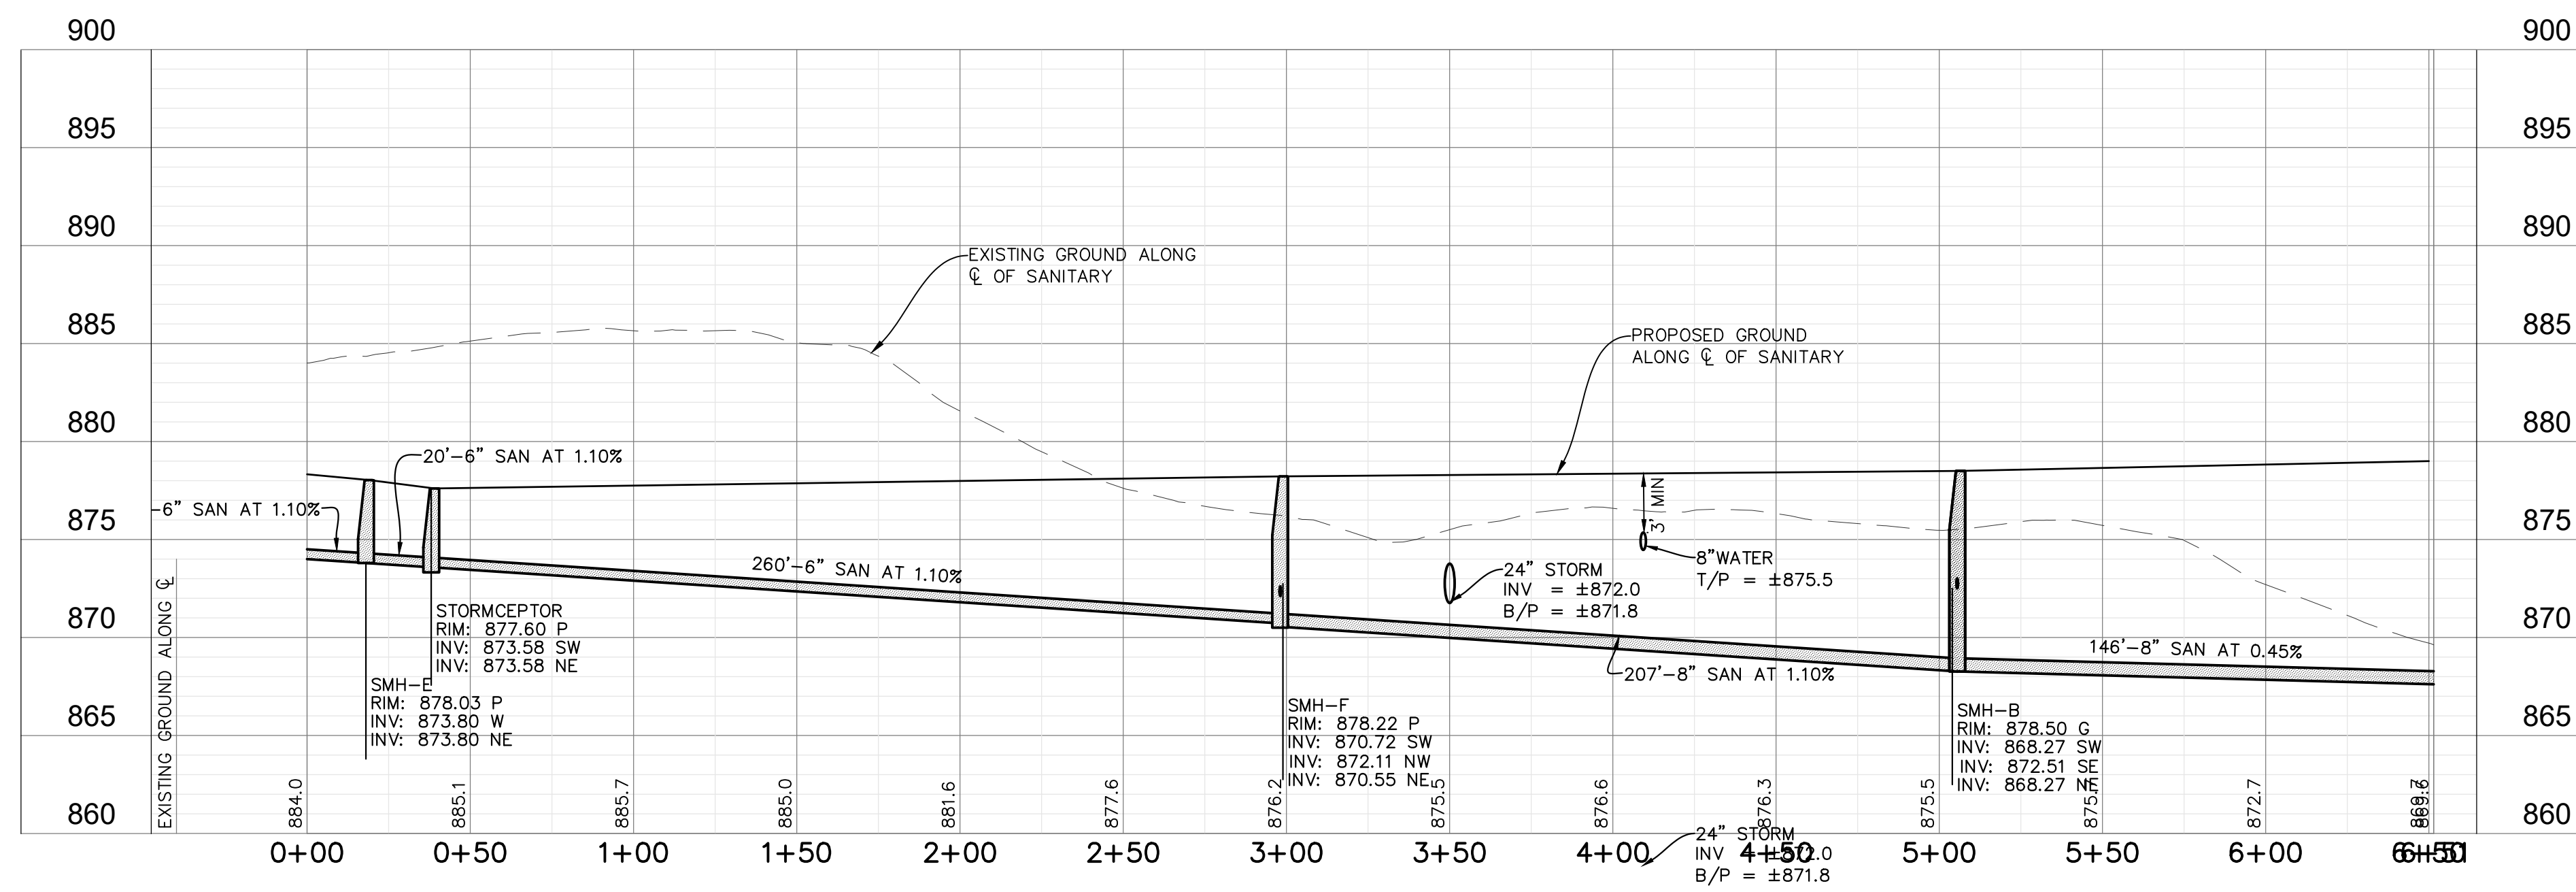

SANITARY SEWER PROFILE SMH G - SMH F

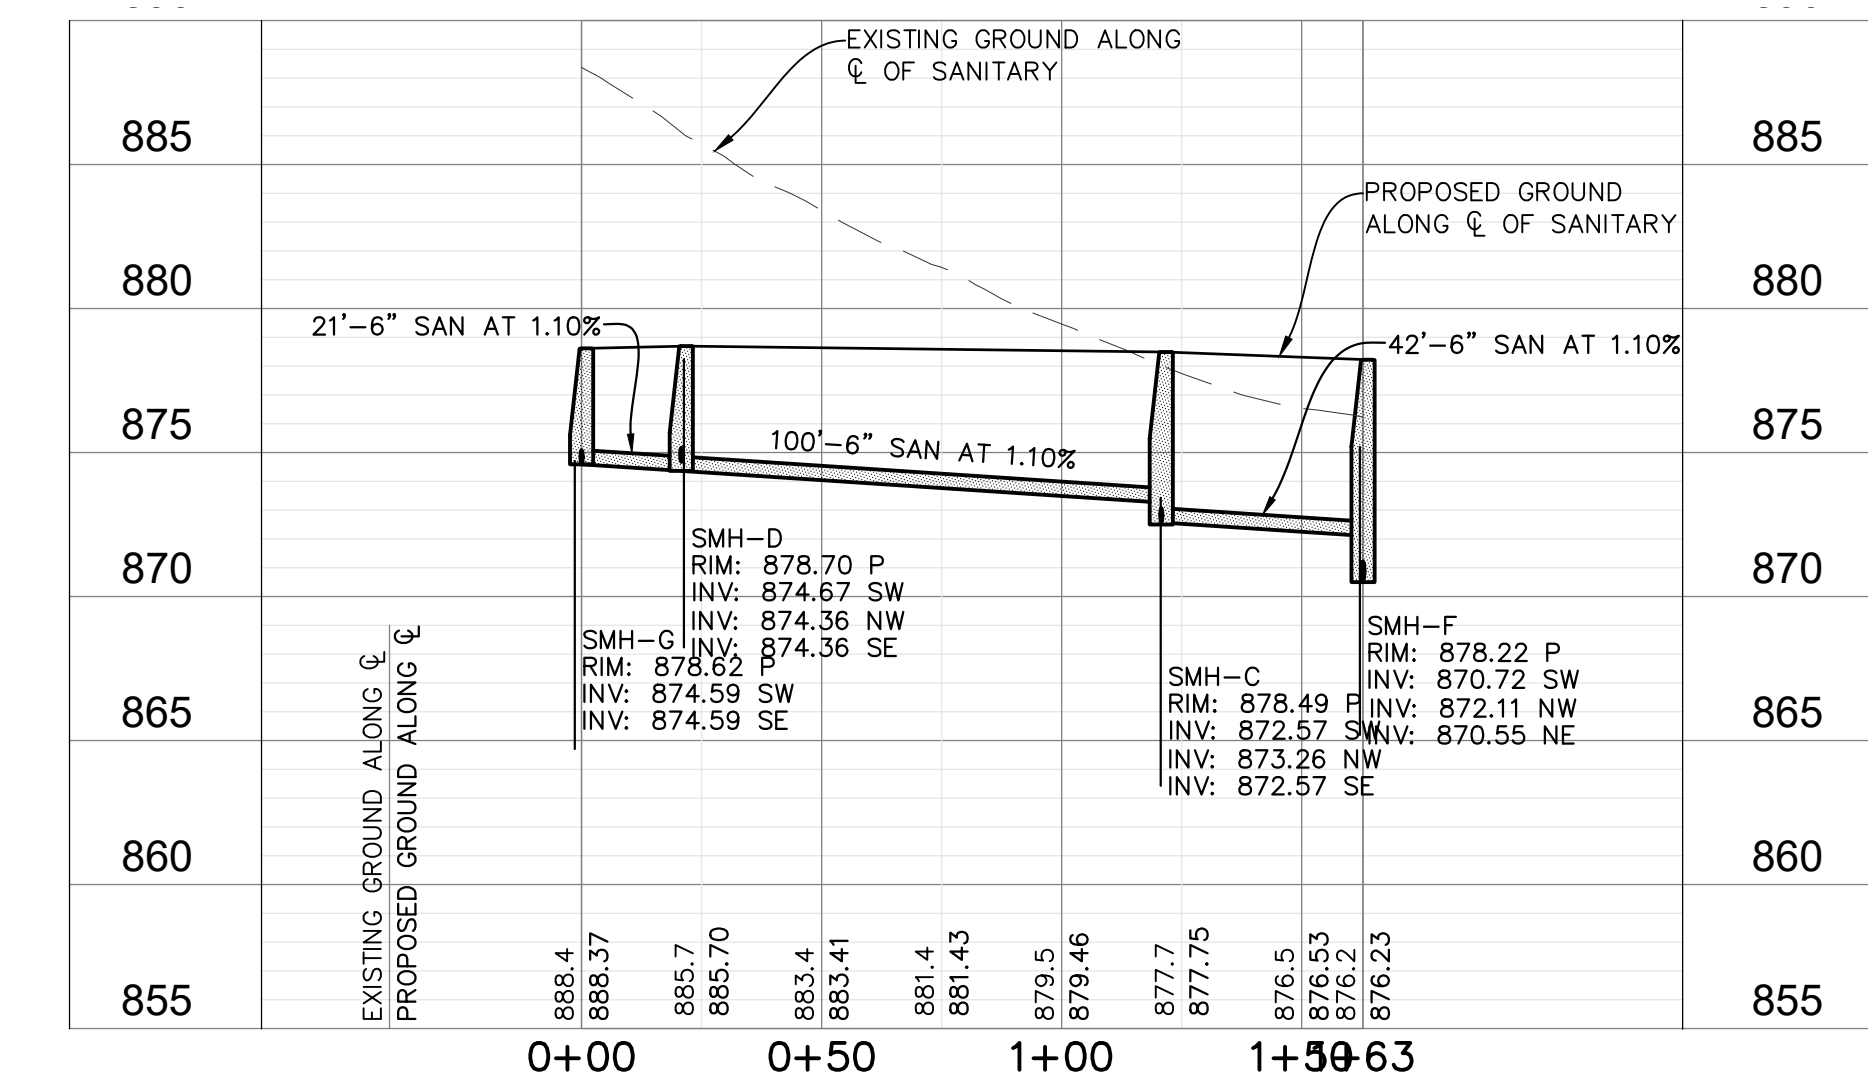



August 15, 2022 - 14:26 - C:\p\proj\2022\01\Drawings\Plan_Sect\20-20-PROFILES.dwg - Updated By: jdonnell

Manhard CONSULTING
 700 Spitzer Drive, Nashville, TN 37208-6601, 615.858.6601, 615.858.6602, 615.858.6603, 615.858.6604, 615.858.6605
 Civil Engineers | Surveyors | Water Resources Engineers | Water & Waste Water Engineers
 Construction Managers | Environmental Scientists | Landscape Architects | Planners




R+L CARRIERS - GEORGETOWN
 CITY OF GEORGETOWN, SCOTT COUNTY, KENTUCKY
 PLAN AND PROFILE - FORCEMAIN

PROJ. MGR.: JMI
 PROJ. ASSOC.: MSP
 DRAWN BY: XL
 DATE: 4/18/2022
 SCALE: ---
 SHEET
33 OF 41
 RLR.GTKY01


FOR REVIEW - NOT FOR CONSTRUCTION

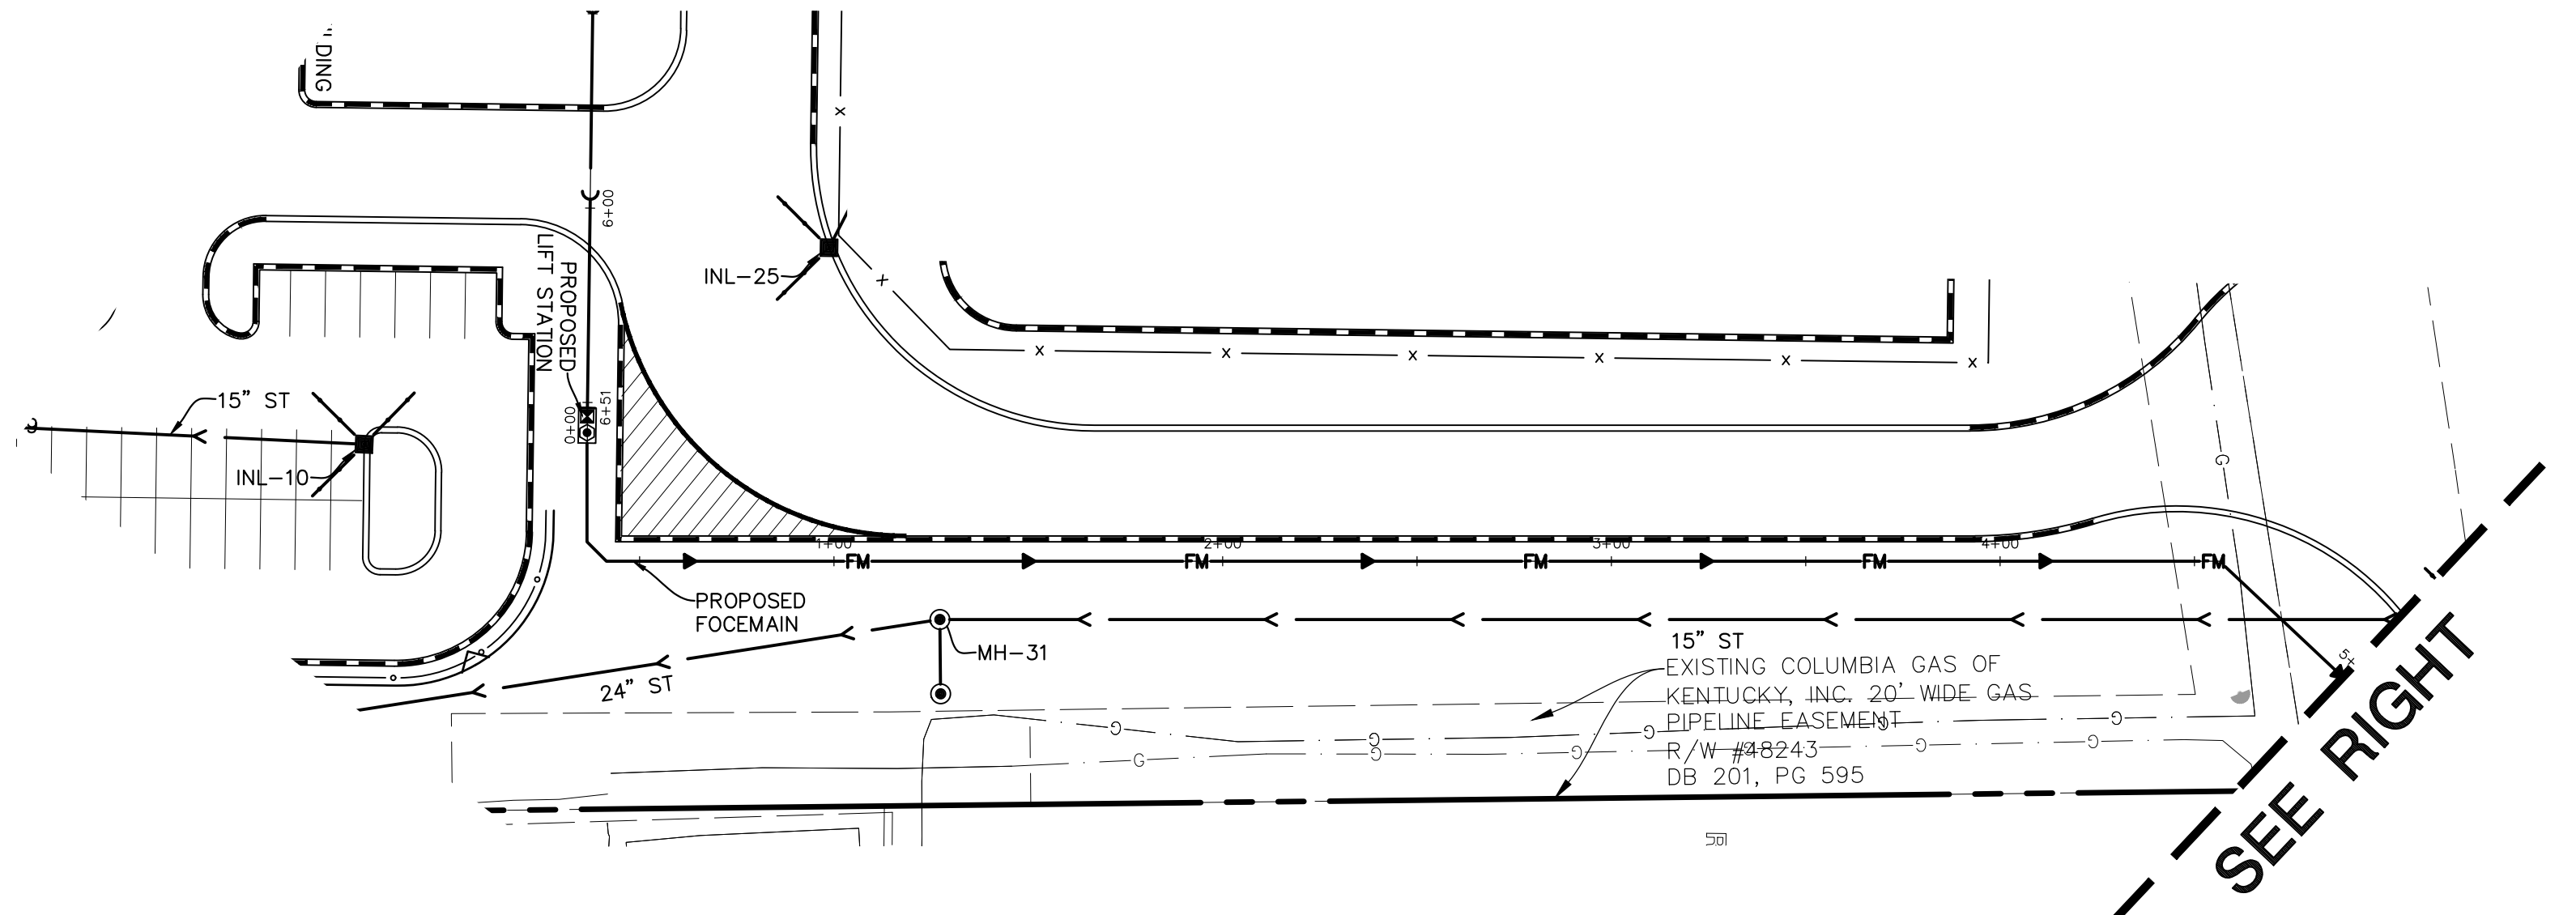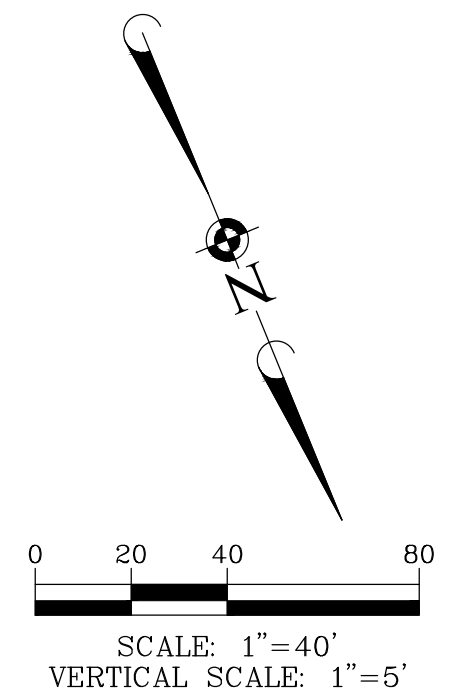

FORCEMAIN PROFILE: STA 0+00-5+50

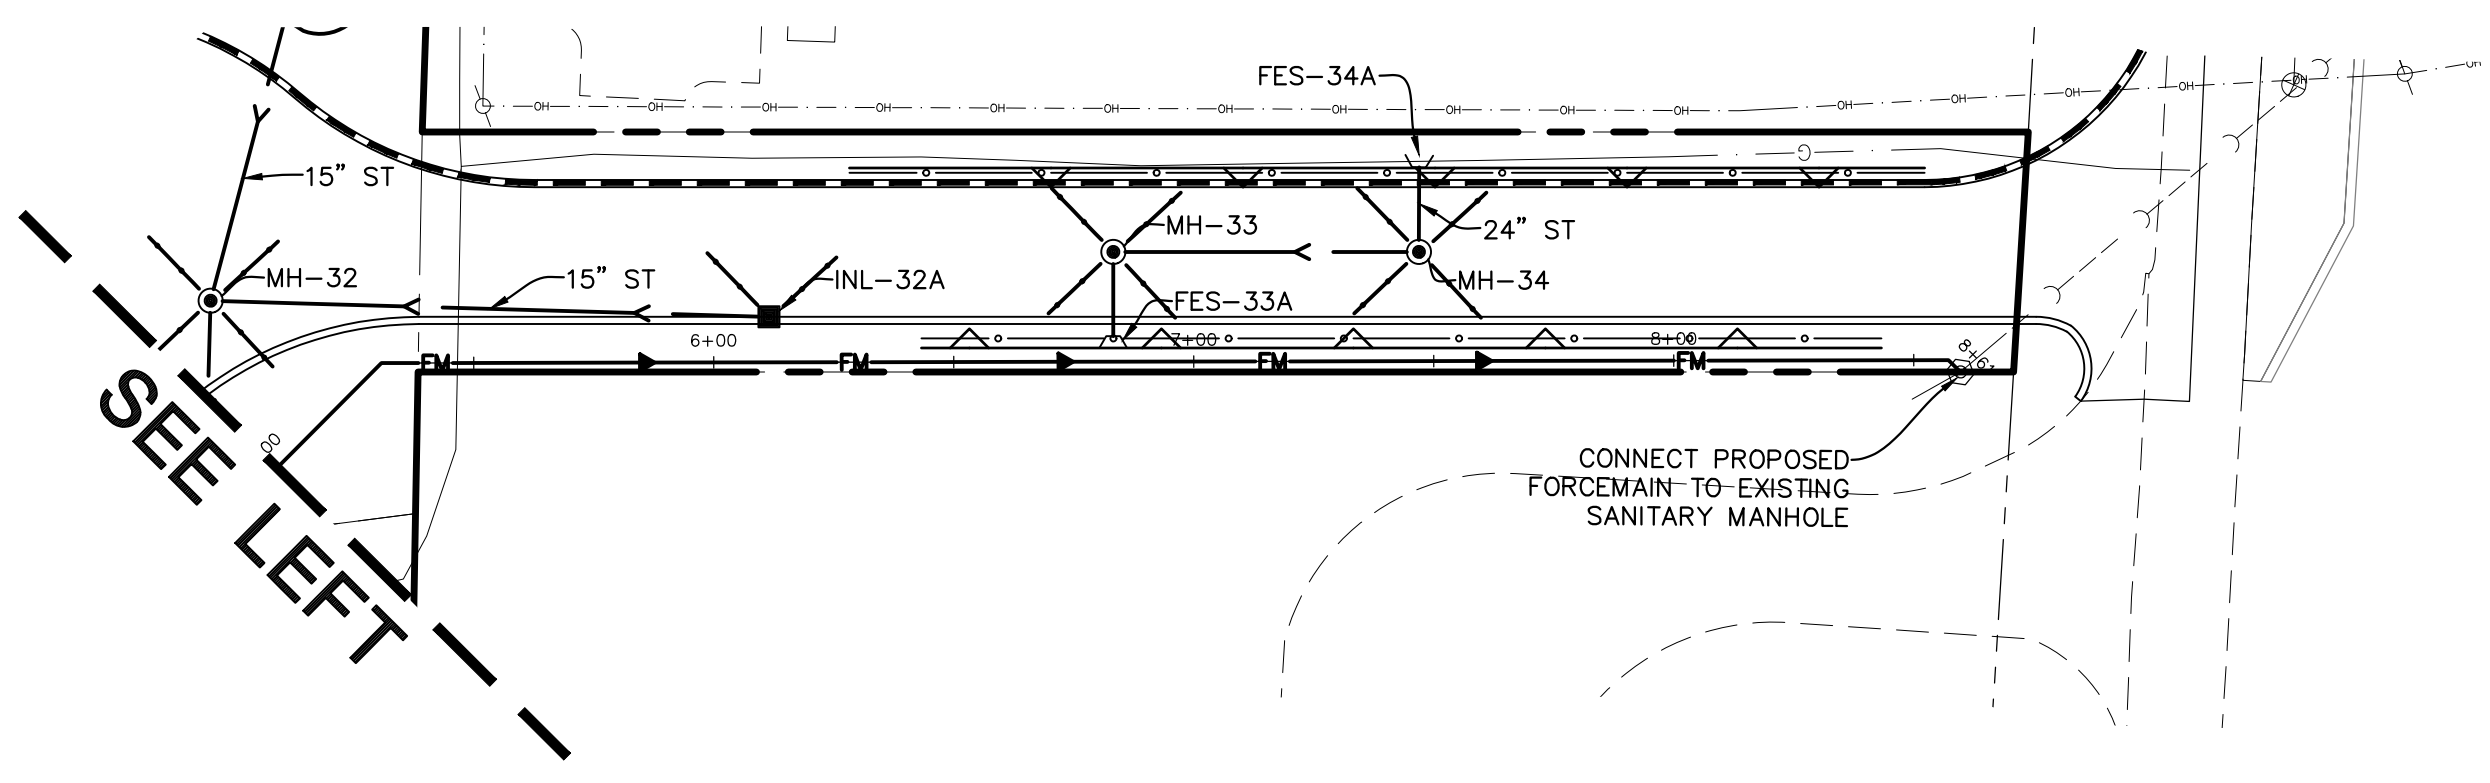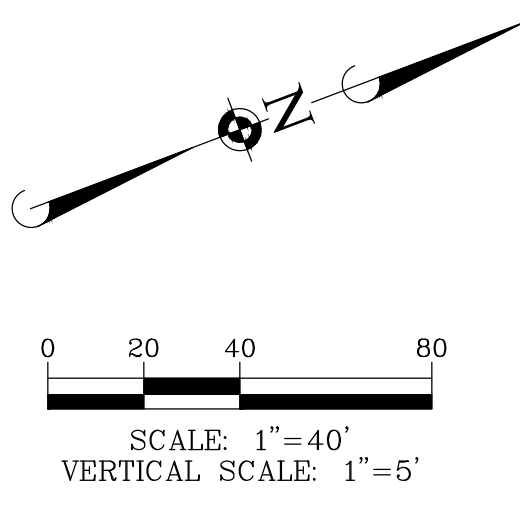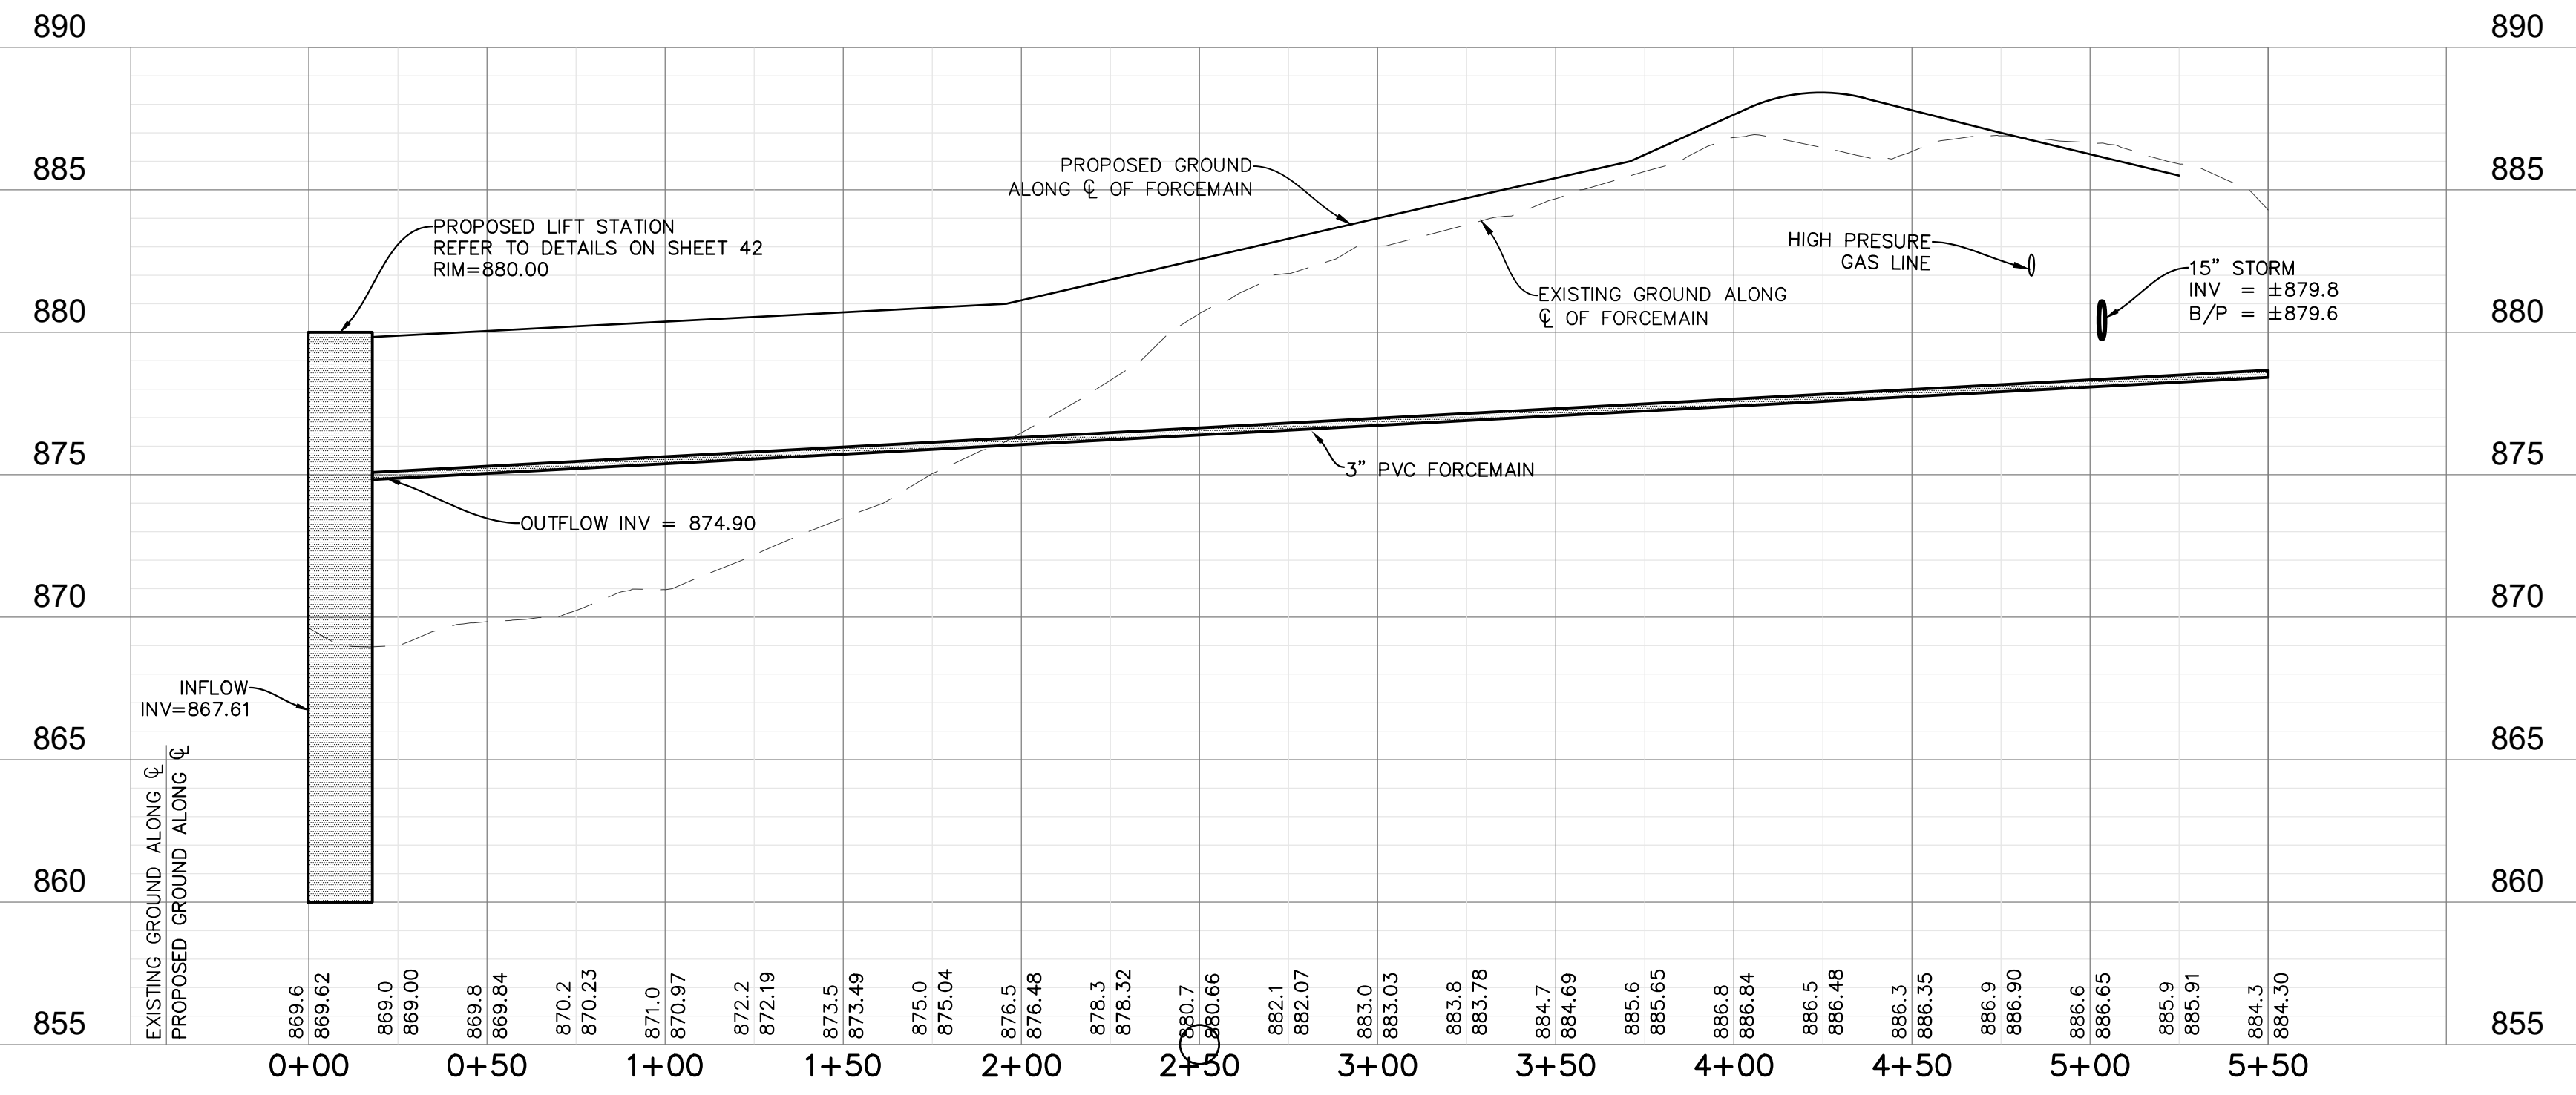

FORCEMAIN PROFILE: STA 5+50-8+86

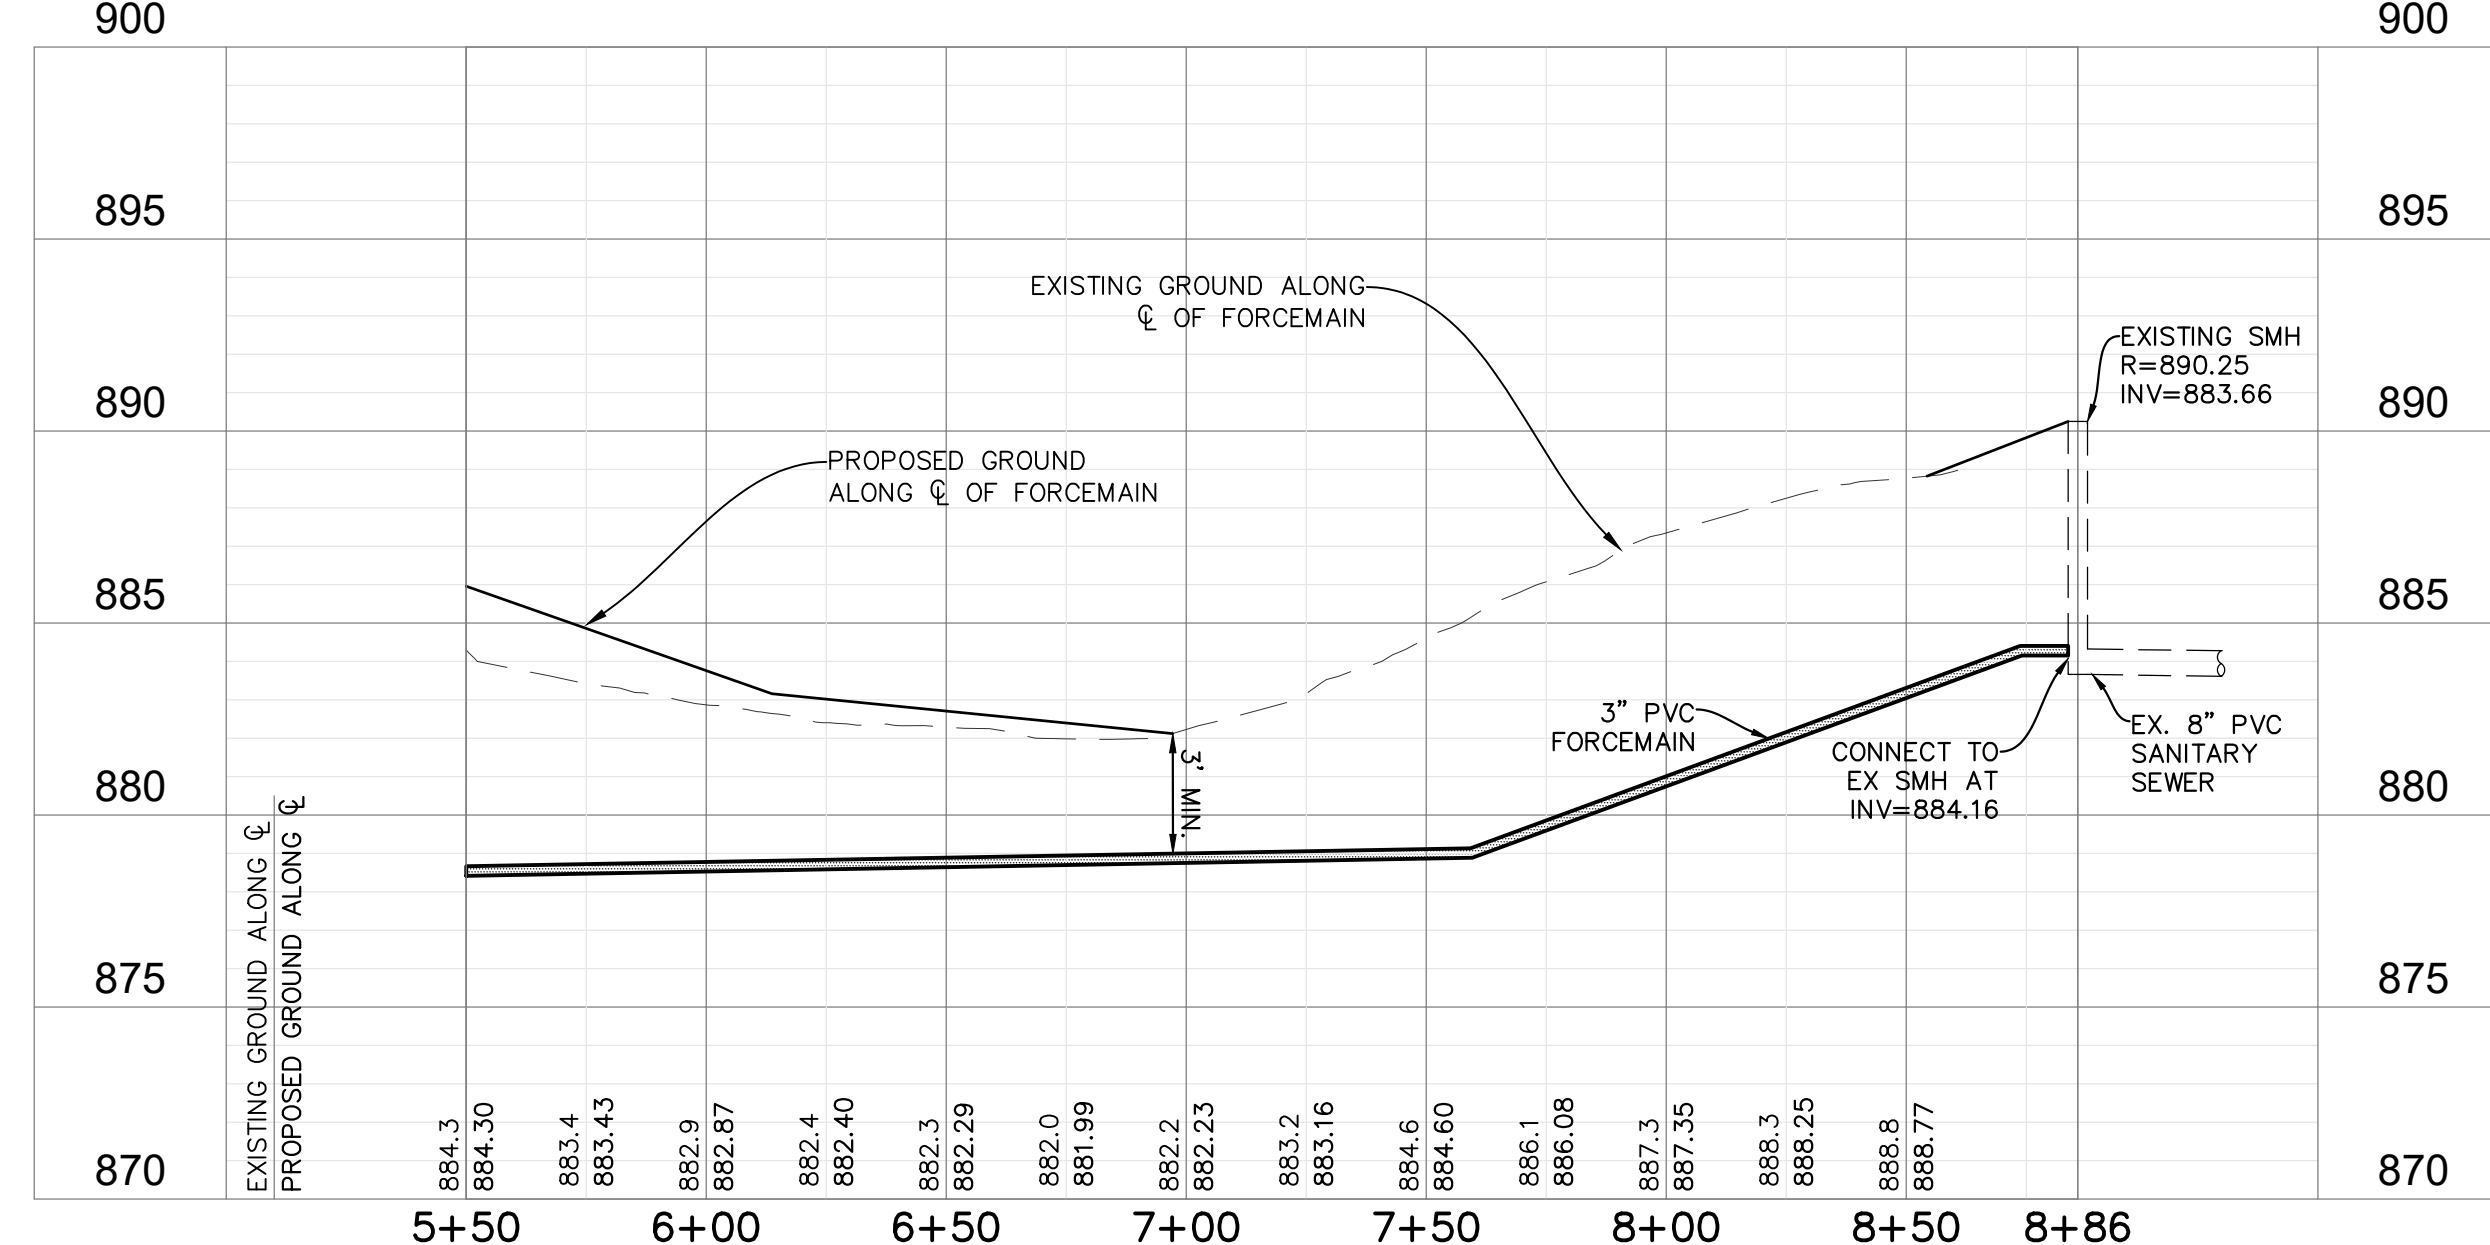

REVISIONS	DATE

Manhard CONSULTING
700 Springfield Drive, Nashville, TN 37217
TEL: 615.269.6611 FAX: 615.269.6611
www.manhard.com
Civil Engineers | Surveyors | Water Resources Engineers | Water & Waste Water Engineers
Construction Managers | Environmental Scientists | Landscape Architects | Planners

R+L CARRIERS - GEORGETOWN
CITY OF GEORGETOWN, SCOTT COUNTY, KENTUCKY
PLAN AND PROFILE - FORCEMAIN

PROJ. MGR.: JMI
PROJ. ASSOC.: MSP
DRAWN BY: JTN
DATE: 4/18/2022
SCALE: H: 1"=40' V: 1"=5'
SHEET **34** OF 41
RLR.GTKY01

FOR REVIEW - NOT FOR CONSTRUCTION

2022 DELAPLAIN DISPOSAL WASTEWATER SYSTEM IMPROVEMENTS

Technical Specifications



Prepared For

Owner:

Central States Water Resources
1650 Des Peres Road, Suite 303
St. Louis, Missouri 63131

Prepared by:

21 Design Group
1351 Jefferson, Suite 301
Washington, MO 63090
636-432-2144

**SECTION 000110
TABLE OF CONTENTS**

SPECIFICATIONS

DIVISION 01 - GENERAL REQUIREMENTS -

- 01 10 00 - Summary
- 01 30 00 - Administrative Requirements
- 01 33 00 - Submittal Procedures
- 01 50 00 - Temporary Facilities and Controls
- 01 57 13 - Temporary Erosion and Sediment Control
- 01 64 00 - Owner Furnished Products
- 01 70 00 - Execution
- 01 78 00 - Closeout Submittals

DIVISION 02 - EXISTING CONDITIONS

- 02 41 00 – Demolition

DIVISION 03 - CONCRETE

- 03 05 10 - Leakage Testing of Hydraulic Structures
- 03 30 00 - Cast-in-Place Concrete

DIVISION 05 - METALS

- 05 12 00 - Structural Steel Framing
- 05 50 00 - Metal Fabrications

DIVISION 09 - FINISHES

- 09 90 00 - Painting and Coating
- 09 90 10 - Painting Schedule

DIVISION 22 - PLUMBING

- 22 11 16 – Domestic Water Piping
- 22 11 19 – Domestic Water Piping Specialties
- 22 13 16 – Sanitary Waste and Vent Piping
- 22 13 29 – Sump Pumps

DIVISION 26 – ELECTRICAL

- 26 05 10 - Common Motor Requirements
- 26 05 19 - Low-Voltage Electrical Power Conductors and Cables
- 26 05 33 - Raceway and Boxes for Electrical Systems
- 26 22 00 - Low-Voltage Transformers
- 26 24 16 - Panelboards
- 26 27 26 - Wiring Devices
- 26 28 16 - Enclosed Switches and Circuit Breakers
- 26 29 13 - Enclosed Controllers
- 26 29 23 - Variable-Frequency Motor Controllers
- 26 36 00 - Transfer Switches
- 26 56 19 - LED Exterior Lighting

DIVISION 31 - EARTHWORK

- 31 20 00 - Earth Moving
- 31 23 33 - Trenching and Backfilling

DIVISION 32 - EXTERIOR IMPROVEMENTS

- 32 15 40 - Crushed Stone Paving
- 32 31 13 - Steel Chain Link Fences and Gates
- 32 92 19 - Seeding

DIVISION 33 - UTILITIES

- 33 05 16 - Precast Concrete Utility Structures
- 33 31 00 - Sanitary Sewer Systems
- 33 32 16 - Wastewater Pumping Systems

DIVISION 40 - PROCESS INTEGRATION

- 40 05 00 - General Piping Requirements
- 40 05 15 - Pressure Testing of Piping
- 40 05 20 - Miscellaneous Process Valves
- 40 05 24 - Valves, General
- 40 05 26 – IFAS Cages
- 40 05 62 - Plug Valves
- 40 05 63 - Ball Valves
- 40 05 66 - Butterfly Valves
- 40 05 67 - Check Valves for Specific Applications
- 40 07 11 - Miscellaneous Pipe Fittings and Accessories
- 40 07 22 - Flexible Pipe Couplings and Expansion Joints
- 40 07 62 - Wall Pipes, Seep Rings, and Penetrations
- 40 07 64 - Pipe Hangers and Supports
- 40 20 40 - Ductile Iron Process Pipe
- 40 20 76 - Carbon & Stainless Steel Pipe
- 40 20 90 - PVC & CPVC (3 Inches and Smaller)
- 40 20 91 - PVC Pipe (4 Inch and Larger)
- 40 71 00 - Flow and Level Measurement
- 40 97 15 - Pressure Gauges

DIVISION 46 - WATER AND WASTEWATER EQUIPMENT

- 43 33 00 - Alum Feed System
- 46 05 29 - Blowers and Blower Controls
- 46 51 03 - Air Diffusers
- 46 61 41 – Cloth Disk Filter

END OF SECTION

SECTION 011000
SUMMARY

PART 1 GENERAL

1.1 SUMMARY

- A. This section generally describes the project and includes work by others, work sequencing, Contractor's use of premises, Owner occupancy, maintenance and operation of existing facilities, special conditions, work restrictions, and utility connection fees.

1.2 LOCATION OF PROJECT SITE

- A. Delaplain Disposal: The project site is located at 249 West Yusen Dr. Scott County, where shown on the drawings.

1.3 GENERAL DESCRIPTION OF WORK

- A. Delaplain Disposal: The work involves the addition of various treatment processes to supplement the existing treatment plant at Delaplain Disposal as shown and specified herein. The project will include: installation of blowers, blower control panels, and air process piping, installation of alum tank, installation of disk filter, installation of an effluent flow meter, Installation of valve vault, conversion of surge tank to post equalization/ contact tank, design and installation of equipment pad(s), metals, access hatches, mechanical piping improvements, electrical improvements, earthwork and exterior improvements, utility improvements, process integration, process improvements, equipment supply coordination and installation, and miscellaneous improvements as shown and specified.

1.4 WORK SEQUENCE

- A. The outlined sequence of construction does not include all items necessary to complete the work but is intended to identify the sequence of critical events necessary to minimize disruption and to ensure compliance with regulatory requirements. It shall be understood by the Contractor that critical events identified are not all inclusive and that additional items of work not shown may be required. The sequence of construction is a precedence requirement and does not attempt to schedule the Contractor's work. It is intended only to indicate which activities must precede other activities in order to minimize interference and disruptions.
- B. The work sequence shall be determined by the Contractor and within ten (10) days after the "Notice to Proceed" is issued shall be:
 - 1. Submitted in writing to the Engineer for approval by the Engineer.
 - 2. The following suggested sequence of construction describes simplistically, the major events required to complete the work in the preferred order of completion. The order of events is designed to minimize disruption to the ongoing operation of the existing facilities.

1.5 CONTRACTOR'S USE OF PREMISES

- A. The Contractor's use of the project site shall be limited to its construction operations, including on-site storage of materials, on-site fabrication facilities, and field offices, as noted in the Contract Drawings.
- B. Contractor shall note the location of all utilities, such as sanitary sewer manholes, water meters and fire hydrants along the route of the work. Contractor shall maintain access to public utilities at all times. Fire hydrants that are inadvertently damaged during construction shall be reported immediately to the utility owner and fire department. The Contractor shall notify each owner and tenant of land or other property not less than five days prior to occupation of such land by the Contractor. Any agreement between the Contractor and the landowner or tenant involving the expenditure of money, materials, or equipment, and such agreement is made to complete the work on this contract, shall be in writing and acknowledged by the landowner/tenant with a copy provided to the Owner.

1.6 OWNER OCCUPANCY

- A. The Owner may utilize all or part of the existing facilities during the entire period of construction for the conduct of the Owner's normal operations. The Contractor shall cooperate with the Owner to minimize interference with the Contractor's operations and to facilitate the Owner's operations.

1.7 MAINTENANCE AND OPERATION OF EXISTING FACILITIES

- A. Work shall be scheduled and performed in such a manner as to result in the least possible disruption

to the operation of the existing facilities and to the public's use of roadways, driveways, and utilities.

- B. Contractor shall perform a location investigation of existing underground utilities and facilities and shall have obtained all required permits and permissions. Contractor shall also deliver written notice to property occupants (private and public) of all planned disruption to roadways, driveways, and utilities seventy-two hours in advance of disruption.
- C. At no time shall the Contractor undertake to close off any pipelines, or open valves, or take any other action which would affect the operation of the existing system or facilities, except as specifically required by the Drawings and specifications, until authorization is granted by the Owner or Engineer and after proper notification.
- D. The facilities will be maintained in continuous operation by the Owner during the entire construction period of this contract. Work shall be scheduled and coordinated by the Contractor that such work will not impede the collection system or pump station operation or cause odor or other nuisance. In performing the work shown and specified, the Contractor shall plan and schedule his work to meet the operating requirements and all additional restrictions.
- E. Only the Owner can authorize the shutdown of any portions of the facility or system. The Contractor shall, under no circumstances, interfere with any existing component without the Owner's authorization in writing. Contractor shall notify the Owner at least 5 days in advance in writing. The Owner shall be responsible for removing facilities from operation.
- F. A planned shutdown may be cancelled by the Owner upon a 24-hour notification by the Owner/Engineer to the Contractor. Such cancellation shall be expected due to wet weather conditions or other conditions beyond the control of the Owner, Engineer or Contractor. All efforts shall be taken to check weather forecasts and the like prior to scheduling facility shutdowns. However, if a cancellation must occur, the Owner shall not be responsible for any additional costs associated with mobilization and demobilization.

1.8 SPECIAL PERMIT CONDITIONS AND WORK RESTRICTIONS

- A. Contractor shall research and report to Owner on any local jurisdiction's ordinance restricting the hours of operation for heavy construction equipment and schedule work in accordance with such ordinance. Contractor shall assume normal working hours on site may be 7 AM to 6 PM, Monday through Friday, and seek approval from Engineer or Owner for work outside of the normal working hours.

1.9 UTILITY CONNECTION FEES

- A. Contractor shall pay for utility connection fees and assessment fees including electric, water, gas, storm drain, and telephone.
- B. Submit contact information for each utility for which utility connections are desired and report to Owner or Engineer on communications with such utilities.

PART 2 PRODUCTS (NOT USED)

PART 3 EXECUTION (NOT USED)

END OF SECTION

PAGE INTENTIONALLY LEFT BLANK

**SECTION 013000 ADMINISTRATIVE
REQUIREMENTS**

PART 1 GENERAL

1.1 SUMMARY

- A. This section includes project management, project records, project meetings, photographic documentation, site safety, security, and environmental procedures.

1.2 PROJECT MANAGEMENT

- A. All work under the Contract shall be performed under the continuous supervision of competent personnel thoroughly experienced in the class of work specified. Prior to beginning the work, the Contractor shall give the Engineer, in writing, the name of the Contractor's official representative or superintendent for the project. The superintendent shall be capable of providing adequate supervision to the project and shall be responsible for receiving instructions, notices, and written orders from the Engineer. A change of the superintendent shall be reported to the Engineer in writing. Failure to provide adequate supervision to the project shall be grounds for the Engineer to require a change in supervision before allowing the work to proceed. The superintendent shall be responsible for reporting to the Engineer any inconsistencies, omissions, or lack of definite detail which is not covered on the plans or in the specification.
- B. File with the Engineer the names, phone numbers and addresses of two or more responsible persons in the Contractor's organization who are to be on call at all times. Contractor shall update the list within 24 hours of a change.
- C. The Contractor shall employ a Project Superintendent who will be responsible for continuous coordination among all phases of work. He shall serve as the Contractor's liaison with the Owner's Representative.
- D. The Project Superintendent shall have a minimum of three years of experience in the field and be acceptable to the Owner. He shall be maintained by the Contractor throughout the project and not be replaced without concurrence of the Owner.
- E. The Project Superintendent's responsibilities shall include, but not be limited to:
1. Consult the contract drawings and specifications of all trades to verify and coordinate the location of the various building components and items to be installed by all Contractors. Review the daily work schedules of all Contractors for a minimum of interferences to the work of other Contractors. This work includes (but is not limited to) installation of sleeves in walls and/or foundations for electrical and mechanical pipes and damper or louver openings.
 2. Consult and cooperate with all Contractors and their installers for all work to determine space requirements and adequate clearances with respect to other equipment in the building. The Owner's Representative reserves the right to determine space priority in the event of interference between piping, conduit equipment, furnishings, etc., of various trades.
 3. Inspect, report to the Owner's representative and coordinate the removal, relocation and reconnection of any installed work which interferes with the work of other trades. All work so directed shall be at the expense of the installing Contractor.

1.3 PROJECT RECORDS

- A. During the performance of this contract, the Contractor shall maintain a suitable office at or near the site of the work which shall be the headquarters of a representative authorized to receive drawings, instructions, or other communication or articles. If a job costs less than \$100,000 the Contractor may use a workman's vehicle for the office at the site of the work and shall designate which workman's vehicle it will be.
- B. Copies of the drawings, specifications, approved shop drawings, change orders, and other contract documents shall be kept at the Contractor's office at the site of the work, and be made available for use at all times by Engineer and Owner.
- C. "As constructed" information shall be recorded on a separate set of Plans for submittal upon completion of the project. See Section 017800 for specifics on recording this information.

1.4 PRECONSTRUCTION CONFERENCE

- A. Prior to the start of work the Engineer, in cooperation with the various agencies, will establish the time and date, distribute agenda, and administer the preconstruction conference. Owner, Engineer, Contractor, major Subcontractor(s) and Governmental Agencies will attend.

1.5 PROGRESS MEETINGS

- A. Progress meetings will generally occur at the end of the month. The general job status will be discussed including progress of work, field observations, problems & decisions, shop submittal schedules and reviews, revision of construction schedule, corrective measures and project payments.

1.6 ELECTRONIC PROTOCOL

- A. This project will use electronic media for communications, submittal of shop drawings, pay requests, and other project related correspondence:

1.7 PHOTOGRAPHIC DOCUMENTATION

- A. Contractor shall be responsible for the production of pre-construction and construction photographs as provided herein.
 - 1. Pre-Construction Photographs: Photographs taken, in sufficient numbers and detail prior to the start of Work to show original construction site conditions.
 - 2. Progress Photographs: Photographs shall be taken throughout the duration of construction at regular intervals to document progress of the Work.
- B. Digital images shall be electronically transferred monthly and at the end of the project on computer disks in JPEG format. Each image shall be labeled with the date taken.
- C. Contractor shall provide electronic copies of photographs at the completion of the project before final payment is made.

1.8 OWNER PURCHASED EQUIPMENT AND MATERIAL

- A. Owner will be purchasing equipment and materials for the project which may affect the Work Sequence and Work Schedule. The following delivery schedule will be described elsewhere.
- B. Owner will be purchasing equipment and materials for the project which may affect the Work Sequence and Work Schedule. Refer to Section 016400 for the details and dates of arrival of the Owner's purchased equipment and materials for the project. Double handling may be required when equipment must be moved from a common carrier and placed in a temporary storage area.

1.9 AVAILABLE LAND

- A. Owner is providing for all land and access required for constructing the Work. If it is necessary or desirable that the Contractor use land outside of the Owner's acquired land, the Contractor shall obtain a written agreement with the landowner. The agreement between Contractor and property owner shall describe in detail such items as removal of fences, installation of temporary fences, limits of land to be occupied, and any costs associated with crop damage.

1.10 CONSTRUCTION PROGRESS SCHEDULE

- A. Develop an overall schedule and submit two copies within seven days of Notice to Proceed for review and approval to Owner's Representative a schedule of the work to be completed on the Project.
- B. Revise the schedule as requested by the Owner's Representative when:
 - 1. Work progress falls 10 percent behind scheduled progress.
 - 2. When time extensions are approved for changes and causes beyond Contractor's control.
 - 3. When Contractor feels a significant reorganization of activities becomes necessary because of field and material supply conditions in order to meet the contract completion date of the Project.
- C. Coordinate Work of various sections, space requirements for installation, and accessibility for construction by others.
- D. Work that disrupts utility service shall be shown on the Construction Schedule and specifically scheduled with the Owner. Schedule notification shall consist of a written notice defining the work to be accomplished, the normal function that will be interrupted, the duration of the interruption, and the mitigating effort to be performed by the Contractor to maintain the capacity to operate continuously. The written notice shall be submitted to the Owner fourteen days in advance of the proposed work and the Owner will respond to the Contractor in writing within 7 days of receipt of the notice regarding the acceptability of the proposed plan.
- E. At no time shall the Contractor close off any pipelines, or open valves, or take any other action which would affect the operation of the existing system or facilities, except as specifically required by the Drawings and specifications, until authorization is granted by the Owner or Engineer and after proper notification.

PART 2 PRODUCTS (NOT USED)

PART 3 EXECUTION (NOT USED)

END OF SECTION

THIS PAGE INTENTIONALLY LEFT BLANK.

SECTION 013300
SUBMITTAL PROCEDURES

PART 1 GENERAL

1.1 SUMMARY

- A. This section specifies the general requirements for the submittals of shop drawings, product data, and samples. Refer to Section 017800 for closeout submittal requirements.

1.2 GENERAL SUBMITTAL REQUIREMENTS

- A. All submittals shall be sent to Engineer at an email address to be provided to contractor during the pre-construction conference.
- B. All submittals, regardless of origin, shall be approved by Contractor before submitting to Engineer. The Contractor shall be responsible for timely submittals so that there will be no delay to the Work due to the absence of approved submittals.
- C. Upon receipt of a submittal, the Engineer will review and return the shop drawings within 14 calendar days. This review time will commence starting the next working day following receipt of the submittal.
- D. Contractor shall be solely responsible for the completeness of each submittal, including the identification of all deviations from the Contract Documents on each submittal and in the Contractor's letter of transmittal. Each submittal shall be complete in all aspects incorporating all information and data required to evaluate the products' compliance with the Contract Documents.
- E. Partial or incomplete submissions shall be returned to the Contractor without review. Time delays caused by rejection of submittals are not cause for extra charges to the Owner or time extensions.

1.3 ELECTRONIC SUBMITTALS

- A. Contractor may make electronic submittals which will be exchanged electronically through mutually agreeable software. Procore, ProjectWise, Submittal Exchange are acceptable, and others may be proposed by Contractor.
- B. Follow the submittal requirements below.
 - 1. Assemble complete submittal package into a single indexed file incorporating submittal requirements of a single specification section and transmittal form with links enabling navigation to each item.
 - 2. Use the same submittal and resubmittal numbering system.
 - 3. Identify the Project, Contractor, Subcontractor or supplier, pertinent Drawing sheet and detail number(s), and specification section number, as appropriate.
 - 4. Apply Contractor's standard certification stamp, signed or initialed certifying that review, approval, verification of Products required, field dimensions, adjacent construction Work, and coordination of information is in accordance with the requirements of the Work and Contract Documents. Submittals without this certification will be returned without review.

1.4 SHOP DRAWINGS

- A. Submit shop drawings in accordance with the Contract Documents and other technical sections in these Contract Documents requiring submittals.
- B. The use of contract drawing reproductions for shop drawings is subject to rejection.
- C. Shop drawings shall show applicable standards, such as ASTM number or Federal Specification, performance characteristics, the principal dimensions, weight, structural and operating features, space required, clearances, dimensions needed for installation and correlation with other equipment and materials, external connections, anchorages, supports required, type and/or brand of finish or shop coat, grease fittings, etc. depending on the subject of the Drawings.
- D. If the Contractor submits shop drawings of equipment by manufacturers other than those listed in the specifications, provide the following information with the submittal:
 - 1. The name and address of at least three companies or agencies that are currently using the equipment.
 - 2. The name and telephone number of at least one person at each of the above companies or agencies whom the Owner's Representative may contact.
 - 3. A description of the equipment that was installed at the above locations. The description shall be

in sufficient detail to allow the Owner's Representative to compare it with the equipment that is proposed to be installed in this project.

- E. For materials originating outside of the United States for which tests are required, provide recertification and retesting by an independent domestic testing laboratory.
- F. Provide a professional engineer's, architect, land surveyor, or landscape architect seal on appropriate drawings of items that are submitted for review where required by the Specifications. Each copy of a submittal requiring a Professional Seal shall bear an original seal with signature and date. Electronic seals are permitted provided they meet the State Board of Professional Licensing regulations.

1.5 PRODUCT DATA

- A. Product data may be in the form of manufacturer's catalog sheets, brochures, diagrams, schedules, performance charts, illustrations, and other standard descriptive data. Product data shall show applicable standards, such as ASTM number or Federal Specification.
- B. Where product data from a manufacturer is submitted, clearly mark each copy with indelible ink to identify pertinent materials, products or models proposed with all pertinent data, performance characteristics and capacities, dimensions, clearances, diagrams, controls, connections, anchorage, and supports. Present a sufficient level of detail for assessment of compliance with the contract documents.
- C. Manufacturer's standard schematic drawings may be used in the submittal, but shall be modified by deleting information which is not applicable to the project, and by providing additional information specific to the project.
- D. When warranties are required, a sample of the warranty for each product shall be submitted with the shop drawings or product data. The sample warranty shall be the same form that will be used for the actual warranty.
- E. When Buy American Provisions are required for the Project, Supplier/Manufacturer shall provide a Buy American Certification with submittals for materials and equipment covered by the Buy American Provisions. Contractor is responsible for confirming that any product purchased for the Project meets the Buy American Provisions.

1.6 SAMPLES

- A. Submit samples for review of the various materials, together with the finish, before purchasing, fabricating, applying, or installing such materials and finishes.
- B. Identify samples as to product, color, manufacturer, trade name, lot, style, model, etc., location of use, and contract document reference.
- C. Samples shall be of sufficient size or quantity to illustrate clearly the quality, type, range of color, finish or texture and shall be properly labeled to show complete project identification, the nature of the material, trade name of manufacturer and location of the Work where the material represented by the sample will be used.
- D. Acceptable samples will establish the standards by which the completed Work will be judged. Therefore, materials, finishes, and workmanship in the completed project shall be equal in every respect to that of the samples submitted and accepted.
- E. Samples of value may be returned to the Contractor for use in the project after review, analysis, comparison, and/or testing as may be required in the review process. One sample marked "resubmittal is not required" will be returned to the Contractor. Rejected samples will not be returned.
- F. Furnish one sample of the finally reviewed materials, colors, or textures to Engineer for final record. Such material samples shall carry on the back all identification as previously described. If the sample is paint, include manufacturer, mix and proportion, name of color, building, Contractor/Subcontractor, and surfaces to which it is to be applied.

1.7 CERTIFICATES OF COMPLIANCE

- A. Furnish a Certificate of Compliance for materials specified to a recognized standard or code prior to the use of any such materials in the work. The Engineer may permit the use of certain materials or assemblies prior to sampling and testing if accompanied by a Certificate of Compliance. The certificate shall be signed by the manufacturer of the material or the manufacturer of assembled materials and shall state that the materials involved comply in all respects with the requirements of the Specifications. A Certificate of Compliance shall be furnished with each lot of material delivered to the work and the lot so certified shall be clearly identified in the certificate.

- B. All materials used on the basis of a Certificate of Compliance may be sampled and tested at any time. The fact that material is used on the basis of a Certificate of Compliance shall not relieve the Contractor of responsibility for incorporating material in the Work which conforms to the requirements of the Contract Documents and any such material not conforming to such requirements will be subject to rejection whether in place or not.
- C. The Engineer reserves the right to refuse permission for use of material on the basis of a Certificate of Compliance.

1.8 ENGINEER'S REVIEW

- A. Engineer's review is only for general conformance with the design concept of the project and the information given in the Construction Documents. Neither the review nor any corrections or comment made on submittals during review relieves the Contractor from full compliance with the Contract Documents, including, but not limited to, the plans and specifications. *Engineer's* review of a specific item does not, nor shall it be construed to, include review of an assembly of which the item is a component. The Contractor is solely responsible for: all measurements, dimensions, quantities, materials, and proper fit up and interfacing of all components; all aspects of any fabrication process; the means, methods, techniques, sequences and procedures of construction; coordination of the work with that of all other trades; and performing all work in a safe and satisfactory manner.
- B. The returned submittal will indicate one of the following actions:
 - 1. Resubmittal not required - The review indicates that the submittal is in general conformance with the design concept and complies with the drawings and specifications. The Contractor may begin to implement the work method or incorporate the material or equipment covered by the submittal.
 - 2. Make corrections noted - The review indicates limited corrections are required as marked on the submittal. The Contractor may begin implementing the work method or incorporating the material and equipment covered by the submittal in accordance with the noted corrections. Where submittal information will be incorporated in O&M data, a corrected copy shall be provided.
 - 3. Revise & resubmit - The review reveals that the submittal is insufficient or contains incorrect data, or indicates that the material, equipment or work method is not in general conformance with the design concept or in compliance with the Drawings and Specifications. The Contractor shall not undertake work covered by such submittals until a new submittal is submitted.
 - 4. Rejected - The submittal was not accepted or reviewed.
- C. Engineer's review of submittals shall not relieve Contractor from responsibility for errors, omissions, deviations, or responsibility for compliance with the Contract Documents.

1.9 RESUBMITTALS

- A. Resubmittals shall be made within 30 days of the date of the review letter returning the material to be modified or corrected, unless within 14 days Contractor submits a request for an extension of the resubmittal time, listing the reasons the resubmittal cannot be completed within that time, and are approved by the Engineer.
- B. Contractor shall request an amendment to the Contract Documents, if the Contractor considers any correction indicated on the shop drawings to constitute a change to the Contract Documents.
- C. Resubmittals will be reviewed and returned in the same 14 day review period. It is considered reasonable that the Contractor shall make a complete and acceptable submittal by the second submission of a submittal item. Contractor shall verify that all exceptions previously noted by Engineer have been taken into account.
- D. Resubmittals shall have the original submittal number for that item followed by an alphabetic suffix. For example, if Submittal 33000-2 requires a resubmittal, the first resubmittal number will bear the designation "33000-2A" and the second resubmittal number will bear the designation "33000-2B".
- E. Resubmittals shall identify what revisions were made.
- F. The need for more than one resubmittal, or any other delay in obtaining Engineer's review of submittals, will not entitle Contractor to extensions of Contract Times unless the delay of the Work is the direct result of failure of Engineer to review and return any submittal to Contractor within the specified review period. Additionally, Contractor shall reimburse Owner for the charges of Engineer for review of the additional resubmissions. Monies due to the Contractor may be withheld to cover additional costs of any review beyond the second submittal.

1.10 SUBMITTALS FOR PROJECT CLOSEOUT

- A. When the following are specified in individual sections, submit them at project closeout, and according to Section 017800.
 - 1. Project record documents
 - 2. Operation and maintenance data
 - 3. Warranties
 - 4. Bonds

PART 2 PRODUCTS (NOT USED)

PART 3 EXECUTION (NOT USED)

END OF SECTION

SECTION 015000
TEMPORARY FACILITIES AND CONTROLS

PART 1 GENERAL

1.1 SUMMARY

- A. This section Includes:
 - 1. Temporary Utilities: Water, sanitary facilities, electrical power, heating, lighting, ventilation.
 - 2. Temporary Controls: Site security, material storage, dust control, water control, noise control, safety, and fire danger.
 - 3. Construction Controls: Traffic Regulation, access roads and parking areas.
 - 4. Construction Facilities: Temporary field office, inspection hoist, and project sign.

1.2 ELECTRICAL POWER

- A. Provide for the purchase of power or provide portable power for the construction of the project where existing outlets are not available. Provide main service disconnect and overcurrent protection. Provide for the extension of utility lines to the point of usage. The cost of power shall be included in the appropriate bid items to which it is appurtenant and shall include full compensation for furnishing all labor, materials, tools, and equipment required to obtain and distribute power for construction purposes.
- B. Provide power outlets for construction operations, with branch wiring and distribution boxes. Provide flexible power cords as required for construction operations.
- C. Existing receptacles may be utilized during construction.

1.3 TEMPORARY BUILDING ENVIRONMENTAL CONTROLS

- A. HEATING
 - 1. Provide heating devices and heat as needed to maintain specified conditions for construction operations.
 - 2. Prior to operation of permanent equipment for temporary heating purposes, verify that installation is approved for operation, equipment is lubricated, and filters are in place. Provide and pay for operation, maintenance, and regular replacement of filters and worn or consumed parts.
- B. LIGHTING
 - 1. Provide and maintain lighting for construction operations to achieve a minimum lighting level of 2 watt/sq. ft.
 - 2. Provide branch wiring from power source to distribution boxes with lighting conductors, pigtails, and lamps as required.
 - 3. Maintain lighting and provide routine repairs.
 - 4. Permanent building lighting may be utilized during construction.
- C. VENTILATION
 - 1. Ventilate enclosed areas to assist cure of materials, to dissipate humidity, and to prevent accumulation of dust, fumes, vapors, or gases.

1.4 CONSTRUCTION WATER

- A. The Contractor shall make his own arrangements for developing water sources and supply labor and equipment to collect, load, transport, and apply water as necessary for compaction of materials, concrete construction operations; testing; dust control; and other construction use.
- B. Obtain water from private sources. Payment for costs connected with utilization of the source shall be made by the Contractor. Water shall be clean and free from objectionable deleterious amounts of acids, alkalines, salts, or organic materials.
- C. Include the cost of construction water in the appropriate bid item to which it is appurtenant. The cost shall include full compensation for furnishing all labor, materials, tools, and equipment and doing all the work necessary to develop a sufficient water supply and furnishing the necessary equipment for applying the water as described in these specifications.
- D. Coordinate the use of water for any construction related purpose with the water utility and Engineer. Provide 24 hour notice prior to withdrawing water from any source.

1.5 SANITARY FACILITIES

- A. Contractor shall provide and maintain adequate fixed or portable chemical sanitary toilet facilities on the job site, and conform to local health codes which govern in the project area. Toilets at construction job sites shall conform to the requirements of Part 1926 of the OSHA Standards for Construction.
- B. The Contractor shall maintain the sanitary facilities in a satisfactory and sanitary condition at all times and shall enforce their use. He shall rigorously prohibit the committing of nuisances on the site of the Work, on the lands of the Owner, or an adjacent property.
- C. Contractor's use of Owner's facilities will not be allowed.

1.6 CONSTRUCTION SITE SECURITY

- A. Provide barriers to prevent unauthorized entry to construction areas, to protect adjacent properties from damage from construction operations, and to serve as warnings for dangerous areas and excavations.
- B. Provide security and facilities to protect Work, and Owner's operations from unauthorized entry, vandalism, or theft. The Owner is not responsible for the security of the site or structures.
- C. Protect non-owned vehicular traffic, stored materials, site, and structures from damage.
- D. Provide a security fence around construction site or storage area; equip with vehicular gates with locks. Provide keys to Owner and Engineer. If gates are chained, allow Contractor and Owner padlocks to be linked together so either party can unlock the gate.
- E. Provide security lighting.

1.7 MATERIAL STORAGE

- A. Storing and Protecting Materials
 - 1. Store and protect products in accordance with manufacturer's instructions, with seals and labels intact and legible. Store sensitive products in weather-tight, climate-controlled enclosures.
 - 2. For exterior storage of fabricated products, place on sloped supports, above ground.
 - 3. Cover products subject to deterioration with impervious sheet covering. Provide ventilation to avoid condensation.
 - 4. Store loose granular materials on solid surfaces in a well-drained area. Prevent mixing with foreign matter.
- B. Storage Areas
 - 1. Generally, storage areas shall be provided within the designated staging area. The staging area is general and does not indicate limits of construction. Responsibility for protection and safekeeping of equipment and materials at or near the sites will be solely that of the Contractor and no claim shall be made against the Owner by reasons of any act of an employee or trespasser. Should an occasion arise necessitating access to an area occupied by stored equipment and/or materials, the Contractor shall immediately move them. No equipment or materials shall be placed upon the Owner's property until it is acceptable to the Owner
 - 2. Provide off-site storage and protection when site does not permit on-site storage or protection.
 - 3. Arrange storage of products to permit access for inspection. Periodically inspect to assure products are undamaged and are maintained under specified conditions.
 - 4. Upon completion of the Contract, the Contractor shall remove from the storage areas all of their equipment, temporary fencing, surplus materials, rubbish, and restore the areas.

1.8 DUST CONTROL

- A. Perform dust control operations to prevent construction operations from producing dust in amounts harmful to persons or causing a nuisance to persons living nearby or occupying buildings in the vicinity of the work. Use water or dust preventative to control dust. May be tied to SWPPP requirements.

1.9 WATER CONTROL

- A. Work to be performed may require draining, pumping, dewatering, and certain cleaning operations necessary to complete the work as specified and as indicated on the drawings. It is the intent of these specifications that such draining, pumping, dewatering, and cleaning operations shall be the obligation of the Contractor
- B. Make provisions for maintaining proper drainage of the work area. Preserve and maintain natural drainage patterns. Remedy situations which could cause excessive erosion including the use of drainage checks or water bars on slopes subject to erosion.

1.10 NOISE CONTROL

- A. Maintain equipment, particularly muffling systems on internal combustion engines, so that acceptable noise levels are not exceeded. If on-site generators are used, locate it in area where the sound will be least offensive.
- B. Provide sound barriers as shown on the drawings.

1.11 SAFETY

- A. The Contractor shall alone be responsible for the safety, efficiency, and adequacy of the plant, appliances and methods, and for any damage which may result from their failure or their improper construction, maintenance or operation.
- B. Contractor shall have a man available 24 hours a day who can be contacted at any time in case of an emergency caused by the construction operations. Name, address, and telephone number of this person shall be filed with the Owner.
- C. All open trenches and other excavations shall be provided with suitable barriers, signs, and lights to the extent that adequate protection is provided to the public against accident by reason of such open construction. All open trenches shall be backfilled or must be barricaded, at the end of each working day.
- D. All barricades, signs, warning lights and other protective devices shall be installed and maintained in conformance with applicable statutory requirements, and, where within highway right-of-way, as required by the authority having jurisdiction.
- E. Materials or equipment in or alongside public streets, roads and highways shall be so placed that the work at all times shall be so conducted as to cause the minimum obstruction and inconvenience to the traveling public. These obstructions shall be provided with barricades, signs, warning lights and other protective devices.
- F. Safety Data Sheets (SDS) shall be provided to the Owner for all materials stored/used during construction of the project.

1.12 FIRE DANGER

- A. Minimize fire danger in the vicinity of and adjacent to the construction site. Provide labor and equipment to protect the surrounding private property from fire damage resulting from construction operations.
- B. All fire hydrants and water control valves shall be kept free from obstruction and available for use at all times.

1.13 INSPECTION AIDS

- A. Contractor shall provide power driven equipment for hoisting Owner's representative for inspection purposes.

1.14 TRAFFIC REGULATION

- A. Contractor shall maintain traffic and protect the public from all damage to persons and property within the contract limits, in accordance with all applicable state, local, and city regulations. The Contractor shall conduct its operations so as to maintain and protect access for vehicular and pedestrian traffic to and from all properties and business establishments adjoining or adjacent to those streets affected by its operations, and to subject the public to a minimum of delay and inconvenience. Suitable signs, barricades, railing, etc. shall be erected and the work outlined by adequate lighting at night. Danger lights shall be provided as required. Watchmen and flagmen shall be provided as may be necessary for the protection of traffic.
- B. The Contractor shall notify the owner or occupant (if not owner-occupied) of the closure of the driveways to be closed more than one eight-hour work day, at least three working days prior to the closure. The Contractor shall minimize the inconvenience and minimize the time period that the driveways will be closed. The Contractor shall fully explain to the owner/occupant how long the work will take and when closure is to start.

1.15 PROJECT SIGN

- A. A project sign is not required for this project.

PART 2 PRODUCTS (NOT USED)

PART 3 EXECUTION (NOT USED)

END OF SECTION

THIS PAGE INTENTIONALLY LEFT BLANK

SECTION 015713
TEMPORARY EROSION AND SEDIMENT CONTROL

PART 1 GENERAL

1.1 SUMMARY

- A. Stormwater Pollution Prevention Plan (SWPPP)
- B. Erosion Control Measures
- C. Velocity and Flow Control Measures
- D. Sediment Control Measures
- E. Application/Installation of Measures
- F. Removal/Replacement of Measures

1.2 DESCRIPTION OF WORK

- A. Furnish all materials; install, construct, maintain, and remove specified erosion control devices; at locations specified in the contract documents, or where specified by the Engineer.
- B. Complete the required construction work on this project, while minimizing soil erosion and controlling water pollution. Maintain these features as specified, from initial construction stages to final completion of the project.

1.3 SUBMITTALS

- A. Comply with Section 013300.
- B. Upon request, provide copies of all records and documentation related to compliance with the SWPPP.

1.4 SCHEDULING AND CONFLICTS

- A. Comply with the following:
 - 1. Implement erosion and sediment control measures at the appropriate time(s).
 - 2. Coordinate construction to minimize damage to erosion and sediment control devices.

1.5 SPECIAL REQUIREMENTS

- A. Protection of Property: Prevent accumulation of soil, sediment, or debris from project site onto adjoining public or private property. Remove any accumulation of soil or debris immediately and take remedial actions for prevention.
- B. Permit Compliance: When applicable, conduct all operations in compliance with the SWPPP. Labor, equipment, or materials not included as a bid item, but necessary to prevent stormwater contamination from construction related sources, are considered incidental. Incidental work related to compliance with the permit may include, but is not limited to: hazardous materials protection, fuel containment, waste disposal, and providing employee sanitary facilities.

- C. Project Staging: Replacing erosion and sediment control practices that are damaged or removed by the contractor in a manner that is inconsistent with the current project staging or SWPPP is the Contractor's responsibility and will be at the Contractor's expense.

PART 2 PRODUCTS – NOT USED

PART 3 EXECUTION

3.1 SWPPP PREPARATION

- A. Prepare a SWPPP according to the requirements of the State.
- B. Have the SWPPP prepared by an individual experienced in erosion and sediment control.
- C. Ensure that controls utilized in the SWPPP conform to the type and quantity of erosion and sediment controls required.
- D. Submit the completed SWPPP to the Engineer for review and approval prior to filing.
- E. Upon approval of the Engineer, submit and pay fee as appropriate.

3.2 SWPPP MANAGEMENT

- A. Update the SWPPP according to the requirements of the State.
- B. Revise the SWPPP and implement changes, as necessary, to prevent sediment or hazardous materials from being transported off the site.
- C. Submit all SWPPP revisions to the Engineer for review and approval.
- D. Perform and maintain records of erosion and sediment control site inspections, unless otherwise specified in the contract documents.
- E. Retain all records on-site.
- F. Provide all records and documentation to the Engineer upon completion of the project.

3.3 EROSION AND SEDIMENT CONTROL INSPECTION

- A. Perform inspections following rainfall events in excess of ½ inch.
- B. Notify the Engineer immediately of situations requiring attention beyond that provided for in the contract documents.
- C. Provide copies of the inspection reports to the Engineer.

END OF SECTION

**SECTION 016400
OWNER-FURNISHED PRODUCTS**

PART 1 GENERAL

1.1 SUMMARY

- A. This section generally describes the logistical aspects of equipment and materials that will be furnished by the Owner for each project.

1.2 OWNER FURNISHED EQUIPMENT AND MATERIALS

- A. The Contractor shall include in his Contract price or prices all costs in connection with handling, storing, protecting, and installing materials, supplies, or equipment furnished by the Owner and shall make good all losses and breakage due to carelessness or negligence while same are in his possession. The obligations of the Contractor under this section shall not extend to defective materials or equipment supplied by the Owner, and the Owner will reimburse the Contractor for Contractor's cost, for work in relation to defective material supplied by the Owner.
- B. All 2022 Kentucky Projects: Equipment and material furnished by Owner and in current inventory will be:
1. Pumps (with appurtenances) and pump control panels with pump VFDs; see Plans and Section 333216
 2. Flow Meters (see Plans and Section 407100)
 3. Owner to supply all air process piping downstream from air headers i.e., drop pipes, laterals, and diffusers for IFAS, and IFAS cages.
 4. Remote monitoring equipment (see Plans)
 5. Cloth Disk Filter (see Plans)
 6. Alum Feed System (see Plans)
- C. A copy of the approved shop drawings and installation requirements for the Owner furnished equipment will be made available to the Contractor during bidding process.
- D. A copy of the specifications, purchase order and manufacturer's information for Owner furnished equipment will be made available to the Contractor during the bidding process.

1.3 DELIVERY OF EQUIPMENT

- A. The Owner will provide furnished equipment to the project site. The Contractor shall provide a crane and labor to unload the Owner furnished equipment.

1.4 CONTRACTOR'S RESPONSIBILITIES

- A. Contractor shall review specifications, manufacturer's information, approved shop drawings and installation requirements for the Owner furnished equipment.
- B. Contractor shall carefully examine each shipment of Owner furnished equipment or material upon arrival. Defective items shall be brought to the attention of the Engineer. Upon inspection and acceptance by the Contractor, the Contractor shall assume custody, and provide insurance for and be responsible for the Owner furnished equipment and materials from the point of delivery on. The Owner furnished equipment and materials shall be properly handled to prevent damage. The Owner will not accept title to the equipment until the project is substantially complete.
- C. Damaged or misplaced Owner furnished items shall be replaced by the Contractor. Replacements shall conform to the original equipment specifications.
- D. Contractor to install all equipment and materials, Owner furnished and otherwise.

1.5 OWNER-FURNISHED TECHNICAL ASSISTANCE

- A. Field service representatives from manufacturers will be provided for Owner furnished equipment will be provided in accordance with the purchase orders, specifications, and agreements with the Owner furnished equipment suppliers. Contractor will be responsible for coordinating with manufacturer's

representative for providing necessary services.

- B. The Owner-furnished equipment manufacturers will provide technical services at no cost to the Contractor, as detailed in the agreements between Owner and the manufacturers.
- C. If the Contractor requires additional time from manufacturer representatives for installation supervision or assistance, installation review, instrumentation calibration, or other field services beyond what is detailed in the agreements between the Owner and the manufacturers, the Contractor shall include these costs in their bid. No additional charges by manufacturers will be paid by Owner for manufacturer's services.

PART 2 PRODUCTS (NOT USED)

PART 3 EXECUTION (NOT USED)

END OF SECTION

SECTION 017000
EXECUTION

PART 1 GENERAL

1.1 SUMMARY

- A. This section includes lands and rights-of-way, underground utility locations, construction layout and staking, methods of operation, salvage of materials and equipment, and cutting and patching.

1.2 MOBILIZATION AND NOTIFICATIONS

- A. Contractor shall notify Engineer and Owner seven working days in advance of startup of construction operations, addition of work crews, or major increase in work force.

1.3 UNDERGROUND UTILITY LOCATIONS

- A. Utility locations are generally not shown on the Drawings. If shown, the locations of the utilities depicted on the Contract Drawings are not to be considered exact. The approximate utility locations, where shown, were derived from data obtained from generalized large-scale utility company supplied drawings or from prior facility construction drawings. The actual location of existing utilities is the sole responsibility of the Contractor. Those shown on the plans are given to call particular attention to areas of special concern.
- B. The Contractor shall make his own investigations including exploratory excavations as needed to determine the locations and type of existing utilities to be encountered. Any work associated with crossing or paralleling a particular utility shall be subsidiary to the work as stipulated in General Conditions.
- C. The utilities anticipated to be affected, if any, by this Project are indicated on the Contract drawings. The utilities shown are not intended to be a complete or an all-inclusive. Other utilities may exist in the Project area and may not be shown. The Contractor shall be responsible for contacting all affected utilities; municipalities, local, County, State, and Federal entities whether or not they are shown or listed.
- D. The Contractor shall coordinate all work which parallels, crosses, or is in the vicinity of a given utility with the Owner of that particular utility. The Contractor shall notify all utilities and underground service agencies in advance of work scheduled or envisioned and arrange to have their respective services located. Upon exposing a utility or underground service, the respective service agency shall be contacted by the Contractor, such that an inspection of the service can be made by the utility (if desired) prior to backfilling. The Contractor shall obtain acceptance, in writing, from the utility regarding the preservation of their respective service during construction.
- E. Should any facility, either underground or overhead, be unexpectedly encountered or damaged during construction, the Contractor shall immediately notify a representative of the company involved and take such steps as necessary for protection of the general public and his own personnel.

1.4 CONSTRUCTION LAYOUT AND STAKING

- A. All work under this Contract shall be constructed in accordance with the lines and grades shown on the Contract Drawings or as directed by the Engineer. Elevation of existing ground, structures and appurtenances are believed to be reasonably correct, but are not guaranteed to be absolute and therefore are presented only as an approximation. Any error or apparent discrepancy in the data shown or omissions of data required for accurately accomplishing the stakeout survey shall be referred immediately to the Engineer for interpretation or correction.

- B. The Owner will establish reference points for construction, which in the judgment of the Engineer are necessary to enable the Contractor to proceed with the Work. The reference points shall be basic horizontal and vertical control points in the project area. Preserve these points and transfer from them distances and elevations necessary for the execution of the structural and piping work. These points shall be used as datum for work under this contract.
- C. The Contractor will furnish construction staking to execute the work as described below. The Contractor shall provide an experienced instrument man, competent assistants, and such instruments, tools, stakes, and other materials required to complete the survey, layout, and measurement work.
- D. The Contractor shall be responsible to preserve benchmarks, reference points, stakes, property pins, and all other survey location items. In case of destruction by the Contractor or resulting from his negligence, he shall be held liable for any expense and damage and shall be responsible for any mistakes that may be caused by the unnecessary loss or disturbance of such benchmarks, reference points and stakes.

1.5 LAYOUT MODIFICATIONS

- A. Should the Contractor desire a revision in the designated alignment or location he shall make said request to the Owner's Representative. The decision of the Owner's Representative is final.
- B. Alignment changes may be proposed and staked by Contractor for review in field by the Owner's Representative and/or Owner. Contractor may propose differences or deviations of the work to avoid disturbances, surface obstructions, easement changes. Reroutes may be authorized by the Owner or Owner's Representative based on staked field conditions. Alignment changes agreed upon by Owner or Owner's representative shall be recorded by the Contractor on the Record Drawings. Field Orders will be issued by the Owner's Representative to document significant changes in alignment.
- C. Adjustment for actual quantities installed for the pipeline and appurtenances, if different from the drawings, will be paid for in accordance with Contract Documents.

1.6 OWNER'S CONSTRUCTION REPRESENTATIVE AT PROJECT SITE

- A. The Owner may appoint or employ a person(s) to work as the Construction Representative on the project. The Owner's Representative shall represent the Owner as specifically set forth in the Contract, and shall observe the work performed under this Contract to the end that such work is performed in substantial accordance with the drawings and specifications. Such observation shall in no way remove any obligations on the part of the Contractor to provide all required supervision and quality control necessary to perform the work in accordance with the Contract.
- B. If the Owner's Representative observes departures from the drawings and specifications, the Owner's Representative will call them to the attention of the Contractor, who shall promptly correct the unsatisfactory conditions. If the Contractor believes there has been no departure from the drawings and specifications, the Contractor may make written appeal.
- C. The presence or absence of the Owner's Representative, or the failure of the Owner's Representative to detect faulty work shall in no way relieve the Contractor from his obligation to perform the work strictly in accordance with the drawings and specifications.
- D. The Owner's Representative shall have no authority to permit any deviation from the drawings and specifications, except on written Change Order or Field Order as applicable. The Contractor will be liable for any deviation, except on such written order.

1.7 METHODS OF OPERATION

- A. The Contractor shall inform the Owner in advance concerning his plans for carrying on

each part of the work, but the Contractor alone shall be responsible for the safety, adequacy, and efficiency of his plant, equipment, and methods.

- B. Any method of work suggested by the Owner or Engineer, but not specified, shall be used at the risk and responsibility of the Contractor; and the Engineer and Owner will assume no responsibility therefor.
- C. Review by the Owner or Engineer of any plan or method of work proposed by the Contractor shall not relieve the Contractor of any responsibility therefor, and such review shall not be considered as an assumption of any risk or liability by the Owner or Engineer, or any officer, agent, or employee thereof. The Contractor shall have no claim because of the failure or inefficiency of any plan or method so reviewed.
- D. The Owner and the Engineer will not be responsible for any act or omission of the Contractor, or any subcontractor, or any of their agents or employees, or any other persons performing any of the work. The Owner and Engineer will not be responsible for any failure of the Contractor or his subcontractors or any other persons to perform the work in accordance with the requirements of the Contract Documents.

1.8 UNFAVORABLE CONSTRUCTION CONDITIONS

- A. During unfavorable weather, wet ground, or other unsuitable construction conditions, Contractor shall confine his operations to work which will not be affected adversely by such conditions. No work shall be constructed under conditions that would adversely affect the quality, unless the Contractor takes special precautions to perform the work in a proper and satisfactory manner.

1.9 OBSTRUCTIONS

- A. Any street signs, traffic signs, posts, mailboxes, guard fence, standards, yard lights or other similar obstructions shall be removed, properly stored and reset or salvaged to the Owner as directed by the Engineer.
- B. Trees and shrubs that are encountered in the vicinity of the proposed facilities shall be removed only if deemed necessary by the Engineer.
- C. Existing fences (including chain link fences) interfering with the construction operations shall be maintained by the Contractor until completion of the work affected thereby, unless written permission is obtained from the owner to leave an interfering fence dismantled for any agreed period of time. On completion of the work the Contractor shall restore all fences to their original or to a better condition and to their original location or as shown on the plans
- D. All property pins, section corners or other monuments moved and/or destroyed by the Contractor's operations shall be replaced and reset. Replacement and resetting shall be done by a professional Engineer or Surveyor paid by the Contractor at no additional cost to the Owner.

PART 2 PRODUCTS (NOT USED)

PART 3 EXECUTION (NOT USED)

END OF SECTION

THIS PAGE INTENTIONALLY LEFT BLANK

SECTION 017800
CLOSEOUT SUBMITTALS

PART 1 GENERAL

1.1 SUMMARY

- A. This section includes closeout submittals, operation and maintenance data, warranties, spare parts and maintenance materials, and project records.

1.2 SUBMITTALS

- A. Submit written certification that Contract Documents have been reviewed, Work has been inspected, and that Work is complete in accordance with Contract Documents and ready for Engineer's review. A partial list of such items appears below, but it shall be the Contractor's responsibility to submit any other items which are required in the Contract Documents:
1. Written test results of project components, where required.
 2. Performance affidavits for equipment, where required.
 3. Certificates of inspection and acceptance by local governing agencies having jurisdiction.
 4. Keys, padlocks, and other items not considered spare parts or maintenance materials.
 5. Clearances of all property owners for work requiring site restoration caused by Contractor's operations.
- B. Provide final submittals to Engineer that are required by governing or other authorities.
- C. Submit final Application for Payment identifying total adjusted quantities, and final change order if required.

1.3 OPERATION AND MAINTENANCE DATA

- A. Submit data bound in 8-1/2 x 11-inch text pages, three ring binders with metal hinges.
- B. Prepare binder cover with printed title "OPERATION AND MAINTENANCE INSTRUCTIONS", title of project, and subject matter of binder when multiple binders are required.
- C. Internally subdivide the binder contents with permanent page dividers, logically organized as described below; with tab titling clearly printed under reinforced laminated plastic tabs.
- D. Contents: Prepare a Table of Contents for each volume, with each Product or system description identified, typed on white paper, in three parts as follows:
1. Section 1: Directory, listing names, addresses, and telephone numbers of Engineer, Contractor, Subcontractors, and major equipment suppliers.
 2. Section 2: Operation and maintenance instructions, arranged by specification section. For each category, identify names, addresses, and telephone numbers of Subcontractors, suppliers and manufacturers. Identify the following:
 - a. Significant design criteria.
 - b. List of equipment.
 - c. Parts list for each component.
 - d. Operating instructions.
 - e. Maintenance instructions for equipment and systems.
 - f. Maintenance instructions for finishes, including recommended cleaning methods and materials, and special precautions identifying detrimental agents.
 3. Section 3: Project documents and certificates, including the following:
 - a. Air and water balance reports.
 - b. Certificates.

- c. Photocopies of warranties and bonds.
- E. Submit 1 draft copy of completed volumes 30 days prior to final inspection. This copy will be reviewed and returned after final inspection, with Engineer comments. Revise content of all document sets as required prior to final submission.
- F. Submit the required number of sets of revised final volumes within 30 days after receipt of Engineer's comments.

1.4 SPARE PARTS AND MAINTENANCE MATERIALS

- A. Provide products, spare parts, maintenance, and extra materials in quantities specified in individual specification sections.
- B. Deliver to Project site and place in location as directed; obtain receipt prior to final payment.
- C. Contractor shall furnish an inventory listing of all spare parts for each piece of equipment using the form included at the end of this section, or similar form.

1.5 WARRANTIES

- A. Provide notarized copies of all warranties.
- B. Execute and assemble transferable warranty documents from Subcontractors, suppliers, and manufacturers.
- C. Provide Table of Contents and assemble in three ring binder similar to O&M manuals.
- D. Submit prior to final Application for Payment.
- E. For items of Work delayed beyond date of Substantial Completion, provide updated submittal within 10 days after acceptance, listing date of acceptance as start of warranty period.

1.6 PROJECT RECORDS

- A. Specifications: Contractor shall legibly mark and record at each Product section description of actual Products installed, including the following:
 - 1. Manufacturer's name and product model and number.
 - 2. Product substitutions or alternates utilized.
 - 3. Changes made by Addenda and modifications.
- B. Drawings: Contractor shall legibly mark each item to record actual construction including:
 - 1. Measured depths of foundations in relation to finish floor datum.
 - 2. Measured horizontal and vertical locations of underground utilities and appurtenances, referenced to permanent surface improvements.
 - 3. Measured locations of internal utilities and appurtenances concealed in construction, referenced to visible and accessible features of the Work.
 - 4. Field changes of dimension and detail.
 - 5. Details not on original Contract drawings

PART 2 PRODUCTS (NOT USED)

PART 3 EXECUTION (NOT USED)

END OF SECTION

SECTION 024100
DEMOLITION

PART 1 GENERAL

1.1 SUMMARY

- A. The removal and or reuse, salvage and disposal of materials and equipment necessary for the work to be performed as shown on the Drawings and as specified herein.
- B. Existing buildings, structures, boxes, pipes, pavements, curbs, and other items are to be removed, altered, salvaged, and disposed of as specified herein or indicated in the drawings.
- C. Equipment, material, and piping, except as specified to be salvaged for the Owner, or removed by others, within the limits of the demolition, excavations, and backfills, will become the property of the Contractor and shall be removed from the project site. The salvage value of this equipment, materials, and piping shall be reflected in the contract price.

1.2 PROCEDURES

- A. Procedures to be used for the removal of all types of materials shall provide for careful removal and disposition of materials specified to be salvaged, protection of property which is to remain undisturbed, coordination with other work in progress, and timely disconnection of utility services. Existing property which is damaged by the Contractor's operations shall be repaired or replaced in kind by the Contractor at no additional cost to the Owner.
- B. Existing Utilities: The Contractor shall notify the Owner and other proper authorities concerned not less than seven days before starting work in any area. He shall furnish all necessary information as to the nature and extent of the work and shall obtain their cooperation and instructions in locating and protecting all underground pipes, cables, and other utilities. All utility line locations shown on the Drawings are approximate.
- C. Perform the work in a manner that will not damage parts of the structure not intended to be removed or to be salvaged for the Owner. If, in the opinion of the Owner's Representative, the method of demolition used may endanger or damage parts of the structure or affect the satisfactory operation of the facilities, promptly change the method when so notified by the Owner's Representative.
- D. Explosives: The use of explosives will not be permitted.

1.3 SUBMITTALS

- A. Submit shop drawings in accordance with the Section 013300.
- B. Shop Drawings: Indicate demolition and removal sequence and location of salvageable items. Include proposed method of demolition and provisions for erosion, dust, and noise control.
- C. Project Record Documents: Accurately record actual locations of capped utilities and subsurface obstructions. Indicate what fill materials were used in backfilling. Information is to be recorded in drawing form.
- D. Salvaged Material Data: Submit description of all salvaged materials, inspection data, and parts lists.

PART 2 PRODUCTS

2.1 MATERIALS

- A. Materials noted to be removed and not relocated, salvaged, or reused in the project shall be removed from the construction site and disposed of by the Contractor. Salvaged materials shall be delivered to an area designated by the Engineer or Owner.
- B. Do not reuse material salvaged from demolition work on this project, except as specifically shown or specified.

PART 3 EXECUTION

3.1 GENERAL

- A. During removal operations all persons and property shall be protected from injury or damage. The work shall proceed in a manner that will minimize the generation and spread of dust, flying particles and objectionable odors.

3.2 PROTECTION

- A. Before beginning any cutting or demolition work, the Contractor shall carefully survey the existing structures and examine the Drawings and specifications to determine the extent of the proposed construction activities. The Contractor shall take all necessary precautions to insure against damage to existing work to remain in place, to be reused, or to remain the property of the Owner, and any damage to such work shall be repaired or replaced as approved by the Engineer at no additional cost to the Owner. Repairing shall mean the restoration of a surface or item to a condition as near as practicable to match the existing adjoining surfaces unless otherwise noted, detailed, or specified. When repairing involves painting, special coatings, vinyl fabric, or other applied finish, refinish the entire surface plane (i.e., wall or ceiling), unless complete refinishing of the entire space is scheduled or specified. Repairing includes cleaning of soiled surfaces.
- B. Erect, and maintain temporary barriers and security devices, including warning signs and lights, and similar measures, for protection of the public, Owner, Contractor's employees, and existing improvements to remain. Method and materials of the partitions including adequate bracing shall be submitted to the Engineer for review.
- C. Provide temporary weather protection, where required.
- D. Mark location of utilities.

3.3 DISPOSITION BY CLASSIFICATION

- A. Disposition of materials and equipment shall be indicated on the plans by the following designations:
 - 1. Reinstall: Material or equipment to be reinstalled into the work shall be carefully removed from the existing location, shall be cleaned, and otherwise readied for reuse, and shall be protected from damage. Such items shall be reinstalled in accordance with applicable sections of these specifications covering new items of similar categories.
 - 2. Salvage: Materials and equipment to be salvaged shall be carefully removed, cleaned and delivered to a location on Owner's premises as designated by the Engineer or Owner. Final list of items to be salvaged is subject to the Owner's review.
 - 3. Remove: Materials and equipment to be removed shall be considered scrap and shall be disposed of by the Contractor. Removed concrete shall be disposed of off-site unless otherwise directed by the Owner or his representative. Final list of items to be scrapped is subject to the Owner's review.
 - 4. Abandon: Materials and equipment to be abandoned in place shall be properly taken out of service according to the methods identified in the project specifications.

3.4 CLEAN-UP

- A. Debris and rubbish: Remove debris and rubbish from the site daily.

- B. Debris Control: Remove and transport debris in a manner as to prevent spillage on streets or adjacent areas.
- C. Regulations: Local regulations regarding hauling and disposal apply.

3.5 REMOVALS - GENERAL

- A. All mechanical and electrical materials indicated to be salvaged shall be removed prior to initiating the scrapping/removal of the existing structure or facility.
- B. All removed structural steel, supports, grating, etc. shall be scrapped unless otherwise noted on the Drawings.
- C. Structures, Walls, and Partitions: Structure and finish shall be removed to the minimum required to remove and install piping. The Contractor shall limit the size of openings for removal. At locations where pipes are removed and not reinstalled, the openings or holes shall be completely filled in to match the surrounding area. At locations where pipes are removed and reinstalled, the openings or holes shall be filled in as shown on the Drawings or specified.
- D. Remove all reinforcement, anchor bolts, and other protruding elements that can cause a safety hazard.
- E. All sanitary sewer lines to be abandoned in place shall be pressure filled with flowable concrete fill as specified in the section entitled "Cast in Place Concrete" unless otherwise shown.
- F. Exposed pipes to be abandoned may be plugged at the ends in lieu of being completely removed.
- G. Underground structures to be abandoned in place shall be filled with concrete or flowable concrete fill to a depth not less than the crown elevation of the uppermost connecting sewer line. The remaining volume of the structures shall be filled with flowable concrete fill or granular fill compacted 90% standard Proctor density.

3.6 REMOVALS - ASBESTOS PIPE

- A. Removal procedures shall be in accordance with current federal and state regulations. Testing of material may be required unless the material has been classified.

END OF SECTION

THIS PAGE INTENTIONALLY LEFT BLANK.

SECTION 030510
LEAKAGE TESTING OF HYDRAULIC STRUCTURES

PART 1 GENERAL

1.1 SUMMARY

- A. This section describes the method of testing concrete and pre-cast concrete hydraulic structures for leakage.

1.2 RELATED WORK SPECIFIED ELSEWHERE

- A. Precast Concrete Utility Structures: 330516.

PART 2 PRODUCTS

2.1 PROVIDE WATER, PIPING, AND EQUIPMENT TO TEST CONCRETE STRUCTURES FOR LEAKAGE.

PART 3 EXECUTION

3.1 GENERAL

- A. Hydrostatically test any reinforced concrete basin which will contain water to determine that it is free of detectable leaks. Do not start leak testing or cleaning of surfaces until cast-in-place concrete has achieved its full 28-day compressive strength and joint sealants have set and cured a minimum of 14 days. Basins to be tested shall be in their final condition with all structural supporting members (slabs, beams, etc.) in place and at their full 28-day compressive strength.
- B. Prior to testing, thoroughly clean exposed surfaces, removing surface laitance and loose matter from walls and slabs. Remove wash water and debris from the structures by means other than washing through plant piping. Replace crystalline waterproofing if damaged by cleaning operations.
- C. Conduct testing before backfill is placed against walls and after concrete has attained the specified compressive strength, the concrete has cured, and joint sealants have set and cured a minimum of 14 days.

3.2 LEAKAGE TEST PROCEDURE

- A. Fill hydraulic structures to be subjected to leakage tests with water to the maximum operating liquid level line. Filling shall not exceed 3 feet of water depth per 24-hour period. Filling shall be at a uniform rate over a 24-hour period with continuous monitoring. For structures with adjacent bays, fill all bays simultaneously. Empty adjacent bays alternately. Repair any running leaks which appear during filling before continuing.
- B. Seed the floor slab of each hydraulic structure with one bag of cement per 1,000-square-foot surface area. Seeding shall take place after the test filling has reached 18 inches in depth. Detect leaks in construction and expansion joints with the aid of a diver. Stir cementitious deposits on the floor. Observe cement deposits flowing toward leaks and repair where the defect is located.
- C. After the structure has been kept full for 48 hours, it will be assumed for the purposes of the test that the absorption of moisture by the concrete in the structure is complete. Close all valves and gates to the structure and measure the change in water surface each day for a five-day period.
- D. During the test period, examine exposed portions of the structure, and mark visible leaks or damp spots. Repair visible leaks or damp spots after dewatering. If the drop in water surface in a 24-hour period exceeds 1/10 of 1% of the normal volume of liquid contained in the structure, the leakage shall be considered excessive. Crystalline waterproofing shall be assumed to be fully effective within three days after filling the structure. Repair leaks and damp spots that still exist three days after filling.
- E. If the leakage is excessive, drain the structure, repair leaks and damp spots, and refill the structure and again test for leakage. Continue this process until leaks have been repaired.
- F. Inspect the manholes of the underdrain system for evidence of leaks in floor slabs. If leaking is indicated, locate and repair.
- G. Repair visible leaks and damp spots whether leakage exceeds the allowable leakage or not. Repair leaks and damp spots with the same procedure that would otherwise be used to repair leakage in the event that the leakage test fails.
- H. Repairs and additional filling and testing (including the cost of water) shall be made by the Contractor at no additional cost to the Owner.

3.3 REPAIR METHODS

- A. Methods for repairing concrete not passing the leakage test and that for repairs of leaks and damp spots shall be as described in Section 033000.

END OF SECTION

SECTION 033000
CAST-IN-PLACE CONCRETE

PART 1 GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract Documents, including Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. Section includes cast-in-place concrete, including formwork, reinforcement, concrete materials, mixture design, placement procedures, and finishes, for the following:
 - 1. Footings.
 - 2. Foundation walls.
 - 3. Slabs-on-grade.
 - 4. Suspended slabs.
 - 5. Concrete toppings.
 - 6. Building frame members.
 - 7. Building and basin walls.

1.3 DEFINITIONS

- A. Cementitious Materials: Portland cement alone or in combination with one or more of the following: blended hydraulic cement, fly ash and other pozzolans, ground granulated blast-furnace slag, and silica fume; subject to compliance with requirements.

1.4 ACTION SUBMITTALS

- A. Product Data: For each type of product indicated.
- B. Design Mixtures: For each concrete mixture. The proposed mix designs shall be submitted by the contractor for review to the engineer of record. Mix design is the responsibility of the Contractor subject to the limitations of the Specifications. Review processing of this submission will be required only as evidence that the mix has been designed by qualified persons and that the minimum requirements of the Specifications have been met. Such review will in no way alter the responsibility of the Contractor to furnish concrete meeting the requirements of the Specifications relative to all criteria listed in the specification. Concrete mix design quantities and test results shall be submitted for review and shall be accepted before concrete work is started. Reports covering the source, quality, and proportions of the concrete materials used in the design mix should include the following information:
- C. Submit alternate design mixtures when characteristics of materials, Project conditions, weather, test results, or other circumstances warrant adjustments.
- D. Steel Reinforcement Shop Drawings: Placing drawings that detail fabrication, bending, and placement. Include bar sizes, lengths, material, grade, bar schedules, stirrup spacing, bent bar diagrams, bar arrangement, splices and laps, mechanical connections, tie spacing, hoop spacing, and supports for concrete reinforcement.
- E. Formwork Shop Drawings: Prepared by or under the supervision of a qualified professional engineer detailing fabrication, assembly, and support of formwork.
 - 1. Shoring and Reshoring: Indicate proposed schedule and sequence of stripping formwork, shoring removal, and reshoring installation and removal.
- F. Construction Joint Layout: Indicate proposed construction joints required to construct the structure.
 - 1. Location of construction joints is subject to approval of the Engineer.

1.5 INFORMATIONAL SUBMITTALS

- A. Submit shop drawings and samples in accordance with Section 013300.
- B. Material Certificates: For each of the following, signed by manufacturers:
 - 1. Cementitious materials.
 - 2. Admixtures.
 - 3. Form materials and form-release agents.
 - 4. Steel reinforcement and accessories.
 - 5. Fiber reinforcement.

6. Waterstops.
 7. Curing compounds.
 8. Floor and slab treatments.
 9. Bonding agents.
 10. Adhesives.
 11. Vapor retarders.
 12. Semirigid joint filler.
 13. Joint-filler strips.
 14. Repair materials.
- C. Material Test Reports: For the following, from a qualified testing agency, indicating compliance with requirements:
1. Aggregates. Provide certificates that aggregate comply with ASTM C 33. State weathering region limits of coarse aggregates: severe, moderate, or negligible. State basis of determining that alkali reactivity potential is negligible. Identify certifications and tests to actual materials to be used in the work. Provide additional tests and certifications for each change in material source. Provide an alternate materials source of aggregate if tests indicate that aggregates are reactive or possess severe weathering potential. Submit gradation analysis for fine and course aggregate with concrete mix designs. If deleterious substances are present, state the amount.
- D. Floor surface flatness and levelness measurements indicating compliance with specified tolerances.
- E. Field quality-control reports.
- F. Minutes of preinstallation conference.

1.6 QUALITY ASSURANCE

- A. Installer Qualifications: A qualified installer who employs on Project personnel qualified as ACI-certified Flatwork Technician and Finisher and a supervisor who is an ACI-certified Concrete Flatwork Technician.
- B. Manufacturer Qualifications: A firm experienced in manufacturing ready-mixed concrete products and that complies with ASTM C 1602 requirements for production facilities and equipment.
1. Manufacturer certified according to NRMCA's "Certification of Ready Mixed Concrete Production Facilities."
- C. Testing Agency Qualifications: An independent agency, qualified according to ASTM C 1077 and ASTM E 329 for testing indicated.
1. Personnel conducting field tests shall be qualified as ACI Concrete Field Testing Technician, Grade 1, according to ACI CP-1 or an equivalent certification program.
 2. Personnel performing laboratory tests shall be ACI-certified Concrete Strength Testing Technician and Concrete Laboratory Testing Technician - Grade I. Testing Agency laboratory supervisor shall be an ACI-certified Concrete Laboratory Testing Technician - Grade II.
- D. Source Limitations: Obtain each type or class of cementitious material of the same brand from the same manufacturer's plant, obtain aggregate from single source, and obtain admixtures from single source from single manufacturer.
- E. Welding Qualifications: Qualify procedures and personnel according to AWS D1.4, "Structural Welding Code - Reinforcing Steel."
- F. ACI Publications: Comply with the following unless modified by requirements in the Contract Documents:
1. ACI 301, "Specifications for Structural Concrete," Sections 1 through 5 and Section 7, "Lightweight Concrete."
 2. ACI 117, "Specifications for Tolerances for Concrete Construction and Materials."
 3. ACI 318, "Building Code requirements for Structural Concrete"
 4. ACI 350, "Code Requirements for Environmental Engineering Concrete Structures"
- G. Concrete Testing Service: Engage a qualified independent testing agency to perform material evaluation tests and to design concrete mixtures.
- H. Evaluation and Acceptance of Concrete
1. Evaluation and acceptance of the compressive strength of concrete shall be according to the requirements of ACI 318, Chapter 5 "Concrete Quality, Mixing, and Placing", and as specified herein.
 2. If any concrete fails to meet these requirements, immediate corrective action shall be taken to increase the compressive strength for all subsequent batches of the type of concrete affected.

3. All concrete which fails to meet ACI requirements and these specifications, is subject to removal and replacement at the cost of the Contractor.
- I. In the event tests on control specimens of concrete fall below the specified requirements, the Engineer may permit check tests for strengths to be made by means of typical cores drilled from the related part of the structure in accordance with ASTM C 42 and C 39. All costs associated with the failure to meet the specification requirements, including this type of testing and removal and replacement shall be borne by the Contractor.

1.7 DELIVERY, STORAGE, AND HANDLING

- A. Steel Reinforcement: Deliver, store, and handle steel reinforcement to prevent bending and damage.
- B. Waterstops: Store waterstops under cover to protect from moisture, sunlight, dirt, oil, and other contaminants.

PART 2 PRODUCTS

2.1 FORM-FACING MATERIALS

- A. Smooth-Formed Finished Concrete: Form-facing panels that will provide continuous, true, and smooth concrete surfaces. Furnish in largest practicable sizes to minimize number of joints.
 1. Plywood, metal, or other approved panel materials.
 2. Exterior-grade plywood panels, suitable for concrete forms, complying with DOC PS 1, and as follows:
 - a. High-density overlay, Class 1 or better.
 - b. Medium-density overlay, Class 1 or better; mill-release agent treated and edge sealed.
 - c. Structural 1, B-B or better; mill oiled and edge sealed.
 - d. B-B (Concrete Form), Class 1 or better; mill oiled and edge sealed.
- B. Rough-Formed Finished Concrete: Plywood, lumber, metal, or another approved material. Provide lumber dressed on at least two edges and one side for tight fit.
- C. Forms for Cylindrical Columns, Pedestals, and Supports: Metal, glass-fiber-reinforced plastic, paper, or fiber tubes that will produce surfaces with gradual or abrupt irregularities not exceeding specified formwork surface class. Provide units with sufficient wall thickness to resist plastic concrete loads without detrimental deformation.
- D. Pan-Type Forms: Glass-fiber-reinforced plastic or formed steel, stiffened to resist plastic concrete loads without detrimental deformation.
- E. Void Forms: Biodegradable paper surface, treated for moisture resistance, structurally sufficient to support weight of plastic concrete and other superimposed loads.
- F. Chamfer Strips: Wood, metal, PVC, or rubber strips, 3/4 by 3/4 inch, minimum.
- G. Rustication Strips: Wood, metal, PVC, or rubber strips, kerfed for ease of form removal.
- H. Form-Release Agent: Commercially formulated form-release agent that will not bond with, stain, or adversely affect concrete surfaces and will not impair subsequent treatments of concrete surfaces.
 1. Formulate form-release agent with rust inhibitor for steel form-facing materials.
- I. Form Ties: Factory-fabricated, removable or snap-off metal or glass-fiber-reinforced plastic form ties designed to resist lateral pressure of fresh concrete on forms and to prevent spalling of concrete on removal.
 1. Furnish units that will leave no corrodible metal closer than 1 inch to the plane of exposed concrete surface.
 2. Furnish ties that, when removed, will leave holes no larger than 1 inch in diameter in concrete surface.
 3. Furnish ties with integral water-barrier plates to walls indicated to receive dampproofing or waterproofing.
 4. Form ties for liquid retaining walls and walls below grade shall be provided with water stop washers located on the permanently embedded portions of the ties at the approximate center of the wall.
 5. Bolts and rods that are to be completely withdrawn shall be coated with a nonstaining bond breaker.
 6. The Contractor shall be responsible for the water tightness of the form ties and any repairs needed.

2.2 STEEL REINFORCEMENT

- A. Recycled Content of Steel Product may be utilized at proportions approved by Engineer.
- B. Reinforcing Bars: ASTM A 615, Grade 60, deformed.
- C. Low-Alloy-Steel Reinforcing Bars: ASTM A 706, deformed
- D. Steel Bar Mats: ASTM A 184, fabricated from ASTM A 615, Grade 60, deformed bars, assembled with clips.
- E. Plain-Steel Wire: ASTM A 82.
- F. Deformed-Steel Wire: ASTM A 496.
- G. Plain-Steel Welded Wire Reinforcement: ASTM A 185, plain, fabricated from as-drawn steel wire into flat sheets.
- H. Deformed-Steel Welded Wire Reinforcement: ASTM A 497, flat sheet.

2.3 REINFORCEMENT ACCESSORIES

- A. Joint Dowel Bars: ASTM A 615, Grade 60, plain-steel bars, cut true to length with ends square and free of burrs.
- B. Epoxy-Coated Joint Dowel Bars: ASTM A 615, Grade 60, plain-steel bars, ASTM A 775 epoxy coated.
- C. Epoxy Repair Coating: Liquid, two-part, epoxy repair coating; compatible with epoxy coating on reinforcement and complying with ASTM A 775.
- D. Zinc Repair Material: ASTM A 780, zinc-based solder, paint containing zinc dust, or sprayed zinc.
- E. Bar Supports: Bolsters, chairs, spacers, and other devices for spacing, supporting, and fastening reinforcing bars and welded wire reinforcement in place. Manufacture bar supports from steel wire, plastic, or precast concrete according to CRSI's "Manual of Standard Practice," of greater compressive strength than concrete and as follows:
 - 1. For concrete surfaces exposed to view where legs of wire bar supports contact forms, use CRSI Class 1 plastic-protected steel wire or CRSI Class 2 stainless-steel bar supports.
- F. Bar Couplers: Reinforcing steel bar splicing couplers shall be a mechanical type as manufactured by Dayton Barsplice Inc., or equal. Use couplers which develop 125% of the specified yield strength of the reinforcing bars. Make field demonstrations and sample splicing prior to splicing bars being included into the work.

2.4 CONCRETE MATERIALS

- A. Cementitious Material: Use the following cementitious materials, of the same type, brand, and source, throughout Project:
 - 1. Portland Cement: ASTM C 150, Type I; gray.
 - a. Fly Ash: ASTM C 618, Class F.
 - b. Ground Granulated Blast-Furnace Slag: ASTM C 989, Grade 100 or 120.
 - c. The Portland cement shall contain not more than 0.60% alkalis. The term "alkalies" referred to herein is defined as the sum of the percentage of sodium oxide and 0.658 times the percentage of potassium oxide ($\text{Na}_2\text{O} + 0.658 \text{K}_2\text{O}$). These oxides shall be determined in accordance with ASTM C 114.
 - d. The Portland cement shall contain not more than 8% tricalcium aluminate.
 - e. A single brand of cement shall be used throughout the Work, and prior to its use, the brand shall be acceptable to the Engineer.
 - f. The cement shall be suitably protected from exposure to moisture until used. Cement that has become lumpy shall not be used. Sacked cement shall be stored in such a manner so as to permit access for inspection and sampling.
 - g. Certified mill test reports for each shipment of cement to be used shall be submitted to the Engineer if requested regarding compliance with these Specifications.
 - h. Fly ash shall have a carbon content of less than 4% as measured by the loss on ignition. 75% of the fly ash shall have a fineness of 45 microns or less.
- B. Silica Fume: ASTM C 1240, amorphous silica.
- C. Normal-Weight Aggregates: ASTM C 33, Class 3S; coarse aggregate or better, graded. Provide aggregates from a single source.
 - 1. Fine Aggregate: Free of materials with deleterious reactivity to alkali in cement.
 - 2. Coarse aggregates shall consist of well-graded, clean, hard, durable gravel, crushed gravel,

crushed rock or a combination thereof. Coarse aggregates shall not contain any materials that are reactive with the alkalis in the cement when exposed to moisture. Where aggregate reactivity has not been established or tested, low-alkali cement shall be used.

3. Fine aggregates shall be natural sand or a combination of natural and manufactured sand that are hard and durable.
4. Combined aggregates shall be well graded from coarse to fine sizes, and shall be uniformly graded between screen sizes to produce a concrete that has optimum workability and consolidation characteristics. Where a trial batch is required for a mix design, the final combined aggregate gradations will be established during the trial batch process
5. When tested in accordance with "Potential Reactivity of Aggregates (Chemical Method)" (ASTM C 289), the ratio of silica released to reduction in alkalinity shall not exceed 1.0.
6. When tested in accordance with "Organic Impurities in Sands for Concrete" (ASTM C 40), the fine aggregate shall produce a color in the supernatant liquid no darker than the reference standard color solution.
7. When tested in accordance with "Resistance to Abrasion of Small size Coarse Aggregate by Use of the Los Angeles Machine (ASTM C 131), the coarse aggregate shall show a loss not exceeding 42% after 500 revolutions, or 10.5% after 100 revolutions.
8. When tested in accordance with "Soundness of Aggregates by Use of Sodium Sulfate or Magnesium Sulfate" (ASTM C 88), the loss resulting after five cycles shall not exceed 15% for fine or coarse aggregate when using sodium sulfate.

D. Lightweight Aggregate: ASTM C 330, 1-inch; nominal maximum aggregate size.

E. Water: ASTM C 1602.

2.5 ADMIXTURES

A. Air-Entraining Admixture: ASTM C 260.

B. Concrete used for liquid containing or retaining structures such as tanks, basins or other liquid retaining or holding structures shall include a crystalline waterproofing admixture such as that manufactured by Xypex Chemical Corp. Such admixture is to be provided for all elements of such liquid containing or retaining structures including top slabs and beams for closed tanks or basins. Equal admixtures from any other manufacturer are acceptable. Mix designs containing flyash shall use Xypex Admix C-500 or equal. Mix design without fly ash shall use Xypex Admix C-1000 or equal. Follow all manufacturer recommendations including dosage rates.

C. Chemical Admixtures: Provide admixtures certified by manufacturer to be compatible with other admixtures and that will not contribute water-soluble chloride ions exceeding those permitted in hardened concrete. Do not use calcium chloride or admixtures containing calcium chloride.

1. Water-Reducing Admixture: ASTM C 494, Type A.
2. Retarding Admixture: Use where the air temperature at the time of placement is expected to be consistently over 80° F. ASTM C 494, Type B.
3. Water-Reducing and Retarding Admixture: ASTM C 494, Type D.
4. High-Range, Water-Reducing Admixture: ASTM C 494, Type F. High-Range, Water-Reducing and Retarding Admixture: ASTM C 494, Type G.
 - a. If the high range water reducing agent is added to the concrete at the batch plant, it shall be second generation type, W.R. Grace & Co. Daracem 100; BASF Pozzolith 430R, or equal. High range water reducer shall be added to the concrete after all other ingredients have been mixed and initial slump has been verified.
 - b. If the high range water reducer is added to the concrete at the job site, it shall be used in conjunction with a low range water reducer and shall be BASF Pozzolith 400N and Pozzolith MBL82, W.R. Grace & Co. WRDA 19 and WRDA 79, or equal. Concrete shall have a slump of 3 inches ± 1/2 inch prior to adding the high range water reducing admixture at the job site. The high range water reducing admixture shall be accurately measured and pressure injected into the mixer as a single dose by an experienced technician. A standby system shall be provided and tested prior to each day's operation of the job site system.
 - c. Concrete shall be mixed at mixing speed for a minimum of 30 mixer revolutions after the addition of the high range water reducer.
5. Plasticizing and Retarding Admixture: ASTM C 1017, Type II.

D. Set-Accelerating Corrosion-Inhibiting Admixture: Use where the air temperature at the time of placement is expected to be consistently under 40° F. Commercially formulated, anodic inhibitor or

mixed cathodic and anodic inhibitor; capable of forming a protective barrier and minimizing chloride reactions with steel reinforcement in concrete and complying with ASTM C 494, Type C.

1. Products: Subject to compliance with requirements, available products that may be incorporated into the Work include, but are not limited to, the following:
 - a. Axim Italcementi Group, Inc.; CATEXOL CN-CI.
 - b. BASF Construction Chemicals - Building Systems; Rheocrete CNI.
 - c. Euclid Chemical Company (The), an RPM company; ARRMATECT.
 - d. Grace Construction Products, W. R. Grace & Co.; DCI.
 - e. Sika Corporation; Sika CNI.
- E. Non-Set-Accelerating Corrosion-Inhibiting Admixture: Commercially formulated, non-set-accelerating, anodic inhibitor or mixed cathodic and anodic inhibitor; capable of forming a protective barrier and minimizing chloride reactions with steel reinforcement in concrete.
 1. Products: Subject to compliance with requirements, available products that may be incorporated into the Work include, but are not limited to, the following:
 - a. BASF Construction Chemicals - Building Systems; Rheocrete 222+.
 - b. Cortec Corporation; MCI-2000.
 - c. Grace Construction Products, W. R. Grace & Co.; DCI-S.
 - d. Sika Corporation; FerroGard 901
- F. Color Pigment: ASTM C 979, synthetic mineral-oxide pigments or colored water-reducing admixtures; color stable, nonfading, and resistant to lime and other alkalis
 1. Manufacturers: Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:
 - a. ChemMasters.
 - b. Davis Colors.
 - c. Dayton Superior Corporation.
 - d. Hoover Color Corporation.
 - e. Lambert Corporation.
 - f. QC Construction Products.
 - g. Rockwood Pigments NA, Inc.
 - h. Scofield, L. M. Company.
 - i. Solomon Colors, Inc.
 2. Color: As indicated by manufacturer's designation.

2.6 FIBER REINFORCEMENT

- A. Carbon-Steel Fiber: ASTM A 820, deformed, minimum of *1.5 inches* long, and aspect ratio of *35 to 40*.
 1. Products: Subject to compliance with requirements, available products that may be incorporated into the Work include, but are not limited to, the following:
 - a. Fiber: Type 1, Cold-Drawn Wire:
 - 1) Bekaert; Dramix.
 - 2) Fibercon International, Inc.; Fibercon Drawn Wire.
 - 3) Nycon, Inc.; Nycon SF Type I.
 - 4) Propex Concrete Systems Corp.; Novocon 1050.
 - 5) Sika Corporation; Sika Fiber SH.
 - b. Fiber: Type 2, Cut Sheet:
 - 1) Bekaert; Wiremix.
 - 2) Fibercon International, Inc.; Fibercon Cut Sheet.
 - 3) Nycon, Inc.; Nycon SF Type II.
 2. Products: Subject to compliance with requirements, available products that may be incorporated into the Work include, but are not limited to, the following:
 - a. Monofilament Micro-Fibers:
 - 1) Axim Italcementi Group, Inc.; Fibrasol II P.
 - 2) Euclid Chemical Company (The), an RPM company; Fiberstrand 100.
 - 3) FORTA Corporation; FORTA Econo-Mono.
 - 4) Grace Construction Products, W. R. Grace & Co.; Grace MicroFiber.
 - 5) Metalcrete Industries; Polystrand 1000.
 - 6) Nycon, Inc.; ProConM.
 - 7) Propex Concrete Systems Corp.; Fibermesh 150.
 - 8) Sika Corporation; Sika Fiber PPM.

- b. Fibrillated Micro-Fibers:
 - 1) Axim Italcementi Group, Inc.; Fibrasol F.
 - 2) Euclid Chemical Company (The), an RPM company; Fiberstrand F.
 - 3) FORTA Corporation; FORTA Econo-Net.
 - 4) Grace Construction Products, W. R. Grace & Co.; Grace Fibers.
 - 5) Nycon, Inc.; ProConF.
 - 6) Propex Concrete Systems Corp.; Fibermesh 300.
 - 7) Sika Corporation; Sika Fiber PPF.
- B. Synthetic Macro-Fiber: Polyolefin macro-fibers engineered and designed for use in concrete, complying with ASTM C 1116, Type III, 1 to 2-1/4 inches long.
 - 1. Products: Subject to compliance with requirements, available products that may be incorporated into the Work include, but are not limited to, the following:
 - a. 3M; Scotchcast Polyolefin Fibers 1".
 - b. Euclid Chemical Company (The), an RPM company; Tuf-Strand SF.
 - c. FORTA Corporation; FORTA FERRO.
 - d. Grace Construction Products, W. R. Grace & Co.; Strux 90/40.
 - e. Nycon, Inc.; XL.
 - f. Propex Concrete Systems Corp.; Fibermesh 650.
 - g. Sika Corporation; Sika Fiber MS.

2.7 WATERSTOPS

- A. Flexible Rubber Waterstops: CE CRD-C 513, with factory-installed metal eyelets, for embedding in concrete to prevent passage of fluids through joints. Factory fabricate corners, intersections, and directional changes.
 - 1. Manufacturers: Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:
 - a. Greenstreak.
 - b. Williams Products, Inc.
 - 2. Profile: Flat, dumbbell with center bulb.
 - 3. Dimensions: 4 inches by 3/16 inch thick, nontapered.
- B. Flexible PVC Waterstops: CE CRD-C 572, [with factory-installed metal eyelets,] for embedding in concrete to prevent passage of fluids through joints. Factory fabricate corners, intersections, and directional changes.
 - 1. Manufacturers: Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:
 - a. BoMetals, Inc.
 - b. Greenstreak.
 - c. Paul Murphy Plastics Company.
 - d. Vinylex Corp.
 - 2. Profile: Flat, dumbbell with center bulb.
 - 3. Dimensions: 4 inches by 3/16 inch thick; nontapered.
- C. Self-Expanding Butyl Strip Waterstops: Manufactured rectangular or trapezoidal strip, butyl rubber with sodium bentonite or other hydrophilic polymers, for adhesive bonding to concrete, 3/4 by 1 inch.
 - 1. Products: Subject to compliance with requirements, available products that may be incorporated into the Work include, but are not limited to, the following:
 - a. Carlisle Coatings & Waterproofing, Inc.; MiraSTOP.
 - b. CETCO; Volclay Waterstop-RX.
 - c. Concrete Sealants Inc.; Conseal CS-231.
 - d. Greenstreak; Swellstop.
 - e. Henry Company, Sealants Division; Hydro-Flex.
 - f. JP Specialties, Inc.; Earth Shield Type 20.
- D. Self-Expanding Rubber Strip Waterstops: Manufactured rectangular or trapezoidal strip, bentonite-free hydrophilic polymer modified chloroprene rubber, for adhesive bonding to concrete, 3/8 by 3/4 inch.
 - 1. Products: Subject to compliance with requirements, available products that may be incorporated into the Work include, but are not limited to, the following:
 - a. Adeka Ultra Seal/OCM, Inc.; Adeka Ultra Seal.
 - b. Greenstreak; Hydrotite.

- c. Vinylex Corp.; Swellseal.

2.9 CURING MATERIALS

- A. Evaporation Retarder: Waterborne, monomolecular film forming, manufactured for application to fresh concrete.
 - 1. Products: Subject to compliance with requirements, available products that may be incorporated into the Work include, but are not limited to, the following:
 - a. Axim Italcementi Group, Inc.; CATEXOL CimFilm.
 - b. BASF Construction Chemicals - Building Systems; Confilm.
 - c. ChemMasters; SprayFilm.
 - d. Conspec by Dayton Superior; Aquafilm.
 - e. Dayton Superior Corporation; Sure Film (J-74).
 - f. Edoco by Dayton Superior; BurkeFilm.
 - g. Euclid Chemical Company (The), an RPM company; Eucobar.
 - h. Kaufman Products, Inc.; Vapor-Aid.
 - i. Lambert Corporation; LAMBCO Skin.
 - j. L&M Construction Chemicals, Inc.; E-CON.
 - k. Meadows, W. R., Inc.; EVAPRE.
 - l. Metalcrete Industries; Waterhold.
 - m. Nox-Crete Products Group; MONOFILM.
 - n. Sika Corporation; SikaFilm.
 - o. SpecChem, LLC; Spec Film.
 - p. Symons by Dayton Superior; Finishing Aid.
 - q. TK Products, Division of Sierra Corporation; TK-2120 TRI-FILM.
 - r. Unitex; PRO-FILM.
 - s. Vexcon Chemicals, Inc.; Certi-Vex Envio Set.
- B. Absorptive Cover: AASHTO M 182, Class 2, burlap cloth made from jute or kenaf, weighing approximately 9 oz. / sq. yd. when dry.
- C. Moisture-Retaining Cover: ASTM C 171, polyethylene film or white burlap-polyethylene sheet.
- D. Water: Potable.
- E. Clear, Waterborne, Membrane-Forming Curing Compound: ASTM C 309, Type 1, Class B, nondissipating
 - 1. Products: Subject to compliance with requirements, available products that may be incorporated into the Work include, but are not limited to, the following:
 - a. Anti-Hydro International, Inc.; AH Clear Cure WB.
 - b. BASF Construction Chemicals - Building Systems; Kure-N-Seal WB.
 - c. ChemMasters; Safe-Cure & Seal 20.
 - d. Conspec by Dayton Superior; Cure and Seal WB.
 - e. Cresset Chemical Company; Crete-Trete 309-VOC Cure & Seal.
 - f. Dayton Superior Corporation; Safe Cure and Seal (J-18).
 - g. Edoco by Dayton Superior; Spartan Cote WB II.
 - h. Euclid Chemical Company (The), an RPM company; Aqua Cure VOX; Clearseal WB 150.
 - i. Kaufman Products, Inc.; Cure & Seal 309 Emulsion.
 - j. Lambert Corporation; Glazecote Sealer-20.
 - k. L&M Construction Chemicals, Inc.; Dress & Seal WB.
 - l. Meadows, W. R., Inc.; Vocomp-20.
 - m. Metalcrete Industries; Metcure.
 - n. Nox-Crete Products Group; Cure & Seal 150E.
 - o. Symons by Dayton Superior; Cure & Seal 18 Percent E.
 - p. TK Products, Division of Sierra Corporation; TK-2519 WB.
 - q. Vexcon Chemicals, Inc.; Starseal 309.
- F. Clear, Solvent-Borne, Membrane-Forming Curing and Sealing Compound: ASTM C 1315, Type 1, Class A.
 - 1. Products: Subject to compliance with requirements, available products that may be incorporated into the Work include, but are not limited to, the following:
 - a. BASF Construction Chemicals - Building Systems; Kure-N-Seal 25 LV.
 - b. ChemMasters; Spray-Cure & Seal Plus.
 - c. Conspec by Dayton Superior; Sealcure 1315.

- d. Dayton Superior Corporation; Day-Chem Cure and Seal (J-22UV).
 - e. Edoco by Dayton Superior; Cureseal 1315.
 - f. Euclid Chemical Company (The), an RPM company; Super Diamond Clear; LusterSeal 300.
 - g. Kaufman Products, Inc.; Sure Cure 25.
 - h. Lambert Corporation; UV Super Seal.
 - i. L&M Construction Chemicals, Inc.; Lumiseal Plus.
 - j. Meadows, W. R., Inc.; CS-309/30.
 - k. Metalcrete Industries; Seal N Kure 30.
 - l. Right Pointe; Right Sheen 30.
 - m. Vexcon Chemicals, Inc.; Certi-Vex AC 1315.
2. VOC Content: Curing and sealing compounds shall have a VOC content of 200 g/L or less when calculated according to 40 CFR 59, Subpart D (EPA Method 24).

2.10 SEALANT

- A. The joint sealant shall be a two-part, gray, nonstaining, nonsagging, polyurethane sealant, which cures at ambient temperature to a firm, flexible, resilient, tear-resistant rubber.
- B. Technical Requirements:

1. Consistency	Gun grade
2. Tack free time	72 hours maximum
3. Pot life	1 to 3 hours
4. Hardness	30 Shore A, +/-5
5. Elongation	50%
6. Tensile strength, ASTM D 412	200 psi
7. Peel strength on concrete	No loss of bond with 50% +/- movement
8. Temperature service range	-40 F to +150 F

- C. Backing Rod: Backing rod shall be an extruded closed-cell polyethulene foam road. The rod shall be 1/4 inch larger in diameter than the joint width. Where possible, provide full-length sections for the joint; minimize splices. Apply backup rod and bond breaker tape in expansion joints.
- D. Bond breaker tape shall be an adhesive-backed glazed butyl or polyethylene tape, which will adhere to the premolded joint material or concrete surface The tape shall be the same width as teh joint. The tape shall be compatible with the sealant.
- E. Expansion Joint Filler: Extruded closed-cell polyethalene foam equal in thickness to joint. Provide foam with tear off strip where joint to receive sealant.
- F. Pre-molded joint Filler: Joint filler shall be preformed, non-extruded type constructed of closed-cell neoprene conforming to ASTM D 1752. Type 1, as manufactured by W.R. Grace Company of Cambridge, Massachusetts; W. R. Meadows, Inc., Elgin, Illinois; or equal.

2.11 RELATED MATERIALS

- A. Expansion and Isolation-Joint-Filler Strips: ASTM D 1751, asphalt-saturated cellulosic fiber.
- B. Semirigid Joint Filler: Two-component, semirigid, 100 percent solids, epoxy resin with a Type A shore durometer hardness of 80 per ASTM D 2240.
- C. Bonding Agent: ASTM C 1059, Type II, non-redispersible, acrylic emulsion or styrene butadiene.
- D. Epoxy Bonding Adhesive: ASTM C 881, two-component epoxy resin, capable of humid curing and bonding to damp surfaces, of class suitable for application temperature and of grade to suit requirements, and as follows:
 - 1. Types I and II, non-load bearing, for bonding hardened or freshly mixed concrete to hardened concrete.
- E. Reglets: Fabricate reglets of not less than 0.022 inch thick, galvanized-steel sheet. Temporarily fill or cover face opening of reglet to prevent intrusion of concrete or debris.
- F. Dovetail Anchor Slots: Hot-dip galvanized-steel sheet, not less than 0.034 inch thick, with bent tab anchors. Temporarily fill or cover face opening of slots to prevent intrusion of concrete or debris.
- G. Nonepoxy bonding agent shall be Larsen Weldcrete, Euclid Euco Weld, or equal.
- H. Nonshrink grout shall conform to ASTM C 1107 and shall be BASF Masterflow 713, Sika

SikaGrout 212, or equal.

2.12 REPAIR MATERIALS

- A. Repair Underlayment: Cement-based, polymer-modified, self-leveling product that can be applied in thicknesses from 1/8 inch and that can be feathered at edges to match adjacent floor elevations.
 - 1. Cement Binder: ASTM C 150, portland cement or hydraulic or blended hydraulic cement as defined in ASTM C 219.
 - 2. Primer: Product of underlayment manufacturer recommended for substrate, conditions, and application.
 - 3. Aggregate: Well-graded, washed gravel, 1/8 to 1/4 inch or coarse sand as recommended by underlayment manufacturer.
 - 4. Compressive Strength: Not less than 4100 psi at 28 days when tested according to ASTM C 109.
- B. Repair Overlayment: Cement-based, polymer-modified, self-leveling product that can be applied in thicknesses from 1/4 inch (and that can be filled in over a scarified surface to match adjacent floor elevations).
 - 1. Cement Binder: ASTM C 150, portland cement or hydraulic or blended hydraulic cement as defined in ASTM C 219.
 - 2. Primer: Product of topping manufacturer recommended for substrate, conditions, and application.
 - 3. Aggregate: Well-graded, washed gravel, 1/8 to 1/4 inch or coarse sand as recommended by topping manufacturer.
 - 4. Compressive Strength: Not less than 5000 psi at 28 days when tested according to ASTM C 109.

2.13 CONCRETE MIXTURES, GENERAL

- A. Prepare design mixtures for each type and strength of concrete, proportioned on the basis of laboratory trial mixture or field test data, or both, according to ACI 301.
 - 1. Use a qualified independent testing agency for preparing and reporting proposed mixture designs based on laboratory trial mixtures.
- B. Cementitious Materials: Use fly ash, pozzolan, ground granulated blast-furnace slag, and silica fume as needed to reduce the total amount of portland cement, which would otherwise be used, by not less than 40 percent:
 - 1. Fly Ash: 25 percent.
 - 2. Combined Fly Ash and Pozzolan: 25 percent.
 - 3. Ground Granulated Blast-Furnace Slag: 50 percent.
 - 4. Combined Fly Ash or Pozzolan and Ground Granulated Blast-Furnace Slag: 50 percent portland cement minimum, with fly ash or pozzolan not exceeding 25 percent.
 - 5. Silica Fume: 10 percent.
 - 6. Combined Fly Ash, Pozzolans, and Silica Fume: 35 percent with fly ash or pozzolans not exceeding 25 percent and silica fume not exceeding 10 percent.
 - 7. Combined Fly Ash or Pozzolans, Ground Granulated Blast-Furnace Slag, and Silica Fume: 50 percent with fly ash or pozzolans not exceeding 25 percent and silica fume not exceeding 10 percent.
- C. Limit water-soluble, chloride-ion content in hardened concrete to 0.06 percent by weight of cement.
- D. Admixtures: Use admixtures according to manufacturer's written instructions.
 - 1. Use water-reducing admixture in concrete, as required, for placement and workability.
 - 2. Use water-reducing and retarding admixture when required by high temperatures, low humidity, or other adverse placement conditions.

3. Use water-reducing admixture in pumped concrete, concrete for heavy-use industrial slabs and parking structure slabs, concrete required to be watertight, and concrete with a water-cementitious materials ratio below 0.50.
 4. Use corrosion-inhibiting admixture in concrete mixtures where indicated.
- E. Color Pigment: Add color pigment to concrete mixture according to manufacturer's written instructions and to result in hardened concrete color consistent with approved mockup.
- F. Controlled Low Strength Material (Flowable Fill): Flowable fill shall be manufactured at plants that have qualified as an approved source in accordance with the Standard Operating Procedure for Ready-Mix Concrete
1. The Contractor shall submit mix design for flowable fill to the Engineer for approval. The following table lists the suggested mix design for flowable fill:

COMPONENT	QUANTITY
CEMENT TYPE 1	75-150 LB/YD3
FLY ASH	150-600 LB/YD3
WATER	MIX DESIGN SHALL PRODUCE A CONSISTENCY THAT WILL RESULT IN A FLOWABLE, SELF-LEVELING PRODUCT AT THE TIME OF PLACEMENT.
AIR	5%-15%
UNIT WEIGHT	100-125 LB/FT3

2.14 CONCRETE MIXTURES FOR BUILDING ELEMENTS

- A. Footings, Foundation Walls: Proportion normal-weight concrete mixture as follows:
1. Minimum Compressive Strength: 4500 psi at 28 days Maximum Water-Cementitious Materials Ratio: 0.5
 3. lump Limit: 5 inches for concrete with verified slump of 2 to 4 inches before adding high-range water-reducing admixture or plasticizing admixture.
 4. Air Content: 6 percent, plus or minus 1.5 percent at point of delivery for 1-inch nominal maximum aggregate size.
- B. Slabs-on-Grade: Proportion normal-weight concrete mixture as follows:
1. Minimum Compressive Strength: 4500 psi at 28 days.
 2. Minimum Cementitious Materials Content: 470 lb/cu. yd.
 3. Slump Limit: 5 inches, plus or minus 1 inch.
 4. Air Content: 6 percent, plus or minus 1.5 percent at point of delivery for 1-inch nominal maximum aggregate size.
 5. Air Content: Do not allow air content of trowel-finished floors to exceed 3 percent.
 6. Steel-Fiber Reinforcement: Add to concrete mixture, according to manufacturer's written instructions, at a rate of 50 lb/cu. yd
- C. Suspended Slabs: Proportion normal-weight concrete mixture as follows:
1. Minimum Compressive Strength: 5000 psi at 28 days.
 2. Minimum Cementitious Materials Content: 470 lb/cu. yd.
 3. Slump Limit: 4 inches, plus or minus 1 inch.
 4. Air Content: 6 percent, plus or minus 1.5 percent at point of delivery for 1-inch nominal maximum aggregate size.
 5. Air Content: Do not allow air content of trowel-finished floors to exceed 3 percent.
 6. Steel-Fiber Reinforcement: Add to concrete mixture, according to manufacturer's written instructions, at a rate of 50 lb/cu. yd.
 7. Synthetic Micro-Fiber: Uniformly disperse in concrete mixture at manufacturer's recommended rate, but not less than 1.0 lb/cu. yd.
 8. Synthetic Macro-Fiber: Uniformly disperse in concrete mixture at manufacturer's recommended rate, but not less than 4.0 lb/cu. yd.

2.15 FABRICATING REINFORCEMENT

- A. Fabricate steel reinforcement according to CRSI's "Manual of Standard Practice."

2.16 CONCRETE MIXING

- A. Ready-Mixed Concrete: Measure, batch, mix, and deliver concrete according to ASTM C 94/C 94M and furnish batch ticket information.
 - 1. When air temperature is between 85 and 90 deg F, reduce mixing and delivery time from 1-1/2 hours to 75 minutes; when air temperature is above 90 deg F, reduce mixing and delivery time to 60 minutes.
- B. Project-Site Mixing: Measure, batch, and mix concrete materials and concrete according to ASTM C 1602. Mix concrete materials in appropriate drum-type batch machine mixer.
 - 1. For mixer capacity of 1 cu. yd. or smaller, continue mixing at least 1-1/2 minutes, but not more than 5 minutes after ingredients are in mixer, before any part of batch is released.
 - 2. For mixer capacity larger than 1 cu. yd., increase mixing time by 15 seconds for each additional 1 cu. yd.
 - 3. Provide batch ticket for each batch discharged and used in the Work, indicating Project identification name and number, date, mixture type, mixture time, quantity, and amount of water added. Record approximate location of final deposit in structure.

PART 3 EXECUTION

3.1 FORMWORK

- A. Design, erect, shore, brace, and maintain formwork, according to ACI 301, to support vertical, lateral, static, and dynamic loads, and construction loads that might be applied, until structure can support such loads.
- B. Construct formwork so concrete members and structures are of size, shape, alignment, elevation, and position indicated, within tolerance limits of ACI 117.
- C. Limit concrete surface irregularities, designated by ACI 347 as abrupt or gradual, as follows:
 - 1. Class A, 1/8 inch for smooth-formed finished surfaces.
 - 2. Class B, 1/4 inch for rough-formed finished surfaces.
- D. Construct forms tight enough to prevent loss of concrete mortar.
- E. Fabricate forms for easy removal without hammering or prying against concrete surfaces. Provide crush or wrecking plates where stripping may damage cast concrete surfaces. Provide top forms for inclined surfaces steeper than 1.5 horizontal to 1 vertical.
 - 1. Install keyways, reglets, recesses, and the like, for easy removal.
 - 2. Do not use rust-stained steel form-facing material.
- F. Set edge forms, bulkheads, and intermediate screed strips for slabs to achieve required elevations and slopes in finished concrete surfaces. Provide and secure units to support screed strips; use strike-off templates or compacting-type screeds.
- G. Provide temporary openings for cleanouts and inspection ports where interior area of formwork is inaccessible. Close openings with panels tightly fitted to forms and securely braced to prevent loss of concrete mortar. Locate temporary openings in forms at inconspicuous locations.
- H. Chamfer exterior corners and edges of permanently exposed concrete.
- I. Form openings, chases, offsets, sinkages, keyways, reglets, blocking, screeds, and bulkheads required in the Work. Determine sizes and locations from trades providing such items.
- J. Clean forms and adjacent surfaces to receive concrete. Remove chips, wood, sawdust, dirt, and other debris just before placing concrete.
- K. Retighten forms and bracing before placing concrete, as required, to prevent mortar leaks and maintain proper alignment.
- L. Coat contact surfaces of forms with form-release agent, according to manufacturer's written instructions, before placing reinforcement.

3.2 EMBEDDED ITEMS

- A. Place and secure anchorage devices and other embedded items required for adjoining work that is attached to or supported by cast-in-place concrete. Use setting drawings, templates, diagrams, instructions, and directions furnished with items to be embedded.
 - 1. Install anchor rods, accurately located, to elevations required and complying with tolerances in Section 7.5 of AISC's "Code of Standard Practice for Steel Buildings and Bridges."
 - 2. Install reglets to receive waterproofing and to receive through-wall flashings in outer face of concrete frame at exterior walls, where flashing is shown at lintels, shelf angles, and other conditions.

3. Install dovetail anchor slots in concrete structures as indicated.

3.3 REMOVING AND REUSING FORMS

- A. General: Formwork for sides of beams, walls, columns, and similar parts of the Work that does not support weight of concrete may be removed after cumulatively curing at not less than 50 deg F for 24 hours after placing concrete. Concrete has to be hard enough to not be damaged by form-removal operations and curing and protection operations need to be maintained.
 1. Leave formwork for beam soffits, joists, slabs, and other structural elements that supports weight of concrete in place until concrete has achieved its 28-day design compressive strength.
 2. Remove forms only if shores have been arranged to permit removal of forms without loosening or disturbing shores.
- B. Clean and repair surfaces of forms to be reused in the Work. Split, frayed, delaminated, or otherwise damaged form-facing material will not be acceptable for exposed surfaces. Apply new form-release agent.
- C. When forms are reused, clean surfaces, remove fins and laitance, and tighten to close joints. Align and secure joints to avoid offsets. Do not use patched forms for exposed concrete surfaces unless approved by Engineer.

3.4 SHORES AND RESHORES

- A. Comply with ACI 318 and ACI 301 for design, installation, and removal of shoring and reshoring.
 1. Do not remove shoring or reshoring until measurement of slab tolerances is complete.
- B. Plan sequence of removal of shores and reshore to avoid damage to concrete. Locate and provide adequate reshoring to support construction without excessive stress or deflection.

3.5 STEEL REINFORCEMENT

- A. General: Bar bending details and placing drawings shall conform to the "Manual of Standard Practice for Detailing Reinforced Concrete Structures" ACI 315 and with CRSI's "Manual of Standard Practice" for placing reinforcement.
- B. Clean reinforcement of loose rust and mill scale, earth, ice, and other foreign materials that would reduce bond to concrete.
- C. Accurately position, support, and secure reinforcement against displacement. Locate and support reinforcement with bar supports to maintain minimum concrete cover. Do not tack weld crossing reinforcing bars.
- D. Set wire ties with ends directed into concrete, not toward exposed concrete surfaces.
- E. Install welded wire reinforcement in longest practicable lengths on bar supports spaced to minimize sagging. Lap edges and ends of adjoining sheets at least one mesh spacing. Offset laps of adjoining sheet widths to prevent continuous laps in either direction. Lace overlaps with wire. Steel in walls, unless otherwise shown, shall be continuous through the length of the various members.
- G. Wire mesh reinforcements in slabs shall be continuous, shall have joints lapped at least one full square + 2", and shall be supported as specified.
- H. Welding of reinforcing bars is prohibited unless noted otherwise. When welding is approved, welding shall be in accordance with AWS D1.4 "Welding Reinforcing Steel".
- I. Provide corner bars of the same size and spacing as adjacent reinforcing.
- J. Openings in walls or structural slabs shall be reinforced with minimum 2-#5 bars on all sides or as indicated in details. Extend reinforcing minimum 24" beyond the opening or as indicated.
- K. All reinforcing bars are to be made continuous or lapped minimum 48 bar diameters or as indicated on drawings.
- L. Dowel Bar Substitution: Contractor has the option to replace any or all dowels indicated on the drawings with a dowel bar substitution. Dowel bar substitution shall be of a size to match size of dowels indicated for strength. Inserts shall be secured to the forms in a manner recommended by the manufacturer. Bolts shall be provided with wire fabricated type to provide bolt clearance.
- M. Epoxy Adhesive Set Dowel Bars:
 1. Install in accordance with adhesive manufacture recommendations.
 2. Drill hole 1/8" larger than the bar outer diameter to a depth 1/2" deeper than the minimum design embedment.
 3. Clean the hole completely with brush and air blast removing all debris.

4. Fill hole half full with properly mixed adhesive.
5. Insert the bar while rotating it two full revolutions to completely distribute epoxy throughout the annular space.
6. Agitate the bars to remove all air voids to full depth embedment penetration.

3.6 JOINTS

- A. General: Construct joints true to line with faces perpendicular to surface plane of concrete.
- B. Construction Joints: Install so strength and appearance of concrete are not impaired, at locations indicated or as approved by Engineer.
 1. Place joints perpendicular to main reinforcement. Continue reinforcement across construction joints unless otherwise indicated. Do not continue reinforcement through sides of strip placements of floors and slabs.
 2. Form keyed joints as indicated. Embed keys at least 1 1/2 inches into concrete.
 3. Locate joints for beams, slabs, joists, and girders in the middle third of spans. Offset joints in girders a minimum distance of twice the beam width from a beam-girder intersection.
 4. Locate horizontal joints in walls and columns at underside of floors, slabs, beams, and girders and at the top of footings or floor slabs.
 5. Space vertical joints in walls as indicated. Locate joints beside piers integral with walls, near corners, and in concealed locations where possible.
 6. Use a bonding agent at locations where fresh concrete is placed against hardened or partially hardened concrete surfaces.
 7. Use epoxy-bonding adhesive at locations where fresh concrete is placed against hardened or partially hardened concrete surfaces.
- C. Contraction Joints in Slabs-on-Grade: Form weakened-plane contraction joints, sectioning concrete into areas as indicated. Construct contraction joints for a depth equal to at least one-fourth of concrete thickness as follows:
 1. Grooved Joints: Form contraction joints after initial floating by grooving and finishing each edge of joint to a radius of 1/8 inch. Repeat grooving of contraction joints after applying surface finishes. Eliminate groover tool marks on concrete surfaces.
 2. Sawed Joints: Form contraction joints with power saws equipped with shatterproof abrasive or diamond-rimmed blades. Cut 1/8 inch wide joints into concrete when cutting action will not tear, abrade, or otherwise damage surface and before concrete develops random contraction cracks.
 3. Isolation Joints in Slabs-on-Grade: After removing formwork, install joint-filler strips at slab junctions with vertical surfaces, such as column pedestals, foundation walls, grade beams, and other locations, as indicated. Extend joint-filler strips full width and depth of joint, terminating flush with finished concrete surface unless otherwise indicated.
 4. Terminate full-width joint-filler strips not less than 1/2 inch or more than 1 inch below finished concrete surface where joint sealants, specified in Division 07 Section "Joint Sealants," are indicated.
 5. Install joint-filler strips in lengths as long as practicable. Where more than one length is required, lace or clip sections together.
- D. Doweled Joints: Install dowel bars and support assemblies at joints where indicated. Lubricate or asphalt coat one-half of dowel length to prevent concrete bonding to one side of joint.

3.7 WATERSTOPS

- A. Flexible Waterstops: Install in construction joints and at other joints indicated to form a continuous diaphragm. Install in longest lengths practicable. Support and protect exposed waterstops during progress of the Work. Field fabricate joints in waterstops according to manufacturer's written instructions.
- B. To properly secure waterstops in wall joints before concrete is placed, drill holes in waterstops approximately 1 inch from each edge or between the outermost ribs at each edge and center the waterstop in the joint. Tie both edges of the waterstop and fasten to reinforcing steel with black annealed steel tie wire as specified for tying reinforcing steel and secure in place so that the waterstop will be perpendicular to the joint and remain in the required position during concrete placement. The spacing of the waterstop ties shall match the spacing of the adjacent reinforcing, but need not be spaced closer than 12 inches on center.
- C. Self-Expanding Strip Waterstops: Install in construction joints and at other locations indicated, according to manufacturer's written instructions, adhesive bonding, mechanically fastening, and firmly pressing into place. Install in longest lengths practicable.

- D. Horizontal PVC waterstops in slabs shall have the edge of the waterstop lifted while placing concrete below the waterstop. Then the waterstop shall be manually forced against and into the placed concrete and covered with fresh concrete, to ensure adequate encasement of the waterstop in concrete.
- E. Waterstops shall be installed so that half of the width will be embedded on each side of the joint. Care shall be exercised to ensure that the waterstop is completely embedded in void-free concrete.

3.8 INSTALLATION OF JOINT SEALANTS

- A. Immediately before installing the joint sealant, clean the joint cavity by sandblasting or power wire brushing. Install bond breaker tape per manufacturer's instructions.
- B. After the joints have been prepared as described above, apply the joint sealant. Apply the primer, if required, and joint sealant only with the equipment and methods recommended by the joint sealant manufacturer.
- C. Application criteria for the sealant materials, such as temperature and moisture requirements and primer cure time, shall be in accordance with the recommendations of the sealant manufacturer.
- D. Apply masking tape along the edges of the exposed surface of the exposed joints. Trowel the joints smooth with a tuck pointing tool wiped with a solvent recommended by the sealant manufacturer.
- E. After the sealant has been applied, remove the masking tape and any sealant spillage.
- F. Installation of Premolded Joint Filler: Install in joint accurately as shown. Attach to concrete with a bonding agent recommended by the joint sealant and joint filler manufacturer for compatibility.

3.9 CONCRETE PLACEMENT

- A. Before placing concrete, verify that installation of formwork, reinforcement, and embedded items is complete and that required inspections have been performed.
- B. Do not add water to concrete during delivery, at Project site, or during placement unless such quantity of water is intentionally withheld for later addition at project site. Such addition, in no case should result in altering of the specified water to cementitious material ratio. Indicate the amount of mixing water that is withheld for later addition at the project site on the batch tickets. Provide such batch tickets to the concrete inspector for review and record.
- C. Before test sampling and placing concrete, water may be added at Project site, subject to limitations of ACI 301.
 - 1. Do not add water to concrete after adding high-range water-reducing admixtures to mixture.
- D. Deposit concrete continuously in one layer or in horizontal layers of such thickness that no new concrete will be placed on concrete that has hardened enough to cause seams or planes of weakness. If a section cannot be placed continuously, provide construction joints as indicated. Deposit concrete to avoid segregation.
 - 1. Deposit concrete in horizontal layers of depth to not exceed formwork design pressures and in a manner to avoid inclined construction joints.
 - 2. Consolidate placed concrete with mechanical vibrating equipment according to ACI 301.
 - 3. Do not use vibrators to transport concrete inside forms. Insert and withdraw vibrators vertically at uniformly spaced locations to rapidly penetrate placed layer and at least 6 inches into preceding layer. Do not insert vibrators into lower layers of concrete that have begun to lose plasticity. At each insertion, limit duration of vibration to time necessary to consolidate concrete and complete embedment of reinforcement and other embedded items without causing mixture constituents to segregate.
- E. Deposit and consolidate concrete for floors and slabs in a continuous operation, within limits of construction joints, until placement of a panel or section is complete.
 - 1. Consolidate concrete during placement operations so concrete is thoroughly worked around reinforcement and other embedded items and into corners.
 - 2. Maintain reinforcement in position on chairs during concrete placement.
 - 3. Screed slab surfaces with a straightedge and strike off to correct elevations.
 - 4. Slope surfaces uniformly to drains where required.
 - 5. Begin initial floating using bull floats or darbies to form a uniform and open-textured surface plane, before excess bleedwater appears on the surface. Do not further disturb slab surfaces before starting finishing operations.
- F. Placement in Wall Forms: Concrete shall not be dropped through reinforcement steel or into any deep form, whether reinforcement is present or not, causing separation of the coarse aggregate from the mortar on account of repeatedly hitting rods or the sides of the form as it falls, nor shall concrete

be placed in any form in such a manner as to leave accumulation of mortar on the form surfaces above the placed concrete. In such cases, some means such as the use of hoppers and, if necessary, vertical ducts of canvas, rubber, or metal shall be used for placing concrete in the forms in a manner that it may reach the place of final deposit without separation. In no case shall the free fall of concrete exceed 4 feet before the ends of ducts, chutes, or buggies. Concrete shall be uniformly distributed during the process of depositing and in no case after depositing shall any portion be displaced in the forms more than 6 feet in horizontal direction. Concrete in forms shall be deposited in uniform horizontal layers not deeper than 2 feet; and care shall be taken to avoid inclined layers or inclined construction joints except where such are required for sloping members. Each layer shall be placed while the previous layer is still soft. The rate of placing concrete in forms shall not exceed 5 feet of vertical rise per hour.

- G. Conveyor Belts and Chutes: All ends of chutes, hopper gates, and all other points of concrete discharge throughout the Contractor's conveying, hoisting and placing system shall be so designed and arranged that concrete passing from them will not fall separated into whatever receptacle immediately receives it. Conveyor belts, if used, shall be of a type acceptable to the Engineer. Chutes longer than 50 feet will not be permitted. Minimum slopes of chutes shall be such that concrete of the specified consistency will readily flow in them. If a conveyor belt is used, it shall be wiped clean by a device operated in such a manner that none of the mortar adhering to the belt will be wasted. All conveyor belts and chutes shall be covered. Sufficient illumination shall be provided in the interior of all forms so that the concrete at the places of deposit is visible from the deck or runway.
- H. Placement in Slabs: Concrete placed in sloping slabs shall proceed uniformly from the bottom of the slab to the top, for the full width of the pour. As the work progresses, the concrete shall be vibrated and carefully worked around the slab reinforcement, and the surface of the slab shall be screeded in an upslope direction
- I. Temperature of Concrete: Concrete temperature shall conform to the applicable requirements of ACI 305R - Hot Weather Concreting, and ACI 306R - Cold Weather Concreting, unless otherwise modified herein. The temperature of concrete when it is being placed shall be not more than 90° F. Concrete ingredients shall not be heated to a temperature higher than that necessary to keep the temperature of the mixed concrete, as placed, from falling below the specified minimum temperature. If concrete is placed when the weather is such that the temperature of the concrete would exceed 90° F, the Contractor shall employ effective means, such as precooling of aggregates and mixing water using ice or placing at night, as necessary to maintain the temperature of the concrete, as it is placed, below 90° F. The Contractor shall be entitled to no additional compensation on the account of the foregoing requirements. See subsections 3.4 and 3.5 for additional requirements.
- J. Concrete shall be handled from the mixer to the place of final deposit as rapidly as practicable by methods, which will prevent segregation or loss of ingredients and in a manner that the required quality of the concrete is maintained. No concrete shall be placed more than 1½ hours after mixing of that particular batch has commenced.
- K. Pumping Equipment: Pumping equipment and procedures, if used, shall conform to the recommendations contained in the report of ACI Committee 304 on Placing Concrete by Pumping Methods, ACI 304.2R. The specified slump shall be measured at the point of discharge. The loss of slump in pumping shall not exceed 1 inch with or without a superplastizer. The slump loss shall be determined by tests made at each end of the pumping system. If tests indicate a loss greater than 1 inch, the contractor shall modify the pumping system as required to reduce the slump loss.
- L. The order of placing concrete in all parts of the work shall be acceptable to the Engineer. In order to minimize the effects of shrinkage, placement shall be scheduled so that one end of each unit is free, except at corner closures. The placing of units shall be done by placing alternate units in a manner such that each unit placed shall have cured at least 7 days before the contiguous unit or units are placed, except that the corner sections of vertical walls shall not be placed until the 2 adjacent wall panels have cured at least 14 days.
- M. The surface of the concrete shall be level whenever a run of concrete is stopped. To insure a level, straight joint on the exposed surface of walls, a wood strip at least 3/4 inch thick shall be tacked to the forms on these surfaces. The concrete shall be carried about 1/2 of an inch above the underside of the strip. About one hour after the concrete is placed, the strip shall be removed and any irregularities in the edge formed by the strip shall be leveled with a trowel and all laitance shall be removed.
- N. As concrete is placed in the forms or in excavations, it shall be thoroughly settled and compacted, throughout the entire depth of the layer which is being consolidated, into a dense, homogeneous mass, filling all corners and angles, thoroughly embedding the reinforcement, eliminating rock pockets,

and bringing only a slight excess of water to the exposed surface of concrete during placement. Vibrators shall be high-speed power vibrators (8,000 to 10,000 rpm) of an immersion type in sufficient number and with (at least one) standby units as required.

- O. Care shall be used in placing concrete around waterstops. The concrete shall be carefully worked by rodding and vibrating to make sure that all air and rock pockets have been eliminated. Where waterstops are placed horizontally, the concrete shall be worked under the waterstops by hand, making sure that all air and rock pockets have been eliminated. Concrete surrounding the waterstops shall be given additional vibration, over and above that used for adjacent concrete placement to assure complete embedment of the waterstops in the concrete.
- P. Concrete in walls shall be internally vibrated and at the same time stirred, or worked with suitable appliances, tamping bars, shovels, or forked tools until it completely fills the forms or excavations and closes snugly against all surfaces, eliminating all air or stone pockets which may cause honeycombing, pitting or planes of weakness. Subsequent layers of concrete shall not be placed until the layers previously placed have been worked thoroughly as specified. Vibrators shall be provided in sufficient numbers, with standby units as required, to accomplish the results herein specified within 15 minutes after concrete of the prescribed consistence is placed in the forms. The vibrating head shall be kept from contact with the surfaces of the forms. Overvibrating and use of vibrators to transport concrete within forms shall not be allowed. Vibrators shall be inserted and withdrawn at many points, approximately 18 inches apart. At each insertion, the duration shall be sufficient to consolidate the concrete, but not sufficient to cause segregation, generally from 5 to 15 sec. duration.
- Q. Backfill placed against walls and grade beams shall be done evenly on both sides. Do not place backfill against walls until the concrete has attained a compressive strength equal to the specified 28-day compressive strength. Backfill against basement foundation walls shall not be placed until ground level floor and lower level slabs that brace this wall are in place and cured unless the wall is properly braced with temporary bracing. All bracing, if used, shall be responsibility of the contractor. Submit all calculations and details to the structural engineer for record. Backfill placed directly adjacent to basement and retaining walls shall be compacted clean free draining granular material. For a minimum of 2'-6" from face of wall. Provide a 1'-6" deep cap of compacted approved impervious cohesive material at top of granular backfill. All backfill shall be compacted using hand operated equipment; no heavy equipment shall be allowed within 5'-0" of any wall.
- R. No aluminum of any type shall be allowed in concrete work unless coated to prevent aluminum-concrete reaction.
- S. Cross reference structural and Engineerural drawings for inserts, anchor bolts, notches, ledges, lugs, etc. required on beams. Width and depth of beams given are overall out-to-out dimensions of concrete.
- T. All field bending of reinforcing shall be done cold. Heating of bars will not be permitted.
- U. Maximum O.D. of embedded conduit shall be no larger than 1/3 slab thickness. No conduit shall be placed above the welded wire fabric in slabs- on-grade or concrete fill placed onto composite metal deck. Do not place pipes, ducts, reglets or chases in structural concrete or composite floor systems without approval of the structural engineer through the Engineer.
- V. Provide vertical construction joints in concrete walls that have their outside surface exposed to view at a maximum uniform spacing not to exceed 30'-0". Coordinate joint locations with Engineerural drawings. Do not cast unexposed walls or grade beams in lengths over 60'-0". Wait 48 hours between adjacent pours. Provide waterstops at all vertical construction joints in walls.
- W. Construction joints in floors shall be located within the middle third of spans of slabs, beams, and girders. Joints in girders shall be offset a minimum distance of two times the width of intersecting beams. Provide waterstops at all construction joints in basin top and bottom concrete slab and beam framing.
- X. No footing shall be placed onto or against sub-grades containing free water, frost, or ice.
- Y. Cold-Weather Placement: Comply with ACI 306.1 and as follows. Protect concrete work from physical damage or reduced strength that could be caused by frost, freezing actions, or low temperatures.
 - 1. When average high and low temperature is expected to fall below 40 deg F for three successive days, maintain delivered concrete mixture temperature within the temperature range required by ACI 301.
 - 2. Do not use frozen materials or materials containing ice or snow. Do not place concrete on frozen subgrade or on subgrade containing frozen materials.
 - 3. Do not use calcium chloride, salt, or other materials containing antifreeze agents or chemical

accelerators unless otherwise specified and approved in mixture designs.

- Z. Hot-Weather Placement: Comply with ACI 301 and as follows:
 - 1. Maintain concrete temperature below 90 deg F at time of placement. Chilled mixing water or chopped ice may be used to control temperature, provided water equivalent of ice is calculated to total amount of mixing water. Using liquid nitrogen to cool concrete is Contractor's option.
 - 2. Fog-spray forms, steel reinforcement, and subgrade just before placing concrete. Keep subgrade uniformly moist without standing water, soft spots, or dry areas.

3.10 CONCRETE SLAB ON GRADE CONSTRUCTION

- A. All unacceptable fill and top soil shall be removed from below all proposed slabs-on-grade and the exposed natural soil shall be proof rolled and the compaction verified by a qualified independent soils testing firm prior to placing fill. Areas exhibiting weakness shall be removed and replaced by acceptable compacted fill.
- B. A minimum 4" of compacted granular fill shall be placed under all slabs-on-grade. All fill required to attain final sub-grade for slabs and walls shall be an acceptable material placed and compacted as directed by the project soils consultant report recommendations.
- C. A vapor barrier with minimum 10 mil thickness shall be placed under all interior slab-on-grade or below granular fill for floors to receive floor covering as indicated on Engineerural drawings. Lap and seal all edges. No vapor barrier required for slab on grades without floor coverings unless noted otherwise.
- D. Pitch slabs to drains and provide depressions, where shown on the process or structural or Engineerural drawings, without reducing the thickness of slab indicated. See details for additional reinforcing for slabs on grade depressions greater than 1".
- E. Provide slab-on-grade construction joints around each column, against grade beams, interior walls, and between columns and walls. Provide slab joints to form areas not to exceed 15' in length in each direction. See typical details. Submit detailed drawings showing locations of all construction joints.

3.11 FINISHING FORMED SURFACES

- A. Rough-Formed Finish: As-cast concrete texture imparted by form-facing material with tie holes and defects repaired and patched. Remove fins and other projections that exceed specified limits on formed-surface irregularities.
 - 1. Apply to concrete surfaces not exposed to public view
- B. Smooth-Formed Finish: As-cast concrete texture imparted by form-facing material, arranged in an orderly and symmetrical manner with a minimum of seams. Repair and patch tie holes and defects. Remove fins and other projections that exceed specified limits on formed-surface irregularities.
 - 1. Apply to concrete surfaces exposed to public view
- C. Rubbed Finish: Apply the following to smooth-formed finished as-cast concrete for basin and tank walls that are exposed to view and where indicated:
 - 1. Smooth-Rubbed Finish: Not later than one day after form removal, moisten concrete surfaces and rub with carborundum brick or another abrasive until producing a uniform color and texture. Do not apply cement grout other than that created by the rubbing process.
 - 2. Grout-Cleaned Finish: Wet concrete surfaces and apply grout of a consistency of thick paint to coat surfaces and fill small holes. Mix one part portland cement to one and one-half parts fine sand with a 1:1 mixture of bonding admixture and water. Add white portland cement in amounts determined by trial patches so color of dry grout will match adjacent surfaces. Scrub grout into voids and remove excess grout. When grout whitens, rub surface with clean burlap and keep surface damp by fog spray for at least 36 hours.
 - 3. Cork-Floated Finish: Wet concrete surfaces and apply a stiff grout. Mix one part portland cement and one part fine sand with a 1:1 mixture of bonding agent and water. Add white portland cement in amounts determined by trial patches so color of dry grout will match adjacent surfaces. Compress grout into voids by grinding surface. In a swirling motion, finish surface with a cork float.
- D. Related Unformed Surfaces: At tops of walls, horizontal offsets, and similar unformed surfaces adjacent to formed surfaces, strike off smooth and finish with a texture matching adjacent formed surfaces. Continue final surface treatment of formed surfaces uniformly across adjacent unformed surfaces unless otherwise indicated.

3.12 FINISHING FLOORS AND SLABS

- A. General: Comply with ACI 302.1R recommendations for screeding, restraightening, and finishing

operations for concrete surfaces. Do not wet concrete surfaces.

- B. Scratch Finish: While still plastic, texture concrete surface that has been screeded and bull-floated or darbied. Use stiff brushes, brooms, or rakes to produce a profile amplitude of 1/4 inch in one direction.
 - 1. Apply scratch finish to surfaces indicated.
- C. Float Finish: Consolidate surface with power-driven floats or by hand floating if area is small or inaccessible to power driven floats. Restraighten, cut down high spots, and fill low spots. Repeat float passes and restraightening until surface is left with a uniform, smooth, granular texture.
 - 1. Apply float finish to surfaces indicated.
- D. Trowel Finish: After applying float finish, apply first troweling and consolidate concrete by hand or power-driven trowel. Continue troweling passes and restraighten until surface is free of trowel marks and uniform in texture and appearance. Grind smooth any surface defects that would telegraph through applied coatings or floor coverings.
 - 1. Apply a trowel finish to surfaces indicated.
 - 2. Finish surfaces to the following tolerances, according to ASTM E 1155, for a randomly trafficked floor surface:
 - a. Specified overall values of flatness, F(F) 25; and of levelness, F(L) 20; with minimum local values of flatness, F(F) 17; and of levelness, F(L) 15.
 - b. Specified overall values of flatness, F(F) 35; and of levelness, F(L) 25; with minimum local values of flatness, F(F) 24; and of levelness, F(L) 17; for slabs-on-grade.
 - c. Specified overall values of flatness, F(F) 30; and of levelness, F(L) 20; with minimum local values of flatness, F(F) 24; and of levelness, F(L) 15; for suspended slabs.
 - d. Specified overall values of flatness, F(F) 45; and of levelness, F(L) 35; with minimum local values of flatness, F(F) 30; and of levelness, F(L) 24.
 - 3. Finish and measure surface so gap at any point between concrete surface and an unlevelled, freestanding, 10 ft. long straightedge resting on two high spots and placed anywhere on the surface does not exceed 1/4 inch.
- E. Broom Finish: Apply a broom finish to exterior concrete platforms, steps, ramps, and elsewhere as indicated.
 - 1. Immediately after float finishing, slightly roughen trafficked surface by brooming with fiber-bristle broom perpendicular to main traffic route. Coordinate required final finish with Engineer before application.

3.13 MISCELLANEOUS CONCRETE ITEMS

- A. Filling In: Fill in holes and openings left in concrete structures after work of other trades is in place unless otherwise indicated. Mix, place, and cure concrete, as specified, to blend with in-place construction. Provide other miscellaneous concrete filling indicated or required to complete the Work.
- B. Curbs: Provide monolithic finish to interior curbs by stripping forms while concrete is still green and by steel-troweling surfaces to a hard, dense finish with corners, intersections, and terminations slightly rounded.
- C. Equipment Bases and Foundations: Provide machine and equipment bases and foundations as shown on Drawings. Set anchor bolts for machines and equipment at correct elevations, complying with diagrams or templates from manufacturer furnishing machines and equipment.
- D. Steel Pan Stairs: Provide concrete fill for steel pan stair treads, landings, and associated items. Cast-in inserts and accessories as shown on Drawings. Screed, tamp, and trowel finish concrete surfaces.

3.14 CONCRETE PROTECTING AND CURING

- A. General: Protect freshly placed concrete from premature drying and excessive cold or hot temperatures. Comply with ACI 306.1 for cold-weather protection and ACI 301 for hot-weather protection during curing.
- B. Evaporation Retarder: Apply evaporation retarder to unformed concrete surfaces if hot, dry, or windy conditions cause moisture loss approaching 0.2 lb/sq. ft. x h before and during finishing operations. Apply according to manufacturer's written instructions after placing, screeding, and bull floating or darbying concrete, but before float finishing.
- C. Formed Surfaces: Cure formed concrete surfaces, including underside of beams, supported slabs, and other similar surfaces. If forms remain during curing period, moist cure after loosening forms. If removing forms before end of curing period, continue curing for the remainder of the curing period.
- D. Unformed Surfaces: Begin curing immediately after finishing concrete. Cure unformed surfaces,

including floors and slabs, concrete floor toppings, and other surfaces.

- E. All concrete in liquid containing structures shall be water cured.
- F. Cure concrete according to ACI 308.1, by one or a combination of the following methods:
 - 1. Moisture Curing: Keep surfaces continuously moist for not less than seven days with the following materials:
 - a. Water.
 - b. Continuous water-fog spray.
 - c. Absorptive cover, water saturated, and kept continuously wet. Cover concrete surfaces and edges with 12-inch lap over adjacent absorptive covers.
 - 2. Moisture-Retaining-Cover Curing: Cover concrete surfaces with moisture-retaining cover for curing concrete, placed in widest practicable width, with sides and ends lapped at least 12 inches, and sealed by waterproof tape or adhesive. Cure for not less than seven days. Immediately repair any holes or tears during curing period using cover material and waterproof tape.
 - a. Moisture cure or use moisture-retaining covers to cure concrete surfaces to receive floor coverings.
 - b. Moisture cure or use moisture-retaining covers to cure concrete surfaces to receive penetrating liquid floor treatments.
 - c. Cure concrete surfaces to receive floor coverings with either a moisture-retaining cover or a curing compound that the manufacturer certifies will not interfere with bonding of floor covering used on Project.
 - 3. Curing Compound: Apply uniformly in continuous operation by power spray or roller according to manufacturer's written instructions. Recoat areas subjected to heavy rainfall within three hours after initial application. Maintain continuity of coating and repair damage during curing period.
 - a. Removal: After curing period has elapsed, remove curing compound without damaging concrete surfaces by method recommended by curing compound manufacturer **<<None - N/A; or unless manufacturer certifies curing compound will not interfere with bonding of floor covering used on Project>>**.
 - 4. Curing and Sealing Compound: Apply uniformly to floors and slabs indicated in a continuous operation by power spray or roller according to manufacturer's written instructions. Recoat areas subjected to heavy rainfall within three hours after initial application. Repeat process 24 hours later and apply a second coat. Maintain continuity of coating and repair damage during curing period.

3.15 LIQUID FLOOR TREATMENTS

- A. Penetrating Liquid Floor Treatment: Prepare, apply, and finish penetrating liquid floor treatment according to manufacturer's written instructions.
 - 1. Remove curing compounds, sealers, oil, dirt, laitance, and other contaminants and complete surface repairs.
 - 2. Do not apply to concrete that is less than **<<three; seven; 14; or 28>>** days' old.
 - 3. Apply liquid until surface is saturated, scrubbing into surface until a gel forms; rewet; and repeat brooming or scrubbing. Rinse with water; remove excess material until surface is dry. Apply a second coat in a similar manner if surface is rough or porous.
- B. Polished Concrete Floor Treatment: Apply polished concrete finish system to cured and prepared slabs to match accepted mockup.
 - 1. Machine grind floor surfaces to receive polished finishes level and smooth **<<None - N/A; or and to depth required to reveal aggregate to match approved mockup>>**.
 - 2. Apply penetrating liquid floor treatment for polished concrete in polishing sequence and according to manufacturer's written instructions, allowing recommended drying time between successive coats.
 - 3. Continue polishing with progressively finer grit diamond polishing pads to gloss level to match approved mockup.
 - 4. Control and dispose of waste products produced by grinding and polishing operations.
 - 5. Neutralize and clean polished floor surfaces.
- C. Sealing Coat: Uniformly apply a continuous sealing coat of curing and sealing compound to hardened concrete by power spray or roller according to manufacturer's written instructions.
- D. When called for in Finish Schedule or on plans, apply first coat of clear concrete floor sealer after final troweling. Surface is damp, but not wet, and can no longer be marred by workman spray sealer at rate

of 300 sq. ft. per gallon. After all trades have completed work, mop-clean floor with TSP solution to remove oil, grease, and dirt, rinse, allow to dry, then cover with second spray coat of sealer at rate of 400 sq. ft. per gallon. Do not allow puddles to occur in either coat.

3.16 JOINT FILLING

- A. Prepare, clean, and install joint filler according to manufacturer's written instructions.
 - 1. Defer joint filling until concrete has aged at least one month. Do not fill joints until construction traffic has permanently ceased.
- B. Remove dirt, debris, saw cuttings, curing compounds, and sealers from joints; leave contact faces of joint clean and dry.
- C. Install semirigid joint filler full depth in saw-cut joints and at least 2 inches deep in formed joints. Overfill joint and trim joint filler flush with top of joint after hardening.

3.17 CONCRETE SURFACE REPAIRS

- A. Defective Concrete: Repair and patch defective areas when approved by Engineer. Remove and replace concrete that cannot be repaired and patched to Engineer's approval.
- B. Patching Mortar: Mix dry-pack patching mortar, consisting of one part portland cement to two and one-half parts fine aggregate passing a No. 16 sieve, using only enough water for handling and placing.
- C. Repairing Formed Surfaces: Surface defects include color and texture irregularities, cracks, spalls, air bubbles, honeycombs, rock pockets, fins and other projections on the surface, and stains and other discolorations that cannot be removed by cleaning.
 - 1. Immediately after form removal, cut out honeycombs, rock pockets, and voids more than 1/2 inch in any dimension to solid concrete. Limit cut depth to 3/4 inch. Make edges of cuts perpendicular to concrete surface. Clean, dampen with water, and brush-coat holes and voids with bonding agent. Fill and compact with patching mortar before bonding agent has dried. Fill form-tie voids with patching mortar or cone plugs secured in place with bonding agent.
 - 2. Repair defects on surfaces exposed to view by blending white portland cement and standard portland cement so that, when dry, patching mortar will match surrounding color. Patch a test area at inconspicuous locations to verify mixture and color match before proceeding with patching. Compact mortar in place and strike off slightly higher than surrounding surface.
 - 3. Repair defects on concealed formed surfaces that affect concrete's durability and structural performance as determined by Engineer.
- D. Repairing Unformed Surfaces: Test unformed surfaces, such as floors and slabs, for finish and verify surface tolerances specified for each surface. Correct low and high areas. Test surfaces sloped to drain for trueness of slope and smoothness; use a sloped template.
 - 1. Repair finished surfaces containing defects. Surface defects include spalls, popouts, honeycombs, rock pockets, crazing and cracks in excess of 0.01 inch wide or that penetrate to reinforcement or completely through unreinforced sections regardless of width, and other objectionable conditions.
 - 2. After concrete has cured at least 14 days, correct high areas by grinding.
 - 3. Correct localized low areas during or immediately after completing surface finishing operations by cutting out low areas and replacing with patching mortar. Finish repaired areas to blend into adjacent concrete.
 - 4. Correct other low areas scheduled to receive floor coverings with a repair underlayment. Prepare, mix, and apply repair underlayment and primer according to manufacturer's written instructions to produce a smooth, uniform, plane, and level surface. Feather edges to match adjacent floor elevations.
 - 5. Correct other low areas scheduled to remain exposed with a repair topping. Cut out low areas to ensure a minimum repair topping depth of 1/4 inch to match adjacent floor elevations. Prepare, mix, and apply repair topping and primer according to manufacturer's written instructions to produce a smooth, uniform, plane, and level surface.
 - 6. Repair defective areas, except random cracks and single holes 1 inch or less in diameter, by cutting out and replacing with fresh concrete. Remove defective areas with clean, square cuts and expose steel reinforcement with at least a 3/4-inch clearance all around. Dampen concrete surfaces in contact with patching concrete and apply bonding agent. Mix patching concrete of same materials and mixture as original concrete except without coarse aggregate. Place, compact, and finish to blend with adjacent finished concrete. Cure in same manner as adjacent concrete.

7. Repair random cracks and single holes 1 inch or less in diameter with patching mortar. Groove top of cracks and cut out holes to sound concrete and clean off dust, dirt, and loose particles. Dampen cleaned concrete surfaces and apply bonding agent. Place patching mortar before bonding agent has dried. Compact patching mortar and finish to match adjacent concrete. Keep patched area continuously moist for at least 72 hours.
- E. Perform structural repairs of concrete, subject to Engineer's approval, using epoxy adhesive and patching mortar.
 - F. Repair materials and installation not specified above may be used, subject to Engineer's approval.
 - G. Repair of concrete not passing leakage test: After the structure has been tested for leaks, repair leaking concrete cracks by cutting out a square edged and uniformly aligned joint 3/8 inch wide by 3/4 inch deep, preparing exposed surfaces of the joint, priming the joint, and apply low viscosity polyurethane joint sealant in accordance with Manufacturer. The Contractor may submit alternate methods of crack repair for review by the Engineer.
 - H. Testing and Inspecting: Owner will engage a special inspector and qualified testing and inspecting agency to perform field tests and inspections and prepare test reports.
 - I. Testing and Inspecting: Engage a qualified testing and inspecting agency to perform tests and inspections and to submit reports.
 - J. Inspections:
 1. Steel reinforcement placement.
 2. Steel reinforcement welding.
 3. Headed bolts and studs.
 4. Verification of use of required design mixture.
 5. Concrete placement, including conveying and depositing.
 6. Curing procedures and maintenance of curing temperature.
 7. Verification of concrete strength before removal of shores and forms from beams and slabs.
 - K. Concrete Tests: Testing of composite samples of fresh concrete obtained according to ASTM C 172 shall be performed according to the following requirements:
 1. Testing Frequency: Obtain one composite sample for each day's pour of each concrete mixture exceeding 5 cu. yd., but less than 25 cu. yd., plus one set for each additional 50 cu. yd. or fraction thereof.
 2. Testing Frequency: Obtain at least one composite sample for each 100 cu. yd. or fraction thereof of each concrete mixture placed each day.
 - a. When frequency of testing will provide fewer than five compressive-strength tests for each concrete mixture, testing shall be conducted from at least five randomly selected batches or from each batch if fewer than five are used.
 3. Slump: ASTM C 143; one test at point of placement for each composite sample, but not less than one test for each day's pour of each concrete mixture. Perform additional tests when concrete consistency appears to change.
 4. Air Content: ASTM C 231, pressure method, for normal-weight concrete; one test for each composite sample, but not less than one test for each day's pour of each concrete mixture.
 5. Concrete Temperature: ASTM C 1064; one test hourly when air temperature is 40 deg F and below and when 80 deg F and above, and one test for each composite sample.
 6. Unit Weight: ASTM C 138, fresh unit weight of structural lightweight concrete; one test for each composite sample, but not less than one test for each day's pour of each concrete mixture.
 7. Compression Test Specimens: ASTM C 31.
 - a. Cast and laboratory cure two sets of two and one set of one standard cylinder specimens for each composite sample.
 - b. Cast and field cure two sets of two standard cylinder specimens for each composite sample.
 8. Compressive-Strength Tests: ASTM C 39; test one set of two laboratory-cured specimens at 7 days and one set of two specimens at 28 days. Hold one set of one specimen for future testing if the two tests mentioned above do not meet strength requirements.
 - a. Test one set of two field-cured specimens at 7 days and one set of two specimens at 28 days.
 - b. A compressive-strength test shall be the average compressive strength from a set of two specimens obtained from same composite sample and tested at age indicated.
 9. When strength of field-cured cylinders is less than 85 percent of companion laboratory-cured

- cylinders, Contractor shall evaluate operations and provide corrective procedures for protecting and curing in-place concrete.
10. Strength of each concrete mixture will be satisfactory if every average of any three consecutive compressive-strength tests equals or exceeds specified compressive strength and no compressive-strength test value falls below specified compressive strength by more than 500 psi.
 11. Test results shall be reported in writing to Engineer, concrete manufacturer, and Contractor within 48 hours of testing. Reports of compressive-strength tests shall contain Project identification name and number, date of concrete placement, name of concrete testing and inspecting agency, location of concrete batch in Work, design compressive strength at 28 days, concrete mixture proportions and materials, compressive breaking strength, and type of break for both 7- and 28-day tests.
 12. Nondestructive Testing: Impact hammer, sonoscope, or other nondestructive device may be permitted by Engineer but will not be used as sole basis for approval or rejection of concrete.
 13. Additional Tests: Testing and inspecting agency shall make additional tests of concrete when test results indicate that slump, air entrainment, compressive strengths, or other requirements have not been met, as directed by Engineer. Testing and inspecting agency may conduct tests to

- determine adequacy of concrete by cored cylinders complying with ASTM C 42 or by other methods as directed by Engineer.
14. Additional testing and inspecting, at Contractor's expense, will be performed to determine compliance of replaced or additional work with specified requirements.
 15. Correct deficiencies in the Work that test reports and inspections indicate do not comply with the Contract Documents.
- L. Measure floor and slab flatness and levelness according to ASTM E 1155 within 24 hours of finishing.
 - M. Water-Soluble Chloride Ion: Water-soluble chloride ion testing shall be performed in accordance with ASTM C 1218.
 - N. Drying Shrinkage Test
 - O. Concrete shrinkage tests shall be performed once for each 1,000 cubic yards of concrete with controlled shrinkage that is placed and shall be made on concrete from a batch of concrete from which concrete compression test cylinders are made. Shrinkage testing shall be in accordance with ASTM C 157.
 - P. A drying shrinkage test shall be conducted on the preliminary trial batch with the maximum water-cementitious materials ratio used to qualify each proposed concrete mix design using the concrete materials, including admixtures, which are proposed for the project. Three test specimens shall be prepared for each test. Specimens shall be fabricated, cured, dried, and measured in accordance with ASTM C 157.
 - Q. Drying shrinkage for each specimen shall be computed as the difference between the base length at (0) zero days drying age and the length after drying at each test age. Results of the shrinkage test shall be reported to the nearest 0.001%. If drying shrinkage of any specimen deviates from the average for that test age by more than 0.004%, the results for that specimen shall be disregarded.
 - R. The average drying shrinkage of each set of test specimens cast in the laboratory from a trial batch as measured at the 21 days drying age shall not exceed 0.035% for concrete to be used in liquid-containing structures and 0.045% for concrete to be used in other structures. Drying shrinkage tests will not be required for isolated footings, pipe blocking, pipe encasement, and duct banks.
 - S. At the Contractor's option, a shrinkage-reducing admixture may be used to comply with the maximum shrinkage requirements. Shrinkage reducing admixture shall be Grace Construction Products Eclipse; or Degussa Tetraguard AS20, or equal, at a rate of 1 gallon per cubic yard. All concrete admixtures shall be from one manufacturer and shall be compatible. Admixture content, batching method, and time of introduction to mix shall comply with these specifications and with manufacturer's recommendations.

3.18 PROTECTION OF LIQUID FLOOR TREATMENTS

- A. Protect liquid floor treatment from damage and wear during the remainder of construction period. Use protective methods and materials, including temporary covering, recommended in writing by liquid floor treatments installer.

END OF SECTION

SECTION 051200
STRUCTURAL STEEL FRAMING

PART 1 GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. Section Includes:
 - 1. Structural steel.
 - 2. Prefabricated building columns.
 - 3. Grout.
- B. Related Sections:
 - 1. Section 014000 "Quality Requirements".
 - 2. Section 055000 "Metal Fabrications".
 - 3. Section 055100 "Metal Stairs, Handrails and Railings."
 - 4. Section 099000. "Painting and Coating".

1.3 DEFINITIONS

- A. Structural Steel: Elements of structural-steel frame, as classified by AISC 303, "Code of Standard Practice for Steel Buildings and Bridges."
- B. Seismic-Load-Resisting System: Elements of structural-steel frame designated as "SLRS" or along grid lines designated as "SLRS" on Drawings, including columns, beams, and braces and their connections.
- C. Heavy Sections: Rolled and built-up sections as follows:
 - 1. Shapes included in ASTM A 6/A 6M with flanges thicker than 1 1/2 inches.
 - 2. Welded built-up members with plates thicker than 2 inches.
 - 3. Column base plates thicker than 2 inches.
- D. Protected Zone: Structural members or portions of structural members indicated as "Protected Zone" on Drawings. Connections of structural and nonstructural elements to protected zones are limited.
- E. Demand Critical Welds: Those welds, the failure of which would result in significant degradation of the strength and stiffness of the Seismic-Load-Resisting System and which are indicated as "Demand Critical" or "Seismic Critical" on Drawings.

1.4 PERFORMANCE REQUIREMENTS

- A. Connections: Provide details of simple shear connections required by the Contract Documents to be selected or completed by structural-steel fabricator to withstand loads indicated and comply with other information and restrictions indicated.
 - 1. Select and complete connections using AISC 360
 - 2. Use LRFD; data are given at factored-load level.
- B. Moment Connections: Type FR restrained.

1.5 ACTION SUBMITTALS

- A. Product Data: For each type of product indicated.
- B. LEED Submittals:
 - 1. Product Data for Credit MR 4: For products having recycled content, documentation indicating percentages by weight of postconsumer and preconsumer recycled content. Include statement indicating cost for each product having recycled content.

2. Laboratory Test Reports for Credit IEQ 4: For primers, documentation indicating that products comply with the testing and product requirements of the California Department of Health Services' "Standard Practice for the Testing of Volatile Organic Emissions from Various Sources Using Small-Scale Environmental Chambers."
- C. Shop Drawings: Show fabrication of structural-steel components.
1. Include details of cuts, connections, splices, camber, holes, and other pertinent data.
 2. Include embedment drawings.
 3. Indicate welds by standard AWS symbols, distinguishing between shop and field welds, and show size, length, and type of each weld. Show backing bars that are to be removed and supplemental fillet welds where backing bars are to remain.
 4. Indicate type, size, and length of bolts, distinguishing between shop and field bolts. Identify pretensioned and slip-critical high-strength bolted connections.
 5. Identify members and connections of the seismic-load-resisting system.
 6. Indicate locations and dimensions of protected zones.
 7. Identify demand critical welds.
 8. For structural-steel connections indicated to comply with design loads, include structural analysis data.
- D. Welding Procedure Specifications (WPSs) and Procedure Qualification Records (PQRs): Provide according to AWS D1.1/D1.1M, "Structural Welding Code - Steel," for each welded joint, including the following:
1. Power source (constant current or constant voltage).
 2. Electrode manufacturer and trade name, for demand critical welds.

1.6 INFORMATIONAL SUBMITTALS

- A. Welding certificates.
- B. Paint Compatibility Certificates: From manufacturers of topcoats applied over shop primers, certifying that shop primers are compatible with topcoats.

- C. Mill test reports for structural steel, including chemical and physical properties.
- D. Product Test Reports: For the following:
 - 1. Bolts, nuts, and washers including mechanical properties and chemical analysis.
 - 2. Direct-tension indicators.
 - 3. Tension-control, high-strength bolt-nut-washer assemblies.
 - 4. Shear stud connectors.
 - 5. Shop primers.
 - 6. Nonshrink grout.
- E. Source quality-control reports.

1.7 QUALITY ASSURANCE

- A. Fabricator Qualifications: A qualified fabricator that participates in the AISC Quality Certification Program and is designated an AISC-Certified Plant, Category STD.
- B. Installer Qualifications: A qualified installer who participates in the AISC Quality Certification Program and is designated an AISC-Certified Erector, Category ACSE.
- C. Shop-Painting Applicators: Qualified according to AISC's Sophisticated Paint Endorsement P1 or SSPC-QP 3, "Standard Procedure for Evaluating Qualifications of Shop Painting Applicators."
- D. Welding Qualifications: Qualify procedures and personnel according to AWS D1.1/D1.1M, "Structural Welding Code - Steel."
 - 1. Welders and welding operators performing work on bottom-flange, demand-critical welds shall pass the supplemental welder qualification testing, as required by AWS D1.8. FCAW-S and FCAW-G shall be considered separate processes for welding personnel qualification.
- E. Comply with applicable provisions of the following specifications and documents:
 - 1. AISC 303.
 - 2. AISC 341 and AISC 341s1.
 - 3. AISC 360.
 - 4. RCSC's "Specification for Structural Joints Using ASTM A 325 or A 490 Bolts."

1.8 DELIVERY, STORAGE, AND HANDLING

- A. Store materials to permit easy access for inspection and identification. Keep steel members off ground and spaced by using pallets, dunnage, or other supports and spacers. Protect steel members and packaged materials from corrosion and deterioration.
 - 1. Do not store materials on structure in a manner that might cause distortion, damage, or overload to members or supporting structures. Repair or replace damaged materials or structures as directed.
- B. Store fasteners in a protected place in sealed containers with manufacturer's labels intact.
 - 1. Fasteners may be repackaged provided Owner's testing and inspecting agency observes

- repackaging and seals containers.
- 2. Clean and relubricate bolts and nuts that become dry or rusty before use.
- 3. Comply with manufacturers' written recommendations for cleaning and lubricating ASTM F 1852 fasteners and for retesting fasteners after lubrication.

1.9 COORDINATION

- A. Coordinate selection of shop primers with topcoats to be applied over them. Comply with paint and coating manufacturers' recommendations to ensure that shop primers and topcoats are compatible with one another.
- B. Coordinate installation of anchorage items to be embedded in or attached to other construction without delaying the Work. Provide setting diagrams, sheet metal templates, instructions, and directions for installation.

PART 2 PRODUCTS

2.1 STRUCTURAL-STEEL MATERIALS

- A. Recycled Content of Steel Products: Postconsumer recycled content plus one-half of preconsumer recycled content not less than 25 percent.
- B. Recycled Content of Steel Products: Provide products with an average recycled content of steel products so postconsumer recycled content plus one-half of preconsumer recycled content is not less than the following:
 - 1. W-Shapes: 60 percent.
 - 2. Channels, Angles: M or S-Shapes: 60 percent.
 - 3. Plate and Bar: 25 percent.
 - 4. Cold-Formed Hollow Structural Sections: 25 percent.
 - 5. Steel Pipe: 25 percent.
 - 6. All Other Steel Materials: 25 percent.
- C. W-Shapes: ASTM A992.
- D. Channels, Angles, M, and S-Shapes, Plate and bars: ASTM A 36.
- E. Corrosion-Resisting Structural-Steel Shapes, Plates, and Bars: ASTM A 588, Grade 50.
- F. Cold-Formed Hollow Structural Sections: ASTM A 500, Grade B, structural tubing.
- G. Corrosion-Resisting Cold-Formed Hollow Structural Sections: ASTM A 847, structural tubing.
- H. Steel Pipe: ASTM A 53, Type E or S, Grade B.
 - 1. Weight Class: Standard.
 - 2. Finish: Black except where indicated to be galvanized.
- I. Steel Castings: ASTM A 216, Grade WCB with supplementary requirement S11.
- J. Steel Forgings: ASTM A 668.
- K. Welding Electrodes: Comply with AWS requirements.

2.2 BOLTS, CONNECTORS, AND ANCHORS

- A. High-Strength Bolts, Nuts, and Washers: ASTM A 325, Type 1, heavy-hex steel structural bolts; ASTM A 563, Grade C, heavy-hex carbon-steel nuts; and ASTM F 436, Type 1, hardened carbon-steel washers; all with plain finish.
 - 1. Direct-Tension Indicators: ASTM F 959, Type 325, compressible-washer type with plain finish.
- B. High-Strength Bolts, Nuts, and Washers: ASTM A 490, Type 1, heavy-hex steel structural bolts; ASTM A 563, Grade DH, heavy-hex carbon-steel nuts; and ASTM F 436, Type 1, hardened carbon-steel washers with plain finish.
 - 1. Direct-Tension Indicators: ASTM F 959, Type 490, compressible-washer type with plain finish.
- C. Zinc-Coated High-Strength Bolts, Nuts, and Washers: ASTM A 325, Type 1, heavy-hex steel structural bolts; ASTM A 563, Grade DH heavy-hex carbon-steel nuts; and ASTM F 436, Type 1, hardened carbon-steel washers.
 - 1. Finish: Hot-dip zinc coating.
 - 2. Direct-Tension Indicators: ASTM F 959, Type 325, compressible-washer type with mechanically deposited zinc coating finish.
- D. Stainless Steel Bolts, Nuts and Washers: Stainless steel bolts shall be ASTM A193, Grade B8 or ASTM F593, Type 304. Nuts shall be ASTM A194, Grade 8 or ASTM F594, Type 304. Use ASTM A194 nuts with ASTM A193 bolts; use ASTM F594 nuts with ASTM F593 bolts. Provide washer for each nut and bolthead. Washers shall be of the same material as the nuts.
- E. Tension-Control, High-Strength Bolt-Nut-Washer Assemblies: ASTM F 1852, Type 1, heavy-hex head assemblies consisting of steel structural bolts with splined ends, heavy-hex carbon-steel nuts, and hardened carbon-steel washers.
 - 1. Finish: Plain.
- F. Shear Connectors: ASTM A 108, Grades 1015 through 1020, headed-stud type, cold-finished carbon steel; AWS D1.1/D1.1M, Type B.
- G. Unheaded Anchor Rods: ASTM F 1554, Grade 36.
 - 1. Configuration: Straight
 - 2. Nuts: ASTM A 563 hex carbon steel.
 - 3. Plate Washers: ASTM A 36 carbon steel.
 - 4. Washers: ASTM F 436, Type 1, hardened carbon steel.
 - 5. Finish: Plain.
- H. Headed Anchor Rods: ASTM F 1554, Grade 36, straight.
 - 1. Nuts: ASTM A 563 hex carbon steel.
 - 2. Plate Washers: ASTM A 36 carbon steel.
 - 3. Washers: ASTM F 436, Type 1, hardened carbon steel.
 - 4. Finish: Plain.
- I. Threaded Rods: ASTM A 36.
 - 1. Nuts: ASTM A 563 (ASTM A 563M) hex carbon steel.
 - 2. Washers: ASTM F 436, Type 1, hardened carbon steel.
 - 3. Finish: Plain
- J. Clevises and Turnbuckles: Made from cold-finished carbon steel bars, ASTM A 108, Grade 1035.
- K. Eye Bolts and Nuts: Made from cold-finished carbon steel bars, ASTM A 108, Grade 1030.
- L. Sleeve Nuts: Made from cold-finished carbon steel bars, ASTM A 108, Grade 1018.
- M. Structural Slide Bearings: Low-friction assemblies, of configuration indicated, that provide vertical transfer of loads and allow horizontal movement perpendicular to plane of expansion joint while resisting movement within plane of expansion joint.
 - 1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
 - 2. Basis-of-Design Product:
 - a. Subject to compliance with requirements, provide product indicated on Drawings or comparable product by one of the following:
 - b. Amscot Structural Products Corp.
 - c. Fluorocarbon Company Limited.

- d. R.J. Watson Bridge & Structural Engineered Systems.
 - e. Seismic Energy Products, L.P.
- 3. Mating Surfaces: PTFE and PTFE.
- 4. Coefficient of Friction: Not more than 0.03.
- 5. Design Load: Not less than 2,000 psi.
- 6. Total Movement Capability: 2 inches.

- N. Post-installed Anchors: Unless otherwise indicated in the drawings, drilled anchors shall be Type 304 stainless steel wedge anchors as manufactured by ITW Ramset/Redhead, Kwik Bolt TZ by Hilti, or equal. Where indicated in drawings, drilled anchors shall be Type 304 stainless steel heavy-duty wedge anchors suitable for dynamic loading. Anchors shall be HSL-3 heavy-duty wedge anchor by Hilti, Power-Bolt by Rawlplug Company, or equal. For metric anchors, use the size that is closest to, but no smaller than, the required English size.
1. Unless otherwise indicated in the drawings, drilled anchors shall be Type 303 stainless steel wedge anchors as manufactured by ITW Ramset/Redhead, Kwik Bolt TZ by Hilti, or equal.
 2. Unless otherwise indicated in the drawings, drilled anchors shall be zinc-plated steel wedge anchors as manufactured by ITW Ramset/Redhead, Kwik Bolt TZ by Hilti, or equal.
 3. Unless otherwise indicated in the drawings, drilled anchors shall be hot dipped galvanized steel wedge anchors as manufactured by ITW Ramset/Redhead, Kwik Bolt TZ by Hilti, or equal.
- O. Screw Anchors: Screw anchors shall be Titen HD Screw anchors by Simpson, HUS-H by Hilti, or equal.
- P. Threaded Alloy Steel Eyebolts: Threaded alloy steel eye bolts shall comply with ASTM F541 and ASME B18.5, Type 1, long length.
- Q. Threaded Carbon Steel Lifting Eyes: Threaded carbon steel lifting eyes shall comply with ASTM A489, Type 1, Style B.

R. Embedded Eyebolts: Eyebolts shall be the welded-eye or forged type, carbon steel.

2.3 PRIMER

- A. Low-Emitting Materials: Paints and coatings shall comply with the testing and product requirements of the California Department of Health Services' "Standard Practice for the Testing of Volatile Organic Emissions from Various Sources Using Small-Scale Environmental Chambers."
- B. Primer: Comply with Section 099000 "Painting and Coatings".
- C. Galvanizing Repair Paint: MPI No.18, MPI No.19, or SSPC-Paint 20.

2.4 GROUT

- A. Metallic, Shrinkage-Resistant Grout: ASTM C 1107, factory-packaged, metallic aggregate grout, mixed with water to consistency suitable for application and a 30-minute working time.
- B. Nonmetallic, Shrinkage-Resistant Grout: ASTM C 1107, factory-packaged, nonmetallic aggregate grout, noncorrosive and nonstaining, mixed with water to consistency suitable for application and a 30-minute working time.

2.5 FABRICATION

- A. Structural Steel: Fabricate and assemble in shop to greatest extent possible. Fabricate according to AISC's "Code of Standard Practice for Steel Buildings and Bridges" and AISC 360.
 - 1. Camber structural-steel members where indicated.
 - 2. Fabricate beams with rolling camber up.
 - 3. Identify high-strength structural steel according to ASTM A 6 and maintain markings until structural steel has been erected.
 - 4. Mark and match-mark materials for field assembly.
 - 5. Complete structural-steel assemblies, including welding of units, before starting shop-priming operations.
- B. Thermal Cutting: Perform thermal cutting by machine to greatest extent possible.
 - 1. Plane thermally cut edges to be welded to comply with requirements in AWS D1.1/D1.1M.
- C. Bolt Holes: Cut, drill, mechanically thermal cut or punch standard bolt holes perpendicular to metal surfaces.
- D. Finishing: Accurately finish ends of columns and other members transmitting bearing loads.
- E. Cleaning: Clean and prepare steel surfaces that are to remain unpainted according to SSPC-SP 1, "Solvent Cleaning"; SSPC-SP 2, "Hand Tool Cleaning"; or SSPC-SP 3, "Power Tool Cleaning".
- F. Shear Connectors: Prepare steel surfaces as recommended by manufacturer of shear connectors. Use automatic end welding of headed-stud shear connectors according to AWS D1.1/D1.1M and manufacturer's written instructions.
- G. Steel Wall-Opening Framing: Select true and straight members for fabricating steel wall-opening framing to be attached to structural steel. Straighten as required to provide uniform, square, and true members in completed wall framing.
- H. Welded Door Frames: Build up welded door frames attached to structural steel. Weld exposed joints continuously and grind smooth. Plug-weld fixed steel bar stops to frames. Secure removable stops to frames with countersunk machine screws, uniformly spaced not more than 10 inches o.c. unless otherwise indicated.
- I. Holes: Provide holes required for securing other work to structural steel and for other work to pass through steel framing members.
 - 1. Cut, drill, or punch holes perpendicular to steel surfaces.
 - 2. Baseplate Holes: Cut, drill, mechanically thermal cut, or punch holes perpendicular to steel surfaces.
 - 3. Weld threaded nuts to framing and other specialty items indicated to receive other work.

2.6 SHOP CONNECTIONS

- A. High-Strength Bolts: Shop install high-strength bolts according to RCSC's "Specification for Structural Joints Using ASTM A 325 or A 490 Bolts" for type of bolt and type of joint specified.
 - 1. Joint Type: Snug tightened.
- B. Weld Connections: Comply with AWS D1.1/D1.1M for tolerances, appearances, welding procedure specifications, weld quality, and methods used in correcting welding work.

1. Assemble and weld built-up sections by methods that will maintain true alignment of axes without exceeding tolerances in AISC 303 for mill material.

2.7 SHOP PRIMING

- A. Shop prime steel surfaces except the following:
 1. Surfaces embedded in concrete or mortar. Extend priming of partially embedded members to a depth of 2 inches.
 2. Surfaces to be field welded.
 3. Surfaces to be high-strength bolted with slip-critical connections.
 4. Surfaces to receive sprayed fire-resistive materials (applied fireproofing).
 5. Galvanized surfaces.
- B. Surface Preparation: Clean surfaces to be painted. Remove loose rust and mill scale and spatter, slag, or flux deposits. Prepare surfaces according to the following specifications and standards:
 1. SSPC-SP 2, "Hand Tool Cleaning."
 2. SSPC-SP 3, "Power Tool Cleaning."
 3. SSPC-SP 7/NACE No. 4, "Brush-Off Blast Cleaning."
 4. SSPC-SP 11, "Power Tool Cleaning to Bare Metal."
 5. SSPC-SP 14/NACE No. 8, "Industrial Blast Cleaning."
 6. SSPC-SP 6/NACE No. 3, "Commercial Blast Cleaning."
 7. SSPC-SP 10/NACE No. 2, "Near-White Blast Cleaning."
 8. SSPC-SP 5/NACE No. 1, "White Metal Blast Cleaning."
 9. SSPC-SP 8, "Pickling."
- C. Priming: Immediately after surface preparation, apply primer according to manufacturer's written instructions and at rate recommended by SSPC to provide a minimum dry film thickness of 1.5 mils. Use priming methods that result in full coverage of joints, corners, edges, and exposed surfaces.
 1. Stripe paint corners, crevices, bolts, welds, and sharp edges.
 2. Apply two coats of shop paint to surfaces that are inaccessible after assembly or erection. Change color of second coat to distinguish it from first.
- D. Painting: Prepare steel and apply a one-coat, non-asphaltic primer complying with SSPC-PS Guide 7.00, "Painting System Guide 7.00: Guide for Selecting One-Coat Shop Painting Systems," to provide a dry film thickness of not less than 1.5 mils.

2.8 GALVANIZING

- A. Hot-Dip Galvanized Finish: Apply zinc coating by the hot-dip process to structural steel according to ASTM A 123. Provide minimum G60. Galvanizing fasteners, connectors and anchors shall be hot-dipped galvanizing in accordance with ASTM A 153.
 1. Fill vent and drain holes that will be exposed in the finished Work unless they will function as weep holes, by plugging with zinc solder and filing off smooth.
 2. Galvanize shelf angles and welded door frames attached to structural-steel frame and located in exterior walls.

2.9 SOURCE QUALITY CONTROL

- A. Testing Agency: Owner will engage an independent testing and inspecting agency to perform shop tests and inspections and prepare test reports.
 1. Provide testing agency with access to places where structural-steel work is being fabricated or produced to perform tests and inspections.
- B. Correct deficiencies in Work that test reports and inspections indicate does not comply with the Contract Documents.
- C. Bolted Connections: Shop-bolted connections will be inspected according to RCSC's "Specification for Structural Joints Using ASTM A 325 or A 490 Bolts."
- D. Welded Connections: In addition to visual inspection, shop-welded connections will be tested and inspected according to AWS D1.1 and the following inspection procedures, at testing agency's option:
 1. Liquid Penetrant Inspection: ASTM E 165.
 2. Magnetic Particle Inspection: ASTM E 709; performed on root pass and on finished weld. Cracks or zones of incomplete fusion or penetration will not be accepted.
 3. Ultrasonic Inspection: ASTM E 164.

4. Radiographic Inspection: ASTM E 94.
- E. In addition to visual inspection, shop-welded shear connectors will be tested and inspected according to requirements in AWS D1.1 for stud welding and as follows:
 1. Bend tests will be performed if visual inspections reveal either a less-than-continuous 360-degree flash or welding repairs to any shear connector.
 2. Tests will be conducted on additional shear connectors if weld fracture occurs on shear connectors already tested, according to requirements in AWS D1.1.

PART 3 EXECUTION

3.1 EXAMINATION

- A. Verify, with steel Erector present, elevations of concrete and masonry-bearing surfaces and locations of anchor rods, bearing plates, and other embedments for compliance with requirements.
 1. Prepare a certified survey of bearing surfaces, anchor rods, bearing plates, and other embedments showing dimensions, locations, angles, and elevations.
- B. Proceed with installation only after unsatisfactory conditions have been corrected.

3.2 PREPARATION

- A. Provide temporary shores, guys, braces, and other supports during erection to keep structural steel secure, plumb, and in alignment against temporary construction loads and loads equal in intensity to design loads. Remove temporary supports when permanent structural steel, connections, and bracing are in place unless otherwise indicated.
 1. Do not remove temporary shoring supporting composite deck construction until cast-in-place concrete has attained its design compressive strength.

3.3 ERECTION

- A. Set structural steel accurately in locations and to elevations indicated and according to AISC 303 and AISC 360.
- B. Base Bearing and Leveling Plates: Clean concrete and masonry bearing surfaces of bond-reducing materials, and roughen surfaces prior to setting plates. Clean bottom surface of plates.
 1. Set plates for structural members on wedges, shims, or setting nuts as required.
 2. Weld plate washers to top of baseplate.
 3. Snug-tighten or Pretension anchor rods after supported members have been positioned and plumbed. Do not remove wedges or shims but, if protruding, cut off flush with edge of plate before packing with grout.
 4. Promptly pack grout solidly between bearing surfaces and plates so no voids remain. Neatly finish exposed surfaces; protect grout and allow to cure. Comply with manufacturer's written installation instructions for shrinkage-resistant grouts.
- C. Maintain erection tolerances of structural steel within AISC's "Code of Standard Practice for Steel Buildings and Bridges."
- D. Align and adjust various members that form part of complete frame or structure before permanently fastening. Before assembly, clean bearing surfaces and other surfaces that will be in permanent contact with members. Perform necessary adjustments to compensate for discrepancies in elevations and alignment.
 1. Level and plumb individual members of structure.
 2. Make allowances for difference between temperature at time of erection and mean temperature when structure is completed and in service.
- E. Splice members only where indicated.
- F. Do not use thermal cutting during erection unless approved by Engineer. Finish thermally cut sections within smoothness limits in AWS D1.1.
- G. Do not enlarge unfair holes in members by burning or using drift pins. Ream holes that must be enlarged to admit bolts.
- H. Shear Connectors: Prepare steel surfaces as recommended by manufacturer of shear connectors. Use automatic end welding of headed-stud shear connectors according to AWS D1.1 and manufacturer's written instructions.

3.4 INSTALLING ANCHOR BOLTS

- A. Preset bolts and anchors by the use of templates. For mechanical equipment (pumps, compressors, and blowers), do not use concrete anchors set in holes drilled in the concrete after the concrete is

placed.

- B. For static items (storage tanks and heat exchangers), use preset anchor bolts or drilled anchors with ICC report data.
- C. After anchor bolts have been embedded, protect projecting threads by applying grease and having the nuts installed until the time of installation of the equipment or metalwork.
- D. Minimum depth of embedment of drilled mechanical anchors and screw anchors shall be as recommended by the manufacturer, but no less than that shown in the drawings.
- E. Minimum depth of embedment of epoxy anchors shall be as calculated from Appendix D in ACI 318, but no less than that shown in the drawings.
- F. Prepare holes for drilled and epoxy anchors in accordance with the anchor manufacturer's recommendations prior to installation.

3.5 FIELD CONNECTIONS

- A. High-Strength Bolts: Install high-strength bolts according to RCSC's "Specification for Structural Joints Using ASTM A 325 or A 490 Bolts" for type of bolt and type of joint specified.

1. Joint Type: Snug tightened; Pretensioned; or Slip critical.
- B. Weld Connections: Comply with AWS D1.1/D1.1M for tolerances, appearances, welding procedure specifications, weld quality, and methods used in correcting welding work.
 1. Comply with AISC 303 and AISC 360 for bearing, alignment, adequacy of temporary connections, and removal of paint on surfaces adjacent to field welds.
 2. Remove backing bars or runoff tabs, back gouge, and grind steel smooth.
 3. Assemble and weld built-up sections by methods that will maintain true alignment of axes without exceeding tolerances in AISC's "Code of Standard Practice for Steel Buildings and Bridges" for mill material.

3.6 PREFABRICATED BUILDING COLUMNS

- A. Install prefabricated building columns to comply with AISC 360, manufacturer's written recommendations, and requirements of testing and inspecting agency that apply to the fire-resistance rating indicated.

3.7 FIELD QUALITY CONTROL

- A. Testing Agency: Contractor shall engage a qualified independent testing and inspecting agency to inspect field welds and high-strength bolted connections.
- B. Furnish qualified inspectors as the duly designated persons who act on behalf of the Owner on all quality assurance matters within the scope of the AWS Code and AISC Code of Standard Practice to ascertain that all fabrication and erection by welding is performed in accordance with the requirements of the specifications.
- C. Qualification of testing personal:
 1. Personnel performing nondestructive weld testing shall be qualified in accordance with the current edition of American Society for Nondestructive Testing Recommended Practice No. SNT-TC 1A. Only individuals qualified for NDT Level 1 and working under the NDT Level 11 or individuals qualified for NDT Level 11 may perform the nondestructive testing specified.
 2. Personnel performing inspections of welding work shall be currently registered with the AWS as having successfully complied with the requirements of the AWS Standards for Qualification and Certification of Welding Inspectors QCI.

- D. Bolted Connections: Bolted connections will be inspected according to RCSC's "Specification for Structural Joints Using ASTM A 325 or A 490 Bolts."
- E. Welded Connections: Field welds will be visually inspected according to AWS D1.1.
 - 1. In addition to visual inspection, field welds will be tested and inspected according to AWS D1.1 and the following inspection procedures, at testing agency's option:
 - a. Liquid Penetrant Inspection: ASTM E 165.
 - b. Magnetic Particle Inspection: ASTM E 709; performed on root pass and on finished weld. Cracks or zones of incomplete fusion or penetration will not be accepted.
 - c. Ultrasonic Inspection: ASTM E 164.
 - d. Radiographic Inspection: ASTM E 94.
- F. In addition to visual inspection, test and inspect field-welded shear connectors according to requirements in AWS D1.1 for stud welding and as follows:
 - 1. Perform bend tests if visual inspections reveal either a less-than-continuous 360-degree flash or welding repairs to any shear connector.
 - 2. Conduct tests on additional shear connectors if weld fracture occurs on shear connectors already tested, according to requirements in AWS D1.1.
- G. Correct deficiencies in Work that test reports and inspections indicate does not comply with the Contract Documents.

3.8 REPAIRS AND PROTECTION

- A. Galvanized Surfaces: Clean areas where galvanizing is damaged or missing and repair galvanizing to comply with ASTM A 780.
- B. Touchup Painting: Immediately after erection, clean exposed areas where primer is damaged or missing and paint with the same material as used for shop painting to comply with SSPC-PA 1 for touching up shop-painted surfaces.
 - 1. Clean and prepare surfaces by SSPC-SP 2 hand-tool cleaning or SSPC-SP 3 power-tool cleaning.

C. Touchup Painting: Cleaning and touchup painting are specified in Section 099000.

END OF SECTION

THIS PAGE INTENTIONALLY LEFT BLANK.

SECTION 055000
METAL FABRICATIONS

PART 1 GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. Section Includes:
1. Steel framing and supports for mechanical and electrical equipment.
 2. Steel framing and supports for applications where framing and supports are not specified in other Sections.
 3. Shelf angles.
 4. Metal ladders.
 5. Ladder safety cages (if shown).
 6. Alternating tread devices.
 7. Metal ships' ladders and pipe crossovers.
 8. Metal floor plate and supports.
 9. Metal grating, handrail, and kickplate (FRP is acceptable alternative), and supports.
 10. Miscellaneous steel trim including steel angle corner guards and steel edgings.
 11. Metal bollards.
 12. Pipe guards.
 13. Clarifier baffles. (FRP is acceptable alternative).
 14. Clarifier weir trough, weir plate, baffle plate, and supports. (FRP is acceptable alternative).
 15. Pump guide rails, guide rail brackets not supplied by pump supplier.
 16. Access hatches.
 17. Custom fabricated pipe supports.
 18. Abrasive metal nosings.
 19. Cast-iron wheel guards.
 20. Metal downspout boots.
 21. Loose bearing and leveling plates for applications where they are not specified in other Sections.
 22. Loose steel lintels.
 23. Anchor bolts, steel pipe sleeves, slotted-channel inserts, and wedge-type inserts indicated to be cast into concrete or built into unit masonry.
 24. Steel weld plates and angles for casting into concrete for applications where they are not specified in other Sections.
- B. Related Sections:
1. Section 033000 "Cast-in-Place Concrete" for installing anchor bolts, steel pipe sleeves, slotted-channel inserts, wedge-type inserts, and other items cast into concrete.
 2. Section 051200 "Structural Steel Framing."
 3. Section 055100 "Metal Stairs, Handrails and Railings."
 4. Section 055300 "Metal Gratings, Cover Plates and Access Hatches."

1.3 PERFORMANCE REQUIREMENTS

- A. Delegated Design: Design steel members including comprehensive engineering analysis by a qualified professional engineer licensed in the state where the project is located, using performance requirements and design criteria indicated on the drawings and in accordance with the building code.
- B. Structural Performance of Aluminum Ladders: Aluminum ladders including landings shall withstand the effects of loads and stresses within limits and under conditions specified in ANSI A14.3.
- C. Structural Performance of Alternating Tread Devices: Alternating tread devices shall withstand the effects of loads and stresses within limits and under conditions specified in ICC's International Building Code.
- D. Thermal Movements: Allow for thermal movements from ambient and surface temperature changes

acting on exterior metal fabrications by preventing buckling, opening of joints, overstressing of components, failure of connections, and other detrimental effects.

1. Temperature Change: 120 deg F, ambient; 180 deg F, material surfaces.

1.4 ACTION SUBMITTALS

- A. Product Data: For the following:
 1. Nonslip aggregates and nonslip-aggregate surface finishes.
 2. Metal nosings and treads.
 3. Paint products.
 4. Grout.
- B. Shop Drawings: Show fabrication and installation details for metal fabrications.
 1. Include plans, elevations, sections, and details of metal fabrications and their connections. Show anchorage and accessory items.
- C. Delegated-Design Submittal: For installed products indicated to comply with performance requirements and design criteria, including analysis data signed and sealed by the qualified professional engineer responsible for their preparation.

1.5 INFORMATIONAL SUBMITTALS

- A. Qualification Data: For qualified professional engineer.
- B. Mill Certificates: Signed by manufacturers of stainless-steel certifying that products furnished comply with requirements.
- C. Welding certificates.
- D. Paint Compatibility Certificates: From manufacturers of topcoats applied over shop primers certifying that shop primers are compatible with topcoats.

1.6 QUALITY ASSURANCE

- A. Welding Qualifications: Qualify procedures and personnel according to AWS D1.1/D1.1M, "Structural Welding Code - Steel."
- B. Welding Qualifications: Qualify procedures and personnel according to the following:
 1. AWS D1.1/D1.1M, "Structural Welding Code - Steel."
 2. AWS D1.2/D1.2M, "Structural Welding Code - Aluminum."
 3. AWS D1.6, "Structural Welding Code - Stainless Steel."

1.7 PROJECT CONDITIONS

- A. Field Measurements: Verify actual locations of walls and other construction contiguous with metal fabrications by field measurements before fabrication.

1.8 COORDINATION

- A. Coordinate selection of shop primers with topcoats to be applied over them. Comply with paint and coating manufacturers' written recommendations to ensure that shop primers and topcoats are compatible with one another.
- B. Coordinate installation of anchorages and steel weld plates and angles for casting into concrete. Furnish setting drawings, templates, and directions for installing anchorages, including sleeves, concrete inserts, anchor bolts, and items with integral anchors, that are to be embedded in concrete or masonry. Deliver such items to Project site in time for installation.

PART 2 PRODUCTS

2.1 METALS, GENERAL

- A. Metal Surfaces, General: Provide materials with smooth, flat surfaces unless otherwise indicated. For metal fabrications exposed to view in the completed Work, provide materials without seam marks, roller marks, rolled trade names, or blemishes.

2.2 FERROUS METALS

- A. Recycled Content of Steel Products: Postconsumer recycled content plus one-half of preconsumer recycled content not less than 25 percent.
- B. Steel Plates, Shapes, and Bars: ASTM A 36.
- C. Stainless-Steel Sheet, Strip, and Plate: ASTM A 240 or ASTM A 666, Type 304.
- D. Stainless-Steel Bars and Shapes: ASTM A 276, Type 304.

- E. Rolled-Steel Floor Plate: ASTM A 786, rolled from plate complying with ASTM A 36 or ASTM A 283, Grade C or D.
- F. Rolled-Stainless-Steel Floor Plate: ASTM A 793.
- G. Abrasive-Surface Floor Plate: Steel plate with abrasive granules rolled into surface.
 - 1. Products: Subject to compliance with requirements, available products that may be incorporated into the Work include, but are not limited to, the following:
 - a. IKG Industries, a division of Harsco Corporation; Mebac.
 - b. SlipNOT Metal Safety Flooring, a W. S. Molnar company; SlipNOT.
- H. Steel Tubing: ASTM A 500, cold-formed steel tubing.
- I. Steel Pipe: ASTM A 53, standard weight (Schedule 40) unless otherwise indicated.
- J. Slotted Channel Framing: Cold-formed metal box channels (struts) complying with MFMA-4.
 - 1. Size of Channels: 1-5/8 by 1-5/8 inches unless indicated otherwise.
 - 2. Material: Galvanized steel, ASTM A 653, commercial steel, Type B with G90 coating; 0.108-inch nominal thickness.
 - 3. Material: Cold-rolled steel, ASTM A 1008, commercial steel, Type B; 0.0966-inch minimum thickness; unfinished.
- K. Cast Iron: Either gray iron, ASTM A 48, or malleable iron, ASTM A 47, unless otherwise indicated.

2.3 NONFERROUS METALS

- A. Aluminum Plate and Sheet: ASTM B 209, Alloy 6061-T6.
- B. Aluminum Extrusions: ASTM B 221, Alloy 6063-T6.
- C. Aluminum-Alloy Rolled Tread Plate: ASTM B 632, Alloy 6061-T6.
- D. Aluminum Castings: ASTM B 26/B 26M, Alloy 443.0-F.
- E. Bronze Plate, Sheet, Strip, and Bars: ASTM B 36, Alloy UNS No. C28000 (muntz metal, 60 percent copper).
- F. Bronze Extrusions: ASTM B 455, Alloy UNS No. C38500 (extruded architectural bronze).
- G. Bronze Castings: ASTM B 584, Alloy UNS No. C83600 (leaded red brass) or No. C84400 (leaded semired brass).
- H. Nickel Silver Extrusions: ASTM B 151, Alloy UNS No. C74500.
- I. Nickel Silver Castings: ASTM B 584, Alloy UNS No. C97600 (20 percent leaded nickel bronze).

2.4 FASTENERS

- A. General: Unless otherwise indicated, provide Type 304 stainless-steel fasteners for exterior use and zinc-plated fasteners with coating complying with ASTM B 633 or ASTM F 1941, Class Fe/Zn 5, at exterior walls. Select fasteners for type, grade, and class required.
 - 1. Provide stainless-steel fasteners for fastening aluminum.
 - 2. Provide stainless-steel fasteners for fastening stainless steel.
 - 3. Provide stainless-steel fasteners for fastening nickel silver.
 - 4. Provide bronze fasteners for fastening bronze.
- B. Steel Bolts and Nuts: Regular hexagon-head bolts, ASTM A 307, Grade A; with hex nuts, ASTM A 563; and, where indicated, flat washers.
- C. Steel Bolts and Nuts: Regular hexagon-head bolts, ASTM A 325, Type 3; with hex nuts, ASTM A 563, Grade C3; and, where indicated, flat washers.
- D. Stainless-Steel Bolts and Nuts: Regular hexagon-head annealed stainless-steel bolts, ASTM F 593; with hex nuts, ASTM F 594; and, where indicated, flat washers; Alloy Group 1.
- E. Anchor Bolts: ASTM F 1554, Grade 36, of dimensions indicated; with nuts, ASTM A 563; and, where indicated, flat washers.
 - 1. Hot-dip galvanize or provide mechanically deposited, zinc coating where item being fastened is indicated to be galvanized.
- F. Eyebolts: ASTM A 489.
- G. Machine Screws: ASME B18.6.3.
- H. Lag Screws: ASME B18.2.1.

- I. Wood Screws: Flat head, ASME B18.6.1.
- J. Plain Washers: Round, ASME B18.22.1.
- K. Lock Washers: Helical, spring type, ASME B18.21.1.
- L. Anchors, General: Anchors capable of sustaining, without failure, a load equal to six times the load imposed when installed in unit masonry and four times the load imposed when installed in concrete, as determined by testing according to ASTM E 488, conducted by a qualified independent testing agency.
- M. Cast-in-Place Anchors in Concrete: Either threaded type or wedge type unless otherwise indicated; galvanized ferrous castings, either ASTM A 47 malleable iron or ASTM A 27 cast steel. Provide bolts, washers, and shims as needed, all hot-dip galvanized per ASTM F 2329.
- N. Post-Installed Anchors: Torque-controlled expansion anchors or chemical anchors.
 - 1. Material for Interior Locations: Carbon-steel components zinc plated to comply with ASTM B 633 or ASTM F 1941, Class Fe/Zn 5, unless otherwise indicated.
 - 2. Material for Exterior Locations and Where Stainless Steel is Indicated: Alloy Group 1 stainless-steel bolts, ASTM F 593, and nuts, ASTM F 594.
- O. Slotted-Channel Inserts: Cold-formed, hot-dip galvanized-steel box channels (struts) complying with MFMA-4, 1-5/8 by 7/8 inches by length indicated with anchor straps or studs not less than 3 inches long at not more than 8 inches o.c. Provide with temporary filler and tee-head bolts, complete with washers and nuts, all zinc-plated to comply with ASTM B 633, Class Fe/Zn 5, as needed for fastening to inserts.

2.5 MISCELLANEOUS MATERIALS

- A. Welding Rods and Bare Electrodes: Select according to AWS specifications for metal alloy welded.
- B. Low-Emitting Materials: Paints and coatings shall comply with the testing and product requirements of the California Department of Health Services' "Standard Practice for the Testing of Volatile Organic Emissions from Various Sources Using Small-Scale Environmental Chambers."
- C. Shop Primers: Provide primers that comply with Section 099000.
- D. Universal Shop Primer: Fast-curing, lead- and chromate-free, universal modified-alkyd primer complying with MPI#79 and compatible with topcoat.
 - 1. Use primer containing pigments that make it easily distinguishable from zinc-rich primer.
- E. Epoxy Zinc-Rich Primer: Complying with MPI#20 and compatible with topcoat.
- F. Galvanizing Repair Paint: High-zinc-dust-content paint complying with SSPC-Paint 20 and compatible with paints specified to be used over it.
- G. Bituminous Paint: Cold-applied asphalt emulsion complying with ASTM D 1187.
- H. Nonshrink, Metallic Grout: Factory-packaged, ferrous-aggregate grout complying with ASTM C 1107, specifically recommended by manufacturer for heavy-duty loading applications.
- I. Nonshrink, Nonmetallic Grout: Factory-packaged, nonstaining, noncorrosive, nongaseous grout complying with ASTM C 1107. Provide grout specifically recommended by manufacturer for interior and exterior applications.
- J. Concrete: Comply with requirements in Section 033000 "Cast-in-Place Concrete" for normal-weight, air-entrained, concrete with a minimum 28-day compressive strength of 3000 psi.

2.6 FABRICATION, GENERAL

- A. Shop Assembly: Preassemble items in the shop to greatest extent possible. Disassemble units only as necessary for shipping and handling limitations. Use connections that maintain structural value of joined pieces. Clearly mark units for reassembly and coordinated installation.
- B. Cut, drill, and punch metals cleanly and accurately. Remove burrs and ease edges to a radius of approximately 1/32 inch unless otherwise indicated. Remove sharp or rough areas on exposed surfaces.
- C. Form bent-metal corners to smallest radius possible without causing grain separation or otherwise impairing work.
- D. Form exposed work with accurate angles and surfaces and straight edges.
- E. Weld corners and seams continuously to comply with the following:
 - 1. Use materials and methods that minimize distortion and develop strength and corrosion resistance of base metals.

2. Obtain fusion without undercut or overlap.
 3. Remove welding flux immediately.
 4. At exposed connections, finish exposed welds and surfaces smooth and blended so no roughness shows after finishing.
- F. Form exposed connections with hairline joints, flush and smooth, using concealed fasteners or welds where possible. Where exposed fasteners are required, use Phillips flat-head (countersunk) fasteners unless otherwise indicated. Locate joints where least conspicuous.
- G. Fabricate seams and other connections that will be exposed to weather in a manner to exclude water. Provide weep holes where water may accumulate.
- H. Cut, reinforce, drill, and tap metal fabrications as indicated to receive finish hardware, screws, and similar items.
- I. Provide for anchorage of type indicated; coordinate with supporting structure. Space anchoring devices to secure metal fabrications rigidly in place and to support indicated loads.
1. Where units are indicated to be cast into concrete or built into masonry, equip with integrally welded steel strap anchors, 1/8 by 1-1/2 inches, with a minimum 6 inch embedment and 2 inch hook, not less than 8 inches from ends and corners of units and 24 inches o.c., unless otherwise indicated.

2.7 MISCELLANEOUS FRAMING AND SUPPORTS

- A. General: Provide steel framing and supports not specified in other Sections as needed to complete the Work.
- B. Fabricate units from steel shapes, plates, and bars of welded construction unless otherwise indicated. Fabricate to sizes, shapes, and profiles indicated and as necessary to receive adjacent construction.
1. Fabricate units from slotted channel framing where indicated.
 2. Furnish inserts for units installed after concrete is placed.
- C. Fabricate steel pipe columns for supports from steel pipe with steel baseplates and top plates as required. Drill or punch baseplates and top plates for anchor and connection bolts and weld to pipe with fillet welds all around. Make welds the same size as pipe wall thickness unless otherwise indicated.
1. Unless otherwise indicated, fabricate from Schedule 40 steel pipe.
 2. Unless otherwise indicated, provide 1/2 inch baseplates with four 5/8 inch anchor bolts and 1/4 inch top plates.
- D. Galvanize miscellaneous framing and supports where indicated.
- E. Prime miscellaneous framing and supports as indicated in Section 099000.

2.8 SHELF ANGLES

- A. Fabricate shelf angles from steel angles of sizes indicated and for attachment to concrete framing. Provide horizontally slotted holes to receive 3/4 inch bolts, spaced not more than 6 inches from ends and 24 inches o.c., unless otherwise indicated.
1. Provide mitered and welded units at corners.
 2. Provide open joints in shelf angles at expansion and control joints. Make open joint approximately 2 inches larger than expansion or control joint.
- B. For cavity walls, provide vertical channel brackets to support angles from backup masonry and concrete.
- C. Galvanize shelf angles located in exterior walls.
- D. Prime shelf angles located in exterior walls as specified in Section 099000.
- E. Furnish wedge-type concrete inserts, complete with fasteners, to attach shelf angles to cast-in-place concrete.

2.9 METAL LADDERS

- A. General:
1. Comply with ANSI A14.3 unless otherwise indicated.
 2. For elevator pit ladders, comply with ASME A17.1.
- B. Vertical Ladders: Fabricate ladders as shown in the drawings. Ladders shall be aluminum unless indicated otherwise in the drawings. The distance between rungs, cleats, and steps shall not exceed 12 inches and shall be uniform throughout the length of the ladder. The minimum clear length of rungs or cleats shall be 16 inches.

- C. Inclined Aluminum Ladders with built in handrail: Ladders shall be aluminum construction: Alloy 6063-T5, mill finish. Clear width of stair treads shall be 16-inches unless otherwise indicated. Provide 1-1/2-inch diameter handrails. Provide 6-inch by 2-inch by 1/8-inch minimum channel stringers. Provide minimum 4-1/8-inch by 1/4-inch minimum rung able to withstand a 1,000-pound load. Provide minimum 3/16-inch thick aluminum wall and floor brackets. Provide 1-1/2-inch aluminum handrails. Manufacturer: O'Keefe's, Inc., Model 523-10 or equal.
- D. Steel Ladders:
1. Space siderails 16 inches apart unless otherwise indicated.
 2. Space siderails of elevator pit ladders 12 inches apart.
 3. Siderails: Continuous, 3/8-by-2-1/2-inch steel flat bars, with eased edges.
 4. Rungs: 1-inch diameter steel bars.
 5. Fit rungs in centerline of siderails; plug-weld and grind smooth on outer rail faces.
 6. Provide nonslip surfaces on top of each rung, either by coating rung with aluminum-oxide granules set in epoxy-resin adhesive or by using a type of manufactured rung filled with aluminum-oxide grout.
 7. Provide nonslip surfaces on top of each rung by coating with abrasive material metallurgically bonded to rung. Products: Subject to compliance with requirements, available products that may be incorporated into the Work include, but are not limited to, the following:
 - 1) IKG Industries, a division of Harsco Corporation; Mebac.
 - 2) SlipNOT Metal Safety Flooring, a W. S. Molnar company; SlipNOT.
 8. Provide platforms as indicated fabricated from welded or pressure-locked steel bar grating, supported by steel angles. Limit openings in gratings to no more than 1/2 inch in least dimension.
 9. Support each ladder at top and bottom and not more than 60 inches o.c. with welded or bolted steel brackets.
 10. Galvanize exterior ladders, including brackets and fasteners.
 11. Prime exterior ladders, including brackets and fasteners, with zinc-rich primer.; or primer specified in Section 099000.
- E. Aluminum Ladders:
1. Manufacturers: Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:
 - a. ACL Industries, Inc.
 - b. Alco-Lite Industrial Products.
 - c. Halliday Products.
 - d. O'Keefe's Inc.
 - e. Precision Ladders, LLC.
 - f. Royalite Manufacturing, Inc.
 - g. Thompson Fabricating, LLC.
 2. Space siderails 16 inches apart unless otherwise indicated.
 3. Siderails: Continuous extruded-aluminum channels or tubes, not less than 2 1/2 inches deep, 3/4 inch wide, and 1/8 inch thick.
 4. Rungs: Extruded-aluminum tubes, not less than 3/4 inch deep and not less than 1/8 inch thick, with ribbed tread surfaces.
 5. Fit rungs in centerline of siderails; fasten by welding or with stainless-steel fasteners or brackets and aluminum rivets.
 6. Provide platforms as indicated fabricated from pressure-locked aluminum bar grating or extruded-aluminum plank grating, supported by extruded-aluminum framing. Limit openings in gratings to no more than 1/2 inch in least dimension.
 7. Support each ladder at top and bottom and not more than 60 inches o.c. with welded or bolted aluminum brackets.
 8. Provide minimum 72 inch high, hinged security door with padlock hasp at foot of ladder to prevent unauthorized ladder use.

2.10 ALTERNATING TREAD DEVICES

- A. Alternating Tread Devices: Fabricate alternating tread devices to comply with ICC's International Building Code. Fabricate of open-type construction with channel or plate stringers and pipe and tube railings unless otherwise indicated. Provide brackets and fittings for installation.
1. Manufacturers: Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:

2. Basis-of-Design Product: Subject to compliance with requirements, provide product by one of the following:
 - a. Lapeyre Stair Inc.
 - b. Schmidt Structural Products; a subsidiary of Penco Products, Inc.
3. Fabricate from aluminum and assemble by welding or with stainless-steel fasteners.

2.11 METAL SHIPS' LADDERS AND PIPE CROSSOVERS

- A. Provide metal ships' ladders and pipe crossovers where indicated. Fabricate of open-type construction with channel or plate stringers and pipe and tube railings unless otherwise indicated. Provide brackets and fittings for installation.
 1. Fabricate ships' ladders and pipe crossovers, including railings from aluminum.
 2. Fabricate treads and platforms from pressure-locked aluminum bar grating, extruded-aluminum plank grating, rolled-aluminum-alloy tread plate or abrasive-surface floor plate. Limit openings in gratings to no more than 1/2 inch in least dimension.
 3. Comply with applicable railing requirements in Section 055100 "Metal Stairs, Handrails and Railings."

2.12 METAL FLOOR PLATE

- A. Fabricate from rolled-steel floor or rolled-aluminum-alloy tread, as indicated:
 1. Thickness: 1/8 inch or as indicated.
- B. Provide grating sections where indicated fabricated from <<welded or pressure-locked steel bar grating or pressure-locked aluminum bar grating as indicated. Limit openings in gratings to no more than 1/2 inch in least dimension.
- C. Provide steel or aluminum angle supports as indicated.
- D. Include steel or aluminum angle stiffeners, and fixed and removable sections as indicated.
- E. Provide flush steel or aluminum bar drop handles for lifting removable sections, one at each end of each section.

2.13 MISCELLANEOUS STEEL TRIM

- A. Unless otherwise indicated, fabricate units from steel shapes, plates, and bars of profiles shown with continuously welded joints and smooth exposed edges. Miter corners and use concealed field splices where possible.
- B. Provide cutouts, fittings, and anchorages as needed to coordinate assembly and installation with other work.
 1. Provide with integrally welded steel strap anchors for embedding in concrete or masonry construction.
- C. Galvanize exterior miscellaneous steel trim.
- D. Prime exterior miscellaneous steel trim with zinc-rich primer as specified in Section 099000.

2.14 METAL BOLLARDS

- A. Fabricate metal bollards from Schedule 40 steel pipe.
 1. Cap bollards with 1/4 inch thick steel plate.
 2. Where bollards are indicated to receive controls for door operators, provide necessary cutouts for controls and holes for wire.
 3. Where bollards are indicated to receive light fixtures, provide necessary cutouts for fixtures and holes for wire.
- B. Fabricate bollards with 3/8 inch thick steel baseplates for bolting to concrete slab. Drill baseplates at all four corners for 3/4 inch anchor bolts.
 1. Where bollards are to be anchored to sloping concrete slabs, angle baseplates for plumb alignment of bollards.
- C. Fabricate sleeves for bollard anchorage from steel pipe with 1/4 inch thick steel plate welded to bottom of sleeve. Make sleeves not less than 8 inches deep and 3/4 inch larger than OD of bollard.

- D. Fabricate internal sleeves for removable bollards from Schedule 40 steel pipe or 1/4 inch wall-thickness steel tubing with an OD approximately 1/16 inch less than ID of bollards. Match drill sleeve and bollard for 3/4 inch steel machine bolt.
- E. Prime bollards with zinc-rich primer as specified in Section 099000.

2.15 LOOSE BEARING AND LEVELING PLATES

- A. Provide loose bearing and leveling plates for steel items bearing on masonry or concrete construction. Drill plates to receive anchor bolts and for grouting.
- B. Galvanize plates.
- C. Prime plates with zinc-rich primer as specified in Section 099000.

2.16 STEEL WELD PLATES AND ANGLES

- A. Provide steel weld plates and angles not specified in other Sections, for items supported from concrete construction as needed to complete the Work. Provide each unit with no fewer than two integrally welded steel strap anchors for embedding in concrete.

2.17 FINISHES, GENERAL

- A. Comply with NAAMM's "Metal Finishes Manual for Architectural and Metal Products" for recommendations for applying and designating finishes.
- B. Finish metal fabrications after assembly.
- C. Finish exposed surfaces to remove tool and die marks and stretch lines, and to blend into surrounding surface.

2.18 STEEL AND IRON FINISHES

- A. Galvanizing: Hot-dip galvanize items as indicated to comply with ASTM A 153 for steel and iron hardware and with ASTM A 123 for other steel and iron products.
 - 1. Do not quench or apply post galvanizing treatments that might interfere with paint adhesion.
- B. Shop prime iron and steel items not indicated to be galvanized unless they are to be embedded in concrete, sprayed-on fireproofing, or masonry, or unless otherwise indicated.
 - 1. Shop prime with primers specified in Section 099000 unless zinc-rich primer is indicated.
- C. Preparation for Shop Priming: Prepare surfaces to comply with SSPC-SP 6/NACE No. 3, "Commercial Blast Cleaning" or SSPC-SP 3, "Power Tool Cleaning".
- D. Shop Priming: Apply shop primer to comply with SSPC-PA 1, "Paint Application Specification No. 1: Shop, Field, and Maintenance Painting of Steel," for shop painting.
 - 1. Stripe paint corners, crevices, bolts, welds, and sharp edges.

2.19 ALUMINUM FINISHES

- A. Finish designations prefixed by AA comply with the system established by the Aluminum Association for designating aluminum finishes.
- B. As-Fabricated Finish: AA-M10 (Mechanical Finish: as fabricated, unspecified).
- C. Class I, Clear Anodic Finish: AA-M12C22A41 (Mechanical Finish: non-specular as fabricated; Chemical Finish: etched, medium matte; Anodic Coating: Architectural Class I, clear coating 0.018 mm or thicker) complying with AAMA 611.

PART 3 EXECUTION

3.1 INSTALLATION, GENERAL

- A. Cutting, Fitting, and Placement: Perform cutting, drilling, and fitting required for installing metal fabrications. Set metal fabrications accurately in location, alignment, and elevation; with edges and surfaces level, plumb, true, and free of rack; and measured from established lines and levels.
- B. Fit exposed connections accurately together to form hairline joints. Weld connections that are not to be left as exposed joints but cannot be shop welded because of shipping size limitations. Do not weld, cut, or abrade surfaces of exterior units that have been hot-dip galvanized after fabrication and are for bolted or screwed field connections.
- C. Field Welding: Comply with the following requirements:
 - 1. Use materials and methods that minimize distortion and develop strength and corrosion resistance of base metals.
 - 2. Obtain fusion without undercut or overlap.
 - 3. Remove welding flux immediately.
 - 4. At exposed connections, finish exposed welds and surfaces smooth and blended so no roughness shows after finishing and contour of welded surface matches that of adjacent surface.
- D. Fastening to In-Place Construction: Provide anchorage devices and fasteners where metal fabrications are required to be fastened to in-place construction. Provide threaded fasteners for use with concrete and masonry inserts, toggle bolts, through bolts, lag screws, wood screws, and other connectors.
- E. Provide temporary bracing or anchors in formwork for items that are to be built into concrete, masonry, or similar construction.
- F. Corrosion Protection: Coat concealed surfaces of aluminum that will come into contact with grout, concrete, masonry, wood, or dissimilar metals with the following:
 - 1. Cast Aluminum: Heavy coat of bituminous paint.
 - 2. Extruded Aluminum: Two coats of clear lacquer.

3.2 INSTALLING MISCELLANEOUS FRAMING AND SUPPORTS

- A. General: Install framing and supports to comply with requirements of items being supported, including manufacturers' written instructions and requirements indicated on Shop Drawings.
- B. Anchor supports for operable partitions securely to and rigidly brace from building structure.
- C. Support steel girders on solid grouted masonry, concrete, or steel pipe columns. Secure girders with anchor bolts embedded in grouted masonry or concrete or with bolts through top plates of pipe columns.
 - 1. Where grout space under bearing plates is indicated for girders supported on concrete or masonry, install as specified in "Installing Bearing and Leveling Plates" Article.
- D. Install pipe columns on concrete footings with grouted baseplates. Position and grout column baseplates as specified in "Installing Bearing and Leveling Plates" Article.
 - 1. Grout baseplates of columns supporting steel girders after girders are installed and leveled.

3.3 INSTALLING METAL BOLLARDS

- A. Fill metal-capped bollards solidly with concrete and allow concrete to cure seven days before installing.
 - 1. Do not fill removable bollards with concrete.
- B. ; anchor bolts; or through bolts. Provide four 3/4 inch bolts at each bollard unless otherwise indicated.
 - 1. Embed anchor bolts at least 4 inches in concrete.
- C. Anchor bollards in concrete as indicated.

3.4 INSTALLING BEARING AND LEVELING PLATES

- A. Clean concrete and masonry bearing surfaces of bond-reducing materials, and roughen to improve bond to surfaces. Clean bottom surface of plates.
- B. Set bearing and leveling plates on wedges, shims, or leveling nuts. After bearing members have been positioned and plumbed, tighten anchor bolts. Do not remove wedges or shims but, if protruding, cut off flush with edge of bearing plate before packing with grout.

1. Use nonshrink grout, either metallic or nonmetallic, in concealed locations where not exposed to moisture; use nonshrink, nonmetallic grout in exposed locations unless otherwise indicated.
2. Pack grout solidly between bearing surfaces and plates to ensure that no voids remain.

3.5 INSTALLING LADDERS

- A. Mount ladders so that no permanent obstruction is within 7 inches of the ladder's centerline.

3.6 ADJUSTING AND CLEANING

- A. Touchup Painting: Immediately after erection, clean field welds, bolted connections, and abraded areas. Paint uncoated and abraded areas with the same material as used for shop painting to comply with SSPC-PA 1 for touching up shop-painted surfaces.
 1. Apply by brush or spray to provide a minimum 2.0 mil dry film thickness.
- B. Touchup Painting: Cleaning and touchup painting of field welds, bolted connections, and abraded areas of shop paint are specified in Section 099000.
- C. Galvanized Surfaces: Clean field welds, bolted connections, and abraded areas and repair galvanizing to comply with ASTM A 780.

END OF SECTION

SECTION 099000
PAINTING AND COATING

PART 1 - GENERAL

1.1 DESCRIPTION

- A. This section includes materials and application of painting and coating systems for the following surfaces:
- B. Exposed, submerged, and buried metal.
- C. PVC
- D. Masonry
- E. Concrete (in contact with aluminum)
- F. Wood
- G. Drywall
- H. ~~It does not include coating steel water tanks and reservoirs.~~

1.2 REFERENCES

- A. ASTM D 16 - Terminology Relating to Paint, Varnish, Lacquer, and Related Products.
- B. ASTM D 4263 - Indicating Moisture in Concrete by the Plastic Sheet Method.
- C. ASTM F 1869 - Measuring Moisture Vapor Emission Rate of Concrete Subfloor Using Anhydrous Calcium Chloride.
- D. AWWA D 102 - Painting Steel Water Storage Tanks
- E. International Concrete Repair Institute (ICRI) Guideline No. 310.2-1997 (formerly 03732) - Selecting and Specifying Concrete Surface Preparation for Sealers, Coatings, and Polymer Overlays.
- F. NACE SP0188 - Standard Recommended Practice, Discontinuity (Holiday) Testing of Protective Coatings.
- G. NAPF 500-03-04 Abrasive Blast Cleaning.
- H. SSPC-SP 1 - Solvent Cleaning.
- I. SSPC-SP 3 - Powertool Cleaning
- J. SSPC-SP 5/NACE 1 - White Metal Blast Cleaning.
- K. SSPC-SP 6/NACE 3 - Commercial Blast Cleaning.
- L. SSPC-SP 10/NACE 2 - Near-White Metal Blast Cleaning.
- M. SSPC-SP 13/NACE 6 - Surface Preparation of Concrete.
- N. SSPC-SP 16 - Brush-Off Blast Cleaning of Coated and Uncoated Galvanized Steel, Stainless Steels, and Non-Ferrous Metals
- O. SSPC-TU 11 - Inspection of Fluorescent Coating Systems

1.3 SUBMITTALS

- A. Submit shop drawings in accordance with the Contract Documents and Section 013300.
- B. Submit manufacturer's data sheets showing the following information, including surface preparation products such as block fillers and galvanized metal primers:
 - 1. Percent solids by volume.
 - 2. Minimum and maximum recommended dry-film thickness per coat for prime, intermediate, and finish coats.
 - 3. Recommended surface preparation.
 - 4. Recommended thinners.
 - 5. Statement verifying that the specified prime coat is recommended by the manufacturer for use with the specified intermediate and finish coats.
 - 6. Application instructions including recommended equipment and temperature limitations.
 - 7. Curing requirements and instructions.
- C. Submit color swatches or charts.

- D. Submit certifications from the manufacturer of field coatings that shop prime coat materials to be applied by others is compatible with field coats.
- E. Submit manufacturer's certification that coatings comply with specified requirements and are suitable for intended application.
- F. Submit material safety data sheets for each coating.
- G. Submit certificate identifying the type and gradation of abrasives used for surface preparation.
- H. Warranty: Submit manufacturer's standard warranty, or special warranty if set forth in the contract documents.

1.4 QUALITY ASSURANCE

- A. Manufacturer's Qualifications:
 - 1. Specialize in manufacture of coatings with a proven successful experience.
 - 2. Able to demonstrate successful performance on comparable projects.
 - 3. Single Source Responsibility: Coatings and coating application reducers and additives shall be products of a single manufacturer.
- B. Applicator's Qualifications:
 - 1. Experienced in application of specified coatings on projects of similar size and complexity to this Work.
 - 2. Applicator's Personnel: Employ persons trained for application of specified coatings.
 - 3. Applicator's Quality Assurance: Upon request, submit list of a minimum of 5 completed projects of similar size and complexity to this Work. Include for each project:
 - a. Project name and location.
 - b. Name of owner.
 - c. Name of contractor.
 - d. Name of engineer.
 - e. Name of coating manufacturer.
 - f. Approximate area of coatings applied.
 - g. Date of completion.
- C. Provide field primers and undercoat paint produced by the same manufacturer as the intermediate and finish coats. All field coatings shall be by the same manufacturer.

1.5 DELIVERY, STORAGE, AND HANDLING

- A. Delivery: Deliver materials to site in manufacturer's original, unopened containers and packaging, with labels clearly identifying:
 - 1. Coating or material name.
 - 2. Manufacturer.
 - 3. Color name and number.
 - 4. Batch or lot number.
 - 5. Date of manufacture.
 - 6. Mixing and thinning instructions.
- B. Storage:
 - 1. Store materials in a clean dry area and within temperature range in accordance with manufacturer's instructions in the area designated by owner's representative.
 - 2. Keep containers sealed until ready for use.
 - 3. Do not use materials beyond manufacturer's shelf-life limits.
- C. Handling: Protect materials during handling and application to prevent damage or contamination
 - 1. Avoid danger of fire: Deposit cleaning rags and waste materials in metal containers having tight covers or remove from building each night. Provide fire extinguishers of type recommended by coating manufacturer in areas of storage and where finishing is occurring. Allow no smoking or open containers of solvents. Store solvents in safety cans.
 - 2. Upon project completion, remaining material will become property of Owner. Seal material as required for storage, marked as to contents and shelf life, and store where required by Owner.
 - 3. Protect floor and walls of storage area from splatter and disfiguration.
 - 4. Prepare multiple-component coatings using all of the contents of the container for each component as packaged by the paint manufacturer. Do not use partial batches. Do not use

multiple-component coatings that have been mixed beyond their pot life. Provide small quantity kits for touch-up painting and for painting other small areas. Mix only the components specified and furnished by the paint manufacturer. Do not intermix additional components for reasons of color or otherwise, even within the same generic type of coating.

1.6 WORK SCHEDULE

Two weeks prior to the beginning of any coating work, establish with the Owner and Engineer a mutually agreeable schedule for the work. The schedule shall allow for all inspections required.

1.7 REGULATORY REQUIREMENTS

Conform to applicable code for flame and smoke rating requirements for products and finishes.

PART 2 - MATERIALS

2.1 MANUFACTURERS

- A. Tnemec Company Inc.
- B. The Sherwin Williams Company
- C. Induron
- D. Diamond Vogel
- E. ENGINEER Approved Equal

2.2 PAINT SYSTEMS SCHEDULE

Paint Systems Schedule is located at the end of this section. Painting products are listed on the System Schedule.

2.3 PAINT FINISH SCHEDULE

The Paint Finish Schedule at the end of this section or located on the drawings indicates which surfaces are to be painted. If there is a doubt as to whether a surface is to be painted, assume it is until instructed otherwise by the Engineer.

2.4 COLORS

Paint colors will be selected from the manufacturer's standard color charts by the Owner and Engineer.

2.5 TOUCH-UP PAINT

Furnish a minimum of one gallon of each coating, in each color used, for the Owners use in future touch-up and minor repair work. Furnish the coatings in unbroken containers clearly labeled with the manufacturer's name, product number, product number, color, date of manufacture and coating system identification.

2.6 GALVANIZED METAL TOUCH-UP

Touch-up galvanized metals with Sherwin Williams Zinc Clad "Cold Galvanizing Compound", or equal, 3 mils DFT minimum, unless shown otherwise in another specification section. Provide SSPC-SP1 surface preparation.

2.7 ABRASIVES AND SURFACE PROFILE

Abrasives and surface profile shall be as recommended by the paint manufacturer for the paint material being coated and the application. Provide information for Engineer review.

PART 3 - EXECUTION

3.1 ENVIRONMENTAL REQUIREMENTS

- A. Weather:
 - 1. Air and Surface Temperatures: Prepare surfaces and apply and cure coatings within air and surface temperature range in accordance with manufacturer's instructions.
 - 2. Surface Temperature: Minimum of 5 degrees F (3 degrees C) above dew point.
 - 3. Relative Humidity: Prepare surfaces and apply and cure coatings within relative humidity range in accordance with manufacturer's instructions.
 - 4. Precipitation: Do not prepare surfaces or apply coatings in rain, snow, fog, or mist.
 - 5. Wind: Do not spray coatings if wind velocity is above manufacturer's limit.

- B. Ventilation: Provide ventilation during coating evaporation stage in confined or enclosed areas in accordance with AWWA D 102.
- C. Dust and Contaminants:
 1. Schedule coating work to avoid excessive dust and airborne contaminants.
 2. Protect work areas from excessive dust and airborne contaminants during coating application and curing
 3. Protect working parts of mechanical and electrical equipment from damage during surface preparation and painting process. Mask openings in motors to prevent paint and other materials from entering the motors.
- D. Maintain interior temperature and relative humidity of space, as recommended by coating manufacturer, 24 hours before applying and until coating is cured.
- E. Do not paint when temperature of metal to be painted is above 120°F.
- F. Do not apply alkyd, inorganic zinc, silicone aluminum, or silicone acrylic paints if air or surface temperature is below 40°F or expected to be below 40°F within 24 hours.

3.2 PROTECTION OF SURFACES NOT SCHEDULED TO BE COATED

- A. Protect surrounding areas and surfaces not scheduled to be coated from damage during surface preparation and application of coatings.
- B. Immediately remove coatings that fall on surrounding areas and surfaces not scheduled to be coated

3.3 SURFACE PREPARATION OF STEEL

- A. Prepare steel surfaces in accordance with paint manufacturer's instructions.
- B. Fabrication Defects:
 1. Correct steel and fabrication defects revealed by surface preparation.
 2. Remove weld spatter and slag.
 3. Round sharp edges and corners of welds to a smooth contour.
 4. Smooth weld undercuts and recesses.
 5. Grind down porous welds to pinhole-free metal.
 6. Remove weld flux from surface.
- C. Ensure surfaces are dry.
- D. Immersion or Below Grade Surfaces: Remove visible oil, grease, dirt, dust, mill scale, rust, paint, oxides, corrosion products, and other foreign matter in accordance with SSPC-SP 10/NACE 2. Create a surface profile as required by the coating manufacturer.
- E. Exterior Exposed or Interior Exposed Surfaces: Remove visible oil, grease, dirt, dust, mill scale, rust, paint, oxides, corrosion products, and other foreign matter in accordance with SSPC-SP 6/NACE 3. Create a surface profile mils as required by the coating manufacturer.
- F. Abrasive Blast-Cleaned Surfaces: Coat abrasive blast-cleaned surfaces with primer before visible rust forms on surface. Do not leave blast-cleaned surfaces uncoated for more than 8 hours. Do not touch blasted surface with bare hands. Do not abrasive blast or prepare more surface area in one day than can be coated in one day; prepare surfaces and apply coatings the same day.
- G. For carbon steel surfaces, after abrasive blast cleaning, verify the surface profile by measuring with an impresser tape acceptable to the Owner's Representative. Perform a minimum of one test per 100 square feet of surface area. Testing shall be witnessed by the Owner's Representative. The impresser tape used in the test shall be permanently marked with the date, time, and locations where the test was made. Test results shall be promptly presented to the Owner's Representative.
- H. Shop Primer: Shop primed steel shall receive a field sweep blast prior to the application of subsequent coats. Prepare shop primer to receive field coat in accordance with manufacturer's instructions. Removal all unknown shop primers and re-prime in accordance with this specification.

3.4 SURFACE PREPARATION OF GALVANIZED STEEL AND NONFERROUS METAL

- A. Prepare galvanized steel and nonferrous metal surfaces in accordance with SSPC-SP 16 and the coating manufacturer's instructions.
- B. Test galvanized surfaces for chromate treatments and remove as required by SSPC-SP 16, or other Engineer approved method.

- C. Ensure surfaces are dry.

3.5 SURFACE PREPARATION OF DUCTILE OR CAST IRON

- A. Prepare ductile or cast iron surfaces in accordance with NAPF 500-03-04 Abrasive Blast Cleaning with the exception that ALL rust and mold coating be removed. Only tightly adhered annealing oxide may remain.
- B. Bituminous coated pipe shall NOT be allowed if field painting is required.
- C. Ensure surfaces are clean, dry, and free of oil, grease, dirt, dust, and other contaminants.
- D. Painting contractor shall install a 360 degree bead of caulk. Prior to painting, in the void between mating flange faces and in the void between any pipe and the thread-on flange. The bead caulk shall prevent exterior water from penetrating into the described void and leaving rust streaks.
- E. Caulk shall be a paintable, high grade flexible polysulfide joint sealant as manufactured by Polyspec or equal

3.6 SURFACE PREPARATION OF PVC

- A. Prepare PVC surfaces in accordance with manufacturer's instructions.
- B. Ensure surfaces are clean, dry, and free of oil, grease, dirt, dust, and other contaminants.
- C. Scarify PVC surfaces.

3.7 SURFACE PREPARATION OF CONCRETE

- A. Interior, Wet Substrate:
 - 1. Prepare concrete surfaces in accordance with manufacturer's instructions, SSPC-SP 13/NACE 6, and ICRI 310.2.
 - 2. Allow concrete to cure for a minimum of 28 days.
 - 3. Test concrete for moisture in accordance with ASTM D 4263 and, if necessary, F 1869.
 - 4. Abrasive blast surface to remove laitance and solid contaminants and to provide clean, sound substrate with uniform anchor profile.
 - 5. Verify that the pH of the cleaned concrete surfaces to be coated is within the range of to 8 to 11. Application of coating materials outside this range will not be permitted without written approval from the Engineer.
 - 6. Fill holes, pits, voids, and cracks with manufacturer approved surfacer.
 - 7. Ensure surfaces are clean, dry, and free of oil, grease, chalk, form release agents, and other contaminants.
- B. Exterior and Interior Dry:
 - 1. Prepare concrete surfaces in accordance with manufacturer's instructions, SSPC-SP 13/NACE 6, and ICRI 310.2.
 - 2. Allow concrete to cure for a minimum of 28 days.
 - 3. Test concrete for moisture in accordance with ASTM D 4263 and, if necessary, F 1869.
 - 4. Level concrete protrusions and mortar spatter.
 - 5. Verify that the pH of the cleaned concrete surfaces to be coated is within the range of to 8 to 11. Application of coating materials outside this range will not be permitted without written approval from the Engineer.
 - 6. Fill hairline cracks less than 1/64 inch (0.4 mm) in accordance with manufacturer's instructions.
 - 7. Prepare cracks wider than 1/64 inch (0.4 mm), moving cracks, gaps, and expansion joints in accordance with manufacturer's instructions.
 - 8. Ensure surfaces are clean, dry, and free of oil, grease, chalk, form release agents, and other contaminants.

3.8 SURFACE PREPARATION OF CONCRETE FLOORS

- A. Prepare concrete surfaces in accordance with manufacturer's instructions, SSPC-SP 13/NACE 6, and ICRI 310.2.
- B. Ensure surfaces are clean, dry, and free of oil, grease, dirt, dust, and other contaminants.
- C. Allow concrete to cure for a minimum of 28 days before coating.
- D. Test concrete for moisture in accordance with ASTM D 4263 and, if necessary, F 1869.

- E. Verify that the pH of the cleaned concrete surfaces to be coated is within the range of 8 to 11. Application of coating materials outside this range will not be permitted without written approval from the Engineer.

3.9 SURFACE PREPARATION OF POROUS CONCRETE MASONRY UNITS

- A. Prepare porous concrete masonry unit surfaces in accordance with manufacturer's instructions and SSPC-SP 13/NACE 6.
- B. Ensure surfaces are clean, dry, and free of oil, grease, dirt, dust, and other contaminants.
- C. Allow mortar to cure for a minimum of 28 days before coating.
- D. Level protrusions and mortar spatter.

3.10 SURFACE PREPARATION OF GYPSUM BOARD

- A. Prepare gypsum board surfaces in accordance with manufacturer's instructions.
- B. Ensure surfaces are clean, dry, and free of oil, grease, dirt, dust, and other contaminants.
- C. Sand joint compound smooth and feather edge.
- D. Avoid heavy sanding of adjacent gypsum board surfaces, which will raise nap of paper covering.
- E. Do not apply putty, patching pencils, caulking, or masking tape to drywall surfaces to be painted.
- F. Lightly scuff-sand tape joints after priming to remove raised paper nap. Do not sand through primer.

3.11 SURFACE PREPARATION OF WOOD

- A. Prepare wood surfaces in accordance with manufacturer's instructions.
- B. Ensure surfaces are clean, dry, and free of oil, grease, dirt, dust, surface deposits of sap or pitch, and other contaminants.
- C. Seal knots and pitch pockets.
- D. Sand rough spots with the grain.
- E. Fill cracks and holes with approved materials after primer is dry. Sand flush with surface when filler is hard.
- F. Lightly sand between coats.

3.12 PROCEDURES FOR ITEMS HAVING SHOP-APPLIED PRIME COATS

- A. After application of primer to surfaces, allow coating to cure for a minimum of two hours before handling to minimize damage.
- B. When loading for shipment to the project site, use spacers and other protective devices to separate items to prevent damaging the shop-primed surfaces during transit and unloading. If wood spacers are used, remove wood splinters and particles from the shop-primed surfaces after separation. Use padded chains or ribbon binders to secure the loaded items and minimize damage to the shop-primed surfaces.
- C. Cover shop-primed items 100% with protective coverings or tarpaulins to prevent deposition of road salts, fuel residue, and other contaminants in transit.
- D. Handle shop-primed items with care during unloading, installation, and erection operations to minimize damage. Do not place or store shop-primed items on the ground or on top of other work unless ground or work is covered with a protective covering or tarpaulin. Place shop-primed items above the ground upon platforms, skids, or other supports.

3.13 FIELD TOUCH-UP OF SHOP-APPLIED PRIME COATS

- A. Remove oil and grease surface contaminants on metal surfaces in accordance with SSPC SP-1. Use clean rags wetted with a degreasing solution, rinse with clean water, and wipe dry.
- B. Remove dust, dirt, salts, moisture, chalking primers, or other surface contaminants that will affect the adhesion or durability of the coating system. Use a high-pressure water blaster or scrub surfaces with a broom or brush wetted with a solution of trisodium phosphate, detergent, and water. Rinse scrubbed surfaces with clean water.
- C. Remove loose or peeling primer and other surface contaminants not easily removed by the previous cleaning methods in accordance with SSPC SP-7. Take care that remaining primers are not damaged

by the blast cleaning operation. Remaining primers shall be firmly bonded to the steel surfaces with blast cleaned edges feathered.

- D. Remove rust, scaling, or primer damaged by welding or during shipment, storage, and erection in accordance with SSPC SP-10. Take care that remaining primers are not damaged by the blast cleaning operation. Areas smaller than 1 square inch may be prepared per SSPC SP-11. Remaining primers shall be firmly bonded to the steel surfaces with cleaned edges feathered.
- E. Use repair procedures on damaged primer that protects adjacent primer. Blast cleaning may require the use of lower air pressure, smaller nozzles, and abrasive particle sizes, short blast nozzle distance from surface, shielding, and/or masking.
- F. After abrasive blast cleaning of damaged and defective areas, remove dust, blast particles, and other debris by dusting, sweeping, and vacuuming; then apply the specified touch-up coating.
- G. Surfaces that are shop primed shall receive a field touch-up of the same primer used in the original prime coat.
- H. Review other Specification Sections in which primers are shop applied to assure compatibility of the total coating system. On request, furnish information on characteristics of intermediate and finish coating materials to assure compatibility with primers. Notify the Owners Representative of anticipated problems using the materials specified over substrates primed by others.

3.14 PROCEDURES FOR THE APPLICATION OF COATINGS

- A. Apply coatings in accordance with manufacturer's instructions.
- B. Mix and thin coatings, including multi-component materials, in accordance with manufacturer's instructions. Only full kits shall be mixed, unless properly measured using graduated measuring devices. Only mix coatings in areas designated for that purpose by the Owner's Representative.
- C. Keep containers closed when not in use to avoid contamination.
- D. Do not use mixed coatings beyond pot life limits.
- E. Use application equipment, tools, pressure settings, and techniques in accordance with manufacturer's instructions.
- F. Uniformly apply coatings at spreading rate required to achieve specified DFT.
- G. Apply coatings to be free of film characteristics or defects that would adversely affect performance or appearance of coating systems.
- H. Stripe paint with brush critical locations on steel such as welds, corners, and edges using specified primer. Apply an additional stripe coat of the intermediate coating material in immersion areas.
- I. Roll or backroll the first coat of epoxy or block filler applied to concrete or interior block substrates to work the material into the substrate

3.15 SURFACES NOT TO BE COATED

- A. Do not paint the following surfaces unless otherwise noted in the drawings or in other specification sections. Protect during the painting of adjacent areas:
- B. Prefinished items not to be painted include, but are not limited to, the following factory-finished components, unless noted otherwise:
 - 1. Toilet enclosures
 - 2. Acoustic materials
 - 3. Architectural woodwork and casework
 - 4. Shop finished water treatment process, mechanical, and electrical equipment
 - 5. Light fixtures
 - 6. Switchgear
 - 7. Distribution cabinets
 - 8. Metal Building Wall and Roof Panels
 - 9. FRP Pipe Supports, Hangers, and grating
 - 10. Laboratory Cabinets
- C. Finished metal surfaces not to be painted include, but are not limited to, the following, unless noted otherwise:
 - 1. Aluminum

2. Stainless steel and stainless steel piping, except for color coding
 3. Chromium plated
 4. Copper pipe, except for color coding
 5. Submerged brass and copper.
- D. Interior and exterior galvanized metal surfaces shall not be painted, unless noted otherwise in the paint schedule or on the plans.
- E. Operating parts not to be painted include moving parts of operating equipment, such as the following:
1. Valve and damper operators
 2. Linkage
 3. Sensing devices
 4. Motor and fan shafts
- F. Labels
1. Do not paint over Underwriters Laboratories, Factory Mutual or other code-required labels or equipment name, identification, performance rating, or nomenclature plates.
- G. Concrete and masonry surfaces unless noted to be painted on Paint Finish Schedule.
- H. Shop primed steel joists if not exposed to view upon completion of construction.
- I. Miscellaneous Items
1. Fencing
 2. Concrete reinforcement steel
 3. Buried piping unless specifically noted otherwise
 4. Exposed electrical conduit.
 5. Glass
 6. Roofing
 7. Metal letters
 8. Grease fittings
- J. Remove, mask, or otherwise protect hardware, lighting fixtures, switchplates, aluminum surfaces, machined surfaces, couplings, shafts, bearings, nameplates on machinery, and other surfaces not intended to be painted. Provide drop cloths to prevent paint materials from falling on or marring adjacent surfaces. Protect working parts of mechanical and electrical equipment from damage during surface preparation and painting process. Mask openings in motors to prevent paint and other materials from entering the motors.

3.16 SURFACES TO BE COATED

- A. Coat surfaces with the specific coating systems as described below:
1. Coat mechanical equipment, such as pumps, as described in the various mechanical equipment specifications. Color of finish coat shall match the color of the connecting piping.
 2. Coat aboveground and exposed piping or piping in vaults and structures as described in the various piping specifications.
 3. Coat valves as described in the various valve specifications. Aboveground valves, or valves in vaults and structures, shall match the color of the connecting piping.
 4. Coat aluminum surfaces in contact with concrete per System No. 11.
 5. Coat aboveground structural steel or structural steel located in vaults and structures as described in Section 05120.
 6. Field applied epoxy coatings for patching and touch-up of fusion-bonded epoxy lining and coatings shall meet the requirements of Specification Section 09961.

3.17 FIELD QUALITY CONTROL

- A. Required Inspections and Documentation:
1. Verify coatings and other materials are as specified.
 2. Verify environmental conditions are as specified.
 3. Verify surface preparation and application are as specified.
 4. Verify DFT of each coat and total DFT of each coating system are as specified using wet film and dry film gauges. DFT's shall be measured in accordance with SSPC-PA2.
 5. Coating Defects: Check coatings for film characteristics or defects that would adversely affect performance or appearance of coating systems.

- a. Check for holidays on interior steel immersion surfaces using holiday detector in accordance with NACE SP0188 or SSPC TU-11 using a safe blue light inspection lamps if OAP technology is used.
6. Report:
 - a. Prepare inspection reports daily.
 - b. Submit written reports describing inspections made and actions taken to correct nonconforming work.
 - c. Report nonconforming work not corrected.
 - d. Submit copies of report to Engineer and Contractor.
7. Perform tests in the presence of the Owner's Representative when available. The Owner's Representative may perform independent testing of coating systems, including wet film, dry film, holiday, surface profile, or testing of paint products as deemed necessary.
8. Manufacturer's Field Services: Manufacturer's representative shall provide technical assistance and guidance for surface preparation and application of coating systems

3.18 REPAIR OF IMPROPERLY COATED SURFACES

If the item has an improper finish color or insufficient film thickness, clean and topcoat the surface with the specified paint material to obtain the specified color and coverage. Sandblast or mechanically abrade visible areas of chipped, peeled, or abraded paint, feathering the edges. Then prime and finish coat in accordance with the specifications. Work shall be free of runs, bridges, shiners, laps, or other imperfections.

3.19 CLEANING

- A. During the progress of the work, remove discarded materials, rubbish, cans, and rags at the end of each day's work.
- B. Thoroughly clean brushes and other application equipment at the end of each period of use and when changing to another paint or color.
- C. Upon completion of painting work, remove masking tape, tarps, and other protective materials. Clean glass and paint splattered surfaces. Remove splattered paint by washing and scaping. Use care not to scratch or damage finished surfaces.
- D. All glass that is scratched or damaged by the painter's work or while cleaning off the paint from the glass shall be replaced.
- E. Collect waste material which may constitute a fire hazard, place in closed metal containers, and remove daily from site.

END OF SECTION

PAGE INTENTIONALLY LEFT BLANK

**SECTION 099000.10
PAINT SYSTEM SCHEDULE**

**PART 1 SCHEDULE 1
TNEMEC PAINTS**

No	Description	Surface preparation	Prime Coat		Intermediate Coat		Final Coat		NOTES
			Series	Min. DFT	Series	Min. DFT	Series	Min. DFT	
1	Exterior Metal - Architectural	SSPC SP3	10	2.0 to 4.0	1029	2.0 to 3.0	1029	2.0 to 3.0	
2	Exterior Metal - Corrosive	SSPC SP6, SEE NOTE 3	90-97	2.0 to 4.0	N69	3.5 to 4.5	73	2.0 to 3.0	Applies to all exterior metal in vicinity of wastewater plant unless indicated as galvanized. Painting existing package plant is not required on this project unless coating is damaged
3	Exterior Galv. Metal	SSPC SP1 & brush-blast	27	3.5 to 4.5	N69	3.5 to 4.5	73	2.0 to 3.0	Where indicated
4	Exterior Concrete	14 day cure & clean and dry	156	4.0 to 8.0	---	---	156	4.0 to 8.0	
5	Exterior Buried Concrete	14 day cure & clean and dry	46-413	8.0 to 12.0	---	---	46-413	8.0 to 12.0	
6	Exterior Masonry	28 day cure & clean and dry	156	60 to 80 ft ² /gal	---	---	156	80 to 100 ft ² /gal	
7	Exterior Wood	Sand & no residues	10	2.5 to 3.5	1029	2.0 to 3.0	1029	2.0 to 3.0	
8	Exterior Pipe and Equipment	SSPC SP6, See Note 2 for DIP	N69	3.0 to 5.0	N69	4.0 to 6.0	73	4.0 to 6.0	Applies to all non-stainless, non-galvanized exterior pipe and equipment

9	Exterior PVC and FRP	Lightly Abrade	27	2.0 to 3.0	---	---	73	2.0 to 3.0	Applies where PVC or FRP exposed to sun
10	Buried Metal	SSPC-SP6, See Note 3	46H-413	16.0 to 20.0	---	---	---	---	
11	Aluminum in Contact with Concrete	SSPC-SP6	46H-413	16.0 to 20.0	---	---	---	---	
12	Submerged Metal - Potable	SSPC-SP10	N140	3.0 to 5.0	N140	4.0 to 6.0	N140	4.0 to 6.0	
13	Submerged Metal - Nonpotable	SSPC-SP10	N69	3.0 to 5.0	N69	4.0 to 6.0	N69	4.0 to 6.0	Contractor shall provide touch-up coat to cages
14	Submerged Concrete - Potable	28 day cure & brush blast	N140	4.0 to 6.0	N140	4.0 to 6.0	N140	4.0 to 6.0	
15	Submerged Concrete - Nonpotable	28 day cure & brush blast	N69	4.0 to 6.0	N69	4.0 to 6.0	N69	4.0 to 6.0	
16	Metal High Temp	SSPC-SP10	39	0.7 to 1.5	39	0.7 to 1.5	39	0.7 to 1.5	Applies to all non-stainless pipe and equipment within 50' of blower discharge
17	Interior Metal - Architectural	SSPC-SP3	10	2.0 to 4.0	1029	2.0 to 3.0	1029	2.0 to 3.0	
18	Interior Metal - Corrosive	SSPC-SP6	N69	2.0 to 3.0	N69	3.0 to 5.0	N69	3.0 to 5.0	
19	Interior Galv. Metal	SSPC-SP6	27	4.0 to 6.0	---	---	73	2.0 to 3.0	
20	Interior Concrete - Architectural	28 day cure & clean and dry	104	60 to 80 ft ² /gal	---	---	104	80 to 100 ft ² /gal	
21	Interior Concrete - Corrosive	28 day cure & brush blast	104	60 to 80 ft ² /gal	---	---	104	80 to 100 ft ² /gal	
22	Concrete Floor Painted	28 day cure & brush blast	201	6.0 to 8.0	280	8.0 to 10.0	280	8.0 to 10.0	
23	Concrete Floor Clear Sealer	28 day cure & brush blast	201	10.0 to 12.0	---	---	---	---	

24	Interior-Masonry-- Archi	28-day-cure	130	60- to- 80- ft2/g al	1029	2.0 to 3.0	1029	2.0- to- 3.0	
25	Interior-Masonry-- Corrosive	28-day-cure	104	60- to- 80- ft2/g al	---	---	104	80 to 100- ft2/g al	
26	Interior Wood	sand & no residues	36	2.0- to- 3.0	1029	2.0 to 3.0	1029	2.0- to- 3.0	
27	Interior-Gypsum- Drywall	See Spec- 09260	151	1.0- to- 2.0	113	2.0 to 3.0	113	2.0- to- 3.0	
28	Bound- Absorption- Panels	No- residues	23	1.5- to- 3.0	23	1.5 to 3.0	---	---	
29	Interior Pipe- and Equipment, See note 1	SSPC- SP6, See Note 2 for DIP	27	3.0- to- 5.0	N69	4.0 to 6.0	N69	4.0- to- 6.0	
30	Interior PVC- and FRP	Lightly- Abrade	27	2.0- to- 3.0	---	---	N69	2.0- to- 3.0	
31	Electrical Conduit Runs, Metallic Tubing	SSPC SP6	37H	2.0 to 3.5	Match	Wall	Match	Wall	
32	Cotton/Canvas on Pipe- Insulation	---	1029	1.5- to- 2.0	---	---	1029	1.5- to- 2.0	
33	Submerged- Metal--Zinc- Primer	SSPC- SP10	91- H2O	2.5- to- 3.5	N140	4.0 to 6.0	N140	4.0- to- 6.0	
34	Metal- Corrosive-- Zinc Primer	SSPC SP6	91- H2O	2.5- to- 3.5	N69	3.0 to 5.0	N69	3.0- to- 5.0	
35	Interior- Gypsum- Drywall-- Epoxy		151- 1051	.07- to- 1.5	113	4.0 to 5.0	113	4.0- to- 5.0	
36	Exterior Metal- Architectural, Epoxy	SSPC SP6	27	4.0- to- 6.0	---	---	73	2.0- to- 3.0	
37	Interior Metal- Architectural, Expoxy	SSPC SP6	27	4.0- to- 6.0	---	---	73	2.0- to- 3.0	

Notes: All paint systems shown with crosshatching are not anticipated to be required on this project.

1. Unless otherwise specified.
2. Surface prep shall be in compliance with Tnemec Technical Bulletin No. 07-52. If surface profile is less than 1.5 mils then brush-off blast clean, if surface profile is more than 1.5 mils then hand or power tool clean.
3. SSPC SP10 for immersion service.

4. Coating systems from other suppliers, including Sherwin Williams and other suppliers approved in Section 099000 will be accepted. This schedule outlines specific systems acceptable if Tnemec is selected.

END OF SECTION

SECTION 221116
DOMESTIC WATER PIPING

PART 1 GENERAL

1.1 SUMMARY

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

1.2 ACTION SUBMITTALS

- A. Product Data: For transition fittings and dielectric fittings.
- B. LEED Submittal:
 - 1. Product Data for Credit EQ 4.1: For solvent cements and adhesive primers, documentation including printed statement of VOC content.
 - 2. Laboratory Test Reports for Credit IEQ 4: For solvent cements and adhesive primers, documentation indicating that products comply with the testing and product requirements of the California Department of Health Services' "Standard Practice for the Testing of Volatile Organic Emissions from Various Sources Using Small-Scale Environmental Chambers."

1.3 INFORMATIONAL SUBMITTALS

- A. System purging and disinfecting activities report.
- B. Field quality-control reports.

1.4 FIELD CONDITIONS

- A. Interruption of Existing Water Service: Do not interrupt water service to facilities occupied by Owner or others unless permitted under the following conditions and then only after arranging to provide temporary water service according to requirements indicated:
 - 1. Notify Engineer no fewer than two days in advance of proposed interruption of water service.
 - 2. Do not interrupt water service without Engineer's written permission.

PART 2 PRODUCTS

2.1 PIPING MATERIALS

- A. Comply with requirements in "Piping Schedule" Article for applications of pipe, tube, fitting materials, and joining methods for specific services, service locations, and pipe sizes.
- B. Potable-water piping and components shall comply with NSF 14 and NSF 61. Plastic piping components shall be marked with "NSF-pw."

2.2 COPPER TUBE AND FITTINGS

- A. Hard Copper Tube: ASTM B 88, Type L water tube, drawn temper.
- B. Soft Copper Tube: ASTM B 88, Type K water tube, annealed temper.
- C. Cast-Copper, Solder-Joint Fittings: ASME B16.18, pressure fittings.
- D. Wrought-Copper Solder-Joint Fittings: ASME B16.22, wrought-copper pressure fittings.
- E. Bronze Flanges: ASME B16.24, Class 150, with solder-joint ends.
- F. Copper Unions:
 - 1. MSS SP-123.
 - 2. Cast-copper-alloy, hexagonal-stock body.
 - 3. Ball-and-socket, metal-to-metal seating surfaces.
 - 4. Solder-joint or threaded ends.

- G. Copper Pressure-Seal-Joint Fittings:
 - 1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
 - a. Elkhart Products Corporation.
 - b. NIBCO Inc.
 - c. Viega.
 - 2. Fittings for NPS 2 and Smaller: Wrought-copper fitting with EPDM-rubber, O-ring seal in each end.
 - 3. Fittings for NPS 2-1/2 to NPS 4: Cast-bronze or wrought-copper fitting with EPDM-rubber, O-ring seal in each end.
- H. Copper Push-on-Joint Fittings:
 - 1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
 - a. Victaulic Company.
 - 2. Description:
 - a. Cast-copper fitting complying with ASME B16.18 or wrought-copper fitting complying with ASME B 16.22.
 - b. Stainless-steel teeth and EPDM-rubber, O-ring seal in each end instead of solder-joint ends.
- I. Copper-Tube Extruded-Tee Connections:
 - 1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
 - a. T-Drill Industries Inc.
 - b. Description: Tee formed in copper tube according to ASTM F 2014.
- J. Appurtenances for Grooved-End Copper-Tubing:
 - 1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
 - a. Anvil International.
 - b. Shurjoint Piping Products.
 - c. Victaulic Company.
 - d. Bronze Fittings for Grooved-End, Copper Tubing: ASTM B 75 copper tube or ASTM B 584 bronze castings.
 - e. Mechanical Couplings for Grooved-End Copper Tubing:
 - 1) Copper-tube dimensions and design similar to AWWA C606.
 - 2) Ferrous housing sections.
 - 3) EPDM-rubber gaskets suitable for hot and cold water.
 - 4) Bolts and nuts.
 - 5) Minimum Pressure Rating: 300 psig.

2.3 DUCTILE-IRON PIPE AND FITTINGS

- A. Mechanical-Joint, Ductile-Iron Pipe:
 - 1. AWWA C151/A21.51, with mechanical-joint bell and plain spigot end unless grooved or flanged ends are indicated.
 - 2. Glands, Gaskets, and Bolts: AWWA C111/A21.11, ductile- or gray-iron glands, rubber gaskets, and steel bolts.
- B. Standard-Pattern, Mechanical-Joint Fittings:
 - 1. AWWA C110/A21.10, ductile or gray iron.
 - 2. Glands, Gaskets, and Bolts: AWWA C111/A21.11, ductile- or gray-iron glands, rubber gaskets, and steel bolts.
- C. Compact-Pattern, Mechanical-Joint Fittings:
 - 1. AWWA C153/A21.53, ductile iron.
 - 2. Glands, Gaskets, and Bolts: AWWA C111/A21.11, ductile- or gray-iron glands, rubber gaskets, and steel bolts.
- D. Push-on-Joint, Ductile-Iron Pipe:
 - 1. AWWA C151/A21.51.
 - 1. Push-on-joint bell and plain spigot end unless grooved or flanged ends are indicated.
- E. Standard-Pattern, Push-on-Joint Fittings:
 - 1. AWWA C110/A21.10, ductile or gray iron.
 - 2. Gaskets: AWWA C111/A21.11, rubber.
- F. Compact-Pattern, Push-on-Joint Fittings:
 - 1. AWWA C153/A21.53, ductile iron.
- G. Gaskets: AWWA C111/A21.11, rubber.
- H. Plain-End, Ductile-Iron Pipe: AWWA C151/A21.51.
- I. Appurtenances for Grooved-End, Ductile-Iron-Pipe:
 - 1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
 - a. Shurjoint Piping Products.
 - b. Star Pipe Products.
 - c. Victaulic Company.
 - 2. Fittings for Grooved-End, Ductile-Iron Pipe: ASTM A 47, malleable-iron castings or ASTM A 536, ductile-iron castings with dimensions that match pipe.
 - 3. Mechanical Couplings for Grooved-End, Ductile-Iron-Pipe:
 - a. AWWA C606 for ductile-iron-pipe dimensions.
 - b. Ferrous housing sections.
 - c. EPDM-rubber gaskets suitable for hot and cold water.
 - d. Bolts and nuts.
 - e. Minimum Pressure Rating:
 - 1) NPS 14 to NPS 18 (DN 350 to DN 450): 250 psig.
 - 2) NPS 20 to NPS 46 (DN 500 to DN 900): 150 psig.

2.4 GALVANIZED-STEEL PIPE AND FITTINGS

- A. Galvanized-Steel Pipe:
 - 1. ASTM A 53/A 53M, Type E, Grade B, Standard Weight.
 - 2. Include ends matching joining method.
- B. Galvanized-Steel Pipe Nipples: ASTM A 733, made of ASTM A 53 or ASTM A 106, Standard Weight, seamless steel pipe with threaded ends.
- C. Galvanized, Gray-Iron Threaded Fittings: ASME B16.4, Class 125, standard pattern.
- D. Malleable-Iron Unions:
 - 1. ASME B16.39, Class 150.
 - 2. Hexagonal-stock body.
 - 3. Ball-and-socket, metal-to-metal, bronze seating surface.
 - 4. Threaded ends.
- E. Flanges: ASME B16.1, Class 125, cast iron.
- F. Appurtenances for Grooved-End, Galvanized-Steel Pipe:
 - 1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
 - a. Anvil International.
 - b. Grinnell Mechanical Products; Tyco Fire Products LP.
 - c. Shurjoint Piping Products.
 - d. Victaulic Company.
 - 2. Fittings for Grooved-End, Galvanized-Steel Pipe: ASTM A 47, malleable-iron casting; ASTM A 106, steel pipe; or ASTM A 536, ductile-iron casting; with dimensions matching steel pipe.
 - 3. Fittings for Grooved-End, Galvanized-Steel Pipe:
 - a. AWWA C606 for steel-pipe dimensions.
 - b. Ferrous housing sections.
 - c. EPDM-rubber gaskets suitable for hot and cold water.
 - d. Bolts and nuts.
 - e. Minimum Pressure Rating:
 - 1) NPS 8 (DN 200) and Smaller: 600 psig.
 - 2) NPS 10 and NPS 12 (DN 250 to DN 300): 400 psig.
 - 3) NPS 14 to NPS 24 (DN 350 to DN 600): 250 psig.

2.5 STAINLESS-STEEL PIPING

- A. Potable-water piping and components shall comply with NSF 61.
- B. Stainless-Steel Pipe: ASTM A 312, Schedule 40.
- C. Stainless-Steel Pipe Fittings: ASTM A 815.
- D. Appurtenances for Grooved-End, Stainless-Steel Pipe:
 - 1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
 - a. Anvil International.
 - b. Grinnell Mechanical Products; Tyco Fire Products LP.
 - c. Shurjoint Piping Products.
 - d. Victaulic Company.
 - 2. Fittings for Grooved-End, Stainless-Steel Pipe: Stainless-steel casting with dimensions matching stainless-steel pipe.
 - 3. Mechanical Couplings for Grooved-End, Stainless-Steel Pipe:
 - a. AWWA C606 for stainless-steel-pipe dimensions.
 - b. Stainless-steel housing sections.
 - c. Stainless-steel bolts and nuts.
 - d. EPDM-rubber gaskets suitable for hot and cold water.
 - e. Minimum Pressure Rating:
 - 1) NPS 8 and Smaller: 600 psig.
 - 2) NPS 10 and NPS 12: 400 psig.
 - 3) NPS 14 to NPS 24: 250 psig.

2.6 CPVC PIPING

- A. CPVC Pipe: ASTM F 441, Schedule 80.
 - 1. CPVC Socket Fittings: ASTM F 439 for Schedule 80.
 - 2. CPVC Threaded Fittings: ASTM F 437, Schedule 80.0
- B. CPVC Piping System: ASTM D 2846, SDR 11, pipe and socket fittings.
- C. CPVC Tubing System: ASTM D 2846, SDR 11, tube and socket fittings.

2.7 PEX TUBE AND FITTINGS

- A. PEX Distribution System: ASTM F 877, SDR 9 tubing.
- B. Fittings for PEX Tube: ASTM F 1807, metal-insert type with copper or stainless-steel crimp rings and matching PEX tube dimensions.
- C. Manifold: Multiple-outlet, plastic or corrosion-resistant-metal assembly complying with ASTM F 877; with plastic or corrosion-resistant-metal valve for each outlet.

2.8 PEX-AL-PEX TUBE AND FITTINGS

- A. PEX-AL-PEX Distribution System: ASTM F 1281 tubing.
- B. Fittings for PEX-AL-PEX Tube: ASTM F 1281, metal-insert type with copper or stainless-steel crimp rings and matching PEX-AL-PEX tube dimensions.

2.9 PEX-AL-HDPE TUBE AND FITTINGS

- A. PEX-AL-HPDE Distribution System: ASTM F 1986 tubing.
- B. Fittings for PEX-AL-HDPE Tube: ASTM F 1986, metal-insert type with copper or stainless-steel crimp ring and matching PEX-AL-HDPE tube dimensions

2.10 PVC PIPE AND FITTINGS

- A. PVC Pipe: ASTM D 1785, Schedule 80.
- B. PVC Socket Fittings: ASTM D 2467 for Schedule 80.
- C. PVC Schedule 80 Threaded Fittings: ASTM D 2464.

2.11 PP PIPE AND FITTINGS

- A. PP Pipe: ASTM F 2389, SDR 11.
- B. PVC Socket Fittings: ASTM F 2389.

2.12 PIPING JOINING MATERIALS

- A. Pipe-Flange Gasket Materials:
 - 1. AWWA C110/A21.10, rubber, flat face, 1/8 inch thick or ASME B16.21, nonmetallic and asbestos free unless otherwise indicated.
 - 2. Full-face or ring type unless otherwise indicated.
- B. Metal, Pipe-Flange Bolts and Nuts: ASME B18.2.1, carbon steel unless otherwise indicated.
 - C. Solder Filler Metals: ASTM B 32, lead-free alloys.
- D. Flux: ASTM B 813, water-flushable.
- E. Brazing Filler Metals: AWS A5.8, BCuP Series, copper-phosphorus alloys for general-duty brazing unless otherwise indicated.
- F. Solvent Cements for Joining CPVC Piping and Tubing: ASTM F 493.
 - 1. CPVC solvent cement shall have a VOC content of 490 g/L or less when calculated according to 40 CFR 59, Subpart D (EPA Method 24).
 - 2. Adhesive primer shall have a VOC content of 550 g/L or less when calculated according to 40 CFR 59, Subpart D (EPA Method 24).
 - 3. Solvent cement and adhesive primer shall comply with the testing and product requirements of the California Department of Health Services' "Standard Practice for the Testing of Volatile Organic Emissions from Various Sources Using Small-Scale Environmental Chambers."
- G. Solvent Cements for Joining PVC Piping: ASTM D 2564. Include primer according to ASTM F 656.
 - 1. PVC solvent cement shall have a VOC content of 510 g/L or less when calculated according to 40 CFR 59, Subpart D (EPA Method 24).
 - 2. Adhesive primer shall have a VOC content of 550 g/L or less when calculated according to 40 CFR 59, Subpart D (EPA Method 24).
 - 3. Solvent cement and adhesive primer shall comply with the testing and product requirements of the California Department of Health Services' "Standard Practice for the Testing of Volatile Organic Emissions from Various Sources Using Small-Scale Environmental Chambers."
- H. Plastic, Pipe-Flange Gaskets, Bolts, and Nuts: Type and material recommended by piping system manufacturer unless otherwise indicated.

2.13 ENCASEMENT FOR PIPING

- A. Standard: ASTM A 674 or AWWA C105/A21.5.

2.14 TRANSITION FITTINGS

- A. General Requirements:
 - 1. Same size as pipes to be joined.
 - 2. Pressure rating at least equal to pipes to be joined.
 - 3. End connections compatible with pipes to be joined.
- B. Fitting-Type Transition Couplings: Manufactured piping coupling or specified piping system fitting
- C. Sleeve-Type Transition Coupling: AWWA C219.

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
 - a. Cascade Waterworks Manufacturing.
 - b. Dresser, Inc.; Piping Specialties Products.
 - c. Ford Meter Box Company, Inc. (The).
 - d. JCM Industries.
 - e. Romac Industries, Inc.
 - f. Smith-Blair, Inc; a Sensus company.
- D. Plastic-to-Metal Transition Fittings:
 1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
 - a. Charlotte Pipe and Foundry Company.
 - b. Harvel Plastics, Inc.
 - c. Spears Manufacturing Company.
- E. Plastic-to-Metal Transition Unions:
 1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
 - a. Colonial Engineering, Inc.
 - b. NIBCO Inc.
 - c. Spears Manufacturing Company.

2.15 DIELECTRIC FITTINGS

- A. General Requirements: Assembly of copper alloy and ferrous materials with separating nonconductive insulating material. Include end connections compatible with pipes to be joined.
- B. Dielectric Unions:
 1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
 - a. Capitol Manufacturing Company; member of the Phoenix Forge Group.
 - b. Central Plastics Company.
 - c. Hart Industries International, Inc.
 - d. Jomar International.
 - e. Matco-Norca.
 - f. McDonald, A.Y. Mfg. Co.
 - g. Watts; a division of Watts Water Technologies, Inc.
 - h. Wilkins; a Zurn company.
 2. Standard: ASSE 1079.
 3. Pressure Rating: 150 psig at 180 deg F.
 4. End Connections: Solder-joint copper alloy and threaded ferrous.
- C. Dielectric Flanges:
 1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
 - a. Capitol Manufacturing Company; member of the Phoenix Forge Group.
 - b. Central Plastics Company.
 - c. Matco-Norca.
 - d. Watts; a division of Watts Water Technologies, Inc.
 - e. Wilkins; a Zurn company.
 2. Standard: ASSE 1079.
 3. Factory-fabricated, bolted, companion-flange assembly.
 4. Pressure Rating: 175 psig minimum.
 5. End Connections: Solder-joint copper alloy and threaded ferrous; threaded solder-joint copper alloy and threaded ferrous.
- D. Dielectric-Flange Insulating Kits:
 1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
 - a. Advance Products & Systems, Inc.
 - b. Calpico, Inc.

- c. Central Plastics Company.
 - d. Pipeline Seal and Insulator, Inc.
 - 2. Nonconducting materials for field assembly of companion flanges.
 - 3. Pressure Rating: 150 psig.
 - 4. Gasket: Neoprene or phenolic.
 - 5. Bolt Sleeves: Phenolic or polyethylene.
 - 6. Washers: Phenolic with steel backing washers.
- E. Dielectric Nipples:
- 1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
 - a. Elster Perfection Corporation.
 - b. Grinnell mechanical Products; Tyco Fire Products LP.
 - c. Matco-Norca.
 - d. Precision Plumbing Products, Inc.
 - e. Victaulic Company.
 - 2. Standard: IAPMO PS 66.
 - 3. Electroplated steel nipple complying with ASTM F 1545.
 - 4. Pressure Rating: 300 psig at 225 deg F.
 - 5. End Connections: Male threaded or grooved.
 - 6. Lining: Inert and noncorrosive, propylene.

PART 3 EXECUTION

3.1 EARTHWORK

- A. Comply with requirements in Section 312000 "Earth Moving" for excavating, trenching, and backfilling.

3.2 PIPING INSTALLATION

- A. Drawing plans, schematics, and diagrams indicate general location and arrangement of domestic water piping. Indicated locations and arrangements are used to size pipe and calculate friction loss, expansion, and other design considerations. Install piping as indicated unless deviations to layout are approved on coordination drawings.
- B. Install copper tubing under building slab according to CDA's "Copper Tube Handbook."
- C. Install ductile-iron piping under building slab with restrained joints according to AWWA C600 and AWWA M41.
- D. Install underground ductile-iron pipe in PE encasement according to ASTM A 674 or AWWA C105.
- E. Install shutoff valve, hose-end drain valve, strainer, pressure gage, and test tee with valve, inside the building at each domestic water service entrance. Comply with requirements for pressure gages in Section 220519 "Meters and Gages for Plumbing Piping" and with requirements for drain valves and strainers Section 221119 "Domestic Water Piping Specialties".
- F. Install shutoff valve immediately upstream of each dielectric fitting.
- G. Install water-pressure-reducing valves downstream from shutoff valves. Comply with requirements for pressure-reducing valves in Section 221119 "Domestic Water Piping Specialties".
- H. Install domestic water piping level without pitch and plumb.
- I. Rough-in domestic water piping for water-meter installation according to utility company's requirements.
- J. Install seismic restraints on piping. Comply with requirements for seismic-restraint devices in Section 220548 "Vibration and Seismic Controls for Plumbing Piping and Equipment".
- K. Install piping concealed from view and protected from physical contact by building occupants unless otherwise indicated and except in equipment rooms and service areas.
- L. Install piping indicated to be exposed and piping in equipment rooms and service areas at right angles or parallel to building walls. Diagonal runs are prohibited unless specifically indicated otherwise.
- M. Install piping above accessible ceilings to allow sufficient space for ceiling panel removal, and coordinate with other services occupying that space.
- N. Install piping to permit valve servicing.

- O. Install nipples, unions, special fittings, and valves with pressure ratings the same as or higher than system pressure rating used in applications below unless otherwise indicated.
- P. Install piping free of sags and bends.
- Q. Install fittings for changes in direction and branch connections.
- R. Install PEX piping with loop at each change of direction of more than 90 degrees.
- S. Install unions in copper tubing at final connection to each piece of equipment, machine, and specialty.
- T. Install pressure gages on suction and discharge piping from each plumbing pump and packaged booster pump. Comply with requirements for pressure gages in Section 220519 "Meters and Gages for Plumbing Piping".
- U. Install thermostats in hot-water circulation piping. Comply with requirements in Section 221123 "Domestic Water Pumps" for thermostats.
- V. Install thermometers on outlet piping from each water heater. Comply with requirements for thermometers in Section 220519 "Meters and Gages for Plumbing Piping".
- W. Install sleeves for piping penetrations of walls, ceilings, and floors. Comply with requirements for sleeves specified in Division 22 Section "Sleeves and Sleeve Seals for Plumbing Piping."
- X. Install sleeve seals for piping penetrations of concrete walls and slabs. Comply with requirements for sleeve seals specified in Division 22 Section "Sleeves and Sleeve Seals for Plumbing Piping."
- Y. Install escutcheons for piping penetrations of walls, ceilings, and floors. Comply with requirements for escutcheons specified in Division 22 Section "Escutcheons for Plumbing Piping."

3.3 JOINT CONSTRUCTION

- A. Ream ends of pipes and tubes and remove burrs. Bevel plain ends of steel pipe.
- B. Remove scale, slag, dirt, and debris from inside and outside of pipes, tubes, and fittings before assembly.
- C. Threaded Joints: Thread pipe with tapered pipe threads according to ASME B1.20.1. Cut threads full and clean using sharp dies. Ream threaded pipe ends to remove burrs and restore full ID. Join pipe fittings and valves as follows:
 1. Apply appropriate tape or thread compound to external pipe threads.
 2. Damaged Threads: Do not use pipe or pipe fittings with threads that are corroded or damaged.
- D. Brazed Joints for Copper Tubing: Comply with CDA's "Copper Tube Handbook," "Braze Joints" chapter.
- E. Soldered Joints for Copper Tubing: Apply ASTM B 813, water-flushable flux to end of tube. Join copper tube and fittings according to ASTM B 828 or CDA's "Copper Tube Handbook."
- F. Pressure-Sealed Joints for Copper Tubing: Join copper tube and pressure-seal fittings with tools recommended by fitting manufacturer.
- G. Push-on Joints for Copper Tubing: Clean end of tube. Measure insertion depth with manufacturer's depth gage. Join copper tube and push-on-joint fittings by inserting tube to measured depth.
- H. Extruded-Tee Connections: Form tee in copper tube according to ASTM F 2014. Use tool designed for copper tube; drill pilot hole, form collar for outlet, dimple tube to form seating stop, and braze branch tube into collar.
- I. Joint Construction for Grooved-End Copper Tubing: Make joints according to AWWA C606. Roll groove ends of tubes. Lubricate and install gasket over ends of tubes or tube and fitting. Install coupling housing sections over gasket with keys seated in tubing grooves. Install and tighten housing bolts.
- J. Joint Construction for Grooved-End Copper Tubing: Make joints according to AWWA C606. Roll groove ends of tubes. Lubricate and install gasket over ends of tubes or tube and fitting. Install coupling housing sections over gasket with keys seated in tubing grooves. Install and tighten housing bolts.

- K. Joint Construction for Grooved-End Steel Piping: Make joints according to AWWA C606. Roll groove ends of pipe as specified. Lubricate and install gasket over ends of pipes or pipe and fitting. Install coupling housing sections over gasket with keys seated in piping grooves. Install and tighten housing bolts
- L. Flanged Joints: Select appropriate asbestos-free, nonmetallic gasket material in size, type, and thickness suitable for domestic water service. Join flanges with gasket and bolts according to ASME B31.9.
- M. Joint Construction for Solvent-Cemented Plastic Piping: Clean and dry joining surfaces. Join pipe and fittings according to the following:
 - 1. Comply with ASTM F 402 for safe-handling practice of cleaners, primers, and solvent cements. Apply primer.
 - 2. CPVC Piping: Join according to ASTM D 2846 Appendix.
 - 3. PVC Piping: Join according to ASTM D 2855.
- N. Joints for PEX Piping: Join according to ASTM F 1807.
- O. Joints for Dissimilar-Material Piping: Make joints using adapters compatible with materials of both piping systems.

3.4 TRANSITION FITTING INSTALLATION

- A. Install transition couplings at joints of dissimilar piping.
- B. Transition Fittings in Underground Domestic Water Piping:
 - 1. Fittings for NPS 1-1/2 and Smaller: Fitting-type coupling.
 - 2. Fittings for NPS 2 and Larger: Sleeve-type coupling.
- C. Transition Fittings in Aboveground Domestic Water Piping NPS 2 and Smaller: Plastic-to-metal transition (**As Shown**)

3.5 DIELECTRIC FITTING INSTALLATION

- A. Install dielectric fittings in piping at connections of dissimilar metal piping and tubing.
- B. Dielectric Fittings for NPS 2 and Smaller: Use dielectric unions.
- C. Dielectric Fittings for NPS 2-1/2 to NPS 4: Use dielectric flange kits.
- D. Dielectric Fittings for NPS 5 and Larger: Use dielectric flange kits.

3.6 HANGER AND SUPPORT INSTALLATION

- A. Comply with requirements for seismic-restraint devices in Section 220548 "Vibration and Seismic Controls for Plumbing Piping and Equipment."
- B. Comply with requirements for pipe hanger, support products, and installation in Section 220529 "Hangers and Supports for Plumbing Piping and Equipment."
 - 1. Vertical Piping: MSS Type 8 or 42, clamps.
 - 2. Individual, Straight, Horizontal Piping Runs:
 - a. 100 Feet and Less: MSS Type 1, adjustable, steel clevis hangers.
 - b. Longer Than 100 Feet: MSS Type 43, adjustable roller hangers.
 - c. Longer Than 100 Feet if Indicated: MSS Type 49, spring cushion rolls.
 - 3. Multiple, Straight, Horizontal Piping Runs 100 Feet or Longer: MSS Type 44, pipe rolls. Support pipe rolls on trapeze.
 - 4. Base of Vertical Piping: MSS Type 52, spring hangers.
- C. Support vertical piping and tubing at base and at each floor.
- D. Rod diameter may be reduced one size for double-rod hangers, to a minimum of 3/8 inch.

- E. Install hangers for copper tubing with the following maximum horizontal spacing and minimum rod diameters:
 1. NPS 3/4 and Smaller: 60 inches with 3/8-inch rod.
 2. NPS 1 and NPS 1-1/4: 72 inches with 3/8-inch rod.
 3. NPS 1-1/2 and NPS 2: 96 inches with 3/8-inch rod.
 4. NPS 2-1/2: 108 inches with 1/2-inch rod.
 5. NPS 3 to NPS 5: 10 feet with 1/2-inch rod.
 6. NPS 6: 10 feet with 5/8-inch rod.
 7. NPS 8: 10 feet with 3/4-inch rod.
- F. Install supports for vertical copper tubing every 10 feet.
- G. Install hangers for steel piping with the following maximum horizontal spacing and minimum rod diameters:
 1. NPS 1-1/4 and Smaller: 84 inches with 3/8-inch rod.
 2. NPS 1-1/2: 108 inches with 3/8-inch rod.
 3. NPS 2: 10 feet with 3/8-inch rod.
 4. NPS 2-1/2: 11 feet with 1/2-inch rod.
 5. NPS 3 and NPS 3-1/2: 12 feet with 1/2-inch rod.
 6. NPS 4 and NPS 5: 12 feet with 5/8-inch rod.
 7. NPS 6: 12 feet with 3/4-inch rod.
 8. NPS 8 to NPS 12: 12 feet with 7/8-inch rod.
- H. Install supports for vertical steel piping every 15 feet.
- I. Install hangers for stainless-steel piping with the following maximum horizontal spacing and minimum rod diameters:
 1. NPS 1-1/4 and Smaller: 84 inches with 3/8-inch rod.
 2. NPS 1-1/2: 108 inches with 3/8-inch rod.
 3. NPS 2: 10 feet with 3/8-inch rod.
 4. NPS 2-1/2: 11 feet with 1/2-inch rod.
 5. NPS 3 and NPS 3-1/2: 12 feet with 1/2-inch rod.
 6. NPS 4 and NPS 5: 12 feet with 5/8-inch rod.
 7. NPS 6: 12 feet with 3/4-inch rod.
 8. NPS 8 to NPS 12: 12 feet with 7/8-inch rod.
- J. Install supports for vertical stainless-steel piping every 15 feet.
- K. Install vinyl-coated hangers for CPVC piping with the following maximum horizontal spacing and minimum rod diameters:
 1. NPS 1 and Smaller: 36 inches with 3/8-inch rod.
 2. NPS 1-1/4 to NPS 2: 48 inches with 3/8-inch rod.
 3. NPS 2-1/2 to NPS 3-1/2: 48 inches with 1/2-inch rod.
 4. NPS 4 and NPS 5: 48 inches with 5/8-inch rod.
 5. NPS 6: 48 inches with 3/4-inch rod.
 6. NPS 8: 48 inches with 7/8-inch rod.
- L. Install supports for vertical CPVC piping every 60 inches for NPS 1 and smaller, and every 72 inches for NPS 1-1/4 and larger.
- M. Install vinyl-coated hangers for PEX piping with the following maximum horizontal spacing and minimum rod diameters:
 1. NPS 1 and Smaller: 32 inches with 3/8-inch rod
- N. Install hangers for vertical PEX piping every 48 inches.

- O. Install vinyl-coated hangers for PVC piping with the following maximum horizontal spacing and minimum rod diameters:
 - 1. NPS 2 and Smaller: 48 inches with 3/8-inch rod.
 - 2. NPS 2-1/2 to NPS 3-1/2: 48 inches with 1/2-inch rod
 - 3. NPS 4 and NPS 5: 48 inches with 5/8-inch rod.
 - 4. NPS 6: 48 inches with 3/4-inch rod.
 - 5. NPS 8: 48 inches with 7/8-inch rod.
- P. Install supports for vertical PVC piping every 48 inches.
- Q. Install vinyl-coated hangers for PP piping with the following maximum horizontal spacing and minimum rod diameters:
 - 1. NPS 1 and Smaller: 36 inches with 3/8-inch rod.
 - 2. NPS 1-1/4 to NPS 2: 48 inches with 3/8-inch rod.
 - 3. NPS 2-1/2 to NPS 3-1/2: 48 inches with 1/2-inch rod.
 - 4. NPS 4 and NPS 5: 48 inches with 5/8-inch rod.
 - 5. NPS 6: 48 inches with 3/4-inch rod.
 - 6. NPS 8: 48 inches with 7/8-inch rod.
- R. Install supports for vertical PP piping every 60 inches for NPS 1 and smaller, and every 72 inches for NPS 1-1/4 and larger.
- S. Support piping and tubing not listed in this article according to MSS SP-69 and manufacturer's written instructions.

3.7 CONNECTIONS

- A. Drawings indicate general arrangement of piping, fittings, and specialties.
- B. When installing piping adjacent to equipment and machines, allow space for service and maintenance.
- C. Connect domestic water piping to exterior water-service piping. Use transition fitting to join dissimilar piping materials.
- D. Connect domestic water piping to water-service piping with shutoff valve; extend and connect to the following:
 - 1. Domestic Water Booster Pumps: Cold-water suction and discharge piping.
 - 2. Water Heaters: Cold-water inlet and hot-water outlet piping in sizes indicated, but not smaller than sizes of water heater connections.
 - 3. Plumbing Fixtures: Cold- and hot-water supply piping in sizes indicated, but not smaller than required by plumbing code.
 - 4. Equipment: Cold- and hot-water supply piping as indicated, but not smaller than equipment connections. Provide shutoff valve and union for each connection. Use flanges instead of unions for NPS 2-1/2 and larger.

3.8 IDENTIFICATION

- A. Identify system components. Comply with requirements for identification materials and installation in Section 220553 "Identification for Plumbing Piping and Equipment".
- B. Label pressure piping with system operating pressure.

3.9 FIELD QUALITY CONTROL

- A. Perform tests and inspections.
- B. Piping Inspections:
 - 1. Do not enclose, cover, or put piping into operation until it has been inspected and approved by authorities having jurisdiction.
 - 2. During installation, notify authorities having jurisdiction at least one day before inspection must be made. Perform tests specified below in presence of authorities having jurisdiction:
 - a. Roughing-in Inspection: Arrange for inspection of piping before concealing or closing-in after roughing-in and before setting fixtures.
 - b. Final Inspection: Arrange for authorities having jurisdiction to observe tests specified in "Piping Tests" Subparagraph below and to ensure compliance with requirements.
 - 3. Reinspection: If authorities having jurisdiction find that piping will not pass tests or inspections, make required corrections and arrange for reinspection.
 - 4. Reports: Prepare inspection reports and have them signed by authorities having jurisdiction.
- C. Piping Tests:
 - 1. Fill domestic water piping. Check components to determine that they are not air bound and that piping is full of water.
 - 2. Test for leaks and defects in new piping and parts of existing piping that have been altered, extended, or repaired. If testing is performed in segments, submit a separate report for each test, complete with diagram of portion of piping tested.
 - 3. Leave new, altered, extended, or replaced domestic water piping uncovered and unconcealed until it has been tested and approved. Expose work that was covered or concealed before it was tested.
 - 4. Cap and subject piping to static water pressure of 50 psig above operating pressure, without exceeding pressure rating of piping system materials. Isolate test source and allow it to stand for four hours. Leaks and loss in test pressure constitute defects that must be repaired.
 - 5. Repair leaks and defects with new materials and retest piping or portion thereof until satisfactory results are obtained.
 - 6. Prepare reports for tests and for corrective action required.
- D. Domestic water piping will be considered defective if it does not pass tests and inspections.
- E. Prepare test and inspection reports.

3.10 ADJUSTING

- A. Perform the following adjustments before operation:
 - 1. Close drain valves, hydrants, and hose bibbs.
 - 2. Open shutoff valves to fully open position.
 - 3. Open throttling valves to proper setting.
 - 4. Adjust balancing valves in hot-water-circulation return piping to provide adequate flow.
 - a. Manually adjust ball-type balancing valves in hot-water-circulation return piping to provide flow of hot water in each branch.
 - b. Adjust calibrated balancing valves to flows indicated.
 - 5. Remove plugs used during testing of piping and for temporary sealing of piping during installation.
 - 6. Remove and clean strainer screens. Close drain valves and replace drain plugs.
 - 7. Remove filter cartridges from housings and verify that cartridges are as specified for application where used and are clean and ready for use.
 - 8. Check plumbing specialties and verify proper settings, adjustments, and operation.

3.11 CLEANING

- A. Clean and disinfect potable domestic water piping as follows:
 - 1. Purge new piping and parts of existing piping that have been altered, extended, or repaired before using.
 - 2. Use purging and disinfecting procedures prescribed by authorities having jurisdiction; if methods are not prescribed, use procedures described in either AWWA C651 or AWWA C652 or follow procedures described below:
 - a. Flush piping system with clean, potable water until dirty water does not appear at outlets.
 - b. Fill and isolate system according to either of the following:
 - 1) Fill system or part thereof with water/chlorine solution with at least 50 ppm of chlorine. Isolate with valves and allow to stand for 24 hours.
 - 2) Fill system or part thereof with water/chlorine solution with at least 200 ppm of chlorine. Isolate and allow to stand for three hours.
 - c. Flush system with clean, potable water until no chlorine is in water coming from system after the standing time.
 - d. Repeat procedures if biological examination shows contamination
 - e. Submit water samples in sterile bottles to authorities having jurisdiction.
- B. Clean non-potable domestic water piping as follows:
 - 1. Purge new piping and parts of existing piping that have been altered, extended, or repaired before using.
 - 2. Use purging procedures prescribed by authorities having jurisdiction or; if methods are not prescribed, follow procedures described below:
 - a. Flush piping system with clean, potable water until dirty water does not appear at outlets.
 - b. Submit water samples in sterile bottles to authorities having jurisdiction. Repeat procedures if biological examination shows contamination.
- C. Prepare and submit reports of purging and disinfecting activities. Include copies of water-sample approvals from authorities having jurisdiction.
- D. Clean interior of domestic water piping system. Remove dirt and debris as progresses.

3.12 PIPING SCHEDULE

- A. Transition and special fittings with pressure ratings at least equal to piping rating may be used in applications below unless otherwise indicated.
- B. Flanges and unions may be used for aboveground piping joints unless otherwise indicated.
- C. Fitting Option: Extruded-tee connections and brazed joints may be used on above ground copper tubing.
- D. Under-building-slab, domestic water, building service piping, NPS 3 and smaller shall be the following:
 - 1. Soft copper tube, ASTM B 88, Type K; wrought-copper, solder-joint fittings; and brazed joints.
 - 2. PVC, Schedule 80 socket fittings; and solvent-cemented joints.
 - 3. PP, SDR 11 socket fittings; and fusion-welded joints.
- E. Under-building-slab, domestic water, building-service piping, NPS 4 to NPS 8 and larger shall be the following:
 - 1. Soft copper tube, ASTM B 88, Type K; wrought-copper, solder-joint fittings; and brazed joints
 - 2. Mechanical-joint, ductile-iron pipe; standard-pattern mechanical-joint fittings; and mechanical joints.
 - 3. Push-on-joint, ductile-iron pipe; compact pattern, push-on-joint fittings; and gasketed joints.
 - 4. Plain-end, ductile-iron pipe; grooved-joint, ductile-iron-pipe appurtenances; and grooved joints.
 - 5. PVC, Schedule 80 socket fittings; and solvent-cemented joints.
 - 6. PP, SDR 11 socket fittings; and fusion-welded joints.

- F. Under-building slab, combined domestic water, building-service, and fire-service-main piping, NPS 6 to NPS 12, shall be the following:
 - 1. Mechanical-joint, ductile-iron pipe; standard-pattern mechanical-joint fittings; and mechanical joints.
 - 2. Push-on-joint, ductile-iron pipe; compact pattern, push-on-joint fittings; and gasketed joints.
 - 3. Plain-end, ductile-iron pipe; grooved-joint, ductile-iron-pipe appurtenances; and grooved joints.
- G. Under-building-slab, domestic water piping, NPS 2 and smaller, shall be the following:
 - 1. Soft copper tube, ASTM B 88, Type K; wrought-copper solder-joint fittings; and brazed joints.
 - 2. PVC, Schedule 80 socket fittings; and solvent-cemented joints.
 - 3. PP, SDR 11 socket fittings; and fusion-welded joints.
- H. Aboveground domestic water piping, NPS 2 and smaller, shall be the following:
 - 1. Galvanized-steel pipe and nipples; galvanized, gray-iron threaded fittings; and threaded joints.
 - 2. Hard copper tube, ASTM B 88, Type L; wrought- copper solder-joint fittings; and soldered joints.
 - 3. Hard copper tube, ASTM B 88, Type L; copper pressure-seal-joint fittings; and pressure-sealed joints.
 - 4. Hard copper tube, ASTM B 88, Type L; copper push-on-joint fittings; and push-on joints.
 - 5. CPVC, Schedule 80 socket fittings; and solvent-cemented joints.
 - 6. CPVC, Schedule 80 pipe; CPVC, Schedule 80 threaded fittings; and threaded joints.
 - 7. CPVC Tubing System: CPVC tube; CPVC socket fittings; and solvent-cemented joints. NPS 1-1/2 and NPS 2 CPVC pipe with CPVC socket fittings may be used instead of tubing.
 - 8. PEX Tube, NPS 1 and smaller; fittings for PEX tube; and crimped joints.
 - 9. PE-AL-PE tube, NPS 1 and smaller; fittings for PE-AL-PE tube; and crimped joints.
 - 10. PEX-AL-PEX tube, NPS 1 and smaller; fittings for PEX-AL-PEX tube; and crimped joints.
 - 11. PVC, Schedule 80 socket fittings; and solvent-cemented joints.
 - 12. PP, SDR 11 socket fittings; and fusion-welded joints.
- I. Aboveground domestic water piping, NPS 2-1/2 to NPS 4, shall be the following:
 - 1. Hard copper tube, ASTM B 88, Type L; wrought- copper, solder-joint fittings; and soldered joints.
 - 2. Hard copper tube, ASTM B 88, Type L; copper pressure-seal-joint fittings; and pressure-sealed joints.
 - 3. Hard copper tube, ASTM B 88, Type L; grooved-joint, copper-tube appurtenances; and grooved joints.
 - 4. Galvanized-steel pipe and nipples; galvanized, gray-iron threaded fittings; and threaded joints.
 - 5. Galvanized-steel pipe; grooved-joint, galvanized-steel-pipe appurtenances; and grooved joints.
 - 6. CPVC, Schedule 80 socket fittings; and solvent-cemented joints.
 - 7. CPVC, Schedule 80 pipe; CPVC, Schedule 80 threaded fittings; and threaded joints.
 - 8. PVC, Schedule 80 socket fittings; and solvent-cemented joints.
 - 9. PP, SDR 11 socket fittings; and fusion-welded joints.
- J. Aboveground domestic water piping, NPS 5 to NPS 8, shall be the following:
 - 1. Hard copper tube, ASTM B 88, Type L; wrought- copper, solder-joint fittings; and soldered joints.
 - 2. Hard copper tube, ASTM B 88, Type L; grooved-joint, copper-tube appurtenances; and grooved joints.
 - 3. Galvanized-steel pipe and nipples; galvanized, gray-iron threaded fittings; and threaded joints.
 - 4. Galvanized-steel pipe; grooved-joint, galvanized-steel-pipe appurtenances; and grooved joints.
 - 5. Stainless-steel Schedule 40 pipe, grooved-joint fittings, and grooved joints.
 - 6. CPVC, Schedule 80 socket fittings; and solvent-cemented joints.
 - 7. CPVC, Schedule 80 pipe; CPVC, Schedule 80 threaded fittings; and threaded joints.
 - 8. PVC, Schedule 80 socket fittings; and solvent-cemented joints.

- K. Aboveground, combined domestic-water-service and fire-service-main piping, NPS 6 to NPS 12, shall be the following:
 - 1. Plain-end, ductile-iron pipe; grooved-joint, ductile-iron-pipe appurtenances; and grooved joints.
 - 2. Galvanized-steel pipe and nipples; galvanized, gray-iron threaded fittings; and threaded joints.
 - 3. Galvanized-steel pipe; grooved-joint, galvanized-steel-pipe appurtenances; and grooved joints.
 - 4. Stainless-steel Schedule 40 pipe, grooved-joint fittings, and grooved joints.

3.13 VALVE SCHEDULE

- A. Drawings indicate valve types to be used. Where specific valve types are not indicated, the following requirements apply:
 - 1. Shutoff Duty: Use ball valves for piping NPS 2 and smaller. Use butterfly or ball valves with flanged ends for piping NPS 2-1/2 and larger.
 - 2. Throttling Duty: Use ball or globe valves for piping NPS 2 and smaller. Use butterfly or ball valves with flanged ends for piping NPS 2-1/2 and larger.
 - 3. Hot-Water Circulation Piping, Balancing Duty: Calibrated balancing valves.
 - 4. Drain Duty: Hose-end drain valves.
- B. Use check valves to maintain correct direction of domestic water flow to and from equipment.
- C. Iron grooved-end valves may be used with grooved-end piping.

**THIS PAGE INTENTIONALLY LEFT BLANK.
END OF SECTION**

SECTION 221119
DOMESTIC WATER PIPING SPECIALTIES

PART 1 GENERAL

1.1 SUMMARY

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

1.2 ACTION SUBMITTALS

- A. Product Data: For each type of product.
- B. Shop Drawings: For domestic water piping specialties.
 - 1. Include diagrams for power, signal, and control wiring.

1.3 INFORMATIONAL SUBMITTALS

- A. Field quality-control reports.

1.4 CLOSEOUT SUBMITTALS

- A. Operation and Maintenance Data: For domestic water piping specialties to include in emergency, operation, and maintenance manuals.

1.5 QUALITY ASSURANCE

- A. Electrical Components, Devices, and Accessories: Listed and labeled as defined in NFPA 70, Article 100, by a testing agency acceptable to authorities having jurisdiction, and marked for intended use.
- B. NSF Compliance:
 - 1. Comply with NSF 14, "Plastics Piping Components and Related Materials," for plastic domestic water piping components.
 - 2. Comply with NSF 61, "Drinking Water System Components - Health Effects; Sections 1 through 9."

PART 2 PRODUCTS

2.1 GENERAL REQUIREMENTS FOR PIPING SPECIALTIES

- A. Potable-water piping and components shall comply with NSF 61.

2.2 PERFORMANCE REQUIREMENTS

- A. Minimum Working Pressure for Domestic Water Piping Specialties: 125 psig, unless otherwise indicated.

2.3 VACUUM BREAKERS

- A. Pipe-Applied, Atmospheric-Type Vacuum Breakers:
 - 1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
 - a. Ames Fire & Waterworks; a division of Watts Water Technologies, Inc.
 - b. Conbraco Industries, Inc.
 - c. FEBCO; a division of Watts Water Technologies, Inc.
 - d. Watts; a division of Watts Water Technologies, Inc.; Watts Regulator Company.
 - e. Zurn Industries, LLC; Plumping Products Group; Wilkins Water Control Products.
 - 2. Standard: ASSE 1001.
 - 3. Size: NPS 1/4 to NPS 3, as required to match connected piping.
 - 4. Body: Bronze.
 - 5. Inlet and Outlet Connections: Threaded.
 - 6. Finish: Rough bronze.

- B. Hose-Connection Vacuum Breakers:
 - 1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
 - a. Conbraco Industries, Inc.
 - b. Watts; a division of Watts Water Technologies, Inc.; Watts Regulator Company.
 - c. Woodford Manufacturing Company; a division of WCM Industries, Inc.
 - d. Zurn Industries, LLC; Plumbing Products Group; Light Commercial Products.
 - e. Zurn Industries, LLC; Plumbing Products Group; Wilkins Water Control Products.
 - 2. Standard: ASSE 1011.
 - 3. Body: Bronze, nonremovable, with manual drain.
 - 4. Outlet Connection: Garden-hose threaded complying with ASME B1.20.7.
 - 5. Finish: Rough bronze.
- C. Pressure Vacuum Breakers:
 - 1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
 - a. Conbraco Industries, Inc.
 - b. FEBCO; a division of Watts Water Technologies, Inc.
 - c. Watts; a division of Watts Water Technologies, Inc.; Watts Regulator Company.
 - d. Zurn Industries, LLC; Plumbing Products Group; Wilkins Water Control Products.
 - 2. Standard: ASSE 1020.
 - 3. Operation: Continuous-pressure applications.
 - 4. Pressure Loss: 5 psig maximum, through middle third of flow range.
 - 5. Size: Match pipe size.
 - 6. Accessories:
 - a. Valves: Ball type, on inlet and outlet.
- D. Laboratory-Faucet Vacuum Breakers:
 - 1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
 - a. Conbraco Industries, Inc.
 - b. Watts; a division of Watts Water Technologies, Inc.; Watts Regulator Company.
 - c. Woodford Manufacturing Company; a division of WCM Industries, Inc.
 - d. Zurn Industries, LLC; Plumbing Products Group; Wilkins Water Control Products.
 - 2. Standard: ASSE 1035.
 - 3. Size: NPS 1/4 or NPS 3/8 matching faucet size.
 - 4. Body: Bronze.
 - 5. End Connections: Threaded.
 - 6. Finish: Chrome plated.
- F. Spill-Resistant Vacuum Breakers:
 - 1. Manufacturers: Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:
 - a. Conbraco Industries, Inc.
 - b. Watts; a division of Watts Water Technologies, Inc.; Watts Regulator Company.
 - 2. Standard: ASSE 1056.
 - 3. Operation: Continuous-pressure applications.
 - 4. Size: **(As Shown)**
 - 5. Accessories:
 - a. Valves: Ball type, on inlet and outlet.

2.4 BACKFLOW PREVENTERS

- A. Intermediate Atmospheric-Vent Backflow Preventers:
1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
 - a. Conbraco Industries, Inc.
 - b. FEBCO; a division of Watts Water Technologies, Inc.
 - c. Watts; a division of Watts Water Technologies, Inc.; Watts Regulator Company.
 - d. Zurn Industries, LLC; Plumbing Products Group; Wilkins Water Control Products.
 2. Standard: ASSE 1012.
 3. Operation: Continuous-pressure applications.
 4. Size: **(As Shown)**
 5. Body: Bronze.
 6. End Connections: Union, solder joint.
 7. Finish: Rough bronze.
- B. Reduced-Pressure-Principle Backflow Preventers:
1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
 - a. Conbraco Industries, Inc.
 - b. FEBCO; a division of Watts Water Technologies, Inc.
 - c. Watts; a division of Watts Water technologies, Inc.; Watts Regulator Company.
 - d. Zurn Industries, LLC; Plumbing Products Group; Wilkins Water Control Products.
 2. Standard: ASSE 1013.
 3. Operation: Continuous-pressure applications.
 4. Pressure Loss: 12 psig maximum, through middle third of flow range.
 5. Size: Match pipe size.
 6. Design Flow Rate: 45 GPM
 7. Body: Bronze for NPS 2 and smaller; cast iron with interior lining complying with AWWA C550 or that is FDA approved for NPS 2-1/2 and larger.
 8. End Connections: Threaded for NPS 2 and smaller; flanged for NPS 2-1/2 and larger.
 9. Configuration: Designed for horizontal, straight through flow.
 10. Accessories:
 - a. Valves NPS 2 and Smaller: Ball type with threaded ends on inlet and outlet.
 - b. Valves 2-1/2 and Larger: Outside screw and yoke-gate type with flanged ends on inlet and outlet.
 - c. Air-Gap Fitting: ASME A112.1.2, matching backflow-preventer connection.
- C. Double-Check Backflow-Prevention Assemblies:
1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
 - a. Conbraco Industries, Inc.
 - b. FEBCO; a division of Watts Water Technologies, Inc.
 - c. Watts; a division of Watts Water Technologies, Inc.; Watts Regulator company.
 - d. Zurn Industries, LLC; Plumbing Products Group; Wilkins Water Control Products.
 2. Standard: ASSE 1015.

3. Operation: Continuous-pressure applications, unless otherwise indicated.
 4. Pressure Loss: 5 psig maximum, through middle third of flow range.
 5. Size: Match pipe size.
 6. Design Flow Rate: _____
 7. Selected Unit Flow Range Limits: _____
 8. Pressure Loss at Design Flow Rate: _____ for sizes NPS 2 and smaller; _____ for NPS 2-1/2 and larger.
 9. Body: Bronze for NPS 2 and smaller; cast iron with interior lining complying with AWWA C550 or that is FDA approved for NPS 2-1/2 and larger.
 10. End Connections: Threaded for NPS 2 and smaller; flanged for NPS 2-1/2 and larger.
 11. Configuration: Designed for horizontal, straight through flow.
 12. Accessories:
 - a. Valves NPS 2 and Smaller: Ball type with threaded ends on inlet and outlet.
 - b. Valves NPS 2-1/2 and Larger: Outside screw and yoke-gate type with flanged ends on inlet and outlet.
- D. Beverage-Dispensing-Equipment Backflow Preventers:
1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
 - a. Conbraco Industries, Inc.
 - b. Watts; a division of Watts Water Technologies, Inc.; Watts Regulator Company.
 - c. Zurn Industries, LLC; Plumbing Products Group; Wilkins Water Control Products.
 2. Standard: ASSE 1022.
 3. Operation: Continuous-pressure applications.
 4. Size: NPS 1/4 or NPS 3/8.
 5. Body: Stainless steel.
 6. End Connections: Threaded.
- E. Dual-Check-Valve Backflow Preventers:
1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
 - a. Conbraco Industries, Inc.
 - b. FEBCO; a division of Watts Water Technologies, Inc.
 - c. Mueller Co. Ltd.; a subsidiary of Mueller Water Products Inc.
 - d. Watts; a division of Watts Water Technologies, Inc.; Watts Regulator Company.
 - e. Zurn Industries, LLC; Plumbing Products Group; Wilkins Water Control Products.
 2. Standard: ASSE 1024.
 3. Operation: Continuous-pressure applications.
 4. Size: **(As Shown)**
 5. Body: Bronze with union inlet.
- F. Carbonated-Beverage-Dispenser, Dual-Check-Valve Backflow Preventers:
1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
 - a. Watts; a division of Watts Water Technologies, Inc.; Watts Regulator Company.
 2. Standard: ASSE 1032.
 3. Operation: Continuous-pressure applications.
 4. Size: NPS 1/4 or NPS 3/8.
 5. Body: Stainless steel.
 6. End Connections: Threaded.

- G. Reduced-Pressure-Detector, Fire-Protection Backflow-Preventer Assemblies:
1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
 - a. Conbraco Industries, Inc.
 - b. FEBCO; a division of Watts Water Technologies, Inc.
 - c. Watts; a division of Watts Water Technologies, Inc.; Watts Regulator Company.
 - d. Zurn Industries, LLC; Plumbing Products Group; Wilkins Water Control Products.
 2. Standard: ASSE 1047 and FMG approved or UL listed.
 3. Operation: Continuous-pressure applications.
 4. Pressure Loss: 12 psig maximum, through middle third of flow range.
 5. Size: Match pipe size.
 6. Design Flow Rate: _____
 7. Selected Unit Flow Range Limits: _____
 8. Pressure Loss at Design Flow Rate: _____.
 9. Body: Cast iron with interior lining complying with AWWA C550 or that is FDA approved.
 10. End Connections: Flanged.
 11. Configuration: Designed for horizontal, straight through flow.
 12. Accessories:
 - a. Valves: Outside screw and yoke gate-type with flanged ends on inlet and outlet.
 - b. Air-Gap Fitting: ASME A112.1.2, matching backflow-preventer connection.
 - c. Bypass: With displacement-type water meter, shutoff valves, and reduced-pressure backflow preventer.
- H. Double-Check, Detector-Assembly Backflow Preventers:
1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
 - a. Conbraco Industries, Inc.
 - b. FEBCO; a division of Watts Water Technologies, Inc.
 - c. Watts; a division of Watts Water Technologies, Inc.; Watts Regulator Company.
 - d. Zurn Industries, LLC; Plumbing Products Group; Wilkins Water Control Products.
 2. Standard: ASSE 1048 and FMG approved or UL listed.
 3. Operation: Continuous-pressure applications.
 4. Pressure Loss: 5 psig maximum, through middle third of flow range.
 5. Size: Match pipe size.
 6. Design Flow Rate: NA
 7. Body: Cast iron with interior lining complying with AWWA C550 or that is FDA approved.
 8. End Connections: Flanged.
 9. Configuration: Designed for horizontal, straight through flow.
 10. Accessories:
 - a. Valves: Outside screw and yoke gate-type with flanged ends on inlet and outlet.
 - b. Bypass: With displacement-type water meter, shutoff valves, and reduced-pressure backflow preventer.

- I. Hose-Connection Backflow Preventers:
 - 1. Manufacturers: Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:
 - a. Conbraco Industries, Inc.
 - b. Watts; a division of Watts Water Technologies, Inc.; Watts Regulator Company.
 - c. Woodford Manufacturing Company; a division of WCM Industries, Inc.
 - 2. Standard: ASSE 1052.
 - 3. Operation: Up to 10-foot head of water back pressure.
 - 4. Inlet Size: NPS 1/2 or NPS 3/4.
 - 5. Outlet Size: Garden-hose thread complying with ASME B1.20.7.
 - 6. Capacity: At least 3-gpm flow.
- J. Backflow-Preventer Test Kits:
 - 1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
 - a. Conbraco Industries, Inc.
 - b. FEBCO; a division of Watts Water Technologies, Inc.
 - c. Watts; a division of Watts Water Technologies, Inc.; Watts Regulator Company.
 - d. Zurn Industries, LLC; Plumbing Products Group; Wilkins Water Control Products.
 - 2. Description: Factory calibrated, with gages, fittings, hoses, and carrying case with test-procedure instructions.

2.5 WATER PRESSURE-REDUCING VALVES

- A. Water Regulators:

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
 - a. Conbraco Industries, Inc.
 - b. Watts; a division of Watts Water Technologies, Inc.; Watts Regulator Company.
 - c. Zurn Industries, LLC; Plumbing Products Group; Wilkins Water Control Products.
 2. Standard: ASSE 1003.
 3. Pressure Rating: Initial working pressure of 150 psig.
 4. Size: Match pipe size.
 5. Design Flow Rate: NA
 6. Design Inlet Pressure: NA
 7. Design Outlet Pressure Setting: NA
 8. Body: Bronze with chrome-plated finish for NPS 2 and smaller; cast iron with interior lining that complies with AWWA C550 or that is FDA approved for NPS 2-1/2 and NPS 3.
 9. Valves for Booster Heater Water Supply: Include integral bypass.
 10. End Connections: Threaded for NPS 2 and smaller; flanged for NPS 2-1/2 and NPS 3.
- B. Water Control Valves:
1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
 - a. Watts; a division of Watts Water Technologies, Inc.; Control Valves (Watts ACV).
 - b. Zurn Industries, LLC; Plumbing Products Group; Wilkins Water Control Products.
 2. Description: Pilot-operation, diaphragm-type, single-seated main water control valve.
 3. Pressure Rating: Initial working pressure of 150 psig minimum with AWWA C550 or FDA-approved, interior epoxy coating. Include small pilot-control valve, restrictor device, specialty fittings, and sensor piping.
 4. Main Valve Body: Cast- or ductile-iron body with AWWA C550 or FDA-approved, interior epoxy coating; or stainless-steel body.
 - a. Size: Match pipe size.
 - b. Pattern: (As Shown) valve design.
 - c. Trim: Stainless steel.
 5. Design Flow: NA
 6. Design Inlet Pressure: NA
 7. Design Outlet Pressure Setting: NA
 8. End Connections: Threaded for NPS 2 and smaller; flanged for NPS 2-1/2 and larger.

2.6 TEMPERATURE-ACTUATED WATER MIXING VALVE

A. Water-Temperature Limiting Devices:

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
 - a. Armstrong International, Inc.
 - b. Conbraco Industries, Inc.
 - c. Leonard Valve Company.
 - d. Powers; a division of Watts Water Technologies, Inc.
 - e. Symmons Industries, Inc.
 - f. TACO, Incorporated.
 - g. Watts; a division of Watts Water Technologies, Inc.; Watts Regulator Company.
 - h. Zurn Industries, LLC; Plumbing Products Group; Wilkins Water Control Products.
2. Standard: ASSE 1017.
3. Pressure Rating: 125 psig.
4. Type: Thermostatically controlled, water mixing valve.
5. Material: Bronze body with corrosion-resistant interior components.
6. Connections: Threaded union inlets and outlet.
7. Accessories: Check stops on hot- and cold-water supplies, and adjustable, temperature-control handle.
8. Tempered-Water Setting: NA°F
9. Tempered-Water Design Flow Rate: NA
10. Valve Finish: Rough bronze

B. Primary, Thermostatic, Water Mixing Valves:

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
 - a. Armstrong International, Inc.
 - b. Leonard Valve Company.
 - c. Powers; a division of Watts Water Technologies, Inc.
 - d. Symmons Industries, Inc.
2. Standard: ASSE 1017.
3. Pressure Rating: 125 psig.
4. Type: **(As Shown)**, thermostatically controlled, water mixing valve.
5. Material: Bronze body with corrosion-resistant interior components.
6. Connections: Threaded union inlets and outlet.
7. Accessories: Manual temperature control, check stops on hot- and cold-water supplies, and adjustable, temperature-control handle.
8. Tempered-Water Setting: NA °F.
9. Tempered-Water Design Flow Rate: NA
10. Selected Valve Flow Rate at 45-psig Pressure Drop: NA
11. Pressure Drop at Design Flow Rate: NA
12. Valve Finish: Rough bronze.
13. Piping Finish: Copper.
14. Cabinet: Factory-fabricated, stainless steel, for surface mounting and with hinged, stainless-steel door.

- C. Manifold, Thermostatic, Water-Mixing-Valve Assemblies:
1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
 - a. Leonard Valve Company.
 - b. Powers; a division of Watts Water Technologies, Inc.
 - c. Symmons Industries, Inc.
 2. Description: Factory-fabricated, exposed-mounting, thermostatically controlled, water-mixing-valve assembly in three-valve parallel arrangement.
 3. Large-Flow Parallel: Thermostatic water mixing valve and downstream pressure regulator with pressure gages on inlet and outlet.
 4. Intermediate-Flow Parallel: Thermostatic water mixing valve and downstream pressure regulator with pressure gages on inlet and outlet.
 5. Small-Flow Parallel: Thermostatic water mixing valve.
 6. Thermostatic Mixing Valves: Comply with ASSE 1017. Include check stops on hot- and cold-water inlets and shutoff valve on outlet.
 7. Water Regulator(s): Comply with ASSE 1003. Include pressure gage on inlet and outlet.
 8. Pressure Rating: 125 psig minimum unless otherwise indicated.
 9. Cabinet: Factory-fabricated, stainless steel, for surface mounting and with hinged, stainless-steel door.
 10. Selected Large Flow, Tempered Water Valve Size: NA
 11. Tempered-Water Setting: NA °F.
 12. Unit Tempered-Water Design Flow Rate: NA
 13. Unit Minimum Tempered-Water Design Flow Rate: NA
 14. Selected Unit Flow Rate at 45-psig Pressure Drop: NA
 15. Unit Pressure Drop at Design Flow Rate: NA
 16. Unit Tempered-Water Outlet Size: NA end connection.
 17. Unit Hot- and Cold-Water Inlet Size: NA end connections.
 18. Thermostatic Mixing Valve and Water Regulator Finish: Rough bronze.
 19. Piping Finish: Copper.
- D. Photographic-Process, Thermostatic, Water-Mixing-Valve Assemblies:
1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
 - a. Leonard Valve Company.
 - b. Powers; a division of Watts Water Technologies, Inc.
 - c. Symmons Industries, Inc.
 2. Standard: ASSE 1017, thermostatically controlled, water mixing valve made for precise, process-water temperature control.
 3. Pressure Rating: 125 psig minimum, unless otherwise indicated.
 4. Body: Bronze with corrosion-resistant interior components.
 5. Connections: Threaded inlets and outlet.
 6. Accessories: Manual temperature control, check stops on hot- and cold-water supplies, thermometer, shutoff valve, and adjustable, temperature-control handle.
 7. Cabinet: Factory-fabricated, stainless steel, for surface mounting; with controls and thermometer mounted on front.
 8. Tempered-Water Setting: NA°F
 9. Tempered-Water Design Flow Rate: NA.
 10. Tempered-Water Outlet Size: NA.
 11. Hot- and Cold-Water Inlet Size: NA.

E. Individual-Fixture, Water Tempering Valves:

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
 - a. Conbraco Industries, Inc.
 - b. Leonard Valve Company.
 - c. Powers; a division of Watts Water Technologies, Inc.
 - d. Watts; a division of Watts Water Technologies, Inc.; Watts Regulator Company.
 - e. Zurn Industries, LLC; Plumbing Products Group; Wilkins Water Control Products.
2. Standard: ASSE 1016, thermostatically controlled water tempering valve.
3. Pressure Rating: 125 psig minimum, unless otherwise indicated.
4. Body: Bronze body with corrosion-resistant interior components.
5. Temperature Control: Adjustable.
6. Inlets and Outlet: Threaded.
7. Finish: Rough or chrome-plated bronze.
8. Tempered-Water Setting: NA °F

9. Tempered-Water Design Flow Rate: NA
- F. Primary Water Tempering Valves:
1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
 - a. Heat-Timer Corporation.
 2. Standard: ASSE 1017, thermostatically controlled, water tempering valve, listed as tempering valve.
 3. Pressure Rating: 125 psig minimum unless otherwise indicated.
 4. Body: Bronze.
 5. Temperature Control: Manual.
 6. Inlets and Outlet: Threaded.
 7. Selected Primary Water Tempering Valve Size: NA
 8. Tempered-Water Setting: NA°F
 9. Tempered-Water Design Flow Rate: NA
 10. Pressure Drop at Design Flow Rate: NA
 11. Tempered-Water Outlet Size: NA
 12. Cold-Water Inlet Size: NA
 13. Hot-Water Inlet Size: NA
 14. Valve Finish: Rough bronze.

2.7 STRAINERS FOR DOMESTIC WATER PIPING

- A. Y-Pattern Strainers:
1. Pressure Rating: 125 psig minimum unless otherwise indicated.
 2. Body: Bronze for NPS 2 and smaller; cast iron with interior lining that complies with AWWA C550 or that is FDA approved, epoxy coated and for NPS 2-1/2 and larger.
 3. End Connections: Threaded for NPS 2 and smaller; flanged for NPS 2-1/2 and larger.
 4. Screen: Stainless steel with round perforations, unless otherwise indicated.
 5. Perforation Size:
 - a. Strainers NPS 2 and Smaller: 0.020 inch.
 - b. Strainers NPS 2-1/2 to NPS 4: 0.045 inch.
 - c. Strainers NPS 5 and Larger: 0.10 inch.
 6. Drain: Factory-installed, hose-end drain valve.

2.8 OUTLET BOXES

A. Clothes Washer Outlet Boxes:

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
 - a. Acorn Engineering Company.
 - b. Guy Gray Manufacturing Co., Inc.
 - c. Symmons Industries, Inc.
 - d. Watts; a division of Watts Water Technologies, Inc.; Watts Regulator Company.
 - e. Whitehall Manufacturing; a div. of Acorn Engineering Company.
 - f. Zurn Industries, LLC; Plumbing Products Group; Light Commercial Products.
2. Mounting: Recessed.
3. Material and Finish: Enameled-steel or epoxy-painted-steel box and faceplate.
4. Faucet: Combination valved fitting or separate hot- and cold-water valved fittings complying with ASME A112.18.1. Include garden-hose thread complying with ASME B1.20.7 on outlets.
5. Supply Shutoff Fittings: NPS 1/2 ball valves and NPS 1/2 copper, water tubing.
6. Drain: NPS 2 standpipe and P-trap for direct waste connection to drainage piping.
7. Inlet Hoses: Two 60-inch- long, rubber household clothes washer inlet hoses with female, garden-hose-thread couplings. Include rubber washers.
8. Drain Hose: One 48-inch- long, rubber household clothes washer drain hose with hooked end.

B. Icemaker Outlet Boxes:

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
 - a. Acorn Engineering Company.
2. Mounting: Recessed.
3. Material and Finish: Enameled-steel or epoxy-painted-steel box and faceplate.
4. Faucet: Valved fitting complying with ASME A112.18.1. Include NPS 1/2 or smaller copper tube outlet.
5. Supply Shutoff Fitting: NPS 1/2 ball valve and NPS 1/2 copper, water tubing.

2.9 HOSE STATIONS

A. Manufacturers: Subject to compliance with requirements, provide products by one of the following:

1. Leonard Valve Company.
2. T & S Brass.

B. Single-Temperature-Water Hose Stations:

1. Standard: ASME A112.18.1.
2. Cabinet: Stainless-steel enclosure with exposed valve handle, hose connection, and hose rack. Include thermometer in front.
3. Hose-Rack Material: Stainless steel.
4. Body Material: Bronze with stainless-steel wetted parts.
5. Body Finish: Rough bronze, chrome plated.
6. Mounting: Wall, with reinforcement.
7. Supply Fitting: NPS 3/4 gate, globe, or ball valve and check valve and NPS 3/4 copper, water tubing. Omit check valve if check stop is included with fitting.
8. Hose: Manufacturer's standard, for service fluid, temperature, and pressure; 25 feet long.
9. Nozzle: With hand squeeze on-off control.
10. Vacuum Breaker:
 - a. Integral or factory-installed, nonremovable, manual-drain-type, hose-connection vacuum breaker complying with ASSE 1011 or backflow preventer complying with ASSE 1052.
 - b. Garden-hose thread complying with ASME B1.20.7 on outlet.

- C. Hot- and Cold-Water Hose Stations:
1. Standard: ASME A112.18.1.
 2. Faucet Type: Thermostatic mixing valve.
 3. Cabinet: Stainless-steel enclosure with exposed valve handles, hose connection, and hose rack. Include thermometer in front.
 4. Hose-Rack Material: Stainless steel.
 5. Body Material: Bronze with stainless-steel wetted parts.
 6. Body Finish: Rough bronze or chrome plated.
 7. Mounting: Wall, with reinforcement
 8. Supply Fittings: Two NPS 3/4 gate, globe, or ball valves and check valves and NPS 3/4 copper, water tubing. Omit check valves if check stops are included with fitting.
 9. Hose: Manufacturer's standard, for service fluid, temperature, and pressure; 25 feet long.
 10. Nozzle: With hand squeeze on-off control.
 11. Vacuum Breaker: Integral or factory-installed, nonremovable, manual-drain-type, hose-connection vacuum breaker complying with ASSE 1011 or backflow preventer complying with ASSE 1052; and garden-hose thread complying with ASME B1.20.7 on outlet.
- D. Cold-Water and Steam Hose Stations:
1. Standard: ASME A112.18.1.
 2. Type Faucet: Thermostatic mixing valve.
 3. Cabinet: Stainless-steel enclosure with exposed valve handles, hose connection, and hose rack. Include thermometer in front.
 4. Hose-Rack Material: Stainless steel.
 5. Body Material: Bronze with stainless-steel wetted parts.
 6. Body Finish: Rough bronze or chrome plate.
 7. Mounting: Wall, with reinforcement.
 8. Supply Fittings: Two NPS 3/4 gate, globe, or ball valves and check valves and NPS 3/4 copper, water tubing. Omit check valves if check stops are included with fitting.
 9. Hose: Manufacturer's standard, for service fluid, temperature, and pressure; 25 feet long.
 10. Nozzle: With hand squeeze on-off control.
 11. Vacuum Breaker:
 - a. Integral or factory-installed, nonremovable, manual-drain-type, hose-connection vacuum breaker complying with ASSE 1011 or backflow preventer complying with ASSE 1052.
 - b. Garden-hose thread complying with ASME B1.20.7 on outlet.

2.10 HOSE BIBBS

- A. Hose Bibbs:
1. Standard: ASME A112.18.1 for sediment faucets.
 2. Body Material: Bronze.
 3. Seat: Bronze, replaceable.
 4. Supply Connections: NPS 1/2 or NPS 3/4 threaded or solder-joint inlet.
 5. Outlet Connection: Garden-hose thread complying with ASME B1.20.7.
 6. Pressure Rating: 125 psig.
 7. Vacuum Breaker: Integral nonremovable, drainable, hose-connection vacuum breaker complying with ASSE 1011.
 8. Finish for Equipment Rooms: Rough bronze, or chrome or nickel plated.
 9. Finish for Service Areas: Rough bronze.
 10. Finish for Finished Rooms: Chrome or nickel plated.
 11. Operation for Equipment Rooms: Wheel handle or operating key.
 12. Operation for Service Areas: Wheel handle.
 13. Operation for Finished Rooms: Wheel handle.
 14. Include operating key with each operating-key hose bibb.
 15. Include integral wall flange with each chrome- or nickel-plated hose bibb.

2.11 WALL HYDRANTS

A. Nonfreeze Wall Hydrants:

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
 - a. Josam Company.
 - b. Smith, Jay R. Mfg. Co.; Division of Smith Industries, Inc.
 - c. Tyler Pipe; Wade Div.
 - d. Watts Drainage Products.
 - e. Woodford Manufacturing Company; a division of WCM Industries, Inc.
 - f. Zurn Industries, LLC; Plumbing Products Group; Light Commercial Products.
 - g. Zurn Industries, LLC; Plumbing Products Group; Specification Drainage Products.
2. Standard: ASME A112.21.3M for exposed outlet, self-draining wall hydrants.
3. Pressure Rating: 125 psig.
4. Operation: Loose key.
5. Casing and Operating Rod: Of length required to match wall thickness. Include wall clamp.
6. Inlet: NPS 3/4 or NPS 1.
7. Outlet: Concealed, with integral vacuum breaker and garden-hose thread complying with ASME B1.20.7.
8. Box: Deep, flush mounting with cover.
9. Box and Cover Finish: Polished nickel bronze.
10. Outlet: Exposed, with integral vacuum breaker and garden-hose thread complying with ASME B1.20.7.
11. Nozzle and Wall-Plate Finish: Polished nickel bronze.
12. Operating Keys(s): Two with each wall hydrant.

B. Nonfreeze, Hot- and Cold-Water Wall Hydrants:

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
 - a. Josam Company.
 - b. Smith, Jay R. Mfg. Co.; Division of Smith Industries, Inc.
 - c. Tyler Pipe; Wade Div.
 - d. Watts Drainage Products Inc.
 - e. Woodford Manufacturing Company; a division of WCM Industries, Inc.
 - f. Zurn Industries, LLC; Plumbing Products Group; Specification Drainage Operation.
2. Standard: ASME A112.21.3M for exposed outlet, self-draining wall hydrants.
3. Pressure Rating: 125 psig.
4. Operation: Loose key.
5. Casings and Operating Rods: Of length required to match wall thickness. Include wall clamps.
6. Inlets: NPS 3/4 or NPS 1.
7. Outlet: Concealed.
8. Box: Deep, flush mounting with cover.
9. Box and Cover Finish: Polished nickel bronze.
10. Vacuum Breaker:
 - a. Nonremovable, manual-drain-type, hose-connection vacuum breaker complying with ASSE 1011 or backflow preventer complying with ASSE 1052.
 - b. Garden-hose thread complying with ASME B1.20.7 on outlet.
11. Operating Keys(s): Two with each wall hydrant.

C. Moderate-Climate Wall Hydrants:

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
 - a. Josam Company.
 - b. Smith, Jay R. Mfg. Co.; Division of Smith Industries, Inc.
 - c. Tyler Pipe; Wade Div.
 - d. Watts Drainage Products Inc.
 - e. Woodford Manufacturing Company.
 - f. Zurn Plumbing Products Group; Light Commercial Operation.
 - g. Zurn Plumbing Products Group; Specification Drainage Operation.
2. Standard: ASME A112.21.3M for exposed outlet, self-draining wall hydrants.
3. Pressure Rating: 125 psig.
4. Operation: Loose key.
5. Inlet: NPS 3/4 or NPS 1.
6. Outlet:
 - a. Concealed, with integral vacuum breaker or nonremovable hose-connection vacuum breaker complying with ASSE 1011 or backflow preventer complying with ASSE 1052.
 - b. Garden-hose thread complying with ASME B1.20.7.
7. Box: Deep, flush mounting with cover.
8. Box and Cover Finish: Polished nickel bronze.
9. Outlet:
 - a. Concealed, with integral vacuum breaker or nonremovable hose-connection vacuum breaker complying with ASSE 1011 or backflow preventer complying with ASSE 1052.
 - b. Garden-hose thread complying with ASME B1.20.7.
10. Nozzle and Wall-Plate Finish: Polished nickel bronze.
11. Operating Keys(s): Two with each wall hydrant.

D. Vacuum Breaker Wall Hydrants:

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
 - a. Mansfield Plumbing Products LLC.
 - b. Smith, Jay. R. Mfg. Co.; Division of Smith Industries, Inc.
 - c. Watts Industries, Inc.; Water Products Div.
 - d. Woodford Manufacturing Company.
 - e. Zurn Plumbing Products Group; Light Commercial Operation.
2. Standard: ASSE 1019, Type A or Type B.
3. Type: Freeze-resistant, automatic draining with integral air-inlet valve.
4. Classification: Type B, for automatic draining with hose removed or with hose attached and nozzle closed.
5. Pressure Rating: 125 psig.
6. Operation: Loose key.
7. Casing and Operating Rod: Of length required to match wall thickness. Include wall clamp.
8. Inlet: NPS 1/2 or NPS 3/4.
9. Outlet: Exposed with garden-hose thread complying with ASME B1.20.7.

2.12 GROUND HYDRANTS

A. Nonfreeze Ground Hydrants:

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
 - a. Josam Company.
 - b. Smith, Jay R. Mfg. Co.; Division of Smith Industries, Inc.
 - c. Tyler Pipe; Wade Div.
 - d. Watts Drainage Products.
 - e. Woodford Manufacturing Company; a division of WCM Industries, Inc.
 - f. Zurn Industries, LLC; Plumbing Products Group; Light Commercial Products.
 - g. Zurn Industries, LLC; Plumbing Products Group; Specification Drainage Products.
2. Standard: ASME A112.21.3M.
3. Type: Nonfreeze, concealed-outlet ground hydrant with box.
4. Operation: Loose key.
5. Casing and Operating Rod: Of at least length required for burial of valve below frost line.
6. Inlet: NPS 3/4.
7. Outlet: Garden-hose thread complying with ASME B1.20.7.
8. Drain: Designed with hole to drain into ground when shut off.
9. Box: Standard pattern with cover.
10. Box and Cover Finish: Rough bronze.
11. Operating Key(s): Two with each ground hydrant.
12. Vacuum Breaker: ASSE 1011.

2.13 POST HYDRANTS

A. Nonfreeze, Draining-Type Post Hydrants:

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
 - a. Simmons Manufacturing Co.
 - b. Smith, Jay R. Mfg. Co.; Division of Smith Industries, Inc.
 - c. Tyler Pipe; Wade Div.
 - d. Watts Drainage Products.
 - e. Woodford Manufacturing Company; a division of WCM Industries, Inc.
 - f. Zurn Industries, LLC; Plumbing Products Group; Light Commercial Products.
 - g. Zurn Industries, LLC; Plumbing Products Group; Specification Drainage Products.
2. Standard: ASME A112.21.3M.
3. Type: Nonfreeze, exposed-outlet post hydrant.
4. Operation: Loose key.
5. Casing and Operating Rod: Of at least length required for burial of valve below frost line.
6. Casing: Bronze with casing guard.
7. Inlet: NPS 3/4.
8. Outlet: Garden-hose thread complying with ASME B1.20.7.
9. Drain: Designed with hole to drain into ground when shut off.
10. Vacuum Breaker:
 - a. Nonremovable, drainable, hose-connection vacuum breaker complying with ASSE 1011 or backflow preventer complying with ASSE 1052.
 - b. Garden-hose thread complying with ASME B1.20.7 on outlet.
11. Operating Key(s): Two with each loose-key-operation post hydrant.

- B. Freeze-Resistant Sanitary Yard Hydrants:
 - 1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
 - a. Hoepfner Products.
 - 2. Standard: ASSE 1057, Type 5 for nondraining hydrants.
 - 3. Operation: Wheel handle.
 - 4. Head: Copper alloy, with pail hook.
 - 5. Inlet: NPS 3/4-inch threaded inlet and inlet nozzle, galvanized-steel riser, and venturi.
 - 6. Canister: Zinc-plated steel with atmospheric-vent device.
 - 7. Vacuum Breaker:
 - a. Removable hose-connection backflow preventer complying with ASSE 1052.
 - b. Garden-hose thread complying with ASME B1.20.7 on outlet for field installation.

2.14 DRAIN VALVES

- A. Ball-Valve-Type, Hose-End Drain Valves:
 - 1. Standard: MSS SP-110 for standard-port, two-piece ball valves.
 - 2. Pressure Rating: 400-psig minimum CWP.
 - 3. Size: NPS 3/4.
 - 4. Body: Copper alloy.
 - 5. Ball: Chrome-plated brass.
 - 6. Seats and Seals: Replaceable.
 - 7. Handle: Vinyl-covered steel.
 - 8. Inlet: Threaded or solder joint.
 - 9. Outlet: Threaded, short nipple with garden-hose thread complying with ASME B1.20.7 and cap with brass chain.
- B. Stop-and-Waste Drain Valves:
 - 1. Standard: MSS SP-110 for ball valves or MSS SP-80 for gate valves.
 - 2. Pressure Rating: 200-psig minimum CWP or Class 125.
 - 3. Size: NPS 3/4.
 - 4. Body: Copper alloy or ASTM B 62 bronze.
 - 5. Drain: NPS 1/8 side outlet with cap.

2.15 WATER HAMMER ARRESTERS

- A. Water Hammer Arresters:
 - 1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
 - a. AMTROL, Inc.
 - b. Josam Company.
 - c. Sioux Chief Manufacturing Company, Inc.
 - d. Smith, Jay R. Mfg. Co.; Division of Smith Industries, Inc.
 - e. Tyler Pipe; Wade Div.
 - f. Watts Drainage Products Inc.
 - g. Zurn Industries, LLC; Plumbing Products Group; Specification Drainage Products.
 - 2. Standard: ASSE 1010 or PDI-WH 201.
 - 3. Type: Metal bellows or Copper tube with piston.
 - 4. Size: ASSE 1010, Sizes AA and A through F or PDI-WH 201, Sizes A through F.

2.16 AIR VENTS

- A. Bolted-Construction Automatic Air Vents:
 - 1. Body: Bronze.
 - 2. Pressure Rating: 125-psig minimum pressure rating at 140 deg F.
 - 3. Float: Replaceable, corrosion-resistant metal.
 - 4. Mechanism and Seat: Stainless steel.
 - 5. Size: NPS 1/2 minimum inlet.
 - 6. Inlet and Vent Outlet End Connections: Threaded.
- B. Welded-Construction Automatic Air Vents:
 - 1. Body: Stainless steel.
 - 2. Pressure Rating: 150-psig minimum pressure rating.
 - 3. Float: Replaceable, corrosion-resistant metal.
 - 4. Mechanism and Seat: Stainless steel.
 - 5. Size: NPS 3/8 minimum inlet.
 - 6. Inlet and Vent Outlet End Connections: Threaded.

2.17 TRAP-SEAL PRIMER VALVES

- A. Supply-Type, Trap-Seal Primer Valves:
 - 1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
 - a. Sioux Chief Manufacturing Company, Inc.
 - b. Smith, Jay R. Mfg. Co.; Division of Smith Industries, Inc.
 - c. Watts; a division of Watts Water Technologies, Inc.; Watts Regulator Company.
 - 2. Standard: ASSE 1018.
 - 3. Pressure Rating: 125 psig minimum.
 - 4. Body: Bronze.
 - 5. Inlet and Outlet Connections: NPS 1/2 threaded, union, or solder joint.
 - 6. Gravity Drain Outlet Connection: NPS 1/2 threaded or solder joint.
 - 7. Finish: Chrome plated, or rough bronze for units used with pipe or tube that is not chrome finished.
- B. Drainage-Type, Trap-Seal Primer Valves:

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
 - a. Smith, Jay R. Mfg. Co.; Division of Smith Industries, Inc.
2. Standard: ASSE 1044, lavatory P-trap with NPS 3/8 minimum, trap makeup connection.
3. Size: NPS 1-1/4 minimum.
4. Material: Chrome-plated, cast brass.

2.18 TRAP-SEAL PRIMER SYSTEMS

A. Trap-Seal Primer Systems:

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
 - a. Precision Plumbing Products, Inc.
2. Standard: ASSE 1044,
3. Piping: NPS 3/4, ASTM B 88, Type L; copper, water tubing.
4. Cabinet: Surface-mounted steel box with stainless-steel cover.
5. Electric Controls: 24-hour timer, solenoid valve, and manual switch for 120-V ac power.
 - a. Electrical Components, Devices, and Accessories: Listed and labeled as defined in NFPA 70, by a qualified testing agency, and marked for intended location and application.
6. Vacuum Breaker: ASSE 1001.
7. Number Outlets: Four
8. Size Outlets: NPS 1/2.

PART 3 EXECUTION

3.1 INSTALLATION.

- A. Install backflow preventers in each water supply to mechanical equipment and systems and to other equipment and water systems that may be sources of contamination. Comply with authorities having jurisdiction.
 - 1. Locate backflow preventers in same room as connected equipment or system.
 - 2. Install drain for backflow preventers with atmospheric-vent drain connection with air-gap fitting, fixed air-gap fitting, or equivalent positive pipe separation of at least two pipe diameters in drain piping and pipe to floor drain. Locate air-gap device attached to or under backflow preventer. Simple air breaks are not acceptable for this application.
 - 3. Do not install bypass piping around backflow preventers.
- B. Install water regulators with inlet and outlet shutoff valves and bypass with memory-stop balancing valve. Install pressure gages on inlet and outlet.
- C. Install water control valves with inlet and outlet shutoff valves and bypass with globe valve. Install pressure gages on inlet and outlet.
- D. Install balancing valves in locations where they can easily be adjusted.
- E. Install temperature-actuated water mixing valves with check stops or shutoff valves on inlets and with shutoff valve on outlet.
 - 1. Install cabinet-type units recessed in or surface mounted on wall as specified.
- F. Install Y-pattern strainers for water on supply side of each control valve, water pressure-reducing valve, solenoid valve, and pump.
- G. Install outlet boxes recessed in wall or surface mounted on wall. Install 2-by-4-inch fire-retardant-treated-wood blocking, wall reinforcement between studs. Comply with requirements for fire-retardant-treated-wood blocking in Division 06 Section "Rough Carpentry."
- H. Install hose stations with check stops or shutoff valves on inlets and with thermometer on outlet.
 - 1. Install cabinet-type units recessed in or surface mounted on wall as specified. Install 2-by-4-inch fire-retardant-treated-wood blocking, wall reinforcement between studs. Comply with requirements for fire-retardant-treated-wood blocking in Division 06 Section "Rough Carpentry."
- I. Install ground hydrants with 1 cu. yd. of crushed gravel around drain hole. Set ground hydrants with box flush with grade.
- J. Install draining-type post hydrants with 1 cu. yd. of crushed gravel around drain hole. Set post hydrants in concrete paving or in 1 cu. ft. of concrete block at grade.
- K. Set nonfreeze, nondraining-type post hydrants in concrete or pavement.
- L. Set freeze-resistant yard hydrants with riser pipe set in concrete or pavement. Do not encase canister in concrete.
- M. Install water hammer arresters in water piping according to PDI-WH 201.
- N. Install air vents at high points of water piping.
- O. Install supply-type, trap-seal primer valves with outlet piping pitched down toward drain trap a minimum of 1 percent, and connect to floor-drain body, trap, or inlet fitting. Adjust valve for proper flow.
- P. Install drainage-type, trap-seal primer valves as lavatory trap with outlet piping pitched down toward drain trap a minimum of 1 percent, and connect to floor-drain body, trap, or inlet fitting.
- Q. Install trap-seal primer systems with outlet piping pitched down toward drain trap a minimum of 1 percent, and connect to floor-drain body, trap, or inlet fitting. Adjust system for proper flow.

3.2 CONNECTIONS

- A. Comply with requirements for ground equipment in Section 260526 "Grounding and Bonding for Electrical Systems."
- B. Fire-retardant-treated-wood blocking is specified in Section 260519 "Low-Voltage Electrical Power Conductors and Cables" for electrical connections.

3.3 LABELING AND IDENTIFYING

- A. Equipment Nameplates and Signs: Install engraved plastic-laminate equipment nameplate or sign on or near each of the following:
 - 1. Pressure vacuum breakers.
 - 2. Intermediate atmospheric-vent backflow preventers.
 - 3. Reduced-pressure-principle backflow preventers.
 - 4. Double-check backflow-prevention assemblies.
 - 5. Carbonated-beverage-machine backflow preventers.
 - 6. Dual-check-valve backflow preventers.
 - 7. Reduced-pressure-detector, fire-protection, backflow-preventer assemblies.
 - 8. Double-check, detector-assembly backflow preventers.
 - 9. Water pressure-reducing valves.
 - 10. Calibrated balancing valves.
 - 11. Primary, thermostatic, water mixing valves.
 - 12. Manifold, thermostatic, water-mixing-valve assemblies.
 - 13. Photographic-process, thermostatic, water mixing-valve assemblies.
 - 14. Primary water tempering valves.
 - 15. Outlet boxes.
 - 16. Hose stations.
 - 17. Supply-type, trap-seal primer valves.
 - 18. Trap-seal primer systems.
- B. Distinguish among multiple units, inform operator of operational requirements, indicate safety and emergency precautions, and warn of hazards and improper operations, in addition to identifying unit. Nameplates and signs are specified in Section 220553 "Identification for Plumbing Piping and Equipment."

3.4 FIELD QUALITY CONTROL

- A. Perform the following tests and prepare test reports:
 - 1. Test each pressure vacuum breaker reduced-pressure-principle backflow preventer double-check backflow-prevention assembly and double-check, detector-assembly backflow preventer according to authorities having jurisdiction and the device's reference standard.
- B. Domestic water piping specialties will be considered defective if they do not pass tests and inspections.
- C. Prepare test and inspection reports.

3.5 ADJUSTING

- A. Set field-adjustable pressure set points of water pressure-reducing valves.
- B. Set field-adjustable flow set points of balancing valves.
- C. Set field-adjustable temperature set points of temperature-actuated water mixing valves.

**THIS PAGE INTENTIONALLY LEFT BLANK.
END OF SECTION**

SECTION 221316
SANITARY WASTE AND VENT PIPING

PART 1 GENERAL

1.1 SUMMARY

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

1.2 PERFORMANCE REQUIREMENTS

- A. Components and installation shall be capable of withstanding the following minimum working pressure unless otherwise indicated:
 - 1. Soil, Waste, and Vent Piping: 10-foot head of water.
 - 2. Waste, Force-Main Piping: 50 psig
- B. Seismic Performance: Soil, waste, and vent piping and support and installation shall withstand the effects of earthquake motions determined according to ASCE/SEI 7.

1.3 ACTION SUBMITTALS

- A. Product Data: For each type of product indicated.
- B. LEED Submittals:
 - 1. Product Data for Credit IEQ 4.1: For solvent cements and adhesive primers, documentation including printed statement of VOC content.
 - 2. Laboratory Test Reports for Credit IEQ 4: For solvent cements and adhesive primers, documentation indicating that products comply with the testing and product requirements of the California Department of Health Services' "Standard Practice for the Testing of Volatile Organic Emissions from Various Sources Using Small-Scale Environmental Chambers."
- C. Shop Drawings: For solvent drainage system. Include plans, elevations, sections, and details.

1.4 INFORMATIONAL SUBMITTALS

- A. Seismic Qualification Certificates: For waste and vent piping, accessories, and components, from manufacturer.
 - 1. Basis for Certification: Indicate whether withstand certification is based on actual test of assembled components or on calculation.
 - 2. Detailed description of piping anchorage devices on which the certification is based and their installation requirements.
- B. Field quality-control reports.

1.5 QUALITY ASSURANCE

- A. Piping materials shall bear label, stamp, or other markings of specified testing agency.
- B. Comply with NSF/ANSI 14, "Plastics Piping Systems Components and Related Materials," for plastic piping components. Include marking with "NSF-dwv" for plastic drain, waste, and vent piping and "NSF-sewer" for plastic sewer piping.

1.6 PROJECT CONDITIONS

- A. Interruption of Existing Sanitary Waste Service: Do not interrupt service to facilities occupied by Owner or others unless permitted under the following conditions and then only after arranging to provide temporary service according to requirements indicated:
 - 1. Notify Engineer no fewer than two days in advance of proposed interruption of sanitary waste service.
 - 2. Do not proceed with interruption of sanitary waste service without Engineer's written permission.

PART 2 PRODUCTS

2.1 PIPING MATERIALS

- A. Comply with requirements in "Piping Schedule" Article for applications of pipe, tube, fitting materials, and joining methods for specific services, service locations, and pipe sizes.

2.2 HUB-AND-SPIGOT, CAST-IRON SOIL PIPE AND FITTINGS

- A. Pipe and Fittings: ASTM A 74, Service class.
- B. Gaskets: ASTM C 564, rubber.
- C. Calking Materials: ASTM B 29, pure lead and oakum or hemp fiber.

2.3 HUBLESS, CAST-IRON SOIL PIPE AND FITTINGS

- A. Pipe and Fittings: ASTM A 888 or CISPI 301.
- B. Solvent Stack Fittings: ASME B16.45 or ASSE 1043, hubless, cast-iron aerator and deaerator drainage fittings.
- C. CISPI, Hubless-Piping Couplings:
 - 1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
 - a. ANACO-Husky.
 - b. Dallas Specialty & Mfg. Co.
 - c. Fernco Inc.
 - d. Matco-Norca, Inc.
 - e. MIFAB, Inc.
 - f. Mission Rubber Company; a division of MCP Industries, Inc.
 - g. Tyler Pipe.
 - 2. Standards: ASTM C 1277 and CISPI 310.
 - 3. Description: Stainless-steel corrugated shield with stainless-steel bands and tightening devices; and ASTM C 564, rubber sleeve with integral, center pipe stop.

D. Heavy-Duty, Hubless-Piping Couplings:

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
 - a. ANACO-Husky.
 - b. Clamp-All Corp.
 - c. Dallas Specialty & Mfg. Co.
 - d. MIFAB, Inc.
 - e. Mission Rubber Company; a division of MCP Industries, Inc.
 - f. Tyler Pipe.
2. Standards: ASTM C 1277 and ASTM C 1540.
3. Description: Stainless-steel shield with stainless-steel bands and tightening devices; and ASTM C 564, rubber sleeve with integral, center pipe stop.

2.4 GALVANIZED-STEEL PIPE AND FITTINGS

- A. Galvanized-Steel Pipe: ASTM A 53, Type E, Standard Weight class. Include square-cut-grooved or threaded ends matching joining method.
- B. Galvanized-Cast-Iron Drainage Fittings: ASME B16.12, threaded.
- C. Steel Pipe Pressure Fittings:
 - 1. Galvanized-Steel Pipe Nipples: ASTM A 733, made of ASTM A 53 or ASTM A 106, Schedule 40, seamless steel pipe. Include ends matching joining method.
 - 2. Malleable-Iron Unions: ASME B16.39; Class 150; hexagonal-stock body with ball-and-socket, metal-to-metal, bronze seating surface; and female threaded ends.
 - 3. Galvanized-Gray-Iron, Threaded Fittings: ASME B16.4, Class 125, standard pattern.
- D. Cast-Iron Flanges: ASME B16.1, Class 125.
 - 1. Flange Gasket Materials: ASME B16.21, full-face, flat, nonmetallic, asbestos-free, 1/8-inch maximum thickness unless thickness or specific material is indicated.
 - 2. Flange Bolts and Nuts: ASME B18.2.1, carbon steel unless otherwise indicated.
- E. Grooved-Joint, Galvanized-Steel-Pipe Appurtenances:
 - 1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
 - a. Grinnell Mechanical Products.
 - b. Victaulic Company.
 - 2. Galvanized, Grooved-End Fittings for Galvanized-Steel Piping: ASTM A 536 ductile-iron castings, ASTM A 47 malleable-iron castings, ASTM A 23 forged steel fittings, or ASTM A 106 steel pipes with dimensions matching ASTM A 53 steel pipe, and complying with AWWA C606 for grooved ends.
 - 3. Grooved Mechanical Couplings for Galvanized-Steel Piping: ASTM F 1476, Type I. Include ferrous housing sections with continuous curved keys; EPDM-rubber gasket suitable for hot and cold water; and bolts and nuts.

2.5 STAINLESS-STEEL PIPE AND FITTINGS

- A. Pipe and Fittings: ASME A112.3.1, drainage pattern with socket and spigot ends.
- B. Internal Sealing Rings: Elastomeric gaskets shaped to fit socket groove.

2.6 DUCTILE-IRON PIPE AND FITTINGS

- A. Ductile-Iron, Mechanical-Joint Piping:
 - 1. Ductile-Iron Pipe: AWWA C151/A21.51, with mechanical-joint bell and plain spigot end unless grooved or flanged ends are indicated.
 - 2. Ductile-Iron Fittings: AWWA C110/A21.10, mechanical-joint, ductile- or gray-iron standard pattern or AWWA C153/A21.53, ductile-iron compact pattern.
 - 3. Glands, Gaskets, and Bolts: AWWA C111/A21.11, ductile- or gray-iron glands, rubber gaskets, and steel bolts.
- B. Ductile-Iron, Push-on-Joint Piping:
 - 1. Ductile-Iron Pipe: AWWA C151/A21.51, with push-on-joint bell and plain spigot end unless grooved or flanged ends are indicated.
 - 2. Ductile-Iron Fittings: AWWA C110/A21.10, push-on-joint ductile- or gray-iron standard pattern or AWWA C153/A21.53, ductile-iron compact pattern.
 - 3. Gaskets: AWWA C111/A21.11, rubber.

- C. Ductile-Iron, Grooved-Joint Piping:
 - 1. Ductile-Iron Pipe: AWWA C151/A21.51 with round-cut-grooved ends according to AWWA C606.
 - 2. Ductile-Iron-Pipe Appurtenances:
 - a. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
 - 1) Victaulic Company.
 - b. Grooved-End, Ductile-Iron Fittings: ASTM A 536 ductile-iron castings with dimensions matching AWWA C110/A 21.10 ductile-iron pipe or AWWA C153/A 21.53 ductile-iron fittings and complying with AWWA C606 for grooved ends.
 - c. Grooved Mechanical Couplings for Ductile-Iron Pipe: ASTM F 1476, Type I. Include ferrous housing sections with continuous curved keys; EPDM-rubber center-leg gasket suitable for hot and cold water; and bolts and nuts.

2.7 COPPER TUBE AND FITTINGS

- A. Copper DWV Tube: ASTM B 306, drainage tube, drawn temper.
- B. Copper Drainage Fittings: ASME B16.23, cast copper or ASME B16.29, wrought copper, solder-joint fittings.

- C. Hard Copper Tube: ASTM B 88, Type L and Type M, water tube, drawn temper.
- D. Copper Pressure Fittings:
 - 1. Copper Fittings: ASME B16.18, cast-copper-alloy or ASME B16.22, wrought-copper, solder-joint fittings. Furnish wrought-copper fittings if indicated.
 - 2. Copper Unions: MSS SP-123, copper-alloy, hexagonal-stock body with ball-and-socket, metal-to-metal seating surfaces, and solder-joint or threaded ends.
- E. Copper Flanges: ASME B16.24, Class 150, cast copper with solder-joint end.
 - 1. Flange Gasket Materials: ASME B16.21, full-face, flat, nonmetallic, asbestos-free, 1/8-inch maximum thickness unless thickness or specific material is indicated.
 - 2. Flange Bolts and Nuts: ASME B18.2.1, carbon steel unless otherwise indicated.
- F. Solder: ASTM B 32, lead free with ASTM B 813, water-flushable flux.

2.8 PVC PIPE AND FITTINGS

- A. Solid-Wall PVC Pipe: ASTM D 2665, drain, waste, and vent.
- B. Cellular-Core PVC Pipe: ASTM F 891, Schedule 40.
- C. PVC Socket Fittings: ASTM D 2665, made to ASTM D 3311, drain, waste, and vent patterns and to fit Schedule 40 pipe.
- D. Adhesive Primer: ASTM F 656.
 - 1. Adhesive primer shall have a VOC content of 550 g/L or less when calculated according to 40 CFR 59, Subpart D (EPA Method 24).
 - 2. Adhesive primer shall comply with the testing and product requirements of the California Department of Health Services' "Standard Practice for the Testing of Volatile Organic Emissions from Various Sources Using Small-Scale Environmental Chambers."
- E. Solvent Cement: ASTM D 2564.

1. PVC solvent cement shall have a VOC content of 510 g/L or less when calculated according to 40 CFR 59, Subpart D (EPA Method 24).
2. Solvent cement shall comply with the testing and product requirements of the California Department of Health Services' "Standard Practice for the Testing of Volatile Organic Emissions from Various Sources Using Small-Scale Environmental Chambers."

2.9 SPECIALTY PIPE FITTINGS

A. Transition Couplings:

1. General Requirements: Fitting or device for joining piping with small differences in OD's or of different materials. Include end connections same size as and compatible with pipes to be joined.
2. Fitting-Type Transition Couplings: Manufactured piping coupling or specified piping system fitting.
3. Unshielded, Nonpressure Transition Couplings:
 - a. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
 - 1) Dallas Specialty & Mfg. Co.
 - 2) Fernco Inc.
 - 3) Mission Rubber Company; a division of MCP Industries, Inc.
 - 4) Plastic Oddities; a division of Diverse Corporate Technologies, Inc.
 - b. Standard: ASTM C 1173.
 - c. Description: Elastomeric, sleeve-type, reducing or transition pattern. Include shear ring and corrosion-resistant-metal tension band and tightening mechanism on each end.
 - d. Sleeve Materials:
 - 1) For Cast-Iron Soil Pipes: ASTM C 564, rubber.
 - 2) For Plastic Pipes: ASTM F 477, elastomeric seal or ASTM D 5926, PVC.
 - 3) For Dissimilar Pipes: ASTM D 5926, PVC or other material compatible with pipe materials being joined.
4. Shielded, Nonpressure Transition Couplings:

- a. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
 - 1) Cascade Waterworks Mfg. Co.
 - 2) Mission Rubber Company; a division of MCP Industries, Inc.
 - b. Standard: ASTM C 1460.
 - c. Description: Elastomeric or rubber sleeve with full-length, corrosion-resistant outer shield and corrosion-resistant-metal tension band and tightening mechanism on each end.
5. Pressure Transition Couplings:
- a. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
 - 1) Cascade Waterworks Mfg. Co.
 - 2) Dresser, Inc.
 - 3) EBAA Iron, Inc.
 - 4) JCM Industries, Inc.
 - 5) Romac Industries, Inc.
 - 6) Smith-Blair, Inc.; a Sensus company.
 - 7) The Ford Meter Box Company, Inc.
 - 8) Viking Johnson.
 - b. Standard: AWWA C219.
 - c. Description: Metal, sleeve-type same size as, with pressure rating at least equal to, and ends compatible with, pipes to be joined.
 - d. Center-Sleeve Material: Manufacturer's standard.
 - e. Gasket Material: Natural or synthetic rubber.
 - f. Metal Component Finish: Corrosion-resistant coating or material.
- B. Dielectric Fittings:
- 1. General Requirements: Assembly of copper alloy and ferrous materials with separating nonconductive insulating material. Include end connections compatible with pipes to be joined.
 - 2. Dielectric Unions:
 - a. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
 - 1) Capitol Manufacturing Company.
 - 2) Central Plastics Company.
 - 3) Hart Industries International, Inc.

- 4) Jomar International Ltd.
 - 5) Matco-Norca, Inc.
 - 6) McDonald, A. Y. Mfg. Co.
 - 7) Watts Regulator Co.; a division of Watts Water Technologies, Inc.
 - 8) Wilkins; a Zurn company.
- b. Description:
- 1) Standard: ASSE 1079.
 - 2) Pressure Rating: 150 psig.
 - 3) End Connections: Solder-joint copper alloy and threaded ferrous.
3. Dielectric Flanges:
- a. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
- 1) Capitol Manufacturing Company.
 - 2) Central Plastics Company.
 - 3) Matco-Norca, Inc.
 - 4) Watts Regulator Co.; a division of Watts Water Technologies, Inc.
 - 5) Wilkins; a Zurn company.
- b. Description:
- 1) Standard: ASSE 1079.
 - 2) Factory-fabricated, bolted, companion-flange assembly.
 - 3) Pressure Rating: 150 psig.
 - 4) End Connections: Solder-joint copper alloy and threaded ferrous; threaded solder-joint copper alloy and threaded ferrous.
4. Dielectric-Flange Insulating Kits:
- a. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
- 1) Advance Products & Systems, Inc.
 - 2) Calpico, Inc.
 - 3) Central Plastics Company.
 - 4) Pipeline Seal and Insulator, Inc.
- b. Description:
- 1) Nonconducting materials for field assembly of companion flanges.
 - 2) Pressure Rating: 150 psig.
 - 3) Gasket: Neoprene or phenolic.
 - 4) Bolt Sleeves: Phenolic or polyethylene.
 - 5) Washers: Phenolic with steel backing washers.
5. Dielectric Nipples:
- a. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
- 1) Elster Perfection.
 - 2) Grinnell Mechanical Products.
 - 3) Matco-Norca, Inc.
 - 4) Precision Plumbing Products, Inc.
 - 5) Victaulic Company.
- b. Description:
- 1) Standard: IAPMO PS 66
 - 2) Electroplated steel nipple.
 - 3) Pressure Rating: 300 psig at 225 deg F.
 - 4) End Connections: Male threaded or grooved.
 - 5) Lining: Inert and noncorrosive, propylene.

2.10 ENCASEMENT FOR UNDERGROUND METAL PIPING

- A. Standard: ASTM A 674 or AWWA C105/A 21.5.
- B. Material: Linear low-density polyethylene film of 0.008-inch or high-density, cross-laminated polyethylene film of 0.004-inch minimum thickness.
- C. Form: Sheet or tube.
- D. Color: Black or natural.

PART 3 EXECUTION

3.1 EARTH MOVING

- A. Comply with requirements for excavating, trenching, and backfilling specified in Section 312000 "Earth Moving."

3.2 PIPING INSTALLATION

- A. Drawing plans, schematics, and diagrams indicate general location and arrangement of piping systems. Indicated locations and arrangements were used to size pipe and calculate friction loss, expansion, pump sizing, and other design considerations. Install piping as indicated unless deviations to layout are approved on coordination drawings.
- B. Install piping in concealed locations unless otherwise indicated and except in equipment rooms and service areas.
- C. Install piping indicated to be exposed and piping in equipment rooms and service areas at right angles or parallel to building walls. Diagonal runs are prohibited unless specifically indicated otherwise.
- D. Install piping above accessible ceilings to allow sufficient space for ceiling panel removal.
- E. Install piping to permit valve servicing.
- F. Install piping at indicated slopes.
- G. Install piping free of sags and bends.
- H. Install fittings for changes in direction and branch connections.
- I. Install piping to allow application of insulation.
- J. Install seismic restraints on piping. Comply with requirements for seismic-restraint devices specified in Section 220548 "Vibration and Seismic Controls for Plumbing Piping and Equipment."
- K. Make changes in direction for soil and waste drainage and vent piping using appropriate branches, bends, and long-sweep bends. Sanitary tees and short-sweep 1/4 bends may be used on vertical stacks if change in direction of flow is from horizontal to vertical. Use long-turn, double Y-branch and 1/8-bend fittings if two fixtures are installed back to back or side by side with common drain pipe. Straight tees, elbows, and crosses may be used on vent lines. Do not change direction of flow more than 90 degrees. Use proper size of standard increasers and reducers if pipes of different sizes are connected. Reducing size of drainage piping in direction of flow is prohibited.
- L. Lay buried building drainage piping beginning at low point of each system. Install true to grades and alignment indicated, with unbroken continuity of invert. Place hub ends of piping upstream. Install required gaskets according to manufacturer's written instructions for use of lubricants, cements, and other installation requirements. Maintain swab in piping and pull past each joint as completed.
- M. Install soil and waste drainage and vent piping at the following minimum slopes unless otherwise indicated:
 - 1. Building Sanitary Drain: 2 percent downward in direction of flow for piping NPS 3 and smaller; 1 percent downward in direction of flow for piping NPS 4 and larger.
 - 2. Horizontal Sanitary Drainage Piping: 2 percent downward in direction of flow.

3. Vent Piping: 1 percent down toward vertical fixture vent or toward vent stack.
- N. Install cast-iron soil piping according to CISPI's "Cast Iron Soil Pipe and Fittings Handbook," Chapter IV, "Installation of Cast Iron Soil Pipe and Fittings."
1. Install encasement on underground piping according to ASTM A 674 or AWWA C105/A 21.5.
- O. Install steel piping according to applicable plumbing code.
- P. Install stainless-steel piping according to ASME A112.3.1 and applicable plumbing code.
- Q. Install aboveground copper tubing according to CDA's "Copper Tube Handbook."
- R. Install aboveground ABS piping according to ASTM D 2661.
- S. Install aboveground PVC piping according to ASTM D 2665.
- T. Install underground PVC piping according to ASTM D 2321.
- U. Install engineered soil and waste drainage and vent piping systems as follows:
1. Combination Waste and Vent: Comply with standards of authorities having jurisdiction.
 2. Sovent Drainage System: Comply with ASSE 1043 and sovent fitting manufacturer's written installation instructions.
 3. Reduced-Size Venting: Comply with standards of authorities having jurisdiction.
- V. Install underground, ductile-iron, force-main piping according to AWWA C600. Install buried piping inside building between wall and floor penetrations and connection to sanitary sewer piping outside building with restrained joints. Anchor pipe to wall or floor. Install thrust-block supports at vertical and horizontal offsets.
1. Install encasement on piping according to ASTM A 674 or AWWA C105/A 21.5.
- W. Install underground, copper, force-main tubing according to CDA's "Copper Tube Handbook."
1. Install encasement on piping according to ASTM A 674 or AWWA C105/A 21.5.
- X. Install force mains at elevations indicated.
- Y. Plumbing Specialties:
1. Install backwater valves in sanitary waster gravity-flow piping. Comply with requirements for backwater valves specified in Section 221319 "Sanitary Waste Piping Specialties."
 2. Install cleanouts at grade and extend to where building sanitary drains connect to building sanitary sewers in sanitary drainage gravity-flow piping. Install cleanout fitting with closure plug inside the building in sanitary drainage force-main piping. Comply with requirements for cleanouts specified in Section 221319 "Sanitary Waste Piping Specialties."
 3. Install drains in sanitary drainage gravity-flow piping. Comply with requirements for drains specified in Division 22 Section "Sanitary Waste Piping Specialties."
- Z. Do not enclose, cover, or put piping into operation until it is inspected and approved by authorities having jurisdiction.
- AA. Install sleeves for piping penetrations of walls, ceilings, and floors. Comply with requirements for sleeves specified in Division 22 Section "Sleeves and Sleeve Seals for Plumbing Piping."
- AB. Install sleeve seals for piping penetrations of concrete walls and slabs. Comply with requirements for sleeve seals specified in Division 22 Section "Sleeves and Sleeve Seals for Plumbing Piping."
- AC. Install escutcheons for piping penetrations of walls, ceilings, and floors. Comply with requirements for escutcheons specified in Division 22 Section "Escutcheons for Plumbing Piping."

3.3 JOINT CONSTRUCTION

- A. Join hub-and-spigot, cast-iron soil piping with gasket joints according to CISPI's "Cast Iron Soil Pipe and Fittings Handbook" for compression joints.
- B. Join hub-and-spigot, cast-iron soil piping with calked joints according to CISPI's "Cast Iron Soil Pipe and Fittings Handbook" for lead-and-oakum calked joints.
- C. Join hubless, cast-iron soil piping according to CISPI 310 and CISPI's "Cast Iron Soil Pipe and Fittings Handbook" for hubless-piping coupling joints.
- D. Threaded Joints: Thread pipe with tapered pipe threads according to ASME B1.20.1. Cut threads full and clean using sharp dies. Ream threaded pipe ends to remove burrs and restore full ID. Join pipe fittings and valves as follows:
 - 1. Apply appropriate tape or thread compound to external pipe threads unless dry seal threading is specified.
 - 2. Damaged Threads: Do not use pipe or pipe fittings with threads that are corroded or damaged. Do not use pipe sections that have cracked or open welds.
- E. Join stainless-steel pipe and fittings with gaskets according to ASME A112.3.1.
- F. Join copper tube and fittings with soldered joints according to ASTM B 828. Use ASTM B 813, water-flushable, lead-free flux and ASTM B 32, lead-free-alloy solder.
- G. Grooved Joints: Cut groove ends of pipe according to AWWA C606. Lubricate and install gasket over ends of pipes or pipe and fitting. Install coupling housing sections, over gasket, with keys seated in piping grooves. Install and tighten housing bolts.
- H. Flanged Joints: Align bolt holes. Select appropriate gasket material, size, type, and thickness. Install gasket concentrically positioned. Use suitable lubricants on bolt threads. Torque bolts in cross pattern.
- I. Plastic, Nonpressure-Piping, Solvent-Cement Joints: Clean and dry joining surfaces. Join pipe and fittings according to the following:
 - 1. Comply with ASTM F 402 for safe-handling practice of cleaners, primers, and solvent cements.
 - 2. ABS Piping: Join according to ASTM D 2235 and ASTM D 2661 Appendixes.
 - 3. PVC Piping: Join according to ASTM D 2855 and ASTM D 2665 Appendixes.

3.4 SPECIALTY PIPE FITTING INSTALLATION

- A. Transition Couplings:
 - 1. Install transition couplings at joints of piping with small differences in OD's.
 - 2. In Drainage Piping: Unshielded or Shielded, nonpressure transition couplings.
 - 3. In Aboveground Force Main Piping: Fitting-type transition couplings.
 - 4. In Underground Force Main Piping:
 - a. NPS 1-1/2 and Smaller: Fitting-type transition couplings.
 - b. NPS 2 and Larger: Pressure transition couplings.
- B. Dielectric Fittings:
 - 1. Install dielectric fittings in piping at connections of dissimilar metal piping and tubing.
 - 2. Dielectric Fittings for NPS 2 and Smaller: Use dielectric unions.
 - 3. Dielectric Fittings for NPS 2-1/2 to NPS 4: Use dielectric flanges.
 - 4. Dielectric Fittings for NPS 5 and Larger: Use dielectric flange kits.

3.5 VALVE INSTALLATION

- A. General valve installation requirements are specified in Section 220523 "General-Duty Valves for Plumbing Piping."
- B. Shutoff Valves:
 - 1. Install shutoff valve on each sewage pump discharge.
 - 2. Install gate or full-port ball valve for piping NPS 2 and smaller.
 - 3. Install gate valve for piping NPS 2-1/2 and larger.
- C. Check Valves: Install swing check valve, between pump and shutoff valve, on each sewage pump discharge.
- D. Backwater Valves: Install backwater valves in piping subject to backflow.
 - 1. Horizontal Piping: Horizontal backwater valves. Use normally closed type unless otherwise indicated.
 - 2. Floor Drains: Drain outlet backwater valves unless drain has integral backwater valve.
 - 3. Install backwater valves in accessible locations.
 - 4. Comply with requirements for backwater valve specified in Section 221319 "Sanitary Waste Piping Specialties."

3.6 HANGER AND SUPPORT INSTALLATION

- A. Comply with requirements for seismic-restraint devices specified in Section 220548 "Vibration and Seismic Controls for Plumbing Piping and Equipment."
- B. Comply with requirements for pipe hanger and support devices and installation specified in Section 220529 "Hangers and Supports for Plumbing Piping and Equipment."
 - 1. Install carbon-steel pipe hangers for horizontal piping in noncorrosive environments.
 - 2. Install stainless-steel pipe hangers for horizontal piping in corrosive environments.
 - 3. Install carbon-steel pipe support clamps for vertical piping in noncorrosive environments.
 - 4. Install stainless-steel pipe support clamps for vertical piping in corrosive environments.
 - 5. Vertical Piping: MSS Type 8 or Type 42, clamps.
 - 6. Install individual, straight, horizontal piping runs:
 - a. 100 Feet and Less: MSS Type 1, adjustable, steel clevis hangers.
 - b. Longer Than 100 Feet: MSS Type 43, adjustable roller hangers.
 - c. Longer Than 100 Feet if Indicated: MSS Type 49, spring cushion rolls.
 - 7. Multiple, Straight, Horizontal Piping Runs 100 Feet or Longer: MSS Type 44, pipe rolls. Support pipe rolls on trapeze.
 - 8. Base of Vertical Piping: MSS Type 52, spring hangers.
- C. Support horizontal piping and tubing within 12 inches of each fitting valve and coupling.
- D. Support vertical piping and tubing at base and at each floor.
- E. Rod diameter may be reduced one size for double-rod hangers, with 3/8-inch minimum rods.
- F. Install hangers for cast-iron soil piping with the following maximum horizontal spacing and minimum rod diameters:
 - 1. NPS 1-1/2 and NPS 2: 60 inches with 3/8-inch rod.
 - 2. NPS 3 (DN 80): 60 inches with 1/2-inch rod.
 - 3. NPS 4 and NPS 5: 60 inches with 5/8-inch rod.
 - 4. NPS 6 and NPS 8: 60 inches with 3/4-inch rod.
 - 5. NPS 10 and NPS 12: 60 inches with 7/8-inch rod.
 - 6. Spacing for 10-foot lengths may be increased to 10 feet. Spacing for fittings is limited to 60 inches.
- G. Install supports for vertical cast-iron soil piping every 15 feet.

- H. Install hangers for steel piping with the following maximum horizontal spacing and minimum rod diameters:
 - 1. NPS 1-1/4: 84 inches with 3/8-inch rod.
 - 2. NPS 1-1/2: 108 inches with 3/8-inch rod.
 - 3. NPS 2: 10 feet with 3/8-inch rod.
 - 4. NPS 2-1/2: 11 feet with 1/2-inch rod.
 - 5. NPS 3: 12 feet with 1/2-inch rod.
 - 6. NPS 4 and NPS 5: 12 feet with 5/8-inch rod.
 - 7. NPS 6 and NPS 8: 12 feet with 3/4-inch rod.
 - 8. NPS 10 and NPS 12: 12 feet with 7/8-inch rod.
- I. Install supports for vertical steel piping every 15 feet.
- J. Install hangers for stainless-steel piping with the following maximum horizontal spacing and minimum rod diameters:
 - 1. NPS 2: 84 inches with 3/8-inch rod.
 - 2. NPS 3: 96 inches with 1/2-inch rod.
 - 3. NPS 4: 108 inches with 1/2-inch rod.
 - 4. NPS 6: 10 feet with 5/8-inch rod.
- K. Install supports for vertical stainless-steel piping every 10 feet.
- L. Install hangers for copper tubing with the following maximum horizontal spacing and minimum rod diameters:
 - 1. NPS 1-1/4: 72 inches with 3/8-inch rod.
 - 2. NPS 1-1/2 and NPS 2: 96 inches with 3/8-inch rod.
 - 3. NPS 2-1/2: 108 inches with 1/2-inch rod.
 - 4. NPS 3 and NPS 5: 10 feet with 1/2-inch rod.
 - 5. NPS 6: 10 feet with 5/8-inch rod.
 - 6. NPS 8: 10 feet with 3/4-inch rod.
- M. Install supports for vertical copper tubing every 10 feet.
- N. Install hangers for PVC piping with the following maximum horizontal spacing and minimum rod diameters:
 - 1. NPS 1-1/2 and NPS 2: 48 inches with 3/8-inch rod.
 - 2. NPS 3: 48 inches with 1/2-inch rod.
 - 3. NPS 4 and NPS 5: 48 inches with 5/8-inch rod.
 - 4. NPS 6 and NPS 8: 48 inches with 3/4-inch rod.
 - 5. NPS 10 and NPS 12: 48 inches with 7/8-inch rod.
- O. Install supports for vertical PVC piping every 48 inches.
- P. Support piping and tubing not listed above according to MSS SP-69 and manufacturer's written instructions.

3.7 CONNECTIONS

- A. Drawings indicate general arrangement of piping, fittings, and specialties.
- B. Connect soil and waste piping to exterior sanitary sewerage piping. Use transition fitting to join dissimilar piping materials.
- C. Connect drainage and vent piping to the following:
 - 1. Plumbing Fixtures: Connect drainage piping in sizes indicated, but not smaller than required by plumbing code.
 - 2. Plumbing Fixtures and Equipment: Connect atmospheric vent piping in sizes indicated, but not smaller than required by authorities having jurisdiction.
 - 3. Plumbing Specialties: Connect drainage and vent piping in sizes indicated, but not smaller than required by plumbing code.
 - 4. Install test tees (wall cleanouts) in conductors near floor and floor cleanouts with cover flush with floor.
 - 5. Install horizontal backwater valves with cleanout cover flush with floor.
 - 6. Comply with requirements for backwater valves cleanouts and drains specified in Section 221319 "Sanitary Waste Piping Specialties."
 - 7. Equipment: Connect drainage piping as indicated. Provide shutoff valve if indicated and union for each connection. Use flanges instead of unions for connections NPS 2-1/2 and larger.
- D. Connect force-main piping to the following:
 - 1. Sanitary Sewer: To exterior force main.
 - 2. Sewage Pump: To sewage pump discharge.
- E. Where installing piping adjacent to equipment, allow space for service and maintenance of equipment.
- F. Make connections according to the following unless otherwise indicated:
 - 1. Install unions, in piping NPS 2 and smaller, adjacent to each valve and at final connection to each piece of equipment.
 - 2. Install flanges, in piping NPS 2-1/2 and larger, adjacent to flanged valves and at final connection to each piece of equipment.

3.8 IDENTIFICATION

- A. Identify exposed sanitary waste and vent piping. Comply with requirements for identification specified in Section 220553 "Identification for Plumbing Piping and Equipment."

3.9 FIELD QUALITY CONTROL

- A. During installation, notify authorities having jurisdiction at least 24 hours before inspection must be made. Perform tests specified below in presence of authorities having jurisdiction.
 - 1. Roughing-in Inspection: Arrange for inspection of piping before concealing or closing-in after roughing-in and before setting fixtures.
 - 2. Final Inspection: Arrange for final inspection by authorities having jurisdiction to observe tests specified below and to ensure compliance with requirements.
- B. Reinspection: If authorities having jurisdiction find that piping will not pass test or inspection, make required corrections and arrange for reinspection.
- C. Reports: Prepare inspection reports and have them signed by authorities having jurisdiction.
- D. Test sanitary drainage and vent piping according to procedures of authorities having jurisdiction or, in absence of published procedures, as follows:
 - 1. Test for leaks and defects in new piping and parts of existing piping that have been altered, extended, or repaired. If testing is performed in segments, submit separate report for each test, complete with diagram of portion of piping tested.
 - 2. Leave uncovered and unconcealed new, altered, extended, or replaced drainage and vent piping until it has been tested and approved. Expose work that was covered or concealed before it was tested.
 - 3. Roughing-in Plumbing Test Procedure: Test drainage and vent piping except outside leaders on completion of roughing-in. Close openings in piping system and fill with water to point of overflow, but not less than 10-foot head of water. From 15 minutes before inspection starts to completion of inspection, water level must not drop. Inspect joints for leaks.
 - 4. Finished Plumbing Test Procedure: After plumbing fixtures have been set and traps filled with water, test connections and prove they are gastight and watertight. Plug vent-stack openings on roof and building drains where they leave building. Introduce air into piping system equal to pressure of 1-inch wg. Use U-tube or manometer inserted in trap of water closet to measure this pressure. Air pressure must remain constant without introducing additional air throughout period of inspection. Inspect plumbing fixture connections for gas and water leaks.
 - 5. Repair leaks and defects with new materials and retest piping, or portion thereof, until satisfactory results are obtained.
 - 6. Prepare reports for tests and required corrective action.
- E. Test force-main piping according to procedures of authorities having jurisdiction or, in absence of published procedures, as follows:
 - 1. Leave uncovered and unconcealed new, altered, extended, or replaced force-main piping until it has been tested and approved. Expose work that was covered or concealed before it was tested.
 - 2. Cap and subject piping to static-water pressure of 50 psig above operating pressure, without exceeding pressure rating of piping system materials. Isolate test source and allow to stand for four hours. Leaks and loss in test pressure constitute defects that must be repaired.
 - 3. Repair leaks and defects with new materials and retest piping, or portion thereof, until satisfactory results are obtained.
 - 4. Prepare reports for tests and required corrective action.

3.10 CLEANING AND PROTECTION

- A. Clean interior of piping. Remove dirt and debris as work progresses.
- B. Protect drains during remainder of construction period to avoid clogging with dirt and debris and to prevent damage from traffic and construction work.
- C. Place plugs in ends of uncompleted piping at end of day and when work stops.
- D. Exposed PVC Piping: Protect plumbing vents exposed to sunlight with two coats of water-based latex paint.

3.11 PIPING SCHEDULE

- A. Flanges and unions may be used on aboveground pressure piping unless otherwise indicated.
- B. Aboveground, soil and waste piping NPS 4 and smaller shall be the following:
 - 1. Service class, cast-iron soil pipe and fittings; gaskets; and gasketed joints.
 - 2. Hubless, cast-iron soil pipe and fittings heavy-duty hubless-piping couplings; and coupled joints.
 - 3. Galvanized-steel pipe, drainage fittings, and threaded joints.
 - 4. Stainless-steel pipe and fittings, sealing rings, and gasketed joints.
 - 5. Copper DWV tube, copper drainage fittings, and soldered joints.
 - 6. Solid-wall PVC pipe, PVC socket fittings, and solvent-cemented joints.
 - 7. Dissimilar Pipe-Material Couplings: Unshielded or Shielded, nonpressure transition couplings.
- C. Aboveground, soil and waste piping NPS 5 and larger shall be the following:
 - 1. Service class, cast-iron soil pipe and fittings; gaskets; and gasketed joints.
 - 2. Hubless, cast-iron soil pipe and fittings heavy-duty hubless-piping couplings; and coupled joints.
 - 3. Galvanized-steel pipe, drainage fittings, and threaded joints.
 - 4. Stainless-steel pipe and fittings, sealing rings, and gasketed joints.
 - 5. Solid-wall PVC pipe, PVC socket fittings, and solvent-cemented joints.
 - 6. Dissimilar Pipe-Material Couplings: Unshielded or Shielded, nonpressure transition couplings.
- D. Aboveground, vent piping NPS 4 and smaller shall be the following:
 - 1. Service class, cast-iron soil pipe and fittings; gaskets; and gasketed joints.
 - 2. Hubless, cast-iron soil pipe and fittings; heavy-duty hubless-piping couplings; and coupled joints.
 - 3. Galvanized-steel pipe, drainage fittings, and threaded joints.
 - 4. Stainless-steel pipe and fittings gaskets, and gasketed joints.
 - 5. Copper DWV tube, copper drainage fittings, and soldered joints.
 - a. Option for Vent Piping, NPS 2-1/2 and NPS 3-1/2: Hard copper tube, Type M; copper pressure fittings; and soldered joints.
 - 6. Solid-wall PVC pipe, PVC socket fittings, and solvent-cemented joints.
 - 7. Dissimilar Pipe-Material Couplings: Unshielded or Shielded, nonpressure transition couplings.
- E. Aboveground, vent piping NPS 5 and larger shall be the following:
 - 1. Service class, cast-iron soil pipe and fittings; gaskets; and gasketed joints.
 - 2. Hubless, cast-iron soil pipe and fittings; heavy-duty hubless-piping couplings; and coupled joints.
 - 3. Galvanized-steel pipe, drainage fittings, and threaded joints.
 - 4. Solid wall PVC pipe, PVC socket fittings, and solvent-cemented joints.
 - 5. Dissimilar Pipe-Material Couplings: Unshielded or Shielded, nonpressure transition couplings.
- F. Underground, soil, waste, and vent piping NPS 4 and smaller shall be the following:
 - 1. Service class, cast-iron soil piping; gaskets; and gasketed joints.
 - 2. Hubless, cast-iron soil pipe and fittings; heavy-duty hubless-piping couplings; and coupled joints.
 - 3. Stainless-steel pipe and fittings, gaskets, and gasketed joints.
 - 4. Solid wall PVC pipe, PVC socket fittings, and solvent-cemented joints.
 - 5. Dissimilar Pipe-Material Couplings: Unshielded or Shielded, nonpressure transition couplings.

- G. Underground, soil and waste piping NPS 5 and larger shall be the following:
 - 1. Service class, cast-iron soil piping; gaskets; and gasketed joints.
 - 2. Hubless, cast-iron soil pipe and fittings; heavy-duty or cast-iron hubless-piping couplings; coupled joints.
 - 3. Solid-wall PVC pipe; PVC socket fittings; and solvent-cemented joints.
 - 4. Dissimilar Pipe-Material Couplings: Unshielded or Shielded, nonpressure transition couplings.
- H. Aboveground sanitary-sewage force mains NPS 1-1/2 and NPS 2 shall be the following:
 - 1. Galvanized-steel pipe, pressure fittings, and threaded joints.
- I. Aboveground sanitary-sewage force mains NPS 2-1/2 to NPS 6 shall be the following:
 - 1. Galvanized-steel pipe, pressure fittings, and threaded joints.
 - 2. Grooved-end, galvanized-steel pipe; grooved-joint, galvanized-steel-pipe appurtenances; and grooved joints.
- J. Underground sanitary-sewage force mains NPS 4 and smaller shall be the following:
 - 1. Ductile-iron, mechanical-joint piping and mechanical joints.
 - 2. Ductile-iron, push-on-joint piping and push-on joints.
 - 3. Ductile-iron, grooved-joint piping and grooved joints.
 - 4. Fitting-type transition coupling for piping smaller than NPS 1-1/2 and pressure transition coupling for NPS 1-1/2 and larger if dissimilar pipe materials.
- K. Underground sanitary-sewage force mains NPS 5 and larger shall be the following:
 - 1. Ductile-iron, mechanical-joint piping and mechanical joints.
 - 2. Ductile-iron, push-on-joint piping and push-on joints.
 - 3. Ductile-iron, grooved-joint piping and grooved joints.
 - 4. Pressure transition couplings if dissimilar pipe materials.

**THIS PAGE INTENTIONALLY LEFT BLANK.
END OF SECTION**

SECTION 221429
SUMP PUMPS

PART 1 GENERAL

1.1 SUMMARY

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

1.2 ACTION SUBMITTALS

- A. Product Data: For each type of product indicated. Include construction details, material descriptions, dimensions of individual components and profiles. Include rated capacities, operating characteristics, electrical characteristics, and furnished specialties and accessories.
- B. Wiring Diagrams: For power, signal, and control wiring.

1.3 CLOSEOUT SUBMITTALS

- A. Operation and Maintenance Data: For pumps and controls, to include in operation and maintenance manuals.

1.4 QUALITY ASSURANCE

- A. Electrical Components, Devices, and Accessories: Listed and labeled as defined in NFPA 70, by a qualified testing agency, and marked for intended location and application.
- B. UL Compliance: Comply with UL 778 for motor-operated water pumps.

1.5 DELIVERY, STORAGE, AND HANDLING

- A. Retain shipping flange protective covers and protective coatings during storage.
- B. Protect bearings and couplings against damage.
- C. Comply with pump manufacturer's written rigging instructions for handling.

PART 2 PRODUCTS

2.1 SUBMERSIBLE SUMP PUMPS

- A. Submersible, Fixed-Position, Single-Seal Sump Pumps:
 - 1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
 - a. Bell & Gossett Domestic Pump; ITT Corporation.
 - b. Goulds Pumps; ITT Corporation.
 - c. Little Giant Pump Co.
 - d. Weil Pump Company, Inc.
 - e. Zoeller Company.
 - f. Liberty Pump
 - 2. Description: Factory-assembled and -tested sump-pump unit.
 - 3. Pump Type: Submersible, end-suction, single-stage, close-coupled, overhung-impeller, centrifugal sump pump as defined in HI 1.1-1.2 and HI 1.3.
 - 4. Pump Casing: Cast iron, with strainer inlet, legs that elevate pump to permit flow into impeller, and vertical discharge for piping connection.
 - 5. Impeller: Statically and dynamically balanced, ASTM A 48, Class No. 25 A cast iron or ASTM A 532, abrasion-resistant cast iron design for clear wastewater handling, and keyed and secured to shaft.
 - 6. Pump and Motor Shaft: Stainless steel, with factory-sealed, grease-lubricated ball bearings.
 - 7. Seal: Mechanical.
 - 8. Motor: Hermetically sealed, capacitor-start type; with built-in overload protection; lifting eye or lug; and three-conductor, waterproof power cable of length required and with grounding plug and cable-sealing assembly for connection at pump.
 - a. Motor Housing Fluid: Air or Oil.

9. Controls:
 - a. Enclosure: NEMA 250, Type 1 mounted.
 - b. Switch Type: Pedestal-mounted float switch with float rods and rod buttons or Mechanical-float or Mercury-float type, in NEMA 250, Type 6 enclosures with mounting rod and electric cables.
 - c. Automatic Alternator: Start pumps on successive cycles and start multiple pumps if one cannot handle load.
 - d. High-Water Alarm: Shall be provided with 120-V ac, with transformer and contacts for remote alarm bell.
10. Control-Interface Features:
 - a. Remote Alarm Contacts: For remote alarm interface.
 - b. Building Automation System Interface: Auxiliary contacts in pump controls for interface to building automation system and capable of providing the following:
 - 1) On-off status of pump.
 - 2) Alarm status.

2.2 SUMP-PUMP BASINS AND BASIN COVERS

- A. Basins: Factory-fabricated, watertight, cylindrical, basin sump with top flange and sidewall openings for pipe connections.
 1. Material: Cast iron or Fiberglass.
 2. Reinforcement: Mounting plates for pumps, fittings, and accessories.
 3. Anchor Flange: Same material as or compatible with basin sump, cast in or attached to sump, in location and of size required to anchor basin in concrete slab.
- B. Basin Covers: Fabricate metal cover with openings having gaskets, seals, and bushings; for access to pumps, pump shafts, control rods, discharge piping, vent connections, and power cables.
 1. Reinforcement: Steel or cast iron, capable of supporting foot traffic for basins installed in foot-traffic areas.

2.3 MOTORS

- A. Comply with NEMA designation, temperature rating, service factor, enclosure type, and efficiency requirements for motors specified in Division 22 Section "Common Motor Requirements for Plumbing Equipment".
 - 1. Motor Sizes: Minimum size as indicated. If not indicated, large enough so driven load will not require motor to operate in service factor range above 1.0.
- B. Motors for submersible pumps shall be hermetically sealed.

PART 3 EXECUTION

3.1 EARTHWORK

- A. Excavation and filling are specified in Section 312000 "Earth Moving".

3.2 EXAMINATION

- A. Examine roughing-in for plumbing piping to verify actual locations of storm drainage piping connections before sump pump installation.

3.3 INSTALLATION

- A. Pump Installation Standards: Comply with HI 1.4 for installation of sump pumps.

3.4 CONNECTIONS

- A. Comply with requirements for piping specified in Division 22 Section "Facility Storm Drainage Piping". Drawings indicate general arrangement of piping, fittings, and specialties.
- B. Install piping adjacent to equipment to allow service and maintenance.

3.5 FIELD QUALITY CONTROL

- A. Manufacturer's Field Service: Engage a factory-authorized service representative to inspect, test, and adjust components, assemblies, and equipment installations, including connections.
- B. Perform tests and inspections.
 - 1. Manufacturer's Field Service: Engage a factory-authorized service representative to inspect components, assemblies, and equipment installations, including connections, and to assist in testing.
- C. Tests and Inspections:
 - 1. Perform each visual and mechanical inspection.
 - 2. Leak Test: After installation, charge system and test for leaks. Repair leaks and retest until no leaks exist.
 - 3. Operational Test: After electrical circuitry has been energized, start units to confirm proper motor rotation and unit operation.
 - 4. Test and adjust controls and safeties. Replace damaged and malfunctioning controls and equipment.
- D. Pumps and controls will be considered defective if they do not pass tests and inspections.
- E. Prepare test and inspection reports.

3.6 STARTUP SERVICE

- A. Perform startup service.
 - 1. Complete installation and startup checks according to manufacturer's written instructions.

3.7 ADJUSTING

- A. Adjust pumps to function smoothly, and lubricate as recommended by manufacturer.
- B. Adjust control set points.

3.8 DEMONSTRATION

- A. Train Owner's maintenance personnel to adjust, operate, and maintain controls and pumps.

**THIS PAGE INTENTIONALLY LEFT BLANK.
END OF SECTION**

SECTION 312000
EARTH MOVING

PART 1 GENERAL

1.1 SUMMARY

- A. Provide all operations necessary to complete site clearing; stockpiling; dewatering; excavations; embankments and backfilling; subgrade preparation; aggregate base; placement of topsoil; and finish grading.
- B. Construct and maintain all temporary drainage swales, berms and diversions; furnish, operate, and maintain all necessary pumping and other equipment for dewatering. After above items serve their purpose, remove them and restore site.
- C. Excavation will be unclassified, and the term "excavation" shall include all material encountered without regard to its physical properties, characteristics or composition.

1.2 LIMITS OF THE WORK

- A. Earthwork shall not extend beyond the areas of excavation, embankment or other construction shown on the drawings.
- B. Contractor shall install construction fencing or other visible barrier around trees and other areas that need to be protected from the earthwork prior moving equipment into that area.
- C. Excavations for new construction shall not undercut existing footings, foundations, or surfacing.
- D. Blasting with any type of explosive will not be permitted, unless shown otherwise in these Specifications.

1.3 SAFETY AND PROTECTION

- A. Shoring, sheeting, and bracing shall be provided as required to protect the work and workmen from damage or injury by caving or sloughing.
- B. Laws and ordinances regulating health and safety measures shall be practiced.

- A. Submit shop drawings in accordance with Section 013300.
- B. None required unless material gradations are requested by Owner's Representative.
- C. Material Gradations.
- D. Standard Proctor Curves for Site and Borrow Materials.
- E. Test results for all proposed imported materials. Test results shall include the Unified Soil Classification System designation, the Liquid Limit (LL), and the Plasticity Index (PI) for each material.
- F. The Contractor shall provide a minimum three gallon sample of each proposed material.

1.4 COMPACTION TESTING

- A. Sample backfill materials for the density testing shall be taken according to ASTM D75.
- B. Determine the density of soil in place by the sand cone method ASTM D 1556; rubber-balloon method ASTM D2167; or nuclear method ASTM D 2922.
- C. Compaction is the calculated ratio of the in-place (dry) density to the laboratory maximum (dry) density expressed as a percentage.
- D. Determine laboratory moisture-density relations of soils according to the ASTM test method identified in the specific subsection.
- E. If the Owner is responsible for compaction testing, the Contractor shall pay the costs of any retesting of work not conforming to specifications.
- F. The following table identifies the compaction required based on the location of the soil.

LOCATION	COMPACTION DENSITY
Under paved areas, sidewalks and piping	90% of ASTM D 1557 or 95% of ASTM D698
Unpaved areas	85% of ASTM D698
Inside of structures under foundations, under equipment support pads, under slabs-on-grade and scarified existing subgrade under fill material	90% of ASTM D1557 or 95% of ASTM D698
Outside structures next to walls, piers, columns and any other structure exterior members	90% of ASTM D1557 or 85% of ASTM D698
Outside structures under equipment support foundations *	95% of ASTM D1557 or 100% of ASTM D698
Granular fill under base slabs and building floor slabs on grade	75% relative density per ASTM D4253 and ASTM D4254
Structural fill for over excavations	90% of ASTM D1557 or 95% of ASTM D698
*Granular fill or flowable fill may be substituted	

1.5 FREQUENCY OF TESTING

- A. Tests of the fill materials and embankments will be made at the following approximate rates or as deemed necessary by the Owner's Representative.
 - 1. One field density test for each 300 square yards of subgrade prior to placing fill.
 - 2. One field density test for each 100 cubic yards of fill placed or each layer of fill for each work area, whichever is greater.
 - 3. One moisture-density curve for each type material used, as indicated by sieve analysis and plasticity index.
 - 4. Field density and moisture test may be determined by current ASTM sand cone, or nuclear methods.

1.6 COMPACTION METHODS

- A. Obtain compaction of backfill and embankment by mechanical means. Jetting or flooding is not permitted. Compact each layer with mechanical tampers. Do not place backfill at hydraulic structures until hydraulic testing has been completed. Do not place backfill against cantilevered walls until design strength of concrete has been reached. Do not place backfill against walls supported at the top by floor

slabs until design strength has been reached.

- B. Use light vibratory or hand tamping equipment adjacent to the wall. Take particular care compacting around pipe spools. Do not use heavy compaction equipment within a horizontal distance from the wall equal to the height of the wall.

PART 2 PRODUCTS

2.1 EXCAVATED MATERIALS

- A. Topsoil obtained by stripping and suitable for finish grading where arable soil is required shall be stockpiled for future use.
- B. Material from the excavation is considered to be an acceptable backfill material provided it is free of vegetal matter, roots, debris, frozen matter, and stones larger than 3 inches in the greatest dimension.
- C. Moisture content is to be maintained at a level sufficient to obtain the specified compaction.

2.2 IMPERMEABLE MATERIAL FOR BACKFILL AND EMBANKMENTS

- A. Impermeable material for backfill and embankments shall be materials classified as CL, CL/CH, CH, or MH as defined by the Unified Soil Classification System. This material shall be free of organic matter, roots, debris, and particles larger than 1 inch in greatest dimension. Submit documentation that material meets this criteria.

2.3 STRUCTURAL FILL

- A. Material for Low Volume Change Structural Fill below structures shall be materials classified as CL, CL/CH, or CH, as defined by the Unified Soil Classification System. Material shall have a Liquid Limit of less than 45 and a Plasticity Index of less than 20. This material shall be free of organic matter, roots, debris, and particles larger than 1 inch in greatest dimension. Submit documentation that material meets this criteria. Most on-site material can be used as low volume change structural fill.
- B. Material for other Structural Fill below structures shall be materials classified as CL, CL/CH, or CH, as defined by the Unified Soil Classification System. Material shall have a Liquid Limit of less than 60, and a Plasticity Limit of less than 30. Submit documentation that material meets this criteria. Most on-site material can be used as low volume change structural fill.

2.4 AGGREGATE BASE MATERIAL

- A. Aggregates for granular bases shall be meet Kentucky DOT specifications.
- B. Aggregates for granular base shall meet the following gradation:

Sieve Size	Percent Passing by Weight
1 1/2 inch	100
1 inch	95-100
1/2 inch	25-65
3/8 inch	5-55
No. 4	0-10

2.5 WATER FOR COMPACTION

- A. Water shall be clean and free of acid, alkali, or organic materials and shall have a pH of 7.0 to 9.0, a maximum chloride concentration of 500 mg/l. Provide temporary tanker trucks, equipment and materials to convey water from the source to the point of use.

PART 3 EXECUTION

3.1 SITE CLEARING

- A. See Section 311000.

3.2 STOCKPILING OF TOPSOIL

- A. Topsoil shall be removed to a depth of one foot. The depth of topsoil may vary throughout the project. Topsoil shall be stockpiled for use in finishing operations.
- B. Protect the stockpile with erosion and sediment controls to prevent loss of material leaving the site.

3.3 OPEN EXCAVATIONS AND STOCKPILES

- A. Provide diversion ditches and dams upstream of disturbed areas to minimize water from entering excavated areas. Construct and maintain all temporary drainage swales, berms and diversions until permanent erosion and sediment controls are established.
- B. Provide erosion and sediment BMPs to controls for non-vegetated surfaces.
- C. When storing excess excavated material, do not obstruct surface drainage or existing waterways with the stockpiles.
- D. See Section 015713 and comply with the SWPPP.

3.4 DEWATERING

- A. Furnish, operate, and maintain all necessary pumping and other equipment for dewatering at all times during construction to remove and dispose of all water from any source from all excavations.
- B. Use methods which will ensure dry excavations and preserve the final lines and grades of the excavation. Methods used may include well points, sump pumps, suitable rock or gravel drains, temporary pipelines, or other acceptable means. Dewater so that floor or footing concrete will not be placed in water. Do not allow water to rise against walls or above footings and slabs.
- C. Dispose of water in a manner that will not damage adjacent property or be a menace to public health. Provide a copy of written permission from the owner of property over which water will pass, become a nuisance, or become impounded. Water may be discharged into the public road ditches located adjacent to the project site.
- D. Excavations that may entrap snow and subject the subgrade soils to a change in the moisture content shall not be left open during winter construction shut-down periods. Any snow that does become entrapped in excavations shall be removed within twenty-four hours.

3.5 GENERAL EXCAVATION

- A. Perform all material conditioning and excavations required. Excavation includes the removal and selected disposal of all excess or unsuitable materials of whatever nature.
- B. Excavate to full depth and width required to accommodate the lines and grades shown on the Drawings. Remove all materials which become blown or washed into excavations.
- C. Contractor shall select sloping or near-vertical trench and structure excavation slopes as he finds compatible with the soil conditions. The Contractor shall select any shoring which he deems appropriate and compatible with the soil conditions. These selections shall be exercised as a portion of the Contractor's responsibility for safety of site operations. The Contractor is responsible for conforming to OSHA requirements as may be applicable during structural excavating, trench excavations, site work, and in other areas of the work.
- D. Excavated material which meets required specifications may be used in embankments or backfill when approved and accepted.
- E. Remove from the site unsuitable materials such as large rocks, excessive organic materials and excess excavation material.

3.6 ROCK EXCAVATION

- A. All rock excavation shall be under one classification, which shall include solid ledge rock in its natural location that requires systematic quarrying, drilling and/or blasting for its removal and also boulders that exceed 1/2 cubic yard in volume.
- B. When rock is encountered, strip free of earth.
- C. The use of explosives shall be limited to the magnitude and location of the charge that will not cause damage to adjacent existing construction and utilities through shock vibrations or other stress loadings.
 - 1. Provide adequate blanket protection to ensure that there will not be fragments of rock or other debris flying through the air when discharging explosives.
 - 2. Contractor to employ personnel certified by appropriate regulatory authority to execute blasting operations if the Owner or local jurisdiction requires such certification.
 - 3. Explosive permits shall be obtained from appropriate local and state authorities.
 - 4. Where explosives and blasting are used, comply with all laws and ordinances of municipal, state and Federal agencies relating to the use of explosives.
 - a. Use qualified personnel for blasting and take proper precautions to protect persons, property

- or the work from damage or injury from blast or explosion.
- b. Conduct preblast survey in the company of the Owner's Representative to aid in determining any damage caused by blasting.
 - c. Any damage to existing construction or other features caused by blasting operations to be repaired and paid for by Contractor.

3.7 EMBANKMENTS

- A. Place all embankments to lines and grades shown. Areas to be covered with topsoil shall be underfilled so the finished lines conform after topsoil placement. Protect and maintain embankments during the course of construction. Replace all materials lost due to storm damage until permanent stabilization. Use materials obtained during excavation or imported materials. Do not use brush, sod, or other unsuitable materials in embankments.
- B. No embankment shall be constructed on frozen material, nor shall organic material be used for embankment.
- C. When an embankment is to be placed against a hillside or existing embankment whose slopes are steeper than 4:1; the existing slope shall be continuously benched in approximately 24 inches rises as the new fill is brought up on lifts as specified below. The material bladed out, the bottom of the area cut into, and the embankment material being placed shall be compacted to the required density.
- D. In fill sections, place material in loose lifts not exceeding 8 inches; brought to within 2% to +4% of optimum moisture content. Bring up each lift uniformly over the entire area being filled and compact each lift to its required density.
- E. Maintain the proper moisture content in the uppermost layer. If placing of materials is interrupted and the material dries, bring to proper moisture content before resuming by sprinkling, cultivating, and rolling to the required compaction. Do not place or roll material during rainfall of sufficient intensity to materially increase the moisture content. If any material placed in embankment acquires a greater moisture content than is suitable for compaction, allow to dry or remove. If removed, recondition the new surface before placing new material. Repair any irregularities caused by erosion by excavating, cultivating, filling, and compacting.

3.8 STRUCTURAL EXCAVATION

- A. Structural excavation is the removal of all materials of whatever nature to approved structural subgrade and as necessary for construction of structures and foundations. Approved structural subgrade is that material which has been observed by the Engineer and upon which structural foundations or other materials may be placed. Locate limits of excavation for structures with formed vertical surfaces at least 5 feet from the extreme outside of the structure to the toe of the cut slope or at a 1:1 slope as detailed on the drawings, whichever is greater.
- B. Design excavations in the proximity of adjacent structures so as to protect the structures from damage or undermining. Design and install shoring if necessary. Side slopes of excavation shall be only as steep as is safe for material to stand. Avoid unnecessary disturbance of adjacent ground.
- C. Subgrade Preparation
 - 1. Remove all existing "fill", loose natural clays, sand, and compressible materials under proposed structures. Provide a relatively smooth subgrade.
 - 2. The exposed bottoms of excavations shall consist of undisturbed native material.
 - 3. Where excavation is inadvertently carried beyond the design elevation or approved structural subgrade, adjust the construction as directed to meet the structural requirements. Over excavations shall be backfilled with graded structural fill compacted to the required density, or adjust the construction as required to meet the structural requirements as approved by the Owner's Representative.

3.9 BACKFILL AROUND STRUCTURES

- A. Place backfill in 6-inch uniform loose lifts and compact to the required density. Larger lifts may be utilized if it is demonstrated to the Owner's Representative that satisfactory results can be obtained.
- B. Use a minimum of 1 foot impermeable backfill for the top layer to prevent surface water from infiltrating next to walls.

3.10 SUBGRADE PREPARATION FOR DRIVE AREAS

- A. Roads, drives and pads shall be graded to grades designated in Drawings.
- B. Soil shall be free of organic material, trash and debris, and rocks larger than three inches in any dimension, and shall not be frozen while construction is in progress.

- C. The subgrade shall be plowed or diced to a depth of 8 inches and the loosened material compacted to the required cross-section elevation.
- D. Subgrade shall be compacted to minimum of 95% of ASTM D698.
- E. Compacted subgrade must support the weight of vehicles and equipment without producing ruts in the surface. Owner's Representative may require Contractor to demonstrate subgrade adequacy by requiring Contractor to move fully loaded equipment across compacted subgrade.
- F. Should rock be encountered, it shall be removed to a depth of one foot below the top of the subgrade and fill material placed and compacted as provided above.

3.11 PROTECTION

- A. Subgrade shall be repaired from action of the elements or others. Any settlement or erosion that occurs prior to placing the aggregate base shall be repaired to the specific line, grade and cross-section. Any subgrade that has become unacceptable shall be reworked as necessary to restore the subgrade to shape, tolerance, density, and moisture content range for such density, immediately prior to the placing of the aggregate base.
- B. The Contractor shall protect all existing improvements from damage resulting from his subgrade operation. Any improvement damaged shall be repaired or replaced by the Contractor at his own expense.

3.12 PLACEMENT OF TOPSOIL

- A. All areas where topsoil is to be placed shall be scarified to a depth of 6" minimum by means of discing, harrowing or culti-packing.
- B. Topsoil shall be spread evenly to a depth of at least 6-inches, smooth and true to the lines and grades as indicated on the Plans, and ready to receive seed and fertilizer. Seedbed areas shall be free of trash, debris and rocks over 2" in size.

3.13 DISPOSAL OF MATERIAL

- A. Excess earth material shall be transported to onsite storage area by Contractor. The Contractor shall not dispose of any excavated material until there is sufficient material to complete all necessary project embankments and fill areas.
- B. Material not suitable for embankment, fill or backfill shall be disposed of off-site at a location determined by the Owner's Representative. Transportation of such material and any disposal fees shall be provided by the Contractor.
- C. Material in excess of requirements for embankment, fill or backfill shall be disposed of on-site or at locations determined by Owner's Representative. Transportation of such material and any disposal fees shall be provided by the Contractor.

3.14 FINISH GRADING

- A. Upon completion of the work, clean the entire site area affected of trash and debris, and grade the surface smooth to drain so that no depressions, vehicle tracks, or ridges are left which could accumulate rainwater.

END OF SECTION

SECTION 312333
TRENCHING AND BACKFILLING

PART 1 GENERAL

1.1 SUMMARY

- A. This section includes materials and installation for trench excavation, backfilling, and compacting.
- B. Sheeting, shoring, bracing, and protection of adjacent property, trees, and structures.
- C. Preparation of subgrades, bedding for pipe, backfilling, and disposal of excess excavation.

1.2 SUBMITTALS

- A. Submit shop drawings in accordance with the Section 013300.
- B. All specified bedding and backfill material, except earth excavated material.
- C. Moisture-Density test for each backfill material.
- D. Sheeting, shoring and bracing design calculations by a registered professional engineer licensed in the State.

1.3 DEFINITIONS

- A. Pipe Embedment Zone - The full width of trench from both below and above the bottom of the pipe or conduit to a horizontal level above the top of the pipe as defined by the embedment class or as shown on the details.
- B. Trench Zone - The portion of the trench from the pipe embedment zone to finished grade in unpaved areas, and to the bottom of the drive zone in drive areas.
- C. Pipe Cover - The distance from the top of the finished grade of the trench to the top of the waterline pipe.
- D. Aggregate Pipe Base - A layer of material below the pipe embedment zone to stabilize the bottom of the trench and provide uniform bearing of the pipe and pipe embedment.
- E. Class A Excavated Material
 - 1. Hard shale, sandstone, limestone, granite or similar materials which is encountered in monolithic ledges greater than 8" in thickness and which, in the opinion of the Owner's Representative, require jackhammering, use of a special headache ball or hydrohammer for removal. A toothed bucket is not considered as special "ripping" equipment.
 - 2. Two or more ledges with inter-lying strata of earth, clay, or gravel not more than eight (8) inches in thickness in each strata will be classified as a solid monolithic formation from the top of the top ledge to the bottom of the bottom ledge. Boulders that are encountered within glacial till or other soil and are not a portion of a continuous monolithic formation shall not be considered
- F. Unclassified Excavated Material - All earth or other materials that do not meet the requirements of Class A excavated material.

1.4 COMPACTION TESTING

- A. An independent geotechnical firm hired by General Contractor will test perform material testing and field compaction testing.
- B. Material testing for each backfill material shall be two moisture density tests or two relative density tests according to the appropriate ASTM specification.
- C. Minimum testing frequency for in-place field shall be:
 - 1. One test for every 200 cubic yards of backfill for site backfill with a minimum of one test for every full shift of compaction operation on mass earthwork.
 - 2. One test at intervals of 500 feet along the trench.
 - 3. One in-place field density test whenever there is a suspicion of a change in backfill material, quality of moisture or effectiveness of compaction.
- D. Sample backfill materials for the density testing shall be taken according to ASTM D75.
- E. Determine the density of soil in place by the sand cone method ASTM D 1556, rubber-balloon method ASTM D2167; or nuclear method ASTM D 2922.
- F. Compaction is the calculated ratio of the in-place (dry) density to the laboratory maximum (dry) density expressed as a percentage.

- G. Determine laboratory moisture-density relations of soils according to the ASTM test method identified in the specific subsection.
- H. If the Owner is responsible for compaction testing, the Contractor shall pay the costs of any retesting of work not conforming to specifications.
- I. The following table identifies the compaction required based on the location of the trench.
 - 1. LOCATION/COMPACTION DENSITY
 - a. Under paved areas, sidewalks, and pipe crossings: 95% of ASTM D698
 - b. Under foundations and equipment support pads: 95% of ASTM D698
 - c. Unpaved areas: 85% of ASTM D698
 - d. Granular backfill: 75% relative density per ASTM D4253 and ASTM D4254

PART 2 PRODUCTS

2.1 PIPE EMBEDMENT MATERIAL

- A. Native earth material which is fine, loose material, free from stones 1-inch and larger, hard frozen clods, and other material that may cause damage to the pipe, organic matter and debris that will deteriorate and cause voids.
- B. Rigid Pipe - Bedding Classes A, B, C or crushed rock, as described in ASTM C12.
- C. Ductile Iron Pipe - Type 1 through Type 5 laying conditions, as described in ASTM A746.
- D. PVC and other Flexible Pipe - Classes I, II, III, as described in ASTM D2321.
- E. Composite Pipe - Same as Flexible Pipe except as described in ASTM D2680.

2.2 GRANULAR BACKFILL MATERIAL

- A. Granular material shall meet the following gradation:
 - 1. Sieve Size 1 inch, Percent Passing By Weight: 100%
 - 2. Sieve Size 3/4 inch, Percent Passing By Weight: 85-100%
 - 3. Sieve Size 3/8 inch, Percent Passing By Weight: 50-80%
 - 4. Sieve Size No. 4, Percent Passing By Weight: 35-60%
 - 5. Sieve Size No. 40, Percent Passing By Weight: 15-30%
 - 6. Sieve Size No. 200, Percent Passing By Weight: 5-10%
- B. The granular material shall not contain clay lumps or organic matter. The fraction passing the No. 4 sieve shall have liquid limits no greater than 25 and a plasticity index no greater than 5. The material shall meet the quality requirements of ASTM C33.

2.3 AGGREGATE PIPE BASE MATERIAL

- A. The aggregate base material shall consist of crushed rock or gravel; free from dust, clay and trash; be hard, durable, non-friable and meet the gradation as defined in ASTM C33 for No. 76 coarse aggregate or the following gradation:
 - 1. Sieve Size 3/4 inch; Percent Passing By Weight: 100%
 - 2. Sieve Size No. 4; Percent Passing By Weight: 0-35%
 - 3. Sieve Size No. 8; Percent Passing By Weight: 0-17%
 - 4. Sieve Size No. 200; Percent Passing By Weight: 0-10%
- B. Other gradations may be utilized provided all the material passes the 3/4 sieve and it can be demonstrated that they provide adequate base support for the pipe.
- C. The aggregate material shall meet the quality requirements of ASTM C33.

PART 3 EXECUTION

3.1 PREPARATION

- A. Verify that survey bench marks and intended elevations for the Work are as shown on drawings.
- B. Identify required lines, levels, contours, and datum.
- C. Identify by visible markings all plant life, trees, lawns, fences and other features that are to be protected.
- D. Protect bench marks from excavation equipment and vehicular traffic.
- E. Existing underground installations such as water mains, gas mains, sewers, telephone lines, power lines, and buried structures in the vicinity of the work to be done hereunder are indicated on the

drawings only to the extent such information has been made available to or discovered by the Engineer in preparing the drawings. There is no guarantee as to the accuracy or completeness of such information, and all responsibility for the accuracy and completeness thereof is expressly disclaimed. Generally, service connections are not indicated on the drawings.

- F. The Contractor shall be solely responsible for locating all existing underground installations, including service connections in advance of excavating or trenching by contacting the owners thereof and prospecting. The Contractor shall use his own information and shall not rely upon any information shown on the drawings concerning existing underground installations.
- G. Where utilities are parallel to or cross the construction but do not conflict with the permanent work to be constructed, follow the procedures given below or as indicated in the drawings. Notify the utility owner 48 hours in advance of the crossing construction and coordinate the construction schedule with the utility owner's requirements.
- H. Determine the true location and depth of utilities and service connections which may be affected by or affect the work. Determine the type, material, and condition of these utilities. In order to provide sufficient lead time to resolve unforeseen conflicts, order materials and take appropriate measures to ensure that there is no delay in

3.2 SHEETING, SHORING, AND BRACING OF TRENCHES

- A. Sheeting and bracing, or trench boxes shall be provided where necessary to conform to 29CFR1926 Subpart P-Excavations, OSHA requirements.
- B. Where it is necessary to drive sheeting below the centerline of the pipe, it shall be driven to a depth of at least 2 feet below the flow line of the pipe, or as directed by the geotechnical engineer.

3.3 TRENCH WIDTHS

- A. Trench widths shall be as shown in the drawings.
- B. The width of the trench shall be ample to allow the pipe to be laid and jointed properly and to allow the bedding and haunching to be placed and compacted to adequately support the pipe. The trench sides shall be kept as nearly vertical as possible. When wider trenches are specified, appropriate bedding class and pipe strength shall be used.
- C. In unsupported, unstable soil the size and stiffness of the pipe, stiffness of the embedment and in-situ soil and depth of cover shall be considered in determining the minimum trench width necessary to adequately support the pipe
- D. Ledge rock, boulders, and large stones shall be removed to provide a minimum clearance of 4-inches below and on each side of the pipe.
- E. Trench width at the top of the trench will not be limited except where width of excavation would undercut adjacent structures and footings. In such case, width of trench shall be a minimum clearance of the trench wall to outside pipe being a minimum of 4-inches, and that there is at least 24-inch clearance between the top edge of the trench and the structure or footing.

3.4 MINIMUM PIPE COVER

- A. Pipeline Location: Non-Paved Areas, Cover - 42 inches
- B. Pipeline Location: Paved Areas, Cover - 42 inches
- C. Pipeline Location: Under ditches and minor drainage courses, Cover - 4 feet
- D. Pipeline Location: Under rivers and streams, Cover - 4 feet
- E. Pipeline Location: State Highway, Cover - 6 feet

3.5 TRENCH EXCAVATION

- A. Perform all excavation regardless of type, nature or condition of the material encountered to accomplish the construction. Excavate the trench to the lines and grades shown on the drawings with allowance for pipe thickness and for pipe base or special bedding.
- B. Care shall be taken not to over-excavate. If the trench is excavated below the required grade, refill any part of the trench excavated below the grade with native material and compact to a density equal to the rest of the trench bottom.
- C. Length of open trench to be no more than amount of pipe installed in one working day. Backfilling of the open trench to grade to be no more than 40-feet behind the installed pipe.
- D. Blasting will not be permitted unless approved by Owner and appropriate jurisdictions.

- E. After the required excavation has been completed, the Owner's Representative will inspect the exposed subgrade to determine the need for any additional excavation. It is the intent that additional excavation be conducted in all areas within the influence of the pipeline where unacceptable materials exist in the exposed subgrade. Over excavation shall include the removal of all such unacceptable material that exists directly beneath the pipeline to a width 24-inches greater than the pipe outside diameter and to the depth required. Refill the trench to subgrade of pipe base with native material. Place the foundation stabilization material over the full width of the trench and compact in layers not exceeding 6 inches deep compacted to 95 percent relative compaction and carried to the required grade.

3.6 LOCATION OF EXCAVATED MATERIAL

- A. During trench excavation, place the excavated material only within the working area. Do not obstruct any roadways or streets. Conform to federal, state, and local codes governing the safe loading of trenches with excavated material.
- B. Excavated material not used as backfill shall be disposed of off-site.

3.7 DEWATERING

- A. Provide and maintain means and devices to remove and dispose of all water entering the trench excavation during the time the trench is being prepared for the pipe laying, during the laying of the pipe, and until the backfill has been completed.
- B. Water entering the excavation or other parts of the work shall be removed until all the work has been completed. No sanitary sewer shall be used for the disposal of trench water, unless specifically approved by the engineer, and then only if the trench water does not ultimately arrive at existing pumping or wastewater treatment facilities
- C. Dispose of the water in a manner to prevent damage to adjacent property. Do not drain trench water through the pipeline under construction. Do not allow groundwater to rise around the pipe until jointing compound has set hard.

3.8 INSTALLING BURIED PIPING

- A. Grade the bottom of the trench to the line and grade to which the pipe is to be laid, with allowance for pipe thickness. Remove hard spots that would prevent a uniform thickness of bedding. Place the specified thickness of pipe base material over the full width of trench. Grade the top of the pipe base ahead of the pipe laying to provide firm, continuous, uniform support along the full length of pipe, and compact to the relative compaction specified herein. Before laying each section of the pipe, check the grade and correct any irregularities.
- B. Excavate bell holes at each joint to permit proper assembly and inspection of the entire joint. Fill the area excavated for the joints with the bedding material specified or indicated in the drawings for use in the pipe zone.
- C. Inspect each pipe and fitting before lowering the buried pipe or fitting into the trench. Inspect the interior and exterior protective coatings. Patch damaged areas in the field with material recommended by the protective coating manufacturer. Clean ends of pipe thoroughly. Remove foreign matter and dirt from inside of pipe and keep clean during and after installation.
- D. Handle pipe in such a manner as to avoid damage to the pipe. Do not drop or dump pipe into trenches under any circumstances.
- E. Lay the pipe at the proper elevation and grade and properly attach to the adjacent pipe according to the type of joint.
- F. When the pipe laying is not in progress, including the noon hours, close the open ends of pipe. Do not allow trench water, animals, or foreign material to enter the pipe.
- G. Keep the trench dry until the pipe has been installed and jointed to the other pipe.

3.9 TRENCH BACKFILLING

- A. Backfill according to the details for the particular type of pipe, and per the following:
 - 1. Place the specified thickness of pipe base material over the full width of trench. Grade the top of the pipe base ahead of the pipe laying to provide firm, uniform support along the full length of pipe. Organic matter or clay material which may fall in an open trench during construction shall be removed. The Contractor shall limit the amount of native material which may fall on top of the completed pipe base until the pipe is installed.
 - 2. Backfill shall be of a suitable material removed from excavation except where other material is specified. Debris, frozen material, large clods or stones, organic matter, or other unstable

- materials shall not be used for final backfill within 2 feet (0.6 m) of the top of the pipe. Do not bury waste material.
3. After pipe has been bedded, backfill simultaneously on both sides of the pipe, keeping the level of backfill the same on each side. Carefully place the material around the pipe so that the pipe barrel is completely supported and that no voids or uncompacted areas are left beneath the pipe. Do not permit free fall of the material until at least 2 feet of cover is provided over the top of the pipe. Use particular care in placing material on the underside of the pipe to prevent lateral movement during subsequent backfilling.
 4. Compact material placed within 12 inches of the outer surface of the pipe by hand tamping only.
 5. Continue to place the backfill material in the trench until it reaches the finished grad according to the following criteria:
 - a. Backfilling under Paved Areas: Plus or minus 1/2 inch from required elevations.
 - b. General Backfilling: Plus 3 inches from required elevations.

3.10 BACKFILL COMPACTION METHODS

- A. Compact by using mechanical compaction or hand tamping. Do not use high impact hammer-type equipment except where the pipe manufacturer warrants in writing that such use will not damage the pipe. Jetting will not be allowed.
- B. Do not use any axle-driven or tractor-drawn compaction equipment within 5 feet of walls and structures.
- C. When existing pipe is encountered during excavation, care shall be taken to support pipe sufficiently so pipe remains in service and to ensure safety of workers. During backfilling place bedding material in and around the existing pipe and compact to specifications above.

3.11 PLACEMENT OF SAND-CEMENT SLURRY BACKFILL

- A. Place sand-cement slurry backfill in a uniform manner that will prevent voids in or segregation of the material. Remove foreign material that falls into the excavation or trench. Do not commence backfilling over or place any material over the slurry cement backfill until at least four hours after placing the sand-cement slurry.

3.12 PLACEMENT OF CLSM (CONTROLLED LOW-STRENGTH MATERIAL)

- A. Provide batching equipment to obtain the proper weights of soil, cement, water, and admixtures. Measuring devices shall be sensitive to a 2% variation above or below the actual weights required. Volumetric batching may be used, provided the same accuracy required for weight batching is maintained.
- B. Design and operate the mixers used for mixing the CLSM so that the CLSM as discharged from the mixer is uniform in composition and consistency throughout each batch.
- C. Place the CLSM such that it flows easily into all openings between the pipe and the excavated trench. In some cases, such as trenches on a slope, a stiffer mix may be required to prevent it from flowing down the trench. In this case, use vibration to ensure that the CLSM completely fills all spaces.
- D. Lay the pipe on the soil pads and place the CLSM bedding as shown in the drawings. Place bedding under pipe from one side and vibrate so that it flows under the pipe until it appears on the other side. Then add CLSM to both sides of the pipe and vibrate until it completely fills the space between the pipe and the excavated trench bottom. This operation shall follow as closely behind pipelaying operations as possible. Place CLSM in such a way as to prevent uplift or buckling of the pipe. Deposit CLSM as nearly as practicable in its final position. Do not disturb the pipe trench or cause foreign material to become mixed with the cement slurry.
- E. Do not place backfill above the pipe until the CLSM has reached the initial set. Place and maintain a 6-inch cover of moist backfill cover until additional backfill is placed. If the ambient temperature is 50°F or less, place an additional 6-inch cover of backfill over the 6-inch moist backfill cover prior to the end of the working day.
- F. Whenever freezing temperatures are imminent, maintain the CLSM at a temperature of not less than 50°F for 24 hours after placement. The temperature of the mix shall be 50°F or greater at the time of placement. Monitor the temperature by placing a thermometer in the CLSM immediately after sampling at the placement site. When freezing weather appears imminent, make ready at the placement site materials that may be required for protection of the CLSM. Delay placement of CLSM until adequate provisions for protection against weather are made. Do not place CLSM bedding in pipe trenches when the trench bottom or walls are frozen or contain frozen material. Backfill placed as cover over the CLSM is prohibited from containing any frozen material.

3.13 INSTALLING IMPERVIOUS BARRIERS

- A. Construct impervious barriers in the pipe and trench zones at 300-foot intervals on slopes exceeding 30% and within 50-feet of vertical points of inflection on slopes exceeding 30%. Construct concrete barriers such that the bottom of the collar extends at least 3 inches into the pipe base, at least 3 inches into each side of the walls of the trench, and at least 3 inches above the top of the pipe zone.
- B. Install ABS dams by digging a slot approximately 3 inches deep into the pipe base, located approximately 3 feet from the nearest pipe bell. Key the dam into the groove such that the neck of the adapter connection pipe faces upstream. Center the dam into position and insert the edges into the side walls of the trench. Slide a Fernco adapter over the pipe to be installed. Move the pipe through the dam opening and assemble the pipe joint. Slip the Fernco adapter over the ABS barrier's neck and tighten the adapter's bands. Backfill both sides of the dam such that there are no voids around the pipe.

3.14 PROTECTING UNDERGROUND UTILITIES

- A. Underground utilities are to be protected in place and remain in service, unless otherwise specified on the Plans or in the specifications. Compact bedding material under and around the utility so that no voids are left. Flowable fill may be an acceptable method of bedding and backfill.
 - 1. Where indicated in the drawings or as determined by the Owner's Representative, support utilities by a reinforced concrete beam or support wall as shown on the utility support details in the drawings. The primary purpose of the beam is to prevent settlement of the existing utility line during and after construction. The Contractor is responsible for the protection of the utility during construction and shall incorporate the beam as part of the protection.
- B. Abandoned utility lines may be cut to facilitate installation of the new Works. All open ends are to be plugged. The cut utility line shall be removed from the site.
 - 1. Storm drains and sewers are to be plugged with an 8-inch wall of brick and mortar.
 - 2. Waterlines are to be capped with a cast-iron cap or a 3-foot-long concrete plug.
- C. Sewer services, water services, and other utility service lines are not shown on the Drawings. Interference with these services may occur. If such situations arise, the Contractor shall move the conflicting utilities (such as water service leads, sewer service lines, gas lines, etc.) or adjust the pipeline vertical and/or horizontal alignment to maintain required vertical and/or horizontal separations. All proposed modifications to the pipeline alignment shall be presented to the Owner's Representative for review and all changes made shall conform to the recommendations of the Owner's Representative.
- D. If the utility must be removed to facilitate construction of the new Works, the utility will be reconstructed with new materials and placed back into service. During this period, Contractor shall provide temporary service for the disconnected utility.
- E. Disruption of water service to residential and/or places of business as a result of the Contractor's operations shall be limited to a maximum of 8 (eight) hours. In the event that disruption of a particular service will be longer than 8 hours, the Contractor shall provide temporary potable water service which meets the Department of Health requirements for potable water to the affected residence or place of business for drinking purposes. In the event that disruption of a particular service will be longer than 24 hours, the Contractor shall provide temporary potable water service which meets the entire domestic water demands of the affected residence or place of business. The Contractor shall at all times maintain on site, the materials required for providing temporary water services.
- F. Waterlines whose thrust is in the direction of the new excavation, may be affected by the construction. Protect thrust blocks in place or shore to resist the thrust by a means approved by the water utility. If the thrust blocks are exposed or rendered to be ineffective in the opinion of the Owner's Representative, reconstruct them to bear against firm unexcavated soil.

END OF SECTION

SECTION 321540
CRUSHED STONE PAVING

PART 1 - GENERAL

1.1 SUMMARY

- A. Section Includes: Provision of aggregate base course material consisting as a mixture of coarse and fine graded aggregate that is free of vegetation and other deleterious matter. Work consists of placing one or more lifts of aggregates, and specified additives, on prepared subgrade, and geogrid, or geotextile, as specified, using conventional equipment and methods for mixing, placement, and compaction of aggregates onto subgrade.

1.2 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.
 - 1. Section 013300 "Submittal Procedures".
 - 2. Section 311000 "Site Clearing" for site stripping, grubbing, stripping and stockpiling topsoil, and removal of above- and below-grade improvements and utilities.
 - 3. Section 312000 "Earth Moving" for subgrade preparation and subgrade testing.

1.3 UNIT PRICES

- A. Rock Measurement: Volume of rock actually removed, measured in original position, but not to exceed the following. Unit prices for rock excavation include replacement with approved materials.
 - 1. 6 inches outside of minimum required dimensions of Crushed Stone Paving against grade.

1.4 DEFINITIONS

- A. Backfill: Soil material or controlled low-strength material used to fill an excavation.
- B. Borrow Soil: Satisfactory soil imported from off-site for use as fill or backfill.
- C. Drainage Course: Aggregate layer supporting the slab-on-grade that also minimizes upward capillary flow of pore water.
- D. Engineered Fill: Fill material allowing the required compaction density. Can be same material used for crushed stone paving.
- E. Excavation: Removal of material encountered above subgrade elevations and to lines and dimensions indicated.
 - 1. Authorized Additional Excavation: Excavation below subgrade elevations or beyond indicated lines and dimensions as directed by Engineer. Authorized additional excavation and replacement material will be paid for according to Contract provisions for changes in the Work.
 - 2. Bulk Excavation: Excavation more than 10 feet in width and more than 30 feet in length.
 - 3. Unauthorized Excavation: Excavation below subgrade elevations or beyond indicated lines and dimensions without direction by Engineer. Unauthorized excavation, as well as remedial work directed by Engineer, shall be without additional compensation.
- F. Fill: Soil materials used to raise existing grades.
- G. Rock: Rock material in beds, ledges, unstratified masses, conglomerate deposits, and boulders of rock material that exceed 1 cu. yd. for bulk excavation that cannot be removed by rock excavating equipment equivalent to the following in size and performance ratings, without systematic drilling, ram hammering, ripping, or blasting, when permitted:
 - 1. Bulk Excavation: Late-model, track-mounted loader; rated at not less than 230-hp flywheel power and developing a minimum of 47,992-lbf breakout force with a general-purpose bare bucket; measured according to SAE J-732.
- H. Rock: Rock material in beds, ledges, unstratified masses, conglomerate deposits, and boulders of rock material 3/4 cu. yd. or more in volume that exceed a standard penetration resistance of 100 blows/2 inches or when tested by a geotechnical testing agency, according to ASTM D 1586.
- I. Subbase Course: Aggregate layer placed between the subgrade and base course for pavement.
- J. Subgrade: Uppermost surface of an excavation or the top surface of a fill or backfill immediately below subbase, drainage fill, drainage course, or topsoil materials.

1.5 SUBMITTALS

- A. Submit shop drawings in accordance with the Section 013300.
- B. Product Data: For each type of the following manufactured products required:
 - 1. Geotextiles.
- C. Samples for Verification: For the following products, in sizes indicated below:
 - 1. Geotextile: 12 by 12 inches.

1.6 INFORMATIONAL SUBMITTALS

- A. Material Test Reports: For each aggregate material proposed for paving as follows
 - 1. Classification according to ASTM C 33.
 - 2. Sieve gradation according to KYTC.
- B. Geotechnical Testing Agency Qualifications: Qualified according to ASTM E 329 and ASTM D 3740 for testing indicated.

1.7 PROJECT CONDITIONS

- A. Traffic: Minimize interference with adjoining roads, streets, walks, and other adjacent occupied or used facilities during paving operations.
 - 1. Do not close or obstruct streets, walks, or other adjacent occupied or used facilities without permission from Owner and authorities having jurisdiction.
 - 2. Provide alternate routes around closed or obstructed traffic ways if required by Owner or authorities having jurisdiction.
- B. Utility Locator Service: Notify utility locator service for area where Project is located before beginning paving operations.

PART 2 - PRODUCTS

2. Provide aggregate material of the type and grade as shown on Drawings and conforming to the requirements of the KYTC.
 - a. Type A: Crushed stone produced and graded from oversized quarry aggregate that originates from a single, naturally occurring source.
 - b. Type B: Crushed or uncrushed gravel. Blending more than one source is allowed.
 - c. Type C: Crushed gravel with a minimum of 60 percent of the particles retained on a No.4 sieve with two or more crushed faces. Blending two or more sources is allowed.
 - d. Type D: Type A material or crushed concrete. Crushed concrete containing gravel will be considered Type D material. Crushed concrete must meet requirements of Section 247.2.A.3.b "Recycled Material (Including Crushed Concrete) Requirements", and be managed to provide uniform quality.

3. Aggregate for paving shall meet requirements of KYTC.
 - a. Contractor shall submit certified test results to Engineer for the gradation of base aggregates. Certification shall show the appropriate AASHTO test for the material, results, and a statement whether material has passed or failed.
 - b. Sampling aggregates per AASHTO T 2.
 - c. Sieve analysis of fine and coarse aggregate per AASHTO T 27 and meet gradation in table at end of this section.
 - d. Material passing No.200 sieve shall be tested per AASHTO T 11 and meet requirements in table at end of this section.
 - e. Engineer may request test results for material prior to and during paving construction to ensure quality control of materials.

2.2 GEOTEXTILES

- A. Subsurface Drainage Geotextile: Refer to Section 310519 "Geotextiles":
 - 1. Survivability: Class 1; AASHTO M 288.
 - 2. Grab Tensile Strength: 157 lbf; ASTM D 4632.
 - 3. Sewn Seam Strength: 142 lbf; ASTM D 4632.
 - 4. Tear Strength: 56 lbf; ASTM D 4533.
 - 5. Puncture Strength: 56 lbf; ASTM D 4833.
 - 6. Apparent Opening Size: No. 40 sieve, maximum; ASTM D 4751.
 - 7. Permittivity: 0.5 per second, minimum; ASTM D 4491.
 - 8. UV Stability: 50 percent after 500 hours' exposure; ASTM D 4355.
- B. Separation Geotextile: Refer to Section 310519 "Geotextiles":
 - 1. Survivability: Class 2; AASHTO M 288.
 - 2. Grab Tensile Strength: 247 lbf; ASTM D 4632.
 - 3. Sewn Seam Strength: 222 lbf; ASTM D 4632.
 - 4. Tear Strength: 90 lbf; ASTM D 4533.
 - 5. Puncture Strength: 90 lbf; ASTM D 4833.
 - 6. Apparent Opening Size: No. 60 sieve, maximum; ASTM D 4751.
 - 7. Permittivity: 0.02 per second, minimum; ASTM D 4491.
 - 8. UV Stability: 50 percent after 500 hours' exposure; ASTM D 4355.

PART 3 - EXECUTION

3.1 PREPARATION

- A. Protect structures, utilities, sidewalks, pavements, and other facilities from damage caused by settlement, lateral movement, undermining, washout, and other hazards created by Crushed Stone Paving operations.
- B. Protect and maintain erosion and sedimentation controls during paving operations.
- C. Protect subgrades and foundation soils from freezing temperatures and frost. Remove temporary protection before placing subsequent materials.
- D. Subgrade to be excavated and compacted per Section 312000 "Earth Moving".
- E. Place Geotextile as required under crushed stone paving per manufacturers recommendations.
- F. Do not place crushed aggregate or geotextiles on excessively wet, frozen, rutted subgrade or any surface not in compliance with compaction density requirements in Section 312000 "Earth Moving".
- G. Aggregate to be uniformly mixed to form a homogeneous mixture of particles.

3.2 EXCAVATION, GENERAL

- A. Unclassified Excavation: Excavate to subgrade elevations regardless of the character of surface and subsurface conditions encountered. Unclassified excavated materials may include rock, soil materials, and obstructions. No changes in the Contract Sum or the Contract Time will be authorized for rock excavation or removal of obstructions.
 - 1. If excavated materials intended for fill and backfill include unsatisfactory soil materials and rock, replace with satisfactory soil materials.
 - 2. Remove rock to lines and grades indicated to permit installation of permanent construction without exceeding the following dimensions:
 - a. 24 inches outside of edge of paving.
- B. Classified Excavation: Excavate to subgrade elevations. Material to be excavated will be classified as earth and rock. Do not excavate rock until it has been classified and cross sectioned by Engineer. The Contract Sum will be adjusted for rock excavation according to unit prices included in the Contract

Documents. Changes in the Contract Time may be authorized for rock excavation.

1. Rock excavation includes removal and disposal of rock. Remove rock to lines and subgrade elevations indicated to permit installation of permanent construction without exceeding the following dimensions:
 - a. 24 inches or outside of edge of paving.

3.3 SUBGRADE INSPECTION

- A. Notify Engineer when excavations have reached required subgrade.
- B. If Engineer determines that unsatisfactory soil is present, continue excavation and replace with compacted backfill or engineered fill material as directed.
- C. Proof-roll subgrade below pavements with a pneumatic-tire and loaded 10-wheel, tandem-axle dump truck weighing not less than 15 tons to identify soft pockets and areas of excess yielding. Do not proof-roll wet or saturated subgrades.
 1. Completely proof-roll subgrade in one direction, repeating proof-rolling in direction perpendicular to first direction>>. Limit vehicle speed to 3 mph.
 2. Excavate soft spots, unsatisfactory soils, and areas of excessive pumping or rutting, as determined by Engineer, and replace with compacted backfill or engineered fill as directed.
- D. Authorized additional excavation and replacement material will be paid for according to Contract provisions for changes in the Work.
- E. Reconstruct subgrades damaged by freezing temperatures, frost, rain, accumulated water, or construction activities, as directed by Engineer, without additional compensation.

3.4 SOIL MOISTURE CONTROL

- A. Uniformly moisten subgrade and each subsequent fill or backfill layer before compaction to within 2 percent of optimum moisture content.

3.5 COMPACTION OF SOIL BACKFILLS AND FILLS

- A. Layers of Crushed Stone Aggregate is to be placed in uniform layer thickness via a mechanical spreader such that no compacted layer exceeds 6 inches.
- B. Maximum thickness of one compacted layer is 6 inches. Minimum layer thickness of one compacted layer is 3 inches.
- C. Compacted aggregate surfacing is to be at 98 percent standard proctor at +/- 2 percent optimum moisture per ASTM D 698; or density as determined by MT 230 and per MDT 301>>.

3.6 FIELD QUALITY CONTROL

- A. Special Inspections: Contractor shall engage a qualified special inspector to perform the following special inspections:
 1. Determine prior to placement of fill that site has been prepared in compliance with requirements.
 2. Determine that fill material and maximum lift thickness comply with requirements.
 3. Determine, at the required frequency, that in-place density of compacted fill complies with requirements.
- B. Testing Agency: Contractor shall engage a qualified geotechnical engineering testing agency to perform tests and inspections.
- C. Allow testing agency to inspect and test subgrades and each fill or backfill layer. Proceed with subsequent earth moving only after test results for previously completed work comply with requirements.
- D. Testing agency will test compaction of soils in place according to ASTM D 1556, ASTM D 2167, ASTM D 2922, and ASTM D 2937, as applicable. Tests will be performed at the following locations and frequencies:
 1. Paved Areas: At subgrade and at each compacted fill and backfill layer, at least one test for every 1000 sq. ft. or less of paved area but in no case fewer than three tests.
- E. When testing agency reports that subgrades, fills, or backfills have not achieved degree of compaction specified, scarify and moisten or aerate, or remove and replace soil materials to depth required; re-compact and retest until specified compaction is obtained.
- F. Final compacted surface is to be constructed to elevations on Drawings within 0.04 feet (1/2 inch). Ensure surface smoothness is within 0.04 feet (1/2 inch) in 10 feet. Test for smoothness with 10 foot long straightedge.

- G. Ensure an average compacted thickness within 0.02 feet (1/4 inch) of that detailed on drawing. Engineer will confirm average Project thickness at 1000 sq. ft. intervals. Contractor to correct any thickness deficiencies by removing material, scarifying to a depth of 3 inches and adding material resulting in a minimum 3 inch compacted lift.
- H. Contractor to ensure uniform compaction of all crushed stone surfacing.

END OF SECTION

THIS PAGE INTENTIONALLY LEFT BLANK

SECTION 323113
STEEL CHAIN LINK FENCES AND GATES

PART 1 GENERAL

1.1 SUMMARY

- A. This section includes materials and installation of galvanized or PVC-coated steel chain link fence and gates top and bottom tension wires and anticlimb extension arms with barbed wire.

1.2 PERFORMANCE REQUIREMENTS

- A. Delegated Design: Design chain-link fences and gates, including comprehensive engineering analysis by a qualified professional engineer, using performance requirements and design criteria indicated.
- B. Structural Performance: Chain-link fence and gate framework shall withstand the effects of gravity loads and the following loads and stresses.
 - 1. Minimum Post Size: Determine according to ASTM F 1043 for framework up to 12 feet high, and post spacing not to exceed 10 feet.
 - 2. Minimum Post Size and Maximum Spacing: Determine according to CLFMI WLG 2445, based on mesh size and pattern specified and on the following:
 - a. Wind Speed, V3s: 90 mph
 - b. Exposure Category: B
- C. Lightning Protection System: Maximum grounding-resistance value of 25 ohms under normal dry conditions.

1.3 SUBMITTALS

- A. Submit shop drawings in accordance with Section 013300.
- B. Submit product data for each type of product indicated. Include construction details, material descriptions, dimensions and profiles, and finishes.
- C. Shop Drawings: Include plans, elevations, sections, details, and attachments to other work. Show accessories, hardware, gate operation, and operational clearances.
- D. For chain-link fences and gate framework indicated to comply with performance requirements and design criteria, including analysis data signed and sealed by the qualified professional engineer responsible for their preparation licensed in the state where the project is located.

1.4 PROJECT CONDITIONS

- A. Field Measurements: Verify layout information for chain-link fences and gates shown on Drawings in relation to property survey and existing structures. Verify dimensions by field measurements.

1.5 WARRANTY

- A. Special Warranty: Manufacturer's standard form in which manufacturer or Installer agrees to repair or replace components of chain-link fences and gates that fail in materials or workmanship within specified warranty period.
 - 1. Failures include, but are not limited to, the following:
 - a. Faulty operation of gate.
 - b. Deterioration of metals, metal finishes, and other materials beyond normal weathering.
 - 2. Warranty Period: Five years from date of Substantial Completion.

PART 2 PRODUCTS

2.1 CHAIN LINK FABRIC

- A. General: Provide fabric in one-piece heights measured between top and bottom of outer edge of selvage knuckle or twist. Comply with CLFMI Product Manual and with requirements indicated below:
 - 1. Fabric Height: As indicated on Drawings
 - 2. Steel Wire Fabric: Wire diameter of 0.192 inch.
 - a. Mesh Size: 2 inches.
 - b. Zinc-Coated Fabric: ASTM A 392, Type II, Class 1, 1.2 oz./sq. ft. with zinc coating applied before weaving.
 - c. Polymer-Coated Fabric: ASTM F 668, Class <1; over zinc coated steel wire.
 - 1) Color: As selected by Owner from manufacturer's full range>>.
 - d. Coat selvage ends of fabric that is metallic coated before the weaving process with manufacturer's standard clear protective coating.

2.2 FENCE FRAMING

- A. Post and Rails: Comply with ASTM F 1043 for framing, including rails, braces, and line; terminal; and corner posts. Provide members with minimum dimensions and wall thickness according to ASTM F 1043 or ASTM F 1083 based on the following:
1. Fence Height: As indicated on Drawings
 2. Horizontal Framework Members: Intermediate rails complying with ASTM F 1043.
 3. Metallic coating for steel framing: Type A, consisting of not less than minimum 2.0-oz./sq. ft. average zinc coating per ASTM A 123/A 123M or 4.0-oz./sq. ft. zinc coating per ASTM A 653/A 653M.

4. Polymer coating over metallic coating: Match chain-link fabric, complying with ASTM F 934.

2.3 TENSION WIRE

- A. Metallic-Coated Steel Wire: 0.177 inch diameter, marcelled tension wire complying with ASTM A 817 and ASTM A 824, with the following metallic coating:
 1. Type II, zinc coated (galvanized) by hot-dip or electrolytic process, with the coating weight matching the chain-link fabric coating weight.
- B. Polymer-Coated Steel Wire: 0.177 inch diameter, tension wire complying with ASTM F 1664 to match the coating of the chain-link fabric. Color of wire to match chain-link fabric unless otherwise noted.

2.4 SWING GATES

- A. General: Comply with ASTM F 900 for gate posts and single swing gate types. Gate leaf width as noted on the plans.
- B. Pipe and Tubing:
 1. Zinc-Coated Steel: Comply with ASTM F 1043 and ASTM F 1083; protective coating and finish to match fence framing.
- C. Frame Corner Construction: Welded or assembled with corner fittings.
- D. Extended Gate Posts and Frame Members: Extend gate posts and frame end members above top of chain-link fabric at both ends of gate frame as indicated to attach barbed wire or tape assemblies.
- E. Hardware:
 1. Hinges: 180 degree inward swing.
 2. Latches permitting operation from both sides of gate with provision for padlocking accessible from both sides of gate.
 3. Padlock and Chain: Owner furnished.
 4. Lock: Owner furnished.
- F. Pipe and Tubing:
 1. Zinc-Coated Steel: Comply with ASTM F 1043 and ASTM F 1083; protective coating and finish to match fence framing.
- G. Frame Corner Construction: Welded or assembled with corner fittings.
- H. Extended Gate Posts and Frame Members: Extend gate posts and frame end members above top of chain-link fabric at both ends of gate frame as indicated to attach barbed wire or tape assemblies.
- I. Overhead Track Assembly: Manufacturer's standard track, with overhead framing supports, bracing, and accessories, engineered to support size, weight, width, operation, and design of gate and roller assemblies.
- J. Hardware:
 1. Latches permitting operation from both sides of gate with provision for padlocking accessible from both sides of gate.
 2. Padlock and Chain: Owner furnished.
 3. Lock: Owner furnished.
 4. Hangers, roller assemblies, and stops fabricated from galvanized steel.

2.5 FITTINGS

- A. General: Comply with ASTM F 626.
- B. Post Caps: Provide for each post.
 1. Provide line post caps with loop to receive tension wire or top rail.
- C. Rail and Brace Ends: For each gate, corner, pull, and end post.
- D. Rail Fittings: Provide the following:
 1. Top Rail Sleeves: Pressed-steel or round-steel tubing not less than 6 inches long.
 2. Rail Clamps: Line and corner boulevard clamps for connecting intermediate and bottom rails in the fence line-to-line posts.
- E. Tension and Brace Bands: As required by the manufacturer.
- F. Tension Bars: Steel, length not less than 2 inches shorter than full height of chain-link fabric. Provide one bar for each gate and end post, and two for each corner and pull post, unless fabric is integrally woven into post.

- G. Truss Rod Assemblies: Steel, hot-dip galvanized after threading rod and turnbuckle or other means of adjustment.
- H. Barbed Wire Arms: Pressed steel or cast iron, with clips, slots, or other means for attaching strands of barbed wire, and means for attaching to posts; for each post unless otherwise indicated, and as follows:
 - 1. Provide line posts with arms that accommodate top rail or tension wire.
 - 2. Provide corner arms at fence corner posts, unless extended posts are indicated.
 - 3. Type I, single slanted arm.
- I. Tie Wires, Clips, and Fasteners: According to ASTM F 626.
 - 1. Standard Round Wire Ties: For attaching chain-link fabric to posts, rails, and frames. Hot-Dip Galvanized Steel: 0.106 inch diameter wire; galvanized coating thickness matching coating thickness of chain-link fence fabric.
- J. Finish: Metallic Coating for Pressed Steel or Cast Iron: Not less than 1.2 oz. /sq. ft. zinc.

2.6 PRIVACY SLATS

- A. Material: PVC, UV-light stabilized, not less than 0.006 inch thick; attached to not less than 0.0475 inch diameter, twisted galvanized wire; hedge-type lattice; sized to fit mesh specified for direction indicated.
- B. Material: Polyethylene tubular slats, not less than 0.023 inch thick, manufactured for chain-link fences from virgin polyethylene containing UV inhibitor, sized to fit mesh specified for direction indicated; with vandal-resistant fasteners and locks strips.
- C. Material: Fiber-glass-reinforced plastic, UV-light stabilized, not less than 0.06 inch thick, sized to fit mesh specified for direction indicated; with vandal-resistant fasteners and lock strips.
- D. Material: Aluminum, not less than 0.01 inch thick, sized to fit mesh specified for direction indicated.
- E. Material: Redwood, 5/16 inch thick, sized to fit mesh specified for direction indicated.
- F. Color: As selected by Owner from manufacturer's full range.

2.7 BARBED WIRE

- A. Steel Barbed Wire: Comply with ASTM A 121, for two-strand barbed wire, 0.099 inch diameter line wire with 0.080 inch diameter, four-point round barbs spaced not more than 5 inches o.c.
 - 1. Zinc Coating: Type Z, Class 3.

2.8 BARBED TAPE

- A. Wire-Reinforced Tape: ASTM F 1910; with four-point, needle-sharp barbs permanently cold clenched around a core wire.
 - 1. Core Wire: High-tensile-strength, zinc-coated steel or stainless steel.
- B. Tie Wires: Stainless steel, 0.065 inch in diameter.
- C. Fabrication: Continuous coils of barbed tape as defined in ASTM F 1379 for the following characteristics:
 - 1. Configuration: Single coil.
 - 2. Style: Helical pattern.
 - 3. Coil Diameter(s): 18 inches.
 - 4. Coil Loop Spacing(s): 12 inches or Manufacturer's standard.
 - 5. Barb Length Classification: Long, 1.2 inch barb.
 - 6. Barb Spacing: 4 inches o.c.
 - 7. Barb Set: Manufacturer's standard.

2.9 GROUT AND ANCHORING CEMENT

- A. Nonshrink, Nonmetallic Grout: Premixed, factory-packaged, nonstaining, noncorrosive, nongaseous grout complying with ASTM C 1107. Provide grout, recommended in writing by manufacturer, for exterior applications.
- B. Erosion-Resistant Anchoring Cement: Factory-packaged, nonshrink, nonstaining, hydraulic-controlled expansion cement formulation for mixing with potable water at Project site to create pourable anchoring, patching, and grouting compound. Provide formulation that is resistant to erosion from water exposure without needing protection by a sealer or waterproof coating and that is recommended in writing by manufacturer, for exterior applications.

2.10 FENCE GROUNDING

- A. Conductors: Bare, solid wire for No. 6 AWG and smaller; stranded wire for No. 4 AWG and larger.
 - 1. Material above Finished Grade: Copper
 - 2. Material on or below Finished Grade: Copper
 - 3. Bonding Jumpers: Braided copper tape, 1 inch wide, woven of No. 30 AWG bare copper wire, terminated with copper ferrules.
- B. Connectors and Grounding Rods: Comply with UL 467.
 - 1. Grounding Rods: Copper-clad steel, 5/8 by 96 inches.

PART 3 EXECUTION

3.1 EXAMINATION

- A. Examine areas and conditions, with Installer present, for compliance with requirements for site clearing, earthwork, pavement work, and other conditions affecting performance of the Work.
 - 1. Do not begin installation before final grading is completed unless otherwise permitted by Engineer.
- B. Proceed with installation only after unsatisfactory conditions have been corrected.

3.2 PREPARATION

- A. Stake locations of fence lines, gates, and terminal posts. Do not exceed intervals of 500 feet or line of sight between stakes. Indicate locations of utilities, lawn sprinkler system, underground structures, benchmarks, and property monuments.

3.3 INSTALLATION, GENERAL

- A. Install chain-link fencing to comply with ASTM F 567 and more stringent requirements indicated and as indicated in the Drawings.

3.4 CHAIN LINK FENCE INSTALLATION

- A. Post Excavation: Drill or hand-excavate holes for posts to diameters and spacings indicated, in firm, undisturbed soil.
- B. Post Setting: Set posts in concrete at indicated spacing into firm, undisturbed soil.
 - 1. Verify that posts are set plumb, aligned, and at correct height and spacing, and hold in position during setting with concrete or mechanical devices.
 - 2. Concrete Fill: Place concrete around posts to dimensions indicated and vibrate or tamp for consolidation. Protect aboveground portion of posts from concrete splatter.
 - a. Exposed Concrete: Extend 2 inches above grade; shape and smooth to shed water.
 - b. Concealed Concrete: Top 2 inches below grade as indicated on Drawings to allow covering with surface material.
 - c. Posts Set into Concrete in Sleeves: Use steel pipe sleeves preset and anchored into concrete for installing posts. After posts have been inserted into sleeves, fill annular space between post and sleeve with non-shrink, nonmetallic grout or anchoring cement, mixed and placed to comply with anchoring material manufacturer's written instructions, and finished sloped to drain water away from post.
 - d. Posts Set into Voids in Concrete: Form or core drill holes not less than 5 inches deep and 3/4 inch between post and concrete with non-shrink, nonmetallic grout or anchoring cement, mixed and placed to comply with anchoring material manufacturer's written instructions, and finished sloped to drain water away from post.
- 3. Mechanically Driven Posts: Drive into soil to depth of 30 inches.

- Protect post top to prevent distortion.
- C. Terminal Posts: Locate terminal end, corner, and gate posts per ASTM F 567 and terminal pull posts at changes in horizontal or vertical alignment of 15 degrees or more unless indicated otherwise on Drawings.
 - D. Line Posts: Space line posts uniformly at 8 feet o.c.
 - E. Post Bracing and Intermediate Rails: Install according to ASTM F 567, maintaining plumb position and alignment of fencing. Diagonally brace terminal posts to adjacent line posts with truss rods and turnbuckles. Install braces at end and gate posts and at both sides of corner and pull posts.
 - 1. Locate horizontal braces at mid-height of fabric 72 inches or higher, on fences with top rail and at two-third fabric height on fences without top rail. Install so posts are plumb when diagonal rod is under proper tension.
 - F. Tension Wire: Install according to ASTM F 567, maintaining plumb position and alignment of fencing. Pull wire taut, without sags. Fasten fabric to tension wire with 0.120 inch diameter hog rings of same material and finish as fabric wire, spaced a maximum of 24 inches o.c. Install tension wire in locations indicated before stretching fabric. Provide horizontal tension wire at the following locations:
 - 1. Extended along top and bottom of fence fabric. Install top tension wire through post cap loops. Install bottom tension wire within 6 inches of bottom of fabric and tie to each post with not less than same diameter and type of wire.
 - 2. Extended along top of barbed wire arms; or extended posts and top of fence fabric for supporting barbed tape.
 - 3. As indicated on Drawings.
 - G. Top Rail: Install according to ASTM F 567, maintaining plumb position and alignment of fencing. Run rail continuously through line post caps, bending to radius for curved runs and terminating into rail end attached to posts or post caps fabricated to receive rail at terminal posts. Provide expansion couplings as recommended in writing by fencing manufacturer.
 - H. Intermediate and Bottom Rails: Install and secure to posts with fittings.
 - I. Chain-Link Fabric: Apply fabric to outside of enclosing framework. Leave 1 inch between finish grade or surface and bottom selvage unless otherwise indicated. Pull fabric taut and tie to posts, rails, and tension wires. Anchor to framework so fabric remains under tension after pulling force is released.
 - J. Tension or Stretcher Bars: Thread through fabric and secure to end, corner, pull, and gate posts with tension bands spaced not more than 15 inches o.c.
 - K. Tie Wires: Use wire of proper length to firmly secure fabric to line posts and rails. Attach wire at one end to chain-link fabric, wrap wire around post a minimum of 180 degrees, and attach other end to chain-link fabric per ASTM F 626. Bend ends of wire to minimize hazard to individuals and clothing.
 - 1. Maximum Spacing: Tie fabric to line posts at 12 inches o.c. and to braces at 24 inches o.c.
 - L. Fasteners: Install nuts for tension bands and carriage bolts on the side of the fence opposite the fabric side.
 - M. Privacy Slats: Install slats in direction indicated, securely locked in place. Install slats vertically.
 - N. Barbed Wire: Install barbed wire uniformly spaced angled toward security side of fence as indicated on Drawings. Pull wire taut, install securely to extension arms, and secure to end post or terminal arms.
 - O. Barbed Tape: Comply with ASTM F 1911. Install barbed tape uniformly in configurations indicated and fasten securely to prevent movement or displacement.

3.5 GATE INSTALLATION

- A. Install gates according to manufacturer's written instructions, level, plumb, and secure for full opening without interference. Attach fabric as for fencing. Attach hardware using tamper-resistant or concealed means. Install ground-set items in concrete for anchorage. Adjust hardware for smooth operation and lubricate where necessary.

3.6 GROUNDING AND BONDING

- A. Fence Grounding: Install at maximum intervals of 1500 feet except as follows:
 - 1. Fences within 100 Feet of Buildings, Structures, Walkways, and Roadways: Ground at maximum intervals of 750 feet.
 - a. Gates and Other Fence Openings: Ground fence on each side of opening.
 - 1) Bond metal gates to gate posts.

- 2) Bond across openings, with and without gates, except openings indicated as intentional fence discontinuities. Use No. 2 AWG wire and bury it at least 18 inches below finished grade.
- B. Protection at Crossings of Overhead Electrical Power Lines: Ground fence at location of crossing and at a maximum distance of 150 feet on each side of crossing.
 - C. Fences Enclosing Electrical Power Distribution Equipment: Ground as required by IEEE C2 unless otherwise indicated.
 - D. Grounding Method: At each grounding location, drive a grounding rod vertically until the top is 6 inches below finished grade. Connect rod to fence with No. 6 AWG conductor. Connect conductor to each fence component at the grounding location, including the following:
 1. Make grounding connections to each barbed wire strand with wire-to-wire connectors designed for this purpose.
 2. Make grounding connections to each barbed tape coil with connectors designed for this purpose.
 - E. Bonding Method for Gates: Connect bonding jumper between gate post and gate frame.
 - F. Connections: Make connections to minimize possibility of galvanic action or electrolysis. Select connectors, connection hardware, conductors, and connection methods so metals in direct contact will be galvanically compatible.
 1. Use electroplated or hot-tin-coated materials to ensure high conductivity and to make contact points closer in order of galvanic series.
 2. Make connections with clean, bare metal at points of contact.
 3. Make aluminum-to-steel connections with stainless-steel separators and mechanical clamps.
 4. Make aluminum-to-galvanized-steel connections with tin-plated copper jumpers and mechanical clamps.
 5. Coat and seal connections having dissimilar metals with inert material to prevent future penetration of moisture to contact surfaces.
 - G. Bonding to Lightning Protection System: If fence terminates at lightning-protected building or structure, ground the fence and bond the fence grounding conductor to lightning protection down conductor or lightning protection grounding conductor complying with NFPA 780.

3.7 ADJUSTING

- A. Gates: Adjust gates to operate smoothly, easily, and quietly, free of binding, warp, excessive deflection, distortion, nonalignment, misplacement, disruption, or malfunction, throughout entire operational range. Confirm that latches and locks engage accurately and securely without forcing or binding.
- B. Automatic Gate Operator: Energize circuits to electrical equipment and devices. Adjust operators, controls, safety devices, alarms and limit switches.
 1. Hydraulic Operator: Purge operating system, adjust pressure and fluid levels, and check for leaks.
 2. Operational Test: After electrical circuitry has been energized, start units to confirm proper motor rotation and unit operation.
 3. Test and adjust controls, alarms and safeties. Replace damaged and malfunctioning controls and equipment.
- C. Lubricate hardware, gate operators and other moving parts.

3.8 DEMONSTRATION

- A. Engage a factory-authorized service representative to train Owner's personnel to adjust, operate, and maintain chain-link fences and gates.

END OF SECTION

SECTION 329219
SEEDING

PART 1 GENERAL

1.1 SUMMARY

- A. This section governs the furnishing of all labor, equipment, tools and materials, and the performance of all work for final seeding of lawns and non-maintained vegetation areas, disturbed by construction operations, and removal of rocks, debris and other foreign matter not suitable for a seed bed.
- B. Refer to SWPPP and Land Disturbance permit for temporary seeding and other erosion control products usage in conjunction with seeding and mulching.
- C. Alternative forms of seeding and mulching, such as hydro seeding and hydro mulching, may be submitted for review.

1.2 SUBMITTALS

- A. Submit shop drawings in accordance with Section 013300.
- B. Provide a mechanically printed seed mixture tag showing percentage of seed mix, year of production, net weight, germination rate, purity, date of packaging, and location of origin.
- C. Hydro mulch material, rolled erosion control product (RECP), and other manufactured products.
- D. Fertilizer: certification of analysis from a certified fertilizer dealer, and straw to be inspected in the field prior to application.
- E. Topsoil analysis by a qualified soil-testing laboratory stating percentages of organic matter; gradation of sand, silt, and clay content; cation exchange capacity; deleterious material; pH; and mineral and plant-nutrient content.
- F. Certified soil fertility report providing nutrient and mineral analysis as a basis for fertilizer requirement.
- G. Certification of composted organics analysis with U.S. Compost Council's Seal of Testing Assurance and recommended rates of application.

PART 2 PRODUCTS

2.1 MULCH

- A. Oat, rye or wheat straw, that are reasonably free from weeds, foreign matter detrimental to plant life, and in dry condition. Supply straw mulch per SUDAS.
- B. Hydromulch shall consist of fiber mulch. Fiber mulch shall be derived from wood chips or recycled paper products. The mulch shall be free of chemicals and growth inhibitors. Mulch shall contain a green dye to assist in metering a uniform application. Supply mulch for hydraulic seeding per SUDAS.
- C. Tackifier (soil binder) shall be a physllium based, organic compound derived from natural plant sources. Binder shall consist of an active hydrophilic colloid, which will hydrate with water and, upon drying after application, will tack hydrospray mix to soil surface. Binder shall be nontoxic and contain no growth or germination inhibitors. Supply tackifier per SUDAS.
- D. Sticking Agent and Inoculant for Legumes per SUDAS.

2.2 MANUFACTURED BMP PRODUCTS

- A. Rolled Erosion Control Product (RECP) may be used for temporary erosion control to hold seed until the newly seeded area is stabilized. The RECP shall be 100% agricultural straw stitched with degradable thread to a single UV accelerated photodegradable polypropylene netting, similar to North American Green S-75 on embankments and DS-75 in lawn areas.

- B. Other forms of RECP may be proposed, such as Bonded Fiber Matrix (BFM) and Turf Reinforcement Mat (TRM).

2.3 FERTILIZER

- A. A commercial granular fertilizer, grade 13-13-13 total nitrogen (N), available phosphoric acid (P205), and soluble potash (K20), delivered in sealed bags and bearing the manufacturer’s “Guaranteed Statement of Analysis.” Apply at rate determined by soil fertility analysis submittal.

2.4 GRASS SEED

- A. Deliver to site in original containers showing analysis of seed mixture, percentage of pure live seed (% germination and % purity), year of production, net weight, date of packaging, and location of origin.
- B. Seed mix per SUDAS Seed Mixtures.

2.5 TOPSOIL

- A. Topsoil furnished by the CONTRACTOR shall consist of a natural friable surface soil without admixtures of undesirable subsoil, refuse, or foreign materials. It shall be reasonably free from roots, hard clay, and coarse gravel, stones larger than one inch in any dimension, noxious weeds, grass, brush, sticks, stubble or other material which would be detrimental to the proper development of vegetative growth.
- B. Topsoil shall contain not less than 3%, or more than 15% organic matter, by weight as determined by loss-on-ignition of oven-dried samples in accordance with ASTM T-6. Organic material shall be decomposed and free of wood.
- C. Topsoil consists of loam, sandy loam, silt loam, silty clay loam, or clay loam humus-bearing soils adapted to sustain plant life, and ensure this topsoil is in a pH range of 6.0 to 8.0.

Soil Classification	Minimum	Maximum
Clay	5%	30%
Silt	10%	70%
Sand & Gravel	10%	70%
Organic Matter	3%	20%
pH	6.1	7.8

- 1. Topsoil shall conform to the following gradation.

Sieve Size	Percentage Passing
1 inch	100%
1/2 inch	95%-97%
No. 4	40%-60%
No. 10	40%-60%
No. 200	10%-30%

PART 3 EXECUTION

3.1 TEMPORARY SEEDING

- A. Provide temporary seeding in areas prone to erosion and sediment transport.
- B. Install RECP in areas that are steeper than 6 (horiz): 1 (vert) according to manufacturer’s recommended method.
- C. Temporary Seed Mix: Apply the following temporary grass seed mix at the specified rate per acre.
 - 1.
 - a. Spring Planting

Location	Species	Pounds per Acre
Established Lawns	Oat or Rye	60
Non-Lawn Areas	Oat, Rye or Red Clover	60

- b. Fall Planting

Location	Species	Pounds per Acre
Established Lawns	Winter Wheat/Rye	60
Non-Lawn Areas	Winter Wheat/Winter Rye	60

2. Fertilizing
 - a. Apply fertilizer at a rate of 150 pounds per acre.
3. Reseeding
 - a. Reseed areas within 30 days of initial seeding where no stand of grass has occurred.

3.2 FINAL SEEDING

A. GENERAL

1. Planting Season: August 15 - November 1 and April 1 - June 1.
2. Mulched on the same day.
3. Proceed with planting only when existing and forecasted weather conditions permit. Do not sow immediately following rain, when ground is too dry, or during windy periods.
4. Areas to be seeded as a dormant seeding must be protected from erosion over winter by mulching.

B. SURFACE PREPARATION

1. Scarify subsoil to a depth of 6 inches by means of blading, chisel plowing, discing, rock picking, harrowing or any other operation necessary to return the ground surface as nearly as practical to its original condition. Remove foreign materials, plants, roots, stones one inch and larger, and debris from the disturbed area. Add suitable material to areas that settled excessively. Spread six inches of topsoil over the area. Rake until the surface is smooth and level with the surrounding ground.
2. Topsoil: see 2.05.
3. Seedbed preparation, seed preparation, seed application, and seed mulching per SUDAS.

3.3 FERTILIZING

- A. Apply fertilizer at a rate of 300 pounds per acre. Work the fertilizer into the topsoil.
- B. Apply after smooth raking of topsoil and prior to roller compaction.
- C. Mix thoroughly into topsoil.
- D. lightly water to aid the dissipation of fertilizer.
- E. If seeding with the drilling method, include a fertilizer attachment on the drill which allows the placement of fertilizer in a band on or near the drill row.
- F. If seeding by means of a hydraulic seeder, include the required amount of fertilizer to be mixed with the seed, cellulose fiber mulch and water and applied in the seeding operation.

3.4 PERMANENT SEEDING

- A. Apply seed evenly in two intersecting directions using mechanical power drills or seeders.
- B. Roll seeded area with cultipacker type roller at right angle to slopes not exceeding 112 lbs.
- C. Apply the following permanent grass seed mix at the specified rate.

Species	PLS Pounds/Acre
Western Wheatgrass (Rodan or Rosana)	2
Slender Wheatgrass (Revenue or Primar)	1
Green Needlegrass (Lodorm)	2
Blue Grama (northern seed source)	2
Sideoats Grama (Killdeer)	8
Switchgrass (Dakota)	3
Little Bluestem (Blaze or Camper)	5
Total	23

*PLS-Pure Live Seed (% germination times % purity)

1. For sandier sites, add 2 lb PLS per acre Prane Sandreed, and 3 lb PLS per acre Sand Bluestem.
2. For low wet areas and drainage ways, add 4 lb PLS per acre Big Bluestem.
3. Apply the selected seed mix per SUDAS.

D. Grass Seed Mix:

Species	% of Mix	PLS per Acre
K31 Fescue	80	340
Perennial Rye	20	60
Total	100	300

3.5 SEEDING BY DRILLING

- A. The specified seed or seed mixture shall be drilled in uniformly using a grass drill equipped with individually mounted adjustable spring loaded, double-disk furrow openers fitted with depth control bands and packer wheels.
- B. The depth of control bands shall be of a size to provide final planting of not more than the optimum depth.
- C. Packer wheels shall have adjustable spring tension and be mounted individually on each furrow opener or be mounted independently with a press wheel situated to follow directly behind each opener

3.6 MULCHING

- A. Immediately following seeding and compacting, apply mulch to a thickness of not less than 1/8 inches (approximately 2 tons per acre). Approximately ten (10) percent of the soil surface shall be visible through the mulch blanket prior to mulch tiller (punching) operation. Maintain clearance from shrubs and trees.
- B. The mulching material shall be punched into the soil so that it is partially covered. The punching operation shall be performed longitudinally with a mulch tiller consisting of a series of dull, flat disks with notched or cutout edges. The disks shall be approximately 20 inches in diameter and 1/4-inch thick, shall be spaced approximately 8-inches apart, and shall be fitted with scrapers. The working width of the tiller shall not exceed six (6) feet per member, but may be operated in gangs of not over 3 members each (18 feet total width).
- C. Care shall be exercised to obtain a reasonably even distribution of mulch partially incorporated into the soil. It may be necessary to use weights or hydraulic pressure to insure that the mulch is punched into the soil adequately.
- D. On slopes too steep for disking, the mulching shall be "patted" with forks as it is placed on the slopes. Soil from the top of slope areas shall be placed by hand methods on the mulching material to reduce loss due to wind. Non-friable soil should be placed over the upper 1/3 of slopes and should average approximately one cubic foot of soil to each 25 square feet of area.
- E. When mulch is applied with a straw blower, it may be necessary to remove cutting knives to prevent cutting mulch too short.
- F. The Contractor shall arrange his work so that the mulch can be placed and punched immediately after each slope area is seeded. Mulching operations shall not lag behind seeding operations more than 24 hours during clear weather. When rain is threatening, the Contractor shall make every effort to mulch areas the same day as seeded. Mulch shall be replaced before seeds germinate when re-mulching wind or rain damaged areas.
- G. Apply potable water with a fine spray immediately after each area has been mulched

3.7 HYDROSEEDING

- A. Contractor may propose hydroseeding upon approval of the Engineer and Owner. Contractor shall submit a hydroseeding plan and product data.
- B. The hydrospray shall be applied in the form of a slurry consisting of cellulose fiber, seed, stabilizer additives, tackifier, commercial fertilizer, and water. When hydraulically sprayed on the soil surface, the mix shall form a blotter-like ground cover impregnated uniformly with seed and fertilizer and shall allow moisture to percolate to the underlying soil.

- C. Prior to hydroseeding, the site shall be measured and staked to identify the areas to be sprayed by each truckload of mix.
- D. Hydraulic equipment used for the application of the slurry shall be a 1500-gallon capacity agitator-mixer. This equipment shall have a built-in agitation system and operating capacity sufficient to agitate, suspend and homogeneously mix a slurry containing not less than 40 pounds of fiber mulch, plus a combined total of 15 pounds of fertilizer solids for each 100 gallons of water or per the submitted soil fertility analysis, whichever is less.
- E. The slurry distribution hose lines shall be large enough to prevent stoppage and shall be equipped with a set of hydraulic spray nozzles which will provide a continuous non-fluctuating discharge. Slurry tank shall be mounted on a traveling unit.
- F. Seeding rate to be hydroseeded shall be increased by 50 percent,
- G. Hydroseed Slurry Mix

PRODUCT	APPLICATION RATE (pound per acre)
Seed Mix	150% of grass seeding rate
Fiber Mulch	2000
Slow-Release Fertilizer: Up to this amount per soil fertility test.	
20-10-5	200
0-18-0 Single Super-Phosphate	150
Argricultural Gypsum	500
Soil Sulfur	100
Soil Binder	100

3.8 HYDROMULCHING

- A. Hydromulching application shall be similar to hydroseeding as far as equipment and procedures.
- B. Hydromulch slurry mix shall be as follows:
 - 1. Fiber Mulch: 200 lbs/acre.
 - 2. Soil Binder: 50 lbs/acre. Mix soil binder at the rate of 30 pounds of concentrate mixed with 1,500 gallons of water.

3.9 MAINTENANCE

- A. Reseed damaged grass areas showing root growth failure, deterioration, bare or thin spots and eroded areas.
- B. Contractor shall be responsible for controlling the growth of weeds in areas disturbed during construction until all seeding work has been completed.
- C. The Contractor shall re-landscape and properly reseed all areas damaged by their operations. Trenches which have settled within the warranty period, and which were previously seeded, shall be reshaped and reseeded by the Contractor at the Contractor's expense.

END OF SECTION

THIS PAGE INTENTIONALLY LEFT BLANK.

SECTION 330516
PRECAST CONCRETE UTILITY STRUCTURES

PART 1 GENERAL

1.1 SUMMARY

- A. This section includes design, materials, testing, and installation of precast concrete tanks, manholes and vaults.

1.2 SUBMITTALS

- A. Submit shop drawings in accordance with Section 013300.
- B. Submit manufacturer's catalog data on precast concrete tanks, manholes, steps and ladders, frames and covers. Show dimensions and materials of construction by ASTM reference and grade. Show lettering on manhole covers.
- C. Provide structural design calculations sealed by a registered engineer in the State of Louisiana, as required for the project.
- D. Show on shop drawings for each structure all proposed pipe size openings at the proposed elevation and orientation of penetrations.
- E. Provide product data for waterproof material, steps, ladders, and all items identified in Part 2.
- F. The date of manufacture and name of manufacturer shall be marked inside each precast section.

1.3 LOADING

- A. All structures with top elevations near grade shall be designed for H-20 traffic loading. Access openings located in driving surfaces shall be designed for H-20 traffic loading. Access openings for vaults that are elevated above the surrounding surface and located in non-driving surfaces shall be designed for 300 pounds per square foot loading, unless otherwise indicated.
- B. Soil lateral loads shall be as determined by ASTM C857 or loadings specified in the project soils report, whichever is greater. Alternate design by the strength design method shall include a load factor of 1.7 times the lateral earth or hydrostatic pressures.
- C. Include the following load conditions in the design:
 - 1. Structure roof removed while structure is backfilled to grade and subject to live and dead loads.
 - 2. Structure roof in place and walls subject to simultaneous vertical and horizontal application of all live, impact, and dead loads. Include the case of an H-20 designated load placed directly above the wall.

PART 2 PRODUCTS

2.1 PRECAST CIRCULAR CONCRETE MANHOLES

- A. Precast manholes and circular wet wells shall conform to the requirements of ASTM Designation C 478 with reinforcement of Grade 60 bars and the following modifications thereto.
- B. The minimum shell thickness shall be 5-inches for 4 feet diameter manholes, 6-inches for 5 feet diameter manholes and 7-inches for 6 feet diameter manholes. All interior and exterior surfaces shall have smooth surfaces free of surface voids. Precast structures with textured or rough surfaces will not be accepted.
- C. Joints shall be a compression type, neoprene gasket joint meeting ASTM C923. The unfilled portion of the joint shall be filled with preformed plastic joint sealing compound that conforms to Federal Specification SS-S-0021 0.
- D. Concrete adjusting rings (4-inch maximum) shall be standard manufactured product of the precast manhole manufacturer and conform to the requirements of ASTM C 478. All grade rings shall have integral key.
- E. Minimum allowable steel shall be hoops of No. 4 wire cast into each unit.
- F. Precast top sections shall be eccentric cone; concentric cone; or flat slab, except where shown otherwise in the drawings.

2.2 PRECAST RECTANGULAR CONCRETE TANKS AND MANHOLES

- A. Precast rectangular concrete manholes shall comply with ASTM C858 except as modified herein. Minimum size shall be 60 inches square. Design manholes for the depths shown in the drawings, assuming a soil density of 130 pounds per cubic foot.
- B. Minimum wall thickness shall be 6 inches unless otherwise noted in plans. Design knockout wall panels to accommodate loading pressures.
- C. Precast top sections shall be flat slab, except where shown otherwise in the drawings.

2.3 PRECAST CONCRETE VAULTS

- A. Precast concrete vaults shall comply with ASTM C858 except as modified herein.
- B. Design shall comply with the following restrictions:
 - 1. The maximum reinforcement ratio allowed is one-half the reinforcement ratio that would produce a balanced strain condition.
 - 2. Earth pressure shall be converted to a horizontal pressure using a coefficient of earth pressure at rest of 0.5 and not a coefficient of active earth pressure.
 - 3. Include a live load surcharge of 3 feet of soil in the design of the walls.
- C. Precast vault construction shall be in the form of monolithic walls or horizontal wall sections; do not use panel walls.
- D. Minimum wall thickness shall be 6 inches. Design knockout wall panels to accommodate loading pressures defined above.
- E. Floor slab shall be cast-in-place concrete as shown in the drawings. Calculations for the floor slab design shall be included in the vault design submittal.
- F. Provide aluminum ladders as indicated.
- G. Vaults shall have concrete covers with lifting handles. Access openings shall be provided by 1) a minimum 30" diameter galvanized steel lids, which are bolted to galvanized steel frames with stainless steel bolts, 2) manhole ring and frames or 3) access hatches, as shown on the Plan details. The galvanized frames and lids shall be provided by the vault manufacturer. Manhole covers and access hatches may be supplied by others provided the required clearances, dimensions and installation requirements are coordinated between both suppliers. When leveling bolts are used to set the vault top sections, the Contractor shall ensure that the load on the vault will be transferred through the mortar to the vault and will not be carried by the leveling bolts.

2.4 INSERTS

- A. Handling eyes, lifting inserts, and threaded inserts shall be galvanized steel. Design load capacity shall be 2,000 pounds unless shown otherwise in the drawings.
- B. No more than 3 lift holes may be cast or drilled in each section.

2.5 STEPS AND RUNGS

- A. Cast structure with steps (ladder rungs). Steps shall be 1/2-inch minimum diameter steel reinforced bar with a copolymer polypropylene plastic covering (per ASTM D4101) resistant to 1,500 pounds pullout force, conform to ASTM C-478 and OSHA standards, and allow hand-driven installation into precast manholes. The tread shall be at least 3/4 inch wide.
- B. Minimum clear length of rungs shall be 14 inches. Space rungs vertically at 16 inches on center, set between 5 and 6 inches from the face of the concrete, and align with each other in a straight vertical line (both parallel and perpendicular to ladder rungs).

2.6 ALUMINUM LADDER

- A. General
 - 1. Aluminum Ladders shall comply with ANSI A14.3.
 - 2. Design of the ladder and attachment to concrete to be provided during the manufacture. Do not connect any aluminum product directly to the concrete unless coated to prevent reaction.

3. The distance between rungs shall not exceed 12 inches and shall be uniform throughout the length of the ladder. The minimum clear length of rungs shall be 14 inches. The rungs shall have a nonskid coating.
 4. Side rails: Continuous extruded-aluminum channels or tubes, not less than 2-1/2 inches deep, 3/4 inch wide, and 1/8 inch thick.
 5. Rungs: Extruded-aluminum tubes, not less than 3/4 inch deep and not less than 1/8 inch thick, with ribbed tread surfaces.
 6. Fit rungs in centerline of side rails; fasten by welding or with stainless-steel fasteners or brackets and aluminum rivets.
 7. ANSI A14.3 requires a minimum support spacing is 10 feet (3 m).
 8. Support ladder at top and bottom and not more than 60 inches o.c. with welded or bolted aluminum brackets.
- B. Approved manufacturers are ACL Industries, Inc., Alco-Lite Industrial Products, Halliday Products, Precision Ladders, LLC., or equal.

2.7 MANHOLE FRAMES AND COVERS

- A. Manhole frames and covers shall be made of cast iron conforming to ASTM A48, Class 35B. Castings shall be smooth, clean, and free from blisters, blowholes, and shrinkage. Frames and covers shall be designed for H20-44 traffic loads. The cover shall seat firmly into the frame without rocking.
- B. Manhole ring and cover shall be:
1. Neenah No. R-1769-A, Deeter No. 1048, Clay & Bailey No. 2032M or approved equal (minimum wt. of cover 150 lbs., and ring 250 lbs.).
 2. Watertight manhole ring and cover shall be Neenah No. R1916-F with anchor bolt holes or approved equal, minimum total weight of 450 lbs.
 3. Manhole ring and cover for Type II manholes shall be slab type, Neenah No. R6065 for 6' deep and 6065A for 8" deep, Deeter No. 1180 for 6" deep or approved equal. Provide stainless steel bolts and fasteners.
- C. Grind or otherwise finish each cover so that it will fit in its frame without rocking. Frames and covers shall be match-marked in sets before shipping to the site.
- D. Manhole covers shall be designated as "Sanitary Sewer"; or "Storm Sewer" and shall be cast in 2-1/2" high block letters flush with the traffic surface on all manhole covers as appropriate for the individual manhole's use.
- E. Coat castings with an asphalt coating complying with ASTM A849, Class A, to a minimum thickness of 50 mils.
- F. Provide insulated cover, consisting of the materials stipulated on the drawings.

2.8 ACCESS HATCHES

- A. Provide single leaf access hatch with clear openings as indicated. Hatch to be W2R by Halliday or equal unless otherwise shown.
- B. The hatch shall be furnished with locking lugs to receive a padlock and recessed lifting handles.
- C. All aluminum in contact with concrete, mortar, steel, or stainless steel shall be protected from direct contact through the use of bituminous coating or some other Engineer approved means.
- D. The hatch shall be provided with 316 stainless steel hardware throughout.
- E. The hatch shall be cast into the top slab

2.9 CONCRETE

- A. Cement for manholes shall conform to ASTM C150, Type II, 4000 psi compressive strength.

2.10 NON-SHRINK GROUT

- A. Nonshrink grout shall be a prepackaged, inorganic, non-gas liberating, nonmetallic, nonstaining, cement-based grout requiring only the addition of water. Manufacturer's instructions shall be printed on each bag or other container in which the materials are packaged. The specific formulation for each class of nonshrink grout specified herein shall be that recommended by the manufacturer for the particular application.
- B. Nonshrink grouts shall have a minimum 28 day compressive strength of 5000 psi, shall have no shrinkage (0.0 percent) and a maximum 4.0 percent expansion in the plastic state when tested in accordance with ASTM C 827, and shall have no shrinkage (0.0 percent) and a maximum of 0.2 percent expansion in the hardened state when tested in accordance with CRD C 621.
- C. Non-shrink grout shall be Cormix "Supreme", L&M "Crystex", Master Builders "Masterflow 713 Grout" or "Set Grout", Sauereisen Cements "F-100 Level Fill Grout", UPCO "Upcon Super Flow", or Five Star Products Inc. "Five Star Grout", without exception.
- D. The grout consistency shall be that necessary to completely fill the space to be grouted for the particular application. Dry pack consistency is such that the grout is plastic and moldable but will not flow. Where "dry pack" is called for in the Contract Documents, it shall mean a grout of the above described consistency; the type of grout to be used shall be as specified herein for the particular application.
- E. Prepackaged grouts shall have ingredients measured by means recommended by the manufacturer.

2.11 SEALING COMPOUND AND MORTAR

- A. Butyl rubber sealing compound shall comply with ASTM C990. Mortar shall comply with ASTM C387, Type S.
- B. All grout used for sealing around pipe openings shall be as specified and designed for use in water. All openings and joints shall be sealed watertight.
- C. Joint sealant shall be approved preformed mastic sealant. Sealant shall conform to the requirements of AASHTO M198 and shall be Kent seal or Ram Neck or pre-approved by the Engineer. Where specifically indicated, trowelable mastic sealant shall be a butyl rubber sealant, Trowelable EZ-Stik #3 as manufactured by Press-Seal Gasket Corporation or approved equal. Use Conseal CS 440 for fuel and oil resistant applications.

2.12 PIPE CONNECTORS

- A. Flexible resilient watertight manhole and pipe connector shall meet all material and performance requirements of ASTM C923 for pipe outside diameter 4" through 60". Gasket material shall be produced from a polyisoprene blend compound or chemically resistant neoprene EPDM flexible boot. Natural rubber gaskets will not be acceptable.
- B. Manhole to pipe connectors shall be cast into the manhole wall during the manufacturing process.
- C. Approved pipe connectors are:
 - 1. A-Lok X-CEL as manufactured by A-Lok Products, Inc.
 - 2. Z-Lok-XP (A-Lok Products, Inc.).
 - 3. Kor-N-Seal (Dukor Corporation),
 - 4. Storm sewer pipe connections shall be Quik-Lok or Z-Lok STM (A-Lok Products) or equal.
- D. Approved pipe connectors for existing concrete structures installed in the field shall be:
 - 1. G3 Boot System as manufactured by A-Lok Products, Inc.,
 - 2. LCT Manhole Adapter Gasket as manufactured by Romac Industries, Inc.
- E. Approved pipe connectors for existing brick structures and rigid connections installed in the field shall be CMA Concrete Manhole Adapter as manufactured by Fernco.
- F. New PVC pipe to existing VCP pipe connectors shall be a flexible coupling with stainless steel band clamps, as required and approved by the Engineer. Connectors shall be manufactured by Fernco Joint Sealer Co. or approved equal.

2.13 COATINGS

- A. Waterproofing. The interior and exterior walls of all sanitary manholes shall be given two coats, each 12-15 mils dry film thickness, of Uniseal 1600, as manufactured by Anchor Tite or approved equal.
- B. PVC Liner. Where indicated, the entire interior surface of all sanitary manholes shall be lined with a PVC sheet liner system equal to Ameron T-Lock liner as manufactured by Ameron Protective Linings Division, Brea, California, or approved equal. The liner shall be installed and tested in strict conformance with the manufacturers recommendations and field welded by Ameron certified technicians, no exceptions. The exterior of all manholes shall be painted with two 12-15 mils DFT coats of Uniseal 1600, as manufactured by Anchor Tite.

PART 3 EXECUTION

3.1 MANHOLE BASE

- A. Excavate for the manhole and install a base of 8 inches thick washed crushed rock (3/4" max.), or as shown on the Plan details. Crushed rock base material shall extend 1 foot beyond the outside edge of the concrete manhole base.
- B. Form and pour concrete bases as one monolithic pour. For sewer manholes, form the portion above the invert elevation of the sewer pipe to provide a smooth channel section. Channels shall vary uniformly in size and shape from inlet to outlet.

3.2 INSTALLATION

- A. Set each precast concrete manhole unit plumb on a bed of sealant or mortar to make a watertight joint at least 1/2 inch thick with the concrete base or with the preceding unit. Point the inside joint and wipe off the excess sealant or mortar. Secure the manhole frame to the grade ring with grout and cement mortar fillet. Backfill, compact, and replace pavement.
- B. When working inside manholes, Contractor shall exercise caution and comply with OSHA requirements when working in the presence of sewer gases, combustible oxygen-deficient atmospheres, and confined spaces.
- C. Handle with care to avoid damage to joint ends of each section. Damaged sections may be subject to rejection at the discretion of the Engineer. All manhole and vault construction shall be watertight. The invert, walls and steps shall be cleaned of excess grout and laitance.
- D. Floors of the manholes shall be shaped and smoothed so that flow channels will be formed such that the manhole will be self-cleaning and free of areas where solids may be deposited. The floors shall have a slope of one (1) inch per foot on areas outside of the flow channels.
- E. Connection to existing sewer mains shall be done in an approved manner. Cutting into existing sewer shall be done in such a manner as to prevent damage to sewer not being removed. New invert channel(s) shall be constructed as required and in accordance with the requirements herein and as shown on the Drawings.
- F. Connections to manufactured, precast items shall be made by casting sections of pipe into the items, using non-shrink grout as shown on the Drawings, and/or using an acceptable resilient connector.
- G. Precast Sections: Precast-reinforced concrete sections shall be set so as to be vertical and with sections in true alignment.
- H. All holes in sections, used for their handling, shall be thoroughly plugged with mortar. The mortar shall be 1 part cement to 1-1/2 parts sand; mixed slightly damp to the touch (just short of "balling"); hammered into the holes until it is dense and an excess of paste appears on the surface; and then finished smooth and flush with the adjoining surfaces.
- I. Upon installation the exterior of all structures shall be given an asphaltic waterproofing. The exterior surfaces of precast and poured-in-place manholes shall be coated with two heavy coats of a water-based asphaltic coating. Application and curing shall be in accordance with the manufacturer's specifications and instructions. Coating shall be fully dried before backfilling.
- J. Manhole Castings shall be set on a full mortar bed or sealed with a troweled-on butyl rubber mastic sealant, Press-Seal Gasket Corporation Trowelable EZ-Stik #3 or equal. Do not backfill around the

manhole casting for a minimum of 20 minutes to allow the grout to set.

- K. In situations where the exterior walls of the manhole will be exposed to weather or where bolt down covers are required, the manhole casting shall be bolted to the precast cone section or flat slab top using 3/4" diameter stainless steel threaded rod, nuts and washers epoxy anchored into the concrete.
- L. Castings and frames shall be set true to line and to correct elevations.
- M. Assemble units so that the cover conforms to the elevation determined by the manhole location as follows:
 - 1. In Paved Areas: Top of cover shall be flush with the paving surface.
 - 2. In Shoulder Areas: Top of cover shall be flush with existing surface where it is in traveled way of shoulder and 0.1 foot above existing surface where outside limits of traveled way but not in the existing roadside ditch.
 - 3. In Roadside Ditch or Unpaved Open Areas: Top of cover shall be 18 inches above the ground surface.
- N. MORTAR
 - 1. All mortar shall be used within 40 minutes after mixing. Mortar which has begun to take on initial set shall be discarded and shall not be mixed with additional cement or new mortar.

3.3 INVERTS

- A. Manhole inverts shall be constructed of concrete with Type II cement and shall have a minimum 28-day compressive strength of 4000 psi.
- B. In no case shall the invert section through a manhole be greater than that of the outgoing pipe. The shape of the invert shall conform exactly to the lower half of the pipe it connects. Side branches shall be connected with as large of a radius of curve as practicable. All inverts shall be troweled to a smooth clean surface. Slope bench 1-inch per foot minimum to avoid solids build-up.
- C. Where the difference in elevation between the incoming sewer line and the manhole invert is less than twenty-four inches (24"), the invert shall be filleted to prevent solids deposition.

3.4 CONNECTION TO MANHOLES

- A. Connections to new manholes shall utilize flexible connections. Flexible connections allow for limited differential settlement to occur between the pipe and manhole. The uniform compaction of the bedding material under the pipe and up to the spring line or top of the pipe as detailed is essential to the control of this differential settlement. Resilient connectors shall be used with all flexible connections. A flexible preformed mastic sealant shall be installed around the bottom half of the exterior pipe surface between the resilient connector and the invert. This flexible sealant shall be installed to separate the pipe from the invert to maintain the flexibility of the pipe/manhole connection. Pipes installed with flexible connections shall not have concrete encasement at the outside of the manhole.
- B. Connection to Existing Structures shall be done in such a manner as to prevent damage to existing structures. Hole for installation of pipe shall be approximately 4 inches larger in diameter than the outside diameter of the pipe to be installed. Annular space around the pipe or resilient connector, as required, shall be filled solid with non-shrink grout. New invert channels shall be constructed as required and shall conform to the requirements herein. For installing a new manhole on an existing pipe, a clamp-on resilient connector shall be installed on the pipe prior to grouting into the manhole wall.

3.5 STUB LINES

- A. Stub lines for future connections shall be provided in manholes at the locations indicated on the drawings and shall terminate in a bell and plug.

3.6 CLEANING AND TESTING

- A. After all installations are complete, including all backfill and compaction, all structures and appurtenances shall be cleaned of foreign materials. Flushing of foreign materials from a newly completed section of sewer into section already in service will not be allowed. If the lining or coating system is damaged during either installation or cleaning it shall be repaired in strict accordance with and approved by the coating system manufacturer's technical field service personnel.
- B. Contractor shall furnish all labor, tools, potable water (if a hydrostatic test is allowed) and equipment necessary to perform all tests as specified herein.

- C. If inspection or test shows defects, such defective work or material shall be replaced and inspection and tests repeated. Repairs to piping and appurtenances shall be made with new material at no additional cost to the Owner.
- D. Manholes structure shall be either vacuum or hydrostatically tested. Vacuum or hydrostatic testing is recommended prior to backfilling, where feasible, to assist in locating leaks. The final test and acceptance shall be based only on a test after the manhole is backfilled and the cast manhole ring is in place. Existing manholes where new connections are made will not be required to be vacuum or hydrostatically tested. These manholes shall be visually inspected for water tightness with any leakage noted and corrected prior to manhole acceptance.
- E. Testing Methods
 - 1. Vacuum Test - Plug all manhole entrances and exits other than the manhole top access using suitably sized and rated pneumatic or mechanical pipeline plugs. Follow manufacturer's recommendations and warnings for proper and safe installation of such plugs, taking care to securely brace the plugs and the pipe. Attach the vacuum test device to the cast manhole ring and draw a vacuum to 10" of mercury. With the valve at the vacuum line connection closed and the vacuum pump off, measure the time required for the vacuum to drop to 9" of mercury. The manhole passes the test if the time is greater than 60 seconds for a 48" diameter manhole, 75 seconds for a 60" diameter manhole, and 90 seconds for a 72" diameter manhole. If the manhole fails the test, the Contractor shall locate the leak and make proper repairs with non-shrink grout. The manhole shall be retested until acceptable test results are obtained.
 - 2. Hydrostatic Test - Manholes may be tested using internal or external hydrostatic pressure with prior approval by the Engineer. External hydrostatic testing shall only be used where the groundwater level is at least 4 feet above the invert of the manhole. In all other cases, the internal hydrostatic test procedures must be followed. Sewers connected to the manhole shall be adequately plugged. For the internal hydrostatic test, the manhole shall be filled with water to the top or to a maximum depth of 25-feet above the invert. Water gain or loss shall not exceed 1.14 gallons per day per vertical foot of manhole for either external or internal hydrostatic testing. Infiltration and exfiltration shall be determined after 24 hours of hydrostatic testing by determining the gain or loss of water in the manhole. Contractor shall be responsible for retrieving any plugs or material accidentally washed down a sewer.

END OF SECTION

THIS PAGE INTENTIONALLY LEFT BLANK

SECTION 333100
SANITARY SEWER SYSTEMS

PART 1 GENERAL

1.1 SUMMARY

- A. The Contractor shall furnish all material, tools, equipment, and labor necessary for material handling, cutting, installation and jointing of various types and sizes of pipe at the locations shown on the Drawings, or as detailed and in conformance with the specifications.

1.2 COORDINATION OF WORK

- A. All work shall be fully coordinated with other work and shop drawings must be checked with each of the various trades. Conflicts in the sequence of the work shall be coordinated through consultation with the Engineer.

1.3 APPLICABLE STANDARDS

- A. Specifications of the following listed standards will be referred to hereinafter by standards abbreviation and specification number which shall include the latest revision thereof.
 - 1. ANSI, American National Standards Institute.
 - 2. ASTM, American Society for Testing and Materials.
 - 3. AWWA, American Water Works Association.
 - 4. AASHTO American Association of State Highway Transportation Officials.

1.4 QUALITY ASSURANCE

- A. Items submitted for approval in accordance with requirements shown on the Drawings and details shall be of the manufacturer indicated, or an approved equal, in compliance with materials, operations, physical assembly and performance as specified herein.
- B. In addition to the correction period set forth in General Conditions, the manufacturer's standard warranties shall be provided.

1.5 SUBMITTALS

- A. Pipe and Fittings: Certification of compliance, shop drawings.
- B. Precast Concrete Structures & Appurtenances: Shop drawings, certification of compliance.
- C. Coating and lining systems, non-shrink grout, polyethylene corrosion protection: Manufacturer's data and specification sheets and certification of compliance.
- D. Construction Sequence

1.6 PRODUCT DELIVERY, STORAGE AND HANDLING

- A. Store materials to prevent physical damage.
- B. Protect materials during transportation and installation to avoid physical damage.
- C. Pipe, fittings, and accessories shall be handled in a manner to insure installation of the material in an undamaged and structurally sound condition.
- D. Particular care shall be taken to not harm pipe bell and spigot ends. Handling equipment and procedures shall be in accordance with the approved manufacturer's recommendation for proper handling of his products. Improper handling of pipe that results in damage to pipe will be grounds for rejection of the pipe for installation.

1.7 CONNECT TO EXISTING LINES

- A. Work shall be so scheduled and timed as to cause the least possible interference with the operation of the existing system.
- B. Adequate facilities for disposal of fluids which may be released during the connecting operations shall be available.
- C. Contractor shall provide the necessary pumps and temporary piping and associated accessories as required for pumping of wastewater around areas of construction so as to not impede the collection and treatment of the wastewater.
- D. Sewage and water contaminated with sewage shall be conveyed to sanitary sewers.

1.8 BYPASS PUMPING

- A. Where flow control is required to perform a specified repair, replacement, or connection to an existing sewer pipe or manhole, plugging or blocking shall be used wherever possible.
- B. If plugging or blocking is not feasible or at the Contractor's discretion, Contractor shall provide the necessary pumps and temporary piping and associated accessories as required for pumping of wastewater around areas of construction so as to not impede the collection and treatment of the wastewater. Backup pumping capability will be required.
- C. The design, installation, and operation of the temporary pumping system shall be the Contractor's responsibility. The temporary pumping system shall comply with the requirements of all codes and regulatory agencies having jurisdiction. Contractor shall be responsible for any spillage of raw sewage that results in civil or criminal charges from any local, state, or federal agency and will bear all costs for these charges and any restoration required.
- D. It is essential to the operation of the existing sewerage system that there be no interruption in the flow of sewage throughout the duration of the Project. Contractor shall provide, maintain, and operate all temporary facilities such as plugs, pumping equipment (both primary and backup units as required), conduits, all necessary power or fuel source, and all other labor and equipment necessary to handle the sewage by-pass flow.
- E. Contractor shall provide all necessary means to safely convey the sewage past the work area. Contractor shall not stop or impede the sewer flows under any circumstances.
- F. Contractor shall maintain sewage flow around the work area in a manner that will not cause surcharging of sewers, damage to sewers, and that will protect public and private property from damage and flooding.
- G. Contractor shall protect water resources, wetlands, and other natural resources.
- H. Contractor shall insure that the flow diversion pumping system is properly operated and maintained and shall provide responsible personnel to oversee the diversion pumping system at all times.
- I. Work shall be so scheduled and timed as to cause the least possible interference with the operation of the existing sewer collection and treatment system.
- J. Sewage and water contaminated with sewage shall be conveyed to sanitary sewers.
- K. Bypass pumping shall be considered subsidiary to all other bid items.

1.9 WRAP OF BEDDING MATERIAL WITH GEOTEXTILE FABRIC

- A. A layer of medium weight non-woven geotextile fabric shall be placed between the pipe zone backfill and the intermediate zone backfill to reduce fines migration into the pipe zone. Filter fabric shall be laid-out and overlapped according to the manufacturer's recommendations.

1.10 WARRANTY

- A. Full warranty against defects in materials and workmanship for one year after FINAL ACCEPTANCE, including all parts, labor, and expenses.

PART 2 PRODUCTS

2.1 PVC (POLYVINYL CHLORIDE) SEWER PIPE

- A. SDR 35 PVC sewer pipe shall conform to ASTM D3034. SCH. 40 and SCH 80 PVC Pipe (Class 12454-B) shall conform to ASTM D1784 and D1785. All pipe joints shall be rubber gasketed bell and spigot. Pipe shall be made from PVC plastic having a cell classification of 12454-B, 12454-C, or 13343-C having a minimum tensile modulus of 500,000 psi, as defined in ASTM D1784. Nominal laying length shall be 13 feet for 8" through 18" and 19 1/2 feet for 21-inch through 27-inch sizes.
- B. PVC pipe joints shall be bell and spigot design conforming to the requirements of ASTM D3212.
- C. Gaskets shall meet the requirements of ASTM F477. Solvent weld or non-gasket friction joints are not acceptable.
- D. PVC fittings shall be manufactured from the same material as the pipe and meet the requirements of ASTM D3034 for 4" through 15" and ASTM F679 - PS46 for 18" through 27". Fittings shall be so designed so that deflection under load is equal to or less than that of the connecting PVC pipe.

2.2 DUCTILE IRON PIPE

- A. Ductile iron pipe, where indicated on the Drawings or required, shall be as specified herein.
- B. All ductile iron pipe shall be push on or mechanical joint and shall conform to the requirements of ANSI/AWWA C151/A21.51. The wall thickness and outside diameter of the pipe shall conform to Tables 51.4 and 51.5 of AWWA C151. All ductile iron pipe shall be Class 51, except as noted otherwise.
- C. Fittings for use with the ductile iron pipe specified herein, shall be ductile iron. Cast ductile iron fittings shall be pressure rated for at least 250 psi. All fittings with mechanical joints and push on joints shall conform to AWWA/ANSI C110/A21.10 and ANSI/AWWA C111/A21.11, except that Buna-N gaskets shall be used for the joint. The fitting manufacturer shall furnish the proper gaskets, nuts, bolts, glands, for each type of joint. Compact fittings are not acceptable. All fittings shall be American made with uniform flange/gland thickness.
- D. The interior of all ductile iron pipe and fittings shall be lined with polyethylene or coated with Protecto 401 Ceramic Epoxy or Coropipe II WasteLiner as manufactured by Madison Chemical Industries, Inc.
- E. All ductile iron pipe and fittings shall be checked for dry film thickness (DFT) in accordance with the SSPCA-PA2. Each pipe and fitting shall be marked with the date of application of the lining system and with its numerical sequence of application on that date. The pipe supplier shall furnish a certificate stating that the lining applicator has complied with all specification requirements relative to the material, its application and inspection.
- F. Surface preparation, number of coats, application of the lining material and field touch-up shall be in strict accordance with the lining material manufacturer's recommendations. During the installation of the pipe, the lining manufacturer shall provide the services of a field engineer to instruct and demonstrate to the Contractor's personnel the procedure for the field touch-up of the lining where field cuts and taps were required.
- G. Holiday inspection shall be conducted using test equipment described in AWWA C 210, Section 5.3.3.1. In accordance with the coating manufacturer's recommendation, holiday testing may be conducted any time after the coating has reached sufficient cure.
- H. Polyethylene: Inside coatings of all ductile iron pipe and fittings shall be of virgin polyethylene with nominal thickness of 40 mils (35 mils minimum) complying with ANSI/ASTM D 1248.
 - 1. The polyethylene shall be bonded to the interior of the pipe by heat. All surfaces to be lined shall be blast cleaned comparable to the requirements of SSPC-SP6 or NACE no. 3.
 - 2. All pipe and fittings shall be lined with a minimum dry film thickness of 40 mils, except for the gasket groove and spigot end up to 6-inches back from the end of the spigot which shall be lined with 10 mils of the material.
 - 3. The coating thickness on sealing areas in the bell socket interior and on the spigot end of the pipe exterior shall be 8 mils nominal with a maximum of 10 mils. Thicker coatings in these areas are acceptable if it is demonstrated that joint dimensions are within allowable tolerances after coating.
 - 4. Repairs and touchup shall be performed in accordance with the manufacturer's recommended repair and touchup procedures. All field cut ends shall be repaired, sealed and fully cured prior to installation.
 - 5. Polyethylene Lining Testing - Factory tests. All ductile iron pipe and fittings with polyethylene linings shall be subjected to a 10,000-volt spark test prior to shipment. This test shall be utilized to seek any pinholes in the lining after the lining has cooled. Any pipe section or fitting that fails the non-destructive test shall be rejected.
- I. Epoxy Coating: Inside coatings of all ductile iron pipe and fittings shall be an amine cured novalac epoxy containing at least 20% by volume of ceramic quartz pigment. The coating shall be Protecto 401 Ceramic Epoxy as manufactured by the Protecto Division of Vulcan Painters, Inc. The coating shall be a nominal 40 mils DFT thickness, with a minimum of 30 mils DFT thickness.
 - 1. The epoxy coating shall be installed and tested in strict accordance with AWWA C 116/ANSI A21.16 and as supplemented in these specifications.

- J. Polyurethane Coating: Inside coatings of all ductile iron pipe and fittings shall receive a two-component polyurethane coating system. The lining material shall consist of a ceramic modified polyisocyanate resin and polyol resin mixed in a 1:1 ratio at the time of application. The material shall be Corropipe II WasteLiner(CM) as manufactured by the Madison Chemical Industries, Inc. The lining material shall be an ASTM D 16 Type V system. The coating shall be a minimum of 40 mils DFT thickness.
 - 1. All surfaces to be coated or lined shall be cleaned to a near white metal finish (SSPC-SP 10) as applied to ductile iron pipe and fittings. All surfaces shall be completely dry, free of moisture, dust, grease or any other deleterious substances at the time the coating or lining is applied.
 - 2. The coating thickness on the sealing areas in the bell socket interior and on the spigot end of the pipe exterior shall be 8 mils DFT nominal with a maximum of 10 mils DFT. Thicker coatings in these areas are acceptable if it is demonstrated that joint dimensions are within allowable tolerances after coating.
 - 3. Field joints, repair and touch up material shall be GP II (E) Touch-Up as manufactured by Madison Chemical Industries, Inc. This work shall be performed in strict accordance with the manufacturer's recommended procedures. All field cut ends and touch ups shall be repaired, sealed and properly cured prior to installation.
- K. Exterior Coating: An asphaltic coating shall be applied to the exterior of all ductile iron pipe and fittings intended for buried service and shall conform to ANSI/AWWA C151/A21.51. The exterior of all piping in the wet well shall be coated as specified in the Painting Section. All ductile iron pipe and fittings intended for interior use and for use above grade shall receive a prime coat of universal primer as specified in the Painting Section.
- L. An asphaltic coating shall be applied to the exterior of all ductile iron pipe and fittings intended for buried service and shall conform to ANSI/AWWA C151/A21.51.
- M. Corrosion Protection:
 - 1. The exterior of all buried ductile iron piping shall be protected from corrosion by a seamless linear low-density polyethylene (LLDPE) tube conforming to ANSI/AWWA C105/A21.5 with a minimum thickness of 8 mils.
 - 2. The tube shall have markings placed at two-foot intervals and include the manufacturer's name and/or trade mark, the year of manufacture, the standard designation ANSI/AWWA C105/A21.5, the minimum film thickness and material type, the application range of pipe nominal diameters for the film, and a warning notice: "Warning - Corrosion Protection - Repair any Damage."
 - 3. Corrosion protection supplied in 48-inch wide flat sheets shall be used to cover irregular shaped valves, fittings and appurtenances not protected by the tube form of polyethylene wrap.
 - 4. Securing tape shall be 2-inch wide by ten (10) mil thickness and supplied by the pipe manufacturers.

2.3 GEOTEXTILE FABRIC

- A. Geotextile wrap of bedding material shall be with filter fabric US 205NW or equivalent and meet the following specifications:
 - 1. Apparent Opening Size (AOS): #80 U.S. Standard Sieve Size per ASTM D4751.
 - 2. Grab Tensile/Elongation: 205 lbs/50% per ASTM D4632.
 - 3. Puncture Strength: 130 lb minimum, average roll value per ASTM D4833.

2.4 MANHOLES, CONCRETE ADDITIVES FOR MANHOLES, MANHOLE COATINGS AND NON-SHRINK GROUT FOR MANHOLES

- A. Precast reinforced concrete manholes, concrete additives for manholes, manhole coatings and non-shrink grout for Sanitary Sewer Systems shall be as specified in Section 330516.

2.5 EXPANSION PIPE PLUG

- A. Expansion pipe plugs 4" - 18" diameter shall be Hand-Tite Pipe Plug as manufactured by R.C. Graham Co.

2.6 TRACER WIRE

- A. All gravity sewer pipes and new sections of laterals shall be installed with tracer wire to facilitate future location of the pipe.

- B. Locator wire shall be #12 gauge solid copper wire with PE-45 insulation as manufactured by Kris-Tech Wire Company or an approved equal. Alternative manufacturer wire must be specified as locator or tracer wire and shall not be conductor wire for other purposes.
- C. Locator wire shall be installed in such a manner to keep slices to an absolute minimum.
- D. All connections or splices shall be made with a Splice Kit equal to 3M-DBR-Part Number – 054007-09964 or approved equal.
- E. Wire shall be taped as shown on the Construction Plan details.
- F. Wire shall be installed along all lines and outside manhole structures, lampholes, and cleanouts as shown on the Construction Plan details and shall have enough slack to extend to 48" above ground.
- G. Contractor must prove continuity of locator wire after installation is complete. Owner's Representative must be present during continuity testing.
- H. Locator wire installation, including signal loss, shall be warranted for one year.

PART 3 EXECUTION

3.1 TRENCHING, BACKFILLING AND COMPACTING

- A. Trenching and backfilling shall be in accordance with applicable requirements of Section 312333.

3.2 GENERAL PIPE INSTALLATION

- A. Pipe shall be protected during handling against impact shocks and free fall and the pipe interior shall be free of extraneous material.
- B. Pipe Handling: Pipe, manholes and appurtenances shall be handled in a manner to insure installation of the material in an undamaged and structurally sound condition. Particular care shall be taken to not harm pipe coatings. Handling equipment and procedures shall be in accordance with the approved manufacturer's recommendation for proper handling of its products. Improper handling of pipe that results in damage to pipe or coatings will be grounds for rejection of the pipe for installation. The Engineer will be the final judge as to the acceptability of any material on the project. Cutting of pipe is discouraged. The Contractor is urged to plan his job to minimize the necessity for cutting. Prior to installation each pipe shall be inspected for defects and cracks. All defective, unsound or damaged pipe shall be rejected. The interior of all pipes and fittings shall be thoroughly cleaned and kept clean thereafter. All joints surfaces shall be kept absolutely clean during the jointing process. Pipelines and runs intended to be straight shall be laid straight and to grade. Grade changes and alignment deflections shall be made as shown on the drawings.
- C. Laying Pipe: Pipe shall not be laid in wet trench. At times when the laying of the pipe is not in progress, the open ends of the pipe shall be closed in such a manner that water due to rainfall or infiltration cannot enter. All joints shall be completed. Except where necessary for making connections with other lines, closures, or as authorized by the Engineer, pipe shall be laid with the bells facing upstream.
- D. Aligning Pipe: Tangent runs intended to be straight shall be laid straight. Horizontal and vertical deflections shall be by angular divergence of the axis of adjacent pipe at the joint in accordance with manufacturer's recommendations. Shorter lengths of pipe may be used to increase the number of available joints.

3.3 PIPE INSTALLATION

- A. Bedding Pipe: Pipe shall be placed in bedding material as specified in Section 312333 TRENCHING AND BACKFILLING.
- B. Laying Pipe: Lay pipe upgrade starting at the low point and with spigot end of pipe pointing downstream with bell holes excavated as required. Inspect each length and reject damaged or defective lengths. All pipe shall be laid with ends abutting and true to line and grade and shall be fitted and matched so that when laid together they will form a smooth and uniform invert. As the work progresses, the interior of the pipe shall be cleared of all superfluous materials.

- C. Pipe jointing shall be accomplished as follows:
 1. All surfaces of the portions of the pipe to be joined shall be clean and dry. Lubricants and primers shall be used as recommended by the pipe manufacturer. The joints shall then be placed, fitted, joined and adjusted so as to obtain a water tight joint. Where possible the proper seating of the gasketed joints shall be visually inspected prior to placement of the next section of pipe. Pipe or piped joints found to be defective shall be removed from the trench, marked as defective and returned to the manufacturer.
- D. The downstream end of new line extensions shall be plugged in a positive manner by use of inflatable plugs or other means acceptable to the Engineer until construction, cleaning, and testing is completed and the new construction is accepted by the Engineer.
- E. Service (Wye) Connections. Install fittings for service connections in all types of pipe at locations and in the manner designated by the manufacturer and approved by the Engineer.
- F. Riser Pipes shall be constructed of approved sewer pipe and fittings as specified herein and as detailed on the Drawings. Each riser pipe shall be plugged with an Engineer approved plugging device.
- G. House service lines shall be constructed of approved sewer pipe and fittings as specified herein and as detailed on the Drawings. Connections between new and old work shall be made by means of suitable adapters approved by the Engineer.
- H. Sewer lines and stubs indicated on the Drawings to be plugged for future connection, shall be plugged with an Engineer approved plugging device. The plugging device shall be corrosion resistant, designed for long term burial and prevent infiltration for the duration of its use. It shall allow easy removal for future connection with no damage to the existing line or stub. The plug shall be as manufactured by Hand-Tite, Inc. or approved equal.

3.4 SEPARATION OF WATER MAINS AND SEWERS

- A. Gravity Sanitary Sewers. When potable water pipes and gravity sanitary sewers are laid parallel to each other, the horizontal distance between them shall be not less than 10 ft (3.0 m). The distance shall be measured from edge to edge. The laying of water pipes and sanitary sewers shall be in separate trenches with undisturbed earth between them. When a water pipe and a sanitary sewer cross and the sewer is 2 ft (0.6 m) or more (clear space) below the water pipe, no special requirements or limitations are provided herein. At all other crossings, the sanitary sewer is to be constructed of one of the following materials (or approved equal) and pressure tested to assure water tightness.
 1. Ductile iron pipe conforming to ASTM A536 or ANSI/AWWA C151/A21.51 with minimum thickness class 50, and gasketed, push-on, or mechanical joints in conformance with ANSI/AWWA C110/A21.10 or ANSI/AWWA C111/A21.11.
 2. PVC pipe conforming to ASTM D3034 with minimum wall thickness of SDR41, ASTM F679, ASTM F789, or ASTM F794, with gasketed push-on joints in conformance with ASTM D3212.
 3. Reinforced concrete pipe conforming to ASTM C76 with gasketed joints in conformance with ASTM C361 or ASTM C443.
- B. Joints in the sewer pipe shall be located as far as practical from the intersected water main.
- C. Where a water main is laid across or through an area where there is an existing sanitary sewer, which is not constructed of one of the above specified materials and is 2 ft (0.6m) or less below the water pipe, the existing sewer shall be encased in concrete with a minimum of 6 in (15 cm) thickness for a 10 ft (3.0 m) distance on each side of the crossing or the crossed section of sewer replaced to meet the above specified construction requirements.
- D. Pressure Sewer Lines. When force mains run parallel to water lines, the separation distance shall be as far as practical, but at least a 10 ft (3.0m) horizontal separation shall be maintained. There shall be at least a 2 ft (0.6 m) vertical separation at crossings with the water main crossing above the sewer force main.

3.5 MANHOLES - GENERAL

- A. Excavation and backfill around manholes shall be in accordance with the applicable paragraphs in Section 312333 TRENCHING AND BACKFILLING. Install manholes on an 8-inch layer of gravel bedding used for sewer pipe bedding. Bedding shall extend a minimum of 6-inches beyond the outer edge of the base

- B. Handle with care to avoid damage to joint ends of each section. Damaged sections may be subject to rejection at the discretion of the Engineer. All manhole construction shall be watertight. The invert, walls and steps shall be cleaned of excess grout and laitance.
- C. Floors of the manholes shall be shaped and smoothed so that flow channels will be formed such that the manhole will be self-cleaning and free of areas where solids may be deposited. The floors shall have a slope of one (1) inch per foot on areas outside of the flow channels.
- D. Connection to existing sewer mains shall be done in an approved manner. Cutting into existing sewer shall be done in such a manner as to prevent damage to sewer not being removed. New invert channel(s) shall be constructed as required and in accordance with the requirements herein and as shown on the Drawings.
- E. Precast manholes with T-lock liner shall be spark tested in strict accordance with the manufacturers recommended test procedures by a certified technician and witnessed by the Owner's representative.

3.6 MANHOLES - PRECAST CONCRETE

- A. Manholes, wetwell and valve vault shall be constructed of precast reinforced manhole sections, concentric or eccentric reducer cone section and flat tops as detailed.
- B. All precast structures shall be set plumb and level on a 8-inch thick (minimum) layer of compacted $\frac{3}{4}$ " gravel.
- C. All section joints shall be set and sealed with an approved joint sealant.

3.7 MANHOLE CASTINGS

- A. All castings and frames shall be placed in the positions indicated on the Drawings.
- B. Manhole Castings shall be set on a full mortar bed or sealed with a troweled-on butyl rubber mastic sealant, Press-Seal Gasket Corporation "Trowelable EZ-Stik #3". In situations where the exterior walls of the manhole will be exposed to weather or where bolt down covers are required, the manhole casting shall be bolted to the precast cone section or flat slab top using $\frac{3}{4}$ " diameter stainless steel threaded rod, nuts and washers epoxy anchored into the concrete.
- C. Castings and frames shall be set true to line and to correct elevations.

3.8 CONNECTION TO MANHOLES.

- A. Connections to new manholes shall utilize flexible connections. Flexible connections allow for limited differential settlement to occur between the pipe and manhole. The uniform compaction of the bedding material under the pipe and up to the spring line or top of the pipe as detailed is essential to the control of this differential settlement. Resilient connectors shall be used with all flexible connections. A flexible preformed mastic sealant shall be installed around the bottom half of the exterior pipe surface between the resilient connector and the invert. This flexible sealant shall be installed to separate the pipe from the invert to maintain the flexibility of the pipe/manhole connection. Pipes installed with flexible connections shall not have concrete encasement at the outside of the manhole.
- B. Connection to Existing Structures shall be done in such a manner as to prevent damage to existing structures. Hole for installation of pipe shall be approximately 4 inches larger in diameter than the outside diameter of the pipe to be installed. Annular space around the pipe or resilient connector, as required, shall be filled solid with non-shrink grout. New invert channels shall be constructed as required and shall conform with the requirements herein. For installing a new manhole on an existing pipe, a clamp-on resilient connector shall be installed on the pipe prior to grouting into the manhole wall.

3.9 NON-SHRINK GROUT

- A. All mixing, surface preparation, handling, placing, consolidation, curing and other means of execution for prepackaged grouts shall be done in strict accordance with the instructions and recommendations of the manufacturer.
- B. Grout shall be placed in such a manner, for the consistency necessary for each application, so as to assure that the space to be grouted is completely filled.

C. The finish of the grout surface shall match that of the adjacent concrete.

3.10 CLEANING AND TESTING

A. General:

1. After all installations are complete, including all backfill and compaction, all piping and appurtenances shall be cleaned of foreign materials. Flushing of foreign materials from a newly completed section of interceptor sewer into section already in service will not be allowed. If ductile iron pipe is utilized the Contractor shall take care not to damage the internal linings. If lining is damaged during either installation or cleaning it shall be repaired in strict accordance with and approved by the pipe manufacturer's technical field service personnel.
2. Contractor shall furnish all labor, tools, potable water, and equipment necessary to perform leakage and deflection tests as specified herein. The methods and equipment used to make the test shall be mutually determined by the Engineer and Contractor before any testing is started. For the purpose of testing, a section of the line shall be considered as the length of line between manholes. Any section that fails the test shall be repaired and retested by the Contractor until the leakage and/or deflection limits is within the allowable limits. Water used for exfiltration testing shall not be allowed to be disposed of through the completed sewer line. The Contractor shall provide the required pumps to dispose of test water to the nearest storm sewer or waterway.
3. If inspection or test shows defects, such defective work or material shall be replaced and inspection and tests repeated. Repairs to piping and appurtenances shall be made with new material at no additional cost to the Owner.
4. All visible leaks shall be repaired.

B. Gravity Lines:

1. Lines shall be checked for alignment by lamping and visual inspection and deflection by mandrel testing. The pipe between manholes shall not be more than 1/4 of the pipe diameter out of alignment.
2. Deflection limits for flexible sewer pipe shall not exceed five (5) percent of the nominal diameter of the pipe. Deflection limits shall be verified by passing a mandrel through the section of sewer line not less than 30 days after completion of the installation.
3. Perform deflection test using a properly sized mandrel without mechanical pulling devices.
4. Under no circumstances shall the mandrel test be performed prior to the completion of all compaction operations required for surface preparation, regardless of the time of completion of the pipe installation.
5. The sewer mandrel shall be fabricated with a diameter not less than 95 percent of base or average diameter of the pipe as determined by the ASTM standard to which the pipe is manufactured. The mandrel shall be certified by an independent testing laboratory. The current certification shall be submitted and approved by the Engineer prior to using the mandrel.
6. The Contractor shall provide video verification of the sewer main on all lines 30 days after substantial completion.
7. Air Test:
 - a. In addition to the visual inspection, the Contractor shall perform a low pressure air test on all pipe installed.
 - b. Testing methods for PVC pipe shall conform to the applicable requirements of ASTM F1417.
 - c. Testing methods for concrete pipe shall conform to the applicable requirements of ASTM C 924.
 - d. Testing methods for vitrified clay pipe shall conform to the applicable requirements of ASTM C828.
 - e. For making the low pressure air tests, the Contractor shall use equipment specifically designed and manufactured for the purpose of testing sewer pipelines using low pressure air. The equipment shall be provided with an air regulator valve or pressure relief valve set so that the internal air pressure in the pipeline cannot exceed 9 psig. All air used shall pass through a single control panel.

- f. Pneumatic plugs shall have a sealing length equal to or greater than the diameter of the pipe to be tested. Pneumatic plugs shall resist internal test pressures without requiring external bracing or blocking.
 - g. The Contractor shall be extremely cautious when testing with low pressure air. It is extremely important that the various plugs be installed in such a way as to prevent blowouts. Inasmuch as a force of 250 lbf (112N) is exerted on an 8-inch (230 mm) plug by an internal pipe pressure of 5 psi (34 kPa), it should be realized that sudden expulsion of a poorly installed plug or of a plug that is partially deflated before the pipe pressure is release can be dangerous.
 - h. NO ONE shall be allowed in the manholes during testing.
 - i. The section of pipe between successive manholes shall be sealed with suitable plugs. Do not overpressure the line. Do not exceed 9.0 psig. One of the plugs shall have an orifice through which to pass air into the section of pipe being tested. The air supply source (air compressor) shall have a 9 psig pressure relief valve. The air supply line shall have a positive on-off valve and suitable means for readily disconnecting it at the control panel. A second orifice in the plug shall be used for constantly reading the internal pressure of the pipe. This orifice shall be continuously connected to a pressure gauge having a range of from 0 to 10 psi. The gauge shall have minimum divisions of 0.10 psi and shall have an accuracy of ± 0.04 psi.
 - j. The line under test shall be slowly pressurized to approximately 4 psi. Regulate the air supply so that the pressure is maintained between 3.5 and 4.0 psig for at least 2 minutes. The air temperature should stabilize in equilibrium with the temperature of the pipe walls. Disconnect the air supply and decrease the pressure to exactly 3.5 psi before starting the test.
 - k. Determine the time required for the pressure to drop from 3.5 psi to 2.5 psi, and compare this interval to the required time to decide if the rate of air loss is within the allowable. Tables 1 and 2 show the minimum holding times for PVC pipe listed by diameter. If the pressure drops 1.0 psig before the appropriate time shown in Table 1 has elapsed, the air loss rate shall be considered excessive and the pipe section has failed the test. For testing of long sections or sections of larger diameter pipes, or both, a timed-pressure drop of 0.5 psig shall be used in lieu of the 1.0 psig drop as shown in Table 2.
 - l. Upon completion of the test, open the bleeder valve and allow all air to escape. Plugs should not be removed until air pressure in the test section has been reduced to atmospheric pressure.
8. An infiltration/exfiltration test may be performed with prior approval by the Engineer.
- a. Infiltration Test: An infiltration test shall be performed when the crown of the sewer line is below the ground water table. The amount of water leaking into the sewer shall be measured by the use of appropriately sized weirs designed specifically for this purpose and approved by the Engineer. The allowable leakage shall not be more than 50 gallons per day, per mile of pipe, per inch nominal diameter. The section of pipe to be tested shall be pumped dry before the start of the test.
 - b. Exfiltration Test: In areas where the crown of the pipe is above the ground water level, an exfiltration test shall be performed. The section of sewer to be tested shall be filled with water so that the water table in the upstream manhole is at least 4 feet above the flowline or 2 feet above the top of the pipe, whichever is greater. The amount of water added during the test period to maintain the water level shall be measured and it shall not exceed a rate of 50 gallons per day, per mile of pipe, per inch of nominal diameter. PVC joints shall be repaired by removal and replacement of the pipe section or pipe joint as directed by the Engineer. D.I.P. joints found to be defective shall be repaired by disassembly of the pipe joint, replacement of the joint and or pipe gasket and reassembly of pipe section utilizing a ductile iron mechanical joint long sleeve with internal pipe filler. Bell clamps will not be an acceptable method of joint repair.
- C. Manholes:
- 1. Manholes structure shall be either vacuum or hydrostatically tested. Vacuum or hydrostatic testing is recommended prior to backfilling, where feasible, to assist in locating leaks. The final test and acceptance shall be based only on a test after the manhole is backfilled and the cast manhole ring is in place. Existing manholes where new connections are made will not be required

- to be vacuum or hydrostatically tested. These manholes shall be visually inspected for water tightness with any leakage noted and corrected prior to manhole acceptance.
2. Vacuum Test - A vacuum test shall be performed on all new manholes. Plug all manhole entrances and exits other than the manhole top access using suitably sized and rated pneumatic or mechanical pipeline plugs. Follow manufacturer's recommendations and warnings for proper and safe installation of such plugs, taking care to securely brace the plugs and the pipe. Attach the vacuum test device to the cast manhole ring and draw a vacuum to 10" of mercury. With the valve at the vacuum line connection closed and the vacuum pump off, measure the time required for the vacuum to drop to 9" of mercury. The manhole passes the test if the time is greater than 60 seconds for a 48" diameter manhole, 75 seconds for a 60" diameter manhole, and 90 seconds for a 72" diameter manhole. If the manhole fails the test, the Contractor shall locate the leak and make proper repairs with non-shrink grout. The manhole shall be retested until acceptable test results are obtained.
 3. Hydrostatic Test - Manholes may be tested using internal or external hydrostatic pressure with prior approval by the Engineer. External hydrostatic testing shall only be used where the groundwater level is at least 4 feet above the invert of the manhole. In all other cases, the internal hydrostatic test procedures must be followed. Sewers connected to the manhole shall be adequately plugged. For the internal hydrostatic test, the manhole shall be filled with water to the top or to a maximum depth of 25-feet above the invert. Water gain or loss shall not exceed 1.14 gallons per day per vertical foot of manhole for either external or internal hydrostatic testing. Infiltration and exfiltration shall be determined after 24 hours of hydrostatic testing by determining the gain or loss of water in the manhole. Contractor shall be responsible for retrieving any plugs or material accidentally washed down a sewer.

3.11 CORROSION PROTECTION

- A. Protective coating for D.I. pipe shall be provided by the use of 8 mil polyethylene loose fitting tubing. The wrapping shall be bunched up at each end to provide for overlap to adjoining pipe by 1 foot. The wrapping on the adjacent pipe is pulled over the bell and secured with three circumferential turns of polyethylene adhesive tape. The resulting loose wrap on the barrel of the pipe shall be pulled snugly around the barrel and taped at 3 foot intervals. The Contractor shall use care in backfilling as to avoid tearing and shall repair all holes in the wrapping.
- B. Polyethylene encasement materials and installation shall be in accordance with ANSI/AWWA C105/A21.5.

3.12 BYPASS PUMPING

- A. Where plugging is used, the Contractor shall monitor upstream manholes for excessive surcharge conditions. The Contractor shall take immediate action and utilize all means necessary to quickly alleviate the surcharge conditions.
- B. Contractor is responsible for locating any existing utilities in the area Contractor selects to locate the diversion pipelines. The diversion pipelines shall be located to minimize any disturbance to existing utilities, traffic, and the Contractor shall obtain approval of the pipeline locations from the Owner and Engineer prior to installation.
- C. Plugging or blocking of sewage flows shall incorporate primary and secondary plugging devices. Plugging devices shall be braced and/or designed such that they are capable of retaining the maximum head that could be produced at the plug location during maximum surcharging of the sewer system. When plugging or blocking is no longer needed for performance and acceptance of work, the plugs or blocks shall be removed in a manner that permits the sewage flow to slowly return to normal, to prevent surcharging or causing other major disturbances downstream.
- D. When working inside manholes, Contractor shall exercise caution and comply with OSHA requirements when working in the presence of sewer gases, combustible oxygen-deficient atmospheres, and confined spaces.
- E. Contractor shall protect the discharge lines from damage in the areas of backhoe operations. Damaged, leaking or defective discharge lines shall be immediately replaced.
- F. Contractor shall confine the discharge pipelines to the limits of Work as defined by the contract documents during bypassing operations.

END OF SECTION

SECTION 333216
WASTEWATER PUMPING SYSTEM

PART 1 GENERAL

1.1 WORK INCLUDED

- A. It is the intent of this section to specify the submersible pump station equipment for the 2022 Kentucky project, complete in every respect whether or not covered by this specification or the Drawings.
- B. The surface of the lift station shall be set at proper elevations so that future access to the station will not be impaired by flooding, excessive road grades, swales, walls or landscaping in any manner.
- C. The wastewater pumping systems to be provided for Delaplain Disposal post-equalization/ contact tank shall include pump P-411, & 412 level control system with one (2) floats installed in the tank, guide rails for the tank, lift chain kit, discharge fittings as required for guide rail system, upper guide rail brackets, electrical/control panel (non-metallic NEMA 4X) including VFDs, anchor bolts, and appurtenances described herein. The wastewater pumping systems will be Owner furnished, as described in Section 016400, and installed by Contractor.
- D. The Contractor will be directly responsible for providing and installing all items listed or not listed above for a complete pumping system, including but not limited to the wet well, valves, piping, piping appurtenances, site work, electrical distribution, communications conduit, and cables routed to Mission Monitoring controls, power source, etc. Installation shall include the Contractor directly coordinating startup and commissioning assistance from the pump supplier (see paragraph 3.5 below).
- E. In order to assure the proper performance and compatibility of interacting components, the pumps, accessories, control system and instrumentation shall be supplied by the same vendor. All electrical equipment to be of the same supplier, i.e., starters, disconnects, etc.

1.2 COORDINATION OF WORK

- A. All work shall be fully coordinated with other work by Contractor and shop drawings must be checked with each of the various trades by Contractor.

PART 2 PRODUCTS

2.1 GENERAL

- A. Products relevant to this section will be Owner furnished for installation by Contractor except as otherwise stated above.

PART 3 EXECUTION

3.1 INSTALLATION

- A. General: All equipment shall be installed in accordance with acceptable procedures submitted with the shop drawings, manufacturer's instructions and installation manual and as indicated on the Drawings and specified herein, unless otherwise accepted by the Engineer.

3.2 PUMP INSTALLATIONS

- A. The Contractor shall perform the following work to install the pumps and accessories.
 1. Provide electrical service per the attached drawings and Division 26 of specifications.
 2. The discharge base elbow and the submersible sewage pumps shall be installed in accordance with the manufacturer's detailed instructions and aligned with discharge piping and guide rails.
 3. The discharge piping shall be connected in a manner to prevent strain on the equipment.
 4. All piping and valves shall be installed in accordance with the applicable sections of Division 40.
 5. Anti-seize compound shall be liberally applied to the threaded portion of all stainless steel bolts during assembly to prevent galling. Anti-seize compound shall be Jet-Lube "Nikal", John Crane "Thred Gard Nickel", Never-Seez "Pure Nickel Special", or Permatex "Nickel Anti-Seize".

3.3 WET WELL INSTALLATION

- A. Each wet well shall be installed in strict accordance with the applicable requirements relating to precast concrete utility structures and as detailed on the Drawings.

3.4 ELECTRICAL/CONTROL SYSTEMS.

- A. Electrical equipment shall be of the type and quality set forth herein and Division 26. Control panel shall be Owner Furnished.
- B. All work shall be performed, and all materials shall be in accordance with the National Electrical Code, the National Electrical Safety Code, and applicable local regulations and ordinances. Where required by applicable codes, materials and equipment shall be listed by Underwriters' Laboratories or other testing organization acceptable to the governing authority.
- C. Sealing of Conduits. Conduit extending from the wet well shall be sealed as set forth herein. After cable has been installed and connected, conduit ends shall be sealed by an approved sealing compound forced into conduits to a minimum depth equal to twice the conduit diameter.

3.5 START UP SERVICE

- A. The Owner-supplier agreement shall require the wastewater pumping system supplier to provide the services of a factory-trained representative to perform initial start-up of the pump station and to instruct the Owner's operating personnel in the operation and maintenance of the equipment provided by them. A written report of the results of the start-up process shall be submitted to the Engineer. The report shall state that the pumps and controls have been properly installed and are operating correctly in accordance with the manufacturer's recommendations and Contract Documents. It shall also indicate any problems or corrections made during the start-up. Contractor shall coordinate the services of the manufacturer's representative and make field modifications recommended by manufacturer.

END OF SECTION

**SECTION 400500 GENERAL
PIPING REQUIREMENTS**

PART 1 GENERAL

1.1 DESCRIPTION

- A. This section describes the general requirements for selecting piping materials; selecting the associated bolts, nuts, and gaskets for flanges for the various piping services in the project; and miscellaneous piping items.

1.2 SUBMITTALS

- A. Submit shop drawings in accordance with Section 013300.
- B. Provide data sheets for each type of piping and submit affidavits of compliance with referenced standards (e.g. AWWA, ANSI, ASTM, etc.).
- C. Submit verification of NSF 61 Certification for pipe and fittings.
- D. Submit affidavit of compliance with referenced standards (e.g., AWWA, ANSI, ASTM, etc.).
- E. Submit certified copies of mill test reports for bolts and nuts, including coatings if specified. Provide recertification by an independent domestic testing laboratory for materials originating outside of the United States.
- F. Submit manufacturer's data sheet for gaskets supplied showing dimensions and bolting recommendations.
- G. Submit manufacturer's data sheet for flange insulating kits.
- H. Submit manufacturer's data sheet for insulating unions, showing recommended installation procedures.

1.3 DEFINITIONS OF BURIED AND EXPOSED PIPING

- A. Buried piping is piping buried in the soil, commencing at the wall or beneath the slab of a structure. Where a coating is specified, provide the coating up to the structure wall. Piping encased in concrete is considered to be buried. Do not coat encased pipe.
- B. Exposed piping is piping in any of the following conditions or locations:
 - 1. Above ground.
 - 2. Inside buildings, vaults, or other structures.
 - 3. In underground concrete trenches or galleries.

1.4 INTENT OF DRAWINGS AND SPECIFICATIONS

- A. Except in details, piping is indicated diagrammatically. Sizes and locations are indicated on the Drawings. Not every offset and fitting, or structural difficulty that may be encountered has been indicated on the Drawings.
- B. Perform minor modifications to piping alignment where necessary to avoid structural, mechanical, or other type of obstructions that cannot be removed or changed.
 - 1. Modifications are intended to be of minor scope, not involving a change in the design concept or a change to the Contract Price or Contract Time.

PART 2 PRODUCTS

2.1 MATERIALS SELECTION AND ALTERNATIVE MATERIALS

- A. The drawings list the material and specification for each piping service in the project. The same pipe material shall be used for all pipe sizes in all locations for the given piping service. Do not intermix piping materials unless shown on the Drawings. Stainless steel pipe may be used as an alternate to ductile iron pipe in "exposed piping" locations.

2.2 THREAD FORMING FOR STAINLESS STEEL BOLTS

- A. Form threads by means of rolling, not cutting or grinding.

2.3 BOLTS AND NUTS FOR FLANGES FOR PVC, STAINLESS STEEL, STEEL, AND DUCTILE IRON PIPING

- A. Bolts and nuts for all buried flanges and all flanges located indoors; outdoors; above ground; and in vaults and structures shall be Type 304 stainless steel conforming to ASTM A193, Grade B8 Class 2, for bolts and ASTM A194, Grade 8, for nuts unless indicated otherwise. Fit shall be Class 2A and

2B per ASME B1.1 when connecting cast iron valves having body bolt holes.

- B. Bolts and nuts used in flange insulation kits shall conform to the same requirements as described in the paragraph contained herein; or ASTM A193 (Grade B7). Nuts shall conform to ASTM A194 (Grade 2H).
- C. Form threads for stainless steel bolts by means of rolling, not cutting or grinding.
- D. Provide washers for each nut and bolt head. Washers shall be of the same material as the nuts.

2.4 LUBRICANT FOR STAINLESS STEEL BOLTS AND NUTS

- A. Lubricant shall be chloride free and shall be RAMCO TG-50, Anti-Seize by RAMCO, Specialty Lubricants Corporation Huskyä Lube O'Seal, or equal.

2.5 GASKETS FOR FLANGES FOR DUCTILE IRON PIPING AND FITTINGS IN WATER SERVICE

- A. Gaskets shall be full face, 1/8-inch thick, cloth-inserted rubber, with a Shore "A" hardness of 75 to 85. Gaskets shall be suitable for a water pressure of 200 psi at a temperature of 180°F. Gaskets shall have "nominal" pipe size inside diameters not the inside diameters per ASME B16.21. Products: Garlock Style 19 or equal.

2.6 GASKETS FOR FLANGES FOR DUCTILE IRON AND STAINLESS STEEL PIPING AND FITTINGS IN AIR SERVICE

- A. Gaskets shall be full face, 1/8-inch thick, cloth-inserted rubber, with a Shore "A" hardness of 60. Gaskets shall be suitable for air pressure of 150 psi at a temperature of 300°F. Gaskets shall have "nominal" pipe size inside diameters not the inside diameters per ASME B16.21. Products: Garlock Style 8314 or equal.

2.7 GASKETS FOR FLANGES FOR STEEL AND DUCTILE-IRON PIPING AND FITTINGS IN RAW SEWAGE, SLUDGE, AND SCUM SERVICE

- A. Gaskets shall be full face, 1/8-inch thick, Buna-N having a hardness of 55 to 65 durometer. Gaskets shall be suitable for a water pressure of 200 psi at a temperature of 250°F. Gaskets shall have "nominal" pipe size inside diameters not the inside diameters per ASME B16.21. Provide Garlock Style 9122 or equal.

2.8 GASKETS FOR FLANGES FOR PVC AND CPVC PIPING

- A. Gaskets for flanged joints shall be full faced, 1/8-inch thick, having a hardness of 50 to 70 durometer. Gasket material for other than sodium hypochlorite service shall be EPR. Gasket material for sodium hypochlorite service shall be Viton ETP.

2.9 FLANGE INSULATION KITS

- A. Flange insulation kits shall consist of insulating gasket, an insulating stud sleeve for each bolt, insulating washers for each bolt, and a steel washer between each insulating washer and the nut. The sleeves shall be one piece, integral with the insulating washer. Gaskets shall be full face. Provide double sleeve and washer sets for each bolt.
- B. Gasket material shall be phenolic, 1/8-inch thick. The flange insulating gasket shall be full diameter of the flange with a nitrile O-ring on each side of the gasket. Dielectric strength shall not be less than 500 volts per mil and a compressive strength of not less than 24,000-psi.
- C. Insulating flange bolt sleeves shall be high-density polyethylene or spiral-wrapped mylar. Dielectric strength shall not be less than 1,200 volts per mil.
- D. Insulating flange bolt washers shall be high-strength phenolic a minimum thickness of 1/8-inch. Dielectric strength shall not be less than 500 volts per mil and a compressive strength of not less than 25,000-psi.
- E. Steel flange bolt washers for placement over the insulating washers shall be a minimum thickness of 1/8-inch and be cadmium plated.
- F. Flange insulation kits shall be as manufactured by Central Plastics Company, Advance Product Systems, or equal.

2.10 INSULATING UNIONS

- A. Insulating unions shall consist of a molded nylon sealing sleeve mounted in a three-piece malleable-iron (ASTM A47 or A197) body. Ends shall be threaded (ASME B1.20.1) when connecting to steel piping and copper solder joint when connecting to copper piping. Minimum working pressure shall be 150-psi. Unions shall be as manufactured by Central Plastics Company, Capital Insulation, or equal.

PART 3 EXECUTION

3.1 INSTALLING PIPE SPOOLS IN CONCRETE

- A. Install pipes in walls and slabs before placing concrete. See Section 400762.

3.2 RAISED FACE AND FLAT FACE FLANGES

- A. Use a flat-faced carbon steel, or alloy flange when mating with a flat-faced cast or ductile iron flanges.
- B. High pressure rated flanges as required to mate with equipment when equipment flange is of high pressure rating than required for piping.
- C. Where a raised face flange connects to a flat-faced flange, remove the raised face of the flange.

3.3 INSTALLING ABOVEGROUND OR EXPOSED PIPING

- A. Set piping plumb and at the horizontal and vertical location shown on the Drawings. Provide pipe hangers and supports to maintain alignment, as detailed in the drawings and as specified in Section 400764.
- B. Install pipe without springing, forcing, or stressing the pipe or any adjacent connecting valves or equipment.
- C. Pipe penetrations through walls, slabs, and floors shall be as detailed on the Drawings or as allowed for alternate configurations as specified herein.
- D. Install pipe spools in walls and slabs before placing concrete.
- E. Inspection for Defects: Before installation, inspect pipe and appurtenances for defects and, when applicable, tap the pipe with a light hammer to detect cracks. Reject defective, damaged, or unsound pipe and appurtenances.
- F. Cutting: Cut pipe, when necessary, in a neat and workmanlike manner without damage to the pipe, interior lining, and exterior coating. Perform cutting with an approved mechanical cutter, using a wheel cutter when applicable and practicable.
- G. Cut pipe ends square, ream pipe and tube ends to full pipe diameter, remove burrs.
- H. Beveling: Grind smooth and bevel cut ends and rough edges using methods recommended by the manufacturer and approved by Engineer.
- I. Bolt holes of flanges shall straddle the horizontal and vertical centerlines of the pipe. Clean flanges by wire brushing before installing flanged fittings. Lubricate bolts and tighten nuts uniformly and progressively. If flanges leak under pressure testing, loosen or remove the nuts and bolts, reset or replace the gasket, reinstall or retighten the bolts and nuts, and retest the joints. Joints shall be watertight.
- J. Provide a flange insulation kit at all flanges between dissimilar metals whether shown on the Drawings or not.
- K. Install access fittings to permit disinfection of water system.

3.4 INSTALLING FLANGED PIPING

- A. Set pipe with the flange bolt holes straddling the pipe horizontal and vertical centerline. Install pipe without springing, forcing, or stressing the pipe or any adjacent connecting valves or equipment. Before bolting up, align flange faces to the design plane within 1/16 inch per foot measured across any diameter. Align flange bolt holes within 1/8-inch maximum offset.
- B. Inspection for Defects: Before installation, inspect pipe and appurtenances for defects and, when applicable, tap the pipe with a light hammer to detect cracks. Reject defective, damaged, or unsound pipe and appurtenances.
- C. Inspect each gasket to verify that it is the correct size, material, and type for the specified service and that it is clean and undamaged. Examine bolts or studs, nuts, and washers for defects such as burrs or cracks and rust and replace as needed.
- D. Clean flanges by wire brushing before installing flanged fittings. Clean flange bolts and nuts by wire brushing, lubricate carbon steel bolts with oil and graphite, and tighten nuts uniformly and progressively.
- E. Bolt lengths shall extend completely through their nuts. Any that fail to do so shall be considered acceptably engaged if the lack of complete engagement is not more than one thread.
- F. Do not use more than one gasket between contact faces in assembling a flanged joint.
- G. Tighten the bolts to the manufacturer's specifications, using the recommended cross bolt pattern in

multiple steps of increasing torque, until the final torque requirements are achieved. Do not over torque.

- H. If flanges leak under pressure testing, loosen or remove the nuts and bolts, reset or replace the gasket, reinstall or retighten the bolts and nuts, and retest the joints. Joints shall be watertight.
- I. Install access fittings to permit disinfection of water system.

3.5 INSTALLING BLIND FLANGES

- A. At outlets not indicated to be connected to valves or to other pipes and to complete the installed pipeline hydrostatic test, provide blind flanges with bolts, nuts, and gaskets.
- B. Coat the inside face of blind flanges per Section 099000, System No. 12.

3.6 INSTALLING GROOVED-END PIPING

- A. Install grooved-end pipe and fittings in accordance with the coupling manufacturer's recommendations and the following.
- B. Clean loose scale, rust, oil, grease, and dirt from the pipe or fitting groove before installing coupling. Apply the coupling manufacturer's gasket lubricant to the gasket exterior including lips, pipe ends, and housing interiors.
- C. Fasten coupling alternately and evenly until coupling halves are seated. Use torques as recommended by the coupling manufacturer.
- D. Provide separate hangers and supports at both sides of flexible joints; see Section 400764.

3.7 INSTALLATION OF STAINLESS STEEL BOLTS AND NUTS

- A. Prior to assembly, coat threaded portions of stainless steel bolts and nuts with lubricant.

3.8 INSTALLATION OF SCHEDULE 80 PVC PIPING

- A. Cut pipe ends square and remove all burrs, chips, and filings before joining pipe or fittings. Bevel solvent welded pipe ends as recommended by the pipe manufacturer.
- B. Wipe away loose dirt and moisture from the ID and OD of the pipe end and the ID of the fitting before applying solvent cement. Do not apply solvent cement to wet surfaces.
- C. Make up solvent welded joints per ASTM D2855.
- D. Allow at least eight (8) hours of drying time before moving solvent welded joints or subjecting the joints to an internal or external loads or pressures.
- E. Tighten bolts on PVC flanges by tightening the nuts diametrically opposite each other using a torque wrench. Complete tightening shall be accomplished in stages.
- F. Cut threaded ends to the dimensions of ASME B1.20.1. Ends shall be square cut. Follow the pipe manufacturer's recommendations regarding pipe hold-down methods, saw cutting blade size, and saw cutting speed. Pipe or tubing cutters shall be specifically designed for use on PVC pipe.
- G. If a hold-down vise is used when the pipe is cut, insert a rubber sheet between the vise jaws and the pipe to protect from scratching the pipe.
- H. Thread cutting dies shall be clean and sharp and shall not be used to cut materials other than plastic.
- I. Apply Teflon thread compound or Teflon tape lubricant to threads before screwing on the fitting.
- J. Provide unions on exposed piping 3-inches and smaller as follows:
 - 1. Provide a union 6 to 12-inches downstream of valves.
 - 2. Upstream and downstream of equipment which may need to be removed for maintenance.
 - 3. Where shown in the Drawings.

END OF SECTION

SECTION 400515
PRESSURE TESTING OF PIPING

PART 1 GENERAL

1.1 DESCRIPTION

- A. This section specifies the cleaning and hydrostatic, pneumatic, and leakage testing of pressure piping for pumping stations, wastewater treatment plants; general water piping systems; and raw sewage force mains.

1.2 RELATED WORK SPECIFIED ELSEWHERE

- A. General Piping Requirements: 400500.
- B. Valves, General: 400524.

1.3 SUBMITTALS

- A. Submit shop drawings in accordance with Section 013300.
- B. Submit test bulkhead locations and design calculations, pipe attachment details, and methods to prevent excessive pipe wall stresses.
- C. Submit six copies of the test records to the Owner's Representative upon completion of the testing.

1.4 TEST PRESSURES

- A. Test pressures for the various services and types of piping are shown in:
 - 1. Subsection on "Test Pressure and Test Fluids" in Part 3.

1.5 TESTING RECORDS

- A. Provide records of each piping installation during the testing. These records shall include:
 - 1. Date and times of test.
 - 2. Identification of pipeline, or pipeline section tested or retested.
 - 3. Identification of pipeline material.
 - 4. Identification of pipe specification.
 - 5. Test fluid.
 - 6. Test pressure at low point in process, pipeline, or pipeline section.
 - 7. Remarks: Leaks identified (type and location), types of repairs, or corrections made.
 - 8. Certification by Contractor that the leakage rate measured conformed to the specifications.

PART 2 PRODUCTS

2.1 VENTS AND DRAINS FOR ABOVEGROUND PIPING

- A. Install vents on the high points of aboveground piping, whether shown in the drawings or not. Install drains on low points of aboveground piping, whether shown in the drawings or not. Provide a valve at each vent or drain point. Valves shall be 3/4 inch for piping 3 inches and larger and 1/2 inch for piping smaller than 3 inches.
 - 1. Valves shall be as specified in Section 400563 and suited for the application unless otherwise shown in the drawings.

2.2 MANUAL AIR-RELEASE VALVES FOR BURIED PIPING

- A. Provide temporary manual air-release valves at test bulkheads for pipeline test. Construct the pipe outlet in the same manner as for a permanent air valve and after use, seal with a blind flange, pipe cap, or plug and coat the same as the adjacent pipe.

2.3 TEST BULKHEADS

- A. Design and fabricate test bulkheads per Section VIII of the ASME Boiler and Pressure Vessel Code. Materials shall comply with Part UCS of said code. Design pressure shall be at least 2.0 times the specified test pressure for the section of pipe containing the bulkhead. Limit stresses to 70 percent of yield strength of the bulkhead material at the bulkhead design pressure. Include air-release and water drainage connections.

2.4 TESTING FLUID

- A. Testing fluid shall be water unless a pneumatic test is shown in the following subsections.
- B. For lubricating oil; hydraulic oil; fuel oil; and gasoline piping, use potable water for

hydrostatic testing and flushing.

- C. For potable water pipelines, obtain and use only potable water for hydrostatic testing.
- D. Submit request for use of water from waterlines of water utility 48 hours in advance.
- E. The Contractor may obtain the water from the water utility water utility's *rate of charges*.

2.5 TESTING EQUIPMENT

- A. Provide calibrated pressure gauges, pipes, bulkheads, pumps, compressors, and meters to perform the hydrostatic and pneumatic testing.

PART 3 EXECUTION

3.1 TESTING PREPARATION

- A. Pipes shall be in place, backfilled, and anchored before commencing pressure testing.
- B. Conduct pressure tests on exposed and aboveground piping after the piping has been installed and attached to the pipe supports, hangers, anchors, expansion joints, valves, and meters.
- C. For buried piping, the pipe may be partially backfilled, and the joints left exposed for inspection during an initial leakage test. Perform the final pressure test, however, after completely backfilling and compacting the trench.
- D. Provide any temporary piping needed to carry the test fluid to the piping that is to be tested. After the test has been completed and demonstrated to comply with the specifications, disconnect and remove temporary piping. Do not remove exposed vent and drain valves at the high and low points in the tested piping; remove any temporary buried valves and cap the associated outlets. Plug taps or connections to the existing piping from which the test fluid was obtained.
- E. Provide temporary drain lines needed to carry testing fluid away from the pipe being tested. Remove such temporary drain lines after completing the pressure testing. Pipes may remain full after testing.
- F. Prior to starting the test, the Contractor shall notify the Owner's Representative.

3.2 CLEANING

- A. Before conducting hydrostatic tests, flush pipes with water to remove dirt and debris. For pneumatic tests, blow air through the pipes. Maintain a flushing velocity of at least 3 fps for water testing and at least 2,000 fpm for pneumatic testing. Flush pipes for time period as given by the formula: $T=(2L)/3$, in which "T" is flushing time (seconds) and "L" is pipe length (feet).
- B. For pipelines 24 inches or larger in diameter, acceptable alternatives to flushing are use of high-pressure water jet, sweeping, or scrubbing. Water, sediment, dirt, and foreign material accumulated during this cleaning operation shall be discharged, vacuumed, or otherwise removed from the pipe.

3.3 TESTING AND DISINFECTION SEQUENCE FOR POTABLE WATER PIPING

- A. Perform required disinfection after hydrostatic testing, except when pipeline being tested is connected to a potable waterline.
- B. Locate and install test bulkheads, valves, connections to existing pipelines, and other appurtenances in a manner to provide an air gap separation between existing potable water pipelines and the pipeline being tested. Disinfect water and pipeline being tested before hydrostatic testing when connected to a potable waterline.

3.4 LENGTH OF TEST SECTION FOR BURIED PIPING

- A. The maximum length of test section for buried pipe of 12 inches or smaller in diameter is 1 mile; for buried pipe larger than 12 inches, 1 mile. Provide intermediate test bulkheads where the pipeline length exceeds these limits.

3.5 INITIAL PIPELINE FILLING FOR HYDROSTATIC TESTING

- A. Maximum rate of filling shall not cause water velocity in pipeline to exceed 1 fps. Filling may be facilitated by removing automatic air valves and releasing air manually.

3.6 TESTING NEW PIPE WHICH CONNECTS TO EXISTING PIPE

- A. Prior to testing new pipelines which are to be connected to existing pipelines, isolate the new line from the existing line by means of test bulkheads, pipe caps, spectacle flanges, or blind flanges. After successfully testing the new line, remove test bulkheads, caps, or flanges and connect to the existing piping.

3.7 HYDROSTATIC TESTING OF ABOVEGROUND OR EXPOSED PIPING

- A. Open vents at high points of the piping system to purge air while filling the pipe with water. Venting during system filling may also be provided by temporarily loosening flanges.
- B. Subject the piping system to the test pressure indicated. Maintain the test pressure for a minimum of two hours. Examine joints, fittings, valves, and connections for leaks. The piping system shall show zero leakage or weeping. Correct leaks and retest until zero leakage is obtained.
- C. Where the test pressure is not indicated, test each pressure piping system at 150 percent of the operating pressure indicated, but not less than 25 psi test pressure. The required test period is two hours. Observe each test section for leakage at end of test period. Test fails if leakage observed or pressure drop exceeds 5 percent of test pressure.
- D. Test hot and cold water piping systems subject to the Uniform Plumbing Code per Section 609 latest edition of the code. Piping subject to this testing requirement is listed below.

3.8 HYDROSTATIC TESTING OF BURIED PIPING

- A. Where any section of the piping contains concrete thrust blocks or encasement, do not perform the pressure test until at least 10 days after placing the concrete. When testing mortar-lined or PVC piping, fill the pipe to be tested with water and allow it to soak for at least 48 hours to absorb water before conducting the pressure test.
- B. Apply and maintain the test pressure by means of a positive displacement hydraulic force pump.
- C. Maintain the test pressure for the following duration by restoring it whenever it falls an amount of 5 psi:
 - 1. Pipe Diameter 18 inches and Less: 2 hours.
 - 2. Pipe Diameter 20 to 36 inches: 8 hours.
 - 3. Pipe Diameter Greater than 36 inches: 24 hours.
- D. After the test pressure is reached, use a meter to measure the additional water added to maintain the pressure. This amount of water is the loss due to leakage in the piping system. The allowable leakage volume is defined by the formula: $L=(HND \times \text{Square Root}[P])/C$. Where L=Allowable leakage (gallons), H=Specified test period (hours), N=Number of rubber-gasketed joints in the pipe tested (use zero for welded or flanged pipe), D=Diameter of the pipe (inches), P=Specified test pressure (psig), and C=7,400.
- E. After the test pressure is reached, use a meter to measure the additional water added to maintain the pressure. This amount of water is the loss due to leakage in the piping system. The allowable leakage volume is defined by the formula: $L=(HSD \times \text{Square Root}[P])/C$. Where L=Allowable leakage (gallons), H=Specified test period (hours), S=length of pipe tested (feet), D=Diameter of the pipe (inches), P=Specified test pressure (psig), and C=148,000.
- F. Test piping subject to the Uniform Fire Code requirements per NFPA 24. Test such piping hydrostatically at not less than 200-psi pressure for two hours or at 50 psi in excess of the maximum static pressure when the maximum static pressure is in excess of 150 psi. The amount of leakage in piping shall be measured at the specified test pressure by pumping from a calibrated container. The amount of leakage at the joints shall not exceed 2 quarts per hour per 100 gaskets or joints irrespective of pipe diameter. The piping subject to this testing requirement is listed below shown in the drawings.
- G. The allowable leakage for buried piping having threaded, brazed, or welded (including solvent welded) joints shall be zero.
- H. Repair and retest any pipes showing leakage rates greater than that allowed in the above criteria.

3.9 PNEUMATIC TESTING

- A. Perform pneumatic testing using dry air or nitrogen. Perform tests only after the piping has been completely installed including supports, hangers, and anchors. Protect test personnel and Owner's operating personnel. Secure piping to be tested to prevent the pipe from moving and to prevent damage to adjacent piping and equipment. Remove or isolate from the piping any appurtenant instruments or devices that could be damaged by the test prior to applying the test.
- B. Apply an initial pneumatic leakage test of 25 psig to the piping system prior to final leak testing. Examine for leakage, detected by soap bubbles, at joints and connections. After correcting visible leaks, gradually increase the pressure in the system to not more than one-half of the test pressure. Then increase the pressure in steps of approximately one-tenth of the test pressure until the required test pressure has been reached. Continuously maintain the pneumatic test pressure for a minimum time of four hours and for such additional time as may be necessary to conduct a soap bubble

examination for leakage. The piping system shall show no leakage. Correct any visible leakage and retest.

- C. Test piping systems subject to the Uniform Plumbing Code per Section **1214** of the **latest** edition of the code. Piping subject to this testing requirement is **listed below**.

3.10 REPETITION OF TEST

- A. If the actual leakage exceeds the allowable, locate and correct the faulty work and repeat the test. Restore the work and all damage resulting from the leak and its repair. Eliminate visible leakage.

3.11 BULKHEAD AND TEST FACILITY REMOVAL

- A. After a satisfactory test, remove the testing fluid, remove test bulkheads and other test facilities, and restore the pipe coatings.

3.12 TEST PRESSURE AND TEST FLUIDS

- A. Testing and design **pressures (psig)** for different types of process piping shall be as **listed below**.
 - 1. Force Main:
 - a. 50 psig test pressure. (Design operating pressure <19-31 psig w/out surge)
 - 2. Gravity Sewer, Gravity Process Lines:
 - a. Low Pressure Air (See Section 333100).
 - 3. Process Air:
 - a. 8 psig test pressure. (Design operating pressures 4 – 6.5 psig)

END OF SECTION

SECTION 400520
MISCELLANEOUS PROCESS VALVES

PART 1 - GENERAL

1.1 DESCRIPTION

- A. This section includes materials, testing, and installation of process valves including hose bibbs; globe; angle; needle; diaphragm; pinch; solenoid; pet cocks; mud valves; vacuum breakers; deluge valves; flap valves; balancing valves; gauge valves; instrument valve manifolds; and telescoping valves.

1.2 RELATED WORK SPECIFIED ELSEWHERE

- A. Painting and Coating: 099000 (and Paint System Schedule 09900.10)
- B. General Piping Requirements: 400500.
- C. Pressure Testing of Piping: 400515.
- D. Valves, General: 400524.
- E. Air-Release and Vacuum-Relief Valves: 400560.
- F. Plug Valves: 400562.
- G. Ball Valves: 400563.
- H. Check Valves for Specific Applications: 400565.
- I. Butterfly Valves: 400566.

1.3 SUBMITTALS

- A. Submit shop drawings in accordance with Section 013300.
- B. Submit manufacturer's catalog data and detailed construction sheets showing all valve parts. Describe each part by material of construction, specification (such as AISI, ASTM, SAE, or CDA), and grade or type. Identify each valve by tag number to which the catalog data and detail sheets pertain.
- C. Show valve dimensions including laying lengths. Show port sizes. Show dimensions and orientation of valve actuators, as installed on the valves.
- D. Show location of internal stops for gear actuators. State differential pressure and fluid velocity used to size actuators. For worm-gear actuators, state the radius of the gear sector in contact with the worm and state the handwheel diameter.
- E. Show valve linings and coatings. Submit manufacturer's catalog data and descriptive literature.
- F. Submit certification from manufacturer that valves are NSF 61 listed.
- G. Provide additional O&M data per Section 017823.

1.4 WARRANTY

- A. Full warranty against defects in materials and workmanship for one year after final acceptance, including all parts, labor, and expenses.

PART 2 - PRODUCTS

2.1 GENERAL

- A. Valves and the required actuators are identified by tag numbers on the drawings and in the Valve Schedule. See the Valve Schedule Section of Valves, General 400524.
- B. Valves shall be installed complete with flange gaskets, nuts and bolts, operating handwheels or levers, chainwheels, extension stems, floor stands, gear actuators, operating nuts, chains, and wrenches required for operation.
- C. Valves shall have the name of the manufacturer and the size of the valve cast or molded onto the valve body or bonnet or shown on a permanently attached plate.
- D. Bronze or brass material requirements:
 - 1. Any bronze or brass components in contact with water throughout the treatment process shall be made "Lead-Free" as defined in the "Reduction of Lead in Drinking Water Act." Lead-Free shall contain no more than twenty-five hundredth of one percent (0.25 percent or less) total lead contained by weight. The manufacturer shall certify that the bronze meets the "Lead-Free"

- requirements.
2. For buried locations, valves with mechanical joint ends may be substituted for the flanged ends specified provided the mechanical joint ends are compatible with the pipe ends.

2.2 VALVE ACTUATORS/OPERATORS

- A. Provide operator types in accordance with the Valve Schedule.
- B. Valves shall open by turning counterclockwise
- C. Valve Boxes: Furnish valve boxes for all buried valves.

2.3 BOLTS AND NUTS FOR FLANGED AND MECHANICAL JOINT VALVES

- A. Bolts and nuts for flanged valves shall be as described in Section 400500.
- B. Buried Service Bolts (for valve installation) shall be fluorocarbon coated cor-ten steel t-bolts and nuts equal to NSS cor-blue or approved equal low allow corrosion-resistant high-strength steel in accordance with ANSI/AWWA C111/A21.11.

2.4 GASKETS FOR FLANGES

- A. Gaskets for flanged end valves shall be as described in Section 400500.

2.5 LINING AND COATING

- A. Coat the exterior of metal valves located above ground or in vaults and structures the same as the adjacent piping. If the adjacent piping is not coated, then coat valves per Section 099000. Apply the specified prime coat at the place of manufacture. Apply intermediate and finish coats at the place of manufacturer or in the field. Finish coat shall match the color of the adjacent piping. Coat handwheels the same as the valves. Do not coat bronze, brass, or stainless steel valves.
- B. Coat the exterior of buried metal valves at the place of manufacture per Section 099000, System No. 10.
- C. Coat the exterior of submerged metal valves, stem guides, extension stems, and bonnets at the place of manufacture per Section 099000, System No. 12. Do not coat bronze, brass, or stainless steel valves.
- D. Line the interior metal parts of metal valves 4 inches and larger, excluding seating areas and bronze and stainless steel pieces, per Section 099000, System No. 12. Apply lining at the place of manufacture. Alternatively, line and coat valves with fusion-bonded epoxy per Section 099761.
- F. Alternatively, apply a fusion-bonded lining suitable for potable water in compliance with AWWA C550.
- G. Coat floor stands per Section 099000.
- H. Measure the thickness of the valve interior linings per Section 099000. Repair areas having insufficient film thickness per Section 099000.

2.6 PACKING, O-RINGS, AND GASKETS

- A. Unless otherwise stated in the detailed valve specifications, packing, O-rings, and gaskets shall be one of the following non-asbestos materials:
 1. Teflon.
 2. Kevlar aramid fiber.
 3. Acrylic or aramid fiber bound by nitrile. Products: Garlock "Bluegard," Klinger "Klingersil C4400," or equal.
 4. Buna-N (nitrile).
 5. EPDM.

2.7 RUBBER SEATS

- A. Rubber seats shall be made of a rubber compound that is resistant to free chlorine and monochloramine concentrations up to 10 mg/l in the fluid conveyed.

2.8 VALVE END CONNECTIONS

- A. Valve end connections for exposed valves shall be flanged unless shown otherwise. The Contractor shall verify the compatibility of valve ends, including class and drilling of flanges with the connecting pipe.
- B. Buried valve end connections shall be mechanical joint or a push-on unless shown otherwise in the Drawings or in the Valve Schedule.

2.9 VALVES

- A. Globe Valves, Angle Valves, Hose Valves, Hose Bibbs, and Fire Hydrants:
1. Bronze Globe Valves 2 Inches and Smaller:
 - a. Globe valves, 2 inches and smaller, shall be all bronze (ASTM B62 or ASTM B584, Alloy C83600) with screwed ends, union bonnet, inside screw, rising stem, and composition or PTFE disc.
 - b. Valves shall have a pressure rating of at least 300 psi at a temperature of 150 degrees F.
 - c. Stem shall be bronze: ASTM B371 (Alloy C69400), ASTM B99 (Alloy C65100), or ASTM B584 (Alloy C87600).
 - d. Valves shall be Crane No. 7TF, Walworth Figure 3095, Stockham B-22T, or equal.
 - 1) Bronze Angle Hose Valves:
 - (a) Angle-type hose valves of sizes 1-1/2 inches and 2-1/2 inches shall be brass or bronze (ASTM B62 or ASTM B584, Alloy C83600) body with rising or nonrising stem, composition disc, and bronze or malleable iron handwheel. Stem shall be bronze, ASTM B62, ASTM B584 (Alloy C83600), or ASTM B198 (Alloy C87600).
 - (b) Valves shall have a cold-water service pressure rating of at least 150 psi.
 - (c) Provide cap and chain with valve.
 - (d) Threads on the valve outlet shall be American National Standard fire hose coupling screw thread.
 - (e) Valves shall be Nibco T-301-HC, Powell Figure 151 with Figure 527 nipple adapter, Crane 17TF with hose nipple adapter, or equal.
 - 2) Bronze Angle Hose Valves (1-1/2-inch and 2-1/2-inch) with Quick Connect Coupling Adapters (for Nonpotable Water Service):
 - (a) Angle-type hose valves of sizes 1-1/2 and 2-1/2 inches shall have brass or bronze (ASTM B62 or B584, Alloy C83600) body with rising or nonrising stem, composition disc, and bronze or malleable iron hand wheel. Stem shall be bronze, ASTM B62, ASTM B585 (Alloy C83600), or ASTM B198 (Alloy C87600).
 - (b) Valve shall have cold-water service pressure rating of at least 150 psi.
 - (c) Threads on valve outlet shall be American National Standard fire hose coupling screw thread (ASME B1.20.7).
 - (d) Provide atmospheric vacuum breaker conforming to ASSE Standard 1011 and IAPMO code and approved by the local health department.
 - (e) Provide with quick connect female adapter to fit the quick connect male adapter on rubber water hose per specification section 221118.
 - (f) Products: Nibco T-301-HC, Powell Figure 151, Crane 17TF, or equal.
 - 3) Bronze Hose Bibbs:
 - (a) Hose bibbs of size 1/2 inch, 3/4 inch, and 1 inch shall be all bronze (ASTM B62 or ASTM B584, Alloy C83600) with rising or nonrising stem, composition disc, bronze or malleable iron handwheel, and bronze stem (ASTM B99, Alloy C65100; ASTM B371, Alloy C69400; or ASTM B584, Alloy C87600). Packing shall be Teflon or graphite.
 - (b) Valves shall have a pressure rating of at least 125 psi for cold-water service.
 - (c) Threads on valve outlet shall be American National Standard fire hose coupling screw thread (ASME B1.20.7).
 - (d) Provide atmospheric vacuum breaker conforming to ASSE Standard 1011 and IAPMO code and approved by the local health department.
 - (e) Valves shall be Jenkins Figure 112, 113, or 372, Nibco Figure T-113-HC, Powell Figure 503H, or equal.
 - 4) Bronze Hose Bibbs 1-inch with Quick Connect Coupling Adapters (for Nonpotable Water Service):
 - (a) Hose bibbs of sizes 1-inch shall be all bronze (ASTM B62 or ASTM B584, Alloy C83600) with rising or non-rising stem, composition disc, bronze or malleable iron hand wheel, and bronze stem (ASTM B99, Alloy C65100; ASTM B371, Alloy C69400; or ASTM B584, Alloy C87600). Packing shall be Teflon or graphite.
 - (b) Valve shall have a pressure rating of at least 125 psi for cold-water service.
 - (c) Threads on valve outlet shall be American National Standard fire hose coupling screw thread (ASME B1.20.7).
 - (d) Provide atmospheric vacuum breaker conforming to ASSE Standard 1011 and

- IAPMO code and approved by the local health department.
- (e) Provide with quick connect female coupling to fit the quick connect male adapter on the rubber water hose per specification section 221118.
 - (f) Products: Jenkins Figure 112, 113, or 372; Nibco Figure T-113-HC; Powell Figure 503H; or equal.
- 5) Hose Valves (3/4 Inch) with Quick Connect Coupling Adapters (for Nonpotable Water Service):
 - (a) Brass body, pressure rating of at least 125 psi cold water, 3/4-inch NPT female inlet, 3/4-inch male hose thread outlet, lock shield bonnet, and removable handle.
 - (b) Provide atmospheric vacuum breaker conforming to ASSE Standard 1011 and IAPMO code and approved by the local health department.
 - (c) Provide with quick connect female adapter to fit the quick connect male adapter on the rubber water hose per Section 221118.
 - (d) Products: Acorn 8126 surface pipe mounted valve with bent nose without flange; Acorn 8121 mount through wall valve with bent nose with flange; Acorn 8131 pipe and pedestal mounted valve located above 6 inches, straight nose; Acorn 8136 pedestal mounted valve located lower than 6 inches, inverted nose; or equal.
 - 6) Bronze Needle Valves 3/4 Inch and Smaller:
 - (a) Needle valves shall be all bronze (ASTM B61, ASTM B62, or ASTM B584, Alloy C83600) with screwed ends, screwed bonnet, and rising stem.
 - (b) Valves shall have a pressure rating of at least 400 psi at a temperature of 150 degrees F.
 - (c) Stem shall be bronze: ASTM B98 (Alloy C65100), ASTM B150 (Alloy C64200), ASTM B584 (Alloy C87600), or ASTM B371 (Alloy C69400).
 - (d) Valves shall be Stockham B-64, Crane No. 88, or equal.
 - 7) Stainless Steel Globe Valves 2 Inches and Smaller:
 - (a) Globe valves 2 inches and smaller shall have bodies, stems, packing nuts, glands, bonnets, union bonnet rings, discs, and disc nuts made of Type 316 stainless steel (ASTM A351, Grade CF8M; or ASTM A276). Packing shall be Teflon.
 - (b) Provide screwed ends (ASME B1.20.1), rising stem, and malleable iron or aluminum handwheel.
 - (c) Valves shall have a pressure rating of at least 150 psig at a temperature of 200 degrees F.
 - (d) Valves shall be Jenkins Figure 1308, Crane/Alloyco Figure 40, or equal.
 - 8) Brass Angle Valves for Use in Fire Protection Service:
 - (a) Valves for use at fire hose racks shall be nominal 1-1/2-inch size, with female NPT inlet and outlet. Valves shall be UL listed and FM rated for fire protection service.
 - (b) Valve shall be constructed of brass with an iron handwheel, painted red.
 - (c) Valve shall be rated for at least 300-psi working pressure.
 - (d) Valves shall be Potter-Roemer Fig. 4070, Allenco Fig. 171, or equal.
 - 9) Bronze Angle Valves 2 Inches and Smaller:
 - (a) Angle valves, 2 inches and smaller, shall be all bronze (ASTM B62 or ASTM B584, Alloy C83600) with screwed ends, union or screwed bonnet, inside screw, rising stem, and bronze disc.
 - (b) Valves shall have a pressure rating of at least 200 psi.
 - (c) Stem shall be bronze: ASTM B371 (Alloy C69400 or C69700).
 - (d) Valves shall be Stockham B-222T, Lunkenheimer Figure 2141, or equal.
 - 10) Wet Barrel Fire Hydrants (AWWA C503):
 - (a) See Section 331219.
 - 11) Dry Barrel Fire Hydrants (AWWA C502):
 - (a) See Section 331219.
 - 12) Angle Fire Hydrants (Wharf Head Valves--AWWA C503):
 - (a) See Section 331219.
2. Diaphragm Valves:
 - a. Cast-Iron Diaphragm Valves 3/4 Inch Through 8 Inches:
 - 1) Diaphragm valves, sizes 3/4 inch through 8 inches, shall be of the weir type complying with MSS SP-83, Category B, with cast-iron (ASTM A48, Class 30, or ASTM A126, Class B) body bonnet and lining suited for application. Diaphragm shall be suited for the application.

- 2) O-rings shall be Teflon. Body-bonnet joint bolting stem, bushing, and travel stop shall be Type 304 stainless steel (ASTM A193, Grade B8).
- 3) Valve shall be manual handwheel operated with rising indicator stem or rising handwheel.
- 4) Valves shall have a minimum pressure rating of 100 psi at a temperature of 120 degrees F.
- 5) Ends shall be flanged, Class 125, ASME B16.1.
- 6) Valves shall be ITT Dia-Flo, Saunders Weir Type, or equal.
- 7) Cast-Iron Diaphragm Valves With Extension Stems:
 - (a) Diaphragm valves, sizes 3/4 inch through 8 inches, shall be of the weir type complying with MSS SP-83, Category B, with cast-iron (ASTM A48, Class 30, or ASTM A126, Class B) body bonnet, and lining suited for application. Diaphragm shall be suited for the application.
 - (b) O-rings shall be Teflon. Body-bonnet joint bolting stem, bushing, and travel stop shall be Type 304 stainless steel (ASTM A193, Grade B8).
 - (c) Valves shall have 2-inch-square operating nut with extension stem actuator.
 - (d) Valves shall have a minimum pressure rating of 100 psi at a temperature of 120 degrees F.
 - (e) Ends shall be flanged, Class 125, ASME B16.1.
 - (f) Valves shall be ITT Dia-Flo, Saunders Weir Type, or equal.
- 8) PVC Diaphragm Valves 1/2 Inch Through 4 Inches:
 - (a) Diaphragm valves, sizes 1/2 inch through 4 inches, shall be of the weir type with PVC bodies and PVC or polypropylene bonnets. PVC shall comply with ASTM D1784, Cell Classification 12454. Polypropylene shall comply with ASTM D4101. Body wall thickness shall conform to Schedule 80 per ASTM D1785.
 - (b) Valve diaphragms shall be EPDM; Viton; or PTFE. Provide elastomer backing for PTFE diaphragms.
 - (c) O-rings shall be EPDM or Viton. Body-bonnet bolting shall be Type 304 stainless steel (ASTM B193, Grade B8) or Hastelloy C (ASTM F468, Grade N10276).
 - (d) Provide polypropylene manual handwheel actuator with rising indicator stem.
 - (e) Minimum pressure rating shall be 150 psi at a temperature of 73 degrees F and 135 psi at a temperature of 110 degrees F.
 - (f) Ends for valves 2 inches and smaller shall be true union with socket weld connections. Ends for valves larger than 2 inches shall be flanged, Class 125, ASME B16.1.
 - (g) Products: Spears Manufacturing Company, ITT Dia-Flo, or equal.
- 9) PVC Diaphragm Valves 1/2 Inch Through 4 Inches in Sodium Hypochlorite Service:
 - (a) Diaphragm valves, sizes 1/2 inch through 4 inches, shall be of the weir type with PVC bodies and PVC or polypropylene bonnets. PVC shall comply with ASTM D1784, Cell Classification 12454. Polypropylene shall comply with ASTM D4101. Body wall thickness shall conform to Schedule 80 per ASTM D1785.
 - (b) Valve diaphragms shall be PTFE coated. Provide Buna-N elastomer backing for diaphragms.
 - (c) O-rings shall be Viton. Body-bonnet bolting shall be Hastelloy C (ASTM F468, Grade N10276).
 - (d) Provide polypropylene manual handwheel actuator with rising indicator stem.
 - (e) Minimum pressure rating shall be 150 psi at a temperature of 73 degrees F and 135 psi at a temperature of 110 degrees F.
 - (f) Ends for valves 2 inches and smaller shall be true union with socket weld connections. Ends for valves larger than 2 inches shall be flanged, Class 125, ASME B16.1.
 - (g) Products: Spears Manufacturing Company or ITT Dia-Flo or equal.
- 10) CPVC Diaphragm Valves 1/2 Inch Through 4 Inches:
 - (a) Diaphragm valves, sizes 1/2 inch through 4 inches, shall be of the weir type with CPVC bodies and CPVC or polypropylene bonnets. CPVC shall comply with ASTM D1784, Cell Classification 23447 or 23547B. Polypropylene shall comply with ASTM D4101. Body wall thickness shall conform to Schedule 80 per ASTM F441.
 - (b) Valve diaphragms shall be EPDM; Viton; or PTFE. Provide elastomer

- backing for PTFE diaphragms.
 - (c) O-rings shall be EPDM or Viton.
 - (d) Body-bonnet bolting shall be Type 304 stainless steel (ASTM B193, Grade B8) or Hastelloy C (ASTM F468, Grade N10276).
 - (e) Provide polypropylene manual handwheel actuator with rising indicator stem. Minimum pressure rating shall be 150 psi at a temperature of 73 degrees F and 110 psi at a temperature of 140 degrees F.
 - (f) Ends for valves 2 inches and smaller shall be true union with socket weld connections. Ends for valves larger than 2 inches shall be flanged, Class 125, ASME B16.1.
 - (g) Products: Spears Manufacturing Company, ITT Dia-Flo, or equal.
- 11) CPVC Diaphragm Valves 1/2 Inch Through 4 Inches in Sodium Hypochlorite Service:
- (a) Diaphragm valves, sizes 1/2 inch through 4 inches, shall be of the weir type with PVC bodies and PVC or polypropylene bonnets. PVC shall comply with ASTM D1784, Cell Classification 12454. Polypropylene shall comply with ASTM D4101. Body wall thickness shall conform to Schedule 80 per ASTM D1785.
 - (b) Valve diaphragms shall be PTFE coated. Provide Buna-N elastomer backing for PTFE diaphragms.
 - (c) O-rings shall be Viton.
 - (d) Body-bonnet bolting shall be Hastelloy C (ASTM F468, Grade N10276).
 - (e) Provide polypropylene manual handwheel actuator with rising indicator stem.
 - (f) Minimum pressure rating shall be 150 psi at a temperature of 73 degrees F and 135 psi at a temperature of 110 degrees F.
 - (g) Ends for valves 2 inches and smaller shall be true union with socket weld connections. Ends for valves larger than 2 inches shall be flanged, Class 125, ASME B16.1.
 - (h) Products: Spears Manufacturing Company, ITT Dia-Flo, or equal.
3. Pinch Valves:
- a. Pinch Valves 1 Inch Through 8 Inches:
 - 1) Pinch valves of sizes 1 inch through 8 inches shall have cast-iron (ASTM A48, Class 30) bodies with totally enclosed actuators and full port design. Sleeves shall be neoprene, Buna-N, or Hypalon. Stems shall be stainless steel or galvanized steel.
 - 2) Ends shall be flanged, ASME B16.1, Class 125.
 - 3) Valves shall be handwheel operated with upper and lower pinch bars.
 - 4) Valves installed on the end of a pipe shall be provided with a Type 304 stainless steel retaining ring to hold the sleeve end in place.
 - 5) Positive Opening Tabs:
 - (a) Ensure that sleeve will not collapse under less than 2 psig internal pressure.
 - (b) Stainless steel with stainless steel fasteners attached to top and bottom pinch bars.
 - (c) Attached to nylon reinforced external band around full circumference of sleeve.
 - (d) Band width: Full width of pinch bars.
 - (1) Valves shall be Red Valve Series 75, Flexible Valve Corporation Series 2100, Galligher "SIGMA," or equal.
 - 6) Pinch Valves 1 Inch Through 8 Inches With Extension Stems:
 - (a) Pinch valves of sizes 1 inch through 8 inches shall have cast-iron (ASTM A48, Class 30) bodies with totally enclosed actuators and full port design. Sleeves shall be neoprene, Buna-N, or Hypalon. Stems shall be stainless steel or galvanized steel.
 - (b) Ends shall be flanged, ASME B16.1, Class 125.
 - (c) Valves shall have 2-inch-square AWWA operating nuts with extension stem actuators. Valves shall have upper and lower pinch bars.
 - (d) Valves installed on the end of a pipe shall be provided with a Type 304 stainless steel retaining ring to hold the sleeve end in place.
 - (e) Positive Opening Tabs:
 - (1) Ensure that sleeve will not collapse under less than 2 psig internal pressure.
 - (2) Stainless steel with stainless steel fasteners attached to top and bottom pinch bars.
 - (3) Attached to nylon reinforced external band around full circumference of

- sleeve.
 - (4) Band width: Full width of pinch bars.
 - (5) Valves shall be Red Valve Series 75, Galligher "SIGMA," or equal.
- 4. Solenoid Valves:
 - a. Design and construct solenoid valves such that they can be used in both horizontal and vertical piping. Provide strainers on solenoid valve supply.
 - 1) Metallic Solenoid Valves 1-1/2 Inches and Smaller:
 - (a) Solenoid valves of sizes 1/4 inch through 1-1/2 inches for water and air service shall have forged brass (Alloy C23000) or bronze (ASTM B62) bodies with Teflon main seats. Internal plunger, core tube, plunger spring, and cage assembly shall be stainless steel (Types 302, 304, or 305).
 - (b) Solenoid enclosures shall be NEMA 1 or NEMA 4; except where explosion-proof is noted in the drawings.
 - (c) Valve actuators shall be 120-volt a-c.
 - (d) Seals shall be Teflon.
 - (e) Valves shall have a maximum operating pressure and a maximum differential pressure of 125 psi.
 - (f) Solenoid valves shall be energized to *open*.
 - (g) Valves shall be ASCO "Redhat" 8210 Series or Parker Hannifin "Skinner" Model equal.
 - 2) Plastic Solenoid Valves 1/4 Inch Through 1 Inch:
 - (a) Solenoid valves of sizes 1/4 inch through 1 inch for water and chemical services shall have CPVC bodies with EPDM seals. Valve bodies shall be of the true union design with threaded end connections with the coil assembly contained in a molded polyester housing. Plunger or core tube shall be Teflon or polypropylene.
 - (b) Solenoid enclosures shall be NEMA 4X.
 - (c) Valve actuators shall be 120 volts a-c.
 - (d) Valves shall have a minimum operating pressure of 120 psi and a maximum differential pressure of 25 psi on either side of the valve, with the valve in the closed position.
 - (e) Solenoid valves shall be energized to open.
 - (f) Products: Hayward or equal.
 - 3) Pilot-Operated Solenoid Valves 1/2 Inch Through 2 Inches:
 - (a) Pilot-operated solenoid valves of sizes 1/2 inch through 2 inches for water and chemical services shall have PVC; CPVC; PVDF (Kynar); or polypropylene bodies with Viton or EPDM seals.
 - (b) Valve bodies shall be of a design in which threaded NPT connections are molded into the valve body. The coil assembly shall be contained in a molded housing of the same material as the valve body or of molded polyester. Plunger or core tube shall be Teflon or polypropylene.
 - (c) When the valve is pressurized and the coil is energized, the coil shall create an electromagnetic field in the top section of the core tube. The resulting electromagnetic force shall pull the core and pilot seat upward, opening the pilot valve. The liquid above the diaphragm shall then vent through the open orifice of the pilot valve to the downstream piping. The inlet pressure under the diaphragm shall lift the diaphragm and open the main valve orifice. When the coil is de-energized, the pilot solenoid spring shall push the core and pilot seat downward, closing the pilot valve. Pressure above the diaphragm shall rise to the inlet pressure level, forcing the diaphragm downward against the main valve seat, sealing the valve.
 - (d) Solenoid enclosures shall be NEMA 4X.
 - (e) Actuators shall be 120 volts a-c.
 - (f) Valve shall sustain a minimum backpressure of 70 psi on the downstream side of the valve, with the valve in the closed position. Minimum inlet pressure rating shall be 140 psi at a temperature of 75 degrees F.
 - (g) Solenoid valves shall be energized to open.
 - (h) Products: Plast-O-Matic Series PS or equal.
 - 4) Three-Way Metallic Solenoid Valves 1/2 Inch and Smaller:
 - (a) Solenoid valves of sizes 1/8 inch through 1/2 inch for water service shall have

8. Deluge Valves:
 - a. Deluge Valves, 2 Inches:
 - 1) Deluge valves shall be nominal 2-inch size, with a 2-inch NPT inlet connection, at least a 1-1/2-inch NPT discharge connection, and NPT trim connections.
 - 2) Valves shall be rated for at least 175-psi working pressure, and be UL listed and FM approved for fire protection service.
 - 3) The valve body and cover shall be constructed of ductile iron. The valve clapper, seat, and clamp ring shall be constructed of bronze.
 - 4) Provide valves with all trim necessary for electric actuation as indicated in the drawings.
 - 5) Valves shall be Viking Model E-1, Gem Model B Flooding, or equal.

9. Flap Valves:
 - a. Flap Valves (Cast-Iron):
 - 1) Flap valves shall have cast-iron body (ASTM A48 or A126) with bronze (ASTM B62) hinge pin, flap ring, and seat.
 - 2) Ends shall be flanged, spigot end, or hub to match the connecting pipe.
 - 3) Products: Clow F-3012, F-3014, F-3016; Waterous Flap Valves; Waterman Industries; or equal.
 - b. Flap Valves (Non-Metallic):
 - 1) Flap valves or gates shall have a reinforced copolymer or stainless steel body with a flap made of non-metallic material resistant to ultraviolet light.
 - 2) Body of the valve shall not be less than 1/4 inch thick for valve sizes 12-inch diameter and smaller, and 1/2 inch thick for larger valve sizes.
 - 3) Cover (flap) shall be held in place with a clamp bar and Type 316 stainless steel threaded fastener no smaller than 5/16 inch diameter.
 - 4) Hinge shall be suitably reinforced with encapsulated fabric to prevent any water from contacting the fabric.
 - 5) Weight shall be molded into the non-metallic flap material to aid in proper quick closure and to prevent material distortion.
 - 6) Hinge and flap assembly shall be readily replaceable while the gate is in service.
 - 7) Flap gates shall open when there is a differential pressure across the flap of 0.2-feet or less and be designed to meet seating pressures listed in the Valve Schedule.
 - 8) With the flap gate submerged, the head loss shall not exceed 0.3-feet at all exit velocities for gates 60-inches or smaller.
 - 9) Allowable leakage through the flap gate, due to seating load, shall not exceed 0.2 gallons per minute per foot of wetted perimeter.
 - 10) Ends shall be flanged and capable of mounting to a Class 125/150 bolt pattern flanged pipe. Provide gasket between flap gate and connecting pipe.
 - (a) Flap valve materials shall be compatible with a pH range of 7.0 to 9.0 or and a maximum chlorine concentration of 4.0 mg/L and a maximum fluoride concentration of 1.0 mg/L.
 - (b) Products: Plasti-Fab, Hydro Gate, Whipps, Inc, or equal.

10. Balancing Valves, Gauge Valves, and Valve Manifolds:
 - a. Balancing Valve:
 - 1) Construct valves of bronze.
 - 2) Valves shall have a machined orifice flow restriction, internal O-rings, a rated working pressure of at least 300 psi, flow setting indicating pointer and calibrated nameplate, and a pressure readout valve port on each side of the orifice.
 - 3) Equip pressure ports with integral check valves.
 - 4) Connections shall be NPT.
 - 5) Valves shall be Bell & Gosset Circuit Setter, Illinois Series 6000, or equal.
 - 6) Gauge Valve:
 - (a) Gauge valves shall be a combination isolation and vent valve with a minimum pressure rating of 3,000 psi at 200 degrees F.
 - (b) Isolation valve shall have interchangeable hard or soft seat.
 - (c) Body, bonnet, and stem shall be Type 316 stainless steel. Packing shall be Teflon or Buna-N.
 - (d) Valves shall have screwed ends and nonblowout stems.

- (e) Valves shall be AGCO M9 gauge valve or equal.
- 7) 1/2-Inch Stainless Steel Two-Valve Manifolds:
 - (a) Provide manifold body block with separate block valve and calibration or bleed valve.
 - (b) Provide three ports: inlet (process), outlet (instrument), and calibration or bleed port.
 - (c) Minimum pressure rating shall be 6,000 psi at a temperature of 100 degrees F.
 - (d) Valve body, stem, side rings, disc rings, bonnet, valve handles, and packing nut shall be Type 316 stainless steel (ASTM A276, A351, or A479). Upper and lower packing shall be Teflon or UHMWPE.
 - (e) Provide hardened Type 316 stainless steel ball tips on manifold stems.
 - (f) Provide vee stem with replaceable Teflon, PFA; or Delrin seat on manifold stems.
 - (g) End connections shall be 1/2-inch female NPT per ASME B1.20.1.
 - (h) Provide Type 316 stainless steel pipe mounting bracket assembly consisting of bracket, U-bolts, cap screws, nuts, and lock washers.
 - (i) Product: Whitey Series M2 or equal.
- 8) 1/2-Inch Stainless Steel Three-Valve Manifolds:
 - (a) Provide manifold body block with separate block valves and equalizer valve.
 - (b) Provide four main ports: two valve-size inlet (process) and two valve-size outlet (instrument) ports. Provide two 1/4-inch body connections with hex key pipe plugs for bleed service.
 - (c) Minimum pressure rating shall be 750 psi at a temperature of 100 degrees F.
 - (d) Valve body, stem, side rings, disc rings, bonnet, valve handles, and packing nut shall be Type 316 stainless steel (ASTM A276, A351, or A479). Upper and lower packing shall be Teflon or UHMWPE.
 - (e) Provide hardened Type 316 stainless steel ball tips on manifold stems.
 - (f) Provide vee stem with replaceable Teflon PFA or Delrin seat on manifold stems.
 - (g) Provide two 1/4-inch purge connections with hex key plugs.
 - (h) End connections shall be **1/2-inch female NPT per ASME B1.20.1; or of the nut-and-ferrule type for connection to tubing>>**.
 - (i) Provide Type 316 stainless steel pipe mounting bracket assembly consisting of bracket, U-bolts, cap screws, nuts, and lock washers.
 - (j) Product: Whitey Series M3 or equal.
- 9) 1/2-Inch Stainless Steel Five-Valve Manifolds:

11. Telescoping Valves 12 Inches and Smaller:

- a. Fabricate plain; flared; V-notch; or U-notch telescoping valve tube from Type 304 stainless steel with a minimum wall thickness of 1/8 inch.
- b. Provide Type 304 stainless steel lifting strap, companion flange, stem, fasteners, and hardware.
- c. Provide Buna-N or neoprene gasket for watertight seal around the sliding tube.
- d. Valve travel shall be as shown in the drawings.
- e. Provide nonrising stem with offset handwheel actuator
- f. Provide Type 304 stainless steel anchor bolts for actuator pedestal.
- g. Manufacturers: Waterman Industries, Inc., Coldwell-Wilcox Company, or equal.

PART 3 - EXECUTION

3.1 JOINTS

- A. Bolt holes of flanged valves shall straddle the horizontal and vertical centerlines of the pipe run to which the valves are attached. Clean flanges by wire brushing before installing flanged valves. Clean flange bolts and nuts by wire brushing, lubricate threads with oil and graphite, and tighten nuts uniformly and progressively. If flanges leak under pressure testing, loosen or remove the nuts and bolts, reseal or replace the gasket, reinstall or retighten the bolts and nuts, and retest the joints. Joints shall be watertight.
- B. Clean threaded joints by wire brushing or swabbing. Apply Teflon joint compound or Teflon tape to pipe threads before installing threaded valves. Joints shall be watertight.
- C. Install lug-type valves with separate hex head machine bolts at each bolt hole and each flange (two bolts per valve bolt hole).
- D. Install grooved-end couplings for valves in accordance with Section 400500.

3.2 INSTALLING EXPOSED VALVES

- A. Install in accordance with manufacturer's instructions.
- B. Unless otherwise indicated in the drawings, install valves in horizontal runs of pipe having centerline elevations 4 feet 6 inches or less above the floor with their operating stems vertical. Install valves in horizontal runs of pipe having centerline elevations between 4 feet 6 inches and 6 feet 9 inches above the floor with their operating stems horizontal.
- C. Install valves on vertical runs of pipe that are next to walls with their stems horizontal, away from the wall. Valves on vertical runs of pipe that are not located next to walls shall be installed with their stems horizontal, oriented to facilitate valve operation.

3.3 INSTALLING BURIED VALVES

- A. Connect the valve, coat the flanges, or apply tape wrapping or polyethylene encasement, and place and compact the backfill to the height of the valve stem.
- B. Place block pads under the extension pipe to maintain the valve box vertical during backfilling and repaving and to prevent the extension pipe from contacting the valve bonnet.
- C. Mount the upper slip pipe of the extension in midposition and secure with backfill around the extension pipe. Pour the concrete ring allowing a depression so the valve box cap will be flush with the pavement surface.
- D. Install debris cap as close as possible under the cast-iron cover without interfering with the cover operation. Trim flexible skirt to provide a smooth contact with the interior or the extension pipe.

3.4 FIELD COATING BURIED VALVES

- A. Coat flanges of buried valves and the flanges of the adjacent piping, and the bolts and nuts of flanges and mechanical joints, per Section 099000, System No. 10.
- B. Wrap buried metal valves 6 inches and larger with polyethylene sheet.
- C. Wrap buried metal valves 6 inches and larger in two layers of polyethylene conforming to AWWA C105, 8 mils in thickness each. Pass the two sheets of polyethylene under the valve and the coated flanges or joints with the connecting pipe and draw the sheets around the valve body, the valve bonnet, and the connecting pipe. Secure the sheets with plastic adhesive tape about the valve stem below the operating nut and about the barrel of the connecting pipe to prevent the entrance of soil. Fold overlaps twice and tape. Backfill the valve with care to avoid damaging the polyethylene.

3.5 MOUNTING GEAR ACTUATORS

- A. The valve manufacturer shall select and mount the gear actuator and accessories on each valve and stroke the valve from fully open to fully closed prior to shipment.

3.6 VALVE FIELD TESTING

- A. Operate manual valves through three full cycles of opening and closing. Valves shall operate from full open to full close without sticking or binding. Do not backfill buried valves until after verifying that valves operate from full open to full closed. If valves stick or bind, or do not operate from full open to full closed, repair or replace the valve and repeat the tests.
- B. Gear actuators shall operate valves from full open to full close through three cycles without binding or sticking. The pull required to operate handwheel- or chainwheel-operated valves shall not exceed 80 pounds. The torque required to operate valves having 2-inch AWWA nuts shall not exceed 150 ft-lbs.

If actuators stick or bind or if pulling forces and torques exceed the values stated previously, repair or replace the actuators and repeat the tests. Operators shall be fully lubricated in accordance with the manufacturer's recommendations prior to operating.

- C. After flap valve/gate installation, exercise each valve from the closed position to fully open position and back to the closed position at least twice and verify if valve is properly seated.

END OF SECTION

**SECTION 400524
VALVES, GENERAL**

PART 1 GENERAL

1.1 WORK INCLUDED

- A. The Contractor shall provide all tools, supplies, materials, equipment, and labor necessary for furnishing, epoxy coating, installing, adjusting, and testing of all valves and appurtenant work, complete and operable, in accordance with the requirements of the Contract Documents. Where buried valves are shown, the Contractor shall furnish and install valve boxes to grade, with covers, extensions, and position indicators.
- B. The provisions of this Section shall apply to all valves and valve operators specified in the various Sections of these Specifications except where otherwise specified in the Contract Documents. Valves and operators in particular locations may require a combination of units, sensors, limit switches, and controls specified in other sections of these Specifications.

1.2 CONTRACTOR SUBMITTALS

- A. Shop Drawing. Shop drawings of all valves and operators including associated wiring diagrams and electrical data, shall be furnished as specified in Section entitled "Shop Drawings, Project Data and Samples".
- B. Valve Labeling. The Contractor shall submit a schedule of valves to be labeled indicating in each case the valve location and the proposed wording for the label.

1.3 QUALITY ASSURANCE

- A. Valve Testing. Unless otherwise specified, each valve body shall be tested under a test pressure equal to twice its design water-working pressure.
- B. Bronze Parts. Unless otherwise specified, all interior bronze parts of valves shall conform to the requirements of ASTM B 62, or, where not subject to dezincification, to ASTM B 584.

PART 2 PRODUCTS

2.1 VALVES

- A. General: The Contractor shall furnish all valves, gates, valve-operating units, stem extensions, and other accessories as shown or specified. All valves and gates shall be new and of current manufacture.
- B. Shut-off valves mounted higher than 6-feet above working level shall be provided with chain operators. All valves shall have a minimum design pressure rating of 150 psi and capable of a test pressure of 300 psi. For service applications with pressures in excess of 150 psi, valves shall have a minimum pressure rating in excess of the service application working pressure.
- C. Cast iron parts of valves shall meet the requirements of ASTM A 126. Flanged ends shall be flat-faced and have bolt circle and bolt patterns conforming to ANSI/ASME B16.1, Class 125, unless otherwise specified hereinafter.
- D. All castings shall be clean and sound, without defects of any kind and no plugging, welding or repairing of defects will be permitted. All bolt heads and nuts shall be hexagonal conforming to ANSI B18.2. Gaskets shall be full face and made of natural or synthetic elastomers in conformance with ANSI B16.21 suitable for the service characteristics, especially chemical compatibility, and temperature. Nonferrous alloys of various types shall be used for parts of valves as specified. Where no definite specification is given, the material shall be the recognized acceptable standard for that particular application.
- E. All buried valves shall be provided with cast-iron valve boxes unless otherwise indicated. The boxes shall be asphalt varnished, or enameled cast iron, adjustable to grade, and installed perpendicularly, centered around, and covering the upper portions of the valve or valve operator, or the pipe. The top of each valve box shall be placed flush with finish grade unless otherwise indicated on the Drawings. Valve boxes shall be as specified elsewhere in this section.
- F. All buried valves and other valves located below the concrete operating deck or level, specified or noted to be key operated, shall have an operator to finish grade or deck level, a 2-inch square AWWA operating nut, and cover or box and cover, as may be required.
- G. Protective Coating: Except where otherwise specified, ferrous surface except stainless steel in the interior passages of all valves 4-inch and larger, as well as the exterior surfaces of all submerged valves, shall receive a fusion-bonded epoxy coating in accordance with AWWA C550. Flange faces of valves shall not be epoxy coated. The Contractor, through the valve manufacturer, shall certify in writing that such coating has been applied and tested in the

- manufacturing plant prior to shipment, in accordance with these Specifications.
- H. Valve Operators: Where shown, certain valves shall be furnished with operators, provided by the valve or gate manufacturer. All operators of a given type shall be furnished by the same manufacturer. All valve operators, regardless of type, shall be installed, adjusted, and tested by the valve manufacturer at the manufacturing plant.
 - I. All operators, unless otherwise specified, shall turn counterclockwise to open. Operators shall have the open direction clearly and permanently marked. All valve operators, manual, motor and pneumatic, shall be provided with the valve by the valve manufacturer. The Contractor, through the valve manufacturer, shall be solely responsible for the selection of the proper operator to meet the operating conditions specified herein. Field calibration and testing of the operators and valves to ensure a proper installation and an operating system shall be the responsibility of the Contractor.
 - J. Unless otherwise specified, all manual operators shall have levers or handwheels. Where buried, the valves shall have extensions with square nuts or floor stands. Tee wrenches for buried valves and hydrants shall be provided at a rate of one (1) per five (5) valves/hydrants. Valves mounted higher than 7'6" above floor or operating level shall have chain operators. Unless otherwise shown or specified, valves of sizes 4-inch and larger shall have gear-assisted operators.
 - K. Operation of valves shall be designed so that the effort required to operate the handwheel, lever or chain shall not exceed 40 pounds applied at the extremity of the wheel or lever. The handwheels on valves 14 inches and smaller shall not be less than 8 inches in diameter, and on valves larger than 14 inches, the handwheel shall not be less than 12 inches in diameter.
 - L. Chainwheel operator shall be fabricated of malleable iron and pocketed type chainwheels with chain guards and guides. Chainwheel operators shall be marked with an arrow and the word "open" indicating direction to open. The operators shall have galvanized smooth welded link type chain. Chain that is crimped or has links with exposed ends shall not be acceptable.
 - M. Floor Stands: Floor stands shall be cast iron, non-rising stem type with lockable hand wheel operator, valve position indicator and steel extension stem. Hand wheel shall be lockable in the full closed position. The floor stand shall be furnished with an armored padlock and six keys. Lock shall be as manufactured by Master, Schlage or equal. Floor stand shall be standard pattern type as manufactured by Clow Corporation, or equal.
 - N. Valve Labeling: A label shall be provided on all shut-off valves. The label shall be of 1/16-inch plastic or stainless steel, minimum 2 inches by 4 inches in size, and shall be permanently attached to the valve or on the wall adjacent to the valve or as indicated by the Engineer.
 - O. Position Indicators: All shut-off valves, 6-inch and larger, shall have operators with position indicators. Where buried, these valves shall be provided with valve boxes and covers containing position indicators, and valve extensions, as required. The valve indicator shall be hermetically sealed for installation inside a cast iron valve box and shall show valve disc position, direction of rotation and number of turns from fully opened to full closed. Position indicator, complete, shall be Diviner Ground Level Position Indicator as manufactured by Henry Pratt Company, GPI-S Series as manufactured by DynaTorque, Inc, or Valve Position Indicator as manufactured by Trumbull Industries, Inc.
 - P. Extension Stems: Extension stems and stem guides shall be furnished and installed where specified, indicated on the drawings, or otherwise required for proper valve operation. Extension stems shall be of solid steel and shall be not smaller in diameter than the stem of the valve actuator shaft. Extension stems shall be connected to the valve actuator by means of a Lovejoy "Type D" single universal joint with grease-filled protective rubber boot and S.S. fasteners. All stem connections shall be pinned.
 - Q. At least two stem guides shall be furnished with each valve requiring stem guides. Stem guides shall be of cast iron construction, bronze bushed and adjustable in two directions. Stem guide spacing shall not exceed 100 times the stem diameter or 10 feet, whichever is smaller. The top stem guide shall be designed to carry the weight of the extension stem. The extension stem shall have a collar; the collar shall be pinned to the stem and shall bear against the stem thrust guide.
 - R. Extension stems shall be provided for all buried valves when the valve actuator is greater than 4 feet below finished grade and/or as required for position indicators. Each extension stem for a buried valve shall extend to within 6 inches of the ground surface, shall be provided with spacers which will center the stem in the valve box, and shall be equipped with a wrench nut.

2.2 DELAPLAIN DISPOSAL VALVE SCHEDULE

VALVE SCHEDULE					
<u>Valve Number</u>	<u>Valve Type</u>	<u>Size (in)</u>	<u>Location</u>	<u>Operator</u>	<u>JOINT TYPE</u>
BFV-231	304SS Butterfly, Wafer	3"	BLWR 231	LO	WAFER
BFV-232	304SS Butterfly, Wafer	3"	BLWR 232	LO	WAFER
CV-233	PVC Ball Check	3"	BLWR 231	NA	NPT
CV-234	PVC Ball Check	3"	BLWR 232	NA	NPT
PRV-235	*	3"	BLWR 231	*	*
PRV-236	*	3"	BLWR 232	*	*
BLV-431	304SS Ball, Full Port	1 ¼"	Air Header to Contact Tank	LO	NPT
BLV-432	304SS Ball, Full Port	1 ¼"	Air Header to Contact Tank	LO	NPT
BLV-433	304SS Ball, Full Port	1 ¼"	Air Header to Contact Tank	LO	NPT
BLV-434	304SS Ball, Full Port	1 ¼"	Air Header to Contact Tank	LO	NPT
CV-411	PVC Ball Check	6"	Filter Feed Valve Vault	NA	NPT
CV-412	PVC Ball Check	6"	Filter Feed Valve Vault	NA	NPT
PV-413	DI Metal Plug	6"	Filter Feed Valve Vault	Vlv. Box, Ext Stem	MJ
PV-414	DI Metal Plug	6"	Filter Feed Valve Vault	Vlv. Box, Ext Stem	MJ
BFV-514	304SS Butterfly, Wafer	8"	PVC Influent to Disk Filter	LO	WAFER
BFV-515	304SS Butterfly, Wafer	8"	PVC Filter By-Pass	LO	WAFER
BFV-513	304SS Butterfly,	8"	PVC Disk Filter Effluent	LO	WAFER

VALVE SCHEDULE					
	Wafer				
CV-512	PVC Ball Check	2"	Sump Pump	NA	NPT
BFV-511	304SS Butterfly, Wafer	2"	Sump Pump	LO	WAFER
BFV-237	304SS Butterfly, Wafer	3"	IFAS Cages	LO	WAFER
BFV-238	304SS Butterfly, Wafer	3"	IFAS Cages	LO	WAFER
BFV-239	304SS Butterfly, Wafer	3"	IFAS Cages	LO	WAFER
BPV-711	*	*	Alum Feed	*	*

TO BE SUPPLIED BY MANUFACTURER

2.3 VALVE BOXES

- A. Each valve buried to a depth of 4 feet or less shall be provided with a slide type valve box. Valve boxes shall be cast iron, extension sleeve type, suitable for the depth of cover required by the drawings. Not more than one extension will be allowed with each slide type valve box. Valve boxes shall be not less than 5 inches in inside diameter, shall have a minimum thickness at any point of 3/16 inch, and shall be provided with suitable cast iron bases and covers.
- B. Each valve buried to a depth greater than 4 feet shall be provided with a valve box consisting of a cast iron cover and a 6-inch cast iron pipe section. The cover shall be a Clay & Bailey "No. 2193" or Tyler "Series 6890-A". The pipe shaft shall be sized to extend from the valve to 5 inches inside the valve box cover. Covers shall have cast thereon designation of the service for which the valve is used.
- C. All parts of valve boxes, bases, and covers shall be shop coated by dipping in asphalt varnish.
- D. Top sections and covers for valve boxes which are to be provided with position indicators shall be designed for proper installation of the position indicator and accessories.
- E. Valves and valve boxes shall be set plumb. Each valve box shall be placed directly over the valve it serves, with the top of the box brought flush with the finished grade. After being placed in proper position, earth shall be filled in around each valve box and thoroughly tamped on each side of the box.
- F. The covers shall be marked "WATER", "SEWER", "GAS", depending on service.

PART 3 EXECUTION

3.1 VALVE INSTALLATION

- A. General: All valves, operating units, stem extensions, valve boxes, and accessories shall be installed in accordance with the manufacturer's written instructions and as shown and specified. All gates shall be adequately braced to prevent warpage and bending under the intended use. Valves shall be firmly supported to avoid undue stresses on the pipe.

- B. Access: All valves shall be installed to provide easy access for operation, removal, and maintenance and to avoid conflicts between valve operators and structural members or handrails.
- C. Valve Accessories: Where combinations of valves, sensors, switches, and controls are specified, it shall be the responsibility of the Contractor to properly assemble and install these various items so that all systems are compatible and operating properly. The relationship between interrelated items shall be clearly noted on shop drawing submittals.

END OF SECTION

PAGE INTENTIONALLY LEFT BLANK.

SECTION 400526

IFAS CAGES

PART 1 GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and technical specification sections, apply to this section.

1.2 SUMMARY

- A. The contractor shall furnish all labor and tools, to perform all work and services necessary for the installation of Owner Furnished Integrated Fixed Film Activated Sludge (IFAS) Equipment, complete and ready for operation in accordance with the provisions of the contract documents.
- B. The owner shall furnish all materials necessary for the installation, including the cages, diffusers (from top of drop pipe down), blowers and blower controls, and media.
- C. Related Sections include the following:
 - a. Blowers and Blower Controls – 460529
 - b. Air Diffusers – 465103

PART 2 PRODUCTS

2.1 SCOPE OF SUPPLY

- A. The Owner shall supply all process equipment and design necessary to achieve the performance standards including:
 - i. Air supply blowers
 - ii. High surface area media
 - iii. Coarse bubble aeration grid
 - iv. IFAS media retaining cages
 - v. Blower control panel
 - vi. Shop drawings and process engineering design
- B. Other non-process related equipment will NOT be provided by the Owner, items include but are not limited to:
 - i. Electrical infrastructure and equipment wiring
 - ii. Piping, valves, pipe supports, piping appurtenances

2.2 AERATION GRID

- A. Included in the scope of supply for the aeration grid are the following: Midwest Water Operations will fabricate and supply the aeration grid which includes all submerged diffuser piping, diffusers, and drop pipes. **Contractor shall be responsible for providing the pipe supports to allow the top of the diffuser to be set at no more than 9-inches from the floor elevation.**
- B. Midwest Water Operations shall provide the services of a field representative to advise on field installation. The services of the field representative shall include at least one (1) day, exclusive of travel time, and one (1) travel trip during the time that the equipment is being installed. The Contractor shall notify the Midwest Water Operations a minimum of ten (10) working days prior to the time that the field services are desired.

2.3 HIGH SURFACE AREA MEDIA

- A. High surface area media shall be manufactured by Raschig or equal and furnished by the Owner for installation by Contractor.

2.4 CAGES

- A. The cages shall be furnished by Owner furnished for installation by Contractor and supplied through Midwest Water Operations.

2.5 AIR SUPPLY BLOWERS

- A. The air supply blowers and blower control panels shall be manufactured by HAC Group, furnished by the Owner, and installed by Contractor.
- B. The control panel will be mounted outside, and it shall be enclosed in an outdoor rated NEMA weatherproof enclosure.
- C. The panel shall be delivered completely assembled, pre-wired, tested, and ready for installation.
- D. The control panel shall have sufficiently sized variable frequency drives for the blowers along with starters for the blower enclosure fans. The enclosure fans shall have a 15 min off delay after the blower is switched off to allow for enclosure cooling.
- E. The control panel shall include a 7-day timer switch that will automatically switch the duty and standby blowers.
- F. The integrated temperature controllers shall be able to accept a type-K thermocouple input and have a digital readout with buttons necessary to adjust the minimum temperature setting.

PART 3 EXECUTION

3.1 INSTALLATION

- A. The IFAS system shall be constructed to the lines and grades as shown on the Drawings.
- B. Installation of the IFAS reactor components shall be in accordance with the Engineer's specifications.
- C. Connect all electrical components in accordance with the requirements provided by manufacturer in submittals.
- D. Owner shall provide the services of a field representative to advise on field installation. The services of the field representative shall include at least one (1) day, exclusive of travel time, and one (1) travel trip during the time that the equipment is being installed. The Contractor shall notify the manufacturer a minimum of ten (10) working days prior to the time that the field services are desired.

3.2 CONTRACTOR RESPONSIBILITIES

- A. The contractor shall furnish all labor and tools, to perform all work and services necessary for and incidental to the installation of a complete system, complete and ready for operation in accordance with the provisions of the contract documents.

- B. Products relevant to this section will be Owner furnished for installation by Contractor unless otherwise stated previously.
- C. The contractor is responsible for the rehabilitation of the existing tanks or other related work if shown on the drawings.
- D. Contractor is responsible for any hardware that is not explicitly stated as provided in this spec, including but not limited to bolts, gaskets, seals, anchors etc.
- E. Contractor shall provide power necessary to operate the IFAS system as shown on Electrical Riser Diagram.

3.3 WARRANTY

- A. The Contractor shall provide a one (1) year warranty to warranty the labor and installation of the IFAS equipment.

END OF SECTION

SECTION 400562
PLUG VALVES

PART 1 - GENERAL

1.1 DESCRIPTION

- A. This section includes materials, testing, and installation of plug valves and accessories.

1.2 RELATED WORK SPECIFIED ELSEWHERE

- A. Painting and Coating: 099000.
- B. General Piping Requirements: 400500.
- C. Pressure Testing of Piping: 400515.
- D. Valves, General: 400524.

1.3 SUBMITTALS

- A. Submit shop drawings in accordance with Section 013300.
- B. Submit manufacturer's catalog data and detailed construction sheets showing all valve parts. Describe each part by material of construction, specification (such as AISI, ASTM, SAE, or CDA), and grade or type. Identify each valve by tag number to which the catalog data and detail sheets pertain.
- C. Show valve dimensions including laying lengths. Show port sizes. Show dimensions and orientation of valve actuators, as installed on the valves.
- D. Show location of internal stops for gear actuators. State differential pressure and fluid velocity used to size actuators. For worm-gear actuators, state the radius of the gear sector in contact with the worm and state the handwheel diameter.
- E. Show valve linings and coatings. Submit manufacturer's catalog data and descriptive literature.
- F. For eccentric plug valves, show the clear diameter or size of the port. Show the actual area of the port as a percentage of the area as calculated for the nominal valve size.
- G. Submit certification from manufacturer that valves are NSF 61 listed.
- H. Provide additional O&M data per Section 017823.

1.4 PROOF OF DESIGN TEST FOR ECCENTRIC PLUG VALVES

- A. The Contractor shall require the valve manufacturer to furnish six certified copies of reports covering the design tests for the eccentric plug valves as described in AWWA C517 and the following. One prototype valve of each size and class of a manufacturer's design shall be tested for leakage at the specified design pressure and hydrostatically tested with twice the specified design pressure. The hydrostatic test shall be performed with the plug in the open position. The leakage test shall be performed with the plug in the closed position. The duration of each test shall be 10 minutes minimum. During the leakage test, there shall be no indication of leakage past the valve plug. Valves specified to have bi-directional seats shall be leak tight in both directions. In the case of flanged valves, the valve body shall be bolted to a flanged test head.
- B. No part of the valve or plug shall be permanently deformed by the hydrostatic test. During the hydrostatic test, there shall be no leakage through the metal, the end joints, or the shaft seal.
- C. It is the intent that the valve manufacturer provides evidence of the adequacy of each type offered to perform under design pressures within the applicable rating for a sufficient number of test cycles simulating a full service life. The adequacy is to be proven by tests, made on one or more valves selected to represent each basic type of seat design of a size within each applicable group, in a pressure class or classes equal to or greater than that specified. The test cycle requirements are as follows:
 - 1. Size Group 3 to 20 inches: 10,000 cycles with a minimum differential pressure of 150 psig.
 - 2. Size Group 24 to 42 inches: 5,000 cycles with a minimum differential pressure of 150 psig.
 - 3. Every test cycle shall consist of applying the specified differential pressure to the plug in the closed position, then opening the plug (which will relieve the pressure) to the wide-open position and then closing the plug.

4. The valve shall be leak tight under the specified pressure differential upon completion of the cycle test without having to stop during the test to repair the valve, modify or reinforce the seat, or install shims or wedges around the seat.
5. The plug shall not be rotated past the center position to jam the plug onto the seat during the hydrostatic test, the leakage test, or the cycle test.

1.5 WARRANTY

- A. Full warranty against defects in materials and workmanship for one year after FINAL ACCEPTANCE, including all parts, labor, and expenses.

PART 2 - PRODUCTS

2.1 GENERAL

- A. Valves and the required actuators are identified by tag numbers and in the Valve Schedule. See the Valve Schedule Section 400521.
- B. Valves shall be installed complete with flange gaskets, nuts and bolts, operating handwheels or levers, chainwheels, extension stems, floor stands, gear actuators, operating nuts, chains, and wrenches required for operation.
- C. Valves shall have the name of the manufacturer and the size of the valve cast or molded onto the valve body or bonnet or shown on a permanently attached plate.
- D. Bronze or brass material requirements:
- E. Any bronze or brass components in contact with water throughout the treatment process shall be made "Lead-Free" as defined in the "Reduction of Lead in Drinking Water Act." Lead-Free shall contain no more than twenty-five hundredth of one percent (0.25 percent or less) total lead contained by weight. The manufacturer shall certify that the bronze meets the "Lead-Free" requirements.
- F. For buried locations, valves with mechanical joint ends may be substituted for the flanged ends specified provided the mechanical joint ends are compatible with the pipe ends.

2.2 VALVE ACTUATORS/OPERATORS

- A. Provide operator types in accordance with the Valve Schedule.
- B. Valves shall open by turning counterclockwise.
- C. Valve Boxes: Furnish valve boxes for all buried valves.

2.3 BOLTS AND NUTS FOR FLANGED AND MECHANICAL JOINT VALVES

- A. Bolts and nuts for flanged valves shall be as described in Section 400500.
- B. Buried Service Bolts (for valve installation) shall be fluorocarbon coated cor-ten steel t-bolts and nuts equal to NSS cor-blue or approved equal low alloy corrosion-resistant high-strength steel in accordance with ANSI/AWWA C111/A21.11.

2.4 GASKETS FOR FLANGES

- A. Gaskets for flanged end valves shall be as described in Section 400500.

2.5 LINING AND COATING

- A. Coat the exterior of metal valves located above ground or in vaults and structures the same as the adjacent piping. If the adjacent piping is not coated, then coat valves per Section 099000. Apply the specified prime coat at the place of manufacture. Apply intermediate and finish coats at the place of manufacturer or in the field. Finish coat shall match the color of the adjacent piping. Coat handwheels the same as the valves. Do not coat bronze, brass, or stainless steel valves.
- B. Coat the exterior of buried metal valves at the place of manufacture per Section 099000, System No. 10.
- C. Coat the exterior of submerged metal valves, stem guides, extension stems, and bonnets at the place of manufacture per Section 099000, System No. 12.
- D. Line the interior metal parts of metal valves 4 inches and larger, excluding seating areas and bronze and stainless steel pieces, per Section 099000, System No. 12. Apply lining at the place of manufacture.
- E. Coat floor stands per Section 099000, System No. 10.
- F. Measure the thickness of the valve interior linings per Section 099000. Repair areas having insufficient

film thickness per Section 099000.

2.6 PACKING, O-RINGS, AND GASKETS

- A. Unless otherwise stated in the detailed valve specifications, packing, O-rings, and gaskets shall be one of the following nonasbestos materials:
 - 1. Teflon.
 - 2. Kevlar aramid fiber.
 - 3. Acrylic or aramid fiber bound by nitrile. Products: Garlock "Bluegard," Klinger "Klingersil C4400," or equal.
 - 4. Buna-N (nitrile).
 - 5. EPDM

2.7 RUBBER SEATS

- A. Rubber seats shall be made of a rubber compound that is resistant to free chlorine and monochloramine concentrations up to 10 mg/l in the fluid conveyed.

2.8 VALVE END CONNECTIONS

- A. Valve end connections for exposed valves shall be flanged unless shown otherwise. The Contractor shall verify the compatibility of valve ends, including class and drilling of flanges with the connecting pipe.
- B. Buried valve end connections shall be mechanical joint or a push-on unless shown otherwise in the Drawings or in the Valve Schedule.

2.9 VALVES

- A. Plug Valves:
 - B. Plug and Seating Design for Eccentric Plug Valves
 - 1. Eccentric plug valves shall comply with AWWA C517 and the following.
 - 2. Provide a rectangular or circular plug design, with an associated rectangular or round seat. Provide bidirectional seating design. The valve shall seat with the rated pressure both upstream and downstream of the closed plug. Provide geared actuators sized for bidirectional operation.
 - a. For eccentric plug valves, the metallic portion of the plug shall be one-piece design and shall be without external reinforcing ribs which result in there being a space between the rib and the main body of the plug through which water can pass.
 - b. Valves shall be repackable without any disassembly of valve or actuator. The valve shall be capable of being repacked while under the design pressure in the open position.
 - c. Nowhere in the valve or actuators shall the valve shaft be exposed to iron on iron contact.
 - d. Sleeve bearings shall be stainless steel in valve sizes 20 inches and smaller and bronze or stainless steel in valve sizes 24 inches and larger.
 - e. Provide enclosed worm-gear actuators for valves 6 inches and larger.
 - f. Rubber compounds shall have less than 2 percent volume increase when tested in accordance with ASTM D471 after being immersed in distilled water at a temperature of 71.4 to 75.4 degrees F for 70 hours.
 - g. Lubricated Plug Valves:
 - 1) Plug coating shall be Teflon or nylon, permanently bonded to the plug. Body, gland, and cover capscrews and bolts and nuts shall be Type 316 stainless steel or high-strength alloy steel (ASTM A193, Grade B7). Provide operating and sealant extensions for buried valves.
 - h. Eccentric Plug Valves 3 Inches and Smaller (to be used in wastewater / sewer applications in lieu of cast iron unless shown or specified otherwise):
 - 1) Eccentric plug valves, 1/2 inch through 3 inches, shall be nonlubricated type.
 - 2) Minimum pressure rating shall be 175 psi.
 - 3) Bodies shall be made of cast iron per ASTM A126, Class B.
 - 4) Ends shall be threaded or flanged (ASME B16.1, Class 125).
 - 5) Plug shall be cast iron (ASTM A126, Class B) with Buna-N or neoprene facing.
 - 6) Design plugs to seat over a pressure range of 25 psi to the valve design pressure rating.
 - 7) Body capscrews and bolts and nuts shall be Type 316 stainless steel.
 - 8) Packing shall be nitrile butadiene-filled Teflon. Provide 100 percent port area.
 - 9) Valves shall be DeZurik PEF, Val-Matic "Cam-Centric," or equal.

- i. Eccentric Plug Valves 4 Inches Through 12 Inches (to be used in wastewater / sewer applications in lieu of cast iron unless shown or specified otherwise):
 - 1) Eccentric plug valves, 4 inches through 12 inches, shall be non-lubricated type.
 - 2) Minimum pressure rating shall be 175 psi.
 - 3) Bodies shall be cast iron per ASTM A126, Class B.
 - 4) Ends shall be flanged, Class 125 per ASME B16.1 for exposed valves.
 - 5) Ends shall be mechanical joint per ANSI A21.11 and AWWA C111 for buried valves.
 - 6) Plugs shall be cast iron (ASTM A126, Class B), or ductile iron (ASTM A536, Grade 65-45-12) with Buna-N or neoprene facing, 70 Type A durometer hardness per ASTM D2240.
 - 7) Design plugs to seat over a pressure range of 25 psi to the valve design pressure rating.
 - 8) Valve body seats shall be Type 304 or 316 stainless steel or have a raised welded-in overlay at least 1/8-inch thick of not less than 90 percent nickel, minimum Brinell hardness of 200.
 - 9) Body capscrews and bolts and nuts shall be Type 316 stainless steel.
 - 10) Shaft bearing bushings shall be permanently lubricated TFE or Delrin sleeve type stainless steel or bronze. Top and bottom thrust bearing shall be provided.
 - 11) The shaft seal shall be per AWWA specification C504-80, Section 3.7 and be of either bronze cartridge type double O-rings with lower grit seal O-ring, V-type packing, or pull down packing.
 - 12) Provide 100 percent port area.
 - 13) Valves shall be DeZurik PEF, Val-Matic Series 5800 or equal.
- j. Cast-Iron Lubricated Plug Valves 2-Inch Through 6 Inches, Class 125:
 - 1) Lubricated plug valves of sizes 2-inch through 6 inches shall have cast iron (ASTM A126, Class B) bodies and plugs.
 - 2) Valves shall be of the short pattern with bolted cover (two-bolt type) and resilient packing. Plugs shall be of the tapered design.
 - 3) Valve ends shall be flanged, Class 125, ASME B16.1. Face-to-face dimensions shall conform to ASME B16.10, Class 125, gate valves.
 - 4) Valve shall have a minimum pressure rating of 175-psi CWP.
 - 5) Valves shall be lubricated with the manufacturer's recommended lubricant for the service.
 - 6) Valve shall be Nordstrom Figure 143, Christensens 9AS40114, Kerotest Figure 2201 or P33 or equal.

PART 3 - EXECUTION

3.1 JOINTS

- A. Bolt holes of flanged valves shall straddle the horizontal and vertical centerlines of the pipe run to which the valves are attached. Clean flanges by wire brushing before installing flanged valves. Clean flange bolts and nuts by wire brushing, lubricate threads with oil and graphite, and tighten nuts uniformly and progressively. If flanges leak under pressure testing, loosen or remove the nuts and bolts, reseal or replace the gasket, reinstall or retighten the bolts and nuts, and retest the joints. Joints shall be watertight.
- B. Clean threaded joints by wire brushing or swabbing. Apply Teflon joint compound or Teflon tape to pipe threads before installing threaded valves. Joints shall be watertight.
- C. Install lug-type valves with separate hex head machine bolts at each bolt hole and each flange (two bolts per valve bolt hole).
- D. Install grooved-end couplings for valves in accordance with Section 400500.

3.2 INSTALLING EXPOSED VALVES

- A. Unless otherwise indicated in the drawings, install valves in horizontal runs of pipe having centerline elevations 4 feet 6 inches or less above the floor with their operating stems vertical. Install valves in horizontal runs of pipe having centerline elevations between 4 feet 6 inches and 6 feet 9 inches above the floor with their operating stems horizontal.
- B. Install valves on vertical runs of pipe that are next to walls with their stems horizontal, away from the wall. Valves on vertical runs of pipe that are not located next to walls shall be installed with their stems

horizontal, oriented to facilitate valve operation.

3.3 INSTALLING BURIED VALVES

- A. Connect the valve, coat the flanges, or apply tape wrapping or polyethylene encasement, and place and compact the backfill to the height of the valve stem.
- B. Place block pads under the extension pipe to maintain the valve box vertical during backfilling and repaving and to prevent the extension pipe from contacting the valve bonnet.
- C. Mount the upper slip pipe of the extension in midposition and secure with backfill around the extension pipe. Pour the concrete ring allowing a depression so the valve box cap will be flush with the pavement surface.

3.4 FIELD COATING BURIED VALVES

- A. Coat flanges of buried valves and the flanges of the adjacent piping, and the bolts and nuts of flanges and mechanical joints, per Section 099000, System No. 10.
- B. Wrap buried metal valves 6 inches and larger with polyethylene sheet per Section 400713.
- C. Wrap buried metal valves 6 inches and larger in two layers of polyethylene conforming to AWWA C105, 8 mils in thickness each. Pass the two sheets of polyethylene under the valve and the coated flanges or joints with the connecting pipe and draw the sheets around the valve body, the valve bonnet, and the connecting pipe. Secure the sheets with plastic adhesive tape about the valve stem below the operating nut and about the barrel of the connecting pipe to prevent the entrance of soil. Fold overlaps twice and tape. Backfill the valve with care to avoid damaging the polyethylene.

3.5 INSTALLING ECCENTRIC PLUG VALVES

- A. Install such that the rotation of the plug is about a horizontal axis.
- B. Install such that the plug stores in the top when the valve is open.
- C. Orient the valve such that the seat is opposite the high-pressure side.

3.6 MOUNTING GEAR ACTUATORS

- A. The valve manufacturer shall select and mount the gear actuator and accessories on each valve and stroke the valve from fully open to fully closed prior to shipment.

3.7 VALVE LEAKAGE TESTING

- A. Test valves for leakage at the same time that the connecting pipelines are tested. See Section 400515 for pressure testing requirements. Protect or isolate any parts of valves, actuators, or control and instrumentation systems whose pressure rating is less than the pressure test. Valves shall show zero leakage. Repair or replace any leaking valves and retest.

3.8 VALVE FIELD TESTING

- A. Operate manual valves through three full cycles of opening and closing. Valves shall operate from full open to full close without sticking or binding. Do not backfill buried valves until after verifying that valves operate from full open to full closed. If valves stick or bind, or do not operate from full open to full closed, repair or replace the valve and repeat the tests.
- B. Gear actuators shall operate valves from full open to full close through three cycles without binding or sticking. The pull required to operate handwheel- or chainwheel-operated valves shall not exceed 80 pounds. The torque required to operate valves having 2-inch AWWA nuts shall not exceed 150 ft-lbs. If actuators stick or bind or if pulling forces and torques exceed the values stated previously, repair or replace the actuators and repeat the tests. Operators shall be fully lubricated in accordance with the manufacturer's recommendations prior to operating.

END OF SECTION

THIS PAGE INTENTIONALLY LEFT BLANK.

SECTION 400563
BALL VALVES

PART 1 - GENERAL

1.1 DESCRIPTION

- A. This section includes:
 - 1. Materials, testing, and installation of general ball valves and accessories.
 - 2. Materials, testing, and installation of AWWA C507 rubber-seated and metal-seated ball valves size range 6 through 48 inches.

1.2 RELATED WORK SPECIFIED ELSEWHERE

- A. Painting and Coating: 099000.
- B. General Piping Requirements: 400500.
- C. Pressure Testing of Piping: 400515.
- D. Valves, General: 400524.

1.3 SUBMITTALS

- A. Submit shop drawings in accordance with Section 013300.
- B. Submit manufacturer's catalog data and detailed construction sheets showing all valve parts. Describe each part by material of construction, specification (such as AISI, ASTM, SAE, or CDA), and grade or type. Identify each valve by tag number to which the catalog data and detail sheets pertain.
- C. Show valve dimensions including laying lengths. Show port sizes. Show dimensions and orientation of valve actuators, as installed on the valves.
- D. Show location of internal stops for gear actuators. State differential pressure and fluid velocity used to size actuators. For worm-gear actuators, state the radius of the gear sector in contact with the worm and state the handwheel diameter.
- E. Show valve linings and coatings. Submit manufacturer's catalog data and descriptive literature.
- F. Submit certification from manufacturer that valves are NSF 61 listed.

1.4 MANUFACTURER'S SERVICES

- A. Provide equipment manufacturer's services at the job site for the minimum man-days listed below, travel time excluded.
 - 1. Two eight hour days to check the installation, supervise startup, supervise testing and adjustments of air operated valves, and instruct the Owner's personnel in the operation and maintenance of the equipment.
 - 2. Any additional trips required by the Contractor before or after final startup and training shall not be charged to the Owner.

1.5 WARRANTY

- A. Full warranty against defects in materials and workmanship for one year after FINAL ACCEPTANCE, including all parts, labor, and expenses.

PART 2 - PRODUCTS

2.1 GENERAL

- A. Valves and the required actuators are identified by tag numbers on the drawings and in the Valve Schedule. See the Valve Schedule Section 400521.
- B. Valves shall be installed complete with flange gaskets, nuts and bolts, operating handwheels or levers, chainwheels, extension stems, floor stands, gear actuators, operating nuts, chains, and wrenches required for operation.
- C. Valves shall have the name of the manufacturer and the size of the valve cast or molded onto the valve body or bonnet or shown on a permanently attached plate.
- D. Bronze or brass material requirements:

1. Any bronze or brass components in contact with potable water shall be made "Lead-Free" as defined in the "Reduction of Lead in Drinking Water Act." Lead-Free shall contain no more than twenty-five hundredth of one percent (0.25 percent or less) total lead contained by weight. The manufacturer shall certify that the bronze meets the "Lead-Free" requirements.
2. For buried locations, valves with mechanical joint ends may be substituted for the flanged ends specified provided the mechanical joint ends are compatible with the pipe ends.

2.2 VALVE ACTUATORS/OPERATORS

- A. Provide operator types in accordance with the Valve Schedule.
- B. Provide a ball shaft support bearing on the cover for AWWA C507 ball valves.
- C. For AWWA C507 ball valves, design the link and lever torque unit such that during the first 50 percent of the closing stroke, the flow area is reduced by approximately 80 percent to 93 percent. The remaining flow area shall be gradually reduced to a complete shutoff throughout the last 50 percent of the closing stroke.
- D. Materials of the valve actuating mechanism subject to rubbing shall be of different hardness. The valve actuating mechanism shall be capable of being inspected, lubricated, removed, and repaired without removing the valve from the connecting piping.
- E. Valves shall open by turning counterclockwise.
- F. Valve Boxes: Furnish valve boxes for all buried valves.

2.3 BOLTS AND NUTS FOR FLANGED AND MECHANICAL JOINT VALVES

- A. Bolts and nuts for flanged valves shall be as described in the detailed piping specifications in Section 400500.
- B. Buried Service Bolts (for valve installation) shall be fluorocarbon coated cor-ten steel t-bolts and nuts equal to NSS cor-blue or approved equal low allow corrosion-resistant high-strength steel in accordance with ANSI/AWWA C111/A21.11.

2.4 GASKETS FOR FLANGES

- A. Gaskets for flanged end valves shall be as described in the detailed piping specifications in Section 400500.

2.5 LINING AND COATING

- A. Coat the exterior of metal valves located above ground or in vaults and structures the same as the adjacent piping. If the adjacent piping is not coated, then coat valves per Section 099000, System No. 10. Apply the specified prime, intermediate, and finish coat at the place of manufacture. Apply intermediate and finish coats at the place of manufacturer or in the field. Finish coat shall match the color of the adjacent piping. Coat handwheels the same as the valves. Do not coat bronze, brass, or stainless steel valves.
- B. Coat the exterior of buried metal valves at the place of manufacture per Section 099000, System No. 10.
- C. Coat the exterior of submerged metal valves, stem guides, extension stems, and bonnets at the place of manufacture per Section 099000, System No. 12.
- D. Line the interior metal parts of metal valves 4 inches and larger, excluding seating areas and bronze and stainless steel pieces, per Section 099000, System No. 12. Apply lining at the place of manufacture. Interior lining shall meet the requirements of NSF 61.
- E. Coat floor stands per Section 099000, System No. 10.
- F. Measure the thickness of the valve interior linings per Section 099000. Repair areas having insufficient film thickness per Section 099000.

2.6 PACKING, O-RINGS, AND GASKETS

- A. Unless otherwise stated in the detailed valve specifications, packing, O-rings, and gaskets shall be one of the following nonasbestos materials:
 1. Teflon.
 2. Kevlar aramid fiber.
 3. Acrylic or aramid fiber bound by nitrile. Products: Garlock "Bluegard," Klinger "Klingersil C4400," or equal.
 4. Buna-N (nitrile).

5. EPDM.

2.7 RUBBER SEATS

- A. Rubber seats shall be made of a rubber compound that is resistant to free chlorine and monochloramine concentrations up to 10 mg/l in the fluid conveyed.

2.8 VALVE END CONNECTIONS

- A. Valve end connections for exposed valves shall be flanged unless shown otherwise or noted otherwise. The Contractor shall verify the compatibility of valve ends, including class and drilling of flanges with the connecting pipe.
- B. Buried valve end connections shall be mechanical joint or a push-on unless shown otherwise in the Drawings or in the Valve Schedule.

2.9 VALVES

A. Ball Valves (Air and Water Service):

1. Full Port Threaded Bronze Ball Valves 2 Inches and Smaller for Water, etc. Service:
 - a. Ball valves, 2 inches and smaller, for air or water service shall have a pressure rating of at least 600 psi WOG at a temperature of 100 degrees F.
 - b. Provide full port ball and body design.
 - c. Valves shall comply with MSS SP-110.
 - d. Provide bronze (ASTM B62 or ASTM B584, Alloy C83600 or C84400) body and plug ball retainer. Ball and stem shall be Type 316 stainless steel.
 - e. Valves shall have threaded ends (ASME B1.20.1), nonblowout stems, reinforced Teflon seats, and have plastic-coated lever actuators.
 - f. Provide locking lever handle.
 - g. Provide stem extensions when valves are installed in insulated piping. Stem extensions shall be of a length sufficient to bring the bottom of the operating handle above the outside of the insulation.
 - h. Valves shall be Stockham T-285 Series, Apollo 77C-140 Series, or equal.
2. Flanged Bronze Ball Valves, Class 150, 4 Inches and Smaller for Water, etc. service:
 - a. Ball valves 4 inches and smaller shall have a minimum pressure rating of 200 psi at a temperature of 150 degrees F.
 - b. Valve body shall be aluminum bronze (ASTM B148, Alloy C95400) or bronze (ASTM B62 or ASTM B584, Alloy C83600).
 - c. Ball and stem shall be Type 316 stainless steel or bronze (ASTM B21, Alloy C48500).
 - d. Seat and seals shall be Teflon.
 - e. Ends shall be flanged, flat faced ASME B16.5, Class 150.
 - f. Valves shall be Neles-Jamesbury Style 5150, McCanna Series S151-BR, or equal.
3. Bronze Ball Valve Curb Stops, 2 Inches and Smaller, for Water, etc. Service:
 - a. Ball valve curb stops shall be bronze (ASTM B62 or ASTM B584, Alloy C83600) with male inlet iron pipe threads and female outlet iron pipe threads and shall conform to AWWA C800.
 - b. Minimum pressure rating shall be 300 psi.
 - c. Stops shall be Ford Ball Valve Curb Stop B81-777 with straight lever handle or equal.
4. Bronze Ball/Corporation Stops, 2 Inches and Smaller, for Water, etc. Service:
 - a. Corporation stops shall be bronze (ASTM B62 or ASTM B584, Alloy C83600) with male inlet iron pipe threads and female outlet iron pipe threads and shall conform to AWWA C800.
 - b. Minimum pressure rating shall be 300 psi.
 - c. Stops shall be Ford Ballcorp Type FB 1700, James Jones J-1931, or equal. Stops shall have an outlet fitting to adapt from iron pipe thread to copper tubing.
5. True Union PVC Ball Valves 4 Inches and Smaller for Wastewater, etc. Service:
 - a. Thermoplastic ball valves, 4 inches and smaller, for wastewater, water and chemical service shall be rated at a pressure of 150 psi at a temperature of 105 degrees F.
 - b. Body, ball, and stem shall be PVC conforming to ASTM D1784, Type 1, Grade 1. Seats shall be Teflon.
 - c. O-ring seals shall be Viton. O-rings used in chemical service shall be verified for chemical compatibility by manufacturer.
 - d. Valve ends shall be of the true union design. Ends shall be socket welded except where threaded or flanged-end valves are specifically shown in the drawings.

- e. Valves shall have handle for manual operation unless otherwise shown.
 - f. Provide stem extensions when valves are installed in insulated piping. Stem extensions shall be of a length sufficient to bring the bottom of the operating handle above the outside of the insulation.
 - g. Valves shall be as manufactured by Spears Manufacturing 2000 Series, Plast-O-Matic, Hayward or equal.
6. True Union CPVC Ball Valves 4 Inches and Smaller for Wastewater, etc. Service:
- a. CPVC ball valves, 4 inches and smaller, for wastewater, water and chemical service shall be rated at a pressure of 150 psi at a temperature of 105 degrees F and rated at a pressure of 100 psi at a temperature of 150 degrees F.
 - b. Body, ball, and stem shall be CPVC conforming to ASTM D1784, Type 4, Grade 1. Seats shall be Teflon.
 - c. O-ring seals shall be Viton.
 - d. Valve ends shall be of the true-union design. Ends shall be socket welded except where threaded or flanged-end valves are specifically shown in the drawings.
 - e. Valves shall have handle for manual operation unless otherwise shown.
 - f. Provide stem extensions when valves are installed in insulated piping. Stem extensions shall be of a length sufficient to bring the bottom of the operating handle above the outside of the insulation.
 - g. Valves shall be as manufactured by Spears Manufacturing 2000 Series, Plast-O-Matic, Hayward, or equal.
7. True Union CPVC Ball Valves 4 Inches and Smaller with Vented Ball for Sodium Hypochlorite, etc. Service:
- a. Vented CPVC ball valves, 4 inches and smaller, for chemical service shall be rated at a pressure of 150 psi at a temperature of 105 degrees F and rated at a pressure of 85 psi at a temperature of 140 degrees F.
 - b. Provide machined vent hole, deburred, in the ball to allow gases to vent.
 - c. Body, ball, and stem shall be CPVC conforming to ASTM D1784, Type 4, Grade 1. Seats shall be Teflon.
 - d. O-ring seals shall be Viton.
 - e. Valve ends shall be of the true-union design. Ends shall be socket welded except where threaded or flanged-end valves are specifically shown in the drawings.
 - f. Valves shall have handle for manual operation.
 - g. Provide stem extensions when valves are installed in insulated piping. Stem extensions shall be of a length sufficient to bring the bottom of the operating handle above the outside of the insulation.
 - h. Valves shall be by Spears Manufacturing, Plast-O-Matic, Hayward or Equal.
8. Full Port Threaded Stainless Steel Ball Valves 3 Inches and Smaller for Process Air Service
- a. Stainless steel ball valves, 3 inches and smaller, for air and water service shall be rated at a minimum pressure of 1,000 psi WOG at a temperature of 100 degrees F.
 - b. Valve body, ball, and stem shall be Type 304 stainless steel, ASTM A276 or A351. Seat and seals shall be reinforced RPTFE.
 - c. Valves shall have lever actuators, plastic coated. Provide locking lever handle.
 - d. Provide stem extensions when valves are installed in insulated piping. Stem extensions shall be of a length sufficient to bring the bottom of the operating handle above the outside of the insulation.
 - e. Valves shall have threaded ends (ASME B1.20.1) and nonblowout stems.
 - f. Valves shall be Apollo 76F-100-A Series, or equal.
9. Full Port Flanged Stainless Steel Ball Valves ½ inch to 12 inches, Class 150 for Process Air Service:
- a. Stainless steel ball valves 1/2 inch through 12 inches shall have flanged ends, ASME B16.5, Class 150.
 - b. Pressure rating shall be at least 250 psi at a temperature of 100 degrees F.
 - c. Bodies shall be Type 304 stainless steel (ASTM A351, Type CF8M). Ball, stem, and compression ring shall be Type 304 or 316 stainless steel. Bonnet bolting shall be ASTM A193, Grade B8M.
 - d. Seats and seals shall be RPTFE.
 - e. Valves shall be Apollo Series 87A-200-Series, or equal.
10. Regular or Full Port, Threaded End, Carbon Steel Ball Valves 2 Inches and Smaller for LPG,

Natural Gas, and Fuel Oil Service (UL Listed):

- a. Carbon steel ball valves 2 inches and smaller shall be rated at a minimum pressure of 2,000-psi WOG for sizes 1 inch and smaller; 1,500-psi WOG for sizes 1-1/4 inches through 2 inches; 1,000-psi WOG for sizes 2-1/2 inches through 3 inches; and 250 psi UL listed for LPG, natural gas, and fuel oil service in all sizes.
 - b. Provide regular or full port design.
 - c. Valve body and retainer shall be carbon steel, ASTM A216, Grade WCB; ASTM A105; or ASTM A108. Ball, gland nut, and stem shall be carbon steel (ASTM A108) or stainless steel (ASTM A479), with chrome-plated ball. Seat, packing, and seals shall be PTFE or reinforced PTFE.
 - d. Valves shall have lever handle, plastic coated.
 - e. Valve shall have threaded ends (ASME B1.20.1). Provide nonblowout stems.
 - f. Provide adjustable packing gland. Provide double union end connections.
 - g. Products: Apollo 489-100 Series, or equal.
11. Forged, Flanged, Carbon Steel Ball Valves 2 Inches Through 24 Inches, Class 150, for High Temperature Hot Water Service:
- a. Valves shall be of the trunnion-mounted ball design, with three-piece body, full bore, double block and bleed, and with anti-static device.
 - b. Design and construction shall comply with API-6D and NACE MR-01-75. The seal design shall utilize the differential between the sealing diameter of the seat insert or ball contact and the outer diameter of the seat. When the fluid differential pressure is insufficient to cause the valve to seal, seat springs shall cause it to seal.
 - c. Provide a secondary metal-to-metal seal after a fire. When the primary soft seals are destroyed by fire, the fire-safe seals shall energize the seat assembly to seal. The fire-safe seal design shall comply with API 607 and API 6FA.
 - d. Provide a stem sealant injection fitting. Provide seat sealant injection fittings on valves 6 inches and larger.
 - e. Provide integral enclosed worm-gear actuator with handwheel for valves 6 inches and larger. Provide lever actuator for valves smaller than 6 inches.
 - f. Valves shall be Class 150 per ASME B16.5, with raised face flanges.
 - g. Design conditions shall be:
 - (1) Fluid: Water.
 - (2) Fluid Temperature Range: 60 degrees F to 400 degrees F.
 - (3) Pressure: 100 psi (maximum).
 - (4) Materials of construction shall be as follows:
 - (5) Body: Carbon steel; ASTM A105.
 - (6) Ball: Carbon steel with 0.003-inch electroless nickel plating; ASTM A105.
 - (7) Stem: Stainless steel; ASTM A182, Grade F316.
 - (8) Seats and inserts: Stainless steel plus nylon; ASTM A182, Grade F316.
 - (9) Seals: Viton/graphite.
 - (10) Body stud bolts and nuts: Alloy steel; ASTM A193, Grade B7M and A194, Grade 2HM.
 - (11) Worm-gear housing: Ductile iron; ASTM A395 or A536.
 - (12) Valves shall be GWC Valve International, Inc., Model FF or equal.
12. Flanged Carbon Steel Ball Valves 4 Inches and Smaller, Class 150 for Miscellaneous Applications:
- a. Carbon steel ball valves 1/2 inch through 4 inches shall have flanged ends, ASME B16.5, Class 150.
 - b. Valve shall have a pressure rating of at least 285 psi at a temperature of 100 degrees F.
 - c. Bodies shall be steel, ASTM A216, Grade WCB. Ball, stem, and compression ring shall be Type 316 stainless steel. Body studs and nuts shall comply with ASTM A193, Grade B7, and ASTM A194, Grade 2H, respectively. Seat and seals shall be Teflon.
 - d. Valves shall be Jamesbury Type 5150, McCanna Series 51F1-CS, or equal.
13. Flanged Ductile-Iron Ball Valves 4 Inches and Smaller, Class 125 for Miscellaneous Applications:
- a. Ball valves 4 inches and smaller shall be rated at a pressure of 200 psi at a temperature of 300 degrees F.
 - b. Valve body shall be ductile iron (ASTM A395 or A536). Ball, stem, and compression ring shall be Type 316 stainless steel. Seat and seals shall be Teflon.
 - c. Provide seats both upstream and downstream of the ball.

- d. Ends shall be flanged, ASME B16.1, Class 125.
 - e. Valves shall be Neles-Jamesbury Style 5150, McCanna Series S151, Worcester Series 51, or equal.
14. Flanged Ball Valves for Chlorine Gas Service:
- a. Ball valves for chlorine gas service shall have carbon steel (ASTM A216, Grade WCB) bodies with Hastelloy (ASTM A494, Alloy CW-12MW) ball and stem. Stem seals and body seals shall be Teflon.
 - b. Minimum operating pressure shall be 200 psi.
 - c. Valve seats shall incorporate a relief system per Chlorine Institute Pamphlet No. 6 such that in the event of pressure buildup in the valve body, chlorine will vent toward the upstream side of the valve.
 - d. Prepare valves for chlorine service as recommended by the Chlorine Institute Pamphlet No. 6.
 - e. Valve ends shall be flanged, Class 150, per ASME B16.5.
 - f. Valves shall have a plastic-coated lever operator.
 - g. Valves shall be Neles-Jamesbury Type 530SC (1/2 inch through 1 inch), 5300C (1-1/2 inches and larger); McCanna Model F; ITT Cam-Tite CLV; or equal.
15. Regular Port, Threaded End, Carbon Steel Ball Valves 2 Inches and Smaller for Anhydrous Ammonia Service (UL Listed):
- a. Carbon steel ball valves 2 inches and smaller shall be rated at a minimum pressure of 800-psi WOG and be UL listed for anhydrous ammonia service.
 - b. Valve body and retainer shall be carbon steel, ASTM A181; ASTM A216, Grade WCB; ASTM A105; or ASTM A108. Ball, stem nut, and stem shall be carbon steel (ASTM A108) or stainless steel (ASTM A479), with chrome-plated ball. Seat, packing, and seals shall be PTFE or reinforced PTFE. Body bolts shall conform to ASTM A449 or ASTM A193, Grade B7. Nuts for body bolts shall conform to ASTM A194, Grade 2H.
 - c. Provide nonblowout stems.
 - d. Valves shall have lever handle, plastic coated.
 - e. Valve shall have threaded ends (ASME B1.20.1).
 - f. Products: Neles-Jamesbury Type 2000 or equal.
16. Class 150 Flanged Carbon Steel Ball Valves 8 Inches and Smaller for Anhydrous Ammonia Service (UL Listed):
- a. Ball valves 1/2 inch through 8 inches shall have carbon steel (ASTM A216, Grade WCB) bodies, carbon steel ball and stem, and be UL listed for anhydrous ammonia service. Provide chrome or electroless nickel plating on ball. Stem seals and body seals shall be PTFE.
 - b. Body pressure rating and valve end flanges shall be Class 150 per ASME B16.5.
 - c. Provide plastic-coated lever actuator for valves smaller than 6 inches; provide geared actuator for valves 6 inches and larger.
 - d. Products: Neles-Jamesbury Type 5150 or equal.
17. Polyethylene Ball Valves for Natural Gas Service:
- a. Polyethylene ball valve used for gas service shall be made from medium density polyethylene resin conforming to ASTM D1248, Type II, Class B, Category 5, Grade P24.
 - b. Valve shall comply with ASME B16.40.
 - c. The valve shall have standard stub ends suitable for heat fusion welding.
 - d. The valve shall have seals and seats molded from Nitrile (Buna-N) material and shall be compatible with gas service.
 - e. Valve shall be Nordstrom Polyvalve, Kerotest Polyball, or equal.
18. Ball Valves (AWWA C507) for Water service:
- a. Valves shall be flanged, conforming to AWWA C507 and the following.
 - b. Valves shall be operable and hydrodynamically stable for fluid velocities up to 35 fps, fluid temperatures of 33 degrees F to 125 degrees F, and environmental temperature range of 35 degrees F to 125 degrees F.
 - c. The ball position shall be partially to fully open under the above criteria. Valve shaft, key, actuator, and complete assembly shall not fail at the specified maximum fluid velocity. Valve ball shall not change position under any line velocity scenario, including maximum velocity.
 - d. Flanged ends shall be flat-faced Class 125, ASME B16.1 or ASME B16.42 for Class 150 or Class 250, ASME B16.1 or ASME B16.42 for Classes 250 and 300 valves.
 - e. Metal-Seated Ball Valves:

- (1) Body: The valve body shall consist of two end pieces and two center body half pieces. Each end piece shall be bolted to the two adjoining center pieces. The two center pieces shall be longitudinally split and shall have machined surfaces for mating with each other. The center body pieces shall contain the ball assembly with the associated shaft stuffing box and packing. The body shall have integrally cast, bronze bushed trunnions. It shall provide rigid means for supporting the torque unit without the necessity of additional supports. Provide two pipe connections, one for an air vent and the other for drain. The end pieces shall contain the flanges for connecting to the adjacent piping. The port openings on the end pieces shall be a true 100 percent full circular opening equal to the nominal size of the valve.
 - (2) Ball: The ball shall have integrally cast, bronze bushed trunnions. An extension of one trunnion (the operating shaft) shall pass through a sealing device (O-ring retainer) and connect to the valve operating mechanism. The operating shaft shall be chrome plated where it passes through the sealing device. The sealing device shall be capable of being removed and having its seals replaced with the line under full pressure, without removing the valve from the line. Design the ball shaft so that the factor of safety for all combined stresses shall be at least five to one. Maximum torsional deflection shall not exceed 1/6 degree per foot of unsupported length using a seat coefficient of friction of 0.5 and a bearing coefficient of friction of 0.3.
 - (3) Bearings: Provide sleeve-type bearings fitted within both the ball and body trunnions. Bearing loading shall not exceed 900 psi at 150-psi differential pressure, 1,500 psi at 250-psi differential pressure, or 1,900 psi at 300-psi differential pressure. Bearings shall be Teflon-lined with fiberglass backing or bronze and of dissimilar hardnesses to prevent galling.
 - (4) Seats: Provide valves with a fixed body seat and a rotating ball seat. The ball seat shall be connected to the ball by means of a stainless steel mounting ring which is securely attached and pinned into position. Do not use seat designs in which the seat is threaded directly onto the ball. Seats shall be metal; no resilient seating surfaces are acceptable. Install metal seating surfaces on a two-degree offset axis to prevent wedging of the seats. Maximum seat bearing pressure shall be 1,000 psi. Seats shall be rigidly attached to the body and ball. Ball seats shall be adjustable to allow sealing in one direction without removing the valve from the adjacent piping.
 - (5) Manufacturers: Apco/Willamette Valve Inc., List 26; Pratt MSBV; or equal.
- f. Rubber-Seated Ball Valves:
- (1) Body: The valve body shall have integral support legs or pads and shall consist of two body end pieces and a center body piece through-bolted and O-ring sealed against leakage.
 - (2) Ball: The valve ball shall be taper-pinned to an upper and lower fitted shaft that is turned, ground, and polished to a 32-microinch or smoother finish per ASME B46.1.
 - (3) Bearings and Seals: The center section shall be fitted with sleeve-type bearings contained in the body hubs. Bearings shall be self-lubricating, with minimum wall thickness of 1/4 inch. Material shall be Teflon-lined with fiberglass backing. Bearing surfaces shall be isolated from flow by O-ring seals. The ball assembly shall be supported by a two-way thrust bearing assembly consisting of a Type 304 stainless steel stud and a bronze thrust collar (ASTM B505, Alloy C93200) in a grease-packed cavity.
 - (4) Seats: Valve seats shall be of a synthetic rubber compound that is resistant to free chlorine and monochloramine concentrations up to 10 mg/l in the fluid conveyed. Seats shall be retained in the valve body by mechanical means without retaining rings, segments, screws, or hardware of any kind in the flow stream. Seats shall seal a full 360 degrees without interruption and shall mate with a spherical Type 316 stainless steel seating surface on the ball. Valve seats shall be field adjustable around the full 360-degree circumference and replaceable without dismantling the operator, ball, or shaft. Where line size permits, seats shall also be capable of being replaced or adjusted without removing the valve from the line.
 - (5) Valves shall be single-seated to allow closure in one direction.
 - (6) Manufacturer: Henry Pratt Co. or equal.
 - (7) Leakage: The allowable leakage through the seat shall be as described in AWWA C507.
 - (8) Materials of Construction.

- a. Materials of construction for Class 150 valves shall be as follows:
 - Valve body: Cast iron (ASTM A126, Class B or ASTM A48, Class 35) or Ductile iron (ASTM A536, Grade 65 45-12).
 - Ball or rotor: Cast iron (ASTM A48, Class 35-minimum) or Ductile iron (ASTM A536, Grade 65 45-12).
 - Ball shaft: Alloy steel (ASTM A564, UNS S17400, Condition H1150).
 - Shaft and taper pins: Stainless steel (ASTM A276, Type 304 or 316) or Monel (ASTM B164, Alloy N04400).
 - Body bolts, studs, and nuts: Stainless steel (Type 304 per ASTM B193, Grade B8 and ASTM A194, Grade 8).
 - Capscrews (internal and external) and lockwashers: Stainless steel (AISI Type 316).
 - Seats (rubber): Buna-N.
 - Ball seats (metal): Stainless steel (ASTM A276, Type 304).
 - Body seats (metal): Monel (UNS N04400).
- b. Materials for construction for Classes 250 and 300 valves shall be as follows:
 - Valve body, ball or rotor: Steel (ASTM A216, Grade WCB) or Ductile iron (ASTM A536, Grade 65 45-12).
 - Ball shaft: Alloy steel (ASTM A564, UNS S17400, Condition H1150).
 - Shaft and taper pins: Stainless steel (ASTM A276, Type 304 or 316) or Monel (ASTM B164, Alloy N04400).
 - Body bolts, studs, and nuts: Stainless steel (Type 304 per ASTM A193, Grade B8 and A194, Grade 8).
 - Capscrews (internal and external) and lockwashers: Stainless steel (AISI Type 316).
 - Seats (rubber): Buna-N.
 - Ball seats (metal): Stainless steel (ASTM A276, Type 304).
 - Body seats (metal): Monel (UNS N04400).

PART 3 - EXECUTION

3.1 SHIPMENT AND STORAGE

- A. Provide flanged openings with metal closures at least 3/16-inch thick, with elastomer gaskets and at least four full-diameter bolts. Install closures at the place of valve manufacture prior to shipping. For studded openings, use all the nuts needed for the intended service to secure closures.
- B. Provide threaded openings with steel caps or solid-shank steel plugs. Do not use nonmetallic (such as plastic) plugs or caps. Install caps or plugs at the place of valve manufacture prior to shipping.
- C. Inspect valves on receipt for damage in shipment and conformance with quantity and description on the shipping notice and order. Unload valves carefully to the ground without dropping. Use forklifts or slings under skids. Do not lift valves with slings or chain around operating shaft, actuator, or through waterway. Lift valves with eyebolts or rods through flange holes or chain hooks at ends of valve parts.
- D. Protect the valve and actuators from weather and the accumulation of dirt, rocks, and debris. Do not expose rubber seats to sunlight or ozone for more than 30 days. Also, see the manufacturer's specific storage instructions.
- E. Make sure flange faces, joint sealing surfaces, body seats, and disc seats are clean. Check the bolting attaching the actuator to the valve for loosening in transit and handling. If loose, tighten firmly. Open and close the valve to make sure it operates properly and that stops or limit switches are correctly set so that the valve seats fully. Close valve before installing.
- F. If the valves and associated power actuators are stored or installed outside or in areas subject to temperatures below 40 degrees F or are exposed to the weather prior to permanent installation, provide the manufacturer's recommended procedures for extended storage. Provide temporary covers over actuator electrical components. Provide temporary conduits, wiring, and electrical supply to space heaters. Exercise each actuator from its fully open to fully closed position at least once every seven days. Inspect electrical contacts before start-up.

3.2 JOINTS

- A. Bolt holes of flanged valves shall straddle the horizontal and vertical centerlines of the pipe run to which the valves are attached. Clean flanges by wire brushing before installing flanged valves. Clean

flange bolts and nuts by wire brushing, lubricate threads with oil and graphite, and tighten nuts uniformly and progressively. If flanges leak under pressure testing, loosen or remove the nuts and bolts, reseal or replace the gasket, reinstall or retighten the bolts and nuts, and retest the joints. Joints shall be watertight.

- B. Clean threaded joints by wire brushing or swabbing. Apply Teflon joint compound or Teflon tape to pipe threads before installing threaded valves. Joints shall be watertight.
- C. Install lug-type valves with separate hex head machine bolts at each bolt hole and each flange (two bolts per valve bolt hole).

3.3 INSTALLING EXPOSED VALVES

- A. Unless otherwise indicated in the drawings, install valves in horizontal runs of pipe having centerline elevations 4 feet 6 inches or less above the floor with their operating stems vertical. Install valves in horizontal runs of pipe having centerline elevations between 4 feet 6 inches and 6 feet 9 inches above the floor with their operating stems horizontal.
- B. Install valves on vertical runs of pipe that are next to walls with their stems horizontal, away from the wall. Valves on vertical runs of pipe that are not located next to walls shall be installed with their stems horizontal, oriented to facilitate valve operation.
- C. Install valves such that the balls rotate about a horizontal axis.
- D. Handle valves carefully when positioning, avoiding contact or impact with other equipment, vault walls, or trench walls.
- E. Clean valve interiors and adjacent piping of foreign material prior to making up valve to pipe joint connection. Prepare pipe ends and install valves in accordance with the pipe manufacturer's instructions for the joint used. Do not deflect pipe-valve joint. Do not use a valve as a jack to pull pipe into alignment. The installation procedure shall not result in bending of the valve/pipe connection with pipe loading.
- F. Support body support legs or pads on a concrete pad without being anchored to such support. Install such that the valve is not subject to any loads due to thermal expansion of the pipe or support any piping loads on the body.
- G. Provide a separate support beneath the actuator extending beyond the valve body, so that no eccentric loads are imposed on the connecting piping.
- H. Prior to assembly, coat threaded portions of stainless steel bolts and nuts with lubricant.

3.4 INSTALLING BURIED VALVES

- A. Connect the valve, coat the flanges, apply tape wrapping or polyethylene encasement, and place and compact the backfill to the height of the valve stem.
- B. Place block pads under the extension pipe to maintain the valve box vertical during backfilling and repaving and to prevent the extension pipe from contacting the valve bonnet.
- C. Mount the upper slip pipe of the extension in midposition and secure with backfill around the extension pipe. Pour the concrete ring allowing a depression so the valve box cap will be flush with the pavement surface.
- D. In streets without concrete curbs and in open areas, install the valve box as for a paved area with concrete curb except include a marker post. Cut the marker post from 4-inch by 4-inch dense structural grade Douglas fir No. 2 or Southern Pine No. 2 surfaced on four sides to a length of 5 feet. Chamfer the top. Set the post in concrete, 2 feet into the ground, away from traffic, and to the side of the pipeline. Coat with a seal and finish coat of white alkyd exterior paint. On the side facing the valve, letter in black the word "VALVE" and the distance in feet from the marker post to the valve box cap.
- E. Install debris cap as close as possible under the cast-iron cover without interfering with the cover operation. Trim flexible skirt to provide a smooth contact with the interior or the extension pipe. Install Owner-furnished locks.

3.5 FIELD COATING BURIED VALVES

- A. Coat flanges of buried valves and the flanges of the adjacent piping, and the bolts and nuts of flanges and mechanical joints, per Section 099000, System No. 10.
- B. Wrap buried metal valves 6 inches and larger with polyethylene sheet per Section 400713.
- C. Wrap buried metal valves 6 inches and larger in two layers of polyethylene conforming to AWWA C105, 8 mils in thickness each. Pass the two sheets of polyethylene under the valve and the coated flanges or joints with the connecting pipe and draw the sheets around the valve body, the valve

bonnet, and the connecting pipe. Secure the sheets with plastic adhesive tape about the valve stem below the operating nut and about the barrel of the connecting pipe to prevent the entrance of soil. Fold overlaps twice and tape. Backfill the valve with care to avoid damaging the polyethylene.

3.6 MOUNTING GEAR ACTUATORS

- A. The valve manufacturer shall select and mount the gear actuator and accessories on each valve and stroke the valve from fully open to fully closed prior to shipment.

3.7 VALVE LEAKAGE TESTING

- A. Test valves for leakage at the same time that the connecting pipelines are tested. See Section 400515 for pressure testing requirements. Protect or isolate any parts of valves, actuators, or control and instrumentation systems whose pressure rating is less than the pressure test. Valves shall show zero leakage. Repair or replace any leaking valves and retest.

3.8 VALVE FIELD TESTING

- A. Actuators shall be fully lubricated in accordance with the manufacturer's recommendations prior to operating.
- B. Operate manual valves through three full cycles of opening and closing. Valves shall operate from full open to full close without sticking or binding. Do not backfill buried valves until after verifying that valves operate from full open to full closed. If valves stick or bind, or do not operate from full open to full closed, repair or replace the valve and repeat the tests.
- C. Gear actuators shall operate valves from full open to full close through three cycles without binding or sticking. The pull required to operate handwheel- or chainwheel-operated valves shall not exceed 80 pounds. The torque required to operate valves having 2-inch AWWA nuts shall not exceed 150 ft-lbs. If actuators stick or bind or if pulling forces and torques exceed the values stated previously, repair or replace the actuators and repeat the tests. Operators shall be fully lubricated in accordance with the manufacturer's recommendations prior to operating.

END OF SECTION

SECTION 400566
BUTTERFLY VALVES

PART 1 - GENERAL

1.1 SUMMARY

- A. This section includes materials, testing, and installation of butterfly valves and accessories in process air, water and wastewater applications.

1.2 RELATED WORK SPECIFIED ELSEWHERE

- A. Painting and Coating: 099000.
- B. General Piping Requirements: 400500.
- C. Pressure Testing of Piping: 400515.
- D. Valves, General: 400524.

1.3 SUBMITTALS

- A. Submit shop drawings in accordance with Section 013300.
- B. Submit manufacturer's catalog data and detailed construction sheets showing all valve parts. Describe each part by material of construction, specification (such as AISI, ASTM, SAE, or CDA), and grade or type. Identify each valve by tag number to which the catalog data and detail sheets pertain.
- C. Show valve dimensions including laying lengths. Show port sizes. Show dimensions and orientation of valve actuators, as installed on the valves.
- D. Show location of internal stops for gear actuators. State differential pressure and fluid velocity used to size actuators. For worm-gear actuators, state the radius of the gear sector in contact with the worm and state the handwheel diameter.
- E. Show valve linings and coatings. Submit manufacturer's catalog data and descriptive literature.
- F. Show the clear diameter or size of the port. Show the actual area of the port as a percentage of the area as calculated for the nominal valve size.

1.4 WARRANTY

- A. Full warranty against defects in materials and workmanship for one year after FINAL ACCEPTANCE including all parts, labor, and expenses.

PART 2 - PRODUCTS

2.1 GENERAL

- A. Valves and the required actuators are identified by tag numbers on the drawings and in the Valve Schedule. See the Valve Schedule in Valves, General Section 400524.
- B. Valves shall be installed complete with flange gaskets, nuts and bolts, operating handwheels or levers, chainwheels, extension stems, floor stands, gear actuators, operating nuts, chains, and wrenches required for operation.
- C. Valves shall have the name of the manufacturer and the size of the valve cast or molded onto the valve body or bonnet or shown on a permanently attached plate. Valves shall open by turning counterclockwise.
- D. Bolts, nuts and gaskets for flanged valves shall be as described in Section 400500.
- E. Lining and coating shall be as described in Section 099000.
- F. Packing, O-Rings and gaskets shall be Teflon, Kevlar aramid fiber, acrylic or aramid fiber, Buna-N or EPDM.
- G. Valve end connections for exposed valves shall be wafer or flanged, as indicated in Valve Schedule. Contractor shall verify compatibility of valve ends, including class and drilling flanges with the connecting pipe.
- H. Buried valve end connections shall be mechanical joint of push on joint unless otherwise shown in the drawings or in the Valve Schedule.

2.2 VALVES

A. BUTTERFLY VALVES FOR PROCESS AIR SERVICE (MSS SP-67).

1. Comply with MSS SP-67.
2. Materials:
 - a. Valve Bodies:
 - i. Wafer body: Cast iron ASTM A126, Class B.
 - ii. Lug Body: Ductile iron, ASTM A395.
 - b. Valve Shaft or Stem:
 - i. Stainless steel, ASTM A276, Type 316
 - c. Valve Disc:
 - i. Ductile iron, ASTM A395, nickel plated, or
 - ii. Aluminum Bronze, ASTM B148 Alloy 954
 - d. Valve Seat:
 - i. Water and air below 180 Deg F
 1. Buna-N
 - ii. Water and air 180 to 250 Deg F
 1. EPDM
 - iii. Valve seat shall be a full body seat isolating stem and body from flow.
3. Design Requirements:
 - a. Exposed and submerged valves 3 IN through 20 IN.
 - i. Body type: Wafer
 - ii. Working pressure: Rated for 150 psi.
 - iii. Equip with fully taped anchor lugs drilled per ASME B16.5.

B. BUTTERFLY VALVES FOR WATER AND WASTEWATER APPLICATIONS:

4. Comply with AWWA C504.
5. Materials:
 - a. Acceptable Materials for Valve Bodies:
 - i. Cast iron ASTM A126, Class B.
 - ii. Cast iron ASTM A48, Class 40
 - iii. Ductile iron ASTM A536, Grade 65-45-12
 - iv. Alloy Cast Iron ASTM A436, Type 1 and Type 2
 - v. Alloy Cast Iron ASTM A439, Type D2.
 - b. Valve Shaft or Stem:
 - i. Stainless steel, 18-8, Type 304
 - c. Acceptable Materials for Valve Disc:
 - i. ASTM A436, Type 1 alloy cast iron.
 - ii. ASTM A536, Grade 65-45-12 ductile iron
 - iii. Bronze in accordance with AWWA C504
 - iv. Aluminum Bronze, ASTM B148 Alloy 954
 - d. Valve Seat:
 - i. Water below 180 Deg F
 1. Buna-N
 - ii. Valve seat shall be a full body seat isolating stem and body from flow.
6. Design Requirements:
 - a. Exposed and submerged valves 3 IN through 20 IN.
 - i. Body type: Short body flanged or wafer, as indicated
 - ii. Working pressure: Rated for 150 psi (Class 150B per AWWA).

2.3 ACCESSORIES

- A. Refer to Valve Schedule for type of actuators. Furnish actuator integral with valve.

PART 3 EXECUTION

3.1 JOINTS

- A. Bolt holes of flanged valves shall straddle the horizontal and vertical centerlines of the pipe run to which the valves are attached. Clean flanges by wire brushing before installing flanged valves. Clean bolts and nuts by wire brushing, lubricate threads with oil and graphite, and tighten bolts uniformly and progressively. If flanges leak under pressure testing, loosen or remove the nuts and bolts, reseal or replace the gasket, reinstall or retighten the bolts and nuts, and retest the joints. Joints shall be watertight.
- B. Clean threaded joints with wire brush and by swabbing. Apply Teflon joint compound or Teflon tape to the pipe threads before installing threaded valves. Joints shall be watertight.
- C. Install lug type valves with separate hex head machine bolts at each bolt hole and each flange (two bolts per valve bolt hole).
- D. Install grooved end couplings for valves in accordance with grooved coupling supplier recommendations.

3.2 INSTALLING EXPOSED VALVES

- A. Unless otherwise indicated in the drawings, install valves in horizontal runs of pipe having centerline elevations 4 feet 6 inches or less above the floor with their operating stems vertical. Install valves in horizontal runs of pipe having centerline elevations between 4 feet 6 inches and 6 feet 9 inches above the floor with their operating stems horizontal.
- B. Install valves on vertical runs of pipe that are next to walls with their stems horizontal, away from the wall. Valves on vertical runs of pipe that are not located next to walls shall be installed with their stems horizontal, oriented to facilitate valve operation.
- C. Valve operator locations have been shown arbitrarily on the Drawings. Contractor shall verify the location of the operator to comply with above requirements, and to allow access for installation, operation, and maintenance.

3.3 INSTALLING BURIED VALVES

- A. Connect the valve, coat the retainer glands, install the tape wrapping or polyethylene encasement, and place and compact the backfill to the height of the valve stem.
- B. Place block pads under the extension pipe to maintain the valve box vertical during backfilling and repaving and to prevent the extension pipe from contacting the valve bonnet.
- C. Mount the upper slip pipe of the extension in midposition and secure with backfill around the extension pipe. Pour the concrete ring allowing a depression so the valve box cap will be flush with the pavement surface.

3.4 FIELD COATING BURIED VALVES

- A. Coat flanges of buried valves and the retaining hardware of the adjacent piping, and the bolts and nuts of retaining hardware and mechanical joints, per Section 099000.
- B. Wrap buried metal valves 6 inches and larger with polyethylene sheet.
- C. Wrap buried metal valves 6 inches and larger in two layers of polyethylene conforming to AWWA C105, 8 mils in thickness each. Pass the two sheets of polyethylene under the valve and the coated flanges or joints with the connecting pipe and draw the sheets around the valve body, the valve bonnet, and the connecting pipe. Secure the sheets with plastic adhesive tape about the valve stem below the operating nut and about the barrel of the connecting pipe to prevent the entrance of soil. Fold overlaps twice and tape. Backfill the valve with care to avoid damaging the polyethylene.

3.5 MOUNTING GEAR ACTUATORS

- A. The valve manufacturer shall select and mount the gear actuator and accessories on each valve and stroke the valve from fully open to fully closed prior to shipment.

3.6 VALVE FIELD TESTING

- A. Operate manual valves through three full cycles of opening and closing. Valves shall operate from full open to full close without sticking or binding. Do not backfill buried valves until after verifying that

valves operate from full open to full closed. If valves stick or bind, or do not operate from full open to full closed, repair or replace the valve and repeat the tests.

- B. Gear actuators shall operate valves from full open to full close through three cycles without binding or sticking. The pull required to operate handwheel- or chainwheel-operated valves shall not exceed 80 pounds. The torque required to operate valves having 2-inch AWWA nuts shall not exceed 150 ft-lbs. If actuators stick or bind or if pulling forces and torques exceed the values stated previously, repair or replace the actuators and repeat the tests. Operators shall be fully lubricated in accordance with the manufacturer's recommendations prior to operating.

END OF SECTION

SECTION 400567
CHECK VALVES FOR SPECIFIC APPLICATIONS

PART 1 - GENERAL

1.1 SUMMARY

- A. This section includes materials, testing, and installation of check valves and accessories in process air applications.

1.2 RELATED WORK SPECIFIED ELSEWHERE

- A. Painting and Coating: 099000.
- B. General Piping Requirements: 400500.
- C. Pressure Testing of Piping: 400515.
- D. Valve Schedule: 400521.

1.3 SUBMITTALS

- A. Submit shop drawings in accordance with Section 013300.
- B. Submit manufacturer's catalog data and detailed construction sheets showing all valve parts. Describe each part by material of construction, specification (such as AISI, ASTM, SAE, or CDA), and grade or type. Identify each valve by tag number to which the catalog data and detail sheets pertain.
- C. Show valve dimensions including laying lengths. Show port sizes. Show dimensions and orientation of valve appurtenances, as installed on the valves.
- D. Show valve linings and coatings. Submit manufacturer's catalog data and descriptive literature.
- E. Show the clear diameter or size of the port. Show the actual area of the port as a percentage of the area as calculated for the nominal valve size.
- F. Provide additional O&M data per Section 017823.

1.4 WARRANTY

- A. Full warranty against defects in materials and workmanship for one year after FINAL ACCEPTANCE including all parts, labor, and expenses.

PART 2 - PRODUCTS

2.1 GENERAL

- A. Valves are identified by tag numbers on the drawings and in the Valve Schedule. See the Valve Schedule Section 400521.
- B. Bolts, nuts and gaskets for flanged valves shall be as described in Section 400500.
- C. Lining and coating shall be as described in Section 099000.
- D. Valve end connections for exposed valves shall be flanged unless shown otherwise. Contractor shall verify compatibility of valve ends, including class and drilling flanges with the connecting pipe.

2.2 VALVES

- A. CHECK VALVES FOR STRAINER FEED PUMP STATIONS (NOT USED)
 - 1. Supply rubber flapper type check valve for raw sewage applications. Check valve shall be Swing-Flex by Val Matic, APCO CRF series, or equal.
 - 2. Standards and Approvals: Valves shall be designed, manufactured, tested and certified to ANSI/AWWA C508 standard.
 - 3. Connections shall be flanges with drilling to ANSI B16.1, Class 125.
 - 4. Materials: The valve body and cover shall be constructed of ASTM A536 Grade 65-45-12 ductile iron or ASTM A126 Class B Gray Iron for 30" and larger valves.
 - 5. Pressure rating: Valve shall withstand up to 250 psi of operating pressure.
 - 6. Options: Coating shall be applied to interior and exterior with an NSF/ANSI 61 approved fusion bonded epoxy coating.

B. CHECK VALVES FOR RAW SEWAGE PUMPING APPLICATIONS (NOT USED)

7. Supply rubber flapper type check valve for raw sewage applications. Check valve shall be Swing-Flex by Val Matic, APCO CRF series, or equal.
8. Standards and Approvals: Valves shall be designed, manufactured, tested and certified to ANSI/AWWA C508 standard.
9. Connections shall be flanges with drilling to ANSI B16.1, Class 125.
10. Materials: The valve body and cover shall be constructed of ASTM A536 Grade 65-45-12 ductile iron or ASTM A126 Class B Gray Iron for 30" and larger valves.
11. Pressure rating: Valve shall withstand up to 250 psi of operating pressure.
12. Options: Coating shall be applied to interior and exterior with an NSF/ANSI 61 approved fusion bonded epoxy coating.

C. CHECK VALVE FOR DUCKBILL CHECK APPLICATIONS, WHERE SHOWN (NOT USED)

1. Supply duckbill check valve by Red Valve or Onyx to meet specific application requirements. In line or flanged valve types will be accepted.

D. CHECK VALVES FOR PROCESS AIR APPLICATIONS

1. Note: Blower supplier will supply check valve with each blower supplied, shipped loose (along with pressure relief valves) for installation by Contractor. No additional process air check valves required for Contractor supply.
2. Supply double disk type wafer body check valves for process air applications. Check valve shall be Dual-Disc Check Valve by Val Matic, Double Door Check Valve by APCO, Duo-Chek Style G or H by Crane or Equal.
3. Standards and Approvals: ASME pressure class 125.
4. Connections shall be wafer body, retained wafer or retainerless wafer.
5. Materials: The valve body shall be carbon steel (with factory applied coating).
6. Seal: EPDM.
7. Coating shall be applied to interior and exterior per Specification Section 099000.

PART 3 EXECUTION

3.1 INSTALLING EXPOSED VALVES

- A. Install check valves in the orientation shown in the drawings with provisions to allow for access as required.

END OF SECTION

SECTION 400722
FLEXIBLE PIPE COUPLINGS AND EXPANSION JOINTS

PART 1 GENERAL

1.1 DESCRIPTION

- A. This section includes materials and installation of:
 - 1. flexible gasketed sleeve-type compression pipe couplings for steel; and ductile-iron pipe
 - 2. thermal expansion compensators and expansion joints 4 inches in diameter and smaller for steel, PVC; CPVC; and copper pipe.
 - 3. flexible expansion joints; expansion loops; or restrained flange adapters and couplings for connecting different pipe materials.

1.2 RELATED WORK SPECIFIED ELSEWHERE

- A. Painting and Coating: 099000.
- B. General Piping Requirements: 400500.
- C. Piping Schedule: 400501.
- D. Pressure Testing of Piping: 400515.
- E. Wall Pipes, Seep Rings, and Penetrations: 400762.
- F. Pipe Hangers and Supports: 400764.

1.3 SUBMITTALS

- A. Submit shop drawings in accordance with Section 013300
- B. Submit manufacturer's catalog data on flexible pipe couplings, thermal expansion compensators; restrained flange adapters; expansion loops; and expansion joints. Show manufacturer's model or figure number for each type of coupling or joint for each type of pipe material for which couplings and joints are used. Show coatings.
- C. Submit manufacturer's recommended torques to which the coupling bolts shall be tightened for the flexible gasketed sleeve-type compression pipe couplings.
- D. Show materials of construction by ASTM reference and grade. Show dimensions.
- E. Show number, size, and material of construction of tie rods and lugs for each thrust harness on the project.

1.4 WARRANTY

- A. Full warranty against defects in materials and workmanship for one year after FINAL ACCEPTANCE, including all parts, labor, and expenses.

PART 2 PRODUCTS

2.1 COUPLING SYSTEM DESIGN AND COMPONENT UNIT RESPONSIBILITY

- A. The coupling manufacturer shall furnish the gaskets, bolts, nuts, glands, end rings, and hardware for pipe couplings of all types and shall design these components as an integral system. Design the gaskets for the coupling and appropriately size to provide a watertight seal at the design pressure and temperature. Ship gaskets, bolts, nuts, glands, end rings, and hardware for pipe couplings with the pipe coupling and clearly label indicating the origin of the material, including place and date of manufacture. Package the manufacturer's printed installation instructions with each pipe coupling.

2.2 STEEL FLEXIBLE PIPE COUPLINGS

- A. Steel couplings shall have center sleeves and end rings made of carbon; Steel couplings shall have center sleeves and end rings made of Type 304 stainless; or Steel couplings shall have center sleeves and end rings made of Type 316 stainless steel conforming to AWWA C219, Section 4. Minimum center sleeve length shall be 5 inches for pipe sizes 3/4 inch through 4-1/2 inches, 7 inches for pipe sizes 5 inches through 24 inches, and 10 inches for pipe sizes larger than 24 inches.
- B. Sleeve bolts in exposed service shall be carbon, Type 304 stainless; or Type 316 stainless steel per AWWA C219, Section 4. Sleeve bolts in buried or submerged service shall be Type 304 stainless; or Type 316 stainless steel per AWWA C219, Section 4.
- C. Steel end rings shall be cast, forged, or hot rolled in one piece. Do not use rings fabricated from two or

more shapes.

- D. Wall thickness of sleeve shall be at least that specified for the size of pipe in which the coupling is to be used.

2.3 DUCTILE-IRON FLEXIBLE PIPE COUPLINGS

- A. Couplings shall have center sleeves and end rings made of ductile iron conforming to AWWA C219, Section 4.
- B. Sleeve bolts in exposed service shall be carbon; Type 304 stainless; or Type 316 stainless steel per AWWA C219, Section 4. Sleeve bolts in buried or submerged service shall be Type 304 stainless or Type 316 stainless steel per AWWA C219, Section 4.

2.4 JOINT HARNESSSES

- A. Tie bolts or studs shall be as shown in the following table. Bolt or stud material shall conform to ASTM A193, Grade B7. Nuts shall conform to ASTM A194, Grade 2H. Lug material shall conform to ASTM A36, ASTM A283, Grade B, C, or D, or ASTM A285, Grade C. Lug dimensions for steel pipe shall be as shown in AWWA Manual M11 (2004 edition), Figure 13-20, using the number and size of lugs as tabulated below.
- B. Lugs for steel pipe shall be Type P for pipes 6 through 10 inches and Type RR for pipes 12 inches and larger.; or Lug or ear dimensions for ductile-iron pipe shall be as shown in the drawings.
- C. Manufactured lugs shall incorporate a three-hole design that utilizes two flange bolts to hold each lug in place for each tie-rod. Lug shall be A36 steel or 316 stainless steel. Manufactured lugs shall be Romac Series 490, or equal.
- D. Select number and size of bolts based on the test pressure shown in Section 4005010. Stagger bolts equally around pipe circumference. Where odd number is tabulated, place odd bolt at top. For test pressures less than or equal to 150 psi, use the 150-psi design in the table above. For test pressures between 150 and 300 psi, use the 300-psi design in the table above.
- E. Provide washer for each nut. Washer material shall be the same as the nuts. Minimum washer thickness shall be 1/8 inch.

2.5 FLEXIBLE PIPE COUPLINGS FOR PLAIN-END STEEL PIPE

- A. Couplings shall be steel, Dresser Style 38, Smith-Blair Type 411, Baker Series 200, or equal.

2.6 FLEXIBLE PIPE COUPLINGS FOR PLAIN-END DUCTILE-IRON PIPE

- A. Couplings for pipe 12 inches and smaller shall be cast iron, Dresser Style 253 or 253 long sleeve, Smith-Blair Type 441, Baker Series 228, or equal.
- B. Couplings for pipe larger than 12 inches shall be cast iron or steel, Dresser Style 38 or 153, Smith-Blair Style 411, Baker Series 228, or equal.

2.7 TRANSITION COUPLINGS

- A. Couplings for connecting different pipes having different outside diameters shall be steel: Dresser Style 62 or 162, Smith-Blair Series 413, Baker Series 212 or 220, or equal.
- B. Couplings shall have an internal full circumference ring pipe stop at the midpoint of the coupling. Inside diameter of coupling pipe stop shall equal inside diameter of smaller diameter pipe.

2.8 FLANGED COUPLING ADAPTERS FOR STEEL PIPE

- A. Adapters for steel pipe shall be steel: Dresser Style 128, Smith-Blair Type 913, or equal. Flange ends shall match the flange of the connecting pipe; see detail piping specifications.

2.9 FLANGED COUPLING ADAPTERS FOR CAST- AND DUCTILE-IRON PIPE

- A. Adapters for cast- and ductile-iron pipe 12 inches and smaller shall be cast iron: Dresser Style 127, Smith-Blair Series 912, or equal.
- B. Adapters for cast- and ductile-iron pipe larger than 12 inches shall be steel: Dresser Style 128, Smith-Blair Type 913, or equal.
- C. Flange ends shall match the flange of the connecting pipe.

2.10 RESTRAINED FLANGE ADAPTER FOR DUCTILE IRON PIPE

- A. Restrained flange adapter shall be made of ductile iron conforming to ASTM A536.
- B. Flange bolt circle of the adapter shall be compatible with Class 125 flanges per AWWA C115.

- C. Restraint for the flange adapter shall consist of a plurality of individually actuated gripping wedges.
- D. Restrained flange adapter shall be Series 2100 Megaflange as produced by EBAA Iron, Inc., or approved equal.
- E. Restrained flange adapters shall only be used specifically where shown on the Contract Documents or with written approval from the Engineer for additional locations.

2.11 DISMANTLING JOINTS

- A. The dismantling joint shall consist of a flanged steel spigot piece, a flanged sleeve, a center ring welded onto the sleeve, and a follower ring containing a gasket through which the spigot piece slides into the sleeve. The joint shall accommodate up to 2 inches of longitudinal movement. The longitudinal adjustability shall be provided by a telescopic action of a flanged spigot and associated sleeve, which inserts into the spigot. A system of tie bolts or rods shall connect the center ring of the sleeve or the end flange on the sleeve to the end flange on the spigot piece. Provide washers and nuts on the tie bolts on both sides of the center ring or sleeve and flange and the spigot end flange to allow for adjustment of the extension length for the sleeve.
- B. The minimum design pressure shall be the same as the adjacent piping. Design stresses shall not exceed 40% of the yield strength of the materials. Minimum factory test pressure shall be 150% of the design pressure.
- C. The gasket shall be compressed by a separate bolting and gland system, independent of the tie bolts. Gasket shall be isoprene, Buna-N or EPDM.
- D. Fabrication, assembly, and erection shall comply with Section 400513.
- E. Dismantling joints shall have a spigot piece made of steel conforming to ASTM A36, A53 (Type E or S), or A283, Grade C having a minimum yield strength of 30,000 psi and a flange adapter and follower ring made of ductile iron conforming to ASTM A536, Grade 65-45-12.
- F. Sleeve and follower ring bolts shall have a minimum yield strength of 105,000 psi, a minimum tensile strength of 125,000 psi, and shall conform to ASTM A193, Grade B7.
- G. Steel flanges [, center ring,] and gasket follower rings shall be cast, forged, or hot rolled in one piece. Do not use flanges or rings fabricated from two or more shapes. Flanges shall conform to ANSI Classes 125 and 150.
- H. Wall thickness of spigot piece and sleeve shall be at least that specified for the size of pipe in which the coupling is to be used.
- I. Flanges: See Section 40051300.
- J. Manufacturers: Romac Industries Style DJ400 or equal.

2.12 SEGMENTED RESTRAINED SLEEVE COUPLINGS AND FLANGED ADAPTER COUPLINGS FOR CARBON AND STAINLESS STEEL PIPE

- A. The coupling shall be of the split or segmented sleeve type with a double arch cross-section, which closes around plain steel pipe ends. The design pressure and wall thickness of the body shall be at least that specified for the size of pipe on which the coupling is to be used. Provide welded steel restraint rings on the pipe ends for end restraint. As the coupling closes, it shall confine an elastomeric

gasket on each pipe end to create a radial seal. The axial seal shall be affected at the closure plates as bolts pull the coupling snug round the pipe. Provide shoulders on each end of the couplings. Flanged adapter couplings shall incorporate a flange on one end (instead of an end ring and shoulder) to match the flange on the connecting pipe or valve. Products: Victaulic "Depend-O-Lok" Model F x F Type 2 for sleeve couplings or Victaulic "Depend-O-Lok" Model F x F flanged adapter coupling for flanged adapter couplings.

- B. Carbon steel piping includes steel pipe lined with cement mortar, polyurethane or epoxy.
- C. Body, flange, and closure plates for couplings used with carbon steel pipe in exposed service shall be carbon steel per ASTM A36, Type 304 or 304L stainless steel per ASTM A240 or A 666; or Type 316 or 316L stainless steel per ASTM A240 or A666.
- D. Body, flange, and closure plates for couplings used with carbon steel pipe in buried service shall be. Type 304 or 304L stainless steel per ASTM A240 or A666; or Type 316 or 316L stainless steel per ASTM A240 or A666.
- E. End restraint rings for couplings used with carbon steel pipe shall be carbon steel per ASTM A108, Grade 1020; Type 304 or 304L stainless steel per ASTM A276; or Type 316 or 316L stainless steel per ASTM A276. Provide end restraint rings on each of the connecting pipes. The end rings shall be welded to the pipe ends using a welding procedure complying with the ASME Pressure Vessel Code, Section IX. Weld the end restraint rings to the pipe before applying the lining and coating (if any is specified) to the pipe. The welded end restraint rings shall have at least the pressure rating of the pipe to which the coupling is attached.
- F. Fasteners for couplings used with carbon steel pipe in exposed service shall be Type 304 stainless steel per ASTM A276, F593, or F738 with stainless steel nuts per ASTM F594 or F836; carbon steel per ASTM A325, with carbon steel nuts and washers per ASTM A563; or Type 316 stainless steel per ASTM A276, F593, or F738 with stainless steel nuts per ASTM F594 or F836
- G. Fasteners for couplings used with carbon steel pipe in buried service shall be Type 304 stainless steel per ASTM A276, F593, or F738 with stainless steel nuts per ASTM F594 or F836; or Type 316 stainless steel per ASTM A276, F593, or F738 with stainless steel nuts per ASTM F594 or F836.
- H. Coupling body, flange, and closure plates for couplings used with stainless steel pipe shall be Type 304 or 304L stainless steel per ASTM A240 or A666; or Type 316 or 316L stainless steel per ASTM A240 or A666.
- I. End restraint rings for couplings used with stainless steel pipe shall be Type 304 or 304L stainless steel per ASTM A276; or Type 316 or 316L stainless steel per ASTM A276. Provide end restraint rings on each of the connecting pipes. The end rings shall be welded to the pipe ends using a welding procedure complying with the ASME Pressure Vessel Code, Section IX. The welded end restraint rings shall have at least the pressure rating of the pipe to which the coupling is attached.
- J. Fasteners for couplings used with stainless steel pipe shall be Type 304 stainless steel per ASTM A276, F593, or F738 with stainless steel nuts per ASTM F594 or F836; or Type 316 stainless steel per ASTM A276, F593, or F738 with stainless steel nuts per ASTM F594 or F836.
- K. Gaskets shall be isoprene, Buna-N; or EPDM conforming to ASTM D2000 for water and sewage service and having a temperature range of -20°F to +180°F.
- L. Provide joint sealant between the pipe ends for piping 24 inches and larger after the sleeve coupling is installed: Sikaflex 2C with Sikaflex 429 primer.

2.13 TYPE 1 EXPANSION JOINTS: FOR COPPER PIPE

- A. Expansion joints for copper pipe shall be all bronze: Metraflex Model HPMF expansion compensator, Hyspan Model 8509 or 8510 expansion compensator, or equal. Expansion compensators shall have antitorque devices to protect the bellows. Minimum working pressure shall be 175 psig.

2.14 TYPE 2 EXPANSION JOINTS: FOR STEEL PIPE 4 INCHES AND SMALLER

- A. Expansion joints for steel pipe 4 inches and smaller shall be carbon steel: Hyspan Model 8503 or 8504 expansion compensators, Metraflex Model HP expansion compensator, or equal. Expansion compensators shall have antitorque devices to protect the bellows. Minimum working pressure shall be 150 psi.

2.15 TYPE 3 EXPANSION JOINTS: TEFLON BELLOWS TYPE

- A. Expansion joints shall be Teflon bellows type having three convolutions, ductile-iron flanges, Monel reinforcing ring, and a Teflon facing on the flanges. Minimum working pressure shall be 110 psi. Provide thrust harnesses. Flanges shall be Class 125, ASME B16.1. Products: Peabody-Dore Style E-1608-B, Resistoflex No. R6905, or equal.

2.16 TYPE 4 EXPANSION JOINTS: SPHERICAL EXPANSION JOINTS

- A. Spherical design expansion joints shall be chlorobutyl with polyester fiber reinforcing and be provided with steel retaining rings and Type 304 stainless steel gusset plates and control rods. Expansion joints shall have flat-face flanges integral with the body to match 125/150-pound flanges. Expansion joints for hot water service shall be rated at a minimum of 150 psig at 212°F.

Joint Size	Flange to Flange Length (inches)	Minimum Pressure Rating (150°) (psi)
4-8	6	225
10-12	8	225
14-20	10-12	125

- B. Expansion joints shall be manufactured by Metraflex Metrasphere, Proco Series 240, or equal.

2.17 TYPE 5 EXPANSION JOINTS: SINGLE; DOUBLE; OR TRIPLE ARCH RUBBER TYPE (24 INCHES AND SMALLER)

- A. Expansion joints shall be rubber, single; double; or triple arch type, with integral flat-face ANSI Class 125/150 flanges.
1. Cover Elastomer: Butyl; Neoprene; or Chlorobutyl.
 2. Tube Elastomer: Butyl; Neoprene; Chlorobutyl; Teflon®; Hypalon®; or Nitrile.
 3. Arch Type: Open or Filled.
 4. Fluid: Potable water; Raw water; Raw sewage; or sludge.
 5. Fluid Temperature Range: 40°F to 105°F.
 6. Ambient Temperature Range: 30° F to 120°F.
- B. Minimum working pressure shall be 150 psi for joints 12 inches and smaller, 120 psi for 14- and 16-inch joints, 110 psi for 18- and 20-inch joints, and 100 psi for 24-inch joints. Provide steel thrust plates, retaining rings, and control rods. Products: Proco Style 220, General Rubber Style 1075, or equal.

2.18 TYPE 6 EXPANSION JOINTS: FLEXIBLE EXPANSION JOINTS

- A. Each flexible expansion joint shall consist of two ball joints and two or three expansion sleeves. Each expansion sleeve shall allow an expansion capability of at least 4 inches. Material of construction shall be ductile iron conforming to the material requirements of AWWA C153. Minimum deflection shall be 15 degrees in both vertical and horizontal planes. Minimum pressure rating of the flexible coupling joint assembly shall be 350 psi. Provide stop collars on the sleeves to restrain the lateral travel. Provide synthetic rubber gaskets in sleeves and balls. Ends of assembly shall be flanged or mechanical joint to match the connecting piping.
- B. Coat exposed, buried and submerged assemblies per Section 099000. Color of finish coat shall match the connecting piping or be the same as the connecting piping.
- C. Flexible expansion joints shall be EBAA Iron, Inc., "Flex-Tend"; Romac Industries "FlexiJoint"; or equal.

2.19 TYPE 7: ELASTOMERIC COUPLING

- A. Provide elastomeric couplings suitable for the pipe types and sizes to be connected. Elastomeric coupling shall consist of an elastomeric plastic sleeve and Type 304 or 305 stainless steel pipe clamps. Provide a minimum of two clamps for pipes up to 15 inches in outer diameter. Provide a minimum of four clamps on a sleeve 10 inches long for pipes larger in diameter than 15 inches.

2.20 TYPE 8 COUPLINGS: FOR CONNECTING VITRIFIED CLAY PIPE TO PLASTIC OR DUCTILE-IRON PIPE

- A. Couplings shall consist of a styrene butadiene (SBR) or neoprene rubber body with stainless steel bands, housings, and clamps. The clamping device for couplings 10 inches and larger shall be cold-rolled steel or stainless steel. Products: Calder Couplings for pipes 3 through 8 inches and

Ceramicweld Coupling for pipes 10 through 42 inches.

2.21 TYPE 9: EXPANSION LOOPS FOR COMPRESSED AIR PIPING

- A. Expansion loops shall consist of two flexible sections of Type 300 stainless steel hose and braid, two 90-degree elbows, and one 180-degree return with drain valve. Fittings shall be Schedule 40 carbon steel with male NPT connections. Expansion loops shall provide a minimum of 1-1/2 inches of axial movement in all directions and shall have a minimum pressure rating of 455 psi at 70°F. Install pipe guides within four pipe diameters of each side of the loop, as recommended by the expansion loop supplier. Manufacturers: Flexicraft, Metraflex, or equal.

2.22 TYPE 10: FLEXIBLE HOSE CONNECTORS 3 INCHES AND SMALLER

- A. Flexible hose connectors 3 inches and smaller shall be of the corrugated metal hose type with an external braid. Connectors shall have a minimum pressure rating of 300 psi at a temperature of 150°F. Corrugation tubing material shall be Type 316 stainless steel with Type 316 or 321 stainless steel braid material. End connections shall be ground joint female union with ANSI/ASME B1.20.1 NPT threads; Class 150 flat-faced flanges. Length shall be 12-24 inches unless otherwise indicated. Flexible connectors shall be American BOA, Flexonics, Metraflex, or equal.

2.23 TYPE 11: FLEXIBLE ELASTOMERIC INTERNAL JOINT

- A. Rubber Joint Liner: EPDM.
- B. Bands, Shims, and Setscrews:
1. Stainless steel bands, spacers, shims, and setscrews for securing rubber membrane across piping joints shall be Type 316 per ASTM A240.
 2. Welding: Perform welding with coated electrode 316L, AWS Class A5.4, AC-DC-16, with tensile strength of 70,000 psi.
- C. Liquid Joint Lubrication:
1. Liquid joint lubricant to assist in installation of the rubber joint seal and bands shall be a nontoxic vegetable-based lubricating gel.
 2. Required Properties:
 - a. Shall not deteriorate or decompose while in storage for a minimum of two years.
 - b. Shall have a soft pasty consistency suitable for use intended from 0°F to 120°F.
 - c. Shall not have any deteriorating effect on natural or synthetic rubber gaskets.
 - d. Shall not impart taste or odor to water.
 - e. Shall have no objectionable odor.
 - f. Shall be nontoxic and does not support the growth of bacteria.
 - g. pH: 9.6 minimum and 11 maximum (pH meter).
 - h. Method of Test: ASTM D562.
 - i. Shall not contain any petroleum-based oils or grease.
 - j. Shall not contain any materials considered toxic.
- D. Filling Materials for Gaps Between Joints: The filling material shall be an injected elastomeric joint filler.
- E. Epoxy:
1. Coating Appearance: Smooth, white, thixotropic liquid.
 2. Gel Appearance: Smooth, white mastic of stiff consistency.
 3. Service Temperature Range: 50°F to 200°F.
- F. Thread Sealing Compound:
1. Thread sealing compound shall be a nontoxic paste type with Teflon.
 2. Teflon Components Required Properties--Physical Data:
 - a. Flash Point: 410°F closed cup.
 - b. Specific Gravity: 1.4 to 1.42.
 - c. Viscosity: 200,000 to 275,000 centipoises.
 - d. Temperature Range: -50°F to 500°F.
 - e. Pressure Application: Maximum 10,000 psi.
- G. Products: EPDM rubber material shall be AMEX-10/WEKO-SEAL from Miller Pipeline Corporation, telephone 317-293-0278; HY-FLEX from Lineal Industries, telephone 1-877-787-9461; or equal.

Description	Method	Result
Flexural strength	ASTM D790	6,000 psi
Flexural modulus	ASTM D790	550,000 psi
Compressive strength, yield	ASTM D695	4,275 psi
Tensile strength	ASTM D638	3,700 psi
Tensile ultimate elongation	ASTM D638	1.4%
Hardness, Shore D	ASTM D2583	85
Hardness, Pencil	ASTM D3363	6H
Impact, IZOD	ASTM D256	0.19 ft-lb/inch of notch
Temperature resistance	Steel, unprimed	250°F
Temperature resistance	Concrete	250°F
Solids content	-----	100%
Solvents present	-----	None

2.24 TYPE 12 EXPANSION JOINTS: METAL BELLOWS PUMP CONNECTION JOINTS 1-1/2 THROUGH 24 INCHES

- A. Provide multiple bellows, annular, flanged expansion joint constructed from single or multiple metal laminations. Provide flow liner. Provide thrust restraining rod system. Minimum pressure rating shall be 275 psi at a temperature of 200°F. Flanges shall be Class 150 per ASME B16.5. Provide fixed, flat-face flanges. Materials of construction shall be as follows:

Item	Material	Specification
Bellows or flow liner>>	Stainless steel	ASTM A240 or A666, Type 304 or 321
Flanges	Steel	ASTM A285, Grade C

- B. Products: Hyspan Model 5501 R or Keflex Type 151-TR or equal.

2.25 PIPE ALIGNMENT GUIDES FOR EXPANSION JOINTS AND EXPANSION COMPENSATORS (TYPES 1, 2, AND 3)

- A. For copper pipes, use Hyspan Series 9500 Copper Tube Alignment Guides, Metraflex Style I, B-Line, Anvil International, or equal.
- B. For bellows-type expansion joints and expansion loops in steel, PVC, and CPVC pipe, use Hyspan Series 9500 Pipe Alignment Guide, Metraflex Style I, B-Line, Anvil International, or equal.

2.26 BOLTS AND NUTS FOR FLANGES

- A. See Section 400500.

2.27 THREADED CAPS FOR PROTECTION OF NUTS AND BOLT THREADS

- A. See Section 400500.

PART 3 EXECUTION

3.1 INSTALLATION OF FLEXIBLE PIPE COUPLINGS, SEGMENTED SLEEVE COUPLINGS, AND EXPANSION JOINTS

- A. Clean oil, scale, rust, and dirt from pipe ends. Clean gaskets in flexible pipe couplings before installing.
- B. Install expansion joints per manufacturer's recommendations, so that 50% of total travel is available for expansion and 50% is available for contraction.
- C. Lubricate bolt threads with graphite and oil prior to installation.
- D. Install threaded nut and bolt thread protection caps after completing the bolt, nut, and gasket installation. Install on exposed; buried; and submerged flexible pipe couplings, transition couplings, flanged coupling adapters, dismantling joints, and segmented restrained sleeve couplings.

3.2 INSTALLATION OF TYPE 11 FLEXIBLE ELASTOMERIC INTERNAL JOINT

- A. Store the membranes in a cool, dry environment away from direct sunlight. Do not remove the rubber joint seals from the plastic bags prior to use. Store seals in a cool, dry environment and do not remove from their plastic bags until required for use. Do not allow them to remain in direct sunlight.
- B. Surface Preparation of Joint Area: Prepare the area of pipe either side of the joint where the actual lip seals make contact with the pipe to a finish that will allow the lip seals to bed consistently and so provide a permanent seal.
- C. Surface Lubrication: Immediately prior to fitting the seal, clean the area with a dry brush and coat with lubricant that is a nontoxic vegetable soap compatible with the composition of the flexible joint seal. Apply the lubricant using a paintbrush over the ground area. Do not pick up dust deposits from the unground surface into the lubricant and therefore onto the ground surface.
- D. Positioning the Seal: Prior to placing the seal, coat the area of pipe which will be covered with the seal with an epoxy coating and allow to partially set up prior to seal installation. Check the seal for damage. Check that the test unit is tight before fitting the seal in place. Place the flexible joint seal in position bridging the joint gap, guided by the marks. Position the seal accurately on the ground areas. The test unit in the seal should be located at either 9 o'clock or 3 o'clock position. Position the seal parallel to the joint gap.
- E. Positioning Retaining Bands: Place two stainless steel radiused shims, 6 inches long and 3/64-inch-thick, underneath the wedge area in the grooves, to provide a bridge that will transmit the radial load evenly to the flexible joint seal, as the bands are expanded. Then place the stainless steel bands in the grooves provided in the seal. Temporarily lock both bands in position.
- F. Expanding the Seal into Position: Use the hydraulic expanding device to apply a set pressure to the retaining bands of the flexible joint seal.
 - 1. When positioning the expander in line with the retaining band, ensure that the band remains in the groove of the flexible joint seal and does not become moved or dislodged. Ensure the expander is positioned correctly on the band.
 - 2. The expander is expanded which radially transmits a load against the retaining band and flexible joint seal. Hold this pressure for at least two minutes. The range of pressure registered on the expander shall be 4,000 psi minimum and 5,000 psi maximum.
 - 3. A space is provided at bottom dead center position of the expander that exposes the grooved-end cleats of the retaining band. Fit a radiused locking wedge piece between the exposed gap of the expanded band ends. Select a size of wedge having a slight interference fit between the band ends, and tap the wedge (leading edge first) into position, locking in the compression of the flexible joint seal. The radius of the wedge shall equal the radius of the pipe.
 - 4. Release the hydraulic pressure from the expander and repeat the procedure on the second retaining band of the seal.
 - 5. Repeat this entire operation (i.e., re-expanded) not before 30 minutes have elapsed after the first expansion. This allows for any seal relaxation that may take place and usually a slightly larger wedge can be fitted. The load forces transmitted by the expander have been determined from test data and should not be altered by changing the pressure used to activate the expander.
- G. Testing the Seal, Test 1: Apply two individual pressure tests to the seal before closing the pipeline. Apply the first test after each section has been completed and not before 30 minutes have elapsed after the final fitting of the seal. Apply a pressure of 10 psig. Because of the excessive ballooning to the center membrane of the seal (that will occur at this higher pressure), lock a restraining device called a "test band" in its expanding position during testing. If the pressure test indicates leakage, determine the cause and repeat from Step E.
- H. Testing the Seal, Test 2: In the second test, introduce 5 psig through the valve in the flexible joint seal. Sustain this pressure while applying a soap and water test to the outer edge and entire body of the seal. Inspect for leakage. If pressure test indicates leakage, determine the cause and repeat from Step E.
- I. Testing Valve Assembly: After the final test of 5 psig, seal the test valve of the flexible joint seal with a countersunk hex head completion plug using a nontoxic thread-sealing compound on the threads. Remove installation hardware, test band, and pressure gauges from the pipe.

3.3 PAINTING AND COATING

- A. Coat buried flexible pipe couplings (including joint harness assemblies), transition couplings,

segmented sleeve couplings, and flanged coupling adapters per Section 099000. Coat buried bolt threads, tie bolt threads, and nuts per Section 099000. Then wrap the buried couplings with polyethylene wrap.

- B. Coat flexible pipe couplings (including joint harness assemblies), transition couplings, segmented sleeve couplings, and flanged coupling adapters located indoors, in vaults and structures, and above ground with the same coating system as specified for the adjacent pipe. If the adjacent pipe is not coated, coat couplings per Section 099000. Apply prime coat at factory.
- C. Line carbon steel and iron flexible pipe couplings and segmented sleeve couplings per Section 099000.
- D. Alternatively, line and coat carbon steel and iron flexible pipe couplings and segmented sleeve couplings with fusion-bonded epoxy.
- E. Wrap Types 7 and 8 couplings with polyethylene.
- F. Coat couplings, expansion joints; expansion compensators; and alignment guides located above ground or in vaults and structures [with the same coating system as specified for the adjacent pipe. If the adjacent pipe is not coated, coat couplings per Section 099000. Color shall match the color of the connecting pipe.

3.4 HYDROSTATIC TESTING

- A. Hydrostatically test flexible pipe couplings, expansion joints, segmented sleeve couplings, and expansion compensators in place with the pipe being tested. Test in accordance with Section 400515.

3.5 PIPE HANGERS AND SUPPORTS FOR EXPANSION JOINTS AND EXPANSION COMPENSATORS (TYPES 1, 2, AND 3)

- A. At each expansion compensator or bellows-type expansion joint located on horizontal piping runs, provide a pipe alignment guide within four pipe diameters of each end of the expansion joint or compensator. Provide a second pipe alignment guide within 14 pipe diameters of each end of the expansion joint or compensator.
- B. Mount pipe alignment guides on wall brackets or steel channels as manufactured by Anvil International, B-Line, or equal.

END OF SECTION

THIS PAGE INTENTIONALLY LEFT BLANK.

SECTION 400762
WALL PIPES, SEEP RINGS, AND PENETRATIONS

PART 1 GENERAL

1.1 DESCRIPTION

- A. This section includes materials, installation, and testing of steel, cast-iron, and ductile-iron wall pipes and sleeves (including wall collars and seepage rings) and penetrations.

1.2 RELATED WORK SPECIFIED ELSEWHERE

- A. Painting and Coating: 099000.
- B. Precast Concrete Utility Structures: 330516.
- C. General Piping Requirements: 400500.

1.3 SUBMITTALS

- A. Submit shop drawings in accordance with Section 013300.
- B. Submit detail drawings for fabricated steel or cast-iron wall and floor pipes and sleeves, wall flanges, seep rings, and sealing materials. Show dimensions and wall thicknesses.
- C. Show flange sizes and the appropriate ANSI or AWWA flange dimensional standard where flanged end wall pipes or penetrations are used.
- D. Show grooved-end dimensions and AWWA grooved-end dimensional standard where grooved-end wall pipes or penetrations are used.
- E. List coating systems to be applied, manufacturer, and dry thickness of coatings. Call out coatings where coatings are to be applied.
- F. List materials of construction, with ASTM material reference and grade.
- G. Submit manufacturer's instructions for installing rubber annular hydrostatic sealing devices.
- H. Submit six copies of the results of the leakage test for cast-iron sleeves having shrink-fit steel collars or collar halves bottomed in a groove and steel sleeves having welded steel collars.

1.4 WARRANTY

- A. Full warranty against defects in materials and workmanship for one year after FINAL ACCEPTANCE; including all parts, labor, and expenses.

PART 2 PRODUCTS

2.1 GENERAL

- A. Use cast-iron, ductile-iron, or fabricated steel wall sleeves when containing rubber annular hydrostatic sealing devices through which piping passes.
- B. Use only cast-iron or ductile-iron wall pipes when connecting to cast-iron and ductile-iron pipe. Use only fabricated steel or stainless steel wall pipes when connecting to steel or stainless steel pipe, respectively.
- C. Cast-iron flanges shall conform to ASME B16.1, Class 125 or 250, to match the flange on the connecting pipe.
- D. Steel flanges shall conform to AWWA C207, Class D. Class 300 steel flanges 48 inches and smaller shall conform to AWWA C207, Class F. Class 300 flanges larger than 48 inches shall conform to the dimensions of ASME B16.1 Class 250 flanges. Flanges shall be flat face. Flanges shall match the flange on the connecting pipe.
- E. See Section 400500 for flange bolts and gaskets.

2.2 CAST-IRON OR DUCTILE-IRON WALL PIPES AND SLEEVES

- A. Provide cast- or ductile-iron wall pipes with ends as shown in the drawings for connection to adjacent cast-iron and ductile-iron pipe or for containing pipes where they pass through concrete walls, ceilings, and floor slabs. Provide seepage ring on wall pipes and sleeves passing through concrete walls and slabs that are to be watertight. Locate collars such that the collar is at the center of the wall or floor slab, unless otherwise shown in the drawings.
- B. Wall pipes and sleeves shall be of the following types:
 - 1. Pipe or sleeve with integrally cast seep ring.

2. Pipe or sleeve with shrink-fit steel collar attached.
 3. Pipe or sleeve with steel collar halves bottomed in a groove provided in the pipe or sleeve.
 4. Pipe or sleeve with ductile iron collar welded continuously around pipe (360 degrees) on both sides of collar. Welding shall be done in pipe manufacturer's shop by a qualified welder.
- C. Minimum wall thickness for pipes and sleeves having integrally cast seep rings shall be as follows:
1. Pipe or Sleeve Size 3 inches: Minimum Wall Thickness 0.48 inches.
 2. Pipe or Sleeve Size 4 inches: Minimum Wall Thickness 0.52 inches.
 3. Pipe or Sleeve Size 6 inches: Minimum Wall Thickness 0.55 inches.
 4. Pipe or Sleeve Size 8 inches: Minimum Wall Thickness 0.60 inches.
 5. Pipe or Sleeve Size 10 inches: Minimum Wall Thickness 0.68 inches.
 6. Pipe or Sleeve Size 12 inches: Minimum Wall Thickness 0.75 inches.
 7. Pipe or Sleeve Size 14 inches: Minimum Wall Thickness 0.66 inches.
 8. Pipe or Sleeve Size 16 inches: Minimum Wall Thickness 0.70 inches.
 9. Pipe or Sleeve Size 18 inches: Minimum Wall Thickness 0.75 inches.
 10. Pipe or Sleeve Size 20 inches: Minimum Wall Thickness 0.80 inches.
 11. Pipe or Sleeve Size 24 inches: Minimum Wall Thickness 0.89 inches.
- D. Minimum wall thickness of pipes or sleeves having shrink-fit collars shall be special Class 52. Cut shrink-fit collars from a 1/4-inch-thick steel ring. Attach the collar to a cast-iron or ductile-iron pipe or sleeve by heating the steel collar and allowing it to shrink over the pipe at the necessary location. Provide an epoxy bond (Keysite 740 or 742 or Scotchkote 302) between the pipe and collar. Sandblast the area of the pipe to be epoxy coated per SSPC SP-10.
- E. Wall pipes or sleeves having steel collar halves bottomed in a groove shall be ductile iron Special Class 54 minimum unless otherwise shown. Wall flanges shall consist of 1/4-inch-thick steel seep ring halves for pipes through 24-inch and 3/8-inch-thick halves for pipe 30 inches and larger, bottomed in a groove provided on the pipe. The pipe groove shall be machine cut to a depth of 1/16 to 5/64 inch to provide a press fit for the seep ring. Seep ring halves shall be welded together after fit into groove but shall not be welded to pipe. Seep rings shall be sealed completely around the pipe with silicon sealant manufactured by Dow-Corning No. 790, General Electric Silpruf, or equal.
- F. The material used in cast- or ductile-iron wall flanges, wall sleeves, and wall penetrations shall conform to ASTM A395, A436, A536, A48 (Class 35), or A126 (Class B).
- G. Pressure test at least one of each size of cast-iron pipes or sleeves having shrink-fit steel collars or collar halves installed in a groove in the pipe at the place of fabrication to demonstrate watertightness of the seal between the collar and the sleeve. The test shall be at a pressure of 20 psig for four hours' duration and shall show zero leakage.

2.3 FABRICATED STEEL WALL PIPES AND SLEEVES

- A. Provide fabricated steel wall pipes and sleeves with ends as shown in the drawings for connection to adjacent steel pipes, or for containing pipes, where they pass through concrete walls. Provide seepage ring or wall flange on wall pipes and sleeves passing through concrete walls and slabs that are to be watertight. Wall thickness shall be the same as the pipe wall thickness when connecting to steel pipe. Minimum wall thickness for sleeves containing pipes shall be standard weight per ASME B36.10 for sleeves 72 inches and smaller and 1/2 inch for sleeves greater than 72 inches through 96 inches.
- B. Wall flanges shall be in the form of a steel wall collar welded to the steel sleeve or penetration. Cut welded wall collars from a 1/4-inch steel ring. Attach the collar to a steel wall pipe or sleeve with full circle, 3/16-inch fillet welds. Welding procedures shall be in accordance with ASME B31.3, Chapter V.
- C. Steel pipe used in fabricating wall sleeves containing pipes shall comply with ASTM A53 (Type E or S), Grade B; ASTM A135, Grade B; ASTM A139, Grade B; or API 5L or 5LX. Wall pipes connecting to steel pipe shall be of the same material as the connecting pipe. Wall collar material shall comply with ASTM A36, A105, A181, or A182.
- D. Stainless steel pipe used in fabricating wall pipes shall be of the same material as the connecting pipe. Wall collar material shall comply with ASTM A240.
- E. Pressure test at least one of each size of fabricated steel wall sleeve or penetration and collar assemblies at the place of fabrication to demonstrate watertightness of the seal between the collar and the sleeve. The test shall be at a pressure of 20 psig for four hours' duration and shall show zero leakage.

2.4 RUBBER ANNULAR HYDROSTATIC SEALING DEVICES

- A. Rubber annular hydrostatic sealing devices shall be of the modular mechanical type, utilizing

interlocking synthetic rubber links shaped to continuously fill the annular space between the pipe sleeve and the passing pipe. Assemble links to form a continuous rubber belt around the pipe, with a pressure plate under each bolthead and nut.

- B. Materials of construction shall be as follows:
 - 1. Pressure plate: Delrin plastic; carbon steel; Type 304 stainless steel; Type 316 stainless steel; or Reinforced nylon polymer.
 - 2. Bolts and nuts for links: Type 303 or 316 stainless steel; or Zinc phosphated carbon steel.
 - 3. Sealing element: EPDM or Nitrile rubber.
- C. The size of the wall sleeve needed to accommodate the passing pipe shall be as recommended by the rubber annular seal manufacturer.
- D. Provide centering blocks in 25 percent of the sealing elements on pipelines larger than 12 inches in diameter.
- E. The rubber annular hydrostatic sealing devices shall be Link Seal as manufactured by Thunderline Corporation; Innerlynx as manufactured by Advance Products & Systems, Inc.; or equal.

2.5 BOLTS, NUTS, AND GASKETS FOR FLANGED-END WALL PIPES

- A. See Section 400500.

2.6 POLYETHYLENE FOAM FILLER FOR PIPE PENETRATIONS

- A. Packing foam shall be an extruded closed-cell polyethylene foam rod, such as Minicel backer rod, manufactured by Industrial Systems Department, Plastic Products Group of Hercules, Inc., Middletown, Delaware; Ethafoam, as manufactured by Dow Chemical Company, Midland, Michigan; or equal. The rod shall be 1/2 inch larger in diameter than the annular space.

2.7 POLYURETHANE SEALANT FOR PIPE PENETRATIONS

- A. Sealant shall be multipart, polyurethane sealant, to cure at ambient temperature, for continuous immersion in water. Install as recommended by the manufacturer. Products: SIKA Sikaflex 2C or equal.

2.8 PAINTING AND COATING

- A. Line and coat sleeves and pipes except stainless steel with fusion-bonded epoxy per Section 099000 or Engineer approved fusion bonded epoxy coating system.
- B. Coat penetrations and sleeves exposed, above ground, or in vaults and structures in accordance with Section 099000 or Engineer approved fusion-bonded epoxy coating system.
- C. Coat submerged sleeves and penetrations per Section 099000, System No. 12 or Engineer approved fusion bonded epoxy coating system.
- D. Coat buried sleeves and penetrations per Section 099000, System No. 10 or Engineer approved fusion bonded epoxy coating system.
- E. Do not coat stainless steel sleeves and penetrations.

PART 3 EXECUTION

3.1 LOCATION OF PIPES AND SLEEVES

- A. Provide a wall or floor pipe where shown in the drawings and wherever piping passes through walls or floors of tanks or channels in which the water surface is above the pipe penetration.
- B. Provide a floor sleeve where shown in the drawings and wherever plastic pipe, steel, or stainless steel pipe 3 inches and smaller or stainless steel or copper tubing passes through a floor or slab. Provide a rubber annular sealing device in the annular space between the sleeve and the passing pipe or tubing.
- C. Provide wall sleeves where shown in the drawings and wherever plastic, steel or stainless steel pipe 3 inches and smaller, or stainless steel or copper tubing passes through a wall. Provide a single rubber annular seal when the wall is 8 inches thick or less. Provide two rubber annular seals (one at each end of the sleeve) when the wall is more than 8 inches thick. Pack the annular space with polyethylene foam filler and fill the ends of the penetration with 2 inches of elastomeric sealant on both sides of the structure.
- D. Where wall sleeves are installed in which water or soil is on one or both sides of the channel or wall, provide two rubber annular seals (one at each end of the sleeve).
- E. Where pipes pass through walls or slabs and no sleeves or wall or floor pipe with seep ring is provided, pack the annular space with polyethylene foam filler and fill the ends of the penetration with

2 inches of elastomeric sealant on both sides of the structure.

3.2 INSTALLATION IN EXISTING CONCRETE WALLS AND SLABS

- A. Core drill holes 1 to 2 inches larger in diameter than the outside diameter of the wall flange or collar. Install wall pipe and collar assembly axially aligned with the piping to which it will be connected or will contain. Pack the void space between the sleeve and concrete with polyethylene foam filler and fill the ends of the penetration with 2 inches of elastomeric sealant on both sides of the structure.

3.3 INSTALLATION IN NEW CONCRETE WALLS AND SLABS

- A. Install wall pipes and sleeves in walls before placing concrete. Do not allow any portion of the pipe or sleeve to touch any of the reinforcing steel. Install wall pipe or sleeve and collar assembly axially aligned with the piping to which it will be attached or will contain. Provide supports to prevent the pipe or sleeve from displacing or deforming while the concrete is being poured and is curing.

3.4 INSTALLATION IN DRY FLOORS AND SLABS

- A. Install pipe sleeves and spools in concrete floors and slabs which do not have water over them such that the sleeve or pipe extends from the bottom of the floor or slab to an elevation sufficient to make pipe and fitting connections; unless shown otherwise in the drawings.

3.5 INSTALLATION OF WALL PIPES HAVING FLANGED END CONNECTIONS

- A. Check alignment before grouting in place or pouring concrete. Realign if the sleeve is not properly aligned.
- B. Install flanged end wall sleeves or penetrations with bolt holes of the end flanges straddling the horizontal and vertical centerlines of the sleeve.

3.6 QUALIFICATIONS OF WELDERS

- A. Welder qualifications shall be in accordance with AWS D1.1.

3.7 INSTALLATION OF RUBBER ANNULAR HYDROSTATIC SEALING DEVICES

- A. Install in accordance with the manufacturer's instructions.

3.8 FIELD TESTING

- A. Check each wall penetration for leakage at the time the hydraulic structure is tested for leakage; see Section 033000. Penetrations shall show zero leakage.

END OF SECTION

SECTION 400764
PIPE HANGERS AND SUPPORTS

PART 1 GENERAL

1.1 DESCRIPTION

- A. This section includes materials and installation of pipe hangers and supports including accessory items, such as anchor bolts and screws; pipe spiders; neoprene isolation pads; cable trays for hoses; and drip guards.

1.2 RELATED WORK SPECIFIED ELSEWHERE

- A. Painting and Coating: 099000.
- B. Flexible Pipe Couplings and Expansion Joints: 400722.
- C. Wall Pipes, Seep Rings, and Penetrations: 400762.

1.3 SUBMITTALS

- A. Submit shop drawings in accordance with the Section 013300.
- B. Provide line drawings of each piping system to the scale shown in the drawings, locating each support or hanger. Identify each type of hanger or support by the manufacturer's catalog number or figure.
- C. Provide installation drawings and manufacturer's catalog information on each type of hanger and support used. Clearly indicate the actual pipe outside diameter (not just nominal pipe size) that is used for the hangers and supports.
- D. Submit layout drawings for the drip guards, showing dimensions and thicknesses. Show design of seam or joint where field connections will be made between sections and pieces of drip guards. Submit a certificate listing the type of resin to be used, describing the manufacturer's brand name or designation, composition, and characteristics.

1.4 WARRANTY

- A. Full warranty against defects in materials and workmanship for one year after FINAL ACCEPTANCE, including all parts, labor, and expenses.

PART 2 - PRODUCTS

2.1 DESIGN CRITERIA.

- A. Pipe supports, anchors, and expansion joints have been indicated on the Drawings in certain locations, but no attempt has been made to indicate every pipe support, anchor, and expansion joint. The Contractor shall design anchors, pipe supports, expansion joints, and flexible couplings not already shown on the Drawings, in accordance with the requirements specified herein. Additional pipe supports may be required adjacent to expansion joints, couplings, valves, meters, and equipment. Contractor shall not delete or relocate supports, expansion joints, or couplings shown in the Drawings without the Engineer's approval.
- B. Absence of pipe supports and details on the Drawings shall not relieve the Contractor of responsibility of providing them throughout the plant.
- C. The Contractor's design shall include pipe supports, bracing, and anchorage adjacent to expansion joints, couplings, valves, in-line devices, equipment, wyes and tees, or changes in direction as required for dismantling piping, removing valves or other in-line devices, disconnecting piping from equipment, and pipe support, in addition to supports in accordance with the maximum spacing specified herein.
- D. Pipe support and hanger components shall withstand hydrostatic loads, up-lift forces, dead loads imposed by the weight of the pipes, fittings, and valves (all filled with water), plus valve actuators and any insulation, and internal test pressures, and shall have a minimum safety factor of five based on material ultimate strength.
- E. All piping shall be rigidly supported so there is no visible movement or visible sagging between supports. The system shall comply with specified code requirements.
- F. Provide anchors to resist thrust due to temperature changes, changes in diameter or direction, or dead-ends. Anchors shall be located as specified to force expansion and contraction to occur at expansion joints, loops, or elbows, and as needed to prevent excessive bending stresses and opening of mechanical couplings. Anchorage for temperature changes shall be centered between elbows and mechanical joints used as expansion joints. Anchorage for bellow type expansion joints may be

located adjacent to the joint.

- G. When expansion joints are required, pipe guides shall be provided adjacent to bellows type expansion joints. Guides will not be required where mechanical couplings are permitted as expansion joints. Guides shall be located on both sides of expansion joints, except where anchors are adjacent to the joint. Unless otherwise indicated on the Drawings, one guide shall be within four pipe diameters from the joint and a second guide within 14 pipe diameters from the first joint. Pipe supports shall allow adequate movement; pipe guides shall not be used for support. Pipe guides shall be provided at locations as recommended by the manufacturer.
- H. Pipe supports for insulated cold piping systems shall be sized for the outside diameter of the insulated pipe, and an insulation protection shield shall be installed between the support and the insulation. Rigid insulation inserts shall be installed between the pipe and the insulation shields for piping larger than 2-inches or when needed to prevent crushing of the insulation. Inserts shall be of the same thickness as the adjacent insulation and shall be vapor sealed.
- I. When supports for the FRP piping systems are in contact with less than 180-degrees of the pipe surface or when the width of the support is less than one-third the nominal pipe diameter (4-inches minimum), and FRP saddle, shaped to the outside diameter of the pipe, shall be bonded to at least the bottom 120-degrees of the pipe.
- J. Supply design criteria to the precast concrete manufacturer for any piping supported from the precast members.
- K. Hanger and Support Systems.
 - 1. Pipe hangers and supports shall be as manufactured by Anvil, Unistrut, B-Line, Superstrut, or equal.
 - 2. Pipe hangers and supports shall comply with MSS SP-58 for the standard types referenced in the drawings. Construct special hangers and supports if detailed in the drawings. Type numbers for standard hangers and supports shall be in accordance with MSS SP-58 as listed below:
 - a. Type 1: Adjustable steel clevis.
 - 1) Manufacturer and Model: Anvil Fig. 590 or 260 or approved equal.
 - b. Type 3: Steel double-bolt pipe clamp.
 - 1) Manufacturer and Model: Anvil Fig. 295A or 295H or approved equal.
 - c. Type 4: Steel pipe clamp (pipes smaller than 3 inches).
 - 1) Manufacturer and Model: Anvil Fig. 212 or approved equal.
 - d. Type 4: Steel pipe clamp (pipes 3 inches and larger).
 - 1) Manufacturer and Model: Anvil Fig. 216 or approved equal.
 - e. Type 5: Pipe hanger support plate.
 - 1) Manufacturer and Model: Anvil Fig. 49 or approved equal.
 - f. Type 6: Adjustable swivel pipe ring.
 - 1) Manufacturer and Model: Anvil Superstrut 714, Anvil Fig. 104, or approved equal.
 - g. Type 7: Adjustable steel band hanger.
 - 1) Manufacturer and Model: Anvil Fig. 69 or approved equal.
 - h. Type 8: Trapeze Beam.
 - 1) Manufacturer and Model: Anvil Fig. 45 or approved equal.
 - i. Type 9: Adjustable band hanger.
 - 1) Manufacturer and Model: Anvil Fig. 97 or approved equal.
 - j. Type 10: Adjustable swivel ring band hanger.
 - 1) Manufacturer and Model: Anvil Fig. 70 or approved equal.
 - k. Type 11: Split pipe ring with adjustable turnbuckle.
 - 1) Manufacturer and Model: Anvil Fig. 108 or approved equal.
 - l. Type 13: Steel turnbuckle.
 - 1) Manufacturer and Model: Anvil Fig. 230 or approved equal.
 - m. Type 14: Steel clevis.
 - 1) Manufacturer and Model: Anvil Fig. 299 or approved equal.
 - n. Type 15: Swivel turnbuckle.
 - 1) Manufacturer and Model: Anvil Fig. 114 or approved equal.
 - o. Type 16: Malleable iron socket.
 - 1) Manufacturer and Model: Anvil Fig. 110R or approved equal.
 - p. Type 17: Steel weldless eye nut.
 - 1) Manufacturer and Model: Anvil Fig. 290 or approved equal.
 - q. Type 18: Steel or malleable iron concrete insert.

- 1) Manufacturer and Model: Anvil Fig. 281, Superstrut 452 or approved equal.
- r. Type 19: Top beam C-clamp.
 - 1) Manufacturer and Model: Anvil Fig. 92 or approved equal.
- s. Type 20: Side I-beam or channel clamp.
 - 1) Manufacturer and Model: Anvil Fig. 14 or 217 or approved equal.
- t. Type 21: Center I-beam clamp.
 - 1) Manufacturer and Model: Anvil Figure 134 or approved equal.
- u. Type 22: Welded attachment type.
 - 1) Manufacturer and Model: Anvil Fig. 66 or approved equal.
- v. Type 23: C-clamp.
 - 1) Manufacturer and Model: Anvil Fig. 86 or approved equal.
- w. Type 24: U-bolt.
 - 1) Manufacturer and Model: Anvil Fig. 137 or approved equal.
- x. Type 26: Clip.
 - 1) Manufacturer and Model: Anvil Fig. 262 or approved equal.
- y. Type 28: Steel I-beam clamp with eye nut.
 - 1) Manufacturer and Model: Anvil Fig. 228 or approved equal.
- z. Type 29: Steel wide flange.
 - 1) Manufacturer and Model: Anvil Fig. 228 clamp with eye nut aa.
- Type 30: Malleable iron beam clamp with extension piece.
 - 1) Manufacturer and Model: Superstrut CM-754 or approved equal. ab.
- Type 31: Light welded steel bracket.
 - 1) Manufacturer and Model: Anvil Fig. 194 or approved equal.
- ac. Type 32: Medium welded steel bracket.
 - 1) Manufacturer and Model: Anvil Fig. 195 or approved equal. ad.
- Type 33: Heavy welded steel bracket.
 - 1) Manufacturer and Model: Anvil Fig. 199 or approved equal. ae.
- Type 34: Side beam bracket.
 - 1) Manufacturer and Model: Anvil Fig. 202 or approved equal.
- af. Type 36: Pipe saddle support.
 - 1) Manufacturer and Model: Anvil Fig. 258 or approved equal. ag.
- Type 37: Pipe stanchion saddle.
 - 1) Manufacturer and Model: Anvil Fig. 259 or approved equal. ah.
- Type 38: Adjustable pipe saddle support.
 - 1) Manufacturer and Model: Anvil Fig. 265 or approved equal.
- ai. Type 39: Steel pipe covering.
 - 1) Manufacturer and Model: Anvil Fig. 160, 161, 162, 163, 164, or 165; Superstrut A 789; or approved equal.
- aj. Type 40: Insulation protection shield.
 - 1) Manufacturer and Model: Anvil Fig. 167 or approved equal. ak.
- Type 41: Single pipe roll.
 - 1) Manufacturer and Model: Anvil Fig. 171 or approved equal.
- al. Type 43: Adjustable roller hanger with swivel.
 - 1) Manufacturer and Model: Anvil Fig. 181 or approved equal. am.
- Type 44: Pipe roll, complete.
 - 1) Manufacturer and Model: Anvil Fig. 271 or approved equal. an.
- Type 45: Lateral Brace Clamp.
 - 1) Manufacturer and Model: Anvil Fig. 775 or approved equal.
- 3. Hangers, rods, clamps, protective shields, metal framing, support components, and hanger accessories shall be hot-dipped galvanized per ASTM A153; or plain carbon steel (ASTM A36, A575, or A576) unless noted otherwise.
- 4. Hangers, rods, clamps, protective shields, metal framing, support components, and hanger accessories in treatment process, pumping, and chemical storage/feed areas and rooms shall be stainless steel or FRP.
- 5. Submerged hangers, rods, clamps, protective shields, metal framing, support components, and hanger accessories in wet wells, tanks, channels or tank covers shall be Type 316 stainless steel.

- L. Offset Pipe Clamp.
1. Anvil Figure 103 or equal. Material shall be **carbon steel; Type 304 stainless steel; or Type 316 stainless steel.**
- M. Miscellaneous Pipe Supports and Hangers.
1. Pipe Anchor Chair: Anvil Figure 198 or equal.
 2. One Hole Clamp: Anvil Figure 126 or equal.
 3. Roller Chair: Anvil Figure 175 or equal.
- N. Steel Channel Framing System.
1. Steel channel frames shall be 1-5/8 inches wide by 1-5/8 or 3-1/4 inches high by 12-gauge metal thickness, unless otherwise shown in the drawings. Material shall conform to ASTM A36, A570 (Grade 33 minimum), or A653 unless stainless steel is indicated in the drawings. Stainless steel shall be Type 304. One side of the channel shall have a continuous open slot with inturned clamping ridges. Maximum allowable stress under any combination of applied uniformly distributed loads and concentrated loads shall not exceed those recommended in the AISC or AISI. Deflection shall not exceed 1/240 of span. Use multiple back-to-back channels to achieve these criteria if single channels are not sufficient. Products: Unistrut P1000 or P5000 Series, B-Line B11 or B22 Series, or equal.
 2. Steel channels shall be hot-dipped galvanized per ASTM A153; plain; coated with 20 mils of white PVC per ASTM D1784; or coated with Engineer approved fusion-bonded epoxy system.
 3. Nuts shall be machined and case hardened. Provide rectangular nuts with the ends shaped to permit a quarter turn crosswise in the framing channel. Provide two serrated grooves in the nut to engage the inturned edges of the channel.
 4. Pipe clamps (including attachment screws and nuts) shall be Unistrut P1100 or P2000 Series, B-Line B2000 Series, or equal. Material shall be Type 304 stainless steel.
 5. Hanger rods for trapezes shall be hot dipped galvanized carbon steel (ASTM A36, A575, or A576) unless stainless steel is indicated in the drawings. Stainless steel hanger rod material shall comply with ASTM A276, Type 304.
 6. Accessory fittings and brackets shall be the same material as the channel or trapeze. Provide coating on carbon steel fittings and brackets as specified for the channels and frames.
 - a. Flat Plate Fittings: Unistrut P1065, P1066, P1925; Superstrut AB-206, AB-207; or equal.
 - b. Post Bases: Unistrut P2072A, Superstrut AP-232, or equal.
 - c. 90-Degree Brackets: Unistrut P1326, P1346; Superstrut AB-203; or equal.
 - d. Rounded-End Flat Plate Fittings: Unistrut P2325, Superstrut X-240, or equal.
 7. Parallel pipe clamps shall be Unistrut P1563 through P1573, Superstrut AB-719, or equal. Material shall be hot-dipped galvanized carbon steel, coated as specified for channels and frames unless stainless steel is indicated in the drawings. Stainless steel clamp material shall comply with ASTM A276, Type 304.
- O. FRP Channel Framing System.
1. FRP pipe hangers and supports shall be Aickinstrut, Inc., or equal.
 2. Material properties shall be as follows:
 - a. Longitudinal Direction:
 - 1) Ultimate Tensile (psi): 35,000 minimum.
 - 2) Ultimate Compressive (psi): 35,000 minimum.
 - 3) Ultimate Flexural (psi): 35,000 minimum.
 - 4) Tensile Modulus (psi): 3.0×10^6 minimum.
 - 5) Flexural Modulus (psi): 2.0×10^6 minimum.
 - 6) Ultimate Shear Strength (psi): 6,000 minimum.
 - 7) Izod Impact (ASTM D256) Ft-lb/inch notch: 30 minimum.
 - b. Transverse Direction:
 - 1) Ultimate Tensile (psi): 10,000 minimum.
 - 2) Ultimate Compressive (psi): 20,000 minimum.
 - 3) Ultimate Flexural (psi): 14,000 minimum.
 - 4) Tensile Modulus (psi): 1.0×10^6 minimum.
 - 5) Compressive Modulus (psi): 1.4×10^6 minimum.
 - 6) Flexural Modulus (psi): 1.0×10^6 minimum.
 - 7) Ultimate Shear Strength (psi): 5,500 minimum.
 - 8) Ultimate Bearing Stress (psi): 35,000 minimum.
 - 9) Izod Impact (ASTM D256) Ft-lb notch: 5 minimum.

- c. Hardness:
 - 1) Barcol Test: 50 minimum.
- 3. Glass fiber reinforced composites and plastic products shall have a flame spread rating of 25 or less when tested per ASTM E84.
- 4. Channel framing shall be 1-5/8 inches deep by 1-5/8 inches wide and shall be made using vinylester resin equal to Derakane 411, Ashland Hetron 922, or Reichhold Dion 9800. It shall have a nexus polyester surfacing veil over 100% of the surface which, along with a filler system, will protect against degradation from ultraviolet light. Channel shall be supplied with integral notches 1 inch on center. Notches shall be located on the interior flange to prevent slippage of pipe clamps and fittings after installation. In place of notched channel, unnotched channel may be used if the vertical channel sections supporting the horizontal piping are provided with stop lock hardware at each pipe clamp to prevent slippage. Channel framing shall be Aickinstrut G.R.P. Type V 200 series or equal.
- 5. Channel framing connections shall be made with vinylester glass fiber composite nuts, bolts, all threaded rods, channel fittings, bases, and hanger assemblies. Nuts, bolts, and rods shall be Aickinstrut 4200 series, Strut Tech PVCG, or equal. Channel fittings shall be Aickinstrut 2800 style or equal.
- 6. Load-bearing pipe clamps and nonload-bearing pipe straps shall be nonmetallic and nonconductive and shall be made by the injection molding process using polyurethane base resin. Pipe clamps and straps shall be Aickinstrut 3100 series or equal.
- 7. Clevis hangers shall be made with vinylester glass fiber and be Aickinstrut 1500 series or equal.
- 8. Hanger rods for trapezes shall be hot dipped galvanized carbon steel (ASTM A36, A575, or A576) unless stainless steel is indicated in the drawings. Stainless steel hanger rod material shall comply with ASTM A276, Type 304.
- P. Pipe Spiders.
 - 1. Superstrut S-794 or equal.
- Q. Waffle Isolation Pads.
 - 1. Mason Type "W"; Machinery Installation Systems "Unisorb" Type S, SB, F, or FB; or equal. Provide minimum 1/4-inch thickness.
- R. Neoprene Isolating Sleeves for Metal Pipe 6 Inches and Smaller.
 - 1. Unistrut P2600, B-Line "Vibrocushion," or equal.
- S. Cable Trays for Support of Chemical Hoses.
 - 1. Provide PVC-coated aluminum, 3-inch loading depth ladder-type cable trays with 6-inch rung spacing. Width shall be 12 inches unless otherwise shown in the drawings. Cable tray shall have a capacity of 56 pounds per foot at 12-foot spacing with a 1.73-inch-capacity deflection. Side members shall have outward flanges. Design loading with a safety factor of 1.5 per NEMA VE-1. Conform to NEMA Class 12A.
 - 2. Cable tray shall be P-W Western, Inc., No. 06-4D03-0012-12; T. J. Cope, Inc., No. 3338-12-SL-12-06; or equal.
 - 3. Provide aluminum support brackets, hold-down clamps (P-W Western, Inc., No. 9988-1B23-01; T. J. Cope, Inc., No. 9018; or equal), and cable clamps (P-W Western, Inc., No. 9996-1911-21; T. J. Cope, Inc., No. SCC-400; or equal) for support of cable trays.
- T. Drip Guards.
 - 1. Drip guards shall be minimum 1/4 inch thick, PVC or FRP. Color shall be white.
 - 2. PVC shall conform to ASTM D1784, Cell Classification 12454-B and ASTM D1927, Type I.
 - 3. Seams or joints between sections and pieces shall be leak free. Design joints so that liquid can flow across the joint and not form ponds.
 - 4. FRP drip guards shall include a corrosion-resistant layer on the side of the drip guard exposed to piping. The exposed corrosion-resistant layer shall be resin rich, shall consist of Type C glass monofilament surfacing mat or Nexus organic fiber, and shall be a minimum of 20 mils thick. Glass content in the corrosion-resistant layer shall not exceed 23% by weight. The structural layer shall be composed of chopped strand mat having a minimum glass content of 30% by weight. The overall glass content of the finished laminate shall be at least 30% by weight. Provide resin throughout the laminate. Determine glass content per ASTM D2584. Resin shall be Derakane 411, Reichhold Dion 9800, Ashland Hetron 922, or equal. Construction shall comply with ASTM D2563, Level II. Hardness shall be at least 90% of the resin manufacturer's recommended Barcol hardness, with a minimum Barcol hardness of 30, with the resin fully cured. Maximum strain in the laminate shall be 0.001 inch/inch. Maximum

- air bubble size in the laminate shall be 1/16 inch. Maximum frequency of air bubbles shall be 10 per square inch of laminate. Construction shall comply with NBS Voluntary Product Standard PS 15-69.
5. Provide nylon washers (minimum 1/8 inch thick) on both sides of holes where pipe hangers penetrate the drip guard. Provide Type 316 stainless steel nuts to connect the drip guards to pipe hangers and supports.

U. Anchor Bolts, Screws, and inserts.

1. Anchor bolts and screws for attaching pipe supports and hangers to walls, floors, ceilings, and roof beams shall be hot-dipped galvanized steel, ASTM A307 or Type 316 stainless steel, ASTM A276 or F593. Nuts shall be galvanized steel, ASTM A563 or Type 316 stainless steel, ASTM A194, Grade 8M or ASTM F594, Type 316 stainless steel.
2. Concrete inserts or anchor bolts shall be used to support piping from new cast-in-place concrete. Adhesive anchors shall be used to fasten supports to existing concrete and masonry.
3. Inserts:
 - a. Reference building structural concrete drawings for concrete inserts. When not provided as part of the building concrete structure, provide inserts for suspending hangers from reinforced concrete slabs and side of reinforced concrete beams. It shall be the Contractor's responsibility to accurately locate and attach inserts to concrete forms.
 - b. Where inserts are omitted, drill through concrete slab from below and provide thru-bolt with recessed square steel plate and nut recessed into and grouted flush with slab. X-ray locate existing reinforcement before drilling.

PART 3 - EXECUTION

3.1 PIPE HANGER AND WALL SUPPORT SPACING

- A. Install pipe hangers and wall supports on horizontal and vertical runs at the spacing shown or detailed in the drawings. Provide hanger rods (for horizontal runs) and wall supports of the sizes shown or detailed in the drawings. If no spacing or rod sizes are given in the drawings or in the specifications for a particular piping system, use the following:
- B. Pipe Hanger and Wall Support Spacing for Steel and Ductile-Iron Pipe:
 1. Pipe Size (inches): 3/8 and smaller.
 - a. Support/Hanger Max Spacing (feet): 4
 - b. Minimum Rod Size (inches): 3/8
 - c. Pipe Size (inches): 1/2 through 1.
 - 1) Support/Hanger Max Spacing (feet): 6
 - 2) Minimum Rod Size (inches): 3/8
 - d. Pipe Size (inches): 1-1/4 through 2.
 - 1) Support/Hanger Max Spacing (feet): 8
 - 2) Minimum Rod Size (inches): 3/8
 - e. Pipe Size (inches): 2-1/2 and 3.
 - 1) Support/Hanger Max Spacing (feet): 10.
 - 2) Minimum Rod Size (inches): 1/2
 - f. Pipe Size (inches): 3-1/2 and 4.
 - 1) Support/Hanger Max Spacing (feet): 10
 - 2) Minimum Rod Size (inches): 5/8
 - g. Pipe Size (inches): 6.
 - 1) Support/Hanger Max Spacing (feet): 12
 - 2) Minimum Rod Size (inches): 3/4
 - h. Pipe Size (inches): 8.
 - 1) Support/Hanger Max Spacing (feet): 12
 - 2) Minimum Rod Size (inches): 7/8
 - i. Pipe Size (inches): 10 and 12.
 - 1) Support/Hanger Max Spacing (feet): 14
 - 2) Minimum Rod Size (inches): 7/8
 - j. Pipe Size (inches): 14 and 16.
 - 1) Support/Hanger Max Spacing (feet): 16
 - 2) Minimum Rod Size (inches): 1
 - k. Pipe Size (inches): 18.
 - 1) Support/Hanger Max Spacing (feet): 15

- 2) Minimum Rod Size (inches): 1
- l. Pipe Size (inches): 20 through 24.
 - 1) Support/Hanger Max Spacing (feet): 9
 - 2) Minimum Rod Size (inches): 1-1/4
- m. Pipe Size (inches): 30.
 - 1) Support/Hanger Max Spacing (feet): 7
 - 2) Minimum Rod Size (inches): 1-1/4
- 2. Pipe Hanger or Wall Support Spacing for PVC and CPVC Pipe:
 - a. Pipe Size (inches): 3/4.
 - 1) Support/Hanger Max Spacing (feet): 4
 - 2) Minimum Rod Size (inches): 3/8
 - b. Pipe Size (inches): 1.
 - 1) Support/Hanger Max Spacing (feet): 4
 - 2) Minimum Rod Size (inches): 3/8
 - c. Pipe Size (inches): 1-1/4.
 - 1) Support/Hanger Max Spacing (feet): 4-1/2
 - 2) Minimum Rod Size (inches): 3/8
 - d. Pipe Size (inches): 1-1/2.
 - 1) Support/Hanger Max Spacing (feet): 5
 - 2) Minimum Rod Size (inches): 3/8
 - e. Pipe Size (inches): 2.
 - 1) Support/Hanger Max Spacing (feet): 5
 - 2) Minimum Rod Size (inches): 3/8
 - f. Pipe Size (inches): 2-1/2.
 - 1) Support/Hanger Max Spacing (feet): 5
 - 2) Minimum Rod Size (inches): 1/2
 - g. Pipe Size (inches): 3.
 - 1) Support/Hanger Max Spacing (feet): 6
 - 2) Minimum Rod Size (inches): 1/2
 - h. Pipe Size (inches): 4.
 - 1) Support/Hanger Max Spacing (feet): 6
 - 2) Minimum Rod Size (inches): 5/8
 - i. Pipe Size (inches): 6.
 - 1) Support/Hanger Max Spacing (feet): 7
 - 2) Minimum Rod Size (inches): 3/4
 - j. Pipe Size (inches): 8.
 - 1) Support/Hanger Max Spacing (feet): 7
 - 2) Minimum Rod Size (inches): 7/8
 - k. Pipe Size (inches): 10.
 - 1) Support/Hanger Max Spacing (feet): 8
 - 2) Minimum Rod Size (inches): 7/8
 - l. Pipe Size (inches): 12.
 - 1) Support/Hanger Max Spacing (feet): 8
 - 2) Minimum Rod Size (inches): 7/8
- 3. Pipe Hanger or Wall Support Spacing for Copper Tubing and Pipe:
 - a. Pipe Size (inches): 1 and smaller.
 - 1) Support/Hanger Max Spacing (feet): 4
 - 2) Minimum Rod Size (inches): 3/8
 - b. Pipe Size (inches): 1-1/4 through 2.
 - 1) Support/Hanger Max Spacing (feet): 6
 - 2) Minimum Rod Size (inches): 3/8
 - c. Pipe Size (inches): 2-1/2 through 3.
 - 1) Support/Hanger Max Spacing (feet): 8
 - 2) Minimum Rod Size (inches): 1/2
- 4. For piping services not described, provide hangers and supports per MSS SP-58 and SP-69.
- 5. Provide bracing for piping 8 inches and smaller that is installed on hangers or trapezes per MSS SP-127, except provide lateral bracing at maximum 10-foot center-to-center spacings. Provide sway bracing for hangers for piping larger than 8 inches as detailed in the drawings.

- C. Pipe Support Spacing for Supports on Top of Slabs or Grade
1. Install pipe supports on horizontal runs at the spacing shown or detailed in the drawings. Provide supports of the type shown or detailed in the drawings. If no spacings are given in the drawings or in the specifications for a particular piping system, use the following:
 2. Pipe Support Spacing for Steel and Ductile-Iron Pipe:
 - a. Pipe Size (inches): 3/8 and smaller.
 - 1) Support/Hanger Max Spacing (feet): 4.
 - b. Pipe Size (inches): 1/2 through 1.
 - 1) Support/Hanger Max Spacing (feet): 6.
 - c. Pipe Size (inches): 1-1/4 through 2.
 - 1) Support/Hanger Max Spacing (feet): 8.
 - d. Pipe Size (inches): 2-1/2 and 3.
 - 1) Support/Hanger Max Spacing (feet): 10.
 - e. Pipe Size (inches): 3-1/2 and 4.
 - 1) Support/Hanger Max Spacing (feet): 10.
 - f. Pipe Size (inches): 6.
 - 1) Support/Hanger Max Spacing (feet): 12.
 - g. Pipe Size (inches): 8.
 - 1) Support/Hanger Max Spacing (feet): 12.
 - h. Pipe Size (inches): 10 and 12.
 - 1) Support/Hanger Max Spacing (feet): 14.
 - i. Pipe Size (inches): 14 and 16.
 - 1) Support/Hanger Max Spacing (feet): 16.
 - j. Pipe Size (inches): 18.
 - 1) Support/Hanger Max Spacing (feet): 16.
 - k. Pipe Size (inches): 20 through 24.
 - 1) Support/Hanger Max Spacing (feet): 18.
 - l. Pipe Size (inches): 30.
 - 1) Support/Hanger Max Spacing (feet): 18.
 - m. Pipe Size (inches): 36.
 - 1) Support/Hanger Max Spacing (feet): 12.
 3. Pipe support spacing for other pipe materials shall be the same as described above in paragraph entitled "Pipe Hanger and Wall Support Spacing."
- D. Installing Pipe Hangers and Supports
1. Pipe hangers, brackets, and supports shall be furnished complete with all necessary inserts, anchor bolts, bolts, nuts, washers, and other accessories.
 2. All piping shall be supported in a manner which will prevent undue stress on any valve, meter, fitting, or piece of equipment. In addition, pipe supports shall be provided at changes in direction or elevation, adjacent to flexible couplings, and where otherwise shown in the Drawings. Pipe supports and hangers shall not be installed in equipment access areas.
 3. Provide separate hangers or supports at each valve. Provide one hanger or support around each end of the valve body or on the adjacent connecting pipe within one pipe diameter of the valve end. Provide additional hangers or supports to relieve eccentric loadings imposed by offset valve actuators.
 4. Provide separate hangers or supports at each pipe elbow, tee, or fitting. Provide separate hangers or supports on both sides of each non-rigid joint or flexible pipe coupling.
 5. Where horizontal piping is arranged with two or more parallel pipe runs, trapeze hangers may be used in lieu of individual hangers. Trapeze assembly shall consist of structure attachments as previously specified with rod size dependent upon total weight supported. Spacing of assemblies shall be determined by the minimum pipe size included in the group supported. Trapeze horizontal assemblies shall be structural angle or channel section of sufficient size to prevent measurable sag between rods. All pipe runs shall be attached to the horizontal with intermediate pipe guides and U-bolts or one-hole clamps. Pre-engineered support equipment may be used when selected and installed in accordance with the manufacturer's recommendations.
 6. Adjust pipe hangers per MSS SP-89, paragraph 10.6.
 7. Install leveling bolts beneath support baseplates. Provide 3/4 to 1-inch thick non-shrink, non-staining grout pad beneath each base.
 8. Install piping without springing, forcing, or stressing the pipe or any connecting valves, pumps, and other equipment to which the pipe is connected.

9. Do not support piping from other piping.
- E. Installing Steel and FRP Channel Frames
1. Use 1-5/8-inch-high channel frames unless 3-1/4-inch is needed to provide clearance from walls. Use multiple back-to-back channels if additional clearance is needed.
 2. Seal the ends of cut FRP channel frames with the channel manufacturer's sealant or resin.
- F. Installing Neoprene Isolating Pads or Sleeves
1. Install a sleeve around each metal pipe 6 inches and smaller at the point of bearing or contact with the pipe hanger or support.
 2. Install isolating pad between each metal pipe larger than 6" at the point of bearing or contact with the pipe hanger or support.
- G. Installing Cable Trays for Chemical Hoses
1. Provide cable tray supports at 8-foot centers, maximum. Locate a support within 2 feet of each fitting extremity. Provide one support under each of the three side rails for horizontal tees. Allow for thermal expansion based on 50 degrees F temperature variation.
 2. Attach chemical hoses to rungs of cable tray at 6-foot intervals using cable clamps.
- H. Painting and Coating
1. Grind welds of fabricated steel pipe supports smooth, prepare surface by sandblasting, and apply coating system.
 2. Exposed pipe hangers and supports are to be provide with hot dip galvanized coating. For areas where the pipe supports are cut, welded, or any other case where the integrity of the galvanized coating is affected due to erection on site, touch up and repair the affected area per Section 099000.
 3. Paint exposed pipe hangers and supports to match the color of the adjacent wall using System per Section 099000. If the adjacent wall is not painted, paint the hangers and supports to match color code of the largest pipe on the support.
 4. Submerged pipe hangers are to be provided as 316 Stainless Steel. No coating required.
 5. Coat submerged pipe hangers and supports per Section 099000.
 6. If the ferrous metal pipe hangers and supports are not galvanized or Stainless Steel, the pipe supports shall be coated per Section 099000.

END OF SECTION

THIS PAGE INTENTIONALLY LEFT BLANK.

SECTION 402040 DUCTILE-IRON PROCESS PIPE

PART 1 GENERAL

1.1 DESCRIPTION

- A. This section describes materials, testing, and installation of ductile-iron process pipe and fittings **12-** inches and smaller.

1.2 RELATED WORK SPECIFIED ELSEWHERE

- A. Painting and Coating: 099000.
- B. Trenching and Backfilling: 312333.
- C. General Piping Requirements: 400500.
- D. Pressure Testing of Piping: 400515.
- E. Wall Pipes, Seep Rings, and Penetrations: 400762.

1.3 SUBMITTALS

- A. Submit shop drawings in accordance with the General Conditions and Section 013300.
- B. Provide an affidavit of compliance with standards referenced in this specification, e.g., AWWA C151. Submit copy of report of pressure tests for qualifying the designs of all sizes and types of AWWA C153 fittings that are being used in the project. The pressure test shall demonstrate that the minimum safety factor described in AWWA C153, Section 5.5 is met.
- C. Submit piping layout profile drawings showing location and dimensions of pipe and fittings; submit after equipment and valve submittals have been reviewed and marked "Resubmittal not required." Include laying lengths of valves, meters, in-line pumps, and other equipment determining piping dimensions. Label or number each fitting or piece of pipe. Piping having identical design pressure class, laying lengths, and bell-and-spigot dimensions that is to be placed in long straight reaches of alignment may have the same identifying label or number.
- D. Provide the following information:
 - 1. Mortar lining thickness.
 - 2. Wall thickness.
 - 3. Outside coating.
 - 4. Material test data for this project.
 - 5. Show deflections at push-on and mechanical joints.
 - 6. Submit joint and fitting details and manufacturer's data sheets.
- E. Submit calculations and test data proving that the proposed restrained joint arrangement can transmit the required forces with a minimum safety factor of 1.5.
- F. Submit certificate that cement for mortar lining complies with ASTM C150, designating type.
- G. Submit test report on physical properties of rubber compound used in the gaskets.
- H. Submit drawing or manufacturer's data sheet showing flange facing, including design of facing serrations.
- I. Submit weld procedure specification, procedure qualification record, and welder's qualifications prior to any welding to ductile-iron pipe.

1.4 WARRANTY

- A. Full warranty against defects in materials and workmanship for one year following FINAL ACCEPTANCE; including all parts, labor, and expenses.

PART 2 PRODUCTS

2.1 PIPE

- A. Pipe shall be cast ductile iron, conforming to AWWA C151.
- B. All pipe shall be manufactured in the United States. The Material Supplier and/or Contractor shall furnish data certified by the Manufacturer that all pipe is of domestic manufacture.

2.2 PIPE MARKING

- A. Plainly mark each length of straight pipe and each fitting at the bell end to identify the design pressure class, the ductile-iron wall thickness, the date of manufacture, and the proper location of the pipe item by reference to the layout schedule. Mark the spigot end of restrained joint pipe to show clearly the

required depth of insertion into the bell.

2.3 PIPE WALL THICKNESS

- A. Minimum wall thicknesses for pipe having grooved-end joints shall be as follows:
 - 1. Pipe Size 4 to 16-Inch: Thickness Class 53
 - 2. Pipe Size 18-Inch: Thickness Class 54
 - 3. Pipe Size 20-Inch: Thickness Class 55
 - 4. Pipe Size 24 to 36-Inch: Thickness Class 56
 - 5. Pipe Size 42-Inch and Larger: Thickness Class 53.
- B. Minimum wall thickness for pipe having push-on or mechanical joints, restrained joints, plain ends, or cast flange ends shall be Thickness Class 50, unless otherwise shown in the drawings.
- C. Minimum wall thickness for pipe having threaded flanges shall be Special Class 53 or Pressure Class 350.
- D. Minimum pipe wall thickness required for corporation stops and tapped outlets shall be in accordance with Table A.1 of AWWA C151 for three full threads for design pressures up to 250 psi and four full threads for design pressures over 250 to 350 psi. Provide threaded weld-on boss for tapped outlets where indicated in the drawings.

2.4 FITTINGS

- A. Fittings 48 inches and smaller shall conform to AWWA C110 with a minimum pressure rating of 250 psi. Flanges shall be flat faced.
- B. Mechanical joint fittings conforming to AWWA C153 may be used in lieu of AWWA C110 fittings. Mechanical joint ductile-iron fittings 18 through 48 inches conforming to AWWA C110 (except for laying length) with a minimum pressure rating of 250 psi may also be used.
- C. Grooved-end fittings shall conform to AWWA C110 with grooved ends conforming to AWWA C606, radius cut rigid joints. Fitting material shall conform to ASTM A48, Class 30; ASTM A126, Class B; or ASTM A536, Grade 65-42-10. Wall thickness of ductile-iron (ASTM A536) fittings shall conform to AWWA C110 or C153; wall thickness of cast-iron fittings shall conform to AWWA C110. Fittings and couplings shall be furnished by the same manufacturer.
- D. Material for fittings with welded-on bosses shall have a Charpy notch impact value of minimum 10 ft-lbs under the conditions defined in AWWA C151. Test completed welds by the liquid penetrant method per ASTM E165.

2.5 FLANGES

- A. Flanges shall be solid back, Class 125 per AWWA C115, or Class 250, flat faced per ASME B16.1 with serrated facings. Flanges on pipe shall be either cast or threaded. Material shall be ductile iron.
- B. Flanged pipe and fittings shall be shop fabricated, not field fabricated. Assembly of flange on pipe outside of manufacturer's shop is unacceptable. Threaded flanges shall comply with AWWA C115. Flanges shall be individually fitted and machine tightened in the shop, then machined flat and perpendicular to the pipe barrel. Flanges shall be back-faced parallel to the face of flange. Prior to assembly of the flange onto the pipe, apply a thread compound to the threads to provide a leak-free connection. There shall be zero leakage through the threads at a hydrostatic test pressure of 250 psi without the use of the gasket.
- C. Flanged pipe for gas service shall be in accordance with AWWA C115 and ANSI A21.52. In addition to pipe marking specified in AWWA C115 and ANSI A21.52, conspicuously stamp each flanged pipe with words "AIR TESTED".
- D. Material for blind flanges shall be ductile iron or as indicated on the Drawings.

2.6 PIPE LINING

- A. Line pipe interior ***and fittings with cement mortar*** per AWWA C104/A21.4. except as otherwise described herein or as otherwise shown. Lining thickness shall be the double thickness listed in AWWA C104, Section 4.7. Cement for lining material shall conform to ASTM C150, Type ***II***.
- B. Line fittings per Section 099000.
- C. The inside coating of ductile iron pipe and fittings shall be Protecto 401 ceramic epoxy lining to a minimum thickness of 40 mils in raw sewage, primary effluent, primary sludge, anaerobically digested sludge, and other corrosive environments. The epoxy coating shall be installed and tested in strict accordance with AWWA C 116/ANSI A21.16 and as supplemented in these specifications.

- D. Where specifically called for in these specifications or shown on the drawings, the inside coating of ductile iron pipe and fittings shall be VITCO SG-14 glass lining (porcelain enamel) to a minimum thickness of 10 mils.
 - 1. The glass lining applied to pipe and fittings shall be hard, smooth, continuous vitreous material which is formulated to prevent the adherence of grease in sludge and scum lines, and to resist the adherence of crystalline metal salt deposits (Struvite and Vivionite) to sludge and centrate lines.
 - 2. The glass portion of the lining, the frit(s) used in the formulation, as supplied from the manufacturer, shall have a density of 2.5 to 3.0 grams per cubic centimeter as measured by ASTM D-792.
 - 3. The finished lining shall be able to withstand a strain of 0.001 inch/inch of the base metal without visible damage to the glass and it shall have a minimum hardness of 5 on the Moh's hardness scale.
 - 4. The lining shall be capable of withstanding an instantaneous thermal shock from ambient + 350oF to ambient without visible crazing, blistering or spalling.
 - 5. The lining shall be resistant to corrosion by an HCl solution adjusted to a pH of 3 at 125 degrees F and a NaOH solution adjusted to a pH of 10 at 125 degrees F. Demonstration of this shall be by a weight loss of not more than 3 milligrams per square inch when exposed for 30 minutes.
 - 6. There shall be negligible visible loss of surface gloss to the lining after immersing a cut production sample in an 8 percent by weight sulfuric acid solution at 148 degrees F for a period of 10 minutes.
 - 7. The lining shall be of a light, bright color to allow visual detection of defects more easily.
- E. Line blind flanges per Section 099000.
- F. Pipe and fittings for process air service shall be unlined (and supplied with EPDM gaskets).
- G. Cement-mortar for pointing interior joints shall consist of one part cement to one and one-half parts of washed plaster sand conforming to ASTM C35, mixed with the minimum amount of water which will permit placing the mortar.
- H. Maintain a moist environment inside the lined pipe and fittings by sealing the ends with polyethylene sheet.
- I. Loose areas of cement-mortar lining are not acceptable. Remove and reconstruct lining in areas where quality is defective, such as sand pockets, voids over sanded areas, blisters, drummy areas, cracked areas, and thin spots. Longitudinal cracks in excess of 1/32 inch in width or where crack extends to metal shall be repaired with epoxy. Repair all cracks larger than 1/16 inch with epoxy.

2.7 GROOVED-END COUPLINGS

- A. Grooved-end pipe couplings shall be ductile iron, ASTM A536 (Grade 65-45-12). Gaskets shall be halogenated butyl rubber or EPDM or Buna-N and shall conform to ASTM D2000.
- B. Bolts in exposed service shall conform to ASTM A183, 110,000-psi tensile strength or ASTM A193, Grade B8, Class 2. Bolts in buried or submerged service shall be ASTM A193, Grade B8, Class 2.
- C. Couplings for pipe 24 inches and smaller shall conform to AWWA C606 for flexible radius ductile-iron pipe, except where rigid radius couplings are required to connect to fittings. Couplings for pipe sizes 30 and 36 inches shall be in accordance with the coupling manufacturer's published literature for tolerances and dimensions for flexible and rigid radius cut joints. Couplings shall be Victaulic Style 31, Gustin-Bacon No. 500, or equal.
- D. Grooved-end adapter flanges for piping 24 inches and smaller having an operating pressure of 150 psi and less shall be Victaulic Style 341 or 342 or equal. Flange dimensions shall conform to ASME B16.1, Class 125.
- E. Grooved-end transition couplings for connecting ductile-iron pipe 12 inches and smaller to steel pipe shall be Victaulic Style 307 or equal.

2.8 GASKETS FOR FLANGES

- A. See Section 400500.

2.9 GASKETS FOR MECHANICAL, PUSH-ON, AND RESTRAINED JOINTS

- A. Synthetic or natural rubber in accordance with AWWA C111.
- B. Gasket materials shall be selected by pipe manufacturer and shall be suitable for service and maximum operating temperature of piping system.

2.10 BOLTS AND NUTS FOR FLANGES

- A. See Section 400500.

2.11 BOLTS AND NUTS FOR MECHANICAL AND RESTRAINED JOINTS

- A. Bolts, nuts and washers for mechanical and restrained joints shall conform to ANSI/AWWA Standard C111/A21.11 and shall be cadmium plated meeting SAE AMS-QQ-P-416, Type 1, Class 2 (Cor-Ten, Cor-Blue, or approved equal) or Type 304 or 316 stainless steel tee head bolts and hex nuts with Teflon coated nuts.

2.12 OUTLETS AND NOZZLES

- A. Provide outlets 2-inches and using a tapping saddle, using a threaded weld-on boss; or as indicated in the Drawings.
- B. For outlets larger than 2 inches use a tee with a flanged outlet.
- C. For outlets larger than 2 inches in buried piping, use a tee with a restrained joint outlet.

2.13 JOINTS

- A. Joints in aboveground or submerged piping or piping located in vaults and structures shall be grooved end or flanged.
- B. Joints in buried piping shall be of the restrained; push-on; or mechanical-joint type per AWWA C111 except where flanged joints are required to connect to valves, meters, and other equipment. Provide unrestrained buried joints except where restrained joints are specifically shown in the drawings.
- C. Restrained joints for piping 6 inches and larger shall be American Cast Iron Pipe "Lok-Ring" or "Flex-Ring," U.S. Pipe "TR-Flex," or equal. Weldments for restrained joints shall be tested by the liquid penetrant method per ASTM E165. Restrained joints for field closures shall be "Megalug" by EBAA Iron.
- D. Restrained joints in 4-inch-diameter buried piping shall be American Cast Iron Pipe Company "Fast-Grip," U.S. Pipe Field-lok gasket within Tyton joint pipe and fittings, or equal. Joint restraint shall be certified to four times rated pressure of 200 psi by Factory Mutual.
- E. Where thrust restraint is called for in the drawings, provide pipe with restrained joints capable of transmitting 1.5 times the thrust, as calculated by the following equation:

2.14 MECHANICAL JOINT RESTRAINT SYSTEM USING FOLLOWER RING AND WEDGES

- A. The restraining mechanism shall consist of a follower gland having a seal gasket and individually actuated wedges that increase their resistance to pullout as pressure or external forces increase. The system manufacturer shall provide all the components (follower ring, wedges, and gaskets) for the restraining device. The device shall be capable of full mechanical joint deflection during assembly, and the flexibility of the joint shall be maintained after burial. The joint restraint ring and its wedging components shall be constructed of ductile iron conforming to ASTM A536, Grade 60-42-10. The wedges shall be ductile iron, heat-treated to a minimum hardness of 370 BHN. Dimensions of the gland shall be such that it can be used with mechanical joint bells conforming to AWWA C111 and AWWA C153. The design shall use torque limiting twist-off nuts to provide actuation of the restraining wedges. The mechanical joint restraint shall be available in the size range of 3 through 48 inches. Minimum rated pressure shall be 350 psi for sizes 16 inches and smaller and 250 psi in sizes 18 inches and larger. Products: Megalug Series 1100 as manufactured by EBAA Iron, Inc., or equal.

2.15 DUCTILE-IRON PIPE WELDMENTS

- A. All welding to ductile-iron pipe, such as for bosses, joint restraint, and joint bond cables, shall be done at the place of manufacture of the pipe. Perform welding by skilled welders experienced in the method and materials to be used. Welders shall be qualified under the standard qualification procedures of the ASME Boiler and Pressure Vessel Code, Section IX, Welding Qualifications.
- B. Welds shall be of uniform composition, neat, smooth, full strength, and ductile. Completely grind out porosity and cracks, trapped welding flux, and other defects in the welds in such a manner that will permit proper and complete repair by welding.
- C. Completed welds shall be inspected at the place of manufacture by the liquid penetrant method. Conform to the requirements specified in ASTM E165, Method A, Type I or Type II. The materials used shall be water washable and nonflammable.

PART 3 EXECUTION

3.1 DELIVERY, UNLOADING, AND TEMPORARY STORAGE OF PIPE AT SITE

- A. Limit onsite pipe storage to a maximum of one week.
- B. Use unloading and installation procedures that avoid cracking of the lining. If necessary, use plastic sheet bulkheads to close pipe ends and keep cement-mortar lining moist.
- C. Deliver the pipe alongside the pipelaying access road over which the pipe trailer-tractors can travel under their own power. Place the pipe in the order in which it is to be installed and secure it from rolling.
- D. Do not move pipe by inserting any devices or pieces of equipment into the pipe barrel. Field repair linings damaged by unloading or installation procedures.

3.2 SANITATION OF PIPE INTERIOR

- A. During laying operations, do not place tools, clothing, or other materials in the pipe.
- B. When pipelaying is not in progress, close the ends of the installed pipe by a child- and vermin-proof plug.

3.3 INSTALLING FLANGED PIPE AND FITTINGS

- A. Install in accordance with Sections 400500. Cut the bore of the gaskets such that the gaskets do not protrude into the pipe when the flange bolts are tightened.

3.4 INSTALLING GROOVED-END PIPE AND FITTINGS

- A. Install in strict accordance with manufacturer's recommendations.

3.5 INSTALLING BURIED PIPING

- A. Install in accordance with AWWA C600 and as specified herein.
- B. When installing piping in trenches, do not deviate more than 1-inch from line or $\frac{1}{4}$ -inch from grade. Measure for grade at the pipe invert.
- C. Provide thrust blocks at fittings where indicated and from Engineer approved submittals.
- D. Inspection for Defects: Before installation, inspect pipe and appurtenances for defects and, when applicable, tap the pipe with a light hammer to detect cracks. Reject defective, damaged, or unsound pipe and appurtenances.
- E. Push-On Joints: Bevel and lubricate spigot end of pipe to facilitate assembly without damage to gasket. Taper of bevel shall be approximately 30 degrees with centerline of pipe and approximately 1/4 IN back.
- F. Push-On Joints: Use lubricant that is non-toxic, does not support the growth of bacteria, has no deteriorating effects on the gasket material, and imparts no taste or odor to water in pipe. Assure the gasket groove is thoroughly clean. For cold weather installation, warm gasket prior to placement in bell.
- G. Cutting: Cut pipe, when necessary, in a neat and workmanlike manner without damage to the pipe, interior lining, and exterior coating. Perform cutting with an approved mechanical cutter, using a wheel cutter when applicable and practicable.
- H. Cut pipe ends square, ream pipe and tube ends to full pipe diameter, remove burrs.
- I. Depth of Cover: The depth of cover over water mains from the top of the pipe to the ground surface shall be sufficient to prevent freezing. The minimum depth shall be 42", or otherwise as shown on the Drawings.
- J. Install access fittings to permit disinfection of water system.
- K. If effective sealing is not obtained, disassemble, thoroughly clean, and reassemble the joint.
- L. Assemble restrained joints per manufacturer's instructions.
- M. Do not exceed the joint deflection angles recommended by the Manufacturer.

3.6 INSTALLING ABOVEGROUND OR EXPOSED PIPING

- A. See Sections 400500
- B. Support exposed pipe in accordance with Section 400764.

3.7 PAINTING AND COATING

- A. Coat pipe located above ground and in vaults and structures per Section 099000 or apply prime coat in the shop before transporting pipe to the jobsite. As an alternate to the specified prime coat, pipe, supplier/manufacturer may utilize Tnemec Series N140, or equal, as the prime coat and apply intermediate and finish coats in the field before installing the pipe, then touch up after installation.
- B. Provide asphaltic coating on buried pipe exterior per AWWA C151.
- C. Coat buried piping per Section 099000, System No. 10.
- D. Coat buried flanges and buried mechanical and restrained joint bolts, nuts, and glands per Section 099000, System No. 10.
- E. Coat submerged pipe per Section 099000, System No. 12 or with Engineer approved fusion-bonded epoxy coating system.
- F. Line and coat exposed grooved-end couplings the same as the pipe exterior coating or with an Engineer approved fusion-bonded epoxy.
- G. Line and coat submerged and buried grooved-end couplings per Section 099000, System No. 12; or with Engineer approved fusion-bonded epoxy system.

3.8 POLYETHYLENE ENCASUREMENT OF BURIED PIPE AND FITTINGS

- A. Wrap buried pipe, fittings, grooved-end couplings, and joints with a minimum of 8-mil low-density polyethylene wrap conforming to AWWA C105.
- B. Polyethylene encasement for ductile-iron pipe shall be supplied as a flat tube meeting the dimensions of Table 1 in AWWA C105 and shall be supplied by the ductile-iron pipe manufacturer.

3.9 CLEANING PIPE

- A. After interior joints have been pointed and mortar has hardened, sweep pipe clean of all dirt and debris. If hardened mud exists in the pipe, remove with the use of pressurized water hoses.

3.10 FIELD HYDROSTATIC TESTING

- A. Test pressures are shown in Section 400515. Test in accordance with Section 400515.

3.11 BURIED WARNING AND IDENTIFICATION TAPE

- A. Provide detectable warning tape. Warning and identification shall read "CAUTION BURIED WATER PIPING BELOW" or similar wording.

END OF SECTION

SECTION 402076

CARBON AND STAINLESS STEEL PIPE

PART 1 GENERAL

1.1 DESCRIPTION

- A. This section includes materials and installation of carbon steel pipe and fittings 26 inches and smaller conforming to ASTM A53 and stainless steel pipe and fittings 30 inches in diameter and smaller conforming to ASTM A312. Seller shall supply piping having a maximum design pressure appropriate for the intended application.

1.2 SUBMITTALS

- A. Submit shop drawings in accordance with the General Conditions and Section 013300
- B. Submit materials list showing material of pipe and fittings with ASTM reference and grade. Submit manufacturer's certificate of compliance with referenced standards. Show piping service
- C. Manufacturer's catalog data marked to indicate materials being furnished.
- D. Weight and support requirements.
- E. Certificate of compliance, signed by the Manufacturer, stating that the equipment offered is in full compliance with the specifications.
- F. Welder certification documents.
- G. Pickling and passivating procedure.
- H. For piping 6-inches and larger, submit detailed piping layout drawings showing location and dimensions of pipe, fittings, taps, and outlets in full detail, location of pipe hangers and supports, large-scale details of all special castings, and locations and types of restraint to prevent joints from pulling apart. Include laying lengths of flanges, gaskets, valves, meters, inline pumps, and other equipment determining piping dimensions. FIELD VERIFY DIMENSIONS PRIOR TO PREPARATION OF LAYOUT DRAWINGS. DO NOT FABRICATE PIPE UNTIL SUBMITTAL HAS BEEN RETURNED STAMPED "RESUBMITTAL IS NOT REQUIRED" OR "MAKE CORRECTIONS NOTED." Label or number each fitting or piece of pipe and provide the following information for each item:
 1. Material of construction, with ASTM reference and grade.
 2. Wall thickness of stainless steel cylinder.
 3. Manufacturer's certificate of compliance with referenced pipe standards.
 4. Show weld sizes and dimensions of grooved-end collars, flanges, reinforcing collars, wrapper plates, and crotch plates.

1.3 QUALITY ASSURANCE

- A. Welder Qualifications
 1. Piping systems welding shall be by welders qualified and certified under provisions of AWS to weld austenitic chromium-nickel stainless steel and carbon steel pipe and tubing meeting requirements of ASME Section VIII, Division 1 and ANSI B31.3.
 2. Welders shall be certified by an independent, acceptable testing agency not more than 12 months prior to commencing work.
 3. Perform certification with machines and electrodes similar to those used in the work.
 4. Certify welders at no additional cost to the Owner.

1.4 WARRANTY

- A. Full warranty against defects in materials and workmanship for two (2) years after final acceptance by the Owner, including all parts, labor, and expenses.
- B. Owner, Owner's Representative, and Contractor shall conduct a 23-month warranty inspection of the pipe to ensure that it is free from defects, pitting, and corrosion. All defective areas shall be repaired according to manufacturer's recommendations or replaced.

PART 2 PRODUCTS

2.1 STAINLESS STEEL PIPE

- A. Pipe shall conform to ASTM A312, Grade TP 316L.
- B. Seller shall determine pipe sizes and wall thicknesses applicable to the application it will be used and

shall conform to ASME B36.19.

2.2 CARBON STEEL PIPE

- A. Pipe shall conform to ASTM A53, Type F, Grade A.
- B. Seller shall determine pipe sizes and wall thicknesses applicable to the application it will be used and shall conform to ASME B36.10.

2.3 FITTINGS

- A. Fittings 3 inches and smaller shall be socket welded, conforming to ASME B16.9 and ASME B16.11. Seller shall determine fitting class applicable to the application it will be used.
 - 1. Material for socket welded fittings shall conform to ASTM A403, Class WP316L or ASTM A182, Grade F316L.
- B. Fittings for aboveground or exposed pipe larger than 3 inches through 24 inches shall be *butt-welded*, conforming to ASTM A403, Class WP, same material and wall thickness as the pipe, conforming to ASME B16.9. Elbows shall be long radius unless indicated otherwise on the Drawings.
- C. Fittings for pipe larger than 24 inches shall conform to ASME B16.9. Material shall be the same as the pipe.

2.4 PICKLING, PASSIVATING, AND FINAL CLEANING

- A. After fabrication, mechanically clean/descale the welded surface, to remove all thick visible oxide scale with wire brushes and/or non-metallic devices. Brushes shall be stainless steel and used only on stainless steel.
- B. After descaling is completed, all pipe and fittings shall be immersed in a pickling solution to remove all weld heat tinted layers from the surface of the stainless steel, ensure removal of all free iron, weld scale, and other impurities and to insure the establishment of a passive surface prior to passivation. Pickling solution shall be a nitric-hydrofluoric bath at the proper temperature and length of time per ASTM A380. Perform a complete neutralizing operation by immersion in a trisodium phosphate rinse followed by a clean water rinse.
 - 1. Chemical clean shall completely remove the surface contamination but will not significantly affect the stainless steel itself.
 - 2. After final cleaning, wet surfaces with water and inspect for rust spots after 24-hours. Reclean if there is any evidence of rusting.
 - 3. Contractor may submit alternate pickling and passivating procedure other than the full immersion bath for review by the Engineer. Alternate pickling and passivating procedure shall be in accordance with ASTM A380. Submittal of alternate procedure does not ensure approval.
- C. After descaling and pickling, the stainless steel piping/fabrication shall be fully passivated to enhance the corrosion resistance of the stainless steel, through forming a chemically inactive surface when exposed to air or oxidizing agent. Passivation shall be completed per ASTM A380, and A967.

2.5 QUALITY CONTROL

- A. Include the "Hydrostatic Test" and "Flattening Test" requirements described in ASTM A999. A nondestructive electric test per ASTM A999 may be substituted for the hydrostatic test.

2.6 EXTERIOR AESTHETIC FINISH

- A. Where shown in the Drawings, or Piping Schedule, exterior finish for piping 12 inches and larger shall be equivalent to a No. 4 per ASTM A480. As an alternative, provide a bright electropolished finish per ASTM B912. The electropolished surface shall pass the test for visual defects per ASTM B912, paragraph 5.1.

2.7 UNIONS

- A. Unions shall WOG forged stainless steel, class determined by seller and appropriate for the application it is used, with dimensions conforming to MSS SP-83. Ends shall be socket-welded type.
 - 1. Material shall conform to ASTM A182, Grade F316L for socket-welded type unions.

2.8 JOINTS

- A. Joints for pipes 3 inches and smaller shall be socket welded, same material as specified for fittings, class determined by seller and appropriate for the application it is used, conforming to ASME B16.11.
- B. Joints for buried or submerged pipe larger than 3 inches shall be butt-welded.

- C. Joints for aboveground or exposed pipe larger than 3 inches shall be butt-welded.
- D. Where piping connects to wall pipes, meters, valves, or other equipment, the pipe ends shall match the ends of the wall pipes, meters, valves, or equipment, unless indicated otherwise.

2.9 OUTLETS AND NOZZLES

- A. Outlets of size 3 inches and smaller in piping 4 inches and larger shall be of the Thredolet type, per MSS SP-97, Figure 13-23. Outlets class shall be selected by the seller and appropriate for the application it is used, conforming to ASTM A182, Grade F316L or ASTM A403, Grade WP316L.
- B. For outlets 3-inches and smaller in piping smaller than 4-inches, use a tee with threaded outlet.
- C. For outlets larger than 3-inches, use a tee with a flanged outlet. Side outlets are not considered equivalent to fabricated tees and shall not be used without written permission.

2.10 THREAD LUBRICANT

- A. Use Teflon thread lubricating compound or Teflon tape.

2.11 FLANGES

- A. Provide weld-neck flanges (conforming to ASME B16.5) for piping 3 inches and smaller to connect to flanged valves, fittings, or equipment. Provide weld-neck or Van Stone flanges (per ASTM F2015) for piping larger than 3 inches. Flanges shall be Class 150 per ASME B16.5. Flanges shall match the connecting flanges on the adjacent fitting, valve, or piece of equipment. Flanges shall be flat face.
- B. Material for weld-neck flanges shall conform to ASTM A182, Grade F316L
- C. Material for Van Stone flanges shall be as follows
 1. Exposed Applications: Carbon steel; ASTM A216, Grade WGA or WGB; Stainless steel; ASTM A351, Grade CF8; or Stainless steel; ASTM A351, Grade CF8M.
 2. Submerged or Buried Applications: Stainless steel; ASTM A351, Grade CF8M

2.12 BOLTS AND NUTS FOR FLANGES

- A. Bolts and nuts for Class 125 or 150 flanges located indoors; outdoors above ground; and in vaults and structures shall be carbon steel, ASTM A307, Grade B, hot-dipped galvanized per ASTM F2329.
- B. Bolts and nuts for all buried flanges and all flanges located indoors; outdoors; above ground; and in vaults and structures shall be Type 316 stainless steel conforming to ASTM A193, Grade B8M Class 2, for bolts, and ASTM A194, Grade 8M, for nuts unless indicated otherwise. Fit shall be Class 2A and 2B per ASME B1.1 when connecting cast iron valves having body bolt holes.
- C. Hex head machine bolts for use with lugged valves shall comply with ASTM A193, Grade B7.
- D. Bolts for ASME B16.5 and B16.47 Class 300 flanges located indoors; outdoors; above ground; and in vaults and structures shall conform to ASTM A193, Grade B7, with nuts conforming to ASTM A194, Grade 2H.
- E. Bolts and nuts for buried or submerged Class 300 flanges and Class 300 flanges located outdoors above ground or in vaults and structures shall be Type 316 stainless steel conforming to ASTM A193, Grade B8M, Class 2, for bolts and ASTM A194, Grade 8M, for nuts.
- F. Bolts for piping in sodium hypochlorite service shall be titanium, per ASTM F467, Grade Ti1, Ti2, or Ti7. Nuts shall conform to ASTM F467, same material as the bolts.
- G. Bolts and nuts used in flange insulation kits shall conform to the same requirements as described in the paragraph contained herein; or ASTM A193 (Grade B7). Nuts shall conform to ASTM A194 (Grade 2H).
- H. Form threads for stainless steel bolts by means of rolling, not cutting or grinding.
- I. Provide washers for each nut and bolt head. Washers shall be of the same material as the nuts.

2.13 LUBRICANT FOR STAINLESS STEEL BOLTS AND NUTS

- A. Lubricant shall be chloride free and shall be RAMCO TG-50, Anti-Seize by RAMCO, Specialty Lubricants Corporation Huskyä Lube O'Seal, or equal.

2.14 GASKETS FOR FLANGES

- A. Gaskets shall be suitable for a maximum pressure of 300 psi and a maximum temperature of 500 degrees F. Gaskets for raw digester gas and methane gas service shall be one of the following materials:

1. Teflon envelope type, full face, 1/8-inch insert, with compressed nonasbestos filler. Provide free-flow design in which the Teflon is machined or milled between leaves to provide a space for the filler.
2. PTFE with inert filler, 1/8-inch thick. Product: Garlock "Gylon."
3. Viton B, 1/8-inch thick.

2.15 WYE STRAINERS

- A. Strainers 2 inches and smaller shall be stainless steel, wye pattern, with minimum pressure rating of 300-psi WOG. Material shall conform to ASTM A351 or A743, Grade CF8M. Screen shall be 20 mesh and same material as the strainer. Provide pet cock of the same material as the strainer body in the blowoff connection. Ends shall be threaded conforming to ASME B1.20.1. Provide one spare screen for each strainer. Strainers shall be Sarco Type 316, Muessco No. 861, or equal.

2.16 PROTECTIVE END CAPS

- A. Provide protective end caps on each piece of pipe or fabricated section, completely sealing the piece from contamination during shipment and storage. Provide the same type of seals on each fitting, or ship and store fittings in sealed boxes or containers.

2.17 SHOP FABRICATION

- A. General
 1. Shop fabricate 4-inch and larger stainless steel and carbon steel pipe and fittings in sections as large as practical.
 2. Pipe and fitting joints in shop fabrication shall be weld joints. Ends of shop fabrications shall have flanges or plain ends. Plain ends shall be prepared for field installed couplings.
- B. Shop Welding
 1. Shop welding procedures for stainless steel pipe shall meet requirements of ANSI/AWS D10.4.
 2. All process gas piping is welded in accordance with ASME B31.3 for normal gas service.
 3. Prepare edges by machine shaping or cutting. Bevel ends of pipe and fittings with wall thickness of 3/16-inch and larger. Bevel ends of stainless steel pipe to meet requirements of ANSI/AWS D10.4. Separate abutting pipe ends before welding, and completely fuse inside walls of pipe without overlapping. Welding shall be continuous around the joint and shall be completed without interruption. Welds shall be single "V" butt type, of sound weld metal thoroughly fused into the ends of pipe and into bottom of "V". Welds shall be free from cold spots, pin holes, oxide inclusions, burrs, snags, rough projections or other defects.
 4. Use an inert shielding gas welding method. Do not use oxygen fuel welding. Purge the interior of the pipe with inert gas prior to root pass.
 5. Welded butt joints (both longitudinal and circumferential) shall comply with ANSI/AWS D10.4. Do not use backing rings. Provide full penetration and smooth internal diameters for the root bead of welds. Grind the inside weld of socket welds flush with pipe internal diameter. Welds shall be of smooth finish. Use anti-spatter compounds specifically formulated or designed for use with stainless steel. Do not allow heat tint to form in the heat-affected zone or remove heat tint completely from the heat-affected zone of the finished weld. The maximum depth of grinding or abrasive blasting to remove defects shall not exceed 10-percent of the wall thickness. Do not perform abrasive blasting with steel shot, grit, or sand.
 6. No iron or steel surfaces shall come into contact with the stainless steel. This includes placing on steel tables, racks, pipe supports, etc. Do not use carbon steel wire brushes or grinders.
 7. Welding electrodes shall comply with AWS A5.4. Bare wire shall comply with AWS A5.9. Use electrodes as follows:
 - a. Type 304 Pipe Material: E 308 Welding Electrode Material.
 - b. Type 304L Pipe Material: E 347 Welding Electrode Material.
 - c. Type 316 Pipe Material: E 316 Welding Electrode Material.
 - d. Type 316L Pipe Material: E 318 Welding Electrode Material.

PART 3 EXECUTION

3.1 SHIPPING, STORAGE, AND HANDLING

- A. When loading piping for shipment to the project site, use spacers and other protective devices to separate pipes to prevent damaging the surfaces during transit and unloading. If wood spacers are used, remove wood splinters and particles from the pipe surfaces after separation. Use padded chains or ribbon binders to secure the loaded pipe and minimize damage.

- B. Cover piping 100% with protective coverings or tarpaulins to prevent deposition of road salts, fuel residue, and other contaminants in transit.
- C. Provide stulls, braces, and supports during shipping and storage such that out-of-roundness or deflection does not exceed 0.5% of the pipe diameter.
- D. Handle piping with care during unloading, installation, and erection operations to minimize damage. Do not place or store pipe on the ground or on top of other work unless ground or work is covered with a protective covering or tarpaulin. Place pipe above the ground upon platforms, skids, or other supports.
- E. Store piping at the site on pallets to prevent direct contact with ground or floor. Cover pipe during storage with protective coverings or tarpaulins to prevent deposition of rainwater, salt air, dirt, dust, and other contaminants.
- F. Do not allow stainless steel piping to contact carbon steel surfaces during storage, handling, or installation and erection at the site.
- G. Piping supplier during manufacturing, fabrication and handling stages, and the Contractor during handling and installation steps, shall use extreme care to avoid contact of any ferrous materials with the stainless steel piping. Pipe storage and fabrication racks shall be non-ferrous, stainless steel, or rubber lined. Nylon slings or straps shall be used for handling stainless steel piping. Slings or straps used for stainless steel piping shall not be used with any other materials. Contact with ferrous items may cause rusting or iron particles embedded in the piping walls. After installation, the Contractor shall wash and rinse all foreign matter from the piping surface. If rusting of embedded iron occurs, the Contractor shall pickle the affected surface with Oakite Deoxidizer SS, or equal, scrub with stainless steel brushes and rinse clean.

3.2 SHOP TESTING OF FABRICATED OR WELDED COMPONENTS

- A. After completion of fabrication and welding in the shop, test each component according to the referenced standards. Test fabricated fittings per ASME B31.3. Test the same in fittings which have not been previously shop hydrostatically tested by the dye penetrant method as described in ASME Boiler and Pressure Vessel Code Section VIII, Appendix B. In lieu of the dye penetrant method of testing, completed fittings may be hydrostatically tested. Use a hydrostatic pressure of 150-percent of the design pressure.
 - 1. Perform tests of production welds in fabricated piping in accordance with ASME B31.3.

3.3 FIELD WELD JOINTS FOR STAINLESS STEEL PIPE AND FITTINGS

- A. General
 - 1. Do not field weld pipe or fittings, unless field welding is approved in writing by the Engineer.
 - a. Welding in field shall be performed only when requested on shop drawings and accepted by Owner and Owner's Representative in writing as specified in this Section.
 - b. Field welding of pipe or fittings will only be considered by the Engineer if:
 - Contractor submits documentation of welder's certification to perform welding and documentation of welder's experience in welding the style of pipe; and Contractor can demonstrate that pipe can be welded to meet requirements of reference standards.
 - If field welding is not approved by the Engineer, provide clamp type coupling joints or flange joints, as specified in this Section and the appropriate piping material Section, at no additional cost to the Owner.
- B. Field Weld Joints for Stainless Steel Pipe and Fittings if Field Weld Joints are Allowed:
 - 1. Welding procedures for stainless steel pipe and fittings shall meet requirements of ANSI/AWS 10.4.
 - 2. Separate abutting pipe ends before welding, and completely fuse inside walls of pipe without overlapping. Welding shall be continuous around the joint and shall be completed without interruption. Welds shall be single "V" butt type, of sound weld metal thoroughly fused into the ends of pipe and into bottom of "V". Welds shall be free from cold spots, pin-holes, oxide inclusions, burrs, snags, rough projections, or other defects.
 - 3. Protect and finish stainless steel weld joints as follows:
 - a. Wire brush outside weld area. Remove weld splatter. Brushes shall be stainless steel and used only on stainless steel.
 - b. Remove surface oxidation by brushing or grinding and brushing.
 - c. Pickle the weld and heat-affected zone with field applied paste. Follow manufacturer's recommendations.

3.3 INSTALLING FLANGED PIPING

- C. Set pipe with the flange bolt holes straddling the pipe horizontal and vertical centerline. Install pipe without springing, forcing, or stressing the pipe or any adjacent connecting valves or equipment. Before bolting up, align flange faces to the design plane within 1/16 inch per foot measured across any diameter. Align flange bolt holes within 1/8-inch maximum offset.
- D. Inspection for Defects: Before installation, inspect pipe and appurtenances for defects and, when applicable, tap the pipe with a light hammer to detect cracks. Reject defective, damaged, or unsound pipe and appurtenances.
- E. Inspect each gasket to verify that it is the correct size, material, and type for the specified service and that it is clean and undamaged. Examine bolts or studs, nuts, and washers for defects such as burrs or cracks and rust and replace as needed.
- F. Clean flanges by wire brushing before installing flanged fittings. Clean flange bolts and nuts by wire brushing, lubricate carbon steel bolts with oil and graphite, and tighten nuts uniformly and progressively.
- G. Bolt lengths shall extend completely through their nuts. Any that fail to do so shall be considered acceptably engaged if the lack of complete engagement is not more than one thread.
- H. Do not use more than one gasket between contact faces in assembling a flanged joint.
- I. Tighten the bolts to the manufacturer's specifications, using the recommended cross bolt pattern in multiple steps of increasing torque, until the final torque requirements are achieved. Do not over torque.
- J. If flanges leak under pressure testing, loosen or remove the nuts and bolts, reset or replace the gasket, reinstall or retighten the bolts and nuts, and retest the joints. Joints shall be gas tight.
- K. Install threaded nut and bolt thread protection caps after completing the bolt, nut, and gasket installation. Install on exposed, buried, and submerged piping.

3.4 INSTALLATION OF STAINLESS STEEL BOLTS AND NUTS

- A. Prior to assembly, coat threaded portions of stainless steel bolts and nuts with lubricant.

3.5 INSTALLING SUBMERGED, ABOVEGROUND, OR EXPOSED PIPING

- A. Set piping plumb and at the horizontal and vertical location shown on the Drawings. Provide pipe hangers and supports to maintain alignment, as determined by the seller based on the application.
- B. Install pipe without springing, forcing, or stressing the pipe or any adjacent connecting valves or equipment. Pipe penetrations through walls, slabs, and floors shall be as detailed on the Drawings or as allowed for alternate configurations as specified herein.
- C. Install pipe spools in walls and slabs before placing concrete.
- D. Inspection for Defects: Before installation, inspect pipe and appurtenances for defects and, when applicable, tap the pipe with a light hammer to detect cracks. Reject defective, damaged, or unsound pipe and appurtenances.
- E. Cutting: Cut pipe, when necessary, in a neat and workmanlike manner without damage to the pipe, interior lining, and exterior coating. Perform cutting with an approved mechanical cutter, using a wheel cutter when applicable and practicable.
- F. Cut pipe ends square, ream pipe and tube ends to full pipe diameter, remove burrs.
- G. Beveling: Grind smooth and bevel cut ends and rough edges using methods recommended by the manufacturer and approved by Engineer.
- H. Bolt holes of flanges shall straddle the horizontal and vertical centerlines of the pipe. Clean flanges by wire brushing before installing flanged fittings. Lubricate bolts and tighten nuts uniformly and progressively. If flanges leak under pressure testing, loosen or remove the nuts and bolts, reset or replace the gasket, reinstall or retighten the bolts and nuts, and retest the joints. Joints shall be watertight.
- I. Provide a flange insulation kit at all flanges between dissimilar metals whether shown on the Drawings or not.

3.6 FIELD INSTALLATION OF AUXILIARIES

- A. Mount field-installed auxiliary equipment, piping, conduit, instruments, coolers, seal pots, control panels, consoles, and so forth separately from the machine and driver unless such equipment is manufactured or fabricated as an integral part of the machine. These items shall not interfere with

removal of the machine or driver or with access to the machinery for normal operation and maintenance.

- B. Locate auxiliary support piping, conduit, instrumentation, and so forth, for a single drop area on the machinery baseplate or soleplate. Do not install piping, conduit, and other support systems at multiple locations on the base.
- C. Make openings for branch connections in piping of NPS 1 inch or smaller by drilling the run pipe. Do not perform torch cutting of any opening smaller than NPS 1 inch in diameter.
- D. Use process-compatible pipe joint compounds for threaded connections. Do not use PTFE tape pipe sealant or antiseize lubricants to make up any threaded connections in lubricating oil, seal fluid, buffer gas, or utility connections to any machine.
- E. Threaded connections shall have two to five exposed pipe threads after making up the joint.

3.7 STRAY ELECTRICAL CURRENTS

- A. Stray currents from welding can cause damage to seals, bearings, and other machinery components. Stray electrical currents can also magnetize machinery components that can later generate damaging currents. Conform to the following requirements for field welds around machinery.
- B. Attach welding ground cables adjacent to the place where the weld is being made. Attach the welding clamps onto the pipe near the weld and ground the welding machine properly. Do not use spring-type alligator clamps.
- C. Do not attach ground leads to any part of the machinery, auxiliary systems, or supports for any reason.
- D. Should it be necessary to attach piping to the machinery for the purpose of field welding, isolate the machinery from the pipe flange by using a full-circle 1/8-inch-thick composition gasket. Then install insulated bolts or studs. Then perform a continuity check to prove the electrical isolation of the machine from the piping.
- E. Measure and record machinery magnetic flux density readings before and after welding. If residual magnetism is in excess of 1 millitesla (10 gauss), degaussing shall be required.

3.8 INSTALLATION VERIFICATION

- A. Prior to checking final piping alignment to the machinery, the piping system shall be complete as follows.
- B. Complete pipe pressure testing and drying out of the system and remove hydrotest blind flanges.
- C. Install and adjust permanent supports and hangers.
- D. Remove temporary supports and hangers.
- E. All the system piping components and machinery shall be at the same ambient temperature within a range of 18 degrees F before starting final piping alignment checks.
- F. Verify that the machine inlet and outlet piping is properly constructed. This inspection shall include verification of gasket material, gasket size, and the material, size, and length of flange bolts, studs, and nuts.
- G. Inspect the machine to verify that it is still removable. This means that sufficient flanged, threaded, and grooved-end piping connections exist to completely remove the machinery from the mounting plate for maintenance without requiring the cutting or welding of pipe or tubing.

3.9 FLANGE AND PIPING ALIGNMENT REQUIREMENTS

- A. Do not spring flanges of connecting piping into position.
- B. Line up pipe flange bolt holes with machinery nozzle bolt holes within 1/16 inch maximum offset from the center of the bolt hole to permit insertion of bolts without applying any external force to the piping.
- C. The machine and piping flange faces shall be parallel to less than 0.001 inch per inch of pipe flange outer diameter up to a maximum of 0.030 inch. For piping flange outer diameters smaller than 10 inches, the flanges shall be parallel to 0.010 inch or less. For raised face flanges, feeler gauge readings shall be taken at the raise face.
- D. Flange face separation shall be within the gasket spacing plus or minus 1/16 inch. Use only one gasket per flanged connection.

3.10 PIPING ALIGNMENT

- A. The objective of the following requirements is to verify that strains imposed by the piping on the machinery are minimized. Less strain imposed on the machine casing results in less distortion of running clearances and better machine performance and reliability.
- B. Separately work machinery inlet and outlet piping systems into position to bring the piping flanges into alignment with the matching machinery flanges. Do not move machinery to achieve piping alignment. Do not use electrical heating stress relieving to achieve piping alignment.
- C. Remove temporary supports for piping alignment (such as chain falls and wedges) during final alignment readings and piping bolt-up. Support piping by permanent fixed and spring supports and hangers. Piping shall not be binding on pipe guides or restraints.
- D. Measure pipe strain while all piping connections are being made to the machine. This includes lubricating oil piping, bearing cooling water piping, seal water piping, auxiliary piping such as steam, air, and flushing medium, as well as process piping and electrical conduits.
- E. For pieces of machinery with common piping such as pairs of pumps, monitor both shaft alignments during pipe installation and connection operations. Additionally, all of the machinery shall be bolted up at the same time with indicator readings taken on each shaft simultaneously.

3.11 PIPE STRAIN MEASUREMENT

- A. Install an alignment bracket on the coupling hub or shaft of the machine being checked for pipe strain.
- B. Mount indicators on the coupling hub to measure vertical and horizontal movement on the machine as the flange bolts are being tightened.
- C. Bolt-up of the piping flanges to the machinery flanges shall proceed with the largest flanges first. Complete bolt-up in a continuous effort without disturbing the location of the dial indicators.
- D. Use torque wrenches to tighten flange bolts. Initial tightening of the flange bolts shall be snug (10 percent of the total torque). Tighten flange bolts to 30 percent of final torque. Then tighten the flange bolts to 100 percent of final torque. Piping bolt torque values shall be specified by the machinery manufacturer taking into account whether bolt threads are lubricated or nonlubricated.

3.12 MISCELLANEOUS REQUIREMENTS

- A. After final piping connection, final shaft alignment shall be verified and all machinery shall be hand rotated to ensure that neither binding nor case distortion has occurred during piping installation.

3.13 PAINTING AND COATING

- A. Coat exposed carbon steel pipe and fittings per Section 099000, System No. 18.
- B. Do not coat stainless steel pipe and fittings.

END OF SECTION

SECTION 402090
PVC & CPVC PIPE (3 INCHES AND SMALLER)

PART 1 GENERAL

1.1 DESCRIPTION

- A. This section includes:
 - 1. Materials, installation, and testing of PVC pipe and fittings of size 3 inches and smaller for use in process piping having a maximum design pressure of 150 psi and having a maximum design temperature of 105 degrees F.
 - 2. Materials, installation, and testing of chlorinated polyvinyl chloride (CPVC) pipe and fittings of size 3 inches and smaller for use in process piping having a maximum design pressure of 150 psi at a maximum operating temperature of 105 degrees F and a maximum design pressure of 100 psi at a temperature of 140 degrees F.

1.2 RELATED WORK SPECIFIED ELSEWHERE

- A. Painting and Coating: 099000.
- B. Trenching and Backfilling: 312333.
- C. General Piping Requirements: 400500.
- D. Pressure Testing of Piping: 400515.
- E. Wall Pipes, Seep Rings, and Penetrations: 400762.
- F. Pipe Hangers and Supports: 400764.
- G. Equipment, Piping, and Valve Identification: 400775.
- H. PVC Pipe (4 Inches and Larger): 402091.

1.3 SUBMITTALS

- A. Submit shop drawings in accordance with Section 013300.
- B. Submit materials list showing materials of pipe and fittings with ASTM reference and grade. Submit manufacturer's certification of compliance with referenced standards, e.g., ASTM D1784, D1785 (PVC), F441 (CPVC), F439 (CPVC), and D2467 (PVC). Show wall thickness of pipe and fittings. Show fitting dimensions.
- C. Submit data sheets for solvent cement and demonstrating compliance with ASTM D2564, F493 (CPVC), and F656.
- D. Submit certification from manufacturer that all pipes and fittings are NSF approved for conveying potable water.

1.4 WARRANTY

- A. Full warranty against defects in materials and workmanship for one year after FINAL ACCEPTANCE, including all parts, labor, and expenses.

PART 2 PRODUCTS

2.1 PIPE

- A. PVC Pipe shall be Schedule 80, Type I, Grade 1 (Class 12454-B), conforming to ASTM D1784 and D1785.
- B. CPVC Pipe shall be Schedule 80, Type IV, Grade 1 (Class 23477-B), conforming to ASTM D1784 and F441.

2.2 PVC PIPE COLORING AND MARKING FOR RECLAIMED WATER; OR IRRIGATION>> SERVICE

- A. PVC pipe shall be purple (Pantone 522) and shall be marked on both sides of the pipe with the wording "CAUTION: RECLAIMED or IRRIGATION WATER--DO NOT DRINK." The lettering shall be minimum 1-inch-high black letters and shall be repeated at intervals not exceeding 36-inches. The purple coloring shall be achieved by adding pigment to the PVC material as the pipe is being manufactured.

2.3 FITTINGS

- A. PVC Fittings shall be Schedule 80 and shall conform to ASTM D2464 for threaded fittings and ASTM D2467 for socket-type fittings.

- B. CPVC Fittings shall be Schedule 80 and shall conform to ASTM F437 for threaded fittings and ASTM F439 for socket-type fittings.

2.4 FLANGES

- A. PVC and CPVC flanges shall be of the one-piece solid socket design and shall be made of the same material as the pipe. Pressure rating shall be at least 150 psi at a temperature of 73 degrees F. Minimum burst pressure shall be 500 psi. Flanges shall match the dimensions of ASME B16.5, Class 150, steel flanges for outside diameter, bolt circle, and bolt holes. Do not use Van Stone flanges.

2.5 UNIONS

- A. PVC Unions shall have socket-type ends, Viton O-rings, and shall be Schedule 80. Material shall be Type I, Grade 1 PVC, per ASTM D1784.
- B. CPVC Unions shall have socket-type ends, Viton O-rings, and shall be Schedule 80. Material shall be Type IV, Grade 1 CPVC, per ASTM D1784.
- C. Union connections to other metal piping materials shall comply with MSS SP-107. The fitting end for connection to CPVC pipe shall be a female socket. Provide wrought or cast copper tailpieces for connection to copper piping and tubing. Provide Type 316 stainless steel tailpieces for connection to steel piping.

2.6 JOINTS

- A. Pipe and fitting joints shall be socket welded except where threaded and flanged joints are required to connect to valves and equipment.

2.7 SOLVENT CEMENT (IN OTHER THAN PAA OR SODIUM HYPOCHLORITE SERVICE)

- A. PVC Solvent cement for socket joints shall comply with ASTM D2564 and F656.
- B. CPVC Solvent cement for socket joints shall comply with ASTM F493. Use the type of solvent cement as recommended in ASTM F493, Appendix X2.

2.8 SOLVENT CEMENT IN SODIUM HYPOCHLORITE SERVICE

- A. Solvent cement shall be free of silica. Products: IPS "Weld-On" PVC or CPVC 724 or Oatey "Lo V.O.C. PVC or CPVC Heavy Duty Gray."

2.9 GASKETS FOR FLANGES

- A. See Section 400500.

2.10 BOLTS AND NUTS FOR FLANGES

- A. See Section 400500.

2.11 LUBRICANT FOR STAINLESS STEEL BOLTS AND NUTS

- A. See Section 400500.

2.12 WYE STRAINERS

- A. PVC and CPVC wye strainers shall be manufactured of the same material as the pipe, with 30-mesh screens and Viton seals. Connecting ends shall be the socket type, solvent welded. Provide one spare screen for each strainer.

PART 3 EXECUTION

3.1 GENERAL

- A. Do not install PVC or CPVC pipe when the temperature is below 40°F or above 90°F. Store loose pipes on racks with a maximum support spacing of 3 feet. Provide shades for pipe stored outdoors or installed outdoors until the pipe is filled with water.
- B. Store fittings indoors in their original cartons.
- C. Store solvent cement indoors or, if outdoors, shade from direct sunlight exposure. Do not use solvent cements that have exceeded the shelf life marked on the storage container.
- D. Before installation, check pipe and fittings for cuts, scratches, gouges, buckling, kinking, or splitting on pipe ends. Remove any pipe section containing defects by cutting out the damaged section of pipe.
- E. Do not drag PVC or CPVC pipe over the ground, drop it onto the ground, or drop objects on it.

3.2 SOLVENT-WELDED JOINTS

- A. Prior to solvent welding, remove fittings and couplings from their cartons and expose them to the air at the same temperature conditions as the pipe for at least one hour.

- B. Cut pipe ends square and remove all burrs, chips, and filings before joining pipe or fittings. Bevel solvent-welded pipe ends as recommended by the pipe manufacturer.
- C. Wipe away loose dirt and moisture from the inside and outside of the pipe end and the inside of the fitting before applying solvent cement. Clean the surfaces of both pipes and fittings that are to be solvent welded with a clean cloth moistened with acetone or methylethyl ketone. Do not apply solvent cement to wet surfaces.
- D. The pipe and fitting socket shall have an interference fit. Perform a dry fit test at each joint before applying solvent cement. The pipe shall enter the fitting socket between one-third and two-thirds of the full socket depth when assembled by hand.
- E. Make up solvent-welded joints per ASTM D2855 (PVC) or F493 Appendix X1 (CPVC). Application of cement to both surfaces to be joined and assembly of these surfaces shall produce a continuous bond between them with visual evidence of cement at least flush with the outer end of the fitting bore around the entire joint perimeter.
- F. Allow at least eight hours of drying time before moving solvent-welded joints or subjecting the joints to any internal or external loads or pressures.
- G. Acceptance criteria for solvent-welded joints shall be as follows:
 - 1. Unfilled Areas in Joint: None permitted.
 - 2. Unbonded Areas in Joint: None permitted.
 - 3. Protrusion of Material into Pipe Bore, Percent of Pipe Wall Thickness: Cement, 50 Percent.

3.3 FLANGED JOINTS

- A. Lubricate carbon steel bolt threads with graphite and oil before installation.
- B. Tighten bolts on PVC and CPVC flanges by tightening the nuts diametrically opposite each other using a torque wrench. Complete tightening shall be accomplished in stages and the final torque values shall be as follows:
 - 1. Pipe Size of 1/2 to 1-1/2 Inches: 10 to 15 foot-pounds Final Torque.
 - 2. Pipe Size of 2 to 3 Inches: 20 to 30 foot-pounds Final Torque.

3.4 INSTALLATION OF STAINLESS STEEL BOLTS AND NUTS

- A. See Section 400500.

3.5 THREADED JOINTS

- A. Cut threaded ends on PVC or CPVC to the dimensions of ASME B1.20.1. Ends shall be square cut. Follow the pipe manufacturer's recommendations regarding pipe hold-down methods, saw cutting blade size, and saw cutting speed.
- B. Pipe or tubing cutters shall be specifically designed for use on PVC or CPVC pipe. Use cutters manufactured by Reed Manufacturing Company, Ridge Tool Company, or equal.
- C. If a hold-down vise is used when the pipe is cut, insert a rubber sheet between the vise jaws and the pipe to avoid scratching the pipe.
- D. Thread cutting dies shall be clean and sharp and shall not be used to cut materials other than plastic.
- E. Apply Teflon® thread compound or Teflon® tape lubricant to threads before screwing on the fitting.

3.6 INSTALLING UNIONS

- A. Provide unions on exposed piping 3 inches and smaller as follows:
- B. At every change in direction (horizontal and vertical).
- C. Six to twelve inches downstream of valves.
- D. Every 40 feet in straight pipe runs.
- E. Where shown in the drawings.

3.7 INSTALLING BURIED PIPE

- A. Install in accordance with Section 312333 and as follows.
- B. Trench bottom shall be continuous, smooth, and free of rocks. See the details in the drawings for trench dimensions, pipe bedding, and backfill.
- C. After the pipe has been solvent-welded and the joints have set, snake the pipe in the trench per the pipe manufacturer's recommendations in order to allow for thermal expansion and contraction of the pipe.

- D. Do not backfill the pipe trench until the solvent-welded joints have set. Support the pipe uniformly and continuously over its entire length on firm, stable soil. Do not use blocking to change pipe grade or to support pipe in the trench.
- E. Install buried PVC and CPVC pipe in accordance with ASTM D2774 and the pipe manufacturer's recommendations. Backfill materials in the pipe zone shall be imported sand per Section 312333.

3.8 INSTALLING ABOVEGROUND OR EXPOSED PIPING

- A. See Section 400500.
- B. Fill empty piping with water and provide temporary shading or other means to keep the surface temperature of the pipe below 100 degrees F.

3.9 PAINTING AND COATING

- A. Coat interior piping per Section 099000, System No. 30.
- B. Coat exterior piping per Section 099000, System No. 9.

3.10 HYDROSTATIC TESTING

- A. Perform hydrostatic testing for leakage in accordance with Section 400515.

END OF SECTION

SECTION 402091
PVC PIPE (4 INCHES AND LARGER)

PART 1 GENERAL

1.1 DESCRIPTION

- A. This section includes materials, installation, and testing of PVC pipe and fittings of size 4 inches and larger for use in aboveground or otherwise exposed process piping having a maximum design pressure of 50 psi and a maximum design temperature of 105 degrees F.

1.2 RELATED WORK SPECIFIED ELSEWHERE

- A. Painting and Coating: 099000.
- B. Trenching and Backfilling: 312333.
- C. General Piping Requirements: 400500.
- D. Pressure Testing of Piping: 400515.
- E. Wall Pipes, Seep Rings, and Penetrations: 400762.
- F. PVC & CPVC Pipe and Fittings, 3 Inches and Smaller: 402090.

1.3 SUBMITTALS

- A. Submit shop drawings in accordance with Section 013300.
- B. Submit materials list showing materials of pipe and fittings with ASTM reference and grade. Submit manufacturer's certification of compliance with referenced standards, e.g., ASTM D1784, D1785, D2467, and ASME B31.3. Show wall thickness of pipe and fittings. Show fitting dimensions.
- C. Submit data sheets for solvent cement and demonstrating compliance with ASTM D2564 and F656.
- D. Submit piping layout drawings showing location and dimensions of pipe and fittings. Include laying lengths of valves, meters, in-line pumps, and other equipment determining piping dimensions. Label or number each fitting or piece of pipe. Show location and detail of every pipe hanger and pipe support.
- E. Submit manufacturer's recommended torques for tightening bolts on flanged connections.
- F. Submit manufacturer's recommended method of installing solvent welded and hot gas welded joints. Submit bonding procedure specification (BPS) developed in accordance with ASME B31.3 (2006 edition), Chapter VII, Part 9, paragraph A328.2.
- G. Submit the names of employees to be utilized on the project who have been qualified per the BPS to make solvent-welded joints and hot gas welded joints. Submit the results of the BPS qualification tests per ASME B31.3, Chapter VII, Part 9, paragraphs A328.2.4 and A328.2.5 for each such employee.
- H. If any fabricated branch connections or tees are used, submit design calculations, service experience records, and performance test records per ASME B31.3, Chapter VII, Part 2, paragraph A304.7.2.
- I. Submit certification from manufacturer that all pipes and fittings are NSF approved for conveying potable water.

1.4 MANUFACTURER'S SERVICE

- A. Provide pipe manufacturer's services at the jobsite for the following minimum labor days, travel time excluded:
- B. One labor day to instruct the Contractor's personnel in the preparation and execution of solvent-welded and hot gas welded joints for the sizes of pipes to be installed in the project.
- C. One person to observe and advise during the assembly and installation of every pipe joint assembly in the project, including hot gas welding for repairing joints. The manufacturer's representative shall be qualified to make both solvent-welded joints and hot gas welded joints per the BPS.

1.5 WARRANTY

- A. Full warranty against defects in materials and workmanship for one year after FINAL ACCEPTANCE, including all parts, labor, and expenses.

PART 2 PRODUCTS

2.1 PIPE

- A. Pipe shall be Schedule 40 or 80, as shown, Type I, Grade 1 (Class 12454-B), conforming to ASTM D1784 and D1785.

- B. Diffuser piping supplied by others will utilize other piping standards.

2.2 FITTINGS

- A. Fittings shall be socket type, Schedule 40 or 80, as shown, and shall conform to ASTM D2467.
- B. Fabricated branch connections or tees may be used only where the type or size of fitting is not described in ASTM D2467. Joints and seams in fabricated fittings shall be in accordance with ASME B31.3 (2006 edition), Chapter VII, Part 9, paragraph A328.5.4. The design and fabrication of such branch connection and tees shall be in accordance with ASME B31.3, Chapter VII, paragraphs A304.3 and A328.5.2. Minimum wall thickness shall be equivalent to that of Schedule 80 pipe.

2.3 FLANGES

- A. PVC flanges shall be of the one-piece solid socket design and shall be made of the same material as the pipe. Pressure rating shall be at least 150 psi at a temperature of 73 degrees F. Minimum burst pressure shall be 500 psi. Flanges shall match the dimensions of ASME B16.5, Class 150 steel flanges for outside diameter, bolt circle, and bolt holes.

2.4 JOINTS

- A. Pipe and fitting joints shall be socket welded except where flanged joints are required to connect to valves and equipment.

2.5 SOLVENT CEMENT

- A. Solvent cement for socket joints shall comply with ASTM D2564 and F656.

2.6 GASKETS FOR FLANGES

- A. See Section 400500.

2.7 BOLTS AND NUTS FOR FLANGES

- A. See Section 400500.

2.8 LUBRICANT FOR STAINLESS STEEL BOLTS AND NUTS

- A. See Section 400500.

PART 3 EXECUTION

3.1 GENERAL

- A. Do not install PVC pipe when the temperature is below 40 degrees F or above 90 degrees F. Store loose pipes on racks with a maximum support spacing of 3 feet. Provide shades for pipe stored outdoors or installed outdoors until the pipe is filled with water.
- B. Store fittings indoors in their original cartons.
- C. Store solvent cement indoors or, if outdoors, shade from direct sunlight exposure. Do not use solvent cements that have exceeded the shelf life marked on the storage container.
- D. Before installation, check pipe and fittings for cuts, scratches, gouges, buckling, kinking, or splitting on pipe ends. Remove any pipe section containing defects by cutting out the damaged section of pipe.
- E. Do not drag PVC pipe over the ground, drop it onto the ground, or drop objects on it.

3.2 SOLVENT-WELDED AND HOT GAS WELDED JOINTS

- A. Bonding requirements shall be in accordance with ASME B31.3 (2006 edition), Chapter VII, Part 9. Bonding shall include both solvent welding or cementing and hot gas welding.
- B. Prior to solvent welding, remove fittings and couplings from their cartons and expose them to the air at the same temperature conditions as the pipe for at least one hour.
- C. Cut pipe ends square and remove burrs, chips, and filings before joining pipe or fittings. Bevel pipe ends as recommended by the pipe manufacturer in the BPS.
- D. Wipe away loose dirt and moisture from the inside and outside diameters of the pipe end and the inside diameter of the fitting before applying solvent cement. Clean the surfaces of both pipes and fittings that are to be solvent welded with a clean cloth moistened with acetone or methyl ethyl ketone. Do not apply solvent cement to wet surfaces.
- E. The pipe and fitting socket shall have an interference fit. Perform a dry fit test at each joint before applying solvent cement. The pipe shall enter the fitting socket between one-third and two-thirds of the full socket depth when assembled by hand.
- F. Make field solvent-welded and hot gas welded joints only in the presence of the pipe manufacturer's

representative who shall instruct and advise the Contractor's personnel in the assembly of the joints. Joint bonding shall be done in accordance with a BPS established by the pipe manufacturer. Qualification of the BPS shall be in accordance with ASME B31.3, Chapter VII, Part 9, paragraphs A328.2 through A328.5. Each person who will perform bonding shall be qualified in executing the BPS per paragraph A328.2.5.

- G. Make up solvent-welded joints per ASTM D2855 and the BPS. Application of cement to both surfaces to be joined and assembly of these surfaces shall produce a continuous bond between them with visual evidence of cement at least flush with the outer end of the fitting bore around the entire joint perimeter.
- H. Allow at least eight hours of drying time before moving solvent welded joints or subjecting the joints to any internal or external loads or pressures.
- I. After completion of the solvent-welded joints, subject the piping system to a hydrostatic test pressure of 75 psi per Section 400515. Solvent-welded joints that show minor weeping at isolated points around the circumference of the joint may be repaired by the hot gas welding method. There shall be no more than one point of weeping for every 12 inches of circumference of the pipe. Remove solvent-welded joints that show excessive leakage and assemble new joints.
- J. The hot gas welding method shall produce a continuous seal at the fillet formed by the junction of the fitting socket entrance and the pipe. Use a hot gas welding procedure per the BPS and the following to melt a plastic filler rod and the surfaces of the pipe in the fillet area. Force the softened rod into the softened fillet. Provide the hot gas weld around the entire circumference of the solvent-welded joint.
- K. Terminate a hot gas weld by lapping the bead on top of itself for a distance of 3/8 inch to 1/2 inch. Do not terminate a hot gas weld by overlapping the bead side by side.
- L. Provide three weld passes on each hot gas welded joint. Deposit the first bead at the bottom of the fillet. Deposit the second and third beads on each side of the first bead. Stagger the starting point for each bead and allow each weld pass to cool before proceeding with the next pass.
- M. Upon completion of each hot gas welded bead, check that the filler rod has completely fused into the base pipe. If the filler rod can be removed or pulled back from the base material, then reject the entire hot gas weld. Reject any hot gas welds showing brown or black discoloration.
- N. Upon completion of the hot gas welded joints, subject the piping system to a test pressure of 75 psi per Section 400515. Cut out, remove, and replace any joints that are leaking. No rework of leaking hot gas welded joints will be permitted.
- O. Acceptance criteria for solvent-welded and hot gas welded joints shall be as follows:
 - 1. Kind of Imperfection: Cracks.
 - a. Hot Gas Welded Joints: None permitted.
 - b. Solvent Cemented Joints: Not applicable.
 - 2. Kind of Imperfection: Unfilled areas in joint.
 - a. Hot Gas Welded Joints: None permitted.
 - b. Solvent Cemented Joints: None permitted.
 - 3. Kind of Imperfection: Unbonded areas in joint.
 - a. Hot Gas Welded Joints: Not applicable.
 - b. Solvent Cemented Joints: None permitted.
 - 4. Kind of Imperfection: Inclusions of charred material.
 - a. Hot Gas Welded Joints: None permitted.
 - b. Solvent Cemented Joints: Not applicable.
 - 5. Kind of Imperfection: Unfused filler material inclusions.
 - a. Hot Gas Welded Joints: None permitted.
 - b. Solvent Cemented Joints: Not applicable.
 - 6. Kind of Imperfection: Protrusion of material into pipe bore, percent of pipe wall thickness.
 - a. Hot Gas Welded Joints: Not applicable.
 - b. Solvent Cemented Joints: Cement, 50 percent.

3.3 FLANGED JOINTS

- A. Lubricate bolt threads with graphite and oil before installation.
- B. Tighten bolts on PVC flanges by tightening the nuts diametrically opposite each other using a torque wrench. Complete tightening shall be accomplished in stages and the final torque values shall be as follows:
 - 1. Pipe Size of 4 inches: 20 to 30 foot-pounds Final Torque.

2. Pipe Size of 6 to 8 inches: 33 to 50 foot-pounds Final Torque.

3.4 INSTALLATION OF STAINLESS STEEL BOLTS AND NUTS

A. See Section 400500.

3.5 INSTALLING ABOVEGROUND AND EXPOSED PIPING

A. See Section 400500.

B. Fill empty piping with water, provide temporary shading, or other means to keep the surface temperature of the pipe below 100 degrees F.

3.6 PAINTING AND COATING

A. Coat interior piping per Section 099000, System No. 30

B. Coat exterior piping per Section 099000, System No. 9

3.7 FINAL HYDROSTATIC TESTING

A. Perform final hydrostatic testing for leakage in accordance with Section 400515 after all joints have been tested and defective joints have been repaired or replaced.

END OF SECTION

SECTION 407100
FLOW AND LEVEL MEASUREMENT

PART 1 GENERAL

1.1 SUMMARY

- A. This section describes requirements for the following flow metering devices:
 - 1. Electronic-type flow meters:
 - a. Magnetic flow meters, inline-type **(FE/FIT-511)**
 - 2. Mechanical-type flow meters:
 - a. Positive displacement meters (5/8-inch to 2-inch).
 - 3. Open channel flow meters: **(Not Applicable)**
 - a. Flow metering weirs.
 - b. Flumes.
 - 4. Other devices:
 - a. Level Elements
 - b. Flow switches.

1.2 SUBMITTALS

- A. General: Submit shop drawings in accordance with the submittal procedures of the General Requirements.
- B. Product Data:
 - 1. Submit manufacturer's descriptive literature and product specifications for each product.
 - 2. Materials of construction shall describe any applicable material specifications (e.g., AISI, ASTM, CDA, SAE) as well as grade or type.
 - 3. Use equipment tag numbering to correlate each product with the relevant product data.
- C. Shop Drawings:
 - 1. Indicate typical layout including dimensions and minimum laying lengths of unimpeded flow.
 - 2. Submit detail drawings of the flow meter
 - 3. If Contract Documents were marked for dimension verification by Contractor, submit drawings showing field measured dimensions.
 - 4. Submit detail drawings of specialty accessory components not included in manufacturer's product data.

1.3 WARRANTY

- A. Full warranty against defects in materials and workmanship for two years including all parts, labor, and expenses.

PART 2 PRODUCTS

2.1 MATERIALS OF CONSTRUCTION

- A. All materials of construction for components that will contact potable water or will contact water indented to become potable must conform to NSF/ANSI Standard 61.
- B. Unless specified otherwise in this Section, meters with bronze main cases shall utilize bronze or 18-8 stainless steel case bolts (capscrews)

2.2 ELECTRONIC-TYPE FLOW METERS:

- A. Magnetic flow meters, inline-type. **(FE/FIT-511)**
 - 1. Manufacturers: Rosemount, Badger or equal.
 - 2. The magnetic flow meter shall be an obstructionless pipeline-mounted instrument to magnetically measure the flow of fluid.
 - 3. The output signal shall not be affected by changes in fluid viscosity or density and shall have zero-point stability and auto zeroing functions.
 - 4. The magnetic flow meter shall have a drip- and splash-proof sensor, capable of withstanding temporary submersion of up to 30 feet of water for 48 hours.
 - 5. The magnetic flow meter shall have an integral terminal box with watertight cable seals.

6. Interconnecting cables.
 - a. Provide stainless steel grounding rings and grounding straps per manufacturer's requirements.
7. Materials of Construction
 - a. Flangeless Meters: The flow tube shall be flangeless wafer construction with cast aluminum enclosure. Provide bolting kit.
 - b. Flanged Meters: The flow tube shall be Type 304 stainless steel with carbon steel flanges.
8. Indicator/Totalizer
 - a. The indicator/totalizer shall accept the process flow signal from the magnetic flow meter and convert its electrical output signals directly proportional to the instantaneous metered flow rate. The housing shall be suitable for field mounting.
9. Transmitter
 - a. The transmitter shall be microprocessor based with flow rate indicator in engineering units, forward, reversed, and net flow totalizer, all in user-selectable engineering units. The display shall also be capable of indicating alarm status and velocity of fluid. The transmitter shall be mounted on Unistrut near the flow meter. The transmitter shall output a 4-20 mA signal to the Remote Monitoring panel, and a 4-20 mA signal directly to the Peroxyacetic Acid Pump P-461.
10. Interconnecting Cable
 - a. The interconnecting cable between the sensor and the transmitter shall be furnished by the magnetic flow meter manufacturer.
11. The overall system's performance shall be as follows:
 - a. Accuracy: 0.5% of flow rate with minimum fluid velocity of 1 fps.
 - b. Repeatability: $\pm 0.1\%$ of flow rate.
 - c. The accuracy of each meter shall be verified by calibration in a flow laboratory traceable to the U.S. National Institute of Standards and Technology.
 - d. Adjustable full-scale range.
 - e. Outputs: Bidirectional, isolated 4- to 20-mA d-c and either 24-volt d-c scaled pulse, or 0- to 10-KHz frequency.
 - f. Power Consumption: 20 watts maximum.
 - g. Temperature Limits, Ambient: -20°F to $+140^{\circ}\text{F}$.
 - h. The flow meter shall have a positive zero return (PZR) input controlled by an external dry contact.
 - i. The meter shall have empty pipe detection.
 - j. A common alarm discrete output (a dry contact or a transistor switch) shall be provided for remote indication of fault conditions.

2.3 MECHANICAL-TYPE FLOW METERS:

- A. Positive displacement meters (5/8-inch to 2-inch) shall be used to monitor potable water consumption and used in addition to utility supplied meter.
 1. Meters shall be positive displacement type, oscillating piston, with sealed register and magnetic drive.
 2. Meters shall conform, except as otherwise specified herein, to the requirements of AWWA C700.
 3. Manufacturers: Sensus, Badger, or equal.
 4. Meters shall register not less than 98.0% or more than 101.5% of actual flow at any flow rate within the normal flow limits specified below:

Meter Size (inches)	Normal Flow Limit (gpm)	Max. Pressure Drop (psi)
5/8 x 3/4	1 to 20	11.0
3/4	2 to 30	11.5
1	3 to 50	11.5
1 1/2	5 to 100	12.0
2	8 to 160	12.5

5. Pressure drop through meters, when operated within specified normal flow limits, shall not exceed the -specified values above.
6. Registers shall be magnetically coupled to the meter and shall be hermetically sealed.
7. Register shall be a six-digit direct-reading totalizer type, calibrated in U.S. gallons.
8. Housing shall be bronze.

9. Disc shall be plastic or hard rubber.
10. Disc spindle, thrust roller insert, and magnet spindle shall be Type 316 stainless steel.
11. End Connections shall be threaded, NPSM, ASME B1.20.1.
12. The pressure rating shall be 150 psi, unless otherwise indicated on Bid Documents.
13. Meter flow accuracy shall be \pm over the flow ranges of meter.

2.4 OPEN CHANNEL FLOW METERS:

- A. UltraSonic Level Sensor and Transmitter (**Not Applicable**)
 1. Acceptable Manufacturer:
 - a. Eastech
 - b. Milltronics
 - c. Endress + Hauser
 - d. Magnetrol
 2. Materials:
 3. Design and fabrication:
 - a. Sensor:
 - 1) Emits Ultrasonic sound.
 - 2) Detects return echo reflected from surface and converts it to electrical energy proportional to level
 - b. Temperature compensated
 - c. Capable of being configured to ignore false targets.
 - d. Operating temperature: -4 to 140 Degrees Fahrenheit
 - e. Humidity: 95 percent non-condensing.
 - f. Transmitter:
 - 1) Capable of producing output signal proportional to level of 4-20 mA DC into 500-ohm load.
 - 2) Power Supply: 120 Vac (+/-10 percent), 60 Hz.
 - 3) Inaccuracy: 0.25 percent of range or 0.24 IN, whichever is greater.
 - 4) Resolution: 0.1 percent of span or 0.08 IN, whichever is greater.
 - 5) Display: Four-digit LED or LCD scalable to engineering units with selectable decimal point.
 - 6) Temperature: -5 to 122 Deg F.
 - 7) Humidity: 95 percent noncondensing.
 - 8) Memory: EEPROM (non-volatile).
 - 9) Keypad programmer.

2.5 PRESSURE TRANSMITTER LEVEL ELEMENTS:

- A. Pressure Transmitters:
 1. Acceptable Manufacturers:
 - a. Rosemount, Model 3051
 - b. Foxboro, I/A series.
 - c. Honeywell 100e.
 2. Materials:
 - a. Process flanges and adapters: (316 Stainless Steel)
 - b. Housing: (Aluminum)
 - c. Vent/Drain Valve: (316 Stainless Steel)
 - d. Fill Fluid:
 - 1) Utilize manufacturer's standard fill for other applications.
 - (a) Ensure fill is suitable for application temperatures.

3. Design and Fabrication:
 - a. Smart Transmitters utilizing microprocessor based electronics.
 - b. Output: 4-20 mA DC proportional to pressure.
 - c. Nonvolatile memory.
 - d. Power Supply: 24 Vdc.
 - e. Adjustable zero and span.
 - f. Temperature limits: -20 to 180 Degrees Fahrenheit
 - 1) -4 to 175 Degrees Fahrenheit for LCD indicators.
 - g. Overpressure Limits: Withstand 150 percent of stated maximum service pressure without damage.
 - h. Humidity Limits: 0 to 100 Percent Relative Humidity
 - i. Damping: Adjustable between 0 and 32 Seconds.
 - j. Inaccuracy (includes effects of linearity, repeatability, and hysteresis): +/-0.10 percent of calibrated span for 15:1 rangeability.

2.6 OTHER FLOW DEVICES

A. Level Elements

1. Submersible Transmitter Level Element (**Not Applicable**)

a. Float switches.

- LS-1-Pump Stop for Duplex Raw Sewage Pumping System, to be provided by pump supplier.
- LS-2-Lead Pump Start for Duplex Raw Sewage Pumping System, to be provided by pump supplier.

PART 3 – EXECUTION

3.1 ERECTION, INSTALLATION, AND APPLICATION

- A. Install, erect, apply, or otherwise place products in accordance with manufacturers printed instructions, GLUMRB Recommended Standards for Water Works and Wastewater Facilities, relevant AWWA standards, and applicable standards promulgated by local jurisdictional authority.
- B. Install plumb, level, and square as shown on Drawing, free from warp or twist while maintaining dimensional tolerances and alignment with surrounding construction or adjacent surfaces.
- C. Install observing minimum laying lengths of unimpeded upstream and downstream flow, using tube elements or radial vane elements if necessary to provide accurate metering operation.
- D. Provide the necessary couplings and fittings to complete meter connections to any piping, tubing, valves, and curb stops.
 1. For each flow meter installed in flanged or grooved piping, provide a replacement spool the same length of the meter, with gaskets, made of the same material as the adjoining piping.
 2. For positive displacement fittings shall be bronze: Ford, James Jones, Mueller, or equal.
- E. Magnetic flow meters shall be provided with ground to adjacent pipe. Locate to ensure full pipe at all times.

3.2 FLOW AND LEVEL MEASUREMENT SCHEDULE

A.

Delaplain Disposal	
<u>Product</u>	<u>Location</u>
MAG Meter	Filter influent (6")

END OF SECTION

PAGE INTENTIONALLY LEFT BLANK

**SECTION 409715
PRESSURE GAUGES**

PART 1 GENERAL

1.1 DESCRIPTION

- A. This section includes materials and installation of pressure gauges and accessories.

1.2 SUBMITTALS

- A. Submit shop drawings in accordance with Section 013300.
- B. Submit manufacturer's catalog data and descriptive literature. Call out materials of construction by ASTM reference and grade. Submit manufacturer's certificate of compliance with the referenced ANSI standards. Identify each gauge by tag number to which the catalog data and descriptive literature pertain.

1.3 WARRANTY

- A. Full warranty against defects in materials and workmanship for one year after FINAL ACCEPTANCE, including all parts, labor, and expenses.

PART 2 PRODUCTS

2.1 MANUFACTURERS

- A. Gauges, diaphragm seals, dampeners, and tools shall be as manufactured by Ashcroft, Crosby, Marshalltown, Marsh, or equivalent.

2.2 GAUGE DESIGN

- A. Gauges 4-1/2 inches in size shall comply with ANSI B40.1, Grade 1A (+/- 1.0% accuracy). Gages 2-1/2 inches in size shall comply with ANSI B40.1, Grade A (+/- 2-1/2% accuracy). Gages shall incorporate the following features:
 - 1. Solid or open front with side or rear blowout relief.
 - 2. Pressure tight.
 - 3. 270-degree arc with adjustable pointer.
 - 4. Stem mounted, 1/2 inch size.
 - 5. Hermetically sealed.
 - 6. Liquid filled.
 - 7. The dial size shall be 2-1/2 inches, except for gauges located on process pump discharge lines which shall be 4-1/2 inches.
 - 8. Dial shall have white background and black markings.
 - 9. The units of measurement shall be indicated on the dial face.
- B. Pressure ranges and locations shall be as indicated on the pressure gauge schedule.

2.3 MATERIALS OF CONSTRUCTION

- A. Materials of construction shall be as shown below:
 - 1. Case shall be phenolic plastic.
 - 2. Bourdon tube shall be stainless steel, AISI 316.
 - 3. Windows shall be acrylic plastic.
 - 4. Ring shall be stainless steel.
 - 5. Stem shall be stainless steel.
 - 6. Dial face shall be aluminum with clear baked on acrylic coating, 6061-T6, ASTM B 209.

2.4 DIAPHRAGM SEAL

- A. Diaphragm seal shall isolate pressure gauge from corrosive liquids. Bottom housing shall be PVC, diaphragm material shall be Teflon. Diaphragm seal shall be rated as continuous duty. Unit shall be capsule type which will allow the diaphragm to be replaced. Filling fluid shall be Halocarbon.

PART 3 EXECUTION

3.1 INSTALLATION

- A. Gauges and pulsation dampeners shall be installed at the locations indicated on the drawings. Install per details on drawings.
- B. Install diaphragm seals on all chemical feed line applications.
- C. Unless otherwise specified herein, direct tapping of pipe walls for installation of gauge connections will

not be permitted.

- D. All gauges and diaphragm seals shall be installed in the vertical upright position. Teflon thread tape or Teflon thread sealer, as specified in the miscellaneous piping section, shall be used in the assembly of threaded connections. All connections shall be free from leaks.

END OF SECTION

PAGE INTENTIONALLY LEFT BLANK

SECTION 465104
ALUM SUPPLY SYSTEM

PART 1 – GENERAL

1.1 SUMMARY

- A. This section covers installation of the contractor furnished Alum Supply System that includes chemical metering pump w/integral controller; pump support table; 50-gallon mix tank with bulk head fitting and ridged suction drop pipe; polymer dilution panel with static mixer, pressure gauge rotameter, 3/4" solenoid valve, pressure reducing valve, globe style flow and stop valve; and appurtenances required for the polymer feed system. The Contractor shall install the Contractor Furnished system.
- B. The Contractor will be directly responsible for installing the contractor furnished effluent flow meter (as specified in Section 407100). The flow meter shall include a contact card that will detect minimum flow setting being reached and send discrete signal to a Contractor supplied relay in a box that will power a Contractor supplied duplex receptacle to supply power for the aluminum sulfate feed pump. The effluent flow meter will send this discrete signal to the relay in a box, a 4-20 mA analogue signal representing the flow rate to the aluminum sulfate pump, and a 4-20 mA analogue signal representing the flow rate to the owner furnished Remote Monitoring system. The Contractor is required to route conduit, wire and cables as required to supply power and communication for the installation of the aluminum sulfate supply system.

1.2 SUBMITTALS

- A. Submit Shop Drawings in accordance with Section 013300.
- B. Submit dimensional layouts and mounting and installation details for each pump model and appurtenances that make up the Polymer feed system.
- C. Submit manufacturer's catalog data, descriptive literature, and detailed drawings for each item, describing materials of construction (including specification, grade, type, etc.), settings at the specified flow, and speed reducer construction. Identify each system component by tag number where appropriate to which the catalog data and detail sheets pertain. Show pump and appurtenance design criteria, if applicable. Submit information on chemical compatibility with chemicals being pumped. Show coatings.

1.3 MANUFACTURER'S SERVICES

- A. Installation shall include Brooks & Associates directly procuring startup and commissioning assistance from the pump supplier beyond what is included in the contract between supplier and Owner, as required.

PART 2 MATERIALS

2.1 GENERAL

- A. Products relevant to this section will be furnished and installed by the contractor.

PART 3 EXECUTION

3.1 EQUIPMENT INSTALLATION

- A. Pump assemblies and related equipment shall be installed as indicated on the drawings and in accordance with the manufacturer's recommendations. Provide the manufacturer's recommended lubricants for each piece of equipment.

3.2 PAINTING AND COATING

- A. Coat all metal components at the factory with manufacturer's standard coating. Touch up after installation.

3.3 STARTUP SERVICES

- A. The Contractor shall coordinate with the operators in the performance of the initial start-up of the aluminum sulfate feed system. Equipment supplier will directly provide installation and operational guidance to Owner and Contractor remotely.

END OF SECTION

PAGE INTENTIONALLY LEFT BLANK

SECTION 460529
BLOWERS AND BLOWER CONTROLS

PART 1 GENERAL

1.1 SECTION INCLUDES

- A. Installation of Owner Furnished Blowers for aeration air supply and Blower Controls.
- B. Delaplain Disposal: The Blower and Blower Control systems shall include Blowers BLWR-231 & BLWR 232. Control panel shall include VFDs, cooling fans, circuit protection, ON/OFF switches, and run lights. These items shall be supplied by FPZ.
- C. Each blower shall be supplied with a check valve and a pressure relief valve, shipped loose for installation by Contractor. Note that the plans do not show the check valve or relief valve, but each of these shall be installed by Contractor, and spatial provisions were made in Plans to accommodate the addition of these items.
- G. The Contractor will be directly responsible for providing and installing all items not listed above for complete blower and blower control systems, including but not limited to the blower equipment pads, downstream process air vibration isolators, isolation valves, piping and appurtenances, communications conduit and cables routed to Remote Monitoring controls, site work, electrical distribution, etc. Installation shall include the Contractor directly performing startup and commissioning of the blowers and blower controls and coordinating remotely with the Blower and Blower Controls supplier (FPZ) and Engineer.

1.2 REFERENCE STANDARDS

- A. ABMA STD 9 - Load Ratings and Fatigue Life for Ball Bearings; 1990 (Reapproved 2008).
- B. ABMA STD 11 - Load Ratings and Fatigue Life for Roller Bearings; 1990 (Reapproved 2008).
- C. ANSI/AGMA 6011 - Specifications for High Speed Helical Gear Units; 2014.
- D. ASHRAE Std 52.2 - Method of Testing General Ventilation Air-Cleaning Devices for Removal Efficiency by Particle Size; 2012.
- E. ASME B16.1 - Gray Iron Pipe Flanges and Flanged Fittings; 2010.
- F. ASME B40.100 - Pressure Gauges and Gauge Attachments; 2013.
- G. NEMA ICS 1 - Industrial Control and Systems: General Requirements; 2005 (R2008).
- H. NEMA MG 1 - Motors and Generators; 2011.

PART 2 PRODUCTS

2.1 GENERAL

- A. Products relevant to this section will be Owner furnished for installation by Contractor.

PART 3 EXECUTION

3.1 INSTALLATION

- A. All equipment shall be installed in accordance with acceptable procedures submitted with the shop drawings, manufacturer's instructions and installation manual and as indicated on the Drawings and specified herein, unless otherwise accepted by the Engineer.
- B. Install equipment in accordance with manufacturer's instructions.
- C. Provide the services of manufacturer's technical representative to supervise installation, adjustment, demonstration, testing, and startup.
- D. Anchor blower/motor bases to foundations per supplier recommendations.

3.2 FIELD QUALITY CONTROL - PRIOR TO STARTUP

- A. After air distribution and diffusion systems have been installed, Contractor shall demonstrate of proper operation of each blower at specified operating conditions

3.3 ELECTRICAL/CONTROL SYSTEMS.

- A. Electrical equipment shall be of the type and quality set forth herein and in accordance with Division 26. Items of equipment installed inside the control panel shall be arranged as shown on the drawings and as specified.
- B. All work shall be performed and all materials shall be in accordance with the National Electrical Code, the National Electrical Safety Code, and applicable local regulations and ordinances. Where required by applicable codes, materials and equipment shall be listed by Underwriters' Laboratories or other testing organization acceptable to the governing authority.

3.4 START UP SERVICE

- A. The Owner-supplier agreement DOES NOT require blower system supplier to provide the services of a factory-trained representative to perform initial start-up of the blowers and blower controls and to instruct the Owner's operating personnel in the operation and maintenance of the equipment provided by them. Contractor shall coordinate with Engineer and manufacturer remotely during installation, startup and commissioning as required.

END OF SECTION

SECTION 465103

AIR DIFFUSERS

PART 1 GENERAL

1.1 SECTION INCLUDES

- A. Installation of Owner Furnished air diffuser, air distribution, and diffusion system for:
 - 1. Pre-Aeration. (NOT USED)
 - 2. IFAS treatment tanks
- B. Air diffusers, in basin drop pipe, in basin air header, and in basin laterals.
- C. In basin air distribution piping and diffuser supports and accessories.
- D. The Contractor will be directly responsible for providing and installing all items not listed above for air diffuser systems, including but not limited to the diffuser pipe supports (to result in top of diffusers being set no more than 9-inches above floor slab), piping between the blowers and drop pipes, the isolation valves upstream of the drop pipes, the tank improvements and accessories, earthwork, etc. Installation shall include the Contractor directly performing startup and coordinating with Engineer, diffuser and aerator supplier, and blower and blower controls supplier to discuss the requirements for installation, startup and commissioning.

PART 2 PRODUCTS

2.1 GENERAL

- A. Products relevant to this section will be Owner furnished for installation by Contractor. Information on the products being Owner Furnished will be provided in Appendices.

PART 3 EXECUTION

3.1 INSTALLATION

- A. Install in accordance with Engineer approved procedures, approved shop drawings, diffuser supplier's written instructions, and as indicated on the Drawings.

3.2 FIELD QUALITY CONTROL - PRIOR TO STARTUP

- A. Piping System: Test with air at minimum of two times normal design pressure; apply pressure and hold for at least 60 minutes without leakage.
- B. In-Tank Diffusers: Test by filling tank with water to depth of approximately two feet (600 mm) above top of diffusers, and:
 - 1. Apply air at design pressure.
 - 2. Inspect diffusers for proper operation and uniformity of diffusion.
 - 3. Adjust diffusers as required for uniform diffusion.
- D. Replace diffusers that cannot be sufficiently adjusted.

END OF SECTION

PAGE INTENTIONALLY LEFT BLANK

**SECTION 466124
CLOTH MEDIA DISK FILTER**

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Furnish all labor, materials, equipment and incidentals required for automatic backwash filter system as shown on the plans and as specified herein, installed, tested and ready for operation.
- B. Each Cloth Media Disk Filter shall consist of individual disks of the number required; support columns and frames, a centrally located rotating shaft with vacuum shoe assemblies mounted thereto, 316 stainless steel swivel joints, filtrate pipes, drive mechanism complete with sprockets and non-metallic drive chain, automatic Allen Bradley MicroLogix 1400 PLC control panel with 10" color touch screen.
- C. Filter system, including the stainless steel tank, shall be designed for installation as shown on the contract drawings/plans.

1.02 MEASUREMENT AND PAYMENT

- A. No separate payment will be made for work required under this section. Contractor will include all costs of the requirements of this section in the appropriate bid item(s) on the bid form.

1.03 QUALITY ASSURANCE

- A. Applicable Standards
 - 1. ASTM - American Society for Testing and Materials
 - 2. AISI - American Iron and Steel Institute
 - 3. AGMA - American Gear Manufacturer's Association
 - 4. NEMA - National Electrical Manufacturer's Association
 - 5. NEC - National Electrical Code
- B. To assure unity of responsibility, all components of the disk filter system shall be supplied by a single manufacturer.
- C. Acceptable Manufacturer:
 - 1. Aqua-Aerobic Systems, INC.
 - 2. Pre-Approved Equal

1.04 SUBMITTALS

- A. Submit shop drawings in accordance with the General Provisions, General Conditions, and Section 013300.
- B. Submit dimensioned, to-scale drawings of equipment showing its proposed installation in this facility. Where piping, structural components, etc. are involved, drawings shall show clearly that the proposed equipment will fit into the plant design without significant modifications and will function as intended in conjunction with other plant items. Modifications to plant structures, piping, electrical, etc. shall be made at the Contractor's expense and only after approval by the Engineer.
- C. Information required for approval by the Engineer prior to incorporation into the project shall include the following as a minimum requirement:
 - 1. Certified dimension prints detailing all required anchor bolt locations and conduit stub-outs. Submit dimensioned to-scale drawings showing installation of screening equipment for this specific application.
 - 2. Specifications for all electrical and mechanical components and complete wiring diagrams for all components.
 - 3. Manufacturer's recommended procedures for jobsite storage and handling of equipment.

1.05 OPERATION AND MAINTENANCE MANUALS:

- A. Prior to delivery of equipment and updated as required during installation of the equipment, the manufacturer shall furnish complete and detailed installation, operation and maintenance manuals which shall include the following information as a minimum requirement:
 1. Assembly, installation and adjustment instructions.
 2. Lubrication and maintenance instructions.
 3. Complete descriptive literature of all materials and components furnished.
 4. Erection drawings with equipment mark numbers.
 5. Complete operating instructions for controlling, modifying, and operating the equipment provided for this facility.

1.06 PERFORMANCE REQUIREMENTS

- A. The disk filter system shall be capable of meeting the following performance requirements while receiving treated domestic wastewater from an IFAS unit:

PERFORMANCE CRITERIA	VALUE
Design Daily Flowrate	240,000 gpd
Design Peak Daily Flowrate	720,000 gpd
Maximum Influent TSS, mg/L	225
Average Influent TSS, mg/L	< 40
Average Effluent Suspended Solids TSS, mg/L	< 5
FILTER DESIGN DATA	
Filter Cloth Material	Polyester, multi-layer
Number of Filter Units	1
Number of Filter disk per unit	10
Filter Disk Diameter, ft.	7
Effective Filter Surface Area per disk, ft ²	72 minimum
Effective Filter Surface Area per unit, ft ²	720
Backwash Arm Rotational Speed, RPM	1.1
Materials of Construction	304 SS and plastics
FILTER DRIVE UNIT	
Drive Motor (1 per unit)	0.50 HP, 460v, 3 phase
Drive Motor Service Factor	1.3
	Drive Assembly
	Parallel Helical Gear
	w/Non-Metallic
	Chain and Sprocket
BACKWASH CLEANING SYSTEM	
Number of Backwash Vacuum Shoes per Disk	2
Backwash Pumps (2 per unit)	2 HP, 460v, 3 phase
Backwash Flowrate, gpm	550
Backwash Flow, % of Influent	< 2% @ PDF

- B. The automatic backwash disk filter system shall be suitable for filtering domestic wastewater after conventional treatment. Each filter shall be designed to operate on a continuous basis at Peak Flow Rate and shall be designed to operate while receiving varying flow rates.
- C. Each disk shall be isolatable, one from the other. Each disk shall be removable without dewatering the filter tank or taking unit out of service.
- D. Cloth media disk filter must provide for redundancy by accommodating 100% of Peak Flow with one disk out of service while continuing to meet effluent quality requirements.
- E. Cloth media disk filter must be certified under CA Title 22 Reuse Standards as listed in the Treatment Technology Report for Recycled Water dated December 2009 that lists all acceptable manufacturers who have achieved "Title 22" quality certification.

1.07 EXPERIENCE

- A. It is desired that ONLY equipment which has undergone thorough development as provided by successful service in at least 50 similar installations for a minimum of 10 years shall be accepted for this project. Manufacturers who do not meet the experience requirements shall not be acceptable. Bonds or cash deposits are not an option in lieu of experience.

PART 2 PRODUCTS

201 MATERIALS

- A. All welding shall conform to the latest standards of the American Welding Society. Filter cloth shall be multi-layered polyester bags with seal arrangements to allow for easy removal and installation. Cloth media that requires bolting to hold it in place is unacceptable and is not allowed. Filter cloth support grid shall be non-metallic and have a deflection of less than 0.25 inches over the entire 7 foot span of the disk.

202 EQUIPMENT

- A. Filter Tank
 1. The filter tank shall be constructed of a minimum 3/16" thick 304 stainless steel.
 2. All structural shapes shall be designed for the intended use and of adequate strengths to withstand all loads during fabrication, shipping and operations.
 3. The filter tank shall incorporate one (1) 12" inlet nozzle with an influent trough designed to evenly distribute the flow across the width or length of the filter tank.
 4. The filter tank shall incorporate one (1) 12" effluent nozzle connected to a filtrate trough designed to remove the entire flow of the filter tank.
 5. The filter tank shall incorporate one (1) 12" outlet nozzle connected to one (1) trough for emergency bypass or overflow. This nozzle is designed to re-direct any excess flow that may occur due to increase flow rate above the Peak Design Flow indicated above.
 6. The filter tank shall incorporate one (1) 6" backwash nozzles connected to a center rotating backwash manifold within the tank. The backwash manifold shall be constructed of 304 stainless steel. Each end of the center rotating backwash manifold shall be connected to a 316 stainless steel swivel joint with double row ball bearing race design bearing designed for submerged service. The filter tank shall incorporate a drain/sludge removal port with a minimum 3" nozzle. Inside the tank shall be a perforated drain pipe sized adequately and designed to evenly remove settled sludge from the filter tank.
- B. Filter Disk
 1. The filter disk frame shall be constructed entirely from Type 304 stainless steel as an integral unit completely welded and supported for all operating and installation loads.
 2. Each disk shall have grid support structure incorporated into the disk frame and it shall be designed to secure the grid in place and minimize wear to the filter cloth bags.
 3. Each disk shall have a single top mounted effluent pipe adequately sized for the application and shall include a lifting eye for easy removal and placement of the ONE PIECE disk assembly.
 4. Each disk shall be attached to the effluent trough independently to allow disk isolation. Only one wall connection point per disk shall be allowed. The disk filter design shall insure the ability to sample filtrate from each disk independently. Each disk shall have a knife gate valve for complete isolation and shutoff while the disk is removed from an operating filter.
- C. Support Frame
 1. Each disk shall be secured in place in the filter tank by a 304 stainless steel frame. The cassette frame shall be designed to withstand all loads of the disk and the rotating shaft assembly.
 2. The frame designed to maintain the disk location in the center of the filter tank and directly above the rotating backwash manifold assembly.
 3. Each vertical frame member shall be flared 15 degrees to minimize damage to the filter disk and cloth as it is being installed and removed from the frame.

D. Rotating Backwash Assembly

1. Each filter unit shall incorporate a centrally located rotating backwash manifold that will operate as the rotating mechanism for the vacuum shoe assembly and also act as the transmission pipe for the backwash water being drawn by the backwash pumps located externally to the filter tank.
2. The center shaft/backwash manifold shall be constructed from 304 stainless steel pipe.
3. The center shaft shall be supported and secured on each end. Each end of the center rotating backwash manifold shall be connected to a 316 stainless steel swivel joint with double row ball bearing race design bearing designed for submerged service.
4. The backwash manifold / rotating shaft is welded to a sprocket hub constructed of 304 stainless steel with a UHMW split-ring sprocket designed for the rotational speed requirements of the application.
5. Each vacuum shoe (two for each filter disk) shall be adjustable to ensure that the shoe is parallel to the disk face. The system shall incorporate a torsion spring/pivoting mechanism designed to maintain the proper tolerance of the vacuum shoe disk interface. The filter backwash shoe shall not contact with the cloth media except at each end of each shoe. Direct contact within the "Suction Zone" is strictly prohibited and will not be allowed.
6. Each vacuum shoe assembly shall be located 180 degrees from the shoe on the opposite side of the same disk.
7. Filter designs that utilize a horizontal vacuum tube, coupled to a 4-point lifting device to vertically raise and lower the backwash header is not acceptable. With no adjustment between the backwash manifold and the cloth media surface, damage may occur to the cloth or uncontrolled wear will occur making this design unacceptable. Designs that incorporate reversed gravity flow and compressed air to backwash the cloth are unproven and unacceptable.

E. Swivel Joints

1. The swivel joints shall be designed to allow rotation of the backwash assembly and center shaft during the backwash cycle.
2. Construction of the swivel joint shall be 316 stainless steel with a double row ball bearing race design bearing designed for submerged service. Stainless steel shafts shall be precision ground with the machined bearing to insure a precise tolerance.

F. Drive Mechanism

1. The drive assembly shall be designed to rotate the backwash assembly and center shaft during the backwash cycle.
2. The drive assembly shall consist of a parallel helical gear drive unit coupled to the shaft with a non-metallic sprocket and a nylon chain assembly with stainless steel pins.
3. The gear motor shall be a SEW Eurodrive gearbox directly coupled to a TEFC induction motor, SEW Model K87R57DRS71S4. Gear ratio to be 615.0. The motor shall be rated for 0.33 HP, 230v, 1-phase, 60Hz. operation.
4. Reducer design end rating shall be equal or exceed AGMA requirements. Speed reducer shall be selected for not more than AGMA class I service.
5. Drive chain shall be NH78 non-metallic with stainless steel pins
6. Drive sprocket shall be a NH78, 11 tooth shear pin sprocket assembly, 9.26 inch P.D., nylon body with UHMW segmental rim, 304 stainless steel hardware and 6061 aluminum shear pins.
7. Reduction sprocket shall be a NH78, 30 tooth segmental sprocket rim, split UHMW.
8. The drive motor assembly shall be mounted on a 304 stainless steel motor bracket that incorporates adjustable placement capabilities and a removable chain guard.
9. Units that incorporate a 4-point vertical lifting design are not acceptable.

G. Control Panel and Operation

1. The disk filter shall have its' own control system and shall be supplied by the disk filter manufacturer and shall included but not be limited to the following components:

- a. 36" x 30" x 12" NEMA 4X "UL Listed" 304 stainless steel wall mounted enclosure with 3-point latching.
 - b. NEMA motor starter with over-current protective devices and overloads
 - c. Selector switches and pilot lights
 - d. Door mounted circuit breaker
 - e. Magnetic circuit breakers
 - f. Power transformer
 - g. Stirring fan
 - h. 20 amp quad receptacle
 - i. Allen-Bradley MicroLogix 1400 PLC with Maple Systems 10" touch screen
 - j. Submersible liquid level transmitter
2. The automatic controls for the disk filter operation shall be furnished as an integral part and shall be provided in a NEMA 4X 316 stainless steel enclosure with 3-point latching. The control panel shall be 460v, 3-phase, 60 Hz. with 120v, 1 phase, 60 Hz. control voltage.
 3. The main disconnect shall be enclosed in the control panel, with a handle mechanism extending through the door.
 4. The backwash cycle is initiated by the level transmitter located in the filter tank. The filter drive unit and the backwash pumps are activated, and an electric actuated valve opens to begin backwashing the filter. After a pre-set time has elapsed, the backwash valve closes; if the water level (headloss) has been reduced; then the system shuts down the backwash system; if not then the system will repeat the sequence until the water level (headloss) is reduced to an acceptable level.
 5. The panel operational sequence shall include a sludge draw-off adjustable timer. This timer shall be pre-set and field adjustable from the control panel OIT.
 6. All pre-set timers shall be adjustable at the control panel OIT.
 7. The control panel shall incorporate a complete manual override system and all switches, lights and necessary components shall be furnished.
 8. The contractor is responsible for all field wiring and interconnecting conduit between the supplied control panel and the disk filter equipment. The filter supplier shall provide all necessary diagrams and schematics for a complete system.
- H. Backwash Pumps
1. The backwash pump(s) shall be Gorman-Rupp or WEMCO Wehr self-priming centrifugal pumps mounted on a fabricated steel base and coupled to a 3 HP, 1800 RPM, 230/1/60, TEFC Electric Motor.
 2. Design duty condition: 550 GPM @ 15' TDH
 3. Pump shall handle 3" solids.
 4. Pumps shall have 6" suction and 6" discharge flanges.
 5. Pumps shall be provided with a 5 year manufactures warranty.
- I. Automatic Backwash Control Valves
1. The backwash valves shall be Bray Series FT15/FT30 flanged style Electric Actuated Fully-Ported Ball Valves.
 2. Valves shall be 115 VAC operated and controlled by the PLC.
 3. Valves shall have manual override and position indicator.
 4. Valves shall be UL Listed and housed in a NEMA 4/4X enclosure and be permanently lubricated with a mechanical brake.
 5. Valves shall move from fully closed to fully open in 25 seconds and have a stall torque of 300 in-lb. with a 25% duty cycle. Thermal overloads shall be included.
- J. Manual Isolation Valves (Backwash Pumps)
1. The manual backwash valves shall be Bray Series FT15/FT30 flanged style Fully-Ported Ball Valves.
 2. Valves shall be rated for 150 psi.
 3. Valves shall have stainless steel shaft and shall be blow-out proof.

- K. Spare Parts
 - 1. Four (4) shear pins for drive sprocket assembly
 - 2. One (1) Swivel joint repair kit for each swivel provided.
 - 3. Four (4) filter cloths, each to cover 100% of a one piece filter disk

PART 3 EXECUTION

301 INSTALLATION

- A. General
 - 1. Install the disk filter system per the manufacturer's directions and the drawings. Provide all supports and anchoring device required to install the disk filter unit. The Equipment Manufacturer will provide adequate crating and protection of the disk filter equipment for shipment to the project site.
 - 2. Installation Instructions will be provided that specifically outline installation of the equipment.
 - 3. Lifting instructions will be provided to assist the installing contractor.
- B. Field Services: The equipment manufacturer shall furnish the service of a factory-trained representative for three (3) working days and one (1) trip.
- C. Warranty: The equipment shall materially conform to the description in this Specification and the Contract Documentation and shall be free from defects in material and workmanship. Warranty periods are 2 years from final acceptance.

END OF SECTION

PAGE INTENTIONALLY LEFT BLANK