

**COMMONWEALTH OF KENTUCKY**  
**BEFORE THE PUBLIC SERVICE COMMISSION**

In the Matter of:

AN ELECTRONIC EXAMINATION OF THE	)	
APPLICATION OF THE FUEL ADJUSTMENT	)	
CLAUSE OF KENTUCKY POWER COMPANY	)	Case No. 2023-00008
FROM NOVEMBER 1, 2020 THROUGH	)	
OCTOBER 31, 2022	)	

**DIRECT TESTIMONY OF**  
**DOUGLAS J. ROSENBERGER**  
**ON BEHALF OF KENTUCKY POWER COMPANY**

**DIRECT TESTIMONY OF  
DOUGLAS J. ROSENBERGER ON BEHALF OF  
KENTUCKY POWER COMPANY  
BEFORE THE PUBLIC SERVICE COMMISSION OF KENTUCKY**

**CASE NO. 2023-00008**

**TABLE OF CONTENTS**

<b><u>SECTION</u></b>	<b><u>PAGE</u></b>
I. INTRODUCTION .....	1
II. BACKGROUND .....	1
III. PURPOSE OF TESTIMONY .....	2
IV. MITCHELL EXTENDED PLANNED AND MAINTENANCE OUTAGES .....	2
V. COAL CONSUMPTION DURING RESERVE SHUTDOWN .....	9
VI. CONCLUSION.....	9

**DIRECT TESTIMONY OF  
DOUGLAS J. ROSENBERGER ON BEHALF OF  
KENTUCKY POWER COMPANY  
BEFORE THE PUBLIC SERVICE COMMISSION OF KENTUCKY**

**CASE NO. 2023-00008**

**I. INTRODUCTION**

1 **Q. PLEASE STATE YOUR NAME, POSITION, AND BUSINESS ADDRESS.**

2 A. My name is Douglas J. Rosenberger and my business address is Mitchell Generating  
3 Station, 8999 Energy Road, Moundsville, WV 26041. I am the Plant Manager at the  
4 Mitchell Generating Station for Wheeling Power Company (“Wheeling Power”) and  
5 Kentucky Power Company (“Kentucky Power” or the “Company”). Wheeling Power and  
6 Kentucky Power are wholly-owned subsidiaries of American Electric Power Company,  
7 Inc. (“AEP”).

**II. BACKGROUND**

8 **Q. PLEASE DESCRIBE YOUR EDUCATIONAL AND PROFESSIONAL**  
9 **BACKGROUND.**

10 A. I hold a Bachelor of Science in Electrical Engineering from Rose-Hulman Institute of  
11 Technology and have been employed with AEP for 31 years. I have worked at various  
12 power plants across the AEP system as an Engineer, Maintenance Supervisor, Process  
13 Owner, Maintenance Superintendent, Operations Superintendent and Plant Manager.

14 **Q. WHAT ARE YOUR PRINCIPAL AREAS OF RESPONSIBILITY WITH**  
15 **KENTUCKY POWER?**

16 A. As Plant Manager I am responsible for the safe, reliable and economic operation of the  
17 Mitchell Generating Station. Specifically, I plan, organize, coordinate, direct, and control  
18 plant activities, including the operations, maintenance, engineering and construction

1 activities of the plant facilities. I also oversee plant budgets and interface with other AEP  
2 functional groups such as accounting, regulatory, and commercial operations to ensure the  
3 needs of the generation station are met.

4 **Q. HAVE YOU PREVIOUSLY TESTIFIED IN ANY REGULATORY**  
5 **PROCEEDINGS?**

6 A. Yes. I have previously testified before the Public Service Commission of Kentucky  
7 ("Commission") in Kentucky Power's previous two-year fuel adjustment clause hearing  
8 (Case No. 2021-00053), and sponsored discovery responses in the Company's last seven  
9 fuel adjustment clause cases (Case Nos. 2022-00263, 2022-00036, 2021-00292, 2021-  
10 00053, 2020-00245, 2020-00004, and 2019-00226).

### **III. PURPOSE OF TESTIMONY**

11 **Q. WHAT IS THE PURPOSE OF YOUR TESTIMONY IN THIS PROCEEDING?**

12 A. My testimony lists and describes any Planned or Maintenance Outages that lasted longer  
13 than the original estimated end time during the Review Period of November 1, 2020 to  
14 October 31, 2022. Further, I will discuss the actions taken by Kentucky Power to address  
15 and remedy the factors that extended the outages, and to minimize each extension duration.

### **IV. MITCHELL EXTENDED PLANNED AND MAINTENANCE OUTAGES**

16 **Q. PLEASE DESCRIBE KENTUCKY POWER'S PRACTICES GENERALLY WITH**  
17 **RESPECT TO OPERATING AND MAINTAINING THE MITCHELL PLANT.**

18 A. The Company utilizes a robust inspection and Circular Letter Program established by  
19 American Electric Power's Corporate Engineering Group. The Circular Letter Program  
20 is a very detailed, written set of requirements and recommendations for how to operate  
21 and maintain each generating unit focusing on critical equipment. Each generating plant

1 strongly adheres to the Circular Letter Program and is audited to ensure adherence. The  
2 Circular Letter Program, for example, spells out required inspection and replacement  
3 intervals for critical equipment based on industry standards, Original Equipment  
4 Manufacturer's recommendations, and past experience and expertise. This enables the  
5 generating plants to plan several years in advance for planned outage scopes to maintain  
6 or improve generating unit availability.

7 The Company's inspection and maintenance practices allow for not only known  
8 issues to be addressed and resolved, but also for discovery of potential issues not  
9 previously known. The nature of the operation of generating units brings occasional  
10 mechanical issues and the sooner the issues are discovered the better the Company can  
11 resolve them in a timely manner.

12 **Q. PLEASE EXPLAIN THE DIFFERENT TYPES OF OUTAGES OR REASONS**  
13 **THAT MAY RESULT IN A UNIT NOT RUNNING.**

14 A. Below are the types of outages that a generating unit can experience:

- 15 • A Planned Outage is an outage lasting several weeks to perform work on major  
16 equipment groups that is not promptly required for the safe operation of the  
17 unit. Planned Outages are scheduled approximately a year in advance and the  
18 dates of the Planned Outages are approved by PJM.
- 19 • In a Reserve Shutdown Outage the unit is available for generation, but it is placed  
20 in stand-by status by PJM because the generation is not needed on the grid at that  
21 time.
- 22 • Maintenance Outages are shorter in duration (seven to ten days) than Planned  
23 Outages and involve emerging issues that typically must be addressed before the  
24 next Planned Outage.
- 25 • A Forced Outage is an unplanned outage needed to address an immediate  
26 operational or safety concern at the generation facility. Forced Outages typically  
27 last from a few hours to several days depending on the situation.

1 Planned Outages and Maintenance Outages are required to maintain the generating units  
 2 to ensure the units operate safely, efficiently and prevent issues from causing forced  
 3 outages or de-rates during times when the units are economic.

4 **Q. PLEASE LIST THE PLANNED OR MAINTENANCE OUTAGES THAT WERE**  
 5 **EXTENDED BEYOND THE ORIGINAL ESTIMATED END DATE DURING THE**  
 6 **REVIEW PERIOD.**

7 A. Mitchell Plant had three Planned and six Maintenance Outages that were extended beyond  
 8 the original estimated end date during the Review Period. They are listed in Table DJR-1  
 9 below with the original planned dates and the actual dates after the extension.

**Table DJR-1**  
**Mitchell Maintenance & Planned Outages Extended During Reporting Period**

Outage Number	Unit	Outage Type	Original Start Date	Original End Date	Original Outage Length (Days)	Actual Start Date	Actual End Date	Actual Outage Length (Days)
1	Mitchell 1	Planned	10/3/2020	11/15/2020	44	10/3/2020	11/22/2020	51
2	Mitchell 1	Planned	10/16/2021	11/21/2021	37	10/16/2021	12/9/2021	55
3	Mitchell 2	Planned	9/10/2022	12/5/2022	87	9/10/2022	12/16/2022	98
4	Mitchell 1	Maintenance	1/23/2021	2/1/2021	9	1/23/2021	2/4/2021	12
5	Mitchell 1	Maintenance	7/16/2021	7/22/2021	5	7/16/2021	7/23/2021	6
6	Mitchell 1	Maintenance	4/15/2022	4/18/2022	3	4/14/2022	4/19/2022	5
7	Mitchell 2	Maintenance	6/26/2021	7/4/2021	8	6/26/2021	7/4/2021	8
8	Mitchell 2	Maintenance	10/22/2021	10/30/2021	7	10/22/2021	11/6/2021	14
9	Mitchell 2	Maintenance	2/20/2022	3/6/2022	14	2/20/2022	3/26/2022	34

10  
 11 **Q. PLEASE DESCRIBE THE REASON OUTAGE NUMBER 1 WAS EXTENDED IN**  
 12 **TABLE DJR-1 ABOVE AND WHAT WAS DONE TO ADDRESS THE**  
 13 **EXTENSION?**

14 A. This Planned Outage was taken to replace the number 11 ID fan regulating hub, inspect  
 15 and repair the boiler, and inspect and repair the electrostatic precipitator. The Planned  
 16 Outage was extended beyond the original end date due to problems that occurred while

1 installing the number 11 induced draft fan regulating hub and actuator. The actuator would  
2 not operate properly after installation. AEP Engineering and Original Equipment  
3 Manufacturer engineering were utilized to assess the problem and quickly develop the plan  
4 to correct. Contractor resources added nightshifts and Sunday shifts where possible to  
5 minimize the extension safely.

6 **Q. PLEASE DESCRIBE THE REASON OUTAGE NUMBER 2 WAS EXTENDED IN**  
7 **TABLE DJR-1 ABOVE AND WHAT WAS DONE TO ADDRESS THE**  
8 **EXTENSION?**

9 A. This Planned Outage was taken to replace the fourth layer of catalyst in the Selective  
10 Catalytic Reduction System (SCR), replace the boiler feed pump rotating element, and  
11 inspect and repair the boiler. The Planned Outage was extended beyond the original end  
12 date due to problems and a significant contractor safety event that occurred during the  
13 catalyst replacement. This project was the critical path of the outage. A critical path for an  
14 outage is the project with the longest duration and that will dictate the length of the outage.  
15 During the delay, manpower loading and work schedules were modified to include  
16 weekends and nights where applicable. AEP Engineering was utilized to assess the  
17 problem found and quickly develop the plan to correct. Contractor resources added Sunday  
18 shifts where possible to minimize the extension safely, in addition to these resources  
19 already working a dayshift and a nightshift six days a week.

20 **Q. PLEASE DESCRIBE THE REASON OUTAGE NUMBER 3 WAS EXTENDED IN**  
21 **TABLE DJR-1 ABOVE AND WHAT WAS DONE TO ADDRESS THE**  
22 **EXTENSION?**

1 A. This Planned Outage was taken to replace the boiler air heater baskets, repair the cooling  
2 tower, replace low pressure turbines A & B, and inspect and repair the boiler. The Planned  
3 Outage was extended beyond the original end date due to problems found inside both air  
4 heaters during planned inspections performed in the outage. The stay plates (critical  
5 components inside the air heaters to hold the air heater baskets in place) were found eroded  
6 beyond repair and had to be completely replaced. Once this problem was found materials  
7 had to be located and procured. During the delay manpower loading and work schedules  
8 were modified to include weekends and nights where applicable. AEP Engineering was  
9 utilized to assess the problem found and quickly develop the plan to correct. Contractor  
10 resources added Sunday shifts where possible to minimize the extension safely.

11 **Q. PLEASE DESCRIBE THE REASON OUTAGE NUMBER 4 WAS EXTENDED IN**  
12 **TABLE DJR-1 ABOVE AND WHAT WAS DONE TO ADDRESS THE**  
13 **EXTENSION?**

14 A. This Maintenance Outage was taken to locate and repair a condenser tube leak, inspect and  
15 repair the number 11 turbine bearing, inspect and repair the number 16 pulverizer, and  
16 inspect and repair the boiler. The Maintenance Outage was extended beyond the original  
17 end date due to difficulties locating the condenser tube leak and then repairing the leak. A  
18 third-party contractor that utilizes a helium leak detection system was brought in to assist  
19 locating the leak. Once the leak was located, the contractor resources added nightshifts  
20 and Sunday shifts where possible to minimize the extension safely.

21 **Q. PLEASE DESCRIBE THE REASON OUTAGE NUMBER 5 WAS EXTENDED IN**  
22 **TABLE DJR-1 ABOVE AND WHAT WAS DONE TO ADDRESS THE**  
23 **EXTENSION?**



1 A. This Maintenance Outage was taken to repair the number 11 induce draft fan pitch blade  
2 operator, install the number 11A circulating water pump, and inspect and repair the boiler.  
3 The Maintenance Outage was extended beyond the original end date due to the extent of  
4 the problems found with the induced draft fan pitch blade actuator. During inspections and  
5 troubleshooting it was determined the actuator had to be disassembled and rebuilt, which  
6 was not expected. Contractor resources added nightshifts and Sunday shifts where possible  
7 to minimize the extension safely.

8 **Q. PLEASE DESCRIBE THE REASON OUTAGE NUMBER 6 WAS EXTENDED IN**  
9 **TABLE DJR-1 ABOVE AND WHAT WAS DONE TO ADDRESS THE**  
10 **EXTENSION?**

11 A. This Maintenance Outage was taken to inspect and repair the deaerator level control valve,  
12 inspect and repair the boiler, and repair a hydraulic oil leak on the reheat turbine stop valve.  
13 The Maintenance Outage was extended beyond the original end date due to problems found  
14 with the deaerator control valve. During inspections and troubleshooting it was determined  
15 the valve had to be disassembled to repair an internal problem that was not expected.  
16 Contractor resources added nightshifts and Sunday shifts where possible to minimize the  
17 extension safely.

18 **Q. PLEASE DESCRIBE THE REASON OUTAGE NUMBER 7 WAS EXTENDED IN**  
19 **TABLE DJR-1 ABOVE AND WHAT WAS DONE TO ADDRESS THE**  
20 **EXTENSION?**

21 A. This Maintenance Outage was taken to repair the electrostatic precipitator inlet duct and  
22 repair the agitator seal and level probe B on the flue gas desulfurization absorber. The  
23 Maintenance Outage was extended beyond the original end date and time due to repairs to

1 the electrostatic precipitator inlet section structural steel taking longer than estimated by  
2 four hours. The Contractor was already working the most aggressive schedule possible  
3 safely including night shift and weekends.

4 **Q. PLEASE DESCRIBE THE REASON OUTAGE NUMBER 8 WAS EXTENDED IN**  
5 **TABLE DJR-1 ABOVE AND WHAT WAS DONE TO ADDRESS THE**  
6 **EXTENSION?**

7 A. This Maintenance Outage was taken to repair a hydraulic line leak on the turbine number  
8 1 control valve, inspect and repair the boiler, inspect and repair unit motor-operated valve  
9 803, inspect and repair feedwater motor-operated valve 101, and inspect and repair the dry  
10 flyash system. The Maintenance Outage was extended beyond the original end date due to  
11 a hydraulic line leak on the turbine number 1 control valve. The leak was located where  
12 the hydraulic line attaches to the turbine number 1 control valve body. Because this repair  
13 was going to involve working on the valve body itself it required additional engineering  
14 support to develop the repair plan to prevent future failures and potential safety issues.  
15 AEP resources were allocated to minimize the extension safely which included night shift  
16 and weekends.

17 **Q. PLEASE DESCRIBE THE REASON OUTAGE NUMBER 9 WAS EXTENDED IN**  
18 **TABLE DJR-1 ABOVE AND WHAT WAS DONE TO ADDRESS THE**  
19 **EXTENSION?**

20 A. This Maintenance Outage was taken to inspect and repair the electrostatic precipitator,  
21 inspect and repair the boiler, inspect and repair a leak in the deaerator, inspect and repair  
22 several valves, and inspect and repair flue gas desulfurization system. The Maintenance  
23 Outage was extended beyond the original end date due to problems found inside the

1 electrostatic precipitator inlet section. Extensive pluggage (very hard ash built up across  
2 approximately 60% of the electrostatic precipitator inlet section) was found unexpectedly  
3 in the inlet section preventing proper distribution of steam generator exit gas flow across  
4 the electrostatic precipitator. The extensive pluggage was not expected and required  
5 considerable employee hours to remove. Contractor resources added nightshifts and  
6 Sunday shifts where possible to minimize the extension safely.

**V. COAL CONSUMPTION DURING RESERVE SHUTDOWN**

7 **Q. HOW IS COAL CONSUMPTION RECORDED FOR A UNIT THAT IS IN**  
8 **RESERVE SHUTDOWN?**

9 A. When a unit is in reserve shutdown it is not running or in service. Therefore, coal is neither  
10 consumed nor recorded.

**VI. CONCLUSION**

11 **Q. DOES THIS CONCLUDE YOUR DIRECT TESTIMONY?**

12 A. Yes, it does.



### Rosenberger Testimony Verification Form.doc

DocVerify ID: EF2ADCDD-1C48-4D24-863C-10840088A43F  
 Created: September 29, 2023 12:39:11 -8:00  
 Pages: 1  
 Remote Notary: Yes / State: KY


This document is a DocVerify VeriVaulted protected version of the document named above. It was created by a notary or on the behalf of a notary, and it is also a DocVerify E-Sign document, which means this document was created for the purposes of Electronic Signatures and/or Electronic Notary. Tampered or altered documents can be easily verified and validated with the DocVerify veriCheck system. This remote online notarization involved the use of communication technology.

Go to [www.docverify.com](http://www.docverify.com) at any time to verify or validate the authenticity and integrity of this or any other DocVerify VeriVaulted document.

#### E-Signature Summary

**E-Signature 1: Douglas J Rosenberger (DJR)**  
 October 03, 2023 11:08:22 -8:00 [FCE0FB1D5D14] [167.239.221.106]  
 djrosenberger@aep.com (Principal) (Personally Known)

**E-Signature Notary: Marilyn Michelle Caldwell (MMC)**  
 October 03, 2023 11:08:22 -8:00 [1E91E41567F3] [167.239.221.107]  
 mmcaldwell@aep.com  
 I, Marilyn Michelle Caldwell, did witness the participants named above electronically sign this document.

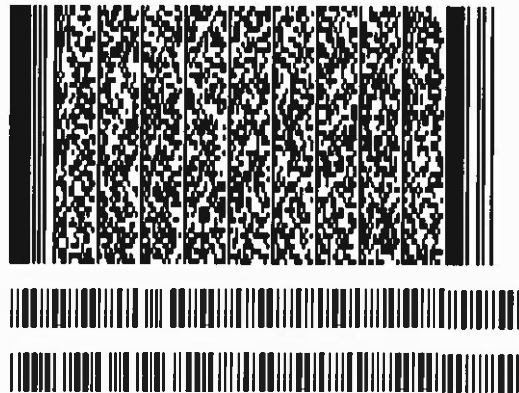

DocVerify documents cannot be altered or tampered with in any way once they are protected by the DocVerify VeriVault System. Best viewed with Adobe Reader or Adobe Acrobat. All visible electronic signatures contained in this document are symbolic representations of the persons signature, and not intended to be an accurate depiction of the persons actual signature as defined by various Acts and or Laws.



VERIFICATION

The undersigned, Douglas J. Rosenberger, being duly sworn, deposes and says he is the Mitchell Plant Manager for Kentucky Power Company, that he has personal knowledge of the matters set forth in the foregoing testimony and the information contained therein is true and correct to the best of his information, knowledge, and belief after reasonable inquiry.

Douglas J Rosenberger  
Signed on 2023 10 03 11:08:22 -0500

Douglas J. Rosenberger

Commonwealth of Kentucky )  
County of Boyd )

Case No. 2023-00008

Subscribed and sworn to before me, a Notary Public in and before said County and State, by Douglas J. Rosenberger, on October 3, 2023

Marilyn Caldwell  
Signed on 2023 10 03 11:08:22 -0500

Notary Public

MARILYN MICHELLE CALDWELL  
ONLINE NOTARY PUBLIC  
STATE AT LARGE KENTUCKY  
Commission # KYNP71841  
My Commission Expires May 05, 2027  
Notary Stamp 2023 10 03 11:08:22 PST

My Commission Expires May 5, 2027 Notarial act performed by audio-visual communication

Notary ID Number KYNP71841

EF2ADCDD-1C48-4D24-863C-10840088A43F ... 2023/09/29 12:39 11 -8:00 ... Remote Notary

