

COMMONWEALTH OF KENTUCKY
BEFORE THE PUBLIC SERVICE COMMISSION

RECEIVED

DEC 10 2008

PUBLIC SERVICE
COMMISSION

In the matter of:

THE APPLICATION OF BULLOCK PEN WATER)
DISTRICT FOR A CERTIFICATE OF PUBLIC)
CONVENIENCE AND NECESSITY TO CONSTRUCT) Case No. 2008-00170
PROPOSED WATERWORKS IMPROVEMENT)
PROJECT AND FOR APPROVAL OF PROPOSED)
PLAN OF FINANCING, INCREASE IN RATES,)
NONRECURRING CHARGES, AND TARIFF)
REVISIONS)


SUPPLEMENTAL INFORMATION RESPONSE

Comes now Bullock Pen Water District ("District") and for its response to the Public Service Commission's ("Commission") request for additional information dated August 28, 2008 states as follows:

1. Pursuant to 807 KAR 5:001 Section 9(2)(b), the District attaches hereto a Permit issued by the Energy and Environment Cabinet, Division of Water issued pursuant to 401 KAR 8:100 approving the Phase VI Engineering Plans.

Respectfully submitted,

BERGER, COX & NIENABER, PSC

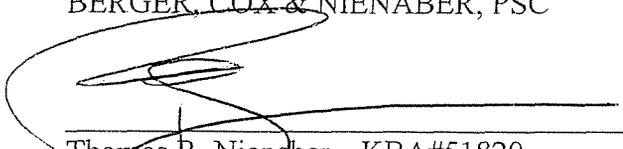


Thomas R. Nienaber - KBA#51820
401 Madison Avenue
Covington, KY 41011
(859) 491-9088

VERIFICATION

Comes now Bullock Pen Water District by and through its Chairman Bobby Burgess and that the statements contained herein are true and correct to the best of his knowledge and belief.


BULLOCK PEN WATER DISTRICT

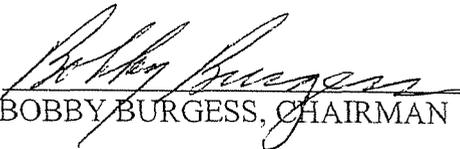BY: 
BOBBY BURGESS, CHAIRMAN

COMMONWEALTH OF KENTUCKY

COUNTY OF GRANT

SUBSCRIBED, SWORN AND ACKNOWLEDGED before by Bobby Burgess, Chairman, Bullock Pen Water District, this 9th day of December, 2008.

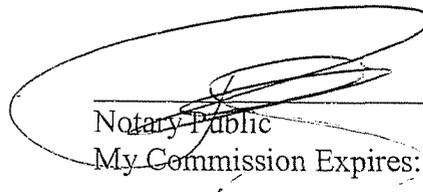
Notary Public
My Commission Expires: 3/24/12

cc: Public Service Commission, Attn: Mr. David R. McDowell
Ms. Stephanie Stumbo, Executive Director
Kentucky Attorney General's Office
Mr. Ryan Gatewood, Filings Division Director



STEVEN L. BESHEAR
GOVERNOR

LEONARD K. DUFFIE
SECRETARY

ENERGY AND ENVIRONMENT CABINET
DEPARTMENT FOR ENVIRONMENTAL PROTECTION
DIVISION OF WATER
200 FAIR OAKS, 4TH FLOOR
FRANKFORT, KENTUCKY 40601
www.kentucky.gov

December 3, 2008

Mr. William L. Catlett, Superintendent
Bullock Pen Water District
PO Box 460
Crittenden, KY 41030

RE: Bullock Pen Water District
AI # 1476, APE20080002
PWSID # 0410047-08-002
Phase 6 Extension Project - SRF
Grant County, KY

Dear Mr. Catlett:

We have reviewed the plans and specifications for the above referenced project. The plans include the construction of approximately 10,140 feet of 12 inch PVC, 38,402 feet of 8 inch PVC, 15,020 feet of 6 inch PVC waterlines and a 20 HP, 709-GPM, 92 TDH Booster Pump Station. This is to advise that plans and specifications for the above referenced project are APPROVED with respect to sanitary features of design, as of this date with the requirements contained in the attached construction permit.

Additionally, your application indicates that the above described project is partially funded by a State Revolving Fund (SRF) Loan and shall meet the following stipulations:


1. This approval is for the technical aspects of this project only. Approval of the SRF aspects of this project will be addressed in a separate letter. You are **NOT** authorized to advertise for bids at this time. We are currently waiting for EPA approval of the Environmental Review Document on this project.
2. If sanitary features of the approved plans are to be changed during construction, the engineer shall submit the revision to the Division of Water for approval prior to implementation of the modification. Written approval from the Division of Water must be granted prior to on-site work dedicated to the adjustment.
3. When this project is completed, the engineer shall submit as-built drawings to the Division of Water.



Phase 6 Extension Project - SRF
AI# 1476, APE20080002
PWSID # 0410047-08-002
December 3, 2008
Page 2 of 2

If you have any questions concerning this project, please contact Mr. Jonathan Reynolds at 502-564-8158 extension 4834.

Sincerely,



Solitha Dharman, PE
Supervisor
Water Infrastructure Branch
Division of Water

SD:JR

Enclosures

C: CMW Engineering
Grant County Health Department
Kenton County Health Department
Public Service Commission
Water Quality
Water Resources
Project Administration Section, RPPS Branch

STEVEN L. BESHEAR
GOVERNOR



LEONARD K. PETERS
SECRETARY

ENERGY AND ENVIRONMENT CABINET
DEPARTMENT FOR ENVIRONMENTAL PROTECTION
DIVISION OF WATER
200 FAIR OAKS, 4TH FLOOR
FRANKFORT, KENTUCKY 40601
www.kentucky.gov

December 3, 2008

Mr. William L Catlett, Superintendent
Bullock Pen Water District
PO Box 460
Crittenden, KY 41030

RE: Bullock Pen Water District
AI # 1476, APE20080002
PWSID # 0410047-08-002
Phase 6 Extension Project - SRF
Grant County, KY

Dear Mr. Catlett:

We have reviewed the plans and specifications for the above referenced project. The plans include the construction of approximately 10,140 feet of 12 inch PVC, 38,402 feet of 8 inch PVC, 15,020 feet of 6 inch PVC waterlines and a 20 HP, 709 GPM, 92 TDH Booster Pump Station. This is to advise that plans and specifications for the above referenced project are APPROVED with respect to sanitary features of design, as of this date with the requirements contained in the attached construction permit.


Additionally, your application indicates that the above described project is partially funded by a State Revolving Fund (SRF) Loan and shall meet the following stipulations:

1. This approval is for the technical aspects of this project only. Approval of the SRF aspects of this project will be addressed in a separate letter. You are **NOT** authorized to advertise for bids at this time. We are currently waiting for EPA approval of the Environmental Review Document on this project.
2. If sanitary features of the approved plans are to be changed during construction, the engineer shall submit the revision to the Division of Water for approval prior to implementation of the modification. Written approval from the Division of Water must be granted prior to on-site work dedicated to the adjustment.
3. When this project is completed, the engineer shall submit as-built drawings to the Division of Water.

Phase 6 Extension Project - SRF
AI# 1476, APE20080002
PWSID # 0410047-08-002
December 3, 2008
Page 2 of 2

If you have any questions concerning this project, please contact Mr. Jonathan Reynolds at 502-564-8158 extension 4834.

Sincerely,



Solitha Dharman, PE
Supervisor
Water Infrastructure Branch
Division of Water

SD:JR

Enclosures

C: CMW Engineering
Grant County Health Department
Kenton County Health Department
Public Service Commission
Water Quality
Water Resources
Project Administration Section, RPPS Branch

Distribution-Major Construction

Bullock Pen Water District

Subject Item Inventory

Activity ID No.: APE20080002

Subject Item Inventory:

| ID | Designation | Description |
|----------|----------------------|---|
| AIOO1476 | | |
| PORT27 | Water lines | 10,140 feet of 12 inch PVC, 38,402 feet of 8 inch PVC, 15,020 feet of 6 inch PVC waterlines |
| PORT28 | Booster Pump Station | 20 HP, 709 GPM, 92 TDH Booster Pump Station |

Subject Item Groups:

| ID | Description | Components |
|--------|---|--|
| GACT28 | 10,140 feet of 12 inch PVC, 38,402 feet of 8 inch PVC, 15,020 feet of 6 inch PVC waterlines and a 20 HP, 709 GPM, 92 TDH Booster Pump Station | PORT28 20 HP, 709 GPM, 92 TDH Booster Pump Station PORT27 10,140 feet of 12 inch PVC, 38,402 feet of 8 inch PVC, 15,020 feet of 6 inch PVC waterlines |

KEY

ACTV = Activity

AREA = Area

EQPT = Equipment

PERS = Personnel

STOR = Storage

AIOO = Agency Interest

COMB = Combustion

MNPT = Monitoring Point

PORT = Transport

STRC = Structure

Distribution-Major Construction
Bullock Pen Water District
Subject Item Inventory

Activity ID No.: APE20080002

KEY

TRMT = Treatment

Distribution-Major Construction

Bullock Pen Water District
Facility Requirements

Activity ID No.: APE20080002

Page 1 of 14

GACT28 (Phase 6 Waterline Ext) 10,140 feet of 12 inch PVC, 38,402 feet of 8 inch PVC, 15,020 feet of 6 inch PVC waterlines and a 20 HP, 709 GPM. 92 TDH Booster Pump Station:
Monitoring Requirements:

| Condition No. | Parameter | Condition |
|---------------|-----------|---|
| M-1 | Coliform | The presence or absence of total Coliform monitored by sampling and analysis as needed shall be determined for the new or relocated water line(s). Take samples at connection points to existing lines, at 1 mile intervals, and at dead ends without omitting any branch of the new or relocated water line. Sample bottles shall be clearly identified as "special" construction tests. [401 KAR 8:100 Section 1(7), 401 KAR 8:150 Section 4, Recommended Standards for Water Works 8.5.6] This requirement is applicable during the following months: All Year. Statistical basis: Instantaneous determination. |
| M-2 | Coliform | The presence or absence of total Coliform monitored by sampling and analysis as needed shall be determined for the new pump(s). If the pump(s) are independent of (not directly connected to) the new or relocated lines, take at least 1 sample at the discharge side pitcock. Otherwise, no additional sampling beyond the sampling required for new or relocated lines shall be required. Sample bottles shall be clearly identified as "special" construction tests. [401 KAR 8:100 Section 1(7)] This requirement is applicable during the following months: All Year. Statistical basis: Instantaneous determination. |

Submittal/Action Requirements:

Coliform:

| Condition No. | Condition |
|---------------|---|
| S-1 | Coliform For new construction projects, the distribution system, using the most expedient method, shall submit Coliform test results to the Cabinet: Due immediately following disinfection and flushing. [401 KAR 8:150 Section 4(2)] |
| S-2 | For proposed changes to the approved plan, submit information: Due prior to any modification to the Cabinet for approval. Changes to the approved plan shall not be implemented without the prior written approval of the Cabinet. [401 KAR 8:100 Section 1(8)] |

Distribution-Major Construction

Bullock Pen Water District
Facility Requirements

Activity ID No.: APE20080002

Page 2 of 14

GACT28 (continued):

Submittal/Action Requirements:

| Condition No. | Condition |
|---------------|---|
| S-3 | The person who presented the plans shall submit the professional engineer's certification: Due when construction is complete to the Division of Water. The certification shall be signed by a registered professional engineer and state that the water project has been constructed and tested in accordance with the approved plans, specifications, and requirements. [401 KAR 8:100 Section 1(8)] |

Narrative Requirements:

Additional Limitations:

| Condition No. | Condition |
|---------------|---|
| T-1 | Additional Limitations: Chlorinated water resulting from disinfection of project components shall be disposed in a manner which will not violate 401 KAR 5:031. [401 KAR 8:020 Section 2(20)] |
| T-2 | This project has been permitted under the provisions of KRS Chapter 224 and regulations promulgated pursuant thereto. Issuance of this permit does not relieve the applicant from the responsibility of obtaining any other approvals, permits or licenses required by this Cabinet and other state, federal and local agencies. Further, this permit does not address the authority of the permittee to provide service to the area to be served. [401 KAR 8:100 Section 1(7)] |
| T-3 | Unless construction of this project is begun within 1 year from the issuance date of this permit, the permit shall expire. If requested prior to the permit expiration, an official extension from the Division of Water may be granted. If this permit expires, the original plans and specifications may be resubmitted for a new comprehensive review. If you have any questions concerning this project, please contact the Drinking Water Branch at 502/564-3410. [401 KAR 8:100 Section 1(9)] |
| T-4 | During construction, a set of approved plans and specification shall be available at the job site at all times. All work shall be performed in accordance with the approved plans and specifications. [401 KAR 8:100 Section 1(7)(a)] |

Distribution-Major Construction

Bullock Pen Water District
Facility Requirements

Activity ID No.: APE20080002

Page 11 of 14

PORT28 (continued):

Narrative Requirements:

Additional Limitations:

| Condition No. | Condition |
|---------------|---|
| T-5 | Additional Limitations: Pumping stations shall be fire and weather resistant. [Recommended Standards for Water Works 6.2.b] |
| T-6 | Additional Limitations: Pumping stations shall have suitable pump gland discharges so that drainage from the glands is not onto the floor. [Recommended Standards for Water Works 6.2.f] |
| T-7 | Additional Limitations: If underground structures are present at pumping stations, they shall be waterproofed. [Recommended Standards for Water Works 6.2.d] |
| T-8 | Additional Limitations: Pumping stations shall have adequate space for the installation of additional pumps. [Recommended Standards for Water Works 6.2.a] |
| T-9 | Additional Limitations: Pumping stations shall have adequate space for the safe servicing of all equipment. [Recommended Standards for Water Works 6.2.a] |
| T-10 | Additional Limitations: Pump stations shall have crane-ways, hoist beams, eyebolts, or other adequate facilities for servicing or removal of pumps, motors or other heavy equipment. [Recommended Standards for Water Works 6.2.2.a] |
| T-11 | Additional Limitations: Pump stations shall have openings as needed for removal of heavy or bulky equipment. [Recommended Standards for Water Works 6.2.2.b] |
| T-12 | Additional Limitations: Pump stations shall have a convenient tool board, or other facilities as needed, for proper maintenance of equipment. [Recommended Standards for Water Works 6.2.2.c] |
| T-13 | Additional Limitations: In areas where excess moisture could cause safety hazards or damage to equipment, dehumidification shall be provided. [401 KAR 8:100 Section 1(7), Recommended Standards for Water Works 6.2.6] |
| T-14 | Additional Limitations: Electrical controls shall be located above grade. [Recommended Standards for Water Works 6.6.5] |

Distribution-Major Construction

Bullock Pen Water District
Facility Requirements

Activity ID No.: APE20080002

Page 12 of 14

PORT28 (continued):

Narrative Requirements:

Additional Limitations:

| Condition No. | Condition |
|---------------|--|
| T-15 | Additional Limitations: All electrical equipment and work shall conform with the applicable state and local electrical codes and the National Electrical Code. [Recommended Standards for Water Works 6.5, Recommended Standards for Water Works 6.2.7] |
| T-16 | Additional Limitations: Pump stations shall be adequately lighted throughout. [Recommended Standards for Water Works 6.2.7] |
| T-17 | Additional Limitations: All automatic pump stations shall be provided with automatic signaling apparatus which will report when the station is out of service. All remote controlled stations shall be electrically operated and controlled and shall have signaling apparatus of proven performance. [Recommended Standards for Water Works 6.5] |
| T-18 | Additional Limitations: Automatic or remote control pump stations shall be located or shall have control devices setup so that the range between start and cutoff pressure prevents excessive pump cycling. [Recommended Standards for Water Works 6.4.d] |
| T-19 | Additional Limitations: Equipment shall be provided or other arrangements made to prevent surge pressures from activating controls which switch on pumps or activate other equipment outside the normal design cycle of operation. [Recommended Standards for Water Works 6.6.5] |
| T-20 | Additional Limitations: Provisions shall be made to prevent energizing the motor in the event of a backspin cycle. [Recommended Standards for Water Works 6.6.5] |
| T-21 | Additional Limitations: Pump stations shall be provided with enough heat to prevent freezing of equipment or treatment processes. [Recommended Standards for Water Works 6.2.4] |
| T-22 | Additional Limitations: Pump stations shall have at least 2 pumps. Pumps shall be sized so that if any single pump is out service, the remaining pump or pumps shall be capable of providing the peak demand on the station. [Recommended Standards for Water Works 6.3, Recommended Standards for Water Works 6.4.1] |
| T-23 | Additional Limitations: Provisions shall be made for pump alternation. [Recommended Standards for Water Works 6.6.5] |

Distribution-Major Construction

Bullock Pen Water District
Facility Requirements

Activity ID No.: APE20080002

Page 13 of 14

PORT28 (continued):

Narrative Requirements:

Additional Limitations:

| Condition No. | Condition |
|---------------|--|
| T-24 | <p>Additional Limitations: Pumps shall</p> <ul style="list-style-type: none">a) have ample capacity to supply the peak demand against the required distribution system pressure without dangerous overloading,b) be driven by prime movers able to meet the maximum horsepower condition of the pumps,c) be provided readily available spare parts and tools, andd) be served by control equipment that is properly protected against temperatures to be encountered. [Recommended Standards for Water Works 6.3] |
| T-25 | <p>Additional Limitations: Pumps, their prime movers and accessories shall be controlled in such a manner that they will operate at rated capacity without dangerous overload. [Recommended Standards for Water Works 6.6.5]</p> |
| T-26 | <p>Additional Limitations: Pump stations shall be located or controlled so that a bypass is available. [Recommended Standards for Water Works 6.4.e]</p> |
| T-27 | <p>Additional Limitations: Pump stations shall contain indicating and totalizing metering of the total water pumped. Each pump shall have</p> <ul style="list-style-type: none">a) a standard pressure gauge on its discharge line andb) a compound gauge on its suction line. <p>Each pump should have a means for measuring the instantaneous volume per time discharge. [401 KAR 8:100 Section 1(7), Recommended Standards for Water Works 6.4.2, Recommended Standards for Water Works 6.6.3]</p> |
| T-28 | <p>Additional Limitations: Pumps shall be adequately valved to permit satisfactory operation, maintenance and repair of the equipment. Each pump shall have a positive-acting check valve on the discharge side between the pump and the shut-off valve. [Recommended Standards for Water Works 6.6.1]</p> |

Distribution-Major Construction

Bullock Pen Water District
Facility Requirements

Activity ID No.: APE20080002

Page 14 of 14

PORT28 (continued):

Narrative Requirements:

Additional Limitations:

| Condition No. | Condition |
|---------------|--|
| T-29 | <p>Additional Limitations: Piping for pumps shall, in general,</p> <ol style="list-style-type: none">1) be designed so that the friction losses will be minimized,2) not be subject to contamination,3) have watertight joints,4) be protected against surge or water hammer,5) be provided with restraints where necessary, and6) a) be such that each pump has an individual suction line or6) b) be manifolded such that the lines insure similar hydraulic and operating conditions. [Recommended Standards for Water Works 6.6.2] |
| T-30 | <p>Additional Limitations: To ensure continuous service when the primary power is interrupted, power supplied to pump stations shall be</p> <ol style="list-style-type: none">a) from at least 2 independent sources orb) from a primary source with a standby or auxiliary source provided. <p>If standby power is provided by onsite generators or engines, the fuel storage and fuel line must be designed to protect the water supply from contamination. [Recommended Standards for Water Works 6.6.6]</p> |

Distribution-Major Construction

Bullock Pen Water District
Facility Requirements

Activity ID No.: APE20080002

Page 3 of 14

PORT27 (Water lines) 10,140 feet of 12 inch PVC, 38,402 feet of 8 inch PVC, 15,020 feet of 6 inch PVC waterlines:

Limitation Requirements:

| Condition No. | Parameter | Condition |
|---------------|-----------|---|
| L-1 | Depth | A continuous and uniform bedding shall be provided in the trench for all buried pipe. Backfill material shall be tamped in layers around the pipe and to a sufficient height above the pipe to adequately support and protect the pipe. Stones found in the trench shall be removed for a Depth ≥ 6 in below the bottom of the pipe. [Recommended Standards for Water Works 8.5.2] This requirement is applicable during the following months: All Year. Statistical basis: Not applicable. |
| L-2 | Depth | All water lines shall be covered to a Depth ≥ 30 in to prevent freezing. [Recommended Standards for Water Works 8.5.3, 401 KAR 8:100 Section 1(7)] This requirement is applicable during the following months: All Year. Statistical basis: Minimum. |
| L-3 | Diameter | All new and existing water lines serving fire hydrants or where fire protection is provided shall have Diameter ≥ 6 in. [Recommended Standards for Water Works 8.1.2] This requirement is applicable during the following months: All Year. Statistical basis: Minimum. |
| L-4 | Distance | Water lines shall have a sufficient quantity of valves so that inconvenience and sanitary hazards will be minimized during repairs. A valve spacing Distance ≤ 800 feet should be utilized in non-commercial districts. Alternatively, non-commercial districts should utilize a valve spacing Distance ≤ 1 block. Commercial districts should utilize a valve spacing Distance ≤ 500 ft. [Recommended Standards for Water Works 8.2] This requirement is applicable during the following months: All Year. Statistical basis: Not applicable. |
| L-5 | Distance | Hydrant drains shall not be connected to sanitary sewers or storm drains and shall be located a Distance > 10 ft from sanitary sewers and storm drains. [Recommended Standards for Water Works 8.3.4] This requirement is applicable during the following months: All Year. Statistical basis: Not applicable. |
| L-6 | Distance | Except when not practical, water lines shall be laid a horizontal Distance ≥ 10 ft from any existing or proposed sewer. The distance shall be measured edge to edge. In cases where it is not practical to maintain a 10 foot separation, water lines may be installed closer to a sewer provided that the water lines shall be laid in a separate trench or on an undisturbed shelf located on one side of the sewer at such an elevation that the bottom of the water line is at least 18 inches above the top of the sewer. [Recommended Standards for Water Works 8.6.2] This requirement is applicable during the following months: All Year. Statistical basis: Not applicable. |

Distribution-Major Construction

Bullock Pen Water District
Facility Requirements

Activity ID No.: APE20080002

PORT27 (continued):

Limitation Requirements:

| Condition No. | Parameter | Condition |
|---------------|-----------------------|---|
| L-7 | Distance | <p>When water lines and sewers cross,</p> <ol style="list-style-type: none"> 1) water lines shall be laid such that either <ol style="list-style-type: none"> a) the the top of the water line is a vertical Distance ≥ 18 in below the bottom of the sewer line or b) the bottom of the water line is a vertical Distance ≥ 18 in above the top of the sewer line, 2) 1 full length of the water pipe shall be located so that both joints of the water pipe will be as far from the sewer as possible, and 3) special structural support for the water and sewer pipes may be required. [Recommended Standards for Water Works 8.6.3] This requirement is applicable during the following months: All Year. Statistical basis: Not applicable. |
| L-8 | Distance | <p>The open end of an air relief pipe from automatic valves shall be extended a Distance ≥ 1.0 ft above grade and provided with a screened, downward-facing elbow. The pipe from a manually operated valve shall be extended to the top of the pit. Use of manual air relief valves is recommended wherever possible. [Recommended Standards for Water Works 8.4.2] This requirement is applicable during the following months: All Year. Statistical basis: Not applicable.</p> |
| L-9 | Pressure | <p>Pipes shall not be installed unless all points of the distribution system remain designed for ground level Pressure ≥ 20 psi under all conditions of flow. [Recommended Standards for Water Works 8.1.1] This requirement is applicable during the following months: All Year. Statistical basis: Minimum.</p> |
| L-10 | Pressure | <p>Pressure ≥ 30 psi must be available on the discharge side of all meters. [401 KAR 8:100 Section 4(2)] This requirement is applicable during the following months: All Year. Statistical basis: Instantaneous determination.</p> |
| L-11 | Residual Disinfection | <p>New or relocated water lines shall be thoroughly disinfected (in accordance with AWWA Standard C651) upon completion of construction and before being placed into service. To disinfect the new or relocated lines use chlorine or chlorine compounds in such amounts as to produce an initial disinfectant concentration of at least 50 ppm and a Residual Disinfection ≥ 25 ppm at the end of 24 hours. Follow the line disinfection with thorough flushing and place the lines into service if, and only if, Coliform monitoring applicable to the line does not show the presence of Coliform.</p> <p>If Coliform is detected, repeat flushing of the line and Coliform monitoring. If Coliform is still detected, repeat disinfection and flushing as if the line has never been disinfected. Continue the described process until monitoring does not show the presence of Coliform. [401 KAR 8:150 Section 4(1), Recommended Standards for Water Works 8.5.6] This requirement is applicable during the following months: All Year. Statistical basis: Minimum.</p> |

Distribution-Major Construction

Bullock Pen Water District
Facility Requirements

Activity ID No.: APE20080002

Page 5 of 14

PORT27 (continued):

Limitation Requirements:

| Condition No. | Parameter | Condition |
|---------------|-----------|--|
| L-12 | Velocity | Each blow-off or fire hydrant shall be sized so that Velocity \geq 2.5 ft/sec can be achieved in the water main served by the blow-off or hydrant during flushing. [Recommended Standards for Water Works 8.1.6.b, 401 KAR 8:100 Section 1(7)] This requirement is applicable during the following months: All Year. Statistical basis: Minimum. |

Monitoring Requirements:

| Condition No. | Parameter | Condition |
|---------------|-----------|---|
| M-1 | leaks | The presence or absence of leaks monitored by physical testing as needed shall be determined in all types of installed pipe. Pressure testing and leakage testing shall be in accordance with the latest edition of AWWA Standard C600. [Recommended Standards for Water Works 8.5.5] This requirement is applicable during the following months: All Year. Statistical basis: Instantaneous determination. |

Narrative Requirements:

Asbestos (Friable):

| Condition No. | Condition |
|---------------|---|
| T-1 | Asbestos (Friable): If the existing water line to be tapped is asbestos concrete, then the contractor shall conform to OSHA regulations governing the handling of hazardous waste during the process of tapping the asbestos concrete line. Pieces of asbestos concrete resulting from the tap shall be double bagged, placed in a rigid container and disposed of in an approved landfill. [401 KAR 8:100 Section 1(7)] |

Distribution-Major Construction

Bullock Pen Water District
Facility Requirements

Activity ID No.: APE20080002

Page 6 of 14

PORT27 (continued):

Narrative Requirements:

Additional Limitations:

| Condition No. | Condition |
|---------------|--|
| T-2 | Additional Limitations: Water line installation shall be in accordance with AWWA standards or manufacturer recommendations. [Recommended Standards for Water Works 8.5.1] |
| T-3 | Additional Limitations: Pipes, fittings, valves and fire hydrants shall conform to the latest standards issued by the AWWA or NSF (if such standards exist). PVC and PE piping used must be certified to ANSI/NSF Standard 61. [Recommended Standards for Water Works 8.0.1] |
| T-4 | Additional Limitations: At high points in water lines, where air can accumulate, provisions shall be made to remove the air by means of hydrants or air relief valves. Automatic air relief valves shall not be used in situations where manhole or chamber flooding may occur. [Recommended Standards for Water Works 8.4.1] |
| T-5 | Additional Limitations: All tees, bends, plugs and hydrants shall be provided with reaction blocking, tie rods or joints designed to prevent movement. [Recommended Standards for Water Works 8.5.4] |
| T-6 | Additional Limitations: A fire hydrant or blow-off shall be required at the end of each dead end line. [Recommended Standards for Water Works 8.1.6] |
| T-7 | Additional Limitations: For each fire hydrant, auxiliary valves shall be installed in the hydrant lead pipe. [Recommended Standards for Water Works 8.3.3] |
| T-8 | Additional Limitations: No flushing device, blow-off, or air relief valve shall be directly connected to any sewer. Chambers, pits or manholes containing valves, blow-offs, meters, or other such appurtenances shall not be directly connected to any storm drain or sanitary sewer. Such chambers, pits or manholes shall be drained to absorptions pits underground or to the surface of the ground where they are not subject to flooding by surface water. [Recommended Standards for Water Works 8.1.6, Recommended Standards for Water Works 8.4.3] |
| T-9 | Additional Limitations: If water lines are installed or replaced in areas of organic contamination or in areas within 200 ft of underground or petroleum storage tanks, ductile iron or other nonpermeable materials shall be used in all portions of the water line installation or replacement. [401 KAR 8:100 Section 1(5)(d)6, Recommended Standards for Water Works 8.0.2] |

Distribution-Major Construction

Bullock Pen Water District
Facility Requirements

Activity ID No.: APE20080002

Page 7 of 14

PORT27 (continued):

Narrative Requirements:

Additional Limitations:

| Condition No. | Condition |
|---------------|--|
| T-10 | Additional Limitations: No water pipe shall pass through or come in contact with any part of a sewer manhole. [Recommended Standards for Water Works 8.6.6] |
| T-11 | Additional Limitations: If a fire sprinkler system is to be installed, a double check detector assembly approved for backflow prevention shall be utilized. The double check detector assembly of the system shall be accessible for testing. [401 KAR 8:100 Section 1(7)] |
| T-12 | Additional Limitations: If water lines cross a stream or wetland, the provisions in the attached Water Quality Certification shall apply. If you have any questions please contact the Water Quality Certification Supervisor of the Water Quality Branch at (502) 564-2225. [401 KAR 8:100 Section 1(7)] |

Subfluvial Pipe Crossings:

| Condition No. | Condition |
|---------------|---|
| T-13 | Subfluvial Pipe Crossings: For subfluvial pipe crossings, a floodplain construction permit will not be required pursuant to KRS 151.250 if the following requirements of 401 KAR 4:050 Section 2 are met. <ol style="list-style-type: none">1) No material may be placed in the stream or in the flood plain of the stream to form construction pads, coffer dams, access roads, etc. during construction of pipe crossings.2) Crossing trenches shall be backfilled as closely as possible to the original contour.3) All excess material resulting from construction displacement in a crossing trench shall be disposed of outside the flood plain.4) For erodible channels, there shall be at least 30 inches of backfill on top of all pipe or conduit points in the crossing.5) For nonerodible channels, pipes or conduits in the crossing shall be encased on all sides by at least 6 inches of concrete with all pipe or conduit points in the crossing at least 6 inches below the original contour of the channel. [401 KAR 8:100 Section 1(7)] |

Distribution-Major Construction

Bullock Pen Water District
Facility Requirements

Activity ID No.: APE20080002

PORT27 (continued):

Narrative Requirements:

Subfluvial Pipe Crossings:

| Condition No. | Condition |
|---------------|--|
| T-14 | <p>Subfluvial Pipe Crossings: For subfluvial pipe crossings greater than 15 feet in width,</p> <ol style="list-style-type: none">1) the pipe shall be of special construction, having flexible, restrained, or welded watertight joints, and2) valves shall be provided at both ends of water crossings so that the section can be isolated for testing or repair. <p>Valves shall</p> <ol style="list-style-type: none">a) be easily accessible,b) not be subject to flooding, andc) if closest to the supply source, be in a manhole with permanent taps made on each side of the valve to allow insertion of a small meter to determine leakage and for sampling purposes. [Recommended Standards for Water Works 8.7.2] |

Distribution-Major Construction

Bullock Pen Water District
Facility Requirements

Activity ID No.: APE20080002

Page 9 of 14

PORT28 (Booster Pump Station) 20 HP, 709 GPM, 92 TDH Booster Pump Station:

Limitation Requirements:

| Condition No. | Parameter | Condition |
|---------------|-----------------------|---|
| L-1 | Pressure | Pump stations shall be located or controlled so that intake Pressure ≥ 20 psi is maintained during normal pump operation. [Recommended Standards for Water Works 6.4.b] This requirement is applicable during the following months: All Year. Statistical basis: Minimum. |
| L-2 | Pressure | Pump stations shall be located or controlled so that an automatic cutoff or a low pressure controller maintains a Pressure ≥ 10 psi in the suction line under all operating conditions. [Recommended Standards for Water Works 6.4.c] This requirement is applicable during the following months: All Year. Statistical basis: Minimum. |
| L-3 | Residual Disinfection | New pumps shall be thoroughly disinfected (in accordance with AWWA Standard C651) upon completion of construction and before being placed into service. To disinfect new pumps use chlorine or chlorine compounds in such amounts as to produce an initial disinfectant concentration of at least 50 ppm and a Residual Disinfection ≥ 25 ppm at the end of 24 hours. Follow the disinfection with thorough flushing and place each pump into service if, and only if, Coliform monitoring applicable to the pump does not show the presence of Coliform. If Coliform is detected, repeat flushing of the pump and Coliform monitoring. If Coliform is still detected, repeat disinfection and flushing as if the pump has never been disinfected. Continue the described process until monitoring does not show the presence of Coliform. [401 KAR 8:100 Section 1(7)] This requirement is applicable during the following months: All Year. Statistical basis: Minimum. |
| L-4 | Slope | Pumping facilities shall be located and designed to maintain the sanitary quality of pumped water. As part of this, all pump station floors shall have Slope ≥ 3 in per 10 ft to a suitable drain. [Recommended Standards for Water Works 6.2.e, Recommended Standards for Water Works 6.0, Recommended Standards for Water Works 6.1] This requirement is applicable during the following months: All Year. Statistical basis: Minimum. |
| L-5 | Air Change Rate | Ventilation shall conform to existing local and/or state codes. At a minimum forced ventilation shall produce an Air Change Rate ≥ 6 air change(s)/hr. [401 KAR 8:100 Section 1(7), Recommended Standards for Water Works 6.2.5] This requirement is applicable during the following months: All Year. Statistical basis: Minimum. |

Distribution-Major Construction

Bullock Pen Water District
Facility Requirements

Activity ID No.: APE20080002

Page 10 of 14

PORT28 (continued):

Limitation Requirements:

| Condition No. | Parameter | Condition |
|---------------|-----------|--|
| L-6 | Height | Pumping stations shall not be subject to flooding. To this end, 1) grading around stations shall lead surface drainage away and 2) stations shall be elevated or protected to a Height \geq 3 ft above the highest of the following: a) the 100-year flood elevation, or b) the highest recorded flood elevation. [Recommended Standards for Water Works 6.1.1, Recommended Standards for Water Works 6.0] This requirement is applicable during the following months: All Year. Statistical basis: Minimum. |
| L-7 | Height | When a pump station has pits or compartments which must be entered, stairways or ladders shall be provided between all floors. Stairs shall have risers with a Height \leq 9 in, handrails on both sides, and treads with non-slip material wide enough for safety. [Recommended Standards for Water Works 6.2.3] This requirement is applicable during the following months: All Year. Statistical basis: Maximum. |

Narrative Requirements:

Additional Limitations:

| Condition No. | Condition |
|---------------|--|
| T-1 | Additional Limitations: Pumping stations shall be so located that the proposed site will meet the requirements for hydraulics of the system. [Recommended Standards for Water Works 6.1] |
| T-2 | Additional Limitations: Pumping stations shall be readily accessible at all times for servicing and repairs. [Recommended Standards for Water Works 6.1.1.b, Recommended Standards for Water Works 6.4.3] |
| T-3 | Additional Limitations: Pumping stations shall be designed to prevent vandalism and protect against entrance of animals or unauthorized persons. [Recommended Standards for Water Works 6.1.1.d] |
| T-4 | Additional Limitations: Pumping stations shall be of durable construction with outward-opening doors. [Recommended Standards for Water Works 6.2.b] |