


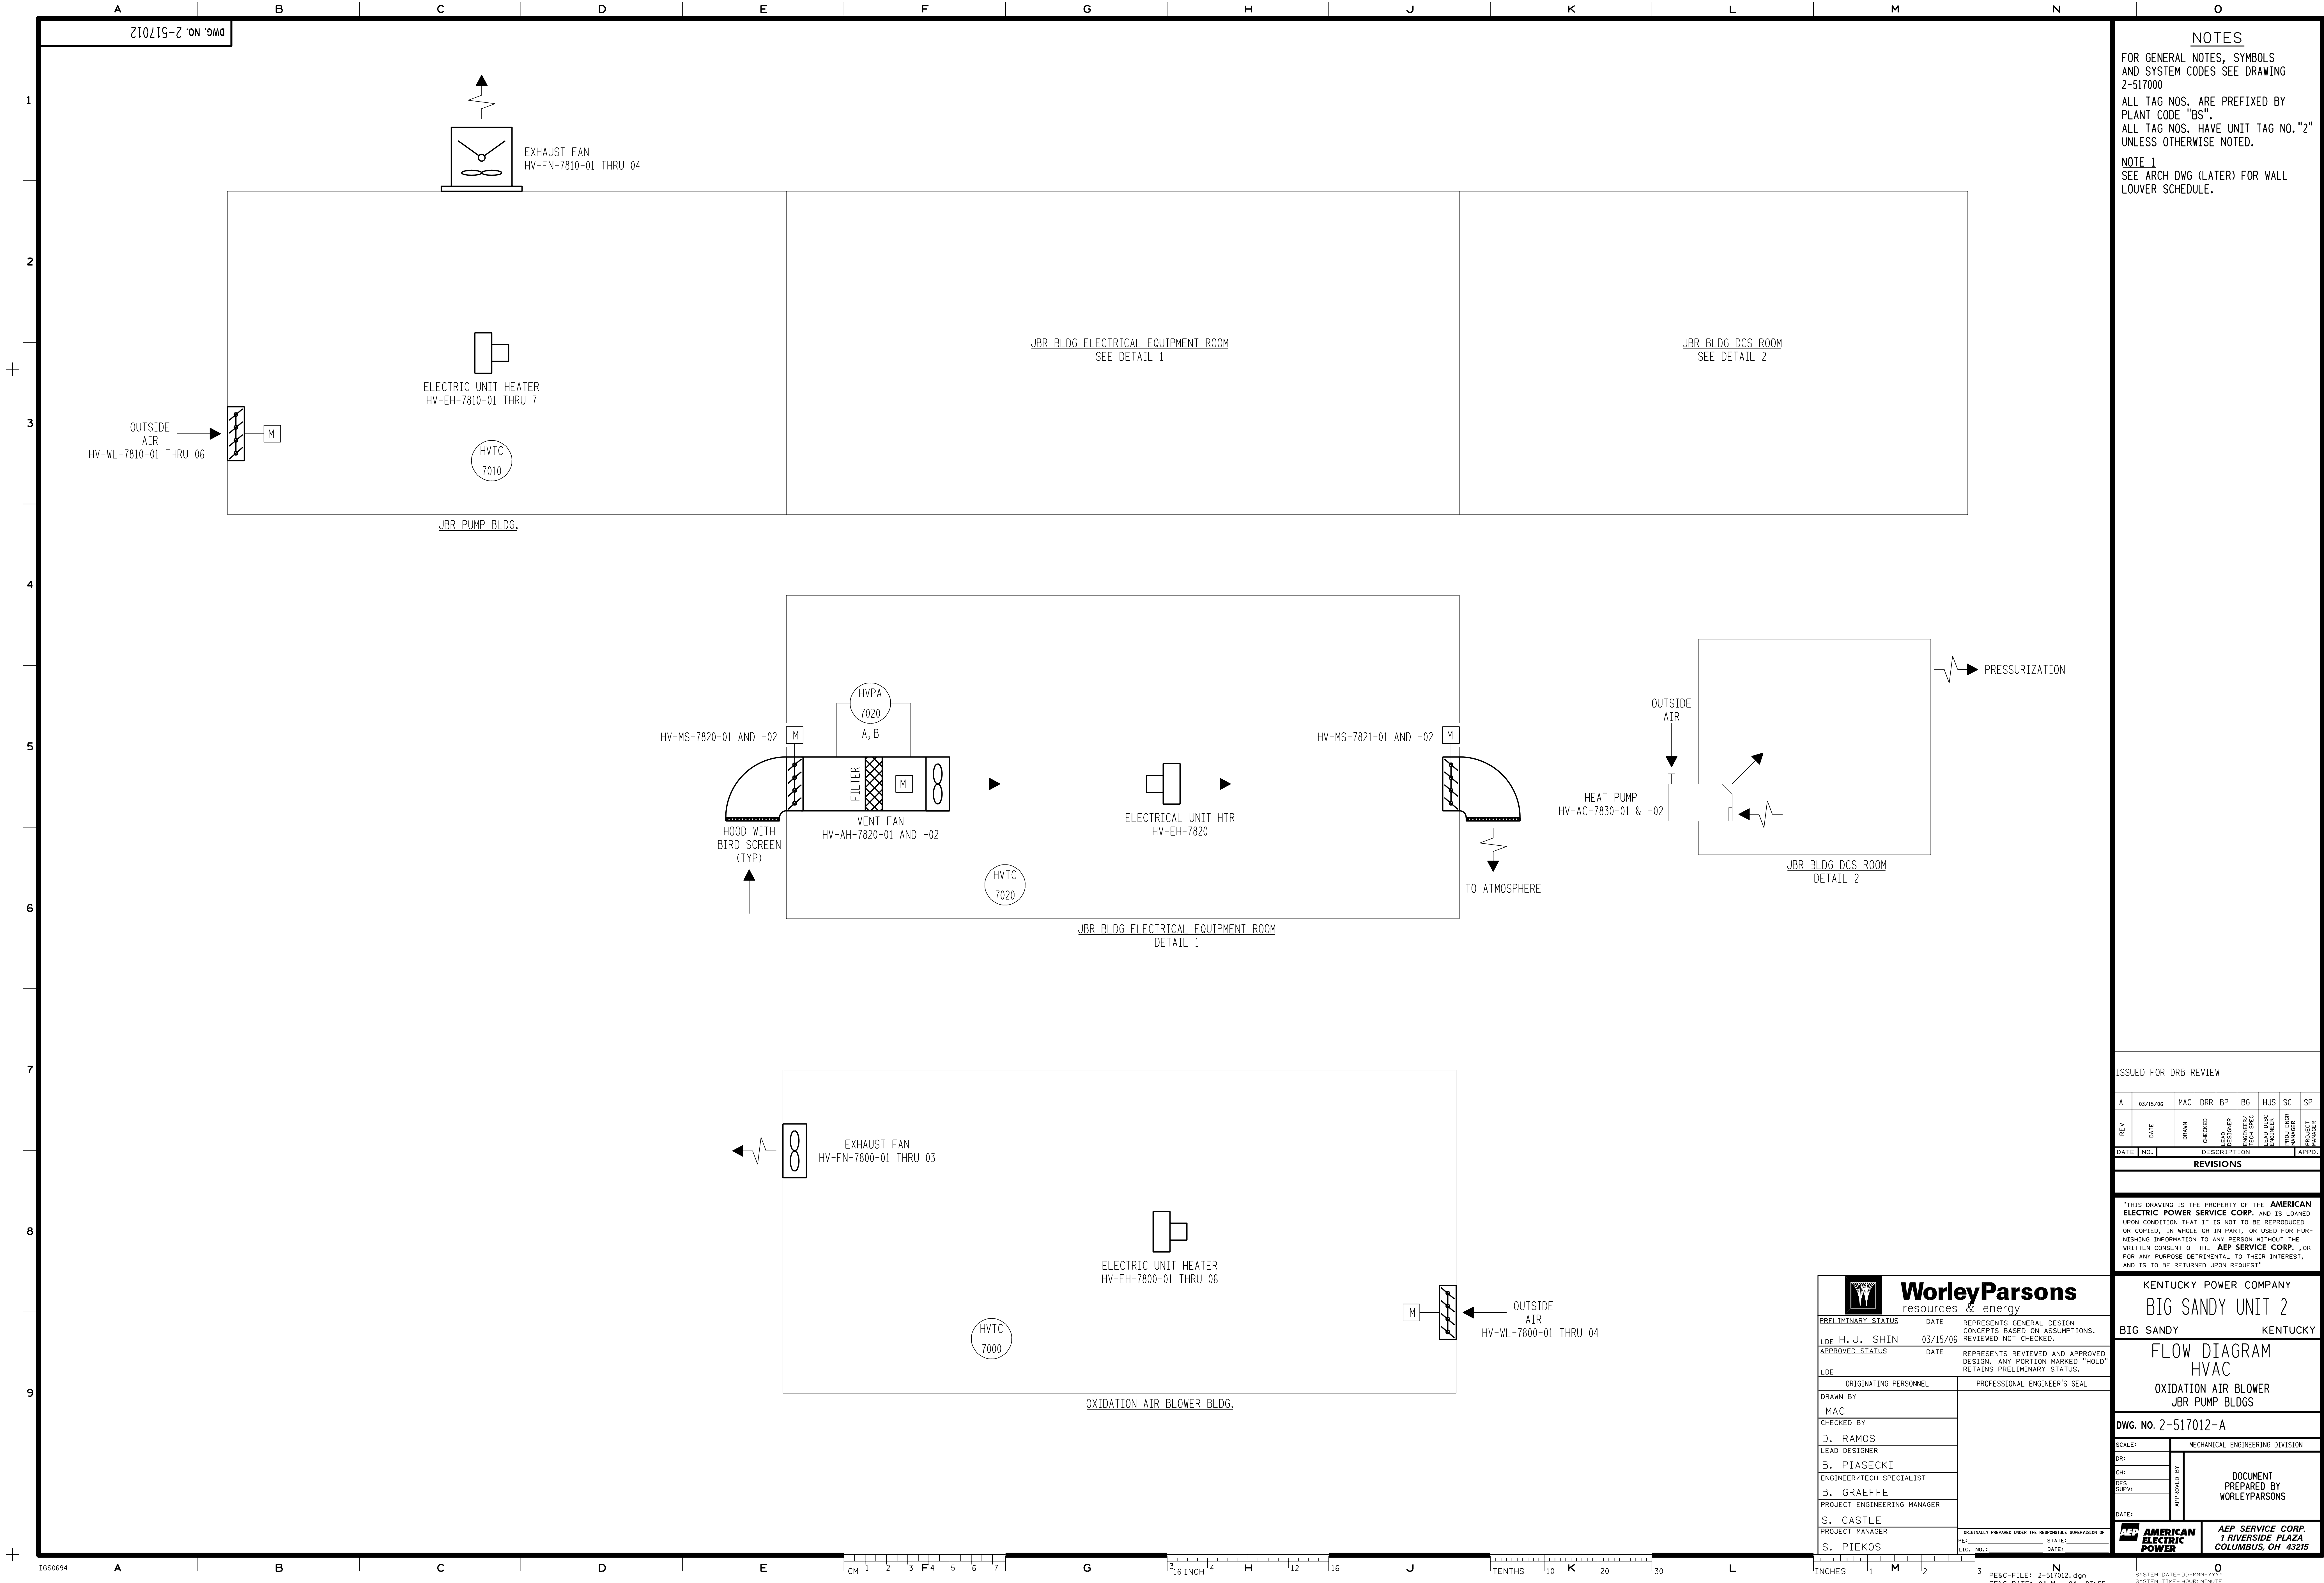

NOTES

FOR GENERAL NOTES, SYMBOLS AND SYSTEM CODES SEE DRAWING 2-517000

ALL TAG NOS. ARE PREFIXED BY PLANT CODE "BS".

ALL TAG NOS. HAVE UNIT TAG NO. "2" UNLESS OTHERWISE NOTED.

NOTE 1
SEE ARCH DWG (LATER) FOR WALL LOUVER SCHEDULE.

ISSUED FOR DRB REVIEW									
A	03/15/06	MAC	DRR	BP	BG	HJS	SC	SP	
REV	DATE	DRAWN	CHECKED	DESIGNED	ENGINEER/TECH SPEC	LEAD DESIG	PROJECT MANAGER	DATE	
REVISIONS									
THIS DRAWING IS THE PROPERTY OF THE AMERICAN ELECTRIC POWER SERVICE CORP. AND IS LOANED UPON CONDITION THAT IT IS NOT TO BE REPRODUCED OR COPIED, IN WHOLE OR IN PART, OR USED FOR FURNISHING INFORMATION TO ANY PERSON WITHOUT THE WRITTEN CONSENT OF THE AEP SERVICE CORP. OR FOR ANY PURPOSE DETRIMENTAL TO THEIR INTEREST, AND IS TO BE RETURNED UPON REQUEST.									
KENTUCKY POWER COMPANY BIG SANDY UNIT 2 BIG SANDY KENTUCKY									
FLOW DIAGRAM HVAC OXIDATION AIR BLOWER JBR PUMP BLDGS									
DWG. NO. 2-517012-A									
SCALE:		MECHANICAL ENGINEERING DIVISION							
DR:		DOCUMENT PREPARED BY WORLEYPARSONS							
CHR:									
DES:									
SUPPLY:									
DATE:									
PROJECT MANAGER S. CASTLE		APPROVED BY S. PIEKOS							
PROJECT MANAGER S. CASTLE		PROJECT MANAGER S. PIEKOS							
PROJECT MANAGER S. CASTLE		PROJECT MANAGER S. PIEKOS							

PE&C-FILE: 2-517012.dgn
PE&C-DATE: 04-Mar-06 07:55

SYSTEM DATE=DD-MMM-YY
SYSTEM TIME=HOUR-MINUTE