


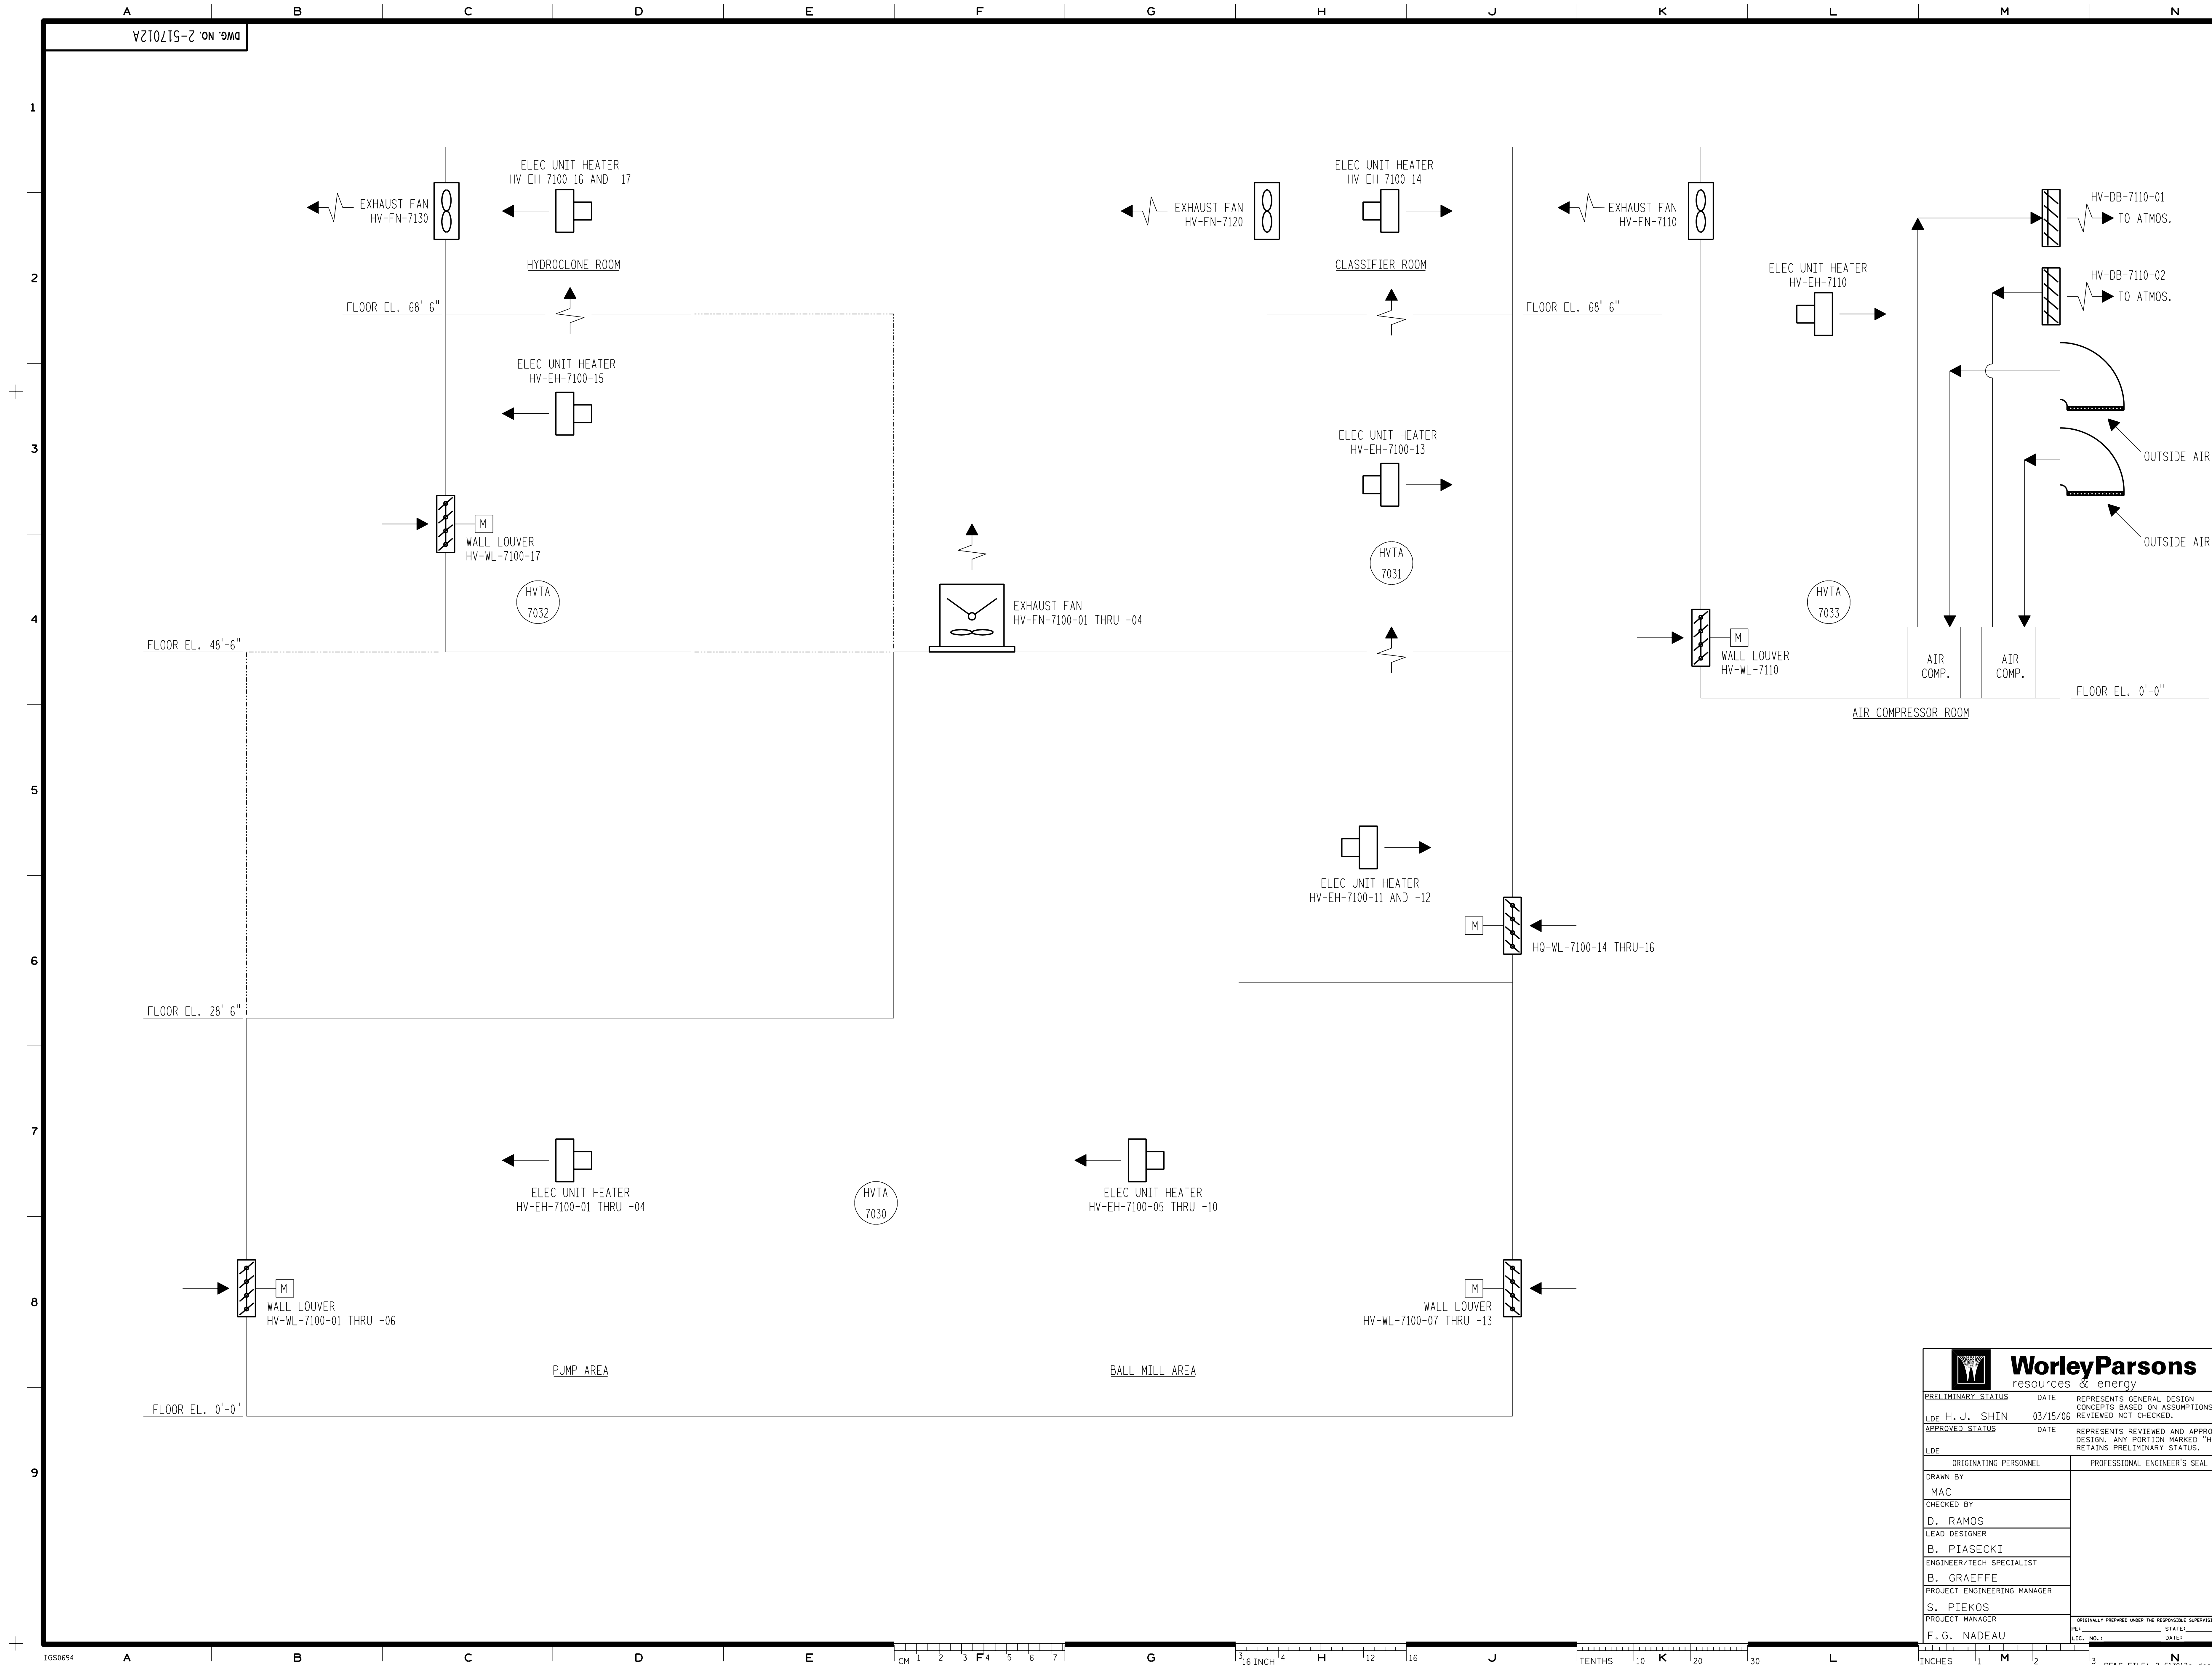

NOTES

FOR GENERAL NOTES, SYMBOLS
AND SYSTEM CODES SEE DRAWING
2-517000A,B,C,D AND E.
ALL PIPING SPECIALTY TAG NOS.
ARE PREFIXED BY PLANT CODE "BS".
ALL TAG NOS. HAVE UNIT TAG NO. "2"
UNLESS OTHERWISE NOTED.

ISSUED FOR DRB REVIEW									
A	03/15/06	SMM	DR	BP	BG	HJS	SC	SP	
REV	DATE	DRAWN	CHECKED	LEAD DESIGNER	ENGINEER/ TECH SPEC	LEAD DISC ENGINEER	PROJ ENGR MANAGER	PROJECT	
DATE	NO.	DESCRIPTION							APPROVED

REVISIONS

"THIS DRAWING IS THE PROPERTY OF THE **AMERICAN ELECTRIC POWER SERVICE CORP.** AND IS LOANED UPON CONDITION THAT IT IS NOT TO BE REPRODUCED OR COPIED, IN WHOLE OR IN PART, OR USED FOR FURNISHING INFORMATION TO ANY PERSON WITHOUT THE WRITTEN CONSENT OF THE **AEP SERVICE CORP.** ,OR FOR ANY PURPOSE DETRIMENTAL TO THEIR INTEREST, AND IS TO BE RETURNED UPON REQUEST"

KENTUCKY POWER COMPANY
BIG SANDY UNIT 2
BIG SANDY KENTUCKY

FLOW DIAGRAM
HVAC
FGD BUILDING MAIN AREA

DWG. NO. 2-517012A-A

SCALE:	MECHANICAL ENGINEERING DIVISION	
DR:	APPROVED BY	DOCUMENT PREPARED BY WORLEYPARSONS
CH:		
DES		
SUPV:		



**AEP AMERICAN
ELECTRIC
POWER**

AEP SERVICE CORP.
1 RIVERSIDE PLAZA
COLUMBUS, OH 43215

SYSTEM DATE=DD-MMM-YYYY
SYSTEM TIME=HOUR:MINUTE

PE&C-FILE: 2-517012a.dgn
PE&C-DATE: 04-May-04 03:55

SYSTEM DATE=CO-MMM-YYYY
SYSTEM TIME=HOUR:MINUTE