


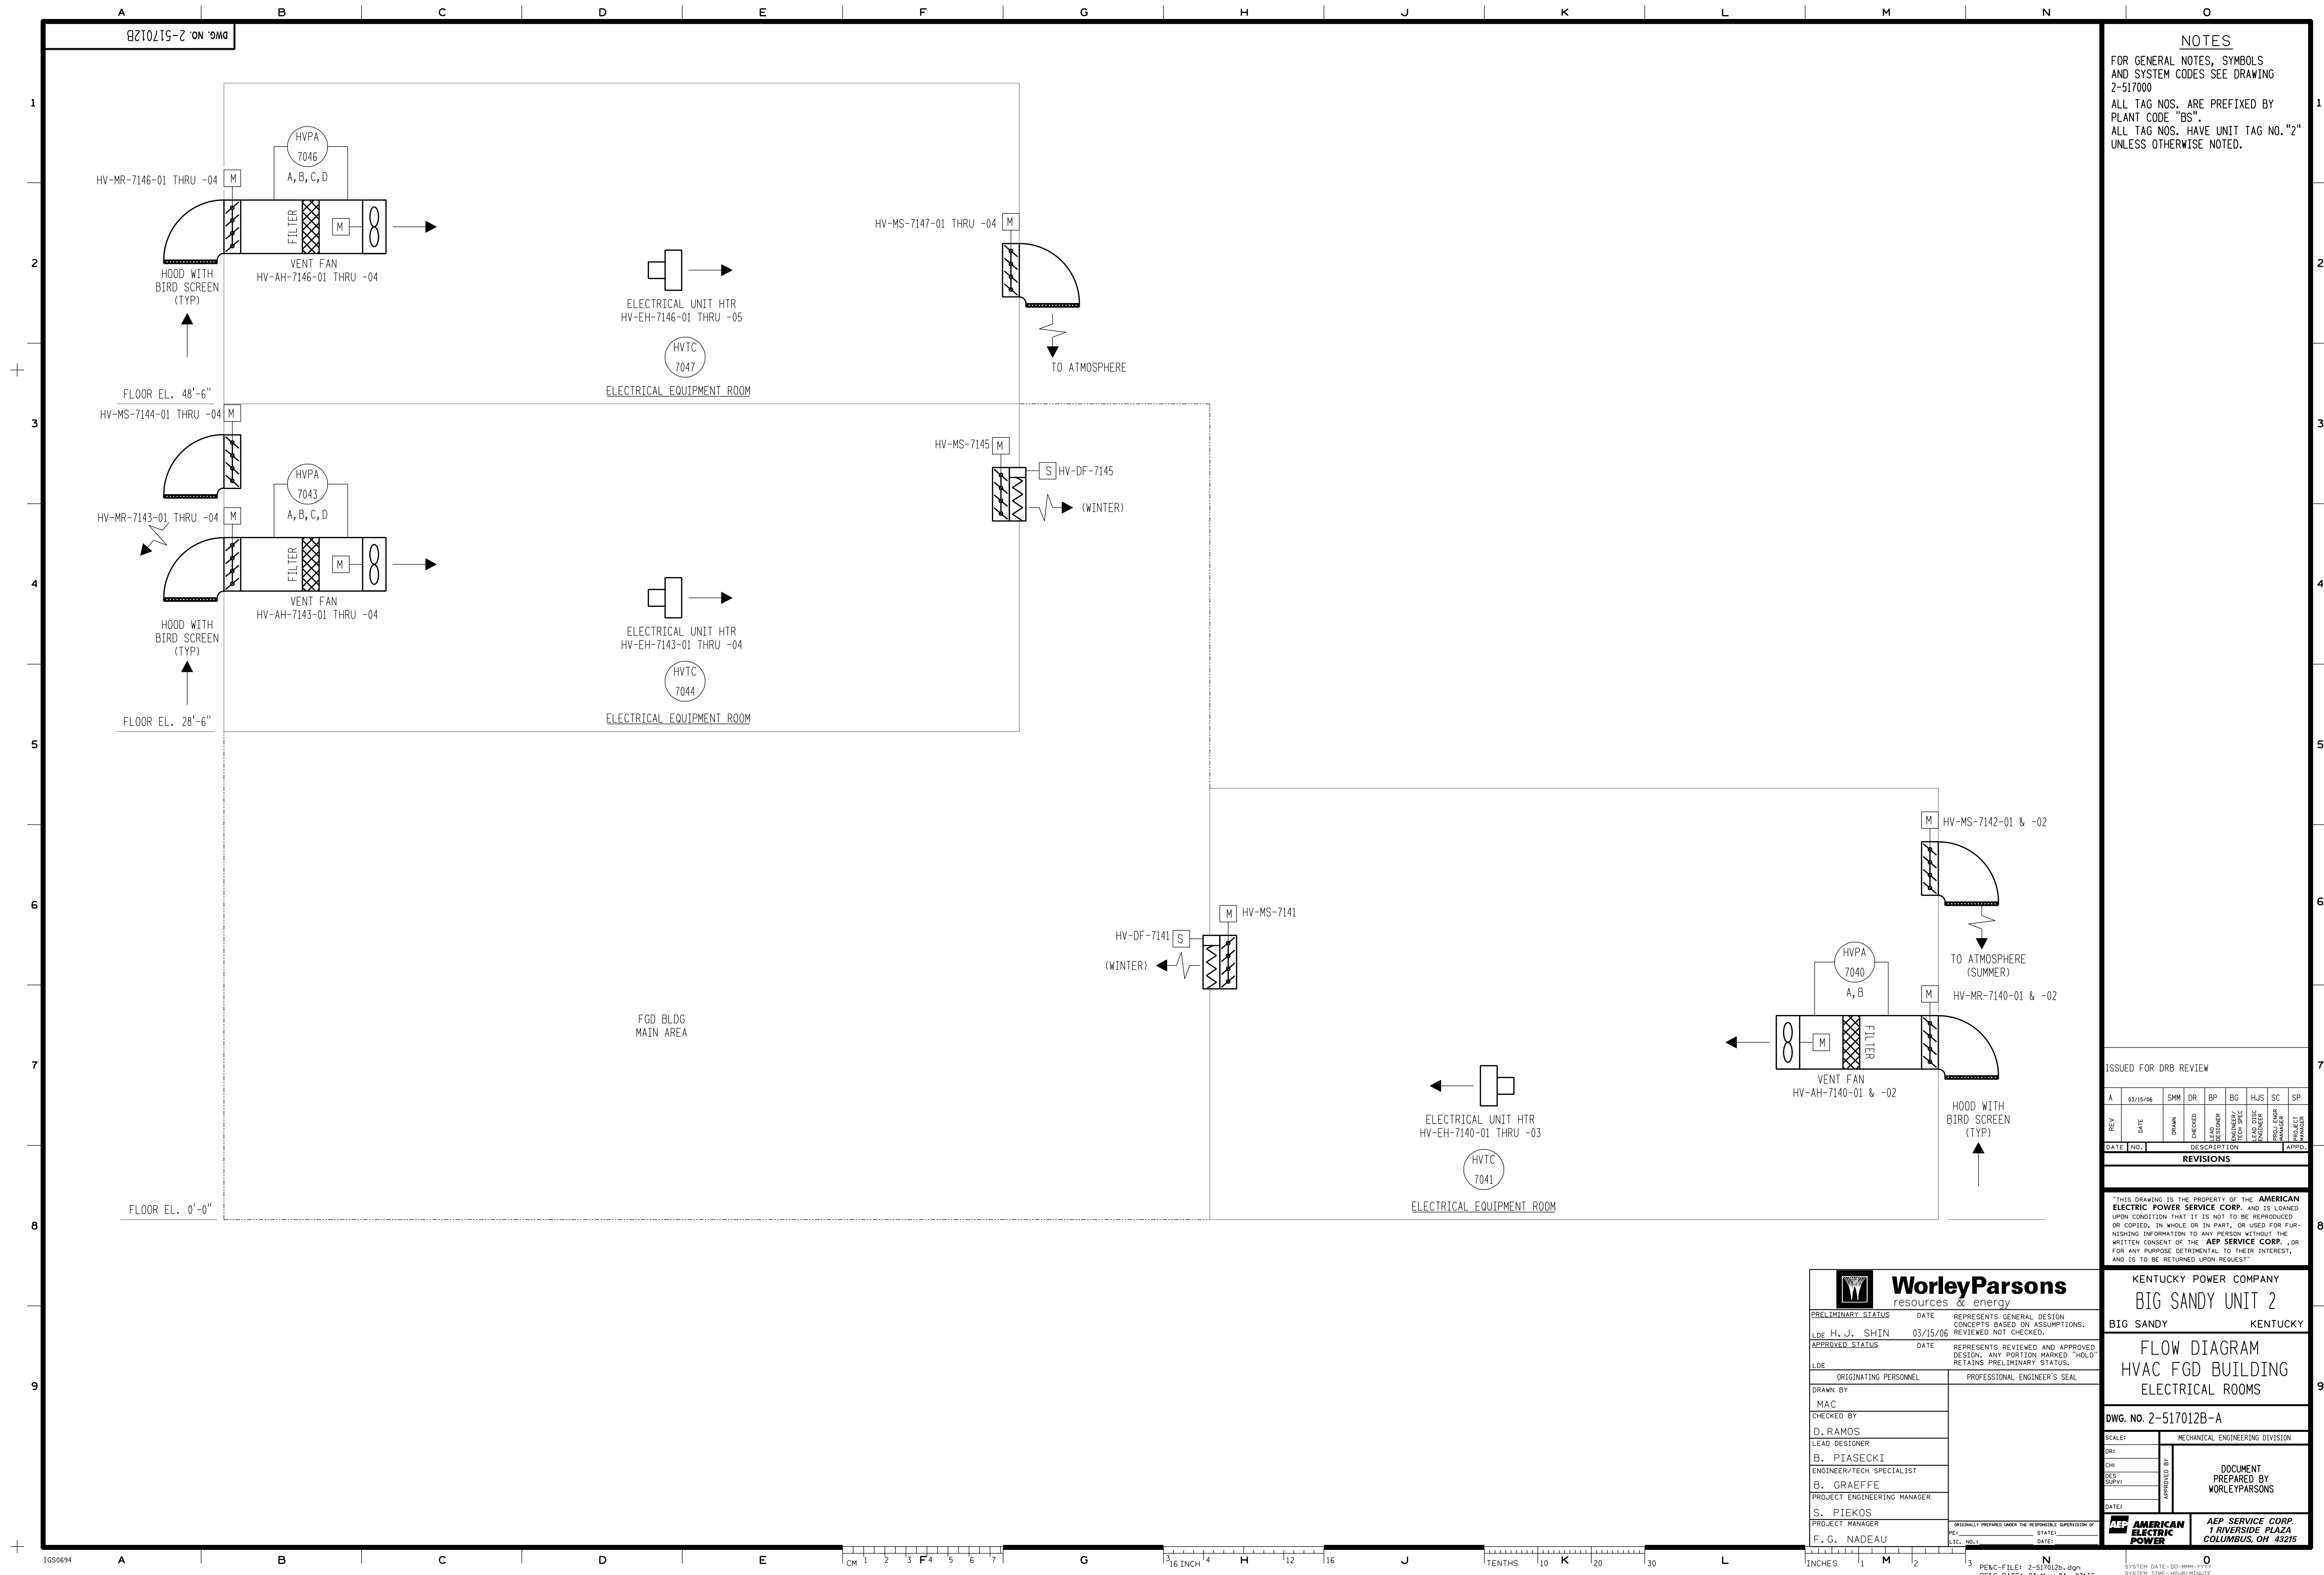

NOTES

FOR GENERAL NOTES, SYMBOLS
AND SYSTEM CODES SEE DRAWING
2-517000

ALL TAG NOS. ARE PREFIXED BY
PLANT CODE "BS".
ALL TAG NOS. HAVE UNIT TAG NO. "2"
UNLESS OTHERWISE NOTED.

ISSUED FOR DRB REVIEW

A	03/15/06	SMM	DR	BP	BG	HJS	SC	SP
REV	DATE	DRAWN	CHECKED	LEAD DESIGNER	ENGINEER/TECH SPEC	LEAD DISC ENGINEER	PROJ ENGR MANAGER	PROJECT MANAGER
DATE	NO.	DESCRIPTION						APPD.

REVISIONS

"THIS DRAWING IS THE PROPERTY OF THE **AMERICAN ELECTRIC POWER SERVICE CORP.** AND IS LOANED UPON CONDITION THAT IT IS NOT TO BE REPRODUCED OR COPIED, IN WHOLE OR IN PART, OR USED FOR FURNISHING INFORMATION TO ANY PERSON WITHOUT THE WRITTEN CONSENT OF THE **AEP SERVICE CORP.**, OR FOR ANY PURPOSE DETRIMENTAL TO THEIR INTEREST, AND IS TO BE RETURNED UPON REQUEST"

KENTUCKY POWER COMPANY
BIG SANDY UNIT 2
BIG SANDY KENTUCKY

FLOW DIAGRAM
HVAC FGD BUILDING
ELECTRICAL ROOMS

DWG. NO. 2-517012B-A

SCALE:	MECHANICAL ENGINEERING DIVISION	
DR:	APPROVED BY	DOCUMENT PREPARED BY WORLEYPARSONS
CH:		
DES SUPV:		
DATE:		

 AMERICAN ELECTRIC POWER	AEP SERVICE CORP. 1 RIVERSIDE PLAZA COLUMBUS, OH 43215
--	---

PE&C-FILE: 2-517012b.dgn
PE&C-DATE: 04-Mar-04 07:55

```

0
SYSTEM DATE=DD-MMM-YYYY
SYSTEM TIME=HH:MM:SS

```