


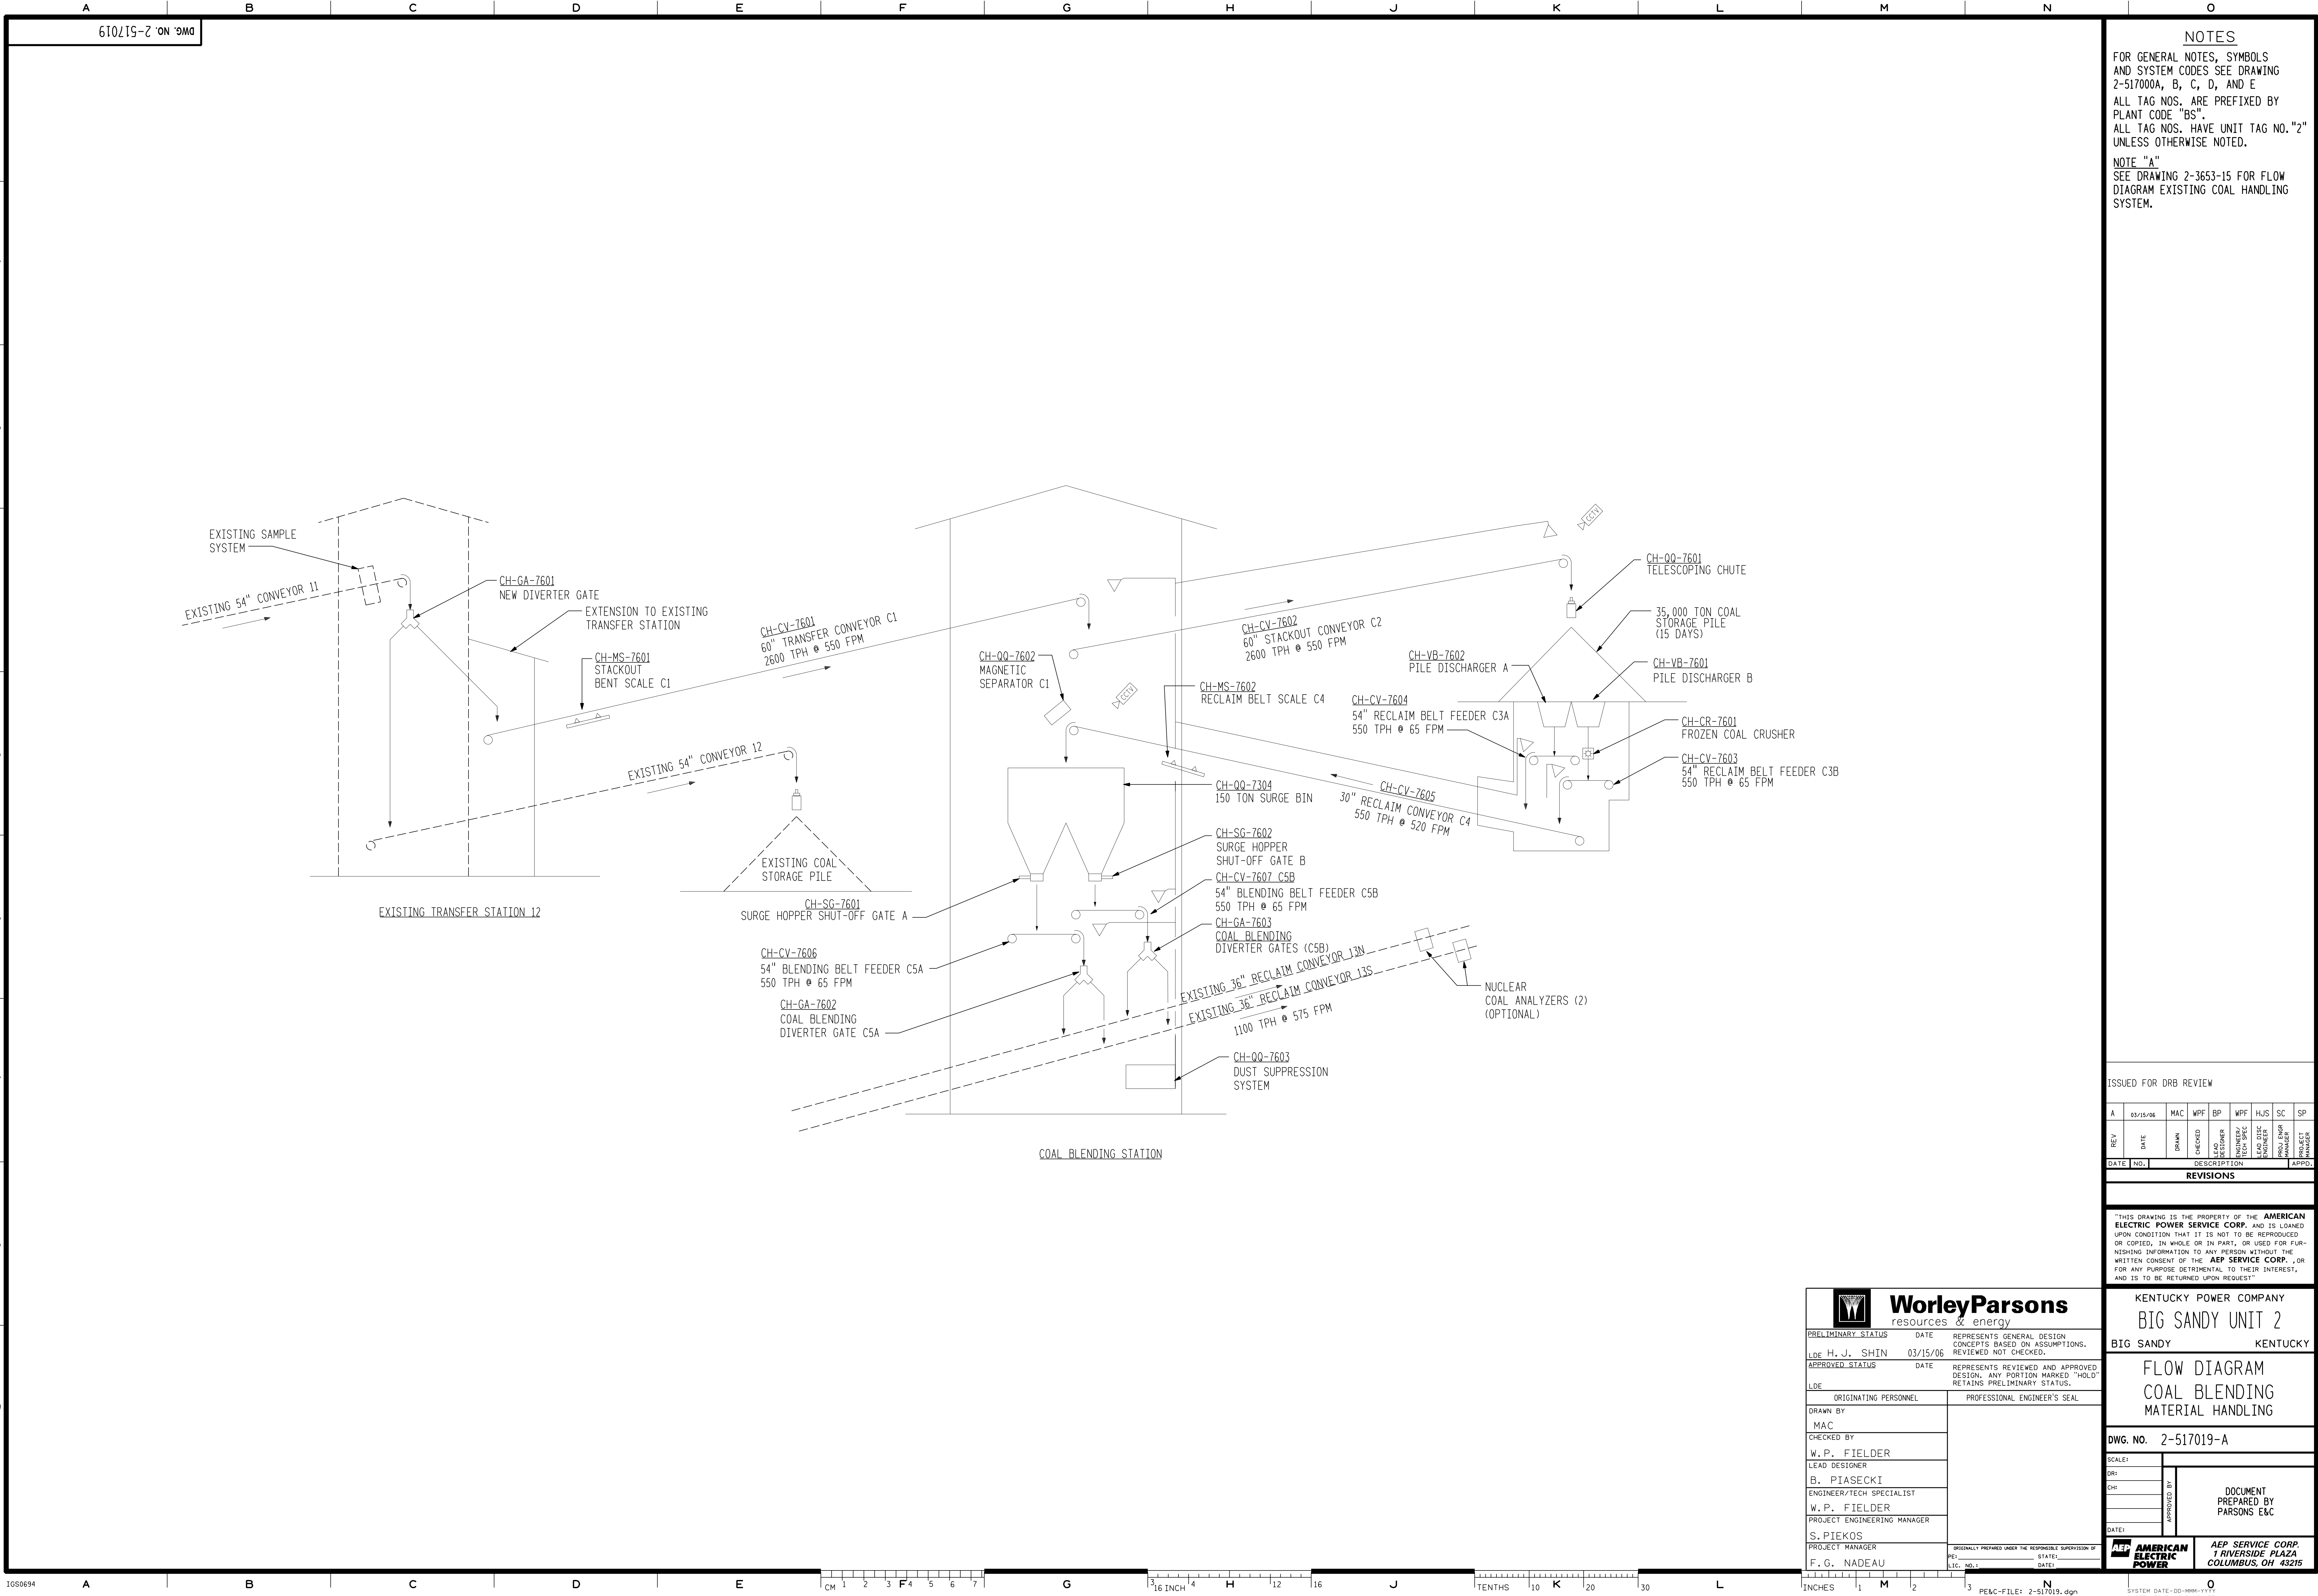

NOTES

FOR GENERAL NOTES, SYMBOLS AND SYSTEM CODES SEE DRAWING 2-517000A, B, C, D, AND E

ALL TAG NOS. ARE PREFIXED BY PLANT CODE "BS".

ALL TAG NOS. HAVE UNIT TAG NO. "2" UNLESS OTHERWISE NOTED.

NOTE "A"

SEE DRAWING 2-3653-15 FOR FLOW DIAGRAM EXISTING COAL HANDLING SYSTEM.

ISSUED FOR DRB REVIEW

REV	DATE	DRAWN	CHECKED	DESIGNED	ENGINEER/TECH SPEC	BLDG OPRC	PROD MGR	PROJECT MANAGER
A	03/15/06	MAC	WPF	BP	WPF	HJS	SC	SP

REVISIONS

"THIS DRAWING IS THE PROPERTY OF THE AMERICAN ELECTRIC POWER SERVICE CORP. AND IS LOANED UPON CONDITION THAT IT IS NOT TO BE REPRODUCED OR COPIED, IN WHOLE OR IN PART, OR USED FOR FURNISHING INFORMATION TO ANY PERSON WITHOUT THE WRITTEN CONSENT OF THE AEP SERVICE CORP. OR FOR ANY PURPOSE DETRIMENTAL TO THEIR INTEREST, AND IS TO BE RETURNED UPON REQUEST."



PRELIMINARY STATUS	DATE	REPRESENTS GENERAL DESIGN CONCEPTS BASED ON ASSUMPTIONS. REVIEWED NOT CHECKED.
LDE H. J. SHIN	03/15/06	
APPROVED STATUS	DATE	REPRESENTS REVIEWED AND APPROVED DESIGN. ANY PORTION MARKED "HOLD" RETAINS PRELIMINARY STATUS.
LDE		
ORIGINATING PERSONNEL	PROFESSIONAL ENGINEER'S SEAL	
DRAWN BY MAC		
CHECKED BY W. P. FIELDER		
LEAD DESIGNER B. PIASECKI		
ENGINEER/TECH SPECIALIST W. P. FIELDER		
PROJECT ENGINEERING MANAGER S. PIEKOS		
PROJECT MANAGER F. G. NADEAU		

KENTUCKY POWER COMPANY
BIG SANDY UNIT 2
BIG SANDY KENTUCKY

FLOW DIAGRAM
COAL BLENDING
MATERIAL HANDLING

DWG. NO. 2-517019-A

SCALE:	DOCUMENT PREPARED BY PARSONS E&C
DR:	
CHR:	
DATE:	



AEP SERVICE CORP.
1 RIVERSIDE PLAZA
COLUMBUS, OH 43215