

COMMONWEALTH OF KENTUCKY
BEFORE THE PUBLIC SERVICE COMMISSION

In the Matter of:

CARL E. KNOCHELMANN JR.)	
)	
COMPLAINANT)	
)	CASE NO.
V.)	2025-00238
)	
NORTHERN KENTUCKY WATER DISTRICT)	
)	
DEFENDANT)	

ORDER

On July 9, 2025, Carl E. Knochelmann Jr. tendered a formal complaint with the Commission against Northern Kentucky Water District (Northern Kentucky District) alleging that he was overbilled in the amount of \$329.44 due to his water meter being faulty.¹

Pursuant to Commission regulation in 807 KAR 5:001, Section 20(4)(a), upon receipt of a formal complaint, the Commission must determine whether the complaint establishes a prima facie case. A complaint establishes a prima facie case when, on its face, it states sufficient allegations that, if uncontradicted by other evidence, would entitle the complainant to the requested relief. If a complaint fails to establish a prima facie case, it may be dismissed.

Based upon a review of the tendered complaint, the Commission is unable to determine at this time whether the complaint establishes a prima facie case, but the

¹ Complaint at 3.

allegations support our further investigation into the merits of the complaint. Mr. Knochelmann asserted that Northern Kentucky District performed a meter test pursuant to his request and reported no fault in the meter.²

The Commission finds that additional information is needed to assist the Commission in making a determination of whether the complaint establishes a prima facie case. Therefore, Northern Kentucky District should file its responses to Commission Staff's request for information, attached to this Order as Appendix A, on or before the date set forth by Commission Staff in the request. Northern Kentucky District should respond to any future requests for information propounded by Commission Staff by the date or dates set forth on any such requests. A copy of Mr. Knochelmann's complaint is attached to this Order as Appendix B to inform Northern Kentucky District of the subject of the complaint and to assist in identifying Mr. Knochelmann 's account.

IT IS THEREFORE ORDERED that:

1. A copy of this Order shall be served on Northern Kentucky District by and through the electronic mail address the district has on file with the Commission and by U.S. Postal Service First Class Mail to 2835 Crescent Springs Road, P.O. Box 18640, Erlanger, Kentucky 41018-0640, for the sole purpose of requesting necessary documents to assist the Commission in determining whether the complaint establishes a prima facie case.
2. Northern Kentucky District shall respond to Commission Staff's request for information as provided in Appendix A attached to this Order.


² Complaint at 2.

3. Northern Kentucky District shall respond to any additional requests for information propounded by Commission Staff, as provided in those requests.

4. A copy of this Order shall be served on Mr. Knochermann by U.S. Postal Service First Class Mail at 3032 Belle Meade Lane Edgewood, Kentucky 41017.

[REMAINDER OF PAGE INTENTIONALLY LEFT BLANK]

PUBLIC SERVICE COMMISSION


Chairman


Commissioner


Commissioner

ATTEST:


Executive Director



APPENDIX A

APPENDIX TO AN ORDER OF THE KENTUCKY PUBLIC SERVICE COMMISSION IN CASE NO. 2025-00238 DATED AUG 12 2025

COMMISSION STAFF'S FIRST REQUEST FOR INFORMATION TO NORTHERN KENTUCKY WATER DISTRICT

Northern Kentucky Water District (Northern Kentucky District), pursuant to 807 KAR 5:001, shall file with the Commission an electronic version of the following information. The information requested is due on August 29, 2025. The Commission directs Northern Kentucky District to the Commission's July 22, 2021 Order in Case No. 2020-00085¹ regarding filings with the Commission. Electronic documents shall be in portable document format (PDF), shall be searchable, and shall be appropriately bookmarked.

Each response shall include the question to which the response is made and shall include the name of the witness responsible for responding to the questions related to the information provided. Each response shall be answered under oath or, for representatives of a public or private corporation or a partnership or association or a governmental agency, be accompanied by a signed certification of the preparer or the person supervising the preparation of the response on behalf of the entity that the response is true and accurate to the best of that person's knowledge, information, and belief formed after a reasonable inquiry.

Northern Kentucky District shall make timely amendment to any prior response if Northern Kentucky District obtains information that indicates the response was incorrect

¹ Case No. 2020-00085, *Electronic Emergency Docket Related to the Novel Coronavirus COVID-19* (Ky. PSC July 22, 2021), Order (in which the Commission ordered that for case filings made on and after March 16, 2020, filers are NOT required to file the original physical copies of the filings required by 807 KAR 5:001, Section 8).

or incomplete when made or, though correct and complete when made, is now incorrect or incomplete in any material respect.

For any request to which Northern Kentucky District fails or refuses to furnish all or part of the requested information, Northern Kentucky District shall provide a written explanation of the specific grounds for its failure to completely and precisely respond.

Careful attention shall be given to copied and scanned material to ensure that it is legible. When the requested information has been previously provided in this proceeding in the requested format, reference may be made to the specific location of that information in responding to this request. When applicable, the requested information shall be separately provided for total company operations and jurisdictional operations. When filing a paper containing personal information, Northern Kentucky District shall, in accordance with 807 KAR 5:001, Section 4(10), encrypt or redact the paper so that personal information cannot be read.

1. Provide a copy of results of any meter tests performed on the meter identified in Mr. Knochemann's complaint, whether on the date identified by Mr. Knochemann or any other date before or after.
2. State when the identified meter was placed into service at Mr. Knochemann's service location.

APPENDIX B

APPENDIX TO AN ORDER OF THE KENTUCKY PUBLIC SERVICE
COMMISSION IN CASE NO. 2025-00238 DATED AUG 12 2025

EIGHTEEN PAGES TO FOLLOW

COMMONWEALTH OF KENTUCKY
BEFORE THE PUBLIC SERVICE COMMISSION

In the Matter of:

Carl E. Knochelmann Jr.

COMPLAINANT

vs.

Northern Kentucky Water District

DEFENDANT

RECEIVED

JUL 03 2025

PUBLIC SERVICE
COMMISSION

COMPLAINT

The Complaint of Carl E. Knochelmann Jr. Respectfully shows:

(a) Carl E. Knochelmann Jr.
3032 Belle Meade Lane
Edgewood, Ky. 41017

(b) Northern Kentucky Water District
P.O. Box 18640
2835 Crescent Springs Road
Erlanger, Ky. 41018

(c) That the water meter in place on and before January 25, 2023 was defective resulting in an erroneous excess water use reading and a subsequent over charge on Mr Knochelmann's water bill.

The amount of water indicated as being used between August 22, 2022 and December 1, 2022 was so great as to be impossible in the time frame given in the use report without being noticed by the residents. (See attached water usage report from the meter). The use report showed that 300 cubic feet of water was used in three days on more than one occasion. Other excessive readings can be found several times in the usage report, such as 200 cubic feet of water being used in two days. The Northern Kentucky Water District (NKY Water) failed and refused to cooperate with Mr. Knochelmann to discuss possible reasons why there was an excessive use reading that was so large. The only logical conclusion is that the meter in place on January 25, 2023 was defective.

NKY Water sent a notice of excessive use to Mr. Knochelmann in January 2023 that covered the previous 3 month billing period. Mr. Knochelmann contacted NKY Water immediately to schedule a check of the meter. On or about January 25, 2023, NKY Water came to the residence of Mr. Knochelmann and the meter was checked to determine if there was a leak. NKY Water personnel determined that **THERE WAS NO LEAK**. No water was running through the meter. There was no water in the meter pit that would indicate that there was a leak at the meter. Also, there was no water in the yard or in the street surrounding Mr. Knochelmann's residence. There was no water in Mr. Knochelmann's basement where the water service entered the residence. NKY Water could not or would not explain where all of the excess water went.

Mr. Knochelmann or members of his family were at home at all times during the day and night when the excessive use was supposed to have occurred. No water was running unchecked at any time within the residence. NKY Water replaced the existing meter at Mr. Knochelmann's residence with a new meter. Since the meter was replaced, there has only been normal usage.

As a result of the no leak finding at his residence, Mr. Knochelmann requested a test of his meter. NKY Water conducted a test of Mr. Knochelmann's meter on or about January 25, 2023 which did not find a fault in the meter. However, the test was not relevant to the issue of erroneous excessive water usage. The test that was performed only tested a small volume of water to determine if the nutating disk had a fault. The issue is excessive water use comprising hundreds of cubic feet of water was not tested. There was no testing to determine if a high volume of water usage was registered on the meter when there was only normal usage.

The meter was replaced on or about January 25, 2023. When the pit was opened, you could see that there was no water in the pit and no indication of any leak. (See attached picture) Mr. Knochelmann contends that the mechanism that counts the nutating disk revolutions would stick

resulting in advancing multiple meter disks when only one should have advanced. For example, when the nutating disk makes a given number of revolutions, the units disk on the meter should advance one click. To explain the erroneous excessive use readings, Mr. Knochelmann contends that, at times, the ones and the tens disks (or the tens and hundreds disks) on the meter would advance together when it should not have. (Or some other possible combination of two or more meter disks sticking together to advance when they should not have). NKY Water would not discuss anything about the reason for the large reading or discuss this theory with Mr. Knochelmann to resolve this issue. Mr. Knochelmann contends that NKY Water has the burden to show that the amount of usage charged is accurate and that Mr. Knochelmann used the water. NKY Water has not met this burden. Mr. Knochelmann was simply told that he was responsible for the water that went through the meter and that the meter reading was the end of the discussion on whether the water went through the meter.

Mr. Knochelmann was charged \$329.44 above his normal bill for the excess water use and has been paying the current usage charges since January 25, 2023. The current usage amount has been in line with Mr. Knochelmann's normal usage prior to the excessive use period.


Wherefore, Complainant asks that:

1. The charge for the excessive use, in the amount of \$329.44 plus all surcharges, be rescinded and his account balance be reduced to zero (excepting the current use charges that he has paid).
2. NKY Water be required to prove that Mr. Knochelmann actually used the water for which he was charged, in order for it to be able to collect any amount from Mr. Knochelmann.

Dated at Kenton County, Kentucky, this 24th day of June, 2025.


Carl E. Knochelmann Jr.

ORION Meter Reading Profile
Serial # 81680924

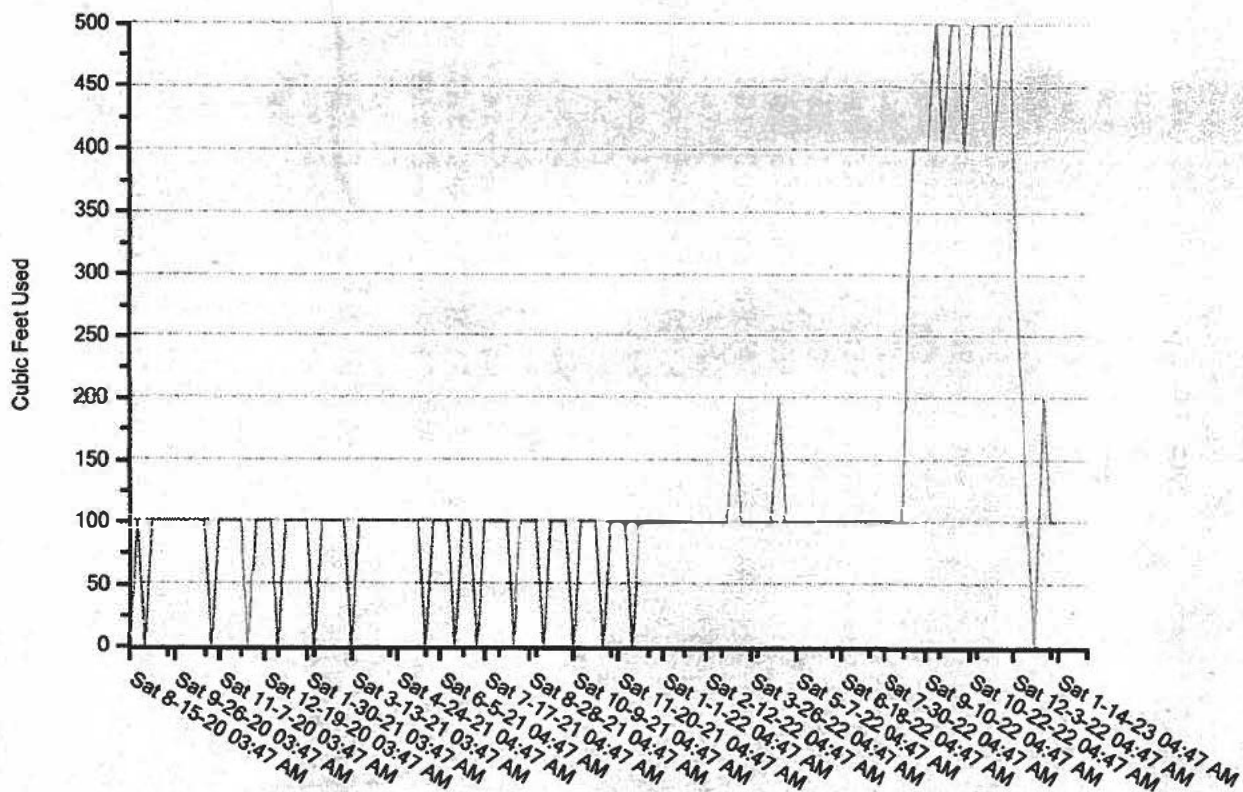

From Sat 8-15-20 03:47 AM to Wed 1-25-23 01:47 PM in Week Intervals

Profile Name: 81680924 20230125 1349

PREVIOUS 9
 PAGES INDICATED
 EQUAL USAGA
 AS THIS
 500 PERP

ORION Meter Reading Profile

Serial # 81680924

Read #	Read Time	Cubic Feet Use
=====	=====	=====
361	Tue 8-10-21 04:47 AM	0
362	Wed 8-11-21 04:47 AM	0
363	Thu 8-12-21 04:47 AM	0
364	Fri 8-13-21 04:47 AM	0
365	Sat 8-14-21 04:47 AM	0
366	Sun 8-15-21 04:47 AM	100
367	Mon 8-16-21 04:47 AM	0
368	Tue 8-17-21 04:47 AM	0
369	Wed 8-18-21 04:47 AM	0
370	Thu 8-19-21 04:47 AM	0
371	Fri 8-20-21 04:47 AM	0
372	Sat 8-21-21 04:47 AM	0
373	Sun 8-22-21 04:47 AM	0
374	Mon 8-23-21 04:47 AM	0
375	Tue 8-24-21 04:47 AM	0
376	Wed 8-25-21 04:47 AM	100
377	Thu 8-26-21 04:47 AM	0
378	Fri 8-27-21 04:47 AM	0
379	Sat 8-28-21 04:47 AM	0
380	Sun 8-29-21 04:47 AM	0
381	Mon 8-30-21 04:47 AM	0
382	Tue 8-31-21 04:47 AM	0
383	Wed 9-1-21 04:47 AM	0
384	Thu 9-2-21 04:47 AM	0
385	Fri 9-3-21 04:47 AM	0
386	Sat 9-4-21 04:47 AM	100
387	Sun 9-5-21 04:47 AM	0
388	Mon 9-6-21 04:47 AM	0
389	Tue 9-7-21 04:47 AM	0
390	Wed 9-8-21 04:47 AM	0
391	Thu 9-9-21 04:47 AM	0
392	Fri 9-10-21 04:47 AM	0
393	Sat 9-11-21 04:47 AM	0
394	Sun 9-12-21 04:47 AM	0
395	Mon 9-13-21 04:47 AM	100
396	Tue 9-14-21 04:47 AM	0
397	Wed 9-15-21 04:47 AM	0
398	Thu 9-16-21 04:47 AM	0
399	Fri 9-17-21 04:47 AM	0
400	Sat 9-18-21 04:47 AM	0
401	Sun 9-19-21 04:47 AM	0
402	Mon 9-20-21 04:47 AM	0
403	Tue 9-21-21 04:47 AM	0
404	Wed 9-22-21 04:47 AM	100
405	Thu 9-23-21 04:47 AM	0

ORION Profile Viewer - Copyright 2023 Badger Meter, Inc.

ORION Meter Reading Profile

Serial # 81680924

Read #	Read Time	Cubic Feet Use
=====	=====	=====
406	Fri 9-24-21 04:47 AM	0
407	Sat 9-25-21 04:47 AM	0
408	Sun 9-26-21 04:47 AM	0
409	Mon 9-27-21 04:47 AM	0
410	Tue 9-28-21 04:47 AM	0
411	Wed 9-29-21 04:47 AM	0
412	Thu 9-30-21 04:47 AM	0
413	Fri 10-1-21 04:47 AM	100
414	Sat 10-2-21 04:47 AM	0
415	Sun 10-3-21 04:47 AM	0
416	Mon 10-4-21 04:47 AM	0
417	Tue 10-5-21 04:47 AM	0
418	Wed 10-6-21 04:47 AM	0
419	Thu 10-7-21 04:47 AM	0
420	Fri 10-8-21 04:47 AM	0
421	Sat 10-9-21 04:47 AM	0
422	Sun 10-10-21 04:47 AM	0
423	Mon 10-11-21 04:47 AM	100
424	Tue 10-12-21 04:47 AM	0
425	Wed 10-13-21 04:47 AM	0
426	Thu 10-14-21 04:47 AM	0
427	Fri 10-15-21 04:47 AM	0
428	Sat 10-16-21 04:47 AM	0
429	Sun 10-17-21 04:47 AM	0
430	Mon 10-18-21 04:47 AM	0
431	Tue 10-19-21 04:47 AM	100
432	Wed 10-20-21 04:47 AM	0
433	Thu 10-21-21 04:47 AM	0
434	Fri 10-22-21 04:47 AM	0
435	Sat 10-23-21 04:47 AM	0
436	Sun 10-24-21 04:47 AM	0
437	Mon 10-25-21 04:47 AM	0
438	Tue 10-26-21 04:47 AM	0
439	Wed 10-27-21 04:47 AM	0
440	Thu 10-28-21 04:47 AM	0
441	Fri 10-29-21 04:47 AM	100
442	Sat 10-30-21 04:47 AM	0
443	Sun 10-31-21 04:47 AM	0
444	Mon 11-1-21 04:47 AM	0
445	Tue 11-2-21 04:47 AM	0
446	Wed 11-3-21 04:47 AM	0
447	Thu 11-4-21 04:47 AM	0
448	Fri 11-5-21 04:47 AM	0
449	Sat 11-6-21 04:47 AM	0
450	Sun 11-7-21 04:47 AM	0

ORION Profile Viewer - Copyright 2023 Badger Meter, Inc.

ORION Meter Reading Profile

Serial # 81680924

Read #	Read Time	Cubic Feet Use
=====	=====	=====
451	Mon 11-8-21 04:47 AM	100
452	Tue 11-9-21 04:47 AM	0
453	Wed 11-10-21 04:47 AM	0
454	Thu 11-11-21 04:47 AM	0
455	Fri 11-12-21 04:47 AM	0
456	Sat 11-13-21 04:47 AM	0
457	Sun 11-14-21 04:47 AM	0
458	Mon 11-15-21 04:47 AM	0
459	Tue 11-16-21 04:47 AM	0
460	Wed 11-17-21 04:47 AM	100
461	Thu 11-18-21 04:47 AM	0
462	Fri 11-19-21 04:47 AM	0
463	Sat 11-20-21 04:47 AM	0
464	Sun 11-21-21 04:47 AM	0
465	Mon 11-22-21 04:47 AM	0
466	Tue 11-23-21 04:47 AM	0
467	Wed 11-24-21 04:47 AM	0
468	Thu 11-25-21 04:47 AM	100
469	Fri 11-26-21 04:47 AM	0
470	Sat 11-27-21 04:47 AM	0
471	Sun 11-28-21 04:47 AM	0
472	Mon 11-29-21 04:47 AM	0
473	Tue 11-30-21 04:47 AM	0
474	Wed 12-1-21 04:47 AM	0
475	Thu 12-2-21 04:47 AM	0
476	Fri 12-3-21 04:47 AM	0
477	Sat 12-4-21 04:47 AM	0
478	Sun 12-5-21 04:47 AM	100
479	Mon 12-6-21 04:47 AM	0
480	Tue 12-7-21 04:47 AM	0
481	Wed 12-8-21 04:47 AM	0
482	Thu 12-9-21 04:47 AM	0
483	Fri 12-10-21 04:47 AM	0
484	Sat 12-11-21 04:47 AM	0
485	Sun 12-12-21 04:47 AM	0
486	Mon 12-13-21 04:47 AM	100
487	Tue 12-14-21 04:47 AM	0
488	Wed 12-15-21 04:47 AM	0
489	Thu 12-16-21 04:47 AM	0
490	Fri 12-17-21 04:47 AM	0
491	Sat 12-18-21 04:47 AM	0
492	Sun 12-19-21 04:47 AM	0
493	Mon 12-20-21 04:47 AM	0
494	Tue 12-21-21 04:47 AM	0
495	Wed 12-22-21 04:47 AM	100

ORION Profile Viewer - Copyright 2023 Badger Meter, Inc.

ORION Meter Reading Profile

Serial # 81680924

Read #	Read Time	Cubic Feet Use
=====	=====	=====
496	Thu 12-23-21 04:47 AM	0
497	Fri 12-24-21 04:47 AM	0
498	Sat 12-25-21 04:47 AM	0
499	Sun 12-26-21 04:47 AM	0
500	Mon 12-27-21 04:47 AM	0
501	Tue 12-28-21 04:47 AM	0
502	Wed 12-29-21 04:47 AM	0
503	Thu 12-30-21 04:47 AM	0
504	Fri 12-31-21 04:47 AM	0
505	Sat 1-1-22 04:47 AM	100
506	Sun 1-2-22 04:47 AM	0
507	Mon 1-3-22 04:47 AM	0
508	Tue 1-4-22 04:47 AM	0
509	Wed 1-5-22 04:47 AM	0
510	Thu 1-6-22 04:47 AM	0
511	Fri 1-7-22 04:47 AM	0
512	Sat 1-8-22 04:47 AM	100
513	Sun 1-9-22 04:47 AM	0
514	Mon 1-10-22 04:47 AM	0
515	Tue 1-11-22 04:47 AM	0
516	Wed 1-12-22 04:47 AM	0
517	Thu 1-13-22 04:47 AM	0
518	Fri 1-14-22 04:47 AM	0
519	Sat 1-15-22 04:47 AM	100
520	Sun 1-16-22 04:47 AM	0
521	Mon 1-17-22 04:47 AM	0
522	Tue 1-18-22 04:47 AM	0
523	Wed 1-19-22 04:47 AM	0
524	Thu 1-20-22 04:47 AM	0
525	Fri 1-21-22 04:47 AM	0
526	Sat 1-22-22 04:47 AM	100
527	Sun 1-23-22 04:47 AM	0
528	Mon 1-24-22 04:47 AM	0
529	Tue 1-25-22 04:47 AM	0
530	Wed 1-26-22 04:47 AM	0
531	Thu 1-27-22 04:47 AM	0
532	Fri 1-28-22 04:47 AM	100
533	Sat 1-29-22 04:47 AM	0
534	Sun 1-30-22 04:47 AM	0
535	Mon 1-31-22 04:47 AM	0
536	Tue 2-1-22 04:47 AM	0
537	Wed 2-2-22 04:47 AM	0
538	Thu 2-3-22 04:47 AM	0
539	Fri 2-4-22 04:47 AM	100
540	Sat 2-5-22 04:47 AM	0

ORION Profile Viewer - Copyright 2023 Badger Meter, Inc.

ORION Meter Reading Profile

Serial # 81680924

Read #	Read Time	Cubic Feet Use
=====	=====	=====
541	Sun 2-6-22 04:47 AM	0
542	Mon 2-7-22 04:47 AM	0
543	Tue 2-8-22 04:47 AM	0
544	Wed 2-9-22 04:47 AM	0
545	Thu 2-10-22 04:47 AM	0
546	Fri 2-11-22 04:47 AM	100
547	Sat 2-12-22 04:47 AM	0
548	Sun 2-13-22 04:47 AM	0
549	Mon 2-14-22 04:47 AM	0
550	Tue 2-15-22 04:47 AM	0
551	Wed 2-16-22 04:47 AM	100
552	Thu 2-17-22 04:47 AM	0
553	Fri 2-18-22 04:47 AM	0
554	Sat 2-19-22 04:47 AM	0
555	Sun 2-20-22 04:47 AM	0
556	Mon 2-21-22 04:47 AM	0
557	Tue 2-22-22 04:47 AM	100
558	Wed 2-23-22 04:47 AM	0
559	Thu 2-24-22 04:47 AM	0
560	Fri 2-25-22 04:47 AM	0
561	Sat 2-26-22 04:47 AM	0
562	Sun 2-27-22 04:47 AM	0
563	Mon 2-28-22 04:47 AM	100
564	Tue 3-1-22 04:47 AM	0
565	Wed 3-2-22 04:47 AM	0
566	Thu 3-3-22 04:47 AM	0
567	Fri 3-4-22 04:47 AM	0
568	Sat 3-5-22 04:47 AM	0
569	Sun 3-6-22 04:47 AM	0
570	Mon 3-7-22 04:47 AM	100
571	Tue 3-8-22 04:47 AM	0
572	Wed 3-9-22 04:47 AM	0
573	Thu 3-10-22 04:47 AM	0
574	Fri 3-11-22 04:47 AM	0
575	Sat 3-12-22 04:47 AM	100
576	Sun 3-13-22 04:47 AM	0
577	Mon 3-14-22 04:47 AM	0
578	Tue 3-15-22 04:47 AM	0
579	Wed 3-16-22 04:47 AM	0
580	Thu 3-17-22 04:47 AM	0
581	Fri 3-18-22 04:47 AM	100
582	Sat 3-19-22 04:47 AM	0
583	Sun 3-20-22 04:47 AM	0
584	Mon 3-21-22 04:47 AM	0
585	Tue 3-22-22 04:47 AM	0

ORION Profile Viewer - Copyright 2023 Badger Meter, Inc.

ORION Meter Reading Profile

Serial # 81680924

Read #	Read Time	Cubic Feet Use
=====	=====	=====
586	Wed 3-23-22 04:47 AM	0
587	Thu 3-24-22 04:47 AM	100
588	Fri 3-25-22 04:47 AM	0
589	Sat 3-26-22 04:47 AM	0
590	Sun 3-27-22 04:47 AM	0
591	Mon 3-28-22 04:47 AM	0
592	Tue 3-29-22 04:47 AM	0
593	Wed 3-30-22 04:47 AM	100
594	Thu 3-31-22 04:47 AM	0
595	Fri 4-1-22 04:47 AM	0
596	Sat 4-2-22 04:47 AM	0
597	Sun 4-3-22 04:47 AM	0
598	Mon 4-4-22 04:47 AM	100
599	Tue 4-5-22 04:47 AM	0
600	Wed 4-6-22 04:47 AM	0
601	Thu 4-7-22 04:47 AM	0
602	Fri 4-8-22 04:47 AM	0
603	Sat 4-9-22 04:47 AM	0
604	Sun 4-10-22 04:47 AM	0
605	Mon 4-11-22 04:47 AM	100
606	Tue 4-12-22 04:47 AM	0
607	Wed 4-13-22 04:47 AM	0
608	Thu 4-14-22 04:47 AM	0
609	Fri 4-15-22 04:47 AM	0
610	Sat 4-16-22 04:47 AM	0
611	Sun 4-17-22 04:47 AM	100
612	Mon 4-18-22 04:47 AM	0
613	Tue 4-19-22 04:47 AM	0
614	Wed 4-20-22 04:47 AM	0
615	Thu 4-21-22 04:47 AM	0
616	Fri 4-22-22 04:47 AM	0
617	Sat 4-23-22 04:47 AM	100
618	Sun 4-24-22 04:47 AM	0
619	Mon 4-25-22 04:47 AM	0
620	Tue 4-26-22 04:47 AM	0
621	Wed 4-27-22 04:47 AM	0
622	Thu 4-28-22 04:47 AM	0
623	Fri 4-29-22 04:47 AM	100
624	Sat 4-30-22 04:47 AM	0
625	Sun 5-1-22 04:47 AM	0
626	Mon 5-2-22 04:47 AM	0
627	Tue 5-3-22 04:47 AM	0
628	Wed 5-4-22 04:47 AM	0
629	Thu 5-5-22 04:47 AM	0
630	Fri 5-6-22 04:47 AM	100

ORION Profile Viewer - Copyright 2023 Badger Meter, Inc.

ORION Meter Reading Profile

Serial # 81680924

Read #	Read Time	Cubic Feet Use
=====	=====	=====
631	Sat 5-7-22 04:47 AM	0
632	Sun 5-8-22 04:47 AM	0
633	Mon 5-9-22 04:47 AM	0
634	Tue 5-10-22 04:47 AM	0
635	Wed 5-11-22 04:47 AM	0
636	Thu 5-12-22 04:47 AM	0
637	Fri 5-13-22 04:47 AM	100
638	Sat 5-14-22 04:47 AM	0
639	Sun 5-15-22 04:47 AM	0
640	Mon 5-16-22 04:47 AM	0
641	Tue 5-17-22 04:47 AM	0
642	Wed 5-18-22 04:47 AM	0
643	Thu 5-19-22 04:47 AM	100
644	Fri 5-20-22 04:47 AM	0
645	Sat 5-21-22 04:47 AM	0
646	Sun 5-22-22 04:47 AM	0
647	Mon 5-23-22 04:47 AM	0
648	Tue 5-24-22 04:47 AM	0
649	Wed 5-25-22 04:47 AM	0
650	Thu 5-26-22 04:47 AM	100
651	Fri 5-27-22 04:47 AM	0
652	Sat 5-28-22 04:47 AM	0
653	Sun 5-29-22 04:47 AM	0
654	Mon 5-30-22 04:47 AM	0
655	Tue 5-31-22 04:47 AM	0
656	Wed 6-1-22 04:47 AM	0
657	Thu 6-2-22 04:47 AM	100
658	Fri 6-3-22 04:47 AM	0
659	Sat 6-4-22 04:47 AM	0
660	Sun 6-5-22 04:47 AM	0
661	Mon 6-6-22 04:47 AM	0
662	Tue 6-7-22 04:47 AM	0
663	Wed 6-8-22 04:47 AM	0
664	Thu 6-9-22 04:47 AM	0
665	Fri 6-10-22 04:47 AM	100
666	Sat 6-11-22 04:47 AM	0
667	Sun 6-12-22 04:47 AM	0
668	Mon 6-13-22 04:47 AM	0
669	Tue 6-14-22 04:47 AM	0
670	Wed 6-15-22 04:47 AM	0
671	Thu 6-16-22 04:47 AM	0
672	Fri 6-17-22 04:47 AM	0
673	Sat 6-18-22 04:47 AM	100
674	Sun 6-19-22 04:47 AM	0
675	Mon 6-20-22 04:47 AM	0

ORION Profile Viewer - Copyright 2023 Badger Meter, Inc.

ORION Meter Reading Profile

Serial # 81680924

Read #	Read Time	Cubic Feet Use
=====	=====	=====
676	Tue 6-21-22 04:47 AM	0
677	Wed 6-22-22 04:47 AM	0
678	Thu 6-23-22 04:47 AM	0
679	Fri 6-24-22 04:47 AM	0
680	Sat 6-25-22 04:47 AM	100
681	Sun 6-26-22 04:47 AM	0
682	Mon 6-27-22 04:47 AM	0
683	Tue 6-28-22 04:47 AM	0
684	Wed 6-29-22 04:47 AM	0
685	Thu 6-30-22 04:47 AM	0
686	Fri 7-1-22 04:47 AM	0
687	Sat 7-2-22 04:47 AM	100
688	Sun 7-3-22 04:47 AM	0
689	Mon 7-4-22 04:47 AM	0
690	Tue 7-5-22 04:47 AM	0
691	Wed 7-6-22 04:47 AM	0
692	Thu 7-7-22 04:47 AM	100
693	Fri 7-8-22 04:47 AM	0
694	Sat 7-9-22 04:47 AM	0
695	Sun 7-10-22 04:47 AM	0
696	Mon 7-11-22 04:47 AM	0
697	Tue 7-12-22 04:47 AM	0
698	Wed 7-13-22 04:47 AM	100
699	Thu 7-14-22 04:47 AM	0
700	Fri 7-15-22 04:47 AM	0
701	Sat 7-16-22 04:47 AM	0
702	Sun 7-17-22 04:47 AM	0
703	Mon 7-18-22 04:47 AM	0
704	Tue 7-19-22 04:47 AM	0
705	Wed 7-20-22 04:47 AM	100
706	Thu 7-21-22 04:47 AM	0
707	Fri 7-22-22 04:47 AM	0
708	Sat 7-23-22 04:47 AM	0
709	Sun 7-24-22 04:47 AM	0
710	Mon 7-25-22 04:47 AM	0
711	Tue 7-26-22 04:47 AM	0
712	Wed 7-27-22 04:47 AM	100
713	Thu 7-28-22 04:47 AM	0
714	Fri 7-29-22 04:47 AM	0
715	Sat 7-30-22 04:47 AM	0
716	Sun 7-31-22 04:47 AM	0
717	Mon 8-1-22 04:47 AM	0
718	Tue 8-2-22 04:47 AM	0
719	Wed 8-3-22 04:47 AM	100
720	Thu 8-4-22 04:47 AM	0

ORION Profile Viewer - Copyright 2023 Badger Meter, Inc.

ORION Meter Reading Profile

Serial # 81680924

Read #	Read Time	Cubic Feet Use
=====	=====	=====
721	Fri 8-5-22 04:47 AM	0
722	Sat 8-6-22 04:47 AM	0
723	Sun 8-7-22 04:47 AM	0
724	Mon 8-8-22 04:47 AM	0
725	Tue 8-9-22 04:47 AM	0
726	Wed 8-10-22 04:47 AM	100
727	Thu 8-11-22 04:47 AM	0
728	Fri 8-12-22 04:47 AM	0
729	Sat 8-13-22 04:47 AM	0
730	Sun 8-14-22 04:47 AM	0
731	Mon 8-15-22 04:47 AM	0
732	Tue 8-16-22 04:47 AM	100
733	Wed 8-17-22 04:47 AM	0
734	Thu 8-18-22 04:47 AM	0
735	Fri 8-19-22 04:47 AM	0
736	Sat 8-20-22 04:47 AM	0
737	Sun 8-21-22 04:47 AM	0
738	Mon 8-22-22 04:47 AM	100
739	Tue 8-23-22 04:47 AM	100
740	Wed 8-24-22 04:47 AM	0
741	Thu 8-25-22 04:47 AM	100
742	Fri 8-26-22 04:47 AM	0
743	Sat 8-27-22 04:47 AM	100
744	Sun 8-28-22 04:47 AM	0
745	Mon 8-29-22 04:47 AM	100
746	Tue 8-30-22 04:47 AM	100
747	Wed 8-31-22 04:47 AM	0
748	Thu 9-1-22 04:47 AM	100
749	Fri 9-2-22 04:47 AM	0
750	Sat 9-3-22 04:47 AM	100
751	Sun 9-4-22 04:47 AM	0
752	Mon 9-5-22 04:47 AM	100
753	Tue 9-6-22 04:47 AM	100
754	Wed 9-7-22 04:47 AM	0
755	Thu 9-8-22 04:47 AM	100
756	Fri 9-9-22 04:47 AM	100
757	Sat 9-10-22 04:47 AM	0
758	Sun 9-11-22 04:47 AM	100
759	Mon 9-12-22 04:47 AM	0
760	Tue 9-13-22 04:47 AM	100
761	Wed 9-14-22 04:47 AM	100
762	Thu 9-15-22 04:47 AM	100
763	Fri 9-16-22 04:47 AM	0
764	Sat 9-17-22 04:47 AM	100
765	Sun 9-18-22 04:47 AM	0

ORION Profile Viewer - Copyright 2023 Badger Meter, Inc.

ORION Meter Reading Profile Serial # 81680924

Read #	Read Time	Cubic Feet Use
=====	=====	=====
766	Mon 9-19-22 04:47 AM	100
767	Tue 9-20-22 04:47 AM	100
768	Wed 9-21-22 04:47 AM	0
769	Thu 9-22-22 04:47 AM	100
770	Fri 9-23-22 04:47 AM	100
771	Sat 9-24-22 04:47 AM	0
772	Sun 9-25-22 04:47 AM	100
773	Mon 9-26-22 04:47 AM	100
774	Tue 9-27-22 04:47 AM	0
775	Wed 9-28-22 04:47 AM	100
776	Thu 9-29-22 04:47 AM	100
777	Fri 9-30-22 04:47 AM	0
778	Sat 10-1-22 04:47 AM	100
779	Sun 10-2-22 04:47 AM	100
780	Mon 10-3-22 04:47 AM	0
781	Tue 10-4-22 04:47 AM	100
782	Wed 10-5-22 04:47 AM	100
783	Thu 10-6-22 04:47 AM	0
784	Fri 10-7-22 04:47 AM	100
785	Sat 10-8-22 04:47 AM	100
786	Sun 10-9-22 04:47 AM	0
787	Mon 10-10-22 04:47 AM	100
788	Tue 10-11-22 04:47 AM	100
789	Wed 10-12-22 04:47 AM	0
790	Thu 10-13-22 04:47 AM	100
791	Fri 10-14-22 04:47 AM	100
792	Sat 10-15-22 04:47 AM	0
793	Sun 10-16-22 04:47 AM	100
794	Mon 10-17-22 04:47 AM	100
795	Tue 10-18-22 04:47 AM	0
796	Wed 10-19-22 04:47 AM	100
797	Thu 10-20-22 04:47 AM	100
798	Fri 10-21-22 04:47 AM	100
799	Sat 10-22-22 04:47 AM	0
800	Sun 10-23-22 04:47 AM	100
801	Mon 10-24-22 04:47 AM	100
802	Tue 10-25-22 04:47 AM	0
803	Wed 10-26-22 04:47 AM	100
804	Thu 10-27-22 04:47 AM	100
805	Fri 10-28-22 04:47 AM	0
806	Sat 10-29-22 04:47 AM	100
807	Sun 10-30-22 04:47 AM	100
808	Mon 10-31-22 04:47 AM	0
809	Tue 11-1-22 04:47 AM	100
810	Wed 11-2-22 04:47 AM	100

ORION Profile Viewer - Copyright 2023 Badger Meter, Inc.

ORION Meter Reading Profile

Serial # 81680924

Read #	Read Time	Cubic Feet Use
=====	=====	=====
811	Thu 11-3-22 04:47 AM	0
812	Fri 11-4-22 04:47 AM	100
813	Sat 11-5-22 04:47 AM	100
814	Sun 11-6-22 04:47 AM	0
815	Mon 11-7-22 04:47 AM	100
816	Tue 11-8-22 04:47 AM	100
817	Wed 11-9-22 04:47 AM	0
818	Thu 11-10-22 04:47 AM	100
819	Fri 11-11-22 04:47 AM	100
820	Sat 11-12-22 04:47 AM	0
821	Sun 11-13-22 04:47 AM	100
822	Mon 11-14-22 04:47 AM	100
823	Tue 11-15-22 04:47 AM	100
824	Wed 11-16-22 04:47 AM	0
825	Thu 11-17-22 04:47 AM	100
826	Fri 11-18-22 04:47 AM	100
827	Sat 11-19-22 04:47 AM	0
828	Sun 11-20-22 04:47 AM	100
829	Mon 11-21-22 04:47 AM	100
830	Tue 11-22-22 04:47 AM	0
831	Wed 11-23-22 04:47 AM	100
832	Thu 11-24-22 04:47 AM	100
833	Fri 11-25-22 04:47 AM	0
834	Sat 11-26-22 04:47 AM	100
835	Sun 11-27-22 04:47 AM	0
836	Mon 11-28-22 04:47 AM	100
837	Tue 11-29-22 04:47 AM	100
838	Wed 11-30-22 04:47 AM	0
839	Thu 12-1-22 04:47 AM	100
840	Fri 12-2-22 04:47 AM	0
841	Sat 12-3-22 04:47 AM	0
842	Sun 12-4-22 04:47 AM	0
843	Mon 12-5-22 04:47 AM	100
844	Tue 12-6-22 04:47 AM	0
845	Wed 12-7-22 04:47 AM	0
846	Thu 12-8-22 04:47 AM	0
847	Fri 12-9-22 04:47 AM	0
848	Sat 12-10-22 04:47 AM	100
849	Sun 12-11-22 04:47 AM	0
850	Mon 12-12-22 04:47 AM	0
851	Tue 12-13-22 04:47 AM	0
852	Wed 12-14-22 04:47 AM	0
853	Thu 12-15-22 04:47 AM	0
854	Fri 12-16-22 04:47 AM	0
855	Sat 12-17-22 04:47 AM	100

ORION Profile Viewer - Copyright 2023 Badger Meter, Inc.

ORION Meter Reading Profile

Serial # 81680924

Read #	Read Time	Cubic Feet Use
=====	=====	=====
856	Sun 12-18-22 04:47 AM	0
857	Mon 12-19-22 04:47 AM	0
858	Tue 12-20-22 04:47 AM	0
859	Wed 12-21-22 04:47 AM	0
860	Thu 12-22-22 04:47 AM	0
861	Fri 12-23-22 04:47 AM	0
862	Sat 12-24-22 04:47 AM	0
863	Sun 12-25-22 04:47 AM	100
864	Mon 12-26-22 04:47 AM	0
865	Tue 12-27-22 04:47 AM	0
866	Wed 12-28-22 04:47 AM	0
867	Thu 12-29-22 04:47 AM	0
868	Fri 12-30-22 04:47 AM	0
869	Sat 12-31-22 04:47 AM	100
870	Sun 1-1-23 04:47 AM	0
871	Mon 1-2-23 04:47 AM	0
872	Tue 1-3-23 04:47 AM	0
873	Wed 1-4-23 04:47 AM	0
874	Thu 1-5-23 04:47 AM	0
875	Fri 1-6-23 04:47 AM	100
876	Sat 1-7-23 04:47 AM	0
877	Sun 1-8-23 04:47 AM	0
878	Mon 1-9-23 04:47 AM	0
879	Tue 1-10-23 04:47 AM	0
880	Wed 1-11-23 04:47 AM	0
881	Thu 1-12-23 04:47 AM	0
882	Fri 1-13-23 04:47 AM	100
883	Sat 1-14-23 04:47 AM	0
884	Sun 1-15-23 04:47 AM	0
885	Mon 1-16-23 04:47 AM	0
886	Tue 1-17-23 04:47 AM	0
887	Wed 1-18-23 04:47 AM	6553500
888	Thu 1-19-23 04:47 AM	0
889	Fri 1-20-23 04:47 AM	0
890	Sat 1-21-23 04:47 AM	0
891	Sun 1-22-23 04:47 AM	100
892	Mon 1-23-23 04:47 AM	0
893	Tue 1-24-23 04:47 AM	0



*Carl E Knochelmann
3032 Belle Meade Lane
Edgewood, KY 41017

*Northern Kentucky Water District
2835 Crescent Springs Road
P. O. Box 18640
Erlanger, KY 41018-0640