




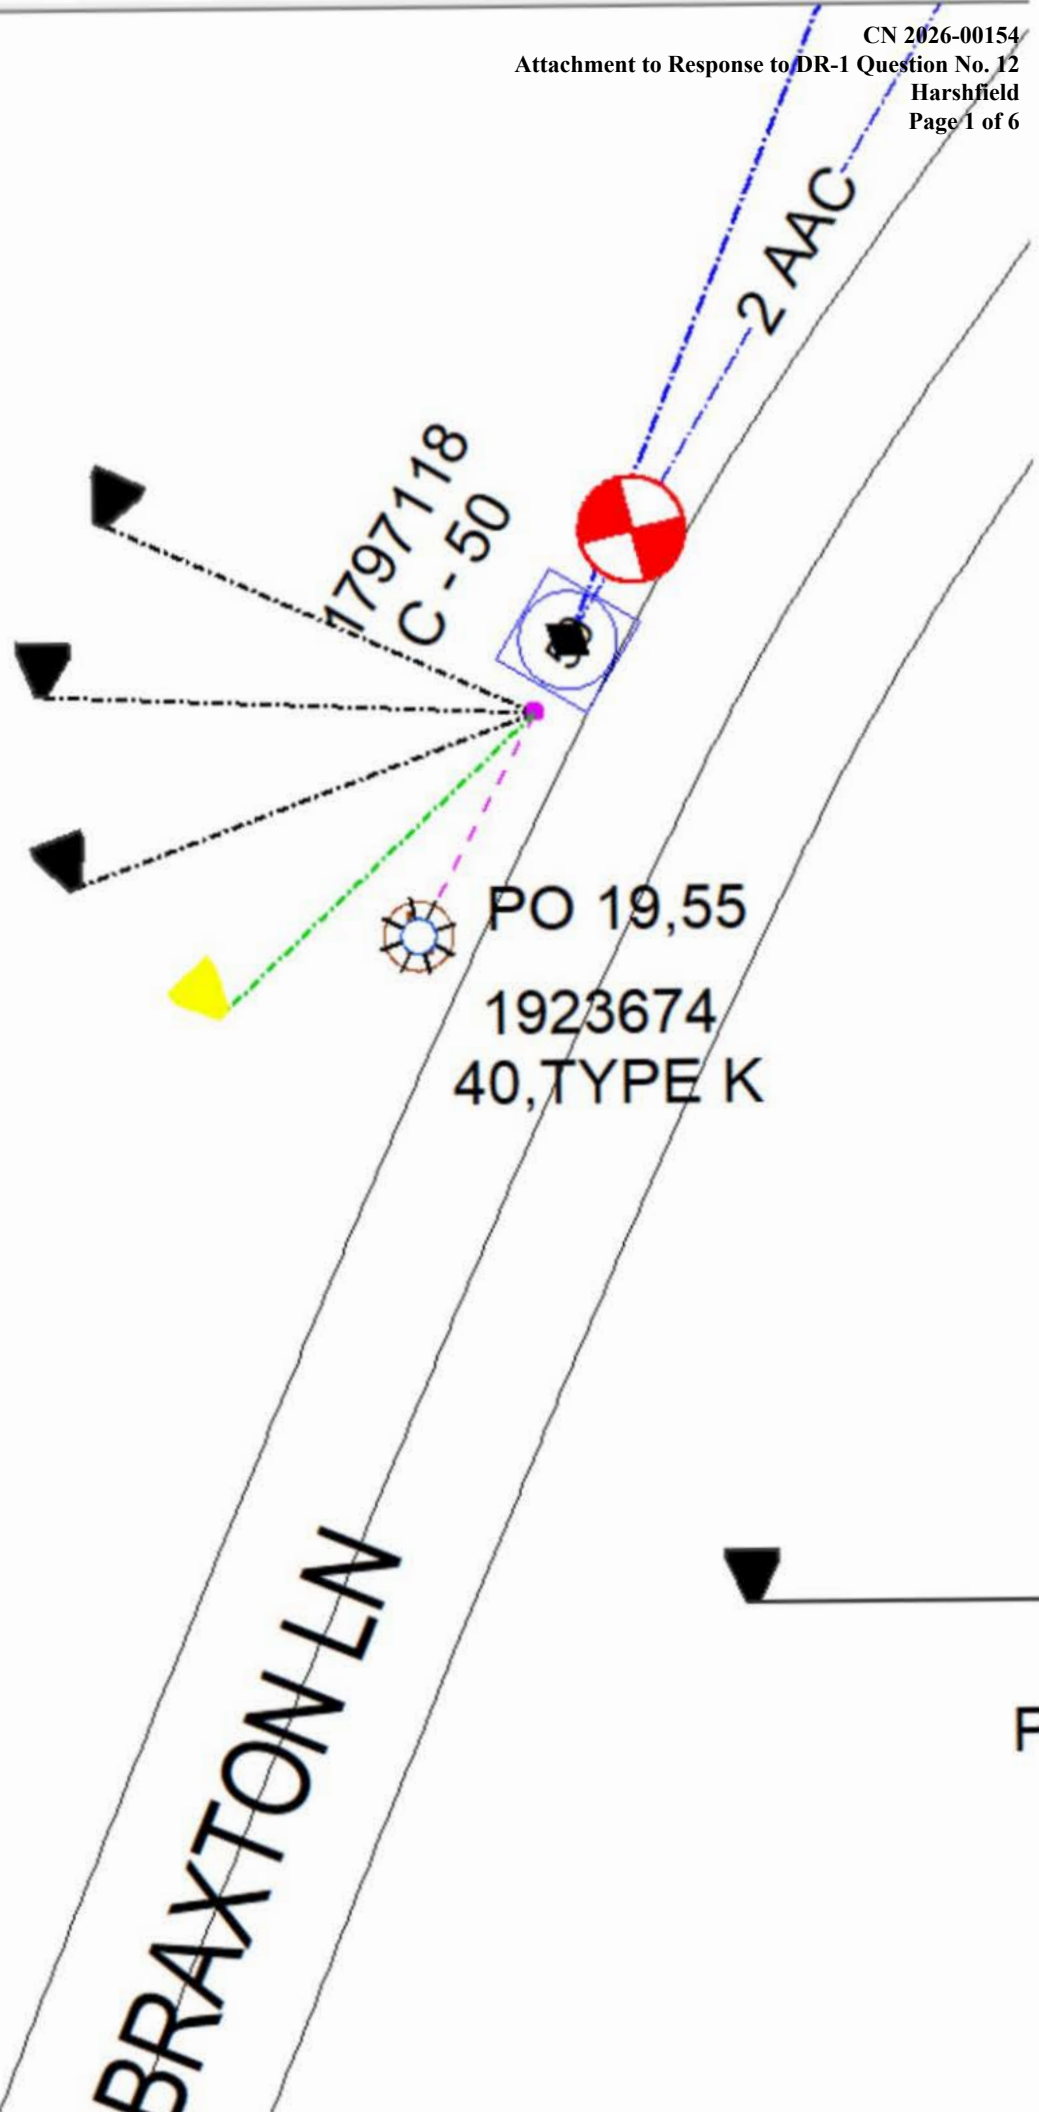

[Electric] Secondary UG Conductor (Secondary UG Segment(20518045 Unknown))

[Electric] Transformer UG Bank

Field name	Value	Δ	*	C
Facility Status	Existing		*	
Standard Item Number	7001428		*	
Standard Item Type	KU DESIGN		*	
Standard Item Description	CONDUCTOR,UG/600V 3/C,2#2/0AL W...		*	
Conductor Size	2/0		*	
Metal	AAC		*	
Strand			*	
Wire Type	TX		*	
Rated Voltage	600		*	
Wire Name	CONVERSE		*	
Cable Construction			*	
Date Installed	05/10/1999			
No Conductors	1			
Secondary UG Segment	20518045		*	
Id	20518053		*	

Field name	Value
Location	✓
Structural Location	✓
Secondary Location	✓
Transformers	1
Load Type	
Facility Status	Existing
Owner	KU
Substation Name	HOPEWELL
Circuit Name	0258
Phase	C
Underground Circuit Nu...	
Secondary Voltage	120/240
Connection Arrangement	Wye / Wye
Current Load	
Study Load	
Operating Number (TLM)	1797118
Structure Location ID	UT19825354973
Location Description	241 BRAXTON LILY
Date Installed	05/10/1999
Kva_rating Large Scale...	✓
Large Scale Anno	✓
Medium Scale Anno	✓
Small Scale Anno	
Id	23699732

