



a PPL company

RECEIVED

FEB 27 2015

PUBLIC SERVICE
COMMISSION

Jeff DeRouen
Executive Director
Kentucky Public Service Commission
211 Sower Boulevard
Frankfort, Kentucky 40601

**Louisville Gas and Electric
Company**
State Regulation and Rates
220 W. Main Street
Louisville, KY 40202
www.lge-ku.com

Martin J. Reinert
Sr. Regulatory Analyst
O 502-627-4173
marty.reinert@lge-ku.com

February 27, 2015

Re: *In the Matter of: Joint Application of Inter County Energy Cooperative, Kentucky Power Company, Kentucky Utilities Company, Louisville Gas and Electric Company, Owen Electric Cooperative, Shelby Energy Cooperative, Inc., and the Union Light, Heat & Power Company for Approval of a Pilot Meter Testing Plan Pursuant 807 KAR 5:041, Section 13, 15, 16, 17, and 22, Case No. 2005-00276*

Annual Report – Louisville Gas and Electric Company

Dear Mr. DeRouen:

The Kentucky Public Service Commission (“Commission”) originally approved a pilot sample meter testing plan for participating electric utilities in its Order of December 12, 2000, in Case Number 99-441. On November 10, 2005, in Case No. 2005-00276, the Commission approved the 2006 Sample Meter Testing Plan submitted by participating electric utilities on a permanent basis effective January 1, 2006.

Pursuant to the 2006 Sample Meter Testing Plan (originally filed on July 1, 2005), Section I(4) and Section II(D)(4), **Louisville Gas and Electric Company** submits the following:

The Certified Test Results of all new meters received
(Attachment A)

2014 Statistical Sampling Test Results and Summary
(Attachment B)

If you have any questions please do not hesitate to contact me.

Sincerely,

Marty J. Reinert

Marty J. Reinert

Cc: Kyle Willard, Engineering Director PSC

Attachments

ATTACHMENT
A

Certified Test Results

LG&E and KU Energy LLC

5040 Annual Report of New Single Phase Meters

Update:

02/16/2015 05:26:33

Dynamic Filters

Plant LG&E
Test Date 01/01/2014 - 12/31/2014

Plant	Manf. Model Number	Serial Number	Calendar Month/Year	Test Date	As Left Full Load	As Left Light Load	As Left Power Factor	Number of records
LG&E	C1S	885820	01/2014	01/15/2014	100.080	99.950	100.1	1
LG&E	C1S	885821	01/2014	01/15/2014	100.100	99.970	100.0	1
LG&E	C1S	885822	01/2014	01/15/2014	100.090	99.960	100.0	1
LG&E	C1S	885823	01/2014	01/15/2014	100.070	99.930	100.1	1
LG&E	C1S	885824	01/2014	01/15/2014	100.060	99.920	99.9	1
LG&E	C1S	885825	01/2014	01/15/2014	100.070	99.930	100.0	1
LG&E	C1S	885826	01/2014	01/15/2014	100.050	99.880	100.0	1
LG&E	C1S	885827	01/2014	01/15/2014	100.060	99.880	100.0	1
LG&E	C1S	885828	01/2014	01/15/2014	100.050	99.860	100.0	1
LG&E	C1S	885829	01/2014	01/15/2014	100.080	99.960	99.9	1
LG&E	C1S	885830	01/2014	01/15/2014	100.050	99.920	99.9	1
LG&E	C1S	885831	01/2014	01/15/2014	100.060	99.900	99.9	1
LG&E	C1S	885832	01/2014	01/15/2014	100.090	99.910	100.0	1
LG&E	C1S	885833	01/2014	01/15/2014	100.080	99.940	100.1	1
LG&E	C1S	885834	01/2014	01/15/2014	100.070	99.940	100.0	1
LG&E	C1S	885835	01/2014	01/15/2014	100.080	99.920	99.9	1
LG&E	C1S	885836	01/2014	01/15/2014	100.070	99.950	100.0	1
LG&E	C1S	885837	01/2014	01/15/2014	100.030	99.860	100.0	1
LG&E	C1S	885838	01/2014	01/15/2014	100.060	99.940	100.1	1

LG&E	C1S	885839	01/2014	01/15/2014	100.060	99.880	100.0	1
LG&E	C1S	885840	01/2014	01/15/2014	100.060	99.890	100.0	1
LG&E	C1S	885841	01/2014	01/15/2014	100.070	99.930	100.0	1
LG&E	C1S	885842	01/2014	01/15/2014	100.060	99.910	100.0	1
LG&E	C1S	885843	01/2014	01/15/2014	100.100	99.960	100.1	1
LG&E	C1S	885844	01/2014	01/15/2014	100.070	99.950	100.0	1
LG&E	C1S	885845	01/2014	01/15/2014	100.100	99.910	100.0	1
LG&E	C1S	885846	01/2014	01/15/2014	100.060	99.860	100.0	1
LG&E	C1S	885847	01/2014	01/15/2014	100.070	99.950	99.9	1
LG&E	C1S	885848	01/2014	01/15/2014	100.050	99.890	100.0	1
LG&E	C1S	885849	01/2014	01/15/2014	100.080	99.920	100.0	1
LG&E	C1S	885850	01/2014	01/15/2014	100.090	99.880	100.1	1
LG&E	C1S	885851	01/2014	01/15/2014	100.070	99.870	100.1	1
LG&E	C1S	885852	01/2014	01/15/2014	100.070	99.930	100.0	1
LG&E	C1S	885853	01/2014	01/15/2014	100.030	99.890	100.0	1
LG&E	C1S	885854	01/2014	01/15/2014	100.060	99.880	100.0	1
LG&E	C1S	885855	01/2014	01/15/2014	100.100	99.960	100.0	1
LG&E	C1S	885856	01/2014	01/15/2014	100.090	99.940	100.0	1
LG&E	C1S	885857	01/2014	01/15/2014	100.090	99.950	100.0	1
LG&E	C1S	885858	01/2014	01/15/2014	100.110	100.020	100.0	1
LG&E	C1S	885859	01/2014	01/15/2014	100.060	99.900	100.1	1
LG&E	C1S	885860	01/2014	01/15/2014	100.080	99.890	100.1	1
LG&E	C1S	885861	01/2014	01/15/2014	100.100	99.940	100.0	1
LG&E	C1S	885862	01/2014	01/15/2014	100.090	100.010	100.0	1
LG&E	C1S	885863	01/2014	01/15/2014	100.050	99.910	100.0	1
LG&E	C1S	885864	01/2014	01/15/2014	100.100	99.960	100.0	1
LG&E	C1S	885865	01/2014	01/15/2014	100.060	99.920	100.0	1
LG&E	C1S	885866	01/2014	01/15/2014	100.090	99.930	100.1	1
LG&E	C1S	885867	01/2014	01/15/2014	100.070	99.940	100.0	1
LG&E	C1S	885868	01/2014	01/15/2014	100.040	99.880	100.0	1
LG&E	C1S	885869	01/2014	01/15/2014	100.070	99.860	100.0	1
LG&E	C1S	885870	01/2014	01/15/2014	100.050	99.880	100.0	1

LG&E	C1S	885871	01/2014	01/15/2014	100.090	99.990	100.1	1
LG&E	C1S	885872	01/2014	01/15/2014	100.060	99.860	100.0	1
LG&E	C1S	885873	01/2014	01/15/2014	100.080	99.900	100.0	1
LG&E	C1S	885874	01/2014	01/15/2014	100.090	99.960	100.0	1
LG&E	C1S	885875	01/2014	01/15/2014	100.050	99.870	100.0	1
LG&E	C1S	885876	01/2014	01/15/2014	100.060	99.910	99.9	1
LG&E	C1S	885877	01/2014	01/15/2014	100.100	99.910	99.9	1
LG&E	C1S	885878	01/2014	01/15/2014	100.030	99.900	100.0	1
LG&E	C1S	885879	01/2014	01/15/2014	100.100	99.970	99.9	1
LG&E	C1S	885880	01/2014	01/15/2014	100.070	99.940	99.9	1
LG&E	C1S	885881	01/2014	01/15/2014	100.080	99.920	100.1	1
LG&E	C1S	885882	01/2014	01/15/2014	100.030	99.840	100.0	1
LG&E	C1S	885883	01/2014	01/15/2014	100.070	99.870	100.0	1
LG&E	C1S	885884	01/2014	01/15/2014	100.050	99.900	100.0	1
LG&E	C1S	885885	01/2014	01/15/2014	100.060	99.910	100.0	1
LG&E	C1S	885886	01/2014	01/15/2014	100.080	99.940	100.0	1
LG&E	C1S	885887	01/2014	01/15/2014	100.050	99.920	100.0	1
LG&E	C1S	885888	01/2014	01/15/2014	100.100	99.970	100.1	1
LG&E	C1S	885889	01/2014	01/15/2014	100.100	99.920	100.0	1
LG&E	C1S	885890	01/2014	01/15/2014	100.080	99.960	100.0	1
LG&E	C1S	885891	01/2014	01/15/2014	100.100	99.960	100.0	1
LG&E	C1S	885892	01/2014	01/15/2014	100.070	99.940	100.0	1
LG&E	C1S	885893	01/2014	01/15/2014	100.090	99.910	100.0	1
LG&E	C1S	885894	01/2014	01/15/2014	100.080	99.880	100.0	1
LG&E	C1S	885895	01/2014	01/15/2014	100.060	99.890	100.0	1
LG&E	C1S	885896	01/2014	01/15/2014	100.080	99.910	99.9	1
LG&E	C1S	885897	01/2014	01/15/2014	100.050	99.870	100.1	1
LG&E	C1S	885898	01/2014	01/15/2014	100.030	99.880	100.0	1
LG&E	C1S	885899	01/2014	01/15/2014	100.050	99.890	100.0	1
LG&E	C1S	885900	01/2014	01/15/2014	100.080	99.970	100.0	1
LG&E	C1S	885901	01/2014	01/15/2014	100.070	99.860	100.0	1
LG&E	C1S	885902	01/2014	01/15/2014	100.070	99.950	100.0	1

LG&E	C1S	885903	01/2014	01/15/2014	100.080	99.920	100.0	1
LG&E	C1S	885904	01/2014	01/15/2014	100.070	99.920	100.0	1
LG&E	C1S	885905	01/2014	01/15/2014	100.030	99.850	100.0	1
LG&E	C1S	885906	01/2014	01/15/2014	100.060	99.920	100.1	1
LG&E	C1S	885907	01/2014	01/15/2014	100.070	99.950	99.9	1
LG&E	C1S	885908	01/2014	01/15/2014	100.080	100.010	100.0	1
LG&E	C1S	885909	01/2014	01/15/2014	100.080	99.910	100.0	1
LG&E	C1S	885910	01/2014	01/15/2014	100.060	99.900	100.0	1
LG&E	C1S	885911	01/2014	01/15/2014	100.100	99.910	100.0	1
LG&E	C1S	885912	01/2014	01/15/2014	100.090	99.970	100.0	1
LG&E	C1S	885913	01/2014	01/15/2014	100.050	99.890	100.0	1
LG&E	C1S	885914	01/2014	01/15/2014	100.070	99.910	100.0	1
LG&E	C1S	885915	01/2014	01/15/2014	100.100	99.930	99.9	1
LG&E	C1S	885916	01/2014	01/15/2014	100.100	99.930	100.0	1
LG&E	C1S	885917	01/2014	01/15/2014	100.070	99.920	100.0	1
LG&E	C1S	885918	01/2014	01/15/2014	100.100	100.010	100.0	1
LG&E	C1S	885919	01/2014	01/15/2014	100.060	99.890	100.0	1
LG&E	C1S	885920	01/2014	01/15/2014	100.070	99.820	100.0	1
LG&E	C1S	885921	01/2014	01/15/2014	100.050	99.950	100.0	1
LG&E	C1S	885922	01/2014	01/15/2014	100.080	99.980	100.0	1
LG&E	C1S	885923	01/2014	01/15/2014	100.070	99.950	100.1	1
LG&E	C1S	885924	01/2014	01/15/2014	100.060	99.860	100.0	1
LG&E	C1S	885925	01/2014	01/15/2014	100.040	99.910	100.0	1
LG&E	C1S	885926	01/2014	01/15/2014	100.030	99.910	100.0	1
LG&E	C1S	885927	01/2014	01/15/2014	100.090	99.990	100.1	1
LG&E	C1S	885928	01/2014	01/15/2014	100.040	99.890	100.0	1
LG&E	C1S	885929	01/2014	01/15/2014	100.030	99.860	100.0	1
LG&E	C1S	885930	01/2014	01/15/2014	100.070	99.910	100.0	1
LG&E	C1S	885931	01/2014	01/15/2014	100.080	99.910	99.9	1
LG&E	C1S	885932	01/2014	01/15/2014	100.060	99.880	100.0	1
LG&E	C1S	885933	01/2014	01/15/2014	100.030	99.850	100.0	1
LG&E	C1S	885934	01/2014	01/15/2014	100.090	99.940	100.0	1

LG&E	C1S	885935	01/2014	01/15/2014	100.060	99.800	100.0	1
LG&E	C1S	885936	01/2014	01/15/2014	100.070	99.920	100.1	1
LG&E	C1S	885937	01/2014	01/15/2014	100.090	99.900	100.0	1
LG&E	C1S	885938	01/2014	01/15/2014	100.050	99.940	100.0	1
LG&E	C1S	885939	01/2014	01/15/2014	100.080	99.930	100.1	1
LG&E	C1S	885940	01/2014	01/15/2014	100.040	99.930	99.9	1
LG&E	C1S	885941	01/2014	01/15/2014	100.080	99.950	100.0	1
LG&E	C1S	885942	01/2014	01/15/2014	100.070	99.930	100.0	1
LG&E	C1S	885943	01/2014	01/15/2014	100.100	99.920	100.0	1
LG&E	C1S	885944	01/2014	01/15/2014	100.060	99.920	100.0	1
LG&E	C1S	885945	01/2014	01/15/2014	100.070	99.920	100.0	1
LG&E	C1S	885946	01/2014	01/15/2014	100.110	99.960	100.0	1
LG&E	C1S	885947	01/2014	01/15/2014	100.100	100.000	100.1	1
LG&E	C1S	885948	01/2014	01/15/2014	100.090	99.930	99.9	1
LG&E	C1S	885949	01/2014	01/15/2014	100.070	99.870	100.0	1
LG&E	C1S	885950	01/2014	01/15/2014	100.080	99.980	100.1	1
LG&E	C1S	885951	01/2014	01/15/2014	100.090	99.890	100.0	1
LG&E	C1S	885952	01/2014	01/15/2014	100.060	99.910	100.0	1
LG&E	C1S	885953	01/2014	01/15/2014	100.060	99.950	100.1	1
LG&E	C1S	885954	01/2014	01/15/2014	100.080	99.940	99.9	1
LG&E	C1S	885955	01/2014	01/15/2014	100.090	99.870	100.1	1
LG&E	C1S	885956	01/2014	01/15/2014	100.060	99.880	100.1	1
LG&E	C1S	885957	01/2014	01/15/2014	100.050	99.840	100.0	1
LG&E	C1S	885958	01/2014	01/15/2014	100.060	99.820	99.9	1
LG&E	C1S	885959	01/2014	01/15/2014	100.080	99.990	100.0	1
LG&E	C1S	885960	01/2014	01/15/2014	100.030	99.910	100.0	1
LG&E	C1S	885961	01/2014	01/15/2014	100.040	99.930	100.0	1
LG&E	C1S	885962	01/2014	01/15/2014	100.080	99.920	100.1	1
LG&E	C1S	885963	01/2014	01/15/2014	100.070	99.850	100.0	1
LG&E	C1S	885964	01/2014	01/15/2014	100.080	99.930	100.0	1
LG&E	C1S	885965	01/2014	01/15/2014	100.060	99.930	100.0	1
LG&E	C1S	885966	01/2014	01/15/2014	100.060	99.840	99.9	1

LG&E	C1S	885967	01/2014	01/15/2014	100.080	99.880	100.1	1
LG&E	C1S	885968	01/2014	01/15/2014	100.080	99.950	100.0	1
LG&E	C1S	885969	01/2014	01/15/2014	100.070	99.890	100.1	1
LG&E	C1S	885970	01/2014	01/15/2014	100.070	99.990	100.1	1
LG&E	C1S	885971	01/2014	01/15/2014	100.060	99.920	100.1	1
LG&E	C1S	885972	01/2014	01/15/2014	100.100	99.950	100.0	1
LG&E	C1S	885973	01/2014	01/15/2014	100.070	99.890	100.0	1
LG&E	C1S	885974	01/2014	01/15/2014	100.070	99.960	100.0	1
LG&E	C1S	885975	01/2014	01/15/2014	100.100	99.910	99.9	1
LG&E	C1S	885976	01/2014	01/15/2014	100.080	99.940	100.0	1
LG&E	C1S	885977	01/2014	01/15/2014	100.070	99.930	100.0	1
LG&E	C1S	885978	01/2014	01/15/2014	100.040	99.860	99.9	1
LG&E	C1S	885979	01/2014	01/15/2014	100.100	99.930	100.0	1
LG&E	C1S	885980	01/2014	01/15/2014	100.100	99.990	99.9	1
LG&E	C1S	885981	01/2014	01/15/2014	100.060	99.880	100.1	1
LG&E	C1S	885982	01/2014	01/15/2014	100.060	99.840	100.0	1
LG&E	C1S	885983	01/2014	01/15/2014	100.070	99.950	99.9	1
LG&E	C1S	885984	01/2014	01/15/2014	100.100	99.920	99.9	1
LG&E	C1S	885985	01/2014	01/15/2014	100.040	99.890	100.0	1
LG&E	C1S	885986	01/2014	01/15/2014	100.080	99.900	100.0	1
LG&E	C1S	885987	01/2014	01/15/2014	100.070	99.910	100.0	1
LG&E	C1S	885988	01/2014	01/15/2014	100.060	99.880	100.0	1
LG&E	C1S	885989	01/2014	01/15/2014	100.060	99.880	100.1	1
LG&E	C1S	885990	01/2014	01/15/2014	100.030	99.940	100.0	1
LG&E	C1S	885991	01/2014	01/15/2014	100.060	99.930	100.0	1
LG&E	C1S	885992	01/2014	01/15/2014	100.060	99.830	100.0	1
LG&E	C1S	885993	01/2014	01/15/2014	100.070	99.950	100.0	1
LG&E	C1S	885994	01/2014	01/15/2014	100.060	99.930	100.0	1
LG&E	C1S	885995	01/2014	01/15/2014	100.070	99.910	100.0	1
LG&E	C1S	885996	01/2014	01/15/2014	100.070	99.920	100.1	1
LG&E	C1S	885997	01/2014	01/15/2014	100.090	99.910	100.0	1
LG&E	C1S	885998	01/2014	01/15/2014	100.050	99.890	100.1	1

LG&E	C1S	885999	01/2014	01/15/2014	100.060	99.850	100.1	1
LG&E	C1S	886000	01/2014	01/15/2014	100.060	99.850	100.0	1
LG&E	C1S	886001	01/2014	01/15/2014	100.030	99.850	100.0	1
LG&E	C1S	886002	01/2014	01/15/2014	100.080	99.930	100.1	1
LG&E	C1S	886003	01/2014	01/15/2014	100.070	99.850	100.1	1
LG&E	C1S	886004	01/2014	01/15/2014	100.060	99.910	100.0	1
LG&E	C1S	886005	01/2014	01/15/2014	100.050	99.880	100.0	1
LG&E	C1S	886006	01/2014	01/15/2014	100.070	99.900	99.9	1
LG&E	C1S	886007	01/2014	01/15/2014	100.070	99.860	100.0	1
LG&E	C1S	886008	01/2014	01/15/2014	100.060	99.880	99.9	1
LG&E	C1S	886009	01/2014	01/15/2014	100.080	99.890	100.0	1
LG&E	C1S	886010	01/2014	01/15/2014	100.060	99.900	100.0	1
LG&E	C1S	886011	01/2014	01/15/2014	100.080	99.890	100.0	1
LG&E	C1S	886012	01/2014	01/15/2014	100.110	99.840	100.0	1
LG&E	C1S	886013	01/2014	01/15/2014	100.070	99.840	100.1	1
LG&E	C1S	886014	01/2014	01/15/2014	100.100	99.920	100.1	1
LG&E	C1S	886015	01/2014	01/15/2014	100.070	99.900	100.0	1
LG&E	C1S	886016	01/2014	01/15/2014	100.060	99.970	100.0	1
LG&E	C1S	886017	01/2014	01/15/2014	100.040	99.940	100.0	1
LG&E	C1S	886018	01/2014	01/15/2014	100.090	99.940	100.1	1
LG&E	C1S	886019	01/2014	01/15/2014	100.050	99.910	100.0	1
LG&E	C1S	886020	01/2014	01/15/2014	100.070	99.890	99.9	1
LG&E	C1S	886021	01/2014	01/15/2014	100.110	100.000	100.1	1
LG&E	C1S	886022	01/2014	01/15/2014	100.050	99.900	100.0	1
LG&E	C1S	886023	01/2014	01/15/2014	100.080	100.010	100.0	1
LG&E	C1S	886024	01/2014	01/15/2014	100.080	99.930	99.9	1
LG&E	C1S	886025	01/2014	01/15/2014	100.040	99.970	100.0	1
LG&E	C1S	886026	01/2014	01/15/2014	100.030	99.890	99.9	1
LG&E	C1S	886027	01/2014	01/15/2014	100.030	99.840	100.0	1
LG&E	C1S	886028	01/2014	01/15/2014	100.090	99.930	99.9	1
LG&E	C1S	886029	01/2014	01/15/2014	100.070	99.940	100.0	1
LG&E	C1S	886030	01/2014	01/15/2014	100.080	99.950	100.0	1

LG&E	C1S	886031	01/2014	01/15/2014	100.060	99.910	100.0	1
LG&E	C1S	886032	01/2014	01/15/2014	100.100	99.990	100.0	1
LG&E	C1S	886033	01/2014	01/15/2014	100.030	99.850	99.9	1
LG&E	C1S	886034	01/2014	01/15/2014	100.070	99.910	100.0	1
LG&E	C1S	886035	01/2014	01/15/2014	100.050	99.900	100.0	1
LG&E	C1S	886036	01/2014	01/15/2014	100.060	99.890	100.0	1
LG&E	C1S	886037	01/2014	01/15/2014	100.050	99.880	100.0	1
LG&E	C1S	886038	01/2014	01/15/2014	100.060	99.920	100.0	1
LG&E	C1S	886039	01/2014	01/15/2014	100.080	99.890	100.0	1
LG&E	C1S	886040	01/2014	01/15/2014	100.080	99.960	100.0	1
LG&E	C1S	886041	01/2014	01/15/2014	100.090	99.940	99.9	1
LG&E	C1S	886042	01/2014	01/15/2014	100.080	99.910	100.1	1
LG&E	C1S	886043	01/2014	01/15/2014	100.100	99.880	100.0	1
LG&E	C1S	886044	01/2014	01/15/2014	100.090	99.940	100.0	1
LG&E	C1S	886045	01/2014	01/15/2014	100.060	99.850	99.9	1
LG&E	C1S	886046	01/2014	01/15/2014	100.080	99.970	100.1	1
LG&E	C1S	886047	01/2014	01/15/2014	100.060	99.920	100.0	1
LG&E	C1S	886048	01/2014	01/15/2014	100.050	99.920	100.1	1
LG&E	C1S	886049	01/2014	01/15/2014	100.090	99.990	100.0	1
LG&E	C1S	886050	01/2014	01/15/2014	100.070	99.860	100.0	1
LG&E	C1S	886051	01/2014	01/15/2014	100.100	99.880	100.0	1
LG&E	C1S	886052	01/2014	01/15/2014	100.040	99.830	100.0	1
LG&E	C1S	886053	01/2014	01/15/2014	100.100	99.920	100.0	1
LG&E	C1S	886054	01/2014	01/15/2014	100.090	99.990	100.1	1
LG&E	C1S	886055	01/2014	01/15/2014	100.090	99.960	100.0	1
LG&E	C1S	886056	01/2014	01/15/2014	100.090	99.910	100.0	1
LG&E	C1S	886057	01/2014	01/15/2014	100.090	99.920	100.1	1
LG&E	C1S	886058	01/2014	01/15/2014	100.060	99.820	99.9	1
LG&E	C1S	886059	01/2014	01/15/2014	100.080	99.960	100.0	1
LG&E	C1S	886060	01/2014	01/15/2014	100.070	99.870	100.0	1
LG&E	C1S	886061	01/2014	01/15/2014	100.090	99.980	100.1	1
LG&E	C1S	886062	01/2014	01/15/2014	100.080	99.910	99.9	1

LG&E	C1S	886063	01/2014	01/15/2014	100.070	99.970	100.0	1
LG&E	C1S	886064	01/2014	01/15/2014	100.030	99.850	100.0	1
LG&E	C1S	886065	01/2014	01/15/2014	100.100	99.990	100.0	1
LG&E	C1S	886066	01/2014	01/15/2014	100.070	99.890	100.0	1
LG&E	C1S	886067	01/2014	01/15/2014	100.060	99.970	100.0	1
LG&E	C1S	886068	01/2014	01/15/2014	100.040	99.870	100.0	1
LG&E	C1S	886069	01/2014	01/15/2014	100.060	99.910	100.0	1
LG&E	C1S	886070	01/2014	01/15/2014	100.070	99.920	100.1	1
LG&E	C1S	886071	01/2014	01/15/2014	100.070	99.880	100.1	1
LG&E	C1S	886072	01/2014	01/15/2014	100.060	99.890	100.0	1
LG&E	C1S	886073	01/2014	01/15/2014	100.090	99.960	100.0	1
LG&E	C1S	886074	01/2014	01/15/2014	100.050	99.830	100.0	1
LG&E	C1S	886075	01/2014	01/15/2014	100.080	99.990	100.0	1
LG&E	C1S	886076	01/2014	01/15/2014	100.100	99.990	100.0	1
LG&E	C1S	886077	01/2014	01/15/2014	100.070	99.850	100.1	1
LG&E	C1S	886078	01/2014	01/15/2014	100.040	99.880	99.9	1
LG&E	C1S	886079	01/2014	01/15/2014	100.040	99.900	100.0	1
LG&E	C1S	886080	01/2014	01/15/2014	100.050	99.880	100.0	1
LG&E	C1S	886081	01/2014	01/15/2014	100.030	99.860	100.0	1
LG&E	C1S	886082	01/2014	01/15/2014	100.090	99.940	100.1	1
LG&E	C1S	886083	01/2014	01/15/2014	100.090	99.960	100.0	1
LG&E	C1S	886084	01/2014	01/15/2014	100.040	99.900	100.0	1
LG&E	C1S	886085	01/2014	01/15/2014	100.080	99.850	99.9	1
LG&E	C1S	886086	01/2014	01/15/2014	100.070	99.870	100.0	1
LG&E	C1S	886087	01/2014	01/15/2014	100.030	99.820	100.0	1
LG&E	C1S	886088	01/2014	01/15/2014	100.060	99.930	100.0	1
LG&E	C1S	886089	01/2014	01/15/2014	100.080	100.030	100.0	1
LG&E	C1S	886090	01/2014	01/15/2014	100.080	99.980	99.9	1
LG&E	C1S	886091	01/2014	01/15/2014	100.060	99.880	99.9	1
LG&E	C1S	886092	01/2014	01/15/2014	100.060	99.880	99.9	1
LG&E	C1S	886093	01/2014	01/15/2014	100.070	99.860	100.0	1
LG&E	C1S	886094	01/2014	01/15/2014	100.080	99.840	99.8	1

LG&E	C1S	886095	01/2014	01/15/2014	100.100	99.910	100.1	1
LG&E	C1S	886096	01/2014	01/15/2014	100.100	99.880	100.0	1
LG&E	C1S	886097	01/2014	01/15/2014	100.090	99.910	100.0	1
LG&E	C1S	886098	01/2014	01/15/2014	100.100	99.960	100.0	1
LG&E	C1S	886099	01/2014	01/15/2014	100.070	99.950	100.0	1
LG&E	C1S	886100	01/2014	01/15/2014	100.070	99.900	100.1	1
LG&E	C1S	886101	01/2014	01/15/2014	100.090	99.830	100.0	1
LG&E	C1S	886102	01/2014	01/15/2014	100.090	99.930	100.0	1
LG&E	C1S	886103	01/2014	01/15/2014	100.040	99.810	99.9	1
LG&E	C1S	886104	01/2014	01/15/2014	100.060	99.930	99.9	1
LG&E	C1S	886105	01/2014	01/15/2014	100.060	99.880	100.0	1
LG&E	C1S	886106	01/2014	01/15/2014	100.110	99.950	100.0	1
LG&E	C1S	886107	01/2014	01/15/2014	100.070	99.900	100.0	1
LG&E	C1S	886108	01/2014	01/15/2014	100.090	99.880	100.1	1
LG&E	C1S	886109	01/2014	01/15/2014	100.070	99.990	99.9	1
LG&E	C1S	886110	01/2014	01/15/2014	100.070	99.880	100.0	1
LG&E	C1S	886111	01/2014	01/15/2014	100.070	99.880	99.9	1
LG&E	C1S	886112	01/2014	01/15/2014	100.050	99.920	100.1	1
LG&E	C1S	886113	01/2014	01/15/2014	100.050	99.850	99.9	1
LG&E	C1S	886114	01/2014	01/15/2014	100.100	99.950	100.1	1
LG&E	C1S	886115	01/2014	01/15/2014	100.030	99.860	100.0	1
LG&E	C1S	886116	01/2014	01/15/2014	100.030	99.920	100.0	1
LG&E	C1S	886117	01/2014	01/15/2014	100.100	99.970	100.0	1
LG&E	C1S	886118	01/2014	01/15/2014	100.080	99.910	100.1	1
LG&E	C1S	886119	01/2014	01/15/2014	100.050	99.930	100.0	1
LG&E	C1S	886120	01/2014	01/15/2014	100.060	99.910	99.9	1
LG&E	C1S	886121	01/2014	01/15/2014	100.080	99.880	100.0	1
LG&E	C1S	886122	01/2014	01/15/2014	100.060	99.890	100.0	1
LG&E	C1S	886123	01/2014	01/15/2014	100.070	99.900	100.0	1
LG&E	C1S	886124	01/2014	01/15/2014	100.060	99.940	100.0	1
LG&E	C1S	886125	01/2014	01/15/2014	100.080	99.940	100.0	1
LG&E	C1S	886126	01/2014	01/15/2014	100.040	99.830	100.0	1

LG&E	C1S	886127	01/2014	01/15/2014	100.050	99.920	100.0	1
LG&E	C1S	886128	01/2014	01/15/2014	100.060	99.870	100.0	1
LG&E	C1S	886129	01/2014	01/15/2014	100.080	99.850	100.0	1
LG&E	C1S	886130	01/2014	01/15/2014	100.060	99.930	100.0	1
LG&E	C1S	886131	01/2014	01/15/2014	100.080	99.900	99.9	1
LG&E	C1S	886132	01/2014	01/15/2014	100.060	99.890	100.0	1
LG&E	C1S	886133	01/2014	01/15/2014	100.100	99.930	99.9	1
LG&E	C1S	886134	01/2014	01/15/2014	100.050	99.910	99.9	1
LG&E	C1S	886135	01/2014	01/15/2014	100.080	99.950	100.0	1
LG&E	C1S	886136	01/2014	01/15/2014	100.080	99.960	100.1	1
LG&E	C1S	886137	01/2014	01/15/2014	100.060	99.900	100.0	1
LG&E	C1S	886138	01/2014	01/15/2014	100.080	99.880	100.0	1
LG&E	C1S	886139	01/2014	01/15/2014	100.090	100.000	100.0	1
LG&E	C1S	886140	01/2014	01/15/2014	100.080	99.960	99.9	1
LG&E	C1S	886141	01/2014	01/15/2014	100.090	100.030	100.1	1
LG&E	C1S	886142	01/2014	01/15/2014	100.070	99.900	99.9	1
LG&E	C1S	886143	01/2014	01/15/2014	100.080	99.940	100.0	1
LG&E	C1S	886144	01/2014	01/15/2014	100.100	99.910	100.1	1
LG&E	C1S	886145	01/2014	01/15/2014	100.090	99.940	100.0	1
LG&E	C1S	886146	01/2014	01/15/2014	100.070	99.820	100.0	1
LG&E	C1S	886147	01/2014	01/15/2014	100.070	99.930	100.0	1
LG&E	C1S	886148	01/2014	01/15/2014	100.040	99.850	100.0	1
LG&E	C1S	886149	01/2014	01/15/2014	100.100	99.930	100.1	1
LG&E	C1S	886150	01/2014	01/15/2014	100.060	99.930	100.1	1
LG&E	C1S	886151	01/2014	01/15/2014	100.090	99.910	100.0	1
LG&E	C1S	886152	01/2014	01/15/2014	100.050	99.970	100.0	1
LG&E	C1S	886153	01/2014	01/15/2014	100.090	99.910	100.0	1
LG&E	C1S	886154	01/2014	01/15/2014	100.080	99.880	100.0	1
LG&E	C1S	886155	01/2014	01/15/2014	100.100	99.940	100.0	1
LG&E	C1S	886156	01/2014	01/15/2014	100.100	99.940	100.0	1
LG&E	C1S	886157	01/2014	01/15/2014	100.060	99.940	99.9	1
LG&E	C1S	886158	01/2014	01/15/2014	100.090	99.960	100.0	1

LG&E	C1S	886159	01/2014	01/15/2014	100,060	99,870	99.9	1
LG&E	C1S	886160	01/2014	01/15/2014	100,050	99,860	100.0	1
LG&E	C1S	886161	01/2014	01/15/2014	100,080	99,950	99.9	1
LG&E	C1S	886162	01/2014	01/15/2014	100,070	99,890	99.9	1
LG&E	C1S	886163	01/2014	01/15/2014	100,050	99,860	100.0	1
LG&E	C1S	886164	01/2014	01/15/2014	100,080	99,870	100.0	1
LG&E	C1S	886165	01/2014	01/15/2014	100,080	99,840	100.0	1
LG&E	C1S	886166	01/2014	01/15/2014	100,070	99,840	100.0	1
LG&E	C1S	886167	01/2014	01/15/2014	100,060	99,900	100.0	1
LG&E	C1S	886168	01/2014	01/15/2014	100,060	99,850	100.0	1
LG&E	C1S	886169	01/2014	01/15/2014	100,060	99,860	99.9	1
LG&E	C1S	886170	01/2014	01/15/2014	100,070	99,890	100.0	1
LG&E	C1S	886171	01/2014	01/15/2014	100,090	99,890	100.0	1
LG&E	C1S	886172	01/2014	01/15/2014	100,100	99,960	100.0	1
LG&E	C1S	886173	01/2014	01/15/2014	100,100	99,960	100.0	1
LG&E	C1S	886174	01/2014	01/15/2014	100,070	99,900	100.0	1
LG&E	C1S	886175	01/2014	01/15/2014	100,040	99,850	100.0	1
LG&E	C1S	886176	01/2014	01/15/2014	100,090	99,960	100.0	1
LG&E	C1S	886177	01/2014	01/15/2014	100,060	99,870	100.0	1
LG&E	C1S	886178	01/2014	01/15/2014	100,100	100,000	100.0	1
LG&E	C1S	886179	01/2014	01/15/2014	100,060	99,920	100.0	1
LG&E	C1S	886180	01/2014	01/15/2014	100,080	99,950	100.1	1
LG&E	C1S	886181	01/2014	01/15/2014	100,060	99,850	99.9	1
LG&E	C1S	886182	01/2014	01/15/2014	100,060	99,900	99.9	1
LG&E	C1S	886183	01/2014	01/15/2014	100,070	99,970	100.0	1
LG&E	C1S	886184	01/2014	01/15/2014	100,070	99,870	100.0	1
LG&E	C1S	886185	01/2014	01/15/2014	100,060	99,970	100.1	1
LG&E	C1S	886186	01/2014	01/15/2014	100,100	99,960	100.0	1
LG&E	C1S	886187	01/2014	01/15/2014	100,080	99,890	100.1	1
LG&E	C1S	886188	01/2014	01/15/2014	100,100	99,920	100.0	1
LG&E	C1S	886189	01/2014	01/15/2014	100,030	99,850	100.0	1
LG&E	C1S	886190	01/2014	01/15/2014	100,080	100,000	100.0	1

LG&E	C1S	886191	01/2014	01/15/2014	100.080	99.960	100.0	1
LG&E	C1S	886192	01/2014	01/15/2014	100.070	99.900	100.0	1
LG&E	C1S	886193	01/2014	01/15/2014	100.060	99.890	100.0	1
LG&E	C1S	886194	01/2014	01/15/2014	100.030	99.930	100.0	1
LG&E	C1S	886195	01/2014	01/15/2014	100.060	99.960	100.0	1
LG&E	C1S	886196	01/2014	01/15/2014	100.090	99.920	100.0	1
LG&E	C1S	886197	01/2014	01/15/2014	100.050	99.910	100.0	1
LG&E	C1S	886198	01/2014	01/15/2014	100.090	99.900	100.1	1
LG&E	C1S	886199	01/2014	01/15/2014	100.070	99.960	100.0	1
LG&E	C1S	886200	01/2014	01/15/2014	100.090	99.940	99.9	1
LG&E	C1S	886201	01/2014	01/15/2014	100.100	99.950	100.1	1
LG&E	C1S	886202	01/2014	01/15/2014	100.090	99.970	100.0	1
LG&E	C1S	886203	01/2014	01/15/2014	100.080	99.910	100.0	1
LG&E	C1S	886204	01/2014	01/15/2014	100.060	99.870	100.0	1
LG&E	C1S	886205	01/2014	01/15/2014	100.070	99.920	99.9	1
LG&E	C1S	886206	01/2014	01/15/2014	100.060	99.940	100.0	1
LG&E	C1S	886207	01/2014	01/15/2014	100.040	99.800	100.0	1
LG&E	C1S	886208	01/2014	01/15/2014	100.060	99.900	100.0	1
LG&E	C1S	886209	01/2014	01/15/2014	100.060	99.890	100.0	1
LG&E	C1S	886210	01/2014	01/15/2014	100.100	99.940	100.0	1
LG&E	C1S	886211	01/2014	01/15/2014	100.060	99.830	100.0	1
LG&E	C1S	886212	01/2014	01/15/2014	100.050	99.890	100.0	1
LG&E	C1S	886213	01/2014	01/15/2014	100.040	99.840	100.0	1
LG&E	C1S	886214	01/2014	01/15/2014	100.070	99.860	100.0	1
LG&E	C1S	886215	01/2014	01/15/2014	100.050	99.820	100.0	1
LG&E	C1S	886216	01/2014	01/15/2014	100.090	99.980	100.0	1
LG&E	C1S	886217	01/2014	01/15/2014	100.100	99.880	100.1	1
LG&E	C1S	886218	01/2014	01/15/2014	100.050	99.900	99.9	1
LG&E	C1S	886219	01/2014	01/15/2014	100.050	99.910	100.0	1
LG&E	C1S	886220	01/2014	01/15/2014	100.080	99.940	100.0	1
LG&E	C1S	886221	01/2014	01/15/2014	100.030	99.850	99.9	1
LG&E	C1S	886222	01/2014	01/15/2014	100.050	99.860	99.9	1

LG&E	C1S	886223	01/2014	01/15/2014	100.100	99.930	100.0	1
LG&E	C1S	886224	01/2014	01/15/2014	100.080	99.920	100.0	1
LG&E	C1S	886225	01/2014	01/15/2014	100.060	99.940	99.9	1
LG&E	C1S	886226	01/2014	01/15/2014	100.090	99.920	100.0	1
LG&E	C1S	886227	01/2014	01/15/2014	100.100	99.930	100.1	1
LG&E	C1S	886228	01/2014	01/15/2014	100.080	99.920	100.0	1
LG&E	C1S	886229	01/2014	01/15/2014	100.080	99.920	100.0	1
LG&E	C1S	886230	01/2014	01/15/2014	100.100	99.910	100.0	1
LG&E	C1S	886231	01/2014	01/15/2014	100.070	99.880	99.9	1
LG&E	C1S	886232	01/2014	01/15/2014	100.060	99.910	100.0	1
LG&E	C1S	886233	01/2014	01/15/2014	100.110	99.930	99.9	1
LG&E	C1S	886234	01/2014	01/15/2014	100.070	99.900	100.1	1
LG&E	C1S	886235	01/2014	01/15/2014	100.080	99.890	100.0	1
LG&E	C1S	886236	01/2014	01/15/2014	100.070	99.960	100.1	1
LG&E	C1S	886237	01/2014	01/15/2014	100.080	99.920	100.0	1
LG&E	C1S	886238	01/2014	01/15/2014	100.080	99.970	100.0	1
LG&E	C1S	886239	01/2014	01/15/2014	100.060	99.860	100.0	1
LG&E	C1S	886240	01/2014	01/15/2014	100.060	99.860	99.9	1
LG&E	C1S	886241	01/2014	01/15/2014	100.090	99.960	99.9	1
LG&E	C1S	886242	01/2014	01/15/2014	100.090	99.930	100.0	1
LG&E	C1S	886243	01/2014	01/15/2014	100.080	99.950	100.0	1
LG&E	C1S	886244	01/2014	01/15/2014	100.030	99.840	100.0	1
LG&E	C1S	886245	01/2014	01/15/2014	100.050	99.920	100.0	1
LG&E	C1S	886246	01/2014	01/15/2014	100.050	99.840	100.0	1
LG&E	C1S	886247	01/2014	01/15/2014	100.060	99.820	100.0	1
LG&E	C1S	886248	01/2014	01/15/2014	100.080	99.900	100.0	1
LG&E	C1S	886249	01/2014	01/15/2014	100.080	99.870	100.0	1
LG&E	C1S	886250	01/2014	01/15/2014	100.070	99.910	100.0	1
LG&E	C1S	886251	01/2014	01/15/2014	100.090	99.930	100.1	1
LG&E	C1S	886252	01/2014	01/15/2014	100.090	99.960	100.1	1
LG&E	C1S	886253	01/2014	01/15/2014	100.090	99.920	100.1	1
LG&E	C1S	886254	01/2014	01/15/2014	100.050	99.890	100.0	1

LG&E	C1S	886255	01/2014	01/15/2014	100.080	99.890	100.0	1
LG&E	C1S	886256	01/2014	01/15/2014	100.070	99.910	99.9	1
LG&E	C1S	886257	01/2014	01/15/2014	100.050	99.830	99.9	1
LG&E	C1S	886258	01/2014	01/15/2014	100.060	99.840	100.0	1
LG&E	C1S	886259	01/2014	01/15/2014	100.090	99.940	100.0	1
LG&E	C1S	886260	01/2014	01/15/2014	100.060	99.910	100.0	1
LG&E	C1S	886261	01/2014	01/15/2014	100.040	99.860	100.0	1
LG&E	C1S	886262	01/2014	01/15/2014	100.040	99.850	99.9	1
LG&E	C1S	886263	01/2014	01/15/2014	100.100	99.980	100.1	1
LG&E	C1S	886264	01/2014	01/15/2014	100.040	99.930	100.0	1
LG&E	C1S	886265	01/2014	01/15/2014	100.090	99.950	100.0	1
LG&E	C1S	886266	01/2014	01/15/2014	100.070	99.970	100.0	1
LG&E	C1S	886267	01/2014	01/15/2014	100.060	99.880	100.0	1
LG&E	C1S	886268	01/2014	01/15/2014	100.060	99.910	100.0	1
LG&E	C1S	886269	01/2014	01/15/2014	100.080	99.930	100.0	1
LG&E	C1S	886270	01/2014	01/15/2014	100.100	99.950	100.0	1
LG&E	C1S	886271	01/2014	01/15/2014	100.090	99.870	100.0	1
LG&E	C1S	886272	01/2014	01/15/2014	100.050	99.900	100.0	1
LG&E	C1S	886273	01/2014	01/15/2014	100.070	99.900	99.9	1
LG&E	C1S	886274	01/2014	01/15/2014	100.100	100.000	100.0	1
LG&E	C1S	886275	01/2014	01/15/2014	100.090	99.880	100.0	1
LG&E	C1S	886276	01/2014	01/15/2014	100.060	99.970	100.0	1
LG&E	C1S	886277	01/2014	01/15/2014	100.100	99.940	100.1	1
LG&E	C1S	886278	01/2014	01/15/2014	100.060	99.910	100.0	1
LG&E	C1S	886279	01/2014	01/15/2014	100.080	99.870	100.1	1
LG&E	C1S	886280	01/2014	01/15/2014	100.070	99.900	99.9	1
LG&E	C1S	886281	01/2014	01/15/2014	100.060	99.900	100.0	1
LG&E	C1S	886282	01/2014	01/15/2014	100.090	99.890	100.1	1
LG&E	C1S	886283	01/2014	01/15/2014	100.080	99.920	100.0	1
LG&E	C1S	886284	01/2014	01/15/2014	100.030	99.830	100.0	1
LG&E	C1S	886285	01/2014	01/15/2014	100.040	99.820	100.0	1
LG&E	C1S	886286	01/2014	01/15/2014	100.080	99.940	99.9	1

LG&E	C1S	886287	01/2014	01/15/2014	100.090	99.980	100.0	1
LG&E	C1S	886288	01/2014	01/15/2014	100.080	99.870	100.0	1
LG&E	C1S	886289	01/2014	01/15/2014	100.090	99.980	99.9	1
LG&E	C1S	886290	01/2014	01/15/2014	100.060	99.910	100.0	1
LG&E	C1S	886291	01/2014	01/15/2014	100.090	99.950	100.0	1
LG&E	C1S	886292	01/2014	01/15/2014	100.050	99.910	99.9	1
LG&E	C1S	886293	01/2014	01/15/2014	100.090	99.920	100.0	1
LG&E	C1S	886294	01/2014	01/15/2014	100.100	99.980	100.1	1
LG&E	C1S	886295	01/2014	01/15/2014	100.070	99.970	100.1	1
LG&E	C1S	886296	01/2014	01/15/2014	100.100	99.910	100.1	1
LG&E	C1S	886297	01/2014	01/15/2014	100.090	99.940	100.0	1
LG&E	C1S	886298	01/2014	01/15/2014	100.050	99.900	100.0	1
LG&E	C1S	886299	01/2014	01/15/2014	100.060	99.920	100.0	1
LG&E	C1S	886300	01/2014	01/15/2014	100.070	99.840	100.0	1
LG&E	C1S	886301	01/2014	01/15/2014	100.060	99.970	100.0	1
LG&E	C1S	886302	01/2014	01/15/2014	100.060	99.840	100.0	1
LG&E	C1S	886303	01/2014	01/15/2014	100.090	99.930	100.1	1
LG&E	C1S	886304	01/2014	01/15/2014	100.060	99.850	100.0	1
LG&E	C1S	886305	01/2014	01/15/2014	100.050	99.890	100.0	1
LG&E	C1S	886306	01/2014	01/15/2014	100.060	99.890	100.0	1
LG&E	C1S	886307	01/2014	01/15/2014	100.100	99.940	100.0	1
LG&E	C1S	886308	01/2014	01/15/2014	100.080	99.840	100.1	1
LG&E	C1S	886309	01/2014	01/15/2014	100.030	99.880	100.0	1
LG&E	C1S	886310	01/2014	01/15/2014	100.070	99.870	100.0	1
LG&E	C1S	886311	01/2014	01/15/2014	100.070	99.870	99.9	1
LG&E	C1S	886312	01/2014	01/15/2014	100.070	99.860	100.0	1
LG&E	C1S	886313	01/2014	01/15/2014	100.090	99.960	100.0	1
LG&E	C1S	886314	01/2014	01/15/2014	100.090	99.930	100.0	1
LG&E	C1S	886315	01/2014	01/15/2014	100.050	99.900	100.0	1
LG&E	C1S	886316	01/2014	01/15/2014	100.070	99.940	100.0	1
LG&E	C1S	886317	01/2014	01/15/2014	100.060	99.900	99.9	1
LG&E	C1S	886318	01/2014	01/15/2014	100.030	99.910	100.0	1

LG&E	C1S	886319	01/2014	01/15/2014	100.110	99.900	100.0	1
LG&E	C1S	886320	01/2014	01/15/2014	100.060	99.890	100.0	1
LG&E	C1S	886321	01/2014	01/15/2014	100.070	99.920	100.0	1
LG&E	C1S	886322	01/2014	01/15/2014	100.080	99.980	100.0	1
LG&E	C1S	886323	01/2014	01/15/2014	100.090	99.960	100.1	1
LG&E	C1S	886324	01/2014	01/15/2014	100.060	100.010	100.0	1
LG&E	C1S	886325	01/2014	01/15/2014	100.090	99.960	100.0	1
LG&E	C1S	886326	01/2014	01/15/2014	100.100	99.930	100.0	1
LG&E	C1S	886327	01/2014	01/15/2014	100.050	99.840	99.9	1
LG&E	C1S	886328	01/2014	01/15/2014	100.070	99.860	100.0	1
LG&E	C1S	886329	01/2014	01/15/2014	100.060	99.880	100.0	1
LG&E	C1S	886330	01/2014	01/15/2014	100.100	99.880	100.0	1
LG&E	C1S	886331	01/2014	01/15/2014	100.060	99.880	100.0	1
LG&E	C1S	886332	01/2014	01/15/2014	100.090	99.960	100.1	1
LG&E	C1S	886333	01/2014	01/15/2014	100.040	99.810	100.0	1
LG&E	C1S	886334	01/2014	01/15/2014	100.070	99.920	99.9	1
LG&E	C1S	886335	01/2014	01/15/2014	100.070	100.000	100.1	1
LG&E	C1S	886336	01/2014	01/15/2014	100.090	99.920	99.9	1
LG&E	C1S	886337	01/2014	01/15/2014	100.030	99.820	100.0	1
LG&E	C1S	886338	01/2014	01/15/2014	100.070	99.880	100.0	1
LG&E	C1S	886339	01/2014	01/15/2014	100.030	99.880	99.9	1
LG&E	C1S	886340	01/2014	01/15/2014	100.030	99.850	100.0	1
LG&E	C1S	886341	01/2014	01/15/2014	100.100	99.880	100.1	1
LG&E	C1S	886342	01/2014	01/15/2014	100.050	99.920	100.0	1
LG&E	C1S	886343	01/2014	01/15/2014	100.060	99.900	99.9	1
LG&E	C1S	886344	01/2014	01/15/2014	100.070	99.900	100.0	1
LG&E	C1S	886345	01/2014	01/15/2014	100.070	99.920	100.0	1
LG&E	C1S	886346	01/2014	01/15/2014	100.090	99.950	100.0	1
LG&E	C1S	886347	01/2014	01/15/2014	100.090	99.950	100.1	1
LG&E	C1S	886348	01/2014	01/15/2014	100.090	100.000	99.9	1
LG&E	C1S	886349	01/2014	01/15/2014	100.080	99.830	100.0	1
LG&E	C1S	886350	01/2014	01/15/2014	100.100	99.910	100.0	1

LG&E	C1S	886351	01/2014	01/15/2014	100.040	99.870	100.0	100.0	1
LG&E	C1S	886352	01/2014	01/15/2014	100.060	99.920	100.0	100.0	1
LG&E	C1S	886353	01/2014	01/15/2014	100.050	99.930	100.0	100.0	1
LG&E	C1S	886354	01/2014	01/15/2014	100.070	99.930	100.0	100.0	1
LG&E	C1S	886355	01/2014	01/15/2014	100.100	99.900	100.0	100.0	1
LG&E	C1S	886356	01/2014	01/15/2014	100.080	99.950	99.9	99.9	1
LG&E	C1S	886357	01/2014	01/15/2014	100.090	99.870	99.9	99.9	1
LG&E	C1S	886358	01/2014	01/15/2014	100.100	99.900	100.0	100.0	1
LG&E	C1S	886359	01/2014	01/15/2014	100.050	99.870	100.0	100.0	1
LG&E	C1S	886360	01/2014	01/15/2014	100.090	99.910	99.9	99.9	1
LG&E	C1S	886361	01/2014	01/15/2014	100.110	99.950	100.0	100.0	1
LG&E	C1S	886362	01/2014	01/15/2014	100.060	99.920	100.1	100.1	1
LG&E	C1S	886363	01/2014	01/15/2014	100.090	99.940	100.0	100.0	1
LG&E	C1S	886364	01/2014	01/15/2014	100.060	99.920	100.0	100.0	1
LG&E	C1S	886365	01/2014	01/15/2014	100.060	99.940	100.1	100.1	1
LG&E	C1S	886366	01/2014	01/15/2014	100.080	100.000	99.9	99.9	1
LG&E	C1S	886367	01/2014	01/15/2014	100.050	99.930	100.0	100.0	1
LG&E	C1S	886368	01/2014	01/15/2014	100.070	99.960	100.0	100.0	1
LG&E	C1S	886369	01/2014	01/15/2014	100.080	99.930	100.0	100.0	1
LG&E	C1S	886370	01/2014	01/15/2014	100.070	99.860	100.0	100.0	1
LG&E	C1S	886371	01/2014	01/15/2014	100.080	99.880	100.0	100.0	1
LG&E	C1S	886372	01/2014	01/15/2014	100.040	99.900	100.0	100.0	1
LG&E	C1S	886373	01/2014	01/15/2014	100.090	99.860	100.1	100.1	1
LG&E	C1S	886374	01/2014	01/15/2014	100.100	99.960	100.0	100.0	1
LG&E	C1S	886375	01/2014	01/15/2014	100.060	99.930	100.0	100.0	1
LG&E	C1S	886376	01/2014	01/15/2014	100.070	99.900	100.0	100.0	1
LG&E	C1S	886377	01/2014	01/15/2014	100.090	99.930	100.0	100.0	1
LG&E	C1S	886378	01/2014	01/15/2014	100.080	99.900	100.0	100.0	1
LG&E	C1S	886379	01/2014	01/15/2014	100.070	99.960	100.1	100.1	1
LG&E	C1S	886380	01/2014	01/15/2014	100.050	99.920	100.0	100.0	1
LG&E	C1S	886381	01/2014	01/15/2014	100.060	99.870	99.9	99.9	1
LG&E	C1S	886382	01/2014	01/15/2014	100.070	99.900	100.0	100.0	1

LG&E	C1S	886383	01/2014	01/15/2014	100.060	99.900	100.0	1
LG&E	C1S	886384	01/2014	01/15/2014	100.070	99.860	100.0	1
LG&E	C1S	886385	01/2014	01/15/2014	100.060	99.910	100.0	1
LG&E	C1S	886386	01/2014	01/15/2014	100.050	99.920	100.0	1
LG&E	C1S	886387	01/2014	01/15/2014	100.040	99.870	100.0	1
LG&E	C1S	886388	01/2014	01/15/2014	100.100	100.000	100.0	1
LG&E	C1S	886389	01/2014	01/15/2014	100.100	99.960	100.0	1
LG&E	C1S	886390	01/2014	01/15/2014	100.060	99.900	100.0	1
LG&E	C1S	886391	01/2014	01/15/2014	100.070	99.930	100.1	1
LG&E	C1S	886392	01/2014	01/15/2014	100.070	99.910	100.0	1
LG&E	C1S	886393	01/2014	01/15/2014	100.090	99.980	100.0	1
LG&E	C1S	886394	01/2014	01/15/2014	100.090	99.950	100.0	1
LG&E	C1S	886395	01/2014	01/15/2014	100.060	99.880	99.9	1
LG&E	C1S	886396	01/2014	01/15/2014	100.100	99.950	100.1	1
LG&E	C1S	886397	01/2014	01/15/2014	100.060	99.900	100.0	1
LG&E	C1S	886398	01/2014	01/15/2014	100.060	99.890	99.9	1
LG&E	C1S	886399	01/2014	01/15/2014	100.090	99.950	100.0	1
LG&E	C1S	886400	01/2014	01/15/2014	100.050	99.930	100.0	1
LG&E	C1S	886401	01/2014	01/15/2014	100.090	99.990	100.0	1
LG&E	C1S	886402	01/2014	01/15/2014	100.090	99.910	99.9	1
LG&E	C1S	886403	01/2014	01/15/2014	100.070	99.860	100.1	1
LG&E	C1S	886404	01/2014	01/15/2014	100.070	99.880	100.0	1
LG&E	C1S	886405	01/2014	01/15/2014	100.070	99.880	100.0	1
LG&E	C1S	886406	01/2014	01/15/2014	100.060	99.910	100.0	1
LG&E	C1S	886407	01/2014	01/15/2014	100.080	99.940	100.0	1
LG&E	C1S	886408	01/2014	01/15/2014	100.090	99.970	100.0	1
LG&E	C1S	886409	01/2014	01/15/2014	100.100	99.970	100.0	1
LG&E	C1S	886410	01/2014	01/15/2014	100.070	99.880	99.9	1
LG&E	C1S	886411	01/2014	01/15/2014	100.030	99.860	100.0	1
LG&E	C1S	886412	01/2014	01/15/2014	100.090	99.970	100.0	1
LG&E	C1S	886413	01/2014	01/15/2014	100.070	99.940	100.1	1
LG&E	C1S	886414	01/2014	01/15/2014	100.070	99.940	99.9	1

LG&E	C1S	886415	01/2014	01/15/2014	100.080	99.920	100.0	100.0	1
LG&E	C1S	886416	01/2014	01/15/2014	100.070	99.840	99.9	99.9	1
LG&E	C1S	886417	01/2014	01/15/2014	100.070	99.920	100.1	100.1	1
LG&E	C1S	886418	01/2014	01/15/2014	100.110	99.930	100.1	100.1	1
LG&E	C1S	886419	01/2014	01/15/2014	100.070	99.850	100.0	100.0	1
LG&E	C1S	886420	01/2014	01/15/2014	100.060	99.990	100.0	100.0	1
LG&E	C1S	886421	01/2014	01/15/2014	100.060	99.860	100.0	100.0	1
LG&E	C1S	886422	01/2014	01/15/2014	100.040	99.860	100.0	100.0	1
LG&E	C1S	886423	01/2014	01/15/2014	100.050	99.880	99.9	99.9	1
LG&E	C1S	886424	01/2014	01/15/2014	100.090	99.930	100.0	100.0	1
LG&E	C1S	886425	01/2014	01/15/2014	100.080	99.880	100.0	100.0	1
LG&E	C1S	886426	01/2014	01/15/2014	100.080	99.960	100.1	100.1	1
LG&E	C1S	886427	01/2014	01/15/2014	100.100	99.950	100.0	100.0	1
LG&E	C1S	886428	01/2014	01/15/2014	100.090	100.010	100.0	100.0	1
LG&E	C1S	886429	01/2014	01/15/2014	100.100	99.920	100.0	100.0	1
LG&E	C1S	886430	01/2014	01/15/2014	100.070	99.880	100.0	100.0	1
LG&E	C1S	886431	01/2014	01/15/2014	100.060	99.930	100.0	100.0	1
LG&E	C1S	886432	01/2014	01/15/2014	100.100	99.930	100.1	100.1	1
LG&E	C1S	886433	01/2014	01/15/2014	100.080	99.930	100.0	100.0	1
LG&E	C1S	886434	01/2014	01/15/2014	100.090	99.960	100.0	100.0	1
LG&E	C1S	886435	01/2014	01/15/2014	100.080	99.960	100.0	100.0	1
LG&E	C1S	886436	01/2014	01/15/2014	100.080	99.910	99.9	99.9	1
LG&E	C1S	886437	01/2014	01/15/2014	100.060	99.870	100.0	100.0	1
LG&E	C1S	886438	01/2014	01/15/2014	100.110	99.930	100.0	100.0	1
LG&E	C1S	886439	01/2014	01/15/2014	100.080	99.920	100.0	100.0	1
LG&E	C1S	886440	01/2014	01/15/2014	100.050	99.920	100.0	100.0	1
LG&E	C1S	886441	01/2014	01/15/2014	100.110	100.020	100.0	100.0	1
LG&E	C1S	886442	01/2014	01/15/2014	100.100	99.940	100.0	100.0	1
LG&E	C1S	886443	01/2014	01/15/2014	100.060	99.940	100.0	100.0	1
LG&E	C1S	886444	01/2014	01/15/2014	100.070	99.900	100.1	100.1	1
LG&E	C1S	886445	01/2014	01/15/2014	100.070	99.910	100.0	100.0	1
LG&E	C1S	886446	01/2014	01/15/2014	100.100	99.970	100.0	100.0	1

LG&E	C1S	886447	01/2014	01/15/2014	100.090	100.030	100.0	1
LG&E	C1S	886448	01/2014	01/15/2014	100.090	99.920	100.1	1
LG&E	C1S	886449	01/2014	01/15/2014	100.070	99.960	100.0	1
LG&E	C1S	886450	01/2014	01/15/2014	100.070	99.980	99.9	1
LG&E	C1S	886451	01/2014	01/15/2014	100.100	99.990	100.0	1
LG&E	C1S	886452	01/2014	01/15/2014	100.090	99.880	100.0	1
LG&E	C1S	886453	01/2014	01/15/2014	100.100	99.970	100.0	1
LG&E	C1S	886454	01/2014	01/15/2014	100.080	99.860	100.0	1
LG&E	C1S	886455	01/2014	01/15/2014	100.050	99.950	100.0	1
LG&E	C1S	886456	01/2014	01/15/2014	100.100	99.980	100.0	1
LG&E	C1S	886457	01/2014	01/15/2014	100.060	99.960	99.9	1
LG&E	C1S	886458	01/2014	01/15/2014	100.080	99.960	100.0	1
LG&E	C1S	886459	01/2014	01/15/2014	100.110	99.930	100.0	1
LG&E	C1S	886460	01/2014	01/15/2014	100.080	99.920	100.0	1
LG&E	C1S	886461	01/2014	01/15/2014	100.080	99.900	100.0	1
LG&E	C1S	886462	01/2014	01/15/2014	100.080	99.930	99.9	1
LG&E	C1S	886463	01/2014	01/15/2014	100.060	99.930	100.1	1
LG&E	C1S	886464	01/2014	01/15/2014	100.050	99.890	99.9	1
LG&E	C1S	886465	01/2014	01/15/2014	100.060	99.950	100.0	1
LG&E	C1S	886466	01/2014	01/15/2014	100.110	100.000	99.9	1
LG&E	C1S	886467	01/2014	01/15/2014	100.040	99.860	100.0	1
LG&E	C1S	886468	01/2014	01/15/2014	100.050	99.900	100.0	1
LG&E	C1S	886469	01/2014	01/15/2014	100.060	99.950	100.0	1
LG&E	C1S	886470	01/2014	01/15/2014	100.030	99.840	100.0	1
LG&E	C1S	886471	01/2014	01/15/2014	100.080	99.950	99.9	1
LG&E	C1S	886472	01/2014	01/15/2014	100.060	99.820	100.1	1
LG&E	C1S	886473	01/2014	01/15/2014	100.050	99.970	100.0	1
LG&E	C1S	886474	01/2014	01/15/2014	100.070	99.910	100.1	1
LG&E	C1S	886475	01/2014	01/15/2014	100.060	99.880	99.9	1
LG&E	C1S	886476	01/2014	01/15/2014	100.050	99.850	100.0	1
LG&E	C1S	886477	01/2014	01/15/2014	100.060	99.830	100.0	1
LG&E	C1S	886478	01/2014	01/15/2014	100.040	99.960	100.0	1

LG&E	C1S	886479	01/2014	01/15/2014	100.070	99.960	99.9	1
LG&E	C1S	886480	01/2014	01/15/2014	100.060	99.870	100.0	1
LG&E	C1S	886481	01/2014	01/15/2014	100.070	99.880	99.9	1
LG&E	C1S	886482	01/2014	01/15/2014	100.060	99.900	99.9	1
LG&E	C1S	886483	01/2014	01/15/2014	100.080	99.940	100.1	1
LG&E	C1S	886484	01/2014	01/15/2014	100.070	99.980	100.0	1
LG&E	C1S	886485	01/2014	01/15/2014	100.040	99.840	100.0	1
LG&E	C1S	886486	01/2014	01/15/2014	100.070	99.940	100.0	1
LG&E	C1S	886487	01/2014	01/15/2014	100.070	99.900	99.9	1
LG&E	C1S	886488	01/2014	01/15/2014	100.100	99.900	100.1	1
LG&E	C1S	886489	01/2014	01/15/2014	100.090	99.940	100.0	1
LG&E	C1S	886490	01/2014	01/15/2014	100.050	99.880	100.0	1
LG&E	C1S	886491	01/2014	01/15/2014	100.080	99.850	100.0	1
LG&E	C1S	886492	01/2014	01/15/2014	100.030	99.890	100.0	1
LG&E	C1S	886493	01/2014	01/15/2014	100.090	99.920	99.9	1
LG&E	C1S	886494	01/2014	01/15/2014	100.110	99.940	100.1	1
LG&E	C1S	886495	01/2014	01/15/2014	100.070	99.850	100.0	1
LG&E	C1S	886496	01/2014	01/15/2014	100.100	99.920	100.0	1
LG&E	C1S	886497	01/2014	01/15/2014	100.080	99.970	100.0	1
LG&E	C1S	886498	01/2014	01/15/2014	100.060	99.980	100.0	1
LG&E	C1S	886499	01/2014	01/15/2014	100.050	99.900	100.0	1
LG&E	C1S	886500	01/2014	01/15/2014	100.100	99.950	100.0	1
LG&E	C1S	886501	01/2014	01/15/2014	100.090	99.950	99.9	1
LG&E	C1S	886502	01/2014	01/15/2014	100.040	99.840	100.0	1
LG&E	C1S	886503	01/2014	01/15/2014	100.080	99.930	100.0	1
LG&E	C1S	886504	01/2014	01/15/2014	100.070	99.920	100.0	1
LG&E	C1S	886505	01/2014	01/15/2014	100.060	99.960	100.0	1
LG&E	C1S	886506	01/2014	01/15/2014	100.030	99.890	100.0	1
LG&E	C1S	886507	01/2014	01/15/2014	100.070	99.890	100.0	1
LG&E	C1S	886508	01/2014	01/15/2014	100.050	99.910	100.1	1
LG&E	C1S	886509	01/2014	01/15/2014	100.070	99.890	100.0	1
LG&E	C1S	886510	01/2014	01/15/2014	100.060	99.920	100.0	1

LG&E	C1S	886511	01/2014	01/15/2014	100.060	99.880	100.0	1
LG&E	C1S	886512	01/2014	01/15/2014	100.100	100.010	100.1	1
LG&E	C1S	886513	01/2014	01/15/2014	100.070	99.920	100.0	1
LG&E	C1S	886514	01/2014	01/15/2014	100.060	99.920	99.9	1
LG&E	C1S	886515	01/2014	01/15/2014	100.070	99.930	99.9	1
LG&E	C1S	886516	01/2014	01/15/2014	100.100	99.970	100.0	1
LG&E	C1S	886517	01/2014	01/15/2014	100.030	99.880	100.0	1
LG&E	C1S	886518	01/2014	01/15/2014	100.100	99.940	100.0	1
LG&E	C1S	886519	01/2014	01/15/2014	100.110	99.930	100.0	1
LG&E	C1S	886520	01/2014	01/15/2014	100.070	99.980	100.0	1
LG&E	C1S	886521	01/2014	01/15/2014	100.110	99.920	100.1	1
LG&E	C1S	886522	01/2014	01/15/2014	100.070	99.920	100.1	1
LG&E	C1S	886523	01/2014	01/15/2014	100.040	99.830	100.0	1
LG&E	C1S	886524	01/2014	01/15/2014	100.060	99.970	100.0	1
LG&E	C1S	886525	01/2014	01/15/2014	100.080	99.910	100.0	1
LG&E	C1S	886526	01/2014	01/15/2014	100.100	100.010	100.0	1
LG&E	C1S	886527	01/2014	01/15/2014	100.040	99.920	100.0	1
LG&E	C1S	886528	01/2014	01/15/2014	100.100	99.950	100.0	1
LG&E	C1S	886529	01/2014	01/15/2014	100.080	99.910	99.9	1
LG&E	C1S	886530	01/2014	01/15/2014	100.100	99.970	100.1	1
LG&E	C1S	886531	01/2014	01/15/2014	100.050	99.870	100.0	1
LG&E	C1S	886532	01/2014	01/15/2014	100.070	99.840	100.1	1
LG&E	C1S	886533	01/2014	01/15/2014	100.090	99.970	100.0	1
LG&E	C1S	886534	01/2014	01/15/2014	100.070	99.930	99.9	1
LG&E	C1S	886535	01/2014	01/15/2014	100.050	99.920	100.0	1
LG&E	C1S	886536	01/2014	01/15/2014	100.070	99.900	100.0	1
LG&E	C1S	886537	01/2014	01/15/2014	100.070	99.910	100.0	1
LG&E	C1S	886538	01/2014	01/15/2014	100.050	99.850	100.0	1
LG&E	C1S	886539	01/2014	01/15/2014	100.070	99.950	100.0	1
LG&E	C1S	886540	01/2014	01/15/2014	100.030	99.920	100.0	1
LG&E	C1S	886541	01/2014	01/15/2014	100.080	99.920	100.0	1
LG&E	C1S	886542	01/2014	01/15/2014	100.060	99.880	100.0	1

LG&E	C1S	886543	01/2014	01/15/2014	100.100	99.920	100.1	1
LG&E	C1S	886544	01/2014	01/15/2014	100.070	99.920	100.0	1
LG&E	C1S	886545	01/2014	01/15/2014	100.100	99.910	100.0	1
LG&E	C1S	886546	01/2014	01/15/2014	100.090	99.930	100.0	1
LG&E	C1S	886547	01/2014	01/15/2014	100.080	99.940	99.9	1
LG&E	C1S	886548	01/2014	01/15/2014	100.090	100.000	100.0	1
LG&E	C1S	886549	01/2014	01/15/2014	100.090	99.960	100.0	1
LG&E	C1S	886550	01/2014	01/15/2014	100.070	99.900	99.9	1
LG&E	C1S	886551	01/2014	01/15/2014	100.070	99.910	100.1	1
LG&E	C1S	886552	01/2014	01/15/2014	100.080	99.980	100.0	1
LG&E	C1S	886553	01/2014	01/15/2014	100.100	99.950	100.0	1
LG&E	C1S	886554	01/2014	01/15/2014	100.090	99.940	100.1	1
LG&E	C1S	886555	01/2014	01/15/2014	100.090	99.890	100.0	1
LG&E	C1S	886556	01/2014	01/15/2014	100.030	99.860	100.0	1
LG&E	C1S	886557	01/2014	01/15/2014	100.100	99.920	100.0	1
LG&E	C1S	886558	01/2014	01/15/2014	100.110	99.980	100.1	1
LG&E	C1S	886559	01/2014	01/15/2014	100.090	99.900	100.0	1
LG&E	C1S	886560	01/2014	01/15/2014	100.100	99.970	100.2	1
LG&E	C1S	886561	01/2014	01/15/2014	100.090	99.930	100.1	1
LG&E	C1S	886562	01/2014	01/15/2014	100.050	99.940	100.0	1
LG&E	C1S	886563	01/2014	01/15/2014	100.050	99.980	100.0	1
LG&E	C1S	886564	01/2014	01/15/2014	100.030	99.830	100.0	1
LG&E	C1S	886565	01/2014	01/15/2014	100.030	99.880	100.0	1
LG&E	C1S	886566	01/2014	01/15/2014	100.100	99.990	100.0	1
LG&E	C1S	886567	01/2014	01/15/2014	100.090	99.970	100.0	1
LG&E	C1S	886568	01/2014	01/15/2014	100.040	99.840	100.0	1
LG&E	C1S	886569	01/2014	01/15/2014	100.040	99.860	100.0	1
LG&E	C1S	886570	01/2014	01/15/2014	100.080	99.890	100.0	1
LG&E	C1S	886571	01/2014	01/15/2014	100.080	99.920	100.0	1
LG&E	C1S	886572	01/2014	01/15/2014	100.070	99.890	100.0	1
LG&E	C1S	886573	01/2014	01/15/2014	100.060	99.850	100.0	1
LG&E	C1S	886574	01/2014	01/15/2014	100.080	99.870	100.0	1

LG&E	C1S	886575	01/2014	01/15/2014	100.060	99.910	100.0	1
LG&E	C1S	886576	01/2014	01/15/2014	100.060	99.910	100.0	1
LG&E	C1S	886577	01/2014	01/15/2014	100.080	100.020	100.1	1
LG&E	C1S	886578	01/2014	01/15/2014	100.050	99.870	99.9	1
LG&E	C1S	886579	01/2014	01/15/2014	100.050	99.910	100.0	1
LG&E	C1S	886580	01/2014	01/15/2014	100.070	99.930	100.0	1
LG&E	C1S	886581	01/2014	01/15/2014	100.060	99.870	100.0	1
LG&E	C1S	886582	01/2014	01/15/2014	100.070	99.890	100.0	1
LG&E	C1S	886583	01/2014	01/15/2014	100.100	99.970	100.1	1
LG&E	C1S	886584	01/2014	01/15/2014	100.080	99.900	100.1	1
LG&E	C1S	886585	01/2014	01/15/2014	100.050	99.840	100.0	1
LG&E	C1S	886586	01/2014	01/15/2014	100.060	99.920	100.0	1
LG&E	C1S	886587	01/2014	01/15/2014	100.100	99.940	100.0	1
LG&E	C1S	886588	01/2014	01/15/2014	100.070	99.920	100.0	1
LG&E	C1S	886589	01/2014	01/15/2014	100.060	99.870	99.9	1
LG&E	C1S	886590	01/2014	01/15/2014	100.030	99.850	100.0	1
LG&E	C1S	886591	01/2014	01/15/2014	100.090	99.930	100.0	1
LG&E	C1S	886592	01/2014	01/15/2014	100.070	99.950	100.0	1
LG&E	C1S	886593	01/2014	01/15/2014	100.070	99.890	100.0	1
LG&E	C1S	886594	01/2014	01/15/2014	100.050	99.870	99.9	1
LG&E	C1S	886595	01/2014	01/15/2014	100.090	99.950	99.9	1
LG&E	C1S	886596	01/2014	01/15/2014	100.120	99.900	100.0	1
LG&E	C1S	886597	01/2014	01/15/2014	100.070	99.930	99.9	1
LG&E	C1S	886598	01/2014	01/15/2014	100.090	99.980	100.0	1
LG&E	C1S	886599	01/2014	01/15/2014	100.030	99.800	100.0	1
LG&E	C1S	886600	01/2014	01/15/2014	100.050	99.930	100.0	1
LG&E	C1S	886601	01/2014	01/15/2014	100.080	99.910	99.9	1
LG&E	C1S	886602	01/2014	01/15/2014	100.100	99.860	100.0	1
LG&E	C1S	886603	01/2014	01/15/2014	100.100	99.980	100.0	1
LG&E	C1S	886604	01/2014	01/15/2014	100.030	99.820	100.0	1
LG&E	C1S	886605	01/2014	01/15/2014	100.070	99.960	100.1	1
LG&E	C1S	886606	01/2014	01/15/2014	100.070	99.880	100.0	1

LG&E	886607	C1S	01/2014	01/15/2014	100.080	99.910	100.0	1
LG&E	886608	C1S	01/2014	01/15/2014	100.080	99.880	100.0	1
LG&E	886609	C1S	01/2014	01/15/2014	100.060	99.900	100.0	1
LG&E	886610	C1S	01/2014	01/15/2014	100.070	99.880	99.9	1
LG&E	886611	C1S	01/2014	01/15/2014	100.090	99.900	100.1	1
LG&E	886612	C1S	01/2014	01/15/2014	100.090	99.990	100.0	1
LG&E	886613	C1S	01/2014	01/15/2014	100.070	99.880	100.0	1
LG&E	886614	C1S	01/2014	01/15/2014	100.110	99.950	100.0	1
LG&E	886615	C1S	01/2014	01/15/2014	100.090	99.960	100.0	1
LG&E	886616	C1S	01/2014	01/15/2014	100.060	99.970	99.9	1
LG&E	886617	C1S	01/2014	01/15/2014	100.070	99.840	99.9	1
LG&E	886618	C1S	01/2014	01/15/2014	100.100	99.960	100.1	1
LG&E	886619	C1S	01/2014	01/15/2014	100.100	99.880	100.1	1
LG&E	886620	C1S	01/2014	01/15/2014	100.080	99.900	99.9	1
LG&E	886621	C1S	01/2014	01/15/2014	100.050	99.880	100.0	1
LG&E	886622	C1S	01/2014	01/15/2014	100.090	99.960	100.0	1
LG&E	886623	C1S	01/2014	01/15/2014	100.030	99.890	100.0	1
LG&E	886624	C1S	01/2014	01/15/2014	100.070	99.890	100.1	1
LG&E	886625	C1S	01/2014	01/15/2014	100.070	99.960	99.9	1
LG&E	886626	C1S	01/2014	01/15/2014	100.070	99.940	99.9	1
LG&E	886627	C1S	01/2014	01/15/2014	100.080	99.940	100.0	1
LG&E	886628	C1S	01/2014	01/15/2014	100.060	99.860	100.0	1
LG&E	886629	C1S	01/2014	01/15/2014	100.070	99.950	100.0	1
LG&E	886630	C1S	01/2014	01/15/2014	100.070	99.950	100.0	1
LG&E	886631	C1S	01/2014	01/15/2014	100.100	99.930	100.0	1
LG&E	886632	C1S	01/2014	01/15/2014	100.090	99.860	99.9	1
LG&E	886633	C1S	01/2014	01/15/2014	100.080	99.940	100.0	1
LG&E	886634	C1S	01/2014	01/15/2014	100.090	99.920	100.0	1
LG&E	886635	C1S	01/2014	01/15/2014	100.060	99.810	100.0	1
LG&E	886636	C1S	01/2014	01/15/2014	100.060	99.870	100.0	1
LG&E	886637	C1S	01/2014	01/15/2014	100.090	99.880	100.0	1
LG&E	886638	C1S	01/2014	01/15/2014	100.060	99.900	99.9	1

LG&E	886639	C1S	01/2014	01/15/2014	100.070	99.860	100.1	1
LG&E	886640	C1S	01/2014	01/15/2014	100.090	99.870	99.9	1
LG&E	886641	C1S	01/2014	01/15/2014	100.090	99.960	100.0	1
LG&E	886642	C1S	01/2014	01/15/2014	100.070	99.810	100.0	1
LG&E	886643	C1S	01/2014	01/15/2014	100.070	99.840	100.0	1
LG&E	886644	C1S	01/2014	01/15/2014	100.100	99.960	100.1	1
LG&E	886645	C1S	01/2014	01/15/2014	100.060	99.880	100.0	1
LG&E	886646	C1S	01/2014	01/15/2014	100.090	99.970	100.0	1
LG&E	886647	C1S	01/2014	01/15/2014	100.070	99.880	100.0	1
LG&E	886648	C1S	01/2014	01/15/2014	100.060	99.900	100.1	1
LG&E	886649	C1S	01/2014	01/15/2014	100.030	99.920	100.0	1
LG&E	886650	C1S	01/2014	01/15/2014	100.060	99.870	100.0	1
LG&E	886651	C1S	01/2014	01/15/2014	100.090	99.870	100.0	1
LG&E	886652	C1S	01/2014	01/15/2014	100.090	99.900	100.0	1
LG&E	886653	C1S	01/2014	01/15/2014	100.110	99.940	100.0	1
LG&E	886654	C1S	01/2014	01/15/2014	100.060	99.900	100.0	1
LG&E	886655	C1S	01/2014	01/15/2014	100.080	99.890	100.0	1
LG&E	886656	C1S	01/2014	01/15/2014	100.050	99.940	100.0	1
LG&E	886657	C1S	01/2014	01/15/2014	100.050	99.880	100.0	1
LG&E	886658	C1S	01/2014	01/15/2014	100.040	99.890	100.0	1
LG&E	886659	C1S	01/2014	01/15/2014	100.090	99.950	100.0	1
LG&E	886660	C1S	01/2014	01/15/2014	100.050	99.940	100.0	1
LG&E	886661	C1S	01/2014	01/15/2014	100.090	99.980	100.1	1
LG&E	886662	C1S	01/2014	01/15/2014	100.050	99.900	100.1	1
LG&E	886663	C1S	01/2014	01/15/2014	100.100	100.000	100.1	1
LG&E	886664	C1S	01/2014	01/15/2014	100.040	99.850	100.0	1
LG&E	886665	C1S	01/2014	01/15/2014	100.070	99.980	100.0	1
LG&E	886666	C1S	01/2014	01/15/2014	100.030	99.940	99.9	1
LG&E	886667	C1S	01/2014	01/15/2014	100.050	99.920	100.0	1
LG&E	886668	C1S	01/2014	01/15/2014	100.080	99.940	99.9	1
LG&E	886669	C1S	01/2014	01/15/2014	100.100	99.940	100.0	1
LG&E	886670	C1S	01/2014	01/15/2014	100.070	99.960	100.1	1

LG&E	886671	C1S	01/2014	01/15/2014	100.070	99,900	99.9	1
LG&E	886672	C1S	01/2014	01/15/2014	100.030	99,870	100.0	1
LG&E	886673	C1S	01/2014	01/15/2014	100.070	99,930	100.0	1
LG&E	886674	C1S	01/2014	01/15/2014	100.090	99,920	100.0	1
LG&E	886675	C1S	01/2014	01/15/2014	100.080	99,990	100.0	1
LG&E	886676	C1S	01/2014	01/15/2014	100.030	99,840	100.0	1
LG&E	886677	C1S	01/2014	01/15/2014	100.030	99,870	100.0	1
LG&E	886678	C1S	01/2014	01/15/2014	100.100	99,990	100.0	1
LG&E	886679	C1S	01/2014	01/15/2014	100.070	99,890	100.0	1
LG&E	886680	C1S	01/2014	01/15/2014	100.090	99,940	100.0	1
LG&E	886681	C1S	01/2014	01/15/2014	100.050	99,900	100.0	1
LG&E	886682	C1S	01/2014	01/15/2014	100.040	99,900	100.0	1
LG&E	886683	C1S	01/2014	01/15/2014	100.070	99,940	100.0	1
LG&E	886684	C1S	01/2014	01/15/2014	100.050	99,890	99.9	1
LG&E	886685	C1S	01/2014	01/15/2014	100.060	99,890	100.0	1
LG&E	886686	C1S	01/2014	01/15/2014	100.100	99,930	100.1	1
LG&E	886687	C1S	01/2014	01/15/2014	100.100	99,850	100.0	1
LG&E	886688	C1S	01/2014	01/15/2014	100.060	99,810	100.0	1
LG&E	886689	C1S	01/2014	01/15/2014	100.060	99,910	100.0	1
LG&E	886690	C1S	01/2014	01/15/2014	100.070	99,980	100.0	1
LG&E	886691	C1S	01/2014	01/15/2014	100.100	99,970	100.1	1
LG&E	886692	C1S	01/2014	01/15/2014	100.100	99,910	100.0	1
LG&E	886693	C1S	01/2014	01/15/2014	100.070	99,940	100.0	1
LG&E	886694	C1S	01/2014	01/15/2014	100.040	99,880	100.0	1
LG&E	886695	C1S	01/2014	01/15/2014	100.060	99,830	100.0	1
LG&E	886696	C1S	01/2014	01/15/2014	100.050	99,850	100.0	1
LG&E	886697	C1S	01/2014	01/15/2014	100.100	99,930	100.1	1
LG&E	886698	C1S	01/2014	01/15/2014	100.070	99,900	99.9	1
LG&E	886699	C1S	01/2014	01/15/2014	100.050	99,910	100.0	1
LG&E	886700	C1S	01/2014	01/15/2014	100.040	99,920	100.1	1
LG&E	886701	C1S	01/2014	01/15/2014	100.090	99,990	100.0	1
LG&E	886702	C1S	01/2014	01/15/2014	100.080	99,890	100.0	1

LG&E	886703	C1S	01/2014	01/15/2014	100.100	99.910	100.0	1
LG&E	886704	C1S	01/2014	01/15/2014	100.070	99.930	100.0	1
LG&E	886705	C1S	01/2014	01/15/2014	100.050	99.940	100.0	1
LG&E	886706	C1S	01/2014	01/15/2014	100.080	99.940	100.0	1
LG&E	886707	C1S	01/2014	01/15/2014	100.080	99.880	100.1	1
LG&E	886708	C1S	01/2014	01/15/2014	100.050	99.920	100.0	1
LG&E	886709	C1S	01/2014	01/15/2014	100.060	99.950	100.0	1
LG&E	886710	C1S	01/2014	01/15/2014	100.070	99.980	100.0	1
LG&E	886711	C1S	01/2014	01/15/2014	100.090	99.930	99.9	1
LG&E	886712	C1S	01/2014	01/15/2014	100.070	99.910	100.0	1
LG&E	886713	C1S	01/2014	01/15/2014	100.040	99.870	100.0	1
LG&E	886714	C1S	01/2014	01/15/2014	100.100	99.940	100.1	1
LG&E	886715	C1S	01/2014	01/15/2014	100.090	100.000	100.0	1
LG&E	886716	C1S	01/2014	01/15/2014	100.090	99.950	100.1	1
LG&E	886717	C1S	01/2014	01/15/2014	100.080	99.890	100.0	1
LG&E	886718	C1S	01/2014	01/15/2014	100.070	99.930	100.0	1
LG&E	886719	C1S	01/2014	01/15/2014	100.040	99.900	100.0	1
LG&E	886720	C1S	01/2014	01/15/2014	100.030	99.830	99.9	1
LG&E	886721	C1S	01/2014	01/15/2014	100.100	99.850	99.9	1
LG&E	886722	C1S	01/2014	01/15/2014	100.100	99.880	100.0	1
LG&E	886723	C1S	01/2014	01/15/2014	100.080	99.940	100.0	1
LG&E	886724	C1S	01/2014	01/15/2014	100.050	99.820	100.0	1
LG&E	886725	C1S	01/2014	01/15/2014	100.040	99.900	99.9	1
LG&E	886726	C1S	01/2014	01/15/2014	100.050	99.820	99.9	1
LG&E	886727	C1S	01/2014	01/15/2014	100.060	99.830	100.0	1
LG&E	886728	C1S	01/2014	01/15/2014	100.070	99.880	100.0	1
LG&E	886729	C1S	01/2014	01/15/2014	100.090	99.990	100.0	1
LG&E	886730	C1S	01/2014	01/15/2014	100.080	99.930	100.1	1
LG&E	886731	C1S	01/2014	01/15/2014	100.060	99.870	100.1	1
LG&E	886732	C1S	01/2014	01/15/2014	100.060	99.880	100.0	1
LG&E	886733	C1S	01/2014	01/15/2014	100.100	99.940	100.0	1
LG&E	886734	C1S	01/2014	01/15/2014	100.090	99.920	100.0	1

LG&E	C1S	886735	01/2014	01/15/2014	100.080	99.910	100.0	1
LG&E	C1S	886736	01/2014	01/15/2014	100.100	99.920	100.0	1
LG&E	C1S	886737	01/2014	01/15/2014	100.050	99.910	100.0	1
LG&E	C1S	886738	01/2014	01/15/2014	100.050	99.860	100.0	1
LG&E	C1S	886739	01/2014	01/15/2014	100.100	99.860	100.0	1
LG&E	C1S	886740	01/2014	01/15/2014	100.060	99.870	99.9	1
LG&E	C1S	886741	01/2014	01/15/2014	100.070	99.920	100.0	1
LG&E	C1S	886742	01/2014	01/15/2014	100.040	99.900	100.0	1
LG&E	C1S	886743	01/2014	01/15/2014	100.090	99.930	99.9	1
LG&E	C1S	886744	01/2014	01/15/2014	100.070	99.890	100.0	1
LG&E	C1S	886745	01/2014	01/15/2014	100.100	99.910	100.0	1
LG&E	C1S	886746	01/2014	01/15/2014	100.090	99.980	100.0	1
LG&E	C1S	886747	01/2014	01/15/2014	100.090	99.950	100.0	1
LG&E	C1S	886748	01/2014	01/15/2014	100.050	99.890	100.0	1
LG&E	C1S	886749	01/2014	01/15/2014	100.070	99.910	99.9	1
LG&E	C1S	886750	01/2014	01/15/2014	100.050	99.880	99.9	1
LG&E	C1S	886751	01/2014	01/15/2014	100.060	99.880	100.0	1
LG&E	C1S	886752	01/2014	01/15/2014	100.080	99.910	100.0	1
LG&E	C1S	886753	01/2014	01/15/2014	100.030	99.840	100.0	1
LG&E	C1S	886754	01/2014	01/15/2014	100.060	99.900	100.0	1
LG&E	C1S	886755	01/2014	01/15/2014	100.050	99.900	100.0	1
LG&E	C1S	886756	01/2014	01/15/2014	100.040	99.890	100.0	1
LG&E	C1S	886757	01/2014	01/15/2014	100.090	99.970	99.9	1
LG&E	C1S	886758	01/2014	01/15/2014	100.040	99.870	99.9	1
LG&E	C1S	886759	01/2014	01/15/2014	100.050	99.850	100.1	1
LG&E	C1S	886760	01/2014	01/15/2014	100.070	99.940	100.0	1
LG&E	C1S	886761	01/2014	01/15/2014	100.100	99.940	99.9	1
LG&E	C1S	886762	01/2014	01/15/2014	100.070	99.970	100.1	1
LG&E	C1S	886763	01/2014	01/15/2014	100.030	99.890	100.0	1
LG&E	C1S	886764	01/2014	01/15/2014	100.080	99.890	100.0	1
LG&E	C1S	886765	01/2014	01/15/2014	100.050	99.900	100.0	1
LG&E	C1S	886766	01/2014	01/15/2014	100.060	99.840	100.0	1

LG&E	C1S	886767	01/2014	01/15/2014	100.040	99.930	100.0	1
LG&E	C1S	886768	01/2014	01/15/2014	100.080	99.870	100.0	1
LG&E	C1S	886769	01/2014	01/15/2014	100.060	99.900	100.0	1
LG&E	C1S	886770	01/2014	01/15/2014	100.080	99.920	99.9	1
LG&E	C1S	886771	01/2014	01/15/2014	100.060	99.920	99.9	1
LG&E	C1S	886772	01/2014	01/15/2014	100.030	99.810	100.0	1
LG&E	C1S	886773	01/2014	01/15/2014	100.060	99.880	100.0	1
LG&E	C1S	886774	01/2014	01/15/2014	100.040	99.830	99.9	1
LG&E	C1S	886775	01/2014	01/15/2014	100.050	99.920	100.0	1
LG&E	C1S	886776	01/2014	01/15/2014	100.070	99.950	100.0	1
LG&E	C1S	886777	01/2014	01/15/2014	100.100	99.950	100.0	1
LG&E	C1S	886778	01/2014	01/15/2014	100.090	99.890	100.0	1
LG&E	C1S	886779	01/2014	01/15/2014	100.060	99.910	100.0	1
LG&E	C1S	886780	01/2014	01/15/2014	100.100	99.950	100.1	1
LG&E	C1S	886781	01/2014	01/15/2014	100.100	99.890	100.0	1
LG&E	C1S	886782	01/2014	01/15/2014	100.090	99.930	100.1	1
LG&E	C1S	886783	01/2014	01/15/2014	100.100	99.980	100.0	1
LG&E	C1S	886784	01/2014	01/15/2014	100.080	99.930	100.0	1
LG&E	C1S	886785	01/2014	01/15/2014	100.060	99.950	100.1	1
LG&E	C1S	886786	01/2014	01/15/2014	100.100	100.040	100.1	1
LG&E	C1S	886787	01/2014	01/15/2014	100.050	99.850	99.9	1
LG&E	C1S	886788	01/2014	01/15/2014	100.080	99.860	100.0	1
LG&E	C1S	886789	01/2014	01/15/2014	100.080	99.890	100.0	1
LG&E	C1S	886790	01/2014	01/15/2014	100.070	99.920	100.0	1
LG&E	C1S	886791	01/2014	01/15/2014	100.080	99.960	100.1	1
LG&E	C1S	886792	01/2014	01/15/2014	100.060	99.930	100.1	1
LG&E	C1S	886793	01/2014	01/15/2014	100.030	99.930	100.0	1
LG&E	C1S	886794	01/2014	01/15/2014	100.030	99.870	100.0	1
LG&E	C1S	886795	01/2014	01/15/2014	100.070	99.940	100.1	1
LG&E	C1S	886796	01/2014	01/15/2014	100.070	99.940	100.0	1
LG&E	C1S	886797	01/2014	01/15/2014	100.100	99.920	100.1	1
LG&E	C1S	886798	01/2014	01/15/2014	100.080	99.990	100.0	1

LG&E	C1S	886799	01/2014	01/15/2014	100.080	99.950	100.1	1
LG&E	C1S	886800	01/2014	01/15/2014	100.070	99.900	100.0	1
LG&E	C1S	886801	01/2014	01/15/2014	100.080	99.970	100.1	1
LG&E	C1S	886802	01/2014	01/15/2014	100.070	99.830	100.0	1
LG&E	C1S	886803	01/2014	01/15/2014	100.080	99.930	100.0	1
LG&E	C1S	886804	01/2014	01/15/2014	100.060	99.910	99.9	1
LG&E	C1S	886805	01/2014	01/15/2014	100.030	99.900	99.9	1
LG&E	C1S	886806	01/2014	01/15/2014	100.100	99.920	100.1	1
LG&E	C1S	886807	01/2014	01/15/2014	100.060	99.970	100.0	1
LG&E	C1S	886808	01/2014	01/15/2014	100.070	99.950	100.1	1
LG&E	C1S	886809	01/2014	01/15/2014	100.030	99.890	100.0	1
LG&E	C1S	886810	01/2014	01/15/2014	100.070	99.890	99.9	1
LG&E	C1S	886811	01/2014	01/15/2014	100.090	99.930	100.0	1
LG&E	C1S	886812	01/2014	01/15/2014	100.060	99.940	99.9	1
LG&E	C1S	886813	01/2014	01/15/2014	100.050	99.870	99.9	1
LG&E	C1S	886814	01/2014	01/15/2014	100.060	99.910	100.1	1
LG&E	C1S	886815	01/2014	01/15/2014	100.050	99.890	99.9	1
LG&E	C1S	886816	01/2014	01/15/2014	100.100	99.900	100.1	1
LG&E	C1S	886817	01/2014	01/15/2014	100.100	99.940	100.0	1
LG&E	C1S	886818	01/2014	01/15/2014	100.080	99.940	100.0	1
LG&E	C1S	886819	01/2014	01/15/2014	100.090	99.920	100.0	1
LG&E	C1S	886820	01/2014	01/15/2014	100.080	99.830	100.0	1
LG&E	C1S	886821	01/2014	01/15/2014	100.050	99.890	100.0	1
LG&E	C1S	886822	01/2014	01/15/2014	100.080	99.930	100.0	1
LG&E	C1S	886823	01/2014	01/15/2014	100.070	99.880	100.0	1
LG&E	C1S	886824	01/2014	01/15/2014	100.070	99.980	100.0	1
LG&E	C1S	886825	01/2014	01/15/2014	100.090	99.900	100.0	1
LG&E	C1S	886826	01/2014	01/15/2014	100.070	99.910	100.1	1
LG&E	C1S	886827	01/2014	01/15/2014	100.050	99.900	100.0	1
LG&E	C1S	886828	01/2014	01/15/2014	100.090	99.940	100.0	1
LG&E	C1S	886829	01/2014	01/15/2014	100.030	99.920	100.0	1
LG&E	C1S	886830	01/2014	01/15/2014	100.070	99.920	100.0	1

LG&E	C1S	886831	01/2014	01/15/2014	100.070	99.980	100.0	1
LG&E	C1S	886832	01/2014	01/15/2014	100.060	99.850	99.9	1
LG&E	C1S	886833	01/2014	01/15/2014	100.050	99.860	100.0	1
LG&E	C1S	886834	01/2014	01/15/2014	100.060	99.910	100.0	1
LG&E	C1S	886835	01/2014	01/15/2014	100.040	99.900	100.0	1
LG&E	C1S	886836	01/2014	01/15/2014	100.090	99.890	100.0	1
LG&E	C1S	886837	01/2014	01/15/2014	100.100	99.940	100.0	1
LG&E	C1S	886838	01/2014	01/15/2014	100.100	99.950	100.1	1
LG&E	C1S	886839	01/2014	01/15/2014	100.060	99.900	100.0	1
LG&E	C1S	886840	01/2014	01/15/2014	100.070	99.910	100.0	1
LG&E	C1S	886841	01/2014	01/15/2014	100.080	99.930	100.0	1
LG&E	C1S	886842	01/2014	01/15/2014	100.080	99.930	100.0	1
LG&E	C1S	886843	01/2014	01/15/2014	100.030	99.860	100.0	1
LG&E	C1S	886844	01/2014	01/15/2014	100.090	99.900	100.0	1
LG&E	C1S	886845	01/2014	01/15/2014	100.090	99.950	100.0	1
LG&E	C1S	886846	01/2014	01/15/2014	100.030	99.910	100.0	1
LG&E	C1S	886847	01/2014	01/15/2014	100.050	99.930	100.0	1
LG&E	C1S	886848	01/2014	01/15/2014	100.080	99.890	99.9	1
LG&E	C1S	886849	01/2014	01/15/2014	100.030	99.840	100.0	1
LG&E	C1S	886850	01/2014	01/15/2014	100.080	99.920	100.0	1
LG&E	C1S	886851	01/2014	01/15/2014	100.090	99.890	99.9	1
LG&E	C1S	886852	01/2014	01/15/2014	100.080	99.880	100.0	1
LG&E	C1S	886853	01/2014	01/15/2014	100.060	99.950	99.9	1
LG&E	C1S	886854	01/2014	01/15/2014	100.070	99.880	100.1	1
LG&E	C1S	886855	01/2014	01/15/2014	100.090	99.920	99.9	1
LG&E	C1S	886856	01/2014	01/15/2014	100.060	99.910	100.0	1
LG&E	C1S	886857	01/2014	01/15/2014	100.060	99.930	99.9	1
LG&E	C1S	886858	01/2014	01/15/2014	100.030	99.830	100.0	1
LG&E	C1S	886859	01/2014	01/15/2014	100.090	99.830	100.1	1
LG&E	C1S	886860	01/2014	01/15/2014	100.100	99.940	100.0	1
LG&E	C1S	886861	01/2014	01/15/2014	100.060	99.860	100.0	1
LG&E	C1S	886862	01/2014	01/15/2014	100.050	99.850	99.9	1

LG&E	C1S	886863	01/2014	01/15/2014	100.030	99.870	100.0	1
LG&E	C1S	886864	01/2014	01/15/2014	100.090	99.940	100.0	1
LG&E	C1S	886865	01/2014	01/15/2014	100.060	99.950	99.9	1
LG&E	C1S	886866	01/2014	01/15/2014	100.040	99.940	100.0	1
LG&E	C1S	886867	01/2014	01/15/2014	100.100	99.910	100.1	1
LG&E	C1S	886868	01/2014	01/15/2014	100.060	99.950	100.0	1
LG&E	C1S	886869	01/2014	01/15/2014	100.070	99.850	100.1	1
LG&E	C1S	886870	01/2014	01/15/2014	100.040	99.880	100.0	1
LG&E	C1S	886871	01/2014	01/15/2014	100.090	99.930	100.1	1
LG&E	C1S	886872	01/2014	01/15/2014	100.100	99.930	100.0	1
LG&E	C1S	886873	01/2014	01/15/2014	100.030	99.800	99.9	1
LG&E	C1S	886874	01/2014	01/15/2014	100.070	99.880	100.0	1
LG&E	C1S	886875	01/2014	01/15/2014	100.090	99.910	100.0	1
LG&E	C1S	886876	01/2014	01/15/2014	100.090	99.910	100.1	1
LG&E	C1S	886877	01/2014	01/15/2014	100.070	99.860	99.9	1
LG&E	C1S	886878	01/2014	01/15/2014	100.100	99.870	100.0	1
LG&E	C1S	886879	01/2014	01/15/2014	100.090	99.910	99.9	1
LG&E	C1S	886880	01/2014	01/15/2014	100.070	99.900	99.9	1
LG&E	C1S	886881	01/2014	01/15/2014	100.070	99.910	100.0	1
LG&E	C1S	886882	01/2014	01/15/2014	100.060	99.880	99.9	1
LG&E	C1S	886883	01/2014	01/15/2014	100.080	99.870	100.0	1
LG&E	C1S	886884	01/2014	01/15/2014	100.070	99.920	100.0	1
LG&E	C1S	886885	01/2014	01/15/2014	100.050	99.870	99.9	1
LG&E	C1S	886886	01/2014	01/15/2014	100.080	99.920	100.1	1
LG&E	C1S	886887	01/2014	01/15/2014	100.080	99.890	100.0	1
LG&E	C1S	886888	01/2014	01/15/2014	100.070	99.890	100.0	1
LG&E	C1S	886889	01/2014	01/15/2014	100.070	99.920	100.1	1
LG&E	C1S	886890	01/2014	01/15/2014	100.090	99.940	99.9	1
LG&E	C1S	886891	01/2014	01/15/2014	100.080	99.920	100.0	1
LG&E	C1S	886892	01/2014	01/15/2014	100.080	99.980	100.0	1
LG&E	C1S	886893	01/2014	01/15/2014	100.090	99.920	100.0	1
LG&E	C1S	886894	01/2014	01/15/2014	100.100	99.890	100.0	1

LG&E	C1S	886895	01/2014	01/15/2014	100.050	99.990	100.0	1
LG&E	C1S	886896	01/2014	01/15/2014	100.080	99.870	100.1	1
LG&E	C1S	886897	01/2014	01/15/2014	100.100	100.020	100.0	1
LG&E	C1S	886898	01/2014	01/15/2014	100.060	99.820	100.0	1
LG&E	C1S	886899	01/2014	01/15/2014	100.060	99.910	100.0	1
LG&E	C1S	886900	01/2014	01/15/2014	100.090	99.930	100.1	1
LG&E	C1S	886901	01/2014	01/15/2014	100.080	99.930	100.0	1
LG&E	C1S	886902	01/2014	01/15/2014	100.030	99.850	100.0	1
LG&E	C1S	886903	01/2014	01/15/2014	100.030	99.810	99.9	1
LG&E	C1S	886904	01/2014	01/15/2014	100.070	99.870	100.1	1
LG&E	C1S	886905	01/2014	01/15/2014	100.040	99.880	99.9	1
LG&E	C1S	886906	01/2014	01/15/2014	100.090	99.970	100.1	1
LG&E	C1S	886907	01/2014	01/15/2014	100.060	99.900	99.9	1
LG&E	C1S	886908	01/2014	01/15/2014	100.090	99.890	100.0	1
LG&E	C1S	886909	01/2014	01/15/2014	100.070	99.980	100.2	1
LG&E	C1S	886910	01/2014	01/15/2014	100.050	99.900	100.0	1
LG&E	C1S	886911	01/2014	01/15/2014	100.100	99.940	99.9	1
LG&E	C1S	886912	01/2014	01/15/2014	100.060	99.940	100.0	1
LG&E	C1S	886913	01/2014	01/15/2014	100.090	99.980	100.0	1
LG&E	C1S	886914	01/2014	01/15/2014	100.100	99.930	99.9	1
LG&E	C1S	886915	01/2014	01/15/2014	100.100	99.920	100.1	1
LG&E	C1S	886916	01/2014	01/15/2014	100.070	99.890	100.0	1
LG&E	C1S	886917	01/2014	01/15/2014	100.040	99.850	100.0	1
LG&E	C1S	886918	01/2014	01/15/2014	100.080	99.930	100.0	1
LG&E	C1S	886919	01/2014	01/15/2014	100.090	99.860	100.1	1
LG&E	C1S	886920	01/2014	01/15/2014	100.060	99.890	99.9	1
LG&E	C1S	886921	01/2014	01/15/2014	100.070	99.900	100.0	1
LG&E	C1S	886922	01/2014	01/15/2014	100.090	99.940	100.1	1
LG&E	C1S	886923	01/2014	01/15/2014	100.090	99.830	100.1	1
LG&E	C1S	886924	01/2014	01/15/2014	100.080	99.860	99.9	1
LG&E	C1S	886925	01/2014	01/15/2014	100.070	99.910	100.0	1
LG&E	C1S	886926	01/2014	01/15/2014	100.060	99.950	100.0	1

LG&E	C1S	886927	01/2014	01/15/2014	100.060	99.840	100.0	1
LG&E	C1S	886928	01/2014	01/15/2014	100.100	100.020	100.0	1
LG&E	C1S	886929	01/2014	01/15/2014	100.090	99.940	100.0	1
LG&E	C1S	886930	01/2014	01/15/2014	100.090	99.870	100.0	1
LG&E	C1S	886931	01/2014	01/15/2014	100.040	99.910	100.0	1
LG&E	C1S	886932	01/2014	01/15/2014	100.060	99.870	100.0	1
LG&E	C1S	886933	01/2014	01/15/2014	100.080	99.940	100.0	1
LG&E	C1S	886934	01/2014	01/15/2014	100.080	99.890	99.9	1
LG&E	C1S	886935	01/2014	01/15/2014	100.040	99.880	100.0	1
LG&E	C1S	886936	01/2014	01/15/2014	100.090	99.950	100.0	1
LG&E	C1S	886937	01/2014	01/15/2014	100.100	99.900	100.0	1
LG&E	C1S	886938	01/2014	01/15/2014	100.050	99.930	100.0	1
LG&E	C1S	886939	01/2014	01/15/2014	100.060	99.860	99.9	1
LG&E	C1S	886940	01/2014	01/15/2014	100.080	99.910	100.0	1
LG&E	C1S	886941	01/2014	01/15/2014	100.070	99.940	100.0	1
LG&E	C1S	886942	01/2014	01/15/2014	100.090	99.900	100.0	1
LG&E	C1S	886943	01/2014	01/15/2014	100.070	99.880	100.0	1
LG&E	C1S	886944	01/2014	01/15/2014	100.090	99.940	100.0	1
LG&E	C1S	886945	01/2014	01/15/2014	100.100	100.000	100.1	1
LG&E	C1S	886946	01/2014	01/15/2014	100.070	99.960	100.0	1
LG&E	C1S	886947	01/2014	01/15/2014	100.050	99.910	100.0	1
LG&E	C1S	886948	01/2014	01/15/2014	100.040	99.910	100.0	1
LG&E	C1S	886949	01/2014	01/15/2014	100.100	99.930	100.1	1
LG&E	C1S	886950	01/2014	01/15/2014	100.050	99.910	100.0	1
LG&E	C1S	886951	01/2014	01/15/2014	100.100	100.000	99.9	1
LG&E	C1S	886952	01/2014	01/15/2014	100.080	99.910	100.0	1
LG&E	C1S	886953	01/2014	01/15/2014	100.070	99.910	100.0	1
LG&E	C1S	886954	01/2014	01/15/2014	100.040	99.890	99.9	1
LG&E	C1S	886955	01/2014	01/15/2014	100.030	99.900	100.0	1
LG&E	C1S	886956	01/2014	01/15/2014	100.060	99.990	99.9	1
LG&E	C1S	886957	01/2014	01/15/2014	100.050	99.880	99.9	1
LG&E	C1S	886958	01/2014	01/15/2014	100.090	99.880	100.1	1

LG&E	C1S	886959	01/2014	01/15/2014	100.030	99.870	100.0	1
LG&E	C1S	886960	01/2014	01/15/2014	100.070	99.890	100.0	1
LG&E	C1S	886961	01/2014	01/15/2014	100.050	99.940	100.0	1
LG&E	C1S	886962	01/2014	01/15/2014	100.080	99.830	100.1	1
LG&E	C1S	886963	01/2014	01/15/2014	100.040	99.870	100.0	1
LG&E	C1S	886964	01/2014	01/15/2014	100.060	99.940	100.0	1
LG&E	C1S	886965	01/2014	01/15/2014	100.060	99.920	99.9	1
LG&E	C1S	886966	01/2014	01/15/2014	100.070	99.910	99.9	1
LG&E	C1S	886967	01/2014	01/15/2014	100.060	99.910	100.1	1
LG&E	C1S	886968	01/2014	01/15/2014	100.060	99.830	100.1	1
LG&E	C1S	886969	01/2014	01/15/2014	100.060	99.940	100.1	1
LG&E	C1S	886970	01/2014	01/15/2014	100.080	99.900	100.1	1
LG&E	C1S	886971	01/2014	01/15/2014	100.060	99.910	99.9	1
LG&E	C1S	886972	01/2014	01/15/2014	100.050	99.930	100.0	1
LG&E	C1S	886973	01/2014	01/15/2014	100.050	99.800	100.0	1
LG&E	C1S	886974	01/2014	01/15/2014	100.060	99.860	100.0	1
LG&E	C1S	886975	01/2014	01/15/2014	100.030	99.900	100.0	1
LG&E	C1S	886976	01/2014	01/15/2014	100.080	99.960	100.0	1
LG&E	C1S	886977	01/2014	01/15/2014	100.030	99.860	100.0	1
LG&E	C1S	886978	01/2014	01/15/2014	100.090	99.880	100.1	1
LG&E	C1S	886979	01/2014	01/15/2014	100.070	99.920	100.0	1
LG&E	C1S	886980	01/2014	01/15/2014	100.070	99.950	100.0	1
LG&E	C1S	886981	01/2014	01/15/2014	100.070	99.950	100.0	1
LG&E	C1S	886982	01/2014	01/15/2014	100.060	99.880	100.0	1
LG&E	C1S	886983	01/2014	01/15/2014	100.100	99.990	100.0	1
LG&E	C1S	886984	01/2014	01/15/2014	100.060	99.840	100.0	1
LG&E	C1S	886985	01/2014	01/15/2014	100.080	99.910	100.1	1
LG&E	C1S	886986	01/2014	01/15/2014	100.060	99.930	100.1	1
LG&E	C1S	886987	01/2014	01/15/2014	100.060	99.860	100.0	1
LG&E	C1S	886988	01/2014	01/15/2014	100.080	99.920	100.1	1
LG&E	C1S	886989	01/2014	01/15/2014	100.060	99.900	100.1	1
LG&E	C1S	886990	01/2014	01/15/2014	100.060	99.840	100.0	1

LG&E	C1S	886991	01/2014	01/15/2014	100.080	99.920	100.1	1
LG&E	C1S	886992	01/2014	01/15/2014	100.060	99.900	99.9	1
LG&E	C1S	886993	01/2014	01/15/2014	100.080	99.960	100.0	1
LG&E	C1S	886994	01/2014	01/15/2014	100.070	99.810	100.1	1
LG&E	C1S	886995	01/2014	01/15/2014	100.070	99.910	100.0	1
LG&E	C1S	886996	01/2014	01/15/2014	100.090	99.900	100.1	1
LG&E	C1S	886997	01/2014	01/15/2014	100.060	99.910	100.0	1
LG&E	C1S	886998	01/2014	01/15/2014	100.090	99.920	100.0	1
LG&E	C1S	886999	01/2014	01/15/2014	100.060	99.830	100.0	1
LG&E	C1S	887000	01/2014	01/15/2014	100.050	99.830	100.0	1
LG&E	C1S	887001	01/2014	01/15/2014	100.060	99.910	100.0	1
LG&E	C1S	887002	01/2014	01/15/2014	100.100	99.960	100.1	1
LG&E	C1S	887003	01/2014	01/15/2014	100.100	99.950	100.1	1
LG&E	C1S	887004	01/2014	01/15/2014	100.080	99.870	100.1	1
LG&E	C1S	887005	01/2014	01/15/2014	100.030	99.890	100.0	1
LG&E	C1S	887006	01/2014	01/15/2014	100.080	99.990	100.0	1
LG&E	C1S	887007	01/2014	01/15/2014	100.040	99.880	100.0	1
LG&E	C1S	887008	01/2014	01/15/2014	100.070	99.920	100.1	1
LG&E	C1S	887009	01/2014	01/15/2014	100.100	99.950	100.0	1
LG&E	C1S	887010	01/2014	01/15/2014	100.100	99.940	100.1	1
LG&E	C1S	887011	01/2014	01/15/2014	100.050	99.910	100.0	1
LG&E	C1S	887012	01/2014	01/15/2014	100.050	99.900	99.9	1
LG&E	C1S	887013	01/2014	01/15/2014	100.080	99.930	100.0	1
LG&E	C1S	887014	01/2014	01/15/2014	100.080	99.860	99.9	1
LG&E	C1S	887015	01/2014	01/15/2014	100.060	99.880	100.0	1
LG&E	C1S	887016	01/2014	01/15/2014	100.100	99.990	100.0	1
LG&E	C1S	887017	01/2014	01/15/2014	100.060	99.880	100.0	1
LG&E	C1S	887018	01/2014	01/15/2014	100.070	99.900	100.0	1
LG&E	C1S	887019	01/2014	01/15/2014	100.060	99.930	100.0	1
LG&E	C1S	887020	01/2014	01/15/2014	100.040	99.930	100.0	1
LG&E	C1S	887021	01/2014	01/15/2014	100.070	99.930	100.0	1
LG&E	C1S	887022	01/2014	01/15/2014	100.060	99.900	100.0	1

LG&E	C1S	887023	01/2014	01/15/2014	100.080	99.890	100.0	1
LG&E	C1S	887024	01/2014	01/15/2014	100.060	99.880	100.0	1
LG&E	C1S	887025	01/2014	01/15/2014	100.030	99.860	99.9	1
LG&E	C1S	887026	01/2014	01/15/2014	100.060	99.900	100.0	1
LG&E	C1S	887027	01/2014	01/15/2014	100.090	99.910	100.1	1
LG&E	C1S	887028	01/2014	01/15/2014	100.040	99.880	100.0	1
LG&E	C1S	887029	01/2014	01/15/2014	100.050	99.830	100.0	1
LG&E	C1S	887030	01/2014	01/15/2014	100.070	99.910	100.1	1
LG&E	C1S	887031	01/2014	01/15/2014	100.070	99.940	100.0	1
LG&E	C1S	887032	01/2014	01/15/2014	100.080	99.910	100.0	1
LG&E	C1S	887033	01/2014	01/15/2014	100.060	99.940	99.9	1
LG&E	C1S	887034	01/2014	01/15/2014	100.040	99.900	100.0	1
LG&E	C1S	887035	01/2014	01/15/2014	100.040	99.880	100.0	1
LG&E	C1S	887036	01/2014	01/15/2014	100.080	99.940	99.9	1
LG&E	C1S	887037	01/2014	01/15/2014	100.060	99.930	99.9	1
LG&E	C1S	887038	01/2014	01/15/2014	100.060	99.850	100.0	1
LG&E	C1S	887039	01/2014	01/15/2014	100.060	99.910	100.0	1
LG&E	C1S	887040	01/2014	01/15/2014	100.090	99.950	100.1	1
LG&E	C1S	887041	01/2014	01/15/2014	100.100	99.980	100.0	1
LG&E	C1S	887042	01/2014	01/15/2014	100.100	99.980	100.0	1
LG&E	C1S	887043	01/2014	01/15/2014	100.060	99.900	99.9	1
LG&E	C1S	887044	01/2014	01/15/2014	100.100	99.880	100.0	1
LG&E	C1S	887045	01/2014	01/15/2014	100.050	99.910	99.9	1
LG&E	C1S	887046	01/2014	01/15/2014	100.050	99.870	100.0	1
LG&E	C1S	887047	01/2014	01/15/2014	100.050	99.870	100.0	1
LG&E	C1S	887048	01/2014	01/15/2014	100.090	99.980	100.1	1
LG&E	C1S	887049	01/2014	01/15/2014	100.080	99.920	100.0	1
LG&E	C1S	887050	01/2014	01/15/2014	100.070	99.970	100.0	1
LG&E	C1S	887051	01/2014	01/15/2014	100.060	99.900	100.0	1
LG&E	C1S	887052	01/2014	01/15/2014	100.070	99.950	100.0	1
LG&E	C1S	887053	01/2014	01/15/2014	100.050	99.870	100.1	1
LG&E	C1S	887054	01/2014	01/15/2014	100.090	99.960	100.0	1

LG&E	C1S	887055	01/2014	01/15/2014	100.060	99.930	99.9	1
LG&E	C1S	887056	01/2014	01/15/2014	100.070	99.840	100.0	1
LG&E	C1S	887057	01/2014	01/15/2014	100.050	99.830	100.0	1
LG&E	C1S	887058	01/2014	01/15/2014	100.060	99.930	100.0	1
LG&E	C1S	887059	01/2014	01/15/2014	100.090	99.950	100.1	1
LG&E	C1S	887060	01/2014	01/15/2014	100.100	99.950	100.0	1
LG&E	C1S	887061	01/2014	01/15/2014	100.100	99.940	100.0	1
LG&E	C1S	887062	01/2014	01/15/2014	100.070	99.910	99.9	1
LG&E	C1S	887063	01/2014	01/15/2014	100.030	99.900	100.0	1
LG&E	C1S	887064	01/2014	01/15/2014	100.050	99.930	100.0	1
LG&E	C1S	887065	01/2014	01/15/2014	100.060	99.900	100.1	1
LG&E	C1S	887066	01/2014	01/15/2014	100.070	99.860	100.0	1
LG&E	C1S	887067	01/2014	01/15/2014	100.100	99.990	99.9	1
LG&E	C1S	887068	01/2014	01/15/2014	100.070	99.950	100.0	1
LG&E	C1S	887069	01/2014	01/15/2014	100.100	99.940	100.1	1
LG&E	C1S	887070	01/2014	01/15/2014	100.040	99.930	100.0	1
LG&E	C1S	887071	01/2014	01/15/2014	100.060	99.910	100.0	1
LG&E	C1S	887072	01/2014	01/15/2014	100.070	99.970	100.0	1
LG&E	C1S	887073	01/2014	01/15/2014	100.070	99.830	100.0	1
LG&E	C1S	887074	01/2014	01/15/2014	100.030	99.820	100.0	1
LG&E	C1S	887075	01/2014	01/15/2014	100.040	99.860	99.9	1
LG&E	C1S	887076	01/2014	01/15/2014	100.090	99.950	100.0	1
LG&E	C1S	887077	01/2014	01/15/2014	100.060	99.930	100.0	1
LG&E	C1S	887078	01/2014	01/15/2014	100.070	99.990	100.0	1
LG&E	C1S	887079	01/2014	01/15/2014	100.070	99.870	100.0	1
LG&E	C1S	887080	01/2014	01/15/2014	100.070	99.930	100.0	1
LG&E	C1S	887081	01/2014	01/15/2014	100.070	99.860	100.0	1
LG&E	C1S	887082	01/2014	01/15/2014	100.100	99.950	100.0	1
LG&E	C1S	887083	01/2014	01/15/2014	100.080	99.980	100.0	1
LG&E	C1S	887084	01/2014	01/15/2014	100.050	99.870	100.0	1
LG&E	C1S	887085	01/2014	01/15/2014	100.090	99.870	100.0	1
LG&E	C1S	887086	01/2014	01/15/2014	100.100	99.980	100.0	1

LG&E	C1S	887087	01/2014	01/15/2014	100.060	99.960	100.1	1
LG&E	C1S	887088	01/2014	01/15/2014	100.070	99.980	100.0	1
LG&E	C1S	887089	01/2014	01/15/2014	100.060	99.900	100.0	1
LG&E	C1S	887090	01/2014	01/15/2014	100.070	99.920	100.0	1
LG&E	C1S	887091	01/2014	01/15/2014	100.060	99.930	99.9	1
LG&E	C1S	887092	01/2014	01/15/2014	100.110	99.900	100.1	1
LG&E	C1S	887093	01/2014	01/15/2014	100.100	99.930	100.0	1
LG&E	C1S	887094	01/2014	01/15/2014	100.100	99.960	100.1	1
LG&E	C1S	887095	01/2014	01/15/2014	100.100	99.980	100.1	1
LG&E	C1S	887096	01/2014	01/15/2014	100.090	99.910	99.9	1
LG&E	C1S	887097	01/2014	01/15/2014	100.090	99.900	100.0	1
LG&E	C1S	887098	01/2014	01/15/2014	100.050	99.940	100.0	1
LG&E	C1S	887099	01/2014	01/15/2014	100.070	99.950	100.0	1
LG&E	C1S	887100	01/2014	01/15/2014	100.050	99.890	100.0	1
LG&E	C1S	887101	01/2014	01/15/2014	100.030	99.880	100.0	1
LG&E	C1S	887102	01/2014	01/15/2014	100.030	99.840	100.0	1
LG&E	C1S	887103	01/2014	01/15/2014	100.090	99.900	100.0	1
LG&E	C1S	887104	01/2014	01/15/2014	100.090	99.950	100.1	1
LG&E	C1S	887105	01/2014	01/15/2014	100.070	99.930	99.9	1
LG&E	C1S	887106	01/2014	01/15/2014	100.030	99.900	99.9	1
LG&E	C1S	887107	01/2014	01/15/2014	100.040	99.950	100.0	1
LG&E	C1S	887108	01/2014	01/15/2014	100.080	99.870	100.0	1
LG&E	C1S	887109	01/2014	01/15/2014	100.060	99.960	100.0	1
LG&E	C1S	887110	01/2014	01/15/2014	100.070	99.980	100.0	1
LG&E	C1S	887111	01/2014	01/15/2014	100.060	99.930	100.1	1
LG&E	C1S	887112	01/2014	01/15/2014	100.040	99.890	100.0	1
LG&E	C1S	887113	01/2014	01/15/2014	100.070	99.900	100.0	1
LG&E	C1S	887114	01/2014	01/15/2014	100.090	99.890	100.0	1
LG&E	C1S	887115	01/2014	01/15/2014	100.100	99.930	100.0	1
LG&E	C1S	887116	01/2014	01/15/2014	100.050	99.870	100.0	1
LG&E	C1S	887117	01/2014	01/15/2014	100.070	99.880	100.0	1
LG&E	C1S	887118	01/2014	01/15/2014	100.040	99.950	100.0	1

LG&E	C1S	887119	01/2014	01/15/2014	100.080	99.980	100.0	1
LG&E	C1S	887120	01/2014	01/15/2014	100.100	99.940	100.0	1
LG&E	C1S	887121	01/2014	01/15/2014	100.090	99.970	100.0	1
LG&E	C1S	887122	01/2014	01/15/2014	100.080	99.850	100.0	1
LG&E	C1S	887123	01/2014	01/15/2014	100.100	99.930	100.1	1
LG&E	C1S	887124	01/2014	01/15/2014	100.100	99.910	100.0	1
LG&E	C1S	887125	01/2014	01/15/2014	100.100	99.960	100.1	1
LG&E	C1S	887126	01/2014	01/15/2014	100.100	99.970	100.0	1
LG&E	C1S	887127	01/2014	01/15/2014	100.030	99.840	100.0	1
LG&E	C1S	887128	01/2014	01/15/2014	100.110	99.960	100.1	1
LG&E	C1S	887129	01/2014	01/15/2014	100.060	99.920	99.9	1
LG&E	C1S	887130	01/2014	01/15/2014	100.070	99.900	100.0	1
LG&E	C1S	887131	01/2014	01/15/2014	100.070	99.930	100.0	1
LG&E	C1S	887132	01/2014	01/15/2014	100.080	99.940	99.9	1
LG&E	C1S	887133	01/2014	01/15/2014	100.040	99.860	100.0	1
LG&E	C1S	887134	01/2014	01/15/2014	100.070	99.930	100.0	1
LG&E	C1S	887135	01/2014	01/15/2014	100.030	99.870	100.0	1
LG&E	C1S	887136	01/2014	01/15/2014	100.040	99.860	100.0	1
LG&E	C1S	887137	01/2014	01/15/2014	100.080	99.910	100.1	1
LG&E	C1S	887138	01/2014	01/15/2014	100.090	99.940	100.1	1
LG&E	C1S	887139	01/2014	01/15/2014	100.060	99.920	99.9	1
LG&E	C1S	887140	01/2014	01/15/2014	100.090	100.000	99.9	1
LG&E	C1S	887141	01/2014	01/15/2014	100.050	99.910	100.0	1
LG&E	C1S	887142	01/2014	01/15/2014	100.070	99.880	99.9	1
LG&E	C1S	887143	01/2014	01/15/2014	100.080	99.860	100.0	1
LG&E	C1S	887144	01/2014	01/15/2014	100.080	99.850	99.9	1
LG&E	C1S	887145	01/2014	01/15/2014	100.090	99.920	100.1	1
LG&E	C1S	887146	01/2014	01/15/2014	100.040	99.820	100.0	1
LG&E	C1S	887147	01/2014	01/15/2014	100.060	99.850	100.1	1
LG&E	C1S	887148	01/2014	01/15/2014	100.030	99.860	99.9	1
LG&E	C1S	887149	01/2014	01/15/2014	100.080	99.980	100.0	1
LG&E	C1S	887150	01/2014	01/15/2014	100.060	99.920	100.0	1

LG&E	C1S	887151	01/2014	01/15/2014	100.100	99.920	100.0	1
LG&E	C1S	887152	01/2014	01/15/2014	100.060	99.950	100.0	1
LG&E	C1S	887153	01/2014	01/15/2014	100.080	99.940	100.0	1
LG&E	C1S	887154	01/2014	01/15/2014	100.100	99.930	100.1	1
LG&E	C1S	887155	01/2014	01/15/2014	100.060	99.950	100.0	1
LG&E	C1S	887156	01/2014	01/15/2014	100.070	99.940	100.1	1
LG&E	C1S	887157	01/2014	01/15/2014	100.070	99.830	100.0	1
LG&E	C1S	887158	01/2014	01/15/2014	100.030	99.850	100.0	1
LG&E	C1S	887159	01/2014	01/15/2014	100.080	99.850	100.0	1
LG&E	C1S	887160	01/2014	01/15/2014	100.050	99.880	100.0	1
LG&E	C1S	887161	01/2014	01/15/2014	100.040	99.920	99.9	1
LG&E	C1S	887162	01/2014	01/15/2014	100.060	99.930	100.0	1
LG&E	C1S	887163	01/2014	01/15/2014	100.090	99.950	100.0	1
LG&E	C1S	887164	01/2014	01/15/2014	100.080	99.870	99.9	1
LG&E	C1S	887165	01/2014	01/15/2014	100.070	99.900	100.0	1
LG&E	C1S	887166	01/2014	01/15/2014	100.090	99.930	100.0	1
LG&E	C1S	887167	01/2014	01/15/2014	100.070	99.960	100.0	1
LG&E	C1S	887168	01/2014	01/15/2014	100.080	99.980	100.0	1
LG&E	C1S	887169	01/2014	01/15/2014	100.080	99.920	100.0	1
LG&E	C1S	887170	01/2014	01/15/2014	100.090	99.990	99.9	1
LG&E	C1S	887171	01/2014	01/15/2014	100.100	99.930	100.0	1
LG&E	C1S	887172	01/2014	01/15/2014	100.060	99.910	100.0	1
LG&E	C1S	887173	01/2014	01/15/2014	100.060	99.960	100.0	1
LG&E	C1S	887174	01/2014	01/15/2014	100.090	99.850	100.1	1
LG&E	C1S	887175	01/2014	01/15/2014	100.050	99.920	100.0	1
LG&E	C1S	887176	01/2014	01/15/2014	100.100	99.980	100.1	1
LG&E	C1S	887177	01/2014	01/15/2014	100.060	99.950	100.0	1
LG&E	C1S	887178	01/2014	01/15/2014	100.070	99.930	100.0	1
LG&E	C1S	887179	01/2014	01/15/2014	100.070	99.860	100.0	1
LG&E	C1S	887180	01/2014	01/15/2014	100.080	99.930	100.0	1
LG&E	C1S	887181	01/2014	01/15/2014	100.070	99.900	100.0	1
LG&E	C1S	887182	01/2014	01/15/2014	100.060	99.850	99.9	1

LG&E	C1S	887183	01/2014	01/15/2014	100.060	99.910	100.0	1
LG&E	C1S	887184	01/2014	01/15/2014	100.060	99.890	99.9	1
LG&E	C1S	887185	01/2014	01/15/2014	100.100	99.950	100.1	1
LG&E	C1S	887186	01/2014	01/15/2014	100.040	99.920	100.0	1
LG&E	C1S	887187	01/2014	01/15/2014	100.060	99.940	100.0	1
LG&E	C1S	887188	01/2014	01/15/2014	100.090	99.980	100.0	1
LG&E	C1S	887189	01/2014	01/15/2014	100.040	99.920	100.1	1
LG&E	C1S	887190	01/2014	01/15/2014	100.100	99.900	100.0	1
LG&E	C1S	887191	01/2014	01/15/2014	100.080	99.820	100.0	1
LG&E	C1S	887192	01/2014	01/15/2014	100.070	99.860	100.0	1
LG&E	C1S	887193	01/2014	01/15/2014	100.080	99.920	100.0	1
LG&E	C1S	887194	01/2014	01/15/2014	100.060	99.940	100.0	1
LG&E	C1S	887195	01/2014	01/15/2014	100.080	99.910	100.0	1
LG&E	C1S	887196	01/2014	01/15/2014	100.060	99.920	100.0	1
LG&E	C1S	887197	01/2014	01/15/2014	100.060	99.890	99.9	1
LG&E	C1S	887198	01/2014	01/15/2014	100.070	99.880	100.0	1
LG&E	C1S	887199	01/2014	01/15/2014	100.070	99.920	99.9	1
LG&E	C1S	887200	01/2014	01/15/2014	100.050	99.940	99.9	1
LG&E	C1S	887201	01/2014	01/15/2014	100.060	99.910	100.0	1
LG&E	C1S	887202	01/2014	01/15/2014	100.070	99.920	99.9	1
LG&E	C1S	887203	01/2014	01/15/2014	100.070	99.840	100.0	1
LG&E	C1S	887204	01/2014	01/15/2014	100.060	99.930	100.0	1
LG&E	C1S	887205	01/2014	01/15/2014	100.070	99.900	100.0	1
LG&E	C1S	887206	01/2014	01/15/2014	100.070	100.000	100.1	1
LG&E	C1S	887207	01/2014	01/15/2014	100.050	99.960	100.0	1
LG&E	C1S	887208	01/2014	01/15/2014	100.090	99.900	100.0	1
LG&E	C1S	887209	01/2014	01/15/2014	100.080	99.950	100.0	1
LG&E	C1S	887210	01/2014	01/15/2014	100.050	99.870	99.9	1
LG&E	C1S	887211	01/2014	01/15/2014	100.070	99.910	99.9	1
LG&E	C1S	887212	01/2014	01/15/2014	100.110	99.890	100.1	1
LG&E	C1S	887213	01/2014	01/15/2014	100.060	99.820	100.0	1
LG&E	C1S	887214	01/2014	01/15/2014	100.090	99.980	100.1	1

LG&E	C1S	887215	01/2014	01/15/2014	100.070	99.940	99.9	1
LG&E	C1S	887216	01/2014	01/15/2014	100.090	99.990	100.0	1
LG&E	C1S	887217	01/2014	01/15/2014	100.070	99.890	100.0	1
LG&E	C1S	887218	01/2014	01/15/2014	100.030	99.880	99.9	1
LG&E	C1S	887219	01/2014	01/15/2014	100.090	100.010	99.9	1
LG&E	C1S	887220	01/2014	01/15/2014	100.040	99.860	100.0	1
LG&E	C1S	887221	01/2014	01/15/2014	100.040	99.890	100.0	1
LG&E	C1S	887222	01/2014	01/15/2014	100.060	99.860	100.0	1
LG&E	C1S	887223	01/2014	01/15/2014	100.090	99.920	100.1	1
LG&E	C1S	887224	01/2014	01/15/2014	100.030	99.850	100.0	1
LG&E	C1S	887225	01/2014	01/15/2014	100.080	99.880	100.0	1
LG&E	C1S	887226	01/2014	01/15/2014	100.080	99.870	100.0	1
LG&E	C1S	887227	01/2014	01/15/2014	100.090	99.960	100.0	1
LG&E	C1S	887228	01/2014	01/15/2014	100.100	99.960	100.0	1
LG&E	C1S	887229	01/2014	01/15/2014	100.040	99.870	100.0	1
LG&E	C1S	887230	01/2014	01/15/2014	100.060	99.970	100.0	1
LG&E	C1S	887231	01/2014	01/15/2014	100.050	99.930	100.0	1
LG&E	C1S	887232	01/2014	01/15/2014	100.070	99.930	99.9	1
LG&E	C1S	887233	01/2014	01/15/2014	100.080	99.950	100.1	1
LG&E	C1S	887234	01/2014	01/15/2014	100.080	99.900	100.0	1
LG&E	C1S	887235	01/2014	01/15/2014	100.090	99.910	100.1	1
LG&E	C1S	887236	01/2014	01/15/2014	100.100	99.910	100.0	1
LG&E	C1S	887237	01/2014	01/15/2014	100.070	99.830	100.0	1
LG&E	C1S	887238	01/2014	01/15/2014	100.040	99.850	100.0	1
LG&E	C1S	887239	01/2014	01/15/2014	100.080	99.910	100.0	1
LG&E	C1S	887240	01/2014	01/15/2014	100.060	99.830	99.9	1
LG&E	C1S	887241	01/2014	01/15/2014	100.090	99.870	100.1	1
LG&E	C1S	887242	01/2014	01/15/2014	100.090	99.920	100.0	1
LG&E	C1S	887243	01/2014	01/15/2014	100.100	99.890	100.0	1
LG&E	C1S	887244	01/2014	01/15/2014	100.060	99.870	100.0	1
LG&E	C1S	887245	01/2014	01/15/2014	100.080	99.920	99.9	1
LG&E	C1S	887246	01/2014	01/15/2014	100.100	99.930	100.0	1

LG&E	C1S	887247	01/2014	01/15/2014	100.100	99.980	100.1	1
LG&E	C1S	887248	01/2014	01/15/2014	100.050	99.880	100.0	1
LG&E	C1S	887249	01/2014	01/15/2014	100.080	99.960	100.0	1
LG&E	C1S	887250	01/2014	01/15/2014	100.090	99.920	99.9	1
LG&E	C1S	887251	01/2014	01/15/2014	100.030	99.810	100.0	1
LG&E	C1S	887252	01/2014	01/15/2014	100.070	99.880	100.0	1
LG&E	C1S	887253	01/2014	01/15/2014	100.030	99.860	100.0	1
LG&E	C1S	887254	01/2014	01/15/2014	100.080	99.940	99.9	1
LG&E	C1S	887255	01/2014	01/15/2014	100.100	99.910	100.0	1
LG&E	C1S	887256	01/2014	01/15/2014	100.040	99.870	100.0	1
LG&E	C1S	887257	01/2014	01/15/2014	100.050	99.830	100.0	1
LG&E	C1S	887258	01/2014	01/15/2014	100.100	99.960	100.0	1
LG&E	C1S	887259	01/2014	01/15/2014	100.080	99.890	100.0	1
LG&E	C1S	887260	01/2014	01/15/2014	100.090	99.930	100.0	1
LG&E	C1S	887261	01/2014	01/15/2014	100.060	99.880	100.1	1
LG&E	C1S	887262	01/2014	01/15/2014	100.080	99.920	100.0	1
LG&E	C1S	887263	01/2014	01/15/2014	100.030	99.820	100.0	1
LG&E	C1S	887264	01/2014	01/15/2014	100.080	99.870	100.0	1
LG&E	C1S	887265	01/2014	01/15/2014	100.080	99.900	100.0	1
LG&E	C1S	887266	01/2014	01/15/2014	100.080	99.910	100.1	1
LG&E	C1S	887267	01/2014	01/15/2014	100.090	99.890	99.9	1
LG&E	C1S	887268	01/2014	01/15/2014	100.040	99.940	100.0	1
LG&E	C1S	887269	01/2014	01/15/2014	100.060	99.860	100.0	1
LG&E	C1S	887270	01/2014	01/15/2014	100.100	100.020	99.9	1
LG&E	C1S	887271	01/2014	01/15/2014	100.060	99.860	100.0	1
LG&E	C1S	887272	01/2014	01/15/2014	100.060	99.870	99.9	1
LG&E	C1S	887273	01/2014	01/15/2014	100.090	99.890	100.0	1
LG&E	C1S	887274	01/2014	01/15/2014	100.070	99.950	100.0	1
LG&E	C1S	887275	01/2014	01/15/2014	100.060	99.880	100.0	1
LG&E	C1S	887276	01/2014	01/15/2014	100.060	99.980	99.9	1
LG&E	C1S	887277	01/2014	01/15/2014	100.050	99.890	100.0	1
LG&E	C1S	887278	01/2014	01/15/2014	100.100	99.940	100.0	1

LG&E	C1S	887279	01/2014	01/15/2014	100.080	99.900	100.0	1
LG&E	C1S	887280	01/2014	01/15/2014	100.090	99.950	99.9	1
LG&E	C1S	887281	01/2014	01/15/2014	100.100	100.010	100.0	1
LG&E	C1S	887282	01/2014	01/15/2014	100.060	99.840	100.0	1
LG&E	C1S	887283	01/2014	01/15/2014	100.060	99.870	99.9	1
LG&E	C1S	887284	01/2014	01/15/2014	100.100	99.970	100.0	1
LG&E	C1S	887285	01/2014	01/15/2014	100.100	99.930	100.0	1
LG&E	C1S	887286	01/2014	01/15/2014	100.110	99.990	100.1	1
LG&E	C1S	887287	01/2014	01/15/2014	100.080	99.940	99.9	1
LG&E	C1S	887288	01/2014	01/15/2014	100.040	99.880	100.0	1
LG&E	C1S	887289	01/2014	01/15/2014	100.080	99.940	100.1	1
LG&E	C1S	887290	01/2014	01/15/2014	100.080	99.900	100.1	1
LG&E	C1S	887291	01/2014	01/15/2014	100.110	99.900	100.1	1
LG&E	C1S	887292	01/2014	01/15/2014	100.060	99.900	100.0	1
LG&E	C1S	887293	01/2014	01/15/2014	100.100	99.960	100.1	1
LG&E	C1S	887294	01/2014	01/15/2014	100.050	99.890	99.9	1
LG&E	C1S	887295	01/2014	01/15/2014	100.100	99.960	100.0	1
LG&E	C1S	887296	01/2014	01/15/2014	100.070	99.930	100.1	1
LG&E	C1S	887297	01/2014	01/15/2014	100.070	99.840	99.9	1
LG&E	C1S	887298	01/2014	01/15/2014	100.100	99.940	100.1	1
LG&E	C1S	887299	01/2014	01/15/2014	100.100	100.000	100.1	1
LG&E	C1S	887300	01/2014	01/15/2014	100.090	99.910	100.0	1
LG&E	C1S	887301	01/2014	01/15/2014	100.040	99.850	100.0	1
LG&E	C1S	887302	01/2014	01/15/2014	100.050	99.850	100.0	1
LG&E	C1S	887303	01/2014	01/15/2014	100.100	99.980	100.0	1
LG&E	C1S	887304	01/2014	01/15/2014	100.070	99.890	100.0	1
LG&E	C1S	887305	01/2014	01/15/2014	100.100	99.970	100.0	1
LG&E	C1S	887306	01/2014	01/15/2014	100.050	99.860	100.0	1
LG&E	C1S	887307	01/2014	01/15/2014	100.080	99.860	100.1	1
LG&E	C1S	887308	01/2014	01/15/2014	100.070	99.980	100.0	1
LG&E	C1S	887309	01/2014	01/15/2014	100.060	99.980	100.0	1
LG&E	C1S	887310	01/2014	01/15/2014	100.050	99.850	99.9	1

LG&E	C1S	887311	01/2014	01/15/2014	100.090	99.990	100.0	1
LG&E	C1S	887312	01/2014	01/15/2014	100.060	99.870	99.9	1
LG&E	C1S	887313	01/2014	01/15/2014	100.070	99.910	100.0	1
LG&E	C1S	887314	01/2014	01/15/2014	100.070	99.870	100.1	1
LG&E	C1S	887315	01/2014	01/15/2014	100.070	99.910	100.0	1
LG&E	C1S	887316	01/2014	01/15/2014	100.030	99.860	100.0	1
LG&E	C1S	887317	01/2014	01/15/2014	100.070	99.960	100.0	1
LG&E	C1S	887318	01/2014	01/15/2014	100.090	99.920	100.1	1
LG&E	C1S	887319	01/2014	01/15/2014	100.080	99.900	99.9	1
LG&E	C1S	887320	01/2014	01/15/2014	100.100	99.940	99.9	1
LG&E	C1S	887321	01/2014	01/15/2014	100.080	99.890	99.9	1
LG&E	C1S	887322	01/2014	01/15/2014	100.070	99.920	99.9	1
LG&E	C1S	887323	01/2014	01/15/2014	100.070	99.860	100.0	1
LG&E	C1S	887324	01/2014	01/15/2014	100.060	99.850	100.1	1
LG&E	C1S	887325	01/2014	01/15/2014	100.070	99.870	100.1	1
LG&E	C1S	887326	01/2014	01/15/2014	100.050	99.910	100.0	1
LG&E	C1S	887327	01/2014	01/15/2014	100.060	99.880	100.0	1
LG&E	C1S	887328	01/2014	01/15/2014	100.060	99.840	100.0	1
LG&E	C1S	887329	01/2014	01/15/2014	100.080	99.980	100.1	1
LG&E	C1S	887330	01/2014	01/15/2014	100.080	99.950	100.0	1
LG&E	C1S	887331	01/2014	01/15/2014	100.070	99.950	99.9	1
LG&E	C1S	887332	01/2014	01/15/2014	100.100	99.930	100.0	1
LG&E	C1S	887333	01/2014	01/15/2014	100.100	99.970	100.0	1
LG&E	C1S	887334	01/2014	01/15/2014	100.080	99.930	100.0	1
LG&E	C1S	887335	01/2014	01/15/2014	100.070	99.870	100.0	1
LG&E	C1S	887336	01/2014	01/15/2014	100.060	99.850	100.1	1
LG&E	C1S	887337	01/2014	01/15/2014	100.080	99.870	99.9	1
LG&E	C1S	887338	01/2014	01/15/2014	100.100	99.910	100.0	1
LG&E	C1S	887339	01/2014	01/15/2014	100.030	99.910	100.0	1
LG&E	C1S	887340	01/2014	01/15/2014	100.070	99.910	100.1	1
LG&E	C1S	887341	01/2014	01/15/2014	100.060	99.940	100.0	1
LG&E	C1S	887342	01/2014	01/15/2014	100.080	99.860	99.9	1

LG&E	C1S	887343	01/2014	01/15/2014	100.060	99.910	100.0	1
LG&E	C1S	887344	01/2014	01/15/2014	100.080	99.920	100.0	1
LG&E	C1S	887345	01/2014	01/15/2014	100.060	99.890	100.0	1
LG&E	C1S	887346	01/2014	01/15/2014	100.030	99.820	100.0	1
LG&E	C1S	887347	01/2014	01/15/2014	100.070	99.870	100.0	1
LG&E	C1S	887348	01/2014	01/15/2014	100.060	99.850	100.0	1
LG&E	C1S	887349	01/2014	01/15/2014	100.100	99.890	100.0	1
LG&E	C1S	887350	01/2014	01/15/2014	100.060	99.840	99.9	1
LG&E	C1S	887351	01/2014	01/15/2014	100.040	99.930	100.0	1
LG&E	C1S	887352	01/2014	01/15/2014	100.060	99.830	100.0	1
LG&E	C1S	887353	01/2014	01/15/2014	100.070	99.910	99.9	1
LG&E	C1S	887354	01/2014	01/15/2014	100.070	99.870	100.0	1
LG&E	C1S	887355	01/2014	01/15/2014	100.040	99.900	100.0	1
LG&E	C1S	887356	01/2014	01/15/2014	100.080	99.940	100.0	1
LG&E	C1S	887357	01/2014	01/15/2014	100.100	99.950	100.1	1
LG&E	C1S	887358	01/2014	01/15/2014	100.050	99.870	100.0	1
LG&E	C1S	887359	01/2014	01/15/2014	100.100	99.870	100.0	1
LG&E	C1S	887360	01/2014	01/15/2014	100.050	99.890	100.0	1
LG&E	C1S	887361	01/2014	01/15/2014	100.060	99.860	100.0	1
LG&E	C1S	887362	01/2014	01/15/2014	100.060	99.860	100.0	1
LG&E	C1S	887363	01/2014	01/15/2014	100.060	99.890	100.0	1
LG&E	C1S	887364	01/2014	01/15/2014	100.050	99.920	100.0	1
LG&E	C1S	887365	01/2014	01/15/2014	100.100	99.980	100.0	1
LG&E	C1S	887366	01/2014	01/15/2014	100.070	99.930	100.0	1
LG&E	C1S	887367	01/2014	01/15/2014	100.080	99.880	100.0	1
LG&E	C1S	887368	01/2014	01/15/2014	100.070	99.920	100.0	1
LG&E	C1S	887369	01/2014	01/15/2014	100.060	99.870	100.0	1
LG&E	C1S	887370	01/2014	01/15/2014	100.040	99.890	100.0	1
LG&E	C1S	887371	01/2014	01/15/2014	100.060	99.960	100.0	1
LG&E	C1S	887372	01/2014	01/15/2014	100.060	99.890	99.9	1
LG&E	C1S	887373	01/2014	01/15/2014	100.050	99.930	99.9	1
LG&E	C1S	887374	01/2014	01/15/2014	100.030	99.910	100.0	1

LG&E	C1S	887375	01/2014	01/15/2014	100.080	99.930	99.9	1
LG&E	C1S	887376	01/2014	01/15/2014	100.060	99.930	100.0	1
LG&E	C1S	887377	01/2014	01/15/2014	100.070	99.900	99.9	1
LG&E	C1S	887378	01/2014	01/15/2014	100.080	99.850	100.0	1
LG&E	C1S	887379	01/2014	01/15/2014	100.070	99.910	100.1	1
LG&E	C1S	887380	01/2014	01/15/2014	100.080	99.870	99.9	1
LG&E	C1S	887381	01/2014	01/15/2014	100.070	99.950	100.0	1
LG&E	C1S	887382	01/2014	01/15/2014	100.060	99.980	100.0	1
LG&E	C1S	887383	01/2014	01/15/2014	100.060	99.900	100.1	1
LG&E	C1S	887384	01/2014	01/15/2014	100.090	99.890	99.9	1
LG&E	C1S	887385	01/2014	01/15/2014	100.030	99.810	100.0	1
LG&E	C1S	887386	01/2014	01/15/2014	100.060	99.880	100.0	1
LG&E	C1S	887387	01/2014	01/15/2014	100.080	99.910	100.0	1
LG&E	C1S	887388	01/2014	01/15/2014	100.070	99.830	100.1	1
LG&E	C1S	887389	01/2014	01/15/2014	100.100	99.970	100.0	1
LG&E	C1S	887390	01/2014	01/15/2014	100.070	99.960	100.0	1
LG&E	C1S	887391	01/2014	01/15/2014	100.040	99.880	100.0	1
LG&E	C1S	887392	01/2014	01/15/2014	100.070	99.850	100.1	1
LG&E	C1S	887393	01/2014	01/15/2014	100.060	99.850	100.0	1
LG&E	C1S	887394	01/2014	01/15/2014	100.090	99.950	100.0	1
LG&E	C1S	887395	01/2014	01/15/2014	100.100	99.940	100.1	1
LG&E	C1S	887396	01/2014	01/15/2014	100.080	99.900	100.0	1
LG&E	C1S	887397	01/2014	01/15/2014	100.080	99.900	99.9	1
LG&E	C1S	887398	01/2014	01/15/2014	100.080	99.950	100.0	1
LG&E	C1S	887399	01/2014	01/15/2014	100.060	99.850	100.0	1
LG&E	C1S	887400	01/2014	01/15/2014	100.080	99.910	100.1	1
LG&E	C1S	887401	01/2014	01/15/2014	100.100	99.910	100.0	1
LG&E	C1S	887402	01/2014	01/15/2014	100.060	99.880	99.9	1
LG&E	C1S	887403	01/2014	01/15/2014	100.060	99.890	100.0	1
LG&E	C1S	887404	01/2014	01/15/2014	100.090	99.940	100.0	1
LG&E	C1S	887405	01/2014	01/15/2014	100.050	99.870	100.0	1
LG&E	C1S	887406	01/2014	01/15/2014	100.070	99.880	100.0	1

LG&E	C1S	887407	01/2014	01/15/2014	100.050	99.900	100.0	1
LG&E	C1S	887408	01/2014	01/15/2014	100.070	99.910	100.1	1
LG&E	C1S	887409	01/2014	01/15/2014	100.090	99.890	99.9	1
LG&E	C1S	887410	01/2014	01/15/2014	100.060	99.920	100.0	1
LG&E	C1S	887411	01/2014	01/15/2014	100.100	99.960	100.0	1
LG&E	C1S	887412	01/2014	01/15/2014	100.060	99.860	99.9	1
LG&E	C1S	887413	01/2014	01/15/2014	100.050	99.950	100.0	1
LG&E	C1S	887414	01/2014	01/15/2014	100.030	99.900	99.9	1
LG&E	C1S	887415	01/2014	01/15/2014	100.100	99.930	100.1	1
LG&E	C1S	887416	01/2014	01/15/2014	100.030	99.800	100.0	1
LG&E	C1S	887417	01/2014	01/15/2014	100.070	99.900	100.0	1
LG&E	C1S	887418	01/2014	01/15/2014	100.070	99.960	99.9	1
LG&E	C1S	887419	01/2014	01/15/2014	100.060	99.880	99.9	1
LG&E	C1S	887420	01/2014	01/15/2014	100.060	99.920	100.0	1
LG&E	C1S	887421	01/2014	01/15/2014	100.060	99.870	100.0	1
LG&E	C1S	887422	01/2014	01/15/2014	100.050	99.940	100.0	1
LG&E	C1S	887423	01/2014	01/15/2014	100.080	100.010	100.0	1
LG&E	C1S	887424	01/2014	01/15/2014	100.080	99.870	100.0	1
LG&E	C1S	887425	01/2014	01/15/2014	100.060	99.930	100.0	1
LG&E	C1S	887426	01/2014	01/15/2014	100.040	99.890	100.0	1
LG&E	C1S	887427	01/2014	01/15/2014	100.070	99.850	100.0	1
LG&E	C1S	887428	01/2014	01/15/2014	100.040	99.850	100.0	1
LG&E	C1S	887429	01/2014	01/15/2014	100.090	99.990	100.0	1
LG&E	C1S	887430	01/2014	01/15/2014	100.080	99.950	100.0	1
LG&E	C1S	887431	01/2014	01/15/2014	100.070	99.910	99.9	1
LG&E	C1S	887432	01/2014	01/15/2014	100.060	99.930	100.0	1
LG&E	C1S	887433	01/2014	01/15/2014	100.090	99.910	100.1	1
LG&E	C1S	887434	01/2014	01/15/2014	100.030	99.870	99.9	1
LG&E	C1S	887435	01/2014	01/15/2014	100.100	100.010	100.1	1
LG&E	C1S	887436	01/2014	01/15/2014	100.060	99.950	100.0	1
LG&E	C1S	887437	01/2014	01/15/2014	100.070	99.870	100.0	1
LG&E	C1S	887438	01/2014	01/15/2014	100.040	99.840	99.9	1

LG&E	C1S	887439	01/2014	01/15/2014	100.100	99.900	100.0	1
LG&E	C1S	887440	01/2014	01/15/2014	100.100	99.900	100.0	1
LG&E	C1S	887441	01/2014	01/15/2014	100.090	99.910	100.0	1
LG&E	C1S	887442	01/2014	01/15/2014	100.100	99.860	100.0	1
LG&E	C1S	887443	01/2014	01/15/2014	100.100	99.920	99.9	1
LG&E	C1S	887444	01/2014	01/15/2014	100.070	99.920	100.0	1
LG&E	C1S	887445	01/2014	01/15/2014	100.060	99.910	100.0	1
LG&E	C1S	887446	01/2014	01/15/2014	100.070	99.920	100.0	1
LG&E	C1S	887447	01/2014	01/15/2014	100.060	99.920	100.0	1
LG&E	C1S	887448	01/2014	01/15/2014	100.080	99.960	100.0	1
LG&E	C1S	887449	01/2014	01/15/2014	100.040	99.900	100.0	1
LG&E	C1S	887450	01/2014	01/15/2014	100.060	99.880	100.0	1
LG&E	C1S	887451	01/2014	01/15/2014	100.080	99.880	100.0	1
LG&E	C1S	887452	01/2014	01/15/2014	100.090	99.940	100.0	1
LG&E	C1S	887453	01/2014	01/15/2014	100.070	99.920	100.0	1
LG&E	C1S	887454	01/2014	01/15/2014	100.100	99.940	100.0	1
LG&E	C1S	887455	01/2014	01/15/2014	100.040	99.870	100.0	1
LG&E	C1S	887456	01/2014	01/15/2014	100.070	99.940	100.0	1
LG&E	C1S	887457	01/2014	01/15/2014	100.060	99.890	100.0	1
LG&E	C1S	887458	01/2014	01/15/2014	100.060	99.920	99.9	1
LG&E	C1S	887459	01/2014	01/15/2014	100.080	99.960	100.0	1
LG&E	C1S	887460	01/2014	01/15/2014	100.090	99.940	100.0	1
LG&E	C1S	887461	01/2014	01/15/2014	100.100	99.980	100.1	1
LG&E	C1S	887462	01/2014	01/15/2014	100.070	99.830	99.9	1
LG&E	C1S	887463	01/2014	01/15/2014	100.060	99.840	99.9	1
LG&E	C1S	887464	01/2014	01/15/2014	100.070	99.990	100.1	1
LG&E	C1S	887465	01/2014	01/15/2014	100.100	99.980	100.0	1
LG&E	C1S	887466	01/2014	01/15/2014	100.070	99.910	99.9	1
LG&E	C1S	887467	01/2014	01/15/2014	100.080	99.990	100.0	1
LG&E	C1S	887468	01/2014	01/15/2014	100.080	99.900	100.0	1
LG&E	C1S	887469	01/2014	01/15/2014	100.050	99.910	100.0	1
LG&E	C1S	887470	01/2014	01/15/2014	100.050	99.880	100.0	1

LG&E	C1S	887471	01/2014	01/15/2014	100.080	99.970	99.9	1
LG&E	C1S	887472	01/2014	01/15/2014	100.060	99.870	100.0	1
LG&E	C1S	887473	01/2014	01/15/2014	100.060	99.860	100.1	1
LG&E	C1S	887474	01/2014	01/15/2014	100.080	99.960	100.0	1
LG&E	C1S	887475	01/2014	01/15/2014	100.050	99.930	100.0	1
LG&E	C1S	887476	01/2014	01/15/2014	100.090	99.940	100.0	1
LG&E	C1S	887477	01/2014	01/15/2014	100.050	99.880	99.9	1
LG&E	C1S	887478	01/2014	01/15/2014	100.110	99.950	100.0	1
LG&E	C1S	887479	01/2014	01/15/2014	100.030	99.920	100.0	1
LG&E	C1S	887480	01/2014	01/15/2014	100.070	99.990	100.0	1
LG&E	C1S	887481	01/2014	01/15/2014	100.060	99.950	100.0	1
LG&E	C1S	887482	01/2014	01/15/2014	100.100	99.900	100.1	1
LG&E	C1S	887483	01/2014	01/15/2014	100.060	99.940	99.9	1
LG&E	C1S	887484	01/2014	01/15/2014	100.080	99.850	100.1	1
LG&E	C1S	887485	01/2014	01/15/2014	100.100	99.880	100.1	1
LG&E	C1S	887486	01/2014	01/15/2014	100.090	99.940	100.0	1
LG&E	C1S	887487	01/2014	01/15/2014	100.070	99.880	100.0	1
LG&E	C1S	887488	01/2014	01/15/2014	100.090	99.920	100.0	1
LG&E	C1S	887489	01/2014	01/15/2014	100.060	99.820	99.9	1
LG&E	C1S	887490	01/2014	01/15/2014	100.050	99.890	100.0	1
LG&E	C1S	887491	01/2014	01/15/2014	100.080	100.010	100.0	1
LG&E	C1S	887492	01/2014	01/15/2014	100.070	99.890	100.1	1
LG&E	C1S	887493	01/2014	01/15/2014	100.070	99.940	99.9	1
LG&E	C1S	887494	01/2014	01/15/2014	100.030	99.930	100.0	1
LG&E	C1S	887495	01/2014	01/15/2014	100.050	99.890	100.0	1
LG&E	C1S	887496	01/2014	01/15/2014	100.070	99.910	100.0	1
LG&E	C1S	887497	01/2014	01/15/2014	100.060	99.920	100.1	1
LG&E	C1S	887498	01/2014	01/15/2014	100.040	99.930	100.0	1
LG&E	C1S	887499	01/2014	01/15/2014	100.060	99.880	100.0	1
LG&E	C1S	887500	01/2014	01/15/2014	100.100	99.880	100.0	1
LG&E	C1S	887501	01/2014	01/15/2014	100.080	99.860	100.0	1
LG&E	C1S	887502	01/2014	01/15/2014	100.030	99.940	100.0	1

LG&E	C1S	887503	01/2014	01/15/2014	100.070	99.950	100.1	1
LG&E	C1S	887504	01/2014	01/15/2014	100.030	99.890	100.0	1
LG&E	C1S	887505	01/2014	01/15/2014	100.040	99.920	100.0	1
LG&E	C1S	887506	01/2014	01/15/2014	100.070	99.880	99.9	1
LG&E	C1S	887507	01/2014	01/15/2014	100.060	99.880	99.9	1
LG&E	C1S	887508	01/2014	01/15/2014	100.060	99.890	99.9	1
LG&E	C1S	887509	01/2014	01/15/2014	100.030	99.900	100.0	1
LG&E	C1S	887510	01/2014	01/15/2014	100.090	99.880	100.0	1
LG&E	C1S	887511	01/2014	01/15/2014	100.030	99.890	100.0	1
LG&E	C1S	887512	01/2014	01/15/2014	100.040	99.860	100.0	1
LG&E	C1S	887513	01/2014	01/15/2014	100.040	99.820	100.0	1
LG&E	C1S	887514	01/2014	01/15/2014	100.070	99.890	100.0	1
LG&E	C1S	887515	01/2014	01/15/2014	100.080	99.900	100.0	1
LG&E	C1S	887516	01/2014	01/15/2014	100.040	99.890	99.9	1
LG&E	C1S	887517	01/2014	01/15/2014	100.080	99.930	99.9	1
LG&E	C1S	887518	01/2014	01/15/2014	100.070	99.930	100.0	1
LG&E	C1S	887519	01/2014	01/15/2014	100.080	99.940	100.1	1
LG&E	C1S	887520	01/2014	01/15/2014	100.040	99.880	99.9	1
LG&E	C1S	887521	01/2014	01/15/2014	100.100	99.990	100.1	1
LG&E	C1S	887522	01/2014	01/15/2014	100.060	99.890	100.0	1
LG&E	C1S	887523	01/2014	01/15/2014	100.070	99.900	100.0	1
LG&E	C1S	887524	01/2014	01/15/2014	100.100	99.950	100.0	1
LG&E	C1S	887525	01/2014	01/15/2014	100.070	99.920	99.9	1
LG&E	C1S	887526	01/2014	01/15/2014	100.070	99.900	100.0	1
LG&E	C1S	887527	01/2014	01/15/2014	100.030	99.810	100.1	1
LG&E	C1S	887528	01/2014	01/15/2014	100.070	99.940	100.0	1
LG&E	C1S	887529	01/2014	01/15/2014	100.080	99.850	100.1	1
LG&E	C1S	887530	01/2014	01/15/2014	100.080	99.920	100.0	1
LG&E	C1S	887531	01/2014	01/15/2014	100.040	99.930	100.0	1
LG&E	C1S	887532	01/2014	01/15/2014	100.060	99.950	100.0	1
LG&E	C1S	887533	01/2014	01/15/2014	100.060	99.870	100.1	1
LG&E	C1S	887534	01/2014	01/15/2014	100.050	99.870	100.0	1

LG&E	C1S	887535	01/2014	01/15/2014	100.080	99.950	100.0	1
LG&E	C1S	887536	01/2014	01/15/2014	100.080	99.950	100.1	1
LG&E	C1S	887537	01/2014	01/15/2014	100.040	99.880	100.0	1
LG&E	C1S	887538	01/2014	01/15/2014	100.080	99.890	100.0	1
LG&E	C1S	887539	01/2014	01/15/2014	100.080	99.900	100.0	1
LG&E	C1S	887540	01/2014	01/15/2014	100.060	99.850	99.9	1
LG&E	C1S	887541	01/2014	01/15/2014	100.040	99.820	99.9	1
LG&E	C1S	887542	01/2014	01/15/2014	100.060	99.900	100.0	1
LG&E	C1S	887543	01/2014	01/15/2014	100.070	99.880	100.1	1
LG&E	C1S	887544	01/2014	01/15/2014	100.060	99.960	100.0	1
LG&E	C1S	887545	01/2014	01/15/2014	100.040	99.870	99.9	1
LG&E	C1S	887546	01/2014	01/15/2014	100.070	99.950	99.9	1
LG&E	C1S	887547	01/2014	01/15/2014	100.080	100.000	100.0	1
LG&E	C1S	887548	01/2014	01/15/2014	100.100	99.900	100.0	1
LG&E	C1S	887549	01/2014	01/15/2014	100.060	99.900	100.1	1
LG&E	C1S	887550	01/2014	01/15/2014	100.080	99.950	100.0	1
LG&E	C1S	887551	01/2014	01/15/2014	100.080	99.860	100.0	1
LG&E	C1S	887552	01/2014	01/15/2014	100.030	99.940	100.0	1
LG&E	C1S	887553	01/2014	01/15/2014	100.030	99.910	100.0	1
LG&E	C1S	887554	01/2014	01/15/2014	100.080	99.880	100.0	1
LG&E	C1S	887555	01/2014	01/15/2014	100.100	99.940	100.0	1
LG&E	C1S	887556	01/2014	01/15/2014	100.070	99.820	100.0	1
LG&E	C1S	887557	01/2014	01/15/2014	100.090	99.920	100.0	1
LG&E	C1S	887558	01/2014	01/15/2014	100.050	99.840	100.0	1
LG&E	C1S	887559	01/2014	01/15/2014	100.040	99.880	99.9	1
LG&E	C1S	887560	01/2014	01/15/2014	100.080	99.930	99.9	1
LG&E	C1S	887561	01/2014	01/15/2014	100.080	99.880	100.0	1
LG&E	C1S	887562	01/2014	01/15/2014	100.040	99.900	100.0	1
LG&E	C1S	887563	01/2014	01/15/2014	100.090	99.930	100.1	1
LG&E	C1S	887564	01/2014	01/15/2014	100.080	99.930	99.9	1
LG&E	C1S	887565	01/2014	01/15/2014	100.060	99.990	100.0	1
LG&E	C1S	887566	01/2014	01/15/2014	100.090	100.000	100.1	1

LG&E	C1S	887567	01/2014	01/15/2014	100.030	99.850	100.0	1
LG&E	C1S	887568	01/2014	01/15/2014	100.060	99.940	99.9	1
LG&E	C1S	887569	01/2014	01/15/2014	100.070	99.810	100.0	1
LG&E	C1S	887570	01/2014	01/15/2014	100.060	99.870	99.9	1
LG&E	C1S	887571	01/2014	01/15/2014	100.100	99.900	100.1	1
LG&E	C1S	887572	01/2014	01/15/2014	100.070	99.940	100.1	1
LG&E	C1S	887573	01/2014	01/15/2014	100.080	99.880	100.0	1
LG&E	C1S	887574	01/2014	01/15/2014	100.060	99.840	100.0	1
LG&E	C1S	887575	01/2014	01/15/2014	100.090	99.930	100.1	1
LG&E	C1S	887576	01/2014	01/15/2014	100.040	99.840	99.9	1
LG&E	C1S	887577	01/2014	01/15/2014	100.100	100.030	100.1	1
LG&E	C1S	887578	01/2014	01/15/2014	100.100	99.940	100.1	1
LG&E	C1S	887579	01/2014	01/15/2014	100.050	99.850	100.0	1
LG&E	C1S	887580	01/2014	01/15/2014	100.100	99.930	100.0	1
LG&E	C1S	887581	01/2014	01/15/2014	100.090	99.910	99.9	1
LG&E	C1S	887582	01/2014	01/15/2014	100.050	99.920	100.0	1
LG&E	C1S	887583	01/2014	01/15/2014	100.070	99.830	100.0	1
LG&E	C1S	887584	01/2014	01/15/2014	100.060	99.930	99.9	1
LG&E	C1S	887585	01/2014	01/15/2014	100.070	99.850	100.0	1
LG&E	C1S	887586	01/2014	01/15/2014	100.070	99.900	100.0	1
LG&E	C1S	887587	01/2014	01/15/2014	100.090	99.940	100.0	1
LG&E	C1S	887588	01/2014	01/15/2014	100.090	99.870	100.0	1
LG&E	C1S	887589	01/2014	01/15/2014	100.040	99.850	100.0	1
LG&E	C1S	887590	01/2014	01/15/2014	100.090	99.990	100.0	1
LG&E	C1S	887591	01/2014	01/15/2014	100.100	99.950	100.0	1
LG&E	C1S	887592	01/2014	01/15/2014	100.060	99.830	100.0	1
LG&E	C1S	887593	01/2014	01/15/2014	100.110	100.000	100.0	1
LG&E	C1S	887594	01/2014	01/15/2014	100.100	99.920	100.1	1
LG&E	C1S	887595	01/2014	01/15/2014	100.070	99.910	100.1	1
LG&E	C1S	887596	01/2014	01/15/2014	100.090	99.870	100.0	1
LG&E	C1S	887597	01/2014	01/15/2014	100.110	99.990	100.0	1
LG&E	C1S	887598	01/2014	01/15/2014	100.090	99.990	100.0	1

LG&E	C1S	887599	01/2014	01/15/2014	100.060	99.970	100.0	100.0	1
LG&E	C1S	887600	01/2014	01/15/2014	100.070	99.960	100.0	100.0	1
LG&E	C1S	887601	01/2014	01/15/2014	100.060	99.840	100.0	100.0	1
LG&E	C1S	887602	01/2014	01/15/2014	100.100	99.930	100.0	100.0	1
LG&E	C1S	887603	01/2014	01/15/2014	100.080	99.920	100.1	100.1	1
LG&E	C1S	887604	01/2014	01/15/2014	100.080	99.960	100.1	100.1	1
LG&E	C1S	887605	01/2014	01/15/2014	100.080	99.990	100.0	100.0	1
LG&E	C1S	887606	01/2014	01/15/2014	100.060	99.870	99.9	99.9	1
LG&E	C1S	887607	01/2014	01/15/2014	100.080	99.950	100.1	100.1	1
LG&E	C1S	887608	01/2014	01/15/2014	100.090	99.920	100.0	100.0	1
LG&E	C1S	887609	01/2014	01/15/2014	100.040	99.810	99.9	99.9	1
LG&E	C1S	887610	01/2014	01/15/2014	100.060	99.890	100.0	100.0	1
LG&E	C1S	887611	01/2014	01/15/2014	100.050	99.850	99.9	99.9	1
LG&E	C1S	887612	01/2014	01/15/2014	100.030	99.830	100.0	100.0	1
LG&E	C1S	887613	01/2014	01/15/2014	100.040	99.920	100.0	100.0	1
LG&E	C1S	887614	01/2014	01/15/2014	100.090	99.900	100.1	100.1	1
LG&E	C1S	887615	01/2014	01/15/2014	100.100	99.940	100.0	100.0	1
LG&E	C1S	887616	01/2014	01/15/2014	100.110	99.900	100.1	100.1	1
LG&E	C1S	887617	01/2014	01/15/2014	100.030	99.850	100.0	100.0	1
LG&E	C1S	887618	01/2014	01/15/2014	100.090	99.930	100.1	100.1	1
LG&E	C1S	887619	01/2014	01/15/2014	100.070	99.900	100.0	100.0	1
LG&E	C1S	887620	01/2014	01/15/2014	100.060	99.930	100.0	100.0	1
LG&E	C1S	887621	01/2014	01/15/2014	100.100	99.910	100.0	100.0	1
LG&E	C1S	887622	01/2014	01/15/2014	100.090	99.900	99.9	99.9	1
LG&E	C1S	887623	01/2014	01/15/2014	100.070	99.910	100.0	100.0	1
LG&E	C1S	887624	01/2014	01/15/2014	100.100	99.920	100.0	100.0	1
LG&E	C1S	887625	01/2014	01/15/2014	100.100	99.990	100.0	100.0	1
LG&E	C1S	887626	01/2014	01/15/2014	100.060	99.940	99.9	99.9	1
LG&E	C1S	887627	01/2014	01/15/2014	100.090	99.910	100.0	100.0	1
LG&E	C1S	887628	01/2014	01/15/2014	100.060	99.890	100.0	100.0	1
LG&E	C1S	887629	01/2014	01/15/2014	100.050	99.930	100.1	100.1	1
LG&E	C1S	887630	01/2014	01/15/2014	100.070	99.910	100.0	100.0	1

LG&E	C1S	887631	01/2014	01/15/2014	100.040	99.920	100.0	1
LG&E	C1S	887632	01/2014	01/15/2014	100.080	99.960	100.0	1
LG&E	C1S	887633	01/2014	01/15/2014	100.100	99.940	100.1	1
LG&E	C1S	887634	01/2014	01/15/2014	100.050	99.910	99.9	1
LG&E	C1S	887635	01/2014	01/15/2014	100.070	99.930	100.0	1
LG&E	C1S	887636	01/2014	01/15/2014	100.080	99.830	100.0	1
LG&E	C1S	887637	01/2014	01/15/2014	100.050	99.910	100.0	1
LG&E	C1S	887638	01/2014	01/15/2014	100.100	99.910	100.0	1
LG&E	C1S	887639	01/2014	01/15/2014	100.050	99.880	100.0	1
LG&E	C1S	887640	01/2014	01/15/2014	100.070	99.890	100.1	1
LG&E	C1S	887641	01/2014	01/15/2014	100.060	99.890	99.9	1
LG&E	C1S	887642	01/2014	01/15/2014	100.050	99.910	100.0	1
LG&E	C1S	887643	01/2014	01/15/2014	100.030	99.860	100.1	1
LG&E	C1S	887644	01/2014	01/15/2014	100.030	99.850	99.9	1
LG&E	C1S	887645	01/2014	01/15/2014	100.040	99.940	100.0	1
LG&E	C1S	887646	01/2014	01/15/2014	100.060	99.920	100.0	1
LG&E	C1S	887647	01/2014	01/15/2014	100.050	99.870	100.0	1
LG&E	C1S	887648	01/2014	01/15/2014	100.040	99.930	99.9	1
LG&E	C1S	887649	01/2014	01/15/2014	100.080	99.910	100.1	1
LG&E	C1S	887650	01/2014	01/15/2014	100.030	99.800	99.9	1
LG&E	C1S	887651	01/2014	01/15/2014	100.090	99.880	100.1	1
LG&E	C1S	887652	01/2014	01/15/2014	100.070	99.860	100.0	1
LG&E	C1S	887653	01/2014	01/15/2014	100.030	99.870	100.0	1
LG&E	C1S	887654	01/2014	01/15/2014	100.050	99.800	100.0	1
LG&E	C1S	887655	01/2014	01/15/2014	100.080	99.910	100.0	1
LG&E	C1S	887656	01/2014	01/15/2014	100.100	99.990	100.0	1
LG&E	C1S	887657	01/2014	01/15/2014	100.070	99.950	99.9	1
LG&E	C1S	887658	01/2014	01/15/2014	100.030	99.900	100.0	1
LG&E	C1S	887659	01/2014	01/15/2014	100.060	99.930	100.1	1
LG&E	C1S	887660	01/2014	01/15/2014	100.070	99.890	100.0	1
LG&E	C1S	887661	01/2014	01/15/2014	100.070	100.010	99.9	1
LG&E	C1S	887662	01/2014	01/15/2014	100.060	99.900	100.0	1

LG&E	C1S	887663	01/2014	01/15/2014	100.040	99.880	100.1	1
LG&E	C1S	887664	01/2014	01/15/2014	100.090	99.880	100.1	1
LG&E	C1S	887665	01/2014	01/15/2014	100.070	99.940	100.0	1
LG&E	C1S	887666	01/2014	01/15/2014	100.040	99.850	100.0	1
LG&E	C1S	887667	01/2014	01/15/2014	100.050	99.900	100.0	1
LG&E	C1S	887668	01/2014	01/15/2014	100.100	99.960	100.0	1
LG&E	C1S	887669	01/2014	01/15/2014	100.080	99.970	100.0	1
LG&E	C1S	887670	01/2014	01/15/2014	100.060	99.880	100.0	1
LG&E	C1S	887671	01/2014	01/15/2014	100.100	99.980	100.1	1
LG&E	C1S	887672	01/2014	01/15/2014	100.070	99.950	100.0	1
LG&E	C1S	887673	01/2014	01/15/2014	100.060	99.850	100.1	1
LG&E	C1S	887674	01/2014	01/15/2014	100.080	99.870	100.0	1
LG&E	C1S	887675	01/2014	01/15/2014	100.090	99.920	100.1	1
LG&E	C1S	887676	01/2014	01/15/2014	100.070	99.900	100.1	1
LG&E	C1S	887677	01/2014	01/15/2014	100.070	99.900	99.9	1
LG&E	C1S	887678	01/2014	01/15/2014	100.100	99.910	100.0	1
LG&E	C1S	887679	01/2014	01/15/2014	100.070	99.850	100.0	1
LG&E	C1S	887680	01/2014	01/15/2014	100.060	99.930	100.0	1
LG&E	C1S	887681	01/2014	01/15/2014	100.100	99.990	99.9	1
LG&E	C1S	887682	01/2014	01/15/2014	100.090	99.960	100.0	1
LG&E	C1S	887683	01/2014	01/15/2014	100.040	99.820	99.9	1
LG&E	C1S	887684	01/2014	01/15/2014	100.030	99.890	100.0	1
LG&E	C1S	887685	01/2014	01/15/2014	100.030	99.870	100.0	1
LG&E	C1S	887686	01/2014	01/15/2014	100.090	99.990	100.1	1
LG&E	C1S	887687	01/2014	01/15/2014	100.050	99.900	100.1	1
LG&E	C1S	887688	01/2014	01/15/2014	100.070	99.940	100.0	1
LG&E	C1S	887689	01/2014	01/15/2014	100.060	99.860	100.0	1
LG&E	C1S	887690	01/2014	01/15/2014	100.080	99.900	100.0	1
LG&E	C1S	887691	01/2014	01/15/2014	100.060	99.890	100.0	1
LG&E	C1S	887692	01/2014	01/15/2014	100.050	99.900	100.0	1
LG&E	C1S	887693	01/2014	01/15/2014	100.080	99.920	100.0	1
LG&E	C1S	887694	01/2014	01/15/2014	100.060	99.900	100.0	1

LG&E	C1S	887695	01/2014	01/15/2014	100.070	99.880	99.9	1
LG&E	C1S	887696	01/2014	01/15/2014	100.040	99.880	100.0	1
LG&E	C1S	887697	01/2014	01/15/2014	100.030	99.900	100.0	1
LG&E	C1S	887698	01/2014	01/15/2014	100.050	99.950	100.0	1
LG&E	C1S	887699	01/2014	01/15/2014	100.100	99.990	100.0	1
LG&E	C1S	887700	01/2014	01/15/2014	100.080	99.880	100.0	1
LG&E	C1S	887701	01/2014	01/15/2014	100.080	99.930	100.1	1
LG&E	C1S	887702	01/2014	01/15/2014	100.080	99.980	100.0	1
LG&E	C1S	887703	01/2014	01/15/2014	100.080	99.870	100.0	1
LG&E	C1S	887704	01/2014	01/15/2014	100.080	99.860	100.1	1
LG&E	C1S	887705	01/2014	01/15/2014	100.070	99.940	100.1	1
LG&E	C1S	887706	01/2014	01/15/2014	100.080	99.930	100.0	1
LG&E	C1S	887707	01/2014	01/15/2014	100.080	99.940	100.1	1
LG&E	C1S	887708	01/2014	01/15/2014	100.070	99.930	100.0	1
LG&E	C1S	887709	01/2014	01/15/2014	100.090	99.900	100.0	1
LG&E	C1S	887710	01/2014	01/15/2014	100.060	99.920	100.1	1
LG&E	C1S	887711	01/2014	01/15/2014	100.080	99.920	100.0	1
LG&E	C1S	887712	01/2014	01/15/2014	100.080	99.840	100.1	1
LG&E	C1S	887713	01/2014	01/15/2014	100.030	99.900	100.0	1
LG&E	C1S	887714	01/2014	01/15/2014	100.060	99.880	100.0	1
LG&E	C1S	887715	01/2014	01/15/2014	100.070	99.900	100.0	1
LG&E	C1S	887716	01/2014	01/15/2014	100.080	99.940	100.1	1
LG&E	C1S	887717	01/2014	01/15/2014	100.050	99.900	100.0	1
LG&E	C1S	887718	01/2014	01/15/2014	100.100	99.940	100.0	1
LG&E	C1S	887719	01/2014	01/15/2014	100.070	99.940	100.0	1
LG&E	C1S	887720	01/2014	01/15/2014	100.050	99.860	100.0	1
LG&E	C1S	887721	01/2014	01/15/2014	100.090	100.010	100.0	1
LG&E	C1S	887722	01/2014	01/15/2014	100.040	99.900	99.9	1
LG&E	C1S	887723	01/2014	01/15/2014	100.050	99.870	100.0	1
LG&E	C1S	887724	01/2014	01/15/2014	100.070	99.840	100.0	1
LG&E	C1S	887725	01/2014	01/15/2014	100.060	99.900	100.0	1
LG&E	C1S	887726	01/2014	01/15/2014	100.080	99.940	100.0	1

LG&E	C1S	887727	01/2014	01/15/2014	100.090	99.980	99.9	1
LG&E	C1S	887728	01/2014	01/15/2014	100.070	99.920	100.0	1
LG&E	C1S	887729	01/2014	01/15/2014	100.050	99.810	100.0	1
LG&E	C1S	887730	01/2014	01/15/2014	100.060	99.920	100.1	1
LG&E	C1S	887731	01/2014	01/15/2014	100.100	99.950	100.0	1
LG&E	C1S	887732	01/2014	01/15/2014	100.070	99.910	100.1	1
LG&E	C1S	887733	01/2014	01/15/2014	100.100	99.930	100.0	1
LG&E	C1S	887734	01/2014	01/15/2014	100.080	99.940	100.0	1
LG&E	C1S	887735	01/2014	01/15/2014	100.080	99.890	100.0	1
LG&E	C1S	887736	01/2014	01/15/2014	100.080	99.910	100.0	1
LG&E	C1S	887737	01/2014	01/15/2014	100.070	99.940	100.0	1
LG&E	C1S	887738	01/2014	01/15/2014	100.070	99.850	100.1	1
LG&E	C1S	887739	01/2014	01/15/2014	100.030	99.820	99.9	1
LG&E	C1S	889975	05/2014	04/23/2014	100.030	99.890	100.0	1
LG&E	C1S	889976	05/2014	04/23/2014	100.060	99.920	100.0	1
LG&E	C1S	889977	05/2014	04/23/2014	100.050	99.890	99.9	1
LG&E	C1S	889978	05/2014	04/23/2014	100.040	99.920	100.0	1
LG&E	C1S	889979	05/2014	04/23/2014	100.100	99.900	100.0	1
LG&E	C1S	889980	05/2014	04/23/2014	100.110	100.020	100.0	1
LG&E	C1S	889981	05/2014	04/23/2014	100.100	99.980	100.0	1
LG&E	C1S	889982	05/2014	04/23/2014	100.090	99.950	100.0	1
LG&E	C1S	889983	05/2014	04/23/2014	100.050	99.910	100.0	1
LG&E	C1S	889984	05/2014	04/23/2014	100.070	99.910	100.0	1
LG&E	C1S	889985	05/2014	04/23/2014	100.080	99.950	100.0	1
LG&E	C1S	889986	05/2014	04/23/2014	100.070	99.960	100.0	1
LG&E	C1S	889987	05/2014	04/23/2014	100.070	99.940	100.1	1
LG&E	C1S	889988	05/2014	04/23/2014	100.070	99.880	99.9	1
LG&E	C1S	889989	05/2014	04/23/2014	100.060	99.960	100.0	1
LG&E	C1S	889990	05/2014	04/23/2014	100.090	99.930	100.0	1
LG&E	C1S	889991	05/2014	04/23/2014	100.090	99.930	100.1	1
LG&E	C1S	889992	05/2014	04/23/2014	100.100	99.910	100.1	1
LG&E	C1S	889993	05/2014	04/23/2014	100.050	99.920	100.0	1

LG&E	C1S	889994	05/2014	04/23/2014	100.070	99.890	100.0	1
LG&E	C1S	889995	05/2014	04/23/2014	100.070	99.900	100.0	1
LG&E	C1S	889996	05/2014	04/23/2014	100.030	99.870	100.0	1
LG&E	C1S	889997	05/2014	04/23/2014	100.110	99.980	100.0	1
LG&E	C1S	889998	05/2014	04/23/2014	100.070	99.920	100.0	1
LG&E	C1S	889999	05/2014	04/23/2014	100.100	99.960	99.9	1
LG&E	C1S	890000	05/2014	04/23/2014	100.100	100.020	100.0	1
LG&E	C1S	890001	05/2014	04/23/2014	100.060	99.880	100.0	1
LG&E	C1S	890002	05/2014	04/23/2014	100.060	99.900	99.9	1
LG&E	C1S	890003	05/2014	04/23/2014	100.070	99.950	100.0	1
LG&E	C1S	890004	05/2014	04/23/2014	100.030	99.840	100.0	1
LG&E	C1S	890005	05/2014	04/23/2014	100.090	99.890	99.9	1
LG&E	C1S	890006	05/2014	04/23/2014	100.090	99.900	100.0	1
LG&E	C1S	890007	05/2014	04/23/2014	100.040	99.820	99.9	1
LG&E	C1S	890008	05/2014	04/23/2014	100.100	99.990	100.1	1
LG&E	C1S	890009	05/2014	04/23/2014	100.080	99.950	100.0	1
LG&E	C1S	890010	05/2014	04/23/2014	100.090	99.910	100.1	1
LG&E	C1S	890011	05/2014	04/23/2014	100.080	99.930	100.0	1
LG&E	C1S	890012	05/2014	04/23/2014	100.090	99.940	100.0	1
LG&E	C1S	890013	05/2014	04/23/2014	100.050	99.940	100.0	1
LG&E	C1S	890014	05/2014	04/23/2014	100.060	99.920	100.0	1
LG&E	C1S	890015	05/2014	04/23/2014	100.060	99.930	100.0	1
LG&E	C1S	890016	05/2014	04/23/2014	100.040	99.870	100.0	1
LG&E	C1S	890017	05/2014	04/23/2014	100.070	99.920	100.0	1
LG&E	C1S	890018	05/2014	04/23/2014	100.050	99.910	100.0	1
LG&E	C1S	890019	05/2014	04/23/2014	100.050	99.880	100.0	1
LG&E	C1S	890020	05/2014	04/23/2014	100.050	99.890	100.0	1
LG&E	C1S	890021	05/2014	04/23/2014	100.070	100.000	100.1	1
LG&E	C1S	890022	05/2014	04/23/2014	100.070	99.900	100.0	1
LG&E	C1S	890023	05/2014	04/23/2014	100.060	99.930	100.0	1
LG&E	C1S	890024	05/2014	04/23/2014	100.040	99.850	100.0	1
LG&E	C1S	890025	05/2014	04/23/2014	100.040	99.830	100.1	1

LG&E	C1S	890026	05/2014	04/23/2014	100.110	99.910	100.0	1
LG&E	C1S	890027	05/2014	04/23/2014	100.070	99.960	100.0	1
LG&E	C1S	890028	05/2014	04/23/2014	100.060	99.970	99.9	1
LG&E	C1S	890029	05/2014	04/23/2014	100.050	99.890	100.0	1
LG&E	C1S	890030	05/2014	04/23/2014	100.050	99.930	100.0	1
LG&E	C1S	890031	05/2014	04/23/2014	100.100	99.980	100.0	1
LG&E	C1S	890032	05/2014	04/23/2014	100.060	99.920	100.0	1
LG&E	C1S	890033	05/2014	04/23/2014	100.030	99.840	100.0	1
LG&E	C1S	890034	05/2014	04/23/2014	100.060	99.880	100.0	1
LG&E	C1S	890035	05/2014	04/23/2014	100.080	99.980	100.0	1
LG&E	C1S	890036	05/2014	04/23/2014	100.100	99.960	100.0	1
LG&E	C1S	890037	05/2014	04/23/2014	100.060	99.980	100.0	1
LG&E	C1S	890038	05/2014	04/23/2014	100.100	99.970	100.0	1
LG&E	C1S	890039	05/2014	04/23/2014	100.070	99.910	100.1	1
LG&E	C1S	890040	05/2014	04/23/2014	100.060	99.960	100.1	1
LG&E	C1S	890041	05/2014	04/23/2014	100.030	99.870	100.0	1
LG&E	C1S	890042	05/2014	04/23/2014	100.050	99.820	99.9	1
LG&E	C1S	890043	05/2014	04/23/2014	100.030	99.820	100.0	1
LG&E	C1S	890044	05/2014	04/23/2014	100.100	99.930	100.0	1
LG&E	C1S	890045	05/2014	04/23/2014	100.040	99.900	100.0	1
LG&E	C1S	890046	05/2014	04/23/2014	100.070	99.930	100.1	1
LG&E	C1S	890047	05/2014	04/23/2014	100.060	99.920	100.0	1
LG&E	C1S	890048	05/2014	04/23/2014	100.100	99.950	100.0	1
LG&E	C1S	890049	05/2014	04/23/2014	100.100	99.940	100.1	1
LG&E	C1S	890050	05/2014	04/23/2014	100.090	99.970	100.0	1
LG&E	C1S	890051	05/2014	04/23/2014	100.090	99.940	100.0	1
LG&E	C1S	890052	05/2014	04/23/2014	100.060	99.920	100.0	1
LG&E	C1S	890053	05/2014	04/23/2014	100.080	99.940	100.0	1
LG&E	C1S	890054	05/2014	04/23/2014	100.060	99.840	100.0	1
LG&E	C1S	890055	05/2014	04/23/2014	100.060	99.890	100.0	1
LG&E	C1S	890056	05/2014	04/23/2014	100.050	99.870	100.1	1
LG&E	C1S	890057	05/2014	04/23/2014	100.090	100.000	100.1	1

LG&E	890058	C1S	05/2014	04/23/2014	100.050	99.870	100.0	1
LG&E	890059	C1S	05/2014	04/23/2014	100.040	99.850	100.0	1
LG&E	890060	C1S	05/2014	04/23/2014	100.080	99.930	100.1	1
LG&E	890061	C1S	05/2014	04/23/2014	100.080	99.860	100.0	1
LG&E	890062	C1S	05/2014	04/23/2014	100.100	99.940	100.0	1
LG&E	890063	C1S	05/2014	04/23/2014	100.070	99.910	100.0	1
LG&E	890064	C1S	05/2014	04/23/2014	100.060	99.940	99.9	1
LG&E	890065	C1S	05/2014	04/23/2014	100.080	99.950	100.1	1
LG&E	890066	C1S	05/2014	04/23/2014	100.050	99.870	100.0	1
LG&E	890067	C1S	05/2014	04/23/2014	100.040	99.830	100.0	1
LG&E	890068	C1S	05/2014	04/23/2014	100.050	100.000	99.9	1
LG&E	890069	C1S	05/2014	04/23/2014	100.070	99.900	100.1	1
LG&E	890070	C1S	05/2014	04/23/2014	100.060	99.870	100.1	1
LG&E	890071	C1S	05/2014	04/23/2014	100.080	99.870	100.1	1
LG&E	890072	C1S	05/2014	04/23/2014	100.080	99.930	100.0	1
LG&E	890073	C1S	05/2014	04/23/2014	100.100	99.910	100.0	1
LG&E	890074	C1S	05/2014	04/23/2014	100.070	99.920	100.1	1
LG&E	890075	C1S	05/2014	04/23/2014	100.050	99.940	99.9	1
LG&E	890076	C1S	05/2014	04/23/2014	100.080	99.920	99.9	1
LG&E	890077	C1S	05/2014	04/23/2014	100.070	99.940	100.0	1
LG&E	890078	C1S	05/2014	04/23/2014	100.060	99.910	100.0	1
LG&E	890079	C1S	05/2014	04/23/2014	100.070	99.930	100.0	1
LG&E	890080	C1S	05/2014	04/23/2014	100.120	99.940	100.0	1
LG&E	890081	C1S	05/2014	04/23/2014	100.070	99.980	100.1	1
LG&E	890082	C1S	05/2014	04/23/2014	100.060	99.900	100.0	1
LG&E	890083	C1S	05/2014	04/23/2014	100.070	99.960	100.0	1
LG&E	890084	C1S	05/2014	04/23/2014	100.090	99.890	100.0	1
LG&E	890085	C1S	05/2014	04/23/2014	100.030	99.850	99.9	1
LG&E	890086	C1S	05/2014	04/23/2014	100.060	99.850	100.0	1
LG&E	890087	C1S	05/2014	04/23/2014	100.070	99.880	100.1	1
LG&E	890088	C1S	05/2014	04/23/2014	100.090	99.890	100.0	1
LG&E	890089	C1S	05/2014	04/23/2014	100.060	99.880	100.0	1

LG&E	C1S	890090	05/2014	04/23/2014	100.090	99.950	100.0	1
LG&E	C1S	890091	05/2014	04/23/2014	100.040	99.960	99.9	1
LG&E	C1S	890092	05/2014	04/23/2014	100.090	99.890	100.1	1
LG&E	C1S	890093	05/2014	04/23/2014	100.080	99.890	100.0	1
LG&E	C1S	890094	05/2014	04/23/2014	100.070	99.880	100.0	1
LG&E	C1S	890095	05/2014	04/23/2014	100.080	99.880	100.0	1
LG&E	C1S	890096	05/2014	04/23/2014	100.060	99.920	100.0	1
LG&E	C1S	890097	05/2014	04/23/2014	100.040	99.920	100.0	1
LG&E	C1S	890098	05/2014	04/23/2014	100.060	99.980	100.1	1
LG&E	C1S	890099	05/2014	04/23/2014	100.060	99.900	100.0	1
LG&E	C1S	890100	05/2014	04/23/2014	100.070	99.990	99.9	1
LG&E	C1S	890101	05/2014	04/23/2014	100.070	99.850	100.0	1
LG&E	C1S	890102	05/2014	04/23/2014	100.100	99.930	100.0	1
LG&E	C1S	890103	05/2014	04/23/2014	100.090	99.910	100.0	1
LG&E	C1S	890104	05/2014	04/23/2014	100.090	99.860	99.9	1
LG&E	C1S	890105	05/2014	04/23/2014	100.060	99.970	100.0	1
LG&E	C1S	890106	05/2014	04/23/2014	100.080	99.920	100.0	1
LG&E	C1S	890107	05/2014	04/23/2014	100.080	99.850	100.0	1
LG&E	C1S	890108	05/2014	04/23/2014	100.100	99.940	100.1	1
LG&E	C1S	890109	05/2014	04/23/2014	100.060	99.920	100.0	1
LG&E	C1S	890110	05/2014	04/23/2014	100.040	99.950	100.0	1
LG&E	C1S	890111	05/2014	04/23/2014	100.050	99.890	100.0	1
LG&E	C1S	890112	05/2014	04/23/2014	100.070	99.910	100.0	1
LG&E	C1S	890113	05/2014	04/23/2014	100.090	99.980	100.1	1
LG&E	C1S	890114	05/2014	04/23/2014	100.100	100.000	100.1	1
LG&E	C1S	890115	05/2014	04/23/2014	100.080	99.940	100.0	1
LG&E	C1S	890116	05/2014	04/23/2014	100.030	99.870	100.0	1
LG&E	C1S	890117	05/2014	04/23/2014	100.030	99.910	100.0	1
LG&E	C1S	890118	05/2014	04/23/2014	100.100	100.000	100.0	1
LG&E	C1S	890119	05/2014	04/23/2014	100.040	99.860	100.0	1
LG&E	C1S	890120	05/2014	04/23/2014	100.070	99.930	100.0	1
LG&E	C1S	890121	05/2014	04/23/2014	100.060	99.960	100.1	1

LG&E	C1S	890122	05/2014	04/23/2014	100.080	99.930	100.0	1
LG&E	C1S	890123	05/2014	04/23/2014	100.050	99.810	100.0	1
LG&E	C1S	890124	05/2014	04/23/2014	100.080	99.940	100.1	1
LG&E	C1S	890125	05/2014	04/23/2014	100.080	99.960	100.0	1
LG&E	C1S	890126	05/2014	04/23/2014	100.090	99.960	100.1	1
LG&E	C1S	890127	05/2014	04/23/2014	100.070	99.910	100.0	1
LG&E	C1S	890128	05/2014	04/23/2014	100.030	99.900	100.0	1
LG&E	C1S	890129	05/2014	04/23/2014	100.030	99.870	99.9	1
LG&E	C1S	890130	05/2014	04/23/2014	100.070	99.940	100.0	1
LG&E	C1S	890131	05/2014	04/23/2014	100.030	99.870	100.0	1
LG&E	C1S	890132	05/2014	04/23/2014	100.080	99.900	100.0	1
LG&E	C1S	890133	05/2014	04/23/2014	100.080	99.950	100.1	1
LG&E	C1S	890134	05/2014	04/23/2014	100.070	99.850	99.9	1
LG&E	C1S	890135	05/2014	04/23/2014	100.060	99.910	100.0	1
LG&E	C1S	890136	05/2014	04/23/2014	100.100	100.000	100.1	1
LG&E	C1S	890137	05/2014	04/23/2014	100.080	99.960	100.0	1
LG&E	C1S	890138	05/2014	04/23/2014	100.030	99.880	99.9	1
LG&E	C1S	890139	05/2014	04/23/2014	100.090	99.920	100.0	1
LG&E	C1S	890140	05/2014	04/23/2014	100.050	99.840	99.9	1
LG&E	C1S	890141	05/2014	04/23/2014	100.100	99.940	100.1	1
LG&E	C1S	890142	05/2014	04/23/2014	100.070	99.920	100.0	1
LG&E	C1S	890143	05/2014	04/23/2014	100.060	99.890	100.0	1
LG&E	C1S	890144	05/2014	04/23/2014	100.080	99.990	99.9	1
LG&E	C1S	890145	05/2014	04/23/2014	100.110	99.920	100.0	1
LG&E	C1S	890146	05/2014	04/23/2014	100.080	99.930	100.0	1
LG&E	C1S	890147	05/2014	04/23/2014	100.030	99.820	99.9	1
LG&E	C1S	890148	05/2014	04/23/2014	100.060	99.930	100.0	1
LG&E	C1S	890149	05/2014	04/23/2014	100.090	99.940	100.0	1
LG&E	C1S	890150	05/2014	04/23/2014	100.070	99.860	100.0	1
LG&E	C1S	890151	05/2014	04/23/2014	100.070	99.930	100.0	1
LG&E	C1S	890152	05/2014	04/23/2014	100.040	99.980	100.0	1
LG&E	C1S	890153	05/2014	04/23/2014	100.090	99.910	100.0	1

LG&E	890154	C1S	05/2014	04/23/2014	100.100	99.960	100.1	1
LG&E	890155	C1S	05/2014	04/23/2014	100.070	99.860	99.9	1
LG&E	890156	C1S	05/2014	04/23/2014	100.070	99.900	100.0	1
LG&E	890157	C1S	05/2014	04/23/2014	100.090	99.910	99.9	1
LG&E	890158	C1S	05/2014	04/23/2014	100.030	99.870	100.0	1
LG&E	890159	C1S	05/2014	04/23/2014	100.060	99.920	100.1	1
LG&E	890160	C1S	05/2014	04/23/2014	100.080	99.930	100.0	1
LG&E	890161	C1S	05/2014	04/23/2014	100.110	99.910	100.1	1
LG&E	890162	C1S	05/2014	04/23/2014	100.060	99.930	99.9	1
LG&E	890163	C1S	05/2014	04/23/2014	100.080	99.900	100.0	1
LG&E	890164	C1S	05/2014	04/23/2014	100.090	99.880	100.2	1
LG&E	890165	C1S	05/2014	04/23/2014	100.070	99.890	100.0	1
LG&E	890166	C1S	05/2014	04/23/2014	100.040	99.830	100.0	1
LG&E	890167	C1S	05/2014	04/23/2014	100.060	99.970	99.9	1
LG&E	890168	C1S	05/2014	04/23/2014	100.070	99.880	100.1	1
LG&E	890169	C1S	05/2014	04/23/2014	100.080	99.870	100.0	1
LG&E	890170	C1S	05/2014	04/23/2014	100.070	99.960	100.1	1
LG&E	890171	C1S	05/2014	04/23/2014	100.030	99.870	100.0	1
LG&E	890172	C1S	05/2014	04/23/2014	100.070	99.880	100.0	1
LG&E	890173	C1S	05/2014	04/23/2014	100.040	99.910	100.0	1
LG&E	890174	C1S	05/2014	04/23/2014	100.050	99.910	100.0	1
LG&E	890175	C1S	05/2014	04/23/2014	100.080	99.930	100.0	1
LG&E	890176	C1S	05/2014	04/23/2014	100.040	99.860	100.0	1
LG&E	890177	C1S	05/2014	04/23/2014	100.090	99.960	100.0	1
LG&E	890178	C1S	05/2014	04/23/2014	100.050	99.940	100.0	1
LG&E	890179	C1S	05/2014	04/23/2014	100.060	99.950	100.1	1
LG&E	890180	C1S	05/2014	04/23/2014	100.030	99.810	100.0	1
LG&E	890181	C1S	05/2014	04/23/2014	100.110	99.990	100.0	1
LG&E	890182	C1S	05/2014	04/23/2014	100.050	99.880	100.0	1
LG&E	890183	C1S	05/2014	04/23/2014	100.060	99.870	100.0	1
LG&E	890184	C1S	05/2014	04/23/2014	100.070	99.910	100.0	1
LG&E	890185	C1S	05/2014	04/23/2014	100.070	99.920	100.0	1

LG&E	890186	C1S	05/2014	04/23/2014	100.040	99.890	99.9	1
LG&E	890187	C1S	05/2014	04/23/2014	100.060	99.930	100.0	1
LG&E	890188	C1S	05/2014	04/23/2014	100.050	99.850	100.0	1
LG&E	890189	C1S	05/2014	04/23/2014	100.100	99.950	100.1	1
LG&E	890190	C1S	05/2014	04/23/2014	100.030	99.830	99.9	1
LG&E	890191	C1S	05/2014	04/23/2014	100.040	99.900	100.0	1
LG&E	890192	C1S	05/2014	04/23/2014	100.080	100.000	100.0	1
LG&E	890193	C1S	05/2014	04/23/2014	100.050	99.900	100.1	1
LG&E	890194	C1S	05/2014	04/23/2014	100.070	99.910	99.9	1
LG&E	890195	C1S	05/2014	04/23/2014	100.090	99.920	100.1	1
LG&E	890196	C1S	05/2014	04/23/2014	100.070	99.870	100.0	1
LG&E	890197	C1S	05/2014	04/23/2014	100.080	99.910	100.1	1
LG&E	890198	C1S	05/2014	04/23/2014	100.070	99.800	100.1	1
LG&E	890199	C1S	05/2014	04/23/2014	100.070	99.880	100.0	1
LG&E	890200	C1S	05/2014	04/23/2014	100.110	99.920	100.0	1
LG&E	890201	C1S	05/2014	04/23/2014	100.080	99.920	100.0	1
LG&E	890202	C1S	05/2014	04/23/2014	100.060	99.900	100.0	1
LG&E	890203	C1S	05/2014	04/23/2014	100.060	99.960	100.0	1
LG&E	890204	C1S	05/2014	04/23/2014	100.070	99.960	99.9	1
LG&E	890205	C1S	05/2014	04/23/2014	100.060	99.850	100.0	1
LG&E	890206	C1S	05/2014	04/23/2014	100.090	99.950	100.0	1
LG&E	890207	C1S	05/2014	04/23/2014	100.070	99.910	100.1	1
LG&E	890208	C1S	05/2014	04/23/2014	100.080	99.930	100.0	1
LG&E	890209	C1S	05/2014	04/23/2014	100.040	99.840	100.0	1
LG&E	890210	C1S	05/2014	04/23/2014	100.060	99.940	100.0	1
LG&E	890211	C1S	05/2014	04/23/2014	100.060	99.900	100.0	1
LG&E	890212	C1S	05/2014	04/23/2014	100.090	99.940	100.1	1
LG&E	890213	C1S	05/2014	04/23/2014	100.100	99.920	100.0	1
LG&E	890214	C1S	05/2014	04/23/2014	100.060	99.970	100.0	1
LG&E	890215	C1S	05/2014	04/23/2014	100.070	99.910	100.0	1
LG&E	890216	C1S	05/2014	04/23/2014	100.070	99.880	100.0	1
LG&E	890217	C1S	05/2014	04/23/2014	100.080	99.940	100.0	1

LG&E	C1S	890218	05/2014	04/23/2014	100.050	99.910	100.0	1
LG&E	C1S	890219	05/2014	04/23/2014	100.060	99.950	99.9	1
LG&E	C1S	890220	05/2014	04/23/2014	100.070	99.940	100.1	1
LG&E	C1S	890221	05/2014	04/23/2014	100.110	99.960	100.1	1
LG&E	C1S	890222	05/2014	04/23/2014	100.050	99.920	100.0	1
LG&E	C1S	890223	05/2014	04/23/2014	100.070	99.910	100.0	1
LG&E	C1S	890224	05/2014	04/23/2014	100.060	99.990	100.1	1
LG&E	C1S	890225	05/2014	04/23/2014	100.110	99.900	99.9	1
LG&E	C1S	890226	05/2014	04/23/2014	100.080	99.980	100.1	1
LG&E	C1S	890227	05/2014	04/23/2014	100.050	99.880	100.1	1
LG&E	C1S	890228	05/2014	04/23/2014	100.050	99.940	100.0	1
LG&E	C1S	890229	05/2014	04/23/2014	100.030	99.890	99.9	1
LG&E	C1S	890230	05/2014	04/23/2014	100.060	99.900	100.0	1
LG&E	C1S	890231	05/2014	04/23/2014	100.090	99.890	100.1	1
LG&E	C1S	890232	05/2014	04/23/2014	100.060	99.870	100.0	1
LG&E	C1S	890233	05/2014	04/23/2014	100.060	99.900	100.0	1
LG&E	C1S	890234	05/2014	04/23/2014	100.070	99.910	100.0	1
LG&E	C1S	890235	05/2014	04/23/2014	100.080	99.920	100.0	1
LG&E	C1S	890236	05/2014	04/23/2014	100.080	99.920	100.1	1
LG&E	C1S	890237	05/2014	04/23/2014	100.100	99.910	100.1	1
LG&E	C1S	890238	05/2014	04/23/2014	100.090	100.010	100.1	1
LG&E	C1S	890239	05/2014	04/23/2014	100.060	99.810	99.9	1
LG&E	C1S	890240	05/2014	04/23/2014	100.100	99.930	100.0	1
LG&E	C1S	890241	05/2014	04/23/2014	100.090	99.990	100.0	1
LG&E	C1S	890242	05/2014	04/23/2014	100.070	99.920	100.0	1
LG&E	C1S	890243	05/2014	04/23/2014	100.070	99.880	100.0	1
LG&E	C1S	890244	05/2014	04/23/2014	100.070	99.950	100.0	1
LG&E	C1S	890245	05/2014	04/23/2014	100.070	99.900	100.0	1
LG&E	C1S	890246	05/2014	04/23/2014	100.050	99.980	100.0	1
LG&E	C1S	890247	05/2014	04/23/2014	100.060	99.870	100.1	1
LG&E	C1S	890248	05/2014	04/23/2014	100.060	99.890	100.0	1
LG&E	C1S	890249	05/2014	04/23/2014	100.080	99.930	100.0	1

LG&E	C1S	890250	05/2014	04/23/2014	100.060	99.920	100.0	1
LG&E	C1S	890251	05/2014	04/23/2014	100.040	99.840	99.9	1
LG&E	C1S	890252	05/2014	04/23/2014	100.110	99.980	100.1	1
LG&E	C1S	890253	05/2014	04/23/2014	100.060	99.900	100.0	1
LG&E	C1S	890254	05/2014	04/23/2014	100.070	100.010	100.0	1
LG&E	C1S	890255	05/2014	04/23/2014	100.070	99.850	100.0	1
LG&E	C1S	890256	05/2014	04/23/2014	100.040	100.020	100.0	1
LG&E	C1S	890257	05/2014	04/23/2014	100.110	100.010	100.0	1
LG&E	C1S	890258	05/2014	04/23/2014	100.100	99.900	100.0	1
LG&E	C1S	890259	05/2014	04/23/2014	100.050	99.930	100.0	1
LG&E	C1S	890260	05/2014	04/23/2014	100.040	99.870	99.9	1
LG&E	C1S	890261	05/2014	04/23/2014	100.090	99.970	100.0	1
LG&E	C1S	890262	05/2014	04/23/2014	100.060	99.860	100.0	1
LG&E	C1S	890263	05/2014	04/23/2014	100.100	99.920	100.1	1
LG&E	C1S	890264	05/2014	04/23/2014	100.040	99.900	100.0	1
LG&E	C1S	890265	05/2014	04/23/2014	100.060	99.970	100.0	1
LG&E	C1S	890266	05/2014	04/23/2014	100.100	99.930	100.0	1
LG&E	C1S	890267	05/2014	04/23/2014	100.060	99.940	100.0	1
LG&E	C1S	890268	05/2014	04/23/2014	100.070	99.920	100.0	1
LG&E	C1S	890269	05/2014	04/23/2014	100.100	99.920	100.0	1
LG&E	C1S	890270	05/2014	04/23/2014	100.070	99.900	100.0	1
LG&E	C1S	890271	05/2014	04/23/2014	100.080	99.930	100.0	1
LG&E	C1S	890272	05/2014	04/23/2014	100.070	99.900	100.0	1
LG&E	C1S	890273	05/2014	04/23/2014	100.050	99.850	100.0	1
LG&E	C1S	890274	05/2014	04/23/2014	100.060	99.940	100.0	1
LG&E	C1S	890275	05/2014	04/23/2014	100.100	99.980	100.0	1
LG&E	C1S	890276	05/2014	04/23/2014	100.050	99.860	100.0	1
LG&E	C1S	890277	05/2014	04/23/2014	100.040	99.850	99.9	1
LG&E	C1S	890278	05/2014	04/23/2014	100.040	99.900	99.9	1
LG&E	C1S	890279	05/2014	04/23/2014	100.030	99.900	99.9	1
LG&E	C1S	890280	05/2014	04/23/2014	100.090	99.940	100.2	1
LG&E	C1S	890281	05/2014	04/23/2014	100.060	99.850	100.0	1

LG&E	C1S	890282	05/2014	04/23/2014	100.070	99.900	100.1	1
LG&E	C1S	890283	05/2014	04/23/2014	100.100	99.960	100.1	1
LG&E	C1S	890284	05/2014	04/23/2014	100.060	99.910	100.0	1
LG&E	C1S	890285	05/2014	04/23/2014	100.070	99.880	100.0	1
LG&E	C1S	890286	05/2014	04/23/2014	100.090	99.940	100.0	1
LG&E	C1S	890287	05/2014	04/23/2014	100.050	99.860	100.0	1
LG&E	C1S	890288	05/2014	04/23/2014	100.080	99.920	100.1	1
LG&E	C1S	890289	05/2014	04/23/2014	100.040	99.870	100.0	1
LG&E	C1S	890290	05/2014	04/23/2014	100.040	99.900	99.9	1
LG&E	C1S	890291	05/2014	04/23/2014	100.100	99.940	100.0	1
LG&E	C1S	890292	05/2014	04/23/2014	100.060	99.890	99.9	1
LG&E	C1S	890293	05/2014	04/23/2014	100.070	99.900	100.0	1
LG&E	C1S	890294	05/2014	04/23/2014	100.050	99.920	99.9	1
LG&E	C1S	890295	05/2014	04/23/2014	100.050	99.890	100.0	1
LG&E	C1S	890296	05/2014	04/23/2014	100.080	99.970	100.1	1
LG&E	C1S	890297	05/2014	04/23/2014	100.090	99.980	100.0	1
LG&E	C1S	890298	05/2014	04/23/2014	100.040	99.890	100.0	1
LG&E	C1S	890299	05/2014	04/23/2014	100.050	99.910	100.0	1
LG&E	C1S	890300	05/2014	04/23/2014	100.100	99.990	100.1	1
LG&E	C1S	890301	05/2014	04/23/2014	100.070	99.930	100.0	1
LG&E	C1S	890302	05/2014	04/23/2014	100.050	99.860	99.9	1
LG&E	C1S	890303	05/2014	04/23/2014	100.080	99.910	100.0	1
LG&E	C1S	890304	05/2014	04/23/2014	100.060	99.950	100.0	1
LG&E	C1S	890305	05/2014	04/23/2014	100.080	99.940	100.0	1
LG&E	C1S	890306	05/2014	04/23/2014	100.100	99.920	100.1	1
LG&E	C1S	890307	05/2014	04/23/2014	100.070	99.820	100.1	1
LG&E	C1S	890308	05/2014	04/23/2014	100.050	99.880	100.0	1
LG&E	C1S	890309	05/2014	04/23/2014	100.050	99.910	100.0	1
LG&E	C1S	890310	05/2014	04/23/2014	100.100	99.950	100.1	1
LG&E	C1S	890311	05/2014	04/23/2014	100.070	99.970	100.1	1
LG&E	C1S	890312	05/2014	04/23/2014	100.030	99.960	100.0	1
LG&E	C1S	890313	05/2014	04/23/2014	100.030	99.920	100.0	1

LG&E	C1S	890314	05/2014	04/23/2014	100.090	99.900	100.1	1
LG&E	C1S	890315	05/2014	04/23/2014	100.070	99.960	100.0	1
LG&E	C1S	890316	05/2014	04/23/2014	100.080	99.920	100.1	1
LG&E	C1S	890317	05/2014	04/23/2014	100.090	99.980	100.1	1
LG&E	C1S	890318	05/2014	04/23/2014	100.080	99.940	100.0	1
LG&E	C1S	890319	05/2014	04/23/2014	100.060	99.900	100.0	1
LG&E	C1S	890320	05/2014	04/23/2014	100.060	99.940	100.0	1
LG&E	C1S	890321	05/2014	04/23/2014	100.030	99.830	100.0	1
LG&E	C1S	890322	05/2014	04/23/2014	100.080	99.860	100.1	1
LG&E	C1S	890323	05/2014	04/23/2014	100.070	99.980	99.9	1
LG&E	C1S	890324	05/2014	04/23/2014	100.060	99.870	100.0	1
LG&E	C1S	890325	05/2014	04/23/2014	100.070	99.870	100.0	1
LG&E	C1S	890326	05/2014	04/23/2014	100.070	99.910	100.1	1
LG&E	C1S	890327	05/2014	04/23/2014	100.040	99.900	100.0	1
LG&E	C1S	890328	05/2014	04/23/2014	100.080	99.910	100.1	1
LG&E	C1S	890329	05/2014	04/23/2014	100.060	99.940	100.0	1
LG&E	C1S	890330	05/2014	04/23/2014	100.070	99.890	100.1	1
LG&E	C1S	890331	05/2014	04/23/2014	100.060	99.860	100.1	1
LG&E	C1S	890332	05/2014	04/23/2014	100.070	99.950	100.0	1
LG&E	C1S	890333	05/2014	04/23/2014	100.070	99.900	100.1	1
LG&E	C1S	890334	05/2014	04/23/2014	100.100	99.940	100.1	1
LG&E	C1S	890335	05/2014	04/23/2014	100.070	99.930	100.0	1
LG&E	C1S	890336	05/2014	04/23/2014	100.040	99.920	100.0	1
LG&E	C1S	890337	05/2014	04/23/2014	100.090	99.890	100.1	1
LG&E	C1S	890338	05/2014	04/23/2014	100.070	99.880	100.1	1
LG&E	C1S	890339	05/2014	04/23/2014	100.080	99.980	100.2	1
LG&E	C1S	890340	05/2014	04/23/2014	100.070	99.930	100.0	1
LG&E	C1S	890341	05/2014	04/23/2014	100.030	99.940	100.0	1
LG&E	C1S	890342	05/2014	04/23/2014	100.100	99.940	100.0	1
LG&E	C1S	890343	05/2014	04/23/2014	100.080	99.930	100.0	1
LG&E	C1S	890344	05/2014	04/23/2014	100.100	99.960	100.1	1
LG&E	C1S	890345	05/2014	04/23/2014	100.060	99.930	100.0	1

LG&E	C1S	890346	05/2014	04/23/2014	100.060	99.910	100.0	1
LG&E	C1S	890347	05/2014	04/23/2014	100.070	99.980	100.0	1
LG&E	C1S	890348	05/2014	04/23/2014	100.110	99.930	100.1	1
LG&E	C1S	890349	05/2014	04/23/2014	100.080	99.920	100.0	1
LG&E	C1S	890350	05/2014	04/23/2014	100.090	99.970	100.1	1
LG&E	C1S	890351	05/2014	04/23/2014	100.080	99.910	100.0	1
LG&E	C1S	890352	05/2014	04/23/2014	100.060	99.960	100.0	1
LG&E	C1S	890353	05/2014	04/23/2014	100.050	99.890	100.0	1
LG&E	C1S	890354	05/2014	04/23/2014	100.060	99.960	100.0	1
LG&E	C1S	890355	05/2014	04/23/2014	100.030	99.910	100.0	1
LG&E	C1S	890356	05/2014	04/23/2014	100.080	99.970	100.0	1
LG&E	C1S	890357	05/2014	04/23/2014	100.080	99.930	100.1	1
LG&E	C1S	890358	05/2014	04/23/2014	100.100	99.970	100.1	1
LG&E	C1S	890359	05/2014	04/23/2014	100.080	99.930	100.1	1
LG&E	C1S	890360	05/2014	04/23/2014	100.090	99.890	100.0	1
LG&E	C1S	890361	05/2014	04/23/2014	100.050	99.890	100.0	1
LG&E	C1S	890362	05/2014	04/23/2014	100.090	99.930	99.9	1
LG&E	C1S	890363	05/2014	04/23/2014	100.070	99.970	99.9	1
LG&E	C1S	890364	05/2014	04/23/2014	100.060	99.930	100.0	1
LG&E	C1S	890365	05/2014	04/23/2014	100.070	99.920	100.0	1
LG&E	C1S	890366	05/2014	04/23/2014	100.060	99.910	100.1	1
LG&E	C1S	890367	05/2014	04/23/2014	100.050	99.890	100.0	1
LG&E	C1S	890368	05/2014	04/23/2014	100.060	99.890	100.0	1
LG&E	C1S	890369	05/2014	04/23/2014	100.050	99.920	100.0	1
LG&E	C1S	890370	05/2014	04/23/2014	100.070	99.960	100.0	1
LG&E	C1S	890371	05/2014	04/23/2014	100.090	99.900	100.1	1
LG&E	C1S	890372	05/2014	04/23/2014	100.050	99.910	100.0	1
LG&E	C1S	890373	05/2014	04/23/2014	100.080	99.910	100.0	1
LG&E	C1S	890374	05/2014	04/23/2014	100.100	99.960	100.1	1
LG&E	C1S	890375	05/2014	04/23/2014	100.030	99.820	99.9	1
LG&E	C1S	890376	05/2014	04/23/2014	100.050	99.860	100.0	1
LG&E	C1S	890377	05/2014	04/23/2014	100.060	99.900	100.0	1


LG&E	C1S	890378	05/2014	04/23/2014	100.070	99.960	100.0	1
LG&E	C1S	890379	05/2014	04/23/2014	100.080	99.880	100.0	1
LG&E	C1S	890380	05/2014	04/23/2014	100.100	99.910	100.0	1
LG&E	C1S	890381	05/2014	04/23/2014	100.080	99.890	99.9	1
LG&E	C1S	890382	05/2014	04/23/2014	100.060	99.970	100.0	1
LG&E	C1S	890383	05/2014	04/23/2014	100.060	99.840	100.0	1
LG&E	C1S	890384	05/2014	04/23/2014	100.070	99.920	100.0	1
LG&E	C1S	890385	05/2014	04/23/2014	100.080	99.950	100.0	1
LG&E	C1S	890386	05/2014	04/23/2014	100.070	99.970	100.0	1
LG&E	C1S	890387	05/2014	04/23/2014	100.030	99.930	99.9	1
LG&E	C1S	890388	05/2014	04/23/2014	100.040	99.910	100.0	1
LG&E	C1S	890389	05/2014	04/23/2014	100.100	99.930	100.0	1
LG&E	C1S	890390	05/2014	04/23/2014	100.060	99.930	100.0	1
LG&E	C1S	890391	05/2014	04/23/2014	100.040	99.890	100.0	1
LG&E	C1S	890392	05/2014	04/23/2014	100.050	99.930	100.0	1
LG&E	C1S	890393	05/2014	04/23/2014	100.060	99.910	100.1	1
LG&E	C1S	890394	05/2014	04/23/2014	100.080	99.960	100.1	1
LG&E	C1S	890395	05/2014	04/23/2014	100.050	99.860	100.0	1
LG&E	C1S	890396	05/2014	04/23/2014	100.060	99.870	100.0	1
LG&E	C1S	890397	05/2014	04/23/2014	100.060	99.900	100.1	1
LG&E	C1S	890398	05/2014	04/23/2014	100.060	99.930	100.0	1
LG&E	C1S	890399	05/2014	04/23/2014	100.050	99.870	100.0	1
LG&E	C1S	890400	05/2014	04/23/2014	100.090	99.880	100.1	1
LG&E	C1S	890401	05/2014	04/23/2014	100.110	99.930	100.0	1
LG&E	C1S	890402	05/2014	04/23/2014	100.050	99.880	99.9	1
LG&E	C1S	890403	05/2014	04/23/2014	100.050	99.930	100.0	1
LG&E	C1S	890404	05/2014	04/23/2014	100.100	99.970	100.0	1
LG&E	C1S	890405	05/2014	04/23/2014	100.030	99.920	100.0	1
LG&E	C1S	890406	05/2014	04/23/2014	100.040	99.970	100.0	1
LG&E	C1S	890407	05/2014	04/23/2014	100.090	99.930	100.1	1
LG&E	C1S	890408	05/2014	04/23/2014	100.100	99.940	100.1	1
LG&E	C1S	890409	05/2014	04/23/2014	100.080	99.960	100.0	1

LG&E	C1S	890410	05/2014	04/23/2014	100.060	99.910	100.0	1
LG&E	C1S	890411	05/2014	04/23/2014	100.080	99.960	100.0	1
LG&E	C1S	890412	05/2014	04/23/2014	100.090	100.010	100.1	1
LG&E	C1S	890413	05/2014	04/23/2014	100.070	99.970	100.1	1
LG&E	C1S	890414	05/2014	04/23/2014	100.070	99.840	100.0	1
LG&E	C1S	890415	05/2014	04/23/2014	100.070	99.910	100.0	1
LG&E	C1S	890416	05/2014	04/23/2014	100.060	99.870	100.0	1
LG&E	C1S	890417	05/2014	04/23/2014	100.070	99.940	99.9	1
LG&E	C1S	890418	05/2014	04/23/2014	100.030	99.820	99.9	1
LG&E	C1S	890419	05/2014	04/23/2014	100.040	99.860	100.1	1
LG&E	C1S	890420	05/2014	04/23/2014	100.060	99.870	100.1	1
LG&E	C1S	890421	05/2014	04/23/2014	100.050	99.930	100.0	1
LG&E	C1S	890422	05/2014	04/23/2014	100.060	99.930	100.0	1
LG&E	C1S	890423	05/2014	04/23/2014	100.070	99.900	100.0	1
LG&E	C1S	890424	05/2014	04/23/2014	100.040	99.880	100.0	1
LG&E	C1S	890425	05/2014	04/23/2014	100.060	99.880	100.0	1
LG&E	C1S	890426	05/2014	04/23/2014	100.050	99.870	100.0	1
LG&E	C1S	890427	05/2014	04/23/2014	100.050	99.860	100.0	1
LG&E	C1S	890428	05/2014	04/23/2014	100.070	99.940	100.0	1
LG&E	C1S	890429	05/2014	04/23/2014	100.070	99.940	100.0	1
LG&E	C1S	890430	05/2014	04/23/2014	100.030	99.870	99.9	1
LG&E	C1S	890431	05/2014	04/23/2014	100.080	99.870	100.0	1
LG&E	C1S	890432	05/2014	04/23/2014	100.070	99.890	100.0	1
LG&E	C1S	890433	05/2014	04/23/2014	100.080	99.970	100.0	1
LG&E	C1S	890434	05/2014	04/23/2014	100.070	99.950	100.0	1
LG&E	C1S	890435	05/2014	04/23/2014	100.060	99.980	100.0	1
LG&E	C1S	890436	05/2014	04/23/2014	100.080	99.890	100.1	1
LG&E	C1S	890437	05/2014	04/23/2014	100.050	99.860	100.0	1
LG&E	C1S	890438	05/2014	04/23/2014	100.060	99.930	100.0	1
LG&E	C1S	890439	05/2014	04/23/2014	100.050	99.890	99.9	1
LG&E	C1S	890440	05/2014	04/23/2014	100.030	99.850	100.0	1
LG&E	C1S	890441	05/2014	04/23/2014	100.060	99.900	100.0	1

LG&E	C1S	890442	05/2014	04/23/2014	100.040	99.850	100.0	1
LG&E	C1S	890443	05/2014	04/23/2014	100.070	99.970	100.0	1
LG&E	C1S	890444	05/2014	04/23/2014	100.100	99.960	100.1	1
LG&E	C1S	890445	05/2014	04/23/2014	100.050	99.910	100.0	1
LG&E	C1S	890446	05/2014	04/23/2014	100.100	99.970	100.1	1
LG&E	C1S	890447	05/2014	04/23/2014	100.110	99.900	100.1	1
LG&E	C1S	890448	05/2014	04/23/2014	100.070	99.880	100.0	1
LG&E	C1S	890449	05/2014	04/23/2014	100.090	99.910	100.0	1
LG&E	C1S	890450	05/2014	04/23/2014	100.110	99.990	100.1	1
LG&E	C1S	890451	05/2014	04/23/2014	100.090	99.980	100.1	1
LG&E	C1S	890452	05/2014	04/23/2014	100.060	99.890	100.0	1
LG&E	C1S	890453	05/2014	04/23/2014	100.050	99.880	100.0	1
LG&E	C1S	890454	05/2014	04/23/2014	100.100	99.950	100.1	1
LG&E	C1S	890455	05/2014	04/23/2014	100.090	99.880	100.0	1
LG&E	C1S	890456	05/2014	04/23/2014	100.090	99.900	100.0	1
LG&E	C1S	890457	05/2014	04/23/2014	100.060	99.900	100.0	1
LG&E	C1S	890458	05/2014	04/23/2014	100.070	99.840	100.0	1
LG&E	C1S	890459	05/2014	04/23/2014	100.100	99.940	100.1	1
LG&E	C1S	890460	05/2014	04/23/2014	100.090	99.960	100.0	1
LG&E	C1S	890461	05/2014	04/23/2014	100.070	99.840	99.9	1
LG&E	C1S	890462	05/2014	04/23/2014	100.110	99.900	100.1	1
LG&E	C1S	890463	05/2014	04/23/2014	100.080	99.900	99.9	1
LG&E	C1S	890464	05/2014	04/23/2014	100.090	99.880	100.0	1
LG&E	C1S	890465	05/2014	04/23/2014	100.080	99.950	100.0	1
LG&E	C1S	890466	05/2014	04/23/2014	100.040	99.900	100.0	1
LG&E	C1S	890467	05/2014	04/23/2014	100.100	99.950	100.0	1
LG&E	C1S	890468	05/2014	04/23/2014	100.060	99.970	99.9	1
LG&E	C1S	890469	05/2014	04/23/2014	100.080	100.010	100.1	1
LG&E	C1S	890470	05/2014	04/23/2014	100.090	99.940	100.1	1
LG&E	C1S	890471	05/2014	04/23/2014	100.050	99.880	100.0	1
LG&E	C1S	890472	05/2014	04/23/2014	100.050	99.800	100.0	1
LG&E	C1S	890473	05/2014	04/23/2014	100.060	99.920	100.0	1

LG&E	C1S	890474	05/2014	04/23/2014	100.050	99.890	100.0	1
LG&E	C1S	890475	05/2014	04/23/2014	100.060	99.870	100.0	1
LG&E	C1S	890476	05/2014	04/23/2014	100.080	100.020	100.0	1
LG&E	C1S	890477	05/2014	04/23/2014	100.060	99.910	100.0	1
LG&E	C1S	890478	05/2014	04/23/2014	100.050	99.890	100.0	1
LG&E	C1S	890479	05/2014	04/23/2014	100.070	99.890	100.1	1
LG&E	C1S	890480	05/2014	04/23/2014	100.080	99.900	99.9	1
LG&E	C1S	890481	05/2014	04/23/2014	100.030	99.870	100.0	1
LG&E	C1S	890482	05/2014	04/23/2014	100.060	99.920	100.0	1
LG&E	C1S	890483	05/2014	04/23/2014	100.100	99.920	100.1	1
LG&E	C1S	890484	05/2014	04/23/2014	100.070	99.890	100.1	1
LG&E	C1S	890485	05/2014	04/23/2014	100.090	99.900	100.1	1
LG&E	C1S	890486	05/2014	04/23/2014	100.070	99.980	100.0	1
LG&E	C1S	890487	05/2014	04/23/2014	100.060	99.930	100.0	1
LG&E	C1S	890488	05/2014	04/23/2014	100.060	99.900	100.0	1
LG&E	C1S	890489	05/2014	04/23/2014	100.080	99.980	100.0	1
LG&E	C1S	890490	05/2014	04/23/2014	100.090	99.940	100.0	1
LG&E	C1S	890491	05/2014	04/23/2014	100.060	99.960	100.0	1
LG&E	C1S	890492	05/2014	04/23/2014	100.080	99.900	100.0	1
LG&E	C1S	890493	05/2014	04/23/2014	100.090	99.960	100.1	1
LG&E	C1S	890494	05/2014	04/23/2014	100.080	99.950	100.1	1
LG&E	C1S	890495	05/2014	04/23/2014	100.080	99.890	100.0	1
LG&E	C1S	890496	05/2014	04/23/2014	100.060	99.910	100.0	1
LG&E	C1S	890497	05/2014	04/23/2014	100.070	99.870	100.0	1
LG&E	C1S	890498	05/2014	04/23/2014	100.090	99.940	100.0	1
LG&E	C1S	890499	05/2014	04/23/2014	100.100	100.020	100.1	1
LG&E	C1S	890500	05/2014	04/23/2014	100.100	99.940	100.0	1
LG&E	C1S	890501	05/2014	04/23/2014	100.070	99.900	99.9	1
LG&E	C1S	890502	05/2014	04/23/2014	100.070	100.000	100.0	1
LG&E	C1S	890503	05/2014	04/23/2014	100.060	99.920	100.0	1
LG&E	C1S	890504	05/2014	04/23/2014	100.090	99.950	100.0	1
LG&E	C1S	890505	05/2014	04/23/2014	100.060	99.890	100.0	1

LG&E	C1S	890506	05/2014	04/23/2014	100.070	99.870	100.0	1
LG&E	C1S	890507	05/2014	04/23/2014	100.060	99.900	100.0	1
LG&E	C1S	890508	05/2014	04/23/2014	100.050	99.840	100.0	1
LG&E	C1S	890509	05/2014	04/23/2014	100.050	99.900	99.9	1
LG&E	C1S	890510	05/2014	04/23/2014	100.070	99.880	100.0	1
LG&E	C1S	890511	05/2014	04/23/2014	100.050	99.880	100.0	1
LG&E	C1S	890512	05/2014	04/23/2014	100.100	99.970	100.0	1
LG&E	C1S	890513	05/2014	04/23/2014	100.090	99.940	100.1	1
LG&E	C1S	890514	05/2014	04/23/2014	100.060	99.950	100.0	1
LG&E	C1S	890515	05/2014	04/23/2014	100.050	99.880	100.0	1
LG&E	C1S	890516	05/2014	04/23/2014	100.060	99.880	100.0	1
LG&E	C1S	890517	05/2014	04/23/2014	100.040	99.870	100.0	1
LG&E	C1S	890518	05/2014	04/23/2014	100.060	99.880	99.9	1
LG&E	C1S	890519	05/2014	04/23/2014	100.070	99.950	100.0	1
LG&E	C1S	890520	05/2014	04/23/2014	100.040	99.950	99.9	1
LG&E	C1S	890521	05/2014	04/23/2014	100.090	99.960	100.1	1
LG&E	C1S	890522	05/2014	04/23/2014	100.090	99.970	100.0	1
LG&E	C1S	890523	05/2014	04/23/2014	100.060	99.980	100.0	1
LG&E	C1S	890524	05/2014	04/23/2014	100.080	99.910	100.0	1
LG&E	C1S	890525	05/2014	04/23/2014	100.070	99.890	100.0	1
LG&E	C1S	890526	05/2014	04/23/2014	100.060	99.920	100.1	1
LG&E	C1S	890527	05/2014	04/23/2014	100.080	99.900	100.0	1
LG&E	C1S	890528	05/2014	04/23/2014	100.060	99.910	100.1	1
LG&E	C1S	890529	05/2014	04/23/2014	100.100	99.890	100.1	1
LG&E	C1S	890530	05/2014	04/23/2014	100.100	99.970	100.0	1
LG&E	C1S	890531	05/2014	04/23/2014	100.080	99.910	100.1	1
LG&E	C1S	890532	05/2014	04/23/2014	100.070	99.890	100.0	1
LG&E	C1S	890533	05/2014	04/23/2014	100.050	99.930	100.0	1
LG&E	C1S	890534	05/2014	04/23/2014	100.060	99.910	100.0	1
LG&E	C1S	890535	05/2014	04/23/2014	100.070	99.890	100.0	1
LG&E	C1S	890536	05/2014	04/23/2014	100.100	99.980	100.1	1
LG&E	C1S	890537	05/2014	04/23/2014	100.090	99.930	100.1	1

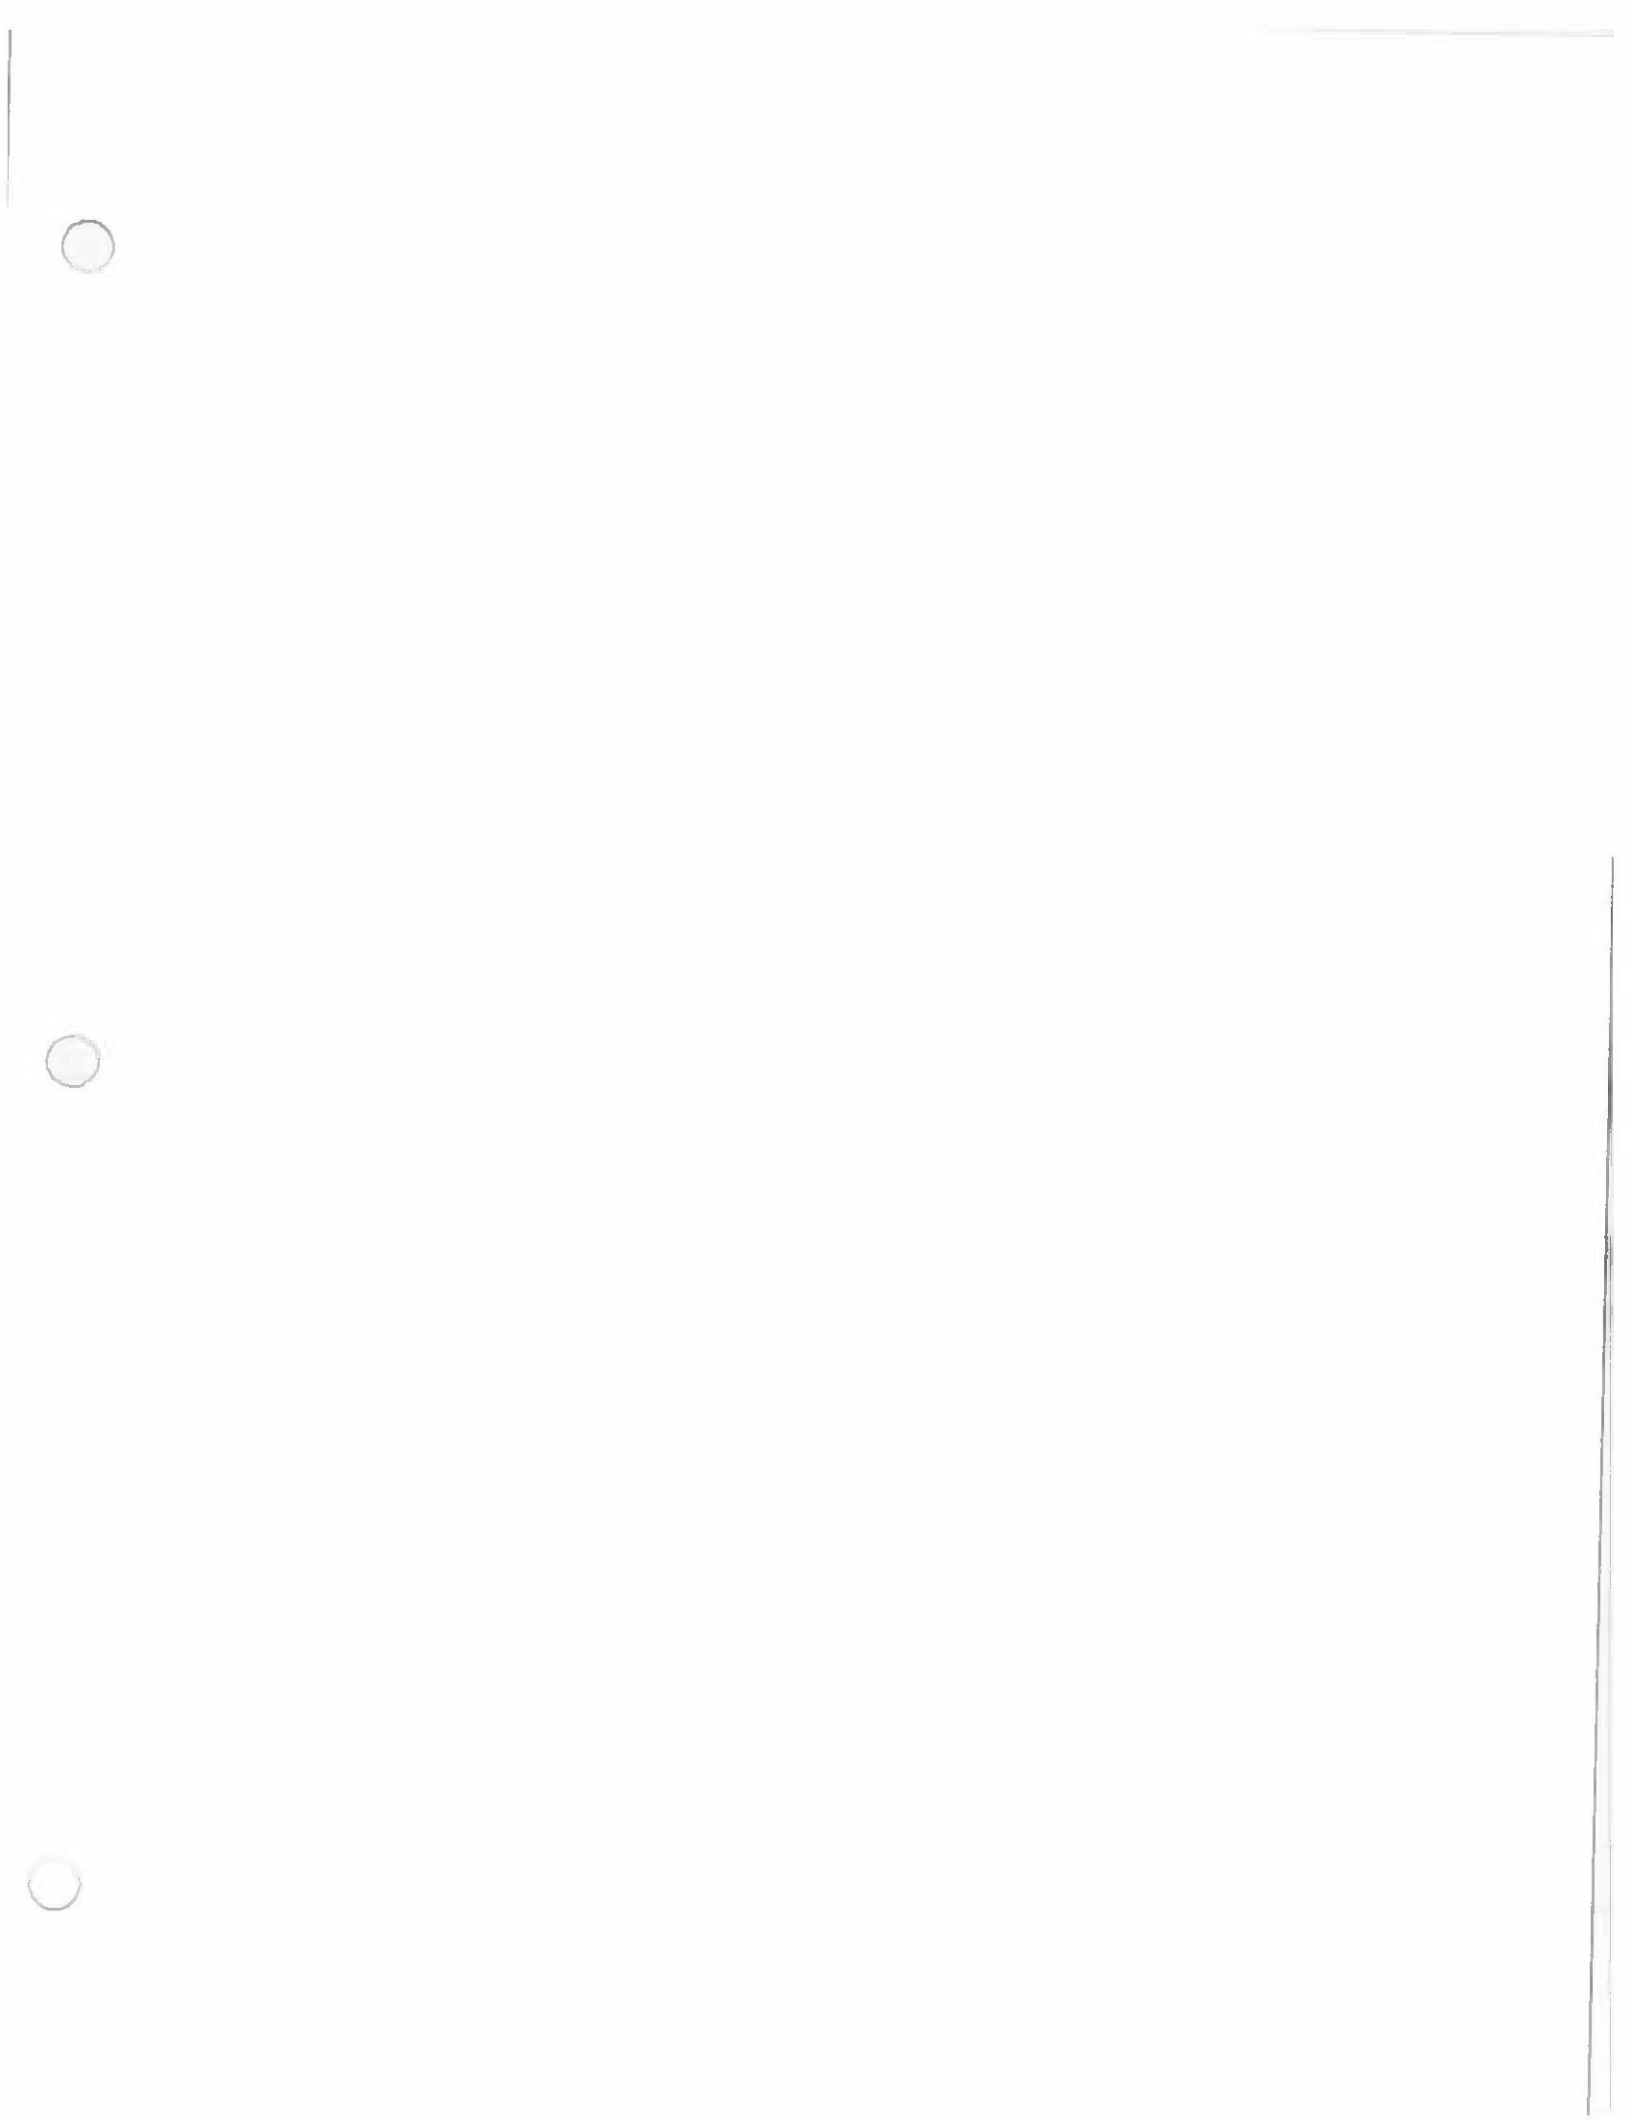

LG&E	C1S	890538	05/2014	04/23/2014	100.060	99.870	100.0	1
LG&E	C1S	890539	05/2014	04/23/2014	100.070	99.910	100.0	1
LG&E	C1S	890540	05/2014	04/23/2014	100.040	99.880	100.0	1
LG&E	C1S	890541	05/2014	04/23/2014	100.060	99.910	99.9	1
LG&E	C1S	890542	05/2014	04/23/2014	100.060	99.880	99.9	1
LG&E	C1S	890543	05/2014	04/23/2014	100.070	99.890	100.0	1
LG&E	C1S	890544	05/2014	04/23/2014	100.090	99.930	100.0	1
LG&E	C1S	890545	05/2014	04/23/2014	100.040	99.890	100.0	1
LG&E	C1S	890546	05/2014	04/23/2014	100.080	99.960	100.0	1
LG&E	C1S	890547	05/2014	04/23/2014	100.090	99.960	100.0	1
LG&E	C1S	890548	05/2014	04/23/2014	100.060	99.930	100.0	1
LG&E	C1S	890549	05/2014	04/23/2014	100.060	99.860	100.0	1
LG&E	C1S	890550	05/2014	04/23/2014	100.040	99.900	100.0	1
LG&E	C1S	890551	05/2014	04/23/2014	100.030	99.870	99.9	1
LG&E	C1S	890552	05/2014	04/23/2014	100.070	99.880	100.1	1
LG&E	C1S	890553	05/2014	04/23/2014	100.060	99.940	100.0	1
LG&E	C1S	890554	05/2014	04/23/2014	100.030	99.900	100.0	1
LG&E	C1S	890555	05/2014	04/23/2014	100.050	99.930	100.0	1
LG&E	C1S	890556	05/2014	04/23/2014	100.070	99.870	100.0	1
LG&E	C1S	890557	05/2014	04/23/2014	100.030	99.850	100.0	1
LG&E	C1S	890558	05/2014	04/23/2014	100.070	99.940	100.0	1
LG&E	C1S	890559	05/2014	04/23/2014	100.100	99.960	100.0	1
LG&E	C1S	890560	05/2014	04/23/2014	100.030	99.870	100.0	1
LG&E	C1S	890561	05/2014	04/23/2014	100.080	99.930	100.0	1
LG&E	C1S	890562	05/2014	04/23/2014	100.070	100.000	100.0	1
LG&E	C1S	890563	05/2014	04/23/2014	100.080	99.930	100.0	1
LG&E	C1S	890564	05/2014	04/23/2014	100.100	99.910	100.0	1
LG&E	C1S	890565	05/2014	04/23/2014	100.070	99.920	100.0	1
LG&E	C1S	890566	05/2014	04/23/2014	100.040	99.890	100.0	1
LG&E	C1S	890567	05/2014	04/23/2014	100.070	99.900	100.0	1
LG&E	C1S	890568	05/2014	04/23/2014	100.030	99.880	100.0	1
LG&E	C1S	890569	05/2014	04/23/2014	100.100	99.970	99.9	1

LG&E	C1S	890570	05/2014	04/23/2014	100.050	99.870	100.0	1
LG&E	C1S	890571	05/2014	04/23/2014	100.060	99.900	100.1	1
LG&E	C1S	890572	05/2014	04/23/2014	100.060	99.890	100.0	1
LG&E	C1S	890573	05/2014	04/23/2014	100.090	99.900	100.1	1
LG&E	C1S	890574	05/2014	04/23/2014	100.060	99.940	99.9	1
LG&E	C1S	890575	05/2014	04/23/2014	100.060	99.930	100.0	1
LG&E	C1S	890576	05/2014	04/23/2014	100.070	99.940	100.1	1
LG&E	C1S	890577	05/2014	04/23/2014	100.040	99.850	100.0	1
LG&E	C1S	890578	05/2014	04/23/2014	100.050	99.900	99.9	1
LG&E	C1S	890579	05/2014	04/23/2014	100.110	99.950	100.0	1
LG&E	C1S	890580	05/2014	04/23/2014	100.090	99.920	100.1	1
LG&E	C1S	890581	05/2014	04/23/2014	100.070	99.870	100.1	1
LG&E	C1S	890582	05/2014	04/23/2014	100.060	99.950	100.0	1
LG&E	C1S	890583	05/2014	04/23/2014	100.070	99.970	100.0	1
LG&E	C1S	890584	05/2014	04/23/2014	100.080	99.920	100.1	1
LG&E	C1S	890585	05/2014	04/23/2014	100.030	99.870	100.0	1
LG&E	C1S	890586	05/2014	04/23/2014	100.070	99.850	100.0	1
LG&E	C1S	890587	05/2014	04/23/2014	100.050	99.920	100.0	1
LG&E	C1S	890588	05/2014	04/23/2014	100.070	99.990	100.0	1
LG&E	C1S	890589	05/2014	04/23/2014	100.100	99.940	100.1	1
LG&E	C1S	890590	05/2014	04/23/2014	100.040	99.910	99.9	1
LG&E	C1S	890591	05/2014	04/23/2014	100.040	99.840	100.0	1
LG&E	C1S	890592	05/2014	04/23/2014	100.060	99.970	100.1	1
LG&E	C1S	890593	05/2014	04/23/2014	100.080	100.010	100.0	1
LG&E	C1S	890594	05/2014	04/23/2014	100.050	99.870	100.0	1
LG&E	C1S	890595	05/2014	04/23/2014	100.040	99.920	100.0	1
LG&E	C1S	890596	05/2014	04/23/2014	100.050	99.940	100.1	1
LG&E	C1S	890597	05/2014	04/23/2014	100.080	99.900	100.0	1
LG&E	C1S	890598	05/2014	04/23/2014	100.040	99.940	100.0	1
LG&E	C1S	890599	05/2014	04/23/2014	100.060	99.830	100.0	1
LG&E	C1S	890600	05/2014	04/23/2014	100.030	99.950	100.0	1
LG&E	C1S	890601	05/2014	04/23/2014	100.080	99.950	100.1	1

LG&E	C1S	890602	05/2014	04/23/2014	100.100	99.920	100.1	1
LG&E	C1S	890603	05/2014	04/23/2014	100.050	99.890	100.0	1
LG&E	C1S	890604	05/2014	04/23/2014	100.100	99.910	100.1	1
LG&E	C1S	890605	05/2014	04/23/2014	100.060	99.880	100.0	1
LG&E	C1S	890606	05/2014	04/23/2014	100.070	99.910	100.0	1
LG&E	C1S	890607	05/2014	04/23/2014	100.050	99.930	100.0	1
LG&E	C1S	890608	05/2014	04/23/2014	100.090	99.990	100.0	1
LG&E	C1S	890609	05/2014	04/23/2014	100.080	99.900	100.1	1
LG&E	C1S	890610	05/2014	04/23/2014	100.080	99.890	100.1	1
LG&E	C1S	890611	05/2014	04/23/2014	100.070	100.020	100.0	1
LG&E	C1S	890612	05/2014	04/23/2014	100.080	100.010	100.1	1
LG&E	C1S	890613	05/2014	04/23/2014	100.050	99.900	100.0	1
LG&E	C1S	890614	05/2014	04/23/2014	100.100	100.040	100.1	1
LG&E	C1S	890615	05/2014	04/23/2014	100.050	99.870	99.9	1
LG&E	C1S	890616	05/2014	04/23/2014	100.080	99.920	100.0	1
LG&E	C1S	890617	05/2014	04/23/2014	100.070	99.950	100.0	1
LG&E	C1S	890618	05/2014	04/23/2014	100.050	99.910	100.0	1
LG&E	C1S	890619	05/2014	04/23/2014	100.030	99.850	100.0	1
LG&E	C1S	890620	05/2014	04/23/2014	100.100	99.950	100.0	1
LG&E	C1S	890621	05/2014	04/23/2014	100.100	99.950	100.1	1
LG&E	C1S	890622	05/2014	04/23/2014	100.060	99.900	100.1	1
LG&E	C1S	890623	05/2014	04/23/2014	100.110	99.930	100.1	1
LG&E	C1S	890624	05/2014	04/23/2014	100.050	99.870	100.0	1
LG&E	C1S	890625	05/2014	04/23/2014	100.050	99.840	100.1	1
LG&E	C1S	890626	05/2014	04/23/2014	100.070	99.950	100.1	1
LG&E	C1S	890627	05/2014	04/23/2014	100.070	99.960	100.0	1
LG&E	C1S	890628	05/2014	04/23/2014	100.100	99.940	100.1	1
LG&E	C1S	890629	05/2014	04/23/2014	100.040	99.910	100.0	1
LG&E	C1S	890630	05/2014	04/23/2014	100.060	99.980	100.1	1
LG&E	C1S	890631	05/2014	04/23/2014	100.100	99.990	100.0	1
LG&E	C1S	890632	05/2014	04/23/2014	100.050	99.900	100.0	1
LG&E	C1S	890633	05/2014	04/23/2014	100.050	99.970	100.0	1

LG&E	C1S	890634	05/2014	04/23/2014	100.100	99.980	100.1	1
LG&E	C1S	890635	05/2014	04/23/2014	100.040	99.870	100.0	1
LG&E	C1S	890636	05/2014	04/23/2014	100.090	99.930	100.0	1
LG&E	C1S	890637	05/2014	04/23/2014	100.060	99.930	99.9	1
LG&E	C1S	890638	05/2014	04/23/2014	100.040	99.860	100.0	1
LG&E	C1S	890639	05/2014	04/23/2014	100.070	99.940	100.0	1
LG&E	C1S	890640	05/2014	04/23/2014	100.070	99.910	100.0	1
LG&E	C1S	890641	05/2014	04/23/2014	100.080	99.930	100.0	1
LG&E	C1S	890642	05/2014	04/23/2014	100.070	99.920	100.1	1
LG&E	C1S	890643	05/2014	04/23/2014	100.050	99.890	100.0	1
LG&E	C1S	890644	05/2014	04/23/2014	100.100	99.970	100.0	1
LG&E	C1S	890645	05/2014	04/23/2014	100.050	99.880	99.9	1
LG&E	C1S	890646	05/2014	04/23/2014	100.060	99.900	99.9	1
LG&E	C1S	890647	05/2014	04/23/2014	100.080	99.880	100.0	1
LG&E	C1S	890648	05/2014	04/23/2014	100.060	99.950	99.9	1
LG&E	C1S	890649	05/2014	04/23/2014	100.060	99.980	100.0	1
LG&E	C1S	890650	05/2014	04/23/2014	100.050	99.890	100.0	1
LG&E	C1S	890651	05/2014	04/23/2014	100.100	99.920	100.1	1
LG&E	C1S	890652	05/2014	04/23/2014	100.070	99.920	100.1	1
LG&E	C1S	890653	05/2014	04/23/2014	100.090	99.970	100.0	1
LG&E	C1S	890654	05/2014	04/23/2014	100.070	99.950	100.0	1
LG&E	C1S	890655	05/2014	04/23/2014	100.060	99.870	100.0	1
LG&E	C1S	890656	05/2014	04/23/2014	100.070	99.900	100.0	1
LG&E	C1S	890657	05/2014	04/23/2014	100.080	100.000	100.0	1
LG&E	C1S	890658	05/2014	04/23/2014	100.080	99.900	100.0	1
LG&E	C1S	890659	05/2014	04/23/2014	100.060	99.890	100.0	1
LG&E	C1S	890660	05/2014	04/23/2014	100.050	99.950	100.0	1
LG&E	C1S	890661	05/2014	04/23/2014	100.040	99.900	100.0	1
LG&E	C1S	890662	05/2014	04/23/2014	100.050	99.900	100.1	1
LG&E	C1S	890663	05/2014	04/23/2014	100.060	99.890	100.1	1
LG&E	C1S	890664	05/2014	04/23/2014	100.030	99.830	100.0	1
LG&E	C1S	890665	05/2014	04/23/2014	100.050	99.840	100.0	1

LG&E	C1S	890666	05/2014	04/23/2014	100.070	99.940	100.0	1
LG&E	C1S	890667	05/2014	04/23/2014	100.060	99.880	100.0	1
LG&E	C1S	890668	05/2014	04/23/2014	100.060	99.880	100.0	1
LG&E	C1S	890669	05/2014	04/23/2014	100.040	99.870	100.0	1
LG&E	C1S	890670	05/2014	04/23/2014	100.080	99.960	100.0	1
LG&E	C1S	890671	05/2014	04/23/2014	100.080	99.870	100.0	1
LG&E	C1S	890672	05/2014	04/23/2014	100.050	99.920	100.0	1
LG&E	C1S	890673	05/2014	04/23/2014	100.070	99.930	100.0	1
LG&E	C1S	890674	05/2014	04/23/2014	100.060	99.830	100.0	1
LG&E	C1S	890675	05/2014	04/23/2014	100.080	99.960	100.1	1
LG&E	C1S	890676	05/2014	04/23/2014	100.040	99.890	100.0	1
LG&E	C1S	890677	05/2014	04/23/2014	100.060	99.950	100.1	1
LG&E	C1S	890678	05/2014	04/23/2014	100.070	99.920	100.0	1
LG&E	C1S	890679	05/2014	04/23/2014	100.070	99.970	100.0	1
LG&E	C1S	890680	05/2014	04/23/2014	100.080	99.940	100.0	1
LG&E	C1S	890681	05/2014	04/23/2014	100.030	99.850	99.9	1
LG&E	C1S	890682	05/2014	04/23/2014	100.100	99.970	100.1	1
LG&E	C1S	890683	05/2014	04/23/2014	100.040	99.900	100.0	1
LG&E	C1S	890684	05/2014	04/23/2014	100.050	99.920	100.0	1
LG&E	C1S	890685	05/2014	04/23/2014	100.070	99.870	100.1	1
LG&E	C1S	890686	05/2014	04/23/2014	100.070	99.920	100.0	1
LG&E	C1S	890687	05/2014	04/23/2014	100.090	99.930	100.1	1
LG&E	C1S	890688	05/2014	04/23/2014	100.060	99.920	100.0	1
LG&E	C1S	890689	05/2014	04/23/2014	100.030	99.870	100.0	1
LG&E	C1S	890690	05/2014	04/23/2014	100.070	99.890	100.1	1
LG&E	C1S	890691	05/2014	04/23/2014	100.040	99.880	99.9	1
LG&E	C1S	890692	05/2014	04/23/2014	100.080	99.970	100.0	1
LG&E	C1S	890693	05/2014	04/23/2014	100.090	99.870	100.0	1
LG&E	C1S	890694	05/2014	04/23/2014	100.060	99.840	100.0	1
LG&E	C1S	890695	05/2014	04/23/2014	100.070	99.900	100.1	1
LG&E	C1S	890696	05/2014	04/23/2014	100.080	99.870	100.0	1
LG&E	C1S	890697	05/2014	04/23/2014	100.070	99.950	100.0	1

LG&E	890698	C1S	05/2014	04/23/2014	100.080	99.940	100.0	1
LG&E	890699	C1S	05/2014	04/23/2014	100.070	99.920	99.9	1
LG&E	890700	C1S	05/2014	04/23/2014	100.100	99.960	100.1	1
LG&E	890701	C1S	05/2014	04/23/2014	100.090	100.000	100.1	1
LG&E	890702	C1S	05/2014	04/23/2014	100.100	99.900	99.9	1
LG&E	890703	C1S	05/2014	04/23/2014	100.090	99.880	100.0	1
LG&E	890704	C1S	05/2014	04/23/2014	100.080	99.870	100.1	1
LG&E	890705	C1S	05/2014	04/23/2014	100.080	99.890	100.0	1
LG&E	890706	C1S	05/2014	04/23/2014	100.110	100.030	100.1	1
LG&E	890707	C1S	05/2014	04/23/2014	100.100	99.980	100.1	1
LG&E	890708	C1S	05/2014	04/23/2014	100.080	99.900	100.1	1
LG&E	890709	C1S	05/2014	04/23/2014	100.040	99.920	100.0	1
LG&E	890710	C1S	05/2014	04/23/2014	100.080	99.920	100.1	1
LG&E	890711	C1S	05/2014	04/23/2014	100.070	99.930	100.0	1
LG&E	890712	C1S	05/2014	04/23/2014	100.040	99.920	100.0	1
LG&E	890713	C1S	05/2014	04/23/2014	100.030	99.890	100.0	1
LG&E	890714	C1S	05/2014	04/23/2014	100.060	99.900	100.0	1
LG&E	890715	C1S	05/2014	04/23/2014	100.090	99.950	99.9	1
LG&E	890716	C1S	05/2014	04/23/2014	100.100	99.990	100.0	1
LG&E	890717	C1S	05/2014	04/23/2014	100.070	99.930	100.0	1
LG&E	890718	C1S	05/2014	04/23/2014	100.070	99.870	100.0	1
LG&E	890719	C1S	05/2014	04/23/2014	100.050	99.860	100.0	1
LG&E	890720	C1S	05/2014	04/23/2014	100.080	99.950	100.0	1
LG&E	890721	C1S	05/2014	04/23/2014	100.110	99.890	100.1	1
LG&E	890722	C1S	05/2014	04/23/2014	100.090	99.940	100.1	1
LG&E	890723	C1S	05/2014	04/23/2014	100.060	99.890	100.0	1
LG&E	890724	C1S	05/2014	04/23/2014	100.060	99.940	100.1	1
LG&E	890725	C1S	05/2014	04/23/2014	100.050	99.910	100.1	1
LG&E	890726	C1S	05/2014	04/23/2014	100.060	99.930	100.0	1
LG&E	890727	C1S	05/2014	04/23/2014	100.070	99.970	100.0	1
LG&E	890728	C1S	05/2014	04/23/2014	100.040	99.840	100.0	1
LG&E	890729	C1S	05/2014	04/23/2014	100.060	99.830	99.9	1

LG&E	890730	C1S	05/2014	04/23/2014	100.060	99.880	100.0	1
LG&E	890731	C1S	05/2014	04/23/2014	100.050	99.890	100.0	1
LG&E	890732	C1S	05/2014	04/23/2014	100.090	99.940	100.1	1
LG&E	890733	C1S	05/2014	04/23/2014	100.070	99.930	100.0	1
LG&E	890734	C1S	05/2014	04/23/2014	100.090	99.890	100.0	1
LG&E	890735	C1S	05/2014	04/23/2014	100.060	99.890	100.0	1
LG&E	890736	C1S	05/2014	04/23/2014	100.050	99.860	100.0	1
LG&E	890737	C1S	05/2014	04/23/2014	100.070	99.890	100.0	1
LG&E	890738	C1S	05/2014	04/23/2014	100.100	99.920	100.1	1
LG&E	890739	C1S	05/2014	04/23/2014	100.060	99.880	99.9	1
LG&E	890740	C1S	05/2014	04/23/2014	100.050	99.860	100.0	1
LG&E	890741	C1S	05/2014	04/23/2014	100.100	100.010	100.1	1
LG&E	890742	C1S	05/2014	04/23/2014	100.090	99.950	100.1	1
LG&E	890743	C1S	05/2014	04/23/2014	100.040	99.900	99.9	1
LG&E	890744	C1S	05/2014	04/23/2014	100.060	99.960	100.0	1
LG&E	890745	C1S	05/2014	04/23/2014	100.090	99.940	100.0	1
LG&E	890746	C1S	05/2014	04/23/2014	100.060	99.920	100.0	1
LG&E	890747	C1S	05/2014	04/23/2014	100.070	99.960	100.1	1
LG&E	890748	C1S	05/2014	04/23/2014	100.110	99.940	100.0	1
LG&E	890749	C1S	05/2014	04/23/2014	100.060	99.860	99.9	1
LG&E	890750	C1S	05/2014	04/23/2014	100.080	99.910	100.1	1
LG&E	890751	C1S	05/2014	04/23/2014	100.100	99.930	100.1	1
LG&E	890752	C1S	05/2014	04/23/2014	100.090	99.920	100.0	1
LG&E	890753	C1S	05/2014	04/23/2014	100.060	99.880	100.0	1
LG&E	890754	C1S	05/2014	04/23/2014	100.060	99.900	99.9	1
LG&E	890755	C1S	05/2014	04/23/2014	100.080	99.890	100.0	1
LG&E	890756	C1S	05/2014	04/23/2014	100.100	99.980	100.0	1
LG&E	890757	C1S	05/2014	04/23/2014	100.030	99.830	100.0	1
LG&E	890758	C1S	05/2014	04/23/2014	100.100	99.970	100.0	1
LG&E	890759	C1S	05/2014	04/23/2014	100.030	99.850	100.0	1
LG&E	890760	C1S	05/2014	04/23/2014	100.070	99.910	100.0	1
LG&E	890761	C1S	05/2014	04/23/2014	100.090	99.920	100.0	1

LG&E	C1S	890762	05/2014	04/23/2014	100.060	99.920	100.0	1
LG&E	C1S	890763	05/2014	04/23/2014	100.100	99.960	100.0	1
LG&E	C1S	890764	05/2014	04/23/2014	100.060	99.830	100.0	1
LG&E	C1S	890765	05/2014	04/23/2014	100.050	99.890	100.0	1
LG&E	C1S	890766	05/2014	04/23/2014	100.100	99.980	100.1	1
LG&E	C1S	890767	05/2014	04/23/2014	100.070	99.890	100.0	1
LG&E	C1S	890768	05/2014	04/23/2014	100.100	99.990	100.1	1
LG&E	C1S	890769	05/2014	04/23/2014	100.040	99.940	100.1	1
LG&E	C1S	890770	05/2014	04/23/2014	100.100	99.940	100.0	1
LG&E	C1S	890771	05/2014	04/23/2014	100.090	99.920	100.1	1
LG&E	C1S	890772	05/2014	04/23/2014	100.100	99.910	100.1	1
LG&E	C1S	890773	05/2014	04/23/2014	100.030	99.850	100.0	1
LG&E	C1S	890774	05/2014	04/23/2014	100.080	99.930	100.1	1
LG&E	C1S	890775	05/2014	04/23/2014	100.070	99.910	100.0	1
LG&E	C1S	890776	05/2014	04/23/2014	100.060	99.920	100.0	1
LG&E	C1S	890777	05/2014	04/23/2014	100.040	99.910	100.0	1
LG&E	C1S	890778	05/2014	04/23/2014	100.030	99.840	100.0	1
LG&E	C1S	890779	05/2014	04/23/2014	100.100	99.960	100.1	1
LG&E	C1S	890780	05/2014	04/23/2014	100.040	99.910	100.0	1
LG&E	C1S	890781	05/2014	04/23/2014	100.080	99.900	100.1	1
LG&E	C1S	890782	05/2014	04/23/2014	100.060	99.860	100.1	1
LG&E	C1S	890783	05/2014	04/23/2014	100.030	99.920	100.0	1
LG&E	C1S	890784	05/2014	04/23/2014	100.070	99.850	100.0	1
LG&E	C1S	890785	05/2014	04/23/2014	100.060	99.870	100.1	1
LG&E	C1S	890786	05/2014	04/23/2014	100.060	99.870	99.9	1
LG&E	C1S	890787	05/2014	04/23/2014	100.060	99.900	99.9	1
LG&E	C1S	890788	05/2014	04/23/2014	100.040	99.890	100.0	1
LG&E	C1S	890789	05/2014	04/23/2014	100.090	99.980	100.0	1
LG&E	C1S	890790	05/2014	04/23/2014	100.060	99.890	100.1	1
LG&E	C1S	890791	05/2014	04/23/2014	100.050	99.950	100.0	1
LG&E	C1S	890792	05/2014	04/23/2014	100.070	99.980	100.0	1
LG&E	C1S	890793	05/2014	04/23/2014	100.050	99.930	100.0	1

LG&E	C1S	890794	05/2014	04/23/2014	100.090	100.040	100.1	1
LG&E	C1S	890795	05/2014	04/23/2014	100.070	99.890	100.0	1
LG&E	C1S	890796	05/2014	04/23/2014	100.060	99.830	100.0	1
LG&E	C1S	890797	05/2014	04/23/2014	100.080	99.900	100.1	1
LG&E	C1S	890798	05/2014	04/23/2014	100.070	99.940	100.0	1
LG&E	C1S	890799	05/2014	04/23/2014	100.100	99.970	100.0	1
LG&E	C1S	890800	05/2014	04/23/2014	100.080	99.860	100.1	1
LG&E	C1S	890801	05/2014	04/23/2014	100.080	99.880	100.1	1
LG&E	C1S	890802	05/2014	04/23/2014	100.090	99.970	100.1	1
LG&E	C1S	890803	05/2014	04/23/2014	100.080	99.910	99.9	1
LG&E	C1S	890804	05/2014	04/23/2014	100.060	99.860	99.9	1
LG&E	C1S	890805	05/2014	04/23/2014	100.030	99.870	100.0	1
LG&E	C1S	890806	05/2014	04/23/2014	100.040	99.900	100.0	1
LG&E	C1S	890807	05/2014	04/23/2014	100.070	99.900	100.1	1
LG&E	C1S	890808	05/2014	04/23/2014	100.060	99.910	100.0	1
LG&E	C1S	890809	05/2014	04/23/2014	100.080	99.970	100.0	1
LG&E	C1S	890810	05/2014	04/23/2014	100.080	99.950	99.9	1
LG&E	C1S	890811	05/2014	04/23/2014	100.100	99.920	100.1	1
LG&E	C1S	890812	05/2014	04/23/2014	100.030	99.860	100.0	1
LG&E	C1S	890813	05/2014	04/23/2014	100.050	99.900	100.0	1
LG&E	C1S	890814	05/2014	04/23/2014	100.030	99.940	100.0	1
LG&E	C1S	890815	05/2014	04/23/2014	100.070	99.880	100.0	1
LG&E	C1S	890816	05/2014	04/23/2014	100.080	99.980	100.2	1
LG&E	C1S	890817	05/2014	04/23/2014	100.070	99.890	100.0	1
LG&E	C1S	890818	05/2014	04/23/2014	100.040	99.870	100.0	1
LG&E	C1S	890819	05/2014	04/23/2014	100.070	99.900	100.0	1
LG&E	C1S	890820	05/2014	04/23/2014	100.080	99.870	100.0	1
LG&E	C1S	890821	05/2014	04/23/2014	100.030	99.840	100.0	1
LG&E	C1S	890822	05/2014	04/23/2014	100.080	99.910	100.0	1
LG&E	C1S	890823	05/2014	04/23/2014	100.070	99.890	99.9	1
LG&E	C1S	890824	05/2014	04/23/2014	100.080	99.930	100.1	1
LG&E	C1S	890825	05/2014	04/23/2014	100.100	99.960	100.1	1

LG&E	890826	C1S	05/2014	04/23/2014	100.050	99.860	100.0	1
LG&E	890827	C1S	05/2014	04/23/2014	100.080	99.910	100.1	1
LG&E	890828	C1S	05/2014	04/23/2014	100.070	99.990	100.0	1
LG&E	890829	C1S	05/2014	04/23/2014	100.050	99.910	99.9	1
LG&E	890830	C1S	05/2014	04/23/2014	100.060	99.870	100.0	1
LG&E	890831	C1S	05/2014	04/23/2014	100.090	99.870	100.0	1
LG&E	890832	C1S	05/2014	04/23/2014	100.040	99.910	100.0	1
LG&E	890833	C1S	05/2014	04/23/2014	100.080	99.900	100.0	1
LG&E	890834	C1S	05/2014	04/23/2014	100.050	99.890	100.0	1
LG&E	890835	C1S	05/2014	04/23/2014	100.070	99.930	100.0	1
LG&E	890836	C1S	05/2014	04/23/2014	100.090	99.970	100.1	1
LG&E	890837	C1S	05/2014	04/23/2014	100.050	99.890	100.0	1
LG&E	890838	C1S	05/2014	04/23/2014	100.100	99.960	100.0	1
LG&E	890839	C1S	05/2014	04/23/2014	100.050	99.880	100.0	1
LG&E	890840	C1S	05/2014	04/23/2014	100.060	99.810	100.0	1
LG&E	890841	C1S	05/2014	04/23/2014	100.060	99.910	100.0	1
LG&E	890842	C1S	05/2014	04/23/2014	100.050	99.880	100.0	1
LG&E	890843	C1S	05/2014	04/23/2014	100.090	99.930	100.1	1
LG&E	890844	C1S	05/2014	04/23/2014	100.080	99.880	100.1	1
LG&E	890845	C1S	05/2014	04/23/2014	100.040	99.880	99.9	1
LG&E	890846	C1S	05/2014	04/23/2014	100.050	99.880	99.9	1
LG&E	890847	C1S	05/2014	04/23/2014	100.060	99.930	100.1	1
LG&E	890848	C1S	05/2014	04/23/2014	100.090	99.960	100.0	1
LG&E	890849	C1S	05/2014	04/23/2014	100.060	99.910	100.0	1
LG&E	890850	C1S	05/2014	04/23/2014	100.050	99.930	100.0	1
LG&E	890851	C1S	05/2014	04/23/2014	100.060	99.920	100.0	1
LG&E	890852	C1S	05/2014	04/23/2014	100.070	99.920	100.0	1
LG&E	890853	C1S	05/2014	04/23/2014	100.070	99.940	100.0	1
LG&E	890854	C1S	05/2014	04/23/2014	100.030	99.810	99.9	1
LG&E	890855	C1S	05/2014	04/23/2014	100.070	99.910	100.0	1
LG&E	890856	C1S	05/2014	04/23/2014	100.100	99.910	100.0	1
LG&E	890857	C1S	05/2014	04/23/2014	100.050	99.870	100.0	1

LG&E	C1S	890858	05/2014	04/23/2014	100.100	99.950	100.0	1
LG&E	C1S	890859	05/2014	04/23/2014	100.070	99.930	100.0	1
LG&E	C1S	890860	05/2014	04/23/2014	100.060	99.930	100.1	1
LG&E	C1S	890861	05/2014	04/23/2014	100.070	99.910	100.0	1
LG&E	C1S	890862	05/2014	04/23/2014	100.080	99.870	100.0	1
LG&E	C1S	890863	05/2014	04/23/2014	100.080	99.850	100.0	1
LG&E	C1S	890864	05/2014	04/23/2014	100.040	99.920	100.0	1
LG&E	C1S	890865	05/2014	04/23/2014	100.100	99.940	100.1	1
LG&E	C1S	890866	05/2014	04/23/2014	100.060	99.920	99.9	1
LG&E	C1S	890867	05/2014	04/23/2014	100.060	99.940	100.1	1
LG&E	C1S	890868	05/2014	04/23/2014	100.060	99.910	100.0	1
LG&E	C1S	890869	05/2014	04/23/2014	100.090	99.900	100.0	1
LG&E	C1S	890870	05/2014	04/23/2014	100.080	100.000	100.0	1
LG&E	C1S	890871	05/2014	04/23/2014	100.040	99.870	100.0	1
LG&E	C1S	890872	05/2014	04/23/2014	100.080	99.950	100.1	1
LG&E	C1S	890873	05/2014	04/23/2014	100.030	99.840	100.0	1
LG&E	C1S	890874	05/2014	04/23/2014	100.040	99.880	100.0	1
LG&E	C1S	890875	05/2014	04/23/2014	100.080	99.970	100.0	1
LG&E	C1S	890876	05/2014	04/23/2014	100.100	99.920	100.0	1
LG&E	C1S	890877	05/2014	04/23/2014	100.070	99.890	100.1	1
LG&E	C1S	890878	05/2014	04/23/2014	100.090	99.940	100.1	1
LG&E	C1S	890879	05/2014	04/23/2014	100.080	99.990	100.0	1
LG&E	C1S	890880	05/2014	04/23/2014	100.080	99.940	100.0	1
LG&E	C1S	890881	05/2014	04/23/2014	100.060	99.930	100.0	1
LG&E	C1S	890882	05/2014	04/23/2014	100.100	99.890	99.9	1
LG&E	C1S	890883	05/2014	04/23/2014	100.080	99.940	100.1	1
LG&E	C1S	890884	05/2014	04/23/2014	100.050	99.910	100.1	1
LG&E	C1S	890885	05/2014	04/23/2014	100.070	99.910	100.0	1
LG&E	C1S	890886	05/2014	04/23/2014	100.090	99.960	100.1	1
LG&E	C1S	890887	05/2014	04/23/2014	100.100	99.900	100.1	1
LG&E	C1S	890888	05/2014	04/23/2014	100.060	99.860	100.0	1
LG&E	C1S	890889	05/2014	04/23/2014	100.100	99.930	100.0	1

LG&E	C1S	890890	05/2014	04/23/2014	100.080	99.890	100.0	1
LG&E	C1S	890891	05/2014	04/23/2014	100.070	99.950	100.0	1
LG&E	C1S	890892	05/2014	04/23/2014	100.110	99.990	100.1	1
LG&E	C1S	890893	05/2014	04/23/2014	100.100	99.970	100.2	1
LG&E	C1S	890894	05/2014	04/23/2014	100.070	99.930	100.0	1
LG&E	C1S	890895	05/2014	04/23/2014	100.080	99.890	100.1	1
LG&E	C1S	890896	05/2014	04/23/2014	100.070	99.990	100.0	1
LG&E	C1S	890897	05/2014	04/23/2014	100.100	99.910	100.0	1
LG&E	C1S	890898	05/2014	04/23/2014	100.060	99.930	100.1	1
LG&E	C1S	890899	05/2014	04/23/2014	100.100	99.930	100.0	1
LG&E	C1S	890900	05/2014	04/23/2014	100.060	99.910	100.1	1
LG&E	C1S	890901	05/2014	04/23/2014	100.030	99.880	100.0	1
LG&E	C1S	890902	05/2014	04/23/2014	100.030	99.810	100.0	1
LG&E	C1S	890903	05/2014	04/23/2014	100.050	99.930	100.0	1
LG&E	C1S	890904	05/2014	04/23/2014	100.080	99.920	100.0	1
LG&E	C1S	890905	05/2014	04/23/2014	100.030	99.870	99.9	1
LG&E	C1S	890906	05/2014	04/23/2014	100.090	99.970	100.1	1
LG&E	C1S	890907	05/2014	04/23/2014	100.040	99.880	100.0	1
LG&E	C1S	890908	05/2014	04/23/2014	100.080	99.860	100.0	1
LG&E	C1S	890909	05/2014	04/23/2014	100.090	99.960	100.0	1
LG&E	C1S	890910	05/2014	04/23/2014	100.050	99.910	100.0	1
LG&E	C1S	890911	05/2014	04/23/2014	100.090	99.940	100.0	1
LG&E	C1S	890912	05/2014	04/23/2014	100.030	99.820	100.0	1
LG&E	C1S	890913	05/2014	04/23/2014	100.070	99.910	100.0	1
LG&E	C1S	890914	05/2014	04/23/2014	100.090	99.940	100.0	1
LG&E	C1S	890915	05/2014	04/23/2014	100.100	100.000	100.0	1
LG&E	C1S	890916	05/2014	04/23/2014	100.080	99.890	100.0	1
LG&E	C1S	890917	05/2014	04/23/2014	100.080	99.880	100.0	1
LG&E	C1S	890918	05/2014	04/23/2014	100.100	99.830	100.1	1
LG&E	C1S	890919	05/2014	04/23/2014	100.060	99.920	100.0	1
LG&E	C1S	890920	05/2014	04/23/2014	100.060	99.860	100.1	1
LG&E	C1S	890921	05/2014	04/23/2014	100.100	99.910	100.0	1

LG&E	C1S	890922	05/2014	04/23/2014	100.080	99.940	100.0	1
LG&E	C1S	890923	05/2014	04/23/2014	100.070	99.930	99.9	1
LG&E	C1S	890924	05/2014	04/23/2014	100.070	100.010	99.9	1
LG&E	C1S	890925	05/2014	04/23/2014	100.070	99.870	100.1	1
LG&E	C1S	890926	05/2014	04/23/2014	100.080	99.940	100.1	1
LG&E	C1S	890927	05/2014	04/23/2014	100.030	99.920	100.0	1
LG&E	C1S	890928	05/2014	04/23/2014	100.040	99.880	99.9	1
LG&E	C1S	890929	05/2014	04/23/2014	100.100	100.000	100.1	1
LG&E	C1S	890930	05/2014	04/23/2014	100.060	99.910	100.1	1
LG&E	C1S	890931	05/2014	04/23/2014	100.070	99.940	100.0	1
LG&E	C1S	890932	05/2014	04/23/2014	100.050	99.910	100.0	1
LG&E	C1S	890933	05/2014	04/23/2014	100.080	99.920	100.1	1
LG&E	C1S	890934	05/2014	04/23/2014	100.090	99.880	100.1	1
LG&E	C1S	896679	10/2014	09/30/2014	100.090	99.900	100.0	1
LG&E	C1S	896680	10/2014	09/30/2014	100.100	99.860	100.0	1
LG&E	C1S	896681	10/2014	09/30/2014	100.080	99.900	99.9	1
LG&E	C1S	896682	10/2014	09/30/2014	100.090	99.900	100.0	1
LG&E	C1S	896683	10/2014	09/30/2014	100.080	99.860	99.9	1
LG&E	C1S	896684	10/2014	09/30/2014	100.060	99.860	100.1	1
LG&E	C1S	896685	10/2014	09/30/2014	100.090	99.900	100.0	1
LG&E	C1S	896686	10/2014	09/30/2014	100.100	100.010	100.0	1
LG&E	C1S	896687	10/2014	09/30/2014	100.070	99.890	99.9	1
LG&E	C1S	896688	10/2014	09/30/2014	100.110	99.870	100.0	1
LG&E	C1S	896689	10/2014	09/30/2014	100.090	99.910	100.0	1
LG&E	C1S	896690	10/2014	09/30/2014	100.060	99.910	100.0	1
LG&E	C1S	896691	10/2014	09/30/2014	100.100	99.830	99.9	1
LG&E	C1S	896692	10/2014	09/30/2014	100.070	99.870	100.0	1
LG&E	C1S	896693	10/2014	09/30/2014	100.080	99.920	100.0	1
LG&E	C1S	896694	10/2014	09/30/2014	100.050	99.920	100.0	1
LG&E	C1S	896695	10/2014	09/30/2014	100.080	99.890	100.0	1
LG&E	C1S	896696	10/2014	09/30/2014	100.080	99.900	100.0	1
LG&E	C1S	896697	10/2014	09/30/2014	100.100	99.920	100.0	1

LG&E	C1S	896698	10/2014	09/30/2014	100.100	99.900	100.1	1
LG&E	C1S	896699	10/2014	09/30/2014	100.060	99.910	99.9	1
LG&E	C1S	896700	10/2014	09/30/2014	100.070	99.840	100.0	1
LG&E	C1S	896701	10/2014	09/30/2014	100.100	99.910	99.9	1
LG&E	C1S	896702	10/2014	09/30/2014	100.070	99.860	100.0	1
LG&E	C1S	896703	10/2014	09/30/2014	100.100	99.940	100.0	1
LG&E	C1S	896704	10/2014	09/30/2014	100.090	99.900	100.0	1
LG&E	C1S	896705	10/2014	09/30/2014	100.050	99.810	99.9	1
LG&E	C1S	896706	10/2014	09/30/2014	100.090	99.900	99.9	1
LG&E	C1S	896707	10/2014	09/30/2014	100.090	99.810	100.0	1
LG&E	C1S	896708	10/2014	09/30/2014	100.070	99.970	100.0	1
LG&E	C1S	896709	10/2014	09/30/2014	100.070	99.840	100.0	1
LG&E	C1S	896710	10/2014	09/30/2014	100.090	99.920	99.9	1
LG&E	C1S	896711	10/2014	09/30/2014	100.070	99.810	99.9	1
LG&E	C1S	896712	10/2014	09/30/2014	100.060	99.910	100.0	1
LG&E	C1S	896713	10/2014	09/30/2014	100.110	99.880	100.0	1
LG&E	C1S	896714	10/2014	09/30/2014	100.080	99.980	99.9	1
LG&E	C1S	896715	10/2014	09/30/2014	100.060	99.820	99.9	1
LG&E	C1S	896716	10/2014	09/30/2014	100.100	99.870	100.0	1
LG&E	C1S	896717	10/2014	09/30/2014	100.080	99.820	100.0	1
LG&E	C1S	896718	10/2014	09/30/2014	100.080	99.900	100.0	1
LG&E	C1S	896719	10/2014	09/30/2014	100.060	99.870	100.0	1
LG&E	C1S	896720	10/2014	09/30/2014	100.060	99.910	99.9	1
LG&E	C1S	896721	10/2014	09/30/2014	100.080	99.900	100.0	1
LG&E	C1S	896722	10/2014	09/30/2014	100.080	99.900	99.9	1
LG&E	C1S	896723	10/2014	09/30/2014	100.060	99.950	100.0	1
LG&E	C1S	896724	10/2014	09/30/2014	100.100	99.950	100.1	1
LG&E	C1S	896725	10/2014	09/30/2014	100.080	99.870	100.0	1
LG&E	C1S	896726	10/2014	09/30/2014	100.070	99.910	100.0	1
LG&E	C1S	896727	10/2014	09/30/2014	100.060	99.830	99.9	1
LG&E	C1S	896728	10/2014	09/30/2014	100.090	99.810	100.0	1
LG&E	C1S	896729	10/2014	09/30/2014	100.070	99.920	100.1	1

LG&E	C1S	896730	10/2014	09/30/2014	100.100	99.990	100.0	1
LG&E	C1S	896731	10/2014	09/30/2014	100.080	99.830	99.9	1
LG&E	C1S	896732	10/2014	09/30/2014	100.060	99.960	99.9	1
LG&E	C1S	896733	10/2014	09/30/2014	100.060	99.960	99.9	1
LG&E	C1S	896734	10/2014	09/30/2014	100.060	99.860	99.9	1
LG&E	C1S	896735	10/2014	09/30/2014	100.100	99.880	100.0	1
LG&E	C1S	896736	10/2014	09/30/2014	100.080	100.000	100.0	1
LG&E	C1S	896737	10/2014	09/30/2014	100.070	99.830	99.9	1
LG&E	C1S	896738	10/2014	09/30/2014	100.070	99.860	100.0	1
LG&E	C1S	896739	10/2014	09/30/2014	100.060	99.880	100.0	1
LG&E	C1S	896740	10/2014	09/30/2014	100.060	99.860	100.0	1
LG&E	C1S	896741	10/2014	09/30/2014	100.100	99.860	100.0	1
LG&E	C1S	896742	10/2014	09/30/2014	100.090	99.930	100.1	1
LG&E	C1S	896743	10/2014	09/30/2014	100.090	99.810	99.9	1
LG&E	C1S	896744	10/2014	09/30/2014	100.090	99.840	99.9	1
LG&E	C1S	896745	10/2014	09/30/2014	100.110	99.850	100.0	1
LG&E	C1S	896746	10/2014	09/30/2014	100.080	99.880	99.9	1
LG&E	C1S	896747	10/2014	09/30/2014	100.080	99.890	100.0	1
LG&E	C1S	896748	10/2014	09/30/2014	100.060	99.900	99.9	1
LG&E	C1S	896749	10/2014	09/30/2014	100.100	99.890	100.0	1
LG&E	C1S	896750	10/2014	09/30/2014	100.080	99.820	100.0	1
LG&E	C1S	896751	10/2014	09/30/2014	100.100	99.890	100.0	1
LG&E	C1S	896752	10/2014	09/30/2014	100.070	99.890	100.0	1
LG&E	C1S	896753	10/2014	09/30/2014	100.080	99.860	99.9	1
LG&E	C1S	896754	10/2014	09/30/2014	100.080	99.980	100.0	1
LG&E	C1S	896755	10/2014	09/30/2014	100.060	99.920	99.9	1
LG&E	C1S	896756	10/2014	09/30/2014	100.090	99.870	99.9	1
LG&E	C1S	896757	10/2014	09/30/2014	100.070	99.850	99.9	1
LG&E	C1S	896758	10/2014	09/30/2014	100.070	99.810	99.9	1
LG&E	C1S	896759	10/2014	09/30/2014	100.060	99.920	100.0	1
LG&E	C1S	896760	10/2014	09/30/2014	100.100	99.970	100.0	1
LG&E	C1S	896761	10/2014	09/30/2014	100.060	99.920	100.0	1

LG&E	896762	10/2014	09/30/2014	100.050	99.930	100.1	1
LG&E	896763	10/2014	09/30/2014	100.090	100.020	100.0	1
LG&E	896764	10/2014	09/30/2014	100.080	99.810	100.0	1
LG&E	896765	10/2014	09/30/2014	100.100	99.940	100.1	1
LG&E	896766	10/2014	09/30/2014	100.080	99.940	100.0	1
LG&E	896767	10/2014	09/30/2014	100.070	99.970	100.0	1
LG&E	896768	10/2014	09/30/2014	100.100	99.930	100.0	1
LG&E	896769	10/2014	09/30/2014	100.070	99.930	100.0	1
LG&E	896770	10/2014	09/30/2014	100.100	99.800	99.9	1
LG&E	896771	10/2014	09/30/2014	100.100	99.950	100.0	1
LG&E	896772	10/2014	09/30/2014	100.090	99.800	99.9	1
LG&E	896773	10/2014	09/30/2014	100.060	99.860	100.0	1
LG&E	896774	10/2014	09/30/2014	100.080	99.830	99.9	1
LG&E	896775	10/2014	09/30/2014	100.060	99.830	99.9	1
LG&E	896776	10/2014	09/30/2014	100.090	99.910	100.0	1
LG&E	896777	10/2014	09/30/2014	100.080	99.850	100.0	1
LG&E	896778	10/2014	09/30/2014	100.100	99.900	100.0	1
LG&E	896779	10/2014	09/30/2014	100.080	99.850	100.0	1
LG&E	896780	10/2014	09/30/2014	100.100	99.920	100.0	1
LG&E	896781	10/2014	09/30/2014	100.100	99.870	99.9	1
LG&E	896782	10/2014	09/30/2014	100.100	99.830	99.9	1
LG&E	896783	10/2014	09/30/2014	100.080	99.870	100.0	1
LG&E	896784	10/2014	09/30/2014	100.070	99.850	100.0	1
LG&E	896785	10/2014	09/30/2014	100.100	99.900	100.0	1
LG&E	896786	10/2014	09/30/2014	100.060	99.960	100.0	1
LG&E	896787	10/2014	09/30/2014	100.080	99.950	100.1	1
LG&E	896788	10/2014	09/30/2014	100.060	99.870	99.9	1
LG&E	896789	10/2014	09/30/2014	100.080	99.920	100.0	1
LG&E	896790	10/2014	09/30/2014	100.100	99.850	99.9	1
LG&E	896791	10/2014	09/30/2014	100.060	99.940	100.0	1
LG&E	896792	10/2014	09/30/2014	100.080	99.840	99.9	1
LG&E	896793	10/2014	09/30/2014	100.060	99.920	100.1	1

LG&E	896794	C1S	10/2014	09/30/2014	100.080	99.820	99.9	1
LG&E	896795	C1S	10/2014	09/30/2014	100.090	99.920	100.1	1
LG&E	896796	C1S	10/2014	09/30/2014	100.070	99.880	99.9	1
LG&E	896797	C1S	10/2014	09/30/2014	100.100	99.960	100.0	1
LG&E	896798	C1S	10/2014	09/30/2014	100.060	99.850	100.0	1
LG&E	896799	C1S	10/2014	09/30/2014	100.100	99.860	99.9	1
LG&E	896800	C1S	10/2014	09/30/2014	100.090	99.930	100.1	1
LG&E	896801	C1S	10/2014	09/30/2014	100.080	99.820	99.9	1
LG&E	896802	C1S	10/2014	09/30/2014	100.090	99.940	100.0	1
LG&E	896803	C1S	10/2014	09/30/2014	100.100	100.000	100.1	1
LG&E	896804	C1S	10/2014	09/30/2014	100.110	99.920	100.0	1
LG&E	896805	C1S	10/2014	09/30/2014	100.100	99.990	100.1	1
LG&E	896806	C1S	10/2014	09/30/2014	100.080	99.960	100.0	1
LG&E	896807	C1S	10/2014	09/30/2014	100.060	99.870	100.0	1
LG&E	896808	C1S	10/2014	09/30/2014	100.060	99.820	99.9	1
LG&E	896809	C1S	10/2014	09/30/2014	100.090	99.910	100.0	1
LG&E	896810	C1S	10/2014	09/30/2014	100.090	99.880	100.0	1
LG&E	896811	C1S	10/2014	09/30/2014	100.060	99.850	100.0	1
LG&E	896812	C1S	10/2014	09/30/2014	100.100	99.940	100.0	1
LG&E	896813	C1S	10/2014	09/30/2014	100.060	99.950	100.0	1
LG&E	896814	C1S	10/2014	09/30/2014	100.070	99.860	99.9	1
LG&E	896815	C1S	10/2014	09/30/2014	100.100	99.880	100.1	1
LG&E	896816	C1S	10/2014	09/30/2014	100.070	99.910	100.0	1
LG&E	896817	C1S	10/2014	09/30/2014	100.060	99.900	99.9	1
LG&E	896818	C1S	10/2014	09/30/2014	100.070	99.900	100.0	1
LG&E	896819	C1S	10/2014	09/30/2014	100.090	99.920	99.9	1
LG&E	896820	C1S	10/2014	09/30/2014	100.080	99.880	99.9	1
LG&E	896821	C1S	10/2014	09/30/2014	100.090	99.930	100.0	1
LG&E	896822	C1S	10/2014	09/30/2014	100.080	99.910	99.9	1
LG&E	896823	C1S	10/2014	09/30/2014	100.050	99.810	99.8	1
LG&E	896824	C1S	10/2014	09/30/2014	100.090	99.910	100.1	1
LG&E	896825	C1S	10/2014	09/30/2014	100.070	99.920	100.0	1

LG&E	C1S	896826	10/2014	09/30/2014	100.060	99.900	100.0	1
LG&E	C1S	896827	10/2014	09/30/2014	100.090	99.960	100.0	1
LG&E	C1S	896828	10/2014	09/30/2014	100.070	99.900	100.0	1
LG&E	C1S	896829	10/2014	09/30/2014	100.100	99.830	99.9	1
LG&E	C1S	896830	10/2014	09/30/2014	100.100	99.850	100.0	1
LG&E	C1S	896831	10/2014	09/30/2014	100.090	99.820	100.0	1
LG&E	C1S	896832	10/2014	09/30/2014	100.060	99.860	100.0	1
LG&E	C1S	896833	10/2014	09/30/2014	100.080	99.870	100.1	1
LG&E	C1S	896834	10/2014	09/30/2014	100.100	99.890	100.0	1
LG&E	C1S	896835	10/2014	09/30/2014	100.100	99.930	100.0	1
LG&E	C1S	896836	10/2014	09/30/2014	100.070	99.910	100.0	1
LG&E	C1S	896837	10/2014	09/30/2014	100.070	99.870	99.9	1
LG&E	C1S	896838	10/2014	09/30/2014	100.070	99.890	100.0	1
LG&E	C1S	896839	10/2014	09/30/2014	100.080	99.970	100.1	1
LG&E	C1S	896840	10/2014	09/30/2014	100.080	99.990	100.0	1
LG&E	C1S	896841	10/2014	09/30/2014	100.060	99.850	99.9	1
LG&E	C1S	896842	10/2014	09/30/2014	100.070	99.810	99.9	1
LG&E	C1S	896843	10/2014	09/30/2014	100.070	99.910	100.0	1
LG&E	C1S	896844	10/2014	09/30/2014	100.080	99.880	100.0	1
LG&E	C1S	896845	10/2014	09/30/2014	100.100	99.960	100.0	1
LG&E	C1S	896846	10/2014	09/30/2014	100.050	99.860	99.9	1
LG&E	C1S	896847	10/2014	09/30/2014	100.100	99.900	100.0	1
LG&E	C1S	896848	10/2014	09/30/2014	100.100	99.890	100.1	1
LG&E	C1S	896849	10/2014	09/30/2014	100.080	99.810	99.9	1
LG&E	C1S	896850	10/2014	09/30/2014	100.080	99.840	100.0	1
LG&E	C1S	896851	10/2014	09/30/2014	100.070	99.890	99.9	1
LG&E	C1S	896852	10/2014	09/30/2014	100.080	99.960	100.0	1
LG&E	C1S	896853	10/2014	09/30/2014	100.070	99.840	99.9	1
LG&E	C1S	896854	10/2014	09/30/2014	100.090	99.890	100.0	1
LG&E	C1S	896855	10/2014	09/30/2014	100.090	99.860	100.0	1
LG&E	C1S	896856	10/2014	09/30/2014	100.100	99.830	99.9	1
LG&E	C1S	896857	10/2014	09/30/2014	100.060	99.850	100.0	1

LG&E	C1S	896858	10/2014	09/30/2014	100.080	99.810	99.9	1
LG&E	C1S	896859	10/2014	09/30/2014	100.090	99.910	100.0	1
LG&E	C1S	896860	10/2014	09/30/2014	100.050	99.860	100.0	1
LG&E	C1S	896861	10/2014	09/30/2014	100.070	99.930	99.9	1
LG&E	C1S	896862	10/2014	09/30/2014	100.070	99.810	100.0	1
LG&E	C1S	896863	10/2014	09/30/2014	100.100	99.930	99.9	1
LG&E	C1S	896864	10/2014	09/30/2014	100.060	99.870	100.0	1
LG&E	C1S	896865	10/2014	09/30/2014	100.060	99.810	100.0	1
LG&E	C1S	896866	10/2014	09/30/2014	100.080	99.930	100.0	1
LG&E	C1S	896867	10/2014	09/30/2014	100.060	99.870	100.0	1
LG&E	C1S	896868	10/2014	09/30/2014	100.060	99.930	100.1	1
LG&E	C1S	896869	10/2014	09/30/2014	100.090	99.910	100.0	1
LG&E	C1S	896870	10/2014	09/30/2014	100.060	99.880	100.0	1
LG&E	C1S	896871	10/2014	09/30/2014	100.090	99.880	100.0	1
LG&E	C1S	896872	10/2014	09/30/2014	100.060	99.870	100.0	1
LG&E	C1S	896873	10/2014	09/30/2014	100.080	99.870	100.0	1
LG&E	C1S	896874	10/2014	09/30/2014	100.100	99.940	100.0	1
LG&E	C1S	896875	10/2014	09/30/2014	100.080	99.860	99.9	1
LG&E	C1S	896876	10/2014	09/30/2014	100.060	99.910	100.0	1
LG&E	C1S	896877	10/2014	09/30/2014	100.080	99.880	99.9	1
LG&E	C1S	896878	10/2014	09/30/2014	100.070	99.800	100.0	1
LG&E	C1S	896879	10/2014	09/30/2014	100.070	99.870	100.0	1
LG&E	C1S	896880	10/2014	09/30/2014	100.070	99.900	100.0	1
LG&E	C1S	896881	10/2014	09/30/2014	100.070	99.940	100.1	1
LG&E	C1S	896882	10/2014	09/30/2014	100.100	99.950	100.0	1
LG&E	C1S	896883	10/2014	09/30/2014	100.090	99.910	100.0	1
LG&E	C1S	896884	10/2014	09/30/2014	100.060	99.810	99.9	1
LG&E	C1S	896885	10/2014	09/30/2014	100.090	99.920	100.0	1
LG&E	C1S	896886	10/2014	09/30/2014	100.060	99.950	100.0	1
LG&E	C1S	896887	10/2014	09/30/2014	100.070	99.840	100.0	1
LG&E	C1S	896888	10/2014	09/30/2014	100.070	99.850	100.0	1
LG&E	C1S	896889	10/2014	09/30/2014	100.050	99.870	99.9	1

LG&E	C1S	896880	10/2014	09/30/2014	100.090	99.810	100.0	1
LG&E	C1S	896891	10/2014	09/30/2014	100.090	99.890	100.1	1
LG&E	C1S	896892	10/2014	09/30/2014	100.060	99.980	100.0	1
LG&E	C1S	896893	10/2014	09/30/2014	100.050	99.880	99.9	1
LG&E	C1S	896894	10/2014	09/30/2014	100.090	99.880	100.0	1
LG&E	C1S	896895	10/2014	09/30/2014	100.080	99.890	99.9	1
LG&E	C1S	896896	10/2014	09/30/2014	100.070	99.820	99.9	1
LG&E	C1S	896897	10/2014	09/30/2014	100.090	99.860	100.1	1
LG&E	C1S	896898	10/2014	09/30/2014	100.070	99.890	100.0	1
LG&E	C1S	896899	10/2014	09/30/2014	100.080	99.910	100.0	1
LG&E	C1S	896900	10/2014	09/30/2014	100.080	99.860	100.0	1
LG&E	C1S	896901	10/2014	09/30/2014	100.090	100.010	100.0	1
LG&E	C1S	896902	10/2014	09/30/2014	100.070	99.900	100.1	1
LG&E	C1S	896903	10/2014	09/30/2014	100.070	99.820	100.0	1
LG&E	C1S	896904	10/2014	09/30/2014	100.070	99.870	99.9	1
LG&E	C1S	896905	10/2014	09/30/2014	100.060	99.920	100.0	1
LG&E	C1S	896906	10/2014	09/30/2014	100.070	99.800	100.0	1
LG&E	C1S	896907	10/2014	09/30/2014	100.070	99.920	100.0	1
LG&E	C1S	896908	10/2014	09/30/2014	100.090	99.870	100.0	1
LG&E	C1S	896909	10/2014	09/30/2014	100.090	99.930	100.1	1
LG&E	C1S	896910	10/2014	09/30/2014	100.070	99.870	100.0	1
LG&E	C1S	896911	10/2014	09/30/2014	100.080	100.000	100.0	1
LG&E	C1S	896912	10/2014	09/30/2014	100.080	99.820	100.0	1
LG&E	C1S	896913	10/2014	09/30/2014	100.070	99.920	100.0	1
LG&E	C1S	896914	10/2014	09/30/2014	100.060	99.850	99.9	1
LG&E	C1S	896915	10/2014	09/30/2014	100.080	99.900	100.0	1
LG&E	C1S	896916	10/2014	09/30/2014	100.060	99.880	99.9	1
LG&E	C1S	896917	10/2014	09/30/2014	100.060	99.880	100.0	1
LG&E	C1S	896918	10/2014	09/30/2014	100.090	99.910	100.0	1
LG&E	C1S	896919	10/2014	09/30/2014	100.090	99.820	100.0	1
LG&E	C1S	896920	10/2014	09/30/2014	100.100	99.960	100.0	1
LG&E	C1S	896921	10/2014	09/30/2014	100.080	99.940	99.9	1

LG&E	896922	C1S	10/2014	09/30/2014	100.090	99.920	100.1	1
LG&E	896923	C1S	10/2014	09/30/2014	100.080	99.910	100.0	1
LG&E	896924	C1S	10/2014	09/30/2014	100.110	99.910	100.0	1
LG&E	896925	C1S	10/2014	09/30/2014	100.090	99.920	100.0	1
LG&E	896926	C1S	10/2014	09/30/2014	100.050	99.830	99.9	1
LG&E	896927	C1S	10/2014	09/30/2014	100.060	99.900	100.0	1
LG&E	896928	C1S	10/2014	09/30/2014	100.100	99.920	100.0	1
LG&E	896929	C1S	10/2014	09/30/2014	100.080	99.880	100.0	1
LG&E	896930	C1S	10/2014	09/30/2014	100.080	99.950	100.0	1
LG&E	896931	C1S	10/2014	09/30/2014	100.080	99.890	100.0	1
LG&E	896932	C1S	10/2014	09/30/2014	100.080	99.840	99.9	1
LG&E	896933	C1S	10/2014	09/30/2014	100.050	99.960	100.0	1
LG&E	896934	C1S	10/2014	09/30/2014	100.100	99.960	100.0	1
LG&E	896935	C1S	10/2014	09/30/2014	100.090	99.820	100.0	1
LG&E	896936	C1S	10/2014	09/30/2014	100.070	99.920	99.9	1
LG&E	896937	C1S	10/2014	09/30/2014	100.070	99.920	100.0	1
LG&E	896938	C1S	10/2014	09/30/2014	100.090	99.960	100.0	1
LG&E	896939	C1S	10/2014	09/30/2014	100.050	99.890	99.9	1
LG&E	896940	C1S	10/2014	09/30/2014	100.090	99.950	99.9	1
LG&E	896941	C1S	10/2014	09/30/2014	100.080	99.810	99.9	1
LG&E	896942	C1S	10/2014	09/30/2014	100.080	99.960	100.1	1
LG&E	896943	C1S	10/2014	09/30/2014	100.090	99.840	100.0	1
LG&E	896944	C1S	10/2014	09/30/2014	100.060	99.880	99.9	1
LG&E	896945	C1S	10/2014	09/30/2014	100.080	99.930	99.9	1
LG&E	896946	C1S	10/2014	09/30/2014	100.090	99.830	99.9	1
LG&E	896947	C1S	10/2014	09/30/2014	100.060	99.890	100.0	1
LG&E	896948	C1S	10/2014	09/30/2014	100.070	99.900	100.0	1
LG&E	896949	C1S	10/2014	09/30/2014	100.080	99.940	100.0	1
LG&E	896950	C1S	10/2014	09/30/2014	100.070	99.880	99.9	1
LG&E	896951	C1S	10/2014	09/30/2014	100.060	99.900	99.9	1
LG&E	896952	C1S	10/2014	09/30/2014	100.070	99.860	99.9	1
LG&E	896953	C1S	10/2014	09/30/2014	100.080	99.910	100.1	1

LG&E	C1S	896954	10/2014	09/30/2014	100.080	99.890	100.0	1
LG&E	C1S	896955	10/2014	09/30/2014	100.060	99.900	100.1	1
LG&E	C1S	896956	10/2014	09/30/2014	100.050	99.890	99.9	1
LG&E	C1S	896957	10/2014	09/30/2014	100.090	99.860	99.9	1
LG&E	C1S	896958	10/2014	09/30/2014	100.090	99.930	100.1	1
LG&E	C1S	896959	10/2014	09/30/2014	100.090	99.930	100.1	1
LG&E	C1S	896960	10/2014	09/30/2014	100.070	99.830	99.9	1
LG&E	C1S	896961	10/2014	09/30/2014	100.100	99.930	100.1	1
LG&E	C1S	896962	10/2014	09/30/2014	100.100	99.870	100.0	1
LG&E	C1S	896963	10/2014	09/30/2014	100.090	99.840	99.9	1
LG&E	C1S	896964	10/2014	09/30/2014	100.080	99.920	100.0	1
LG&E	C1S	896965	10/2014	09/30/2014	100.070	99.900	100.0	1
LG&E	C1S	896966	10/2014	09/30/2014	100.100	99.840	99.9	1
LG&E	C1S	896967	10/2014	09/30/2014	100.090	99.890	100.1	1
LG&E	C1S	896968	10/2014	09/30/2014	100.070	99.970	99.9	1
LG&E	C1S	896969	10/2014	09/30/2014	100.080	99.880	99.9	1
LG&E	C1S	896970	10/2014	09/30/2014	100.090	99.850	100.0	1
LG&E	C1S	896971	10/2014	09/30/2014	100.100	99.800	100.0	1
LG&E	C1S	896972	10/2014	09/30/2014	100.090	99.990	100.0	1
LG&E	C1S	896973	10/2014	09/30/2014	100.090	99.800	100.0	1
LG&E	C1S	896974	10/2014	09/30/2014	100.090	99.900	100.0	1
LG&E	C1S	896975	10/2014	09/30/2014	100.080	99.890	100.0	1
LG&E	C1S	896976	10/2014	09/30/2014	100.080	99.810	99.9	1
LG&E	C1S	896977	10/2014	09/30/2014	100.060	99.830	100.0	1
LG&E	C1S	896978	10/2014	09/30/2014	100.080	99.810	99.9	1
LG&E	C1S	896979	10/2014	09/30/2014	100.060	99.910	99.9	1
LG&E	C1S	896980	10/2014	09/30/2014	100.080	99.850	100.0	1
LG&E	C1S	896981	10/2014	09/30/2014	100.080	99.830	99.9	1
LG&E	C1S	896982	10/2014	09/30/2014	100.090	99.930	100.0	1
LG&E	C1S	896983	10/2014	09/30/2014	100.070	99.860	100.0	1
LG&E	C1S	896984	10/2014	09/30/2014	100.070	99.950	100.0	1
LG&E	C1S	896985	10/2014	09/30/2014	100.110	99.860	100.0	1

LG&E	C1S	896986	10/2014	09/30/2014	100.080	99.800	100.0	1
LG&E	C1S	896987	10/2014	09/30/2014	100.070	99.840	99.9	1
LG&E	C1S	896988	10/2014	09/30/2014	100.100	99.870	99.9	1
LG&E	C1S	896989	10/2014	09/30/2014	100.080	99.880	99.9	1
LG&E	C1S	896990	10/2014	09/30/2014	100.070	99.900	100.0	1
LG&E	C1S	896991	10/2014	09/30/2014	100.060	99.900	99.9	1
LG&E	C1S	896992	10/2014	09/30/2014	100.100	99.890	100.0	1
LG&E	C1S	896993	10/2014	09/30/2014	100.100	99.920	100.1	1
LG&E	C1S	896994	10/2014	09/30/2014	100.100	99.980	100.0	1
LG&E	C1S	896995	10/2014	09/30/2014	100.060	99.830	99.9	1
LG&E	C1S	896996	10/2014	09/30/2014	100.070	99.910	100.0	1
LG&E	C1S	896997	10/2014	09/30/2014	100.060	99.850	99.9	1
LG&E	C1S	896998	10/2014	09/30/2014	100.090	99.920	100.0	1
LG&E	C1S	896999	10/2014	09/30/2014	100.060	99.840	99.9	1
LG&E	C1S	897000	10/2014	09/30/2014	100.070	99.920	100.0	1
LG&E	C1S	897001	10/2014	09/30/2014	100.080	99.900	100.0	1
LG&E	C1S	897002	10/2014	09/30/2014	100.080	99.980	100.0	1
LG&E	C1S	897003	10/2014	09/30/2014	100.050	99.850	99.9	1
LG&E	C1S	897004	10/2014	09/30/2014	100.100	99.930	100.0	1
LG&E	C1S	897005	10/2014	09/30/2014	100.050	99.860	100.0	1
LG&E	C1S	897006	10/2014	09/30/2014	100.100	99.950	100.1	1
LG&E	C1S	897007	10/2014	09/30/2014	100.090	99.910	100.1	1
LG&E	C1S	897008	10/2014	09/30/2014	100.060	99.870	99.9	1
LG&E	C1S	897009	10/2014	09/30/2014	100.100	99.900	100.0	1
LG&E	C1S	897010	10/2014	09/30/2014	100.060	99.890	100.0	1
LG&E	C1S	897011	10/2014	09/30/2014	100.090	99.850	100.0	1
LG&E	C1S	897012	10/2014	09/30/2014	100.080	100.010	100.0	1
LG&E	C1S	897013	10/2014	09/30/2014	100.080	99.910	100.0	1
LG&E	C1S	897014	10/2014	09/30/2014	100.100	99.830	100.0	1
LG&E	C1S	897015	10/2014	09/30/2014	100.080	99.930	100.0	1
LG&E	C1S	897016	10/2014	09/30/2014	100.090	99.910	100.0	1
LG&E	C1S	897017	10/2014	09/30/2014	100.060	99.850	99.9	1

LG&E	C1S	897018	10/2014	09/30/2014	100.080	99.890	99.9	1
LG&E	C1S	897019	10/2014	09/30/2014	100.070	99.820	100.0	1
LG&E	C1S	897020	10/2014	09/30/2014	100.080	99.880	99.9	1
LG&E	C1S	897021	10/2014	09/30/2014	100.110	99.880	100.1	1
LG&E	C1S	897022	10/2014	09/30/2014	100.060	99.940	99.9	1
LG&E	C1S	897023	10/2014	09/30/2014	100.070	99.900	100.1	1
LG&E	C1S	897024	10/2014	09/30/2014	100.070	99.830	99.9	1
LG&E	C1S	897025	10/2014	09/30/2014	100.080	99.860	99.9	1
LG&E	C1S	897026	10/2014	09/30/2014	100.080	99.940	99.9	1
LG&E	C1S	897027	10/2014	09/30/2014	100.080	99.930	100.0	1
LG&E	C1S	897028	10/2014	09/30/2014	100.080	99.870	100.1	1
LG&E	C1S	897029	10/2014	09/30/2014	100.060	99.880	99.9	1
LG&E	C1S	897030	10/2014	09/30/2014	100.070	99.890	100.1	1
LG&E	C1S	897031	10/2014	09/30/2014	100.070	99.890	100.0	1
LG&E	C1S	897032	10/2014	09/30/2014	100.080	99.870	100.0	1
LG&E	C1S	897033	10/2014	09/30/2014	100.090	99.870	100.0	1
LG&E	C1S	897034	10/2014	09/30/2014	100.090	99.850	99.9	1
LG&E	C1S	897035	10/2014	09/30/2014	100.070	99.980	99.9	1
LG&E	C1S	897036	10/2014	09/30/2014	100.100	99.830	99.9	1
LG&E	C1S	897037	10/2014	09/30/2014	100.110	99.920	99.9	1
LG&E	C1S	897038	10/2014	09/30/2014	100.080	99.940	100.0	1
LG&E	C1S	897039	10/2014	09/30/2014	100.100	100.030	100.0	1
LG&E	C1S	897040	10/2014	09/30/2014	100.100	99.820	99.9	1
LG&E	C1S	897041	10/2014	09/30/2014	100.080	99.910	100.0	1
LG&E	C1S	897042	10/2014	09/30/2014	100.060	99.890	100.0	1
LG&E	C1S	897043	10/2014	09/30/2014	100.060	99.920	99.9	1
LG&E	C1S	897044	10/2014	09/30/2014	100.070	99.930	100.0	1
LG&E	C1S	897045	10/2014	09/30/2014	100.060	99.850	100.0	1
LG&E	C1S	897046	10/2014	09/30/2014	100.070	99.930	100.0	1
LG&E	C1S	897047	10/2014	09/30/2014	100.100	99.910	100.0	1
LG&E	C1S	897048	10/2014	09/30/2014	100.080	99.860	100.0	1
LG&E	C1S	897049	10/2014	09/30/2014	100.100	99.950	100.0	1

LG&E	C1S	897050	10/2014	09/30/2014	100.100	99.920	100.0	1
LG&E	C1S	897051	10/2014	09/30/2014	100.100	99.850	99.9	1
LG&E	C1S	897052	10/2014	09/30/2014	100.080	99.810	99.9	1
LG&E	C1S	897053	10/2014	09/30/2014	100.090	99.870	100.1	1
LG&E	C1S	897054	10/2014	09/30/2014	100.090	99.940	100.0	1
LG&E	C1S	897055	10/2014	09/30/2014	100.090	99.880	100.0	1
LG&E	C1S	897056	10/2014	09/30/2014	100.060	99.970	100.1	1
LG&E	C1S	897057	10/2014	09/30/2014	100.080	99.860	100.0	1
LG&E	C1S	897058	10/2014	09/30/2014	100.090	99.900	100.0	1
LG&E	C1S	897059	10/2014	09/30/2014	100.100	99.910	99.9	1
LG&E	C1S	897060	10/2014	09/30/2014	100.100	99.840	99.9	1
LG&E	C1S	897061	10/2014	09/30/2014	100.090	99.890	100.1	1
LG&E	C1S	897062	10/2014	09/30/2014	100.090	99.820	100.0	1
LG&E	C1S	897063	10/2014	09/30/2014	100.080	99.880	99.9	1
LG&E	C1S	897064	10/2014	09/30/2014	100.080	99.820	100.0	1
LG&E	C1S	897065	10/2014	09/30/2014	100.110	99.960	100.0	1
LG&E	C1S	897066	10/2014	09/30/2014	100.060	99.860	100.0	1
LG&E	C1S	897067	10/2014	09/30/2014	100.080	99.880	100.1	1
LG&E	C1S	897068	10/2014	09/30/2014	100.090	99.820	99.9	1
LG&E	C1S	897069	10/2014	09/30/2014	100.090	99.910	100.0	1
LG&E	C1S	897070	10/2014	09/30/2014	100.090	99.860	99.9	1
LG&E	C1S	897071	10/2014	09/30/2014	100.090	99.900	100.0	1
LG&E	C1S	897072	10/2014	09/30/2014	100.090	99.930	100.1	1
LG&E	C1S	897073	10/2014	09/30/2014	100.100	99.920	100.0	1
LG&E	C1S	897074	10/2014	09/30/2014	100.090	99.860	99.9	1
LG&E	C1S	897075	10/2014	09/30/2014	100.060	99.840	99.9	1
LG&E	C1S	897076	10/2014	09/30/2014	100.080	99.950	100.0	1
LG&E	C1S	897077	10/2014	09/30/2014	100.070	99.870	99.9	1
LG&E	C1S	897078	10/2014	09/30/2014	100.080	99.820	99.9	1
LG&E	C1S	897079	10/2014	09/30/2014	100.070	99.920	100.1	1
LG&E	C1S	897080	10/2014	09/30/2014	100.090	99.890	99.9	1
LG&E	C1S	897081	10/2014	09/30/2014	100.060	99.900	100.0	1

LG&E	C1S	897082	10/2014	09/30/2014	100.060	99.880	99.9	1
LG&E	C1S	897083	10/2014	09/30/2014	100.060	99.840	100.0	1
LG&E	C1S	897084	10/2014	09/30/2014	100.090	99.890	100.0	1
LG&E	C1S	897085	10/2014	09/30/2014	100.060	99.960	100.0	1
LG&E	C1S	897086	10/2014	09/30/2014	100.090	99.830	100.0	1
LG&E	C1S	897087	10/2014	09/30/2014	100.060	99.880	100.0	1
LG&E	C1S	897088	10/2014	09/30/2014	100.060	99.810	99.9	1
LG&E	C1S	897089	10/2014	09/30/2014	100.070	99.870	100.1	1
LG&E	C1S	897090	10/2014	09/30/2014	100.080	99.860	100.0	1
LG&E	C1S	897091	10/2014	09/30/2014	100.060	99.870	100.0	1
LG&E	C1S	897092	10/2014	09/30/2014	100.080	99.850	100.0	1
LG&E	C1S	897093	10/2014	09/30/2014	100.070	99.810	100.0	1
LG&E	C1S	897094	10/2014	09/30/2014	100.070	99.840	99.9	1
LG&E	C1S	897095	10/2014	09/30/2014	100.070	99.920	100.0	1
LG&E	C1S	897096	10/2014	09/30/2014	100.090	99.890	100.0	1
LG&E	C1S	897097	10/2014	09/30/2014	100.080	99.900	100.0	1
LG&E	C1S	897098	10/2014	09/30/2014	100.080	99.930	100.0	1
LG&E	C1S	897099	10/2014	09/30/2014	100.060	99.880	100.0	1
LG&E	C1S	897100	10/2014	09/30/2014	100.070	99.920	100.0	1
LG&E	C1S	897101	10/2014	09/30/2014	100.070	99.870	99.9	1
LG&E	C1S	897102	10/2014	09/30/2014	100.100	99.910	100.1	1
LG&E	C1S	897103	10/2014	09/30/2014	100.050	99.930	100.0	1
LG&E	C1S	897104	10/2014	09/30/2014	100.060	99.930	99.9	1
LG&E	C1S	897105	10/2014	09/30/2014	100.090	99.850	100.0	1
LG&E	C1S	897106	10/2014	09/30/2014	100.070	99.860	100.0	1
LG&E	C1S	897107	10/2014	09/30/2014	100.080	99.930	100.0	1
LG&E	C1S	897108	10/2014	09/30/2014	100.050	99.860	99.9	1
LG&E	C1S	897109	10/2014	09/30/2014	100.080	99.820	99.9	1
LG&E	C1S	897110	10/2014	09/30/2014	100.110	99.920	100.1	1
LG&E	C1S	897111	10/2014	09/30/2014	100.080	99.810	100.0	1
LG&E	C1S	897112	10/2014	09/30/2014	100.100	99.880	100.0	1
LG&E	C1S	897113	10/2014	09/30/2014	100.100	99.850	100.1	1

LG&E	897114	C1S	10/2014	09/30/2014	100.090	99.830	99.9	1
LG&E	897115	C1S	10/2014	09/30/2014	100.100	99.960	100.0	1
LG&E	897116	C1S	10/2014	09/30/2014	100.070	99.880	99.9	1
LG&E	897117	C1S	10/2014	09/30/2014	100.100	99.890	100.0	1
LG&E	897118	C1S	10/2014	09/30/2014	100.100	99.830	99.9	1
LG&E	897119	C1S	10/2014	09/30/2014	100.070	99.880	100.0	1
LG&E	897120	C1S	10/2014	09/30/2014	100.060	99.920	100.1	1
LG&E	897121	C1S	10/2014	09/30/2014	100.080	99.930	100.0	1
LG&E	897122	C1S	10/2014	09/30/2014	100.080	99.870	100.0	1
LG&E	897123	C1S	10/2014	09/30/2014	100.060	99.920	100.0	1
LG&E	897124	C1S	10/2014	09/30/2014	100.080	99.960	100.1	1
LG&E	897125	C1S	10/2014	09/30/2014	100.100	99.900	100.0	1
LG&E	897126	C1S	10/2014	09/30/2014	100.050	99.820	99.9	1
LG&E	897127	C1S	10/2014	09/30/2014	100.070	99.900	100.1	1
LG&E	897128	C1S	10/2014	09/30/2014	100.080	99.860	99.9	1
LG&E	897129	C1S	10/2014	09/30/2014	100.080	99.830	99.9	1
LG&E	897130	C1S	10/2014	09/30/2014	100.090	99.870	100.0	1
LG&E	897131	C1S	10/2014	09/30/2014	100.060	99.870	100.0	1
LG&E	897132	C1S	10/2014	09/30/2014	100.080	99.860	100.0	1
LG&E	897133	C1S	10/2014	09/30/2014	100.070	99.880	100.0	1
LG&E	897134	C1S	10/2014	09/30/2014	100.080	99.850	99.9	1
LG&E	897135	C1S	10/2014	09/30/2014	100.100	99.980	100.0	1
LG&E	897136	C1S	10/2014	09/30/2014	100.070	99.870	100.0	1
LG&E	897137	C1S	10/2014	09/30/2014	100.090	99.950	99.9	1
LG&E	897138	C1S	10/2014	09/30/2014	100.080	99.850	100.0	1
LG&E	897139	C1S	10/2014	09/30/2014	100.060	99.810	100.0	1
LG&E	897140	C1S	10/2014	09/30/2014	100.090	99.810	99.9	1
LG&E	897141	C1S	10/2014	09/30/2014	100.100	99.970	100.0	1
LG&E	897142	C1S	10/2014	09/30/2014	100.090	99.860	99.9	1
LG&E	897143	C1S	10/2014	09/30/2014	100.090	99.850	100.0	1
LG&E	897144	C1S	10/2014	09/30/2014	100.060	99.830	100.0	1
LG&E	897145	C1S	10/2014	09/30/2014	100.070	99.930	100.0	1

LG&E	C1S	897146	10/2014	09/30/2014	100.100	99.840	99.9	1
LG&E	C1S	897147	10/2014	09/30/2014	100.060	99.900	99.9	1
LG&E	C1S	897148	10/2014	09/30/2014	100.070	99.840	99.9	1
LG&E	C1S	897149	10/2014	09/30/2014	100.090	99.980	100.0	1
LG&E	C1S	897150	10/2014	09/30/2014	100.060	99.900	99.9	1
LG&E	C1S	897151	10/2014	09/30/2014	100.100	99.910	100.1	1
LG&E	C1S	897152	10/2014	09/30/2014	100.080	99.890	100.1	1
LG&E	C1S	897153	10/2014	09/30/2014	100.080	99.900	100.0	1
LG&E	C1S	897154	10/2014	09/30/2014	100.070	99.910	99.9	1
LG&E	C1S	897155	10/2014	09/30/2014	100.090	99.970	100.1	1
LG&E	C1S	897156	10/2014	09/30/2014	100.080	99.890	100.0	1
LG&E	C1S	897157	10/2014	09/30/2014	100.100	99.960	100.0	1
LG&E	C1S	897158	10/2014	09/30/2014	100.060	99.910	99.9	1
LG&E	C1S	897159	10/2014	09/30/2014	100.050	99.910	100.0	1
LG&E	C1S	897160	10/2014	09/30/2014	100.060	99.940	100.0	1
LG&E	C1S	897161	10/2014	09/30/2014	100.090	99.980	100.1	1
LG&E	C1S	897162	10/2014	09/30/2014	100.090	99.920	100.0	1
LG&E	C1S	897163	10/2014	09/30/2014	100.100	100.030	100.0	1
LG&E	C1S	897164	10/2014	09/30/2014	100.080	99.840	100.0	1
LG&E	C1S	897165	10/2014	09/30/2014	100.080	99.970	99.9	1
LG&E	C1S	897166	10/2014	09/30/2014	100.100	99.870	99.9	1
LG&E	C1S	897167	10/2014	09/30/2014	100.100	99.910	100.0	1
LG&E	C1S	897168	10/2014	09/30/2014	100.070	99.870	100.0	1
LG&E	C1S	897169	10/2014	09/30/2014	100.060	99.910	100.0	1
LG&E	C1S	897170	10/2014	09/30/2014	100.090	99.930	100.0	1
LG&E	C1S	897171	10/2014	09/30/2014	100.080	99.810	100.0	1
LG&E	C1S	897172	10/2014	09/30/2014	100.070	99.930	100.0	1
LG&E	C1S	897173	10/2014	09/30/2014	100.070	99.940	100.0	1
LG&E	C1S	897174	10/2014	09/30/2014	100.070	99.820	100.0	1
LG&E	C1S	897175	10/2014	09/30/2014	100.100	99.920	100.0	1
LG&E	C1S	897176	10/2014	09/30/2014	100.090	99.900	100.1	1
LG&E	C1S	897177	10/2014	09/30/2014	100.100	99.820	100.0	1

LG&E	C1S	897178	10/2014	09/30/2014	100.060	99.900	100.0	1
LG&E	C1S	897179	10/2014	09/30/2014	100.060	99.870	100.0	1
LG&E	C1S	897180	10/2014	09/30/2014	100.080	99.920	100.0	1
LG&E	C1S	897181	10/2014	09/30/2014	100.090	99.940	100.0	1
LG&E	C1S	897182	10/2014	09/30/2014	100.070	99.830	100.0	1
LG&E	C1S	897183	10/2014	09/30/2014	100.080	99.870	100.0	1
LG&E	C1S	897184	10/2014	09/30/2014	100.090	99.940	100.0	1
LG&E	C1S	897185	10/2014	09/30/2014	100.060	99.870	100.0	1
LG&E	C1S	897186	10/2014	09/30/2014	100.050	99.860	100.0	1
LG&E	C1S	897187	10/2014	09/30/2014	100.080	99.900	99.9	1
LG&E	C1S	897188	10/2014	09/30/2014	100.080	99.840	99.9	1
LG&E	C1S	897189	10/2014	09/30/2014	100.100	100.000	100.0	1
LG&E	C1S	897190	10/2014	09/30/2014	100.100	100.020	100.0	1
LG&E	C1S	897191	10/2014	09/30/2014	100.100	99.980	100.1	1
LG&E	C1S	897192	10/2014	09/30/2014	100.070	99.820	99.9	1
LG&E	C1S	897193	10/2014	09/30/2014	100.060	99.910	100.0	1
LG&E	C1S	897194	10/2014	09/30/2014	100.090	99.940	100.1	1
LG&E	C1S	897195	10/2014	09/30/2014	100.080	99.880	99.9	1
LG&E	C1S	897196	10/2014	09/30/2014	100.060	99.900	99.9	1
LG&E	C1S	897197	10/2014	09/30/2014	100.060	99.920	100.0	1
LG&E	C1S	897198	10/2014	09/30/2014	100.100	99.880	100.0	1
LG&E	C1S	897199	10/2014	09/30/2014	100.060	99.840	99.9	1
LG&E	C1S	897200	10/2014	09/30/2014	100.110	99.830	100.0	1
LG&E	C1S	897201	10/2014	09/30/2014	100.090	99.930	100.0	1
LG&E	C1S	897202	10/2014	09/30/2014	100.090	99.850	100.0	1
LG&E	C1S	897203	10/2014	09/30/2014	100.060	99.810	99.9	1
LG&E	C1S	897204	10/2014	09/30/2014	100.070	99.850	100.0	1
LG&E	C1S	897205	10/2014	09/30/2014	100.090	99.870	99.9	1
LG&E	C1S	897206	10/2014	09/30/2014	100.080	99.870	100.0	1
LG&E	C1S	897207	10/2014	09/30/2014	100.070	99.820	99.9	1
LG&E	C1S	897208	10/2014	09/30/2014	100.060	99.880	100.0	1
LG&E	C1S	897209	10/2014	09/30/2014	100.060	99.850	100.0	1

LG&E	C1S	897210	10/2014	09/30/2014	100.100	99.940	100.0	1
LG&E	C1S	897211	10/2014	09/30/2014	100.090	99.870	100.1	1
LG&E	C1S	897212	10/2014	09/30/2014	100.070	99.920	100.0	1
LG&E	C1S	897213	10/2014	09/30/2014	100.100	99.840	100.0	1
LG&E	C1S	897214	10/2014	09/30/2014	100.070	99.890	100.0	1
LG&E	C1S	897215	10/2014	09/30/2014	100.070	99.880	100.0	1
LG&E	C1S	897216	10/2014	09/30/2014	100.080	99.850	99.9	1
LG&E	C1S	897217	10/2014	09/30/2014	100.070	99.870	100.0	1
LG&E	C1S	897218	10/2014	09/30/2014	100.080	99.890	99.9	1
LG&E	C1S	897219	10/2014	09/30/2014	100.090	99.900	99.9	1
LG&E	C1S	897220	10/2014	09/30/2014	100.090	99.920	100.0	1
LG&E	C1S	897221	10/2014	09/30/2014	100.080	99.830	99.9	1
LG&E	C1S	897222	10/2014	09/30/2014	100.110	99.840	100.0	1
LG&E	C1S	897223	10/2014	09/30/2014	100.100	99.960	100.0	1
LG&E	C1S	897224	10/2014	09/30/2014	100.060	99.880	100.0	1
LG&E	C1S	897225	10/2014	09/30/2014	100.110	99.940	100.1	1
LG&E	C1S	897226	10/2014	09/30/2014	100.080	99.950	100.0	1
LG&E	C1S	897227	10/2014	09/30/2014	100.080	99.870	100.0	1
LG&E	C1S	897228	10/2014	09/30/2014	100.100	99.960	100.0	1
LG&E	C1S	897229	10/2014	09/30/2014	100.070	99.820	100.0	1
LG&E	C1S	897230	10/2014	09/30/2014	100.100	99.820	99.9	1
LG&E	C1S	897231	10/2014	09/30/2014	100.100	99.990	100.0	1
LG&E	C1S	897232	10/2014	09/30/2014	100.090	99.890	100.1	1
LG&E	C1S	897233	10/2014	09/30/2014	100.070	99.970	100.1	1
LG&E	C1S	897234	10/2014	09/30/2014	100.100	99.830	100.0	1
LG&E	C1S	897235	10/2014	09/30/2014	100.070	99.930	100.0	1
LG&E	C1S	897236	10/2014	09/30/2014	100.080	99.910	100.1	1
LG&E	C1S	897237	10/2014	09/30/2014	100.100	99.850	99.9	1
LG&E	C1S	897238	10/2014	09/30/2014	100.080	99.890	100.0	1
LG&E	C1S	897239	10/2014	09/30/2014	100.080	99.820	99.9	1
LG&E	C1S	897240	10/2014	09/30/2014	100.060	99.890	100.0	1
LG&E	C1S	897241	10/2014	09/30/2014	100.060	99.890	100.0	1

LG&E	C1S	897242	10/2014	09/30/2014	100.060	99.870	99.9	1
LG&E	C1S	897243	10/2014	09/30/2014	100.070	99.900	99.9	1
LG&E	C1S	897244	10/2014	09/30/2014	100.060	99.940	100.0	1
LG&E	C1S	897245	10/2014	09/30/2014	100.080	99.840	100.0	1
LG&E	C1S	897246	10/2014	09/30/2014	100.070	99.910	99.9	1
LG&E	C1S	897247	10/2014	09/30/2014	100.070	99.880	100.0	1
LG&E	C1S	897248	10/2014	09/30/2014	100.070	99.810	100.0	1
LG&E	C1S	897249	10/2014	09/30/2014	100.100	99.970	100.0	1
LG&E	C1S	897250	10/2014	09/30/2014	100.070	99.860	99.9	1
LG&E	C1S	897251	10/2014	09/30/2014	100.090	99.880	100.0	1
LG&E	C1S	897252	10/2014	09/30/2014	100.090	99.870	100.0	1
LG&E	C1S	897253	10/2014	09/30/2014	100.070	99.920	100.1	1
LG&E	C1S	897254	10/2014	09/30/2014	100.100	99.870	100.0	1
LG&E	C1S	897255	10/2014	09/30/2014	100.090	99.910	100.0	1
LG&E	C1S	897256	10/2014	09/30/2014	100.080	99.890	99.9	1
LG&E	C1S	897257	10/2014	09/30/2014	100.100	99.950	100.0	1
LG&E	C1S	897258	10/2014	09/30/2014	100.070	99.840	99.9	1
LG&E	C1S	897259	10/2014	09/30/2014	100.070	99.840	99.9	1
LG&E	C1S	897260	10/2014	09/30/2014	100.110	99.840	100.0	1
LG&E	C1S	897261	10/2014	09/30/2014	100.100	99.900	100.0	1
LG&E	C1S	897262	10/2014	09/30/2014	100.070	99.880	100.1	1
LG&E	C1S	897263	10/2014	09/30/2014	100.090	99.970	99.9	1
LG&E	C1S	897264	10/2014	09/30/2014	100.100	99.920	100.1	1
LG&E	C1S	897265	10/2014	09/30/2014	100.080	99.930	100.0	1
LG&E	C1S	897266	10/2014	09/30/2014	100.080	99.830	99.9	1
LG&E	C1S	897267	10/2014	09/30/2014	100.100	99.950	100.1	1
LG&E	C1S	897268	10/2014	09/30/2014	100.070	99.840	99.9	1
LG&E	C1S	897269	10/2014	09/30/2014	100.080	99.950	100.0	1
LG&E	C1S	897270	10/2014	09/30/2014	100.070	99.860	100.0	1
LG&E	C1S	897271	10/2014	09/30/2014	100.090	99.840	100.0	1
LG&E	C1S	897272	10/2014	09/30/2014	100.080	99.950	99.9	1
LG&E	C1S	897273	10/2014	09/30/2014	100.080	99.960	99.9	1

LG&E	C1S	897274	10/2014	09/30/2014	100.090	99.930	100.0	1
LG&E	C1S	897275	10/2014	09/30/2014	100.060	99.810	99.9	1
LG&E	C1S	897276	10/2014	09/30/2014	100.080	99.930	100.0	1
LG&E	C1S	897277	10/2014	09/30/2014	100.080	99.940	100.1	1
LG&E	C1S	897278	10/2014	09/30/2014	100.080	99.820	100.0	1
LG&E	C1S	897279	10/2014	09/30/2014	100.090	99.900	100.0	1
LG&E	C1S	897280	10/2014	09/30/2014	100.090	99.920	100.0	1
LG&E	C1S	897281	10/2014	09/30/2014	100.050	99.880	100.0	1
LG&E	C1S	897282	10/2014	09/30/2014	100.080	99.990	100.1	1
LG&E	C1S	897283	10/2014	09/30/2014	100.090	99.920	100.1	1
LG&E	C1S	897284	10/2014	09/30/2014	100.090	99.950	100.0	1
LG&E	C1S	897285	10/2014	09/30/2014	100.060	99.930	100.0	1
LG&E	C1S	897286	10/2014	09/30/2014	100.070	99.920	99.9	1
LG&E	C1S	897287	10/2014	09/30/2014	100.100	99.920	100.1	1
LG&E	C1S	897288	10/2014	09/30/2014	100.090	99.930	100.0	1
LG&E	C1S	897289	10/2014	09/30/2014	100.060	99.930	100.0	1
LG&E	C1S	897290	10/2014	09/30/2014	100.090	99.930	100.0	1
LG&E	C1S	897291	10/2014	09/30/2014	100.070	99.850	99.9	1
LG&E	C1S	897292	10/2014	09/30/2014	100.100	99.900	100.0	1
LG&E	C1S	897293	10/2014	09/30/2014	100.070	99.890	100.0	1
LG&E	C1S	897294	10/2014	09/30/2014	100.060	99.860	100.0	1
LG&E	C1S	897295	10/2014	09/30/2014	100.090	99.820	100.0	1
LG&E	C1S	897296	10/2014	09/30/2014	100.070	99.870	100.0	1
LG&E	C1S	897297	10/2014	09/30/2014	100.090	99.860	99.9	1
LG&E	C1S	897298	10/2014	09/30/2014	100.080	99.840	99.9	1
LG&E	C1S	897299	10/2014	09/30/2014	100.060	99.880	99.9	1
LG&E	C1S	897300	10/2014	09/30/2014	100.100	99.930	100.0	1
LG&E	C1S	897301	10/2014	09/30/2014	100.100	99.810	99.9	1
LG&E	C1S	897302	10/2014	09/30/2014	100.090	99.940	100.1	1
LG&E	C1S	897303	10/2014	09/30/2014	100.070	99.960	100.0	1
LG&E	C1S	897304	10/2014	09/30/2014	100.080	100.000	100.0	1
LG&E	C1S	897305	10/2014	09/30/2014	100.070	99.850	99.9	1

LG&E	C1S	897306	10/2014	09/30/2014	100.080	99.880	100.0	100.0	1
LG&E	C1S	897307	10/2014	09/30/2014	100.060	99.890	99.9	99.9	1
LG&E	C1S	897308	10/2014	09/30/2014	100.060	99.830	100.0	100.0	1
LG&E	C1S	897309	10/2014	09/30/2014	100.090	99.930	100.1	100.1	1
LG&E	C1S	897310	10/2014	09/30/2014	100.090	99.820	99.9	99.9	1
LG&E	C1S	897311	10/2014	09/30/2014	100.090	99.910	100.1	100.1	1
LG&E	C1S	897312	10/2014	09/30/2014	100.090	99.930	100.0	100.0	1
LG&E	C1S	897313	10/2014	09/30/2014	100.070	99.890	99.9	99.9	1
LG&E	C1S	897314	10/2014	09/30/2014	100.100	99.840	100.0	100.0	1
LG&E	C1S	897315	10/2014	09/30/2014	100.080	99.900	100.0	100.0	1
LG&E	C1S	897316	10/2014	09/30/2014	100.080	99.830	99.9	99.9	1
LG&E	C1S	897317	10/2014	09/30/2014	100.070	99.940	100.0	100.0	1
LG&E	C1S	897318	10/2014	09/30/2014	100.080	99.840	99.9	99.9	1
LG&E	C1S	897319	10/2014	09/30/2014	100.080	99.900	100.0	100.0	1
LG&E	C1S	897320	10/2014	09/30/2014	100.080	100.000	100.0	100.0	1
LG&E	C1S	897321	10/2014	09/30/2014	100.090	99.950	100.0	100.0	1
LG&E	C1S	897322	10/2014	09/30/2014	100.080	99.990	100.0	100.0	1
LG&E	C1S	897323	10/2014	09/30/2014	100.100	99.930	100.0	100.0	1
LG&E	C1S	897324	10/2014	09/30/2014	100.080	99.830	99.9	99.9	1
LG&E	C1S	897325	10/2014	09/30/2014	100.090	99.940	100.1	100.1	1
LG&E	C1S	897326	10/2014	09/30/2014	100.100	99.930	100.0	100.0	1
LG&E	C1S	897327	10/2014	09/30/2014	100.090	99.950	100.1	100.1	1
LG&E	C1S	897328	10/2014	09/30/2014	100.080	99.880	100.1	100.1	1
LG&E	C1S	897329	10/2014	09/30/2014	100.090	99.910	100.0	100.0	1
LG&E	C1S	897330	10/2014	09/30/2014	100.090	99.840	99.9	99.9	1
LG&E	C1S	897331	10/2014	09/30/2014	100.060	99.940	100.0	100.0	1
LG&E	C1S	897332	10/2014	09/30/2014	100.090	99.820	100.0	100.0	1
LG&E	C1S	897333	10/2014	09/30/2014	100.100	99.850	100.0	100.0	1
LG&E	C1S	897334	10/2014	09/30/2014	100.060	99.910	99.9	99.9	1
LG&E	C1S	897335	10/2014	09/30/2014	100.090	99.840	100.0	100.0	1
LG&E	C1S	897336	10/2014	09/30/2014	100.070	99.890	100.0	100.0	1
LG&E	C1S	897337	10/2014	09/30/2014	100.070	99.810	100.0	100.0	1

LG&E	C1S	897338	10/2014	09/30/2014	100.070	99.890	100.1	1
LG&E	C1S	897339	10/2014	09/30/2014	100.060	99.890	100.0	1
LG&E	C1S	897340	10/2014	09/30/2014	100.100	99.910	100.0	1
LG&E	C1S	897341	10/2014	09/30/2014	100.060	99.910	100.0	1
LG&E	C1S	897342	10/2014	09/30/2014	100.090	99.960	99.9	1
LG&E	C1S	897343	10/2014	09/30/2014	100.070	99.860	100.0	1
LG&E	C1S	897344	10/2014	09/30/2014	100.080	99.850	100.0	1
LG&E	C1S	897345	10/2014	09/30/2014	100.070	99.870	100.0	1
LG&E	C1S	897346	10/2014	09/30/2014	100.110	99.920	100.1	1
LG&E	C1S	897347	10/2014	09/30/2014	100.090	99.960	100.0	1
LG&E	C1S	897348	10/2014	09/30/2014	100.090	99.940	99.9	1
LG&E	C1S	897349	10/2014	09/30/2014	100.090	99.970	100.0	1
LG&E	C1S	897350	10/2014	09/30/2014	100.070	99.900	100.0	1
LG&E	C1S	897351	10/2014	09/30/2014	100.060	99.960	100.0	1
LG&E	C1S	897352	10/2014	09/30/2014	100.100	99.920	100.0	1
LG&E	C1S	897353	10/2014	09/30/2014	100.080	99.850	100.0	1
LG&E	C1S	897354	10/2014	09/30/2014	100.080	99.890	100.1	1
LG&E	C1S	897355	10/2014	09/30/2014	100.050	99.820	99.9	1
LG&E	C1S	897356	10/2014	09/30/2014	100.070	99.870	99.9	1
LG&E	C1S	897357	10/2014	09/30/2014	100.110	99.920	100.0	1
LG&E	C1S	897358	10/2014	09/30/2014	100.060	99.900	100.0	1
LG&E	C1S	897359	10/2014	09/30/2014	100.070	99.950	100.1	1
LG&E	C1S	897360	10/2014	09/30/2014	100.080	99.860	100.0	1
LG&E	C1S	897361	10/2014	09/30/2014	100.070	99.920	99.9	1
LG&E	C1S	897362	10/2014	09/30/2014	100.070	99.860	100.1	1
LG&E	C1S	897363	10/2014	09/30/2014	100.060	99.850	100.0	1
LG&E	C1S	897364	10/2014	09/30/2014	100.060	99.900	100.0	1
LG&E	C1S	897365	10/2014	09/30/2014	100.060	99.910	99.9	1
LG&E	C1S	897366	10/2014	09/30/2014	100.070	99.890	100.0	1
LG&E	C1S	897367	10/2014	09/30/2014	100.100	99.950	100.0	1
LG&E	C1S	897368	10/2014	09/30/2014	100.100	99.920	100.0	1
LG&E	C1S	897369	10/2014	09/30/2014	100.100	99.950	100.0	1

LG&E	C1S	897370	10/2014	09/30/2014	100.060	99.860	99.9	1
LG&E	C1S	897371	10/2014	09/30/2014	100.090	99.900	100.0	1
LG&E	C1S	897372	10/2014	09/30/2014	100.090	99.990	100.1	1
LG&E	C1S	897373	10/2014	09/30/2014	100.060	99.930	99.9	1
LG&E	C1S	897374	10/2014	09/30/2014	100.100	99.950	99.9	1
LG&E	C1S	897375	10/2014	09/30/2014	100.060	99.940	100.1	1
LG&E	C1S	897376	10/2014	09/30/2014	100.080	100.030	99.9	1
LG&E	C1S	897377	10/2014	09/30/2014	100.080	99.820	100.0	1
LG&E	C1S	897378	10/2014	09/30/2014	100.100	99.880	100.0	1
LG&E	C1S	897379	10/2014	09/30/2014	100.100	99.990	100.1	1
LG&E	C1S	897380	10/2014	09/30/2014	100.080	99.890	100.1	1
LG&E	C1S	897381	10/2014	09/30/2014	100.100	99.920	99.9	1
LG&E	C1S	897382	10/2014	09/30/2014	100.090	99.970	100.0	1
LG&E	C1S	897383	10/2014	09/30/2014	100.070	99.940	100.0	1
LG&E	C1S	897384	10/2014	09/30/2014	100.100	99.940	100.0	1
LG&E	C1S	897385	10/2014	09/30/2014	100.090	99.930	100.0	1
LG&E	C1S	897386	10/2014	09/30/2014	100.080	99.930	100.0	1
LG&E	C1S	897387	10/2014	09/30/2014	100.090	99.880	100.0	1
LG&E	C1S	897388	10/2014	09/30/2014	100.090	99.950	99.9	1
LG&E	C1S	897389	10/2014	09/30/2014	100.070	99.860	99.9	1
LG&E	C1S	897390	10/2014	09/30/2014	100.100	99.910	100.0	1
LG&E	C1S	897391	10/2014	09/30/2014	100.080	99.810	99.9	1
LG&E	C1S	897392	10/2014	09/30/2014	100.100	99.880	100.0	1
LG&E	C1S	897393	10/2014	09/30/2014	100.080	99.910	100.1	1
LG&E	C1S	897394	10/2014	09/30/2014	100.060	99.850	99.9	1
LG&E	C1S	897395	10/2014	09/30/2014	100.070	99.850	100.0	1
LG&E	C1S	897396	10/2014	09/30/2014	100.070	99.830	99.9	1
LG&E	C1S	897397	10/2014	09/30/2014	100.100	99.950	100.0	1
LG&E	C1S	897398	10/2014	09/30/2014	100.090	99.900	99.9	1
LG&E	C1S	897399	10/2014	09/30/2014	100.100	99.900	99.9	1
LG&E	C1S	897400	10/2014	09/30/2014	100.050	99.850	99.9	1
LG&E	C1S	897401	10/2014	09/30/2014	100.090	99.830	99.9	1

LG&E	897402	C1S	10/2014	09/30/2014	100.070	99.810	99.9	1
LG&E	897403	C1S	10/2014	09/30/2014	100.090	99.880	99.9	1
LG&E	897404	C1S	10/2014	09/30/2014	100.090	99.950	100.0	1
LG&E	897405	C1S	10/2014	09/30/2014	100.100	99.840	99.9	1
LG&E	897406	C1S	10/2014	09/30/2014	100.060	99.830	99.9	1
LG&E	897407	C1S	10/2014	09/30/2014	100.060	99.820	99.9	1
LG&E	897408	C1S	10/2014	09/30/2014	100.080	99.910	100.1	1
LG&E	897409	C1S	10/2014	09/30/2014	100.070	99.820	100.0	1
LG&E	897410	C1S	10/2014	09/30/2014	100.080	99.910	100.0	1
LG&E	897411	C1S	10/2014	09/30/2014	100.070	99.910	100.0	1
LG&E	897412	C1S	10/2014	09/30/2014	100.060	99.840	99.9	1
LG&E	897413	C1S	10/2014	09/30/2014	100.050	99.870	100.0	1
LG&E	897414	C1S	10/2014	09/30/2014	100.080	99.820	100.0	1
LG&E	897415	C1S	10/2014	09/30/2014	100.090	99.960	100.0	1
LG&E	897416	C1S	10/2014	09/30/2014	100.090	99.850	99.9	1
LG&E	897417	C1S	10/2014	09/30/2014	100.080	99.900	100.0	1
LG&E	897418	C1S	10/2014	09/30/2014	100.080	99.910	100.1	1
LG&E	897419	C1S	10/2014	09/30/2014	100.090	99.910	99.9	1
LG&E	897420	C1S	10/2014	09/30/2014	100.070	99.860	100.0	1
LG&E	897421	C1S	10/2014	09/30/2014	100.100	99.860	99.9	1
LG&E	897422	C1S	10/2014	09/30/2014	100.060	99.940	100.0	1
LG&E	897423	C1S	10/2014	09/30/2014	100.100	99.880	100.0	1
LG&E	897424	C1S	10/2014	09/30/2014	100.070	99.920	99.9	1
LG&E	897425	C1S	10/2014	09/30/2014	100.060	99.890	99.9	1
LG&E	897426	C1S	10/2014	09/30/2014	100.100	99.820	99.9	1
LG&E	897427	C1S	10/2014	09/30/2014	100.070	99.880	99.9	1
LG&E	897428	C1S	10/2014	09/30/2014	100.090	99.960	100.1	1
LG&E	897429	C1S	10/2014	09/30/2014	100.100	99.870	100.0	1
LG&E	897430	C1S	10/2014	09/30/2014	100.060	99.830	99.9	1
LG&E	897431	C1S	10/2014	09/30/2014	100.100	99.890	100.0	1
LG&E	897432	C1S	10/2014	09/30/2014	100.090	99.930	100.0	1
LG&E	897433	C1S	10/2014	09/30/2014	100.060	99.810	99.9	1

LG&E	C1S	897434	10/2014	09/30/2014	100.080	99.950	100.0	1
LG&E	C1S	897435	10/2014	09/30/2014	100.090	99.840	100.0	1
LG&E	C1S	897436	10/2014	09/30/2014	100.070	99.820	99.9	1
LG&E	C1S	897437	10/2014	09/30/2014	100.080	99.990	99.9	1
LG&E	C1S	897438	10/2014	09/30/2014	100.060	99.810	99.9	1
LG&E	C1S	897439	10/2014	09/30/2014	100.100	99.830	99.9	1
LG&E	C1S	897440	10/2014	09/30/2014	100.080	99.900	100.1	1
LG&E	C1S	897441	10/2014	09/30/2014	100.080	99.920	100.0	1
LG&E	C1S	897442	10/2014	09/30/2014	100.080	99.900	100.0	1
LG&E	C1S	897443	10/2014	09/30/2014	100.090	99.830	99.9	1
LG&E	C1S	897444	10/2014	09/30/2014	100.080	99.920	100.1	1
LG&E	C1S	897445	10/2014	09/30/2014	100.070	99.830	100.0	1
LG&E	C1S	897446	10/2014	09/30/2014	100.070	99.840	100.0	1
LG&E	C1S	897447	10/2014	09/30/2014	100.090	99.980	100.0	1
LG&E	C1S	897448	10/2014	09/30/2014	100.100	99.880	100.0	1
LG&E	C1S	897449	10/2014	09/30/2014	100.090	99.950	100.1	1
LG&E	C1S	897450	10/2014	09/30/2014	100.090	99.920	100.1	1
LG&E	C1S	897451	10/2014	09/30/2014	100.070	99.940	100.1	1
LG&E	C1S	897452	10/2014	09/30/2014	100.080	99.970	100.0	1
LG&E	C1S	897453	10/2014	09/30/2014	100.090	99.850	100.0	1
LG&E	C1S	897454	10/2014	09/30/2014	100.070	99.920	100.1	1
LG&E	C1S	897455	10/2014	09/30/2014	100.080	99.900	100.0	1
LG&E	C1S	897456	10/2014	09/30/2014	100.080	99.860	99.9	1
LG&E	C1S	897457	10/2014	09/30/2014	100.070	99.900	100.0	1
LG&E	C1S	897458	10/2014	09/30/2014	100.070	99.840	99.9	1
LG&E	C1S	897459	10/2014	09/30/2014	100.090	99.930	100.1	1
LG&E	C1S	897460	10/2014	09/30/2014	100.090	99.890	99.9	1
LG&E	C1S	897461	10/2014	09/30/2014	100.060	99.980	100.0	1
LG&E	C1S	897462	10/2014	09/30/2014	100.090	99.880	100.1	1
LG&E	C1S	897463	10/2014	09/30/2014	100.080	99.900	100.0	1
LG&E	C1S	897464	10/2014	09/30/2014	100.080	99.880	100.0	1
LG&E	C1S	897465	10/2014	09/30/2014	100.070	99.860	100.0	1

LG&E	C1S	897466	10/2014	09/30/2014	100.110	99.960	100.0	1
LG&E	C1S	897467	10/2014	09/30/2014	100.060	99.900	100.0	1
LG&E	C1S	897468	10/2014	09/30/2014	100.070	99.930	99.9	1
LG&E	C1S	897469	10/2014	09/30/2014	100.100	99.870	100.0	1
LG&E	C1S	897470	10/2014	09/30/2014	100.070	99.850	99.9	1
LG&E	C1S	897471	10/2014	09/30/2014	100.050	99.810	100.0	1
LG&E	C1S	897472	10/2014	09/30/2014	100.060	99.870	100.0	1
LG&E	C1S	897473	10/2014	09/30/2014	100.100	99.870	99.9	1
LG&E	C1S	897474	10/2014	09/30/2014	100.090	99.830	100.0	1
LG&E	C1S	897475	10/2014	09/30/2014	100.070	99.960	100.1	1
LG&E	C1S	897476	10/2014	09/30/2014	100.070	99.900	99.9	1
LG&E	C1S	897477	10/2014	09/30/2014	100.080	99.880	99.9	1
LG&E	C1S	897478	10/2014	09/30/2014	100.060	99.810	99.9	1
LG&E	C1S	897479	10/2014	09/30/2014	100.080	99.940	100.0	1
LG&E	C1S	897480	10/2014	09/30/2014	100.090	99.930	100.1	1
LG&E	C1S	897481	10/2014	09/30/2014	100.060	99.840	99.9	1
LG&E	C1S	897482	10/2014	09/30/2014	100.090	99.880	100.0	1
LG&E	C1S	897483	10/2014	09/30/2014	100.050	99.860	99.9	1
LG&E	C1S	897484	10/2014	09/30/2014	100.090	99.890	100.0	1
LG&E	C1S	897485	10/2014	09/30/2014	100.070	99.900	100.0	1
LG&E	C1S	897486	10/2014	09/30/2014	100.060	99.860	100.0	1
LG&E	C1S	897487	10/2014	09/30/2014	100.100	99.920	100.1	1
LG&E	C1S	897488	10/2014	09/30/2014	100.090	99.870	99.9	1
LG&E	C1S	897489	10/2014	09/30/2014	100.090	99.910	100.0	1
LG&E	C1S	897490	10/2014	09/30/2014	100.080	99.840	99.9	1
LG&E	C1S	897491	10/2014	09/30/2014	100.100	99.890	100.0	1
LG&E	C1S	897492	10/2014	09/30/2014	100.080	99.890	100.0	1
LG&E	C1S	897493	10/2014	09/30/2014	100.060	99.850	100.0	1
LG&E	C1S	897494	10/2014	09/30/2014	100.070	99.930	99.9	1
LG&E	C1S	897495	10/2014	09/30/2014	100.100	99.800	99.9	1
LG&E	C1S	897496	10/2014	09/30/2014	100.080	99.900	99.9	1
LG&E	C1S	897497	10/2014	09/30/2014	100.090	99.820	100.0	1

LG&E	897498	C1S	10/2014	09/30/2014	100.060	99.950	99.9	1
LG&E	897499	C1S	10/2014	09/30/2014	100.100	99.870	100.0	1
LG&E	897500	C1S	10/2014	09/30/2014	100.080	99.920	100.0	1
LG&E	897501	C1S	10/2014	09/30/2014	100.060	99.880	99.9	1
LG&E	897502	C1S	10/2014	09/30/2014	100.100	99.960	100.0	1
LG&E	897503	C1S	10/2014	09/30/2014	100.090	99.880	100.0	1
LG&E	897504	C1S	10/2014	09/30/2014	100.100	99.890	100.0	1
LG&E	897505	C1S	10/2014	09/30/2014	100.070	99.960	100.0	1
LG&E	897506	C1S	10/2014	09/30/2014	100.060	99.870	100.0	1
LG&E	897507	C1S	10/2014	09/30/2014	100.100	99.910	100.1	1
LG&E	897508	C1S	10/2014	09/30/2014	100.100	99.940	100.0	1
LG&E	897509	C1S	10/2014	09/30/2014	100.100	99.860	100.0	1
LG&E	897510	C1S	10/2014	09/30/2014	100.090	99.920	100.1	1
LG&E	897511	C1S	10/2014	09/30/2014	100.080	99.920	100.0	1
LG&E	897512	C1S	10/2014	09/30/2014	100.100	99.850	100.0	1
LG&E	897513	C1S	10/2014	09/30/2014	100.070	99.870	100.0	1
LG&E	897514	C1S	10/2014	09/30/2014	100.060	99.860	100.0	1
LG&E	897515	C1S	10/2014	09/30/2014	100.090	99.900	100.0	1
LG&E	897516	C1S	10/2014	09/30/2014	100.100	99.890	100.0	1
LG&E	897517	C1S	10/2014	09/30/2014	100.090	99.870	100.1	1
LG&E	897518	C1S	10/2014	09/30/2014	100.100	99.940	100.0	1
LG&E	897519	C1S	10/2014	09/30/2014	100.090	99.820	100.0	1
LG&E	897520	C1S	10/2014	09/30/2014	100.090	99.850	100.0	1
LG&E	897521	C1S	10/2014	09/30/2014	100.080	99.980	100.0	1
LG&E	897522	C1S	10/2014	09/30/2014	100.100	99.910	100.1	1
LG&E	897523	C1S	10/2014	09/30/2014	100.090	99.870	100.0	1
LG&E	897524	C1S	10/2014	09/30/2014	100.070	99.840	99.9	1
LG&E	897525	C1S	10/2014	09/30/2014	100.080	99.830	99.9	1
LG&E	897526	C1S	10/2014	09/30/2014	100.070	99.950	100.0	1
LG&E	897527	C1S	10/2014	09/30/2014	100.100	99.940	100.0	1
LG&E	897528	C1S	10/2014	09/30/2014	100.080	99.910	100.0	1
LG&E	897529	C1S	10/2014	09/30/2014	100.080	99.950	100.0	1

LG&E	C1S	897530	10/2014	09/30/2014	100.090	99.960	100.0	1
LG&E	C1S	897531	10/2014	09/30/2014	100.060	99.940	100.0	1
LG&E	C1S	897532	10/2014	09/30/2014	100.060	99.920	100.0	1
LG&E	C1S	897533	10/2014	09/30/2014	100.060	99.950	100.0	1
LG&E	C1S	897534	10/2014	09/30/2014	100.060	99.960	100.0	1
LG&E	C1S	897535	10/2014	09/30/2014	100.080	99.840	99.9	1
LG&E	C1S	897536	10/2014	09/30/2014	100.100	99.950	100.1	1
LG&E	C1S	897537	10/2014	09/30/2014	100.060	99.840	100.0	1
LG&E	C1S	897538	10/2014	09/30/2014	100.090	99.930	100.0	1
LG&E	C1S	897539	10/2014	09/30/2014	100.090	99.850	100.0	1
LG&E	C1S	897540	10/2014	09/30/2014	100.080	99.870	99.9	1
LG&E	C1S	897541	10/2014	09/30/2014	100.100	99.900	100.0	1
LG&E	C1S	897542	10/2014	09/30/2014	100.090	99.950	100.0	1
LG&E	C1S	897543	10/2014	09/30/2014	100.060	99.930	99.9	1
LG&E	C1S	897544	10/2014	09/30/2014	100.070	99.810	99.9	1
LG&E	C1S	897545	10/2014	09/30/2014	100.090	99.860	100.0	1
LG&E	C1S	897546	10/2014	09/30/2014	100.090	99.940	100.0	1
LG&E	C1S	897547	10/2014	09/30/2014	100.090	99.940	100.0	1
LG&E	C1S	897548	10/2014	09/30/2014	100.080	99.950	100.0	1
LG&E	C1S	897549	10/2014	09/30/2014	100.080	99.900	100.1	1
LG&E	C1S	897550	10/2014	09/30/2014	100.070	99.830	100.0	1
LG&E	C1S	897551	10/2014	09/30/2014	100.060	99.810	99.9	1
LG&E	C1S	897552	10/2014	09/30/2014	100.080	99.890	100.1	1
LG&E	C1S	897553	10/2014	09/30/2014	100.080	99.810	99.9	1
LG&E	C1S	897554	10/2014	09/30/2014	100.080	99.890	99.9	1
LG&E	C1S	897555	10/2014	09/30/2014	100.110	99.910	100.0	1
LG&E	C1S	897556	10/2014	09/30/2014	100.070	99.900	100.0	1
LG&E	C1S	897557	10/2014	09/30/2014	100.070	99.880	99.9	1
LG&E	C1S	897558	10/2014	09/30/2014	100.070	99.940	100.0	1
LG&E	C1S	897559	10/2014	09/30/2014	100.070	99.990	100.0	1
LG&E	C1S	897560	10/2014	09/30/2014	100.050	99.860	99.9	1
LG&E	C1S	897561	10/2014	09/30/2014	100.090	99.860	99.9	1

LG&E	C1S	897562	10/2014	09/30/2014	100.110	99.900	100.0	1
LG&E	C1S	897563	10/2014	09/30/2014	100.070	99.820	100.0	1
LG&E	C1S	897564	10/2014	09/30/2014	100.110	99.890	100.0	1
LG&E	C1S	897565	10/2014	09/30/2014	100.070	99.910	100.0	1
LG&E	C1S	897566	10/2014	09/30/2014	100.070	99.840	100.0	1
LG&E	C1S	897567	10/2014	09/30/2014	100.070	99.830	100.0	1
LG&E	C1S	897568	10/2014	09/30/2014	100.100	99.880	100.1	1
LG&E	C1S	897569	10/2014	09/30/2014	100.100	99.910	100.0	1
LG&E	C1S	897570	10/2014	09/30/2014	100.100	99.900	100.0	1
LG&E	C1S	897571	10/2014	09/30/2014	100.070	99.860	100.0	1
LG&E	C1S	897572	10/2014	09/30/2014	100.060	99.970	100.0	1
LG&E	C1S	897573	10/2014	09/30/2014	100.100	99.920	100.0	1
LG&E	C1S	897574	10/2014	09/30/2014	100.080	99.820	100.0	1
LG&E	C1S	897575	10/2014	09/30/2014	100.070	99.920	99.9	1
LG&E	C1S	897576	10/2014	09/30/2014	100.100	99.820	100.0	1
LG&E	C1S	897577	10/2014	09/30/2014	100.090	99.940	100.0	1
LG&E	C1S	897578	10/2014	09/30/2014	100.100	99.960	100.1	1
LG&E	C1S	897579	10/2014	09/30/2014	100.090	99.850	99.9	1
LG&E	C1S	897580	10/2014	09/30/2014	100.080	99.920	100.0	1
LG&E	C1S	897581	10/2014	09/30/2014	100.100	99.810	99.9	1
LG&E	C1S	897582	10/2014	09/30/2014	100.090	99.820	100.0	1
LG&E	C1S	897583	10/2014	09/30/2014	100.070	99.990	100.0	1
LG&E	C1S	897584	10/2014	09/30/2014	100.060	99.870	100.0	1
LG&E	C1S	897585	10/2014	09/30/2014	100.090	99.880	100.0	1
LG&E	C1S	897586	10/2014	09/30/2014	100.060	99.840	99.9	1
LG&E	C1S	897587	10/2014	09/30/2014	100.100	99.880	99.9	1
LG&E	C1S	897588	10/2014	09/30/2014	100.100	99.910	100.1	1
LG&E	C1S	897589	10/2014	09/30/2014	100.110	99.940	100.0	1
LG&E	C1S	897590	10/2014	09/30/2014	100.060	99.880	100.0	1
LG&E	C1S	897591	10/2014	09/30/2014	100.070	99.880	100.0	1
LG&E	C1S	897592	10/2014	09/30/2014	100.090	99.940	99.9	1
LG&E	C1S	897593	10/2014	09/30/2014	100.050	99.930	99.9	1

LG&E	C1S	897594	10/2014	09/30/2014	100.090	99.900	99.9	1
LG&E	C1S	897595	10/2014	09/30/2014	100.090	99.820	99.9	1
LG&E	C1S	897596	10/2014	09/30/2014	100.060	99.890	100.0	1
LG&E	C1S	897597	10/2014	09/30/2014	100.090	99.920	100.0	1
LG&E	C1S	897598	10/2014	09/30/2014	100.060	99.880	99.9	1
LG&E	C1S	897599	10/2014	09/30/2014	100.070	99.970	100.0	1
LG&E	C1S	897600	10/2014	09/30/2014	100.100	99.920	100.0	1
LG&E	C1S	897601	10/2014	09/30/2014	100.070	99.830	100.0	1
LG&E	C1S	897602	10/2014	09/30/2014	100.090	99.870	100.1	1
LG&E	C1S	897603	10/2014	09/30/2014	100.070	99.920	100.0	1
LG&E	C1S	897604	10/2014	09/30/2014	100.070	100.010	100.0	1
LG&E	C1S	897605	10/2014	09/30/2014	100.060	99.850	99.9	1
LG&E	C1S	897606	10/2014	09/30/2014	100.080	99.930	100.0	1
LG&E	C1S	897607	10/2014	09/30/2014	100.090	99.930	100.0	1
LG&E	C1S	897608	10/2014	09/30/2014	100.080	99.930	100.0	1
LG&E	C1S	897609	10/2014	09/30/2014	100.080	99.930	100.0	1
LG&E	C1S	897610	10/2014	09/30/2014	100.100	99.860	100.0	1
LG&E	C1S	897611	10/2014	09/30/2014	100.100	99.820	100.0	1
LG&E	C1S	897612	10/2014	09/30/2014	100.090	99.860	99.9	1
LG&E	C1S	897613	10/2014	09/30/2014	100.070	99.920	100.0	1
LG&E	C1S	897614	10/2014	09/30/2014	100.080	99.940	99.9	1
LG&E	C1S	897615	10/2014	09/30/2014	100.090	99.970	100.0	1
LG&E	C1S	897616	10/2014	09/30/2014	100.060	99.910	100.0	1
LG&E	C1S	897617	10/2014	09/30/2014	100.080	99.900	100.0	1
LG&E	C1S	897618	10/2014	09/30/2014	100.090	99.900	100.0	1
LG&E	C1S	897619	10/2014	09/30/2014	100.100	99.910	100.0	1
LG&E	C1S	897620	10/2014	09/30/2014	100.080	99.850	100.0	1
LG&E	C1S	897621	10/2014	09/30/2014	100.110	99.990	100.0	1
LG&E	C1S	897622	10/2014	09/30/2014	100.100	99.830	100.0	1
LG&E	C1S	897623	10/2014	09/30/2014	100.090	99.900	99.9	1
LG&E	C1S	897624	10/2014	09/30/2014	100.090	99.950	100.0	1
LG&E	C1S	897625	10/2014	09/30/2014	100.080	99.930	100.0	1

LG&E	C1S	897626	10/2014	09/30/2014	100.080	99.880	100.0	1
LG&E	C1S	897627	10/2014	09/30/2014	100.100	99.970	100.0	1
LG&E	C1S	897628	10/2014	09/30/2014	100.080	99.970	100.0	1
LG&E	C1S	897629	10/2014	09/30/2014	100.070	99.850	100.0	1
LG&E	C1S	897630	10/2014	09/30/2014	100.060	99.870	99.9	1
LG&E	C1S	897631	10/2014	09/30/2014	100.100	99.980	100.0	1
LG&E	C1S	897632	10/2014	09/30/2014	100.090	99.940	99.9	1
LG&E	C1S	897633	10/2014	09/30/2014	100.070	99.840	99.9	1
LG&E	C1S	897634	10/2014	09/30/2014	100.080	99.930	99.9	1
LG&E	C1S	897635	10/2014	09/30/2014	100.060	99.930	100.0	1
LG&E	C1S	897636	10/2014	09/30/2014	100.060	99.800	99.9	1
LG&E	C1S	897637	10/2014	09/30/2014	100.100	99.940	100.1	1
LG&E	C1S	897638	10/2014	09/30/2014	100.090	99.860	100.0	1
LG&E	C1S	897834	12/2014	12/16/2014	100.080	99.820	100.0	1
LG&E	C1S	897835	12/2014	12/16/2014	100.070	99.910	100.0	1
LG&E	C1S	897836	12/2014	12/16/2014	100.060	99.860	100.0	1
LG&E	C1S	897837	12/2014	12/16/2014	100.100	99.980	100.0	1
LG&E	C1S	897838	12/2014	12/16/2014	100.070	99.850	100.0	1
LG&E	C1S	897839	12/2014	12/16/2014	100.080	99.840	100.0	1
LG&E	C1S	897840	12/2014	12/16/2014	100.080	99.890	100.1	1
LG&E	C1S	897841	12/2014	12/16/2014	100.090	99.880	100.0	1
LG&E	C1S	897842	12/2014	12/16/2014	100.090	99.940	100.0	1
LG&E	C1S	897843	12/2014	12/16/2014	100.090	99.980	100.0	1
LG&E	C1S	897844	12/2014	12/16/2014	100.070	99.930	100.0	1
LG&E	C1S	897845	12/2014	12/16/2014	100.100	99.920	100.1	1
LG&E	C1S	897846	12/2014	12/16/2014	100.100	99.900	100.0	1
LG&E	C1S	897847	12/2014	12/16/2014	100.060	99.910	100.0	1
LG&E	C1S	897848	12/2014	12/16/2014	100.060	99.860	99.9	1
LG&E	C1S	897849	12/2014	12/16/2014	100.080	99.930	100.0	1
LG&E	C1S	897850	12/2014	12/16/2014	100.090	99.950	99.9	1
LG&E	C1S	897851	12/2014	12/16/2014	100.080	99.870	100.0	1
LG&E	C1S	897852	12/2014	12/16/2014	100.070	99.840	100.0	1

LG&E	897853	C1S	12/2014	12/16/2014	100.090	100.000	100.0	1
LG&E	897854	C1S	12/2014	12/16/2014	100.080	99.940	100.1	1
LG&E	897855	C1S	12/2014	12/16/2014	100.080	99.840	100.0	1
LG&E	897856	C1S	12/2014	12/16/2014	100.080	99.930	100.0	1
LG&E	897857	C1S	12/2014	12/16/2014	100.090	99.960	100.0	1
LG&E	897858	C1S	12/2014	12/16/2014	100.100	100.000	100.0	1
LG&E	897859	C1S	12/2014	12/16/2014	100.060	99.940	100.0	1
LG&E	897860	C1S	12/2014	12/16/2014	100.060	99.920	100.1	1
LG&E	897861	C1S	12/2014	12/16/2014	100.070	99.950	100.0	1
LG&E	897862	C1S	12/2014	12/16/2014	100.100	99.930	100.0	1
LG&E	897863	C1S	12/2014	12/16/2014	100.090	99.920	100.0	1
LG&E	897864	C1S	12/2014	12/16/2014	100.080	99.880	100.1	1
LG&E	897865	C1S	12/2014	12/16/2014	100.070	99.940	100.0	1
LG&E	897866	C1S	12/2014	12/16/2014	100.090	99.930	100.0	1
LG&E	897867	C1S	12/2014	12/16/2014	100.100	99.890	100.1	1
LG&E	897868	C1S	12/2014	12/16/2014	100.080	99.900	100.0	1
LG&E	897869	C1S	12/2014	12/16/2014	100.090	99.880	100.0	1
LG&E	897870	C1S	12/2014	12/16/2014	100.070	99.880	99.9	1
LG&E	897871	C1S	12/2014	12/16/2014	100.080	99.890	100.0	1
LG&E	897872	C1S	12/2014	12/16/2014	100.100	99.920	100.1	1
LG&E	897873	C1S	12/2014	12/16/2014	100.100	99.970	100.1	1
LG&E	897874	C1S	12/2014	12/16/2014	100.060	99.950	100.0	1
LG&E	897875	C1S	12/2014	12/16/2014	100.070	99.950	100.0	1
LG&E	897876	C1S	12/2014	12/16/2014	100.090	99.930	100.1	1
LG&E	897877	C1S	12/2014	12/16/2014	100.090	99.880	100.0	1
LG&E	897878	C1S	12/2014	12/16/2014	100.060	99.910	100.0	1
LG&E	897879	C1S	12/2014	12/16/2014	100.080	99.890	100.0	1
LG&E	897880	C1S	12/2014	12/16/2014	100.080	99.950	100.1	1
LG&E	897881	C1S	12/2014	12/16/2014	100.070	99.950	100.0	1
LG&E	897882	C1S	12/2014	12/16/2014	100.090	99.900	100.1	1
LG&E	897883	C1S	12/2014	12/16/2014	100.070	99.920	100.1	1
LG&E	897884	C1S	12/2014	12/16/2014	100.070	99.880	99.9	1

LG&E	C1S	897885	12/2014	12/16/2014	100.080	99.930	100.0	1
LG&E	C1S	897886	12/2014	12/16/2014	100.060	99.930	100.0	1
LG&E	C1S	897887	12/2014	12/16/2014	100.100	99.980	100.1	1
LG&E	C1S	897888	12/2014	12/16/2014	100.100	99.990	100.0	1
LG&E	C1S	897889	12/2014	12/16/2014	100.070	99.940	100.0	1
LG&E	C1S	897890	12/2014	12/16/2014	100.060	99.940	99.9	1
LG&E	C1S	897891	12/2014	12/16/2014	100.070	99.830	100.0	1
LG&E	C1S	897892	12/2014	12/16/2014	100.080	99.910	100.1	1
LG&E	C1S	897893	12/2014	12/16/2014	100.090	99.960	100.0	1
LG&E	C1S	897894	12/2014	12/16/2014	100.090	99.910	100.1	1
LG&E	C1S	897895	12/2014	12/16/2014	100.100	99.980	100.0	1
LG&E	C1S	897896	12/2014	12/16/2014	100.100	99.920	100.0	1
LG&E	C1S	897897	12/2014	12/16/2014	100.060	99.950	100.0	1
LG&E	C1S	897898	12/2014	12/16/2014	100.050	99.920	100.0	1
LG&E	C1S	897899	12/2014	12/16/2014	100.080	99.930	100.0	1
LG&E	C1S	897900	12/2014	12/16/2014	100.080	99.980	100.1	1
LG&E	C1S	897901	12/2014	12/16/2014	100.090	99.910	100.0	1
LG&E	C1S	897902	12/2014	12/16/2014	100.100	99.980	100.0	1
LG&E	C1S	897903	12/2014	12/16/2014	100.070	99.860	100.0	1
LG&E	C1S	897904	12/2014	12/16/2014	100.100	99.890	100.1	1
LG&E	C1S	897905	12/2014	12/16/2014	100.090	99.910	100.0	1
LG&E	C1S	897906	12/2014	12/16/2014	100.100	99.960	100.0	1
LG&E	C1S	897907	12/2014	12/16/2014	100.070	99.940	99.9	1
LG&E	C1S	897908	12/2014	12/16/2014	100.100	99.990	100.0	1
LG&E	C1S	897909	12/2014	12/16/2014	100.100	99.940	100.0	1
LG&E	C1S	897910	12/2014	12/16/2014	100.110	99.940	100.1	1
LG&E	C1S	897911	12/2014	12/16/2014	100.060	99.860	100.0	1
LG&E	C1S	897912	12/2014	12/16/2014	100.060	99.860	100.0	1
LG&E	C1S	897913	12/2014	12/16/2014	100.080	99.930	100.0	1
LG&E	C1S	897914	12/2014	12/16/2014	100.090	99.930	100.0	1
LG&E	C1S	897915	12/2014	12/16/2014	100.090	99.940	100.0	1
LG&E	C1S	897916	12/2014	12/16/2014	100.070	99.850	100.1	1

LG&E	C1S	897917	12/2014	12/16/2014	100.070	99.920	100.1	1
LG&E	C1S	897918	12/2014	12/16/2014	100.110	99.920	100.1	1
LG&E	C1S	897919	12/2014	12/16/2014	100.090	99.900	100.1	1
LG&E	C1S	897920	12/2014	12/16/2014	100.090	99.870	100.0	1
LG&E	C1S	897921	12/2014	12/16/2014	100.090	99.880	100.0	1
LG&E	C1S	897922	12/2014	12/16/2014	100.100	99.890	100.1	1
LG&E	C1S	897923	12/2014	12/16/2014	100.060	99.880	100.0	1
LG&E	C1S	897924	12/2014	12/16/2014	100.100	99.910	100.1	1
LG&E	C1S	897925	12/2014	12/16/2014	100.090	99.950	99.9	1
LG&E	C1S	897926	12/2014	12/16/2014	100.070	99.930	100.0	1
LG&E	C1S	897927	12/2014	12/16/2014	100.060	99.950	100.0	1
LG&E	C1S	897928	12/2014	12/16/2014	100.090	100.010	100.0	1
LG&E	C1S	897929	12/2014	12/16/2014	100.100	99.970	99.9	1
LG&E	C1S	897930	12/2014	12/16/2014	100.080	99.930	100.0	1
LG&E	C1S	897931	12/2014	12/16/2014	100.060	99.950	100.0	1
LG&E	C1S	897932	12/2014	12/16/2014	100.070	99.910	100.0	1
LG&E	C1S	897933	12/2014	12/16/2014	100.080	99.870	100.1	1
LG&E	C1S	897934	12/2014	12/16/2014	100.060	99.880	100.0	1
LG&E	C1S	897935	12/2014	12/16/2014	100.110	100.000	100.0	1
LG&E	C1S	897936	12/2014	12/16/2014	100.060	100.000	100.0	1
LG&E	C1S	897937	12/2014	12/16/2014	100.090	99.880	100.0	1
LG&E	C1S	897938	12/2014	12/16/2014	100.070	99.910	100.1	1
LG&E	C1S	897939	12/2014	12/16/2014	100.100	99.930	100.0	1
LG&E	C1S	897940	12/2014	12/16/2014	100.070	99.950	100.0	1
LG&E	C1S	897941	12/2014	12/16/2014	100.070	99.900	100.0	1
LG&E	C1S	897942	12/2014	12/16/2014	100.090	99.900	100.0	1
LG&E	C1S	897943	12/2014	12/16/2014	100.100	99.960	100.0	1
LG&E	C1S	897944	12/2014	12/16/2014	100.060	99.930	99.9	1
LG&E	C1S	897945	12/2014	12/16/2014	100.100	99.930	100.1	1
LG&E	C1S	897946	12/2014	12/16/2014	100.070	100.010	99.9	1
LG&E	C1S	897947	12/2014	12/16/2014	100.070	99.910	100.1	1
LG&E	C1S	897948	12/2014	12/16/2014	100.060	99.910	100.0	1

LG&E	C1S	897949	12/2014	12/16/2014	100.080	99.970	100.0	1
LG&E	C1S	897950	12/2014	12/16/2014	100.080	99.960	100.0	1
LG&E	C1S	897951	12/2014	12/16/2014	100.110	99.930	100.0	1
LG&E	C1S	897952	12/2014	12/16/2014	100.100	99.980	100.0	1
LG&E	C1S	897953	12/2014	12/16/2014	100.070	99.920	100.0	1
LG&E	C1S	897954	12/2014	12/16/2014	100.090	99.950	100.0	1
LG&E	C1S	897955	12/2014	12/16/2014	100.100	99.950	100.0	1
LG&E	C1S	897956	12/2014	12/16/2014	100.080	99.920	99.9	1
LG&E	C1S	897957	12/2014	12/16/2014	100.070	99.890	100.1	1
LG&E	C1S	897958	12/2014	12/16/2014	100.070	99.990	100.0	1
LG&E	C1S	897959	12/2014	12/16/2014	100.080	99.880	100.0	1
LG&E	C1S	897960	12/2014	12/16/2014	100.100	99.920	100.0	1
LG&E	C1S	897961	12/2014	12/16/2014	100.080	99.810	100.0	1
LG&E	C1S	897962	12/2014	12/16/2014	100.110	99.900	100.0	1
LG&E	C1S	897963	12/2014	12/16/2014	100.100	99.960	100.1	1
LG&E	C1S	897964	12/2014	12/16/2014	100.100	99.970	100.1	1
LG&E	C1S	897965	12/2014	12/16/2014	100.060	99.920	100.0	1
LG&E	C1S	897966	12/2014	12/16/2014	100.090	99.920	100.0	1
LG&E	C1S	897967	12/2014	12/16/2014	100.080	99.880	100.0	1
LG&E	C1S	897968	12/2014	12/16/2014	100.100	99.980	100.0	1
LG&E	C1S	897969	12/2014	12/16/2014	100.070	99.910	100.0	1
LG&E	C1S	897970	12/2014	12/16/2014	100.080	99.970	100.0	1
LG&E	C1S	897971	12/2014	12/16/2014	100.070	99.890	100.0	1
LG&E	C1S	897972	12/2014	12/16/2014	100.070	99.940	100.0	1
LG&E	C1S	897973	12/2014	12/16/2014	100.100	99.920	100.0	1
LG&E	C1S	897974	12/2014	12/16/2014	100.090	99.970	100.1	1
LG&E	C1S	897975	12/2014	12/16/2014	100.090	99.870	100.1	1
LG&E	C1S	897976	12/2014	12/16/2014	100.100	99.950	99.9	1
LG&E	C1S	897977	12/2014	12/16/2014	100.070	99.910	100.1	1
LG&E	C1S	897978	12/2014	12/16/2014	100.070	99.920	100.1	1
LG&E	C1S	897979	12/2014	12/16/2014	100.100	99.930	100.0	1
LG&E	C1S	897980	12/2014	12/16/2014	100.060	99.970	100.1	1

LG&E	C1S	897981	12/2014	12/16/2014	100.110	99.950	100.0	1
LG&E	C1S	897982	12/2014	12/16/2014	100.110	99.870	100.0	1
LG&E	C1S	897983	12/2014	12/16/2014	100.060	99.890	100.0	1
LG&E	C1S	897984	12/2014	12/16/2014	100.080	99.930	100.0	1
LG&E	C1S	897985	12/2014	12/16/2014	100.070	99.950	99.9	1
LG&E	C1S	897986	12/2014	12/16/2014	100.070	99.860	100.0	1
LG&E	C1S	897987	12/2014	12/16/2014	100.070	99.830	100.0	1
LG&E	C1S	897988	12/2014	12/16/2014	100.080	99.880	100.0	1
LG&E	C1S	897989	12/2014	12/16/2014	100.090	99.950	100.1	1
LG&E	C1S	897990	12/2014	12/16/2014	100.080	99.910	100.0	1
LG&E	C1S	897991	12/2014	12/16/2014	100.080	99.860	100.1	1
LG&E	C1S	897992	12/2014	12/16/2014	100.090	99.930	100.1	1
LG&E	C1S	897993	12/2014	12/16/2014	100.060	99.850	100.0	1
LG&E	C1S	897994	12/2014	12/16/2014	100.060	99.920	100.0	1
LG&E	C1S	897995	12/2014	12/16/2014	100.060	99.870	100.0	1
LG&E	C1S	897996	12/2014	12/16/2014	100.060	99.880	100.0	1
LG&E	C1S	897997	12/2014	12/16/2014	100.060	99.990	99.9	1
LG&E	C1S	897998	12/2014	12/16/2014	100.090	99.940	100.0	1
LG&E	C1S	897999	12/2014	12/16/2014	100.060	99.920	99.9	1
LG&E	C1S	898000	12/2014	12/16/2014	100.070	99.950	100.0	1
LG&E	C1S	898001	12/2014	12/16/2014	100.080	99.940	100.1	1
LG&E	C1S	898002	12/2014	12/16/2014	100.100	99.910	100.0	1
LG&E	C1S	898003	12/2014	12/16/2014	100.070	99.860	100.0	1
LG&E	C1S	898004	12/2014	12/16/2014	100.090	99.970	100.1	1
LG&E	C1S	898005	12/2014	12/16/2014	100.070	99.900	100.0	1
LG&E	C1S	898006	12/2014	12/16/2014	100.100	99.930	100.0	1
LG&E	C1S	898007	12/2014	12/16/2014	100.060	99.820	100.0	1
LG&E	C1S	898008	12/2014	12/16/2014	100.070	99.950	100.0	1
LG&E	C1S	898009	12/2014	12/16/2014	100.080	100.000	100.0	1
LG&E	C1S	898010	12/2014	12/16/2014	100.090	99.940	100.1	1
LG&E	C1S	898011	12/2014	12/16/2014	100.100	99.920	100.1	1
LG&E	C1S	898012	12/2014	12/16/2014	100.080	99.870	100.1	1

LG&E	C1S	898013	12/2014	12/16/2014	100.060	99.880	100.0	1
LG&E	C1S	898014	12/2014	12/16/2014	100.100	100.010	100.1	1
LG&E	C1S	898015	12/2014	12/16/2014	100.080	99.900	100.0	1
LG&E	C1S	898016	12/2014	12/16/2014	100.070	99.890	100.0	1
LG&E	C1S	898017	12/2014	12/16/2014	100.070	99.920	100.0	1
LG&E	C1S	898018	12/2014	12/16/2014	100.060	99.880	100.0	1
LG&E	C1S	898019	12/2014	12/16/2014	100.090	99.930	100.0	1
LG&E	C1S	898020	12/2014	12/16/2014	100.090	99.900	100.0	1
LG&E	C1S	898021	12/2014	12/16/2014	100.070	99.890	100.0	1
LG&E	C1S	898022	12/2014	12/16/2014	100.080	99.930	100.0	1
LG&E	C1S	898023	12/2014	12/16/2014	100.070	99.900	100.0	1
LG&E	C1S	898024	12/2014	12/16/2014	100.100	100.020	100.0	1
LG&E	C1S	898025	12/2014	12/16/2014	100.080	99.900	100.0	1
LG&E	C1S	898026	12/2014	12/16/2014	100.090	99.920	100.0	1
LG&E	C1S	898027	12/2014	12/16/2014	100.060	99.930	100.0	1
LG&E	C1S	898028	12/2014	12/16/2014	100.100	99.950	100.0	1
LG&E	C1S	898029	12/2014	12/16/2014	100.070	99.860	100.0	1
LG&E	C1S	898030	12/2014	12/16/2014	100.070	99.890	100.1	1
LG&E	C1S	898031	12/2014	12/16/2014	100.090	99.910	100.0	1
LG&E	C1S	898032	12/2014	12/16/2014	100.060	99.890	100.0	1
LG&E	C1S	898033	12/2014	12/16/2014	100.080	99.880	100.0	1
LG&E	C1S	898034	12/2014	12/16/2014	100.080	99.940	100.0	1
LG&E	C1S	898035	12/2014	12/16/2014	100.090	99.960	100.1	1
LG&E	C1S	898036	12/2014	12/16/2014	100.100	99.970	100.0	1
LG&E	C1S	898037	12/2014	12/16/2014	100.100	99.970	100.1	1
LG&E	C1S	898038	12/2014	12/16/2014	100.080	99.970	100.1	1
LG&E	C1S	898039	12/2014	12/16/2014	100.060	99.940	100.0	1
LG&E	C1S	898040	12/2014	12/16/2014	100.100	99.940	100.1	1
LG&E	C1S	898041	12/2014	12/16/2014	100.090	99.870	100.1	1
LG&E	C1S	898042	12/2014	12/16/2014	100.060	99.890	100.0	1
LG&E	C1S	898043	12/2014	12/16/2014	100.080	99.960	100.1	1
LG&E	C1S	898044	12/2014	12/16/2014	100.050	99.870	99.9	1

LG&E	C1S	898045	12/2014	12/16/2014	100.080	99.940	100.0	1
LG&E	C1S	898046	12/2014	12/16/2014	100.070	99.920	100.0	1
LG&E	C1S	898047	12/2014	12/16/2014	100.090	99.900	100.1	1
LG&E	C1S	898048	12/2014	12/16/2014	100.080	99.940	99.9	1
LG&E	C1S	898049	12/2014	12/16/2014	100.080	99.910	100.0	1
LG&E	C1S	898050	12/2014	12/16/2014	100.070	99.850	100.0	1
LG&E	C1S	898051	12/2014	12/16/2014	100.090	99.930	100.0	1
LG&E	C1S	898052	12/2014	12/16/2014	100.060	99.970	100.0	1
LG&E	C1S	898053	12/2014	12/16/2014	100.110	99.930	100.0	1
LG&E	C1S	898054	12/2014	12/16/2014	100.100	99.990	100.1	1
LG&E	C1S	898055	12/2014	12/16/2014	100.100	99.900	100.1	1
LG&E	C1S	898056	12/2014	12/16/2014	100.100	99.910	100.1	1
LG&E	C1S	898057	12/2014	12/16/2014	100.060	99.930	100.0	1
LG&E	C1S	898058	12/2014	12/16/2014	100.090	99.950	100.0	1
LG&E	C1S	898059	12/2014	12/16/2014	100.090	99.930	100.1	1
LG&E	C1S	898060	12/2014	12/16/2014	100.110	100.020	100.0	1
LG&E	C1S	898061	12/2014	12/16/2014	100.100	99.950	99.9	1
LG&E	C1S	898062	12/2014	12/16/2014	100.070	99.980	100.0	1
LG&E	C1S	898063	12/2014	12/16/2014	100.080	99.950	100.0	1
LG&E	C1S	898064	12/2014	12/16/2014	100.100	99.930	100.0	1
LG&E	C1S	898065	12/2014	12/16/2014	100.070	99.890	100.0	1
LG&E	C1S	898066	12/2014	12/16/2014	100.090	99.850	100.0	1
LG&E	C1S	898067	12/2014	12/16/2014	100.060	99.870	100.0	1
LG&E	C1S	898068	12/2014	12/16/2014	100.060	99.850	100.1	1
LG&E	C1S	898069	12/2014	12/16/2014	100.080	99.910	100.0	1
LG&E	C1S	898070	12/2014	12/16/2014	100.090	99.930	100.0	1
LG&E	C1S	898071	12/2014	12/16/2014	100.100	99.900	100.1	1
LG&E	C1S	898072	12/2014	12/16/2014	100.090	99.910	99.9	1
LG&E	C1S	898073	12/2014	12/16/2014	100.080	99.910	100.1	1
LG&E	C1S	898074	12/2014	12/16/2014	100.070	99.980	100.0	1
LG&E	C1S	898075	12/2014	12/16/2014	100.110	99.900	100.0	1
LG&E	C1S	898076	12/2014	12/16/2014	100.070	99.990	100.0	1

LG&E	C1S	898077	12/2014	12/16/2014	100.080	99.900	100.0	1
LG&E	C1S	898078	12/2014	12/16/2014	100.090	99.930	100.1	1
LG&E	C1S	898079	12/2014	12/16/2014	100.060	99.890	100.0	1
LG&E	C1S	898080	12/2014	12/16/2014	100.090	99.970	100.0	1
LG&E	C1S	898081	12/2014	12/16/2014	100.060	99.950	100.0	1
LG&E	C1S	898082	12/2014	12/16/2014	100.110	99.920	100.1	1
LG&E	C1S	898083	12/2014	12/16/2014	100.080	99.880	100.0	1
LG&E	C1S	898084	12/2014	12/16/2014	100.060	99.890	100.0	1
LG&E	C1S	898085	12/2014	12/16/2014	100.060	99.970	100.0	1
LG&E	C1S	898086	12/2014	12/16/2014	100.070	99.910	100.0	1
LG&E	C1S	898087	12/2014	12/16/2014	100.060	99.960	99.9	1
LG&E	C1S	898088	12/2014	12/16/2014	100.090	99.920	100.0	1
LG&E	C1S	898089	12/2014	12/16/2014	100.060	99.890	100.0	1
LG&E	C1S	898090	12/2014	12/16/2014	100.070	99.860	100.0	1
LG&E	C1S	898091	12/2014	12/16/2014	100.080	99.890	100.0	1
LG&E	C1S	898092	12/2014	12/16/2014	100.050	99.880	100.0	1
LG&E	C1S	898093	12/2014	12/16/2014	100.100	99.970	100.1	1
LG&E	C1S	898094	12/2014	12/16/2014	100.060	99.920	99.9	1
LG&E	C1S	898095	12/2014	12/16/2014	100.100	99.920	100.1	1
LG&E	C1S	898096	12/2014	12/16/2014	100.100	99.930	100.0	1
LG&E	C1S	898097	12/2014	12/16/2014	100.070	99.850	100.1	1
LG&E	C1S	898098	12/2014	12/16/2014	100.090	99.920	100.1	1
LG&E	C1S	898099	12/2014	12/16/2014	100.060	99.920	100.0	1
LG&E	C1S	898100	12/2014	12/16/2014	100.080	99.880	100.1	1
LG&E	C1S	898101	12/2014	12/16/2014	100.090	99.940	100.0	1
LG&E	C1S	898102	12/2014	12/16/2014	100.100	99.940	100.0	1
LG&E	C1S	898103	12/2014	12/16/2014	100.080	99.910	100.0	1
LG&E	C1S	898104	12/2014	12/16/2014	100.110	99.900	100.1	1
LG&E	C1S	898105	12/2014	12/16/2014	100.080	99.920	100.0	1
LG&E	C1S	898106	12/2014	12/16/2014	100.060	99.870	100.1	1
LG&E	C1S	898107	12/2014	12/16/2014	100.110	99.970	100.0	1
LG&E	C1S	898108	12/2014	12/16/2014	100.060	99.870	100.0	1

LG&E	C1S	898109	12/2014	12/16/2014	100.110	99.900	100.0	1
LG&E	C1S	898110	12/2014	12/16/2014	100.080	99.970	100.0	1
LG&E	C1S	898111	12/2014	12/16/2014	100.060	99.880	100.0	1
LG&E	C1S	898112	12/2014	12/16/2014	100.090	99.960	100.1	1
LG&E	C1S	898113	12/2014	12/16/2014	100.090	99.910	100.0	1
LG&E	C1S	898114	12/2014	12/16/2014	100.100	99.940	99.9	1
LG&E	C1S	898115	12/2014	12/16/2014	100.070	99.900	100.0	1
LG&E	C1S	898116	12/2014	12/16/2014	100.100	99.970	100.0	1
LG&E	C1S	898117	12/2014	12/16/2014	100.060	99.940	100.0	1
LG&E	C1S	898118	12/2014	12/16/2014	100.080	100.010	100.0	1
LG&E	C1S	898119	12/2014	12/16/2014	100.100	99.950	99.9	1
LG&E	C1S	898120	12/2014	12/16/2014	100.060	99.910	100.0	1
LG&E	C1S	898121	12/2014	12/16/2014	100.050	99.890	100.0	1
LG&E	C1S	898122	12/2014	12/16/2014	100.090	99.930	100.1	1
LG&E	C1S	898123	12/2014	12/16/2014	100.090	100.030	100.0	1
LG&E	C1S	898124	12/2014	12/16/2014	100.070	99.930	100.0	1
LG&E	C1S	898125	12/2014	12/16/2014	100.090	99.990	100.0	1
LG&E	C1S	898126	12/2014	12/16/2014	100.100	99.910	100.1	1
LG&E	C1S	898127	12/2014	12/16/2014	100.090	99.880	100.0	1
LG&E	C1S	898128	12/2014	12/16/2014	100.060	99.900	100.0	1
LG&E	C1S	898129	12/2014	12/16/2014	100.090	99.980	100.1	1
LG&E	C1S	898130	12/2014	12/16/2014	100.070	99.880	100.0	1
LG&E	C1S	898131	12/2014	12/16/2014	100.060	99.900	100.1	1
LG&E	C1S	898132	12/2014	12/16/2014	100.100	99.940	100.0	1
LG&E	C1S	898133	12/2014	12/16/2014	100.060	99.930	100.0	1
LG&E	C1S	898134	12/2014	12/16/2014	100.070	99.940	100.0	1
LG&E	C1S	898135	12/2014	12/16/2014	100.060	99.920	100.0	1
LG&E	C1S	898136	12/2014	12/16/2014	100.090	100.000	100.0	1
LG&E	C1S	898137	12/2014	12/16/2014	100.060	99.860	100.0	1
LG&E	C1S	898138	12/2014	12/16/2014	100.100	99.920	100.0	1
LG&E	C1S	898139	12/2014	12/16/2014	100.070	99.970	100.0	1
LG&E	C1S	898140	12/2014	12/16/2014	100.090	100.000	100.1	1

LG&E	898141	C1S	12/2014	12/16/2014	100.070	99.940	100.0	1
LG&E	898142	C1S	12/2014	12/16/2014	100.090	99.860	100.0	1
LG&E	898143	C1S	12/2014	12/16/2014	100.080	99.940	100.0	1
LG&E	898144	C1S	12/2014	12/16/2014	100.090	99.940	99.9	1
LG&E	898145	C1S	12/2014	12/16/2014	100.070	99.870	100.1	1
LG&E	898146	C1S	12/2014	12/16/2014	100.050	99.860	100.0	1
LG&E	898147	C1S	12/2014	12/16/2014	100.070	99.950	100.0	1
LG&E	898148	C1S	12/2014	12/16/2014	100.100	99.970	100.1	1
LG&E	898149	C1S	12/2014	12/16/2014	100.100	99.920	100.1	1
LG&E	898150	C1S	12/2014	12/16/2014	100.090	99.960	100.1	1
LG&E	898151	C1S	12/2014	12/16/2014	100.100	99.960	100.0	1
LG&E	898152	C1S	12/2014	12/16/2014	100.110	100.010	100.0	1
LG&E	898153	C1S	12/2014	12/16/2014	100.060	99.880	99.9	1
LG&E	898154	C1S	12/2014	12/16/2014	100.100	99.920	100.0	1
LG&E	898155	C1S	12/2014	12/16/2014	100.110	99.940	100.1	1
LG&E	898156	C1S	12/2014	12/16/2014	100.100	99.940	100.0	1
LG&E	898157	C1S	12/2014	12/16/2014	100.100	99.940	100.0	1
LG&E	898158	C1S	12/2014	12/16/2014	100.080	99.940	100.0	1
LG&E	898159	C1S	12/2014	12/16/2014	100.090	100.010	100.0	1
LG&E	898160	C1S	12/2014	12/16/2014	100.100	100.000	100.1	1
LG&E	898161	C1S	12/2014	12/16/2014	100.070	99.910	100.0	1
LG&E	898162	C1S	12/2014	12/16/2014	100.080	99.900	100.0	1
LG&E	898163	C1S	12/2014	12/16/2014	100.060	99.850	100.0	1
LG&E	898164	C1S	12/2014	12/16/2014	100.090	99.930	100.0	1
LG&E	898165	C1S	12/2014	12/16/2014	100.100	99.930	100.1	1
LG&E	898166	C1S	12/2014	12/16/2014	100.070	99.900	100.1	1
LG&E	898167	C1S	12/2014	12/16/2014	100.090	100.000	100.1	1
LG&E	898168	C1S	12/2014	12/16/2014	100.080	99.930	100.1	1
LG&E	898169	C1S	12/2014	12/16/2014	100.100	99.990	100.0	1
LG&E	898170	C1S	12/2014	12/16/2014	100.110	99.950	100.1	1
LG&E	898171	C1S	12/2014	12/16/2014	100.090	99.900	100.1	1
LG&E	898172	C1S	12/2014	12/16/2014	100.070	99.870	100.0	1

LG&E	C1S	898173	12/2014	12/16/2014	100.080	99.960	100.0	1
LG&E	C1S	898174	12/2014	12/16/2014	100.100	100.000	100.1	1
LG&E	C1S	898175	12/2014	12/16/2014	100.060	99.910	100.0	1
LG&E	C1S	898176	12/2014	12/16/2014	100.070	99.960	99.9	1
LG&E	C1S	898177	12/2014	12/16/2014	100.080	99.950	100.1	1
LG&E	C1S	898178	12/2014	12/16/2014	100.070	99.920	100.1	1
LG&E	C1S	898179	12/2014	12/16/2014	100.080	99.950	100.0	1
LG&E	C1S	898180	12/2014	12/16/2014	100.080	99.940	100.1	1
LG&E	C1S	898181	12/2014	12/16/2014	100.090	99.930	100.1	1
LG&E	C1S	898182	12/2014	12/16/2014	100.060	99.890	100.0	1
LG&E	C1S	898183	12/2014	12/16/2014	100.090	99.870	100.0	1
LG&E	C1S	898184	12/2014	12/16/2014	100.090	99.950	100.0	1
LG&E	C1S	898185	12/2014	12/16/2014	100.090	99.890	100.0	1
LG&E	C1S	898186	12/2014	12/16/2014	100.090	99.950	100.1	1
LG&E	C1S	898187	12/2014	12/16/2014	100.080	99.900	100.1	1
LG&E	C1S	898188	12/2014	12/16/2014	100.090	99.960	100.1	1
LG&E	C1S	898189	12/2014	12/16/2014	100.070	99.950	100.0	1
LG&E	C1S	898190	12/2014	12/16/2014	100.070	99.830	100.0	1
LG&E	C1S	898191	12/2014	12/16/2014	100.080	99.960	100.1	1
LG&E	C1S	898192	12/2014	12/16/2014	100.080	99.980	100.0	1
LG&E	C1S	898193	12/2014	12/16/2014	100.060	99.920	100.0	1
LG&E	C1S	898194	12/2014	12/16/2014	100.070	99.910	100.0	1
LG&E	C1S	898195	12/2014	12/16/2014	100.060	99.910	99.9	1
LG&E	C1S	898196	12/2014	12/16/2014	100.060	99.830	100.0	1
LG&E	C1S	898197	12/2014	12/16/2014	100.100	99.990	100.0	1
LG&E	C1S	898198	12/2014	12/16/2014	100.090	99.930	100.0	1
LG&E	C1S	898199	12/2014	12/16/2014	100.060	99.930	100.0	1
LG&E	C1S	898200	12/2014	12/16/2014	100.090	99.970	100.1	1
LG&E	C1S	898201	12/2014	12/16/2014	100.110	99.930	100.1	1
LG&E	C1S	898202	12/2014	12/16/2014	100.100	99.930	100.0	1
LG&E	C1S	898203	12/2014	12/16/2014	100.080	99.930	100.0	1
LG&E	C1S	898204	12/2014	12/16/2014	100.090	99.960	100.1	1

LG&E	C1S	898205	12/2014	12/16/2014	100.080	99.960	100.0	1
LG&E	C1S	898206	12/2014	12/16/2014	100.060	99.890	100.0	1
LG&E	C1S	898207	12/2014	12/16/2014	100.070	99.850	100.0	1
LG&E	C1S	898208	12/2014	12/16/2014	100.070	99.900	100.1	1
LG&E	C1S	898209	12/2014	12/16/2014	100.060	99.920	100.0	1
LG&E	C1S	898210	12/2014	12/16/2014	100.080	99.890	100.0	1
LG&E	C1S	898211	12/2014	12/16/2014	100.060	99.890	100.0	1
LG&E	C1S	898212	12/2014	12/16/2014	100.080	99.960	100.0	1
LG&E	C1S	898213	12/2014	12/16/2014	100.080	99.930	100.0	1
LG&E	C1S	898214	12/2014	12/16/2014	100.080	99.880	100.0	1
LG&E	C1S	898215	12/2014	12/16/2014	100.100	99.960	100.0	1
LG&E	C1S	898216	12/2014	12/16/2014	100.090	99.990	100.0	1
LG&E	C1S	898217	12/2014	12/16/2014	100.100	100.000	100.1	1
LG&E	C1S	898218	12/2014	12/16/2014	100.080	99.910	99.9	1
LG&E	C1S	898219	12/2014	12/16/2014	100.090	99.950	100.0	1
LG&E	C1S	898220	12/2014	12/16/2014	100.090	99.990	100.0	1
LG&E	C1S	898221	12/2014	12/16/2014	100.070	99.850	100.0	1
LG&E	C1S	898222	12/2014	12/16/2014	100.060	99.870	100.0	1
LG&E	C1S	898223	12/2014	12/16/2014	100.100	99.980	100.1	1
LG&E	C1S	898224	12/2014	12/16/2014	100.090	99.940	100.1	1
LG&E	C1S	898225	12/2014	12/16/2014	100.100	99.980	100.0	1
LG&E	C1S	898226	12/2014	12/16/2014	100.110	99.990	100.0	1
LG&E	C1S	898227	12/2014	12/16/2014	100.070	99.890	100.0	1
LG&E	C1S	898228	12/2014	12/16/2014	100.060	99.910	100.0	1
LG&E	C1S	898229	12/2014	12/16/2014	100.100	99.910	100.0	1
LG&E	C1S	898230	12/2014	12/16/2014	100.090	99.940	100.0	1
LG&E	C1S	898231	12/2014	12/16/2014	100.100	99.940	100.0	1
LG&E	C1S	898232	12/2014	12/16/2014	100.060	99.920	100.1	1
LG&E	C1S	898233	12/2014	12/16/2014	100.070	99.960	100.0	1
LG&E	C1S	898234	12/2014	12/16/2014	100.070	99.910	100.1	1
LG&E	C1S	898235	12/2014	12/16/2014	100.060	99.900	100.0	1
LG&E	C1S	898236	12/2014	12/16/2014	100.090	99.900	100.1	1

LG&E	C1S	898237	12/2014	12/16/2014	100.080	99.880	100.0	1
LG&E	C1S	898238	12/2014	12/16/2014	100.080	99.930	100.0	1
LG&E	C1S	898239	12/2014	12/16/2014	100.090	99.920	100.0	1
LG&E	C1S	898240	12/2014	12/16/2014	100.080	99.890	100.1	1
LG&E	C1S	898241	12/2014	12/16/2014	100.100	99.970	100.1	1
LG&E	C1S	898242	12/2014	12/16/2014	100.090	99.890	100.1	1
LG&E	C1S	898243	12/2014	12/16/2014	100.080	99.870	100.1	1
LG&E	C1S	898244	12/2014	12/16/2014	100.080	99.880	100.0	1
LG&E	C1S	898245	12/2014	12/16/2014	100.080	99.930	100.0	1
LG&E	C1S	898246	12/2014	12/16/2014	100.100	99.920	100.1	1
LG&E	C1S	898247	12/2014	12/16/2014	100.090	99.920	100.0	1
LG&E	C1S	898248	12/2014	12/16/2014	100.060	99.970	99.9	1
LG&E	C1S	898249	12/2014	12/16/2014	100.100	99.920	100.1	1
LG&E	C1S	898250	12/2014	12/16/2014	100.080	99.920	100.0	1
LG&E	C1S	898251	12/2014	12/16/2014	100.060	99.870	100.0	1
LG&E	C1S	898252	12/2014	12/16/2014	100.100	100.020	100.0	1
LG&E	C1S	898253	12/2014	12/16/2014	100.090	99.940	100.0	1
LG&E	C1S	898254	12/2014	12/16/2014	100.100	100.020	100.1	1
LG&E	C1S	898255	12/2014	12/16/2014	100.090	99.960	100.1	1
LG&E	C1S	898256	12/2014	12/16/2014	100.090	99.940	100.1	1
LG&E	C1S	898257	12/2014	12/16/2014	100.070	99.910	100.0	1
LG&E	C1S	898258	12/2014	12/16/2014	100.100	100.040	100.0	1
LG&E	C1S	898259	12/2014	12/16/2014	100.070	99.940	100.0	1
LG&E	C1S	898260	12/2014	12/16/2014	100.100	99.920	100.0	1
LG&E	C1S	898261	12/2014	12/16/2014	100.060	99.900	100.0	1
LG&E	C1S	898262	12/2014	12/16/2014	100.110	99.950	100.1	1
LG&E	C1S	898263	12/2014	12/16/2014	100.070	99.960	100.0	1
LG&E	C1S	898264	12/2014	12/16/2014	100.090	99.950	100.0	1
LG&E	C1S	898265	12/2014	12/16/2014	100.080	99.900	100.0	1
LG&E	C1S	898266	12/2014	12/16/2014	100.070	99.900	100.0	1
LG&E	C1S	898267	12/2014	12/16/2014	100.090	100.000	100.1	1
LG&E	C1S	898268	12/2014	12/16/2014	100.050	99.910	100.0	1

LG&E	C1S	898269	12/2014	12/16/2014	100.070	99.900	100.1	1
LG&E	C1S	898270	12/2014	12/16/2014	100.060	99.920	100.0	1
LG&E	C1S	898271	12/2014	12/16/2014	100.070	99.880	100.1	1
LG&E	C1S	898272	12/2014	12/16/2014	100.070	99.940	100.0	1
LG&E	C1S	898273	12/2014	12/16/2014	100.090	99.990	100.0	1
LG&E	C1S	898274	12/2014	12/16/2014	100.110	99.970	100.0	1
LG&E	C1S	898275	12/2014	12/16/2014	100.080	99.930	100.0	1
LG&E	C1S	898276	12/2014	12/16/2014	100.100	99.930	100.0	1
LG&E	C1S	898277	12/2014	12/16/2014	100.070	99.910	100.0	1
LG&E	C1S	898278	12/2014	12/16/2014	100.080	99.960	100.0	1
LG&E	C1S	898279	12/2014	12/16/2014	100.100	99.960	100.0	1
LG&E	C1S	898280	12/2014	12/16/2014	100.110	99.920	100.1	1
LG&E	C1S	898281	12/2014	12/16/2014	100.060	99.950	100.1	1
LG&E	C1S	898282	12/2014	12/16/2014	100.080	99.950	100.1	1
LG&E	C1S	898283	12/2014	12/16/2014	100.080	99.890	100.1	1
LG&E	C1S	898284	12/2014	12/16/2014	100.080	99.930	100.1	1
LG&E	C1S	898285	12/2014	12/16/2014	100.100	99.920	100.1	1
LG&E	C1S	898286	12/2014	12/16/2014	100.100	99.910	100.0	1
LG&E	C1S	898287	12/2014	12/16/2014	100.080	99.850	100.0	1
LG&E	C1S	898288	12/2014	12/16/2014	100.090	99.970	100.1	1
LG&E	C1S	898289	12/2014	12/16/2014	100.060	99.840	100.1	1
LG&E	C1S	898290	12/2014	12/16/2014	100.070	99.920	100.1	1
LG&E	C1S	898291	12/2014	12/16/2014	100.080	99.930	100.0	1
LG&E	C1S	898292	12/2014	12/16/2014	100.070	99.920	100.1	1
LG&E	C1S	898293	12/2014	12/16/2014	100.090	99.910	100.1	1
LG&E	C1S	898294	12/2014	12/16/2014	100.080	99.920	100.0	1
LG&E	C1S	898295	12/2014	12/16/2014	100.100	100.010	100.1	1
LG&E	C1S	898296	12/2014	12/16/2014	100.080	99.890	100.0	1
LG&E	C1S	898297	12/2014	12/16/2014	100.060	99.930	100.1	1
LG&E	C1S	898298	12/2014	12/16/2014	100.090	99.950	100.1	1
LG&E	C1S	898299	12/2014	12/16/2014	100.080	99.900	100.1	1
LG&E	C1S	898300	12/2014	12/16/2014	100.060	99.900	100.1	1

LG&E	C1S	898301	12/2014	12/16/2014	100.090	99.950	100.1	1
LG&E	C1S	898302	12/2014	12/16/2014	100.090	99.890	100.1	1
LG&E	C1S	898303	12/2014	12/16/2014	100.110	99.900	100.1	1
LG&E	C1S	898304	12/2014	12/16/2014	100.100	99.950	100.0	1
LG&E	C1S	898305	12/2014	12/16/2014	100.080	99.890	100.1	1
LG&E	C1S	898306	12/2014	12/16/2014	100.090	99.870	100.0	1
LG&E	C1S	898307	12/2014	12/16/2014	100.090	100.000	100.0	1
LG&E	C1S	898308	12/2014	12/16/2014	100.060	99.950	100.0	1
LG&E	C1S	898309	12/2014	12/16/2014	100.090	99.950	100.1	1
LG&E	C1S	898310	12/2014	12/16/2014	100.060	99.940	100.1	1
LG&E	C1S	898311	12/2014	12/16/2014	100.100	99.920	100.1	1
LG&E	C1S	898312	12/2014	12/16/2014	100.100	99.990	100.0	1
LG&E	C1S	898313	12/2014	12/16/2014	100.080	99.850	100.1	1
LG&E	C1S	898314	12/2014	12/16/2014	100.070	99.890	100.1	1
LG&E	C1S	898315	12/2014	12/16/2014	100.080	99.990	100.1	1
LG&E	C1S	898316	12/2014	12/16/2014	100.060	99.950	100.0	1
LG&E	C1S	898317	12/2014	12/16/2014	100.060	99.890	100.0	1
LG&E	C1S	898318	12/2014	12/16/2014	100.090	99.960	100.1	1
LG&E	C1S	898319	12/2014	12/16/2014	100.080	99.860	100.1	1
LG&E	C1S	898320	12/2014	12/16/2014	100.090	100.000	99.9	1
LG&E	C1S	898321	12/2014	12/16/2014	100.080	99.910	100.0	1
LG&E	C1S	898322	12/2014	12/16/2014	100.080	99.900	100.0	1
LG&E	C1S	898323	12/2014	12/16/2014	100.080	99.900	100.0	1
LG&E	C1S	898324	12/2014	12/16/2014	100.080	99.900	100.0	1
LG&E	C1S	898325	12/2014	12/16/2014	100.090	99.900	100.1	1
LG&E	C1S	898326	12/2014	12/16/2014	100.060	99.830	100.0	1
LG&E	C1S	898327	12/2014	12/16/2014	100.060	99.890	100.0	1
LG&E	C1S	898328	12/2014	12/16/2014	100.110	99.930	100.1	1
LG&E	C1S	898329	12/2014	12/16/2014	100.080	99.940	100.0	1
LG&E	C1S	898330	12/2014	12/16/2014	100.060	99.910	100.0	1
LG&E	C1S	898331	12/2014	12/16/2014	100.060	99.870	100.0	1
LG&E	C1S	898332	12/2014	12/16/2014	100.070	99.910	100.0	1

LG&E	C1S	898333	12/2014	12/16/2014	100.080	99.900	100.0	1
LG&E	C1S	898334	12/2014	12/16/2014	100.070	99.900	100.1	1
LG&E	C1S	898335	12/2014	12/16/2014	100.060	99.820	100.0	1
LG&E	C1S	898336	12/2014	12/16/2014	100.070	99.860	100.0	1
LG&E	C1S	898337	12/2014	12/16/2014	100.070	99.940	100.1	1
LG&E	C1S	898338	12/2014	12/16/2014	100.080	99.920	100.0	1
LG&E	C1S	898339	12/2014	12/16/2014	100.100	99.940	100.1	1
LG&E	C1S	898340	12/2014	12/16/2014	100.090	99.880	100.1	1
LG&E	C1S	898341	12/2014	12/16/2014	100.090	99.930	100.0	1
LG&E	C1S	898342	12/2014	12/16/2014	100.070	99.990	100.0	1
LG&E	C1S	898343	12/2014	12/16/2014	100.090	99.920	100.0	1
LG&E	C1S	898344	12/2014	12/16/2014	100.080	99.990	100.0	1
LG&E	C1S	898345	12/2014	12/16/2014	100.080	99.970	100.0	1
LG&E	C1S	898346	12/2014	12/16/2014	100.070	99.990	100.1	1
LG&E	C1S	898347	12/2014	12/16/2014	100.100	99.970	100.1	1
LG&E	C1S	898348	12/2014	12/16/2014	100.080	99.910	100.0	1
LG&E	C1S	898349	12/2014	12/16/2014	100.070	99.860	99.9	1
LG&E	C1S	898350	12/2014	12/16/2014	100.070	99.930	100.1	1
LG&E	C1S	898351	12/2014	12/16/2014	100.100	99.970	100.0	1
LG&E	C1S	898352	12/2014	12/16/2014	100.100	99.910	100.0	1
LG&E	C1S	898353	12/2014	12/16/2014	100.100	99.940	99.9	1
LG&E	C1S	898354	12/2014	12/16/2014	100.100	99.910	100.1	1
LG&E	C1S	898355	12/2014	12/16/2014	100.100	100.000	100.0	1
LG&E	C1S	898356	12/2014	12/16/2014	100.070	99.910	100.0	1
LG&E	C1S	898357	12/2014	12/16/2014	100.060	99.880	99.9	1
LG&E	C1S	898358	12/2014	12/16/2014	100.110	99.930	100.0	1
LG&E	C1S	898359	12/2014	12/16/2014	100.080	99.950	100.0	1
LG&E	C1S	898360	12/2014	12/16/2014	100.060	99.950	100.0	1
LG&E	C1S	898361	12/2014	12/16/2014	100.110	99.910	100.1	1
LG&E	C1S	898362	12/2014	12/16/2014	100.060	99.860	100.0	1
LG&E	C1S	898363	12/2014	12/16/2014	100.060	99.930	99.9	1
LG&E	C1S	898364	12/2014	12/16/2014	100.070	99.890	100.0	1

LG&E	C1S	898365	12/2014	12/16/2014	100.060	99.920	100.0	1
LG&E	C1S	898366	12/2014	12/16/2014	100.060	99.880	100.0	1
LG&E	C1S	898367	12/2014	12/16/2014	100.100	99.990	100.0	1
LG&E	C1S	898368	12/2014	12/16/2014	100.090	99.950	100.0	1
LG&E	C1S	898369	12/2014	12/16/2014	100.100	99.920	100.0	1
LG&E	C1S	898370	12/2014	12/16/2014	100.090	99.870	100.1	1
LG&E	C1S	898371	12/2014	12/16/2014	100.100	99.850	100.0	1
LG&E	C1S	898372	12/2014	12/16/2014	100.090	100.020	100.0	1
LG&E	C1S	898373	12/2014	12/16/2014	100.090	99.970	100.0	1
LG&E	C1S	898374	12/2014	12/16/2014	100.090	99.900	100.1	1
LG&E	C1S	898375	12/2014	12/16/2014	100.100	99.910	100.1	1
LG&E	C1S	898376	12/2014	12/16/2014	100.110	99.990	100.1	1
LG&E	C1S	898377	12/2014	12/16/2014	100.090	99.920	100.0	1
LG&E	C1S	898378	12/2014	12/16/2014	100.110	99.960	100.1	1
LG&E	C1S	898379	12/2014	12/16/2014	100.090	99.950	100.0	1
LG&E	C1S	898380	12/2014	12/16/2014	100.100	99.970	100.1	1
LG&E	C1S	898381	12/2014	12/16/2014	100.090	99.930	100.0	1
LG&E	C1S	898382	12/2014	12/16/2014	100.090	99.930	100.0	1
LG&E	C1S	898383	12/2014	12/16/2014	100.070	99.930	100.0	1
LG&E	C1S	898384	12/2014	12/16/2014	100.100	99.940	100.1	1
LG&E	C1S	898385	12/2014	12/16/2014	100.090	99.910	100.1	1
LG&E	C1S	898386	12/2014	12/16/2014	100.060	99.960	99.9	1
LG&E	C1S	898387	12/2014	12/16/2014	100.070	99.930	100.0	1
LG&E	C1S	898388	12/2014	12/16/2014	100.090	99.930	100.1	1
LG&E	C1S	898389	12/2014	12/16/2014	100.090	99.960	100.1	1
LG&E	C1S	898390	12/2014	12/16/2014	100.100	99.900	100.0	1
LG&E	C1S	898391	12/2014	12/16/2014	100.070	99.980	100.0	1
LG&E	C1S	898392	12/2014	12/16/2014	100.100	99.880	100.0	1
LG&E	C1S	898393	12/2014	12/16/2014	100.100	99.920	100.1	1
LG&E	C1S	898394	12/2014	12/16/2014	100.070	99.830	100.0	1
LG&E	C1S	898395	12/2014	12/16/2014	100.070	99.900	100.0	1
LG&E	C1S	898396	12/2014	12/16/2014	100.100	99.870	100.1	1

LG&E	C1S	898397	12/2014	12/16/2014	100.070	99.920	100.0	1
LG&E	C1S	898398	12/2014	12/16/2014	100.100	99.950	100.0	1
LG&E	C1S	898399	12/2014	12/16/2014	100.100	99.970	100.0	1
LG&E	C1S	898400	12/2014	12/16/2014	100.090	99.930	99.9	1
LG&E	C1S	898401	12/2014	12/16/2014	100.060	99.900	100.0	1
LG&E	C1S	898402	12/2014	12/16/2014	100.060	99.980	100.0	1
LG&E	C1S	898403	12/2014	12/16/2014	100.090	99.940	100.0	1
LG&E	C1S	898404	12/2014	12/16/2014	100.090	99.920	100.0	1
LG&E	C1S	898405	12/2014	12/16/2014	100.060	99.960	100.0	1
LG&E	C1S	898406	12/2014	12/16/2014	100.110	99.970	100.1	1
LG&E	C1S	898407	12/2014	12/16/2014	100.090	99.940	99.9	1
LG&E	C1S	898408	12/2014	12/16/2014	100.110	99.980	100.1	1
LG&E	C1S	898409	12/2014	12/16/2014	100.090	99.980	100.1	1
LG&E	C1S	898410	12/2014	12/16/2014	100.070	99.920	99.9	1
LG&E	C1S	898411	12/2014	12/16/2014	100.110	99.900	100.1	1
LG&E	C1S	898412	12/2014	12/16/2014	100.110	99.940	100.1	1
LG&E	C1S	898413	12/2014	12/16/2014	100.100	99.990	100.1	1
LG&E	C1S	898414	12/2014	12/16/2014	100.100	99.980	100.0	1
LG&E	C1S	898415	12/2014	12/16/2014	100.080	99.920	100.0	1
LG&E	C1S	898416	12/2014	12/16/2014	100.070	99.920	100.0	1
LG&E	C1S	898417	12/2014	12/16/2014	100.090	99.920	100.1	1
LG&E	C1S	898418	12/2014	12/16/2014	100.110	99.890	100.0	1
LG&E	C1S	898419	12/2014	12/16/2014	100.070	99.900	100.1	1
LG&E	C1S	898420	12/2014	12/16/2014	100.060	99.920	100.0	1
LG&E	C1S	898421	12/2014	12/16/2014	100.090	99.980	100.0	1
LG&E	C1S	898422	12/2014	12/16/2014	100.100	99.980	100.1	1
LG&E	C1S	898423	12/2014	12/16/2014	100.060	99.900	100.0	1
LG&E	C1S	898424	12/2014	12/16/2014	100.060	99.930	99.9	1
LG&E	C1S	898425	12/2014	12/16/2014	100.100	99.990	100.0	1
LG&E	C1S	898426	12/2014	12/16/2014	100.090	99.970	100.0	1
LG&E	C1S	898427	12/2014	12/16/2014	100.110	100.010	100.0	1
LG&E	C1S	898428	12/2014	12/16/2014	100.080	99.920	100.0	1

LG&E	898429	C1S	12/2014	12/16/2014	100.070	99.860	100.0	1
LG&E	898430	C1S	12/2014	12/16/2014	100.090	99.970	100.0	1
LG&E	898431	C1S	12/2014	12/16/2014	100.100	99.930	100.1	1
LG&E	898432	C1S	12/2014	12/16/2014	100.080	99.850	100.0	1
LG&E	898433	C1S	12/2014	12/16/2014	100.090	99.950	100.0	1
LG&E	898434	C1S	12/2014	12/16/2014	100.090	99.930	100.0	1
LG&E	898435	C1S	12/2014	12/16/2014	100.080	99.890	100.0	1
LG&E	898436	C1S	12/2014	12/16/2014	100.110	99.920	100.0	1
LG&E	898437	C1S	12/2014	12/16/2014	100.090	99.930	100.0	1
LG&E	898438	C1S	12/2014	12/16/2014	100.070	99.940	100.0	1
LG&E	898439	C1S	12/2014	12/16/2014	100.080	99.940	100.1	1
LG&E	898440	C1S	12/2014	12/16/2014	100.080	99.880	100.0	1
LG&E	898441	C1S	12/2014	12/16/2014	100.060	99.900	99.9	1
LG&E	898442	C1S	12/2014	12/16/2014	100.090	99.910	100.1	1
LG&E	898443	C1S	12/2014	12/16/2014	100.080	100.010	100.1	1
LG&E	898444	C1S	12/2014	12/16/2014	100.070	99.890	100.1	1
LG&E	898445	C1S	12/2014	12/16/2014	100.080	99.910	100.0	1
LG&E	898446	C1S	12/2014	12/16/2014	100.060	99.880	100.0	1
LG&E	898447	C1S	12/2014	12/16/2014	100.080	99.910	100.0	1
LG&E	898448	C1S	12/2014	12/16/2014	100.100	99.940	100.0	1
LG&E	898449	C1S	12/2014	12/16/2014	100.080	99.970	100.0	1
LG&E	898450	C1S	12/2014	12/16/2014	100.080	99.900	100.0	1
LG&E	898451	C1S	12/2014	12/16/2014	100.070	99.880	100.1	1
LG&E	898452	C1S	12/2014	12/16/2014	100.060	99.930	100.1	1
LG&E	898453	C1S	12/2014	12/16/2014	100.080	99.950	100.1	1
LG&E	898454	C1S	12/2014	12/16/2014	100.100	99.970	100.1	1
LG&E	898455	C1S	12/2014	12/16/2014	100.100	99.870	100.0	1
LG&E	898456	C1S	12/2014	12/16/2014	100.060	99.940	99.9	1
LG&E	898457	C1S	12/2014	12/16/2014	100.060	99.930	100.0	1
LG&E	898458	C1S	12/2014	12/16/2014	100.060	99.820	100.0	1
LG&E	898459	C1S	12/2014	12/16/2014	100.100	99.920	100.1	1
LG&E	898460	C1S	12/2014	12/16/2014	100.090	99.900	100.1	1

LG&E	C1S	898461	12/2014	12/16/2014	100.080	99.920	100.1	1
LG&E	C1S	898462	12/2014	12/16/2014	100.050	99.900	100.0	1
LG&E	C1S	898463	12/2014	12/16/2014	100.080	99.950	100.1	1
LG&E	C1S	898464	12/2014	12/16/2014	100.060	99.910	100.0	1
LG&E	C1S	898465	12/2014	12/16/2014	100.060	99.890	100.1	1
LG&E	C1S	898466	12/2014	12/16/2014	100.060	99.850	100.1	1
LG&E	C1S	898467	12/2014	12/16/2014	100.090	99.950	100.0	1
LG&E	C1S	898468	12/2014	12/16/2014	100.100	99.940	100.0	1
LG&E	C1S	898469	12/2014	12/16/2014	100.070	99.840	100.0	1
LG&E	C1S	898470	12/2014	12/16/2014	100.060	99.900	100.1	1
LG&E	C1S	898471	12/2014	12/16/2014	100.080	99.910	100.1	1
LG&E	C1S	898472	12/2014	12/16/2014	100.070	99.880	100.0	1
LG&E	C1S	898473	12/2014	12/16/2014	100.100	99.950	100.0	1
LG&E	C1S	898474	12/2014	12/16/2014	100.080	99.950	100.0	1
LG&E	C1S	898475	12/2014	12/16/2014	100.090	99.970	100.0	1
LG&E	C1S	898476	12/2014	12/16/2014	100.070	100.010	100.0	1
LG&E	C1S	898477	12/2014	12/16/2014	100.070	99.860	100.0	1
LG&E	C1S	898478	12/2014	12/16/2014	100.090	99.920	100.0	1
LG&E	C1S	898479	12/2014	12/16/2014	100.090	99.940	100.0	1
LG&E	C1S	898480	12/2014	12/16/2014	100.090	99.910	100.1	1
LG&E	C1S	898481	12/2014	12/16/2014	100.070	99.860	100.0	1
LG&E	C1S	898482	12/2014	12/16/2014	100.090	99.950	100.1	1
LG&E	C1S	898483	12/2014	12/16/2014	100.060	99.920	100.1	1
LG&E	C1S	898484	12/2014	12/16/2014	100.100	99.990	100.1	1
LG&E	C1S	898485	12/2014	12/16/2014	100.060	99.910	100.0	1
LG&E	C1S	898486	12/2014	12/16/2014	100.070	99.950	100.0	1
LG&E	C1S	898487	12/2014	12/16/2014	100.070	99.970	100.0	1
LG&E	C1S	898488	12/2014	12/16/2014	100.060	99.930	100.0	1
LG&E	C1S	898489	12/2014	12/16/2014	100.070	99.920	100.0	1
LG&E	C1S	898490	12/2014	12/16/2014	100.100	99.940	100.1	1
LG&E	C1S	898491	12/2014	12/16/2014	100.100	99.910	100.0	1
LG&E	C1S	898492	12/2014	12/16/2014	100.090	99.890	100.1	1

LG&E	C1S	898493	12/2014	12/16/2014	100.070	99.990	100.0	1
LG&E	C1S	898494	12/2014	12/16/2014	100.080	99.930	100.0	1
LG&E	C1S	898495	12/2014	12/16/2014	100.090	99.920	100.1	1
LG&E	C1S	898496	12/2014	12/16/2014	100.100	99.950	99.9	1
LG&E	C1S	898497	12/2014	12/16/2014	100.070	99.930	100.1	1
LG&E	C1S	898498	12/2014	12/16/2014	100.050	99.920	100.0	1
LG&E	C1S	898499	12/2014	12/16/2014	100.060	99.930	100.1	1
LG&E	C1S	898500	12/2014	12/16/2014	100.060	99.950	99.9	1
LG&E	C1S	898501	12/2014	12/16/2014	100.060	99.900	100.1	1
LG&E	C1S	898502	12/2014	12/16/2014	100.060	99.920	100.0	1
LG&E	C1S	898503	12/2014	12/16/2014	100.060	99.920	99.9	1
LG&E	C1S	898504	12/2014	12/16/2014	100.070	99.900	100.0	1
LG&E	C1S	898505	12/2014	12/16/2014	100.070	99.900	100.1	1
LG&E	C1S	898506	12/2014	12/16/2014	100.090	99.900	100.0	1
LG&E	C1S	898507	12/2014	12/16/2014	100.090	99.920	100.0	1
LG&E	C1S	898508	12/2014	12/16/2014	100.060	99.900	100.0	1
LG&E	C1S	898509	12/2014	12/16/2014	100.090	99.990	100.0	1
LG&E	C1S	898510	12/2014	12/16/2014	100.060	99.910	100.0	1
LG&E	C1S	898511	12/2014	12/16/2014	100.100	99.890	100.0	1
LG&E	C1S	898512	12/2014	12/16/2014	100.070	99.920	100.0	1
LG&E	C1S	898513	12/2014	12/16/2014	100.070	99.960	100.0	1
LG&E	C1S	898514	12/2014	12/16/2014	100.070	99.950	100.1	1
LG&E	C1S	898515	12/2014	12/16/2014	100.090	99.960	100.0	1
LG&E	C1S	898516	12/2014	12/16/2014	100.080	99.970	100.0	1
LG&E	C1S	898517	12/2014	12/16/2014	100.060	99.940	100.0	1
LG&E	C1S	898518	12/2014	12/16/2014	100.060	99.870	100.0	1
LG&E	C1S	898519	12/2014	12/16/2014	100.070	99.960	100.0	1
LG&E	C1S	898520	12/2014	12/16/2014	100.100	99.920	100.0	1
LG&E	C1S	898521	12/2014	12/16/2014	100.110	99.960	100.1	1
LG&E	C1S	898522	12/2014	12/16/2014	100.050	99.900	100.0	1
LG&E	C1S	898523	12/2014	12/16/2014	100.100	99.980	100.2	1
LG&E	C1S	898524	12/2014	12/16/2014	100.080	99.930	100.1	1

LG&E	C1S	898525	12/2014	12/16/2014	100.080	99.910	100.1	1
LG&E	C1S	898526	12/2014	12/16/2014	100.100	99.910	100.1	1
LG&E	C1S	898527	12/2014	12/16/2014	100.060	99.900	100.0	1
LG&E	C1S	898528	12/2014	12/16/2014	100.060	99.920	100.0	1
LG&E	C1S	898529	12/2014	12/16/2014	100.100	99.970	100.1	1
LG&E	C1S	898530	12/2014	12/16/2014	100.060	99.880	100.0	1
LG&E	C1S	898531	12/2014	12/16/2014	100.060	99.990	100.0	1
LG&E	C1S	898532	12/2014	12/16/2014	100.060	99.930	100.0	1
LG&E	C1S	898533	12/2014	12/16/2014	100.070	99.860	100.1	1
LG&E	C1S	898534	12/2014	12/16/2014	100.070	99.970	100.1	1
LG&E	C1S	898535	12/2014	12/16/2014	100.080	99.980	100.0	1
LG&E	C1S	898536	12/2014	12/16/2014	100.060	99.880	100.1	1
LG&E	C1S	898537	12/2014	12/16/2014	100.070	99.870	100.0	1
LG&E	C1S	898538	12/2014	12/16/2014	100.070	99.920	100.0	1
LG&E	C1S	898539	12/2014	12/16/2014	100.080	99.940	100.1	1
LG&E	C1S	898540	12/2014	12/16/2014	100.100	100.040	100.0	1
LG&E	C1S	898541	12/2014	12/16/2014	100.060	99.900	100.1	1
LG&E	C1S	898542	12/2014	12/16/2014	100.110	99.950	100.0	1
LG&E	C1S	898543	12/2014	12/16/2014	100.070	99.870	100.1	1
LG&E	C1S	898544	12/2014	12/16/2014	100.090	100.030	100.0	1
LG&E	C1S	898545	12/2014	12/16/2014	100.070	99.860	100.0	1
LG&E	C1S	898546	12/2014	12/16/2014	100.070	99.920	99.9	1
LG&E	C1S	898547	12/2014	12/16/2014	100.100	100.010	100.1	1
LG&E	C1S	898548	12/2014	12/16/2014	100.090	99.930	100.1	1
LG&E	C1S	898549	12/2014	12/16/2014	100.080	99.880	100.1	1
LG&E	C1S	898550	12/2014	12/16/2014	100.060	99.940	100.0	1
LG&E	C1S	898551	12/2014	12/16/2014	100.100	99.950	100.1	1
LG&E	C1S	898552	12/2014	12/16/2014	100.070	99.910	100.1	1
LG&E	C1S	898553	12/2014	12/16/2014	100.070	99.950	99.9	1
LG&E	C1S	898554	12/2014	12/16/2014	100.080	99.920	100.0	1
LG&E	C1S	898555	12/2014	12/16/2014	100.090	99.930	100.1	1
LG&E	C1S	898556	12/2014	12/16/2014	100.060	99.870	100.1	1

LG&E	898557	C1S	12/2014	12/16/2014	100.110	100.060	100.1	1
LG&E	898558	C1S	12/2014	12/16/2014	100.090	99.930	100.0	1
LG&E	898559	C1S	12/2014	12/16/2014	100.090	99.940	100.1	1
LG&E	898560	C1S	12/2014	12/16/2014	100.060	99.870	100.1	1
LG&E	898561	C1S	12/2014	12/16/2014	100.110	99.930	100.1	1
LG&E	898562	C1S	12/2014	12/16/2014	100.090	99.910	100.1	1
LG&E	898563	C1S	12/2014	12/16/2014	100.060	100.000	100.0	1
LG&E	898564	C1S	12/2014	12/16/2014	100.060	99.960	100.0	1
LG&E	898565	C1S	12/2014	12/16/2014	100.100	99.870	100.1	1
LG&E	898566	C1S	12/2014	12/16/2014	100.100	99.910	100.1	1
LG&E	898567	C1S	12/2014	12/16/2014	100.100	99.940	100.0	1
LG&E	898568	C1S	12/2014	12/16/2014	100.060	99.860	100.1	1
LG&E	898569	C1S	12/2014	12/16/2014	100.070	99.870	100.0	1
LG&E	898570	C1S	12/2014	12/16/2014	100.080	99.870	100.0	1
LG&E	898571	C1S	12/2014	12/16/2014	100.100	99.940	100.0	1
LG&E	898572	C1S	12/2014	12/16/2014	100.080	99.860	100.0	1
LG&E	898573	C1S	12/2014	12/16/2014	100.090	99.880	100.0	1
LG&E	898574	C1S	12/2014	12/16/2014	100.090	99.940	100.0	1
LG&E	898575	C1S	12/2014	12/16/2014	100.060	99.840	100.1	1
LG&E	898576	C1S	12/2014	12/16/2014	100.070	99.930	100.0	1
LG&E	898577	C1S	12/2014	12/16/2014	100.080	99.970	100.1	1
LG&E	898578	C1S	12/2014	12/16/2014	100.060	99.900	99.9	1
LG&E	898579	C1S	12/2014	12/16/2014	100.100	99.940	100.0	1
LG&E	898580	C1S	12/2014	12/16/2014	100.080	99.950	100.0	1
LG&E	898581	C1S	12/2014	12/16/2014	100.060	99.950	100.1	1
LG&E	898582	C1S	12/2014	12/16/2014	100.100	100.000	100.0	1
LG&E	898583	C1S	12/2014	12/16/2014	100.090	99.970	100.1	1
LG&E	898584	C1S	12/2014	12/16/2014	100.100	99.920	100.0	1
LG&E	898585	C1S	12/2014	12/16/2014	100.100	99.960	100.0	1
LG&E	898586	C1S	12/2014	12/16/2014	100.070	99.950	100.1	1
LG&E	898587	C1S	12/2014	12/16/2014	100.050	99.930	100.0	1
LG&E	898588	C1S	12/2014	12/16/2014	100.090	99.930	100.0	1

LG&E	C1S	898589	12/2014	12/16/2014	100.070	99.970	100.0	1
LG&E	C1S	898590	12/2014	12/16/2014	100.060	99.930	100.0	1
LG&E	C1S	898591	12/2014	12/16/2014	100.080	99.950	100.0	1
LG&E	C1S	898592	12/2014	12/16/2014	100.110	99.940	100.1	1
LG&E	C1S	898593	12/2014	12/16/2014	100.060	99.920	99.9	1
LG&E	C1S	898594	12/2014	12/16/2014	100.100	99.880	100.1	1
LG&E	C1S	898595	12/2014	12/16/2014	100.070	99.910	100.0	1
LG&E	C1S	898596	12/2014	12/16/2014	100.080	99.960	100.1	1
LG&E	C1S	898597	12/2014	12/16/2014	100.070	99.860	100.0	1
LG&E	C1S	898598	12/2014	12/16/2014	100.100	99.940	100.0	1
LG&E	C1S	898599	12/2014	12/16/2014	100.090	99.970	100.0	1
LG&E	C1S	898600	12/2014	12/16/2014	100.070	99.930	100.0	1
LG&E	C1S	898601	12/2014	12/16/2014	100.060	99.920	100.0	1
LG&E	C1S	898602	12/2014	12/16/2014	100.100	99.980	100.0	1
LG&E	C1S	898603	12/2014	12/16/2014	100.070	99.950	100.0	1
LG&E	C1S	898604	12/2014	12/16/2014	100.080	99.910	100.1	1
LG&E	C1S	898605	12/2014	12/16/2014	100.060	99.950	100.1	1
LG&E	C1S	898606	12/2014	12/16/2014	100.090	99.910	100.1	1
LG&E	C1S	898607	12/2014	12/16/2014	100.070	99.900	99.9	1
LG&E	C1S	898608	12/2014	12/16/2014	100.080	99.860	100.0	1
LG&E	C1S	898609	12/2014	12/16/2014	100.090	99.940	99.9	1
LG&E	C1S	898610	12/2014	12/16/2014	100.070	99.850	100.0	1
LG&E	C1S	898611	12/2014	12/16/2014	100.080	99.860	100.0	1
LG&E	C1S	898612	12/2014	12/16/2014	100.100	99.910	100.1	1
LG&E	C1S	898613	12/2014	12/16/2014	100.060	99.860	100.1	1
LG&E	C1S	898614	12/2014	12/16/2014	100.080	99.850	100.0	1
LG&E	C1S	898615	12/2014	12/16/2014	100.100	99.950	100.1	1
LG&E	C1S	898616	12/2014	12/16/2014	100.070	99.950	100.0	1
LG&E	C1S	898617	12/2014	12/16/2014	100.060	99.830	100.1	1
LG&E	C1S	898618	12/2014	12/16/2014	100.100	99.960	100.1	1
LG&E	C1S	898619	12/2014	12/16/2014	100.070	99.880	100.0	1
LG&E	C1S	898620	12/2014	12/16/2014	100.080	99.870	100.1	1

LG&E	C1S	898621	12/2014	12/16/2014	100.060	99.890	100.1	1
LG&E	C1S	898622	12/2014	12/16/2014	100.090	99.980	100.0	1
LG&E	C1S	898623	12/2014	12/16/2014	100.060	99.870	100.0	1
LG&E	C1S	898624	12/2014	12/16/2014	100.100	99.950	100.1	1
LG&E	C1S	898625	12/2014	12/16/2014	100.080	99.920	100.0	1
LG&E	C1S	898626	12/2014	12/16/2014	100.060	99.870	100.0	1
LG&E	C1S	898627	12/2014	12/16/2014	100.090	99.990	100.0	1
LG&E	C1S	898628	12/2014	12/16/2014	100.060	99.870	100.0	1
LG&E	C1S	898629	12/2014	12/16/2014	100.070	99.930	100.0	1
LG&E	C1S	898630	12/2014	12/16/2014	100.060	99.880	100.0	1
LG&E	C1S	898631	12/2014	12/16/2014	100.080	99.940	100.0	1
LG&E	C1S	898632	12/2014	12/16/2014	100.100	99.970	100.1	1
LG&E	C1S	898633	12/2014	12/16/2014	100.090	99.930	100.0	1
LG&E	C1S	898634	12/2014	12/16/2014	100.080	99.910	100.0	1
LG&E	C1S	898635	12/2014	12/16/2014	100.100	99.960	100.1	1
LG&E	C1S	898636	12/2014	12/16/2014	100.060	99.900	100.0	1
LG&E	C1S	898637	12/2014	12/16/2014	100.070	99.980	100.1	1
LG&E	C1S	898638	12/2014	12/16/2014	100.100	99.860	100.0	1
LG&E	C1S	898639	12/2014	12/16/2014	100.060	99.860	100.0	1
LG&E	C1S	898640	12/2014	12/16/2014	100.090	99.980	100.0	1
LG&E	C1S	898641	12/2014	12/16/2014	100.070	99.900	100.1	1
LG&E	C1S	898642	12/2014	12/16/2014	100.080	99.910	100.0	1
LG&E	C1S	898643	12/2014	12/16/2014	100.090	99.960	100.0	1
LG&E	C1S	898644	12/2014	12/16/2014	100.060	99.870	100.0	1
LG&E	C1S	898645	12/2014	12/16/2014	100.100	99.970	100.0	1
LG&E	C1S	898646	12/2014	12/16/2014	100.060	99.950	100.0	1
LG&E	C1S	898647	12/2014	12/16/2014	100.100	99.940	100.0	1
LG&E	C1S	898648	12/2014	12/16/2014	100.090	99.860	100.0	1
LG&E	C1S	898649	12/2014	12/16/2014	100.080	99.900	99.9	1
LG&E	C1S	898650	12/2014	12/16/2014	100.060	99.820	100.0	1
LG&E	C1S	898651	12/2014	12/16/2014	100.060	99.890	100.1	1
LG&E	C1S	898652	12/2014	12/16/2014	100.080	99.990	100.0	1

LG&E	C1S	898653	12/2014	12/16/2014	100.070	99.940	100.0	1
LG&E	C1S	898654	12/2014	12/16/2014	100.090	99.970	100.0	1
LG&E	C1S	898655	12/2014	12/16/2014	100.060	99.930	99.9	1
LG&E	C1S	898656	12/2014	12/16/2014	100.090	99.970	100.1	1
LG&E	C1S	898657	12/2014	12/16/2014	100.080	99.910	100.0	1
LG&E	C1S	898658	12/2014	12/16/2014	100.080	99.900	100.0	1
LG&E	C1S	898659	12/2014	12/16/2014	100.050	99.920	100.1	1
LG&E	C1S	898660	12/2014	12/16/2014	100.080	99.940	100.0	1
LG&E	C1S	898661	12/2014	12/16/2014	100.080	100.000	100.0	1
LG&E	C1S	898662	12/2014	12/16/2014	100.080	99.900	100.0	1
LG&E	C1S	898663	12/2014	12/16/2014	100.090	99.890	100.0	1
LG&E	C1S	898664	12/2014	12/16/2014	100.110	99.950	100.1	1
LG&E	C1S	898665	12/2014	12/16/2014	100.100	99.900	100.1	1
LG&E	C1S	898666	12/2014	12/16/2014	100.100	99.980	100.1	1
LG&E	C1S	898667	12/2014	12/16/2014	100.110	99.980	100.0	1
LG&E	C1S	898668	12/2014	12/16/2014	100.060	99.890	100.0	1
LG&E	C1S	898669	12/2014	12/16/2014	100.080	99.890	100.0	1
LG&E	C1S	898670	12/2014	12/16/2014	100.100	99.860	100.0	1
LG&E	C1S	898671	12/2014	12/16/2014	100.050	99.950	99.9	1
LG&E	C1S	898672	12/2014	12/16/2014	100.100	99.990	100.1	1
LG&E	C1S	898673	12/2014	12/16/2014	100.080	100.000	100.0	1
LG&E	C1S	898674	12/2014	12/16/2014	100.080	99.950	100.1	1
LG&E	C1S	898675	12/2014	12/16/2014	100.110	99.950	100.1	1
LG&E	C1S	898676	12/2014	12/16/2014	100.060	99.930	100.1	1
LG&E	C1S	898677	12/2014	12/16/2014	100.100	99.930	100.1	1
LG&E	C1S	898678	12/2014	12/16/2014	100.100	99.970	100.1	1
LG&E	C1S	898679	12/2014	12/16/2014	100.100	99.900	100.0	1
LG&E	C1S	898680	12/2014	12/16/2014	100.100	99.940	100.1	1
LG&E	C1S	898681	12/2014	12/16/2014	100.060	99.880	100.1	1
LG&E	C1S	898682	12/2014	12/16/2014	100.090	99.870	100.1	1
LG&E	C1S	898683	12/2014	12/16/2014	100.100	99.910	100.1	1
LG&E	C1S	898684	12/2014	12/16/2014	100.090	99.870	100.1	1

LG&E	C1S	898685	12/2014	12/16/2014	100.080	99.910	100.1	1
LG&E	C1S	898686	12/2014	12/16/2014	100.060	99.910	99.9	1
LG&E	C1S	898687	12/2014	12/16/2014	100.070	99.960	100.0	1
LG&E	C1S	898688	12/2014	12/16/2014	100.090	99.890	100.1	1
LG&E	C1S	898689	12/2014	12/16/2014	100.080	99.900	100.1	1
LG&E	C1S	898690	12/2014	12/16/2014	100.080	99.910	100.0	1
LG&E	C1S	898691	12/2014	12/16/2014	100.060	99.890	100.0	1
LG&E	C1S	898692	12/2014	12/16/2014	100.100	99.900	100.1	1
LG&E	C1S	898693	12/2014	12/16/2014	100.100	99.920	100.0	1
LG&E	C1S	898694	12/2014	12/16/2014	100.080	99.980	100.0	1
LG&E	C1S	898695	12/2014	12/16/2014	100.060	99.900	100.0	1
LG&E	C1S	898696	12/2014	12/16/2014	100.050	99.970	99.9	1
LG&E	C1S	898697	12/2014	12/16/2014	100.060	99.990	99.9	1
LG&E	C1S	898698	12/2014	12/16/2014	100.090	99.900	100.1	1
LG&E	C1S	898699	12/2014	12/16/2014	100.080	99.880	100.0	1
LG&E	C1S	898700	12/2014	12/16/2014	100.100	100.010	100.0	1
LG&E	C1S	898701	12/2014	12/16/2014	100.070	99.880	100.0	1
LG&E	C1S	898702	12/2014	12/16/2014	100.090	99.910	100.1	1
LG&E	C1S	898703	12/2014	12/16/2014	100.060	99.860	100.0	1
LG&E	C1S	898704	12/2014	12/16/2014	100.080	99.940	100.1	1
LG&E	C1S	898705	12/2014	12/16/2014	100.070	99.980	100.0	1
LG&E	C1S	898706	12/2014	12/16/2014	100.100	99.960	100.0	1
LG&E	C1S	898707	12/2014	12/16/2014	100.090	99.910	100.0	1
LG&E	C1S	898708	12/2014	12/16/2014	100.100	99.840	100.1	1
LG&E	C1S	898709	12/2014	12/16/2014	100.060	99.870	100.0	1
LG&E	C1S	898710	12/2014	12/16/2014	100.060	99.890	99.9	1
LG&E	C1S	898711	12/2014	12/16/2014	100.070	99.970	100.0	1
LG&E	C1S	898712	12/2014	12/16/2014	100.090	99.940	100.0	1
LG&E	C1S	898713	12/2014	12/16/2014	100.100	99.930	100.0	1
LG&E	C1S	898714	12/2014	12/16/2014	100.100	99.940	100.1	1
LG&E	C1S	898715	12/2014	12/16/2014	100.100	99.900	100.1	1
LG&E	C1S	898716	12/2014	12/16/2014	100.060	99.870	100.0	1

LG&E	C1S	898717	12/2014	12/16/2014	100.060	99.960	100.0	1
LG&E	C1S	898718	12/2014	12/16/2014	100.100	99.920	100.0	1
LG&E	C1S	898719	12/2014	12/16/2014	100.070	99.960	100.0	1
LG&E	C1S	898720	12/2014	12/16/2014	100.060	99.900	100.0	1
LG&E	C1S	898721	12/2014	12/16/2014	100.060	99.940	99.9	1
LG&E	C1S	898722	12/2014	12/16/2014	100.110	99.950	100.1	1
LG&E	C1S	898723	12/2014	12/16/2014	100.070	99.940	99.9	1
LG&E	C1S	898724	12/2014	12/16/2014	100.090	99.950	100.1	1
LG&E	C1S	898725	12/2014	12/16/2014	100.060	100.000	99.9	1
LG&E	C1S	898726	12/2014	12/16/2014	100.070	99.910	100.1	1
LG&E	C1S	898727	12/2014	12/16/2014	100.070	99.890	100.0	1
LG&E	C1S	898728	12/2014	12/16/2014	100.100	99.990	100.0	1
LG&E	C1S	898729	12/2014	12/16/2014	100.080	99.960	100.1	1
LG&E	C1S	898730	12/2014	12/16/2014	100.060	99.890	100.0	1
LG&E	C1S	898731	12/2014	12/16/2014	100.080	99.860	100.1	1
LG&E	C1S	898732	12/2014	12/16/2014	100.100	99.940	100.1	1
LG&E	C1S	898733	12/2014	12/16/2014	100.050	99.850	100.0	1
LG&E	C1S	898734	12/2014	12/16/2014	100.090	99.930	100.0	1
LG&E	C1S	898735	12/2014	12/16/2014	100.090	99.960	100.0	1
LG&E	C1S	898736	12/2014	12/16/2014	100.080	99.890	100.0	1
LG&E	C1S	898737	12/2014	12/16/2014	100.060	99.930	100.0	1
LG&E	C1S	898738	12/2014	12/16/2014	100.060	99.910	100.0	1
LG&E	C1S	898739	12/2014	12/16/2014	100.070	99.900	100.0	1
LG&E	C1S	898740	12/2014	12/16/2014	100.080	99.890	100.0	1
LG&E	C1S	898741	12/2014	12/16/2014	100.090	99.880	100.0	1
LG&E	C1S	898742	12/2014	12/16/2014	100.060	99.890	99.9	1
LG&E	C1S	898743	12/2014	12/16/2014	100.080	99.830	100.0	1
LG&E	C1S	898744	12/2014	12/16/2014	100.080	100.020	99.9	1
LG&E	C1S	898745	12/2014	12/16/2014	100.100	99.890	100.0	1
LG&E	C1S	898746	12/2014	12/16/2014	100.100	99.900	100.1	1
LG&E	C1S	898747	12/2014	12/16/2014	100.100	99.950	100.1	1
LG&E	C1S	898748	12/2014	12/16/2014	100.060	99.890	100.0	1

LG&E	C1S	898749	12/2014	12/16/2014	100.070	99.950	100.0	1
LG&E	C1S	898750	12/2014	12/16/2014	100.080	99.880	100.1	1
LG&E	C1S	898751	12/2014	12/16/2014	100.100	99.940	100.0	1
LG&E	C1S	898752	12/2014	12/16/2014	100.080	99.920	100.1	1
LG&E	C1S	898753	12/2014	12/16/2014	100.070	99.980	100.0	1
LG&E	C1S	898754	12/2014	12/16/2014	100.090	99.960	100.1	1
LG&E	C1S	898755	12/2014	12/16/2014	100.090	99.940	100.0	1
LG&E	C1S	898756	12/2014	12/16/2014	100.100	100.030	100.1	1
LG&E	C1S	898757	12/2014	12/16/2014	100.080	99.960	100.1	1
LG&E	C1S	898758	12/2014	12/16/2014	100.100	99.950	99.9	1
LG&E	C1S	898759	12/2014	12/16/2014	100.090	99.980	100.1	1
LG&E	C1S	898760	12/2014	12/16/2014	100.100	99.970	100.1	1
LG&E	C1S	898761	12/2014	12/16/2014	100.100	99.950	100.1	1
LG&E	C1S	898762	12/2014	12/16/2014	100.090	99.870	100.0	1
LG&E	C1S	898763	12/2014	12/16/2014	100.070	99.900	100.1	1
LG&E	C1S	898764	12/2014	12/16/2014	100.090	99.970	100.0	1
LG&E	C1S	898765	12/2014	12/16/2014	100.080	99.940	100.0	1
LG&E	C1S	898766	12/2014	12/16/2014	100.090	99.920	100.0	1
LG&E	C1S	898767	12/2014	12/16/2014	100.070	99.820	100.0	1
LG&E	C1S	898768	12/2014	12/16/2014	100.070	99.940	100.1	1
LG&E	C1S	898769	12/2014	12/16/2014	100.090	99.870	100.1	1
LG&E	C1S	898770	12/2014	12/16/2014	100.080	100.020	100.0	1
LG&E	C1S	898771	12/2014	12/16/2014	100.060	99.940	100.0	1
LG&E	C1S	898772	12/2014	12/16/2014	100.060	99.900	100.0	1
LG&E	C1S	898773	12/2014	12/16/2014	100.090	99.960	100.0	1
LG&E	C1S	898774	12/2014	12/16/2014	100.070	99.900	100.0	1
LG&E	C1S	898775	12/2014	12/16/2014	100.070	99.930	100.1	1
LG&E	C1S	898776	12/2014	12/16/2014	100.090	99.910	100.0	1
LG&E	C1S	898777	12/2014	12/16/2014	100.100	99.920	100.1	1
LG&E	C1S	898778	12/2014	12/16/2014	100.060	99.860	100.0	1
LG&E	C1S	898779	12/2014	12/16/2014	100.090	99.940	100.1	1
LG&E	C1S	898780	12/2014	12/16/2014	100.100	99.920	100.1	1

LG&E	C1S	898781	12/2014	12/16/2014	100.110	99.970	100.1	1
LG&E	C1S	898782	12/2014	12/16/2014	100.070	99.910	100.0	1
LG&E	C1S	898783	12/2014	12/16/2014	100.080	99.930	100.1	1
LG&E	C1S	898784	12/2014	12/16/2014	100.060	99.890	100.0	1
LG&E	C1S	898785	12/2014	12/16/2014	100.080	99.910	100.0	1
LG&E	C1S	898786	12/2014	12/16/2014	100.060	99.930	100.1	1
LG&E	C1S	898787	12/2014	12/16/2014	100.090	99.940	100.0	1
LG&E	C1S	898788	12/2014	12/16/2014	100.070	99.870	100.1	1
LG&E	C1S	898789	12/2014	12/16/2014	100.080	99.900	100.1	1
LG&E	C1S	898790	12/2014	12/16/2014	100.090	99.970	100.0	1
LG&E	C1S	898791	12/2014	12/16/2014	100.090	99.970	100.0	1
LG&E	C1S	898792	12/2014	12/16/2014	100.090	99.900	100.1	1
LG&E	C1S	898793	12/2014	12/16/2014	100.060	99.840	100.0	1
LG&E	C1S	898794	12/2014	12/16/2014	100.090	99.970	100.1	1
LG&E	C1S	898795	12/2014	12/16/2014	100.060	99.940	100.1	1
LG&E	C1S	898796	12/2014	12/16/2014	100.110	99.960	100.0	1
LG&E	C1S	898797	12/2014	12/16/2014	100.070	99.820	100.0	1
LG&E	C1S	898798	12/2014	12/16/2014	100.090	99.970	100.0	1
LG&E	C1S	898799	12/2014	12/16/2014	100.070	99.920	99.9	1
LG&E	C1S	898800	12/2014	12/16/2014	100.100	99.900	100.1	1
LG&E	C1S	898801	12/2014	12/16/2014	100.090	99.970	100.1	1
LG&E	C1S	898802	12/2014	12/16/2014	100.070	99.850	100.2	1
LG&E	C1S	898803	12/2014	12/16/2014	100.060	99.850	100.0	1
LG&E	C1S	898804	12/2014	12/16/2014	100.060	99.920	100.0	1
LG&E	C1S	898805	12/2014	12/16/2014	100.080	99.940	100.0	1
LG&E	C1S	898806	12/2014	12/16/2014	100.090	99.990	100.1	1
LG&E	C1S	898807	12/2014	12/16/2014	100.100	99.940	100.0	1
LG&E	C1S	898808	12/2014	12/16/2014	100.070	99.900	100.0	1
LG&E	C1S	898809	12/2014	12/16/2014	100.070	99.880	100.0	1
LG&E	C1S	898810	12/2014	12/16/2014	100.100	99.970	100.1	1
LG&E	C1S	898811	12/2014	12/16/2014	100.060	99.920	100.0	1
LG&E	C1S	898812	12/2014	12/16/2014	100.090	99.870	100.1	1

LG&E	C1S	898813	12/2014	12/16/2014	100.080	99.970	100.0	1
LG&E	C1S	898814	12/2014	12/16/2014	100.070	99.920	100.0	1
LG&E	C1S	898815	12/2014	12/16/2014	100.080	99.950	100.1	1
LG&E	C1S	898816	12/2014	12/16/2014	100.110	99.920	100.1	1
LG&E	C1S	898817	12/2014	12/16/2014	100.090	99.900	100.0	1
LG&E	C1S	898818	12/2014	12/16/2014	100.070	99.870	100.0	1
LG&E	C1S	898819	12/2014	12/16/2014	100.090	99.930	100.1	1
LG&E	C1S	898820	12/2014	12/16/2014	100.070	99.970	100.0	1
LG&E	C1S	898821	12/2014	12/16/2014	100.060	99.960	100.0	1
LG&E	C1S	898822	12/2014	12/16/2014	100.090	99.950	100.1	1
LG&E	C1S	898823	12/2014	12/16/2014	100.070	99.860	100.0	1
LG&E	C1S	898824	12/2014	12/16/2014	100.060	99.950	100.1	1
LG&E	C1S	898825	12/2014	12/16/2014	100.060	99.870	99.9	1
LG&E	C1S	898826	12/2014	12/16/2014	100.100	99.910	100.1	1
LG&E	C1S	898827	12/2014	12/16/2014	100.070	99.920	100.1	1
LG&E	C1S	898828	12/2014	12/16/2014	100.060	99.930	100.0	1
LG&E	C1S	898829	12/2014	12/16/2014	100.060	99.900	100.0	1
LG&E	C1S	898830	12/2014	12/16/2014	100.060	99.910	100.0	1
LG&E	C1S	898831	12/2014	12/16/2014	100.070	99.890	100.1	1
LG&E	C1S	898832	12/2014	12/16/2014	100.060	99.920	100.0	1
LG&E	C1S	898833	12/2014	12/16/2014	100.100	99.930	100.0	1
LG&E	C1S	898834	12/2014	12/16/2014	100.070	99.950	100.0	1
LG&E	C1S	898835	12/2014	12/16/2014	100.090	99.970	99.9	1
LG&E	C1S	898836	12/2014	12/16/2014	100.060	99.890	100.0	1
LG&E	C1S	898837	12/2014	12/16/2014	100.100	99.910	100.0	1
LG&E	C1S	898838	12/2014	12/16/2014	100.070	99.860	100.1	1
LG&E	C1S	898839	12/2014	12/16/2014	100.060	99.880	99.9	1
LG&E	C1S	898840	12/2014	12/16/2014	100.100	100.010	100.0	1
LG&E	C1S	898841	12/2014	12/16/2014	100.070	99.940	100.0	1
LG&E	C1S	898842	12/2014	12/16/2014	100.080	99.850	100.0	1
LG&E	C1S	898843	12/2014	12/16/2014	100.060	99.890	100.0	1
LG&E	C1S	898844	12/2014	12/16/2014	100.070	99.880	100.0	1

LG&E	C1S	898845	12/2014	12/16/2014	100.100	99.950	100.1	1
LG&E	C1S	898846	12/2014	12/16/2014	100.060	99.940	100.1	1
LG&E	C1S	898847	12/2014	12/16/2014	100.080	99.920	100.0	1
LG&E	C1S	898848	12/2014	12/16/2014	100.070	99.890	100.0	1
LG&E	C1S	898849	12/2014	12/16/2014	100.070	99.910	100.1	1
LG&E	C1S	898850	12/2014	12/16/2014	100.070	100.000	99.9	1
LG&E	C1S	898851	12/2014	12/16/2014	100.090	99.910	100.1	1
LG&E	C1S	898852	12/2014	12/16/2014	100.090	99.940	100.1	1
LG&E	C1S	898853	12/2014	12/16/2014	100.060	99.930	100.1	1
LG&E	C1S	898854	12/2014	12/16/2014	100.100	100.010	100.0	1
LG&E	C1S	898855	12/2014	12/16/2014	100.060	99.900	99.9	1
LG&E	C1S	898856	12/2014	12/16/2014	100.090	99.900	100.0	1
LG&E	C1S	898857	12/2014	12/16/2014	100.060	99.940	100.0	1
LG&E	C1S	898858	12/2014	12/16/2014	100.060	99.920	100.0	1
LG&E	C1S	898859	12/2014	12/16/2014	100.100	99.980	100.0	1
LG&E	C1S	898860	12/2014	12/16/2014	100.090	99.920	100.0	1
LG&E	C1S	898861	12/2014	12/16/2014	100.090	99.930	100.1	1
LG&E	C1S	898862	12/2014	12/16/2014	100.080	99.940	100.1	1
LG&E	C1S	898863	12/2014	12/16/2014	100.100	99.910	100.1	1
LG&E	C1S	898864	12/2014	12/16/2014	100.060	99.930	100.0	1
LG&E	C1S	898865	12/2014	12/16/2014	100.100	100.010	100.1	1
LG&E	C1S	898866	12/2014	12/16/2014	100.100	99.920	100.0	1
LG&E	C1S	898867	12/2014	12/16/2014	100.090	99.910	100.1	1
LG&E	C1S	898868	12/2014	12/16/2014	100.080	99.930	100.2	1
LG&E	C1S	898869	12/2014	12/16/2014	100.060	99.890	99.9	1
LG&E	C1S	898870	12/2014	12/16/2014	100.070	99.810	100.1	1
LG&E	C1S	898871	12/2014	12/16/2014	100.100	99.930	100.1	1
LG&E	C1S	898872	12/2014	12/16/2014	100.060	99.900	99.9	1
LG&E	C1S	898873	12/2014	12/16/2014	100.090	99.860	100.0	1
LG&E	C1S	898874	12/2014	12/16/2014	100.090	99.920	100.0	1
LG&E	C1S	898875	12/2014	12/16/2014	100.080	99.890	100.0	1
LG&E	C1S	898876	12/2014	12/16/2014	100.070	99.910	100.1	1

LG&E	898877	12/2014	12/16/2014	100.090	99.860	100.1	1
LG&E	898878	12/2014	12/16/2014	100.080	99.910	100.0	1
LG&E	898879	12/2014	12/16/2014	100.080	99.920	100.2	1
LG&E	898880	12/2014	12/16/2014	100.100	99.910	100.0	1
LG&E	898881	12/2014	12/16/2014	100.060	99.960	100.0	1
LG&E	898882	12/2014	12/16/2014	100.090	99.950	100.1	1
LG&E	898883	12/2014	12/16/2014	100.070	99.880	99.9	1
LG&E	898884	12/2014	12/16/2014	100.090	99.990	100.0	1
LG&E	898885	12/2014	12/16/2014	100.070	99.890	100.0	1
LG&E	898886	12/2014	12/16/2014	100.090	99.940	100.0	1
LG&E	898887	12/2014	12/16/2014	100.060	99.910	100.0	1
LG&E	898888	12/2014	12/16/2014	100.070	99.930	100.0	1
LG&E	898889	12/2014	12/16/2014	100.080	99.980	100.0	1
LG&E	898890	12/2014	12/16/2014	100.100	99.980	100.0	1
LG&E	898891	12/2014	12/16/2014	100.110	99.920	100.0	1
LG&E	898892	12/2014	12/16/2014	100.060	99.900	100.0	1
LG&E	898893	12/2014	12/16/2014	100.100	99.930	100.0	1
LG&E	898894	12/2014	12/16/2014	100.080	99.890	100.0	1
LG&E	898895	12/2014	12/16/2014	100.110	99.940	100.0	1
LG&E	898896	12/2014	12/16/2014	100.070	99.920	100.1	1
LG&E	898897	12/2014	12/16/2014	100.060	99.940	100.0	1
LG&E	898898	12/2014	12/16/2014	100.090	99.950	100.1	1
LG&E	898899	12/2014	12/16/2014	100.090	99.880	100.1	1
LG&E	898900	12/2014	12/16/2014	100.100	99.900	100.1	1
LG&E	898901	12/2014	12/16/2014	100.080	99.890	100.1	1
LG&E	898902	12/2014	12/16/2014	100.100	99.950	100.2	1
LG&E	898903	12/2014	12/16/2014	100.060	99.910	100.0	1
LG&E	898904	12/2014	12/16/2014	100.100	99.960	100.1	1
LG&E	898905	12/2014	12/16/2014	100.100	99.960	100.0	1
LG&E	898906	12/2014	12/16/2014	100.060	99.860	100.0	1
LG&E	898907	12/2014	12/16/2014	100.090	99.940	100.1	1
LG&E	898908	12/2014	12/16/2014	100.090	99.900	100.0	1

LG&E	898909	C1S	12/2014	12/16/2014	100.090	99.940	100.1	1
LG&E	898910	C1S	12/2014	12/16/2014	100.090	99.870	99.9	1
LG&E	898911	C1S	12/2014	12/16/2014	100.100	99.940	100.1	1
LG&E	898912	C1S	12/2014	12/16/2014	100.090	99.950	100.0	1
LG&E	898913	C1S	12/2014	12/16/2014	100.090	99.960	100.0	1
LG&E	898914	C1S	12/2014	12/16/2014	100.060	99.910	100.1	1
LG&E	898915	C1S	12/2014	12/16/2014	100.060	99.870	100.0	1
LG&E	898916	C1S	12/2014	12/16/2014	100.080	99.860	100.0	1
LG&E	898917	C1S	12/2014	12/16/2014	100.070	99.880	100.1	1
LG&E	898918	C1S	12/2014	12/16/2014	100.080	99.950	100.0	1
LG&E	898919	C1S	12/2014	12/16/2014	100.070	99.900	100.1	1
LG&E	898920	C1S	12/2014	12/16/2014	100.080	99.900	100.0	1
LG&E	898921	C1S	12/2014	12/16/2014	100.060	99.970	100.1	1
LG&E	898922	C1S	12/2014	12/16/2014	100.080	99.930	99.9	1
LG&E	898923	C1S	12/2014	12/16/2014	100.070	99.910	100.0	1
LG&E	898924	C1S	12/2014	12/16/2014	100.080	99.960	100.0	1
LG&E	898925	C1S	12/2014	12/16/2014	100.070	99.870	100.0	1
LG&E	898926	C1S	12/2014	12/16/2014	100.070	99.870	100.0	1
LG&E	898927	C1S	12/2014	12/16/2014	100.100	99.960	100.1	1
LG&E	898928	C1S	12/2014	12/16/2014	100.070	99.930	100.0	1
LG&E	898929	C1S	12/2014	12/16/2014	100.080	99.880	100.1	1
LG&E	898930	C1S	12/2014	12/16/2014	100.090	99.930	100.0	1
LG&E	898931	C1S	12/2014	12/16/2014	100.110	99.980	100.1	1
LG&E	898932	C1S	12/2014	12/16/2014	100.090	99.990	100.0	1
LG&E	898933	C1S	12/2014	12/16/2014	100.110	99.950	100.0	1
LG&E	898934	C1S	12/2014	12/16/2014	100.080	99.860	100.0	1
LG&E	898935	C1S	12/2014	12/16/2014	100.080	99.860	100.0	1
LG&E	898936	C1S	12/2014	12/16/2014	100.090	99.930	100.1	1
LG&E	898937	C1S	12/2014	12/16/2014	100.070	99.880	100.0	1
LG&E	898938	C1S	12/2014	12/16/2014	100.060	99.930	100.0	1
LG&E	898939	C1S	12/2014	12/16/2014	100.110	99.970	100.1	1
LG&E	898940	C1S	12/2014	12/16/2014	100.060	99.890	100.1	1

LG&E	C1S	898941	12/2014	12/16/2014	100.080	99.950	100.1	1
LG&E	C1S	898942	12/2014	12/16/2014	100.080	99.940	100.0	1
LG&E	C1S	898943	12/2014	12/16/2014	100.060	99.830	100.0	1
LG&E	C1S	898944	12/2014	12/16/2014	100.070	99.870	100.0	1
LG&E	C1S	898945	12/2014	12/16/2014	100.100	99.920	100.1	1
LG&E	C1S	898946	12/2014	12/16/2014	100.100	99.970	100.1	1
LG&E	C1S	898947	12/2014	12/16/2014	100.090	99.970	99.9	1
LG&E	C1S	898948	12/2014	12/16/2014	100.060	99.930	100.1	1
LG&E	C1S	898949	12/2014	12/16/2014	100.100	99.950	99.9	1
LG&E	C1S	898950	12/2014	12/16/2014	100.060	99.940	100.1	1
LG&E	C1S	898951	12/2014	12/16/2014	100.070	99.900	100.1	1
LG&E	C1S	898952	12/2014	12/16/2014	100.080	99.980	100.0	1
LG&E	C1S	898953	12/2014	12/16/2014	100.100	99.940	100.1	1
LG&E	C1S	898954	12/2014	12/16/2014	100.080	99.880	100.0	1
LG&E	C1S	898955	12/2014	12/16/2014	100.060	99.830	100.0	1
LG&E	C1S	898956	12/2014	12/16/2014	100.070	99.910	100.0	1
LG&E	C1S	898957	12/2014	12/16/2014	100.080	99.920	100.0	1
LG&E	C1S	898958	12/2014	12/16/2014	100.070	99.980	100.0	1
LG&E	C1S	898959	12/2014	12/16/2014	100.100	99.910	100.1	1
LG&E	C1S	898960	12/2014	12/16/2014	100.090	99.940	100.1	1
LG&E	C1S	898961	12/2014	12/16/2014	100.060	99.940	100.0	1
LG&E	C1S	898962	12/2014	12/16/2014	100.070	99.920	100.0	1
LG&E	C1S	898963	12/2014	12/16/2014	100.060	99.920	100.1	1
LG&E	C1S	898964	12/2014	12/16/2014	100.080	99.950	100.0	1
LG&E	C1S	898965	12/2014	12/16/2014	100.090	99.890	100.1	1
LG&E	C1S	898966	12/2014	12/16/2014	100.100	99.960	100.1	1
LG&E	C1S	898967	12/2014	12/16/2014	100.110	100.020	100.1	1
LG&E	C1S	898968	12/2014	12/16/2014	100.090	99.870	100.1	1
LG&E	C1S	898969	12/2014	12/16/2014	100.070	99.930	100.1	1
LG&E	C1S	898970	12/2014	12/16/2014	100.070	99.950	100.1	1
LG&E	C1S	898971	12/2014	12/16/2014	100.090	99.920	100.0	1
LG&E	C1S	898972	12/2014	12/16/2014	100.080	99.940	100.0	1

LG&E	C1S	898973	12/2014	12/16/2014	100,080	99,890	100,0	100,0	1
LG&E	C1S	898974	12/2014	12/16/2014	100,060	99,850	100,0	100,0	1
LG&E	C1S	898975	12/2014	12/16/2014	100,080	99,830	100,1	100,1	1
LG&E	C1S	898976	12/2014	12/16/2014	100,100	100,000	100,1	100,1	1
LG&E	C1S	898977	12/2014	12/16/2014	100,070	99,840	100,0	100,0	1
LG&E	C1S	898978	12/2014	12/16/2014	100,060	99,810	100,1	100,1	1
LG&E	C1S	898979	12/2014	12/16/2014	100,080	99,940	100,1	100,1	1
LG&E	C1S	898980	12/2014	12/16/2014	100,060	99,870	100,1	100,1	1
LG&E	C1S	898981	12/2014	12/16/2014	100,080	99,870	100,0	100,0	1
LG&E	C1S	898982	12/2014	12/16/2014	100,090	99,880	100,0	100,0	1
LG&E	C1S	898983	12/2014	12/16/2014	100,090	99,890	100,0	100,0	1
LG&E	C1S	898984	12/2014	12/16/2014	100,090	100,010	100,1	100,1	1
LG&E	C1S	898985	12/2014	12/16/2014	100,090	99,980	100,0	100,0	1
LG&E	C1S	898986	12/2014	12/16/2014	100,060	99,930	100,0	100,0	1
LG&E	C1S	898987	12/2014	12/16/2014	100,090	99,890	100,1	100,1	1
LG&E	C1S	898988	12/2014	12/16/2014	100,110	100,010	100,0	100,0	1
LG&E	C1S	898989	12/2014	12/16/2014	100,100	99,930	100,1	100,1	1
LG&E	C1S	898990	12/2014	12/16/2014	100,070	99,880	100,0	100,0	1
LG&E	C1S	898991	12/2014	12/16/2014	100,110	99,970	100,1	100,1	1
LG&E	C1S	898992	12/2014	12/16/2014	100,060	99,870	100,0	100,0	1
LG&E	C1S	898993	12/2014	12/16/2014	100,070	99,820	100,0	100,0	1
LG&E	C1S	898994	12/2014	12/16/2014	100,080	99,900	100,0	100,0	1
LG&E	C1S	898995	12/2014	12/16/2014	100,070	99,940	100,1	100,1	1
LG&E	C1S	898996	12/2014	12/16/2014	100,100	99,980	100,0	100,0	1
LG&E	C1S	898997	12/2014	12/16/2014	100,090	99,910	100,0	100,0	1
LG&E	C1S	898998	12/2014	12/16/2014	100,070	99,870	100,1	100,1	1
LG&E	C1S	898999	12/2014	12/16/2014	100,100	100,010	100,0	100,0	1
LG&E	C1S	899000	12/2014	12/16/2014	100,080	99,970	100,0	100,0	1
LG&E	C1S	899001	12/2014	12/16/2014	100,060	99,830	100,0	100,0	1
LG&E	C1S	899002	12/2014	12/16/2014	100,090	99,980	100,0	100,0	1
LG&E	C1S	899003	12/2014	12/16/2014	100,080	99,940	100,1	100,1	1
LG&E	C1S	899004	12/2014	12/16/2014	100,090	99,900	100,1	100,1	1

LG&E	C1S	899005	12/2014	12/16/2014	100.070	99.870	100.0	1
LG&E	C1S	899006	12/2014	12/16/2014	100.080	99.950	100.0	1
LG&E	C1S	899007	12/2014	12/16/2014	100.070	99.900	100.0	1
LG&E	C1S	899008	12/2014	12/16/2014	100.090	99.920	100.1	1
LG&E	C1S	899009	12/2014	12/16/2014	100.060	99.930	100.0	1
LG&E	C1S	899010	12/2014	12/16/2014	100.080	99.920	100.1	1
LG&E	C1S	899011	12/2014	12/16/2014	100.080	99.940	100.0	1
LG&E	C1S	899012	12/2014	12/16/2014	100.060	99.880	99.9	1
LG&E	C1S	899013	12/2014	12/16/2014	100.080	99.910	100.1	1
LG&E	C1S	899014	12/2014	12/16/2014	100.060	99.860	100.0	1
LG&E	C1S	899015	12/2014	12/16/2014	100.060	99.930	100.0	1
LG&E	C1S	899016	12/2014	12/16/2014	100.100	100.050	100.0	1
LG&E	C1S	899017	12/2014	12/16/2014	100.060	99.890	100.0	1
LG&E	C1S	899018	12/2014	12/16/2014	100.100	99.950	100.0	1
LG&E	C1S	899019	12/2014	12/16/2014	100.090	99.890	100.1	1
LG&E	C1S	899020	12/2014	12/16/2014	100.070	99.840	100.0	1
LG&E	C1S	899021	12/2014	12/16/2014	100.060	99.920	100.0	1
LG&E	C1S	899022	12/2014	12/16/2014	100.080	99.930	100.0	1
LG&E	C1S	899023	12/2014	12/16/2014	100.070	99.910	100.0	1
LG&E	C1S	899024	12/2014	12/16/2014	100.080	99.880	100.2	1
LG&E	C1S	899025	12/2014	12/16/2014	100.080	99.970	100.1	1
LG&E	C1S	899026	12/2014	12/16/2014	100.060	99.860	100.1	1
LG&E	C1S	899027	12/2014	12/16/2014	100.110	99.990	100.0	1
LG&E	C1S	899028	12/2014	12/16/2014	100.080	99.890	100.0	1
LG&E	C1S	899029	12/2014	12/16/2014	100.090	99.990	100.1	1
LG&E	C1S	899030	12/2014	12/16/2014	100.090	99.940	100.0	1
LG&E	C1S	899031	12/2014	12/16/2014	100.100	99.940	100.1	1
LG&E	C1S	899032	12/2014	12/16/2014	100.110	99.980	100.0	1
LG&E	C1S	899033	12/2014	12/16/2014	100.080	99.920	99.9	1
LG&E	C1S	899034	12/2014	12/16/2014	100.070	99.880	100.0	1
LG&E	C1S	899035	12/2014	12/16/2014	100.110	99.950	100.1	1
LG&E	C1S	899036	12/2014	12/16/2014	100.070	99.890	100.0	1

LG&E	C1S	899037	12/2014	12/16/2014	100.070	99.920	100.1	1
LG&E	C1S	899038	12/2014	12/16/2014	100.050	99.910	100.0	1
LG&E	C1S	899039	12/2014	12/16/2014	100.080	100.010	100.0	1
LG&E	C1S	899040	12/2014	12/16/2014	100.080	99.960	100.0	1
LG&E	C1S	899041	12/2014	12/16/2014	100.060	99.910	99.9	1
LG&E	C1S	899042	12/2014	12/16/2014	100.090	99.890	100.1	1
LG&E	C1S	899043	12/2014	12/16/2014	100.090	99.980	100.0	1
LG&E	C1S	899044	12/2014	12/16/2014	100.080	99.920	100.1	1
LG&E	C1S	899045	12/2014	12/16/2014	100.070	99.920	100.0	1
LG&E	C1S	899046	12/2014	12/16/2014	100.100	100.010	100.0	1
LG&E	C1S	899047	12/2014	12/16/2014	100.090	99.910	100.0	1
LG&E	C1S	899048	12/2014	12/16/2014	100.090	99.980	100.0	1
LG&E	C1S	899049	12/2014	12/16/2014	100.100	99.950	100.0	1
LG&E	C1S	899050	12/2014	12/16/2014	100.080	99.890	100.1	1
LG&E	C1S	899051	12/2014	12/16/2014	100.090	99.960	100.0	1
LG&E	C1S	899052	12/2014	12/16/2014	100.070	99.950	100.0	1
LG&E	C1S	899053	12/2014	12/16/2014	100.060	99.910	99.9	1
LG&E	C1S	899054	12/2014	12/16/2014	100.060	99.920	100.0	1
LG&E	C1S	899055	12/2014	12/16/2014	100.060	99.950	100.0	1
LG&E	C1S	899056	12/2014	12/16/2014	100.080	99.970	100.0	1
LG&E	C1S	899057	12/2014	12/16/2014	100.070	99.890	100.0	1
LG&E	C1S	899058	12/2014	12/16/2014	100.070	99.980	100.0	1
LG&E	C1S	899059	12/2014	12/16/2014	100.050	99.840	100.0	1
LG&E	C1S	899060	12/2014	12/16/2014	100.100	100.010	100.0	1
LG&E	C1S	899061	12/2014	12/16/2014	100.060	99.920	100.0	1
LG&E	C1S	899062	12/2014	12/16/2014	100.070	99.960	100.0	1
LG&E	C1S	899063	12/2014	12/16/2014	100.100	99.980	100.1	1
LG&E	C1S	899064	12/2014	12/16/2014	100.090	99.920	100.1	1
LG&E	C1S	899065	12/2014	12/16/2014	100.060	99.840	100.0	1
LG&E	C1S	899066	12/2014	12/16/2014	100.070	99.850	100.0	1
LG&E	C1S	899067	12/2014	12/16/2014	100.080	99.930	100.1	1
LG&E	C1S	899068	12/2014	12/16/2014	100.090	99.980	100.1	1

LG&E	C1S	899069	12/2014	12/16/2014	100.070	99.910	100.0	1
LG&E	C1S	899070	12/2014	12/16/2014	100.060	99.890	100.0	1
LG&E	C1S	899071	12/2014	12/16/2014	100.070	99.960	100.0	1
LG&E	C1S	899072	12/2014	12/16/2014	100.060	99.900	100.1	1
LG&E	C1S	899073	12/2014	12/16/2014	100.060	99.920	100.1	1
LG&E	C1S	899074	12/2014	12/16/2014	100.100	99.980	100.1	1
LG&E	C1S	899075	12/2014	12/16/2014	100.090	100.000	100.0	1
LG&E	C1S	899076	12/2014	12/16/2014	100.060	99.860	100.1	1
LG&E	C1S	899077	12/2014	12/16/2014	100.070	99.930	100.0	1
LG&E	C1S	899078	12/2014	12/16/2014	100.080	99.920	100.0	1
LG&E	C1S	899079	12/2014	12/16/2014	100.060	99.920	99.9	1
LG&E	C1S	899080	12/2014	12/16/2014	100.100	99.960	100.0	1
LG&E	C1S	899081	12/2014	12/16/2014	100.080	99.990	99.9	1
LG&E	C1S	899082	12/2014	12/16/2014	100.090	99.930	100.1	1
LG&E	C1S	899083	12/2014	12/16/2014	100.090	99.900	100.1	1
LG&E	C1S	899084	12/2014	12/16/2014	100.100	99.890	100.0	1
LG&E	C1S	899085	12/2014	12/16/2014	100.070	99.920	100.1	1
LG&E	C1S	899086	12/2014	12/16/2014	100.090	99.970	100.0	1
LG&E	C1S	899087	12/2014	12/16/2014	100.060	99.840	100.1	1
LG&E	C1S	899088	12/2014	12/16/2014	100.090	99.890	100.1	1
LG&E	C1S	899089	12/2014	12/16/2014	100.100	99.950	100.0	1
LG&E	C1S	899090	12/2014	12/16/2014	100.080	99.990	99.9	1
LG&E	C1S	899091	12/2014	12/16/2014	100.090	99.930	100.1	1
LG&E	C1S	899092	12/2014	12/16/2014	100.110	99.970	100.0	1
LG&E	C1S	899093	12/2014	12/16/2014	100.080	99.950	100.0	1
LG&E	C1S	899094	12/2014	12/16/2014	100.060	99.940	100.0	1
LG&E	C1S	899095	12/2014	12/16/2014	100.080	99.900	100.0	1
LG&E	C1S	899096	12/2014	12/16/2014	100.080	99.980	99.9	1
LG&E	C1S	899097	12/2014	12/16/2014	100.080	99.950	99.9	1
LG&E	C1S	899098	12/2014	12/16/2014	100.090	99.900	100.1	1
LG&E	C1S	899099	12/2014	12/16/2014	100.070	99.860	100.0	1
LG&E	C1S	899100	12/2014	12/16/2014	100.100	99.960	100.0	1

LG&E	C1S	899101	12/2014	12/16/2014	100.090	99.860	100.0	1
LG&E	C1S	899102	12/2014	12/16/2014	100.100	100.030	100.0	1
LG&E	C1S	899103	12/2014	12/16/2014	100.070	99.880	100.0	1
LG&E	C1S	899104	12/2014	12/16/2014	100.080	99.900	100.0	1
LG&E	C1S	899105	12/2014	12/16/2014	100.060	99.850	100.0	1
LG&E	C1S	899106	12/2014	12/16/2014	100.090	99.940	100.0	1
LG&E	C1S	899107	12/2014	12/16/2014	100.090	99.930	100.1	1
LG&E	C1S	899108	12/2014	12/16/2014	100.090	99.870	100.1	1
LG&E	C1S	899109	12/2014	12/16/2014	100.070	99.900	100.0	1
LG&E	C1S	899110	12/2014	12/16/2014	100.080	99.980	100.0	1
LG&E	C1S	899111	12/2014	12/16/2014	100.110	99.950	100.0	1
LG&E	C1S	899112	12/2014	12/16/2014	100.060	99.850	100.0	1
LG&E	C1S	899113	12/2014	12/16/2014	100.070	99.860	100.0	1
LG&E	C1S	899114	12/2014	12/16/2014	100.080	99.970	100.0	1
LG&E	C1S	899115	12/2014	12/16/2014	100.070	99.890	100.0	1
LG&E	C1S	899116	12/2014	12/16/2014	100.080	99.820	100.0	1
LG&E	C1S	899117	12/2014	12/16/2014	100.080	99.930	100.1	1
LG&E	C1S	899118	12/2014	12/16/2014	100.070	100.000	100.1	1
LG&E	C1S	899119	12/2014	12/16/2014	100.090	99.980	100.0	1
LG&E	C1S	899120	12/2014	12/16/2014	100.100	99.940	100.1	1
LG&E	C1S	899121	12/2014	12/16/2014	100.060	99.900	100.1	1
LG&E	C1S	899122	12/2014	12/16/2014	100.100	100.010	100.1	1
LG&E	C1S	899123	12/2014	12/16/2014	100.060	99.890	100.0	1
LG&E	C1S	899124	12/2014	12/16/2014	100.080	99.880	100.0	1
LG&E	C1S	899125	12/2014	12/16/2014	100.060	99.840	100.0	1
LG&E	C1S	899126	12/2014	12/16/2014	100.060	99.840	100.0	1
LG&E	C1S	899127	12/2014	12/16/2014	100.070	99.850	100.0	1
LG&E	C1S	899128	12/2014	12/16/2014	100.090	99.940	100.0	1
LG&E	C1S	899129	12/2014	12/16/2014	100.100	99.980	100.0	1
LG&E	C1S	899130	12/2014	12/16/2014	100.100	99.900	100.1	1
LG&E	C1S	899131	12/2014	12/16/2014	100.100	99.880	100.0	1
LG&E	C1S	899132	12/2014	12/16/2014	100.100	99.880	100.0	1

LG&E	C1S	899133	12/2014	12/16/2014	100.100	99.960	100.0	1
LG&E	C1S	899134	12/2014	12/16/2014	100.100	100.000	99.9	1
LG&E	C1S	899135	12/2014	12/16/2014	100.060	99.930	100.0	1
LG&E	C1S	899136	12/2014	12/16/2014	100.090	99.880	100.0	1
LG&E	C1S	899137	12/2014	12/16/2014	100.090	99.900	100.0	1
LG&E	C1S	899138	12/2014	12/16/2014	100.100	99.950	100.1	1
LG&E	C1S	899139	12/2014	12/16/2014	100.110	99.920	100.1	1
LG&E	C1S	899140	12/2014	12/16/2014	100.060	99.880	100.0	1
LG&E	C1S	899141	12/2014	12/16/2014	100.060	99.860	100.1	1
LG&E	C1S	899142	12/2014	12/16/2014	100.080	99.880	100.0	1
LG&E	C1S	899143	12/2014	12/16/2014	100.060	99.960	100.0	1
LG&E	C1S	899144	12/2014	12/16/2014	100.090	99.920	100.1	1
LG&E	C1S	899145	12/2014	12/16/2014	100.060	99.940	100.0	1
LG&E	C1S	899146	12/2014	12/16/2014	100.080	99.930	100.1	1
LG&E	C1S	899147	12/2014	12/16/2014	100.080	99.920	100.0	1
LG&E	C1S	899148	12/2014	12/16/2014	100.100	99.910	100.0	1
LG&E	C1S	899149	12/2014	12/16/2014	100.050	99.860	100.0	1
LG&E	C1S	899150	12/2014	12/16/2014	100.090	99.870	100.0	1
LG&E	C1S	899151	12/2014	12/16/2014	100.090	99.900	100.0	1
LG&E	C1S	899152	12/2014	12/16/2014	100.090	99.940	100.1	1
LG&E	C1S	899153	12/2014	12/16/2014	100.060	99.870	100.1	1
LG&E	C1S	899154	12/2014	12/16/2014	100.070	99.880	100.1	1
LG&E	C1S	899155	12/2014	12/16/2014	100.090	99.940	100.0	1
LG&E	C1S	899156	12/2014	12/16/2014	100.060	99.930	99.9	1
LG&E	C1S	899157	12/2014	12/16/2014	100.080	99.910	100.0	1
LG&E	C1S	899158	12/2014	12/16/2014	100.060	99.870	100.1	1
LG&E	C1S	899159	12/2014	12/16/2014	100.060	99.890	100.0	1
LG&E	C1S	899160	12/2014	12/16/2014	100.090	99.900	100.1	1
LG&E	C1S	899161	12/2014	12/16/2014	100.060	99.930	99.9	1
LG&E	C1S	899162	12/2014	12/16/2014	100.060	99.890	100.0	1
LG&E	C1S	899163	12/2014	12/16/2014	100.080	99.930	100.0	1
LG&E	C1S	899164	12/2014	12/16/2014	100.070	99.960	100.0	1

LG&E	C1S	899165	12/2014	12/16/2014	100.080	99.940	100.0	1
LG&E	C1S	899166	12/2014	12/16/2014	100.070	99.900	100.1	1
LG&E	C1S	899167	12/2014	12/16/2014	100.070	99.860	100.0	1
LG&E	C1S	899168	12/2014	12/16/2014	100.090	99.960	100.0	1
LG&E	C1S	899169	12/2014	12/16/2014	100.060	99.890	100.0	1
LG&E	C1S	899170	12/2014	12/16/2014	100.080	99.960	100.0	1
LG&E	C1S	899171	12/2014	12/16/2014	100.110	100.010	100.0	1
LG&E	C1S	899172	12/2014	12/16/2014	100.100	99.960	100.0	1
LG&E	C1S	899173	12/2014	12/16/2014	100.080	100.000	100.0	1
LG&E	C1S	899174	12/2014	12/16/2014	100.080	99.930	100.0	1
LG&E	C1S	899175	12/2014	12/16/2014	100.080	99.930	100.1	1
LG&E	C1S	899176	12/2014	12/16/2014	100.070	99.980	100.1	1
LG&E	C1S	899177	12/2014	12/16/2014	100.070	99.970	100.1	1
LG&E	C1S	899178	12/2014	12/16/2014	100.070	99.910	100.0	1
LG&E	C1S	899179	12/2014	12/16/2014	100.060	99.940	100.0	1
LG&E	C1S	899180	12/2014	12/16/2014	100.110	99.980	100.0	1
LG&E	C1S	899181	12/2014	12/16/2014	100.100	100.030	100.1	1
LG&E	C1S	899182	12/2014	12/16/2014	100.090	99.930	100.1	1
LG&E	C1S	899183	12/2014	12/16/2014	100.090	99.900	100.1	1
LG&E	C1S	899184	12/2014	12/16/2014	100.100	99.960	100.0	1
LG&E	C1S	899185	12/2014	12/16/2014	100.070	99.960	100.0	1
LG&E	C1S	899186	12/2014	12/16/2014	100.100	99.950	100.0	1
LG&E	C1S	899187	12/2014	12/16/2014	100.100	100.010	100.0	1
LG&E	C1S	899188	12/2014	12/16/2014	100.080	99.940	100.0	1
LG&E	C1S	899189	12/2014	12/16/2014	100.080	99.910	100.0	1
LG&E	C1S	899190	12/2014	12/16/2014	100.100	100.010	100.0	1
LG&E	C1S	899191	12/2014	12/16/2014	100.080	99.910	100.1	1
LG&E	C1S	899192	12/2014	12/16/2014	100.070	99.860	99.9	1
LG&E	C1S	899193	12/2014	12/16/2014	100.100	99.950	100.0	1
LG&E	C1S	899194	12/2014	12/16/2014	100.070	99.910	99.9	1
LG&E	C1S	899195	12/2014	12/16/2014	100.060	99.890	100.0	1
LG&E	C1S	899196	12/2014	12/16/2014	100.100	99.970	100.0	1

LG&E	C1S	899197	12/2014	12/16/2014	100.060	99.930	100.0	1
LG&E	C1S	899198	12/2014	12/16/2014	100.090	99.940	100.0	1
LG&E	C1S	899199	12/2014	12/16/2014	100.090	99.930	100.0	1
LG&E	C1S	899200	12/2014	12/16/2014	100.060	99.960	100.1	1
LG&E	C1S	899201	12/2014	12/16/2014	100.090	99.960	100.1	1
LG&E	C1S	899202	12/2014	12/16/2014	100.100	99.850	100.1	1
LG&E	C1S	899203	12/2014	12/16/2014	100.070	99.880	100.0	1
LG&E	C1S	899204	12/2014	12/16/2014	100.090	99.910	100.1	1
LG&E	C1S	899205	12/2014	12/16/2014	100.100	99.940	100.1	1
LG&E	C1S	899206	12/2014	12/16/2014	100.060	99.890	100.1	1
LG&E	C1S	899207	12/2014	12/16/2014	100.070	99.950	100.0	1
LG&E	C1S	899208	12/2014	12/16/2014	100.070	99.990	100.0	1
LG&E	C1S	899209	12/2014	12/16/2014	100.070	99.930	100.0	1
LG&E	C1S	899210	12/2014	12/16/2014	100.060	100.000	100.0	1
LG&E	C1S	899211	12/2014	12/16/2014	100.100	99.930	99.9	1
LG&E	C1S	899212	12/2014	12/16/2014	100.100	99.880	100.0	1
LG&E	C1S	899213	12/2014	12/16/2014	100.110	99.880	100.0	1
LG&E	C1S	899214	12/2014	12/16/2014	100.080	100.010	99.9	1
LG&E	C1S	899215	12/2014	12/16/2014	100.090	99.970	100.0	1
LG&E	C1S	899216	12/2014	12/16/2014	100.060	99.900	100.0	1
LG&E	C1S	899217	12/2014	12/16/2014	100.060	99.890	100.0	1
LG&E	C1S	899218	12/2014	12/16/2014	100.110	99.950	100.1	1
LG&E	C1S	899219	12/2014	12/16/2014	100.100	99.910	100.0	1
LG&E	C1S	899220	12/2014	12/16/2014	100.090	99.930	100.1	1
LG&E	C1S	899221	12/2014	12/16/2014	100.080	99.910	100.1	1
LG&E	C1S	899222	12/2014	12/16/2014	100.100	99.990	100.0	1
LG&E	C1S	899223	12/2014	12/16/2014	100.100	99.940	100.0	1
LG&E	C1S	899224	12/2014	12/16/2014	100.090	99.900	100.1	1
LG&E	C1S	899225	12/2014	12/16/2014	100.080	99.930	100.0	1
LG&E	C1S	899226	12/2014	12/16/2014	100.110	99.930	100.1	1
LG&E	C1S	899227	12/2014	12/16/2014	100.110	99.910	100.1	1
LG&E	C1S	899228	12/2014	12/16/2014	100.060	99.870	100.0	1

LG&E	C1S	899229	12/2014	12/16/2014	100.070	99.840	100.0	1
LG&E	C1S	899230	12/2014	12/16/2014	100.090	99.810	99.9	1
LG&E	C1S	899231	12/2014	12/16/2014	100.100	99.910	100.1	1
LG&E	C1S	899232	12/2014	12/16/2014	100.080	99.870	100.1	1
LG&E	C1S	899233	12/2014	12/16/2014	100.060	99.820	100.0	1
LG&E	C1S	899234	12/2014	12/16/2014	100.070	99.900	100.0	1
LG&E	C1S	899235	12/2014	12/16/2014	100.090	99.940	100.0	1
LG&E	C1S	899236	12/2014	12/16/2014	100.070	99.880	100.0	1
LG&E	C1S	899237	12/2014	12/16/2014	100.070	99.920	100.1	1
LG&E	C1S	899238	12/2014	12/16/2014	100.100	99.930	100.0	1
LG&E	C1S	899239	12/2014	12/16/2014	100.080	99.910	100.0	1
LG&E	C1S	899240	12/2014	12/16/2014	100.050	99.810	100.0	1
LG&E	C1S	899241	12/2014	12/16/2014	100.050	99.900	100.0	1
LG&E	C1S	899242	12/2014	12/16/2014	100.100	99.890	100.1	1
LG&E	C1S	899243	12/2014	12/16/2014	100.100	99.950	100.1	1
LG&E	C1S	899244	12/2014	12/16/2014	100.100	99.880	100.0	1
LG&E	C1S	899245	12/2014	12/16/2014	100.080	99.920	100.1	1
LG&E	C1S	899246	12/2014	12/16/2014	100.080	99.870	100.0	1
LG&E	C1S	899247	12/2014	12/16/2014	100.080	99.960	100.0	1
LG&E	C1S	899248	12/2014	12/16/2014	100.070	100.010	100.0	1
LG&E	C1S	899249	12/2014	12/16/2014	100.090	99.890	100.1	1
LG&E	C1S	899250	12/2014	12/16/2014	100.060	99.900	100.0	1
LG&E	C1S	899251	12/2014	12/16/2014	100.110	99.940	100.1	1
LG&E	C1S	899252	12/2014	12/16/2014	100.090	100.020	100.0	1
LG&E	C1S	899253	12/2014	12/16/2014	100.100	100.000	100.1	1
LG&E	C1S	899254	12/2014	12/16/2014	100.060	99.840	100.0	1
LG&E	C1S	899255	12/2014	12/16/2014	100.060	99.900	100.1	1
LG&E	C1S	899256	12/2014	12/16/2014	100.080	99.920	100.0	1
LG&E	C1S	899257	12/2014	12/16/2014	100.070	99.900	99.9	1
LG&E	C1S	899258	12/2014	12/16/2014	100.060	99.810	100.0	1
LG&E	C1S	899259	12/2014	12/16/2014	100.090	99.950	100.1	1
LG&E	C1S	899260	12/2014	12/16/2014	100.110	99.950	100.0	1

LG&E	C1S	899261	12/2014	12/16/2014	100.100	100.010	100.0	1
LG&E	C1S	899262	12/2014	12/16/2014	100.070	99.930	100.1	1
LG&E	C1S	899263	12/2014	12/16/2014	100.080	99.940	100.0	1
LG&E	C1S	899264	12/2014	12/16/2014	100.090	99.990	100.0	1
LG&E	C1S	899265	12/2014	12/16/2014	100.060	99.930	100.0	1
LG&E	C1S	899266	12/2014	12/16/2014	100.070	99.850	100.0	1
LG&E	C1S	899267	12/2014	12/16/2014	100.060	99.970	100.0	1
LG&E	C1S	899268	12/2014	12/16/2014	100.100	99.930	100.1	1
LG&E	C1S	899269	12/2014	12/16/2014	100.080	99.810	100.0	1
LG&E	C1S	899270	12/2014	12/16/2014	100.070	99.860	100.0	1
LG&E	C1S	899271	12/2014	12/16/2014	100.060	99.890	100.0	1
LG&E	C1S	899272	12/2014	12/16/2014	100.090	100.000	100.0	1
LG&E	C1S	899273	12/2014	12/16/2014	100.060	99.930	100.0	1
LG&E	C1S	899274	12/2014	12/16/2014	100.090	99.950	100.0	1
LG&E	C1S	899275	12/2014	12/16/2014	100.070	99.920	100.0	1
LG&E	C1S	899276	12/2014	12/16/2014	100.060	99.890	100.1	1
LG&E	C1S	899277	12/2014	12/16/2014	100.090	99.920	100.0	1
LG&E	C1S	899278	12/2014	12/16/2014	100.060	99.900	100.0	1
LG&E	C1S	899279	12/2014	12/16/2014	100.070	99.890	100.0	1
LG&E	C1S	899280	12/2014	12/16/2014	100.100	99.960	100.1	1
LG&E	C1S	899281	12/2014	12/16/2014	100.060	99.910	100.0	1
LG&E	C1S	899282	12/2014	12/16/2014	100.090	99.960	100.0	1
LG&E	C1S	899283	12/2014	12/16/2014	100.070	99.970	100.0	1
LG&E	C1S	899284	12/2014	12/16/2014	100.090	99.940	100.1	1
LG&E	C1S	899285	12/2014	12/16/2014	100.060	99.950	100.0	1
LG&E	C1S	899286	12/2014	12/16/2014	100.080	99.930	100.0	1
LG&E	C1S	899287	12/2014	12/16/2014	100.070	99.930	100.0	1
LG&E	C1S	899288	12/2014	12/16/2014	100.070	99.920	100.1	1
LG&E	C1S	899289	12/2014	12/16/2014	100.100	99.900	100.1	1
LG&E	C1S	899290	12/2014	12/16/2014	100.090	99.990	100.0	1
LG&E	C1S	899291	12/2014	12/16/2014	100.090	99.980	100.1	1
LG&E	C1S	899292	12/2014	12/16/2014	100.090	99.870	100.0	1

LG&E	C1S	899293	12/2014	12/16/2014	100.060	99.840	100.0	1
LG&E	C1S	899294	12/2014	12/16/2014	100.080	99.940	100.0	1
LG&E	C1S	899295	12/2014	12/16/2014	100.080	99.920	100.0	1
LG&E	C1S	899296	12/2014	12/16/2014	100.070	99.900	100.0	1
LG&E	C1S	899297	12/2014	12/16/2014	100.050	99.850	100.0	1
LG&E	C1S	899298	12/2014	12/16/2014	100.080	99.910	100.0	1
LG&E	C1S	899299	12/2014	12/16/2014	100.050	99.820	100.0	1
LG&E	C1S	899300	12/2014	12/16/2014	100.090	99.960	100.1	1
LG&E	C1S	899301	12/2014	12/16/2014	100.090	99.940	100.0	1
LG&E	C1S	899302	12/2014	12/16/2014	100.070	99.930	100.0	1
LG&E	C1S	899303	12/2014	12/16/2014	100.060	99.840	100.1	1
LG&E	C1S	899304	12/2014	12/16/2014	100.090	99.840	100.0	1
LG&E	C1S	899305	12/2014	12/16/2014	100.060	99.870	100.1	1
LG&E	C1S	899306	12/2014	12/16/2014	100.060	99.850	100.0	1
LG&E	C1S	899307	12/2014	12/16/2014	100.060	99.920	100.0	1
LG&E	C1S	899308	12/2014	12/16/2014	100.070	99.850	100.0	1
LG&E	C1S	899309	12/2014	12/16/2014	100.060	99.930	100.0	1
LG&E	C1S	899310	12/2014	12/16/2014	100.100	99.990	100.1	1
LG&E	C1S	899311	12/2014	12/16/2014	100.060	99.910	100.1	1
LG&E	C1S	899312	12/2014	12/16/2014	100.060	99.870	100.1	1
LG&E	C1S	899313	12/2014	12/16/2014	100.090	99.880	100.0	1
LG&E	C1S	899314	12/2014	12/16/2014	100.090	99.970	100.0	1
LG&E	C1S	899315	12/2014	12/16/2014	100.090	99.930	100.1	1
LG&E	C1S	899316	12/2014	12/16/2014	100.100	99.970	100.0	1
LG&E	C1S	899317	12/2014	12/16/2014	100.070	99.860	100.0	1
LG&E	C1S	899318	12/2014	12/16/2014	100.070	99.830	100.0	1
LG&E	C1S	899319	12/2014	12/16/2014	100.080	99.950	100.0	1
LG&E	C1S	899320	12/2014	12/16/2014	100.060	99.900	100.0	1
LG&E	C1S	899321	12/2014	12/16/2014	100.100	99.970	100.0	1
LG&E	C1S	899322	12/2014	12/16/2014	100.100	99.980	100.0	1
LG&E	C1S	899323	12/2014	12/16/2014	100.080	99.850	100.0	1
LG&E	C1S	899324	12/2014	12/16/2014	100.060	99.890	100.0	1

LG&E	C1S	899325	12/2014	12/16/2014	100.080	99.910	100.0	1
LG&E	C1S	899326	12/2014	12/16/2014	100.090	99.900	100.1	1
LG&E	C1S	899327	12/2014	12/16/2014	100.060	99.990	100.0	1
LG&E	C1S	899328	12/2014	12/16/2014	100.110	99.900	100.0	1
LG&E	C1S	899329	12/2014	12/16/2014	100.070	99.890	100.1	1
LG&E	C1S	899330	12/2014	12/16/2014	100.070	99.900	100.0	1
LG&E	C1S	899331	12/2014	12/16/2014	100.070	99.940	100.0	1
LG&E	C1S	899332	12/2014	12/16/2014	100.070	99.890	100.0	1
LG&E	C1S	899333	12/2014	12/16/2014	100.090	99.930	100.0	1
LG&E	C1S	899334	12/2014	12/16/2014	100.090	99.940	100.1	1
LG&E	C1S	899335	12/2014	12/16/2014	100.070	99.880	100.0	1
LG&E	C1S	899336	12/2014	12/16/2014	100.070	99.870	100.0	1
LG&E	C1S	899337	12/2014	12/16/2014	100.080	99.990	100.0	1
LG&E	C1S	899338	12/2014	12/16/2014	100.070	99.920	100.1	1
LG&E	C1S	899339	12/2014	12/16/2014	100.070	99.960	100.0	1
LG&E	C1S	899340	12/2014	12/16/2014	100.100	99.900	100.1	1
LG&E	C1S	899341	12/2014	12/16/2014	100.110	99.950	100.0	1
LG&E	C1S	899342	12/2014	12/16/2014	100.090	99.920	100.0	1
LG&E	C1S	899343	12/2014	12/16/2014	100.070	99.900	100.0	1
LG&E	C1S	899344	12/2014	12/16/2014	100.090	99.900	100.1	1
LG&E	C1S	899345	12/2014	12/16/2014	100.100	99.950	100.0	1
LG&E	C1S	899346	12/2014	12/16/2014	100.070	99.910	100.0	1
LG&E	C1S	899347	12/2014	12/16/2014	100.080	99.950	100.1	1
LG&E	C1S	899348	12/2014	12/16/2014	100.070	99.930	100.0	1
LG&E	C1S	899349	12/2014	12/16/2014	100.080	99.900	100.0	1
LG&E	C1S	899350	12/2014	12/16/2014	100.110	100.000	100.0	1
LG&E	C1S	899351	12/2014	12/16/2014	100.090	99.900	100.0	1
LG&E	C1S	899352	12/2014	12/16/2014	100.090	99.950	100.0	1
LG&E	C1S	899353	12/2014	12/16/2014	100.100	99.940	100.0	1
LG&E	C1S	899354	12/2014	12/16/2014	100.090	99.930	100.0	1
LG&E	C1S	899355	12/2014	12/16/2014	100.110	99.970	100.1	1
LG&E	C1S	899356	12/2014	12/16/2014	100.070	99.980	100.0	1

LG&E	C1S	899357	12/2014	12/16/2014	100.110	99.940	100.0	1
LG&E	C1S	899358	12/2014	12/16/2014	100.050	99.870	100.0	1
LG&E	C1S	899359	12/2014	12/16/2014	100.070	99.910	100.1	1
LG&E	C1S	899360	12/2014	12/16/2014	100.090	99.880	100.1	1
LG&E	C1S	899361	12/2014	12/16/2014	100.100	99.840	100.0	1
LG&E	C1S	899362	12/2014	12/16/2014	100.080	99.890	100.0	1
LG&E	C1S	899363	12/2014	12/16/2014	100.090	99.930	100.1	1
LG&E	C1S	899364	12/2014	12/16/2014	100.060	99.940	100.0	1
LG&E	C1S	899365	12/2014	12/16/2014	100.060	99.870	100.1	1
LG&E	C1S	899366	12/2014	12/16/2014	100.080	99.890	100.1	1
LG&E	C1S	899367	12/2014	12/16/2014	100.080	99.910	100.0	1
LG&E	C1S	899368	12/2014	12/16/2014	100.080	99.980	99.9	1
LG&E	C1S	899369	12/2014	12/16/2014	100.070	99.880	100.0	1
LG&E	C1S	899370	12/2014	12/16/2014	100.080	99.960	100.0	1
LG&E	C1S	899371	12/2014	12/16/2014	100.090	99.950	100.0	1
LG&E	C1S	899372	12/2014	12/16/2014	100.100	99.990	100.0	1
LG&E	C1S	899373	12/2014	12/16/2014	100.080	99.970	100.0	1
LG&E	C1S	899374	12/2014	12/16/2014	100.090	99.910	100.0	1
LG&E	C1S	899375	12/2014	12/16/2014	100.070	99.950	100.1	1
LG&E	C1S	899376	12/2014	12/16/2014	100.090	99.910	100.0	1
LG&E	C1S	899377	12/2014	12/16/2014	100.080	99.870	100.0	1
LG&E	C1S	899378	12/2014	12/16/2014	100.080	99.930	100.0	1
LG&E	C1S	899379	12/2014	12/16/2014	100.080	99.950	99.9	1
LG&E	C1S	899380	12/2014	12/16/2014	100.070	99.970	100.0	1
LG&E	C1S	899381	12/2014	12/16/2014	100.090	99.930	100.0	1
LG&E	C1S	899382	12/2014	12/16/2014	100.100	99.960	100.1	1
LG&E	C1S	899383	12/2014	12/16/2014	100.100	99.910	100.1	1
LG&E	C1S	899384	12/2014	12/16/2014	100.100	99.910	100.0	1
LG&E	C1S	899385	12/2014	12/16/2014	100.090	99.920	100.0	1
LG&E	C1S	899386	12/2014	12/16/2014	100.090	99.950	100.0	1
LG&E	C1S	899387	12/2014	12/16/2014	100.060	99.860	100.0	1
LG&E	C1S	899388	12/2014	12/16/2014	100.060	99.980	100.0	1

LG&E	C1S	899389	12/2014	12/16/2014	100.100	99.940	100.0	1
LG&E	C1S	899390	12/2014	12/16/2014	100.070	99.850	100.0	1
LG&E	C1S	899391	12/2014	12/16/2014	100.090	99.940	100.1	1
LG&E	C1S	899392	12/2014	12/16/2014	100.060	99.880	100.0	1
LG&E	C1S	899393	12/2014	12/16/2014	100.090	99.960	100.1	1
LG&E	C1S	899394	12/2014	12/16/2014	100.080	99.930	100.0	1
LG&E	C1S	899395	12/2014	12/16/2014	100.060	99.910	100.0	1
LG&E	C1S	899396	12/2014	12/16/2014	100.090	99.980	100.1	1
LG&E	C1S	899397	12/2014	12/16/2014	100.090	99.920	100.0	1
LG&E	C1S	899398	12/2014	12/16/2014	100.100	100.010	100.1	1
LG&E	C1S	899399	12/2014	12/16/2014	100.090	99.860	100.0	1
LG&E	C1S	899400	12/2014	12/16/2014	100.090	99.910	100.0	1
LG&E	C1S	899401	12/2014	12/16/2014	100.100	99.990	100.0	1
LG&E	C1S	899402	12/2014	12/16/2014	100.090	99.940	100.1	1
LG&E	C1S	899403	12/2014	12/16/2014	100.060	99.890	100.1	1
LG&E	C1S	899404	12/2014	12/16/2014	100.080	99.950	100.0	1
LG&E	C1S	899405	12/2014	12/16/2014	100.060	99.940	99.9	1
LG&E	C1S	899406	12/2014	12/16/2014	100.070	99.910	100.0	1
LG&E	C1S	899407	12/2014	12/16/2014	100.060	99.940	100.0	1
LG&E	C1S	899408	12/2014	12/16/2014	100.090	99.920	100.0	1
LG&E	C1S	899409	12/2014	12/16/2014	100.070	99.870	100.0	1
LG&E	C1S	899410	12/2014	12/16/2014	100.060	99.830	100.0	1
LG&E	C1S	899411	12/2014	12/16/2014	100.100	99.950	100.0	1
LG&E	C1S	899412	12/2014	12/16/2014	100.110	99.930	100.1	1
LG&E	C1S	899413	12/2014	12/16/2014	100.080	99.920	100.0	1
LG&E	C1S	899414	12/2014	12/16/2014	100.060	99.900	100.1	1
LG&E	C1S	899415	12/2014	12/16/2014	100.080	99.840	100.1	1
LG&E	C1S	899416	12/2014	12/16/2014	100.080	99.890	100.1	1
LG&E	C1S	899417	12/2014	12/16/2014	100.060	99.960	100.1	1
LG&E	C1S	899418	12/2014	12/16/2014	100.070	99.920	100.1	1
LG&E	C1S	899419	12/2014	12/16/2014	100.070	99.930	100.0	1
LG&E	C1S	899420	12/2014	12/16/2014	100.080	99.920	100.1	1

LG&E	C1S	899421	12/2014	12/16/2014	100.100	99.940	100.1	1
LG&E	C1S	899422	12/2014	12/16/2014	100.100	99.960	100.0	1
LG&E	C1S	899423	12/2014	12/16/2014	100.080	99.940	100.0	1
LG&E	C1S	899424	12/2014	12/16/2014	100.100	99.870	100.1	1
LG&E	C1S	899425	12/2014	12/16/2014	100.090	99.900	100.0	1
LG&E	C1S	899426	12/2014	12/16/2014	100.070	99.930	100.0	1
LG&E	C1S	899427	12/2014	12/16/2014	100.080	99.960	100.1	1
LG&E	C1S	899428	12/2014	12/16/2014	100.070	99.910	100.0	1
LG&E	C1S	899429	12/2014	12/16/2014	100.100	99.980	100.1	1
LG&E	C1S	899430	12/2014	12/16/2014	100.050	99.900	100.0	1
LG&E	C1S	899431	12/2014	12/16/2014	100.060	99.940	100.0	1
LG&E	C1S	899432	12/2014	12/16/2014	100.100	99.900	100.1	1
LG&E	C1S	899433	12/2014	12/16/2014	100.100	99.960	100.1	1
LG&E	C1S	899434	12/2014	12/16/2014	100.090	99.920	100.0	1
LG&E	C1S	899435	12/2014	12/16/2014	100.080	99.880	100.0	1
LG&E	C1S	899436	12/2014	12/16/2014	100.070	99.880	100.0	1
LG&E	C1S	899437	12/2014	12/16/2014	100.070	99.960	100.1	1
LG&E	C1S	899438	12/2014	12/16/2014	100.080	99.930	99.9	1
LG&E	C1S	899439	12/2014	12/16/2014	100.090	99.980	100.1	1
LG&E	C1S	899440	12/2014	12/16/2014	100.090	99.890	100.1	1
LG&E	C1S	899441	12/2014	12/16/2014	100.070	99.850	100.1	1
LG&E	C1S	899442	12/2014	12/16/2014	100.090	99.870	100.1	1
LG&E	C1S	899443	12/2014	12/16/2014	100.100	99.980	100.1	1
LG&E	C1S	899444	12/2014	12/16/2014	100.100	99.930	100.1	1
LG&E	C1S	899445	12/2014	12/16/2014	100.060	99.940	100.0	1
LG&E	C1S	899446	12/2014	12/16/2014	100.090	99.900	100.0	1
LG&E	C1S	899447	12/2014	12/16/2014	100.070	99.890	100.0	1
LG&E	C1S	899448	12/2014	12/16/2014	100.100	99.940	100.1	1
LG&E	C1S	899449	12/2014	12/16/2014	100.070	99.900	100.0	1
LG&E	C1S	899450	12/2014	12/16/2014	100.090	99.970	100.0	1
LG&E	C1S	899451	12/2014	12/16/2014	100.060	99.890	100.1	1
LG&E	C1S	899452	12/2014	12/16/2014	100.080	99.950	100.0	1

LG&E	C1S	899453	12/2014	12/16/2014	100.090	99.870	100.1	1
LG&E	C1S	899454	12/2014	12/16/2014	100.090	99.890	100.0	1
LG&E	C1S	899455	12/2014	12/16/2014	100.100	99.980	100.0	1
LG&E	C1S	899456	12/2014	12/16/2014	100.090	99.930	100.0	1
LG&E	C1S	899457	12/2014	12/16/2014	100.090	99.960	100.0	1
LG&E	C1S	899458	12/2014	12/16/2014	100.090	99.990	100.0	1
LG&E	C1S	899459	12/2014	12/16/2014	100.090	99.900	100.1	1
LG&E	C1S	899460	12/2014	12/16/2014	100.080	99.940	100.1	1
LG&E	C1S	899461	12/2014	12/16/2014	100.090	100.000	100.0	1
LG&E	C1S	899462	12/2014	12/16/2014	100.080	99.860	100.0	1
LG&E	C1S	899463	12/2014	12/16/2014	100.060	99.900	99.9	1
LG&E	C1S	899464	12/2014	12/16/2014	100.100	99.940	100.1	1
LG&E	C1S	899465	12/2014	12/16/2014	100.090	99.920	100.0	1
LG&E	C1S	899466	12/2014	12/16/2014	100.060	99.910	100.0	1
LG&E	C1S	899467	12/2014	12/16/2014	100.060	99.880	100.0	1
LG&E	C1S	899468	12/2014	12/16/2014	100.080	99.890	100.1	1
LG&E	C1S	899469	12/2014	12/16/2014	100.090	99.920	100.0	1
LG&E	C1S	899470	12/2014	12/16/2014	100.100	99.960	100.1	1
LG&E	C1S	899471	12/2014	12/16/2014	100.070	99.930	100.0	1
LG&E	C1S	899472	12/2014	12/16/2014	100.060	99.860	100.0	1
LG&E	C1S	899473	12/2014	12/16/2014	100.110	99.980	100.1	1
LG&E	C1S	899474	12/2014	12/16/2014	100.100	99.890	100.0	1
LG&E	C1S	899475	12/2014	12/16/2014	100.060	99.970	99.9	1
LG&E	C1S	899476	12/2014	12/16/2014	100.090	99.910	100.1	1
LG&E	C1S	899477	12/2014	12/16/2014	100.080	99.930	99.9	1
LG&E	C1S	899478	12/2014	12/16/2014	100.080	99.960	100.1	1
LG&E	C1S	899479	12/2014	12/16/2014	100.070	99.890	100.1	1
LG&E	C1S	899480	12/2014	12/16/2014	100.100	99.990	100.0	1
LG&E	C1S	899481	12/2014	12/16/2014	100.060	99.940	100.0	1
LG&E	C1S	899482	12/2014	12/16/2014	100.090	99.930	100.0	1
LG&E	C1S	899483	12/2014	12/16/2014	100.070	99.920	100.0	1
LG&E	C1S	899484	12/2014	12/16/2014	100.100	99.940	100.1	1

LG&E	C1S	899485	12/2014	12/16/2014	100.080	99.870	100.0	1
LG&E	C1S	899486	12/2014	12/16/2014	100.090	99.970	100.0	1
LG&E	C1S	899487	12/2014	12/16/2014	100.080	99.970	100.0	1
LG&E	C1S	899488	12/2014	12/16/2014	100.060	99.930	100.0	1
LG&E	C1S	899489	12/2014	12/16/2014	100.100	99.970	100.1	1
LG&E	C1S	899490	12/2014	12/16/2014	100.070	99.970	100.0	1
LG&E	C1S	899491	12/2014	12/16/2014	100.050	99.930	100.0	1
LG&E	C1S	899492	12/2014	12/16/2014	100.090	99.930	100.0	1
LG&E	C1S	899493	12/2014	12/16/2014	100.090	99.910	100.1	1
LG&E	C1S	899494	12/2014	12/16/2014	100.060	99.900	100.0	1
LG&E	C1S	899495	12/2014	12/16/2014	100.080	99.940	100.0	1
LG&E	C1S	899496	12/2014	12/16/2014	100.100	99.970	100.0	1
LG&E	C1S	899497	12/2014	12/16/2014	100.080	99.900	100.1	1
LG&E	C1S	899498	12/2014	12/16/2014	100.100	99.960	100.1	1
LG&E	C1S	899499	12/2014	12/16/2014	100.060	99.920	100.0	1
LG&E	C1S	899500	12/2014	12/16/2014	100.070	99.960	100.0	1
LG&E	C1S	899501	12/2014	12/16/2014	100.080	99.980	100.1	1
LG&E	C1S	899502	12/2014	12/16/2014	100.070	99.890	100.0	1
LG&E	C1S	899503	12/2014	12/16/2014	100.070	99.870	100.0	1
LG&E	C1S	899504	12/2014	12/16/2014	100.080	99.950	100.0	1
LG&E	C1S	899505	12/2014	12/16/2014	100.060	99.880	100.0	1
LG&E	C1S	899506	12/2014	12/16/2014	100.070	99.940	100.0	1
LG&E	C1S	899507	12/2014	12/16/2014	100.080	99.900	100.0	1
LG&E	C1S	899508	12/2014	12/16/2014	100.100	99.890	100.1	1
LG&E	C1S	899509	12/2014	12/16/2014	100.100	99.990	100.1	1
LG&E	C1S	899510	12/2014	12/16/2014	100.060	99.840	100.0	1
LG&E	C1S	899511	12/2014	12/16/2014	100.100	99.930	100.2	1
LG&E	C1S	899512	12/2014	12/16/2014	100.070	99.880	100.0	1
LG&E	C1S	899513	12/2014	12/16/2014	100.100	99.990	100.0	1
LG&E	C1S	899514	12/2014	12/16/2014	100.060	99.880	99.9	1
LG&E	C1S	899515	12/2014	12/16/2014	100.070	99.910	100.0	1
LG&E	C1S	899516	12/2014	12/16/2014	100.100	99.990	100.0	1

LG&E	C1S	899517	12/2014	12/16/2014	100.070	99.870	100.0	1
LG&E	C1S	899518	12/2014	12/16/2014	100.060	99.980	99.9	1
LG&E	C1S	899519	12/2014	12/16/2014	100.070	99.920	100.0	1
LG&E	C1S	899520	12/2014	12/16/2014	100.060	99.900	100.1	1
LG&E	C1S	899521	12/2014	12/16/2014	100.080	99.910	100.0	1
LG&E	C1S	899522	12/2014	12/16/2014	100.060	99.870	100.0	1
LG&E	C1S	899523	12/2014	12/16/2014	100.070	99.890	100.0	1
LG&E	C1S	899524	12/2014	12/16/2014	100.080	99.910	100.1	1
LG&E	C1S	899525	12/2014	12/16/2014	100.100	99.950	100.0	1
LG&E	C1S	899526	12/2014	12/16/2014	100.060	99.870	100.0	1
LG&E	C1S	899527	12/2014	12/16/2014	100.070	99.900	100.0	1
LG&E	C1S	899528	12/2014	12/16/2014	100.090	99.830	99.9	1
LG&E	C1S	899529	12/2014	12/16/2014	100.090	99.990	100.0	1
LG&E	C1S	899530	12/2014	12/16/2014	100.060	99.860	100.0	1
LG&E	C1S	899531	12/2014	12/16/2014	100.090	99.940	100.0	1
LG&E	C1S	899532	12/2014	12/16/2014	100.060	99.900	100.1	1
LG&E	C1S	899533	12/2014	12/16/2014	100.090	99.880	100.0	1
LG&E	C1S	899534	12/2014	12/16/2014	100.090	99.900	100.0	1
LG&E	C1S	899535	12/2014	12/16/2014	100.070	99.890	100.0	1
LG&E	C1S	899536	12/2014	12/16/2014	100.070	99.880	100.0	1
LG&E	C1S	899537	12/2014	12/16/2014	100.060	99.890	100.0	1
LG&E	C1S	899538	12/2014	12/16/2014	100.070	99.840	100.0	1
LG&E	C1S	899539	12/2014	12/16/2014	100.090	99.940	100.0	1
LG&E	C1S	899540	12/2014	12/16/2014	100.070	99.860	100.1	1
LG&E	C1S	899541	12/2014	12/16/2014	100.080	99.920	100.0	1
LG&E	C1S	899542	12/2014	12/16/2014	100.070	99.870	100.0	1
LG&E	C1S	899543	12/2014	12/16/2014	100.070	99.980	100.0	1
LG&E	C1S	899544	12/2014	12/16/2014	100.080	99.930	99.9	1
LG&E	C1S	899545	12/2014	12/16/2014	100.090	99.890	100.1	1
LG&E	C1S	899546	12/2014	12/16/2014	100.070	99.890	100.0	1
LG&E	C1S	899547	12/2014	12/16/2014	100.090	99.940	100.0	1
LG&E	C1S	899548	12/2014	12/16/2014	100.070	99.920	100.0	1

LG&E	C1S	899549	12/2014	12/16/2014	100.070	99.900	100.0	1
LG&E	C1S	899550	12/2014	12/16/2014	100.090	99.900	100.0	1
LG&E	C1S	899551	12/2014	12/16/2014	100.070	99.920	100.0	1
LG&E	C1S	899552	12/2014	12/16/2014	100.100	99.890	100.0	1
LG&E	C1S	899553	12/2014	12/16/2014	100.070	99.840	100.0	1
LG&E	C1S	899554	12/2014	12/16/2014	100.070	99.870	100.0	1
LG&E	C1S	899555	12/2014	12/16/2014	100.100	99.880	100.1	1
LG&E	C1S	899556	12/2014	12/16/2014	100.060	99.880	100.0	1
LG&E	C1S	899557	12/2014	12/16/2014	100.060	99.950	100.0	1
LG&E	C1S	899558	12/2014	12/16/2014	100.090	99.890	100.0	1
LG&E	C1S	899559	12/2014	12/16/2014	100.060	99.970	100.0	1
LG&E	C1S	899560	12/2014	12/16/2014	100.080	99.870	100.0	1
LG&E	C1S	899561	12/2014	12/16/2014	100.100	99.960	100.1	1
LG&E	C1S	899562	12/2014	12/16/2014	100.090	99.930	99.9	1
LG&E	C1S	899563	12/2014	12/16/2014	100.090	99.960	100.0	1
LG&E	C1S	899564	12/2014	12/16/2014	100.060	99.890	100.0	1
LG&E	C1S	899565	12/2014	12/16/2014	100.080	99.950	100.1	1
LG&E	C1S	899566	12/2014	12/16/2014	100.050	99.890	99.9	1
LG&E	C1S	899567	12/2014	12/16/2014	100.080	99.930	100.1	1
LG&E	C1S	899568	12/2014	12/16/2014	100.100	99.930	100.1	1
LG&E	C1S	899569	12/2014	12/16/2014	100.080	99.950	99.9	1
LG&E	C1S	899570	12/2014	12/16/2014	100.070	99.870	100.0	1
LG&E	C1S	899571	12/2014	12/16/2014	100.050	99.880	99.9	1
LG&E	C1S	899572	12/2014	12/16/2014	100.070	99.850	100.0	1
LG&E	C1S	899573	12/2014	12/16/2014	100.070	99.930	100.0	1
LG&E	C1S	899574	12/2014	12/16/2014	100.080	99.900	100.0	1
LG&E	C1S	899575	12/2014	12/16/2014	100.090	99.880	100.1	1
LG&E	C1S	899576	12/2014	12/16/2014	100.060	99.970	100.0	1
LG&E	C1S	899577	12/2014	12/16/2014	100.090	99.900	100.1	1
LG&E	C1S	899578	12/2014	12/16/2014	100.090	99.930	100.0	1
LG&E	C1S	899579	12/2014	12/16/2014	100.080	99.990	99.9	1
LG&E	C1S	899580	12/2014	12/16/2014	100.060	99.930	99.9	1

LG&E	C1S	899581	12/2014	12/16/2014	100.100	99.910	100.0	1
LG&E	C1S	899582	12/2014	12/16/2014	100.110	99.930	100.0	1
LG&E	C1S	899583	12/2014	12/16/2014	100.080	99.940	100.1	1
LG&E	C1S	899584	12/2014	12/16/2014	100.090	99.950	100.0	1
LG&E	C1S	899585	12/2014	12/16/2014	100.090	99.900	99.9	1
LG&E	C1S	899586	12/2014	12/16/2014	100.070	99.980	100.1	1
LG&E	C1S	899587	12/2014	12/16/2014	100.060	99.930	99.9	1
LG&E	C1S	899588	12/2014	12/16/2014	100.090	99.950	100.1	1
LG&E	C1S	899589	12/2014	12/16/2014	100.090	99.920	100.1	1
LG&E	C1S	899590	12/2014	12/16/2014	100.090	99.980	100.0	1
LG&E	C1S	899591	12/2014	12/16/2014	100.100	99.960	100.1	1
LG&E	C1S	899592	12/2014	12/16/2014	100.080	99.980	100.0	1
LG&E	C1S	899593	12/2014	12/16/2014	100.090	99.850	100.0	1
LG&E	C1S	899594	12/2014	12/16/2014	100.080	99.900	100.0	1
LG&E	C1S	899595	12/2014	12/16/2014	100.090	99.920	99.9	1
LG&E	C1S	899596	12/2014	12/16/2014	100.080	99.910	100.0	1
LG&E	C1S	899597	12/2014	12/16/2014	100.060	99.920	99.9	1
LG&E	C1S	899598	12/2014	12/16/2014	100.080	99.890	100.1	1
LG&E	C1S	899599	12/2014	12/16/2014	100.090	99.940	100.0	1
LG&E	C1S	899600	12/2014	12/16/2014	100.100	99.950	100.0	1
LG&E	C1S	899601	12/2014	12/16/2014	100.100	99.880	100.0	1
LG&E	C1S	899602	12/2014	12/16/2014	100.100	99.930	100.0	1
LG&E	C1S	899603	12/2014	12/16/2014	100.100	99.930	100.1	1
LG&E	C1S	899604	12/2014	12/16/2014	100.070	99.930	100.0	1
LG&E	C1S	899605	12/2014	12/16/2014	100.080	99.920	100.0	1
LG&E	C1S	899606	12/2014	12/16/2014	100.080	99.910	100.0	1
LG&E	C1S	899607	12/2014	12/16/2014	100.060	99.860	100.0	1
LG&E	C1S	899608	12/2014	12/16/2014	100.060	99.950	100.0	1
LG&E	C1S	899609	12/2014	12/16/2014	100.070	99.930	100.0	1
LG&E	C1S	899610	12/2014	12/16/2014	100.090	99.970	100.0	1
LG&E	C1S	899611	12/2014	12/16/2014	100.090	99.930	100.0	1
LG&E	C1S	899612	12/2014	12/16/2014	100.070	99.900	100.0	1

LG&E	C1S	899613	12/2014	12/16/2014	100.080	99.930	100.0	1
LG&E	C1S	899614	12/2014	12/16/2014	100.090	99.920	100.0	1
LG&E	C1S	899615	12/2014	12/16/2014	100.100	99.910	100.1	1
LG&E	C1S	899616	12/2014	12/16/2014	100.090	99.860	100.0	1
LG&E	C1S	899617	12/2014	12/16/2014	100.090	99.920	100.0	1
LG&E	C1S	899618	12/2014	12/16/2014	100.060	99.880	100.0	1
LG&E	C1S	899619	12/2014	12/16/2014	100.050	99.910	100.0	1
LG&E	C1S	899620	12/2014	12/16/2014	100.110	100.010	100.1	1
LG&E	C1S	899621	12/2014	12/16/2014	100.100	100.000	100.0	1
LG&E	C1S	899622	12/2014	12/16/2014	100.100	99.890	100.1	1
LG&E	C1S	899623	12/2014	12/16/2014	100.090	99.900	100.0	1
LG&E	C1S	899624	12/2014	12/16/2014	100.050	99.870	99.9	1
LG&E	C1S	899625	12/2014	12/16/2014	100.070	99.900	99.9	1
LG&E	C1S	899626	12/2014	12/16/2014	100.060	99.960	100.0	1
LG&E	C1S	899627	12/2014	12/16/2014	100.100	99.980	100.0	1
LG&E	C1S	899628	12/2014	12/16/2014	100.070	99.890	100.1	1
LG&E	C1S	899629	12/2014	12/16/2014	100.100	99.890	100.1	1
LG&E	C1S	899630	12/2014	12/16/2014	100.070	99.940	100.0	1
LG&E	C1S	899631	12/2014	12/16/2014	100.080	99.890	100.0	1
LG&E	C1S	899632	12/2014	12/16/2014	100.090	99.900	100.1	1
LG&E	C1S	899633	12/2014	12/16/2014	100.080	99.970	100.1	1
LG&E	C1S	899634	12/2014	12/16/2014	100.070	99.910	100.1	1
LG&E	C1S	899635	12/2014	12/16/2014	100.060	99.870	100.0	1
LG&E	C1S	899636	12/2014	12/16/2014	100.070	100.010	100.1	1
LG&E	C1S	899637	12/2014	12/16/2014	100.090	99.870	100.0	1
LG&E	C1S	899638	12/2014	12/16/2014	100.100	99.970	100.1	1
LG&E	C1S	899639	12/2014	12/16/2014	100.080	99.920	100.1	1
LG&E	C1S	899640	12/2014	12/16/2014	100.060	99.920	100.0	1
LG&E	C1S	899641	12/2014	12/16/2014	100.090	99.890	100.1	1
LG&E	C1S	899642	12/2014	12/16/2014	100.080	99.870	100.0	1
LG&E	C1S	899643	12/2014	12/16/2014	100.080	99.920	100.0	1
LG&E	C1S	899644	12/2014	12/16/2014	100.070	99.960	100.0	1

LG&E	C1S	899645	12/2014	12/16/2014	100.060	99.930	100.0	1
LG&E	C1S	899646	12/2014	12/16/2014	100.080	99.900	100.1	1
LG&E	C1S	899647	12/2014	12/16/2014	100.070	99.920	100.0	1
LG&E	C1S	899648	12/2014	12/16/2014	100.080	99.920	100.0	1
LG&E	C1S	899649	12/2014	12/16/2014	100.060	99.960	100.0	1
LG&E	C1S	899650	12/2014	12/16/2014	100.080	99.920	100.0	1
LG&E	C1S	899651	12/2014	12/16/2014	100.070	99.860	100.1	1
LG&E	C1S	899652	12/2014	12/16/2014	100.100	99.950	100.0	1
LG&E	C1S	899653	12/2014	12/16/2014	100.060	99.900	99.9	1
LG&E	C1S	899654	12/2014	12/16/2014	100.080	99.890	100.0	1
LG&E	C1S	899655	12/2014	12/16/2014	100.100	99.960	100.0	1
LG&E	C1S	899656	12/2014	12/16/2014	100.080	99.870	100.0	1
LG&E	C1S	899657	12/2014	12/16/2014	100.070	99.950	100.0	1
LG&E	C1S	899658	12/2014	12/16/2014	100.080	99.860	100.0	1
LG&E	C1S	899659	12/2014	12/16/2014	100.100	99.970	100.0	1
LG&E	C1S	899660	12/2014	12/16/2014	100.090	99.980	100.0	1
LG&E	C1S	899661	12/2014	12/16/2014	100.060	99.910	100.1	1
LG&E	C1S	899662	12/2014	12/16/2014	100.100	99.940	100.0	1
LG&E	C1S	899663	12/2014	12/16/2014	100.080	99.890	99.9	1
LG&E	C1S	899664	12/2014	12/16/2014	100.070	99.930	100.0	1
LG&E	C1S	899665	12/2014	12/16/2014	100.060	99.970	100.0	1
LG&E	C1S	899666	12/2014	12/16/2014	100.100	99.900	99.9	1
LG&E	C1S	899667	12/2014	12/16/2014	100.090	99.900	100.0	1
LG&E	C1S	899668	12/2014	12/16/2014	100.070	99.900	100.0	1
LG&E	C1S	899669	12/2014	12/16/2014	100.100	99.950	100.1	1
LG&E	C1S	899670	12/2014	12/16/2014	100.060	99.940	100.0	1
LG&E	C1S	899671	12/2014	12/16/2014	100.070	99.850	100.0	1
LG&E	C1S	899672	12/2014	12/16/2014	100.100	99.960	100.0	1
LG&E	C1S	899673	12/2014	12/16/2014	100.080	99.970	100.0	1
LG&E	C1S	899674	12/2014	12/16/2014	100.100	99.930	100.0	1
LG&E	C1S	899675	12/2014	12/16/2014	100.070	99.920	100.1	1
LG&E	C1S	899676	12/2014	12/16/2014	100.090	99.940	100.1	1

LG&E	C1S	899677	12/2014	12/16/2014	100.090	99.910	100.0	1
LG&E	C1S	899678	12/2014	12/16/2014	100.060	99.950	100.1	1
LG&E	C1S	899679	12/2014	12/16/2014	100.100	99.940	100.0	1
LG&E	C1S	899680	12/2014	12/16/2014	100.060	99.950	100.0	1
LG&E	C1S	899681	12/2014	12/16/2014	100.080	99.880	100.0	1
LG&E	C1S	899682	12/2014	12/16/2014	100.080	99.880	100.0	1
LG&E	C1S	899683	12/2014	12/16/2014	100.100	99.990	100.1	1
LG&E	C1S	899684	12/2014	12/16/2014	100.050	99.920	100.0	1
LG&E	C1S	899685	12/2014	12/16/2014	100.060	99.900	100.1	1
LG&E	C1S	899686	12/2014	12/16/2014	100.060	99.950	100.0	1
LG&E	C1S	899687	12/2014	12/16/2014	100.090	99.930	100.1	1
LG&E	C1S	899688	12/2014	12/16/2014	100.070	99.940	100.0	1
LG&E	C1S	899689	12/2014	12/16/2014	100.090	99.910	100.1	1
LG&E	C1S	899690	12/2014	12/16/2014	100.100	100.020	100.0	1
LG&E	C1S	899691	12/2014	12/16/2014	100.060	99.940	100.0	1
LG&E	C1S	899692	12/2014	12/16/2014	100.060	99.910	100.1	1
LG&E	C1S	899693	12/2014	12/16/2014	100.060	99.850	100.0	1
LG&E	C1S	899694	12/2014	12/16/2014	100.100	99.930	99.9	1
LG&E	C1S	899695	12/2014	12/16/2014	100.060	99.940	100.1	1
LG&E	C1S	899696	12/2014	12/16/2014	100.110	99.970	100.1	1
LG&E	C1S	899697	12/2014	12/16/2014	100.100	99.970	100.0	1
LG&E	C1S	899698	12/2014	12/16/2014	100.070	99.910	100.1	1
LG&E	C1S	899699	12/2014	12/16/2014	100.070	99.870	100.0	1
LG&E	C1S	899700	12/2014	12/16/2014	100.110	99.920	100.0	1
LG&E	C1S	899701	12/2014	12/16/2014	100.090	99.930	100.0	1
LG&E	C1S	899702	12/2014	12/16/2014	100.090	99.940	100.1	1
LG&E	C1S	899703	12/2014	12/16/2014	100.100	99.970	100.0	1
LG&E	C1S	899704	12/2014	12/16/2014	100.070	99.890	100.1	1
LG&E	C1S	899705	12/2014	12/16/2014	100.100	99.860	100.1	1
LG&E	C1S	899706	12/2014	12/16/2014	100.100	99.980	100.2	1
LG&E	C1S	899707	12/2014	12/16/2014	100.090	99.880	100.0	1
LG&E	C1S	899708	12/2014	12/16/2014	100.090	99.940	100.0	1

LG&E	C1S	899709	12/2014	12/16/2014	100.080	99.920	100.1	1
LG&E	C1S	899710	12/2014	12/16/2014	100.090	99.910	100.0	1
LG&E	C1S	899711	12/2014	12/16/2014	100.060	99.840	99.9	1
LG&E	C1S	899712	12/2014	12/16/2014	100.090	99.950	100.0	1
LG&E	C1S	899713	12/2014	12/16/2014	100.090	99.960	100.0	1
LG&E	C1S	899714	12/2014	12/16/2014	100.090	99.980	100.0	1
LG&E	C1S	899715	12/2014	12/16/2014	100.060	99.840	100.0	1
LG&E	C1S	899716	12/2014	12/16/2014	100.070	99.970	100.0	1
LG&E	C1S	899717	12/2014	12/16/2014	100.090	99.920	100.0	1
LG&E	C1S	899718	12/2014	12/16/2014	100.100	99.900	100.0	1
LG&E	C1S	899719	12/2014	12/16/2014	100.090	99.900	100.0	1
LG&E	C1S	899720	12/2014	12/16/2014	100.070	99.860	100.0	1
LG&E	C1S	899721	12/2014	12/16/2014	100.090	99.910	100.1	1
LG&E	C1S	899722	12/2014	12/16/2014	100.100	99.950	100.1	1
LG&E	C1S	899723	12/2014	12/16/2014	100.070	99.900	100.0	1
LG&E	C1S	899724	12/2014	12/16/2014	100.080	99.900	100.0	1
LG&E	C1S	899725	12/2014	12/16/2014	100.110	99.910	100.1	1
LG&E	C1S	899726	12/2014	12/16/2014	100.080	99.900	100.1	1
LG&E	C1S	899727	12/2014	12/16/2014	100.060	99.830	100.0	1
LG&E	C1S	899728	12/2014	12/16/2014	100.090	99.900	100.1	1
LG&E	C1S	899729	12/2014	12/16/2014	100.060	99.960	99.9	1
LG&E	C1S	899730	12/2014	12/16/2014	100.050	99.870	100.0	1
LG&E	C1S	899731	12/2014	12/16/2014	100.090	99.920	100.1	1
LG&E	C1S	899732	12/2014	12/16/2014	100.090	99.860	100.0	1
LG&E	C1S	899733	12/2014	12/16/2014	100.100	99.880	100.0	1
LG&E	C1S	899734	12/2014	12/16/2014	100.060	99.900	100.0	1
LG&E	C1S	899735	12/2014	12/16/2014	100.080	99.900	100.0	1
LG&E	C1S	899736	12/2014	12/16/2014	100.080	99.850	100.0	1
LG&E	C1S	899737	12/2014	12/16/2014	100.080	99.940	100.1	1
LG&E	C1S	899738	12/2014	12/16/2014	100.090	99.920	100.1	1
LG&E	C1S	899739	12/2014	12/16/2014	100.060	99.920	100.0	1
LG&E	C1S	899740	12/2014	12/16/2014	100.100	99.920	100.1	1

LG&E	C1S	899741	12/2014	12/16/2014	100.100	99.870	100.1	1
LG&E	C1S	899742	12/2014	12/16/2014	100.100	99.900	100.1	1
LG&E	C1S	899743	12/2014	12/16/2014	100.080	99.870	100.0	1
LG&E	C1S	899744	12/2014	12/16/2014	100.060	99.840	100.0	1
LG&E	C1S	899745	12/2014	12/16/2014	100.050	99.870	99.9	1
LG&E	C1S	899746	12/2014	12/16/2014	100.090	99.980	100.0	1
LG&E	C1S	899747	12/2014	12/16/2014	100.060	99.960	100.0	1
LG&E	C1S	899748	12/2014	12/16/2014	100.100	99.920	100.1	1
LG&E	C1S	899749	12/2014	12/16/2014	100.050	99.910	100.0	1
LG&E	C1S	899750	12/2014	12/16/2014	100.090	99.920	100.1	1
LG&E	C1S	899751	12/2014	12/16/2014	100.090	99.900	100.1	1
LG&E	C1S	899752	12/2014	12/16/2014	100.080	99.940	100.1	1
LG&E	C1S	899753	12/2014	12/16/2014	100.060	99.920	100.0	1
LG&E	C1SR	891963	06/2014	05/29/2014	100.050	99.940	100.0	1
LG&E	C1SR	891964	06/2014	05/29/2014	100.040	99.930	100.1	1
LG&E	C1SR	891965	06/2014	05/29/2014	100.090	99.950	99.9	1
LG&E	C1SR	891966	06/2014	05/29/2014	100.070	99.910	99.9	1
LG&E	C1SR	891967	06/2014	05/29/2014	100.060	99.990	99.9	1
LG&E	C1SR	891968	06/2014	05/29/2014	100.070	99.910	99.8	1
LG&E	C1SR	891969	06/2014	05/29/2014	100.090	100.010	100.0	1
LG&E	C1SR	891970	06/2014	05/29/2014	100.060	99.910	99.9	1
LG&E	C1SR	891971	06/2014	05/29/2014	100.100	100.020	100.1	1
LG&E	C1SR	891972	06/2014	05/29/2014	100.100	99.940	100.0	1
LG&E	C1SR	891973	06/2014	05/29/2014	100.050	99.870	100.0	1
LG&E	C1SR	891974	06/2014	05/29/2014	100.080	99.980	100.0	1
LG&E	C1SR	891975	06/2014	05/29/2014	100.070	99.890	99.8	1
LG&E	C1SR	891976	06/2014	05/29/2014	100.040	99.890	99.9	1
LG&E	C1SR	891977	06/2014	05/29/2014	100.070	99.940	99.9	1
LG&E	C1SR	891978	06/2014	05/29/2014	100.060	99.930	99.9	1
LG&E	C1SR	891979	06/2014	05/29/2014	100.070	99.990	99.9	1
LG&E	C1SR	891980	06/2014	05/29/2014	100.070	99.930	99.9	1
LG&E	C1SR	891981	06/2014	05/29/2014	100.040	99.880	100.0	1

LG&E	C1SR	891982	06/2014	05/29/2014	100.070	99.900	99.9	1
LG&E	C1SR	891983	06/2014	05/29/2014	100.090	99.930	99.9	1
LG&E	C1SR	891984	06/2014	05/29/2014	100.050	99.960	99.9	1
LG&E	C1SR	891985	06/2014	05/29/2014	100.040	99.900	99.9	1
LG&E	C1SR	891986	06/2014	05/29/2014	100.100	99.900	99.9	1
LG&E	C1SR	891987	06/2014	05/29/2014	100.050	99.960	100.1	1
LG&E	C1SR	891988	06/2014	05/29/2014	100.060	99.970	100.0	1
LG&E	C1SR	891989	06/2014	05/29/2014	100.060	99.940	100.0	1
LG&E	C1SR	891990	06/2014	05/29/2014	100.060	99.970	100.0	1
LG&E	C1SR	891991	06/2014	05/29/2014	100.040	99.920	100.0	1
LG&E	C1SR	891992	06/2014	05/29/2014	100.070	99.920	99.9	1
LG&E	C1SR	891993	06/2014	05/29/2014	100.090	100.000	100.0	1
LG&E	C1SR	891994	06/2014	05/29/2014	100.050	99.980	99.9	1
LG&E	C1SR	891995	06/2014	05/29/2014	100.060	99.970	99.9	1
LG&E	C1SR	891996	06/2014	05/29/2014	100.070	99.880	99.8	1
LG&E	C1SR	891997	06/2014	05/29/2014	100.060	99.860	99.9	1
LG&E	C1SR	891998	06/2014	05/29/2014	100.060	99.930	99.9	1
LG&E	C1SR	891999	06/2014	05/29/2014	100.080	99.980	100.0	1
LG&E	C1SR	892000	06/2014	05/29/2014	100.090	99.940	99.9	1
LG&E	C1SR	892001	06/2014	05/29/2014	100.090	99.980	99.9	1
LG&E	C1SR	892002	06/2014	05/29/2014	100.070	99.920	99.9	1
LG&E	C1SR	892003	06/2014	05/29/2014	100.070	99.960	99.9	1
LG&E	C1SR	892004	06/2014	05/29/2014	100.100	100.050	100.0	1
LG&E	C1SR	892005	06/2014	05/29/2014	100.070	99.940	100.0	1
LG&E	C1SR	892006	06/2014	05/29/2014	100.090	100.020	100.0	1
LG&E	C1SR	892007	06/2014	05/29/2014	100.050	99.990	99.8	1
LG&E	C1SR	892008	06/2014	05/29/2014	100.070	99.970	100.0	1
LG&E	C1SR	892009	06/2014	05/29/2014	100.040	99.940	99.9	1
LG&E	C1SR	892010	06/2014	05/29/2014	100.070	99.930	99.9	1
LG&E	C1SR	892011	06/2014	05/29/2014	100.070	99.940	99.9	1
LG&E	C1SR	892012	06/2014	05/29/2014	100.060	99.920	100.0	1
LG&E	C1SR	892013	06/2014	05/29/2014	100.050	99.950	100.0	1

LG&E	C1SR	892014	06/2014	05/29/2014	100.080	99.990	99.9	1
LG&E	C1SR	892015	06/2014	05/29/2014	100.050	99.940	99.9	1
LG&E	C1SR	892016	06/2014	05/29/2014	100.080	99.910	99.9	1
LG&E	C1SR	892017	06/2014	05/29/2014	100.090	100.000	99.9	1
LG&E	C1SR	892018	06/2014	05/29/2014	100.080	99.940	99.9	1
LG&E	C1SR	892019	06/2014	05/29/2014	100.080	99.970	100.0	1
LG&E	C1SR	892020	06/2014	05/29/2014	100.080	100.010	100.0	1
LG&E	C1SR	892021	06/2014	05/29/2014	100.060	99.930	100.0	1
LG&E	C1SR	892022	06/2014	05/29/2014	100.030	99.920	100.0	1
LG&E	C1SR	892063	05/2014	05/23/2014	100.050	99.910	99.9	1
LG&E	C1SR	892064	05/2014	05/23/2014	100.060	99.880	99.9	1
LG&E	C1SR	892065	05/2014	05/23/2014	100.080	99.980	100.0	1
LG&E	C1SR	892066	05/2014	05/23/2014	100.070	99.900	100.0	1
LG&E	C1SR	892067	05/2014	05/23/2014	100.050	99.820	100.0	1
LG&E	C1SR	892068	05/2014	05/23/2014	100.050	99.890	100.0	1
LG&E	C1SR	892069	05/2014	05/23/2014	100.080	99.940	100.0	1
LG&E	C1SR	892070	05/2014	05/23/2014	100.100	99.910	100.1	1
LG&E	C1SR	892071	05/2014	05/23/2014	100.100	99.950	100.0	1
LG&E	C1SR	892072	05/2014	05/23/2014	100.060	99.920	100.1	1
LG&E	C1SR	892073	05/2014	05/23/2014	100.030	99.860	100.1	1
LG&E	C1SR	892074	05/2014	05/23/2014	100.100	99.970	100.0	1
LG&E	C1SR	892075	05/2014	05/23/2014	100.060	99.890	100.0	1
LG&E	C1SR	892076	05/2014	05/23/2014	100.070	99.850	100.0	1
LG&E	C1SR	892077	05/2014	05/23/2014	100.050	99.920	99.9	1
LG&E	C1SR	892078	05/2014	05/23/2014	100.060	99.960	100.0	1
LG&E	C1SR	892079	05/2014	05/23/2014	100.060	99.960	99.9	1
LG&E	C1SR	892080	05/2014	05/23/2014	100.060	99.860	100.0	1
LG&E	C1SR	892081	05/2014	05/23/2014	100.040	99.830	100.0	1
LG&E	C1SR	892082	05/2014	05/23/2014	100.090	99.920	100.1	1
LG&E	C1SR	892083	05/2014	05/23/2014	100.030	99.920	100.0	1
LG&E	C1SR	892084	05/2014	05/23/2014	100.070	99.940	100.0	1
LG&E	C1SR	892085	05/2014	05/23/2014	100.030	99.860	99.9	1

LG&E	C1SR	892086	05/2014	05/23/2014	100.050	99.830	100.0	1
LG&E	C1SR	892087	05/2014	05/23/2014	100.080	99.920	100.0	1
LG&E	C1SR	892088	05/2014	05/23/2014	100.090	100.010	100.1	1
LG&E	C1SR	892089	05/2014	05/23/2014	100.100	100.000	100.1	1
LG&E	C1SR	892090	05/2014	05/23/2014	100.070	99.930	99.9	1
LG&E	C1SR	892091	05/2014	05/23/2014	100.070	99.880	99.9	1
LG&E	C1SR	892092	05/2014	05/23/2014	100.100	99.970	100.1	1
LG&E	C1SR	892093	05/2014	05/23/2014	100.060	99.870	99.9	1
LG&E	C1SR	892094	05/2014	05/23/2014	100.050	99.900	100.0	1
LG&E	C1SR	892095	05/2014	05/23/2014	100.090	99.970	100.0	1
LG&E	C1SR	892096	05/2014	05/23/2014	100.030	99.910	100.0	1
LG&E	C1SR	892097	05/2014	05/23/2014	100.060	99.910	100.0	1
LG&E	C1SR	892098	05/2014	05/23/2014	100.030	99.880	99.9	1
LG&E	C1SR	892099	05/2014	05/23/2014	100.050	99.920	100.0	1
LG&E	C1SR	892100	05/2014	05/23/2014	100.080	99.930	100.0	1
LG&E	C1SR	892101	05/2014	05/23/2014	100.100	99.900	100.0	1
LG&E	C1SR	892102	05/2014	05/23/2014	100.040	99.840	99.9	1
LG&E	C1SR	892103	05/2014	05/23/2014	100.070	99.900	100.0	1
LG&E	C1SR	892104	05/2014	05/23/2014	100.060	99.850	100.0	1
LG&E	C1SR	892105	05/2014	05/23/2014	100.030	99.870	100.0	1
LG&E	C1SR	892106	05/2014	05/23/2014	100.050	99.930	100.0	1
LG&E	C1SR	892107	05/2014	05/23/2014	100.070	99.880	100.0	1
LG&E	C1SR	892108	05/2014	05/23/2014	100.040	99.880	100.0	1
LG&E	C1SR	892109	05/2014	05/23/2014	100.060	99.910	100.0	1
LG&E	C1SR	892110	05/2014	05/23/2014	100.050	99.910	100.0	1
LG&E	C1SR	892111	05/2014	05/23/2014	100.030	99.890	99.9	1
LG&E	C1SR	892112	05/2014	05/23/2014	100.040	99.840	100.0	1
LG&E	C1SR	892113	05/2014	05/23/2014	100.040	99.870	100.0	1
LG&E	C1SR	892114	05/2014	05/23/2014	100.040	99.880	99.9	1
LG&E	C1SR	892115	05/2014	05/23/2014	100.040	99.950	100.0	1
LG&E	C1SR	892116	05/2014	05/23/2014	100.090	99.890	100.1	1
LG&E	C1SR	892117	05/2014	05/23/2014	100.060	99.870	100.0	1

LG&E	C1SR	892118	05/2014	05/23/2014	100.080	99.920	100.1	1
LG&E	C1SR	892119	05/2014	05/23/2014	100.060	99.880	99.9	1
LG&E	C1SR	892120	05/2014	05/23/2014	100.080	99.940	100.0	1
LG&E	C1SR	892121	05/2014	05/23/2014	100.080	99.890	99.9	1
LG&E	C1SR	892122	05/2014	05/23/2014	100.050	99.890	100.0	1
LG&E	C1SR	892123	05/2014	05/23/2014	100.070	99.890	100.0	1
LG&E	C1SR	892124	05/2014	05/23/2014	100.060	99.900	99.9	1
LG&E	C1SR	892125	05/2014	05/23/2014	100.070	99.910	100.0	1
LG&E	C1SR	892126	05/2014	05/23/2014	100.060	99.920	100.1	1
LG&E	C1SR	892127	05/2014	05/23/2014	100.060	99.880	100.0	1
LG&E	C1SR	892128	05/2014	05/23/2014	100.040	99.890	100.0	1
LG&E	C1SR	892129	05/2014	05/23/2014	100.090	99.900	100.0	1
LG&E	C1SR	892130	05/2014	05/23/2014	100.070	99.930	100.0	1
LG&E	C1SR	892131	05/2014	05/23/2014	100.090	99.860	100.1	1
LG&E	C1SR	892132	05/2014	05/23/2014	100.060	99.930	100.0	1
LG&E	C1SR	892133	05/2014	05/23/2014	100.110	99.930	100.1	1
LG&E	C1SR	892134	05/2014	05/23/2014	100.070	99.950	100.1	1
LG&E	C1SR	892135	05/2014	05/23/2014	100.040	99.930	100.0	1
LG&E	C1SR	892136	05/2014	05/23/2014	100.100	99.930	100.0	1
LG&E	C1SR	892137	05/2014	05/23/2014	100.090	99.970	100.0	1
LG&E	C1SR	892138	05/2014	05/23/2014	100.070	99.900	100.0	1
LG&E	C1SR	892139	05/2014	05/23/2014	100.080	99.910	100.0	1
LG&E	C1SR	892140	05/2014	05/23/2014	100.090	99.960	100.0	1
LG&E	C1SR	892141	05/2014	05/23/2014	100.060	99.890	100.1	1
LG&E	C1SR	892142	05/2014	05/23/2014	100.080	99.860	100.0	1
LG&E	C1SR	892143	05/2014	05/23/2014	100.070	99.880	100.0	1
LG&E	C1SR	892144	05/2014	05/23/2014	100.100	99.940	100.0	1
LG&E	C1SR	892145	05/2014	05/23/2014	100.070	99.880	100.1	1
LG&E	C1SR	892146	05/2014	05/23/2014	100.040	99.940	100.0	1
LG&E	C1SR	892147	05/2014	05/23/2014	100.080	99.900	100.1	1
LG&E	C1SR	892148	05/2014	05/23/2014	100.090	99.930	100.1	1
LG&E	C1SR	892149	05/2014	05/23/2014	100.030	99.890	100.0	1

LG&E	C1SR	892150	05/2014	05/23/2014	100.080	99.960	100.0	1
LG&E	C1SR	892151	05/2014	05/23/2014	100.090	99.930	100.1	1
LG&E	C1SR	892152	05/2014	05/23/2014	100.060	99.930	100.1	1
LG&E	C1SR	892153	05/2014	05/23/2014	100.070	99.910	100.0	1
LG&E	C1SR	892154	05/2014	05/23/2014	100.100	99.960	100.0	1
LG&E	C1SR	892155	05/2014	05/23/2014	100.100	99.970	100.0	1
LG&E	C1SR	892156	05/2014	05/23/2014	100.040	99.890	100.0	1
LG&E	C1SR	892157	05/2014	05/23/2014	100.090	99.890	100.1	1
LG&E	C1SR	892158	05/2014	05/23/2014	100.100	99.900	100.0	1
LG&E	C1SR	892159	05/2014	05/23/2014	100.070	99.870	100.0	1
LG&E	C1SR	892160	05/2014	05/23/2014	100.070	99.860	100.0	1
LG&E	C1SR	892161	05/2014	05/23/2014	100.070	99.910	100.0	1
LG&E	C1SR	892162	05/2014	05/23/2014	100.030	99.800	100.0	1
LG&E	C1SR	892163	05/2014	05/23/2014	100.070	99.970	100.0	1
LG&E	C1SR	892164	05/2014	05/23/2014	100.060	99.890	100.0	1
LG&E	C1SR	892165	05/2014	05/23/2014	100.040	99.860	100.0	1
LG&E	C1SR	892166	05/2014	05/23/2014	100.060	99.930	100.0	1
LG&E	C1SR	892167	05/2014	05/23/2014	100.070	99.900	100.0	1
LG&E	C1SR	892168	05/2014	05/23/2014	100.060	99.880	100.0	1
LG&E	C1SR	892169	05/2014	05/23/2014	100.040	99.900	100.0	1
LG&E	C1SR	892170	05/2014	05/23/2014	100.090	99.930	100.0	1
LG&E	C1SR	892171	05/2014	05/23/2014	100.070	99.880	100.1	1
LG&E	C1SR	892172	05/2014	05/23/2014	100.070	99.930	99.9	1
LG&E	C1SR	892173	05/2014	05/23/2014	100.070	99.950	100.0	1
LG&E	C1SR	892174	05/2014	05/23/2014	100.060	99.920	100.1	1
LG&E	C1SR	892175	05/2014	05/23/2014	100.060	99.950	99.9	1
LG&E	C1SR	892176	05/2014	05/23/2014	100.090	100.000	100.1	1
LG&E	C1SR	892177	05/2014	05/23/2014	100.070	99.930	100.0	1
LG&E	C1SR	892178	05/2014	05/23/2014	100.050	99.910	100.0	1
LG&E	C1SR	892179	05/2014	05/23/2014	100.080	99.950	100.0	1
LG&E	C1SR	892180	05/2014	05/23/2014	100.060	99.890	100.0	1
LG&E	C1SR	892181	05/2014	05/23/2014	100.100	99.950	100.0	1

LG&E	C1SR	892182	05/2014	05/23/2014	100.100	99.980	100.0	1
LG&E	C1SR	892183	05/2014	05/23/2014	100.040	99.810	100.0	1
LG&E	C1SR	892184	05/2014	05/23/2014	100.070	99.970	100.0	1
LG&E	C1SR	892185	05/2014	05/23/2014	100.090	99.920	100.0	1
LG&E	C1SR	892186	05/2014	05/23/2014	100.040	99.870	99.9	1
LG&E	C1SR	892187	05/2014	05/23/2014	100.080	99.970	100.0	1
LG&E	C1SR	892188	05/2014	05/23/2014	100.100	99.950	100.1	1
LG&E	C1SR	892189	05/2014	05/23/2014	100.080	99.910	99.9	1
LG&E	C1SR	892190	05/2014	05/23/2014	100.060	99.880	100.0	1
LG&E	C1SR	892191	05/2014	05/23/2014	100.090	99.860	100.0	1
LG&E	C1SR	892192	05/2014	05/23/2014	100.060	99.870	100.1	1
LG&E	C1SR	892193	05/2014	05/23/2014	100.080	99.940	100.0	1
LG&E	C1SR	892194	05/2014	05/23/2014	100.070	99.930	100.0	1
LG&E	C1SR	892195	05/2014	05/23/2014	100.030	99.910	99.9	1
LG&E	C1SR	892196	05/2014	05/23/2014	100.050	99.890	99.9	1
LG&E	C1SR	892197	05/2014	05/23/2014	100.070	99.930	100.0	1
LG&E	C1SR	892198	05/2014	05/23/2014	100.060	99.910	99.9	1
LG&E	C1SR	892199	05/2014	05/23/2014	100.070	99.890	100.1	1
LG&E	C1SR	892200	05/2014	05/23/2014	100.080	99.940	99.9	1
LG&E	C1SR	892201	05/2014	05/23/2014	100.070	99.980	100.1	1
LG&E	C1SR	892202	05/2014	05/23/2014	100.040	99.830	99.9	1
LG&E	C1SR	892203	05/2014	05/23/2014	100.050	99.930	99.9	1
LG&E	C1SR	892204	05/2014	05/23/2014	100.030	99.930	100.0	1
LG&E	C1SR	892205	05/2014	05/23/2014	100.070	99.950	100.0	1
LG&E	C1SR	892206	05/2014	05/23/2014	100.080	99.900	99.9	1
LG&E	C1SR	892207	05/2014	05/23/2014	100.040	99.860	99.9	1
LG&E	C1SR	892208	05/2014	05/23/2014	100.060	100.000	100.0	1
LG&E	C1SR	892209	05/2014	05/23/2014	100.040	99.930	100.0	1
LG&E	C1SR	892210	05/2014	05/23/2014	100.080	99.980	100.1	1
LG&E	C1SR	892211	05/2014	05/23/2014	100.050	99.910	100.0	1
LG&E	C1SR	892212	05/2014	05/23/2014	100.060	99.910	100.0	1
LG&E	C1SR	892213	05/2014	05/23/2014	100.090	99.950	100.1	1

LG&E	C1SR	892214	05/2014	05/23/2014	100.110	99.900	100.0	1
LG&E	C1SR	892215	05/2014	05/23/2014	100.070	99.930	100.0	1
LG&E	C1SR	892216	05/2014	05/23/2014	100.060	99.910	100.0	1
LG&E	C1SR	892217	05/2014	05/23/2014	100.110	99.980	100.0	1
LG&E	C1SR	892218	05/2014	05/23/2014	100.090	100.000	100.1	1
LG&E	C1SR	892219	05/2014	05/23/2014	100.060	99.870	100.0	1
LG&E	C1SR	892220	05/2014	05/23/2014	100.080	99.950	100.0	1
LG&E	C1SR	892221	05/2014	05/23/2014	100.070	99.930	100.0	1
LG&E	C1SR	892222	05/2014	05/23/2014	100.080	99.970	100.0	1
LG&E	C1SR	892223	05/2014	05/23/2014	100.060	99.830	100.0	1
LG&E	C1SR	892224	05/2014	05/23/2014	100.080	99.930	100.0	1
LG&E	C1SR	892225	05/2014	05/23/2014	100.060	99.890	100.0	1
LG&E	C1SR	892226	05/2014	05/23/2014	100.090	99.940	100.0	1
LG&E	C1SR	892227	05/2014	05/23/2014	100.100	99.880	100.0	1
LG&E	C1SR	892228	05/2014	05/23/2014	100.040	99.860	100.0	1
LG&E	C1SR	892229	05/2014	05/23/2014	100.070	99.940	100.0	1
LG&E	C1SR	892230	05/2014	05/23/2014	100.070	99.930	100.0	1
LG&E	C1SR	892231	05/2014	05/23/2014	100.030	99.850	100.0	1
LG&E	C1SR	892232	05/2014	05/23/2014	100.080	99.920	100.0	1
LG&E	C1SR	892233	05/2014	05/23/2014	100.060	99.830	100.0	1
LG&E	C1SR	892234	05/2014	05/23/2014	100.060	99.830	100.0	1
LG&E	C1SR	892235	05/2014	05/23/2014	100.080	99.910	99.9	1
LG&E	C1SR	892236	05/2014	05/23/2014	100.070	99.930	100.0	1
LG&E	C1SR	892237	05/2014	05/23/2014	100.050	99.900	100.0	1
LG&E	C1SR	892238	05/2014	05/23/2014	100.080	99.890	100.0	1
LG&E	C1SR	892239	05/2014	05/23/2014	100.030	99.900	100.0	1
LG&E	C1SR	892240	05/2014	05/23/2014	100.050	99.900	100.0	1
LG&E	C1SR	892241	05/2014	05/23/2014	100.060	99.890	100.1	1
LG&E	C1SR	892242	05/2014	05/23/2014	100.070	99.910	99.9	1
LG&E	C1SR	892243	05/2014	05/23/2014	100.080	99.920	100.0	1
LG&E	C1SR	892244	05/2014	05/23/2014	100.070	99.940	100.0	1
LG&E	C1SR	892245	05/2014	05/23/2014	100.050	99.850	100.0	1

LG&E	C1SR	892246	05/2014	05/23/2014	100.070	99.910	100.0	1
LG&E	C1SR	892247	05/2014	05/23/2014	100.090	99.890	100.0	1
LG&E	C1SR	892248	05/2014	05/23/2014	100.030	99.880	100.0	1
LG&E	C1SR	892249	05/2014	05/23/2014	100.060	99.900	99.9	1
LG&E	C1SR	892250	05/2014	05/23/2014	100.080	99.910	99.9	1
LG&E	C1SR	892251	05/2014	05/23/2014	100.050	99.930	100.0	1
LG&E	C1SR	892252	05/2014	05/23/2014	100.060	99.870	100.0	1
LG&E	C1SR	892253	05/2014	05/23/2014	100.060	99.900	100.0	1
LG&E	C1SR	892254	05/2014	05/23/2014	100.100	99.920	100.1	1
LG&E	C1SR	892255	05/2014	05/23/2014	100.060	99.940	100.0	1
LG&E	C1SR	892256	05/2014	05/23/2014	100.090	99.900	100.0	1
LG&E	C1SR	892257	05/2014	05/23/2014	100.080	99.960	100.0	1
LG&E	C1SR	892258	05/2014	05/23/2014	100.080	100.000	100.0	1
LG&E	C1SR	892259	05/2014	05/23/2014	100.030	99.860	100.0	1
LG&E	C1SR	892260	05/2014	05/23/2014	100.100	100.010	100.1	1
LG&E	C1SR	892261	05/2014	05/23/2014	100.060	99.970	100.0	1
LG&E	C1SR	892262	05/2014	05/23/2014	100.080	99.930	100.1	1
LG&E	C1SR	892263	05/2014	05/23/2014	100.070	99.850	100.0	1
LG&E	C1SR	892264	05/2014	05/23/2014	100.050	99.880	100.0	1
LG&E	C1SR	892265	05/2014	05/23/2014	100.030	99.830	99.9	1
LG&E	C1SR	892266	05/2014	05/23/2014	100.070	99.900	99.9	1
LG&E	C1SR	892267	05/2014	05/23/2014	100.060	99.870	100.0	1
LG&E	C1SR	892268	05/2014	05/23/2014	100.110	99.940	100.1	1
LG&E	C1SR	892269	05/2014	05/23/2014	100.060	99.900	99.9	1
LG&E	C1SR	892270	05/2014	05/23/2014	100.070	99.910	99.9	1
LG&E	C1SR	892271	05/2014	05/23/2014	100.060	99.900	100.0	1
LG&E	C1SR	892272	05/2014	05/23/2014	100.080	99.890	100.1	1
LG&E	C1SR	892273	05/2014	05/23/2014	100.090	99.950	99.9	1
LG&E	C1SR	892274	05/2014	05/23/2014	100.040	99.920	100.0	1
LG&E	C1SR	892275	05/2014	05/23/2014	100.100	100.010	100.1	1
LG&E	C1SR	892276	05/2014	05/23/2014	100.100	99.940	100.1	1
LG&E	C1SR	892277	05/2014	05/23/2014	100.100	99.920	100.0	1

LG&E	C1SR	892278	05/2014	05/23/2014	100.060	99.930	100.0	1
LG&E	C1SR	892279	05/2014	05/23/2014	100.090	99.940	100.1	1
LG&E	C1SR	892280	05/2014	05/23/2014	100.080	99.900	100.0	1
LG&E	C1SR	892281	05/2014	05/23/2014	100.070	99.860	100.1	1
LG&E	C1SR	892282	05/2014	05/23/2014	100.050	99.920	100.0	1
LG&E	C1SR	892283	05/2014	05/23/2014	100.050	99.910	100.0	1
LG&E	C1SR	892284	05/2014	05/23/2014	100.070	99.920	100.0	1
LG&E	C1SR	892285	05/2014	05/23/2014	100.060	99.860	100.1	1
LG&E	C1SR	892286	05/2014	05/23/2014	100.070	99.880	100.0	1
LG&E	C1SR	892287	05/2014	05/23/2014	100.090	99.980	100.1	1
LG&E	C1SR	892288	05/2014	05/23/2014	100.060	99.860	99.9	1
LG&E	C1SR	892289	05/2014	05/23/2014	100.060	99.910	100.1	1
LG&E	C1SR	892290	05/2014	05/23/2014	100.070	99.890	100.0	1
LG&E	C1SR	892291	05/2014	05/23/2014	100.060	99.960	100.0	1
LG&E	C1SR	892292	05/2014	05/23/2014	100.050	99.910	100.0	1
LG&E	C1SR	892293	05/2014	05/23/2014	100.080	99.960	100.1	1
LG&E	C1SR	892294	05/2014	05/23/2014	100.090	99.910	100.1	1
LG&E	C1SR	892295	05/2014	05/23/2014	100.040	99.940	99.9	1
LG&E	C1SR	892296	05/2014	05/23/2014	100.070	99.970	100.0	1
LG&E	C1SR	892297	05/2014	05/23/2014	100.030	99.840	99.9	1
LG&E	C1SR	892298	05/2014	05/23/2014	100.060	99.870	100.0	1
LG&E	C1SR	892299	05/2014	05/23/2014	100.100	99.890	100.0	1
LG&E	C1SR	892300	05/2014	05/23/2014	100.060	99.900	100.1	1
LG&E	C1SR	892301	05/2014	05/23/2014	100.070	99.860	100.1	1
LG&E	C1SR	892302	05/2014	05/23/2014	100.070	99.890	100.1	1
LG&E	C1SR	892303	05/2014	05/23/2014	100.100	99.900	100.1	1
LG&E	C1SR	892304	05/2014	05/23/2014	100.060	99.860	100.0	1
LG&E	C1SR	892305	05/2014	05/23/2014	100.070	99.930	100.1	1
LG&E	C1SR	892306	05/2014	05/23/2014	100.070	99.940	100.1	1
LG&E	C1SR	892307	05/2014	05/23/2014	100.070	99.890	99.9	1
LG&E	C1SR	892308	05/2014	05/23/2014	100.070	99.950	100.0	1
LG&E	C1SR	892309	05/2014	05/23/2014	100.090	99.920	100.0	1

LG&E	C1SR	892310	05/2014	05/23/2014	100.090	99.900	100.0	1
LG&E	C1SR	892311	05/2014	05/23/2014	100.060	99.900	100.0	1
LG&E	C1SR	892312	05/2014	05/23/2014	100.050	99.930	100.0	1
LG&E	C1SR	892313	05/2014	05/23/2014	100.030	99.830	99.9	1
LG&E	C1SR	892314	05/2014	05/23/2014	100.030	99.870	99.9	1
LG&E	C1SR	892315	05/2014	05/23/2014	100.070	99.870	100.0	1
LG&E	C1SR	892316	05/2014	05/23/2014	100.060	99.910	100.0	1
LG&E	C1SR	892317	05/2014	05/23/2014	100.100	99.990	100.1	1
LG&E	C1SR	892318	05/2014	05/23/2014	100.070	99.930	100.0	1
LG&E	C1SR	892319	05/2014	05/23/2014	100.060	99.940	99.9	1
LG&E	C1SR	892320	05/2014	05/23/2014	100.040	99.900	100.0	1
LG&E	C1SR	892321	05/2014	05/23/2014	100.070	99.910	100.0	1
LG&E	C1SR	892322	05/2014	05/23/2014	100.060	99.880	99.9	1
LG&E	C1SR	892323	05/2014	05/23/2014	100.100	99.970	100.0	1
LG&E	C1SR	892324	05/2014	05/23/2014	100.080	99.960	100.1	1
LG&E	C1SR	892325	05/2014	05/23/2014	100.090	99.930	100.1	1
LG&E	C1SR	892326	05/2014	05/23/2014	100.030	99.920	100.0	1
LG&E	C1SR	892327	05/2014	05/23/2014	100.050	99.880	100.0	1
LG&E	C1SR	892328	05/2014	05/23/2014	100.070	99.890	100.0	1
LG&E	C1SR	892329	05/2014	05/23/2014	100.070	99.950	100.0	1
LG&E	C1SR	892330	05/2014	05/23/2014	100.070	99.950	100.0	1
LG&E	C1SR	892331	05/2014	05/23/2014	100.070	99.940	100.0	1
LG&E	C1SR	892332	05/2014	05/23/2014	100.030	99.890	100.0	1
LG&E	C1SR	892333	05/2014	05/23/2014	100.060	99.890	100.0	1
LG&E	C1SR	892334	05/2014	05/23/2014	100.050	99.900	100.0	1
LG&E	C1SR	892335	05/2014	05/23/2014	100.060	99.870	100.0	1
LG&E	C1SR	892336	05/2014	05/23/2014	100.040	99.950	100.0	1
LG&E	C1SR	892337	05/2014	05/23/2014	100.100	99.870	100.0	1
LG&E	C1SR	892338	05/2014	05/23/2014	100.060	99.840	99.9	1
LG&E	C1SR	892339	05/2014	05/23/2014	100.050	99.920	100.0	1
LG&E	C1SR	892340	05/2014	05/23/2014	100.090	99.860	100.0	1
LG&E	C1SR	892341	05/2014	05/23/2014	100.100	99.910	100.0	1

LG&E	C1SR	892342	05/2014	05/23/2014	100.070	99.900	100.0	1
LG&E	C1SR	892343	05/2014	05/23/2014	100.070	99.940	99.9	1
LG&E	C1SR	892344	05/2014	05/23/2014	100.100	99.970	100.0	1
LG&E	C1SR	892345	05/2014	05/23/2014	100.070	99.910	100.0	1
LG&E	C1SR	892346	05/2014	05/23/2014	100.070	99.880	100.0	1
LG&E	C1SR	892347	05/2014	05/23/2014	100.060	99.920	100.0	1
LG&E	C1SR	892348	05/2014	05/23/2014	100.100	99.960	100.1	1
LG&E	C1SR	892349	05/2014	05/23/2014	100.070	99.910	99.9	1
LG&E	C1SR	892350	05/2014	05/23/2014	100.070	99.960	100.1	1
LG&E	C1SR	892351	05/2014	05/23/2014	100.060	99.900	100.0	1
LG&E	C1SR	892352	05/2014	05/23/2014	100.090	99.890	100.0	1
LG&E	C1SR	892353	05/2014	05/23/2014	100.080	99.880	100.1	1
LG&E	C1SR	892354	05/2014	05/23/2014	100.080	99.890	100.0	1
LG&E	C1SR	892355	05/2014	05/23/2014	100.030	99.980	100.0	1
LG&E	C1SR	892356	05/2014	05/23/2014	100.080	99.920	100.0	1
LG&E	C1SR	892357	05/2014	05/23/2014	100.060	99.940	100.0	1
LG&E	C1SR	892358	05/2014	05/23/2014	100.050	99.850	100.0	1
LG&E	C1SR	892359	05/2014	05/23/2014	100.050	99.930	100.0	1
LG&E	C1SR	892360	05/2014	05/23/2014	100.080	99.950	100.0	1
LG&E	C1SR	892361	05/2014	05/23/2014	100.110	100.000	100.1	1
LG&E	C1SR	892362	05/2014	05/23/2014	100.100	99.920	100.1	1
LG&E	C1SR	892363	05/2014	05/23/2014	100.030	99.840	100.0	1
LG&E	C1SR	892364	05/2014	05/23/2014	100.060	99.910	100.0	1
LG&E	C1SR	892365	05/2014	05/23/2014	100.070	99.940	100.0	1
LG&E	C1SR	892366	05/2014	05/23/2014	100.040	99.880	100.0	1
LG&E	C1SR	892367	05/2014	05/23/2014	100.090	99.970	100.1	1
LG&E	C1SR	892368	05/2014	05/23/2014	100.060	99.920	100.0	1
LG&E	C1SR	892369	05/2014	05/23/2014	100.040	99.930	100.0	1
LG&E	C1SR	892370	05/2014	05/23/2014	100.080	99.890	100.0	1
LG&E	C1SR	892371	05/2014	05/23/2014	100.040	99.820	99.9	1
LG&E	C1SR	892372	05/2014	05/23/2014	100.080	99.870	100.0	1
LG&E	C1SR	892373	05/2014	05/23/2014	100.060	99.890	99.9	1

LG&E	C1SR	892374	05/2014	05/23/2014	100.060	99.890	100.0	1
LG&E	C1SR	892375	05/2014	05/23/2014	100.110	99.900	100.1	1
LG&E	C1SR	892376	05/2014	05/23/2014	100.100	99.930	100.0	1
LG&E	C1SR	892377	05/2014	05/23/2014	100.060	99.890	100.0	1
LG&E	C1SR	892378	05/2014	05/23/2014	100.110	99.920	100.0	1
LG&E	C1SR	892379	05/2014	05/23/2014	100.060	99.940	100.0	1
LG&E	C1SR	892380	05/2014	05/23/2014	100.060	99.940	100.0	1
LG&E	C1SR	892381	05/2014	05/23/2014	100.030	99.800	100.0	1
LG&E	C1SR	892382	05/2014	05/23/2014	100.100	99.930	100.0	1
LG&E	C1SR	892383	05/2014	05/23/2014	100.060	99.860	99.9	1
LG&E	C1SR	892384	05/2014	05/23/2014	100.030	99.810	99.9	1
LG&E	C1SR	892385	05/2014	05/23/2014	100.030	99.800	99.9	1
LG&E	C1SR	892386	05/2014	05/23/2014	100.060	99.860	100.0	1
LG&E	C1SR	892387	05/2014	05/23/2014	100.080	99.930	100.0	1
LG&E	C1SR	892388	05/2014	05/23/2014	100.030	99.880	100.0	1
LG&E	C1SR	892389	05/2014	05/23/2014	100.040	99.870	99.9	1
LG&E	C1SR	892390	05/2014	05/23/2014	100.060	99.880	99.9	1
LG&E	C1SR	892391	05/2014	05/23/2014	100.090	99.940	100.0	1
LG&E	C1SR	892392	05/2014	05/23/2014	100.040	99.860	100.0	1
LG&E	C1SR	892393	05/2014	05/23/2014	100.050	99.840	99.9	1
LG&E	C1SR	892394	05/2014	05/23/2014	100.100	99.900	100.0	1
LG&E	C1SR	892395	05/2014	05/23/2014	100.070	99.890	100.0	1
LG&E	C1SR	892396	05/2014	05/23/2014	100.070	99.900	100.0	1
LG&E	C1SR	892397	05/2014	05/23/2014	100.060	99.860	100.0	1
LG&E	C1SR	892398	05/2014	05/23/2014	100.090	99.910	100.0	1
LG&E	C1SR	892399	05/2014	05/23/2014	100.040	99.880	100.1	1
LG&E	C1SR	892400	05/2014	05/23/2014	100.100	99.910	100.0	1
LG&E	C1SR	892401	05/2014	05/23/2014	100.060	99.890	100.0	1
LG&E	C1SR	892402	05/2014	05/23/2014	100.050	99.930	100.0	1
LG&E	C1SR	892403	05/2014	05/23/2014	100.060	99.890	100.0	1
LG&E	C1SR	892404	05/2014	05/23/2014	100.060	99.900	99.9	1
LG&E	C1SR	892405	05/2014	05/23/2014	100.090	99.900	100.1	1

LG&E	C1SR	892406	05/2014	05/23/2014	100.060	99.890	100.1	1
LG&E	C1SR	892407	05/2014	05/23/2014	100.050	99.850	99.9	1
LG&E	C1SR	892408	05/2014	05/23/2014	100.050	99.860	100.0	1
LG&E	C1SR	892409	05/2014	05/23/2014	100.100	99.930	100.0	1
LG&E	C1SR	892410	05/2014	05/23/2014	100.070	99.940	99.9	1
LG&E	C1SR	892411	05/2014	05/23/2014	100.040	99.880	99.9	1
LG&E	C1SR	892412	05/2014	05/23/2014	100.070	99.870	100.0	1
LG&E	C1SR	892413	05/2014	05/23/2014	100.070	99.860	100.0	1
LG&E	C1SR	892414	05/2014	05/23/2014	100.080	99.910	100.0	1
LG&E	C1SR	892415	05/2014	05/23/2014	100.110	99.980	99.9	1
LG&E	C1SR	892416	05/2014	05/23/2014	100.100	99.980	100.1	1
LG&E	C1SR	892417	05/2014	05/23/2014	100.100	99.860	100.1	1
LG&E	C1SR	892418	05/2014	05/23/2014	100.070	99.970	100.1	1
LG&E	C1SR	892419	05/2014	05/23/2014	100.060	99.930	100.1	1
LG&E	C1SR	892420	05/2014	05/23/2014	100.060	99.910	100.0	1
LG&E	C1SR	892421	05/2014	05/23/2014	100.060	99.930	100.0	1
LG&E	C1SR	892422	05/2014	05/23/2014	100.090	99.950	100.0	1
LG&E	C1SR	892423	05/2014	05/23/2014	100.050	99.890	99.9	1
LG&E	C1SR	892424	05/2014	05/23/2014	100.070	99.930	100.0	1
LG&E	C1SR	892425	05/2014	05/23/2014	100.070	99.890	100.0	1
LG&E	C1SR	892426	05/2014	05/23/2014	100.080	99.900	100.1	1
LG&E	C1SR	892427	05/2014	05/23/2014	100.060	99.880	99.9	1
LG&E	C1SR	892428	05/2014	05/23/2014	100.100	99.990	100.0	1
LG&E	C1SR	892429	05/2014	05/23/2014	100.070	99.940	100.0	1
LG&E	C1SR	892430	05/2014	05/23/2014	100.030	99.860	100.0	1
LG&E	C1SR	892431	05/2014	05/23/2014	100.060	99.880	100.0	1
LG&E	C1SR	892432	05/2014	05/23/2014	100.070	99.980	100.0	1
LG&E	C1SR	892433	05/2014	05/23/2014	100.100	99.990	100.0	1
LG&E	C1SR	892434	05/2014	05/23/2014	100.070	99.920	100.0	1
LG&E	C1SR	892435	05/2014	05/23/2014	100.030	99.860	99.9	1
LG&E	C1SR	892436	05/2014	05/23/2014	100.070	99.910	100.0	1
LG&E	C1SR	892437	05/2014	05/23/2014	100.090	99.840	100.0	1

LG&E	C1SR	892438	05/2014	05/23/2014	100.030	99.870	99.9	1
LG&E	C1SR	892439	05/2014	05/23/2014	100.100	99.990	100.1	1
LG&E	C1SR	892440	05/2014	05/23/2014	100.040	99.930	100.0	1
LG&E	C1SR	892441	05/2014	05/23/2014	100.040	99.860	99.9	1
LG&E	C1SR	892442	05/2014	05/23/2014	100.060	99.960	100.0	1
LG&E	C1SR	892443	05/2014	05/23/2014	100.060	99.930	100.0	1
LG&E	C1SR	892444	05/2014	05/23/2014	100.070	99.910	100.0	1
LG&E	C1SR	892445	05/2014	05/23/2014	100.040	99.920	99.9	1
LG&E	C1SR	892446	05/2014	05/23/2014	100.060	99.910	100.0	1
LG&E	C1SR	892447	05/2014	05/23/2014	100.090	99.890	100.0	1
LG&E	C1SR	892448	05/2014	05/23/2014	100.030	99.890	100.0	1
LG&E	C1SR	892449	05/2014	05/23/2014	100.100	99.920	100.0	1
LG&E	C1SR	892450	05/2014	05/23/2014	100.080	99.930	100.0	1
LG&E	C1SR	892451	05/2014	05/23/2014	100.110	99.930	100.1	1
LG&E	C1SR	892452	05/2014	05/23/2014	100.090	99.920	100.1	1
LG&E	C1SR	892453	05/2014	05/23/2014	100.060	99.900	100.0	1
LG&E	C1SR	892454	05/2014	05/23/2014	100.060	99.870	100.0	1
LG&E	C1SR	892455	05/2014	05/23/2014	100.060	99.960	100.0	1
LG&E	C1SR	892456	05/2014	05/23/2014	100.060	99.850	100.0	1
LG&E	C1SR	892457	05/2014	05/23/2014	100.060	99.840	99.9	1
LG&E	C1SR	892458	05/2014	05/23/2014	100.050	99.850	100.0	1
LG&E	C1SR	892459	05/2014	05/23/2014	100.070	99.900	100.0	1
LG&E	C1SR	892460	05/2014	05/23/2014	100.060	99.950	100.0	1
LG&E	C1SR	892461	05/2014	05/23/2014	100.050	99.850	100.0	1
LG&E	C1SR	892462	05/2014	05/23/2014	100.060	99.900	99.9	1
LG&E	C1SR	892463	05/2014	05/23/2014	100.050	99.850	100.0	1
LG&E	C1SR	892464	05/2014	05/23/2014	100.060	99.860	100.0	1
LG&E	C1SR	892465	05/2014	05/23/2014	100.050	99.880	100.0	1
LG&E	C1SR	892466	05/2014	05/23/2014	100.080	99.870	99.9	1
LG&E	C1SR	892467	05/2014	05/23/2014	100.030	99.860	99.9	1
LG&E	C1SR	892468	05/2014	05/23/2014	100.050	99.900	99.8	1
LG&E	C1SR	892469	05/2014	05/23/2014	100.100	99.930	99.9	1

LG&E	C1SR	892470	05/2014	05/23/2014	100.070	99.850	99.9	1
LG&E	C1SR	892471	05/2014	05/23/2014	100.070	99.890	100.0	1
LG&E	C1SR	892472	05/2014	05/23/2014	100.100	99.990	100.0	1
LG&E	C1SR	892473	05/2014	05/23/2014	100.100	99.950	100.0	1
LG&E	C1SR	892474	05/2014	05/23/2014	100.050	99.860	100.0	1
LG&E	C1SR	892475	05/2014	05/23/2014	100.090	99.920	100.0	1
LG&E	C1SR	892476	05/2014	05/23/2014	100.070	99.840	100.0	1
LG&E	C1SR	892477	05/2014	05/23/2014	100.090	99.890	100.0	1
LG&E	C1SR	892478	05/2014	05/23/2014	100.090	99.960	100.0	1
LG&E	C1SR	892479	05/2014	05/23/2014	100.030	99.860	100.0	1
LG&E	C1SR	892480	05/2014	05/23/2014	100.060	99.920	99.9	1
LG&E	C1SR	892481	05/2014	05/23/2014	100.040	99.900	100.0	1
LG&E	C1SR	892482	05/2014	05/23/2014	100.040	99.910	99.9	1
LG&E	C1SR	892483	05/2014	05/23/2014	100.100	100.020	100.0	1
LG&E	C1SR	892484	05/2014	05/23/2014	100.050	99.860	100.0	1
LG&E	C1SR	892485	05/2014	05/23/2014	100.060	99.900	100.0	1
LG&E	C1SR	892486	05/2014	05/23/2014	100.060	99.900	99.9	1
LG&E	C1SR	892487	05/2014	05/23/2014	100.100	99.890	100.0	1
LG&E	C1SR	892488	05/2014	05/23/2014	100.030	99.810	99.9	1
LG&E	C1SR	892489	05/2014	05/23/2014	100.060	99.960	100.0	1
LG&E	C1SR	892490	05/2014	05/23/2014	100.070	99.920	100.1	1
LG&E	C1SR	892491	05/2014	05/23/2014	100.100	99.940	100.0	1
LG&E	C1SR	892492	05/2014	05/23/2014	100.070	99.900	100.0	1
LG&E	C1SR	892493	05/2014	05/23/2014	100.090	100.000	100.1	1
LG&E	C1SR	892494	05/2014	05/23/2014	100.030	99.880	99.9	1
LG&E	C1SR	892495	05/2014	05/23/2014	100.070	99.930	100.1	1
LG&E	C1SR	892496	05/2014	05/23/2014	100.090	99.930	100.0	1
LG&E	C1SR	892497	05/2014	05/23/2014	100.060	99.900	100.0	1
LG&E	C1SR	892498	05/2014	05/23/2014	100.070	99.930	100.0	1
LG&E	C1SR	892499	05/2014	05/23/2014	100.070	99.950	99.9	1
LG&E	C1SR	892500	05/2014	05/23/2014	100.080	99.900	100.0	1
LG&E	C1SR	892501	05/2014	05/23/2014	100.090	99.980	100.0	1

LG&E	C1SR	892502	05/2014	05/23/2014	100.040	99.910	100.0	1
LG&E	C1SR	892503	05/2014	05/23/2014	100.100	99.950	100.1	1
LG&E	C1SR	892504	05/2014	05/23/2014	100.070	99.860	100.1	1
LG&E	C1SR	892505	05/2014	05/23/2014	100.050	99.840	99.9	1
LG&E	C1SR	892506	05/2014	05/23/2014	100.050	99.920	100.0	1
LG&E	C1SR	892507	05/2014	05/23/2014	100.060	99.880	100.0	1
LG&E	C1SR	892508	05/2014	05/23/2014	100.090	99.950	100.1	1
LG&E	C1SR	892509	05/2014	05/23/2014	100.050	99.810	100.0	1
LG&E	C1SR	892510	05/2014	05/23/2014	100.060	99.900	100.0	1
LG&E	C1SR	892511	05/2014	05/23/2014	100.080	99.900	100.0	1
LG&E	C1SR	892512	05/2014	05/23/2014	100.050	99.930	99.9	1
LG&E	C1SR	892513	05/2014	05/23/2014	100.060	99.920	99.9	1
LG&E	C1SR	892514	05/2014	05/23/2014	100.030	99.840	99.9	1
LG&E	C1SR	892515	05/2014	05/23/2014	100.060	99.880	100.0	1
LG&E	C1SR	892516	05/2014	05/23/2014	100.070	99.860	100.0	1
LG&E	C1SR	892517	05/2014	05/23/2014	100.080	99.860	100.0	1
LG&E	C1SR	892518	05/2014	05/23/2014	100.090	99.930	100.1	1
LG&E	C1SR	892519	05/2014	05/23/2014	100.070	99.960	100.1	1
LG&E	C1SR	892520	05/2014	05/23/2014	100.090	99.910	100.0	1
LG&E	C1SR	892521	05/2014	05/23/2014	100.100	99.980	100.0	1
LG&E	C1SR	892522	05/2014	05/23/2014	100.100	99.930	100.1	1
LG&E	C1SR	892523	05/2014	05/23/2014	100.060	99.880	100.0	1
LG&E	C1SR	892524	05/2014	05/23/2014	100.060	99.930	100.0	1
LG&E	C1SR	892525	05/2014	05/23/2014	100.060	99.860	99.9	1
LG&E	C1SR	892526	05/2014	05/23/2014	100.100	99.970	100.0	1
LG&E	C1SR	892527	05/2014	05/23/2014	100.060	99.890	100.0	1
LG&E	C1SR	892528	05/2014	05/23/2014	100.040	99.840	100.0	1
LG&E	C1SR	892529	05/2014	05/23/2014	100.070	99.840	100.0	1
LG&E	C1SR	892530	05/2014	05/23/2014	100.080	99.880	100.0	1
LG&E	C1SR	892531	05/2014	05/23/2014	100.070	99.900	100.0	1
LG&E	C1SR	892532	05/2014	05/23/2014	100.040	99.890	99.9	1
LG&E	C1SR	892533	05/2014	05/23/2014	100.070	99.870	100.0	1

LG&E	C1SR	892534	05/2014	05/23/2014	100.030	99.840	99.9	1
LG&E	C1SR	892535	05/2014	05/23/2014	100.060	99.930	100.0	1
LG&E	C1SR	892536	05/2014	05/23/2014	100.090	99.990	100.0	1
LG&E	C1SR	892537	05/2014	05/23/2014	100.100	99.910	100.0	1
LG&E	C1SR	892538	05/2014	05/23/2014	100.080	99.950	100.0	1
LG&E	C1SR	892539	05/2014	05/23/2014	100.080	99.930	100.0	1
LG&E	C1SR	892540	05/2014	05/23/2014	100.080	99.940	99.9	1
LG&E	C1SR	892541	05/2014	05/23/2014	100.050	99.850	99.9	1
LG&E	C1SR	892542	05/2014	05/23/2014	100.050	99.870	99.9	1
LG&E	C1SR	892543	05/2014	05/23/2014	100.070	99.920	100.0	1
LG&E	C1SR	892544	05/2014	05/23/2014	100.030	99.890	100.0	1
LG&E	C1SR	892545	05/2014	05/23/2014	100.060	99.870	99.9	1
LG&E	C1SR	892546	05/2014	05/23/2014	100.040	99.920	100.0	1
LG&E	C1SR	892547	05/2014	05/23/2014	100.100	99.930	100.0	1
LG&E	C1SR	892548	05/2014	05/23/2014	100.050	99.930	100.0	1
LG&E	C1SR	892549	05/2014	05/23/2014	100.030	99.840	99.9	1
LG&E	C1SR	892550	05/2014	05/23/2014	100.100	99.940	100.0	1
LG&E	C1SR	892551	05/2014	05/23/2014	100.090	99.890	100.0	1
LG&E	C1SR	892552	05/2014	05/23/2014	100.040	99.910	100.0	1
LG&E	C1SR	892553	05/2014	05/23/2014	100.080	99.920	99.9	1
LG&E	C1SR	892554	05/2014	05/23/2014	100.050	99.880	100.0	1
LG&E	C1SR	892555	05/2014	05/23/2014	100.050	99.950	99.9	1
LG&E	C1SR	892556	05/2014	05/23/2014	100.070	99.860	100.0	1
LG&E	C1SR	892557	05/2014	05/23/2014	100.050	99.840	100.0	1
LG&E	C1SR	892558	05/2014	05/23/2014	100.060	99.870	100.0	1
LG&E	C1SR	892559	05/2014	05/23/2014	100.070	99.920	100.0	1
LG&E	C1SR	892560	05/2014	05/23/2014	100.060	99.920	100.0	1
LG&E	C1SR	892561	05/2014	05/23/2014	100.100	99.900	100.1	1
LG&E	C1SR	892562	05/2014	05/23/2014	100.030	99.840	100.0	1
LG&E	C1SR	892563	05/2014	05/23/2014	100.060	99.950	100.0	1
LG&E	C1SR	892564	05/2014	05/23/2014	100.050	99.830	99.9	1
LG&E	C1SR	892565	05/2014	05/23/2014	100.030	99.890	99.9	1

LG&E	C1SR	892566	05/2014	05/23/2014	100.060	99.960	100.0	1
LG&E	C1SR	892567	05/2014	05/23/2014	100.050	99.870	100.0	1
LG&E	C1SR	892568	05/2014	05/23/2014	100.080	99.910	100.0	1
LG&E	C1SR	892569	05/2014	05/23/2014	100.060	99.940	100.0	1
LG&E	C1SR	892570	05/2014	05/23/2014	100.040	99.820	99.9	1
LG&E	C1SR	892571	05/2014	05/23/2014	100.070	99.960	99.9	1
LG&E	C1SR	892572	05/2014	05/23/2014	100.060	99.850	100.0	1
LG&E	C1SR	892573	05/2014	05/23/2014	100.050	99.850	100.0	1
LG&E	C1SR	892574	05/2014	05/23/2014	100.060	99.880	100.0	1
LG&E	C1SR	892575	05/2014	05/23/2014	100.100	99.940	100.1	1
LG&E	C1SR	892576	05/2014	05/23/2014	100.030	99.860	100.0	1
LG&E	C1SR	892577	05/2014	05/23/2014	100.050	99.930	100.0	1
LG&E	C1SR	892578	05/2014	05/23/2014	100.060	99.840	100.0	1
LG&E	C1SR	892579	05/2014	05/23/2014	100.050	99.860	99.9	1
LG&E	C1SR	892580	05/2014	05/23/2014	100.050	99.960	100.0	1
LG&E	C1SR	892581	05/2014	05/23/2014	100.060	99.870	99.9	1
LG&E	C1SR	892582	05/2014	05/23/2014	100.030	99.920	100.0	1
LG&E	C1SR	892583	05/2014	05/23/2014	100.040	99.850	100.0	1
LG&E	C1SR	892584	05/2014	05/23/2014	100.050	99.870	100.0	1
LG&E	C1SR	892585	05/2014	05/23/2014	100.050	99.970	100.0	1
LG&E	C1SR	892586	05/2014	05/23/2014	100.070	99.930	100.1	1
LG&E	C1SR	892587	05/2014	05/23/2014	100.040	99.900	100.0	1
LG&E	C1SR	892588	05/2014	05/23/2014	100.080	99.860	100.0	1
LG&E	C1SR	892589	05/2014	05/23/2014	100.070	99.910	100.0	1
LG&E	C1SR	892590	05/2014	05/23/2014	100.050	99.860	99.9	1
LG&E	C1SR	892591	05/2014	05/23/2014	100.040	99.900	100.0	1
LG&E	C1SR	892592	05/2014	05/23/2014	100.090	99.900	100.0	1
LG&E	C1SR	892593	05/2014	05/23/2014	100.080	99.900	100.0	1
LG&E	C1SR	892594	05/2014	05/23/2014	100.040	99.800	100.0	1
LG&E	C1SR	892595	05/2014	05/23/2014	100.100	99.910	100.1	1
LG&E	C1SR	892596	05/2014	05/23/2014	100.070	99.910	100.0	1
LG&E	C1SR	892597	05/2014	05/23/2014	100.070	99.830	99.9	1

LG&E	C1SR	892598	05/2014	05/23/2014	100.100	99.900	100.0	1
LG&E	C1SR	892599	05/2014	05/23/2014	100.060	99.860	99.9	1
LG&E	C1SR	892600	05/2014	05/23/2014	100.060	99.890	99.9	1
LG&E	C1SR	892601	05/2014	05/23/2014	100.080	99.970	99.9	1
LG&E	C1SR	892602	05/2014	05/23/2014	100.080	99.860	100.0	1
LG&E	C1SR	892603	05/2014	05/23/2014	100.060	99.960	100.0	1
LG&E	C1SR	892604	05/2014	05/23/2014	100.080	99.900	100.1	1
LG&E	C1SR	892605	05/2014	05/23/2014	100.080	99.860	100.1	1
LG&E	C1SR	892606	05/2014	05/23/2014	100.080	99.880	100.0	1
LG&E	C1SR	892607	05/2014	05/23/2014	100.060	99.970	99.9	1
LG&E	C1SR	892608	05/2014	05/23/2014	100.090	99.970	100.1	1
LG&E	C1SR	892609	05/2014	05/23/2014	100.070	99.860	100.0	1
LG&E	C1SR	892610	05/2014	05/23/2014	100.050	99.910	100.0	1
LG&E	C1SR	892611	05/2014	05/23/2014	100.060	99.950	100.0	1
LG&E	C1SR	892612	05/2014	05/23/2014	100.070	99.870	100.0	1
LG&E	C1SR	892613	05/2014	05/23/2014	100.080	99.840	100.0	1
LG&E	C1SR	892614	05/2014	05/23/2014	100.070	99.900	100.0	1
LG&E	C1SR	892615	05/2014	05/23/2014	100.080	99.960	99.9	1
LG&E	C1SR	892616	05/2014	05/23/2014	100.070	99.880	100.0	1
LG&E	C1SR	892617	05/2014	05/23/2014	100.090	99.950	100.0	1
LG&E	C1SR	892618	05/2014	05/23/2014	100.070	99.910	100.0	1
LG&E	C1SR	892619	05/2014	05/23/2014	100.050	99.800	99.9	1
LG&E	C1SR	892620	05/2014	05/23/2014	100.060	99.850	99.9	1
LG&E	C1SR	892621	05/2014	05/23/2014	100.080	99.990	100.0	1
LG&E	C1SR	892622	05/2014	05/23/2014	100.100	99.960	100.0	1
LG&E	C1SR	892623	05/2014	05/23/2014	100.040	99.820	99.9	1
LG&E	C1SR	892624	05/2014	05/23/2014	100.090	99.900	100.0	1
LG&E	C1SR	892625	05/2014	05/23/2014	100.080	99.850	100.0	1
LG&E	C1SR	892626	05/2014	05/23/2014	100.070	99.910	100.0	1
LG&E	C1SR	892627	05/2014	05/23/2014	100.070	99.900	99.9	1
LG&E	C1SR	892628	05/2014	05/23/2014	100.040	99.910	99.9	1
LG&E	C1SR	892629	05/2014	05/23/2014	100.060	99.900	100.0	1

LG&E	C1SR	892630	05/2014	05/23/2014	100.070	99.930	100.0	1
LG&E	C1SR	892631	05/2014	05/23/2014	100.060	99.950	100.0	1
LG&E	C1SR	892632	05/2014	05/23/2014	100.060	99.920	100.0	1
LG&E	C1SR	892633	05/2014	05/23/2014	100.100	99.910	100.1	1
LG&E	C1SR	892634	05/2014	05/23/2014	100.100	99.950	100.0	1
LG&E	C1SR	892635	05/2014	05/23/2014	100.060	99.870	99.9	1
LG&E	C1SR	892636	05/2014	05/23/2014	100.070	99.930	100.1	1
LG&E	C1SR	892637	05/2014	05/23/2014	100.040	99.860	99.9	1
LG&E	C1SR	892638	05/2014	05/23/2014	100.080	99.910	100.0	1
LG&E	C1SR	892639	05/2014	05/23/2014	100.040	99.800	99.9	1
LG&E	C1SR	892640	05/2014	05/23/2014	100.070	99.900	100.0	1
LG&E	C1SR	892641	05/2014	05/23/2014	100.060	99.850	100.0	1
LG&E	C1SR	892642	05/2014	05/23/2014	100.100	99.970	100.0	1
LG&E	C1SR	892643	05/2014	05/23/2014	100.090	99.950	100.0	1
LG&E	C1SR	892644	05/2014	05/23/2014	100.050	99.910	100.0	1
LG&E	C1SR	892645	05/2014	05/23/2014	100.090	99.960	100.0	1
LG&E	C1SR	892646	05/2014	05/23/2014	100.060	99.910	100.0	1
LG&E	C1SR	892647	05/2014	05/23/2014	100.070	99.920	100.0	1
LG&E	C1SR	892648	05/2014	05/23/2014	100.090	99.950	100.0	1
LG&E	C1SR	892649	05/2014	05/23/2014	100.090	99.900	100.1	1
LG&E	C1SR	892650	05/2014	05/23/2014	100.030	99.880	99.9	1
LG&E	C1SR	892651	05/2014	05/23/2014	100.060	99.930	99.9	1
LG&E	C1SR	892652	05/2014	05/23/2014	100.070	99.990	99.9	1
LG&E	C1SR	892653	05/2014	05/23/2014	100.040	99.830	99.9	1
LG&E	C1SR	892654	05/2014	05/23/2014	100.060	99.960	100.0	1
LG&E	C1SR	892655	05/2014	05/23/2014	100.090	99.880	100.0	1
LG&E	C1SR	892656	05/2014	05/23/2014	100.050	99.910	100.0	1
LG&E	C1SR	892657	05/2014	05/23/2014	100.060	99.850	100.0	1
LG&E	C1SR	892658	05/2014	05/23/2014	100.090	99.930	100.1	1
LG&E	C1SR	892659	05/2014	05/23/2014	100.090	99.960	100.0	1
LG&E	C1SR	892660	05/2014	05/23/2014	100.090	99.930	100.1	1
LG&E	C1SR	892661	05/2014	05/23/2014	100.070	99.850	100.0	1

LG&E	C1SR	892662	05/2014	05/23/2014	100.070	99.950	100.0	1
LG&E	C1SR	892663	05/2014	05/23/2014	100.060	99.920	100.0	1
LG&E	C1SR	892664	05/2014	05/23/2014	100.050	99.900	100.0	1
LG&E	C1SR	892665	05/2014	05/23/2014	100.050	99.880	100.0	1
LG&E	C1SR	892666	05/2014	05/23/2014	100.060	99.920	100.0	1
LG&E	C1SR	892667	05/2014	05/23/2014	100.050	99.860	99.9	1
LG&E	C1SR	892668	05/2014	05/23/2014	100.070	99.890	99.9	1
LG&E	C1SR	892669	05/2014	05/23/2014	100.080	99.940	99.9	1
LG&E	C1SR	892670	05/2014	05/23/2014	100.080	99.980	100.0	1
LG&E	C1SR	892671	05/2014	05/23/2014	100.060	99.910	100.0	1
LG&E	C1SR	892672	05/2014	05/23/2014	100.080	99.870	100.0	1
LG&E	C1SR	892673	05/2014	05/23/2014	100.050	99.930	100.0	1
LG&E	C1SR	892674	05/2014	05/23/2014	100.060	99.860	100.0	1
LG&E	C1SR	892675	05/2014	05/23/2014	100.090	99.910	100.1	1
LG&E	C1SR	892676	05/2014	05/23/2014	100.060	99.920	100.0	1
LG&E	C1SR	892677	05/2014	05/23/2014	100.090	99.970	99.9	1
LG&E	C1SR	892678	05/2014	05/23/2014	100.060	99.870	100.0	1
LG&E	C1SR	892679	05/2014	05/23/2014	100.060	99.950	100.0	1
LG&E	C1SR	892680	05/2014	05/23/2014	100.060	99.880	99.9	1
LG&E	C1SR	892681	05/2014	05/23/2014	100.060	99.910	100.0	1
LG&E	C1SR	892682	05/2014	05/23/2014	100.070	99.960	100.0	1
LG&E	C1SR	892683	05/2014	05/23/2014	100.070	99.910	100.0	1
LG&E	C1SR	892684	05/2014	05/23/2014	100.070	99.900	100.0	1
LG&E	C1SR	892685	05/2014	05/23/2014	100.080	99.900	100.0	1
LG&E	C1SR	892686	05/2014	05/23/2014	100.070	100.000	100.0	1
LG&E	C1SR	892687	05/2014	05/23/2014	100.060	99.890	99.9	1
LG&E	C1SR	892688	05/2014	05/23/2014	100.080	99.900	100.0	1
LG&E	C1SR	892689	05/2014	05/23/2014	100.100	99.890	100.1	1
LG&E	C1SR	892690	05/2014	05/23/2014	100.090	99.950	100.1	1
LG&E	C1SR	892691	05/2014	05/23/2014	100.050	99.950	100.0	1
LG&E	C1SR	892692	05/2014	05/23/2014	100.080	99.900	100.0	1
LG&E	C1SR	892693	05/2014	05/23/2014	100.050	99.920	99.9	1

LG&E	C1SR	892694	05/2014	05/23/2014	100.090	99.940	100.1	1
LG&E	C1SR	892695	05/2014	05/23/2014	100.030	99.850	100.0	1
LG&E	C1SR	892696	05/2014	05/23/2014	100.040	99.870	100.0	1
LG&E	C1SR	892697	05/2014	05/23/2014	100.080	99.910	100.0	1
LG&E	C1SR	892698	05/2014	05/23/2014	100.070	99.890	100.1	1
LG&E	C1SR	892699	05/2014	05/23/2014	100.080	99.960	100.0	1
LG&E	C1SR	892700	05/2014	05/23/2014	100.060	99.900	100.0	1
LG&E	C1SR	892701	05/2014	05/23/2014	100.050	99.930	100.0	1
LG&E	C1SR	892702	05/2014	05/23/2014	100.070	99.940	100.0	1
LG&E	C1SR	892703	05/2014	05/23/2014	100.050	99.950	100.0	1
LG&E	C1SR	892704	05/2014	05/23/2014	100.070	99.930	100.0	1
LG&E	C1SR	892705	05/2014	05/23/2014	100.060	99.900	99.9	1
LG&E	C1SR	892706	05/2014	05/23/2014	100.040	99.880	100.0	1
LG&E	C1SR	892707	05/2014	05/23/2014	100.070	100.000	99.9	1
LG&E	C1SR	892708	05/2014	05/23/2014	100.070	99.920	100.0	1
LG&E	C1SR	892709	05/2014	05/23/2014	100.060	99.890	100.0	1
LG&E	C1SR	892710	05/2014	05/23/2014	100.080	99.960	100.1	1
LG&E	C1SR	892711	05/2014	05/23/2014	100.080	99.920	100.0	1
LG&E	C1SR	892712	05/2014	05/23/2014	100.080	99.950	99.9	1
LG&E	C1SR	892713	05/2014	05/23/2014	100.060	99.920	100.0	1
LG&E	C1SR	892714	05/2014	05/23/2014	100.090	99.950	100.0	1
LG&E	C1SR	892715	05/2014	05/23/2014	100.070	99.830	100.0	1
LG&E	C1SR	892716	05/2014	05/23/2014	100.090	100.020	100.0	1
LG&E	C1SR	892717	05/2014	05/23/2014	100.060	99.900	100.0	1
LG&E	C1SR	892718	05/2014	05/23/2014	100.100	99.990	100.0	1
LG&E	C1SR	892719	05/2014	05/23/2014	100.050	99.900	100.0	1
LG&E	C1SR	892720	05/2014	05/23/2014	100.070	99.880	100.0	1
LG&E	C1SR	892721	05/2014	05/23/2014	100.030	99.850	99.9	1
LG&E	C1SR	892722	05/2014	05/23/2014	100.100	99.980	100.0	1
LG&E	C1SR	892723	05/2014	05/23/2014	100.030	99.920	100.0	1
LG&E	C1SR	892724	05/2014	05/23/2014	100.070	99.900	100.1	1
LG&E	C1SR	892725	05/2014	05/23/2014	100.100	99.920	100.1	1

LG&E	C1SR	892726	05/2014	05/23/2014	100.060	99.960	100.0	1
LG&E	C1SR	892727	05/2014	05/23/2014	100.070	99.970	100.0	1
LG&E	C1SR	892728	05/2014	05/23/2014	100.080	99.880	100.0	1
LG&E	C1SR	892729	05/2014	05/23/2014	100.030	99.870	99.9	1
LG&E	C1SR	892730	05/2014	05/23/2014	100.050	99.930	100.0	1
LG&E	C1SR	892731	05/2014	05/23/2014	100.070	99.900	99.9	1
LG&E	C1SR	892732	05/2014	05/23/2014	100.030	99.850	99.9	1
LG&E	C1SR	892733	05/2014	05/23/2014	100.050	99.880	100.0	1
LG&E	C1SR	892734	05/2014	05/23/2014	100.100	99.980	100.0	1
LG&E	C1SR	892735	05/2014	05/23/2014	100.100	99.950	100.1	1
LG&E	C1SR	892736	05/2014	05/23/2014	100.030	99.950	99.9	1
LG&E	C1SR	892737	05/2014	05/23/2014	100.070	99.880	100.0	1
LG&E	C1SR	892738	05/2014	05/23/2014	100.060	99.940	99.9	1
LG&E	C1SR	892739	05/2014	05/23/2014	100.090	99.920	100.1	1
LG&E	C1SR	892740	05/2014	05/23/2014	100.080	99.920	100.0	1
LG&E	C1SR	892741	05/2014	05/23/2014	100.060	99.940	100.0	1
LG&E	C1SR	892742	05/2014	05/23/2014	100.070	99.950	100.0	1
LG&E	C1SR	892743	05/2014	05/23/2014	100.060	99.800	100.0	1
LG&E	C1SR	892744	05/2014	05/23/2014	100.090	99.920	100.0	1
LG&E	C1SR	892745	05/2014	05/23/2014	100.040	99.850	100.0	1
LG&E	C1SR	892746	05/2014	05/23/2014	100.030	99.890	100.0	1
LG&E	C1SR	892747	05/2014	05/23/2014	100.050	99.870	100.0	1
LG&E	C1SR	892748	05/2014	05/23/2014	100.040	99.930	100.0	1
LG&E	C1SR	892749	05/2014	05/23/2014	100.050	99.890	100.0	1
LG&E	C1SR	892750	05/2014	05/23/2014	100.090	99.900	100.1	1
LG&E	C1SR	892751	05/2014	05/23/2014	100.060	99.960	100.0	1
LG&E	C1SR	892752	05/2014	05/23/2014	100.090	99.970	100.1	1
LG&E	C1SR	892753	05/2014	05/23/2014	100.060	99.920	100.0	1
LG&E	C1SR	892754	05/2014	05/23/2014	100.080	99.930	100.0	1
LG&E	C1SR	892755	05/2014	05/23/2014	100.070	99.880	100.0	1
LG&E	C1SR	892756	05/2014	05/23/2014	100.060	99.890	100.0	1
LG&E	C1SR	892757	05/2014	05/23/2014	100.050	99.900	99.9	1

LG&E	C1SR	892758	05/2014	05/23/2014	100.080	99.920	100.0	1
LG&E	C1SR	892759	05/2014	05/23/2014	100.050	99.900	100.1	1
LG&E	C1SR	892760	05/2014	05/23/2014	100.050	99.920	100.0	1
LG&E	C1SR	892761	05/2014	05/23/2014	100.100	100.010	100.1	1
LG&E	C1SR	892762	05/2014	05/23/2014	100.040	99.900	99.9	1
LG&E	C1SR	892763	05/2014	05/23/2014	100.060	99.910	100.0	1
LG&E	C1SR	892764	05/2014	05/23/2014	100.090	99.970	100.0	1
LG&E	C1SR	892765	05/2014	05/23/2014	100.060	99.930	100.1	1
LG&E	C1SR	892766	05/2014	05/23/2014	100.060	99.880	100.0	1
LG&E	C1SR	892767	05/2014	05/23/2014	100.080	99.890	100.1	1
LG&E	C1SR	892768	05/2014	05/23/2014	100.040	99.920	100.0	1
LG&E	C1SR	892769	05/2014	05/23/2014	100.070	99.880	100.1	1
LG&E	C1SR	892770	05/2014	05/23/2014	100.060	99.840	99.9	1
LG&E	C1SR	892771	05/2014	05/23/2014	100.070	99.900	100.0	1
LG&E	C1SR	892772	05/2014	05/23/2014	100.100	99.980	100.0	1
LG&E	C1SR	892773	05/2014	05/23/2014	100.080	99.920	99.9	1
LG&E	C1SR	892774	05/2014	05/23/2014	100.070	99.940	100.0	1
LG&E	C1SR	892775	05/2014	05/23/2014	100.080	99.930	100.1	1
LG&E	C1SR	892776	05/2014	05/23/2014	100.110	99.950	100.1	1
LG&E	C1SR	892777	05/2014	05/23/2014	100.050	99.880	99.9	1
LG&E	C1SR	892778	05/2014	05/23/2014	100.060	99.880	99.9	1
LG&E	C1SR	892779	05/2014	05/23/2014	100.060	99.900	99.9	1
LG&E	C1SR	892780	05/2014	05/23/2014	100.030	99.850	100.0	1
LG&E	C1SR	892781	05/2014	05/23/2014	100.050	99.940	100.0	1
LG&E	C1SR	892782	05/2014	05/23/2014	100.060	99.900	100.0	1
LG&E	C1SR	892783	05/2014	05/23/2014	100.050	99.880	99.9	1
LG&E	C1SR	892784	05/2014	05/23/2014	100.070	99.920	100.0	1
LG&E	C1SR	892785	05/2014	05/23/2014	100.060	99.920	100.0	1
LG&E	C1SR	892786	05/2014	05/23/2014	100.070	99.840	100.0	1
LG&E	C1SR	892787	05/2014	05/23/2014	100.040	99.920	99.9	1
LG&E	C1SR	892788	05/2014	05/23/2014	100.060	99.960	100.0	1
LG&E	C1SR	892789	05/2014	05/23/2014	100.090	99.920	100.0	1

LG&E	C1SR	892790	05/2014	05/23/2014	100.070	99.890	100.0	1
LG&E	C1SR	892791	05/2014	05/23/2014	100.030	99.840	100.0	1
LG&E	C1SR	892792	05/2014	05/23/2014	100.050	99.850	100.0	1
LG&E	C1SR	892793	05/2014	05/23/2014	100.030	99.850	99.9	1
LG&E	C1SR	892794	05/2014	05/23/2014	100.060	99.940	100.0	1
LG&E	C1SR	892795	05/2014	05/23/2014	100.080	99.910	100.1	1
LG&E	C1SR	892796	05/2014	05/23/2014	100.110	100.030	100.0	1
LG&E	C1SR	892797	05/2014	05/23/2014	100.090	99.930	100.1	1
LG&E	C1SR	892798	05/2014	05/23/2014	100.040	99.890	99.9	1
LG&E	C1SR	892799	05/2014	05/23/2014	100.060	99.900	100.0	1
LG&E	C1SR	892800	05/2014	05/23/2014	100.050	99.880	100.0	1
LG&E	C1SR	892801	05/2014	05/23/2014	100.050	99.910	100.0	1
LG&E	C1SR	892802	05/2014	05/23/2014	100.050	99.860	99.9	1
LG&E	C1SR	892803	05/2014	05/23/2014	100.030	99.830	99.9	1
LG&E	C1SR	892804	05/2014	05/23/2014	100.070	99.890	100.0	1
LG&E	C1SR	892805	05/2014	05/23/2014	100.040	99.830	100.0	1
LG&E	C1SR	892806	05/2014	05/23/2014	100.070	99.910	99.9	1
LG&E	C1SR	892807	05/2014	05/23/2014	100.030	99.840	99.9	1
LG&E	C1SR	892808	05/2014	05/23/2014	100.080	99.960	100.1	1
LG&E	C1SR	892809	05/2014	05/23/2014	100.070	99.910	100.0	1
LG&E	C1SR	892810	05/2014	05/23/2014	100.070	99.810	100.0	1
LG&E	C1SR	892811	05/2014	05/23/2014	100.100	99.960	100.1	1
LG&E	C1SR	892812	05/2014	05/23/2014	100.070	99.910	100.0	1
LG&E	C1SR	892813	05/2014	05/23/2014	100.100	99.990	100.1	1
LG&E	C1SR	892814	05/2014	05/23/2014	100.100	99.960	100.1	1
LG&E	C1SR	892815	05/2014	05/23/2014	100.060	99.910	100.0	1
LG&E	C1SR	892816	05/2014	05/23/2014	100.090	99.970	100.0	1
LG&E	C1SR	892817	05/2014	05/23/2014	100.050	99.830	99.9	1
LG&E	C1SR	892818	05/2014	05/23/2014	100.070	99.880	99.9	1
LG&E	C1SR	892819	05/2014	05/23/2014	100.080	99.980	100.0	1
LG&E	C1SR	892820	05/2014	05/23/2014	100.080	99.930	100.0	1
LG&E	C1SR	892821	05/2014	05/23/2014	100.090	99.970	100.0	1

LG&E	C1SR	892822	05/2014	05/23/2014	100.070	99.830	100.0	1
LG&E	C1SR	892823	05/2014	05/23/2014	100.060	99.930	99.9	1
LG&E	C1SR	892824	05/2014	05/23/2014	100.070	99.920	100.0	1
LG&E	C1SR	892825	05/2014	05/23/2014	100.080	99.960	100.0	1
LG&E	C1SR	892826	05/2014	05/23/2014	100.050	99.900	99.9	1
LG&E	C1SR	892827	05/2014	05/23/2014	100.050	99.870	100.0	1
LG&E	C1SR	892828	05/2014	05/23/2014	100.030	99.920	100.0	1
LG&E	C1SR	892829	05/2014	05/23/2014	100.080	99.860	100.0	1
LG&E	C1SR	892830	05/2014	05/23/2014	100.070	99.960	100.0	1
LG&E	C1SR	892831	05/2014	05/23/2014	100.110	99.910	100.1	1
LG&E	C1SR	892832	05/2014	05/23/2014	100.070	99.880	99.9	1
LG&E	C1SR	892833	05/2014	05/23/2014	100.080	99.910	100.0	1
LG&E	C1SR	892834	05/2014	05/23/2014	100.110	99.980	100.0	1
LG&E	C1SR	892835	05/2014	05/23/2014	100.100	99.920	100.0	1
LG&E	C1SR	892836	05/2014	05/23/2014	100.070	99.930	100.0	1
LG&E	C1SR	892837	05/2014	05/23/2014	100.100	99.910	100.1	1
LG&E	C1SR	892838	05/2014	05/23/2014	100.070	99.930	100.0	1
LG&E	C1SR	892839	05/2014	05/23/2014	100.100	99.930	100.0	1
LG&E	C1SR	892840	05/2014	05/23/2014	100.100	99.980	100.1	1
LG&E	C1SR	892841	05/2014	05/23/2014	100.100	99.910	100.0	1
LG&E	C1SR	892842	05/2014	05/23/2014	100.060	99.900	100.0	1
LG&E	C1SR	892843	05/2014	05/23/2014	100.110	100.040	100.0	1
LG&E	C1SR	892844	05/2014	05/23/2014	100.060	99.880	100.0	1
LG&E	C1SR	892845	05/2014	05/23/2014	100.050	99.920	99.9	1
LG&E	C1SR	892846	05/2014	05/23/2014	100.060	99.950	100.0	1
LG&E	C1SR	892847	05/2014	05/23/2014	100.040	99.900	99.9	1
LG&E	C1SR	892848	05/2014	05/23/2014	100.060	99.970	100.0	1
LG&E	C1SR	892849	05/2014	05/23/2014	100.080	99.880	100.0	1
LG&E	C1SR	892850	05/2014	05/23/2014	100.040	99.860	99.9	1
LG&E	C1SR	892851	05/2014	05/23/2014	100.070	99.850	99.9	1
LG&E	C1SR	892852	05/2014	05/23/2014	100.070	99.910	100.0	1
LG&E	C1SR	892853	05/2014	05/23/2014	100.070	99.940	100.0	1

LG&E	C1SR	892854	05/2014	05/23/2014	100.090	99.940	100.1	1
LG&E	C1SR	892855	05/2014	05/23/2014	100.100	99.940	100.1	1
LG&E	C1SR	892856	05/2014	05/23/2014	100.080	99.890	100.1	1
LG&E	C1SR	892857	05/2014	05/23/2014	100.070	99.910	100.0	1
LG&E	C1SR	892858	05/2014	05/23/2014	100.100	99.980	100.0	1
LG&E	C1SR	892859	05/2014	05/23/2014	100.090	99.920	100.1	1
LG&E	C1SR	892860	05/2014	05/23/2014	100.050	99.810	100.0	1
LG&E	C1SR	892861	05/2014	05/23/2014	100.090	99.970	100.0	1
LG&E	C1SR	892862	05/2014	05/23/2014	100.060	99.900	100.0	1
LG&E	C1SR	892863	05/2014	05/23/2014	100.060	99.960	100.0	1
LG&E	C1SR	892864	05/2014	05/23/2014	100.100	99.860	100.1	1
LG&E	C1SR	892865	05/2014	05/23/2014	100.030	99.860	100.0	1
LG&E	C1SR	892866	05/2014	05/23/2014	100.070	99.970	100.0	1
LG&E	C1SR	892867	05/2014	05/23/2014	100.090	99.970	100.0	1
LG&E	C1SR	892868	05/2014	05/23/2014	100.080	100.000	100.0	1
LG&E	C1SR	892869	05/2014	05/23/2014	100.080	100.040	100.0	1
LG&E	C1SR	892870	05/2014	05/23/2014	100.080	99.960	100.0	1
LG&E	C1SR	892871	05/2014	05/23/2014	100.060	99.860	100.0	1
LG&E	C1SR	892872	05/2014	05/23/2014	100.060	99.970	99.9	1
LG&E	C1SR	892873	05/2014	05/23/2014	100.070	99.930	99.9	1
LG&E	C1SR	892874	05/2014	05/23/2014	100.090	99.870	100.1	1
LG&E	C1SR	892875	05/2014	05/23/2014	100.090	99.880	100.0	1
LG&E	C1SR	892876	05/2014	05/23/2014	100.080	99.910	99.9	1
LG&E	C1SR	892877	05/2014	05/23/2014	100.060	99.900	100.1	1
LG&E	C1SR	892878	05/2014	05/23/2014	100.050	99.970	99.9	1
LG&E	C1SR	892879	05/2014	05/23/2014	100.030	99.970	100.0	1
LG&E	C1SR	892880	05/2014	05/23/2014	100.040	99.890	99.9	1
LG&E	C1SR	892881	05/2014	05/23/2014	100.040	99.810	99.9	1
LG&E	C1SR	892882	05/2014	05/23/2014	100.080	99.950	100.0	1
LG&E	C1SR	892883	05/2014	05/23/2014	100.030	99.920	100.0	1
LG&E	C1SR	892884	05/2014	05/23/2014	100.060	99.900	100.0	1
LG&E	C1SR	892885	05/2014	05/23/2014	100.080	99.930	100.0	1

LG&E	C1SR	892886	05/2014	05/23/2014	100.030	99.860	100.0	1
LG&E	C1SR	892887	05/2014	05/23/2014	100.060	99.880	100.0	1
LG&E	C1SR	892888	05/2014	05/23/2014	100.080	99.820	100.0	1
LG&E	C1SR	892889	05/2014	05/23/2014	100.070	99.900	100.1	1
LG&E	C1SR	892890	05/2014	05/23/2014	100.040	99.820	99.9	1
LG&E	C1SR	892891	05/2014	05/23/2014	100.030	99.860	99.9	1
LG&E	C1SR	892892	05/2014	05/23/2014	100.080	99.970	100.0	1
LG&E	C1SR	892893	05/2014	05/23/2014	100.040	99.910	99.9	1
LG&E	C1SR	892894	05/2014	05/23/2014	100.090	99.930	100.0	1
LG&E	C1SR	892895	05/2014	05/23/2014	100.080	99.890	100.0	1
LG&E	C1SR	892896	05/2014	05/23/2014	100.050	99.900	100.0	1
LG&E	C1SR	892897	05/2014	05/23/2014	100.050	99.900	100.0	1
LG&E	C1SR	892898	05/2014	05/23/2014	100.070	99.930	100.0	1
LG&E	C1SR	892899	05/2014	05/23/2014	100.080	99.890	100.0	1
LG&E	C1SR	892900	05/2014	05/23/2014	100.050	99.860	100.0	1
LG&E	C1SR	892901	05/2014	05/23/2014	100.060	99.960	100.0	1
LG&E	C1SR	892902	05/2014	05/23/2014	100.050	99.880	100.0	1
LG&E	C1SR	892903	05/2014	05/23/2014	100.070	99.900	100.0	1
LG&E	C1SR	892904	05/2014	05/23/2014	100.080	99.920	100.0	1
LG&E	C1SR	892905	05/2014	05/23/2014	100.030	99.930	99.9	1
LG&E	C1SR	892906	05/2014	05/23/2014	100.060	99.960	100.0	1
LG&E	C1SR	892907	05/2014	05/23/2014	100.060	99.860	100.0	1
LG&E	C1SR	892908	05/2014	05/23/2014	100.080	100.000	100.0	1
LG&E	C1SR	892909	05/2014	05/23/2014	100.030	99.950	100.1	1
LG&E	C1SR	892910	05/2014	05/23/2014	100.050	99.900	100.0	1
LG&E	C1SR	892911	05/2014	05/23/2014	100.090	99.910	100.1	1
LG&E	C1SR	892912	05/2014	05/23/2014	100.060	99.890	100.0	1
LG&E	C1SR	892913	05/2014	05/23/2014	100.060	99.880	100.0	1
LG&E	C1SR	892914	05/2014	05/23/2014	100.040	99.890	100.0	1
LG&E	C1SR	892915	05/2014	05/23/2014	100.050	99.960	100.0	1
LG&E	C1SR	892916	05/2014	05/23/2014	100.030	99.820	99.9	1
LG&E	C1SR	892917	05/2014	05/23/2014	100.110	99.980	100.0	1

LG&E	C1SR	892918	05/2014	05/23/2014	100.080	100.000	99.9	1
LG&E	C1SR	892919	05/2014	05/23/2014	100.090	99.870	100.1	1
LG&E	C1SR	892920	05/2014	05/23/2014	100.090	99.900	100.0	1
LG&E	C1SR	892921	05/2014	05/23/2014	100.090	99.950	99.9	1
LG&E	C1SR	892922	05/2014	05/23/2014	100.060	99.810	100.0	1
LG&E	C1SR	892923	05/2014	05/23/2014	100.060	99.890	100.0	1
LG&E	C1SR	892924	05/2014	05/23/2014	100.060	99.920	100.0	1
LG&E	C1SR	892925	05/2014	05/23/2014	100.040	99.870	99.9	1
LG&E	C1SR	892926	05/2014	05/23/2014	100.070	99.880	100.0	1
LG&E	C1SR	892927	05/2014	05/23/2014	100.070	99.990	100.1	1
LG&E	C1SR	892928	05/2014	05/23/2014	100.060	99.870	99.9	1
LG&E	C1SR	892929	05/2014	05/23/2014	100.060	99.870	100.0	1
LG&E	C1SR	892930	05/2014	05/23/2014	100.050	99.930	100.0	1
LG&E	C1SR	892931	05/2014	05/23/2014	100.060	99.870	99.9	1
LG&E	C1SR	892932	05/2014	05/23/2014	100.070	99.840	100.0	1
LG&E	C1SR	892933	05/2014	05/23/2014	100.070	99.860	100.1	1
LG&E	C1SR	892934	05/2014	05/23/2014	100.050	99.880	100.0	1
LG&E	C1SR	892935	05/2014	05/23/2014	100.090	99.890	100.0	1
LG&E	C1SR	892936	05/2014	05/23/2014	100.060	99.910	99.9	1
LG&E	C1SR	892937	05/2014	05/23/2014	100.050	99.930	100.0	1
LG&E	C1SR	892938	05/2014	05/23/2014	100.050	99.960	100.0	1
LG&E	C1SR	892939	05/2014	05/23/2014	100.090	99.910	100.0	1
LG&E	C1SR	892940	05/2014	05/23/2014	100.050	99.860	100.0	1
LG&E	C1SR	892941	05/2014	05/23/2014	100.090	99.910	100.1	1
LG&E	C1SR	892942	05/2014	05/23/2014	100.090	99.900	100.0	1
LG&E	C1SR	892943	05/2014	05/23/2014	100.080	99.890	100.0	1
LG&E	C1SR	892944	05/2014	05/23/2014	100.090	99.950	100.0	1
LG&E	C1SR	892945	05/2014	05/23/2014	100.070	99.940	100.0	1
LG&E	C1SR	892946	05/2014	05/23/2014	100.030	99.880	100.0	1
LG&E	C1SR	892947	05/2014	05/23/2014	100.060	99.840	100.0	1
LG&E	C1SR	892948	05/2014	05/23/2014	100.050	99.920	100.0	1
LG&E	C1SR	892949	05/2014	05/23/2014	100.070	99.950	100.0	1

LG&E	C1SR	892950	05/2014	05/23/2014	100.050	100.010	100.0	1
LG&E	C1SR	892951	05/2014	05/23/2014	100.080	99.860	100.0	1
LG&E	C1SR	892952	05/2014	05/23/2014	100.050	99.850	100.0	1
LG&E	C1SR	892953	05/2014	05/23/2014	100.060	99.850	100.0	1
LG&E	C1SR	892954	05/2014	05/23/2014	100.030	99.900	100.0	1
LG&E	C1SR	892955	05/2014	05/23/2014	100.050	99.940	100.0	1
LG&E	C1SR	892956	05/2014	05/23/2014	100.090	99.940	100.0	1
LG&E	C1SR	892957	05/2014	05/23/2014	100.070	99.900	99.9	1
LG&E	C1SR	892958	05/2014	05/23/2014	100.070	99.890	100.0	1
LG&E	C1SR	892959	05/2014	05/23/2014	100.060	99.910	100.0	1
LG&E	C1SR	892960	05/2014	05/23/2014	100.030	99.840	99.9	1
LG&E	C1SR	892961	05/2014	05/23/2014	100.100	99.910	100.1	1
LG&E	C1SR	892962	05/2014	05/23/2014	100.050	99.840	99.9	1
LG&E	C1SR	892963	05/2014	05/23/2014	100.060	99.920	99.9	1
LG&E	C1SR	892964	05/2014	05/23/2014	100.030	99.880	99.9	1
LG&E	C1SR	892965	05/2014	05/23/2014	100.090	99.890	100.1	1
LG&E	C1SR	892966	05/2014	05/23/2014	100.030	99.850	99.9	1
LG&E	C1SR	892967	05/2014	05/23/2014	100.030	99.850	100.0	1
LG&E	C1SR	892968	05/2014	05/23/2014	100.070	99.930	100.1	1
LG&E	C1SR	892969	05/2014	05/23/2014	100.070	99.870	100.1	1
LG&E	C1SR	892970	05/2014	05/23/2014	100.100	99.960	100.1	1
LG&E	C1SR	892971	05/2014	05/23/2014	100.040	99.830	100.0	1
LG&E	C1SR	892972	05/2014	05/23/2014	100.030	99.870	100.0	1
LG&E	C1SR	892973	05/2014	05/23/2014	100.040	99.940	99.9	1
LG&E	C1SR	892974	05/2014	05/23/2014	100.040	99.860	100.0	1
LG&E	C1SR	892975	05/2014	05/23/2014	100.060	99.900	99.9	1
LG&E	C1SR	892976	05/2014	05/23/2014	100.080	100.000	100.0	1
LG&E	C1SR	892977	05/2014	05/23/2014	100.040	99.880	99.9	1
LG&E	C1SR	892978	05/2014	05/23/2014	100.070	99.960	100.1	1
LG&E	C1SR	892979	05/2014	05/23/2014	100.050	99.920	100.0	1
LG&E	C1SR	892980	05/2014	05/23/2014	100.050	99.950	100.0	1
LG&E	C1SR	892981	05/2014	05/23/2014	100.090	99.940	100.0	1

LG&E	C1SR	892982	05/2014	05/23/2014	100.090	99.900	100.1	1
LG&E	C1SR	892983	05/2014	05/23/2014	100.030	99.870	99.9	1
LG&E	C1SR	892984	05/2014	05/23/2014	100.090	99.880	100.0	1
LG&E	C1SR	892985	05/2014	05/23/2014	100.070	99.900	100.0	1
LG&E	C1SR	892986	05/2014	05/23/2014	100.080	99.940	100.0	1
LG&E	C1SR	892987	05/2014	05/23/2014	100.080	99.860	100.0	1
LG&E	C1SR	892988	05/2014	05/23/2014	100.070	99.890	100.0	1
LG&E	C1SR	892989	05/2014	05/23/2014	100.040	99.820	99.9	1
LG&E	C1SR	892990	05/2014	05/23/2014	100.090	99.930	100.0	1
LG&E	C1SR	892991	05/2014	05/23/2014	100.100	99.950	100.0	1
LG&E	C1SR	892992	05/2014	05/23/2014	100.040	99.860	100.0	1
LG&E	C1SR	892993	05/2014	05/23/2014	100.040	99.810	100.0	1
LG&E	C1SR	892994	05/2014	05/23/2014	100.090	99.930	100.0	1
LG&E	C1SR	892995	05/2014	05/23/2014	100.040	99.840	100.0	1
LG&E	C1SR	892996	05/2014	05/23/2014	100.070	99.850	100.0	1
LG&E	C1SR	892997	05/2014	05/23/2014	100.060	99.940	100.0	1
LG&E	C1SR	892998	05/2014	05/23/2014	100.070	99.930	100.1	1
LG&E	C1SR	892999	05/2014	05/23/2014	100.060	99.910	100.0	1
LG&E	C1SR	893000	05/2014	05/23/2014	100.070	99.920	100.1	1
LG&E	C1SR	893001	05/2014	05/23/2014	100.060	99.880	100.0	1
LG&E	C1SR	893002	05/2014	05/23/2014	100.080	99.950	100.0	1
LG&E	C1SR	893003	05/2014	05/23/2014	100.090	99.930	100.0	1
LG&E	C1SR	893004	05/2014	05/23/2014	100.060	99.930	99.8	1
LG&E	C1SR	893005	05/2014	05/23/2014	100.040	99.820	100.0	1
LG&E	C1SR	893006	05/2014	05/23/2014	100.060	99.910	100.0	1
LG&E	C1SR	893007	05/2014	05/23/2014	100.030	99.920	100.0	1
LG&E	C1SR	893008	05/2014	05/23/2014	100.110	99.940	100.0	1
LG&E	C1SR	893009	05/2014	05/23/2014	100.060	99.940	100.0	1
LG&E	C1SR	893010	05/2014	05/23/2014	100.080	99.920	100.0	1
LG&E	C1SR	893011	05/2014	05/23/2014	100.080	99.910	100.0	1
LG&E	C1SR	893012	05/2014	05/23/2014	100.090	99.910	100.0	1
LG&E	C1SR	893013	05/2014	05/23/2014	100.100	99.980	100.0	1

LG&E	C1SR	893014	05/2014	05/23/2014	100.070	99.890	100.0	1
LG&E	C1SR	893015	05/2014	05/23/2014	100.100	99.970	100.1	1
LG&E	C1SR	893016	05/2014	05/23/2014	100.040	99.870	99.9	1
LG&E	C1SR	893017	05/2014	05/23/2014	100.110	100.010	100.1	1
LG&E	C1SR	893018	05/2014	05/23/2014	100.110	99.890	100.0	1
LG&E	C1SR	893019	05/2014	05/23/2014	100.070	99.920	100.0	1
LG&E	C1SR	893020	05/2014	05/23/2014	100.080	99.960	100.1	1
LG&E	C1SR	893021	05/2014	05/23/2014	100.080	99.920	100.1	1
LG&E	C1SR	893022	05/2014	05/23/2014	100.090	100.020	100.0	1
LG&E	C1SR	893023	05/2014	05/23/2014	100.090	99.950	100.0	1
LG&E	C1SR	893024	05/2014	05/23/2014	100.090	99.960	99.9	1
LG&E	C1SR	893025	05/2014	05/23/2014	100.040	99.880	99.9	1
LG&E	C1SR	893026	05/2014	05/23/2014	100.070	99.920	99.9	1
LG&E	C1SR	893027	05/2014	05/23/2014	100.090	99.880	99.9	1
LG&E	C1SR	893028	05/2014	05/23/2014	100.060	99.940	100.1	1
LG&E	C1SR	893029	05/2014	05/23/2014	100.070	99.870	100.1	1
LG&E	C1SR	893030	05/2014	05/23/2014	100.070	99.930	100.0	1
LG&E	C1SR	893031	05/2014	05/23/2014	100.040	99.850	100.0	1
LG&E	C1SR	893032	05/2014	05/23/2014	100.080	99.870	100.1	1
LG&E	C1SR	893033	05/2014	05/23/2014	100.070	99.920	100.0	1
LG&E	C1SR	893034	05/2014	05/23/2014	100.040	99.900	100.0	1
LG&E	C1SR	893035	05/2014	05/23/2014	100.070	99.910	100.1	1
LG&E	C1SR	893036	05/2014	05/23/2014	100.060	99.900	100.0	1
LG&E	C1SR	893037	05/2014	05/23/2014	100.070	99.950	100.0	1
LG&E	C1SR	893038	05/2014	05/23/2014	100.040	99.860	100.0	1
LG&E	C1SR	893039	05/2014	05/23/2014	100.090	99.890	99.9	1
LG&E	C1SR	893040	05/2014	05/23/2014	100.100	99.870	100.0	1
LG&E	C1SR	893041	05/2014	05/23/2014	100.070	99.920	100.0	1
LG&E	C1SR	893042	05/2014	05/23/2014	100.070	99.920	100.0	1
LG&E	C1SR	893043	05/2014	05/23/2014	100.090	99.920	99.9	1
LG&E	C1SR	893044	05/2014	05/23/2014	100.080	99.940	100.0	1
LG&E	C1SR	893045	05/2014	05/23/2014	100.060	99.840	100.0	1

LG&E	C1SR	893046	05/2014	05/23/2014	100.080	99.970	100.1	1
LG&E	C1SR	893047	05/2014	05/23/2014	100.080	99.910	100.0	1
LG&E	C1SR	893048	05/2014	05/23/2014	100.070	99.880	100.0	1
LG&E	C1SR	893049	05/2014	05/23/2014	100.070	99.970	100.0	1
LG&E	C1SR	893050	05/2014	05/23/2014	100.090	99.980	100.0	1
LG&E	C1SR	893051	05/2014	05/23/2014	100.050	99.860	100.0	1
LG&E	C1SR	893052	05/2014	05/23/2014	100.090	100.010	100.0	1
LG&E	C1SR	893053	05/2014	05/23/2014	100.080	99.920	100.1	1
LG&E	C1SR	893054	05/2014	05/23/2014	100.080	99.890	100.1	1
LG&E	C1SR	893055	05/2014	05/23/2014	100.060	99.860	99.9	1
LG&E	C1SR	893056	05/2014	05/23/2014	100.080	99.860	100.1	1
LG&E	C1SR	893057	05/2014	05/23/2014	100.060	99.910	100.0	1
LG&E	C1SR	893058	05/2014	05/23/2014	100.070	99.900	100.0	1
LG&E	C1SR	893059	05/2014	05/23/2014	100.090	99.890	100.0	1
LG&E	C1SR	893060	05/2014	05/23/2014	100.060	99.920	99.9	1
LG&E	C1SR	893061	05/2014	05/23/2014	100.040	99.860	99.9	1
LG&E	C1SR	893062	05/2014	05/23/2014	100.060	99.920	100.0	1
LG&E	C1SR	893063	05/2014	05/23/2014	100.100	99.890	100.0	1
LG&E	C1SR	893064	05/2014	05/23/2014	100.080	99.950	100.0	1
LG&E	C1SR	893065	05/2014	05/23/2014	100.050	99.900	99.9	1
LG&E	C1SR	893066	05/2014	05/23/2014	100.110	99.940	100.0	1
LG&E	C1SR	893067	05/2014	05/23/2014	100.060	99.890	100.0	1
LG&E	C1SR	893068	05/2014	05/23/2014	100.110	99.910	100.0	1
LG&E	C1SR	893069	05/2014	05/23/2014	100.100	99.980	100.0	1
LG&E	C1SR	893070	05/2014	05/23/2014	100.060	99.900	100.0	1
LG&E	C1SR	893071	05/2014	05/23/2014	100.080	99.950	100.0	1
LG&E	C1SR	893072	05/2014	05/23/2014	100.060	99.840	100.0	1
LG&E	C1SR	893073	05/2014	05/23/2014	100.070	100.010	100.0	1
LG&E	C1SR	893074	05/2014	05/23/2014	100.060	99.930	100.0	1
LG&E	C1SR	893075	05/2014	05/23/2014	100.050	99.950	100.1	1
LG&E	C1SR	893076	05/2014	05/23/2014	100.090	99.970	99.9	1
LG&E	C1SR	893077	05/2014	05/23/2014	100.070	99.860	100.0	1

LG&E	C1SR	893078	05/2014	05/23/2014	100.080	99.930	100.1	1
LG&E	C1SR	893079	05/2014	05/23/2014	100.060	99.850	100.0	1
LG&E	C1SR	893080	05/2014	05/23/2014	100.070	99.890	100.0	1
LG&E	C1SR	893081	05/2014	05/23/2014	100.070	99.900	99.9	1
LG&E	C1SR	893082	05/2014	05/23/2014	100.060	99.950	100.0	1
LG&E	C1SR	893083	05/2014	05/23/2014	100.100	99.860	100.1	1
LG&E	C1SR	893084	05/2014	05/23/2014	100.050	99.930	100.0	1
LG&E	C1SR	893085	05/2014	05/23/2014	100.070	99.850	100.0	1
LG&E	C1SR	893086	05/2014	05/23/2014	100.070	99.940	100.1	1
LG&E	C1SR	893087	05/2014	05/23/2014	100.030	99.930	100.0	1
LG&E	C1SR	893088	05/2014	05/23/2014	100.070	99.960	100.0	1
LG&E	C1SR	893089	05/2014	05/23/2014	100.080	99.870	100.1	1
LG&E	C1SR	893090	05/2014	05/23/2014	100.100	99.940	100.1	1
LG&E	C1SR	893091	05/2014	05/23/2014	100.070	99.940	100.0	1
LG&E	C1SR	893092	05/2014	05/23/2014	100.060	99.820	100.0	1
LG&E	C1SR	893093	05/2014	05/23/2014	100.080	99.960	100.0	1
LG&E	C1SR	893094	05/2014	05/23/2014	100.080	99.960	100.0	1
LG&E	C1SR	893095	05/2014	05/23/2014	100.090	99.920	100.0	1
LG&E	C1SR	893096	05/2014	05/23/2014	100.070	99.920	100.0	1
LG&E	C1SR	893097	05/2014	05/23/2014	100.100	99.900	100.0	1
LG&E	C1SR	893098	05/2014	05/23/2014	100.040	99.910	100.0	1
LG&E	C1SR	893099	05/2014	05/23/2014	100.070	99.980	99.9	1
LG&E	C1SR	893100	05/2014	05/23/2014	100.070	99.950	99.9	1
LG&E	C1SR	893101	05/2014	05/23/2014	100.090	100.000	100.0	1
LG&E	C1SR	893102	05/2014	05/23/2014	100.090	99.930	100.1	1
LG&E	C1SR	893103	05/2014	05/23/2014	100.080	99.870	100.0	1
LG&E	C1SR	893104	05/2014	05/23/2014	100.090	99.950	100.0	1
LG&E	C1SR	893105	05/2014	05/23/2014	100.070	99.930	100.0	1
LG&E	C1SR	893106	05/2014	05/23/2014	100.060	99.880	100.0	1
LG&E	C1SR	893107	05/2014	05/23/2014	100.100	99.940	100.0	1
LG&E	C1SR	893108	05/2014	05/23/2014	100.070	99.900	100.0	1
LG&E	C1SR	893109	05/2014	05/23/2014	100.080	99.940	100.0	1

LG&E	C1SR	893110	05/2014	05/23/2014	100.030	99.810	100.0	1
LG&E	C1SR	893111	05/2014	05/23/2014	100.100	99.970	100.1	1
LG&E	C1SR	893112	05/2014	05/23/2014	100.080	99.980	100.0	1
LG&E	C1SR	893113	05/2014	05/23/2014	100.070	99.920	99.9	1
LG&E	C1SR	893114	05/2014	05/23/2014	100.080	99.870	100.1	1
LG&E	C1SR	893115	05/2014	05/23/2014	100.060	99.870	100.0	1
LG&E	C1SR	893116	05/2014	05/23/2014	100.070	99.850	99.9	1
LG&E	C1SR	893117	05/2014	05/23/2014	100.090	99.930	100.1	1
LG&E	C1SR	893118	05/2014	05/23/2014	100.050	99.900	99.9	1
LG&E	C1SR	893119	05/2014	05/23/2014	100.100	99.950	100.0	1
LG&E	C1SR	893120	05/2014	05/23/2014	100.110	99.940	100.0	1
LG&E	C1SR	893121	05/2014	05/23/2014	100.060	99.980	99.9	1
LG&E	C1SR	893122	05/2014	05/23/2014	100.090	99.940	100.0	1
LG&E	C1SR	893123	05/2014	05/23/2014	100.060	99.910	100.0	1
LG&E	C1SR	893124	05/2014	05/23/2014	100.080	99.900	100.0	1
LG&E	C1SR	893125	05/2014	05/23/2014	100.050	99.850	99.9	1
LG&E	C1SR	893126	05/2014	05/23/2014	100.070	99.880	100.0	1
LG&E	C1SR	893127	05/2014	05/23/2014	100.030	99.880	100.0	1
LG&E	C1SR	893128	05/2014	05/23/2014	100.070	99.900	100.0	1
LG&E	C1SR	893129	05/2014	05/23/2014	100.100	99.940	100.1	1
LG&E	C1SR	893130	05/2014	05/23/2014	100.060	99.940	99.9	1
LG&E	C1SR	893131	05/2014	05/23/2014	100.060	99.980	100.0	1
LG&E	C1SR	893132	05/2014	05/23/2014	100.100	99.920	100.0	1
LG&E	C1SR	893133	05/2014	05/23/2014	100.040	99.800	99.9	1
LG&E	C1SR	893134	05/2014	05/23/2014	100.090	99.970	100.0	1
LG&E	C1SR	893135	05/2014	05/23/2014	100.080	99.950	100.0	1
LG&E	C1SR	893136	05/2014	05/23/2014	100.090	99.910	99.9	1
LG&E	C1SR	893137	05/2014	05/23/2014	100.050	99.850	100.0	1
LG&E	C1SR	893138	05/2014	05/23/2014	100.080	99.890	100.0	1
LG&E	C1SR	893139	05/2014	05/23/2014	100.100	99.950	100.0	1
LG&E	C1SR	893140	05/2014	05/23/2014	100.030	99.920	100.0	1
LG&E	C1SR	893141	05/2014	05/23/2014	100.070	99.930	100.0	1

LG&E	C1SR	893142	05/2014	05/23/2014	100.080	99.950	100.0	1
LG&E	C1SR	893143	05/2014	05/23/2014	100.070	99.930	100.0	1
LG&E	C1SR	893144	05/2014	05/23/2014	100.070	99.880	100.1	1
LG&E	C1SR	893145	05/2014	05/23/2014	100.050	99.930	99.9	1
LG&E	C1SR	893146	05/2014	05/23/2014	100.050	99.900	99.9	1
LG&E	C1SR	893147	05/2014	05/23/2014	100.110	99.930	100.1	1
LG&E	C1SR	893148	05/2014	05/23/2014	100.090	99.960	100.0	1
LG&E	C1SR	893149	05/2014	05/23/2014	100.090	99.950	100.0	1
LG&E	C1SR	893150	05/2014	05/23/2014	100.050	99.900	100.0	1
LG&E	C1SR	893151	05/2014	05/23/2014	100.090	99.950	100.0	1
LG&E	C1SR	893152	05/2014	05/23/2014	100.080	99.940	100.0	1
LG&E	C1SR	893153	05/2014	05/23/2014	100.070	99.910	100.0	1
LG&E	C1SR	893154	05/2014	05/23/2014	100.090	99.950	100.0	1
LG&E	C1SR	893155	05/2014	05/23/2014	100.070	99.940	100.0	1
LG&E	C1SR	893156	05/2014	05/23/2014	100.070	99.890	100.0	1
LG&E	C1SR	893157	05/2014	05/23/2014	100.050	99.880	100.0	1
LG&E	C1SR	893158	05/2014	05/23/2014	100.050	99.850	100.0	1
LG&E	C1SR	893159	05/2014	05/23/2014	100.060	99.950	99.9	1
LG&E	C1SR	893160	05/2014	05/23/2014	100.100	99.980	100.0	1
LG&E	C1SR	893161	05/2014	05/23/2014	100.080	99.930	100.0	1
LG&E	C1SR	893162	05/2014	05/23/2014	100.050	99.920	100.0	1
LG&E	C1SR	893163	05/2014	05/23/2014	100.090	99.920	100.1	1
LG&E	C1SR	893164	05/2014	05/23/2014	100.050	99.860	100.0	1
LG&E	C1SR	893165	05/2014	05/23/2014	100.100	99.990	100.1	1
LG&E	C1SR	893166	05/2014	05/23/2014	100.060	99.990	100.0	1
LG&E	C1SR	893167	05/2014	05/23/2014	100.080	99.900	100.0	1
LG&E	C1SR	893168	05/2014	05/23/2014	100.070	99.810	99.9	1
LG&E	C1SR	893169	05/2014	05/23/2014	100.060	99.950	100.0	1
LG&E	C1SR	893170	05/2014	05/23/2014	100.070	99.920	99.9	1
LG&E	C1SR	893171	05/2014	05/23/2014	100.030	99.900	99.9	1
LG&E	C1SR	893172	05/2014	05/23/2014	100.080	99.900	100.0	1
LG&E	C1SR	893173	05/2014	05/23/2014	100.100	99.910	100.0	1

LG&E	C1SR	893174	05/2014	05/23/2014	100.080	99.970	100.0	1
LG&E	C1SR	893175	05/2014	05/23/2014	100.060	99.940	100.0	1
LG&E	C1SR	893176	05/2014	05/23/2014	100.070	99.930	99.9	1
LG&E	C1SR	893177	05/2014	05/23/2014	100.080	100.010	100.0	1
LG&E	C1SR	893178	05/2014	05/23/2014	100.090	100.010	100.0	1
LG&E	C1SR	893179	05/2014	05/23/2014	100.080	99.910	99.9	1
LG&E	C1SR	893180	05/2014	05/23/2014	100.050	99.980	100.0	1
LG&E	C1SR	893181	05/2014	05/23/2014	100.070	99.910	99.9	1
LG&E	C1SR	893182	05/2014	05/23/2014	100.060	99.890	100.1	1
LG&E	C1SR	893183	05/2014	05/23/2014	100.080	99.920	100.0	1
LG&E	C1SR	893184	05/2014	05/23/2014	100.060	99.900	100.0	1
LG&E	C1SR	893185	05/2014	05/23/2014	100.080	99.920	100.0	1
LG&E	C1SR	893186	05/2014	05/23/2014	100.060	99.860	100.1	1
LG&E	C1SR	893187	05/2014	05/23/2014	100.030	99.870	100.0	1
LG&E	C1SR	893188	05/2014	05/23/2014	100.100	99.910	100.1	1
LG&E	C1SR	893189	05/2014	05/23/2014	100.060	99.880	100.0	1
LG&E	C1SR	893190	05/2014	05/23/2014	100.030	99.890	100.0	1
LG&E	C1SR	893191	05/2014	05/23/2014	100.060	99.900	100.0	1
LG&E	C1SR	893192	05/2014	05/23/2014	100.090	99.860	100.0	1
LG&E	C1SR	893193	05/2014	05/23/2014	100.080	99.920	100.1	1
LG&E	C1SR	893194	05/2014	05/23/2014	100.080	99.930	100.0	1
LG&E	C1SR	893195	05/2014	05/23/2014	100.090	100.020	100.0	1
LG&E	C1SR	893196	05/2014	05/23/2014	100.070	99.920	99.9	1
LG&E	C1SR	893197	05/2014	05/23/2014	100.070	99.990	100.0	1
LG&E	C1SR	893198	05/2014	05/23/2014	100.090	99.890	100.0	1
LG&E	C1SR	893199	05/2014	05/23/2014	100.070	99.950	99.9	1
LG&E	C1SR	893200	05/2014	05/23/2014	100.070	99.960	100.0	1
LG&E	C1SR	893201	05/2014	05/23/2014	100.050	99.880	99.9	1
LG&E	C1SR	893202	05/2014	05/23/2014	100.050	99.840	99.9	1
LG&E	C1SR	893203	05/2014	05/23/2014	100.070	99.890	100.0	1
LG&E	C1SR	893204	05/2014	05/23/2014	100.080	99.930	99.9	1
LG&E	C1SR	893205	05/2014	05/23/2014	100.030	99.820	99.9	1

LG&E	C1SR	893206	05/2014	05/23/2014	100.030	99.890	99.9	1
LG&E	C1SR	893207	05/2014	05/23/2014	100.090	99.970	100.0	1
LG&E	C1SR	893208	05/2014	05/23/2014	100.090	99.950	100.0	1
LG&E	C1SR	893209	05/2014	05/23/2014	100.070	99.890	100.0	1
LG&E	C1SR	893210	05/2014	05/23/2014	100.080	99.910	100.0	1
LG&E	C1SR	893211	05/2014	05/23/2014	100.060	99.870	100.0	1
LG&E	C1SR	893212	05/2014	05/23/2014	100.080	99.900	100.0	1
LG&E	C1SR	893213	05/2014	05/23/2014	100.040	99.910	100.0	1
LG&E	C1SR	893214	05/2014	05/23/2014	100.070	99.910	99.9	1
LG&E	C1SR	893215	05/2014	05/23/2014	100.060	99.910	100.0	1
LG&E	C1SR	893216	05/2014	05/23/2014	100.070	99.970	100.0	1
LG&E	C1SR	893217	05/2014	05/23/2014	100.090	99.970	100.0	1
LG&E	C1SR	893218	05/2014	05/23/2014	100.080	99.900	100.0	1
LG&E	C1SR	893219	05/2014	05/23/2014	100.100	99.910	99.9	1
LG&E	C1SR	893220	05/2014	05/23/2014	100.080	99.890	100.0	1
LG&E	C1SR	893221	05/2014	05/23/2014	100.070	99.970	100.0	1
LG&E	C1SR	893222	05/2014	05/23/2014	100.070	99.940	99.9	1
LG&E	C1SR	893223	05/2014	05/23/2014	100.070	99.960	100.0	1
LG&E	C1SR	893224	05/2014	05/23/2014	100.050	99.840	100.0	1
LG&E	C1SR	893225	05/2014	05/23/2014	100.050	99.930	100.0	1
LG&E	C1SR	893226	05/2014	05/23/2014	100.030	99.880	100.0	1
LG&E	C1SR	893227	05/2014	05/23/2014	100.080	100.010	99.9	1
LG&E	C1SR	893228	05/2014	05/23/2014	100.080	99.880	100.0	1
LG&E	C1SR	893229	05/2014	05/23/2014	100.060	99.910	100.0	1
LG&E	C1SR	893230	05/2014	05/23/2014	100.100	99.890	100.0	1
LG&E	C1SR	893231	05/2014	05/23/2014	100.060	99.870	100.0	1
LG&E	C1SR	893232	05/2014	05/23/2014	100.070	99.950	100.0	1
LG&E	C1SR	893233	05/2014	05/23/2014	100.040	99.860	100.0	1
LG&E	C1SR	893234	05/2014	05/23/2014	100.100	100.010	100.0	1
LG&E	C1SR	893235	05/2014	05/23/2014	100.060	99.940	100.0	1
LG&E	C1SR	893236	05/2014	05/23/2014	100.050	99.880	99.9	1
LG&E	C1SR	893237	05/2014	05/23/2014	100.070	99.910	100.0	1

LG&E	C1SR	893238	05/2014	05/23/2014	100.100	99.950	100.0	1
LG&E	C1SR	893239	05/2014	05/23/2014	100.100	99.980	100.1	1
LG&E	C1SR	893240	05/2014	05/23/2014	100.050	99.910	100.0	1
LG&E	C1SR	893241	05/2014	05/23/2014	100.110	99.990	100.1	1
LG&E	C1SR	893242	05/2014	05/23/2014	100.100	99.870	100.1	1
LG&E	C1SR	893243	05/2014	05/23/2014	100.080	99.880	100.0	1
LG&E	C1SR	893244	05/2014	05/23/2014	100.040	99.970	99.9	1
LG&E	C1SR	893245	05/2014	05/23/2014	100.090	99.890	99.9	1
LG&E	C1SR	893246	05/2014	05/23/2014	100.100	99.940	100.0	1
LG&E	C1SR	893247	05/2014	05/23/2014	100.070	99.880	100.0	1
LG&E	C1SR	893248	05/2014	05/23/2014	100.050	99.810	100.0	1
LG&E	C1SR	893249	05/2014	05/23/2014	100.100	99.910	100.0	1
LG&E	C1SR	893250	05/2014	05/23/2014	100.080	99.930	100.1	1
LG&E	C1SR	893251	05/2014	05/23/2014	100.070	99.840	100.0	1
LG&E	C1SR	893252	05/2014	05/23/2014	100.090	99.920	100.0	1
LG&E	C1SR	893253	05/2014	05/23/2014	100.100	99.970	99.9	1
LG&E	C1SR	893254	05/2014	05/23/2014	100.100	99.940	100.0	1
LG&E	C1SR	893255	05/2014	05/23/2014	100.100	99.940	100.0	1
LG&E	C1SR	893256	05/2014	05/23/2014	100.090	99.930	100.1	1
LG&E	C1SR	893257	05/2014	05/23/2014	100.100	99.960	100.1	1
LG&E	C1SR	893258	05/2014	05/23/2014	100.070	100.010	100.1	1
LG&E	C1SR	893259	05/2014	05/23/2014	100.080	99.940	100.0	1
LG&E	C1SR	893260	05/2014	05/23/2014	100.080	99.920	100.0	1
LG&E	C1SR	893261	05/2014	05/23/2014	100.070	99.890	100.0	1
LG&E	C1SR	893262	05/2014	05/23/2014	100.070	99.910	100.0	1
LG&E	C1SR	893263	05/2014	05/23/2014	100.070	99.940	99.9	1
LG&E	C1SR	893264	05/2014	05/23/2014	100.040	99.860	99.9	1
LG&E	C1SR	893265	05/2014	05/23/2014	100.040	99.880	100.0	1
LG&E	C1SR	893266	05/2014	05/23/2014	100.050	99.920	99.9	1
LG&E	C1SR	893267	05/2014	05/23/2014	100.080	99.940	100.1	1
LG&E	C1SR	893268	05/2014	05/23/2014	100.050	99.930	100.0	1
LG&E	C1SR	893269	05/2014	05/23/2014	100.060	99.910	99.9	1

LG&E	C1SR	893270	05/2014	05/23/2014	100.080	100.000	100.0	1
LG&E	C1SR	893271	05/2014	05/23/2014	100.060	99.960	99.9	1
LG&E	C1SR	893272	05/2014	05/23/2014	100.060	99.930	100.0	1
LG&E	C1SR	893273	05/2014	05/23/2014	100.100	99.940	100.1	1
LG&E	C1SR	893274	05/2014	05/23/2014	100.090	99.960	100.1	1
LG&E	C1SR	893275	05/2014	05/23/2014	100.090	99.900	99.9	1
LG&E	C1SR	893276	05/2014	05/23/2014	100.090	99.930	100.1	1
LG&E	C1SR	893277	05/2014	05/23/2014	100.060	99.970	100.0	1
LG&E	C1SR	893278	05/2014	05/23/2014	100.100	99.940	100.0	1
LG&E	C1SR	893279	05/2014	05/23/2014	100.090	99.900	100.1	1
LG&E	C1SR	893280	05/2014	05/23/2014	100.060	99.890	99.9	1
LG&E	C1SR	893281	05/2014	05/23/2014	100.060	99.970	100.0	1
LG&E	C1SR	893282	05/2014	05/23/2014	100.060	99.930	100.0	1
LG&E	C1SR	893283	05/2014	05/23/2014	100.070	99.920	100.0	1
LG&E	C1SR	893284	05/2014	05/23/2014	100.100	99.950	100.0	1
LG&E	C1SR	893285	05/2014	05/23/2014	100.100	100.000	100.1	1
LG&E	C1SR	893286	05/2014	05/23/2014	100.080	99.900	100.0	1
LG&E	C1SR	893287	05/2014	05/23/2014	100.030	99.890	100.0	1
LG&E	C1SR	893288	05/2014	05/23/2014	100.090	99.920	100.0	1
LG&E	C1SR	893289	05/2014	05/23/2014	100.100	99.890	100.0	1
LG&E	C1SR	893290	05/2014	05/23/2014	100.060	99.940	100.0	1
LG&E	C1SR	893291	05/2014	05/23/2014	100.050	99.910	100.1	1
LG&E	C1SR	893292	05/2014	05/23/2014	100.090	99.860	100.0	1
LG&E	C1SR	893293	05/2014	05/23/2014	100.100	99.930	100.0	1
LG&E	C1SR	893294	05/2014	05/23/2014	100.090	99.850	100.1	1
LG&E	C1SR	893295	05/2014	05/23/2014	100.090	99.960	100.0	1
LG&E	C1SR	893296	05/2014	05/23/2014	100.090	99.990	100.0	1
LG&E	C1SR	893297	05/2014	05/23/2014	100.030	99.910	100.0	1
LG&E	C1SR	893298	05/2014	05/23/2014	100.110	99.900	100.0	1
LG&E	C1SR	893299	05/2014	05/23/2014	100.060	99.880	100.0	1
LG&E	C1SR	893300	05/2014	05/23/2014	100.070	99.870	100.0	1
LG&E	C1SR	893301	05/2014	05/23/2014	100.080	99.870	100.1	1

LG&E	C1SR	893302	05/2014	05/23/2014	100.060	99.910	99.9	1
LG&E	C1SR	893303	05/2014	05/23/2014	100.090	99.920	100.0	1
LG&E	C1SR	893304	05/2014	05/23/2014	100.060	99.890	100.0	1
LG&E	C1SR	893305	05/2014	05/23/2014	100.060	99.910	100.0	1
LG&E	C1SR	893306	05/2014	05/23/2014	100.050	99.880	100.0	1
LG&E	C1SR	893307	05/2014	05/23/2014	100.080	99.940	99.9	1
LG&E	C1SR	893308	05/2014	05/23/2014	100.090	99.910	99.9	1
LG&E	C1SR	893309	05/2014	05/23/2014	100.050	99.810	100.1	1
LG&E	C1SR	893310	05/2014	05/23/2014	100.060	99.940	99.9	1
LG&E	C1SR	893311	05/2014	05/23/2014	100.070	99.930	100.0	1
LG&E	C1SR	893312	05/2014	05/23/2014	100.070	99.850	99.9	1
LG&E	C1SR	893313	05/2014	05/23/2014	100.040	99.860	100.0	1
LG&E	C1SR	893314	05/2014	05/23/2014	100.080	99.940	100.0	1
LG&E	C1SR	893315	05/2014	05/23/2014	100.100	99.940	100.0	1
LG&E	C1SR	893316	05/2014	05/23/2014	100.070	99.930	99.9	1
LG&E	C1SR	893317	05/2014	05/23/2014	100.060	99.870	100.0	1
LG&E	C1SR	893318	05/2014	05/23/2014	100.030	99.820	99.9	1
LG&E	C1SR	893319	05/2014	05/23/2014	100.070	99.910	99.9	1
LG&E	C1SR	893320	05/2014	05/23/2014	100.080	99.920	99.9	1
LG&E	C1SR	893321	05/2014	05/23/2014	100.090	99.940	100.0	1
LG&E	C1SR	893322	05/2014	05/23/2014	100.060	99.870	100.0	1
LG&E	C1SR	893323	05/2014	05/23/2014	100.070	99.950	100.0	1
LG&E	C1SR	893324	05/2014	05/23/2014	100.070	99.960	99.9	1
LG&E	C1SR	893325	05/2014	05/23/2014	100.070	99.900	100.1	1
LG&E	C1SR	893326	05/2014	05/23/2014	100.060	99.910	99.9	1
LG&E	C1SR	893327	05/2014	05/23/2014	100.090	100.020	99.9	1
LG&E	C1SR	893328	05/2014	05/23/2014	100.080	99.920	100.1	1
LG&E	C1SR	893329	05/2014	05/23/2014	100.070	99.930	100.0	1
LG&E	C1SR	893330	05/2014	05/23/2014	100.090	99.920	100.1	1
LG&E	C1SR	893331	05/2014	05/23/2014	100.070	99.910	99.9	1
LG&E	C1SR	893332	05/2014	05/23/2014	100.060	99.910	100.1	1
LG&E	C1SR	893333	05/2014	05/23/2014	100.070	99.950	100.0	1

LG&E	C1SR	893334	05/2014	05/23/2014	100.070	99.900	100.0	1
LG&E	C1SR	893335	05/2014	05/23/2014	100.060	99.930	99.9	1
LG&E	C1SR	893336	05/2014	05/23/2014	100.100	99.970	100.0	1
LG&E	C1SR	893337	05/2014	05/23/2014	100.060	100.010	99.9	1
LG&E	C1SR	893338	05/2014	05/23/2014	100.070	99.910	100.0	1
LG&E	C1SR	893339	05/2014	05/23/2014	100.090	99.900	100.0	1
LG&E	C1SR	893340	05/2014	05/23/2014	100.100	99.900	100.1	1
LG&E	C1SR	893341	05/2014	05/23/2014	100.100	99.970	99.9	1
LG&E	C1SR	893342	05/2014	05/23/2014	100.030	99.850	100.0	1
LG&E	C1SR	893343	05/2014	05/23/2014	100.090	99.960	100.1	1
LG&E	C1SR	893344	05/2014	05/23/2014	100.070	99.880	100.0	1
LG&E	C1SR	893345	05/2014	05/23/2014	100.050	99.890	99.9	1
LG&E	C1SR	893346	05/2014	05/23/2014	100.090	99.980	99.9	1
LG&E	C1SR	893347	05/2014	05/23/2014	100.100	99.920	100.0	1
LG&E	C1SR	893348	05/2014	05/23/2014	100.040	99.880	100.0	1
LG&E	C1SR	893349	05/2014	05/23/2014	100.070	99.880	99.9	1
LG&E	C1SR	893350	05/2014	05/23/2014	100.070	99.880	100.0	1
LG&E	C1SR	893351	05/2014	05/23/2014	100.060	99.900	99.9	1
LG&E	C1SR	893352	05/2014	05/23/2014	100.080	99.900	100.0	1
LG&E	C1SR	893353	05/2014	05/23/2014	100.080	99.970	100.0	1
LG&E	C1SR	893354	05/2014	05/23/2014	100.060	99.860	99.9	1
LG&E	C1SR	893355	05/2014	05/23/2014	100.040	99.900	100.0	1
LG&E	C1SR	893356	05/2014	05/23/2014	100.070	99.960	100.0	1
LG&E	C1SR	893357	05/2014	05/23/2014	100.060	99.890	99.9	1
LG&E	C1SR	893358	05/2014	05/23/2014	100.080	99.880	100.0	1
LG&E	C1SR	893359	05/2014	05/23/2014	100.050	99.900	99.9	1
LG&E	C1SR	893360	05/2014	05/23/2014	100.050	99.900	99.9	1
LG&E	C1SR	893361	05/2014	05/23/2014	100.100	99.980	100.1	1
LG&E	C1SR	893362	05/2014	05/23/2014	100.050	99.900	100.0	1
LG&E	C1SR	893363	05/2014	05/23/2014	100.030	99.820	100.0	1
LG&E	C1SR	893364	05/2014	05/23/2014	100.070	99.930	100.0	1
LG&E	C1SR	893365	05/2014	05/23/2014	100.090	99.950	100.0	1

LG&E	C1SR	893366	05/2014	05/23/2014	100.100	99.950	100.1	1
LG&E	C1SR	893367	05/2014	05/23/2014	100.060	99.890	100.0	1
LG&E	C1SR	893368	05/2014	05/23/2014	100.070	99.920	100.0	1
LG&E	C1SR	893369	05/2014	05/23/2014	100.080	99.910	100.0	1
LG&E	C1SR	893370	05/2014	05/23/2014	100.080	99.900	100.0	1
LG&E	C1SR	893371	05/2014	05/23/2014	100.090	99.910	100.0	1
LG&E	C1SR	893372	05/2014	05/23/2014	100.100	99.960	99.9	1
LG&E	C1SR	893373	05/2014	05/23/2014	100.050	99.880	99.9	1
LG&E	C1SR	893374	05/2014	05/23/2014	100.100	99.950	100.0	1
LG&E	C1SR	893375	05/2014	05/23/2014	100.060	99.880	100.1	1
LG&E	C1SR	893376	05/2014	05/23/2014	100.070	99.970	100.0	1
LG&E	C1SR	893377	05/2014	05/23/2014	100.090	99.930	100.0	1
LG&E	C1SR	893378	05/2014	05/23/2014	100.090	99.890	100.1	1
LG&E	C1SR	893379	05/2014	05/23/2014	100.070	99.950	100.0	1
LG&E	C1SR	893380	05/2014	05/23/2014	100.060	99.870	100.0	1
LG&E	C1SR	893381	05/2014	05/23/2014	100.050	99.900	100.0	1
LG&E	C1SR	893382	05/2014	05/23/2014	100.070	99.920	100.0	1
LG&E	C1SR	893383	05/2014	05/23/2014	100.030	99.910	100.0	1
LG&E	C1SR	893384	05/2014	05/23/2014	100.070	99.890	100.0	1
LG&E	C1SR	893385	05/2014	05/23/2014	100.060	99.930	100.0	1
LG&E	C1SR	893386	05/2014	05/23/2014	100.100	99.940	100.0	1
LG&E	C1SR	893387	05/2014	05/23/2014	100.060	99.920	100.0	1
LG&E	C1SR	893388	05/2014	05/23/2014	100.080	99.970	100.1	1
LG&E	C1SR	893389	05/2014	05/23/2014	100.050	99.850	99.9	1
LG&E	C1SR	893390	05/2014	05/23/2014	100.090	99.920	100.0	1
LG&E	C1SR	893391	05/2014	05/23/2014	100.040	99.850	100.0	1
LG&E	C1SR	893392	05/2014	05/23/2014	100.040	99.890	99.9	1
LG&E	C1SR	893393	05/2014	05/23/2014	100.070	99.930	100.0	1
LG&E	C1SR	893394	05/2014	05/23/2014	100.060	99.960	100.1	1
LG&E	C1SR	893395	05/2014	05/23/2014	100.030	99.900	100.0	1
LG&E	C1SR	893396	05/2014	05/23/2014	100.090	99.950	100.0	1
LG&E	C1SR	893397	05/2014	05/23/2014	100.110	99.950	100.0	1

LG&E	C1SR	893398	05/2014	05/23/2014	100.070	99.880	100.0	1
LG&E	C1SR	893399	05/2014	05/23/2014	100.080	99.940	100.1	1
LG&E	C1SR	893400	05/2014	05/23/2014	100.080	99.890	100.0	1
LG&E	C1SR	893401	05/2014	05/23/2014	100.040	99.880	99.9	1
LG&E	C1SR	893402	05/2014	05/23/2014	100.080	99.960	100.0	1
LG&E	C1SR	893403	05/2014	05/23/2014	100.080	99.930	100.0	1
LG&E	C1SR	893404	05/2014	05/23/2014	100.100	99.860	100.0	1
LG&E	C1SR	893405	05/2014	05/23/2014	100.060	99.880	100.1	1
LG&E	C1SR	893406	05/2014	05/23/2014	100.050	99.900	100.0	1
LG&E	C1SR	893407	05/2014	05/23/2014	100.090	99.930	100.0	1
LG&E	C1SR	893408	05/2014	05/23/2014	100.070	99.930	100.0	1
LG&E	C1SR	893409	05/2014	05/23/2014	100.090	99.940	100.0	1
LG&E	C1SR	893410	05/2014	05/23/2014	100.090	99.860	99.9	1
LG&E	C1SR	893411	05/2014	05/23/2014	100.070	99.840	100.0	1
LG&E	C1SR	893412	05/2014	05/23/2014	100.060	99.920	99.9	1
LG&E	C1SR	893413	05/2014	05/23/2014	100.070	99.960	99.9	1
LG&E	C1SR	893414	05/2014	05/23/2014	100.050	99.960	100.0	1
LG&E	C1SR	893415	05/2014	05/23/2014	100.100	99.960	99.9	1
LG&E	C1SR	893416	05/2014	05/23/2014	100.070	99.890	100.0	1
LG&E	C1SR	893417	05/2014	05/23/2014	100.040	99.870	99.9	1
LG&E	C1SR	893418	05/2014	05/23/2014	100.070	99.920	100.1	1
LG&E	C1SR	893419	05/2014	05/23/2014	100.060	99.960	99.9	1
LG&E	C1SR	893420	05/2014	05/23/2014	100.100	99.880	100.2	1
LG&E	C1SR	893421	05/2014	05/23/2014	100.070	99.900	100.0	1
LG&E	C1SR	893422	05/2014	05/23/2014	100.050	99.860	99.9	1
LG&E	C1SR	893423	05/2014	05/23/2014	100.080	99.920	100.0	1
LG&E	C1SR	893424	05/2014	05/23/2014	100.060	99.920	99.9	1
LG&E	C1SR	893425	05/2014	05/23/2014	100.050	99.860	100.0	1
LG&E	C1SR	893426	05/2014	05/23/2014	100.050	99.900	99.9	1
LG&E	C1SR	893427	05/2014	05/23/2014	100.060	99.990	100.0	1
LG&E	C1SR	893428	05/2014	05/23/2014	100.060	99.870	100.0	1
LG&E	C1SR	893429	05/2014	05/23/2014	100.040	99.860	100.0	1

LG&E	C1SR	893430	05/2014	05/23/2014	100.040	99.850	99.9	1
LG&E	C1SR	893431	05/2014	05/23/2014	100.100	99.890	100.0	1
LG&E	C1SR	893432	05/2014	05/23/2014	100.060	99.990	99.9	1
LG&E	C1SR	893433	05/2014	05/23/2014	100.050	99.860	99.9	1
LG&E	C1SR	893434	05/2014	05/23/2014	100.060	99.890	100.0	1
LG&E	C1SR	893435	05/2014	05/23/2014	100.060	99.860	100.0	1
LG&E	C1SR	893436	05/2014	05/23/2014	100.100	99.970	100.0	1
LG&E	C1SR	893437	05/2014	05/23/2014	100.050	99.890	100.0	1
LG&E	C1SR	893438	05/2014	05/23/2014	100.100	99.910	100.0	1
LG&E	C1SR	893439	05/2014	05/23/2014	100.070	99.900	100.0	1
LG&E	C1SR	893440	05/2014	05/23/2014	100.080	99.860	99.9	1
LG&E	C1SR	893441	05/2014	05/23/2014	100.030	99.900	99.9	1
LG&E	C1SR	893442	05/2014	05/23/2014	100.090	99.900	100.1	1
LG&E	C1SR	893443	05/2014	05/23/2014	100.060	99.860	100.0	1
LG&E	C1SR	893444	05/2014	05/23/2014	100.080	99.960	100.0	1
LG&E	C1SR	893445	05/2014	05/23/2014	100.090	99.910	100.0	1
LG&E	C1SR	893446	05/2014	05/23/2014	100.060	99.820	99.9	1
LG&E	C1SR	893447	05/2014	05/23/2014	100.080	99.950	100.0	1
LG&E	C1SR	893448	05/2014	05/23/2014	100.080	99.950	100.0	1
LG&E	C1SR	893449	05/2014	05/23/2014	100.070	99.900	99.9	1
LG&E	C1SR	893450	05/2014	05/23/2014	100.030	99.860	100.0	1
LG&E	C1SR	893451	05/2014	05/23/2014	100.090	99.900	100.1	1
LG&E	C1SR	893452	05/2014	05/23/2014	100.070	99.870	100.0	1
LG&E	C1SR	893453	05/2014	05/23/2014	100.100	99.950	100.0	1
LG&E	C1SR	893454	05/2014	05/23/2014	100.070	99.880	99.9	1
LG&E	C1SR	893455	05/2014	05/23/2014	100.070	99.910	100.0	1
LG&E	C1SR	893456	05/2014	05/23/2014	100.100	99.970	100.0	1
LG&E	C1SR	893457	05/2014	05/23/2014	100.050	99.890	100.0	1
LG&E	C1SR	893458	05/2014	05/23/2014	100.090	99.930	100.0	1
LG&E	C1SR	893459	05/2014	05/23/2014	100.090	99.950	100.0	1
LG&E	C1SR	893460	05/2014	05/23/2014	100.080	99.940	100.1	1
LG&E	C1SR	893461	05/2014	05/23/2014	100.050	99.870	100.0	1

LG&E	C1SR	893462	05/2014	05/23/2014	100.090	99.950	100.0	1
LG&E	C1SR	893463	05/2014	05/23/2014	100.060	99.910	100.0	1
LG&E	C1SR	893464	05/2014	05/23/2014	100.080	99.940	99.9	1
LG&E	C1SR	893465	05/2014	05/23/2014	100.100	99.860	100.0	1
LG&E	C1SR	893466	05/2014	05/23/2014	100.090	99.880	100.0	1
LG&E	C1SR	893467	05/2014	05/23/2014	100.060	99.880	100.0	1
LG&E	C1SR	893468	05/2014	05/23/2014	100.040	99.930	100.0	1
LG&E	C1SR	893469	05/2014	05/23/2014	100.060	99.930	99.9	1
LG&E	C1SR	893470	05/2014	05/23/2014	100.060	99.940	100.0	1
LG&E	C1SR	893471	05/2014	05/23/2014	100.080	99.900	100.0	1
LG&E	C1SR	893472	05/2014	05/23/2014	100.100	99.870	100.0	1
LG&E	C1SR	893473	05/2014	05/23/2014	100.090	99.950	100.0	1
LG&E	C1SR	893474	05/2014	05/23/2014	100.090	99.930	100.0	1
LG&E	C1SR	893475	05/2014	05/23/2014	100.100	99.970	100.1	1
LG&E	C1SR	893476	05/2014	05/23/2014	100.040	99.840	99.9	1
LG&E	C1SR	893477	05/2014	05/23/2014	100.050	99.880	100.0	1
LG&E	C1SR	893478	05/2014	05/23/2014	100.090	99.980	100.0	1
LG&E	C1SR	893479	05/2014	05/23/2014	100.090	99.920	100.1	1
LG&E	C1SR	893480	05/2014	05/23/2014	100.100	99.950	100.0	1
LG&E	C1SR	893481	05/2014	05/23/2014	100.080	99.890	99.9	1
LG&E	C1SR	893482	05/2014	05/23/2014	100.050	99.870	100.0	1
LG&E	C1SR	893483	05/2014	05/23/2014	100.070	99.940	100.0	1
LG&E	C1SR	893484	05/2014	05/23/2014	100.090	99.970	100.0	1
LG&E	C1SR	893485	05/2014	05/23/2014	100.100	99.990	100.1	1
LG&E	C1SR	893486	05/2014	05/23/2014	100.100	99.950	99.9	1
LG&E	C1SR	893487	05/2014	05/23/2014	100.060	99.920	100.0	1
LG&E	C1SR	893488	05/2014	05/23/2014	100.050	99.910	100.0	1
LG&E	C1SR	893489	05/2014	05/23/2014	100.060	99.910	100.0	1
LG&E	C1SR	893490	05/2014	05/23/2014	100.100	99.910	100.1	1
LG&E	C1SR	893491	05/2014	05/23/2014	100.090	99.990	100.0	1
LG&E	C1SR	893492	05/2014	05/23/2014	100.050	99.920	100.0	1
LG&E	C1SR	893493	05/2014	05/23/2014	100.070	99.840	99.9	1

LG&E	C1SR	893494	05/2014	05/23/2014	100.080	99.950	99.9	1
LG&E	C1SR	893495	05/2014	05/23/2014	100.050	99.920	100.0	1
LG&E	C1SR	893496	05/2014	05/23/2014	100.100	99.930	100.0	1
LG&E	C1SR	893497	05/2014	05/23/2014	100.080	99.970	100.0	1
LG&E	C1SR	893498	05/2014	05/23/2014	100.100	99.940	99.9	1
LG&E	C1SR	893499	05/2014	05/23/2014	100.100	99.870	100.0	1
LG&E	C1SR	893500	05/2014	05/23/2014	100.060	99.860	100.0	1
LG&E	C1SR	893501	05/2014	05/23/2014	100.090	99.910	100.0	1
LG&E	C1SR	893502	05/2014	05/23/2014	100.080	99.850	100.0	1
LG&E	C1SR	893503	05/2014	05/23/2014	100.070	99.860	100.0	1
LG&E	C1SR	893504	05/2014	05/23/2014	100.050	99.870	99.9	1
LG&E	C1SR	893505	05/2014	05/23/2014	100.080	99.950	100.0	1
LG&E	C1SR	893506	05/2014	05/23/2014	100.040	99.840	100.0	1
LG&E	C1SR	893507	05/2014	05/23/2014	100.070	99.950	100.1	1
LG&E	C1SR	893508	05/2014	05/23/2014	100.050	99.940	99.9	1
LG&E	C1SR	893509	05/2014	05/23/2014	100.050	99.850	99.9	1
LG&E	C1SR	893510	05/2014	05/23/2014	100.050	99.870	99.9	1
LG&E	C1SR	893511	05/2014	05/23/2014	100.050	99.920	100.0	1
LG&E	C1SR	893512	05/2014	05/23/2014	100.100	99.940	100.0	1
LG&E	C1SR	893513	05/2014	05/23/2014	100.080	99.940	100.1	1
LG&E	C1SR	893514	05/2014	05/23/2014	100.090	99.940	100.1	1
LG&E	C1SR	893515	05/2014	05/23/2014	100.070	99.920	100.0	1
LG&E	C1SR	893516	05/2014	05/23/2014	100.070	99.920	99.9	1
LG&E	C1SR	893517	05/2014	05/23/2014	100.060	99.900	100.0	1
LG&E	C1SR	893518	05/2014	05/23/2014	100.060	99.970	100.0	1
LG&E	C1SR	893519	05/2014	05/23/2014	100.060	99.920	100.1	1
LG&E	C1SR	893520	05/2014	05/23/2014	100.070	99.920	99.9	1
LG&E	C1SR	893521	05/2014	05/23/2014	100.100	99.960	100.0	1
LG&E	C1SR	893522	05/2014	05/23/2014	100.050	99.930	99.9	1
LG&E	C1SR	893523	05/2014	05/23/2014	100.070	99.930	100.0	1
LG&E	C1SR	893524	05/2014	05/23/2014	100.070	99.890	100.1	1
LG&E	C1SR	893525	05/2014	05/23/2014	100.070	99.910	99.9	1

LG&E	C1SR	893526	05/2014	05/23/2014	100.080	99.940	100.0	1
LG&E	C1SR	893527	05/2014	05/23/2014	100.030	99.900	99.9	1
LG&E	C1SR	893528	05/2014	05/23/2014	100.080	99.880	100.0	1
LG&E	C1SR	893529	05/2014	05/23/2014	100.040	99.990	100.0	1
LG&E	C1SR	893530	05/2014	05/23/2014	100.070	99.960	100.0	1
LG&E	C1SR	893531	05/2014	05/23/2014	100.070	99.920	100.0	1
LG&E	C1SR	893532	05/2014	05/23/2014	100.080	99.960	100.0	1
LG&E	C1SR	893533	05/2014	05/23/2014	100.100	99.970	100.0	1
LG&E	C1SR	893534	05/2014	05/23/2014	100.060	99.860	99.9	1
LG&E	C1SR	893535	05/2014	05/23/2014	100.110	99.980	100.0	1
LG&E	C1SR	893536	05/2014	05/23/2014	100.030	99.880	99.9	1
LG&E	C1SR	893537	05/2014	05/23/2014	100.100	99.970	100.1	1
LG&E	C1SR	893538	05/2014	05/23/2014	100.060	99.930	100.0	1
LG&E	C1SR	893539	05/2014	05/23/2014	100.080	99.900	100.0	1
LG&E	C1SR	893540	05/2014	05/23/2014	100.100	99.980	100.0	1
LG&E	C1SR	893541	05/2014	05/23/2014	100.070	99.880	100.0	1
LG&E	C1SR	893542	05/2014	05/23/2014	100.080	99.950	100.0	1
LG&E	C1SR	893543	05/2014	05/23/2014	100.030	99.840	99.9	1
LG&E	C1SR	893544	05/2014	05/23/2014	100.100	99.930	100.2	1
LG&E	C1SR	893545	05/2014	05/23/2014	100.060	99.930	100.0	1
LG&E	C1SR	893546	05/2014	05/23/2014	100.100	100.020	100.0	1
LG&E	C1SR	893547	05/2014	05/23/2014	100.080	99.880	100.0	1
LG&E	C1SR	893548	05/2014	05/23/2014	100.080	99.900	99.9	1
LG&E	C1SR	893549	05/2014	05/23/2014	100.090	99.980	100.0	1
LG&E	C1SR	893550	05/2014	05/23/2014	100.100	99.920	100.0	1
LG&E	C1SR	893551	05/2014	05/23/2014	100.070	99.960	100.0	1
LG&E	C1SR	893552	05/2014	05/23/2014	100.080	99.970	100.0	1
LG&E	C1SR	893553	05/2014	05/23/2014	100.050	99.850	100.0	1
LG&E	C1SR	893554	05/2014	05/23/2014	100.100	99.870	99.9	1
LG&E	C1SR	893555	05/2014	05/23/2014	100.070	99.970	100.0	1
LG&E	C1SR	893556	05/2014	05/23/2014	100.060	99.880	99.9	1
LG&E	C1SR	893557	05/2014	05/23/2014	100.080	99.870	100.0	1

LG&E	C1SR	893558	05/2014	05/23/2014	100.100	99.960	100.0	1
LG&E	C1SR	893559	05/2014	05/23/2014	100.080	99.940	100.0	1
LG&E	C1SR	893560	05/2014	05/23/2014	100.100	99.990	100.1	1
LG&E	C1SR	893561	05/2014	05/23/2014	100.100	99.960	100.0	1
LG&E	C1SR	893562	05/2014	05/23/2014	100.060	99.860	99.9	1
LG&E	C1SR	893563	05/2014	05/23/2014	100.060	99.950	100.0	1
LG&E	C1SR	893564	05/2014	05/23/2014	100.060	99.920	100.0	1
LG&E	C1SR	893565	05/2014	05/23/2014	100.070	99.900	99.9	1
LG&E	C1SR	893566	05/2014	05/23/2014	100.080	99.900	100.0	1
LG&E	C1SR	893567	05/2014	05/23/2014	100.060	99.850	100.0	1
LG&E	C1SR	893568	05/2014	05/23/2014	100.040	99.860	100.0	1
LG&E	C1SR	893569	05/2014	05/23/2014	100.030	99.840	99.9	1
LG&E	C1SR	893570	05/2014	05/23/2014	100.090	99.830	100.1	1
LG&E	C1SR	893571	05/2014	05/23/2014	100.070	99.940	99.9	1
LG&E	C1SR	893572	05/2014	05/23/2014	100.060	99.920	99.9	1
LG&E	C1SR	893573	05/2014	05/23/2014	100.110	99.970	100.0	1
LG&E	C1SR	893574	05/2014	05/23/2014	100.070	99.900	100.0	1
LG&E	C1SR	893575	05/2014	05/23/2014	100.070	99.920	100.0	1
LG&E	C1SR	893576	05/2014	05/23/2014	100.070	99.920	100.0	1
LG&E	C1SR	893577	05/2014	05/23/2014	100.080	99.910	100.0	1
LG&E	C1SR	893578	05/2014	05/23/2014	100.100	99.870	100.0	1
LG&E	C1SR	893579	05/2014	05/23/2014	100.100	99.880	100.0	1
LG&E	C1SR	893580	05/2014	05/23/2014	100.070	99.940	100.0	1
LG&E	C1SR	893581	05/2014	05/23/2014	100.100	99.900	100.1	1
LG&E	C1SR	893582	05/2014	05/23/2014	100.060	99.910	100.0	1
LG&E	C1SR	893583	05/2014	05/23/2014	100.040	100.000	100.0	1
LG&E	C1SR	893584	05/2014	05/23/2014	100.070	99.920	100.0	1
LG&E	C1SR	893585	05/2014	05/23/2014	100.090	99.940	100.0	1
LG&E	C1SR	893586	05/2014	05/23/2014	100.100	99.960	100.1	1
LG&E	C1SR	893587	05/2014	05/23/2014	100.030	99.910	100.0	1
LG&E	C1SR	893588	05/2014	05/23/2014	100.050	99.830	100.1	1
LG&E	C1SR	893589	05/2014	05/23/2014	100.090	99.960	100.0	1

LG&E	C1SR	893590	05/2014	05/23/2014	100.100	99.960	100.1	1
LG&E	C1SR	893591	05/2014	05/23/2014	100.070	99.920	100.0	1
LG&E	C1SR	893592	05/2014	05/23/2014	100.090	99.850	100.0	1
LG&E	C1SR	893593	05/2014	05/23/2014	100.080	99.880	100.0	1
LG&E	C1SR	893594	05/2014	05/23/2014	100.070	99.900	99.9	1
LG&E	C1SR	893595	05/2014	05/23/2014	100.110	99.920	100.1	1
LG&E	C1SR	893596	05/2014	05/23/2014	100.050	99.860	100.0	1
LG&E	C1SR	893597	05/2014	05/23/2014	100.090	99.920	100.0	1
LG&E	C1SR	893598	05/2014	05/23/2014	100.090	99.990	100.0	1
LG&E	C1SR	893599	05/2014	05/23/2014	100.090	99.930	100.1	1
LG&E	C1SR	893600	05/2014	05/23/2014	100.080	99.920	100.0	1
LG&E	C1SR	893601	05/2014	05/23/2014	100.040	99.870	99.9	1
LG&E	C1SR	893602	05/2014	05/23/2014	100.080	99.900	100.1	1
LG&E	C1SR	893603	05/2014	05/23/2014	100.090	99.960	100.0	1
LG&E	C1SR	893604	05/2014	05/23/2014	100.080	99.870	100.0	1
LG&E	C1SR	893605	05/2014	05/23/2014	100.070	99.870	100.1	1
LG&E	C1SR	893606	05/2014	05/23/2014	100.060	99.880	99.9	1
LG&E	C1SR	893607	05/2014	05/23/2014	100.060	99.930	100.0	1
LG&E	C1SR	893608	05/2014	05/23/2014	100.030	99.850	99.9	1
LG&E	C1SR	893609	05/2014	05/23/2014	100.060	99.910	100.0	1
LG&E	C1SR	893610	05/2014	05/23/2014	100.070	100.000	99.9	1
LG&E	C1SR	893611	05/2014	05/23/2014	100.090	99.980	100.0	1
LG&E	C1SR	893612	05/2014	05/23/2014	100.060	99.930	100.1	1
LG&E	C1SR	893613	05/2014	05/23/2014	100.100	99.980	100.1	1
LG&E	C1SR	893614	05/2014	05/23/2014	100.070	99.930	99.9	1
LG&E	C1SR	893615	05/2014	05/23/2014	100.080	99.920	100.0	1
LG&E	C1SR	893616	05/2014	05/23/2014	100.060	99.880	100.0	1
LG&E	C1SR	893617	05/2014	05/23/2014	100.060	99.890	100.0	1
LG&E	C1SR	893618	05/2014	05/23/2014	100.060	99.880	100.0	1
LG&E	C1SR	893619	05/2014	05/23/2014	100.090	99.860	100.0	1
LG&E	C1SR	893620	05/2014	05/23/2014	100.080	99.870	100.0	1
LG&E	C1SR	893621	05/2014	05/23/2014	100.070	99.930	100.1	1

LG&E	C1SR	893622	05/2014	05/23/2014	100.080	99.930	99.9	1
LG&E	C1SR	893623	05/2014	05/23/2014	100.030	99.840	100.0	1
LG&E	C1SR	893624	05/2014	05/23/2014	100.060	99.890	100.0	1
LG&E	C1SR	893625	05/2014	05/23/2014	100.060	99.870	100.0	1
LG&E	C1SR	893626	05/2014	05/23/2014	100.080	99.890	100.0	1
LG&E	C1SR	893627	05/2014	05/23/2014	100.060	99.940	99.9	1
LG&E	C1SR	893628	05/2014	05/23/2014	100.050	99.920	100.0	1
LG&E	C1SR	893629	05/2014	05/23/2014	100.060	99.880	100.0	1
LG&E	C1SR	893630	05/2014	05/23/2014	100.090	99.990	100.0	1
LG&E	C1SR	893631	05/2014	05/23/2014	100.070	99.930	100.0	1
LG&E	C1SR	893632	05/2014	05/23/2014	100.080	99.880	100.0	1
LG&E	C1SR	893633	05/2014	05/23/2014	100.060	99.900	100.1	1
LG&E	C1SR	893634	05/2014	05/23/2014	100.090	99.900	100.1	1
LG&E	C1SR	893635	05/2014	05/23/2014	100.080	99.930	99.9	1
LG&E	C1SR	893636	05/2014	05/23/2014	100.100	99.980	100.0	1
LG&E	C1SR	893637	05/2014	05/23/2014	100.050	99.910	100.0	1
LG&E	C1SR	893638	05/2014	05/23/2014	100.100	99.910	100.2	1
LG&E	C1SR	893639	05/2014	05/23/2014	100.090	99.910	100.1	1
LG&E	C1SR	893640	05/2014	05/23/2014	100.080	99.950	100.0	1
LG&E	C1SR	893641	05/2014	05/23/2014	100.080	99.970	100.0	1
LG&E	C1SR	893642	05/2014	05/23/2014	100.060	99.870	100.0	1
LG&E	C1SR	893643	05/2014	05/23/2014	100.060	99.880	100.0	1
LG&E	C1SR	893644	05/2014	05/23/2014	100.070	99.930	100.0	1
LG&E	C1SR	893645	05/2014	05/23/2014	100.100	99.910	100.1	1
LG&E	C1SR	893646	05/2014	05/23/2014	100.090	99.890	100.1	1
LG&E	C1SR	893647	05/2014	05/23/2014	100.060	99.930	100.0	1
LG&E	C1SR	893648	05/2014	05/23/2014	100.110	99.880	100.0	1
LG&E	C1SR	893649	05/2014	05/23/2014	100.050	99.880	100.0	1
LG&E	C1SR	893650	05/2014	05/23/2014	100.090	99.920	100.0	1
LG&E	C1SR	893651	05/2014	05/23/2014	100.090	99.930	99.9	1
LG&E	C1SR	893652	05/2014	05/23/2014	100.030	99.820	99.9	1
LG&E	C1SR	893653	05/2014	05/23/2014	100.090	99.960	100.0	1

LG&E	C1SR	893654	05/2014	05/23/2014	100.070	99.930	99.9	1
LG&E	C1SR	893655	05/2014	05/23/2014	100.030	99.890	100.0	1
LG&E	C1SR	893656	05/2014	05/23/2014	100.100	99.960	99.9	1
LG&E	C1SR	893657	05/2014	05/23/2014	100.080	99.910	100.0	1
LG&E	C1SR	893658	05/2014	05/23/2014	100.090	99.880	99.9	1
LG&E	C1SR	893659	05/2014	05/23/2014	100.080	99.970	100.0	1
LG&E	C1SR	893660	05/2014	05/23/2014	100.080	99.890	100.0	1
LG&E	C1SR	893661	05/2014	05/23/2014	100.080	99.920	100.0	1
LG&E	C1SR	893662	05/2014	05/23/2014	100.080	99.860	100.0	1
LG&E	C1SR	893663	05/2014	05/23/2014	100.080	100.020	100.1	1
LG&E	C1SR	893664	05/2014	05/23/2014	100.060	99.860	100.0	1
LG&E	C1SR	893665	05/2014	05/23/2014	100.050	99.890	99.9	1
LG&E	C1SR	893666	05/2014	05/23/2014	100.100	100.000	100.0	1
LG&E	C1SR	893667	05/2014	05/23/2014	100.090	99.980	100.0	1
LG&E	C1SR	893668	05/2014	05/23/2014	100.060	99.880	99.9	1
LG&E	C1SR	893669	05/2014	05/23/2014	100.100	99.930	100.1	1
LG&E	C1SR	893670	05/2014	05/23/2014	100.090	99.900	100.0	1
LG&E	C1SR	893671	05/2014	05/23/2014	100.070	99.960	100.1	1
LG&E	C1SR	893672	05/2014	05/23/2014	100.090	99.970	100.0	1
LG&E	C1SR	893673	05/2014	05/23/2014	100.080	99.940	100.1	1
LG&E	C1SR	893674	05/2014	05/23/2014	100.080	99.870	100.2	1
LG&E	C1SR	893675	05/2014	05/23/2014	100.090	99.960	99.9	1
LG&E	C1SR	893676	05/2014	05/23/2014	100.090	99.940	100.1	1
LG&E	C1SR	893677	05/2014	05/23/2014	100.070	99.870	100.0	1
LG&E	C1SR	893678	05/2014	05/23/2014	100.070	99.910	99.9	1
LG&E	C1SR	893679	05/2014	05/23/2014	100.080	99.850	100.1	1
LG&E	C1SR	893680	05/2014	05/23/2014	100.050	99.890	100.0	1
LG&E	C1SR	893681	05/2014	05/23/2014	100.110	99.920	100.1	1
LG&E	C1SR	893682	05/2014	05/23/2014	100.050	99.830	99.9	1
LG&E	C1SR	893683	05/2014	05/23/2014	100.070	99.900	100.0	1
LG&E	C1SR	893684	05/2014	05/23/2014	100.090	99.900	100.0	1
LG&E	C1SR	893685	05/2014	05/23/2014	100.090	99.980	100.1	1

LG&E	C1SR	893686	05/2014	05/23/2014	100.080	99.920	100.0	1
LG&E	C1SR	893687	05/2014	05/23/2014	100.060	99.900	100.0	1
LG&E	C1SR	893688	05/2014	05/23/2014	100.050	99.850	100.0	1
LG&E	C1SR	893689	05/2014	05/23/2014	100.100	99.920	100.1	1
LG&E	C1SR	893690	05/2014	05/23/2014	100.070	99.870	100.0	1
LG&E	C1SR	893691	05/2014	05/23/2014	100.100	99.970	100.0	1
LG&E	C1SR	893692	05/2014	05/23/2014	100.060	99.870	100.0	1
LG&E	C1SR	893693	05/2014	05/23/2014	100.070	99.860	100.0	1
LG&E	C1SR	893694	05/2014	05/23/2014	100.040	99.980	100.0	1
LG&E	C1SR	893695	05/2014	05/23/2014	100.080	99.980	100.0	1
LG&E	C1SR	893696	05/2014	05/23/2014	100.100	99.950	100.1	1
LG&E	C1SR	893697	05/2014	05/23/2014	100.080	99.940	100.0	1
LG&E	C1SR	893698	05/2014	05/23/2014	100.070	99.930	99.9	1
LG&E	C1SR	893699	05/2014	05/23/2014	100.050	99.900	100.0	1
LG&E	C1SR	893700	05/2014	05/23/2014	100.060	99.930	100.0	1
LG&E	C1SR	893701	05/2014	05/23/2014	100.100	99.960	100.0	1
LG&E	C1SR	893702	05/2014	05/23/2014	100.070	99.940	100.0	1
LG&E	C1SR	893703	05/2014	05/23/2014	100.070	99.930	100.1	1
LG&E	C1SR	893704	05/2014	05/23/2014	100.100	99.950	100.0	1
LG&E	C1SR	893705	05/2014	05/23/2014	100.070	99.930	100.0	1
LG&E	C1SR	893706	05/2014	05/23/2014	100.080	99.900	100.0	1
LG&E	C1SR	893707	05/2014	05/23/2014	100.060	99.910	100.0	1
LG&E	C1SR	893708	05/2014	05/23/2014	100.080	99.970	100.0	1
LG&E	C1SR	893709	05/2014	05/23/2014	100.080	99.980	100.0	1
LG&E	C1SR	893710	05/2014	05/23/2014	100.090	99.980	100.1	1
LG&E	C1SR	893711	05/2014	05/23/2014	100.060	99.870	100.0	1
LG&E	C1SR	893712	05/2014	05/23/2014	100.100	99.940	100.0	1
LG&E	C1SR	893713	05/2014	05/23/2014	100.070	99.960	100.0	1
LG&E	C1SR	893714	05/2014	05/23/2014	100.080	99.840	100.0	1
LG&E	C1SR	893715	05/2014	05/23/2014	100.100	99.920	100.0	1
LG&E	C1SR	893716	05/2014	05/23/2014	100.100	99.870	99.9	1
LG&E	C1SR	893717	05/2014	05/23/2014	100.060	99.890	100.0	1

LG&E	C1SR	893718	05/2014	05/23/2014	100.060	99.950	100.1	1
LG&E	C1SR	893719	05/2014	05/23/2014	100.070	99.870	99.9	1
LG&E	C1SR	893720	05/2014	05/23/2014	100.070	99.920	100.0	1
LG&E	C1SR	893721	05/2014	05/23/2014	100.090	99.930	99.9	1
LG&E	C1SR	893722	05/2014	05/23/2014	100.060	99.920	99.9	1
LG&E	C1SR	893723	05/2014	05/23/2014	100.090	99.890	100.1	1
LG&E	C1SR	893724	05/2014	05/23/2014	100.090	99.900	100.0	1
LG&E	C1SR	893725	05/2014	05/23/2014	100.060	99.900	100.0	1
LG&E	C1SR	893726	05/2014	05/23/2014	100.100	99.990	99.9	1
LG&E	C1SR	893727	05/2014	05/23/2014	100.070	100.000	100.0	1
LG&E	C1SR	893728	05/2014	05/23/2014	100.090	99.980	100.0	1
LG&E	C1SR	893729	05/2014	05/23/2014	100.060	99.890	99.9	1
LG&E	C1SR	893730	05/2014	05/23/2014	100.090	100.010	100.0	1
LG&E	C1SR	893731	05/2014	05/23/2014	100.030	99.860	100.0	1
LG&E	C1SR	893732	05/2014	05/23/2014	100.050	99.880	99.9	1
LG&E	C1SR	893733	05/2014	05/23/2014	100.080	99.970	100.0	1
LG&E	C1SR	893734	05/2014	05/23/2014	100.070	99.890	99.9	1
LG&E	C1SR	893735	05/2014	05/23/2014	100.070	99.970	100.1	1
LG&E	C1SR	893736	05/2014	05/23/2014	100.060	99.910	100.0	1
LG&E	C1SR	893737	05/2014	05/23/2014	100.030	99.880	100.0	1
LG&E	C1SR	893738	05/2014	05/23/2014	100.090	99.960	100.0	1
LG&E	C1SR	893739	05/2014	05/23/2014	100.090	99.900	100.1	1
LG&E	C1SR	893740	05/2014	05/23/2014	100.050	99.900	100.1	1
LG&E	C1SR	893741	05/2014	05/23/2014	100.050	99.920	100.0	1
LG&E	C1SR	893742	05/2014	05/23/2014	100.100	99.910	100.0	1
LG&E	C1SR	893743	05/2014	05/23/2014	100.090	99.970	99.9	1
LG&E	C1SR	893744	05/2014	05/23/2014	100.070	99.860	100.1	1
LG&E	C1SR	893745	05/2014	05/23/2014	100.050	99.850	100.0	1
LG&E	C1SR	893746	05/2014	05/23/2014	100.050	99.880	99.9	1
LG&E	C1SR	893747	05/2014	05/23/2014	100.070	99.820	100.0	1
LG&E	C1SR	893748	05/2014	05/23/2014	100.050	99.920	100.0	1
LG&E	C1SR	893749	05/2014	05/23/2014	100.070	99.930	100.0	1

LG&E	C1SR	893750	05/2014	05/23/2014	100.050	99.890	100.0	1
LG&E	C1SR	893751	05/2014	05/23/2014	100.110	99.930	100.0	1
LG&E	C1SR	893752	05/2014	05/23/2014	100.060	99.880	100.0	1
LG&E	C1SR	893753	05/2014	05/23/2014	100.080	100.010	100.0	1
LG&E	C1SR	893754	05/2014	05/23/2014	100.070	99.920	100.0	1
LG&E	C1SR	893755	05/2014	05/23/2014	100.080	99.910	100.0	1
LG&E	C1SR	893756	05/2014	05/23/2014	100.050	99.880	100.0	1
LG&E	C1SR	893757	05/2014	05/23/2014	100.030	99.870	99.9	1
LG&E	C1SR	893758	05/2014	05/23/2014	100.060	99.860	100.0	1
LG&E	C1SR	893759	05/2014	05/23/2014	100.040	99.860	99.9	1
LG&E	C1SR	893760	05/2014	05/23/2014	100.030	99.910	100.0	1
LG&E	C1SR	893761	05/2014	05/23/2014	100.060	99.960	99.9	1
LG&E	C1SR	893762	05/2014	05/23/2014	100.090	99.940	100.0	1
LG&E	C1SR	893763	05/2014	05/23/2014	100.090	99.930	99.9	1
LG&E	C1SR	893764	05/2014	05/23/2014	100.060	99.890	100.0	1
LG&E	C1SR	893765	05/2014	05/23/2014	100.060	99.960	100.0	1
LG&E	C1SR	893766	05/2014	05/23/2014	100.050	99.850	99.9	1
LG&E	C1SR	893767	05/2014	05/23/2014	100.070	99.960	100.0	1
LG&E	C1SR	893768	05/2014	05/23/2014	100.040	99.880	100.0	1
LG&E	C1SR	893769	05/2014	05/23/2014	100.060	99.840	99.9	1
LG&E	C1SR	893770	05/2014	05/23/2014	100.060	99.860	100.0	1
LG&E	C1SR	893771	05/2014	05/23/2014	100.060	99.960	100.0	1
LG&E	C1SR	893772	05/2014	05/23/2014	100.090	99.960	100.1	1
LG&E	C1SR	893773	05/2014	05/23/2014	100.090	99.900	100.0	1
LG&E	C1SR	893774	05/2014	05/23/2014	100.100	99.940	100.0	1
LG&E	C1SR	893775	05/2014	05/23/2014	100.090	99.970	100.0	1
LG&E	C1SR	893776	05/2014	05/23/2014	100.060	99.970	100.0	1
LG&E	C1SR	893777	05/2014	05/23/2014	100.090	99.900	100.1	1
LG&E	C1SR	893778	05/2014	05/23/2014	100.060	99.910	100.0	1
LG&E	C1SR	893779	05/2014	05/23/2014	100.050	99.890	100.1	1
LG&E	C1SR	893780	05/2014	05/23/2014	100.090	99.890	99.9	1
LG&E	C1SR	893781	05/2014	05/23/2014	100.080	99.920	100.1	1

LG&E	C1SR	893782	05/2014	05/23/2014	100.040	99.900	99.9	1
LG&E	C1SR	893783	05/2014	05/23/2014	100.070	99.860	100.0	1
LG&E	C1SR	893784	05/2014	05/23/2014	100.030	99.870	100.0	1
LG&E	C1SR	893785	05/2014	05/23/2014	100.110	99.870	100.1	1
LG&E	C1SR	893786	05/2014	05/23/2014	100.070	99.990	100.0	1
LG&E	C1SR	893787	05/2014	05/23/2014	100.060	99.910	100.0	1
LG&E	C1SR	893788	05/2014	05/23/2014	100.060	99.910	100.1	1
LG&E	C1SR	893789	05/2014	05/23/2014	100.050	99.860	99.9	1
LG&E	C1SR	893790	05/2014	05/23/2014	100.090	99.980	99.9	1
LG&E	C1SR	893791	05/2014	05/23/2014	100.110	99.940	100.1	1
LG&E	C1SR	893792	05/2014	05/23/2014	100.070	99.820	100.1	1
LG&E	C1SR	893793	05/2014	05/23/2014	100.030	99.800	99.9	1
LG&E	C1SR	893794	05/2014	05/23/2014	100.030	99.840	100.0	1
LG&E	C1SR	893795	05/2014	05/23/2014	100.070	99.910	99.9	1
LG&E	C1SR	893796	05/2014	05/23/2014	100.110	99.940	100.0	1
LG&E	C1SR	893797	05/2014	05/23/2014	100.100	99.920	100.0	1
LG&E	C1SR	893798	05/2014	05/23/2014	100.100	99.950	100.0	1
LG&E	C1SR	893799	05/2014	05/23/2014	100.090	99.970	100.0	1
LG&E	C1SR	893800	05/2014	05/23/2014	100.060	99.930	99.9	1
LG&E	C1SR	893801	05/2014	05/23/2014	100.110	99.990	100.0	1
LG&E	C1SR	893802	05/2014	05/23/2014	100.060	99.820	100.1	1
LG&E	C1SR	893803	05/2014	05/23/2014	100.030	99.840	99.9	1
LG&E	C1SR	893804	05/2014	05/23/2014	100.050	99.840	100.0	1
LG&E	C1SR	893805	05/2014	05/23/2014	100.060	99.870	100.0	1
LG&E	C1SR	893806	05/2014	05/23/2014	100.060	99.880	100.0	1
LG&E	C1SR	893807	05/2014	05/23/2014	100.060	99.890	100.0	1
LG&E	C1SR	893808	05/2014	05/23/2014	100.050	99.890	100.0	1
LG&E	C1SR	893809	05/2014	05/23/2014	100.060	99.950	100.1	1
LG&E	C1SR	893810	05/2014	05/23/2014	100.070	99.950	100.0	1
LG&E	C1SR	893811	05/2014	05/23/2014	100.090	99.930	99.9	1
LG&E	C1SR	893812	05/2014	05/23/2014	100.070	99.940	99.9	1
LG&E	C1SR	893813	05/2014	05/23/2014	100.070	99.940	100.1	1

LG&E	C1SR	893814	05/2014	05/23/2014	100.030	99.840	100.0	1
LG&E	C1SR	893815	05/2014	05/23/2014	100.050	99.860	100.0	1
LG&E	C1SR	893816	05/2014	05/23/2014	100.070	99.910	100.0	1
LG&E	C1SR	893817	05/2014	05/23/2014	100.080	99.930	100.0	1
LG&E	C1SR	893818	05/2014	05/23/2014	100.060	99.980	100.0	1
LG&E	C1SR	893819	05/2014	05/23/2014	100.100	99.950	100.1	1
LG&E	C1SR	893820	05/2014	05/23/2014	100.090	99.930	100.0	1
LG&E	C1SR	893821	05/2014	05/23/2014	100.090	99.940	100.0	1
LG&E	C1SR	893822	05/2014	05/23/2014	100.060	99.950	99.9	1
LG&E	C1SR	893823	05/2014	05/23/2014	100.070	99.860	100.1	1
LG&E	C1SR	893824	05/2014	05/23/2014	100.040	99.900	100.0	1
LG&E	C1SR	893825	05/2014	05/23/2014	100.090	99.980	100.0	1
LG&E	C1SR	893826	05/2014	05/23/2014	100.030	99.900	100.0	1
LG&E	C1SR	893827	05/2014	05/23/2014	100.070	99.940	99.9	1
LG&E	C1SR	893828	05/2014	05/23/2014	100.050	99.840	100.0	1
LG&E	C1SR	893829	05/2014	05/23/2014	100.060	99.900	100.0	1
LG&E	C1SR	893830	05/2014	05/23/2014	100.070	99.920	100.0	1
LG&E	C1SR	893831	05/2014	05/23/2014	100.090	99.940	100.0	1
LG&E	C1SR	893832	05/2014	05/23/2014	100.070	99.900	100.0	1
LG&E	C1SR	893833	05/2014	05/23/2014	100.030	99.840	99.9	1
LG&E	C1SR	893834	05/2014	05/23/2014	100.040	99.820	100.0	1
LG&E	C1SR	893835	05/2014	05/23/2014	100.100	99.910	100.0	1
LG&E	C1SR	893836	05/2014	05/23/2014	100.060	99.900	100.0	1
LG&E	C1SR	893837	05/2014	05/23/2014	100.070	99.970	100.0	1
LG&E	C1SR	893838	05/2014	05/23/2014	100.080	99.890	100.0	1
LG&E	C1SR	893839	05/2014	05/23/2014	100.090	99.900	100.0	1
LG&E	C1SR	893840	05/2014	05/23/2014	100.090	99.980	100.0	1
LG&E	C1SR	893841	05/2014	05/23/2014	100.090	99.940	100.1	1
LG&E	C1SR	893842	05/2014	05/23/2014	100.070	99.840	100.0	1
LG&E	C1SR	893843	05/2014	05/23/2014	100.090	99.960	100.0	1
LG&E	C1SR	893844	05/2014	05/23/2014	100.080	99.930	100.1	1
LG&E	C1SR	893845	05/2014	05/23/2014	100.070	99.950	100.1	1

LG&E	C1SR	893846	05/2014	05/23/2014	100.100	100.000	100.0	1
LG&E	C1SR	893847	05/2014	05/23/2014	100.080	99.970	100.0	1
LG&E	C1SR	893848	05/2014	05/23/2014	100.070	99.940	99.9	1
LG&E	C1SR	893849	05/2014	05/23/2014	100.070	99.880	100.0	1
LG&E	C1SR	893850	05/2014	05/23/2014	100.080	99.900	99.9	1
LG&E	C1SR	893851	05/2014	05/23/2014	100.070	99.910	100.1	1
LG&E	C1SR	893852	05/2014	05/23/2014	100.080	99.890	99.9	1
LG&E	C1SR	893853	05/2014	05/23/2014	100.070	99.960	100.1	1
LG&E	C1SR	893854	05/2014	05/23/2014	100.060	99.880	100.1	1
LG&E	C1SR	893855	05/2014	05/23/2014	100.040	99.800	99.9	1
LG&E	C1SR	893856	05/2014	05/23/2014	100.100	99.960	100.0	1
LG&E	C1SR	893857	05/2014	05/23/2014	100.070	99.980	100.0	1
LG&E	C1SR	893858	05/2014	05/23/2014	100.080	99.940	100.0	1
LG&E	C1SR	893859	05/2014	05/23/2014	100.060	99.960	100.0	1
LG&E	C1SR	893860	05/2014	05/23/2014	100.060	99.890	100.0	1
LG&E	C1SR	893861	05/2014	05/23/2014	100.100	99.980	100.1	1
LG&E	C1SR	893862	05/2014	05/23/2014	100.040	99.830	100.0	1
LG&E	C1SR	893863	05/2014	05/23/2014	100.080	99.910	100.1	1
LG&E	C1SR	893864	05/2014	05/23/2014	100.100	99.910	100.0	1
LG&E	C1SR	893865	05/2014	05/23/2014	100.080	99.890	100.0	1
LG&E	C1SR	893866	05/2014	05/23/2014	100.080	99.910	100.0	1
LG&E	C1SR	893867	05/2014	05/23/2014	100.100	99.930	100.1	1
LG&E	C1SR	893868	05/2014	05/23/2014	100.060	99.860	100.0	1
LG&E	C1SR	893869	05/2014	05/23/2014	100.040	99.900	99.9	1
LG&E	C1SR	893870	05/2014	05/23/2014	100.100	99.900	99.9	1
LG&E	C1SR	893871	05/2014	05/23/2014	100.090	99.920	99.9	1
LG&E	C1SR	893872	05/2014	05/23/2014	100.070	99.890	100.0	1
LG&E	C1SR	893873	05/2014	05/23/2014	100.100	99.910	100.0	1
LG&E	C1SR	893874	05/2014	05/23/2014	100.080	99.920	100.1	1
LG&E	C1SR	893875	05/2014	05/23/2014	100.060	99.930	100.0	1
LG&E	C1SR	893876	05/2014	05/23/2014	100.060	99.880	100.0	1
LG&E	C1SR	893877	05/2014	05/23/2014	100.060	99.910	100.0	1

LG&E	C1SR	893878	05/2014	05/23/2014	100.090	99.940	100.0	1
LG&E	C1SR	893879	05/2014	05/23/2014	100.060	99.840	100.1	1
LG&E	C1SR	893880	05/2014	05/23/2014	100.070	99.900	100.0	1
LG&E	C1SR	893881	05/2014	05/23/2014	100.080	99.950	100.0	1
LG&E	C1SR	893882	05/2014	05/23/2014	100.100	99.980	100.1	1
LG&E	C1SR	893883	05/2014	05/23/2014	100.090	99.880	99.9	1
LG&E	C1SR	893884	05/2014	05/23/2014	100.090	99.930	100.0	1
LG&E	C1SR	893885	05/2014	05/23/2014	100.070	99.910	100.0	1
LG&E	C1SR	893886	05/2014	05/23/2014	100.070	99.910	100.0	1
LG&E	C1SR	893887	05/2014	05/23/2014	100.100	100.010	100.1	1
LG&E	C1SR	893888	05/2014	05/23/2014	100.070	99.870	100.0	1
LG&E	C1SR	893889	05/2014	05/23/2014	100.100	99.970	100.0	1
LG&E	C1SR	893890	05/2014	05/23/2014	100.080	99.870	100.0	1
LG&E	C1SR	893891	05/2014	05/23/2014	100.060	99.940	100.0	1
LG&E	C1SR	893892	05/2014	05/23/2014	100.070	99.890	100.0	1
LG&E	C1SR	893893	05/2014	05/23/2014	100.040	99.960	99.9	1
LG&E	C1SR	893894	05/2014	05/23/2014	100.090	99.950	100.1	1
LG&E	C1SR	893895	05/2014	05/23/2014	100.090	99.950	100.0	1
LG&E	C1SR	893896	05/2014	05/23/2014	100.080	99.950	100.1	1
LG&E	C1SR	893897	05/2014	05/23/2014	100.110	99.890	99.9	1
LG&E	C1SR	893898	05/2014	05/23/2014	100.110	99.930	100.0	1
LG&E	C1SR	893899	05/2014	05/23/2014	100.070	99.940	100.1	1
LG&E	C1SR	893900	05/2014	05/23/2014	100.040	99.850	100.0	1
LG&E	C1SR	893901	05/2014	05/23/2014	100.070	99.910	100.0	1
LG&E	C1SR	893902	05/2014	05/23/2014	100.070	99.880	100.0	1
LG&E	C1SR	893903	05/2014	05/23/2014	100.090	99.910	100.1	1
LG&E	C1SR	893904	05/2014	05/23/2014	100.060	99.900	100.0	1
LG&E	C1SR	893905	05/2014	05/23/2014	100.040	99.910	100.0	1
LG&E	C1SR	893906	05/2014	05/23/2014	100.080	99.900	100.0	1
LG&E	C1SR	893907	05/2014	05/23/2014	100.080	99.860	100.0	1
LG&E	C1SR	893908	05/2014	05/23/2014	100.060	99.920	100.1	1
LG&E	C1SR	893909	05/2014	05/23/2014	100.030	99.890	100.0	1

LG&E	C1SR	893910	05/2014	05/23/2014	100.100	99.900	100.0	1
LG&E	C1SR	893911	05/2014	05/23/2014	100.080	99.900	100.0	1
LG&E	C1SR	893912	05/2014	05/23/2014	100.050	99.910	100.0	1
LG&E	C1SR	893913	05/2014	05/23/2014	100.070	99.920	100.0	1
LG&E	C1SR	893914	05/2014	05/23/2014	100.060	99.900	100.0	1
LG&E	C1SR	893915	05/2014	05/23/2014	100.040	99.960	100.0	1
LG&E	C1SR	893916	05/2014	05/23/2014	100.070	99.920	100.0	1
LG&E	C1SR	893917	05/2014	05/23/2014	100.030	99.880	100.0	1
LG&E	C1SR	893918	05/2014	05/23/2014	100.050	99.900	99.9	1
LG&E	C1SR	893919	05/2014	05/23/2014	100.050	99.850	100.0	1
LG&E	C1SR	893920	05/2014	05/23/2014	100.050	99.890	100.0	1
LG&E	C1SR	893921	05/2014	05/23/2014	100.070	99.920	100.0	1
LG&E	C1SR	893922	05/2014	05/23/2014	100.060	99.950	100.0	1
LG&E	C1SR	893923	05/2014	05/23/2014	100.060	99.880	100.0	1
LG&E	C1SR	893924	05/2014	05/23/2014	100.050	99.850	100.0	1
LG&E	C1SR	893925	05/2014	05/23/2014	100.030	99.940	100.0	1
LG&E	C1SR	893926	05/2014	05/23/2014	100.050	99.910	100.0	1
LG&E	C1SR	893927	05/2014	05/23/2014	100.050	99.920	100.0	1
LG&E	C1SR	893928	05/2014	05/23/2014	100.050	99.930	100.1	1
LG&E	C1SR	893929	05/2014	05/23/2014	100.070	99.810	100.0	1
LG&E	C1SR	893930	05/2014	05/23/2014	100.050	99.870	100.0	1
LG&E	C1SR	893931	05/2014	05/23/2014	100.100	99.960	100.1	1
LG&E	C1SR	893932	05/2014	05/23/2014	100.090	99.880	100.0	1
LG&E	C1SR	893933	05/2014	05/23/2014	100.090	99.970	100.0	1
LG&E	C1SR	893934	05/2014	05/23/2014	100.060	99.870	99.9	1
LG&E	C1SR	893935	05/2014	05/23/2014	100.060	99.920	100.0	1
LG&E	C1SR	893936	05/2014	05/23/2014	100.060	99.860	99.9	1
LG&E	C1SR	893937	05/2014	05/23/2014	100.080	99.980	100.0	1
LG&E	C1SR	893938	05/2014	05/23/2014	100.090	99.950	100.1	1
LG&E	C1SR	893939	05/2014	05/23/2014	100.060	99.930	100.0	1
LG&E	C1SR	893940	05/2014	05/23/2014	100.070	99.910	100.1	1
LG&E	C1SR	893941	05/2014	05/23/2014	100.080	99.980	100.0	1

LG&E	C1SR	893942	05/2014	05/23/2014	100.040	99.850	100.0	1
LG&E	C1SR	893943	05/2014	05/23/2014	100.050	99.910	100.0	1
LG&E	C1SR	893944	05/2014	05/23/2014	100.050	99.880	99.9	1
LG&E	C1SR	893945	05/2014	05/23/2014	100.080	99.890	100.1	1
LG&E	C1SR	893946	05/2014	05/23/2014	100.070	99.900	100.0	1
LG&E	C1SR	893947	05/2014	05/23/2014	100.060	99.930	100.0	1
LG&E	C1SR	893948	05/2014	05/23/2014	100.060	99.900	100.1	1
LG&E	C1SR	893949	05/2014	05/23/2014	100.100	99.980	100.0	1
LG&E	C1SR	893950	05/2014	05/23/2014	100.050	99.930	100.0	1
LG&E	C1SR	893951	05/2014	05/23/2014	100.030	99.800	100.0	1
LG&E	C1SR	893952	05/2014	05/23/2014	100.040	99.830	100.0	1
LG&E	C1SR	893953	05/2014	05/23/2014	100.060	99.890	100.0	1
LG&E	C1SR	893954	05/2014	05/23/2014	100.100	99.950	100.0	1
LG&E	C1SR	893955	05/2014	05/23/2014	100.070	99.920	100.1	1
LG&E	C1SR	893956	05/2014	05/23/2014	100.090	99.840	100.1	1
LG&E	C1SR	893957	05/2014	05/23/2014	100.070	99.900	100.0	1
LG&E	C1SR	893958	05/2014	05/23/2014	100.040	99.860	100.0	1
LG&E	C1SR	893959	05/2014	05/23/2014	100.040	99.870	100.0	1
LG&E	C1SR	893960	05/2014	05/23/2014	100.080	99.910	100.0	1
LG&E	C1SR	893961	05/2014	05/23/2014	100.060	99.850	100.0	1
LG&E	C1SR	893962	05/2014	05/23/2014	100.060	100.000	100.0	1
LG&E	C1SR	893963	05/2014	05/23/2014	100.100	99.960	99.9	1
LG&E	C1SR	893964	05/2014	05/23/2014	100.050	99.860	100.0	1
LG&E	C1SR	893965	05/2014	05/23/2014	100.080	99.920	100.0	1
LG&E	C1SR	893966	05/2014	05/23/2014	100.090	99.960	100.1	1
LG&E	C1SR	893967	05/2014	05/23/2014	100.060	99.890	100.0	1
LG&E	C1SR	893968	05/2014	05/23/2014	100.040	99.930	100.0	1
LG&E	C1SR	893969	05/2014	05/23/2014	100.110	99.960	100.0	1
LG&E	C1SR	893970	05/2014	05/23/2014	100.030	99.870	100.0	1
LG&E	C1SR	893971	05/2014	05/23/2014	100.070	99.940	100.0	1
LG&E	C1SR	893972	05/2014	05/23/2014	100.070	99.860	100.1	1
LG&E	C1SR	893973	05/2014	05/23/2014	100.060	99.860	100.0	1

LG&E	C1SR	893974	05/2014	05/23/2014	100.080	99.920	99.9	1
LG&E	C1SR	893975	05/2014	05/23/2014	100.070	99.910	100.0	1
LG&E	C1SR	893976	05/2014	05/23/2014	100.070	99.910	100.0	1
LG&E	C1SR	893977	05/2014	05/23/2014	100.070	99.870	100.1	1
LG&E	C1SR	893978	05/2014	05/23/2014	100.080	99.980	100.0	1
LG&E	C1SR	893979	05/2014	05/23/2014	100.110	99.990	100.0	1
LG&E	C1SR	893980	05/2014	05/23/2014	100.060	100.000	99.9	1
LG&E	C1SR	893981	05/2014	05/23/2014	100.090	99.890	100.1	1
LG&E	C1SR	893982	05/2014	05/23/2014	100.030	99.800	100.0	1
LG&E	C1SR	893983	05/2014	05/23/2014	100.100	99.920	100.0	1
LG&E	C1SR	893984	05/2014	05/23/2014	100.080	99.920	100.1	1
LG&E	C1SR	893985	05/2014	05/23/2014	100.070	99.850	100.0	1
LG&E	C1SR	893986	05/2014	05/23/2014	100.030	99.900	100.0	1
LG&E	C1SR	893987	05/2014	05/23/2014	100.100	99.950	100.1	1
LG&E	C1SR	893988	05/2014	05/23/2014	100.050	99.850	100.0	1
LG&E	C1SR	893989	05/2014	05/23/2014	100.070	99.940	100.0	1
LG&E	C1SR	893990	05/2014	05/23/2014	100.100	100.010	99.9	1
LG&E	C1SR	893991	05/2014	05/23/2014	100.050	99.890	100.0	1
LG&E	C1SR	893992	05/2014	05/23/2014	100.090	99.960	100.1	1
LG&E	C1SR	893993	05/2014	05/23/2014	100.100	99.900	100.0	1
LG&E	C1SR	893994	05/2014	05/23/2014	100.030	99.820	99.9	1
LG&E	C1SR	893995	05/2014	05/23/2014	100.070	99.890	100.1	1
LG&E	C1SR	893996	05/2014	05/23/2014	100.080	99.860	100.1	1
LG&E	C1SR	893997	05/2014	05/23/2014	100.060	99.980	100.1	1
LG&E	C1SR	893998	05/2014	05/23/2014	100.040	99.900	99.9	1
LG&E	C1SR	893999	05/2014	05/23/2014	100.030	99.840	100.0	1
LG&E	C1SR	894000	05/2014	05/23/2014	100.080	99.870	100.1	1
LG&E	C1SR	894001	05/2014	05/23/2014	100.060	99.880	100.1	1
LG&E	C1SR	894002	05/2014	05/23/2014	100.070	99.940	99.9	1
LG&E	C1SR	894003	05/2014	05/23/2014	100.090	99.940	100.1	1
LG&E	C1SR	894004	05/2014	05/23/2014	100.050	99.900	100.0	1
LG&E	C1SR	894005	05/2014	05/23/2014	100.040	99.880	99.9	1

LG&E	C:ISR	894006	05/2014	05/23/2014	100.040	99.850	100.0	1
LG&E	C:ISR	894007	05/2014	05/23/2014	100.070	99.910	99.9	1
LG&E	C:ISR	894008	05/2014	05/23/2014	100.070	99.940	100.0	1
LG&E	C:ISR	894009	05/2014	05/23/2014	100.050	99.930	100.0	1
LG&E	C:ISR	894010	05/2014	05/23/2014	100.060	99.870	100.0	1
LG&E	C:ISR	894011	05/2014	05/23/2014	100.060	99.950	100.0	1
LG&E	C:ISR	894012	05/2014	05/23/2014	100.070	99.970	99.9	1
LG&E	C:ISR	894013	05/2014	05/23/2014	100.060	99.820	100.0	1
LG&E	C:ISR	894014	05/2014	05/23/2014	100.070	99.890	100.0	1
LG&E	C:ISR	894015	05/2014	05/23/2014	100.030	99.880	99.9	1
LG&E	C:ISR	894016	05/2014	05/23/2014	100.060	99.910	100.0	1
LG&E	C:ISR	894017	05/2014	05/23/2014	100.040	99.930	100.0	1
LG&E	C:ISR	894018	05/2014	05/23/2014	100.090	99.960	100.1	1
LG&E	C:ISR	894019	05/2014	05/23/2014	100.080	99.920	100.0	1
LG&E	C:ISR	894020	05/2014	05/23/2014	100.090	99.900	100.0	1
LG&E	C:ISR	894021	05/2014	05/23/2014	100.040	99.850	100.0	1
LG&E	C:ISR	894022	05/2014	05/23/2014	100.040	99.830	99.9	1
LG&E	C:ISR	894023	05/2014	05/23/2014	100.050	99.880	100.0	1
LG&E	C:ISR	894024	05/2014	05/23/2014	100.070	99.930	100.1	1
LG&E	C:ISR	894025	05/2014	05/23/2014	100.060	99.860	99.9	1
LG&E	C:ISR	894026	05/2014	05/23/2014	100.080	99.920	100.1	1
LG&E	C:ISR	894027	05/2014	05/23/2014	100.100	99.940	100.1	1
LG&E	C:ISR	894028	05/2014	05/23/2014	100.070	99.930	100.1	1
LG&E	C:ISR	894029	05/2014	05/23/2014	100.050	100.010	100.0	1
LG&E	C:ISR	894030	05/2014	05/23/2014	100.070	99.910	100.0	1
LG&E	C:ISR	894031	05/2014	05/23/2014	100.050	99.830	99.9	1
LG&E	C:ISR	894032	05/2014	05/23/2014	100.070	99.890	100.0	1
LG&E	C:ISR	894033	05/2014	05/23/2014	100.100	99.950	100.1	1
LG&E	C:ISR	894034	05/2014	05/23/2014	100.040	99.910	99.9	1
LG&E	C:ISR	894035	05/2014	05/23/2014	100.070	99.900	99.9	1
LG&E	C:ISR	894036	05/2014	05/23/2014	100.070	99.920	100.0	1
LG&E	C:ISR	894037	05/2014	05/23/2014	100.080	99.910	100.1	1

LG&E	C1SR	894038	05/2014	05/23/2014	100.050	99.900	100.0	1
LG&E	C1SR	894039	05/2014	05/23/2014	100.070	99.840	100.0	1
LG&E	C1SR	894040	05/2014	05/23/2014	100.050	99.880	99.9	1
LG&E	C1SR	894041	05/2014	05/23/2014	100.070	99.880	100.0	1
LG&E	C1SR	894042	05/2014	05/23/2014	100.050	99.920	100.0	1
LG&E	C1SR	894043	05/2014	05/23/2014	100.040	99.930	100.0	1
LG&E	C1SR	894044	05/2014	05/23/2014	100.070	99.950	99.9	1
LG&E	C1SR	894045	05/2014	05/23/2014	100.080	99.860	100.1	1
LG&E	C1SR	894046	05/2014	05/23/2014	100.070	99.910	100.0	1
LG&E	C1SR	894047	05/2014	05/23/2014	100.060	99.920	99.9	1
LG&E	C1SR	894048	05/2014	05/23/2014	100.050	99.890	99.9	1
LG&E	C1SR	894049	05/2014	05/23/2014	100.070	99.890	100.1	1
LG&E	C1SR	894050	05/2014	05/23/2014	100.040	99.940	100.0	1
LG&E	C1SR	894051	05/2014	05/23/2014	100.100	99.890	100.0	1
LG&E	C1SR	894052	05/2014	05/23/2014	100.080	99.950	100.0	1
LG&E	C1SR	894053	05/2014	05/23/2014	100.060	99.900	100.0	1
LG&E	C1SR	894054	05/2014	05/23/2014	100.080	99.850	100.0	1
LG&E	C1SR	894055	05/2014	05/23/2014	100.030	99.900	100.0	1
LG&E	C1SR	894056	05/2014	05/23/2014	100.070	99.970	100.0	1
LG&E	C1SR	894057	05/2014	05/23/2014	100.070	99.890	100.0	1
LG&E	C1SR	894058	05/2014	05/23/2014	100.080	99.970	100.1	1
LG&E	C1SR	894059	05/2014	05/23/2014	100.070	99.940	100.0	1
LG&E	C1SR	894060	05/2014	05/23/2014	100.030	99.980	100.0	1
LG&E	C1SR	894061	05/2014	05/23/2014	100.050	99.900	100.0	1
LG&E	C1SR	894062	05/2014	05/23/2014	100.110	99.900	100.1	1
LG&E	C1SR	894063	05/2014	05/23/2014	100.100	100.010	100.0	1
LG&E	C1SR	894064	05/2014	05/23/2014	100.090	99.940	100.0	1
LG&E	C1SR	894065	05/2014	05/23/2014	100.090	99.950	100.0	1
LG&E	C1SR	894066	05/2014	05/23/2014	100.030	99.920	100.0	1
LG&E	C1SR	894067	05/2014	05/23/2014	100.050	99.890	100.0	1
LG&E	C1SR	894068	05/2014	05/23/2014	100.050	99.860	100.1	1
LG&E	C1SR	894069	05/2014	05/23/2014	100.040	99.880	100.0	1

LG&E	C1SR	894070	05/2014	05/23/2014	100.050	99.860	100.1	1
LG&E	C1SR	894071	05/2014	05/23/2014	100.040	99.870	99.9	1
LG&E	C1SR	894072	05/2014	05/23/2014	100.090	99.980	100.1	1
LG&E	C1SR	894073	05/2014	05/23/2014	100.100	99.930	100.0	1
LG&E	C1SR	894074	05/2014	05/23/2014	100.080	99.940	100.0	1
LG&E	C1SR	894075	05/2014	05/23/2014	100.080	100.000	100.0	1
LG&E	C1SR	894076	05/2014	05/23/2014	100.070	99.880	100.0	1
LG&E	C1SR	894077	05/2014	05/23/2014	100.060	99.900	99.9	1
LG&E	C1SR	894078	05/2014	05/23/2014	100.050	99.880	100.0	1
LG&E	C1SR	894079	05/2014	05/23/2014	100.080	99.920	100.0	1
LG&E	C1SR	894080	05/2014	05/23/2014	100.070	99.840	99.9	1
LG&E	C1SR	894081	05/2014	05/23/2014	100.110	99.950	100.1	1
LG&E	C1SR	894082	05/2014	05/23/2014	100.100	99.950	100.0	1
LG&E	C1SR	894083	05/2014	05/23/2014	100.090	99.990	100.1	1
LG&E	C1SR	894084	05/2014	05/23/2014	100.080	99.930	100.1	1
LG&E	C1SR	894085	05/2014	05/23/2014	100.110	99.920	100.1	1
LG&E	C1SR	894086	05/2014	05/23/2014	100.070	99.920	100.0	1
LG&E	C1SR	894087	05/2014	05/23/2014	100.050	99.920	100.0	1
LG&E	C1SR	894088	05/2014	05/23/2014	100.050	99.910	99.9	1
LG&E	C1SR	894089	05/2014	05/23/2014	100.050	99.870	99.9	1
LG&E	C1SR	894090	05/2014	05/23/2014	100.080	99.870	99.9	1
LG&E	C1SR	894091	05/2014	05/23/2014	100.100	99.950	100.1	1
LG&E	C1SR	894092	05/2014	05/23/2014	100.070	99.940	100.1	1
LG&E	C1SR	894093	05/2014	05/23/2014	100.070	99.920	99.9	1
LG&E	C1SR	894094	05/2014	05/23/2014	100.080	99.950	100.0	1
LG&E	C1SR	894095	05/2014	05/23/2014	100.080	99.920	100.0	1
LG&E	C1SR	894096	05/2014	05/23/2014	100.070	99.900	100.0	1
LG&E	C1SR	894097	05/2014	05/23/2014	100.070	99.940	100.0	1
LG&E	C1SR	894098	05/2014	05/23/2014	100.070	99.870	100.1	1
LG&E	C1SR	894099	05/2014	05/23/2014	100.110	99.920	100.0	1
LG&E	C1SR	894100	05/2014	05/23/2014	100.100	99.970	100.0	1
LG&E	C1SR	894101	05/2014	05/23/2014	100.070	99.990	100.0	1

LG&E	C1SR	894102	05/2014	05/23/2014	100.100	99.910	100.0	1
LG&E	C1SR	894103	05/2014	05/23/2014	100.080	99.920	99.9	1
LG&E	C1SR	894104	05/2014	05/23/2014	100.060	99.890	100.0	1
LG&E	C1SR	894105	05/2014	05/23/2014	100.090	99.930	100.0	1
LG&E	C1SR	894106	05/2014	05/23/2014	100.060	99.980	100.0	1
LG&E	C1SR	894107	05/2014	05/23/2014	100.080	99.920	100.0	1
LG&E	C1SR	894108	05/2014	05/23/2014	100.060	99.940	100.0	1
LG&E	C1SR	894109	05/2014	05/23/2014	100.060	99.920	100.1	1
LG&E	C1SR	894110	05/2014	05/23/2014	100.050	99.840	100.1	1
LG&E	C1SR	894111	05/2014	05/23/2014	100.090	99.960	100.0	1
LG&E	C1SR	894112	05/2014	05/23/2014	100.060	99.870	99.9	1
LG&E	C1SR	894113	05/2014	05/23/2014	100.080	99.850	100.0	1
LG&E	C1SR	894114	05/2014	05/23/2014	100.100	99.960	100.1	1
LG&E	C1SR	894115	05/2014	05/23/2014	100.060	99.870	100.0	1
LG&E	C1SR	894116	05/2014	05/23/2014	100.100	99.870	100.1	1
LG&E	C1SR	894117	05/2014	05/23/2014	100.070	99.910	99.9	1
LG&E	C1SR	894118	05/2014	05/23/2014	100.080	99.900	100.0	1
LG&E	C1SR	894119	05/2014	05/23/2014	100.040	99.870	99.9	1
LG&E	C1SR	894120	05/2014	05/23/2014	100.100	99.990	100.1	1
LG&E	C1SR	894121	05/2014	05/23/2014	100.080	99.950	100.0	1
LG&E	C1SR	894122	05/2014	05/23/2014	100.080	99.880	99.9	1
LG&E	C1SR	894123	05/2014	05/23/2014	100.070	99.930	99.9	1
LG&E	C1SR	894124	05/2014	05/23/2014	100.100	99.970	100.1	1
LG&E	C1SR	894125	05/2014	05/23/2014	100.030	99.840	100.0	1
LG&E	C1SR	894126	05/2014	05/23/2014	100.080	99.920	100.1	1
LG&E	C1SR	894127	05/2014	05/23/2014	100.050	99.820	100.0	1
LG&E	C1SR	894128	05/2014	05/23/2014	100.060	99.970	100.0	1
LG&E	C1SR	894129	05/2014	05/23/2014	100.060	99.910	100.0	1
LG&E	C1SR	894130	05/2014	05/23/2014	100.060	99.900	100.0	1
LG&E	C1SR	894131	05/2014	05/23/2014	100.070	99.910	100.0	1
LG&E	C1SR	894132	05/2014	05/23/2014	100.040	99.860	99.9	1
LG&E	C1SR	894133	05/2014	05/23/2014	100.050	99.880	100.0	1

LG&E	C1SR	894134	05/2014	05/23/2014	100.040	99.870	100.0	1
LG&E	C1SR	894135	05/2014	05/23/2014	100.050	99.900	100.0	1
LG&E	C1SR	894136	05/2014	05/23/2014	100.100	99.850	100.1	1
LG&E	C1SR	894137	05/2014	05/23/2014	100.060	99.920	100.0	1
LG&E	C1SR	894138	05/2014	05/23/2014	100.050	99.890	100.0	1
LG&E	C1SR	894139	05/2014	05/23/2014	100.070	99.850	100.1	1
LG&E	C1SR	894140	05/2014	05/23/2014	100.030	99.890	100.0	1
LG&E	C1SR	894141	05/2014	05/23/2014	100.090	99.920	99.9	1
LG&E	C1SR	894142	05/2014	05/23/2014	100.050	99.950	100.0	1
LG&E	C1SR	894143	05/2014	05/23/2014	100.090	99.960	100.0	1
LG&E	C1SR	894144	05/2014	05/23/2014	100.090	99.860	100.0	1
LG&E	C1SR	894145	05/2014	05/23/2014	100.080	99.870	100.0	1
LG&E	C1SR	894146	05/2014	05/23/2014	100.060	99.900	100.1	1
LG&E	C1SR	894147	05/2014	05/23/2014	100.070	99.930	100.0	1
LG&E	C1SR	894148	05/2014	05/23/2014	100.040	99.840	100.0	1
LG&E	C1SR	894149	05/2014	05/23/2014	100.070	99.930	100.0	1
LG&E	C1SR	894150	05/2014	05/23/2014	100.110	99.960	99.9	1
LG&E	C1SR	894151	05/2014	05/23/2014	100.080	99.870	100.1	1
LG&E	C1SR	894152	05/2014	05/23/2014	100.060	99.920	100.1	1
LG&E	C1SR	894153	05/2014	05/23/2014	100.040	99.980	100.0	1
LG&E	C1SR	894154	05/2014	05/23/2014	100.100	99.940	100.0	1
LG&E	C1SR	894155	05/2014	05/23/2014	100.080	99.880	100.1	1
LG&E	C1SR	894156	05/2014	05/23/2014	100.080	99.950	99.9	1
LG&E	C1SR	894157	05/2014	05/23/2014	100.080	99.990	100.0	1
LG&E	C1SR	894158	05/2014	05/23/2014	100.080	99.900	100.1	1
LG&E	C1SR	894159	05/2014	05/23/2014	100.060	99.930	99.9	1
LG&E	C1SR	894160	05/2014	05/23/2014	100.060	99.940	100.0	1
LG&E	C1SR	894161	05/2014	05/23/2014	100.070	99.930	100.0	1
LG&E	C1SR	894162	05/2014	05/23/2014	100.060	99.950	99.9	1
LG&E	C1SR	894163	05/2014	05/23/2014	100.030	99.910	99.9	1
LG&E	C1SR	894164	05/2014	05/23/2014	100.070	99.870	100.0	1
LG&E	C1SR	894165	05/2014	05/23/2014	100.040	99.890	99.9	1

LG&E	C1SR	894166	05/2014	05/23/2014	100.090	99.950	100.0	1
LG&E	C1SR	894167	05/2014	05/23/2014	100.070	99.840	100.1	1
LG&E	C1SR	894168	05/2014	05/23/2014	100.050	99.950	100.0	1
LG&E	C1SR	894169	05/2014	05/23/2014	100.070	99.920	100.0	1
LG&E	C1SR	894170	05/2014	05/23/2014	100.080	99.940	100.0	1
LG&E	C1SR	894171	05/2014	05/23/2014	100.090	99.930	100.1	1
LG&E	C1SR	894172	05/2014	05/23/2014	100.080	99.910	100.0	1
LG&E	C1SR	894173	05/2014	05/23/2014	100.070	99.950	100.0	1
LG&E	C1SR	894174	05/2014	05/23/2014	100.030	99.840	100.0	1
LG&E	C1SR	894175	05/2014	05/23/2014	100.060	99.910	100.0	1
LG&E	C1SR	894176	05/2014	05/23/2014	100.070	99.870	100.0	1
LG&E	C1SR	894177	05/2014	05/23/2014	100.040	99.880	100.0	1
LG&E	C1SR	894178	05/2014	05/23/2014	100.040	99.850	100.0	1
LG&E	C1SR	894179	05/2014	05/23/2014	100.050	99.840	100.0	1
LG&E	C1SR	894180	05/2014	05/23/2014	100.040	99.850	100.0	1
LG&E	C1SR	894181	05/2014	05/23/2014	100.060	99.950	99.9	1
LG&E	C1SR	894182	05/2014	05/23/2014	100.050	99.870	99.9	1
LG&E	C1SR	894183	05/2014	05/23/2014	100.100	99.910	100.0	1
LG&E	C1SR	894184	05/2014	05/23/2014	100.070	99.860	100.0	1
LG&E	C1SR	894185	05/2014	05/23/2014	100.040	99.820	100.0	1
LG&E	C1SR	894186	05/2014	05/23/2014	100.100	99.950	100.1	1
LG&E	C1SR	894187	05/2014	05/23/2014	100.100	99.910	99.9	1
LG&E	C1SR	894188	05/2014	05/23/2014	100.090	99.920	100.0	1
LG&E	C1SR	894189	05/2014	05/23/2014	100.090	99.950	100.0	1
LG&E	C1SR	894190	05/2014	05/23/2014	100.090	99.940	100.0	1
LG&E	C1SR	894191	05/2014	05/23/2014	100.060	99.880	100.0	1
LG&E	C1SR	894192	05/2014	05/23/2014	100.070	99.920	100.0	1
LG&E	C1SR	894193	05/2014	05/23/2014	100.080	100.000	100.1	1
LG&E	C1SR	894194	05/2014	05/23/2014	100.060	99.950	100.0	1
LG&E	C1SR	894195	05/2014	05/23/2014	100.090	99.980	100.0	1
LG&E	C1SR	894196	05/2014	05/23/2014	100.070	99.880	100.0	1
LG&E	C1SR	894197	05/2014	05/23/2014	100.070	99.910	100.1	1

LG&E	C1SR	894198	05/2014	05/23/2014	100.040	99.810	99.9	1
LG&E	C1SR	894199	05/2014	05/23/2014	100.050	99.900	99.9	1
LG&E	C1SR	894200	05/2014	05/23/2014	100.100	99.980	100.1	1
LG&E	C1SR	894201	05/2014	05/23/2014	100.080	99.960	100.0	1
LG&E	C1SR	894202	05/2014	05/23/2014	100.060	99.860	100.0	1
LG&E	C1SR	894203	05/2014	05/23/2014	100.080	99.870	100.0	1
LG&E	C1SR	894204	05/2014	05/23/2014	100.090	99.930	100.0	1
LG&E	C1SR	894205	05/2014	05/23/2014	100.070	99.900	100.0	1
LG&E	C1SR	894206	05/2014	05/23/2014	100.080	99.900	100.0	1
LG&E	C1SR	894207	05/2014	05/23/2014	100.070	99.930	100.0	1
LG&E	C1SR	894208	05/2014	05/23/2014	100.100	99.960	100.1	1
LG&E	C1SR	894209	05/2014	05/23/2014	100.070	99.860	100.0	1
LG&E	C1SR	894210	05/2014	05/23/2014	100.060	99.900	100.0	1
LG&E	C1SR	894211	05/2014	05/23/2014	100.050	99.880	100.0	1
LG&E	C1SR	894212	05/2014	05/23/2014	100.070	99.930	100.1	1
LG&E	C1SR	894213	05/2014	05/23/2014	100.050	99.880	99.9	1
LG&E	C1SR	894214	05/2014	05/23/2014	100.070	99.920	100.0	1
LG&E	C1SR	894215	05/2014	05/23/2014	100.050	99.950	100.0	1
LG&E	C1SR	894216	05/2014	05/23/2014	100.060	99.860	99.9	1
LG&E	C1SR	894217	05/2014	05/23/2014	100.100	100.010	100.0	1
LG&E	C1SR	894218	05/2014	05/23/2014	100.060	99.860	99.9	1
LG&E	C1SR	894219	05/2014	05/23/2014	100.100	99.990	100.1	1
LG&E	C1SR	894220	05/2014	05/23/2014	100.050	99.810	99.9	1
LG&E	C1SR	894221	05/2014	05/23/2014	100.080	99.910	100.0	1
LG&E	C1SR	894222	05/2014	05/23/2014	100.070	99.940	99.9	1
LG&E	C1SR	894223	05/2014	05/23/2014	100.090	100.010	100.1	1
LG&E	C1SR	894224	05/2014	05/23/2014	100.040	99.910	100.0	1
LG&E	C1SR	894225	05/2014	05/23/2014	100.090	99.980	100.0	1
LG&E	C1SR	894226	05/2014	05/23/2014	100.060	99.930	100.1	1
LG&E	C1SR	894227	05/2014	05/23/2014	100.060	99.940	100.0	1
LG&E	C1SR	894228	05/2014	05/23/2014	100.070	99.900	100.0	1
LG&E	C1SR	894229	05/2014	05/23/2014	100.060	99.970	99.9	1

LG&E	C1SR	894230	05/2014	05/23/2014	100.060	99.960	100.0	1
LG&E	C1SR	894231	05/2014	05/23/2014	100.030	99.860	100.0	1
LG&E	C1SR	894232	05/2014	05/23/2014	100.030	99.880	100.0	1
LG&E	C1SR	894233	05/2014	05/23/2014	100.070	99.830	100.0	1
LG&E	C1SR	894234	05/2014	05/23/2014	100.070	99.900	100.0	1
LG&E	C1SR	894235	05/2014	05/23/2014	100.060	99.890	100.0	1
LG&E	C1SR	894236	05/2014	05/23/2014	100.070	99.910	100.1	1
LG&E	C1SR	894237	05/2014	05/23/2014	100.080	99.970	100.0	1
LG&E	C1SR	894238	05/2014	05/23/2014	100.030	99.820	99.9	1
LG&E	C1SR	894239	05/2014	05/23/2014	100.080	99.970	99.9	1
LG&E	C1SR	894240	05/2014	05/23/2014	100.060	99.910	100.0	1
LG&E	C1SR	894241	05/2014	05/23/2014	100.030	99.870	99.9	1
LG&E	C1SR	894242	05/2014	05/23/2014	100.070	99.910	100.0	1
LG&E	C1SR	894243	05/2014	05/23/2014	100.080	99.990	100.1	1
LG&E	C1SR	894244	05/2014	05/23/2014	100.060	99.920	100.0	1
LG&E	C1SR	894245	05/2014	05/23/2014	100.070	99.890	100.0	1
LG&E	C1SR	894246	05/2014	05/23/2014	100.070	99.900	100.0	1
LG&E	C1SR	894247	05/2014	05/23/2014	100.060	99.830	99.9	1
LG&E	C1SR	894248	05/2014	05/23/2014	100.070	99.900	100.0	1
LG&E	C1SR	894249	05/2014	05/23/2014	100.070	100.010	100.0	1
LG&E	C1SR	894250	05/2014	05/23/2014	100.100	99.980	100.0	1
LG&E	C1SR	894251	05/2014	05/23/2014	100.070	99.990	100.0	1
LG&E	C1SR	894252	05/2014	05/23/2014	100.070	99.910	100.0	1
LG&E	C1SR	894253	05/2014	05/23/2014	100.090	99.910	100.1	1
LG&E	C1SR	894254	05/2014	05/23/2014	100.080	99.930	100.0	1
LG&E	C1SR	894255	05/2014	05/23/2014	100.060	99.890	100.0	1
LG&E	C1SR	894256	05/2014	05/23/2014	100.050	99.950	100.0	1
LG&E	C1SR	894257	05/2014	05/23/2014	100.100	99.930	100.0	1
LG&E	C1SR	894258	05/2014	05/23/2014	100.060	99.910	100.0	1
LG&E	C1SR	894259	05/2014	05/23/2014	100.030	99.850	99.9	1
LG&E	C1SR	894260	05/2014	05/23/2014	100.070	99.860	100.1	1
LG&E	C1SR	894261	05/2014	05/23/2014	100.060	99.930	100.0	1

LG&E	C1SR	894262	05/2014	05/23/2014	100.060	99.920	100.0	100.0	1
LG&E	C1SR	894263	05/2014	05/23/2014	100.100	99.900	100.1	100.1	1
LG&E	C1SR	894264	05/2014	05/23/2014	100.060	99.880	100.2	100.2	1
LG&E	C1SR	894265	05/2014	05/23/2014	100.060	99.930	100.0	100.0	1
LG&E	C1SR	894266	05/2014	05/23/2014	100.090	99.910	100.1	100.1	1
LG&E	C1SR	894267	05/2014	05/23/2014	100.080	99.920	100.0	100.0	1
LG&E	C1SR	894268	05/2014	05/23/2014	100.080	100.060	100.0	100.0	1
LG&E	C1SR	894269	05/2014	05/23/2014	100.110	99.930	100.0	100.0	1
LG&E	C1SR	894270	05/2014	05/23/2014	100.030	99.900	100.0	100.0	1
LG&E	C1SR	894271	05/2014	05/23/2014	100.100	99.890	100.0	100.0	1
LG&E	C1SR	894272	05/2014	05/23/2014	100.060	99.860	100.0	100.0	1
LG&E	C1SR	894273	05/2014	05/23/2014	100.060	99.910	100.0	100.0	1
LG&E	C1SR	894274	05/2014	05/23/2014	100.060	99.840	100.0	100.0	1
LG&E	C1SR	894275	05/2014	05/23/2014	100.080	99.870	100.0	100.0	1
LG&E	C1SR	894276	05/2014	05/23/2014	100.090	99.970	100.0	100.0	1
LG&E	C1SR	894277	05/2014	05/23/2014	100.100	99.920	100.1	100.1	1
LG&E	C1SR	894278	05/2014	05/23/2014	100.060	99.860	100.0	100.0	1
LG&E	C1SR	894279	05/2014	05/23/2014	100.050	99.830	99.9	99.9	1
LG&E	C1SR	894280	05/2014	05/23/2014	100.070	99.820	99.9	99.9	1
LG&E	C1SR	894281	05/2014	05/23/2014	100.070	99.960	99.9	99.9	1
LG&E	C1SR	894282	05/2014	05/23/2014	100.080	99.900	100.0	100.0	1
LG&E	C1SR	894283	05/2014	05/23/2014	100.040	99.830	100.0	100.0	1
LG&E	C1SR	894284	05/2014	05/23/2014	100.060	99.870	100.0	100.0	1
LG&E	C1SR	894285	05/2014	05/23/2014	100.080	99.980	100.0	100.0	1
LG&E	C1SR	894286	05/2014	05/23/2014	100.040	99.860	99.9	99.9	1
LG&E	C1SR	894287	05/2014	05/23/2014	100.080	99.960	100.1	100.1	1
LG&E	C1SR	894288	05/2014	05/23/2014	100.070	99.900	100.0	100.0	1
LG&E	C1SR	894289	05/2014	05/23/2014	100.090	99.880	100.0	100.0	1
LG&E	C1SR	894290	05/2014	05/23/2014	100.050	99.860	99.9	99.9	1
LG&E	C1SR	894291	05/2014	05/23/2014	100.030	99.900	100.0	100.0	1
LG&E	C1SR	894292	05/2014	05/23/2014	100.080	99.950	100.1	100.1	1
LG&E	C1SR	894293	05/2014	05/23/2014	100.080	99.930	100.0	100.0	1

LG&E	C1SR	894294	05/2014	05/23/2014	100.100	99.940	100.0	100.0	1
LG&E	C1SR	894295	05/2014	05/23/2014	100.060	99.970	100.0	100.0	1
LG&E	C1SR	894296	05/2014	05/23/2014	100.060	99.900	100.0	100.0	1
LG&E	C1SR	894297	05/2014	05/23/2014	100.090	99.990	100.0	100.0	1
LG&E	C1SR	894298	05/2014	05/23/2014	100.050	99.870	100.1	100.1	1
LG&E	C1SR	894299	05/2014	05/23/2014	100.030	99.840	100.1	100.1	1
LG&E	C1SR	894300	05/2014	05/23/2014	100.080	99.940	100.0	100.0	1
LG&E	C1SR	894301	05/2014	05/23/2014	100.060	99.930	100.0	100.0	1
LG&E	C1SR	894302	05/2014	05/23/2014	100.100	99.940	100.0	100.0	1
LG&E	C1SR	894303	05/2014	05/23/2014	100.090	99.970	100.0	100.0	1
LG&E	C1SR	894304	05/2014	05/23/2014	100.110	99.960	100.1	100.1	1
LG&E	C1SR	894305	05/2014	05/23/2014	100.050	99.910	100.0	100.0	1
LG&E	C1SR	894306	05/2014	05/23/2014	100.060	99.920	100.1	100.1	1
LG&E	C1SR	894307	05/2014	05/23/2014	100.100	99.990	100.0	100.0	1
LG&E	C1SR	894308	05/2014	05/23/2014	100.090	99.960	100.0	100.0	1
LG&E	C1SR	894309	05/2014	05/23/2014	100.110	99.980	100.0	100.0	1
LG&E	C1SR	894310	05/2014	05/23/2014	100.050	99.900	100.0	100.0	1
LG&E	C1SR	894311	05/2014	05/23/2014	100.050	100.010	100.1	100.1	1
LG&E	C1SR	894312	05/2014	05/23/2014	100.050	99.870	100.0	100.0	1
LG&E	C1SR	894313	05/2014	05/23/2014	100.060	99.910	100.0	100.0	1
LG&E	C1SR	894314	05/2014	05/23/2014	100.040	99.880	100.0	100.0	1
LG&E	C1SR	894315	05/2014	05/23/2014	100.090	99.960	100.0	100.0	1
LG&E	C1SR	894316	05/2014	05/23/2014	100.060	99.930	100.0	100.0	1
LG&E	C1SR	894317	05/2014	05/23/2014	100.080	99.900	100.1	100.1	1
LG&E	C1SR	894318	05/2014	05/23/2014	100.030	99.860	99.9	99.9	1
LG&E	C1SR	894319	05/2014	05/23/2014	100.050	99.910	100.0	100.0	1
LG&E	C1SR	894320	05/2014	05/23/2014	100.060	99.980	100.0	100.0	1
LG&E	C1SR	894321	05/2014	05/23/2014	100.060	99.880	100.0	100.0	1
LG&E	C1SR	894322	05/2014	05/23/2014	100.100	99.980	100.1	100.1	1
LG&E	C1SR	894323	05/2014	05/23/2014	100.080	99.950	100.0	100.0	1
LG&E	C1SR	894324	05/2014	05/23/2014	100.040	99.860	100.0	100.0	1
LG&E	C1SR	894325	05/2014	05/23/2014	100.070	99.930	100.1	100.1	1

LG&E	C1SR	894326	05/2014	05/23/2014	100.070	99.890	100.0	1
LG&E	C1SR	894327	05/2014	05/23/2014	100.070	99.930	100.0	1
LG&E	C1SR	894328	05/2014	05/23/2014	100.040	99.850	100.0	1
LG&E	C1SR	894329	05/2014	05/23/2014	100.050	99.860	100.1	1
LG&E	C1SR	894330	05/2014	05/23/2014	100.060	99.940	100.0	1
LG&E	C1SR	894331	05/2014	05/23/2014	100.030	99.820	99.9	1
LG&E	C1SR	894332	05/2014	05/23/2014	100.060	99.910	99.9	1
LG&E	C1SR	894333	05/2014	05/23/2014	100.040	99.830	99.9	1
LG&E	C1SR	894334	05/2014	05/23/2014	100.050	99.910	100.0	1
LG&E	C1SR	894335	05/2014	05/23/2014	100.060	99.840	100.0	1
LG&E	C1SR	894336	05/2014	05/23/2014	100.040	99.960	100.0	1
LG&E	C1SR	894337	05/2014	05/23/2014	100.080	99.920	100.0	1
LG&E	C1SR	894338	05/2014	05/23/2014	100.100	99.910	100.1	1
LG&E	C1SR	894339	05/2014	05/23/2014	100.060	99.850	100.0	1
LG&E	C1SR	894340	05/2014	05/23/2014	100.060	99.890	100.0	1
LG&E	C1SR	894341	05/2014	05/23/2014	100.060	99.890	100.0	1
LG&E	C1SR	894342	05/2014	05/23/2014	100.060	99.890	100.0	1
LG&E	C1SR	894343	05/2014	05/23/2014	100.070	99.910	100.1	1
LG&E	C1SR	894344	05/2014	05/23/2014	100.070	99.900	100.0	1
LG&E	C1SR	894345	05/2014	05/23/2014	100.040	99.820	100.0	1
LG&E	C1SR	894346	05/2014	05/23/2014	100.070	99.950	100.0	1
LG&E	C1SR	894347	05/2014	05/23/2014	100.050	99.860	100.0	1
LG&E	C1SR	894348	05/2014	05/23/2014	100.060	99.990	99.9	1
LG&E	C1SR	894349	05/2014	05/23/2014	100.110	99.960	100.1	1
LG&E	C1SR	894350	05/2014	05/23/2014	100.060	99.920	100.0	1
LG&E	C1SR	894351	05/2014	05/23/2014	100.080	99.900	100.0	1
LG&E	C1SR	894352	05/2014	05/23/2014	100.100	99.930	100.0	1
LG&E	C1SR	894353	05/2014	05/23/2014	100.070	99.870	100.0	1
LG&E	C1SR	894354	05/2014	05/23/2014	100.080	99.930	100.0	1
LG&E	C1SR	894355	05/2014	05/23/2014	100.050	99.850	99.9	1
LG&E	C1SR	894356	05/2014	05/23/2014	100.100	99.870	100.1	1
LG&E	C1SR	894357	05/2014	05/23/2014	100.060	99.950	100.0	1

LG&E	C1SR	894358	05/2014	05/23/2014	100.090	99.930	100.0	1
LG&E	C1SR	894359	05/2014	05/23/2014	100.050	99.870	99.9	1
LG&E	C1SR	894360	05/2014	05/23/2014	100.060	99.920	100.0	1
LG&E	C1SR	894361	05/2014	05/23/2014	100.090	99.930	100.0	1
LG&E	C1SR	894362	05/2014	05/23/2014	100.040	99.920	100.0	1
LG&E	C1SR	894363	05/2014	05/23/2014	100.070	99.870	100.0	1
LG&E	C1SR	894364	05/2014	05/23/2014	100.060	99.890	99.9	1
LG&E	C1SR	894365	05/2014	05/23/2014	100.060	99.930	100.0	1
LG&E	C1SR	894366	05/2014	05/23/2014	100.070	99.890	100.0	1
LG&E	C1SR	894367	05/2014	05/23/2014	100.090	99.970	100.0	1
LG&E	C1SR	894368	05/2014	05/23/2014	100.030	99.910	99.9	1
LG&E	C1SR	894369	05/2014	05/23/2014	100.090	99.920	100.0	1
LG&E	C1SR	894370	05/2014	05/23/2014	100.050	99.910	99.9	1
LG&E	C1SR	894371	05/2014	05/23/2014	100.080	99.870	100.0	1
LG&E	C1SR	894372	05/2014	05/23/2014	100.050	99.930	99.9	1
LG&E	C1SR	894373	05/2014	05/23/2014	100.090	99.930	100.0	1
LG&E	C1SR	894374	05/2014	05/23/2014	100.070	99.950	100.0	1
LG&E	C1SR	894375	05/2014	05/23/2014	100.100	99.970	100.0	1
LG&E	C1SR	894376	05/2014	05/23/2014	100.050	99.910	100.0	1
LG&E	C1SR	894377	05/2014	05/23/2014	100.060	99.910	100.0	1
LG&E	C1SR	894378	05/2014	05/23/2014	100.050	99.890	100.0	1
LG&E	C1SR	894379	05/2014	05/23/2014	100.070	99.900	100.0	1
LG&E	C1SR	894380	05/2014	05/23/2014	100.090	99.900	100.0	1
LG&E	C1SR	894381	05/2014	05/23/2014	100.030	99.870	100.0	1
LG&E	C1SR	894382	05/2014	05/23/2014	100.080	99.920	99.9	1
LG&E	C1SR	894383	05/2014	05/23/2014	100.100	99.880	100.0	1
LG&E	C1SR	894384	05/2014	05/23/2014	100.060	99.870	99.9	1
LG&E	C1SR	894385	05/2014	05/23/2014	100.030	99.880	99.9	1
LG&E	C1SR	894386	05/2014	05/23/2014	100.090	99.960	100.0	1
LG&E	C1SR	894387	05/2014	05/23/2014	100.060	99.950	100.0	1
LG&E	C1SR	894388	05/2014	05/23/2014	100.060	99.920	100.1	1
LG&E	C1SR	894389	05/2014	05/23/2014	100.030	99.890	99.9	1

LG&E	C1SR	894390	05/2014	05/23/2014	100.080	99.870	100.0	1
LG&E	C1SR	894391	05/2014	05/23/2014	100.080	99.950	100.1	1
LG&E	C1SR	894392	05/2014	05/23/2014	100.050	99.910	100.0	1
LG&E	C1SR	894393	05/2014	05/23/2014	100.060	99.900	99.9	1
LG&E	C1SR	894394	05/2014	05/23/2014	100.060	99.920	100.0	1
LG&E	C1SR	894395	05/2014	05/23/2014	100.070	99.960	100.0	1
LG&E	C1SR	894396	05/2014	05/23/2014	100.070	99.950	100.1	1
LG&E	C1SR	894397	05/2014	05/23/2014	100.060	99.930	100.0	1
LG&E	C1SR	894398	05/2014	05/23/2014	100.070	99.960	99.9	1
LG&E	C1SR	894399	05/2014	05/23/2014	100.060	99.950	100.0	1
LG&E	C1SR	894400	05/2014	05/23/2014	100.080	99.890	100.0	1
LG&E	C1SR	894401	05/2014	05/23/2014	100.050	99.890	99.9	1
LG&E	C1SR	894402	05/2014	05/23/2014	100.050	99.870	99.9	1
LG&E	C1SR	894403	05/2014	05/23/2014	100.060	99.890	100.1	1
LG&E	C1SR	894404	05/2014	05/23/2014	100.070	99.900	100.1	1
LG&E	C1SR	894405	05/2014	05/23/2014	100.030	99.890	100.0	1
LG&E	C1SR	894406	05/2014	05/23/2014	100.090	99.940	100.0	1
LG&E	C1SR	894407	05/2014	05/23/2014	100.060	99.890	99.9	1
LG&E	C1SR	894408	05/2014	05/23/2014	100.080	100.000	100.1	1
LG&E	C1SR	894409	05/2014	05/23/2014	100.050	99.890	99.9	1
LG&E	C1SR	894410	05/2014	05/23/2014	100.080	99.990	100.0	1
LG&E	C1SR	894411	05/2014	05/23/2014	100.050	99.960	100.0	1
LG&E	C1SR	894412	05/2014	05/23/2014	100.090	99.950	100.0	1
LG&E	C1SR	894413	05/2014	05/23/2014	100.080	99.950	100.0	1
LG&E	C1SR	894414	05/2014	05/23/2014	100.050	99.880	100.0	1
LG&E	C1SR	894415	05/2014	05/23/2014	100.030	99.850	100.0	1
LG&E	C1SR	894416	05/2014	05/23/2014	100.060	99.900	100.0	1
LG&E	C1SR	894417	05/2014	05/23/2014	100.050	99.880	100.0	1
LG&E	C1SR	894418	05/2014	05/23/2014	100.040	99.910	100.0	1
LG&E	C1SR	894419	05/2014	05/23/2014	100.060	99.930	99.9	1
LG&E	C1SR	894420	05/2014	05/23/2014	100.030	99.920	100.0	1
LG&E	C1SR	894421	05/2014	05/23/2014	100.100	99.990	100.0	1

LG&E	C1SR	894422	05/2014	05/23/2014	100.080	99.920	100.0	1
LG&E	C1SR	894423	05/2014	05/23/2014	100.070	99.950	100.0	1
LG&E	C1SR	894424	05/2014	05/23/2014	100.030	99.860	100.0	1
LG&E	C1SR	894425	05/2014	05/23/2014	100.090	99.890	100.0	1
LG&E	C1SR	894426	05/2014	05/23/2014	100.030	99.860	100.0	1
LG&E	C1SR	894427	05/2014	05/23/2014	100.060	99.850	99.9	1
LG&E	C1SR	894428	05/2014	05/23/2014	100.080	99.920	100.0	1
LG&E	C1SR	894429	05/2014	05/23/2014	100.070	99.930	100.0	1
LG&E	C1SR	894430	05/2014	05/23/2014	100.100	99.950	100.0	1
LG&E	C1SR	894431	05/2014	05/23/2014	100.050	99.970	100.0	1
LG&E	C1SR	894432	05/2014	05/23/2014	100.100	99.950	100.0	1
LG&E	C1SR	894433	05/2014	05/23/2014	100.100	99.950	100.0	1
LG&E	C1SR	894434	05/2014	05/23/2014	100.060	99.890	100.0	1
LG&E	C1SR	894435	05/2014	05/23/2014	100.050	99.930	100.0	1
LG&E	C1SR	894436	05/2014	05/23/2014	100.100	99.990	100.0	1
LG&E	C1SR	894437	05/2014	05/23/2014	100.070	99.940	100.0	1
LG&E	C1SR	894438	05/2014	05/23/2014	100.100	99.950	100.0	1
LG&E	C1SR	894439	05/2014	05/23/2014	100.070	99.870	99.9	1
LG&E	C1SR	894440	05/2014	05/23/2014	100.110	99.940	100.1	1
LG&E	C1SR	894441	05/2014	05/23/2014	100.070	99.900	100.0	1
LG&E	C1SR	894442	05/2014	05/23/2014	100.070	99.890	100.0	1
LG&E	C1SR	894443	05/2014	05/23/2014	100.080	99.860	100.0	1
LG&E	C1SR	894444	05/2014	05/23/2014	100.070	99.910	100.0	1
LG&E	C1SR	894445	05/2014	05/23/2014	100.060	99.860	100.0	1
LG&E	C1SR	894446	05/2014	05/23/2014	100.060	99.920	100.0	1
LG&E	C1SR	894447	05/2014	05/23/2014	100.080	99.960	100.0	1
LG&E	C1SR	894448	05/2014	05/23/2014	100.040	99.910	100.0	1
LG&E	C1SR	894449	05/2014	05/23/2014	100.100	99.860	100.0	1
LG&E	C1SR	894450	05/2014	05/23/2014	100.070	99.910	100.0	1
LG&E	C1SR	894451	05/2014	05/23/2014	100.070	99.880	99.9	1
LG&E	C1SR	894452	05/2014	05/23/2014	100.050	99.910	100.0	1
LG&E	C1SR	894453	05/2014	05/23/2014	100.050	99.910	100.0	1

LG&E	C1SR	894454	05/2014	05/23/2014	100.060	99.870	99.9	1
LG&E	C1SR	894455	05/2014	05/23/2014	100.080	99.890	100.0	1
LG&E	C1SR	894456	05/2014	05/23/2014	100.030	99.840	100.0	1
LG&E	C1SR	894457	05/2014	05/23/2014	100.030	99.850	99.9	1
LG&E	C1SR	894458	05/2014	05/23/2014	100.060	99.900	100.0	1
LG&E	C1SR	894459	05/2014	05/23/2014	100.030	99.840	100.0	1
LG&E	C1SR	894460	05/2014	05/23/2014	100.100	100.020	100.1	1
LG&E	C1SR	894461	05/2014	05/23/2014	100.060	99.950	100.0	1
LG&E	C1SR	894462	05/2014	05/23/2014	100.050	99.920	100.0	1
LG&E	C1SR	894463	05/2014	05/23/2014	100.030	99.880	99.9	1
LG&E	C1SR	894464	05/2014	05/23/2014	100.060	99.860	100.0	1
LG&E	C1SR	894465	05/2014	05/23/2014	100.050	99.920	99.9	1
LG&E	C1SR	894466	05/2014	05/23/2014	100.030	99.890	100.0	1
LG&E	C1SR	894467	05/2014	05/23/2014	100.100	99.920	100.1	1
LG&E	C1SR	894468	05/2014	05/23/2014	100.080	99.880	100.0	1
LG&E	C1SR	894469	05/2014	05/23/2014	100.040	99.830	100.0	1
LG&E	C1SR	894470	05/2014	05/23/2014	100.090	99.910	100.1	1
LG&E	C1SR	894471	05/2014	05/23/2014	100.070	99.860	100.0	1
LG&E	C1SR	894472	05/2014	05/23/2014	100.060	99.920	100.0	1
LG&E	C1SR	894473	05/2014	05/23/2014	100.060	99.900	100.0	1
LG&E	C1SR	894474	05/2014	05/23/2014	100.070	99.880	100.0	1
LG&E	C1SR	894475	05/2014	05/23/2014	100.050	99.860	100.0	1
LG&E	C1SR	894476	05/2014	05/23/2014	100.080	99.950	100.0	1
LG&E	C1SR	894477	05/2014	05/23/2014	100.070	99.900	100.0	1
LG&E	C1SR	894478	05/2014	05/23/2014	100.080	99.920	100.1	1
LG&E	C1SR	894479	05/2014	05/23/2014	100.070	99.930	99.9	1
LG&E	C1SR	894480	05/2014	05/23/2014	100.070	99.960	100.1	1
LG&E	C1SR	894481	05/2014	05/23/2014	100.060	99.890	99.9	1
LG&E	C1SR	894482	05/2014	05/23/2014	100.030	99.940	100.0	1
LG&E	C1SR	894483	05/2014	05/23/2014	100.080	99.940	100.0	1
LG&E	C1SR	894484	05/2014	05/23/2014	100.040	99.870	100.0	1
LG&E	C1SR	894485	05/2014	05/23/2014	100.080	99.980	100.1	1

LG&E	C1SR	894486	05/2014	05/23/2014	100.070	99.970	100.0	1
LG&E	C1SR	894487	05/2014	05/23/2014	100.080	99.960	100.1	1
LG&E	C1SR	894488	05/2014	05/23/2014	100.080	99.920	99.9	1
LG&E	C1SR	894489	05/2014	05/23/2014	100.070	99.810	100.0	1
LG&E	C1SR	894490	05/2014	05/23/2014	100.030	99.810	99.9	1
LG&E	C1SR	894491	05/2014	05/23/2014	100.090	99.880	100.0	1
LG&E	C1SR	894492	05/2014	05/23/2014	100.090	99.970	100.0	1
LG&E	C1SR	894493	05/2014	05/23/2014	100.080	99.950	100.0	1
LG&E	C1SR	894494	05/2014	05/23/2014	100.070	99.920	99.9	1
LG&E	C1SR	894495	05/2014	05/23/2014	100.040	99.850	99.9	1
LG&E	C1SR	894496	05/2014	05/23/2014	100.090	99.970	100.0	1
LG&E	C1SR	894497	05/2014	05/23/2014	100.100	99.980	100.0	1
LG&E	C1SR	894498	05/2014	05/23/2014	100.070	99.890	99.9	1
LG&E	C1SR	894499	05/2014	05/23/2014	100.100	99.870	100.0	1
LG&E	C1SR	894500	05/2014	05/23/2014	100.050	99.890	100.0	1
LG&E	C1SR	894501	05/2014	05/23/2014	100.060	99.850	99.9	1
LG&E	C1SR	894502	05/2014	05/23/2014	100.060	99.870	100.1	1
LG&E	C1SR	894503	05/2014	05/23/2014	100.090	99.970	99.9	1
LG&E	C1SR	894504	05/2014	05/23/2014	100.040	99.930	100.0	1
LG&E	C1SR	894505	05/2014	05/23/2014	100.040	99.850	99.9	1
LG&E	C1SR	894506	05/2014	05/23/2014	100.050	99.970	100.0	1
LG&E	C1SR	894507	05/2014	05/23/2014	100.100	100.000	100.0	1
LG&E	C1SR	894508	05/2014	05/23/2014	100.050	99.860	100.0	1
LG&E	C1SR	894509	05/2014	05/23/2014	100.080	99.990	100.0	1
LG&E	C1SR	894510	05/2014	05/23/2014	100.060	99.920	100.0	1
LG&E	C1SR	894511	05/2014	05/23/2014	100.040	99.900	99.9	1
LG&E	C1SR	894512	05/2014	05/23/2014	100.100	99.880	100.0	1
LG&E	C1SR	894513	05/2014	05/23/2014	100.040	99.830	99.9	1
LG&E	C1SR	894514	05/2014	05/23/2014	100.050	99.890	100.0	1
LG&E	C1SR	894515	05/2014	05/23/2014	100.030	99.840	100.0	1
LG&E	C1SR	894516	05/2014	05/23/2014	100.090	99.960	100.1	1
LG&E	C1SR	894517	05/2014	05/23/2014	100.070	99.990	100.0	1

LG&E	C1SR	894518	05/2014	05/23/2014	100.070	99.970	100.0	1
LG&E	C1SR	894519	05/2014	05/23/2014	100.060	99.880	100.0	1
LG&E	C1SR	894520	05/2014	05/23/2014	100.070	99.910	99.9	1
LG&E	C1SR	894521	05/2014	05/23/2014	100.060	99.900	100.0	1
LG&E	C1SR	894522	05/2014	05/23/2014	100.070	99.880	100.0	1
LG&E	C1SR	894523	05/2014	05/23/2014	100.080	99.860	100.0	1
LG&E	C1SR	894524	05/2014	05/23/2014	100.100	99.920	100.0	1
LG&E	C1SR	894525	05/2014	05/23/2014	100.070	99.940	100.0	1
LG&E	C1SR	894526	05/2014	05/23/2014	100.040	99.860	99.9	1
LG&E	C1SR	894527	05/2014	05/23/2014	100.060	99.980	100.1	1
LG&E	C1SR	894528	05/2014	05/23/2014	100.070	99.890	100.0	1
LG&E	C1SR	894529	05/2014	05/23/2014	100.040	99.810	100.0	1
LG&E	C1SR	894530	05/2014	05/23/2014	100.070	99.940	100.0	1
LG&E	C1SR	894531	05/2014	05/23/2014	100.070	99.940	100.0	1
LG&E	C1SR	894532	05/2014	05/23/2014	100.070	99.880	100.0	1
LG&E	C1SR	894533	05/2014	05/23/2014	100.070	99.890	100.0	1
LG&E	C1SR	894534	05/2014	05/23/2014	100.060	99.870	100.0	1
LG&E	C1SR	894535	05/2014	05/23/2014	100.060	99.930	100.0	1
LG&E	C1SR	894536	05/2014	05/23/2014	100.040	99.860	100.0	1
LG&E	C1SR	894537	05/2014	05/23/2014	100.050	99.820	100.0	1
LG&E	C1SR	894538	05/2014	05/23/2014	100.050	99.850	99.9	1
LG&E	C1SR	894539	05/2014	05/23/2014	100.070	99.950	100.0	1
LG&E	C1SR	894540	05/2014	05/23/2014	100.070	99.910	100.0	1
LG&E	C1SR	894541	05/2014	05/23/2014	100.040	99.870	100.0	1
LG&E	C1SR	894542	05/2014	05/23/2014	100.080	99.880	99.9	1
LG&E	C1SR	894543	05/2014	05/23/2014	100.040	99.840	99.9	1
LG&E	C1SR	894544	05/2014	05/23/2014	100.070	99.870	100.0	1
LG&E	C1SR	894545	05/2014	05/23/2014	100.060	99.950	100.0	1
LG&E	C1SR	894546	05/2014	05/23/2014	100.050	99.860	100.0	1
LG&E	C1SR	894547	05/2014	05/23/2014	100.070	99.980	100.0	1
LG&E	C1SR	894548	05/2014	05/23/2014	100.050	99.900	99.9	1
LG&E	C1SR	894549	05/2014	05/23/2014	100.060	99.930	100.0	1

LG&E	C1SR	894550	05/2014	05/23/2014	100.100	99.930	100.0	1
LG&E	C1SR	894551	05/2014	05/23/2014	100.030	99.890	100.0	1
LG&E	C1SR	894552	05/2014	05/23/2014	100.050	99.900	99.9	1
LG&E	C1SR	894553	05/2014	05/23/2014	100.090	99.880	100.0	1
LG&E	C1SR	894554	05/2014	05/23/2014	100.060	99.810	100.1	1
LG&E	C1SR	894555	05/2014	05/23/2014	100.090	99.940	100.2	1
LG&E	C1SR	894556	05/2014	05/23/2014	100.100	99.890	100.1	1
LG&E	C1SR	894557	05/2014	05/23/2014	100.030	99.900	100.0	1
LG&E	C1SR	894558	05/2014	05/23/2014	100.110	99.970	100.1	1
LG&E	C1SR	894559	05/2014	05/23/2014	100.100	99.940	100.1	1
LG&E	C1SR	894560	05/2014	05/23/2014	100.040	99.800	99.9	1
LG&E	C1SR	894561	05/2014	05/23/2014	100.040	99.830	99.9	1
LG&E	C1SR	894562	05/2014	05/23/2014	100.070	99.930	100.1	1
LG&E	C1SR	894563	05/2014	05/23/2014	100.080	99.910	99.9	1
LG&E	C1SR	894564	05/2014	05/23/2014	100.070	99.880	100.0	1
LG&E	C1SR	894565	05/2014	05/23/2014	100.070	99.950	100.0	1
LG&E	C1SR	894566	05/2014	05/23/2014	100.040	99.810	99.9	1
LG&E	C1SR	894567	05/2014	05/23/2014	100.050	99.910	100.1	1
LG&E	C1SR	894568	05/2014	05/23/2014	100.050	99.900	100.0	1
LG&E	C1SR	894569	05/2014	05/23/2014	100.040	99.900	100.0	1
LG&E	C1SR	894570	05/2014	05/23/2014	100.070	100.000	100.0	1
LG&E	C1SR	894571	05/2014	05/23/2014	100.040	99.900	100.0	1
LG&E	C1SR	894572	05/2014	05/23/2014	100.090	99.890	100.1	1
LG&E	C1SR	894573	05/2014	05/23/2014	100.050	99.930	100.0	1
LG&E	C1SR	894574	05/2014	05/23/2014	100.060	99.870	100.0	1
LG&E	C1SR	894575	05/2014	05/23/2014	100.050	99.890	100.0	1
LG&E	C1SR	894576	05/2014	05/23/2014	100.060	99.880	100.0	1
LG&E	C1SR	894577	05/2014	05/23/2014	100.090	99.890	100.1	1
LG&E	C1SR	894578	05/2014	05/23/2014	100.040	99.880	99.9	1
LG&E	C1SR	894579	05/2014	05/23/2014	100.080	99.960	100.0	1
LG&E	C1SR	894580	05/2014	05/23/2014	100.070	99.890	100.0	1
LG&E	C1SR	894581	05/2014	05/23/2014	100.080	99.900	100.0	1

LG&E	C1SR	894582	05/2014	05/23/2014	100.060	99.860	100.0	1
LG&E	C1SR	894583	05/2014	05/23/2014	100.050	99.880	100.0	1
LG&E	C1SR	894584	05/2014	05/23/2014	100.040	99.910	100.0	1
LG&E	C1SR	894585	05/2014	05/23/2014	100.030	99.910	100.0	1
LG&E	C1SR	894586	05/2014	05/23/2014	100.070	99.910	99.9	1
LG&E	C1SR	894587	05/2014	05/23/2014	100.030	99.830	99.9	1
LG&E	C1SR	894588	05/2014	05/23/2014	100.030	99.920	100.0	1
LG&E	C1SR	894589	05/2014	05/23/2014	100.080	99.960	100.0	1
LG&E	C1SR	894590	05/2014	05/23/2014	100.030	99.840	99.9	1
LG&E	C1SR	894591	05/2014	05/23/2014	100.030	99.860	100.0	1
LG&E	C1SR	894592	05/2014	05/23/2014	100.030	99.880	100.0	1
LG&E	C1SR	894593	05/2014	05/23/2014	100.100	99.940	100.0	1
LG&E	C1SR	894594	05/2014	05/23/2014	100.070	99.910	100.0	1
LG&E	C1SR	894595	05/2014	05/23/2014	100.080	99.960	100.0	1
LG&E	C1SR	894596	05/2014	05/23/2014	100.090	99.990	100.0	1
LG&E	C1SR	894597	05/2014	05/23/2014	100.070	99.930	100.0	1
LG&E	C1SR	894598	05/2014	05/23/2014	100.050	99.860	100.0	1
LG&E	C1SR	894599	05/2014	05/23/2014	100.070	99.940	100.1	1
LG&E	C1SR	894600	05/2014	05/23/2014	100.040	99.900	100.0	1
LG&E	C1SR	894601	05/2014	05/23/2014	100.070	99.940	100.0	1
LG&E	C1SR	894602	05/2014	05/23/2014	100.090	99.910	100.1	1
LG&E	C1SR	894603	05/2014	05/23/2014	100.080	99.910	100.1	1
LG&E	C1SR	894604	05/2014	05/23/2014	100.100	99.950	100.0	1
LG&E	C1SR	894605	05/2014	05/23/2014	100.070	99.890	100.0	1
LG&E	C1SR	894606	05/2014	05/23/2014	100.070	99.930	100.1	1
LG&E	C1SR	894607	05/2014	05/23/2014	100.060	99.920	100.1	1
LG&E	C1SR	894608	05/2014	05/23/2014	100.070	99.900	100.0	1
LG&E	C1SR	894609	05/2014	05/23/2014	100.040	99.850	100.0	1
LG&E	C1SR	894610	05/2014	05/23/2014	100.060	99.850	100.0	1
LG&E	C1SR	894611	05/2014	05/23/2014	100.070	99.920	100.0	1
LG&E	C1SR	894612	05/2014	05/23/2014	100.060	99.930	99.9	1
LG&E	C1SR	894613	05/2014	05/23/2014	100.050	99.860	100.1	1

LG&E	C1SR	894614	05/2014	05/23/2014	100.050	99.950	100.0	1
LG&E	C1SR	894615	05/2014	05/23/2014	100.030	99.870	100.0	1
LG&E	C1SR	894616	05/2014	05/23/2014	100.040	99.910	100.0	1
LG&E	C1SR	894617	05/2014	05/23/2014	100.040	99.810	99.9	1
LG&E	C1SR	894618	05/2014	05/23/2014	100.080	99.930	100.0	1
LG&E	C1SR	894619	05/2014	05/23/2014	100.110	99.950	100.0	1
LG&E	C1SR	894620	05/2014	05/23/2014	100.090	99.900	100.0	1
LG&E	C1SR	894621	05/2014	05/23/2014	100.090	99.920	100.0	1
LG&E	C1SR	894622	05/2014	05/23/2014	100.050	99.920	100.0	1
LG&E	C1SR	894623	05/2014	05/23/2014	100.050	99.880	100.1	1
LG&E	C1SR	894624	05/2014	05/23/2014	100.100	99.970	100.0	1
LG&E	C1SR	894625	05/2014	05/23/2014	100.080	99.940	100.0	1
LG&E	C1SR	894626	05/2014	05/23/2014	100.060	99.890	100.0	1
LG&E	C1SR	894627	05/2014	05/23/2014	100.080	99.940	100.0	1
LG&E	C1SR	894628	05/2014	05/23/2014	100.080	99.940	100.1	1
LG&E	C1SR	894629	05/2014	05/23/2014	100.090	99.840	100.1	1
LG&E	C1SR	894630	05/2014	05/23/2014	100.030	99.900	100.0	1
LG&E	C1SR	894631	05/2014	05/23/2014	100.080	99.910	100.0	1
LG&E	C1SR	894632	05/2014	05/23/2014	100.040	99.860	100.0	1
LG&E	C1SR	894633	05/2014	05/23/2014	100.050	99.880	100.0	1
LG&E	C1SR	894634	05/2014	05/23/2014	100.050	99.910	100.1	1
LG&E	C1SR	894635	05/2014	05/23/2014	100.060	99.930	100.0	1
LG&E	C1SR	894636	05/2014	05/23/2014	100.060	99.970	100.0	1
LG&E	C1SR	894637	05/2014	05/23/2014	100.090	99.840	99.9	1
LG&E	C1SR	894638	05/2014	05/23/2014	100.100	99.960	100.1	1
LG&E	C1SR	894639	05/2014	05/23/2014	100.080	99.930	100.0	1
LG&E	C1SR	894640	05/2014	05/23/2014	100.090	99.880	100.0	1
LG&E	C1SR	894641	05/2014	05/23/2014	100.050	99.870	100.0	1
LG&E	C1SR	894642	05/2014	05/23/2014	100.030	99.840	99.9	1
LG&E	C1SR	894643	05/2014	05/23/2014	100.090	99.910	100.0	1
LG&E	C1SR	894644	05/2014	05/23/2014	100.080	100.030	100.0	1
LG&E	C1SR	894645	05/2014	05/23/2014	100.060	99.910	100.0	1

LG&E	C1SR	894646	05/2014	05/23/2014	100.040	99.830	99.9	1
LG&E	C1SR	894647	05/2014	05/23/2014	100.030	99.830	99.9	1
LG&E	C1SR	894648	05/2014	05/23/2014	100.090	99.930	100.0	1
LG&E	C1SR	894649	05/2014	05/23/2014	100.070	99.930	100.0	1
LG&E	C1SR	894650	05/2014	05/23/2014	100.100	99.930	100.0	1
LG&E	C1SR	894651	05/2014	05/23/2014	100.070	99.970	100.0	1
LG&E	C1SR	894652	05/2014	05/23/2014	100.030	99.800	100.0	1
LG&E	C1SR	894653	05/2014	05/23/2014	100.060	99.850	99.9	1
LG&E	C1SR	894654	05/2014	05/23/2014	100.070	99.910	100.0	1
LG&E	C1SR	894655	05/2014	05/23/2014	100.060	99.880	100.0	1
LG&E	C1SR	894656	05/2014	05/23/2014	100.100	99.920	100.1	1
LG&E	C1SR	894657	05/2014	05/23/2014	100.100	99.920	99.9	1
LG&E	C1SR	894658	05/2014	05/23/2014	100.060	99.930	100.1	1
LG&E	C1SR	894659	05/2014	05/23/2014	100.070	99.950	100.0	1
LG&E	C1SR	894660	05/2014	05/23/2014	100.050	99.900	100.1	1
LG&E	C1SR	894661	05/2014	05/23/2014	100.080	99.920	100.0	1
LG&E	C1SR	894662	05/2014	05/23/2014	100.050	99.860	100.0	1
LG&E	C1SR	894663	05/2014	05/23/2014	100.080	99.970	99.9	1
LG&E	C1SR	894664	05/2014	05/23/2014	100.060	99.980	100.0	1
LG&E	C1SR	894665	05/2014	05/23/2014	100.070	99.960	100.0	1
LG&E	C1SR	894666	05/2014	05/23/2014	100.070	99.860	100.1	1
LG&E	C1SR	894667	05/2014	05/23/2014	100.070	99.910	100.0	1
LG&E	C1SR	894668	05/2014	05/23/2014	100.070	99.980	100.0	1
LG&E	C1SR	894669	05/2014	05/23/2014	100.090	99.960	100.1	1
LG&E	C1SR	894670	05/2014	05/23/2014	100.110	99.930	100.0	1
LG&E	C1SR	894671	05/2014	05/23/2014	100.080	99.920	100.0	1
LG&E	C1SR	894672	05/2014	05/23/2014	100.030	99.820	100.0	1
LG&E	C1SR	894673	05/2014	05/23/2014	100.070	99.860	100.0	1
LG&E	C1SR	894674	05/2014	05/23/2014	100.090	99.910	100.0	1
LG&E	C1SR	894675	05/2014	05/23/2014	100.040	99.900	99.9	1
LG&E	C1SR	894676	05/2014	05/23/2014	100.060	99.850	100.0	1
LG&E	C1SR	894677	05/2014	05/23/2014	100.090	99.980	100.0	1

LG&E	C1SR	894678	05/2014	05/23/2014	100.070	99.980	100.0	1
LG&E	C1SR	894679	05/2014	05/23/2014	100.030	99.900	99.9	1
LG&E	C1SR	894680	05/2014	05/23/2014	100.080	99.960	100.0	1
LG&E	C1SR	894681	05/2014	05/23/2014	100.050	99.930	100.0	1
LG&E	C1SR	894682	05/2014	05/23/2014	100.040	99.840	99.9	1
LG&E	C1SR	894683	05/2014	05/23/2014	100.080	99.840	100.0	1
LG&E	C1SR	894684	05/2014	05/23/2014	100.080	99.890	99.9	1
LG&E	C1SR	894685	05/2014	05/23/2014	100.060	99.900	100.1	1
LG&E	C1SR	894686	05/2014	05/23/2014	100.090	99.920	100.1	1
LG&E	C1SR	894687	05/2014	05/23/2014	100.070	99.940	100.0	1
LG&E	C1SR	894688	05/2014	05/23/2014	100.060	99.900	100.0	1
LG&E	C1SR	894689	05/2014	05/23/2014	100.060	99.930	100.0	1
LG&E	C1SR	894690	05/2014	05/23/2014	100.070	99.940	100.0	1
LG&E	C1SR	894691	05/2014	05/23/2014	100.060	99.970	100.0	1
LG&E	C1SR	894692	05/2014	05/23/2014	100.050	99.850	99.9	1
LG&E	C1SR	894693	05/2014	05/23/2014	100.090	99.870	100.1	1
LG&E	C1SR	894694	05/2014	05/23/2014	100.050	99.880	100.0	1
LG&E	C1SR	894695	05/2014	05/23/2014	100.050	99.880	100.0	1
LG&E	C1SR	894696	05/2014	05/23/2014	100.040	99.870	100.0	1
LG&E	C1SR	894697	05/2014	05/23/2014	100.070	99.880	100.0	1
LG&E	C1SR	894698	05/2014	05/23/2014	100.080	99.930	100.0	1
LG&E	C1SR	894699	05/2014	05/23/2014	100.030	99.870	100.0	1
LG&E	C1SR	894700	05/2014	05/23/2014	100.060	99.850	100.0	1
LG&E	C1SR	894701	05/2014	05/23/2014	100.050	99.920	100.0	1
LG&E	C1SR	894702	05/2014	05/23/2014	100.030	99.860	100.0	1
LG&E	C1SR	894703	05/2014	05/23/2014	100.040	99.890	100.0	1
LG&E	C1SR	894704	05/2014	05/23/2014	100.070	99.880	100.1	1
LG&E	C1SR	894705	05/2014	05/23/2014	100.100	99.970	100.0	1
LG&E	C1SR	894706	05/2014	05/23/2014	100.090	99.980	100.0	1
LG&E	C1SR	894707	05/2014	05/23/2014	100.060	99.870	100.0	1
LG&E	C1SR	894708	05/2014	05/23/2014	100.090	99.940	100.0	1
LG&E	C1SR	894709	05/2014	05/23/2014	100.040	99.810	99.9	1

LG&E	C1SR	894710	05/2014	05/23/2014	100.060	99.900	100.0	1
LG&E	C1SR	894711	05/2014	05/23/2014	100.070	99.920	100.0	1
LG&E	C1SR	894712	05/2014	05/23/2014	100.040	99.860	100.0	1
LG&E	C1SR	894713	05/2014	05/23/2014	100.050	99.920	100.0	1
LG&E	C1SR	894714	05/2014	05/23/2014	100.060	99.920	100.0	1
LG&E	C1SR	894715	05/2014	05/23/2014	100.070	99.860	100.0	1
LG&E	C1SR	894716	05/2014	05/23/2014	100.090	99.920	100.1	1
LG&E	C1SR	894717	05/2014	05/23/2014	100.070	99.890	100.1	1
LG&E	C1SR	894718	05/2014	05/23/2014	100.070	99.880	100.0	1
LG&E	C1SR	894719	05/2014	05/23/2014	100.060	99.920	100.0	1
LG&E	C1SR	894720	05/2014	05/23/2014	100.080	99.980	99.9	1
LG&E	C1SR	894721	05/2014	05/23/2014	100.060	99.890	100.0	1
LG&E	C1SR	894722	05/2014	05/23/2014	100.070	99.870	100.0	1
LG&E	C1SR	894723	05/2014	05/23/2014	100.080	99.910	100.1	1
LG&E	C1SR	894724	05/2014	05/23/2014	100.070	99.910	100.0	1
LG&E	C1SR	894725	05/2014	05/23/2014	100.030	99.910	100.0	1
LG&E	C1SR	894726	05/2014	05/23/2014	100.040	99.960	99.9	1
LG&E	C1SR	894727	05/2014	05/23/2014	100.040	99.850	100.0	1
LG&E	C1SR	894728	05/2014	05/23/2014	100.050	99.870	99.9	1
LG&E	C1SR	894729	05/2014	05/23/2014	100.030	99.860	99.9	1
LG&E	C1SR	894730	05/2014	05/23/2014	100.070	99.930	100.0	1
LG&E	C1SR	894731	05/2014	05/23/2014	100.080	99.890	99.9	1
LG&E	C1SR	894732	05/2014	05/23/2014	100.100	99.940	100.0	1
LG&E	C1SR	894733	05/2014	05/23/2014	100.060	99.970	100.0	1
LG&E	C1SR	894734	05/2014	05/23/2014	100.080	99.930	100.0	1
LG&E	C1SR	894735	05/2014	05/23/2014	100.060	99.880	100.0	1
LG&E	C1SR	894736	05/2014	05/23/2014	100.080	99.840	100.0	1
LG&E	C1SR	894737	05/2014	05/23/2014	100.060	99.910	100.0	1
LG&E	C1SR	894738	05/2014	05/23/2014	100.070	99.940	100.1	1
LG&E	C1SR	894739	05/2014	05/23/2014	100.030	99.840	99.9	1
LG&E	C1SR	894740	05/2014	05/23/2014	100.040	99.920	100.1	1
LG&E	C1SR	894741	05/2014	05/23/2014	100.080	99.860	100.0	1

LG&E	C1SR	894742	05/2014	05/23/2014	100.070	99.940	100.0	1
LG&E	C1SR	894743	05/2014	05/23/2014	100.060	99.950	100.1	1
LG&E	C1SR	894744	05/2014	05/23/2014	100.080	99.910	100.0	1
LG&E	C1SR	894745	05/2014	05/23/2014	100.080	99.920	100.1	1
LG&E	C1SR	894746	05/2014	05/23/2014	100.060	99.860	100.0	1
LG&E	C1SR	894747	05/2014	05/23/2014	100.100	99.910	100.1	1
LG&E	C1SR	894748	05/2014	05/23/2014	100.040	99.870	100.0	1
LG&E	C1SR	894749	05/2014	05/23/2014	100.080	99.950	100.0	1
LG&E	C1SR	894750	05/2014	05/23/2014	100.080	99.900	100.0	1
LG&E	C1SR	894751	05/2014	05/23/2014	100.080	99.870	100.0	1
LG&E	C1SR	894752	05/2014	05/23/2014	100.080	99.830	100.1	1
LG&E	C1SR	894753	05/2014	05/23/2014	100.100	99.930	100.1	1
LG&E	C1SR	894754	05/2014	05/23/2014	100.050	99.900	100.0	1
LG&E	C1SR	894755	05/2014	05/23/2014	100.070	99.880	100.0	1
LG&E	C1SR	894756	05/2014	05/23/2014	100.060	99.900	100.0	1
LG&E	C1SR	894757	05/2014	05/23/2014	100.030	99.840	100.0	1
LG&E	C1SR	894758	05/2014	05/23/2014	100.070	99.910	100.0	1
LG&E	C1SR	894759	05/2014	05/23/2014	100.070	99.940	100.0	1
LG&E	C1SR	894760	05/2014	05/23/2014	100.100	99.970	100.0	1
LG&E	C1SR	894761	05/2014	05/23/2014	100.090	99.860	99.9	1
LG&E	C1SR	894762	05/2014	05/23/2014	100.070	99.840	100.0	1
LG&E	C1SR	894763	05/2014	05/23/2014	100.060	99.890	99.9	1
LG&E	C1SR	894764	05/2014	05/23/2014	100.080	99.900	100.0	1
LG&E	C1SR	894765	05/2014	05/23/2014	100.100	99.950	100.0	1
LG&E	C1SR	894766	05/2014	05/23/2014	100.040	99.810	100.0	1
LG&E	C1SR	894767	05/2014	05/23/2014	100.090	99.890	100.0	1
LG&E	C1SR	894768	05/2014	05/23/2014	100.040	99.870	100.0	1
LG&E	C1SR	894769	05/2014	05/23/2014	100.060	99.890	100.0	1
LG&E	C1SR	894770	05/2014	05/23/2014	100.080	99.920	100.0	1
LG&E	C1SR	894771	05/2014	05/23/2014	100.070	99.970	100.1	1
LG&E	C1SR	894772	05/2014	05/23/2014	100.050	99.860	100.0	1
LG&E	C1SR	894773	05/2014	05/23/2014	100.040	99.840	100.0	1

LG&E	C1SR	894774	05/2014	05/23/2014	100.070	99.950	100.0	1
LG&E	C1SR	894775	05/2014	05/23/2014	100.080	99.970	100.0	1
LG&E	C1SR	894776	05/2014	05/23/2014	100.060	99.910	100.0	1
LG&E	C1SR	894777	05/2014	05/23/2014	100.060	99.870	100.0	1
LG&E	C1SR	894778	05/2014	05/23/2014	100.090	99.940	100.1	1
LG&E	C1SR	894779	05/2014	05/23/2014	100.070	99.830	100.0	1
LG&E	C1SR	894780	05/2014	05/23/2014	100.070	99.930	100.1	1
LG&E	C1SR	894781	05/2014	05/23/2014	100.060	99.910	99.9	1
LG&E	C1SR	894782	05/2014	05/23/2014	100.050	99.820	99.9	1
LG&E	C1SR	894783	05/2014	05/23/2014	100.060	99.930	100.0	1
LG&E	C1SR	894784	05/2014	05/23/2014	100.090	99.970	100.0	1
LG&E	C1SR	894785	05/2014	05/23/2014	100.070	99.930	100.1	1
LG&E	C1SR	894786	05/2014	05/23/2014	100.040	99.910	100.0	1
LG&E	C1SR	894787	05/2014	05/23/2014	100.090	99.960	100.0	1
LG&E	C1SR	894788	05/2014	05/23/2014	100.100	99.920	100.1	1
LG&E	C1SR	894789	05/2014	05/23/2014	100.100	99.910	99.9	1
LG&E	C1SR	894790	05/2014	05/23/2014	100.060	99.880	99.9	1
LG&E	C1SR	894791	05/2014	05/23/2014	100.100	99.970	100.1	1
LG&E	C1SR	894792	05/2014	05/23/2014	100.090	99.960	100.1	1
LG&E	C1SR	894793	05/2014	05/23/2014	100.060	100.000	100.0	1
LG&E	C1SR	894794	05/2014	05/23/2014	100.080	99.940	100.0	1
LG&E	C1SR	894795	05/2014	05/23/2014	100.090	99.890	100.0	1
LG&E	C1SR	894796	05/2014	05/23/2014	100.070	99.940	100.0	1
LG&E	C1SR	894797	05/2014	05/23/2014	100.090	99.990	100.1	1
LG&E	C1SR	894798	05/2014	05/23/2014	100.060	99.860	100.0	1
LG&E	C1SR	894799	05/2014	05/23/2014	100.070	99.940	100.0	1
LG&E	C1SR	894800	05/2014	05/23/2014	100.040	99.900	100.0	1
LG&E	C1SR	894801	05/2014	05/23/2014	100.060	99.960	99.9	1
LG&E	C1SR	894802	05/2014	05/23/2014	100.090	99.960	100.0	1
LG&E	C1SR	894803	05/2014	05/23/2014	100.080	99.900	100.0	1
LG&E	C1SR	894804	05/2014	05/23/2014	100.060	99.930	99.9	1
LG&E	C1SR	894805	05/2014	05/23/2014	100.090	99.930	99.9	1

LG&E	C1SR	894806	05/2014	05/23/2014	100.090	99.890	100.0	1
LG&E	C1SR	894807	05/2014	05/23/2014	100.060	99.910	100.1	1
LG&E	C1SR	894808	05/2014	05/23/2014	100.050	99.890	100.0	1
LG&E	C1SR	894809	05/2014	05/23/2014	100.080	99.910	100.0	1
LG&E	C1SR	894810	05/2014	05/23/2014	100.090	99.850	100.0	1
LG&E	C1SR	894811	05/2014	05/23/2014	100.060	99.900	100.0	1
LG&E	C1SR	894812	05/2014	05/23/2014	100.090	99.930	100.0	1
LG&E	C1SR	894813	05/2014	05/23/2014	100.090	99.920	100.1	1
LG&E	C1SR	894814	05/2014	05/23/2014	100.050	99.930	100.0	1
LG&E	C1SR	894815	05/2014	05/23/2014	100.060	99.870	100.0	1
LG&E	C1SR	894816	05/2014	05/23/2014	100.080	99.890	100.0	1
LG&E	C1SR	894817	05/2014	05/23/2014	100.060	99.920	100.0	1
LG&E	C1SR	894818	05/2014	05/23/2014	100.070	99.930	100.0	1
LG&E	C1SR	894819	05/2014	05/23/2014	100.040	99.900	100.0	1
LG&E	C1SR	894820	05/2014	05/23/2014	100.080	99.940	100.1	1
LG&E	C1SR	894821	05/2014	05/23/2014	100.080	99.940	100.0	1
LG&E	C1SR	894822	05/2014	05/23/2014	100.050	99.930	99.9	1
LG&E	C1SR	894823	05/2014	05/23/2014	100.070	99.900	100.1	1
LG&E	C1SR	894824	05/2014	05/23/2014	100.070	99.920	100.0	1
LG&E	C1SR	894825	05/2014	05/23/2014	100.080	99.910	100.0	1
LG&E	C1SR	894826	05/2014	05/23/2014	100.030	99.860	99.9	1
LG&E	C1SR	894827	05/2014	05/23/2014	100.070	99.940	100.0	1
LG&E	C1SR	894828	05/2014	05/23/2014	100.090	99.970	100.0	1
LG&E	C1SR	894829	05/2014	05/23/2014	100.100	99.960	100.0	1
LG&E	C1SR	894830	05/2014	05/23/2014	100.100	99.970	100.1	1
LG&E	C1SR	894831	05/2014	05/23/2014	100.030	99.880	99.9	1
LG&E	C1SR	894832	05/2014	05/23/2014	100.070	99.880	100.0	1
LG&E	C1SR	894833	05/2014	05/23/2014	100.090	99.880	100.0	1
LG&E	C1SR	894834	05/2014	05/23/2014	100.100	99.920	100.1	1
LG&E	C1SR	894835	05/2014	05/23/2014	100.030	99.890	100.0	1
LG&E	C1SR	894836	05/2014	05/23/2014	100.090	99.970	100.0	1
LG&E	C1SR	894837	05/2014	05/23/2014	100.040	99.820	99.9	1

LG&E	C1SR	894838	05/2014	05/23/2014	100.090	99.910	100.0	1
LG&E	C1SR	894839	05/2014	05/23/2014	100.060	99.920	100.1	1
LG&E	C1SR	894840	05/2014	05/23/2014	100.060	99.880	100.1	1
LG&E	C1SR	894841	05/2014	05/23/2014	100.060	99.820	100.0	1
LG&E	C1SR	894842	05/2014	05/23/2014	100.060	99.880	100.0	1
LG&E	C1SR	894843	05/2014	05/23/2014	100.070	100.010	100.0	1
LG&E	C1SR	894844	05/2014	05/23/2014	100.100	99.920	100.1	1
LG&E	C1SR	894845	05/2014	05/23/2014	100.070	99.940	99.9	1
LG&E	C1SR	894846	05/2014	05/23/2014	100.040	99.910	99.9	1
LG&E	C1SR	894847	05/2014	05/23/2014	100.080	99.950	100.0	1
LG&E	C1SR	894848	05/2014	05/23/2014	100.040	99.890	100.0	1
LG&E	C1SR	894849	05/2014	05/23/2014	100.080	99.980	100.0	1
LG&E	C1SR	894850	05/2014	05/23/2014	100.080	99.960	100.0	1
LG&E	C1SR	894851	05/2014	05/23/2014	100.070	99.970	100.0	1
LG&E	C1SR	894852	05/2014	05/23/2014	100.100	99.980	100.0	1
LG&E	C1SR	894853	05/2014	05/23/2014	100.060	99.880	100.0	1
LG&E	C1SR	894854	05/2014	05/23/2014	100.080	99.920	100.0	1
LG&E	C1SR	894855	05/2014	05/23/2014	100.050	99.910	100.0	1
LG&E	C1SR	894856	05/2014	05/23/2014	100.050	99.880	100.0	1
LG&E	C1SR	894857	05/2014	05/23/2014	100.060	99.930	100.0	1
LG&E	C1SR	894858	05/2014	05/23/2014	100.050	99.900	100.0	1
LG&E	C1SR	894859	05/2014	05/23/2014	100.100	99.980	100.0	1
LG&E	C1SR	894860	05/2014	05/23/2014	100.070	99.940	100.0	1
LG&E	C1SR	894861	05/2014	05/23/2014	100.040	99.850	99.9	1
LG&E	C1SR	894862	05/2014	05/23/2014	100.080	99.870	100.0	1
LG&E	C1SR	894863	05/2014	05/23/2014	100.100	99.910	100.0	1
LG&E	C1SR	894864	05/2014	05/23/2014	100.090	99.920	99.9	1
LG&E	C1SR	894865	05/2014	05/23/2014	100.040	99.850	99.9	1
LG&E	C1SR	894866	05/2014	05/23/2014	100.030	99.840	100.0	1
LG&E	C1SR	894867	05/2014	05/23/2014	100.070	99.940	100.0	1
LG&E	C1SR	894868	05/2014	05/23/2014	100.030	99.890	100.0	1
LG&E	C1SR	894869	05/2014	05/23/2014	100.030	99.840	100.0	1

LG&E	C1SR	894870	05/2014	05/23/2014	100.080	99.900	100.0	1
LG&E	C1SR	894871	05/2014	05/23/2014	100.070	99.990	99.9	1
LG&E	C1SR	894872	05/2014	05/23/2014	100.100	99.910	100.0	1
LG&E	C1SR	894873	05/2014	05/23/2014	100.060	99.880	100.0	1
LG&E	C1SR	894874	05/2014	05/23/2014	100.030	99.830	99.9	1
LG&E	C1SR	894875	05/2014	05/23/2014	100.040	99.840	99.9	1
LG&E	C1SR	894876	05/2014	05/23/2014	100.070	99.970	100.0	1
LG&E	C1SR	894877	05/2014	05/23/2014	100.070	99.910	100.0	1
LG&E	C1SR	894878	05/2014	05/23/2014	100.070	99.930	100.0	1
LG&E	C1SR	894879	05/2014	05/23/2014	100.060	99.990	100.0	1
LG&E	C1SR	894880	05/2014	05/23/2014	100.050	99.910	100.0	1
LG&E	C1SR	894881	05/2014	05/23/2014	100.060	99.880	99.9	1
LG&E	C1SR	894882	05/2014	05/23/2014	100.070	99.860	100.0	1
LG&E	C1SR	894883	05/2014	05/23/2014	100.050	99.950	100.0	1
LG&E	C1SR	894884	05/2014	05/23/2014	100.070	99.950	100.0	1
LG&E	C1SR	894885	05/2014	05/23/2014	100.080	99.820	100.0	1
LG&E	C1SR	894886	05/2014	05/23/2014	100.070	99.920	100.0	1
LG&E	C1SR	894887	05/2014	05/23/2014	100.060	99.880	100.0	1
LG&E	C1SR	894888	05/2014	05/23/2014	100.050	99.850	100.0	1
LG&E	C1SR	894889	05/2014	05/23/2014	100.100	99.980	100.1	1
LG&E	C1SR	894890	05/2014	05/23/2014	100.070	99.850	99.9	1
LG&E	C1SR	894891	05/2014	05/23/2014	100.050	99.970	99.9	1
LG&E	C1SR	894892	05/2014	05/23/2014	100.030	99.830	99.9	1
LG&E	C1SR	894893	05/2014	05/23/2014	100.090	99.880	100.1	1
LG&E	C1SR	894894	05/2014	05/23/2014	100.050	99.970	100.0	1
LG&E	C1SR	894895	05/2014	05/23/2014	100.030	99.890	100.0	1
LG&E	C1SR	894896	05/2014	05/23/2014	100.070	99.910	100.0	1
LG&E	C1SR	894897	05/2014	05/23/2014	100.070	99.890	100.0	1
LG&E	C1SR	894898	05/2014	05/23/2014	100.060	99.870	100.0	1
LG&E	C1SR	894899	05/2014	05/23/2014	100.050	99.870	100.1	1
LG&E	C1SR	894900	05/2014	05/23/2014	100.030	99.830	100.0	1
LG&E	C1SR	894901	05/2014	05/23/2014	100.040	99.930	100.0	1

LG&E	C1SR	894902	05/2014	05/23/2014	100.040	99.880	99.9	1
LG&E	C1SR	894903	05/2014	05/23/2014	100.080	99.920	100.0	1
LG&E	C1SR	894904	05/2014	05/23/2014	100.070	99.940	100.0	1
LG&E	C1SR	894905	05/2014	05/23/2014	100.070	99.920	100.0	1
LG&E	C1SR	894906	05/2014	05/23/2014	100.040	99.940	100.0	1
LG&E	C1SR	894907	05/2014	05/23/2014	100.100	99.860	100.1	1
LG&E	C1SR	894908	05/2014	05/23/2014	100.060	99.860	100.0	1
LG&E	C1SR	894909	05/2014	05/23/2014	100.060	99.940	100.0	1
LG&E	C1SR	894910	05/2014	05/23/2014	100.090	100.010	100.0	1
LG&E	C1SR	894911	05/2014	05/23/2014	100.070	99.900	100.0	1
LG&E	C1SR	894912	05/2014	05/23/2014	100.070	99.870	99.9	1
LG&E	C1SR	894913	05/2014	05/23/2014	100.080	99.980	100.0	1
LG&E	C1SR	894914	05/2014	05/23/2014	100.080	99.970	100.1	1
LG&E	C1SR	894915	05/2014	05/23/2014	100.030	99.850	100.0	1
LG&E	C1SR	894916	05/2014	05/23/2014	100.070	99.930	100.0	1
LG&E	C1SR	894917	05/2014	05/23/2014	100.070	99.850	100.1	1
LG&E	C1SR	894918	05/2014	05/23/2014	100.060	99.870	100.0	1
LG&E	C1SR	894919	05/2014	05/23/2014	100.030	99.900	100.0	1
LG&E	C1SR	894920	05/2014	05/23/2014	100.070	99.930	100.0	1
LG&E	C1SR	894921	05/2014	05/23/2014	100.040	99.910	99.9	1
LG&E	C1SR	894922	05/2014	05/23/2014	100.060	99.870	100.0	1
LG&E	C1SR	894923	05/2014	05/23/2014	100.050	99.890	100.0	1
LG&E	C1SR	894924	05/2014	05/23/2014	100.050	99.860	100.0	1
LG&E	C1SR	894925	05/2014	05/23/2014	100.070	99.960	100.0	1
LG&E	C1SR	894926	05/2014	05/23/2014	100.080	99.910	100.0	1
LG&E	C1SR	894927	05/2014	05/23/2014	100.070	99.930	100.0	1
LG&E	C1SR	894928	05/2014	05/23/2014	100.060	99.960	100.0	1
LG&E	C1SR	894929	05/2014	05/23/2014	100.050	99.930	100.0	1
LG&E	C1SR	894930	05/2014	05/23/2014	100.030	99.880	99.9	1
LG&E	C1SR	894931	05/2014	05/23/2014	100.060	99.820	100.0	1
LG&E	C1SR	894932	05/2014	05/23/2014	100.040	99.860	100.0	1
LG&E	C1SR	894933	05/2014	05/23/2014	100.050	99.890	100.0	1

LG&E	C1SR	894934	05/2014	05/23/2014	100.040	99.920	100.0	1
LG&E	C1SR	894935	05/2014	05/23/2014	100.040	99.880	100.0	1
LG&E	C1SR	894936	05/2014	05/23/2014	100.070	99.900	100.0	1
LG&E	C1SR	894937	05/2014	05/23/2014	100.040	99.920	99.9	1
LG&E	C1SR	894938	05/2014	05/23/2014	100.040	99.940	100.0	1
LG&E	C1SR	894939	05/2014	05/23/2014	100.080	99.840	100.0	1
LG&E	C1SR	894940	05/2014	05/23/2014	100.050	99.850	100.0	1
LG&E	C1SR	894941	05/2014	05/23/2014	100.060	99.890	100.0	1
LG&E	C1SR	894942	05/2014	05/23/2014	100.030	99.870	99.9	1
LG&E	C1SR	894943	05/2014	05/23/2014	100.050	99.920	100.0	1
LG&E	C1SR	894944	05/2014	05/23/2014	100.030	99.870	100.0	1
LG&E	C1SR	894945	05/2014	05/23/2014	100.040	99.900	99.9	1
LG&E	C1SR	894946	05/2014	05/23/2014	100.070	99.880	100.0	1
LG&E	C1SR	894947	05/2014	05/23/2014	100.070	99.950	100.0	1
LG&E	C1SR	894948	05/2014	05/23/2014	100.060	99.880	100.0	1
LG&E	C1SR	894949	05/2014	05/23/2014	100.090	99.910	100.1	1
LG&E	C1SR	894950	05/2014	05/23/2014	100.080	99.900	100.0	1
LG&E	C1SR	894951	05/2014	05/23/2014	100.060	99.870	100.0	1
LG&E	C1SR	894952	05/2014	05/23/2014	100.060	99.950	100.0	1
LG&E	C1SR	894953	05/2014	05/23/2014	100.100	99.950	100.1	1
LG&E	C1SR	894954	05/2014	05/23/2014	100.090	99.980	100.1	1
LG&E	C1SR	894955	05/2014	05/23/2014	100.060	99.870	100.0	1
LG&E	C1SR	894956	05/2014	05/23/2014	100.030	99.910	100.0	1
LG&E	C1SR	894957	05/2014	05/23/2014	100.050	99.940	100.1	1
LG&E	C1SR	894958	05/2014	05/23/2014	100.060	99.920	100.0	1
LG&E	C1SR	894959	05/2014	05/23/2014	100.060	99.870	100.0	1
LG&E	C1SR	894960	05/2014	05/23/2014	100.070	99.940	100.0	1
LG&E	C1SR	894961	05/2014	05/23/2014	100.090	99.940	99.9	1
LG&E	C1SR	894962	05/2014	05/23/2014	100.100	99.960	100.0	1
LG&E	C1SR	894963	05/2014	05/23/2014	100.090	99.880	100.0	1
LG&E	C1SR	894964	05/2014	05/23/2014	100.070	99.910	100.0	1
LG&E	C1SR	894965	05/2014	05/23/2014	100.060	99.840	99.9	1

LG&E	C1SR	894966	05/2014	05/23/2014	100.060	99.900	100.0	1
LG&E	C1SR	894967	05/2014	05/23/2014	100.070	99.940	99.9	1
LG&E	C1SR	894968	05/2014	05/23/2014	100.050	99.900	100.0	1
LG&E	C1SR	894969	05/2014	05/23/2014	100.060	99.920	100.0	1
LG&E	C1SR	894970	05/2014	05/23/2014	100.030	99.950	100.0	1
LG&E	C1SR	894971	05/2014	05/23/2014	100.070	99.880	100.0	1
LG&E	C1SR	894972	05/2014	05/23/2014	100.060	99.910	100.0	1
LG&E	C1SR	894973	05/2014	05/23/2014	100.060	99.900	99.9	1
LG&E	C1SR	894974	05/2014	05/23/2014	100.040	99.890	100.0	1
LG&E	C1SR	894975	05/2014	05/23/2014	100.050	99.860	100.0	1
LG&E	C1SR	894976	05/2014	05/23/2014	100.090	99.940	100.1	1
LG&E	C1SR	894977	05/2014	05/23/2014	100.060	99.930	100.0	1
LG&E	C1SR	894978	05/2014	05/23/2014	100.080	99.910	100.0	1
LG&E	C1SR	894979	05/2014	05/23/2014	100.060	99.900	99.9	1
LG&E	C1SR	894980	05/2014	05/23/2014	100.050	99.910	100.0	1
LG&E	C1SR	894981	05/2014	05/23/2014	100.070	99.920	100.0	1
LG&E	C1SR	894982	05/2014	05/23/2014	100.050	99.850	99.9	1
LG&E	C1SR	894983	05/2014	05/23/2014	100.070	99.830	100.0	1
LG&E	C1SR	894984	05/2014	05/23/2014	100.060	99.840	100.0	1
LG&E	C1SR	894985	05/2014	05/23/2014	100.070	99.930	100.0	1
LG&E	C1SR	894986	05/2014	05/23/2014	100.080	99.880	100.0	1
LG&E	C1SR	894987	05/2014	05/23/2014	100.060	99.870	99.9	1
LG&E	C1SR	894988	05/2014	05/23/2014	100.080	99.940	100.1	1
LG&E	C1SR	894989	05/2014	05/23/2014	100.070	99.960	100.0	1
LG&E	C1SR	894990	05/2014	05/23/2014	100.080	100.030	100.0	1
LG&E	C1SR	894991	05/2014	05/23/2014	100.070	99.910	100.0	1
LG&E	C1SR	894992	05/2014	05/23/2014	100.090	99.980	99.9	1
LG&E	C1SR	894993	05/2014	05/23/2014	100.070	99.970	99.9	1
LG&E	C1SR	894994	05/2014	05/23/2014	100.080	99.860	100.0	1
LG&E	C1SR	894995	05/2014	05/23/2014	100.070	99.860	100.1	1
LG&E	C1SR	894996	05/2014	05/23/2014	100.030	99.900	99.9	1
LG&E	C1SR	894997	05/2014	05/23/2014	100.080	99.910	100.0	1

LG&E	C1SR	894998	05/2014	05/23/2014	100.070	99.920	100.0	1
LG&E	C1SR	894999	05/2014	05/23/2014	100.070	99.950	100.0	1
LG&E	C1SR	895000	05/2014	05/23/2014	100.050	99.900	100.0	1
LG&E	C1SR	895001	05/2014	05/23/2014	100.030	99.860	99.9	1
LG&E	C1SR	895002	05/2014	05/23/2014	100.060	99.900	100.1	1
LG&E	C1SR	895003	05/2014	05/23/2014	100.050	99.890	100.0	1
LG&E	C1SR	895004	05/2014	05/23/2014	100.060	99.930	100.0	1
LG&E	C1SR	895005	05/2014	05/23/2014	100.080	99.940	100.0	1
LG&E	C1SR	895006	05/2014	05/23/2014	100.050	99.950	100.0	1
LG&E	C1SR	895007	05/2014	05/23/2014	100.090	99.910	100.1	1
LG&E	C1SR	895008	05/2014	05/23/2014	100.070	99.890	100.0	1
LG&E	C1SR	895009	05/2014	05/23/2014	100.080	99.910	100.0	1
LG&E	C1SR	895010	05/2014	05/23/2014	100.070	99.930	100.0	1
LG&E	C1SR	895011	05/2014	05/23/2014	100.100	99.960	100.1	1
LG&E	C1SR	895012	05/2014	05/23/2014	100.060	99.970	100.0	1
LG&E	C1SR	895013	05/2014	05/23/2014	100.030	99.860	99.9	1
LG&E	C1SR	895014	05/2014	05/23/2014	100.070	99.900	100.1	1
LG&E	C1SR	895015	05/2014	05/23/2014	100.060	99.900	99.9	1
LG&E	C1SR	895016	05/2014	05/23/2014	100.060	99.950	100.0	1
LG&E	C1SR	895017	05/2014	05/23/2014	100.070	99.840	100.1	1
LG&E	C1SR	895018	05/2014	05/23/2014	100.070	99.950	100.0	1
LG&E	C1SR	895019	05/2014	05/23/2014	100.080	99.960	100.1	1
LG&E	C1SR	895020	05/2014	05/23/2014	100.070	99.860	100.0	1
LG&E	C1SR	895021	05/2014	05/23/2014	100.090	99.960	100.0	1
LG&E	C1SR	895022	05/2014	05/23/2014	100.060	99.930	99.9	1
LG&E	C1SR	895023	05/2014	05/23/2014	100.070	99.880	100.0	1
LG&E	C1SR	895024	05/2014	05/23/2014	100.070	99.980	100.0	1
LG&E	C1SR	895025	05/2014	05/23/2014	100.030	99.910	99.9	1
LG&E	C1SR	895026	05/2014	05/23/2014	100.080	99.890	100.1	1
LG&E	C1SR	895027	05/2014	05/23/2014	100.050	99.900	100.0	1
LG&E	C1SR	895028	05/2014	05/23/2014	100.050	99.880	99.9	1
LG&E	C1SR	895029	05/2014	05/23/2014	100.080	99.880	100.0	1

LG&E	C1SR	895030	05/2014	05/23/2014	100.090	99.930	100.0	1
LG&E	C1SR	895031	05/2014	05/23/2014	100.040	99.880	100.0	1
LG&E	C1SR	895032	05/2014	05/23/2014	100.060	99.940	100.0	1
LG&E	C1SR	895033	05/2014	05/23/2014	100.030	99.890	100.0	1
LG&E	C1SR	895034	05/2014	05/23/2014	100.090	99.930	100.0	1
LG&E	C1SR	895035	05/2014	05/23/2014	100.090	99.900	100.1	1
LG&E	C1SR	895036	05/2014	05/23/2014	100.060	99.930	100.0	1
LG&E	C1SR	895037	05/2014	05/23/2014	100.030	99.820	100.0	1
LG&E	C1SR	895038	05/2014	05/23/2014	100.040	99.810	100.0	1
LG&E	C1SR	895039	05/2014	05/23/2014	100.090	99.910	100.1	1
LG&E	C1SR	895040	05/2014	05/23/2014	100.080	99.910	100.0	1
LG&E	C1SR	895041	05/2014	05/23/2014	100.050	99.970	99.9	1
LG&E	C1SR	895042	05/2014	05/23/2014	100.070	99.940	99.9	1
LG&E	C1SR	895043	05/2014	05/23/2014	100.100	99.890	100.0	1
LG&E	C1SR	895044	05/2014	05/23/2014	100.050	99.880	100.1	1
LG&E	C1SR	895045	05/2014	05/23/2014	100.070	99.870	100.0	1
LG&E	C1SR	895046	05/2014	05/23/2014	100.070	99.910	100.0	1
LG&E	C1SR	895047	05/2014	05/23/2014	100.050	99.880	99.9	1
LG&E	C1SR	895048	05/2014	05/23/2014	100.030	99.880	100.0	1
LG&E	C1SR	895049	05/2014	05/23/2014	100.040	99.860	99.9	1
LG&E	C1SR	895050	05/2014	05/23/2014	100.050	99.930	100.0	1
LG&E	C1SR	895051	05/2014	05/23/2014	100.060	99.910	100.1	1
LG&E	C1SR	895052	05/2014	05/23/2014	100.080	99.940	100.1	1
LG&E	C1SR	895053	05/2014	05/23/2014	100.090	99.900	100.1	1
LG&E	C1SR	895054	05/2014	05/23/2014	100.060	99.980	99.9	1
LG&E	C1SR	895055	05/2014	05/23/2014	100.060	99.820	100.0	1
LG&E	C1SR	895056	05/2014	05/23/2014	100.060	99.920	99.9	1
LG&E	C1SR	895057	05/2014	05/23/2014	100.090	99.880	100.1	1
LG&E	C1SR	895058	05/2014	05/23/2014	100.040	99.890	99.9	1
LG&E	C1SR	895059	05/2014	05/23/2014	100.080	99.870	100.0	1
LG&E	C1SR	895060	05/2014	05/23/2014	100.040	99.910	99.9	1
LG&E	C1SR	895061	05/2014	05/23/2014	100.090	100.000	100.0	1

LG&E	C1SR	895062	05/2014	05/23/2014	100.050	99.900	100.1	1
LG&E	C1SR	895063	05/2014	05/23/2014	100.070	99.860	100.0	1
LG&E	C1SR	895064	05/2014	05/23/2014	100.070	99.990	100.0	1
LG&E	C1SR	895065	05/2014	05/23/2014	100.080	99.930	99.9	1
LG&E	C1SR	895066	05/2014	05/23/2014	100.090	99.960	99.9	1
LG&E	C1SR	895067	05/2014	05/23/2014	100.090	99.890	100.0	1
LG&E	C1SR	895068	05/2014	05/23/2014	100.080	99.930	100.0	1
LG&E	C1SR	895069	05/2014	05/23/2014	100.060	99.850	100.0	1
LG&E	C1SR	895070	05/2014	05/23/2014	100.100	99.950	100.0	1
LG&E	C1SR	895071	05/2014	05/23/2014	100.100	99.970	99.9	1
LG&E	C1SR	895072	05/2014	05/23/2014	100.070	99.930	100.1	1
LG&E	C1SR	895073	05/2014	05/23/2014	100.090	99.960	100.1	1
LG&E	C1SR	895074	05/2014	05/23/2014	100.070	99.930	100.0	1
LG&E	C1SR	895075	05/2014	05/23/2014	100.070	99.880	100.0	1
LG&E	C1SR	895076	05/2014	05/23/2014	100.060	99.920	100.0	1
LG&E	C1SR	895077	05/2014	05/23/2014	100.090	99.870	100.0	1
LG&E	C1SR	895078	05/2014	05/23/2014	100.100	100.010	99.9	1
LG&E	C1SR	895079	05/2014	05/23/2014	100.070	99.860	100.0	1
LG&E	C1SR	895080	05/2014	05/23/2014	100.100	99.880	100.1	1
LG&E	C1SR	895081	05/2014	05/23/2014	100.040	99.840	100.0	1
LG&E	C1SR	895082	05/2014	05/23/2014	100.030	99.800	99.9	1
LG&E	C1SR	895083	05/2014	05/23/2014	100.090	99.930	99.9	1
LG&E	C1SR	895084	05/2014	05/23/2014	100.060	99.920	100.0	1
LG&E	C1SR	895085	05/2014	05/23/2014	100.070	99.930	100.0	1
LG&E	C1SR	895086	05/2014	05/23/2014	100.070	99.930	100.0	1
LG&E	C1SR	895087	05/2014	05/23/2014	100.100	99.990	100.1	1
LG&E	C1SR	895088	05/2014	05/23/2014	100.070	99.890	100.0	1
LG&E	C1SR	895089	05/2014	05/23/2014	100.090	99.900	100.0	1
LG&E	C1SR	895090	05/2014	05/23/2014	100.040	99.910	100.0	1
LG&E	C1SR	895091	05/2014	05/23/2014	100.090	99.960	100.1	1
LG&E	C1SR	895092	05/2014	05/23/2014	100.050	99.840	100.0	1
LG&E	C1SR	895093	05/2014	05/23/2014	100.060	99.880	100.0	1

LG&E	C1SR	895094	05/2014	05/23/2014	100.070	99.890	100.0	1
LG&E	C1SR	895095	05/2014	05/23/2014	100.060	99.850	100.0	1
LG&E	C1SR	895096	05/2014	05/23/2014	100.050	99.890	100.0	1
LG&E	C1SR	895097	05/2014	05/23/2014	100.050	99.950	100.0	1
LG&E	C1SR	895098	05/2014	05/23/2014	100.100	99.970	100.0	1
LG&E	C1SR	895099	05/2014	05/23/2014	100.100	99.850	100.0	1
LG&E	C1SR	895100	05/2014	05/23/2014	100.040	99.900	99.9	1
LG&E	C1SR	895101	05/2014	05/23/2014	100.040	99.920	100.0	1
LG&E	C1SR	895102	05/2014	05/23/2014	100.090	99.950	100.0	1
LG&E	C1SR	895103	05/2014	05/23/2014	100.100	99.930	99.9	1
LG&E	C1SR	895104	05/2014	05/23/2014	100.100	99.950	100.0	1
LG&E	C1SR	895105	05/2014	05/23/2014	100.090	99.920	100.0	1
LG&E	C1SR	895106	05/2014	05/23/2014	100.080	99.900	100.0	1
LG&E	C1SR	895107	05/2014	05/23/2014	100.040	99.870	99.9	1
LG&E	C1SR	895108	05/2014	05/23/2014	100.090	99.930	100.0	1
LG&E	C1SR	895109	05/2014	05/23/2014	100.040	99.850	99.9	1
LG&E	C1SR	895110	05/2014	05/23/2014	100.040	99.880	100.0	1
LG&E	C1SR	895111	05/2014	05/23/2014	100.100	99.890	100.1	1
LG&E	C1SR	895112	05/2014	05/23/2014	100.060	99.920	100.1	1
LG&E	C1SR	895113	05/2014	05/23/2014	100.060	99.860	100.0	1
LG&E	C1SR	895114	05/2014	05/23/2014	100.090	99.950	100.0	1
LG&E	C1SR	895115	05/2014	05/23/2014	100.030	99.890	100.0	1
LG&E	C1SR	895116	05/2014	05/23/2014	100.060	99.930	99.9	1
LG&E	C1SR	895117	05/2014	05/23/2014	100.050	99.910	100.0	1
LG&E	C1SR	895118	05/2014	05/23/2014	100.090	100.000	100.1	1
LG&E	C1SR	895119	05/2014	05/23/2014	100.080	99.950	100.1	1
LG&E	C1SR	895120	05/2014	05/23/2014	100.090	99.990	100.0	1
LG&E	C1SR	895121	05/2014	05/23/2014	100.100	99.920	100.0	1
LG&E	C1SR	895122	05/2014	05/23/2014	100.080	99.900	100.0	1
LG&E	C1SR	895123	05/2014	05/23/2014	100.050	99.870	100.0	1
LG&E	C1SR	895124	05/2014	05/23/2014	100.070	99.840	100.0	1
LG&E	C1SR	895125	05/2014	05/23/2014	100.070	99.940	100.0	1

LG&E	C1SR	895126	05/2014	05/23/2014	100.110	100.000	100.0	1
LG&E	C1SR	895127	05/2014	05/23/2014	100.090	99.930	100.0	1
LG&E	C1SR	895128	05/2014	05/23/2014	100.050	99.850	99.9	1
LG&E	C1SR	895129	05/2014	05/23/2014	100.100	99.970	100.0	1
LG&E	C1SR	895130	05/2014	05/23/2014	100.070	99.810	100.0	1
LG&E	C1SR	895131	05/2014	05/23/2014	100.060	99.880	99.9	1
LG&E	C1SR	895132	05/2014	05/23/2014	100.050	99.880	99.9	1
LG&E	C1SR	895133	05/2014	05/23/2014	100.030	99.920	100.0	1
LG&E	C1SR	895134	05/2014	05/23/2014	100.040	99.880	100.0	1
LG&E	C1SR	895135	05/2014	05/23/2014	100.070	99.920	100.0	1
LG&E	C1SR	895136	05/2014	05/23/2014	100.070	99.980	100.1	1
LG&E	C1SR	895137	05/2014	05/23/2014	100.100	99.960	100.0	1
LG&E	C1SR	895138	05/2014	05/23/2014	100.060	99.890	99.9	1
LG&E	C1SR	895139	05/2014	05/23/2014	100.100	99.990	100.1	1
LG&E	C1SR	895140	05/2014	05/23/2014	100.070	99.920	100.0	1
LG&E	C1SR	895141	05/2014	05/23/2014	100.080	99.980	100.0	1
LG&E	C1SR	895142	05/2014	05/23/2014	100.090	99.950	99.9	1
LG&E	C1SR	895143	05/2014	05/23/2014	100.080	99.970	100.0	1
LG&E	C1SR	895144	05/2014	05/23/2014	100.070	99.940	100.0	1
LG&E	C1SR	895145	05/2014	05/23/2014	100.060	99.910	100.0	1
LG&E	C1SR	895146	05/2014	05/23/2014	100.100	99.900	100.1	1
LG&E	C1SR	895147	05/2014	05/23/2014	100.040	99.910	100.0	1
LG&E	C1SR	895148	05/2014	05/23/2014	100.070	99.880	100.0	1
LG&E	C1SR	895149	05/2014	05/23/2014	100.100	99.900	100.0	1
LG&E	C1SR	895150	05/2014	05/23/2014	100.030	99.910	100.0	1
LG&E	C1SR	895151	05/2014	05/23/2014	100.050	99.860	100.0	1
LG&E	C1SR	895152	05/2014	05/23/2014	100.070	99.930	99.9	1
LG&E	C1SR	895153	05/2014	05/23/2014	100.050	99.910	100.1	1
LG&E	C1SR	895154	05/2014	05/23/2014	100.090	100.000	100.1	1
LG&E	C1SR	895155	05/2014	05/23/2014	100.070	99.950	99.9	1
LG&E	C1SR	895156	05/2014	05/23/2014	100.070	99.980	100.0	1
LG&E	C1SR	895157	05/2014	05/23/2014	100.050	99.890	100.0	1

LG&E	C1SR	895158	05/2014	05/23/2014	100.060	99.860	100.0	1
LG&E	C1SR	895159	05/2014	05/23/2014	100.060	99.890	99.9	1
LG&E	C1SR	895160	05/2014	05/23/2014	100.110	99.920	100.0	1
LG&E	C1SR	895161	05/2014	05/23/2014	100.040	99.940	99.9	1
LG&E	C1SR	895162	05/2014	05/23/2014	100.060	99.900	100.0	1
LG&E	C1SR	895163	05/2014	05/23/2014	100.070	99.880	100.0	1
LG&E	C1SR	895164	05/2014	05/23/2014	100.060	99.890	99.9	1
LG&E	C1SR	895165	05/2014	05/23/2014	100.100	99.950	100.0	1
LG&E	C1SR	895166	05/2014	05/23/2014	100.100	99.880	100.0	1
LG&E	C1SR	895167	05/2014	05/23/2014	100.080	99.920	99.9	1
LG&E	C1SR	895168	05/2014	05/23/2014	100.070	99.880	99.9	1
LG&E	C1SR	895169	05/2014	05/23/2014	100.080	100.000	100.0	1
LG&E	C1SR	895170	05/2014	05/23/2014	100.090	99.900	99.9	1
LG&E	C1SR	895171	05/2014	05/23/2014	100.070	99.870	100.0	1
LG&E	C1SR	895172	05/2014	05/23/2014	100.070	99.980	100.1	1
LG&E	C1SR	895173	05/2014	05/23/2014	100.060	99.940	100.0	1
LG&E	C1SR	895174	05/2014	05/23/2014	100.080	99.880	100.0	1
LG&E	C1SR	895175	05/2014	05/23/2014	100.090	99.920	100.1	1
LG&E	C1SR	895176	05/2014	05/23/2014	100.030	99.900	100.0	1
LG&E	C1SR	895177	05/2014	05/23/2014	100.040	99.880	99.9	1
LG&E	C1SR	895178	05/2014	05/23/2014	100.060	99.870	100.0	1
LG&E	C1SR	895179	05/2014	05/23/2014	100.060	99.860	99.9	1
LG&E	C1SR	895180	05/2014	05/23/2014	100.080	99.960	100.0	1
LG&E	C1SR	895181	05/2014	05/23/2014	100.030	99.860	100.0	1
LG&E	C1SR	895182	05/2014	05/23/2014	100.100	99.910	100.1	1
LG&E	C1SR	895183	05/2014	05/23/2014	100.050	99.900	100.0	1
LG&E	C1SR	895184	05/2014	05/23/2014	100.090	99.910	100.0	1
LG&E	C1SR	895185	05/2014	05/23/2014	100.030	99.900	99.9	1
LG&E	C1SR	895186	05/2014	05/23/2014	100.050	99.900	100.0	1
LG&E	C1SR	895187	05/2014	05/23/2014	100.080	99.910	99.9	1
LG&E	C1SR	895188	05/2014	05/23/2014	100.080	99.910	99.9	1
LG&E	C1SR	895189	05/2014	05/23/2014	100.100	99.930	100.0	1

LG&E	C1SR	895190	05/2014	05/23/2014	100.060	99.900	100.0	1
LG&E	C1SR	895191	05/2014	05/23/2014	100.050	99.890	100.0	1
LG&E	C1SR	895192	05/2014	05/23/2014	100.090	99.920	100.1	1
LG&E	C1SR	895193	05/2014	05/23/2014	100.080	99.980	100.0	1
LG&E	C1SR	895194	05/2014	05/23/2014	100.070	99.920	100.0	1
LG&E	C1SR	895195	05/2014	05/23/2014	100.040	99.900	100.0	1
LG&E	C1SR	895196	05/2014	05/23/2014	100.070	99.890	100.0	1
LG&E	C1SR	895197	05/2014	05/23/2014	100.050	99.870	100.0	1
LG&E	C1SR	895198	05/2014	05/23/2014	100.100	99.960	100.1	1
LG&E	C1SR	895199	05/2014	05/23/2014	100.030	99.910	100.0	1
LG&E	C1SR	895200	05/2014	05/23/2014	100.070	99.910	100.1	1
LG&E	C1SR	895201	05/2014	05/23/2014	100.090	100.020	99.9	1
LG&E	C1SR	895202	05/2014	05/23/2014	100.100	99.940	100.0	1
LG&E	C1SR	895203	05/2014	05/23/2014	100.040	99.860	99.9	1
LG&E	C1SR	895204	05/2014	05/23/2014	100.070	99.920	100.1	1
LG&E	C1SR	895205	05/2014	05/23/2014	100.060	99.900	100.0	1
LG&E	C1SR	895206	05/2014	05/23/2014	100.080	99.930	100.1	1
LG&E	C1SR	895207	05/2014	05/23/2014	100.060	99.920	100.0	1
LG&E	C1SR	895208	05/2014	05/23/2014	100.050	99.960	100.0	1
LG&E	C1SR	895209	05/2014	05/23/2014	100.040	99.870	99.9	1
LG&E	C1SR	895210	05/2014	05/23/2014	100.090	99.960	99.9	1
LG&E	C1SR	895211	05/2014	05/23/2014	100.040	99.860	100.0	1
LG&E	C1SR	895212	05/2014	05/23/2014	100.060	99.920	99.9	1
LG&E	C1SR	895213	05/2014	05/23/2014	100.100	99.970	100.0	1
LG&E	C1SR	895214	05/2014	05/23/2014	100.100	100.000	100.1	1
LG&E	C1SR	895215	05/2014	05/23/2014	100.090	99.920	100.0	1
LG&E	C1SR	895216	05/2014	05/23/2014	100.090	99.890	100.0	1
LG&E	C1SR	895217	05/2014	05/23/2014	100.080	99.950	100.0	1
LG&E	C1SR	895218	05/2014	05/23/2014	100.070	99.910	100.0	1
LG&E	C1SR	895219	05/2014	05/23/2014	100.030	99.820	99.9	1
LG&E	C1SR	895220	05/2014	05/23/2014	100.060	99.890	99.9	1
LG&E	C1SR	895221	05/2014	05/23/2014	100.110	99.870	100.1	1

LG&E	C1SR	895222	05/2014	05/23/2014	100.040	99.920	100.0	1
LG&E	C1SR	895223	05/2014	05/23/2014	100.030	99.860	99.9	1
LG&E	C1SR	895224	05/2014	05/23/2014	100.060	99.960	100.1	1
LG&E	C1SR	895225	05/2014	05/23/2014	100.090	99.930	100.0	1
LG&E	C1SR	895226	05/2014	05/23/2014	100.050	99.810	100.0	1
LG&E	C1SR	895227	05/2014	05/23/2014	100.030	99.870	100.0	1
LG&E	C1SR	895228	05/2014	05/23/2014	100.100	100.010	100.1	1
LG&E	C1SR	895229	05/2014	05/23/2014	100.040	99.840	99.9	1
LG&E	C1SR	895230	05/2014	05/23/2014	100.100	99.980	100.0	1
LG&E	C1SR	895231	05/2014	05/23/2014	100.060	99.920	100.0	1
LG&E	C1SR	895232	05/2014	05/23/2014	100.100	99.960	100.0	1
LG&E	C1SR	895233	05/2014	05/23/2014	100.060	99.880	100.0	1
LG&E	C1SR	895234	05/2014	05/23/2014	100.080	99.940	100.1	1
LG&E	C1SR	895235	05/2014	05/23/2014	100.070	99.890	99.9	1
LG&E	C1SR	895236	05/2014	05/23/2014	100.080	99.930	100.0	1
LG&E	C1SR	895237	05/2014	05/23/2014	100.080	99.880	100.0	1
LG&E	C1SR	895238	05/2014	05/23/2014	100.060	99.880	99.9	1
LG&E	C1SR	895239	05/2014	05/23/2014	100.070	99.910	100.1	1
LG&E	C1SR	895240	05/2014	05/23/2014	100.040	99.900	99.9	1
LG&E	C1SR	895241	05/2014	05/23/2014	100.080	99.890	100.1	1
LG&E	C1SR	895242	05/2014	05/23/2014	100.080	99.950	100.1	1
LG&E	C1SR	895243	05/2014	05/23/2014	100.040	99.860	100.0	1
LG&E	C1SR	895244	05/2014	05/23/2014	100.080	99.900	100.1	1
LG&E	C1SR	895245	05/2014	05/23/2014	100.040	99.860	100.0	1
LG&E	C1SR	895246	05/2014	05/23/2014	100.080	99.860	100.0	1
LG&E	C1SR	895247	05/2014	05/23/2014	100.060	100.010	100.0	1
LG&E	C1SR	895248	05/2014	05/23/2014	100.060	99.870	100.0	1
LG&E	C1SR	895249	05/2014	05/23/2014	100.050	99.900	100.0	1
LG&E	C1SR	895250	05/2014	05/23/2014	100.060	99.920	100.0	1
LG&E	C1SR	895251	05/2014	05/23/2014	100.060	99.880	100.0	1
LG&E	C1SR	895252	05/2014	05/23/2014	100.080	99.960	100.0	1
LG&E	C1SR	895253	05/2014	05/23/2014	100.050	99.850	99.9	1

LG&E	C1SR	895254	05/2014	05/23/2014	100.030	99.900	99.9	1
LG&E	C1SR	895255	05/2014	05/23/2014	100.100	99.990	100.0	1
LG&E	C1SR	895256	05/2014	05/23/2014	100.060	99.930	100.0	1
LG&E	C1SR	895257	05/2014	05/23/2014	100.100	99.910	99.9	1
LG&E	C1SR	895258	05/2014	05/23/2014	100.060	99.880	100.0	1
LG&E	C1SR	895259	05/2014	05/23/2014	100.040	99.900	100.0	1
LG&E	C1SR	895260	05/2014	05/23/2014	100.090	99.930	100.0	1
LG&E	C1SR	895261	05/2014	05/23/2014	100.040	99.910	100.0	1
LG&E	C1SR	895262	05/2014	05/23/2014	100.070	99.920	100.0	1
LG&E	C1SR	895263	05/2014	05/23/2014	100.040	99.920	100.1	1
LG&E	C1SR	895264	05/2014	05/23/2014	100.080	99.900	100.0	1
LG&E	C1SR	895265	05/2014	05/23/2014	100.080	99.960	100.0	1
LG&E	C1SR	895266	05/2014	05/23/2014	100.090	99.900	100.0	1
LG&E	C1SR	895267	05/2014	05/23/2014	100.070	99.840	100.0	1
LG&E	C1SR	895268	05/2014	05/23/2014	100.100	99.940	100.1	1
LG&E	C1SR	895269	05/2014	05/23/2014	100.080	99.880	100.1	1
LG&E	C1SR	895270	05/2014	05/23/2014	100.030	99.830	99.9	1
LG&E	C1SR	895271	05/2014	05/23/2014	100.070	99.920	99.9	1
LG&E	C1SR	895272	05/2014	05/23/2014	100.100	99.940	100.0	1
LG&E	C1SR	895273	05/2014	05/23/2014	100.060	99.900	100.0	1
LG&E	C1SR	895274	05/2014	05/23/2014	100.070	99.950	100.0	1
LG&E	C1SR	895275	05/2014	05/23/2014	100.040	99.800	99.9	1
LG&E	C1SR	895276	05/2014	05/23/2014	100.070	99.990	100.0	1
LG&E	C1SR	895277	05/2014	05/23/2014	100.070	99.920	100.1	1
LG&E	C1SR	895278	05/2014	05/23/2014	100.050	99.950	100.0	1
LG&E	C1SR	895279	05/2014	05/23/2014	100.080	99.950	99.9	1
LG&E	C1SR	895280	05/2014	05/23/2014	100.100	100.020	100.0	1
LG&E	C1SR	895281	05/2014	05/23/2014	100.040	99.900	100.0	1
LG&E	C1SR	895282	05/2014	05/23/2014	100.080	99.930	100.0	1
LG&E	C1SR	895283	05/2014	05/23/2014	100.060	99.920	99.9	1
LG&E	C1SR	895284	05/2014	05/23/2014	100.100	99.940	100.0	1
LG&E	C1SR	895285	05/2014	05/23/2014	100.060	99.920	100.0	1

LG&E	C1SR	895286	05/2014	05/23/2014	100.090	99.970	99.9	1
LG&E	C1SR	895287	05/2014	05/23/2014	100.080	99.970	100.0	1
LG&E	C1SR	895288	05/2014	05/23/2014	100.100	99.980	100.1	1
LG&E	C1SR	895289	05/2014	05/23/2014	100.060	99.920	100.0	1
LG&E	C1SR	895290	05/2014	05/23/2014	100.080	99.970	100.0	1
LG&E	C1SR	895291	05/2014	05/23/2014	100.050	99.900	100.0	1
LG&E	C1SR	895292	05/2014	05/23/2014	100.100	99.930	100.0	1
LG&E	C1SR	895293	05/2014	05/23/2014	100.100	99.920	100.0	1
LG&E	C1SR	895294	05/2014	05/23/2014	100.040	99.900	100.0	1
LG&E	C1SR	895295	05/2014	05/23/2014	100.080	99.940	100.0	1
LG&E	C1SR	895296	05/2014	05/23/2014	100.090	99.860	100.0	1
LG&E	C1SR	895297	05/2014	05/23/2014	100.050	99.900	100.0	1
LG&E	C1SR	895298	05/2014	05/23/2014	100.070	99.820	100.0	1
LG&E	C1SR	895299	05/2014	05/23/2014	100.070	99.920	100.0	1
LG&E	C1SR	895300	05/2014	05/23/2014	100.060	99.890	100.0	1
LG&E	C1SR	895301	05/2014	05/23/2014	100.040	99.880	99.9	1
LG&E	C1SR	895302	05/2014	05/23/2014	100.070	99.870	99.9	1
LG&E	C1SR	895303	05/2014	05/23/2014	100.070	99.950	99.9	1
LG&E	C1SR	895304	05/2014	05/23/2014	100.070	99.890	99.9	1
LG&E	C1SR	895305	05/2014	05/23/2014	100.050	99.850	99.9	1
LG&E	C1SR	895306	05/2014	05/23/2014	100.070	99.870	100.1	1
LG&E	C1SR	895307	05/2014	05/23/2014	100.100	99.990	99.9	1
LG&E	C1SR	895308	05/2014	05/23/2014	100.040	99.950	100.0	1
LG&E	C1SR	895309	05/2014	05/23/2014	100.090	99.940	100.0	1
LG&E	C1SR	895310	05/2014	05/23/2014	100.060	99.920	100.1	1
LG&E	C1SR	895311	05/2014	05/23/2014	100.080	99.900	100.0	1
LG&E	C1SR	895312	05/2014	05/23/2014	100.050	99.900	100.0	1
LG&E	C1SR	895313	05/2014	05/23/2014	100.060	99.910	100.0	1
LG&E	C1SR	895314	05/2014	05/23/2014	100.060	99.890	100.0	1
LG&E	C1SR	895315	05/2014	05/23/2014	100.060	99.950	100.0	1
LG&E	C1SR	895316	05/2014	05/23/2014	100.100	99.910	99.9	1
LG&E	C1SR	895317	05/2014	05/23/2014	100.100	99.970	100.0	1

LG&E	C1SR	895318	05/2014	05/23/2014	100.070	99.910	100.0	1
LG&E	C1SR	895319	05/2014	05/23/2014	100.090	99.960	100.1	1
LG&E	C1SR	895320	05/2014	05/23/2014	100.070	99.930	100.0	1
LG&E	C1SR	895321	05/2014	05/23/2014	100.070	99.850	100.0	1
LG&E	C1SR	895322	05/2014	05/23/2014	100.060	99.920	99.9	1
LG&E	C1SR	895323	05/2014	05/23/2014	100.090	99.970	100.0	1
LG&E	C1SR	895324	05/2014	05/23/2014	100.060	99.850	99.9	1
LG&E	C1SR	895325	05/2014	05/23/2014	100.060	99.910	100.0	1
LG&E	C1SR	895326	05/2014	05/23/2014	100.060	99.890	100.0	1
LG&E	C1SR	895327	05/2014	05/23/2014	100.070	99.900	100.0	1
LG&E	C1SR	895328	05/2014	05/23/2014	100.080	99.840	100.0	1
LG&E	C1SR	895329	05/2014	05/23/2014	100.070	99.920	100.1	1
LG&E	C1SR	895330	05/2014	05/23/2014	100.050	99.930	99.9	1
LG&E	C1SR	895331	05/2014	05/23/2014	100.030	99.830	100.0	1
LG&E	C1SR	895332	05/2014	05/23/2014	100.070	99.910	99.9	1
LG&E	C1SR	895333	05/2014	05/23/2014	100.100	99.930	100.1	1
LG&E	C1SR	895334	05/2014	05/23/2014	100.090	99.980	100.0	1
LG&E	C1SR	895335	05/2014	05/23/2014	100.030	99.890	99.9	1
LG&E	C1SR	895336	05/2014	05/23/2014	100.030	99.860	99.9	1
LG&E	C1SR	895337	05/2014	05/23/2014	100.070	99.870	100.1	1
LG&E	C1SR	895338	05/2014	05/23/2014	100.090	99.930	100.0	1
LG&E	C1SR	895339	05/2014	05/23/2014	100.100	99.980	100.0	1
LG&E	C1SR	895340	05/2014	05/23/2014	100.060	99.840	100.0	1
LG&E	C1SR	895341	05/2014	05/23/2014	100.080	99.930	99.9	1
LG&E	C1SR	895342	05/2014	05/23/2014	100.040	99.900	100.0	1
LG&E	C1SR	895343	05/2014	05/23/2014	100.100	99.950	100.0	1
LG&E	C1SR	895344	05/2014	05/23/2014	100.090	99.940	100.0	1
LG&E	C1SR	895345	05/2014	05/23/2014	100.040	99.870	100.0	1
LG&E	C1SR	895346	05/2014	05/23/2014	100.070	99.920	100.0	1
LG&E	C1SR	895347	05/2014	05/23/2014	100.030	99.880	100.0	1
LG&E	C1SR	895348	05/2014	05/23/2014	100.090	99.960	100.0	1
LG&E	C1SR	895349	05/2014	05/23/2014	100.090	99.910	100.0	1

LG&E	C1SR	895350	05/2014	05/23/2014	100.070	99.920	100.0	1
LG&E	C1SR	895351	05/2014	05/23/2014	100.060	99.910	99.9	1
LG&E	C1SR	895352	05/2014	05/23/2014	100.070	99.960	100.0	1
LG&E	C1SR	895353	05/2014	05/23/2014	100.050	99.880	100.0	1
LG&E	C1SR	895354	05/2014	05/23/2014	100.100	99.920	100.1	1
LG&E	C1SR	895355	05/2014	05/23/2014	100.100	99.950	100.0	1
LG&E	C1SR	895356	05/2014	05/23/2014	100.070	99.950	100.0	1
LG&E	C1SR	895357	05/2014	05/23/2014	100.060	99.950	99.9	1
LG&E	C1SR	895358	05/2014	05/23/2014	100.060	99.880	100.0	1
LG&E	C1SR	895359	05/2014	05/23/2014	100.060	99.920	99.9	1
LG&E	C1SR	895360	05/2014	05/23/2014	100.060	99.870	100.0	1
LG&E	C1SR	895361	05/2014	05/23/2014	100.080	99.930	100.0	1
LG&E	C1SR	895362	05/2014	05/23/2014	100.060	99.920	100.0	1
LG&E	C1SR	895363	05/2014	05/23/2014	100.100	99.920	99.9	1
LG&E	C1SR	895364	05/2014	05/23/2014	100.080	99.930	99.9	1
LG&E	C1SR	895365	05/2014	05/23/2014	100.090	99.940	99.9	1
LG&E	C1SR	895366	05/2014	05/23/2014	100.090	99.920	100.0	1
LG&E	C1SR	895367	05/2014	05/23/2014	100.050	99.950	100.0	1
LG&E	C1SR	895368	05/2014	05/23/2014	100.100	99.900	100.0	1
LG&E	C1SR	895369	05/2014	05/23/2014	100.080	99.920	99.9	1
LG&E	C1SR	895370	05/2014	05/23/2014	100.060	99.910	100.0	1
LG&E	C1SR	895371	05/2014	05/23/2014	100.040	99.890	99.9	1
LG&E	C1SR	895372	05/2014	05/23/2014	100.050	99.940	100.1	1
LG&E	C1SR	895373	05/2014	05/23/2014	100.090	99.930	100.1	1
LG&E	C1SR	895374	05/2014	05/23/2014	100.040	99.880	99.9	1
LG&E	C1SR	895375	05/2014	05/23/2014	100.040	99.880	100.0	1
LG&E	C1SR	895376	05/2014	05/23/2014	100.070	99.900	99.9	1
LG&E	C1SR	895377	05/2014	05/23/2014	100.060	99.900	100.0	1
LG&E	C1SR	895378	05/2014	05/23/2014	100.090	99.900	100.0	1
LG&E	C1SR	895379	05/2014	05/23/2014	100.100	99.900	100.0	1
LG&E	C1SR	895380	05/2014	05/23/2014	100.100	99.960	100.0	1
LG&E	C1SR	895381	05/2014	05/23/2014	100.090	99.910	100.0	1

LG&E	C1SR	895382	05/2014	05/23/2014	100.090	99.990	100.0	1
LG&E	C1SR	895383	05/2014	05/23/2014	100.090	99.970	100.0	1
LG&E	C1SR	895384	05/2014	05/23/2014	100.060	99.870	100.0	1
LG&E	C1SR	895385	05/2014	05/23/2014	100.040	99.840	100.0	1
LG&E	C1SR	895386	05/2014	05/23/2014	100.070	99.860	100.0	1
LG&E	C1SR	895387	05/2014	05/23/2014	100.080	99.900	100.1	1
LG&E	C1SR	895388	05/2014	05/23/2014	100.100	99.920	100.0	1
LG&E	C1SR	895389	05/2014	05/23/2014	100.070	99.900	100.0	1
LG&E	C1SR	895390	05/2014	05/23/2014	100.080	99.920	99.9	1
LG&E	C1SR	895391	05/2014	05/23/2014	100.070	99.940	100.0	1
LG&E	C1SR	895392	05/2014	05/23/2014	100.080	99.890	100.0	1
LG&E	C1SR	895393	05/2014	05/23/2014	100.060	99.870	99.9	1
LG&E	C1SR	895394	05/2014	05/23/2014	100.080	99.870	99.9	1
LG&E	C1SR	895395	05/2014	05/23/2014	100.060	99.890	100.0	1
LG&E	C1SR	895396	05/2014	05/23/2014	100.070	99.930	100.0	1
LG&E	C1SR	895397	05/2014	05/23/2014	100.070	99.960	100.0	1
LG&E	C1SR	895398	05/2014	05/23/2014	100.060	99.890	100.0	1
LG&E	C1SR	895399	05/2014	05/23/2014	100.060	99.940	99.9	1
LG&E	C1SR	895400	05/2014	05/23/2014	100.080	100.020	100.0	1
LG&E	C1SR	895401	05/2014	05/23/2014	100.080	99.900	99.9	1
LG&E	C1SR	895402	05/2014	05/23/2014	100.070	99.930	100.0	1
LG&E	C1SR	895403	05/2014	05/23/2014	100.090	99.900	100.0	1
LG&E	C1SR	895404	05/2014	05/23/2014	100.060	99.910	100.0	1
LG&E	C1SR	895405	05/2014	05/23/2014	100.040	99.850	100.0	1
LG&E	C1SR	895406	05/2014	05/23/2014	100.070	99.910	100.0	1
LG&E	C1SR	895407	05/2014	05/23/2014	100.030	99.850	100.0	1
LG&E	C1SR	895408	05/2014	05/23/2014	100.100	99.980	100.1	1
LG&E	C1SR	895409	05/2014	05/23/2014	100.090	100.000	100.1	1
LG&E	C1SR	895410	05/2014	05/23/2014	100.100	99.960	100.0	1
LG&E	C1SR	895411	05/2014	05/23/2014	100.070	99.920	100.0	1
LG&E	C1SR	895412	05/2014	05/23/2014	100.070	99.980	99.9	1
LG&E	C1SR	895413	05/2014	05/23/2014	100.030	99.860	100.0	1

LG&E	C1SR	895414	05/2014	05/23/2014	100.090	99.980	100.0	1
LG&E	C1SR	895415	05/2014	05/23/2014	100.040	99.860	99.9	1
LG&E	C1SR	895416	05/2014	05/23/2014	100.080	99.940	100.0	1
LG&E	C1SR	895417	05/2014	05/23/2014	100.060	99.930	100.1	1
LG&E	C1SR	895418	05/2014	05/23/2014	100.060	99.930	100.0	1
LG&E	C1SR	895419	05/2014	05/23/2014	100.100	99.940	99.9	1
LG&E	C1SR	895420	05/2014	05/23/2014	100.040	99.860	100.0	1
LG&E	C1SR	895421	05/2014	05/23/2014	100.100	100.020	100.0	1
LG&E	C1SR	895422	05/2014	05/23/2014	100.060	99.880	100.0	1
LG&E	C1SR	895423	05/2014	05/23/2014	100.060	99.900	100.0	1
LG&E	C1SR	895424	05/2014	05/23/2014	100.040	99.880	100.0	1
LG&E	C1SR	895425	05/2014	05/23/2014	100.090	99.950	100.0	1
LG&E	C1SR	895426	05/2014	05/23/2014	100.050	99.860	100.0	1
LG&E	C1SR	895427	05/2014	05/23/2014	100.070	99.900	99.9	1
LG&E	C1SR	895428	05/2014	05/23/2014	100.100	99.900	100.1	1
LG&E	C1SR	895429	05/2014	05/23/2014	100.070	99.900	100.0	1
LG&E	C1SR	895430	05/2014	05/23/2014	100.070	99.920	99.9	1
LG&E	C1SR	895431	05/2014	05/23/2014	100.090	100.040	100.1	1
LG&E	C1SR	895432	05/2014	05/23/2014	100.090	99.900	99.9	1
LG&E	C1SR	895433	05/2014	05/23/2014	100.050	99.890	100.1	1
LG&E	C1SR	895434	05/2014	05/23/2014	100.050	99.860	100.0	1
LG&E	C1SR	895435	05/2014	05/23/2014	100.090	99.940	100.0	1
LG&E	C1SR	895436	05/2014	05/23/2014	100.100	99.980	100.0	1
LG&E	C1SR	895437	05/2014	05/23/2014	100.090	99.900	100.0	1
LG&E	C1SR	895438	05/2014	05/23/2014	100.080	100.010	99.9	1
LG&E	C1SR	895439	05/2014	05/23/2014	100.070	99.870	99.9	1
LG&E	C1SR	895440	05/2014	05/23/2014	100.100	99.900	100.0	1
LG&E	C1SR	895441	05/2014	05/23/2014	100.080	99.940	100.1	1
LG&E	C1SR	895442	05/2014	05/23/2014	100.070	99.940	100.0	1
LG&E	C1SR	895443	05/2014	05/23/2014	100.050	99.900	100.0	1
LG&E	C1SR	895444	05/2014	05/23/2014	100.060	99.920	100.0	1
LG&E	C1SR	895445	05/2014	05/23/2014	100.100	99.920	100.0	1

LG&E	C1SR	895446	05/2014	05/23/2014	100.100	99.960	100.0	1
LG&E	C1SR	895447	05/2014	05/23/2014	100.070	99.930	99.9	1
LG&E	C1SR	895448	05/2014	05/23/2014	100.050	99.880	100.0	1
LG&E	C1SR	895449	05/2014	05/23/2014	100.050	99.940	99.9	1
LG&E	C1SR	895450	05/2014	05/23/2014	100.030	99.850	100.0	1
LG&E	C1SR	895451	05/2014	05/23/2014	100.070	99.880	100.0	1
LG&E	C1SR	895452	05/2014	05/23/2014	100.050	99.930	100.0	1
LG&E	C1SR	895453	05/2014	05/23/2014	100.070	99.950	100.0	1
LG&E	C1SR	895454	05/2014	05/23/2014	100.070	99.880	100.0	1
LG&E	C1SR	895455	05/2014	05/23/2014	100.070	100.000	100.0	1
LG&E	C1SR	895456	05/2014	05/23/2014	100.070	99.950	100.0	1
LG&E	C1SR	895457	05/2014	05/23/2014	100.100	99.960	100.0	1
LG&E	C1SR	895458	05/2014	05/23/2014	100.080	99.980	100.0	1
LG&E	C1SR	895459	05/2014	05/23/2014	100.090	99.970	99.9	1
LG&E	C1SR	895460	05/2014	05/23/2014	100.060	99.900	100.0	1
LG&E	C1SR	895461	05/2014	05/23/2014	100.070	99.920	100.1	1
LG&E	C1SR	895462	05/2014	05/23/2014	100.060	99.960	100.0	1
LG&E	C1SR	895463	05/2014	05/23/2014	100.080	99.940	100.0	1
LG&E	C1SR	895464	05/2014	05/23/2014	100.080	99.940	100.0	1
LG&E	C1SR	895465	05/2014	05/23/2014	100.090	99.920	100.1	1
LG&E	C1SR	895466	05/2014	05/23/2014	100.060	99.910	100.0	1
LG&E	C1SR	895467	05/2014	05/23/2014	100.100	99.890	100.1	1
LG&E	C1SR	895468	05/2014	05/23/2014	100.080	99.940	100.1	1
LG&E	C1SR	895469	05/2014	05/23/2014	100.100	99.970	100.0	1
LG&E	C1SR	895470	05/2014	05/23/2014	100.080	99.930	100.0	1
LG&E	C1SR	895471	05/2014	05/23/2014	100.060	99.940	100.0	1
LG&E	C1SR	895472	05/2014	05/23/2014	100.080	99.930	100.0	1
LG&E	C1SR	895473	05/2014	05/23/2014	100.030	99.870	100.0	1
LG&E	C1SR	895474	05/2014	05/23/2014	100.100	99.960	100.0	1
LG&E	C1SR	895475	05/2014	05/23/2014	100.070	99.930	100.0	1
LG&E	C1SR	895476	05/2014	05/23/2014	100.030	99.910	99.9	1
LG&E	C1SR	895477	05/2014	05/23/2014	100.080	99.980	100.0	1

LG&E	C1SR	895478	05/2014	05/23/2014	100.030	99.900	99.9	1
LG&E	C1SR	895479	05/2014	05/23/2014	100.060	99.930	100.0	1
LG&E	C1SR	895480	05/2014	05/23/2014	100.040	99.830	100.0	1
LG&E	C1SR	895481	05/2014	05/23/2014	100.100	99.940	100.0	1
LG&E	C1SR	895482	05/2014	05/23/2014	100.070	99.940	100.0	1
LG&E	C1SR	895483	05/2014	05/23/2014	100.080	99.930	100.0	1
LG&E	C1SR	895484	05/2014	05/23/2014	100.030	99.810	100.0	1
LG&E	C1SR	895485	05/2014	05/23/2014	100.060	99.910	100.0	1
LG&E	C1SR	895486	05/2014	05/23/2014	100.040	99.950	99.9	1
LG&E	C1SR	895487	05/2014	05/23/2014	100.060	99.890	100.0	1
LG&E	C1SR	895488	05/2014	05/23/2014	100.060	99.950	99.9	1
LG&E	C1SR	895489	05/2014	05/23/2014	100.060	99.930	100.1	1
LG&E	C1SR	895490	05/2014	05/23/2014	100.100	99.960	100.0	1
LG&E	C1SR	895491	05/2014	05/23/2014	100.050	99.900	100.0	1
LG&E	C1SR	895492	05/2014	05/23/2014	100.060	99.960	100.0	1
LG&E	C1SR	895493	05/2014	05/23/2014	100.060	99.890	100.0	1
LG&E	C1SR	895494	05/2014	05/23/2014	100.060	99.890	99.9	1
LG&E	C1SR	895495	05/2014	05/23/2014	100.030	99.890	100.0	1
LG&E	C1SR	895496	05/2014	05/23/2014	100.060	99.910	100.0	1
LG&E	C1SR	895497	05/2014	05/23/2014	100.080	99.960	100.0	1
LG&E	C1SR	895498	05/2014	05/23/2014	100.100	100.010	100.0	1
LG&E	C1SR	895499	05/2014	05/23/2014	100.070	99.980	100.0	1
LG&E	C1SR	895500	05/2014	05/23/2014	100.040	99.830	99.9	1
LG&E	C1SR	895501	05/2014	05/23/2014	100.070	99.930	100.0	1
LG&E	C1SR	895502	05/2014	05/23/2014	100.030	99.900	100.0	1
LG&E	C1SR	895503	05/2014	05/23/2014	100.080	100.000	100.1	1
LG&E	C1SR	895504	05/2014	05/23/2014	100.040	99.900	100.0	1
LG&E	C1SR	895505	05/2014	05/23/2014	100.060	99.940	100.0	1
LG&E	C1SR	895506	05/2014	05/23/2014	100.070	99.850	100.0	1
LG&E	C1SR	895507	05/2014	05/23/2014	100.070	99.930	100.0	1
LG&E	C1SR	895508	05/2014	05/23/2014	100.040	99.900	99.9	1
LG&E	C1SR	895509	05/2014	05/23/2014	100.060	99.870	100.0	1

LG&E	C1SR	895510	05/2014	05/23/2014	100.050	99.880	100.0	1
LG&E	C1SR	895511	05/2014	05/23/2014	100.080	99.890	99.9	1
LG&E	C1SR	895512	05/2014	05/23/2014	100.060	99.870	99.9	1
LG&E	C1SR	895513	05/2014	05/23/2014	100.100	99.940	100.0	1
LG&E	C1SR	895514	05/2014	05/23/2014	100.070	99.960	100.0	1
LG&E	C1SR	895515	05/2014	05/23/2014	100.030	99.880	99.9	1
LG&E	C1SR	895516	05/2014	05/23/2014	100.090	99.910	100.0	1
LG&E	C1SR	895517	05/2014	05/23/2014	100.100	99.960	100.0	1
LG&E	C1SR	895518	05/2014	05/23/2014	100.070	99.840	100.1	1
LG&E	C1SR	895519	05/2014	05/23/2014	100.100	99.950	99.9	1
LG&E	C1SR	895520	05/2014	05/23/2014	100.060	99.900	100.0	1
LG&E	C1SR	895521	05/2014	05/23/2014	100.100	99.950	100.0	1
LG&E	C1SR	895522	05/2014	05/23/2014	100.100	99.940	100.1	1
LG&E	C1SR	895523	05/2014	05/23/2014	100.050	99.890	100.0	1
LG&E	C1SR	895524	05/2014	05/23/2014	100.080	99.910	100.0	1
LG&E	C1SR	895525	05/2014	05/23/2014	100.070	99.910	100.0	1
LG&E	C1SR	895526	05/2014	05/23/2014	100.090	99.890	100.0	1
LG&E	C1SR	895527	05/2014	05/23/2014	100.090	99.920	100.0	1
LG&E	C1SR	895528	05/2014	05/23/2014	100.100	99.990	100.0	1
LG&E	C1SR	895529	05/2014	05/23/2014	100.070	99.910	100.1	1
LG&E	C1SR	895530	05/2014	05/23/2014	100.050	99.870	100.0	1
LG&E	C1SR	895531	05/2014	05/23/2014	100.060	99.910	100.0	1
LG&E	C1SR	895532	05/2014	05/23/2014	100.080	99.910	100.0	1
LG&E	C1SR	895533	05/2014	05/23/2014	100.060	99.990	100.0	1
LG&E	C1SR	895534	05/2014	05/23/2014	100.060	99.900	100.0	1
LG&E	C1SR	895535	05/2014	05/23/2014	100.080	99.890	99.9	1
LG&E	C1SR	895536	05/2014	05/23/2014	100.070	99.900	100.0	1
LG&E	C1SR	895537	05/2014	05/23/2014	100.030	99.880	99.9	1
LG&E	C1SR	895538	05/2014	05/23/2014	100.070	99.950	100.0	1
LG&E	C1SR	895539	05/2014	05/23/2014	100.090	99.980	100.1	1
LG&E	C1SR	895540	05/2014	05/23/2014	100.050	99.930	99.9	1
LG&E	C1SR	895541	05/2014	05/23/2014	100.050	99.920	100.0	1

LG&E	C1SR	895542	05/2014	05/23/2014	100.060	99.880	100.0	1
LG&E	C1SR	895543	05/2014	05/23/2014	100.060	99.930	100.0	1
LG&E	C1SR	895544	05/2014	05/23/2014	100.070	99.950	99.9	1
LG&E	C1SR	895545	05/2014	05/23/2014	100.070	99.940	100.0	1
LG&E	C1SR	895546	05/2014	05/23/2014	100.080	99.960	100.0	1
LG&E	C1SR	895547	05/2014	05/23/2014	100.070	99.920	100.0	1
LG&E	C1SR	895548	05/2014	05/23/2014	100.070	99.920	100.0	1
LG&E	C1SR	895549	05/2014	05/23/2014	100.050	99.900	100.1	1
LG&E	C1SR	895550	05/2014	05/23/2014	100.030	99.890	100.0	1
LG&E	C1SR	895551	05/2014	05/23/2014	100.070	99.900	100.0	1
LG&E	C1SR	895552	05/2014	05/23/2014	100.100	99.950	100.1	1
LG&E	C1SR	895553	05/2014	05/23/2014	100.060	99.850	100.0	1
LG&E	C1SR	895554	05/2014	05/23/2014	100.050	99.910	100.0	1
LG&E	C1SR	895555	05/2014	05/23/2014	100.030	99.870	100.0	1
LG&E	C1SR	895556	05/2014	05/23/2014	100.060	99.910	99.9	1
LG&E	C1SR	895557	05/2014	05/23/2014	100.040	99.900	100.0	1
LG&E	C1SR	895558	05/2014	05/23/2014	100.100	99.930	100.1	1
LG&E	C1SR	895559	05/2014	05/23/2014	100.060	99.870	100.0	1
LG&E	C1SR	895560	05/2014	05/23/2014	100.080	99.950	100.0	1
LG&E	C1SR	895561	05/2014	05/23/2014	100.090	99.950	100.0	1
LG&E	C1SR	895562	05/2014	05/23/2014	100.100	99.930	100.0	1
LG&E	C1SR	895563	05/2014	05/23/2014	100.090	99.980	100.0	1
LG&E	C1SR	895564	05/2014	05/23/2014	100.080	99.930	100.0	1
LG&E	C1SR	895565	05/2014	05/23/2014	100.060	99.910	100.0	1
LG&E	C1SR	895566	05/2014	05/23/2014	100.070	99.870	100.0	1
LG&E	C1SR	895567	05/2014	05/23/2014	100.110	99.980	100.0	1
LG&E	C1SR	895568	05/2014	05/23/2014	100.100	99.820	100.0	1
LG&E	C1SR	895569	05/2014	05/23/2014	100.040	99.900	100.0	1
LG&E	C1SR	895570	05/2014	05/23/2014	100.090	99.910	100.1	1
LG&E	C1SR	895571	05/2014	05/23/2014	100.070	99.950	100.0	1
LG&E	C1SR	895572	05/2014	05/23/2014	100.060	99.890	100.0	1
LG&E	C1SR	895573	05/2014	05/23/2014	100.050	99.880	100.0	1

LG&E	C1SR	895574	05/2014	05/23/2014	100.070	99.930	100.0	1
LG&E	C1SR	895575	05/2014	05/23/2014	100.050	99.910	99.9	1
LG&E	C1SR	895576	05/2014	05/23/2014	100.050	99.870	99.9	1
LG&E	C1SR	895577	05/2014	05/23/2014	100.030	99.930	100.0	1
LG&E	C1SR	895578	05/2014	05/23/2014	100.080	99.860	100.0	1
LG&E	C1SR	895579	05/2014	05/23/2014	100.060	99.970	100.0	1
LG&E	C1SR	895580	05/2014	05/23/2014	100.060	99.830	100.1	1
LG&E	C1SR	895581	05/2014	05/23/2014	100.070	99.860	100.0	1
LG&E	C1SR	895582	05/2014	05/23/2014	100.080	99.930	100.1	1
LG&E	C1SR	895583	05/2014	05/23/2014	100.090	99.890	100.0	1
LG&E	C1SR	895584	05/2014	05/23/2014	100.060	99.900	100.0	1
LG&E	C1SR	895585	05/2014	05/23/2014	100.060	99.890	99.9	1
LG&E	C1SR	895586	05/2014	05/23/2014	100.070	99.940	100.0	1
LG&E	C1SR	895587	05/2014	05/23/2014	100.070	99.950	99.9	1
LG&E	C1SR	895588	05/2014	05/23/2014	100.100	99.890	100.0	1
LG&E	C1SR	895589	05/2014	05/23/2014	100.110	99.970	100.1	1
LG&E	C1SR	895590	05/2014	05/23/2014	100.050	99.910	100.0	1
LG&E	C1SR	895591	05/2014	05/23/2014	100.100	99.920	100.0	1
LG&E	C1SR	895592	05/2014	05/23/2014	100.090	99.910	100.0	1
LG&E	C1SR	895593	05/2014	05/23/2014	100.070	99.900	99.9	1
LG&E	C1SR	895594	05/2014	05/23/2014	100.090	99.920	99.9	1
LG&E	C1SR	895595	05/2014	05/23/2014	100.060	99.890	100.1	1
LG&E	C1SR	895596	05/2014	05/23/2014	100.080	99.880	99.9	1
LG&E	C1SR	895597	05/2014	05/23/2014	100.090	99.960	100.0	1
LG&E	C1SR	895598	05/2014	05/23/2014	100.100	99.960	100.0	1
LG&E	C1SR	895599	05/2014	05/23/2014	100.080	99.890	99.9	1
LG&E	C1SR	895600	05/2014	05/23/2014	100.070	99.950	99.9	1
LG&E	C1SR	895601	05/2014	05/23/2014	100.090	99.890	100.0	1
LG&E	C1SR	895602	05/2014	05/23/2014	100.070	99.920	100.1	1
LG&E	C1SR	895603	05/2014	05/23/2014	100.100	100.000	100.0	1
LG&E	C1SR	895604	05/2014	05/23/2014	100.070	99.900	99.9	1
LG&E	C1SR	895605	05/2014	05/23/2014	100.060	99.930	100.0	1

LG&E	C1SR	895606	05/2014	05/23/2014	100.090	99.890	100.0	1
LG&E	C1SR	895607	05/2014	05/23/2014	100.100	99.960	100.0	1
LG&E	C1SR	895608	05/2014	05/23/2014	100.060	99.890	100.0	1
LG&E	C1SR	895609	05/2014	05/23/2014	100.070	99.950	99.9	1
LG&E	C1SR	895610	05/2014	05/23/2014	100.080	99.870	100.0	1
LG&E	C1SR	895611	05/2014	05/23/2014	100.060	99.900	100.0	1
LG&E	C1SR	895612	05/2014	05/23/2014	100.080	99.950	100.0	1
LG&E	C1SR	895613	05/2014	05/23/2014	100.110	99.900	100.0	1
LG&E	C1SR	895614	05/2014	05/23/2014	100.060	99.890	100.0	1
LG&E	C1SR	895615	05/2014	05/23/2014	100.090	100.000	100.0	1
LG&E	C1SR	895616	05/2014	05/23/2014	100.070	99.930	99.9	1
LG&E	C1SR	895617	05/2014	05/23/2014	100.100	99.940	100.0	1
LG&E	C1SR	895618	05/2014	05/23/2014	100.060	99.920	100.1	1
LG&E	C1SR	895619	05/2014	05/23/2014	100.080	99.980	100.0	1
LG&E	C1SR	895620	05/2014	05/23/2014	100.070	99.920	100.0	1
LG&E	C1SR	895621	05/2014	05/23/2014	100.060	99.920	100.0	1
LG&E	C1SR	895622	05/2014	05/23/2014	100.090	99.910	100.1	1
LG&E	C1SR	895623	05/2014	05/23/2014	100.040	99.870	99.9	1
LG&E	C1SR	895624	05/2014	05/23/2014	100.080	99.920	100.1	1
LG&E	C1SR	895625	05/2014	05/23/2014	100.070	99.890	100.0	1
LG&E	C1SR	895626	05/2014	05/23/2014	100.080	99.950	100.0	1
LG&E	C1SR	895627	05/2014	05/23/2014	100.060	99.890	100.0	1
LG&E	C1SR	895628	05/2014	05/23/2014	100.030	99.890	99.9	1
LG&E	C1SR	895629	05/2014	05/23/2014	100.070	99.910	99.9	1
LG&E	C1SR	895630	05/2014	05/23/2014	100.080	99.950	100.0	1
LG&E	C1SR	895631	05/2014	05/23/2014	100.090	99.950	100.0	1
LG&E	C1SR	895632	05/2014	05/23/2014	100.070	99.890	100.0	1
LG&E	C1SR	895633	05/2014	05/23/2014	100.060	99.810	100.0	1
LG&E	C1SR	895634	05/2014	05/23/2014	100.070	99.950	100.0	1
LG&E	C1SR	895635	05/2014	05/23/2014	100.080	99.940	99.9	1
LG&E	C1SR	895636	05/2014	05/23/2014	100.080	99.920	100.0	1
LG&E	C1SR	895637	05/2014	05/23/2014	100.030	99.810	99.9	1

LG&E	C1SR	895638	05/2014	05/23/2014	100.090	99.880	100.0	1
LG&E	C1SR	895639	05/2014	05/23/2014	100.080	99.910	99.9	1
LG&E	C1SR	895640	05/2014	05/23/2014	100.050	99.870	100.0	1
LG&E	C1SR	895641	05/2014	05/23/2014	100.040	99.880	100.0	1
LG&E	C1SR	895642	05/2014	05/23/2014	100.050	99.890	99.9	1
LG&E	C1SR	895643	05/2014	05/23/2014	100.060	99.950	100.1	1
LG&E	C1SR	895644	05/2014	05/23/2014	100.040	99.880	99.9	1
LG&E	C1SR	895645	05/2014	05/23/2014	100.070	99.930	100.0	1
LG&E	C1SR	895646	05/2014	05/23/2014	100.100	100.010	100.0	1
LG&E	C1SR	895647	05/2014	05/23/2014	100.070	99.950	100.1	1
LG&E	C1SR	895648	05/2014	05/23/2014	100.060	99.960	100.0	1
LG&E	C1SR	895649	05/2014	05/23/2014	100.090	99.900	100.0	1
LG&E	C1SR	895650	05/2014	05/23/2014	100.090	99.930	100.0	1
LG&E	C1SR	895651	05/2014	05/23/2014	100.080	99.920	99.9	1
LG&E	C1SR	895652	05/2014	05/23/2014	100.060	100.000	100.0	1
LG&E	C1SR	895653	05/2014	05/23/2014	100.080	99.930	100.0	1
LG&E	C1SR	895654	05/2014	05/23/2014	100.070	99.870	100.1	1
LG&E	C1SR	895655	05/2014	05/23/2014	100.070	99.920	100.0	1
LG&E	C1SR	895656	05/2014	05/23/2014	100.070	99.840	100.0	1
LG&E	C1SR	895657	05/2014	05/23/2014	100.050	99.860	100.0	1
LG&E	C1SR	895658	05/2014	05/23/2014	100.050	99.870	100.0	1
LG&E	C1SR	895659	05/2014	05/23/2014	100.070	99.800	99.9	1
LG&E	C1SR	895660	05/2014	05/23/2014	100.090	99.920	100.0	1
LG&E	C1SR	895661	05/2014	05/23/2014	100.070	99.980	99.9	1
LG&E	C1SR	895662	05/2014	05/23/2014	100.040	99.850	99.9	1
LG&E	C1SR	895663	05/2014	05/23/2014	100.060	99.890	100.0	1
LG&E	C1SR	895664	05/2014	05/23/2014	100.100	99.860	100.1	1
LG&E	C1SR	895665	05/2014	05/23/2014	100.080	99.860	100.0	1
LG&E	C1SR	895666	05/2014	05/23/2014	100.070	99.950	100.0	1
LG&E	C1SR	895667	05/2014	05/23/2014	100.050	99.940	100.0	1
LG&E	C1SR	895668	05/2014	05/23/2014	100.040	99.900	100.0	1
LG&E	C1SR	895669	05/2014	05/23/2014	100.060	99.880	99.9	1

LG&E	C1SR	895670	05/2014	05/23/2014	100.050	99.880	99.9	1
LG&E	C1SR	895671	05/2014	05/23/2014	100.080	99.880	100.0	1
LG&E	C1SR	895672	05/2014	05/23/2014	100.100	99.920	100.0	1
LG&E	C1SR	895673	05/2014	05/23/2014	100.070	99.870	100.0	1
LG&E	C1SR	895674	05/2014	05/23/2014	100.100	99.930	100.0	1
LG&E	C1SR	895675	05/2014	05/23/2014	100.100	99.920	100.0	1
LG&E	C1SR	895676	05/2014	05/23/2014	100.080	99.930	100.0	1
LG&E	C1SR	895677	05/2014	05/23/2014	100.050	99.890	99.9	1
LG&E	C1SR	895678	05/2014	05/23/2014	100.070	99.910	100.0	1
LG&E	C1SR	895679	05/2014	05/23/2014	100.100	99.940	100.0	1
LG&E	C1SR	895680	05/2014	05/23/2014	100.080	99.970	100.0	1
LG&E	C1SR	895681	05/2014	05/23/2014	100.050	99.940	99.9	1
LG&E	C1SR	895682	05/2014	05/23/2014	100.070	99.920	100.0	1
LG&E	C1SR	895683	05/2014	05/23/2014	100.080	99.880	100.0	1
LG&E	C1SR	895684	05/2014	05/23/2014	100.070	99.960	100.0	1
LG&E	C1SR	895685	05/2014	05/23/2014	100.060	99.970	100.0	1
LG&E	C1SR	895686	05/2014	05/23/2014	100.080	99.950	100.0	1
LG&E	C1SR	895687	05/2014	05/23/2014	100.080	99.920	100.0	1
LG&E	C1SR	895688	05/2014	05/23/2014	100.070	99.890	100.0	1
LG&E	C1SR	895689	05/2014	05/23/2014	100.090	99.910	100.1	1
LG&E	C1SR	895690	05/2014	05/23/2014	100.100	99.960	100.1	1
LG&E	C1SR	895691	05/2014	05/23/2014	100.060	99.890	100.0	1
LG&E	C1SR	895692	05/2014	05/23/2014	100.090	99.980	100.0	1
LG&E	C1SR	895693	05/2014	05/23/2014	100.100	99.910	100.0	1
LG&E	C1SR	895694	05/2014	05/23/2014	100.100	99.970	100.1	1
LG&E	C1SR	895695	05/2014	05/23/2014	100.100	100.020	100.0	1
LG&E	C1SR	895696	05/2014	05/23/2014	100.050	99.850	99.9	1
LG&E	C1SR	895697	05/2014	05/23/2014	100.070	99.900	100.1	1
LG&E	C1SR	895698	05/2014	05/23/2014	100.050	99.870	99.9	1
LG&E	C1SR	895699	05/2014	05/23/2014	100.060	99.840	100.0	1
LG&E	C1SR	895700	05/2014	05/23/2014	100.030	99.850	100.0	1
LG&E	C1SR	895701	05/2014	05/23/2014	100.090	100.000	100.0	1

LG&E	C1SR	895702	05/2014	05/23/2014	100.090	99.940	100.0	1
LG&E	C1SR	895703	05/2014	05/23/2014	100.050	99.890	100.0	1
LG&E	C1SR	895704	05/2014	05/23/2014	100.050	99.820	100.0	1
LG&E	C1SR	895705	05/2014	05/23/2014	100.060	99.880	99.9	1
LG&E	C1SR	895706	05/2014	05/23/2014	100.040	99.820	100.0	1
LG&E	C1SR	895707	05/2014	05/23/2014	100.100	99.930	100.0	1
LG&E	C1SR	895708	05/2014	05/23/2014	100.070	99.880	100.0	1
LG&E	C1SR	895709	05/2014	05/23/2014	100.090	99.940	99.9	1
LG&E	C1SR	895710	05/2014	05/23/2014	100.090	99.950	99.9	1
LG&E	C1SR	895711	05/2014	05/23/2014	100.110	99.950	100.1	1
LG&E	C1SR	895712	05/2014	05/23/2014	100.070	99.910	100.0	1
LG&E	C1SR	895713	05/2014	05/23/2014	100.090	99.920	100.0	1
LG&E	C1SR	895714	05/2014	05/23/2014	100.060	99.850	100.1	1
LG&E	C1SR	895715	05/2014	05/23/2014	100.030	99.840	99.9	1
LG&E	C1SR	895716	05/2014	05/23/2014	100.100	99.880	100.0	1
LG&E	C1SR	895717	05/2014	05/23/2014	100.040	99.880	99.9	1
LG&E	C1SR	895718	05/2014	05/23/2014	100.090	99.980	100.0	1
LG&E	C1SR	895719	05/2014	05/23/2014	100.040	99.880	100.0	1
LG&E	C1SR	895720	05/2014	05/23/2014	100.070	99.850	100.0	1
LG&E	C1SR	895721	05/2014	05/23/2014	100.090	99.930	100.0	1
LG&E	C1SR	895722	05/2014	05/23/2014	100.100	99.860	100.0	1
LG&E	C1SR	895723	05/2014	05/23/2014	100.080	99.970	100.0	1
LG&E	C1SR	895724	05/2014	05/23/2014	100.060	99.910	100.0	1
LG&E	C1SR	895725	05/2014	05/23/2014	100.060	99.910	100.0	1
LG&E	C1SR	895726	05/2014	05/23/2014	100.070	99.920	100.0	1
LG&E	C1SR	895727	05/2014	05/23/2014	100.100	99.960	99.9	1
LG&E	C1SR	895728	05/2014	05/23/2014	100.070	99.910	100.0	1
LG&E	C1SR	895729	05/2014	05/23/2014	100.060	99.860	100.0	1
LG&E	C1SR	895730	05/2014	05/23/2014	100.080	99.830	100.0	1
LG&E	C1SR	895731	05/2014	05/23/2014	100.050	99.900	100.0	1
LG&E	C1SR	895732	05/2014	05/23/2014	100.070	100.010	100.1	1
LG&E	C1SR	895733	05/2014	05/23/2014	100.100	99.940	100.1	1

LG&E	C1SR	895734	05/2014	05/23/2014	100.060	99.890	100.0	1
LG&E	C1SR	895735	05/2014	05/23/2014	100.060	99.840	99.9	1
LG&E	C1SR	895736	05/2014	05/23/2014	100.080	99.870	100.0	1
LG&E	C1SR	895737	05/2014	05/23/2014	100.060	99.850	100.0	1
LG&E	C1SR	895738	05/2014	05/23/2014	100.060	99.830	99.9	1
LG&E	C1SR	895739	05/2014	05/23/2014	100.060	99.960	100.0	1
LG&E	C1SR	895740	05/2014	05/23/2014	100.050	99.870	100.0	1
LG&E	C1SR	895741	05/2014	05/23/2014	100.080	99.950	100.0	1
LG&E	C1SR	895742	05/2014	05/23/2014	100.030	99.910	100.0	1
LG&E	C1SR	895743	05/2014	05/23/2014	100.060	99.900	100.0	1
LG&E	C1SR	895744	05/2014	05/23/2014	100.100	99.960	100.0	1
LG&E	C1SR	895745	05/2014	05/23/2014	100.070	99.910	99.9	1
LG&E	C1SR	895746	05/2014	05/23/2014	100.090	99.960	100.0	1
LG&E	C1SR	895747	05/2014	05/23/2014	100.060	99.930	99.9	1
LG&E	C1SR	895748	05/2014	05/23/2014	100.110	99.960	100.1	1
LG&E	C1SR	895749	05/2014	05/23/2014	100.100	99.990	100.0	1
LG&E	C1SR	895750	05/2014	05/23/2014	100.070	99.970	100.1	1
LG&E	C1SR	895751	05/2014	05/23/2014	100.060	99.910	100.1	1
LG&E	C1SR	895752	05/2014	05/23/2014	100.070	99.960	100.0	1
LG&E	C1SR	895753	05/2014	05/23/2014	100.050	99.840	99.9	1
LG&E	C1SR	895754	05/2014	05/23/2014	100.080	99.970	100.0	1
LG&E	C1SR	895755	05/2014	05/23/2014	100.060	99.860	100.0	1
LG&E	C1SR	895756	05/2014	05/23/2014	100.060	99.950	100.0	1
LG&E	C1SR	895757	05/2014	05/23/2014	100.080	99.950	100.0	1
LG&E	C1SR	895758	05/2014	05/23/2014	100.100	99.950	100.0	1
LG&E	C1SR	895759	05/2014	05/23/2014	100.030	99.890	99.9	1
LG&E	C1SR	895760	05/2014	05/23/2014	100.060	99.850	99.9	1
LG&E	C1SR	895761	05/2014	05/23/2014	100.080	99.870	100.0	1
LG&E	C1SR	895762	05/2014	05/23/2014	100.070	99.930	100.0	1
LG&E	C1SR	895763	05/2014	05/23/2014	100.060	99.910	99.9	1
LG&E	C1SR	895764	05/2014	05/23/2014	100.100	100.000	100.0	1
LG&E	C1SR	895765	05/2014	05/23/2014	100.030	99.920	100.0	1

LG&E	C1SR	895766	05/2014	05/23/2014	100.080	99.910	100.1	1
LG&E	C1SR	895767	05/2014	05/23/2014	100.050	99.920	100.1	1
LG&E	C1SR	895768	05/2014	05/23/2014	100.070	99.860	100.1	1
LG&E	C1SR	895769	05/2014	05/23/2014	100.060	99.890	100.0	1
LG&E	C1SR	895770	05/2014	05/23/2014	100.100	99.940	100.0	1
LG&E	C1SR	895771	05/2014	05/23/2014	100.100	99.890	99.9	1
LG&E	C1SR	895772	05/2014	05/23/2014	100.070	99.900	100.0	1
LG&E	C1SR	895773	05/2014	05/23/2014	100.080	99.910	100.1	1
LG&E	C1SR	895774	05/2014	05/23/2014	100.100	99.910	100.0	1
LG&E	C1SR	895775	05/2014	05/23/2014	100.090	99.940	99.9	1
LG&E	C1SR	895776	05/2014	05/23/2014	100.060	99.880	100.0	1
LG&E	C1SR	895777	05/2014	05/23/2014	100.070	99.930	100.0	1
LG&E	C1SR	895778	05/2014	05/23/2014	100.070	99.900	99.9	1
LG&E	C1SR	895779	05/2014	05/23/2014	100.100	99.950	100.1	1
LG&E	C1SR	895780	05/2014	05/23/2014	100.070	99.870	100.0	1
LG&E	C1SR	895781	05/2014	05/23/2014	100.060	99.920	100.0	1
LG&E	C1SR	895782	05/2014	05/23/2014	100.080	99.940	100.0	1
LG&E	C1SR	895783	05/2014	05/23/2014	100.030	99.850	99.9	1
LG&E	C1SR	895784	05/2014	05/23/2014	100.060	99.920	100.0	1
LG&E	C1SR	895785	05/2014	05/23/2014	100.030	99.840	100.0	1
LG&E	C1SR	895786	05/2014	05/23/2014	100.070	99.930	100.0	1
LG&E	C1SR	895787	05/2014	05/23/2014	100.040	99.930	100.0	1
LG&E	C1SR	895788	05/2014	05/23/2014	100.110	99.950	100.1	1
LG&E	C1SR	895789	05/2014	05/23/2014	100.100	99.880	100.1	1
LG&E	C1SR	895790	05/2014	05/23/2014	100.090	99.850	100.0	1
LG&E	C1SR	895791	05/2014	05/23/2014	100.060	99.890	99.9	1
LG&E	C1SR	895792	05/2014	05/23/2014	100.100	99.940	100.1	1
LG&E	C1SR	895793	05/2014	05/23/2014	100.090	99.950	100.0	1
LG&E	C1SR	895794	05/2014	05/23/2014	100.070	99.890	100.1	1
LG&E	C1SR	895795	05/2014	05/23/2014	100.110	99.980	100.0	1
LG&E	C1SR	895796	05/2014	05/23/2014	100.110	99.960	100.0	1
LG&E	C1SR	895797	05/2014	05/23/2014	100.040	99.820	100.0	1

LG&E	C1SR	895798	05/2014	05/23/2014	100.040	99.920	100.0	1
LG&E	C1SR	895799	05/2014	05/23/2014	100.100	99.940	100.0	1
LG&E	C1SR	895800	05/2014	05/23/2014	100.100	100.000	100.0	1
LG&E	C1SR	895801	05/2014	05/23/2014	100.060	99.940	100.0	1
LG&E	C1SR	895802	05/2014	05/23/2014	100.070	99.880	100.0	1
LG&E	C1SR	895803	05/2014	05/23/2014	100.080	99.960	100.1	1
LG&E	C1SR	895804	05/2014	05/23/2014	100.100	99.920	100.0	1
LG&E	C1SR	895805	05/2014	05/23/2014	100.040	99.900	99.9	1
LG&E	C1SR	895806	05/2014	05/23/2014	100.070	99.960	100.0	1
LG&E	C1SR	895807	05/2014	05/23/2014	100.080	99.900	100.0	1
LG&E	C1SR	895808	05/2014	05/23/2014	100.060	99.920	100.0	1
LG&E	C1SR	895809	05/2014	05/23/2014	100.100	99.920	100.0	1
LG&E	C1SR	895810	05/2014	05/23/2014	100.100	99.930	100.1	1
LG&E	C1SR	895811	05/2014	05/23/2014	100.090	99.890	100.0	1
LG&E	C1SR	895812	05/2014	05/23/2014	100.050	99.820	100.0	1
LG&E	C1SR	895813	05/2014	05/23/2014	100.070	99.920	100.1	1
LG&E	C1SR	895814	05/2014	05/23/2014	100.040	99.850	99.9	1
LG&E	C1SR	895815	05/2014	05/23/2014	100.100	99.890	100.1	1
LG&E	C1SR	895816	05/2014	05/23/2014	100.060	99.870	100.0	1
LG&E	C1SR	895817	05/2014	05/23/2014	100.050	99.850	100.0	1
LG&E	C1SR	895818	05/2014	05/23/2014	100.050	99.930	100.0	1
LG&E	C1SR	895819	05/2014	05/23/2014	100.070	99.940	100.1	1
LG&E	C1SR	895820	05/2014	05/23/2014	100.100	99.860	99.9	1
LG&E	C1SR	895821	05/2014	05/23/2014	100.040	99.880	100.0	1
LG&E	C1SR	895822	05/2014	05/23/2014	100.100	99.920	100.0	1
LG&E	C1SR	895823	05/2014	05/23/2014	100.080	99.850	100.0	1
LG&E	C1SR	895824	05/2014	05/23/2014	100.080	99.900	100.0	1
LG&E	C1SR	895825	05/2014	05/23/2014	100.080	99.930	100.0	1
LG&E	C1SR	895826	05/2014	05/23/2014	100.090	99.970	100.0	1
LG&E	C1SR	895827	05/2014	05/23/2014	100.060	99.950	100.0	1
LG&E	C1SR	895828	05/2014	05/23/2014	100.090	99.920	99.9	1
LG&E	C1SR	895829	05/2014	05/23/2014	100.070	99.930	100.1	1

LG&E	C1SR	895830	05/2014	05/23/2014	100.100	99.970	100.0	1
LG&E	C1SR	895831	05/2014	05/23/2014	100.060	99.940	99.9	1
LG&E	C1SR	895832	05/2014	05/23/2014	100.100	99.870	100.0	1
LG&E	C1SR	895833	05/2014	05/23/2014	100.080	99.910	100.1	1
LG&E	C1SR	895834	05/2014	05/23/2014	100.040	99.900	100.0	1
LG&E	C1SR	895835	05/2014	05/23/2014	100.100	99.950	100.1	1
LG&E	C1SR	895836	05/2014	05/23/2014	100.100	99.980	100.0	1
LG&E	C1SR	895837	05/2014	05/23/2014	100.080	99.970	100.1	1
LG&E	C1SR	895838	05/2014	05/23/2014	100.080	99.880	100.0	1
LG&E	C1SR	895839	05/2014	05/23/2014	100.070	99.880	100.1	1
LG&E	C1SR	895840	05/2014	05/23/2014	100.070	99.940	99.9	1
LG&E	C1SR	895841	05/2014	05/23/2014	100.060	99.940	100.0	1
LG&E	C1SR	895842	05/2014	05/23/2014	100.060	99.950	100.0	1
LG&E	C1SR	895843	05/2014	05/23/2014	100.100	100.000	100.0	1
LG&E	C1SR	895844	05/2014	05/23/2014	100.090	100.030	100.1	1
LG&E	C1SR	895845	05/2014	05/23/2014	100.070	99.870	100.0	1
LG&E	C1SR	895846	05/2014	05/23/2014	100.070	99.920	100.0	1
LG&E	C1SR	895847	05/2014	05/23/2014	100.100	99.910	100.1	1
LG&E	C1SR	895848	05/2014	05/23/2014	100.060	99.880	100.0	1
LG&E	C1SR	895849	05/2014	05/23/2014	100.060	99.940	100.0	1
LG&E	C1SR	895850	05/2014	05/23/2014	100.080	99.910	100.1	1
LG&E	C1SR	895851	05/2014	05/23/2014	100.080	99.970	100.0	1
LG&E	C1SR	895852	05/2014	05/23/2014	100.080	99.950	100.0	1
LG&E	C1SR	895853	05/2014	05/23/2014	100.060	99.910	100.0	1
LG&E	C1SR	895854	05/2014	05/23/2014	100.080	99.970	100.0	1
LG&E	C1SR	895855	05/2014	05/23/2014	100.090	100.050	99.9	1
LG&E	C1SR	895856	05/2014	05/23/2014	100.070	99.900	100.0	1
LG&E	C1SR	895857	05/2014	05/23/2014	100.060	99.870	100.0	1
LG&E	C1SR	895858	05/2014	05/23/2014	100.090	99.930	100.1	1
LG&E	C1SR	895859	05/2014	05/23/2014	100.060	99.960	100.1	1
LG&E	C1SR	895860	05/2014	05/23/2014	100.110	99.920	100.1	1
LG&E	C1SR	895861	05/2014	05/23/2014	100.060	99.910	100.0	1

LG&E	C1SR	895862	05/2014	05/23/2014	100.030	99.860	99.9	1
LG&E	CN1SR	891891	06/2014	06/03/2014	100.050	99.920	100.0	1
LG&E	CN1SR	891892	06/2014	06/03/2014	100.050	99.920	100.0	1
LG&E	CN1SR	891893	06/2014	06/03/2014	100.050	99.890	100.0	1
LG&E	CN1SR	891894	06/2014	06/03/2014	100.040	99.890	100.0	1
LG&E	CN1SR	891895	06/2014	06/03/2014	100.050	99.860	100.0	1
LG&E	CN1SR	891896	06/2014	06/03/2014	100.050	99.870	100.0	1
LG&E	CN1SR	891897	06/2014	06/03/2014	100.070	99.920	100.0	1
LG&E	CN1SR	891898	06/2014	06/03/2014	100.040	99.880	100.0	1
LG&E	CN1SR	891899	06/2014	06/03/2014	100.040	99.870	100.0	1
LG&E	CN1SR	891900	06/2014	06/03/2014	100.050	99.860	100.1	1
LG&E	CN1SR	891901	06/2014	06/03/2014	100.050	99.910	100.1	1
LG&E	CN1SR	891902	06/2014	06/03/2014	100.070	99.920	100.0	1
LG&E	CN1SR	891903	06/2014	06/03/2014	100.050	99.880	100.1	1
LG&E	CN1SR	891904	06/2014	06/03/2014	100.040	99.870	100.1	1
LG&E	CN1SR	891905	06/2014	06/03/2014	100.030	99.900	100.0	1
LG&E	CN1SR	891906	06/2014	06/03/2014	100.050	99.890	100.0	1
LG&E	CN1SR	891907	06/2014	06/03/2014	100.070	99.970	100.1	1
LG&E	CN1SR	891908	06/2014	06/03/2014	100.050	99.950	100.1	1
LG&E	CN1SR	891909	06/2014	06/03/2014	100.060	99.850	100.0	1
LG&E	CN1SR	891910	06/2014	06/03/2014	100.040	99.900	100.1	1
LG&E	CN1SR	891911	06/2014	06/03/2014	100.050	99.900	100.1	1
LG&E	CN1SR	891912	06/2014	06/03/2014	100.050	99.860	100.0	1
LG&E	CN1SR	891913	06/2014	06/03/2014	100.050	99.930	100.1	1
LG&E	CN1SR	891914	06/2014	06/03/2014	100.050	99.910	100.1	1
Overall Result					X	X	X	9,644

ATTACHMENT
B

Sampling Test Results

LG&E
2014 SAMPLE
ELECTRIC METER SUMMARY

SAMPLE

In-Service Population	384,698	Divided into 49 Lots
Sample Quantity	3,285	
Meters Tested	3,285	
Meters Not Tested	0	
Failed Lots	0	
Failed Lot Meters	0	

Louisville Gas and Electric

2014 Sample Test Program (01/01/2014) to (12/31/2014)

Device Category: F2S240V30AC200 Model Number: AB1 Division: 01 Sample Lot: 1301 Lot Descr: LG&E AB1-1
 In Service Population: 159 Sample Quantity: 15 Meters Tested: 15 Pass/ Fail: PASS

Test Results Per ANSI/ASQC Z1.9-1993

Double Specification Limit - Variability Unknown - Standard Deviation Method

One AQL Value for Both Upper and Lower Specification Limit Combined

AQL = 2.5% - Inspection Level II "E" # Normal Inspection

Page 1

Run Date: 01/07/2015

Run Time: 03:37:18 AM

Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy
725044	99.40	725052	99.80	725090	100.00	725112	100.00	725121	100.10
725158	100.10	725178	99.20	725272	100.00	725274	100.10	725305	99.70
725324	99.70	725347	100.30	725394	100.40	725408	100.10	725507	99.70

INFORMATION NEEDED

VALUE OBTAINED

1 Sample Size (N)	15
2 Sum of Measurements: (Sum X)	1498.60
3 Sum of Squared Measurements	149721.60
4 Correction Factor (CF): Sum of Measurements Squared / N	149720.13
5 Corrected Sum of Squares (SS)	1.47
6 Variance (V) : SS/(N-1)	0.1050
7 Estimate of Lot Standard Deviation(S): SQRT of V	0.3240
8 Sample Mean(XBAR): Sum X/N	99.91
9 Upper Specification Limit (U)	102.00
10 Lower Specification Limit (L)	98.00
11 Quality Index Upper (QU): (U-XBAR) / S	6.46
12 Quality Index Lower (QL): (XBAR-L) / S	5.89
13 Estimate of Lot Percent NCF Above U (PU)	0.00
14 Estimate of Lot Percent NCF Below L (PL)	0.00
15 Total Estimate Percent NCF. In Lot (P): PU+PL	0.00
16 Maximum Allowable Percent NCF(M)	6.55
17 Acceptability Criterion: Compare P with M	PASS
18 The Lot Meets the Acceptability Criterion if P <= M	
19 The Lot Fails the Acceptability Criterion if P > M	

Louisville Gas and Electric

2014 Sample Test Program (01/01/2014) to (12/31/2014)

Device Category: F25240V30AC200E Model Number: ALF (Trilliant) Division: 01 Sample Lot: 1302 Lot Descr: LG&E ALF-1
 In Service Population: 827 Sample Quantity: 35 Meters Tested: 35 Pass/ Fail: PASS

Test Results Per ANSI/ASQC Z1.9-1993

Double Specification Limit - Variability Unknown - Standard Deviation Method
 One AQL Value for Both Upper and Lower Specification Limit Combined
 AQL = 2.5% - Inspection Level II "E" # Normal Inspection

Page 2
 Run Date: 01/07/2015
 Run Time: 03:37:18 AM

Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy
833596	100.00	833609	100.00	833708	100.00	833736	100.00	833811	99.90
833945	99.90	834033	100.00	834068	100.00	834097	99.90	834124	99.90
834260	100.10	834406	100.00	834408	100.00	834537	100.00	834574	100.00
834605	100.00	834645	100.00	834691	100.00	834697	100.00	834741	99.90
834744	100.10	834761	99.90	834809	100.00	834822	100.00	834872	99.90
834874	100.00	835029	100.00	835049	100.00	835082	100.00	855803	100.00
855814	99.90	863387	99.90	863398	99.80	863407	99.90	863420	100.00

INFORMATION NEEDED

VALUE OBTAINED

1 Sample Size (N)	35
2 Sum of Measurements: (Sum X)	3499.00
3 Sum of Squared Measurements	349800.16
4 Correction Factor (CF): Sum of Measurements Squared / N	349800.03
5 Corrected Sum of Squares (SS)	0.13
6 Variance (V) : SS/(N-1)	0.0039
7 Estimate of Lot Standard Deviation(S): SQRT of V	0.0622
8 Sample Mean(XBAR): Sum X/N	99.97
9 Upper Specification Limit (U)	102.00
10 Lower Specification Limit (L)	98.00
11 Quality Index Upper (QU): (U-XBAR) / S	32.63
12 Quality Index Lower (QL): (XBAR-L) / S	31.71
13 Estimate of Lot Percent NCF Above U (PU)	0.00
14 Estimate of Lot Percent NCF Below L (PL)	0.00
15 Total Estimate Percent NCF. In Lot (P): PU+PL	0.00
16 Maximum Allowable Percent NCF(M)	5.58
17 Acceptability Criterion: Compare P with M	PASS
18 The Lot Meets the Acceptability Criterion if P <= M	
19 The Lot Fails the Acceptability Criterion if P > M	

Louisville Gas and Electric

2014 Sample Test Program (01/01/2014) to (12/31/2014)

Device Category: F2S240V30AC200E Model Number: C1SR (ERT) Division: 01 Sample Lot: 1303 Lot Descr: LG&E CIS-1
 In Service Population: 10,000 Sample Quantity: 75 Meters Tested: 75 Pass/ Fail: PASS

Test Results Per ANSI/ASQC Z1.9-1993

Double Specification Limit - Variability Unknown - Standard Deviation Method
 One AQL Value for Both Upper and Lower Specification Limit Combined
 AQL = 2.5% - Inspection Level II "E" # Normal Inspection

Page 3
 Run Date: 01/07/2015
 Run Time: 03:37:18 AM

Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy
754117	100.10	754327	100.10	754534	100.00	755453	100.10	755456	100.00
755495	100.10	755543	100.00	755721	100.10	755739	100.10	755790	100.10
755811	100.20	755898	100.20	756172	100.20	756314	99.80	756333	100.00
756341	100.00	766167	100.20	766514	100.10	766549	100.20	766794	100.20
766993	100.10	767089	100.20	767219	100.10	767242	99.80	767303	100.00
767340	100.10	777131	100.20	777257	100.10	777291	100.20	777327	100.10
777420	100.10	777569	100.20	777679	100.10	777725	100.20	777762	100.20
777887	100.10	777933	100.10	777999	100.30	778469	100.10	778814	100.10
778925	100.10	779086	100.00	779269	100.13	779318	100.21	779446	100.10
779527	100.10	794092	100.10	794188	100.00	794198	100.10	794299	100.00
794310	100.00	794773	100.10	794832	100.10	794871	100.10	795065	100.10
795091	100.10	795176	99.98	795300	99.90	795765	100.10	795900	100.00
796149	100.10	796448	100.10	796811	100.10	797329	100.10	797477	100.20
797898	100.10	797950	100.10	798210	100.10	798291	100.10	798429	100.20
798455	100.10	798512	100.10	798526	100.10	798679	100.12	798869	100.00

INFORMATION NEEDED

VALUE OBTAINED

1 Sample Size (N)	75
2 Sum of Measurements: (Sum X)	7507.14
3 Sum of Squared Measurements	751429.23
4 Correction Factor (CF): Sum of Measurements Squared / N	751428.68
5 Corrected Sum of Squares (SS)	0.55
6 Variance (V) : SS/(N-1)	0.0074
7 Estimate of Lot Standard Deviation(S): SQRT of V	0.0859
8 Sample Mean(XBAR): Sum X/N	100.10
9 Upper Specification Limit (U)	102.00
10 Lower Specification Limit (L)	98.00
11 Quality Index Upper (QU): (U-XBAR) / S	22.17
12 Quality Index Lower (QL): (XBAR-L) / S	24.39
13 Estimate of Lot Percent NCF Above U (PU)	0.00
14 Estimate of Lot Percent NCF Below L (PL)	0.00
15 Total Estimate Percent NCF. In Lot (P): PU+PL	0.00
16 Maximum Allowable Percent NCF (M)	4.83
17 Acceptability Criterion: Compare P with M	PASS
18 The Lot Meets the Acceptability Criterion if P <= M	
19 The Lot Fails the Acceptability Criterion if P > M	

Louisville Gas and Electric

2014 Sample Test Program (01/01/2014) to (12/31/2014)

Device Category: F2S240V30AC200E Model Number: CIS Division: 01 Sample Lot: 1304 Lot Descr: LG&E CIS-2
 In Service Population: 10,000 Sample Quantity: 75 Meters Tested: 75 Pass/ Fail: PASS

Test Results Per ANSI/ASQC Z1.9-1993

Double Specification Limit - Variability Unknown - Standard Deviation Method
 One AQL Value for Both Upper and Lower Specification Limit Combined
 AQL = 2.5% - Inspection Level II "E" # Normal Inspection

Page 4
 Run Date: 01/07/2015
 Run Time: 03:37:18 AM

Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy
799073	100.10	799138	100.20	799532	100.10	799587	100.10	808821	100.10
809151	99.90	809305	100.00	843501	100.10	843719	100.00	843881	100.10
844067	100.10	844129	99.90	844146	100.00	844187	100.10	844505	100.00
844573	99.90	845100	100.10	845105	100.00	845130	100.10	845148	100.00
845386	100.10	845695	100.10	845735	100.10	845940	99.90	846092	100.10
846145	99.90	846435	100.00	846575	100.20	846830	99.90	847608	100.00
847688	100.10	847712	100.10	847805	100.00	847818	100.00	848093	100.10
848105	100.00	848553	100.00	848818	100.10	848852	100.20	849139	99.90
849202	99.90	849254	99.90	849741	100.10	849791	100.10	849818	99.90
849966	99.90	850036	100.20	850121	100.00	850318	99.70	850410	100.00
850418	100.00	850857	100.00	850924	100.00	850927	100.00	850965	100.00
851146	100.10	851184	100.10	851211	100.10	851245	100.10	851334	100.00
851406	99.90	851484	100.20	851507	100.00	852197	100.00	852315	100.20
852409	99.80	852664	100.10	852779	100.20	852787	100.00	852789	100.00
853025	100.00	853440	100.10	854379	100.00	854633	99.80	854941	100.10

INFORMATION NEEDED

VALUE OBTAINED

1 Sample Size (N)	75
2 Sum of Measurements: (Sum X)	7502.20
3 Sum of Squared Measurements	750440.84
4 Correction Factor (CF): Sum of Measurements Squared / N	750440.06
5 Corrected Sum of Squares (SS)	0.78
6 Variance (V) : SS/(N-1)	0.0105
7 Estimate of Lot Standard Deviation(S): SQRT of V	0.1024
8 Sample Mean(XBAR): Sum X/N	100.03
9 Upper Specification Limit (U)	102.00
10 Lower Specification Limit (L)	98.00
11 Quality Index Upper (QU): (U-XBAR) / S	19.25
12 Quality Index Lower (QL): (XBAR-L) / S	19.82
13 Estimate of Lot Percent NCF Above U (PU)	0.00
14 Estimate of Lot Percent NCF Below L (PL)	0.00
15 Total Estimate Percent NCF. In Lot (P): PU+PL	0.00
16 Maximum Allowable Percent NCF(M)	4.83
17 Acceptability Criterion: Compare P with M	PASS
18 The Lot Meets the Acceptability Criterion if P <= M	
19 The Lot Fails the Acceptability Criterion if P > M	

Louisville Gas and Electric

2014 Sample Test Program (01/01/2014) to (12/31/2014)

Device Category: F2S240V30AC200E Model Number: CIS Division: 01 Sample Lot: 1305 Lot Descr: LG&E CIS-3
 In Service Population: 10,000 Sample Quantity: 75 Meters Tested: 75 Pass/ Fail: PASS

Test Results Per ANSI/ASQC Z1.9-1993

Double Specification Limit - Variability Unknown - Standard Deviation Method
 One AQL Value for Both Upper and Lower Specification Limit Combined
 AQL = 2.5% - Inspection Level II "E" # Normal Inspection

Page 5
 Run Date: 01/07/2015
 Run Time: 03:37:18 AM

Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy
854953	100.00	855029	100.00	855165	100.10	855339	99.90	855372	99.90
855609	100.10	856304	100.00	856514	99.90	856647	99.90	857100	99.90
857126	100.00	857132	100.00	857191	99.90	857246	100.10	857291	100.00
857456	100.10	857538	99.90	857672	100.00	857704	99.90	857897	99.90
858125	99.95	858180	100.10	858210	99.80	858691	100.00	859804	99.96
860142	100.00	860256	99.90	860274	100.00	860329	100.00	860504	99.90
860505	100.00	860691	99.98	860695	100.00	860793	100.00	860951	99.90
861072	99.90	861146	100.00	861455	100.00	861986	99.90	862120	100.00
862126	100.10	862267	100.10	862337	100.10	862341	100.00	862398	100.00
862433	100.00	862532	100.00	862681	100.10	862793	100.00	862832	100.00
863443	99.90	863622	100.10	863693	100.10	864009	100.20	864074	99.90
865238	99.90	865247	100.10	865290	99.80	865378	100.00	865391	100.00
865415	100.10	866145	100.01	866726	100.10	866866	100.00	866980	100.10
867004	100.10	868329	100.00	868502	100.10	868700	100.10	868832	100.10
868834	100.00	868855	100.00	869036	100.00	869057	100.00	870462	100.10

INFORMATION NEEDED

VALUE OBTAINED

1 Sample Size (N)	75
2 Sum of Measurements: (Sum X)	7500.00
3 Sum of Squared Measurements	750000.49
4 Correction Factor (CF): Sum of Measurements Squared / N	750000.00
5 Corrected Sum of Squares (SS)	0.49
6 Variance (V) : SS/(N-1)	0.0067
7 Estimate of Lot Standard Deviation(S): SQRT of V	0.0818
8 Sample Mean(XBAR): Sum X/N	100.00
9 Upper Specification Limit (U)	102.00
10 Lower Specification Limit (L)	98.00
11 Quality Index Upper (QU): (U-XBAR) / S	24.46
12 Quality Index Lower (QL): (XBAR-L) / S	24.46
13 Estimate of Lot Percent NCF Above U (PU)	0.00
14 Estimate of Lot Percent NCF Below L (PL)	0.00
15 Total Estimate Percent NCF. In Lot (P): PU+PL	0.00
16 Maximum Allowable Percent NCF(M)	4.83
17 Acceptability Criterion: Compare P with M	PASS
18 The Lot Meets the Acceptability Criterion if P <= M	
19 The Lot Fails the Acceptability Criterion if P > M	

Louisville Gas and Electric

2014 Sample Test Program (01/01/2014) to (12/31/2014)

Device Category: F2S240V30AC200E Model Number: C15 Division: 01 Sample Lot: 1306 Lot Desor: LG&E CIS-4
 In Service Population: 8,213 Sample Quantity: 75 Meters Tested: 75 Pass/ Fail: PASS

Test Results Per ANSI/ASQC Z1.9-1993

Double Specification Limit - Variability Unknown - Standard Deviation Method

One AQL Value for Both Upper and Lower Specification Limit Combined

AQL = 2.5% - Inspection Level II "E" # Normal Inspection

Page 6

Run Date: 01/07/2015

Run Time: 03:37:18 AM

Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy
870631	100.00	870749	99.90	870912	100.10	870981	100.00	871164	100.00
871700	100.00	871713	99.90	871758	100.10	871814	100.10	871826	100.00
871837	99.90	871855	100.00	872177	99.90	872191	100.10	873370	100.00
873513	100.00	873557	100.20	873566	99.90	873925	100.10	874193	100.10
874261	99.90	874449	100.00	874476	100.10	874532	100.10	874558	100.10
874568	99.90	874692	100.10	874752	100.10	874961	100.00	874987	100.10
875033	100.10	876446	100.10	876472	100.10	876648	100.00	876657	100.00
876665	100.10	876941	100.00	877056	100.00	877104	100.00	877332	99.80
877356	100.00	877372	100.10	877844	100.10	877854	99.90	877866	100.20
877874	100.20	878045	99.90	878150	100.10	878342	100.00	878442	100.00
878454	100.10	878558	100.10	878853	100.00	878867	99.90	878963	99.90
879449	100.00	879494	100.10	879500	100.10	879716	99.90	879952	100.00
879957	100.00	879993	100.00	881598	100.00	881635	99.90	881674	100.00
881794	100.00	88108I	99.90	881896	100.10	882337	99.90	882348	99.90
883441	100.10	883556	100.00	883610	100.00	883677	100.10	883851	99.90

INFORMATION NEEDED

VALUE OBTAINED

1 Sample Size (N)	75
2 Sum of Measurements: (Sum X)	7501.30
3 Sum of Squared Measurements	750260.59
4 Correction Factor (CF): Sum of Measurements Squared / N	750260.02
5 Corrected Sum of Squares (SS)	0.57
6 Variance (V) : SS/(N-1)	0.0077
7 Estimate of Lot Standard Deviation(S): SQRT of V	0.0876
8 Sample Mean(XBAR) : Sum X/N	100.02
9 Upper Specification Limit (U)	102.00
10 Lower Specification Limit (L)	98.00
11 Quality Index Upper (QU): (U-XBAR) / s	22.64
12 Quality Index Lower (QL): (XBAR-L) / s	23.04
13 Estimate of Lot Percent NCF Above U (PU)	0.00
14 Estimate of Lot Percent NCF Below L (PL)	0.00
15 Total Estimate Percent NCF. In Lot (P): PU+PL	0.00
16 Maximum Allowable Percent NCF(M)	4.83
17 Acceptability Criterion: Compare P with M	PASS
18 The Lot Meets the Acceptability Criterion if P <= M	
19 The Lot Fails the Acceptability Criterion if P > M	

Louisville Gas and Electric

2014 Sample Test Program (01/01/2014) to (12/31/2014)

Device Category: F2S240V30AC200 Model Number: D4S Division: 01 Sample Lot: 1307 Lot Descr: LG&E D4S-1
 In Service Population: 10,000 Sample Quantity: 75 Meters Tested: 75 Pass/ Fail: PASS

Test Results Per ANSI/ASQC Z1.9-1993

Double Specification Limit - Variability Unknown - Standard Deviation Method
 One AQL Value for Both Upper and Lower Specification Limit Combined
 AQL = 2.5% - Inspection Level II "E" # Normal Inspection

Page 7
 Run Date: 01/07/2015
 Run Time: 03:37:18 AM

Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy
366983	100.00	367385	99.80	367427	100.10	367551	100.10	371725	99.80
371880	100.00	371914	100.10	372064	99.60	372134	99.80	372228	99.80
372442	99.90	376247	100.70	376422	99.40	376460	99.90	376587	100.20
376708	99.50	376729	99.80	376984	99.90	381991	99.50	382227	100.30
382290	99.60	386241	98.90	386333	99.30	386784	99.90	391407	99.20
391521	99.70	391690	99.70	396254	99.70	396329	99.50	400604	99.90
400774	99.90	401030	99.90	401231	99.60	401306	100.00	401373	100.00
404009	99.90	405576	99.60	410406	99.60	414862	99.90	415121	99.90
415125	99.80	415433	100.00	415736	100.00	415781	99.90	420068	100.70
420195	99.40	420379	99.70	420396	100.50	424819	100.60	424850	99.70
425038	99.80	425288	100.10	425371	99.90	425454	100.50	431134	100.20
434046	99.80	436728	100.60	437196	100.10	437199	99.70	441080	100.00
441236	99.40	441343	99.70	443586	99.90	443798	100.50	447842	100.10
448876	100.10	449009	100.00	449133	99.90	451567	100.10	451753	99.50
451893	100.20	452667	99.70	454287	100.30	454302	100.20	457323	100.00

INFORMATION NEEDED

VALUE OBTAINED

1 Sample Size (N)	75
2 Sum of Measurements: (Sum X)	7492.50
3 Sum of Squared Measurements	748509.27
4 Correction Factor (CF): Sum of Measurements Squared / N	748500.75
5 Corrected Sum of Squares (SS)	8.52
6 Variance (V) : SS/(N-1)	0.1151
7 Estimate of Lot Standard Deviation(S): SQRT of V	0.3393
8 Sample Mean(XBAR): Sum X/N	99.90
9 Upper Specification Limit (U)	102.00
10 Lower Specification Limit (L)	98.00
11 Quality Index Upper (QU): (U-XBAR) / S	6.19
12 Quality Index Lower (QL): (XBAR-L) / S	5.60
13 Estimate of Lot Percent NCF Above U (PU)	0.00
14 Estimate of Lot Percent NCF Below L (PL)	0.00
15 Total Estimate Percent NCF. In Lot (P): PU+PL	0.00
16 Maximum Allowable Percent NCF (M)	4.83
17 Acceptability Criterion: Compare P with M	PASS
18 The Lot Meets the Acceptability Criterion if P <= M	
19 The Lot Fails the Acceptability Criterion if P > M	

Louisville Gas and Electric

2014 Sample Test Program (01/01/2014) to (12/31/2014)

Device Category: F2S240V30AC200
In Service Population: 2,908

Model Number: D4S
Sample Quantity: 50

Division: 01
Meters Tested: 50

Sample Lot: 1308
Pass/ Fail: PASS

Lot Descr: LG&E D4S-2

Test Results Per ANSI/ASQC Z1.9-1993

Double Specification Limit - Variability Unknown - Standard Deviation Method
One AQL Value for Both Upper and Lower Specification Limit Combined
AQL = 2.5% - Inspection Level II "E" # Normal Inspection

Page 8

Run Date: 01/07/2015

Run Time: 03:37:18 AM

Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy
461275	100.00	461386	99.90	461389	99.80	461395	100.00	464314	100.40
464360	99.90	464510	100.10	464560	100.10	464587	99.90	464673	100.20
465170	100.10	465452	100.30	465523	100.10	465582	100.00	468570	99.40
468620	99.20	468897	101.30	468917	100.30	468935	99.70	469861	100.10
470003	99.73	470663	100.20	470668	100.40	470983	100.20	471051	100.00
471120	100.10	471311	99.80	471377	100.10	472515	100.40	472539	100.20
472607	100.60	472635	100.10	475209	100.30	475478	99.20	475501	99.90
475550	100.10	475642	100.10	475881	100.40	478291	100.00	478479	100.00
478491	99.90	478495	100.00	478576	100.10	478590	99.90	478666	100.30
478685	99.80	478714	100.10	481455	100.30	483347	100.00	483683	100.60

INFORMATION NEEDED

VALUE OBTAINED

1 Sample Size (N)	50
2 Sum of Measurements: (Sum X)	5003.63
3 Sum of Squared Measurements	500731.76
4 Correction Factor (CF): Sum of Measurements Squared / N	500726.26
5 Corrected Sum of Squares (SS)	5.50
6 Variance (V) : SS/(N-1)	0.1122
7 Estimate of Lot Standard Deviation(S): SQRT of V	0.3350
8 Sample Mean(XBAR): Sum X/N	100.07
9 Upper Specification Limit (U)	102.00
10 Lower Specification Limit (L)	98.00
11 Quality Index Upper (QU): (U-XBAR) / S	5.75
12 Quality Index Lower (QL): (XBAR-L) / S	6.19
13 Estimate of Lot Percent NCF Above U (PU)	0.00
14 Estimate of Lot Percent NCF Below L (PL)	0.00
15 Total Estimate Percent NCF. In Lot (P): PU+PL	0.00
16 Maximum Allowable Percent NCF (M)	5.21
17 Acceptability Criterion: Compare P with M	PASS
18 The Lot Meets the Acceptability Criterion if P <= M	
19 The Lot Fails the Acceptability Criterion if P > M	

Louisville Gas and Electric

2014 Sample Test Program (01/01/2014) to (12/31/2014)

Device Category: F2S240V30AC200E Model Number: I-210 (ERT) Division: 01 Sample Lot: 1309 Lot Descr: LG&E I210-1
 In Service Population: 1,102 Sample Quantity: 35 Meters Tested: 35 Pass/ Fail: PASS

Test Results Per ANSI/ASQC Z1.9-1993

Double Specification Limit - Variability Unknown - Standard Deviation Method
 One AQL Value for Both Upper and Lower Specification Limit Combined
 AQL = 2.5% - Inspection Level II "E" # Normal Inspection

Page 9
 Run Date: 01/07/2015
 Run Time: 03:37:18 AM

Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy
832160	100.00	832169	100.00	832224	100.10	832301	100.10	832310	100.00
832317	100.10	832453	100.00	832477	99.80	832478	100.00	832500	100.20
832552	100.00	832574	99.90	832576	99.90	832581	99.90	832601	100.10
832629	99.90	832725	99.94	832734	99.90	832737	100.00	832820	100.00
832831	100.00	832907	100.00	832909	100.10	835347	100.00	835394	99.90
835395	100.00	838260	100.10	838294	99.90	838308	100.00	838320	100.00
838322	100.00	838339	99.90	838386	100.10	838395	100.00	838447	100.00

INFORMATION NEEDED

VALUE OBTAINED

1 Sample Size (N)	35
2 Sum of Measurements: (Sum X)	3499.84
3 Sum of Squared Measurements	349968.23
4 Correction Factor (CF): Sum of Measurements Squared / N	349968.00
5 Corrected Sum of Squares (SS)	0.23
6 Variance (V) : SS/(N-1)	0.0068
7 Estimate of Lot Standard Deviation(S): SQRT of V	0.0828
8 Sample Mean(XBAR) : Sum X/N	100.00
9 Upper Specification Limit (U)	102.00
10 Lower Specification Limit (L)	98.00
11 Quality Index Upper (QU) : (U-XBAR) / S	24.22
12 Quality Index Lower (QL) : (XBAR-L) / S	24.11
13 Estimate of Lot Percent NCF Above U (PU)	0.00
14 Estimate of Lot Percent NCF Below L (PL)	0.00
15 Total Estimate Percent NCF. In Lot (P) : PU+PL	0.00
16 Maximum Allowable Percent NCF (M)	5.58
17 Acceptability Criterion: Compare P with M	PASS
18 The Lot Meets the Acceptability Criterion if P <= M	
19 The Lot Fails the Acceptability Criterion if P > M	

Louisville Gas and Electric

2014 Sample Test Program (01/01/2014) to (12/31/2014)

Device Category: F2S240V15AC100

Model Number: I-50S

Division: 01

Sample Lot: 1310

Lot Descr: LG&E I50-1

In Service Population: 1,055

Sample Quantity: 35

Meters Tested: 35

Pass/ Fail: PASS

Test Results Per ANSI/ASQC Z1.9-1993

Double Specification Limit - Variability Unknown - Standard Deviation Method

Page 10

One AQL Value for Both Upper and Lower Specification Limit Combined

Run Date: 01/07/2015

AQL = 2.5% - Inspection Level II "E" # Normal Inspection

Run Time: 03:37:18 AM

Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy
182597	99.80	183591	100.00	198153	100.20	198591	100.60	199136	99.70
199638	100.00	200033	99.90	200163	100.10	204538	100.40	205194	100.00
207370	100.50	208112	100.00	208678	99.90	208963	100.00	213833	100.30
217032	100.00	218364	100.00	220021	100.00	222483	100.20	222872	99.90
223396	100.20	223929	100.10	224849	99.70	226898	100.40	227944	100.10
229391	98.40	230344	99.70	233239	99.80	234187	100.50	234964	100.20
235095	100.20	235813	99.90	236217	100.30	237077	99.80	237197	99.80

INFORMATION NEEDED

VALUE OBTAINED

1 Sample Size (N)	35
2 Sum of Measurements: (Sum X)	3500.60
3 Sum of Squared Measurements	350124.62
4 Correction Factor (CF): Sum of Measurements Squared / N	350120.01
5 Corrected Sum of Squares (SS)	4.61
6 Variance (V) : SS/(N-1)	0.1356
7 Estimate of Lot Standard Deviation(S): SQRT of V	0.3682
8 Sample Mean(XBAR): Sum X/N	100.02
9 Upper Specification Limit (U)	102.00
10 Lower Specification Limit (L)	98.00
11 Quality Index Upper (QU): (U-XBAR) / S	5.39
12 Quality Index Lower (QL): (XBAR-L) / S	5.48
13 Estimate of Lot Percent NCF Above U (PU)	0.00
14 Estimate of Lot Percent NCF Below L (PL)	0.00
15 Total Estimate Percent NCF. In Lot (P): PU+PL	0.00
16 Maximum Allowable Percent NCF(M)	5.58
17 Acceptability Criterion: Compare P with M	PASS
18 The Lot Meets the Acceptability Criterion if P <= M	
19 The Lot Fails the Acceptability Criterion if P > M	

Louisville Gas and Electric

2014 Sample Test Program (01/01/2014) to (12/31/2014)

Device Category: F2S240V15AC100 Model Number: I-558 Division: 01 Sample Lot: 1311 Lot Descr: LG&E I55-1
 In Service Population: 1,368 Sample Quantity: 50 Meters Tested: 50 Pass/ Fail: PASS

Test Results Per ANSI/ASQC Z1.9-1993

Double Specification Limit - Variability Unknown - Standard Deviation Method
 One AQL Value for Both Upper and Lower Specification Limit Combined
 AQL = 2.5% - Inspection Level II "E" # Normal Inspection

Page 11
 Run Date: 01/07/2015
 Run Time: 03:37:18 AM

Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy
238312	99.90	238655	100.20	240461	100.00	240549	100.00	240795	100.00
240821	100.70	242500	99.90	243785	100.00	243892	100.20	243943	100.50
245428	100.00	245680	99.40	245745	100.50	245795	100.20	245813	100.30
246140	100.50	246224	100.00	246855	100.40	246886	100.40	247776	100.00
248016	100.30	248183	100.62	248426	100.40	248600	100.40	248624	100.00
251305	100.20	251530	100.50	251833	100.10	251991	99.60	252157	100.00
257514	100.10	257562	100.10	257583	100.30	257823	100.30	263186	99.80
263200	100.30	263307	100.10	263409	100.00	263517	100.20	264115	99.70
264379	100.40	264563	99.90	264951	100.00	264977	99.90	265238	99.90
265337	100.00	265373	99.40	265507	100.10	265716	99.90	265844	99.60

INFORMATION NEEDED

VALUE OBTAINED

1 Sample Size (N)	50
2 Sum of Measurements: (Sum X)	5005.22
3 Sum of Squared Measurements	501048.60
4 Correction Factor (CF): Sum of Measurements Squared / N	501044.54
5 Corrected Sum of Squares (SS)	4.06
6 Variance (V) : SS/(N-1)	0.0828
7 Estimate of Lot Standard Deviation(S): SQRT of V	0.2878
8 Sample Mean(XBAR): Sum X/N	100.10
9 Upper Specification Limit (U)	102.00
10 Lower Specification Limit (L)	98.00
11 Quality Index Upper (QU): (U-XBAR) / s	6.59
12 Quality Index Lower (QL): (XBAR-L) / s	7.31
13 Estimate of Lot Percent NCF Above U (PU)	0.00
14 Estimate of Lot Percent NCF Below L (PL)	0.00
15 Total Estimate Percent NCF, In Lot (P): PU+PL	0.00
16 Maximum Allowable Percent NCF (M)	5.21
17 Acceptability Criterion: Compare P with M	PASS
18 The Lot Meets the Acceptability Criterion if P <= M	
19 The Lot Fails the Acceptability Criterion if P > M	

Louisville Gas and Electric

2014 Sample Test Program (01/01/2014) to (12/31/2014)

Device Category: F2S240V30AC200 Model Number: I-60S Division: 01 Sample Lot: 1312 Lot Descr: LGGE I60-1
 In Service Population: 10,000 Sample Quantity: 75 Meters Tested: 75 Pass/ Fail: PASS

Test Results Per ANSI/ASQC Z1.9-1993

Double Specification Limit - Variability Unknown - Standard Deviation Method

One AQL Value for Both Upper and Lower Specification Limit Combined

AQL = 2.5% - Inspection Level II "E" # Normal Inspection

Page 12

Run Date: 01/07/2015

Run Time: 03:37:18 AM

Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy
269067	99.90	271258	99.90	271270	100.30	275164	100.00	279081	100.10
279113	99.60	279371	99.80	280009	100.30	280438	99.80	280533	99.96
281221	100.20	281511	99.70	281551	99.50	281693	99.70	281770	99.90
281897	100.10	281912	99.70	282505	100.20	282577	99.40	285070	99.70
285971	100.60	286418	99.90	286442	99.80	286501	100.60	291512	100.00
292232	99.40	292626	100.00	292817	100.00	292880	99.80	294137	99.90
294363	99.40	297310	100.40	297343	100.00	297997	99.60	298104	100.80
299476	99.70	300127	100.10	300140	99.40	303863	99.80	304335	99.40
307463	99.40	307523	100.10	307687	100.10	307709	100.00	311585	99.50
311589	100.10	311608	100.30	312024	100.40	312208	100.30	312272	99.80
312282	100.60	312827	100.00	313075	100.80	313345	100.30	313546	100.00
313573	100.10	313615	100.20	316852	100.00	317259	100.20	317470	99.40
317578	99.50	317652	99.70	317881	100.10	317961	100.20	318377	99.70
319582	99.80	320068	100.00	320468	100.10	322461	99.80	327200	99.90
331266	100.20	331277	99.70	331453	100.10	331502	99.90	333943	100.00

INFORMATION NEEDED

VALUE OBTAINED

1 Sample Size (N)	75
2 Sum of Measurements: (Sum X)	7496.66
3 Sum of Squared Measurements	749340.17
4 Correction Factor (CF): Sum of Measurements Squared / N	749332.15
5 Corrected Sum of Squares (SS)	8.02
6 Variance (V) : SS/(N-1)	0.1084
7 Estimate of Lot Standard Deviation(S): SQRT of V	0.3293
8 Sample Mean(XBAR) : Sum X/N	99.96
9 Upper Specification Limit (U)	102.00
10 Lower Specification Limit (L)	98.00
11 Quality Index Upper (QU): (U-XBAR) / S	6.21
12 Quality Index Lower (QL): (XBAR-L) / S	5.94
13 Estimate of Lot Percent NCF Above U (PU)	0.00
14 Estimate of Lot Percent NCF Below L (PL)	0.00
15 Total Estimate Percent NCF. In Lot (P): PU+PL	0.00
16 Maximum Allowable Percent NCF(M)	4.83
17 Acceptability Criterion: Compare P with M	PASS
18 The Lot Meets the Acceptability Criterion if P <= M	
19 The Lot Fails the Acceptability Criterion if P > M	

Louisville Gas and Electric

2014 Sample Test Program (01/01/2014) to (12/31/2014)

Device Category: F2S240V30AC200 Model Number: I-60S Division: 01 Sample Lot: 1313 Lot Descr: LG&E 160-2
 In Service Population: 2,768 Sample Quantity: 50 Meters Tested: 50 Pass/ Fail: PASS

Test Results Per ANSI/ASQC Z1.9-1993

Double Specification Limit - Variability Unknown - Standard Deviation Method
 One AQL Value for Both Upper and Lower Specification Limit Combined
 AQL = 2.5% - Inspection Level II "E" # Normal Inspection

Page 13
 Run Date: 01/07/2015
 Run Time: 03:37:18 AM

Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy
334085	100.20	334155	100.10	334196	99.80	335582	100.00	335744	100.30
335796	100.00	335835	100.10	338081	100.00	338117	100.10	338156	100.10
338490	100.10	338831	100.10	340145	100.20	340157	99.70	340443	100.30
341081	99.70	342775	100.30	342892	100.20	343154	99.90	343368	100.00
345411	100.10	345467	100.10	345742	100.10	347360	100.10	347391	100.40
348056	100.00	348194	100.20	349398	100.20	349565	100.00	349612	100.00
349956	100.00	350071	99.90	350077	99.70	352328	99.70	352333	100.10
352508	99.90	352556	100.10	352635	100.20	352749	100.40	352750	99.80
352753	99.90	352944	99.80	355012	100.00	355231	99.90	356961	99.90
357444	100.10	357728	100.50	358976	100.00	359530	100.10	359736	99.80

INFORMATION NEEDED

VALUE OBTAINED

1 Sample Size (N)	50
2 Sum of Measurements: (Sum X)	5002.20
3 Sum of Squared Measurements	500441.80
4 Correction Factor (CF): Sum of Measurements Squared / N	500440.10
5 Corrected Sum of Squares (SS)	1.70
6 Variance (V) : SS/(N-1)	0.0348
7 Estimate of Lot Standard Deviation(S): SQRT of V	0.1864
8 Sample Mean (XBAR): Sum X/N	100.04
9 Upper Specification Limit (U)	102.00
10 Lower Specification Limit (L)	98.00
11 Quality Index Upper (QU): (U-XBAR) / S	10.49
12 Quality Index Lower (QL): (XBAR-L) / S	10.96
13 Estimate of Lot Percent NCF Above U (PU)	0.00
14 Estimate of Lot Percent NCF Below L (PL)	0.00
15 Total Estimate Percent NCF. In Lot (P): PU+PL	0.00
16 Maximum Allowable Percent NCF (M)	5.21
17 Acceptability Criterion: Compare P with M	PASS
18 The Lot Meets the Acceptability Criterion if P <= M	
19 The Lot Fails the Acceptability Criterion if P > M	

Louisville Gas and Electric

2014 Sample Test Program (01/01/2014) to (12/31/2014)

Device Category: F2S240V30AC200
In Service Population: 10,000

Model Number: I-70S
Sample Quantity: 75

Division: 01

Sample Lot: 1314

Lot Descr: LG&E I70-1

Meters Tested: 75

Pass/ Fail: PASS

Test Results Per ANSI/ASQC Z1.9-1993

Double Specification Limit - Variability Unknown - Standard Deviation Method

One AQL Value for Both Upper and Lower Specification Limit Combined

AQL = 2.5% - Inspection Level II "E" # Normal Inspection

Page 14

Run Date: 01/07/2015

Run Time: 03:37:18 AM

Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy
361238	99.90	361507	100.00	361527	100.10	361681	99.70	361701	100.00
361837	100.10	363399	99.90	363473	100.00	363548	100.30	363825	99.90
364044	100.20	364076	100.00	364103	100.20	366148	100.00	366295	99.90
366396	99.60	366530	100.30	366625	99.90	368240	100.20	368543	100.30
368572	100.10	368657	100.10	368851	100.10	371083	100.50	371331	100.20
372849	100.40	372906	100.00	372980	100.20	373035	100.20	373270	94.40
373484	100.40	373562	100.50	373755	100.30	375273	100.30	375309	100.10
375421	100.20	375580	100.20	375612	99.80	375930	100.00	376049	100.10
377438	100.30	377635	100.40	377774	100.30	377784	100.30	377910	100.40
378056	100.10	378058	100.40	380403	100.30	380673	100.20	382495	100.10
382593	100.30	382694	100.10	382740	100.10	382815	100.30	382840	100.00
383037	100.20	384751	100.30	384813	100.30	385059	100.20	385348	100.30
387157	100.30	387344	100.20	387369	100.50	387400	100.70	387405	100.00
387454	100.20	387524	100.30	387628	100.41	387632	100.20	387683	100.30
390251	100.00	390921	99.90	392155	100.30	392251	100.20	392419	100.60

INFORMATION NEEDED

VALUE OBTAINED

1 Sample Size (N)	75
2 Sum of Measurements: (Sum X)	7507.61
3 Sum of Squared Measurements	751558.61
4 Correction Factor (CF): Sum of Measurements Squared / N	751522.77
5 Corrected Sum of Squares (SS)	35.84
6 Variance (V) : SS/(N-1)	0.4843
7 Estimate of Lot Standard Deviation(S): SQRT of V	0.6959
8 Sample Mean(XBAR): Sum X/N	100.10
9 Upper Specification Limit (U)	102.00
10 Lower Specification Limit (L)	98.00
11 Quality Index Upper (QU): (U-XBAR) / S	2.73
12 Quality Index Lower (QL): (XBAR-L) / S	3.02
13 Estimate of Lot Percent NCF Above U (PU)	0.26
14 Estimate of Lot Percent NCF Below L (PL)	0.09
15 Total Estimate Percent NCF. In Lot (P): PU+PL	0.35
16 Maximum Allowable Percent NCF(M)	4.83
17 Acceptability Criterion: Compare P with M	PASS
18 The Lot Meets the Acceptability Criterion if P <= M	
19 The Lot Fails the Acceptability Criterion if P > M	

Louisville Gas and Electric

2014 Sample Test Program (01/01/2014) to (12/31/2014)

Device Category: F2S240V30AC200 Model Number: I-70S Division: 01 Sample Lot: 1315 Lot Descr: LG6E I70-2
 In Service Population: 10,000 Sample Quantity: 75 Meters Tested: 75 Pass/ Fail: PASS

Test Results Per ANSI/ASQC Z1.9-1993

Double Specification Limit - Variability Unknown - Standard Deviation Method
 One AQL Value for Both Upper and Lower Specification Limit Combined
 AQL = 2.5% - Inspection Level II "E" # Normal Inspection

Page 15
 Run Date: 01/07/2015
 Run Time: 03:37:18 AM

Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy
395043	100.10	395083	100.20	395115	100.00	395255	100.10	395377	100.60
395514	100.40	396644	100.00	396682	100.00	396809	99.80	396956	99.80
396984	100.10	397000	99.70	397073	100.30	399038	100.10	399422	100.10
399426	99.80	399651	100.30	399682	100.30	399705	99.70	399945	99.90
401620	100.30	401783	100.00	401899	100.00	401914	100.00	402144	100.10
402166	100.00	402359	100.40	402373	100.30	404825	100.30	405099	100.40
405280	100.60	406510	100.10	406837	100.10	407047	100.30	409142	100.20
409737	100.10	409783	99.90	409984	100.00	409991	100.00	409995	100.10
411085	100.00	411394	100.00	411437	99.80	411509	100.20	411604	99.90
411738	99.70	411746	99.90	413901	99.90	414315	100.30	414369	100.20
414491	99.90	414611	100.00	414614	100.40	414772	100.00	416196	100.30
416211	100.20	416285	100.30	416392	100.40	416683	100.30	416746	100.40
416899	100.20	418701	100.20	418902	100.30	418903	99.90	419364	99.50
421052	99.80	421175	100.20	421712	99.90	421736	100.30	421741	100.20
421772	100.30	421781	100.30	423960	100.20	423981	100.20	424009	99.70

INFORMATION NEEDED

VALUE OBTAINED

1 Sample Size (N)	75
2 Sum of Measurements: (Sum X)	7507.80
3 Sum of Squared Measurements	751564.46
4 Correction Factor (CF): Sum of Measurements Squared / N	751560.81
5 Corrected Sum of Squares (SS)	3.65
6 Variance (V) : SS/(N-1)	0.0493
7 Estimate of Lot Standard Deviation(S): SQRT of V	0.2221
8 Sample Mean(XBAR): Sum X/N	100.10
9 Upper Specification Limit (U)	102.00
10 Lower Specification Limit (L)	98.00
11 Quality Index Upper (QU): (U-XBAR) / S	8.54
12 Quality Index Lower (QL): (XBAR-L) / S	9.48
13 Estimate of Lot Percent NCF Above U (PU)	0.00
14 Estimate of Lot Percent NCF Below L (PL)	0.00
15 Total Estimate Percent NCF, In Lot (P): PU+PL	0.00
16 Maximum Allowable Percent NCF (M)	4.83
17 Acceptability Criterion: Compare P with M	PASS
18 The Lot Meets the Acceptability Criterion if P <= M	
19 The Lot Fails the Acceptability Criterion if P > M	

Louisville Gas and Electric

2014 Sample Test Program (01/01/2014) to (12/31/2014)

Device Category: F2S240V30AC200 Model Number: I-70S Division: 01 Sample Lot: 1316 Lot Descr: LG&E 170-3
 In Service Population: 10,000 Sample Quantity: 75 Meters Tested: 75 Pass/ Fail: PASS

Test Results Per ANSI/ASQC Z1.9-1993

Double Specification Limit - Variability Unknown - Standard Deviation Method

One AQL Value for Both Upper and Lower Specification Limit Combined

AQL = 2.5% - Inspection Level II "E" # Normal Inspection

Page 16

Run Date: 01/07/2015

Run Time: 03:37:18 AM

Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy
424183	99.80	424254	100.10	424567	100.10	424682	100.10	424720	99.70
425734	99.90	425805	100.40	425996	100.30	426121	100.10	426183	100.10
426288	100.10	426294	100.30	426444	100.30	426656	100.20	429045	100.20
429147	99.10	429218	100.30	429219	100.30	429629	100.20	432038	100.10
432172	100.10	432207	100.10	432639	100.40	434633	99.70	435818	100.20
436532	100.00	437531	99.40	437564	100.50	437870	99.80	438294	100.00
442653	101.00	442755	100.00	443010	100.20	444971	99.80	444992	99.80
445328	100.20	445397	99.90	445428	100.10	445466	100.10	445769	100.20
448410	99.90	448516	100.10	448561	100.60	448600	99.90	449243	100.00
450698	100.00	450763	100.00	450877	99.80	451042	99.70	451276	100.00
453092	100.20	453205	99.90	453259	100.10	453325	100.10	453332	98.60
455250	100.60	455380	100.20	455491	100.40	456652	100.30	455939	100.30
459308	99.70	459345	100.20	459466	100.10	459566	99.90	459567	100.20
459752	100.20	459759	100.00	461601	99.90	461827	100.10	461954	100.20
462218	100.00	462232	100.00	462241	100.10	462362	100.20	462374	100.00

INFORMATION NEEDED

VALUE OBTAINED

1 Sample Size (N)	75
2 Sum of Measurements: (Sum X)	7504.70
3 Sum of Squared Measurements	750947.57
4 Correction Factor (CF): Sum of Measurements Squared / N	750940.29
5 Corrected Sum of Squares (SS)	7.28
6 Variance (V) : SS/(N-1)	0.0983
7 Estimate of Lot Standard Deviation(S): SQRT of V	0.3136
8 Sample Mean(XBAR) : Sum X/N	100.06
9 Upper Specification Limit (U)	102.00
10 Lower Specification Limit (L)	98.00
11 Quality Index Upper (QU): (U-XBAR) / S	6.18
12 Quality Index Lower (QL): (XBAR-L) / S	6.58
13 Estimate of Lot Percent NCF Above U (PU)	0.00
14 Estimate of Lot Percent NCF Below L (PL)	0.00
15 Total Estimate Percent NCF. In Lot (P): PU+PL	0.00
16 Maximum Allowable Percent NCF(M)	4.83
17 Acceptability Criterion: Compare P with M	PASS
18 The Lot Meets the Acceptability Criterion if P <= M	
19 The Lot Fails the Acceptability Criterion if P > M	

Louisville Gas and Electric

2014 Sample Test Program (01/01/2014) to (12/31/2014)

Device Category: F2S240V30AC200 Model Number: I-70S Division: 01 Sample Lot: 1317 Lot Descr: LG&E I70-4
 In Service Population: 10,000 Sample Quantity: 75 Meters Tested: 75 Pass/ Fail: PASS

Test Results Per ANSI/ASQC Z1.9-1993

Double Specification Limit - Variability Unknown - Standard Deviation Method

One AQL Value for Both Upper and Lower Specification Limit Combined

AQL = 2.5% - Inspection Level II "E" # Normal Inspection

Page 17

Run Date: 01/07/2015

Run Time: 03:37:18 AM

Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy
462400	99.90	463915	99.90	464018	100.00	465675	100.30	466081	99.90
466516	100.40	467710	100.30	467857	100.30	467896	100.20	471481	100.00
471786	100.00	471958	100.30	472410	100.00	472420	99.80	472433	99.80
472458	100.20	474052	100.10	474215	100.10	474520	100.00	474554	100.00
474864	99.00	476062	99.90	476093	100.00	476151	99.40	476423	100.00
476460	99.60	476486	100.30	476785	99.90	476820	100.00	476859	100.20
477685	100.10	478935	100.00	479195	100.50	479557	100.40	479825	100.10
479844	100.70	479851	99.90	482708	100.30	482751	100.10	482832	100.30
483935	100.10	484151	100.00	484170	99.90	484263	99.90	484369	100.40
484577	100.10	484734	99.70	484933	100.20	484966	100.10	487314	100.20
487320	100.20	487529	100.10	487602	100.20	487646	100.10	487695	100.10
487702	100.30	487875	100.00	488101	100.20	488149	99.70	489517	100.10
489652	100.10	489833	100.10	490057	100.20	490077	99.90	490816	100.00
490998	100.10	492280	100.20	493189	99.90	493246	100.00	493304	100.30
493390	100.00	493436	100.20	493490	99.90	493728	99.80	493759	99.20

INFORMATION NEEDED

VALUE OBTAINED

1 Sample Size (N)	75
2 Sum of Measurements: (Sum X)	7503.70
3 Sum of Squared Measurements	750745.19
4 Correction Factor (CF): Sum of Measurements Squared / N	750740.18
5 Corrected Sum of Squares (SS)	5.01
6 Variance (V) : SS/(N-1)	0.0677
7 Estimate of Lot Standard Deviation(S): SQRT of V	0.2601
8 Sample Mean(XBAR): Sum X/N	100.05
9 Upper Specification Limit (U)	102.00
10 Lower Specification Limit (L)	98.00
11 Quality Index Upper (QU): (U-XBAR) / S	7.50
12 Quality Index Lower (QL): (XBAR-L) / S	7.88
13 Estimate of Lot Percent NCF Above U (PU)	0.00
14 Estimate of Lot Percent NCF Below L (PL)	0.00
15 Total Estimate Percent NCF. In Lot (P): PU+PL	0.00
16 Maximum Allowable Percent NCF(M)	4.83
17 Acceptability Criterion: Compare P with M	PASS
18 The Lot Meets the Acceptability Criterion if P <= M	
19 The Lot Fails the Acceptability Criterion if P > M	

Louisville Gas and Electric

2014 Sample Test Program (01/01/2014) to (12/31/2014)

Device Category: F2S240V30AC200
In Service Population: 10,000

Model Number: I-70S
Sample Quantity: 75

Division: 01

Sample Lot: 1318

Lot Descr: LG&E I70-5

Meters Tested: 75

Pass/ Fail: PASS

Test Results Per ANSI/ASQC Z1.9-1993

Double Specification Limit - Variability Unknown - Standard Deviation Method

One AQL Value for Both Upper and Lower Specification Limit Combined

AQL = 2.5% - Inspection Level II "E" # Normal Inspection

Page 18

Run Date: 01/07/2015

Run Time: 03:37:18 AM

Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy
494173	99.70	495504	99.80	495518	99.90	495656	100.20	498625	100.00
498682	100.00	498904	100.00	499112	100.00	499172	100.10	499202	100.00
499564	100.00	501023	100.20	501041	100.30	501336	99.90	501724	100.20
501744	100.20	501922	99.90	506068	99.60	506247	99.90	506655	99.00
506665	99.70	506682	99.90	506771	100.30	507093	100.20	509763	100.10
510062	99.60	510073	100.00	510134	99.90	510627	99.70	511003	100.10
511024	100.00	511060	100.00	511149	100.10	511299	100.00	511318	99.90
511790	100.20	511861	100.30	512092	100.00	512093	100.30	512208	100.00
512209	100.00	515794	100.10	515872	100.00	516075	100.10	516106	99.80
516124	99.80	516503	100.00	516529	100.10	518758	99.80	522159	99.70
522449	99.90	522704	99.80	522717	99.70	522799	99.70	522816	100.20
522904	100.10	524158	99.70	524238	99.80	524813	100.10	524903	100.00
526672	100.20	526694	100.20	526898	100.10	529055	99.80	529158	100.30
529182	99.80	529236	99.90	529504	100.10	529577	100.10	529614	99.60
529764	100.40	529831	99.90	532846	99.80	533167	100.00	533540	100.40

INFORMATION NEEDED

VALUE OBTAINED

1 Sample Size (N)	75
2 Sum of Measurements: (Sum X)	7498.20
3 Sum of Squared Measurements	749643.82
4 Correction Factor (CF): Sum of Measurements Squared / N	749640.04
5 Corrected Sum of Squares (SS)	3.78
6 Variance (V) : SS/(N-1)	0.0510
7 Estimate of Lot Standard Deviation(S): SQRT of V	0.2259
8 Sample Mean(XBAR): Sum X/N	99.98
9 Upper Specification Limit (U)	102.00
10 Lower Specification Limit (L)	98.00
11 Quality Index Upper (QU): (U-XBAR) / S	8.96
12 Quality Index Lower (QL): (XBAR-L) / S	8.75
13 Estimate of Lot Percent NCF Above U (PU)	0.00
14 Estimate of Lot Percent NCF Below L (PL)	0.00
15 Total Estimate Percent NCF. In Lot (P): PU+PL	0.00
16 Maximum Allowable Percent NCF(M)	4.83
17 Acceptability Criterion: Compare P with M	PASS
18 The Lot Meets the Acceptability Criterion if P <= M	
19 The Lot Fails the Acceptability Criterion if P > M	

Louisville Gas and Electric

2014 Sample Test Program (01/01/2014) to (12/31/2014)

Device Category: F2S240V30AC200 Model Number: I-70S Division: 01 Sample Lot: 1319 Lot Descr: LG&E I70-6
 In Service Population: 10,000 Sample Quantity: 75 Meters Tested: 75 Pass/ Fail: PASS

Test Results Per ANSI/ASQC Z1.9-1993

Double Specification Limit - Variability Unknown - Standard Deviation Method
 One AQL Value for Both Upper and Lower Specification Limit Combined
 AQL = 2.5% - Inspection Level II "E" # Normal Inspection

Page 19
 Run Date: 01/07/2015
 Run Time: 03:37:18 AM

Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy
540623	100.10	540930	100.60	540935	100.30	541052	100.20	541154	100.20
541355	100.10	541644	99.80	542035	100.00	542142	100.00	545188	100.00
545492	100.00	551686	100.10	551748	100.10	551971	100.20	552413	100.20
552481	100.00	552597	100.20	552603	100.00	552991	100.20	553221	99.90
553294	99.90	553443	99.70	553583	100.10	553672	100.20	553709	100.10
553718	100.20	553767	99.90	553899	100.20	553968	99.90	554149	100.10
554167	100.20	554176	100.10	554216	100.10	555364	99.80	555396	100.10
555413	100.00	555647	100.20	555661	100.10	561833	100.10	562074	100.00
562102	100.10	562238	100.10	562312	100.10	562475	100.10	562536	100.10
562606	100.10	562627	100.10	562656	100.20	562811	99.90	563714	100.10
564036	99.40	564041	98.80	564085	100.00	564228	100.10	564231	100.00
564540	99.60	564593	100.20	564647	100.20	564659	100.30	564686	100.10
564797	99.90	565023	100.10	565129	100.10	565472	100.20	568560	100.00
568977	100.00	569075	99.90	569217	100.00	569442	100.00	569457	100.10
569562	99.80	569710	100.00	569773	100.10	569881	100.00	569905	99.90

INFORMATION NEEDED

VALUE OBTAINED

1 Sample Size (N)	75
2 Sum of Measurements: (Sum X)	7502.90
3 Sum of Squared Measurements	750583.65
4 Correction Factor (CF): Sum of Measurements Squared / N	750580.11
5 Corrected Sum of Squares (SS)	3.54
6 Variance (V) : SS/(N-1)	0.0478
7 Estimate of Lot Standard Deviation(S): SQRT of V	0.2187
8 Sample Mean(XBAR): Sum X/N	100.04
9 Upper Specification Limit (U)	102.00
10 Lower Specification Limit (L)	98.00
11 Quality Index Upper (QU): (U-XBAR) / S	8.97
12 Quality Index Lower (QL): (XBAR-L) / S	9.32
13 Estimate of Lot Percent NCF Above U (PU)	0.00
14 Estimate of Lot Percent NCF Below L (PL)	0.00
15 Total Estimate Percent NCF. In Lot (P): PU+PL	0.00
16 Maximum Allowable Percent NCF (M)	4.83
17 Acceptability Criterion: Compare P with M	PASS
18 The Lot Meets the Acceptability Criterion if P <= M	
19 The Lot Fails the Acceptability Criterion if P > M	

Louisville Gas and Electric

2014 Sample Test Program (01/01/2014) to (12/31/2014)

Device Category: F2S240V30AC200 Model Number: I-70S Division: 01 Sample Lot: 1320 Lot Descr: LG&E I70-7
 In Service Population: 10,000 Sample Quantity: 75 Meters Tested: 75 Pass/ Fail: PASS

Test Results Per ANSI/ASQC Z1.9-1993

Double Specification Limit - Variability Unknown - Standard Deviation Method
 One AQL Value for Both Upper and Lower Specification Limit Combined
 AQL = 2.5% - Inspection Level II "E" # Normal Inspection

Page 20
 Run Date: 01/07/2015
 Run Time: 03:37:18 AM

Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy
570435	100.10	570560	100.10	570600	99.80	570667	100.00	570875	100.00
571028	100.10	571088	99.90	571386	99.80	571466	100.00	571516	100.00
571680	100.40	572145	100.10	572218	100.00	572348	100.10	572362	100.20
572514	100.30	572809	99.90	572818	100.00	572873	100.30	573126	99.90
573612	99.90	573631	100.30	573772	100.20	573881	100.30	573905	100.00
575314	100.00	582036	100.10	582236	100.40	582329	97.40	582480	100.10
582568	100.00	582941	100.00	583585	100.20	583581	100.40	583634	100.30
583774	100.10	588461	100.00	591528	100.00	591884	100.00	592466	100.10
592601	100.40	592640	100.10	592832	100.00	592954	100.20	593033	98.00
593501	100.00	593749	100.20	593807	100.20	593899	100.10	594017	100.10
594090	100.20	594112	100.20	594715	100.10	594950	100.30	598848	99.60
598937	99.90	598993	100.10	599052	100.00	599324	99.80	602898	99.90
603092	100.10	603123	100.10	603493	99.80	603527	100.30	603609	99.80
603658	100.20	603724	100.00	603755	100.10	603801	100.30	604046	99.90
604339	99.60	604424	100.00	604475	100.10	604719	99.90	604730	100.10

INFORMATION NEEDED

VALUE OBTAINED

1 Sample Size (N)	75
2 Sum of Measurements: (Sum X)	7500.50
3 Sum of Squared Measurements	750113.27
4 Correction Factor (CF): Sum of Measurements Squared / N	750100.00
5 Corrected Sum of Squares (SS)	13.27
6 Variance (V) : SS/(N-1)	0.1793
7 Estimate of Lot Standard Deviation(S): SQRT of V	0.4234
8 Sample Mean(XBAR): Sum X/N	100.01
9 Upper Specification Limit (U)	102.00
10 Lower Specification Limit (L)	98.00
11 Quality Index Upper (QU): (U-XBAR) / S	4.71
12 Quality Index Lower (QL): (XBAR-L) / S	4.74
13 Estimate of Lot Percent NCF Above U (PU)	0.00
14 Estimate of Lot Percent NCF Below L (PL)	0.00
15 Total Estimate Percent NCF. In Lot (P): PU+PL	0.00
16 Maximum Allowable Percent NCF (M)	4.83
17 Acceptability Criterion: Compare P with M	PASS
18 The Lot Meets the Acceptability Criterion if P <= M	
19 The Lot Fails the Acceptability Criterion if P > M	

Louisville Gas and Electric

2014 Sample Test Program (01/01/2014) to (12/31/2014)

Device Category: F2S240V30AC200
In Service Population: 10,000

Model Number: I-70S
Sample Quantity: 75

Division: 01
Meters Tested: 75

Sample Lot: 1321
Pass/ Fail: PASS

Lot Descr: LG&E I70-8

Test Results Per ANSI/ASQC Z1.9-1993

Double Specification Limit - Variability Unknown - Standard Deviation Method
One AQL Value for Both Upper and Lower Specification Limit Combined
AQL = 2.5% - Inspection Level II "E" # Normal Inspection

Page 21

Run Date: 01/07/2015

Run Time: 03:37:18 AM

Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy
604777	99.80	604797	99.90	604887	100.10	604940	100.00	605098	100.00
605873	100.00	606131	100.10	606363	99.90	606729	99.70	606888	100.60
607055	99.90	607088	99.70	607108	99.80	610861	100.00	623592	100.30
623601	100.40	623698	100.00	624104	100.20	624284	98.50	624434	100.20
624856	100.00	624902	98.60	625212	100.10	625328	100.10	625504	99.90
625610	100.40	626343	100.20	626701	100.00	626744	100.10	626748	100.10
626852	99.90	627046	100.10	627061	100.20	627081	100.10	627124	99.60
627144	100.00	627285	99.90	627429	99.20	627682	100.00	627779	99.70
627967	100.10	628123	99.40	628184	99.70	628213	99.60	628433	99.90
628512	99.90	628573	100.00	628747	100.30	629313	100.10	629574	100.47
629785	100.20	630025	100.00	630041	99.40	630113	99.80	630176	100.00
630243	100.30	630461	100.20	630530	100.10	630582	100.10	630741	100.20
630997	100.10	631089	100.00	631236	100.00	631289	100.01	631691	100.00
631759	100.20	631862	100.40	631941	100.20	633568	99.60	633676	100.10
639678	100.00	640051	100.10	640135	99.90	640431	100.40	640578	100.10

INFORMATION NEEDED

VALUE OBTAINED

1 Sample Size (N)	75
2 Sum of Measurements: (Sum X)	7498.18
3 Sum of Squared Measurements	749644.63
4 Correction Factor (CF): Sum of Measurements Squared / N	749636.04
5 Corrected Sum of Squares (SS)	8.59
6 Variance (V) : SS/(N-1)	0.1160
7 Estimate of Lot Standard Deviation(S): SQRT of V	0.3406
8 Sample Mean (XBAR) : Sum X/N	99.98
9 Upper Specification Limit (U)	102.00
10 Lower Specification Limit (L)	98.00
11 Quality Index Upper (QU): (U-XBAR) / S	5.94
12 Quality Index Lower (QL): (XBAR-L) / S	5.80
13 Estimate of Lot Percent NCF Above U (PU)	0.00
14 Estimate of Lot Percent NCF Below L (PL)	0.00
15 Total Estimate Percent NCF. In Lot (P): PU+PL	0.00
16 Maximum Allowable Percent NCF(M)	4.83
17 Acceptability Criterion: Compare P with M	PASS
18 The Lot Meets the Acceptability Criterion if P <= M	
19 The Lot Fails the Acceptability Criterion if P > M	

Louisville Gas and Electric

2014 Sample Test Program (01/01/2014) to (12/31/2014)

Device Category: F2S240V30AC200
In Service Population: 10,000

Model Number: I-70S
Sample Quantity: 75

Division: 01
Meters Tasted: 75

Sample Lot: 1322
Pass/ Fail: PASS

Lot Descr: LG&E I70-9

Test Results Per ANSI/ASQC Z1.9-1993

Double Specification Limit - Variability Unknown - Standard Deviation Method
One AQL Value for Both Upper and Lower Specification Limit Combined
AQL = 2.5% - Inspection Level II "E" # Normal Inspection

Page 22

Run Date: 01/07/2015

Run Time: 03:37:18 AM

Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy
640736	100.20	640956	99.70	640994	100.10	641216	100.10	641364	100.10
641471	100.10	641502	100.10	641615	100.00	641853	100.20	642060	100.10
642331	99.90	642498	99.90	642730	99.80	643697	100.30	643771	100.20
643799	100.00	643938	100.20	643960	100.00	644110	100.10	644420	100.20
644441	100.30	644460	100.20	644569	100.10	644827	99.90	645425	99.50
654190	100.10	654384	99.80	654643	100.30	654695	100.10	654716	100.20
655044	100.20	655071	100.00	655093	99.90	655165	99.90	655233	100.00
655445	99.90	655497	100.20	655658	99.80	656033	99.80	656157	99.90
656194	100.10	656412	100.00	656439	99.90	656562	100.20	656575	100.20
656624	100.20	656658	100.20	656767	99.90	656858	100.40	656916	100.20
656993	99.80	657898	99.90	658064	99.80	661335	99.71	661476	100.20
676683	100.00	676822	100.10	676988	100.10	676997	100.20	677240	100.00
677465	99.90	677490	99.80	677631	100.00	678073	100.10	678090	100.10
678215	97.60	678634	99.90	678680	100.10	678789	99.90	678844	99.60
678936	99.90	679090	99.90	679132	100.10	679423	100.20	679470	99.70

INFORMATION NEEDED

VALUE OBTAINED

1 Sample Size (N)	75
2 Sum of Measurements: (Sum X)	7499.31
3 Sum of Squared Measurements	749870.14
4 Correction Factor (CF): Sum of Measurements Squared / N	749862.01
5 Corrected Sum of Squares (SS)	8.14
6 Variance (V) : SS/(N-1)	0.1100
7 Estimate of Lot Standard Deviation(S): SQRT of V	0.3316
8 Sample Mean(XBAR) : Sum X/N	99.99
9 Upper Specification Limit (U)	102.00
10 Lower Specification Limit (L)	98.00
11 Quality Index Upper (QU): (U-XBAR) / S	6.06
12 Quality Index Lower (QL): (XBAR-L) / S	6.00
13 Estimate of Lot Percent NCF Above U (PU)	0.00
14 Estimate of Lot Percent NCF Below L (PL)	0.00
15 Total Estimate Percent NCF. In Lot (P): PU+PL	0.00
16 Maximum Allowable Percent NCF(M)	4.83
17 Acceptability Criterion: Compare P with M	PASS
18 The Lot Meets the Acceptability Criterion if P <= M	
19 The Lot Fails the Acceptability Criterion if P > M	

Louisville Gas and Electric

2014 Sample Test Program (01/01/2014) to (12/31/2014)

Device Category: E2S240V30AC200 Model Number: I-705 Division: 01 Sample Lot: 1323 Lot Descr: LG&E 170-10
 In Service Population: 5,503 Sample Quantity: 75 Meters Tested: 75 Pass/ Fail: PASS

Test Results Per ANSI/ASQC Z1.9-1993

Double Specification Limit - Variability Unknown - Standard Deviation Method
 One AQL Value for Both Upper and Lower Specification Limit Combined
 AQL = 2.5% - Inspection Level II "E" # Normal Inspection

Page 23
 Run Date: 01/07/2015
 Run Time: 03:37:18 AM

Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy
679770	99.80	679784	100.00	679850	100.00	679936	99.90	679966	99.90
680067	100.00	680107	99.90	680124	99.60	680175	100.00	680271	99.90
680281	100.20	680378	99.70	680544	99.90	680640	99.60	680835	100.00
680880	99.70	681129	100.20	681182	100.40	681246	99.40	681320	99.90
681435	99.90	681579	99.80	681666	99.90	681760	100.20	681802	99.90
681959	100.30	682051	99.70	682228	100.00	682292	100.00	682487	100.00
682545	99.90	682930	99.60	682942	100.30	689311	100.20	689385	100.30
689416	100.10	689434	100.10	689696	100.00	689705	100.40	689882	101.40
689922	100.20	689948	100.30	690039	100.30	690083	100.00	690088	100.20
690089	100.10	690105	99.70	690313	100.10	690401	100.00	690443	100.10
690516	100.10	690544	100.30	690694	100.40	690700	100.10	690726	100.40
690926	100.10	690965	100.10	691084	100.20	691131	100.07	691207	100.20
691222	100.20	691233	100.00	691313	100.10	691338	100.20	691339	100.10
691370	100.20	691395	99.80	691416	100.20	691443	100.00	691707	100.10
691831	100.00	691877	100.10	692001	100.10	692068	100.00	698529	99.90

INFORMATION NEEDED

VALUE OBTAINED

1 Sample Size (N)	75
2 Sum of Measurements: (Sum X)	7503.97
3 Sum of Squared Measurements	750799.19
4 Correction Factor (CF): Sum of Measurements Squared / N	750794.21
5 Corrected Sum of Squares (SS)	4.98
6 Variance (V) : SS/(N-1)	0.0674
7 Estimate of Lot Standard Deviation(S): SQRT of V	0.2595
8 Sample Mean (XBAR) : Sum X/N	100.05
9 Upper Specification Limit (U)	102.00
10 Lower Specification Limit (L)	98.00
11 Quality Index Upper (QU) : (U-XBAR) / S	7.50
12 Quality Index Lower (QL) : (XBAR-L) / S	7.91
13 Estimate of Lot Percent NCF Above U (PU)	0.00
14 Estimate of Lot Percent NCF Below L (PL)	0.00
15 Total Estimate Percent NCF. In Lot (P) : PU+PL	0.00
16 Maximum Allowable Percent NCF(M)	4.83
17 Acceptability Criterion: Compare P with M	PASS
18 The Lot Meets the Acceptability Criterion if P <= M	
19 The Lot Fails the Acceptability Criterion if P > M	

Louisville Gas and Electric

2014 Sample Test Program (01/01/2014) to (12/31/2014)

Device Category: F2S240V30AC200 Model Number: J4S Division: 01 Sample Lot: 1324 Lot Descr: LG&E J4S-1
 In Service Population: 10,000 Sample Quantity: 75 Meters Tested: 75 Pass/ Fail: PASS

Test Results Per ANSI/ASQC Z1.9-1993

Double Specification Limit - Variability Unknown - Standard Deviation Method

One AQL Value for Both Upper and Lower Specification Limit Combined

AQL = 2.5% - Inspection Level II "E" # Normal Inspection

Page 24

Run Date: 01/07/2015

Run Time: 03:37:18 AM

Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy
388582	100.60	388629	100.30	388776	99.80	388953	101.00	393037	100.00
393090	100.30	393359	100.10	393736	99.93	397720	100.00	397820	100.60
397905	99.70	398237	100.30	398257	99.50	402884	100.50	403133	100.30
403148	99.60	407694	100.70	407980	100.10	408025	100.10	408569	100.50
411975	99.70	411982	100.60	412006	100.70	412168	100.00	412304	99.80
412717	100.00	412735	100.40	417182	100.90	417184	100.30	417226	100.80
417334	100.50	417458	100.20	417542	100.40	417824	100.10	418066	100.00
421958	100.60	422111	99.90	422423	99.90	422489	99.90	422587	100.20
427256	100.30	427526	99.90	427678	100.00	427987	99.60	432970	100.60
433126	100.20	433337	100.10	433540	99.60	433579	100.30	438566	99.30
439035	99.70	439053	99.80	439063	100.10	443186	100.20	443195	99.90
443226	100.10	447279	99.80	449797	99.80	453854	100.20	456690	99.40
456858	100.30	456965	100.00	457064	105.60	457094	99.60	460431	99.70
468226	99.00	470266	99.80	473735	99.90	473792	100.20	477816	100.20
478193	99.50	492726	99.50	492757	99.50	493039	99.80	495945	99.90

INFORMATION NEEDED

VALUE OBTAINED

1 Sample Size (N)	75
2 Sum of Measurements: (Sum X)	7510.23
3 Sum of Squared Measurements	752088.93
4 Correction Factor (CF): Sum of Measurements Squared / N	752047.40
5 Corrected Sum of Squares (SS)	41.54
6 Variance (V) : SS/(N-1)	0.5613
7 Estimate of Lot Standard Deviation(S): SQRT of V	0.7492
8 Sample Mean(XBAR) : Sum X/N	100.14
9 Upper Specification Limit (U)	102.00
10 Lower Specification Limit (L)	98.00
11 Quality Index Upper (QU): (U-XBAR) / S	2.49
12 Quality Index Lower (QL): (XBAR-L) / S	2.85
13 Estimate of Lot Percent NCF Above U (PU)	0.56
14 Estimate of Lot Percent NCF Below L (PL)	0.17
15 Total Estimate Percent NCF. In Lot (P): PU+PL	0.73
16 Maximum Allowable Percent NCF(M)	4.83
17 Acceptability Criterion: Compare P with M	PASS
18 The Lot Meets the Acceptability Criterion if P <= M	
19 The Lot Fails the Acceptability Criterion if P > M	

Louisville Gas and Electric

2014 Sample Test Program (01/01/2014) to (12/31/2014)

Device Category: F2S240V30AC320

Model Number: J4ES

Division: 01

Sample Lot: 1325

Lot Descr: LGGE J4S-2

In Service Population: 1,274

Sample Quantity: 50

Meters Tested: 50

Pass/ Fail: PASS

Test Results Per ANSI/ASQC Z1.9-1993

Double Specification Limit - Variability Unknown - Standard Deviation Method

One AQL Value for Both Upper and Lower Specification Limit Combined

AQL = 2.5% - Inspection Level II "E" # Normal Inspection

Page 25

Run Date: 01/07/2015

Run Time: 03:37:18 AM

Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy
496186	99.90	496295	99.00	496300	100.80	496311	99.80	496363	100.10
496375	99.30	499658	100.20	499660	100.00	499694	99.60	499751	99.70
499782	100.10	499785	100.20	499825	99.90	499829	99.90	499840	99.60
499871	99.90	499885	100.00	499892	99.90	502070	99.70	502076	99.60
734134	100.00	734195	100.20	734229	99.20	734239	99.60	734242	99.80
734244	100.50	734249	100.50	734287	99.70	734311	100.20	739978	100.70
739980	100.30	740002	100.10	740011	99.90	740037	100.50	740041	99.90
740055	100.30	740073	100.00	740075	99.90	740139	100.20	740150	100.60
740199	101.00	740259	100.30	740322	100.10	740336	99.90	740437	100.50
740448	100.10	740449	100.90	740450	99.90	740454	100.30	756267	99.70

INFORMATION NEEDED

VALUE OBTAINED

1 Sample Size (N)	50
2 Sum of Measurements: (Sum X)	5002.00
3 Sum of Squared Measurements	500408.22
4 Correction Factor (CF): Sum of Measurements Squared / N	500400.08
5 Corrected Sum of Squares (SS)	8.14
6 Variance (V) : SS/(N-1)	0.1661
7 Estimate of Lot Standard Deviation(S): SQRT of V	0.4076
8 Sample Mean(XBAR): Sum X/N	100.04
9 Upper Specification Limit (U)	102.00
10 Lower Specification Limit (L)	98.00
11 Quality Index Upper (QU): (U-XBAR) / S	4.81
12 Quality Index Lower (QL): (XBAR-L) / S	5.01
13 Estimate of Lot Percent NCF Above U (PU)	0.00
14 Estimate of Lot Percent NCF Below L (PL)	0.00
15 Total Estimate Percent NCF. In Lot (P): PU+PL	0.00
16 Maximum Allowable Percent NCF(M)	5.21
17 Acceptability Criterion: Compare P with M	PASS
18 The Lot Meets the Acceptability Criterion if P <= M	
19 The Lot Fails the Acceptability Criterion if P > M	

Louisville Gas and Electric

2014 Sample Test Program (01/01/2014) to (12/31/2014)

Device Category: F2S240V30AC200 Model Number: J5S Division: 01 Sample Lot: 1326 Lot Descr: LG&E J5S-1
 In Service Population: 10,000 Sample Quantity: 75 Meters Tested: 75 Pass/ Fail: PASS

Test Results Per ANSI/ASQC Z1.9-1993

Double Specification Limit - Variability Unknown - Standard Deviation Method

One AQL Value for Both Upper and Lower Specification Limit Combined

AQL = 2.5% - Inspection Level II "E" # Normal Inspection

Page 26

Run Date: 01/07/2015

Run Time: 03:37:18 AM

Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy
512258	99.90	512320	99.60	512421	99.80	512447	99.80	512450	99.30
512498	99.80	513108	100.10	513865	100.20	514263	99.90	514295	100.00
514313	100.60	514332	100.30	514561	100.60	514659	100.30	516918	99.80
516964	99.70	517140	99.80	517484	100.00	517513	100.20	517887	99.60
518031	99.40	518090	99.80	518318	100.30	518570	100.20	521100	100.00
521200	100.10	521233	100.10	521477	100.40	521782	100.20	526047	99.80
526090	100.00	526125	100.10	526463	99.60	527174	99.60	527179	100.00
527580	99.90	527976	99.70	527981	100.40	528164	100.00	528231	99.70
528323	99.80	528498	99.70	528690	99.80	528848	99.50	529928	99.70
529942	99.60	530152	99.80	530201	99.70	530606	99.50	530891	99.70
530904	100.30	530922	100.00	531041	100.10	531356	99.80	531824	99.70
531829	99.20	533976	99.00	534256	99.70	534305	100.50	534498	100.30
534645	99.70	534796	100.00	535214	100.20	535256	99.80	535418	99.90
535481	99.40	535630	100.10	535653	99.40	539830	99.90	539856	100.40
540109	99.60	543578	100.00	543769	99.70	543809	100.00	543850	100.70

INFORMATION NEEDED

VALUE OBTAINED

1 Sample Size (N)	75
2 Sum of Measurements: (Sum X)	7492.80
3 Sum of Squared Measurements	748568.84
4 Correction Factor (CF): Sum of Measurements Squared / N	748560.69
5 Corrected Sum of Squares (SS)	8.15
6 Variance (V) : SS/(N-1)	0.1101
7 Estimate of Lot Standard Deviation(S): SQRT of V	0.3318
8 Sample Mean(XBAR): Sum X/N	99.90
9 Upper Specification Limit (U)	102.00
10 Lower Specification Limit (L)	98.00
11 Quality Index Upper (QU): (U-XBAR) / S	6.32
12 Quality Index Lower (QL): (XBAR-L) / S	5.74
13 Estimate of Lot Percent NCF Above U (PU)	0.00
14 Estimate of Lot Percent NCF Below L (PL)	0.00
15 Total Estimate Percent NCF. In Lot (P): PU+PL	0.00
16 Maximum Allowable Percent NCF(M)	4.83
17 Acceptability Criterion: Compare P with M	PASS
18 The Lot Meets the Acceptability Criterion if P <= M	
19 The Lot Fails the Acceptability Criterion if P > M	

Louisville Gas and Electric

2014 Sample Test Program (01/01/2014) to (12/31/2014)

Device Category: F2S240V30AC200

Model Number: J5S

Division: 01

Sample Lot: 1327

Lot Descr: LG&E J5S-2

In Service Population: 10,000

Sample Quantity: 75

Meters Tested: 75

Pass/ Fail: PASS

Test Results Per ANSI/ASQC Z1.9-1993

Double Specification Limit - Variability Unknown - Standard Deviation Method

One AQL Value for Both Upper and Lower Specification Limit Combined

AQL = 2.5% - Inspection Level II "E" # Normal Inspection

Page 27

Run Date: 01/07/2015

Run Time: 03:37:18 AM

Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy
544151	100.30	544170	100.00	544496	100.20	544612	99.90	544863	99.80
548678	100.10	548754	100.30	548804	100.20	548958	100.20	548971	99.90
549063	100.30	549172	100.00	549265	100.00	549451	99.80	549468	100.10
549559	100.10	549760	99.90	549783	100.10	549962	100.10	550051	100.20
550096	100.10	550265	99.70	550340	100.40	550508	100.30	550840	100.30
550903	100.00	550981	100.00	551015	100.10	551304	99.90	551342	100.10
551397	99.80	555818	100.00	555946	99.70	556162	99.40	556243	99.50
556260	100.00	556539	99.80	556731	99.40	556787	99.70	556826	99.80
556859	99.90	557085	99.80	557087	100.00	557348	99.80	557382	99.80
557765	99.70	558340	99.40	565787	99.70	566113	99.80	566245	100.30
566709	99.10	566863	100.20	567518	99.70	567899	100.00	568026	99.90
574085	100.10	579134	99.90	579308	100.10	579340	100.10	579343	100.20
579729	99.80	579845	100.10	579924	100.30	580374	99.70	580435	100.60
580479	100.00	580481	100.00	580573	100.10	581011	100.30	581033	99.80
581051	100.20	581123	100.00	581188	100.40	581264	99.40	581612	100.40

INFORMATION NEEDED

VALUE OBTAINED

1 Sample Size (N)	75
2 Sum of Measurements: (Sum X)	7498.10
3 Sum of Squared Measurements	749625.61
4 Correction Factor (CF): Sum of Measurements Squared / N	749620.05
5 Corrected Sum of Squares (SS)	5.56
6 Variance (V) : SS/(N-1)	0.0752
7 Estimate of Lot Standard Deviation(S): SQRT of V	0.2742
8 Sample Mean(XBAR): Sum X/N	99.97
9 Upper Specification Limit (U)	102.00
10 Lower Specification Limit (L)	98.00
11 Quality Index Upper (QU): (U-XBAR) / S	7.39
12 Quality Index Lower (QL): (XBAR-L) / S	7.20
13 Estimate of Lot Percent NCF Above U (FU)	0.00
14 Estimate of Lot Percent NCF Below L (PL)	0.00
15 Total Estimate Percent NCF In Lot (P): FU+PL	0.00
16 Maximum Allowable Percent NCF (M)	4.83
17 Acceptability Criterion: Compare P with M	PASS
18 The Lot Meets the Acceptability Criterion if P <= M	
19 The Lot Fails the Acceptability Criterion if P > M	

Louisville Gas and Electric

2014 Sample Test Program (01/01/2014) to (12/31/2014)

Device Category: F2S240V30AC200 Model Number: J5S Division: 01 Sample Lot: 1328 Lot Descr: LGGE J5S-3
 In Service Population: 10,000 Sample Quantity: 75 Meters Tested: 75 Pass/ Fail: PASS

Test Results Per ANSI/ASQC Z1.9-1993
 Double Specification Limit - Variability Unknown - Standard Deviation Method
 One AQL Value for Both Upper and Lower Specification Limit Combined
 AQL = 2.5% - Inspection Level II "E" # Normal Inspection

Page 28
 Run Date: 01/07/2015
 Run Time: 03:37:18 AM

Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy
584155	99.20	584270	99.80	584289	99.60	584622	100.60	584756	99.70
584761	100.10	584848	100.20	584926	99.60	585133	99.80	585299	99.70
585336	100.00	585451	100.20	585805	100.10	586118	99.90	586138	100.20
586405	99.70	586407	99.82	586626	99.70	586668	99.80	586725	99.70
588653	100.20	588743	100.00	588781	100.20	588888	100.10	589130	99.90
589531	100.00	589576	99.70	589631	100.10	589663	100.00	589896	100.00
589905	100.10	589930	100.00	590262	99.90	590289	100.10	590327	99.60
590394	100.30	590558	100.60	590609	100.30	590801	100.40	591037	100.20
591042	100.30	599447	100.00	599497	100.50	599632	100.10	599828	100.10
599966	100.10	600240	100.00	600647	100.40	600725	100.30	601162	99.40
601201	99.70	601518	99.90	602199	99.60	602203	100.10	602308	100.20
602660	100.10	607690	100.30	607750	100.60	607826	100.10	607837	100.10
607858	100.00	607995	100.30	608146	100.30	608224	100.30	608240	100.20
608270	100.10	608742	99.90	608775	100.20	609574	100.10	609647	101.90
609648	100.00	609841	99.70	610190	100.30	610311	100.20	633832	100.40

INFORMATION NEEDED

VALUE OBTAINED

1 Sample Size (N)	75
2 Sum of Measurements: (Sum X)	7504.92
3 Sum of Squared Measurements	750993.34
4 Correction Factor (CF): Sum of Measurements Squared / N	750984.32
5 Corrected Sum of Squares (SS)	9.02
6 Variance (V) : SS/(N-1)	0.1219
7 Estimate of Lot Standard Deviation(S): SQRT of V	0.3491
8 Sample Mean(XBAR) : Sum X/N	100.07
9 Upper Specification Limit (U)	102.00
10 Lower Specification Limit (L)	98.00
11 Quality Index Upper (QU): (U-XBAR) / S	5.54
12 Quality Index Lower (QL): (XBAR-L) / S	5.92
13 Estimate of Lot Percent NCF Above U (PU)	0.00
14 Estimate of Lot Percent NCF Below L (PL)	0.00
15 Total Estimate Percent NCF. In Lot (P): PU+PL	0.00
16 Maximum Allowable Percent NCF(M)	4.83
17 Acceptability Criterion: Compare P with M	PASS
18 The Lot Meets the Acceptability Criterion if P <= M	
19 The Lot Fails the Acceptability Criterion if P > M	

Louisville Gas and Electric

2014 Sample Test Program (01/01/2014) to (12/31/2014)

Device Category: F2S240V30AC200

Model Number: J5S

Division: 01

Sample Lot: 1329

Lot Descr: LG&E J5S-4

In Service Population: 10,000

Sample Quantity: 75

Meters Tested: 75

Pass/ Fail: PASS

Test Results Per ANSI/ASQC Z1.9-1993

Double Specification Limit - Variability Unknown - Standard Deviation Method

One AQL Value for Both Upper and Lower Specification Limit Combined

AQL = 2.5% - Inspection Level II "E" # Normal Inspection

Page 29

Run Date: 01/07/2015

Run Time: 03:37:18 AM

Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy
578953	99.80	634037	100.00	634219	99.80	634282	100.40	634483	99.80
634825	99.70	635021	100.10	635321	100.20	635593	99.90	635904	100.00
635916	100.00	636211	99.60	636341	100.00	636486	100.10	636642	99.60
657559	99.80	657652	100.50	657654	100.00	661935	99.80	662004	99.60
662158	99.70	662291	99.80	662297	99.60	662605	99.60	662658	99.80
662670	99.70	662855	99.70	662860	99.30	662988	99.90	662993	99.60
662999	100.00	663400	98.80	663783	99.90	663811	99.20	664025	99.80
664548	99.40	664771	99.90	664896	100.10	665065	100.00	665365	99.60
665483	99.70	665855	99.40	665969	100.60	665990	99.70	666002	99.70
666075	99.70	666119	99.90	666147	99.80	666263	99.60	666325	99.60
666474	99.80	666865	99.70	667183	100.10	667250	100.20	667366	99.80
667450	99.40	667599	99.70	667601	99.70	667625	99.90	667635	100.10
667918	99.70	667920	99.90	668090	99.80	668097	99.90	668186	99.70
668216	99.70	668722	99.70	668962	99.60	669020	99.90	669178	100.00
669182	99.70	669419	99.90	669504	99.80	669557	99.70	669568	99.70

INFORMATION NEEDED

VALUE OBTAINED

1 Sample Size (N)	75
2 Sum of Measurements: (Sum X)	7484.90
3 Sum of Squared Measurements	746988.39
4 Correction Factor (CF): Sum of Measurements Squared / N	746983.04
5 Corrected Sum of Squares (SS)	5.35
6 Variance (V) : SS/(N-1)	0.0723
7 Estimate of Lot Standard Deviation(S): SQRT of V	0.2689
8 Sample Mean(XBAR): Sum X/N	99.80
9 Upper Specification Limit (U)	102.00
10 Lower Specification Limit (L)	98.00
11 Quality Index Upper (QU): (U-XBAR) / S	8.19
12 Quality Index Lower (QL): (XBAR-L) / S	6.69
13 Estimate of Lot Percent NCF Above U (PU)	0.00
14 Estimate of Lot Percent NCF Below L (PL)	0.00
15 Total Estimate Percent NCF. In Lot (P): PU+PL	0.00
16 Maximum Allowable Percent NCF(M)	4.83
17 Acceptability Criterion: Compare P with M	PASS
18 The Lot Meets the Acceptability Criterion if P <= M	
19 The Lot Fails the Acceptability Criterion if P > M	

Louisville Gas and Electric

2014 Sample Test Program (01/01/2014) to (12/31/2014)

Device Category: F2S240V30AC200 Model Number: J5S (R200) Division: 01 Sample Lot: 1330 Lot Descr: LG&E J5S-5
 In Service Population: 10,000 Sample Quantity: 75 Meters Tested: 75 Pass/ Fail: PASS

Test Results Per ANSI/ASQC E1.9-1993

Double Specification Limit - Variability Unknown - Standard Deviation Method

One AQL Value for Both Upper and Lower Specification Limit Combined

AQL = 2.5% - Inspection Level II "E" # Normal Inspection

Page 30

Run Date: 01/07/2015

Run Time: 03:37:18 AM

Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy
669990	99.90	670049	99.90	670162	99.60	670319	99.60	670370	99.70
670391	99.80	670535	99.80	670540	99.60	670583	99.70	683344	100.20
683503	99.80	683505	99.60	683591	99.60	683650	99.40	683812	99.90
683844	99.60	684098	99.30	684297	99.60	684688	99.80	684735	99.20
684749	99.20	684837	99.50	684962	99.10	684987	100.10	685012	99.60
685142	99.40	685157	100.40	685171	100.00	685295	100.40	685567	99.40
685703	100.00	685737	100.10	685936	100.44	685959	100.20	685971	99.77
686019	99.98	686114	99.90	686257	100.00	686568	100.00	686584	99.80
686719	100.40	687031	100.60	687042	99.90	687197	100.00	687278	99.30
687345	99.90	687394	99.90	687493	100.21	687602	99.40	687812	99.70
688065	99.90	688164	99.80	688577	99.90	688777	99.80	688821	100.10
688924	99.80	692252	100.20	692656	100.30	692982	100.20	693249	100.30
693342	100.10	693465	100.00	694390	99.90	694629	99.80	695395	100.00
695455	100.30	695602	99.80	695769	99.80	696701	100.10	696841	99.80
696984	100.10	697093	99.10	697415	99.90	697477	99.80	697805	99.80

INFORMATION NEEDED

VALUE OBTAINED

1 Sample Size (N)	75
2 Sum of Measurements: (Sum X)	7488.80
3 Sum of Squared Measurements	747769.41
4 Correction Factor (CF): Sum of Measurements Squared / N	747761.67
5 Corrected Sum of Squares (SS)	7.74
6 Variance (V) : SS/(N-1)	0.1046
7 Estimate of Lot Standard Deviation(S): SQRT of V	0.3234
8 Sample Mean(XBAR) : Sum X/N	99.85
9 Upper Specification Limit (U)	102.00
10 Lower Specification Limit (L)	98.00
11 Quality Index Upper (QU): (U-XBAR) / S	6.65
12 Quality Index Lower (QL): (XBAR-L) / S	5.72
13 Estimate of Lot Percent NCF Above U (PU)	0.00
14 Estimate of Lot Percent NCF Below L (PL)	0.00
15 Total Estimate Percent NCF. In Lot (P): PU+PL	0.00
16 Maximum Allowable Percent NCF(M)	4.83
17 Acceptability Criterion: Compare P with M	PASS
18 The Lot Meets the Acceptability Criterion if P <= M	
19 The Lot Fails the Acceptability Criterion if P > M	

Louisville Gas and Electric

2014 Sample Test Program (01/01/2014) to (12/31/2014)

Device Category: F2S240V30AC200
In Service Population: 10,000

Model Number: J55
Sample Quantity: 75

Division: 01
Meters Tested: 75

Sample Lot: 1331
Pass/ Fail: PASS

Lot Descr: LG&E J55-6

Test Results Per ANSI/ASQC Z1.9-1993

Double Specification Limit - Variability Unknown - Standard Deviation Method
One AQL Value for Both Upper and Lower Specification Limit Combined
AQL = 2.5% - Inspection Level II "E" # Normal Inspection

Page 31

Run Date: 01/07/2015

Run Time: 03:37:18 AM

Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy
698149	100.20	698996	99.70	699233	99.80	699270	99.60	699765	99.90
699886	99.90	700202	100.10	700287	100.00	700682	99.60	705531	99.70
705555	99.80	705867	99.60	706545	100.10	706636	100.10	706656	99.80
706772	99.40	706794	99.70	706947	100.10	707036	100.30	707070	99.90
707395	99.80	707446	100.10	707494	99.80	707500	99.50	707707	99.80
707916	99.40	708133	100.10	724220	98.90	724461	99.90	724475	99.50
724558	99.80	724575	99.90	724871	99.30	724944	99.80	726227	99.80
726338	99.80	726382	99.70	726460	100.20	726576	99.70	726839	99.70
726853	99.30	726867	99.30	726872	99.80	727021	99.80	727030	100.60
727033	100.60	727061	99.70	727070	99.60	727221	99.70	727288	99.50
727333	99.60	727374	100.30	728018	99.60	728133	100.20	728241	100.30
728249	99.70	728478	100.00	728510	100.10	728990	100.10	729270	100.10
729336	100.00	729357	100.30	729500	99.90	729545	100.00	729909	100.20
730028	100.00	730094	99.80	730178	100.00	730416	100.10	730470	100.30
730619	100.00	730660	100.00	730906	99.90	730952	100.00	731058	100.10

INFORMATION NEEDED

VALUE OBTAINED

1 Sample Size (N)	75
2 Sum of Measurements: (Sum X)	7490.30
3 Sum of Squared Measurements	748067.95
4 Correction Factor (CF): Sum of Measurements Squared / N	748061.25
5 Corrected Sum of Squares (SS)	6.70
6 Variance (V) : SS/(N-1)	0.0905
7 Estimate of Lot Standard Deviation(S): SQRT of V	0.3008
8 Sample Mean(XBAR): Sum X/N	99.87
9 Upper Specification Limit (U)	102.00
10 Lower Specification Limit (L)	98.00
11 Quality Index Upper (QU): (U-XBAR) / S	7.08
12 Quality Index Lower (QL): (XBAR-L) / S	6.22
13 Estimate of Lot Percent NCF Above U (PU)	0.00
14 Estimate of Lot Percent NCF Below L (PL)	0.00
15 Total Estimate Percent NCF. In Lot (P): PU+PL	0.00
16 Maximum Allowable Percent NCF(M)	4.83
17 Acceptability Criterion: Compare P with M	PASS
18 The Lot Meets the Acceptability Criterion if P <= M	
19 The Lot Fails the Acceptability Criterion if P > M	

Louisville Gas and Electric

2014 Sample Test Program (01/01/2014) to (12/31/2014)

Device Category: F2S240V30AC200 Model Number: J55 Division: 01 Sample Lot: 1332 Lot Descr: LG&E J55-7
 In Service Population: 10,000 Sample Quantity: 75 Meters Tested: 75 Pass/ Fail: PASS

Test Results Per ANSI/ASQC Z1.9-1993

Double Specification Limit - Variability Unknown - Standard Deviation Method
 One AQL Value for Both Upper and Lower Specification Limit Combined
 AQL = 2.5% - Inspection Level II "E" # Normal Inspection

Page 32
 Run Date: 01/07/2015
 Run Time: 03:37:18 AM

Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy
731663	100.30	731713	99.90	731782	99.50	732119	99.40	732298	99.80
732578	99.90	732860	100.00	733055	99.70	733103	99.60	733189	99.90
733357	99.70	733478	100.00	733711	99.90	733809	99.70	733879	99.30
733887	99.10	733894	100.20	733971	100.30	734587	99.90	734826	100.30
735071	99.80	735183	99.90	735227	100.40	735348	99.80	735522	99.80
735651	99.80	736005	100.00	736022	99.90	736363	100.40	736411	100.60
736441	100.40	736904	100.50	736918	100.50	736996	100.00	737522	99.70
738037	100.30	738139	99.90	738221	99.80	738229	100.00	738253	100.30
738260	100.00	738376	99.00	738532	100.00	738687	99.70	739052	99.80
739329	100.20	739330	100.00	739337	99.80	739446	99.90	739963	99.70
740645	99.80	740693	100.20	740812	99.90	740835	99.90	740885	100.10
741168	99.50	741235	100.30	741299	99.30	741305	100.20	741450	99.80
741489	99.60	741663	100.20	741711	100.10	741765	100.10	741924	99.80
741945	100.10	742250	99.20	742264	99.30	743291	99.40	743374	99.90
743497	99.90	743893	99.70	744365	100.20	744463	99.10	744553	99.50

INFORMATION NEEDED

VALUE OBTAINED

1 Sample Size (N)	75
2 Sum of Measurements: (Sum X)	7491.40
3 Sum of Squared Measurements	748289.88
4 Correction Factor (CF): Sum of Measurements Squared / N	748280.99
5 Corrected Sum of Squares (SS)	8.89
6 Variance (V) : SS/(N-1)	0.1202
7 Estimate of Lot Standard Deviation(S): SQRT of V	0.3467
8 Sample Mean(XBAR) : Sum X/N	99.89
9 Upper Specification Limit (U)	102.00
10 Lower Specification Limit (L)	98.00
11 Quality Index Upper (QU): (U-XBAR) / s	6.10
12 Quality Index Lower (QL): (XBAR-L) / s	5.44
13 Estimate of Lot Percent NCF Above U (PU)	0.00
14 Estimate of Lot Percent NCF Below L (PL)	0.00
15 Total Estimate Percent NCF. In Lot (P): PU+PL	0.00
16 Maximum Allowable Percent NCF(M)	4.83
17 Acceptability Criterion: Compare P with M	PASS
18 The Lot Meets the Acceptability Criterion if P <= M	
19 The Lot Fails the Acceptability Criterion if P > M	

Louisville Gas and Electric

2014 Sample Test Program (01/01/2014) to (12/31/2014)

Device Category: F2S240V30AC200 Model Number: J5S Division: 01 Sample Lot: 1333 Lot Descr: LG&E J5S-8
 In Service Population: 10,000 Sample Quantity: 75 Meters Tested: 75 Pass/ Fail: PASS

Test Results Per ANSI/ASQC Z1.9-1993

Double Specification Limit - Variability Unknown - Standard Deviation Method
 One AQL Value for Both Upper and Lower Specification Limit Combined
 AQL = 2.5% - Inspection Level II "E" # Normal Inspection

Page 33
 Run Date: 01/07/2015
 Run Time: 03:37:18 AM

Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy
744836	99.60	744924	99.00	745217	99.40	745246	99.90	745618	99.30
745624	99.40	745914	99.70	745978	99.60	746041	99.70	746061	99.70
746105	99.10	746313	99.40	746344	99.70	746575	99.90	746847	99.40
746934	99.20	746962	100.20	747450	99.30	747477	99.80	747620	99.50
747638	99.40	747786	98.50	747814	99.90	747827	99.20	748049	99.20
748228	98.60	748351	98.90	748531	99.60	748564	99.30	748614	99.50
748616	99.60	748846	99.50	749473	99.30	749633	99.10	749676	99.00
749734	100.20	749750	99.40	749806	100.10	749832	101.50	750054	98.80
750256	99.40	750548	98.90	750681	99.30	751310	99.60	751629	100.00
751662	100.00	751794	99.40	751943	99.60	752129	99.80	752158	98.80
752452	99.10	752556	99.30	752598	99.20	752793	99.30	752875	99.50
752942	99.60	753089	100.00	753166	100.10	753171	100.00	757492	99.70
757545	99.80	757877	99.30	757961	100.10	758075	99.90	758239	99.70
758394	99.60	758453	99.90	758576	100.00	758639	100.10	758855	99.40
758948	99.80	759177	99.70	759197	99.80	759280	99.90	759316	100.30

INFORMATION NEEDED

VALUE OBTAINED

1 Sample Size (N)	75
2 Sum of Measurements: (Sum X)	7467.30
3 Sum of Squared Measurements	743489.29
4 Correction Factor (CF): Sum of Measurements Squared / N	743474.26
5 Corrected Sum of Squares (SS)	15.03
6 Variance (V) : SS/(N-1)	0.2031
7 Estimate of Lot Standard Deviation(S): SQRT of V	0.4507
8 Sample Mean(XBAR): Sum X/N	99.56
9 Upper Specification Limit (U)	102.00
10 Lower Specification Limit (L)	98.00
11 Quality Index Upper (QU): (U-XBAR) / S	5.40
12 Quality Index Lower (QL): (XBAR-L) / S	3.47
13 Estimate of Lot Percent NCF Above U (PU)	0.00
14 Estimate of Lot Percent NCF Below L (PL)	0.02
15 Total Estimate Percent NCF. In Lot (P): PU+PL	0.02
16 Maximum Allowable Percent NCF (M)	4.83
17 Acceptability Criterion: Compare P with M	PASS
18 The Lot Meets the Acceptability Criterion if P <= M	
19 The Lot Fails the Acceptability Criterion if P > M	

Louisville Gas and Electric

2014 Sample Test Program (01/01/2014) to (12/31/2014)

Device Category: F2S240V30AC200 Model Number: J5S Division: 01 Sample Lot: 1334 Lot Desor: LG&E J5S-9
 In Service Population: 10,000 Sample Quantity: 75 Meters Tested: 75 Pass/ Fail: PASS

Test Results Per ANSI/ASQC Z1.9-1993

Double Specification Limit - Variability Unknown - Standard Deviation Method

One AQL Value for Both Upper and Lower Specification Limit Combined

AQL = 2.5% - Inspection Level II "E" # Normal Inspection

Page 34

Run Date: 01/07/2015

Run Time: 03:37:18 AM

Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy
759472	99.90	759551	100.00	759852	99.40	759907	99.90	760123	99.80
760158	100.40	760276	100.30	760345	100.10	760574	99.50	760621	99.70
760819	99.60	760849	99.70	760972	99.60	761216	100.00	761243	99.90
761366	99.40	761459	99.40	761618	99.80	761646	99.60	761743	100.40
761811	99.60	762349	99.40	762495	99.20	762583	99.80	762613	99.90
762687	100.00	762760	99.90	762930	99.40	762957	99.90	762966	99.70
763178	99.30	763226	99.80	763506	99.50	763520	99.40	763727	99.70
763819	99.90	763880	99.60	764195	99.40	764425	99.70	764509	99.50
764742	99.40	764815	99.50	765014	99.90	767884	100.00	768030	99.80
768529	99.60	768584	100.10	768794	100.20	768811	100.00	768882	99.70
768929	99.80	769384	99.10	769420	99.70	769474	99.60	769832	99.80
769877	100.00	769900	100.00	770039	100.00	770056	99.80	770371	99.60
770476	99.90	770879	99.70	771002	100.30	771051	99.40	771213	99.90
771547	99.70	771685	99.90	771697	100.10	771703	99.90	771948	99.80
772015	99.90	772025	99.80	772157	100.00	772281	99.90	772328	100.00

INFORMATION NEEDED

VALUE OBTAINED

1 Sample Size (N)	75
2 Sum of Measurements: (Sum X)	7482.80
3 Sum of Squared Measurements	746569.38
4 Correction Factor (CF): Sum of Measurements Squared / N	746563.94
5 Corrected Sum of Squares (SS)	5.44
6 Variance (V) : SS/(N-1)	0.0735
7 Estimate of Lot Standard Deviation(S): SQRT of V	0.2710
8 Sample Mean(XBAR) : Sum X/N	99.77
9 Upper Specification Limit (U)	102.00
10 Lower Specification Limit (L)	98.00
11 Quality Index Upper (QU): (U-XBAR) / S	8.23
12 Quality Index Lower (QL): (XBAR-L) / S	6.53
13 Estimate of Lot Percent NCF Above U (PU)	0.00
14 Estimate of Lot Percent NCF Below L (PL)	0.00
15 Total Estimate Percent NCF. In Lot (P): PU+PL	0.00
16 Maximum Allowable Percent NCF(M)	4.83
17 Acceptability Criterion: Compare P with M	PASS
18 The Lot Meets the Acceptability Criterion if P <= M	
19 The Lot Fails the Acceptability Criterion if P > M	

Louisville Gas and Electric

2014 Sample Test Program (01/01/2014) to (12/31/2014)

Device Category: F2S240V30AC200 Model Number: J5S Division: 01 Sample Lot: 1335 Lot Descr: LG&E J5S-10
 In Service Population: 10,000 Sample Quantity: 75 Meters Tested: 75 Pass/ Fail: PASS

Test Results Per ANSI/ASQC Z1.9-1993

Double Specification Limit - Variability Unknown - Standard Deviation Method
 One AQL Value for Both Upper and Lower Specification Limit Combined
 AQL = 2.5% - Inspection Level II "E" # Normal Inspection

Page 35
 Run Date: 01/07/2015
 Run Time: 03:37:18 AM

Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy
772406	99.90	772491	100.20	772520	100.20	772881	99.90	773402	99.60
773502	99.70	773646	99.80	773845	99.90	773951	99.50	774027	100.00
774075	99.60	774264	100.30	774323	100.30	774331	100.00	774670	100.20
774726	101.00	774806	99.90	774960	100.10	775055	100.00	775063	99.80
775425	100.00	775564	99.90	775573	100.40	779962	99.70	780023	99.80
780207	100.00	780222	99.70	780280	99.80	780863	100.00	780984	99.20
781241	99.20	781737	99.70	781820	99.80	781948	99.70	782064	100.00
782154	100.20	782589	99.70	782728	100.80	782965	99.60	783237	99.60
783569	99.60	783617	99.80	783796	100.00	783839	99.90	783888	99.70
783890	100.10	784043	99.70	784262	100.20	784806	99.70	784900	100.00
785083	100.10	785100	99.90	785127	99.60	785136	99.60	785345	100.00
785731	100.30	785741	100.20	785793	100.20	785802	99.70	785836	100.20
785971	99.40	786055	100.40	786127	99.70	786285	100.10	786342	100.10
786358	100.10	786422	100.30	792597	99.40	792670	100.40	792794	99.50
792876	100.50	792895	99.80	793098	100.00	793181	100.10	793267	100.20

INFORMATION NEEDED

VALUE OBTAINED

1 Sample Size (N)	75
2 Sum of Measurements: (Sum X)	7495.20
3 Sum of Squared Measurements	749048.12
4 Correction Factor (CF): Sum of Measurements Squared / N	749040.31
5 Corrected Sum of Squares (SS)	7.81
6 Variance (V) : SS/(N-1)	0.1056
7 Estimate of Lot Standard Deviation(S): SQRT of V	0.3249
8 Sample Mean(XBAR): Sum X/N	99.94
9 Upper Specification Limit (U)	102.00
10 Lower Specification Limit (L)	98.00
11 Quality Index Upper (QU): (U-XBAR) / S	6.35
12 Quality Index Lower (QL): (XBAR-L) / S	5.96
13 Estimate of Lot Percent NCF Above U (PU)	0.00
14 Estimate of Lot Percent NCF Below L (PL)	0.00
15 Total Estimate Percent NCF. In Lot (P): PU+PL	0.00
16 Maximum Allowable Percent NCF (M)	4.83
17 Acceptability Criterion: Compare P with M	PASS
18 The Lot Meets the Acceptability Criterion if P <= M	
19 The Lot Fails the Acceptability Criterion if P > M	

Louisville Gas and Electric

2014 Sample Test Program (01/01/2014) to (12/31/2014)

Device Category: F2S240V30AC200
In Service Population: 10,000

Model Number: J5S
Sample Quantity: 75

Division: 01
Meters Tested: 75

Sample Lot: 1336
Pass/ Fail: PASS

Lot Descr: LGEE J5S-11

Test Results Per ANSI/ASQC Z1.9-1993

Double Specification Limit - Variability Unknown - Standard Deviation Method
One AQL Value for Both Upper and Lower Specification Limit Combined
AQL = 2.5% - Inspection Level II "E" # Normal Inspection

Page 36

Run Date: 01/07/2015

Run Time: 03:37:18 AM

Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy
786595	99.80	786643	100.20	786660	100.10	786900	100.00	786989	100.20
787397	99.80	787736	99.60	787957	99.60	787975	99.90	788208	99.50
788243	100.00	788267	99.90	788430	99.90	788457	99.70	788545	99.70
788549	100.00	788551	99.80	788614	100.00	788642	100.20	788752	99.70
788789	99.90	788943	99.90	789141	99.60	789151	100.00	789157	99.70
789204	99.90	789308	99.80	789504	100.20	789595	99.40	789679	99.30
790018	99.70	790063	100.00	790502	99.70	790567	99.90	790948	99.90
791087	99.90	791207	99.90	791272	100.20	791358	99.80	791566	99.80
800780	99.50	800825	99.80	800833	99.80	800953	99.80	801057	99.30
801657	99.10	801790	99.40	801897	99.30	802269	99.50	802315	99.30
802413	99.50	802415	100.10	802557	99.80	802582	99.70	802831	99.60
803117	100.00	803201	100.10	803214	99.80	803236	100.00	803673	99.60
803836	100.00	804029	100.20	804448	100.00	804580	99.30	804592	99.40
804763	99.10	804803	100.60	805106	99.60	805165	99.80	805505	99.00
805535	100.00	805795	99.70	805900	99.20	805964	99.60	806047	99.80

INFORMATION NEEDED

VALUE OBTAINED

1 Sample Size (N)	75
2 Sum of Measurements: (Sum X)	7482.40
3 Sum of Squared Measurements	746490.88
4 Correction Factor (CF): Sum of Measurements Squared / N	746484.13
5 Corrected Sum of Squares (SS)	6.75
6 Variance (V) : SS/(N-1)	0.0912
7 Estimate of Lot Standard Deviation(S): SQRT of V	0.3020
8 Sample Mean(XBAR): Sum X/N	99.77
9 Upper Specification Limit (U)	102.00
10 Lower Specification Limit (L)	98.00
11 Quality Index Upper (QU): (U-XBAR) / S	7.40
12 Quality Index Lower (QL): (XBAR-L) / S	5.85
13 Estimate of Lot Percent NCF Above U (PU)	0.00
14 Estimate of Lot Percent NCF Below L (PL)	0.00
15 Total Estimate Percent NCF. In Lot (P): PU+PL	0.00
16 Maximum Allowable Percent NCF(M)	4.83
17 Acceptability Criterion: Compare P with M	PASS
18 The Lot Meets the Acceptability Criterion if P <= M	
19 The Lot Fails the Acceptability Criterion if P > M	

Louisville Gas and Electric

2014 Sample Test Program (01/01/2014) to (12/31/2014)

Device Category: F2S240V30AC200
In Service Population: 6,332

Model Number: J5S
Sample Quantity: 75

Division: 01
Meters Tested: 75

Sample Lot: 1337
Pass/ Fail: PASS

Lot Descr: LG&E J5S-12

Test Results Per ANSI/ASQC Z1.9-1993

Double Specification Limit - Variability Unknown - Standard Deviation Method
One AQL Value for Both Upper and Lower Specification Limit Combined
AQL = 2.5% - Inspection Level II "E" # Normal Inspection

Page 37

Run Date: 01/07/2015

Run Time: 03:37:18 AM

Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy
806285	98.70	806371	99.40	806498	100.10	806560	99.30	806641	99.20
806643	100.30	806648	99.50	806674	98.50	806841	98.50	806845	98.30
806910	99.60	806920	98.50	806939	99.70	807033	99.80	807054	100.20
807312	99.90	807370	98.70	807402	99.80	807551	99.60	807647	99.20
807683	99.80	807691	99.90	807798	99.50	807892	99.40	807954	99.50
808076	99.30	808137	99.30	808260	99.60	808304	100.10	809941	98.70
809943	99.10	809944	99.10	809956	99.70	809973	99.20	810056	99.40
810145	99.60	810161	99.20	810235	99.18	810251	99.50	810321	99.48
810393	100.10	810422	99.30	810426	98.30	810444	99.40	810485	99.50
810613	98.40	810703	99.30	810707	99.40	810914	99.20	810952	99.30
810990	99.20	811325	99.70	811331	99.30	811598	99.60	812486	100.00
812487	99.30	812546	99.80	812750	99.80	812837	99.90	813154	99.40
813264	99.80	813273	99.40	813297	99.40	813357	99.70	813580	99.60
813584	100.40	813619	99.20	813683	99.70	813748	100.00	814076	99.70
814248	99.30	814357	99.60	814358	99.10	814364	99.10	814436	99.98

INFORMATION NEEDED

VALUE OBTAINED

1 Sample Size (N)	75
2 Sum of Measurements: (Sum X)	7457.30
3 Sum of Squared Measurements	741499.85
4 Correction Factor (CF): Sum of Measurements Squared / N	741484.31
5 Corrected Sum of Squares (SS)	15.54
6 Variance (V) : SS/(N-1)	0.2100
7 Estimate of Lot Standard Deviation(S): SQRT of V	0.4582
8 Sample Mean(XBAR): Sum X/N	99.43
9 Upper Specification Limit (U)	102.00
10 Lower Specification Limit (L)	98.00
11 Quality Index Upper (QU): (U-XBAR) / S	5.61
12 Quality Index Lower (QL): (XBAR-L) / S	3.12
13 Estimate of Lot Percent NCF Above U (PU)	0.00
14 Estimate of Lot Percent NCF Below L (PL)	0.06
15 Total Estimate Percent NCF. In Lot (P): PU+PL	0.06
16 Maximum Allowable Percent NCF (M)	4.83
17 Acceptability Criterion: Compare P with M	PASS
18 The Lot Meets the Acceptability Criterion if P <= M	
19 The Lot Fails the Acceptability Criterion if P > M	

Louisville Gas and Electric

2014 Sample Test Program (01/01/2014) to (12/31/2014)

Device Category: F2S240V30AC200 Model Number: MQS Division: 01 Sample Lot: 1338 Lot Descr: LG&E MQS-1
 In Service Population: 164 Sample Quantity: 15 Meters Tested: 15 Pass/ Fail: PASS

Test Results Per ANSI/ASQC Z1.9-1993

Double Specification Limit - Variability Unknown - Standard Deviation Method

Page 38

One AQL Value for Both Upper and Lower Specification Limit Combined

Run Date: 01/07/2015

AQL = 2.5% - Inspection Level II "E" # Normal Inspection

Run Time: 03:37:18 AM

Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy
328464	100.20	328475	100.20	333107	99.40	333178	99.90	333343	100.20
333369	100.40	337760	100.20	337904	99.90	342471	99.70	342476	100.40
347009	100.60	351713	100.00	374808	99.60	374819	100.00	375143	100.40

INFORMATION NEEDED

VALUE OBTAINED

1 Sample Size (N)	15
2 Sum of Measurements: (Sum X)	1501.30
3 Sum of Squared Measurements	150261.91
4 Correction Factor (CF): Sum of Measurements Squared / N	150260.11
5 Corrected Sum of Squares (SS)	1.80
6 Variance (V) : SS/(N-1)	0.1284
7 Estimate of Lot Standard Deviation(S): SQRT of V	0.3583
8 Sample Mean(XBAR): Sum X/N	100.09
9 Upper Specification Limit (U)	102.00
10 Lower Specification Limit (L)	98.00
11 Quality Index Upper (QU): (U-XBAR) / S	5.34
12 Quality Index Lower (QL): (XBAR-L) / S	5.82
13 Estimate of Lot Percent NCF Above U (PU)	0.00
14 Estimate of Lot Percent NCF Below L (PL)	0.00
15 Total Estimate Percent NCF. In Lot (P): PU+PL	0.00
16 Maximum Allowable Percent NCF (M)	6.55
17 Acceptability Criterion: Compare P with M	PASS
18 The Lot Meets the Acceptability Criterion if P <= M	
19 The Lot Fails the Acceptability Criterion if P > M	

Louisville Gas and Electric

2014 Sample Test Program (01/01/2014) to (12/31/2014)

Device Category: F2S240V30AC200

Model Number: MS

Division: 01

Sample Lot: 1339

Lot Descr: LG&E MS-1

In Service Population: 8,596

Sample Quantity: 75

Meters Tested: 75

Pass/ Fail: PASS

Test Results Per ANSI/ASQC Z1.9-1993

Double Specification Limit - Variability Unknown - Standard Deviation Method

One AQL Value for Both Upper and Lower Specification Limit Combined

AQL = 2.5% - Inspection Level II "E" # Normal Inspection

Page 39

Run Date: 01/07/2015

Run Time: 03:37:18 AM

Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy
378409	100.10	378660	99.90	378680	99.70	379934	99.80	380365	100.60
384691	100.50	389248	100.00	389750	99.60	394096	100.00	394260	100.10
394314	100.50	394362	100.00	398489	100.40	398564	100.20	398626	99.90
398745	100.50	398773	99.90	403424	100.50	403553	100.00	403911	100.70
408724	99.60	408923	100.20	408993	100.40	409070	100.50	413228	100.20
413668	100.30	413863	101.50	418459	100.20	418469	99.70	418490	100.10
422955	100.30	422956	100.70	423093	100.10	423177	100.30	423243	100.20
423598	100.80	423770	100.20	428075	100.40	428443	100.10	428594	100.10
428955	100.00	434640	100.20	434658	104.40	434708	100.80	434834	100.10
434998	100.20	435176	100.60	435336	100.60	435471	100.50	439768	100.30
440073	100.60	440076	100.60	440243	99.90	444142	100.10	444288	100.10
445942	100.10	446079	99.70	446197	99.60	446203	99.30	446283	99.30
447322	100.00	447326	99.60	447338	99.80	447386	99.50	447643	99.90
447676	99.90	447783	99.60	450261	99.60	450284	100.10	450370	100.20
450569	99.90	452332	98.90	452403	100.00	508341	100.00	659961	99.90

INFORMATION NEEDED

VALUE OBTAINED

1 Sample Size (N)	75
2 Sum of Measurements: (Sum X)	7512.70
3 Sum of Squared Measurements	752572.31
4 Correction Factor (CF): Sum of Measurements Squared / N	752542.15
5 Corrected Sum of Squares (SS)	30.16
6 Variance (V) : SS/(N-1)	0.4076
7 Estimate of Lot Standard Deviation(S): SQRT of V	0.6384
8 Sample Mean(XBAR) : Sum X/N	100.17
9 Upper Specification Limit (U)	102.00
10 Lower Specification Limit (L)	98.00
11 Quality Index Upper (QU) : (U-XBAR) / S	2.87
12 Quality Index Lower (QL) : (XBAR-L) / S	3.40
13 Estimate of Lot Percent NCF Above U (PU)	0.16
14 Estimate of Lot Percent NCF Below L (PL)	0.02
15 Total Estimate Percent NCF. In Lot (P) : PU+PL	0.18
16 Maximum Allowable Percent NCF (M)	4.83
17 Acceptability Criterion: Compare P with M	PASS
18 The Lot Meets the Acceptability Criterion if P <= M	
19 The Lot Fails the Acceptability Criterion if P > M	

Louisville Gas and Electric

2014 Sample Test Program (01/01/2014) to (12/31/2014)

Device Category: F2S240V30AC200
In Service Population: 10,000

Model Number: MSII
Sample Quantity: 75

Division: 01
Meters Tested: 75

Sample Lot: 1340
Pass/ Fail: PASS

Lot Descr: LG&E MSII-1

Test Results Per ANSI/ASQC Z1.9-1993

Double Specification Limit - Variability Unknown - Standard Deviation Method

One AQL Value for Both Upper and Lower Specification Limit Combined

AQL = 2.5% - Inspection Level II "E" # Normal Inspection

Page 40

Run Date: 01/07/2015

Run Time: 03:37:18 AM

Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy
454515	99.50	454563	99.60	460628	100.20	460665	100.20	460937	100.20
462981	100.30	466645	100.10	466658	100.50	466824	100.30	467037	100.00
469091	99.70	469103	100.50	469128	100.40	469301	100.10	473067	100.00
473086	100.60	473129	99.70	473181	100.00	473310	99.80	473406	100.30
473448	99.70	477337	100.00	477520	100.00	480464	100.20	480633	99.30
481943	99.70	481960	100.40	482016	99.70	482113	99.80	482160	100.10
482372	100.00	482397	100.00	485303	100.10	485425	100.40	488468	99.90
488671	100.20	494748	100.30	495102	100.10	497919	99.90	498297	99.70
502397	100.10	502440	99.80	502679	100.10	502920	99.80	502923	99.80
503003	100.00	503300	99.90	503483	99.80	503932	99.60	503971	100.10
507181	100.40	507333	100.00	507613	99.90	507730	100.10	507921	100.80
508007	99.90	508130	99.90	508156	99.90	519043	100.20	519142	99.80
519169	99.70	519213	100.30	519412	99.70	519693	99.50	519711	100.00
523144	100.20	523145	102.00	523180	99.90	523291	100.10	523488	100.50
523504	100.60	523505	100.00	523630	100.10	523881	100.40	523936	100.00

INFORMATION NEEDED

VALUE OBTAINED

1 Sample Size (N)	75
2 Sum of Measurements: (Sum X)	7504.40
3 Sum of Squared Measurements	750890.14
4 Correction Factor (CF): Sum of Measurements Squared / N	750880.26
5 Corrected Sum of Squares (SS)	9.88
6 Variance (V) : SS/(N-1)	0.1335
7 Estimate of Lot Standard Deviation(S): SQRT of V	0.3654
8 Sample Mean(XBAR) : Sum X/N	100.06
9 Upper Specification Limit (U)	102.00
10 Lower Specification Limit (L)	98.00
11 Quality Index Upper (QU): (U-XBAR) / s	5.31
12 Quality Index Lower (QL): (XBAR-L) / S	5.63
13 Estimate of Lot Percent NCF Above U (PU)	0.00
14 Estimate of Lot Percent NCF Below L (PL)	0.00
15 Total Estimate Percent NCF. In Lot (P): PU+PL	0.00
16 Maximum Allowable Percent NCF(M)	4.83
17 Acceptability Criterion: Compare P with M	PASS
18 The Lot Meets the Acceptability Criterion if P <= M	
19 The Lot Fails the Acceptability Criterion if P > M	

Louisville Gas and Electric

2014 Sample Test Program (01/01/2014) to (12/31/2014)

Device Category: F2S240V30AC200

Model Number: MSII

Division: 01

Sample Lot: 1341

Lot Descr: LG&E MSII-2

In Service Population: 10,000

Sample Quantity: 75

Meters Tested: 75

Pass/ Fail: PASS

Test Results Per ANSI/ASQC Z1.9-1993

Double Specification Limit - Variability Unknown - Standard Deviation Method

One AQL Value for Both Upper and Lower Specification Limit Combined

AQL = 2.5% - Inspection Level II "E" # Normal Inspection

Page 41

Run Date: 01/07/2015

Run Time: 03:37:18 AM

Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy
532097	100.17	532253	100.30	532270	100.00	532472	100.00	532755	100.20
532759	100.00	535993	99.90	536064	100.00	536067	99.90	536082	100.10
536173	100.00	536380	99.90	536385	99.70	536413	99.20	536479	99.20
536749	99.80	536751	99.90	536832	100.30	536993	99.60	537027	100.10
537103	100.20	537379	99.00	537402	99.70	537620	100.40	537699	99.80
542645	100.10	543003	99.90	543135	100.10	543164	100.00	545749	100.20
545922	100.20	546036	100.20	546341	100.00	546487	100.50	546513	100.00
547072	100.30	547209	100.30	547466	100.20	547482	99.80	548104	99.80
548156	99.60	548300	100.00	548487	99.70	548490	100.00	558627	100.00
559065	99.70	559333	100.10	559351	99.90	559445	100.20	559526	99.80
559662	100.00	560206	99.30	560249	100.20	560648	100.10	560728	99.60
560752	100.20	560787	100.20	560869	99.90	561268	100.10	561313	100.10
561385	100.10	575686	100.00	575784	100.30	575895	99.90	575986	100.30
576198	100.60	576334	100.20	576341	100.10	576375	100.10	576479	100.30
576626	100.70	576859	100.30	577109	100.20	577258	100.10	577427	100.10

INFORMATION NEEDED

VALUE OBTAINED

1 Sample Size (N)	75
2 Sum of Measurements: (Sum X)	7501.77
3 Sum of Squared Measurements	750359.55
4 Correction Factor (CF): Sum of Measurements Squared / N	750354.04
5 Corrected Sum of Squares (SS)	5.51
6 Variance (V) : SS/(N-1)	0.0744
7 Estimate of Lot Standard Deviation(S): SQRT of V	0.2728
8 Sample Mean(XBAR): Sum X/N	100.02
9 Upper Specification Limit (U)	102.00
10 Lower Specification Limit (L)	98.00
11 Quality Index Upper (QU): (U-XBAR) / S	7.24
12 Quality Index Lower (QL): (XBAR-L) / S	7.42
13 Estimate of Lot Percent NCF Above U (PU)	0.00
14 Estimate of Lot Percent NCF Below L (PL)	0.00
15 Total Estimate Percent NCF. In Lot (P): PU+PL	0.00
16 Maximum Allowable Percent NCF(M)	4.83
17 Acceptability Criterion: Compare P with M	PASS
18 The Lot Meets the Acceptability Criterion if P <= M	
19 The Lot Fails the Acceptability Criterion if P > M	

Louisville Gas and Electric

2014 Sample Test Program (01/01/2014) to (12/31/2014)

Device Category: F2S240V30AC200 Model Number: MSII Division: 01 Sample Lot: 1342 Lot Descr: LG&E MSII-3
 In Service Population: 10,000 Sample Quantity: 75 Meters Tested: 75 Pass/ Fail: PASS

Test Results Per ANSI/ASQC Z1.9-1993

Double Specification Limit - Variability Unknown - Standard Deviation Method
 One AQL Value for Both Upper and Lower Specification Limit Combined
 AQL = 2.5% - Inspection Level II "E" # Normal Inspection

Page 42
 Run Date: 01/07/2015
 Run Time: 03:37:18 AM

Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy
577467	100.00	577609	100.00	577684	100.30	577726	100.20	577984	100.10
578001	100.90	578188	100.20	578190	100.10	596101	100.10	596122	100.20
596539	99.80	596642	100.10	596789	100.00	596879	100.20	596895	100.00
597008	100.40	597152	100.00	597221	99.90	597301	100.00	597368	100.00
597694	100.10	597859	99.80	597876	99.80	598175	100.10	598204	99.90
598375	100.00	598383	100.00	598455	99.90	598686	100.00	598757	100.30
611611	99.80	611755	100.40	611774	100.90	611801	99.40	611888	100.20
612118	100.40	612148	99.86	612165	100.40	612191	100.30	612297	99.90
612348	100.20	612463	100.60	612752	100.60	612823	100.30	612825	100.10
613330	100.40	613508	100.70	613538	100.40	613670	100.20	613797	100.20
614796	99.70	615047	100.20	615115	100.00	615253	99.70	615290	100.20
615411	99.90	615557	100.50	615751	99.80	615825	99.70	616818	99.80
617129	100.30	617315	100.40	617450	99.50	617766	100.10	617806	99.90
617888	100.50	617890	100.30	617901	100.00	618204	99.30	618309	99.80
618363	100.70	618470	100.40	618554	100.20	618678	99.70	618968	100.20

INFORMATION NEEDED

VALUE OBTAINED

1 Sample Size (N)	75
2 Sum of Measurements: (Sum X)	7508.46
3 Sum of Squared Measurements	751700.02
4 Correction Factor (CF): Sum of Measurements Squared / N	751692.95
5 Corrected Sum of Squares (SS)	7.07
6 Variance (V) : SS/(N-1)	0.0955
7 Estimate of Lot Standard Deviation(S): SQRT of V	0.3090
8 Sample Mean(XBAR): Sum X/N	100.11
9 Upper Specification Limit (U)	102.00
10 Lower Specification Limit (L)	98.00
11 Quality Index Upper (QU): (U-XBAR) / s	6.11
12 Quality Index Lower (QL): (XBAR-L) / S	6.84
13 Estimate of Lot Percent NCF Above U (PU)	0.00
14 Estimate of Lot Percent NCF Below L (PL)	0.00
15 Total Estimate Percent NCF. In Lot (P): PU+PL	0.00
16 Maximum Allowable Percent NCF (M)	4.83
17 Acceptability Criterion: Compare P with M	PASS
18 The Lot Meets the Acceptability Criterion if P <= M	
19 The Lot Fails the Acceptability Criterion if P > M	

Louisville Gas and Electric

2014 Sample Test Program (01/01/2014) to (12/31/2014)

Device Category: F2S240V30AC200

Model Number: MSII

Division: 01

Sample Lot: 1343

Lot Descr: LG&E MSII-4

In Service Population: 10,000

Sample Quantity: 75

Meters Tested: 75

Pass/ Fail: PASS

Test Results Per ANSI/ASQC Z1.9-1993

Double Specification Limit - Variability Unknown - Standard Deviation Method

One AQL Value for Both Upper and Lower Specification Limit Combined

AQL = 2.5% - Inspection Level II "E" # Normal Inspection

Page 43

Run Date: 01/07/2015

Run Time: 03:37:18 AM

Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy
619280	100.50	619554	99.80	619589	100.90	619612	100.20	619887	100.30
619997	99.60	620028	100.10	620232	99.30	620243	99.70	620605	100.10
620719	100.10	621125	100.10	621604	99.40	621666	98.80	621687	99.10
622064	99.40	622275	99.80	622656	99.90	622772	99.50	622902	99.50
622934	100.50	623222	99.30	623323	100.40	636712	99.90	636865	99.80
637139	100.20	637180	100.20	637530	99.90	637900	100.00	637913	99.90
638102	100.28	638510	100.10	638541	99.90	638746	100.40	638978	100.10
638986	100.20	639111	99.80	639125	100.00	639265	100.10	639317	100.20
639451	100.20	645543	100.10	645606	100.10	645769	100.20	645900	99.80
645906	100.30	646045	100.40	646141	100.00	646279	100.00	646348	100.00
646453	99.90	646470	100.10	646505	100.20	646522	99.60	646581	99.90
646584	99.80	646679	99.90	646687	104.70	646955	100.30	647311	100.10
647317	100.20	647338	100.20	647429	100.00	647520	100.10	647602	100.10
647661	99.60	647893	99.70	648067	100.00	648084	100.00	648141	100.00
648281	99.90	648550	100.20	648659	100.20	648857	99.90	649299	100.00

INFORMATION NEEDED

VALUE OBTAINED

1 Sample Size (N)	75
2 Sum of Measurements: (Sum X)	7502.90
3 Sum of Squared Measurements	750610.25
4 Correction Factor (CF): Sum of Measurements Squared / N	750580.11
5 Corrected Sum of Squares (SS)	30.14
6 Variance (V) : SS/(N-1)	0.4073
7 Estimate of Lot Standard Deviation(S): SQRT of V	0.6382
8 Sample Mean(XBAR): Sum X/N	100.04
9 Upper Specification Limit (U)	102.00
10 Lower Specification Limit (L)	98.00
11 Quality Index Upper (QU): (U-XBAR) / S	3.07
12 Quality Index Lower (QL): (XBAR-L) / S	3.19
13 Estimate of Lot Percent NCF Above U (PU)	0.08
14 Estimate of Lot Percent NCF Below L (PL)	0.05
15 Total Estimate Percent NCF. In Lot (P): PU+PL	0.13
16 Maximum Allowable Percent NCF(M)	4.83
17 Acceptability Criterion: Compare P with M	PASS
18 The Lot Meets the Acceptability Criterion if P <= M	
19 The Lot Fails the Acceptability Criterion if P > M	

Louisville Gas and Electric

2014 Sample Test Program (01/01/2014) to (12/31/2014)

Device Category: F2S240V30AC200 Model Number: MSII Division: 01 Sample Lot: 1344 Lot Descr: LG&E MSII-5
 In Service Population: 10,000 Sample Quantity: 75 Meters Tested: 75 Pass/ Fail: PASS

Test Results Per ANSI/ASQC Z1.9-1993

Double Specification Limit - Variability Unknown - Standard Deviation Method

One AQL Value For Both Upper and Lower Specification Limit Combined

AQL = 2.5% - Inspection Level II "E" # Normal Inspection

Page 44

Run Date: 01/07/2015

Run Time: 03:37:18 AM

Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy
649752	100.00	650005	100.20	650245	100.10	650486	100.20	650765	100.20
650798	100.10	650803	100.20	650941	100.20	651011	100.40	651143	100.50
651349	99.90	651359	99.80	651421	100.00	651688	99.80	651782	100.20
652032	100.10	652288	100.00	652516	99.80	652534	100.20	652574	99.90
652721	100.00	652725	100.00	652741	100.10	652789	100.30	652811	100.00
652845	100.40	653166	99.90	653454	100.00	653552	100.10	653723	100.20
653826	100.30	653859	100.10	654145	100.30	658116	100.30	658133	100.60
658156	100.20	658461	100.40	658638	100.40	658675	100.40	658750	100.40
659090	100.30	659144	100.40	659251	100.30	659263	100.40	659370	100.10
659447	100.10	659449	100.10	660234	100.00	660237	100.10	660661	99.70
660668	100.20	660688	100.70	660789	100.30	660810	100.30	660930	100.00
671113	100.30	671214	100.20	671528	100.10	671653	99.40	671658	100.00
672023	99.90	672063	100.00	672083	100.20	672104	100.40	672287	100.00
672438	100.10	672864	100.10	672995	100.10	673147	100.10	673347	100.40
673800	100.20	673984	100.10	673996	100.30	674053	100.10	674064	100.10

INFORMATION NEEDED

VALUE OBTAINED

1 Sample Size (N)	75
2 Sum of Measurements: (Sum X)	7511.30
3 Sum of Squared Measurements	752264.91
4 Correction Factor (CF): Sum of Measurements Squared / N	752261.70
5 Corrected Sum of Squares (SS)	3.21
6 Variance (V) : SS/(N-1)	0.0433
7 Estimate of Lot Standard Deviation(S): SQRT of V	0.2082
8 Sample Mean(XBAR): Sum X/N	100.15
9 Upper Specification Limit (U)	102.00
10 Lower Specification Limit (L)	98.00
11 Quality Index Upper (QU): (U-XBAR) / S	8.88
12 Quality Index Lower (QL): (XBAR-L) / S	10.33
13 Estimate of Lot Percent NCF Above U (PU)	0.00
14 Estimate of Lot Percent NCF Below L (PL)	0.00
15 Total Estimate Percent NCF. In Lot (P): PU+PL	0.00
16 Maximum Allowable Percent NCF(M)	4.83
17 Acceptability Criterion: Compare P with M	PASS
18 The Lot Meets the Acceptability Criterion if P <= M	
19 The Lot Fails the Acceptability Criterion if P > M	

Louisville Gas and Electric

2014 Sample Test Program (01/01/2014) to (12/31/2014)

Device Category: F25240V30AC200 Model Number: MSII Division: 01 Sample Lot: 1345 Lot Descr: LG&E MSII-6
 In Service Population: 2,107 Sample Quantity: 50 Meters Tested: 50 Pass/ Fail: PASS

Test Results Per ANSI/ASQC Z1.9-1993

Double Specification Limit - Variability Unknown - Standard Deviation Method
 One AQL Value for Both Upper and Lower Specification Limit Combined
 AQL = 2.5% - Inspection Level II "E" # Normal Inspection

Page 45
 Run Date: 01/07/2015
 Run Time: 03:37:18 AM

Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy
674291	100.30	674296	100.00	674314	100.30	674371	100.00	674451	100.00
674609	100.10	674673	100.20	674691	100.00	674735	100.30	674765	100.40
674837	100.10	674885	100.20	674910	100.10	675006	100.30	675013	100.20
675166	100.10	675191	100.10	675192	100.20	675206	100.00	675228	100.30
675300	100.40	675333	100.20	675351	100.00	675508	100.30	675578	100.20
675627	100.20	675683	100.00	675694	99.80	675706	100.20	675798	100.20
675877	101.30	675879	100.20	675926	100.00	676008	100.10	676121	100.20
676152	100.20	676163	101.00	676178	100.00	676197	100.30	676235	100.10
676316	99.90	676337	99.90	676368	100.20	676375	100.40	676404	100.10
676452	100.00	676547	100.00	676550	100.00	676558	99.90	676624	100.10

INFORMATION NEEDED

VALUE OBTAINED

1 Sample Size (N)	50
2 Sum of Measurements: (Sum X)	5008.60
3 Sum of Squared Measurements	501724.48
4 Correction Factor (CF): Sum of Measurements Squared / N	501721.48
5 Corrected Sum of Squares (SS)	3.00
6 Variance (V) : SS/(N-1)	0.0612
7 Estimate of Lot Standard Deviation(S): SQRT of V	0.2475
8 Sample Mean (XBAR): Sum X/N	100.17
9 Upper Specification Limit (U)	102.00
10 Lower Specification Limit (L)	98.00
11 Quality Index Upper (QU): (U-XBAR) / S	7.39
12 Quality Index Lower (QL): (XBAR-L) / S	8.78
13 Estimate of Lot Percent NCF Above U (PU)	0.00
14 Estimate of Lot Percent NCF Below L (PL)	0.00
15 Total Estimate Percent NCF. In Lot (P): PU+PL	0.00
16 Maximum Allowable Percent NCF(M)	5.21
17 Acceptability Criterion: Compare P with M	PASS
18 The Lot Meets the Acceptability Criterion if P <= M	
19 The Lot Fails the Acceptability Criterion if P > M	

Louisville Gas and Electric

2014 Sample Test Program (01/01/2014) to (12/31/2014)

Device Category: F2S240V30AC200 Model Number: MK Division: 01 Sample Lot: 1346 Lot Descr: LGSE MK-1
 In Service Population: 10,000 Sample Quantity: 75 Meters Tested: 75 Pass/ Fail: PASS

Test Results Per ANSI/ASQC Z1.9-1993

Double Specification Limit - Variability Unknown - Standard Deviation Method

One AQL Value for Both Upper and Lower Specification Limit Combined

AQL = 2.5% - Inspection Level II "E" # Normal Inspection

Page 46

Run Date: 01/07/2015

Run Time: 03:37:18 AM

Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy
702483	100.00	702557	99.90	702745	100.20	702827	99.90	703123	98.80
703169	100.20	703288	99.70	703309	100.00	703364	100.10	703403	100.00
703416	100.00	703619	100.00	703624	99.80	703782	100.10	703792	100.10
703794	99.80	703896	99.80	703957	99.80	704442	100.00	704480	99.80
704577	99.80	704582	100.10	704614	99.80	704628	100.10	704878	99.90
705089	99.80	705110	100.00	708778	99.90	709251	100.00	709589	100.10
709742	100.10	709784	99.90	709803	99.90	710165	100.10	710770	99.70
710858	99.90	711701	99.90	712242	100.30	712481	99.80	712548	99.80
712713	99.60	712805	99.80	712958	99.90	713083	99.80	713211	99.90
713378	99.40	713643	99.90	713658	100.20	713757	99.80	713956	99.80
714117	100.20	714270	99.40	714328	99.70	714425	99.40	714541	100.00
714558	99.30	714678	99.80	714739	99.70	714838	99.90	715014	99.70
715249	99.60	715341	99.50	715342	99.90	715370	99.70	715475	99.80
715763	99.90	715794	99.90	715953	99.60	716025	99.60	716394	99.70
716433	99.70	716450	100.00	716463	99.70	716533	99.50	716554	99.70

INFORMATION NEEDED

VALUE OBTAINED

1 Sample Size (N)	75
2 Sum of Measurements: (Sum X)	7487.90
3 Sum of Squared Measurements	747586.17
4 Correction Factor (CF): Sum of Measurements Squared / N	747581.95
5 Corrected Sum of Squares (SS)	4.22
6 Variance (V) : SS/(N-1)	0.0570
7 Estimate of Lot Standard Deviation(S): SQRT of V	0.2387
8 Sample Mean(XBAR) : Sum X/N	99.84
9 Upper Specification Limit (U)	102.00
10 Lower Specification Limit (L)	98.00
11 Quality Index Upper (QU): (U-XBAR) / S	9.05
12 Quality Index Lower (QL): (XBAR-L) / S	7.70
13 Estimate of Lot Percent NCF Above U (PU)	0.00
14 Estimate of Lot Percent NCF Below L (PL)	0.00
15 Total Estimate Percent NCF. In Lot (P): PU+PL	0.00
16 Maximum Allowable Percent NCF(M)	4.83
17 Acceptability Criterion: Compare P with M	PASS
18 The Lot Meets the Acceptability Criterion if P <= M	
19 The Lot Fails the Acceptability Criterion if P > M	

Louisville Gas and Electric

2014 Sample Test Program (01/01/2014) to (12/31/2014)

Device Category: F2S240V30AC200

Model Number: MX

Division: 01

Sample Lot: 1347

Lot Descr: LG&E MX-2

In Service Population: 10,000

Sample Quantity: 75

Meters Tested: 75

Pass/ Fail: PASS

Test Results Per ANSI/ASQC Z1.9-1993

Double Specification Limit - Variability Unknown - Standard Deviation Method

One AQL Value for Both Upper and Lower Specification Limit Combined

AQL = 2.5% - Inspection Level II "E" # Normal Inspection

Page 47

Run Date: 01/07/2015

Run Time: 03:37:18 AM

Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy
716970	99.40	717254	99.50	717279	100.00	717458	99.30	717579	99.60
717589	99.80	717614	99.70	717634	99.60	717797	99.50	717826	99.50
717852	99.90	717992	99.80	718139	99.80	718147	100.00	718289	100.10
718290	99.70	718493	99.80	718576	99.70	718621	99.60	718766	99.70
718776	99.30	718793	99.60	718849	99.70	719070	99.50	719490	100.00
719813	100.00	719956	100.10	720087	99.70	720090	99.70	720222	99.80
720303	100.00	720307	99.70	721019	99.80	721210	99.60	721228	99.80
721438	100.00	721482	99.90	721550	99.80	721656	99.50	721698	99.70
721896	100.10	722308	99.40	722310	99.60	722317	100.00	722376	99.40
722441	99.90	722494	99.80	722558	99.80	722719	99.60	722817	99.70
722954	99.60	814751	99.40	814958	99.40	815000	99.60	815027	99.80
815070	99.60	815141	99.70	815254	99.70	815302	99.90	815365	99.70
815417	99.80	815972	99.40	816141	99.50	816337	99.40	816484	99.90
816805	99.50	817519	99.50	817630	99.80	817708	99.40	817955	99.70
818043	100.00	818061	99.90	818117	99.80	818163	99.80	819286	100.40

INFORMATION NEEDED

VALUE OBTAINED

1 Sample Size (N)	75
2 Sum of Measurements: (Sum X)	7478.70
3 Sum of Squared Measurements	745749.57
4 Correction Factor (CF): Sum of Measurements Squared / N	745746.05
5 Corrected Sum of Squares (SS)	3.52
6 Variance (V) : SS/(N-1)	0.0476
7 Estimate of Lot Standard Deviation(S): SQRT of V	0.2181
8 Sample Mean(XBAR): Sum X/N	99.72
9 Upper Specification Limit (U)	102.00
10 Lower Specification Limit (L)	98.00
11 Quality Index Upper (QU): (U-XBAR) / S	10.47
12 Quality Index Lower (QL): (XBAR-L) / S	7.87
13 Estimate of Lot Percent NCF Above U (PU)	0.00
14 Estimate of Lot Percent NCF Below L (PL)	0.00
15 Total Estimate Percent NCF. In Lot (P): PU+PL	0.00
16 Maximum Allowable Percent NCF(M)	4.83
17 Acceptability Criterion: Compare P with M	PASS
18 The Lot Meets the Acceptability Criterion if P <= M	
19 The Lot Fails the Acceptability Criterion if P > M	

Louisville Gas and Electric

2014 Sample Test Program (01/01/2014) to (12/31/2014)

Device Category: F2S240V30AC200 Model Number: MX Division: 01 Sample Lot: 134B Lot Descr: LG&E MX-3
 In Service Population: 10,000 Sample Quantity: 75 Meters Tested: 75 Pass/ Fail: PASS

Test Results Per ANSI/ASQC Z1.9-1993

Double Specification Limit - Variability Unknown - Standard Deviation Method

One AQL Value for Both Upper and Lower Specification Limit Combined

AQL = 2.5% - Inspection Level II "E" # Normal Inspection

Page 4B

Run Date: 01/07/2015

Run Time: 03:37:18 AM

Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy
819909	100.00	819994	99.80	820075	99.60	820522	98.70	820554	99.70
820572	99.30	820775	99.80	820779	100.00	820904	100.10	821046	100.10
821342	99.20	821515	99.40	821588	99.70	821709	99.40	821791	99.60
821835	99.80	821918	99.50	822003	99.60	822234	99.90	822262	99.70
822294	99.70	822442	99.30	822752	99.70	823086	99.60	824232	99.80
824287	99.70	824426	99.60	824507	99.60	824628	99.80	824667	99.90
825364	99.90	825502	99.50	825643	99.30	825734	99.70	825762	99.60
825875	99.90	826102	99.40	826127	99.50	826135	99.60	826239	99.60
826281	99.20	826359	99.80	826368	99.80	826514	99.90	826528	99.80
826778	99.40	826822	99.80	826941	99.90	827026	100.00	827213	99.70
827550	99.70	827617	99.40	827673	99.10	827805	99.70	828019	99.30
830618	99.70	830690	99.80	830716	99.30	831254	99.80	831309	99.40
831311	99.60	831440	99.20	831490	99.70	831552	99.60	836560	99.70
836579	100.00	836662	100.00	836784	100.00	836872	99.80	836955	99.90
837119	100.20	837289	99.90	837477	99.20	837491	100.00	837539	99.80

INFORMATION NEEDED

VALUE OBTAINED

1 Sample Size (N)	75
2 Sum of Measurements: (Sum X)	7474.70
3 Sum of Squared Measurements	744954.01
4 Correction Factor (CF): Sum of Measurements Squared / N	744948.53
5 Corrected Sum of Squares (SS)	5.48
6 Variance (V) : SS/(N-1)	0.0740
7 Estimate of Lot Standard Deviation(S): SQRT of V	0.2720
8 Sample Mean(XBAR): Sum X/N	99.66
9 Upper Specification Limit (U)	102.00
10 Lower Specification Limit (L)	98.00
11 Quality Index Upper (QU): (U-XBAR) / s	8.59
12 Quality Index Lower (QL): (XBAR-L) / s	6.11
13 Estimate of Lot Percent NCF Above U (PU)	0.00
14 Estimate of Lot Percent NCF Below L (PL)	0.00
15 Total Estimate Percent NCF. In Lot (P): PU+PL	0.00
16 Maximum Allowable Percent NCF(M)	4.83
17 Acceptability Criterion: Compare P with M	PASS
18 The Lot Meets the Acceptability Criterion if P <= M	
19 The Lot Fails the Acceptability Criterion if P > M	

Louisville Gas and Electric

2014 Sample Test Program { 01/01/2014 } to { 12/31/2014 }

Device Category: E2S240V30AC200

Model Number: MX

Division: 01

Sample Lot: 1349

Lot Descr: LG&E MX-4

In Service Population: 2,322

Sample Quantity: 50

Meters Tested: 50

Pass/ Fail: PASS

Test Results Per ANSI/ASQC Z1.9-1993

Double Specification Limit - Variability Unknown - Standard Deviation Method

One AQL Value for Both Upper and Lower Specification Limit Combined

AQL = 2.5% - Inspection Level II "E" # Normal Inspection

Page 49

Run Date: 01/07/2015

Run Time: 03:37:18 AM

Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy	Serial Number	Full Load Accuracy
837659	99.70	837664	99.70	837726	99.90	837765	99.70	837853	99.80
837862	99.90	837884	99.60	837936	99.90	838121	99.80	838155	99.60
839026	99.80	839027	99.90	839052	99.80	839123	100.10	839164	99.80
839184	100.30	839195	99.90	839291	99.60	839321	99.80	839407	99.90
839467	99.20	839476	100.00	839568	100.00	839573	99.70	839678	99.80
839799	100.00	839824	99.70	839841	99.80	839852	99.60	839882	99.80
839912	99.70	839966	99.70	840039	100.00	840075	101.40	840168	99.80
840204	100.20	840288	99.90	840342	99.70	840410	99.80	840423	99.80
840437	99.80	840523	100.10	840568	100.00	840605	100.10	840681	99.60
840735	99.80	840770	99.90	840783	99.80	840838	99.70	840859	99.80

INFORMATION NEEDED

VALUE OBTAINED

1 Sample Size (N)	50
2 Sum of Measurements: (Sum X)	4992.70
3 Sum of Squared Measurements	498545.09
4 Correction Factor (CF): Sum of Measurements Squared / N	498541.07
5 Corrected Sum of Squares (SS)	4.02
6 Variance (V) : SS/(N-1)	0.0821
7 Estimate of Lot Standard Deviation(S): SQRT of V	0.2866
8 Sample Mean(XBAR): Sum X/N	99.85
9 Upper Specification Limit (U)	102.00
10 Lower Specification Limit (L)	98.00
11 Quality Index Upper (QU): (U-XBAR) / S	7.49
12 Quality Index Lower (QL): (XBAR-L) / S	6.47
13 Estimate of Lot Percent NCF Above U (PU)	0.00
14 Estimate of Lot Percent NCF Below L (PL)	0.00
15 Total Estimate Percent NCF. In Lot (P): PU+PL	0.00
16 Maximum Allowable Percent NCF(M)	5.21
17 Acceptability Criterion: Compare P with M	PASS
18 The Lot Meets the Acceptability Criterion if P <= M	
19 The Lot Fails the Acceptability Criterion if P > M	

Louisville Gas and Electric
2014 Sample Test Program (01/01/2014) to (12/31/2014)

LOT NAME	MANUFACTURER	MODEL	IN-SERV POP	SAMP QTY	SET	REMV	MTRS TST	PASS/FAIL	LOT NUMBER
LG&E AB1-1	Westinghouse	AB1	159	15	0	0	15	PASS TESTING COMPLETE	1301
LG&E ALF-1	Landis + Gyr	ALF (Trilliant)	827	35	0	0	35	PASS TESTING COMPLETE	1302
LG&E CIS-1	Itron	CLSR (ERT)	10,000	75	0	0	75	PASS TESTING COMPLETE	1303
LG&E CIS-2	Itron	C1S	10,000	75	0	0	75	PASS TESTING COMPLETE	1304
LG&E CIS-3	Itron	C1S	10,000	75	0	0	75	PASS TESTING COMPLETE	1305
LG&E CIS-4	Itron	C1S	8,213	75	0	0	75	PASS TESTING COMPLETE	1306
LG&E D4S-1	Westinghouse	D4S	10,000	75	0	0	75	PASS TESTING COMPLETE	1307
LG&E D4S-2	Westinghouse	D4S	2,908	50	0	0	50	PASS TESTING COMPLETE	1308
LG&E I210-1	General Electric	I-210 (ERT)	1,102	35	0	0	35	PASS TESTING COMPLETE	1309
LG&E I50-1	General Electric	I-50S	1,055	35	0	0	35	PASS TESTING COMPLETE	1310
LG&E I55-1	General Electric	I-55S	1,368	50	0	0	50	PASS TESTING COMPLETE	1311
LG&E I60-1	General Electric	I-60S	10,000	75	0	0	75	PASS TESTING COMPLETE	1312
LG&E I60-2	General Electric	I-60S	2,768	50	0	0	50	PASS TESTING COMPLETE	1313
LG&E I70-1	General Electric	I-70S	10,000	75	0	0	75	PASS TESTING COMPLETE	1314
LG&E I70-2	General Electric	I-70S	10,000	75	0	0	75	PASS TESTING COMPLETE	1315
LG&E I70-3	General Electric	I-70S	10,000	75	0	0	75	PASS TESTING COMPLETE	1316
LG&E I70-4	General Electric	I-70S	10,000	75	0	0	75	PASS TESTING COMPLETE	1317
LG&E I70-5	General Electric	I-70S	10,000	75	0	0	75	PASS TESTING COMPLETE	1318
LG&E I70-6	General Electric	I-70S	10,000	75	0	0	75	PASS TESTING COMPLETE	1319
LG&E I70-7	General Electric	I-70S	10,000	75	0	0	75	PASS TESTING COMPLETE	1320
LG&E I70-8	General Electric	I-70S	10,000	75	0	0	75	PASS TESTING COMPLETE	1321
LG&E I70-9	General Electric	I-70S	10,000	75	0	0	75	PASS TESTING COMPLETE	1322
LG&E I70-10	General Electric	I-70S	5,503	75	0	0	75	PASS TESTING COMPLETE	1323
LG&E J4S-1	Itron	J4S	10,000	75	0	0	75	PASS TESTING COMPLETE	1324
LG&E J4S-2	Itron	J4ES	1,274	50	0	0	50	PASS TESTING COMPLETE	1325
LG&E J5S-1	Itron	J5S	10,000	75	0	0	75	PASS TESTING COMPLETE	1326
LG&E J5S-2	Itron	J5S	10,000	75	0	0	75	PASS TESTING COMPLETE	1327
LG&E J5S-3	Itron	J5S	10,000	75	0	0	75	PASS TESTING COMPLETE	1328
LG&E J5S-4	Itron	J5S	10,000	75	0	0	75	PASS TESTING COMPLETE	1329
LG&E J5S-5	Itron	J5S (R200)	10,000	75	0	0	75	PASS TESTING COMPLETE	1330
LG&E J5S-6	Itron	J5S	10,000	75	0	0	75	PASS TESTING COMPLETE	1331
LG&E J5S-7	Itron	J5S	10,000	75	0	0	75	PASS TESTING COMPLETE	1332
LG&E J5S-8	Itron	J5S	10,000	75	0	0	75	PASS TESTING COMPLETE	1333
LG&E J5S-9	Itron	J5S	10,000	75	0	0	75	PASS TESTING COMPLETE	1334
LG&E J5S-10	Itron	J5S	10,000	75	0	0	75	PASS TESTING COMPLETE	1335
LG&E J5S-11	Itron	J5S	10,000	75	0	0	75	PASS TESTING COMPLETE	1336
LG&E J5S-12	Itron	J5S	6,332	75	0	0	75	PASS TESTING COMPLETE	1337
LG&E MQS-1	Landis + Gyr	MQS	164	15	0	0	15	PASS TESTING COMPLETE	1338
LG&E MS-1	Landis + Gyr	MS	8,596	75	0	0	75	PASS TESTING COMPLETE	1339
LG&E MSII-1	Landis + Gyr	MSII	10,000	75	0	0	75	PASS TESTING COMPLETE	1340
LG&E MSII-2	Landis + Gyr	MSII	10,000	75	0	0	75	PASS TESTING COMPLETE	1341
LG&E MSII-3	Landis + Gyr	MSII	10,000	75	0	0	75	PASS TESTING COMPLETE	1342
LG&E MSII-4	Landis + Gyr	MSII	10,000	75	0	0	75	PASS TESTING COMPLETE	1343
LG&E MSII-5	Landis + Gyr	MSII	10,000	75	0	0	75	PASS TESTING COMPLETE	1344
LG&E MSII-6	Landis + Gyr	MSII	2,107	50	0	0	50	PASS TESTING COMPLETE	1345
LG&E MX-1	Landis + Gyr	MX	10,000	75	0	0	75	PASS TESTING COMPLETE	1346
LG&E MX-2	Landis + Gyr	MX	10,000	75	0	0	75	PASS TESTING COMPLETE	1347
LG&E MX-3	Landis + Gyr	MX	10,000	75	0	0	75	PASS TESTING COMPLETE	1348
LG&E MX-4	Landis + Gyr	MX	2,322	50	0	0	50	PASS TESTING COMPLETE	1349
TOTALS			384,698	3285	0	0	3285		

TOTAL LOTS PASSED: 49
TOTAL LOTS FAILED: 0
METERS CANNOT TEST: 0

Report completed successfully with results.