

STANDARD RATE SHEET

3rd Rev. SHEET NO. 67 OF P. S. C. of Ky. No. 1  
CANCELLING 2nd Rev. SHEET NO. 67 OF P. S. C. of Ky. No. 1

LOUISVILLE GAS AND ELECTRIC COMPANY

Special Terms and Conditions Governing the Supply of  
Reserve, Breakdown, Standby or Auxiliary Service Electric

All reserve, breakdown, standby or auxiliary service furnished by the Company to commercial and industrial customers whose premises or equipment are regularly supplied with electrical energy from a private generating plant shall be subject to the following special terms and conditions:

1. Contract Demand. Customer shall contract for a specified maximum kilowatt capacity based on an adequate and acceptable estimate of his prospective maximum service requirements as indicated by such factors as connected load, largest unit of equipment to be served, size of largest generating unit, required transformer capacity, previously recorded demands or test demands under full load conditions, etc. The maximum capacity thus contracted for, which in no case shall be for less than 10 kilowatts, will be checked by means of a suitable demand meter to be installed by the Company. In the event that the highest average load in kilowatts recorded in any fifteen minute interval by such demand meter exceeds the previously established or original contract demand, then such higher recorded demand shall automatically become the new contract demand commencing with the month in which it was recorded and continuing until superseded by a higher demand.

2. Metering. Metering and billing for reserve, breakdown, standby or auxiliary service shall be kept separate and distinct from the metering or billing for any regular service supplied exclusively by the Company at the same location. Each separate meter used to measure reserve, breakdown, standby or auxiliary service will be considered and billed as a separate customer, but customer has the option of arranging his wiring so as to permit the Company to supply all such service, whether used for light, power, or combined light and power purposes, through a single meter. Customer shall furnish and maintain any transformation or voltage regulatory equipment which may be necessary for lighting purposes when service is delivered at power voltage.

3. Rates. Reserve, breakdown, standby or auxiliary service will be supplied only under the Company's standard rate schedules GP, LC, and LP. In the case of loads involving maximum demands of not to exceed 200 kilowatts, customer may elect to take service under Rate GP or under Rate LC or LP,

APPROVED  
DEC 5 1957  
PUBLIC SERVICE COMMISSION  
ENGINEERING DIVISION

DATE OF ISSUE November 21, 1957

Meter readings taken on  
DATE EFFECTIVE and after Dec. 26, 1957

ISSUED BY G. R. Armstrong  
NAME

President  
TITLE

Louisville, Kentucky  
ADDRESS

Issued by authority of an order of the Public Service Commission of Ky., dated Nov. 26, 1957

STANDARD RATE SHEET

2nd Rev. SHEET NO. 67.1 OF P. S. C. of Ky. No. 1  
CANCELLING 1st Rev. SHEET NO. 67.1 OF P. S. C. of Ky. No. 1

LOUISVILLE GAS AND ELECTRIC COMPANY

Special Terms and Conditions Governing the Supply of  
Reserve, Breakdown, Standby or Auxiliary Service (Cont.) Electric

depending on the suitability and applicability of each of these rates for the class and character of the service to be supplied. Loads involving maximum demands in excess of 200 kilowatts will not be served under Rate GP and must be taken under appropriate Rate LC or LP.

In no case shall the monthly billing demand used in the determination of demand charges under Rates LC and LP be taken as less than 50% of the customer's original or subsequently established contract demand.

4. Minimum Monthly Charge. The monthly charge for reserve, breakdown, standby or auxiliary service as determined in accordance with the demand and energy charges of the rate under which service is taken shall be subject to a minimum monthly guarantee by the customer (whether or not service is actually used during the month) of \$2.00 net per kilowatt for the first 20 kilowatts of contract demand, plus \$1.50 net per kilowatt for any excess over 20 kilowatts of contract demand. In no case shall the contract demand used for such minimum monthly guarantee purposes be taken as less than 10 kilowatts nor less than either the maximum kilowatt demand contracted for or the highest average load in kilowatts recorded by Company's demand meter during any fifteen minute interval in that portion of the contract period ending with the month for which bill is rendered.

5. Power Factor. Customer will be required at all times to maintain a power factor of not less than 80% lagging. If customer's power factor is less than 80% he will be required to install suitable accessory equipment to correct same to at least 80% as a condition precedent to continuation of Company's service.

6. Intermittent or Fluctuating Loads. In the event customer's use of service is intermittent or subject to violent fluctuations the Company will require customer to install and maintain at his own expense suitable equipment to satisfactorily limit such intermittence or fluctuation.

7. Parallel Operation Not Permitted. Parallel operation of customer's private generating plant with Company's service will not be permitted, and customer's wiring must be so arranged that such parallel operation will not be possible.

APPROVED  
DEC 5 1957  
PUBLIC SERVICE COMMISSION  
ENGINEERING DIVISION  
G. R. Armstrong  
President

DATE OF ISSUE November 27, 1957 DATE EFFECTIVE and after Dec. 26, 1957  
ISSUED BY G. R. Armstrong, President Louisville, Kentucky  
NAME ADDRESS

Issued by authority of an order of the Public Service Commission of Ky., dated Nov., 26, 1957

STANDARD RATE SHEET

2nd Rev. SHEET NO. 67.2 OF P. S. C. of Ky. No. 1  
CANCELLING 1st Rev. SHEET NO. 67.2 OF P. S. C. of Ky. No. 1

LOUISVILLE GAS AND ELECTRIC COMPANY

Special Terms and Conditions Governing the Supply of  
Reserve, Breakdown, Standby or Auxiliary Service (Cont.) Electric


8. Overload Protection. In order to protect its equipment from overload damage, Company may require customer to install at his own expense an approved type of automatic circuit breaker contained in an approved type of locked steel enclosure. Such circuit breaker shall be under the sole control of the Company and will be set by the Company to break the connection with its service in the event customer's demand, at 80% power factor, materially exceeds that contracted for.

9. Primary Service to Large Loads. As a condition precedent to the supply of reserve, breakdown, standby or auxiliary service to customers with loads involving transformer installations in excess of 300 Kva Company may require such customers to furnish their own substation facilities and purchase service at primary voltage.

10. Contract Period. The minimum contract period shall be one year continuing from month to month thereafter, but Company may require that contract be executed for a longer initial term when deemed necessary by the size of load or special conditions.

11. Application of Company's General Rules. Such of the Company's general rules and regulations as are not in conflict or inconsistent with the special provisions herein prescribed shall likewise apply to reserve, breakdown, standby or auxiliary service.

6-6-62

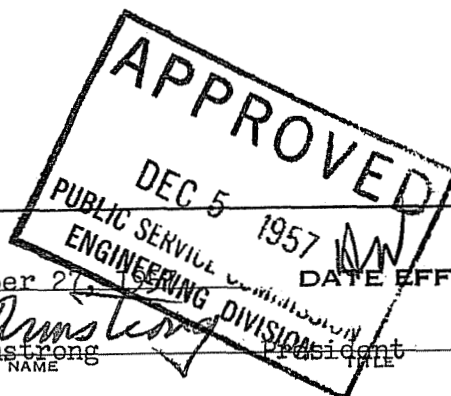

DATE OF ISSUE November 27, 1957 DATE EFFECTIVE Meter readings taken on and after Dec. 26, 1957  
ISSUED BY G. R. Armstrong President Louisville, Kentucky

Issued by authority of an order of the Public Service Commission of Ky., dated Nov. 26, 1957